

2015 Annual Groundwater Monitoring Report

Univar USA, Inc.
8201 South 212th Street
Kent, Washington
Agreed Order No. DE5988

Prepared for
Univar USA Inc.
Job No.: 60478408
February 29, 2016

Table of Contents

1 INTRODUCTION	1
2 BACKGROUND	2
3 GROUNDWATER MONITORING ACTIVITIES	3
3.1 MONITORING NETWORK	3
3.2 GROUNDWATER ELEVATIONS AND FLOW	3
3.3 GROUNDWATER SAMPLING	3
3.4 LABORATORY ANALYTICAL METHODS	4
4 GROUNDWATER QUALITY	5
4.1 GROUNDWATER ANALYTICAL RESULTS AND CONCLUSIONS	5
4.1.1 Shallow Groundwater Zone	5
4.1.2 Deep Groundwater Zone	7
4.2 ANALYTICAL DATA VALIDATION AND REVIEW	9
5 SUMMARY OF CONCLUSIONS AND RECOMMENDATIONS FOR 2016	12
5.1 SHALLOW GROUNDWATER ZONE SUMMARY	12
5.2 DEEP GROUNDWATER ZONE SUMMARY	12
5.3 RECOMMENDATIONS FOR 2016	12
6 REFERENCES	13

List of Appendices

Appendix A	Historical Groundwater Elevation Data
Appendix B	Historical Field Parameters and Groundwater Analytical Data (Indicator Hazardous Substances, General Chemistry, Dissolved Gases, and Fatty Acids)
Appendix C	Analytical Data Plots of Constituents and Microbial Populations
Appendix D	Groundwater Sampling Field Forms, Data Validation Reports, and Analytical Lab Reports

List of Tables

Table 1	Groundwater Elevations
Table 2	Field Parameters
Table 3	Indicator Hazardous Substances in Groundwater
Table 4	Total Organic Carbon and Dissolved Organic Gases in Groundwater
Table 5	Groundwater Microbiological Test Results

List of Figures

Figure 1	Site Location Map
Figure 2	Monitoring Well Locations
Figure 3	Injection Point Locations
Figure 4	Groundwater Contour Map – Shallow Zone, March 16-17, 2015
Figure 5	Groundwater Contour Map – Shallow Zone, September 13-14, 2015
Figure 6	Groundwater Contour Map – Deep Zone, March 16-17, 2015
Figure 7	Groundwater Contour Map – Deep Zone, September 13-14, 2015
Figure 8	Benzene Concentrations in Shallow Groundwater
Figure 9	Chloroethane Concentrations in Shallow Groundwater
Figure 10	Tetrachloroethene Concentrations in Shallow Groundwater
Figure 11	Trichloroethene Concentrations in Shallow Groundwater
Figure 12	Vinyl Chloride Concentrations in Shallow Groundwater
Figure 13	Benzene Concentrations in Deep Groundwater
Figure 14	Toluene Concentrations in Deep Groundwater
Figure 15	1,1-Dichloroethane Concentrations in Deep Groundwater
Figure 16	Chloroethane Concentrations in Deep Groundwater
Figure 17	cis-1,2-Dichloroethene Concentrations in Deep Groundwater
Figure 18	Vinyl Chloride Concentrations in Deep Groundwater

List of Acronyms

AECOM	AECOM Technical Services
AO	agreed order
bgs	below ground surface
CA	cleanup action
cis-1,2-DCE	cis-1,2-dichloroethene
CMP	compliance monitoring plan
CUL(s)	cleanup level(s)
DCA	dichloroethane
DCE	dichloroethene
DO	dissolved oxygen
Ecology	Washington State Department of Ecology
EDR	engineering design report
Dhb	<i>dehalobacter</i>
Dhc	<i>dehalococcoides</i>
IHS	indicator hazardous substances
mg/L	milligrams per liter
MDL	method detection limit
MRL	method reporting limit
ORP	oxidation-reduction potential
PCE	tetrachloroethene
PCR	polymerase chain reaction
PES	PES Environmental, Inc.
TCE	trichloroethene
TOC	total organic carbon
TPH	total petroleum hydrocarbons
URS	URS Corporation
<i>vcrA</i>	<i>vinyl chloride reductase</i>
VOC(s)	volatile organic compound(s)
1,1-DCA	1,1-dichloroethane
1,1-DCE	1,1-dichloroethene
µg/L	micrograms per liter

1 INTRODUCTION

This 2015 annual groundwater monitoring report has been prepared by AECOM on behalf of Univar USA Inc. (Univar) pursuant to the requirements of Agreed Order No. DE 5988 (AO) between Univar and the Washington State Department of Ecology (Ecology), effective November 20, 2008.¹ URS Corporation assumed the role of Univar's environmental consultant on June 1, 2013. AECOM acquired URS on October 17, 2014.

This report presents data collected and activities performed at the Univar Kent Site (Site) located at 8201 South 212th Street, Kent, Washington (Figure 1), during the period January 1 through December 31, 2015. The 2015 groundwater monitoring at the Site was conducted consistent with the *Compliance Monitoring Plan (CMP)*, which was submitted to Ecology as an appendix to the Engineering Design Report (EDR; PES, 2010). Per Task 4 of the AO Scope of Work, this report provides an overview of the status of groundwater monitoring at the Site, including tabulated groundwater data, water level contour maps, isoconcentration contour maps, field forms, laboratory analytical data; and a discussion of data validation, water quality data, and data trends.

¹ Washington State Department of Ecology. 2008. *Agreed Order No. DE5988, Univar USA Inc., 8201 South 212th Street, Kent, WA 98032*. November 20.

2 BACKGROUND

Groundwater was sampled at the Site from 1995 through 2009 consistent with the sampling procedures outlined in the groundwater investigation work plan (EMCON 1996) and from 2009 through 2010 consistent with the sampling procedures outlined in the Groundwater Monitoring Plan (PES 2009a). Groundwater monitoring was conducted on a quarterly basis from 1996 until 2003. The monitoring frequency was reduced from quarterly to semi-annually in 2004. Prior to 1999, groundwater was sampled at the Site by purging three well pore volumes using a high capacity peristaltic pump, allowing the field parameters (temperature, pH, specific conductance, dissolved oxygen [DO], and turbidity) to stabilize, and collecting a sample using the pump tubing and a disposable bailer. Since June 1999, groundwater samples were collected using low-flow sampling techniques. Groundwater samples were initially analyzed for constituents that were historically stored or handled at the Site, including total petroleum hydrocarbons (TPH) and volatile organic compounds (VOCs). The analyte list was reduced in 2004 based on analytical data demonstrating low concentrations of certain constituents, and from 2004 to 2010, groundwater was monitored semi-annually for VOCs only. The monitoring well locations are shown on Figure 2.

Implementation of the final cleanup action (CA) was initiated at the Site with the performance of an injection test in 2010. The full-scale injection program was conducted in late 2010 through early 2011, including injection of emulsified oil as a carbon substrate and injection of a microbial consortium containing *Dehalobacter* (Dhb) and *Dehalococcoides* (Dhc) bacteria into both shallow and deep injection wells and direct push injection points. The intent of the injection program was to stimulate the enhanced reductive dechlorination of the chlorinated VOCs found in the shallow MW-5 source area and the deeper MW-13/MW-21 source area. The locations of the injection wells are shown on Figure 3.

Groundwater performance monitoring was initiated in March 2011 consistent with the CMP and EDR (PES 2010). It was conducted to evaluate two aspects of the cleanup action: substrate injection and groundwater quality. Substrate injection performance monitoring was conducted at selected wells within the injection and monitoring well networks to confirm that the injected substrate is producing conditions conducive to reductive dechlorination. Two years of quarterly performance monitoring was completed in March 2013, consistent with the CMP. Groundwater performance monitoring is currently conducted semi-annually (March and September). The monitoring includes semi-annual monitoring for VOCs in all CMP wells; semi-annual monitoring for substrate distribution, and natural attenuation parameters in selected wells; and periodic monitoring for the presence of microbes in selected wells.

Groundwater performance monitoring is also being conducted to assess how the cleanup action is affecting the groundwater quality in and downgradient of the source treatment areas. Two new deep monitoring wells, MW-27 and MW-28, were installed in the north area of the monitoring well network in September 2014 to provide further delineation of the plume downgradient of the source treatment areas.

Performance monitoring will be conducted until groundwater cleanup levels have been achieved for Site indicator hazardous substances (IHS) at the point of compliance (defined in the AO as the downgradient property boundary).

An evaluation of the performance of the CA (enhanced reductive dechlorination) was completed in November 2014 and documented in a technical memorandum (URS 2014b). Recommendations provided in the technical memorandum included continuing to monitor and review the semi-annual groundwater analytical data and to evaluate the efficacy of conducting another injection event downgradient of the deep zone source area. Given that groundwater concentrations were generally decreasing at the Site before and after injections (with notable exceptions in post-injection "daughter" product accumulation), if groundwater monitoring data from off-property wells do not show increasing trends, then natural attenuation may still be appropriate for the off-property plume.

3 GROUNDWATER MONITORING ACTIVITIES

3.1 MONITORING NETWORK

There are currently a total of 27 monitoring wells and one piezometer installed at the Site. The groundwater monitoring network specified in the CMP includes 22 monitoring wells and one piezometer as illustrated in Figure 2. There are an additional five monitoring wells installed; three wells are used for collecting water levels and two wells were installed in September 2014. The following describes the monitoring wells and piezometer that are installed at the Site:

- Twelve of the monitoring wells specified in the CMP (MW-1 through MW-10, MW-12, and MW-23) are installed in the upper portion of the shallow aquifer (between 4 and 20 feet below ground surface [bgs]) and are designated shallow zone monitoring wells.
- Ten of the monitoring wells specified in the CMP (MW-13 through MW-22), two wells installed in 2014 (MW-27 and MW-28), and the piezometer (P-1) are installed at the base of the shallow aquifer (between approximately 32 and 49 feet bgs) and are designated deep zone monitoring wells. MW-27 and MW-28 were installed in September 2014 to provide further delineation of the downgradient portion of the deep zone groundwater plume.
- Three additional wells, one designated shallow (MW-11) and two designated deep (MW-24 and MW-25), are not specified in the CMP but are used for collecting water levels only.

All of the monitoring points, with the exception of MW-20 and MW-27, are located on the Univar property. The two off-site wells are located on the north side of South 212th Street.

The 22 CMP monitoring wells and MW-27 and MW-28 are monitored for VOCs to evaluate the effects of the CA on groundwater quality. Shallow zone wells MW-1 and MW-4 are also used to monitor natural attenuation east of the eastern loading dock. Four shallow zone wells (MW-5, MW-7, MW-12, and MW-23) and six deep zone wells (MW-13, MW-17, MW-18, MW-19, MW-21, and MW-22) are also used to monitor substrate injection performance (distribution and reducing conditions). The CMP originally designated nine substrate performance monitoring wells but a tenth well (MW-19) was added in 2012 to aid in the evaluation of the effects of substrate injection further downgradient from the initial network.

3.2 GROUNDWATER ELEVATIONS AND FLOW

Table 1 presents the depth to groundwater measurements and calculated groundwater elevations for the monitoring events conducted in March and September 2015. Historical groundwater elevation data (prior to 2015) for each monitoring location are provided in Appendix A. Figures 4 and 5 present the shallow zone groundwater elevation contour maps for March and September, respectively. Figures 6 and 7 present the deep zone groundwater elevation contour maps for March and September, respectively. The shallow groundwater elevations and contours were similar to historical data, with the shallow groundwater gradient (approximately 0.003 feet/foot to 0.005 feet/foot) oriented to the north-northeast away from the highest measured groundwater levels (groundwater mound) located near MW-1 and MW-4. The deep groundwater elevations and contours were also similar to historical data, with the deep groundwater gradient oriented toward the northwest. The effects of the shallow groundwater mound were not seen in the deep groundwater zone contours. As in previous years, the deep potentiometric surface was flat (with a hydraulic gradient less than 0.001 feet/foot), and the inferred groundwater flow was toward the northwest.

3.3 GROUNDWATER SAMPLING

All groundwater monitoring and sampling was conducted consistent with the procedures described in the CMP unless otherwise noted. In 2015, groundwater levels were measured on March 16th and 17th and September 13th and 14th in the CMP monitoring wells. Consistent with the CMP, the 22 network monitoring wells and two downgradient monitoring wells were sampled for VOC analysis in two semi-annual events in 2015: March (March 16 through March

19) and September (September 16 through September 19). Consistent with the CMP, samples collected in the September event from seven wells (MW-5, MW-7, MW-12, MW-13, MW-21, MW-22, and MW-23) plus one additional well (MW-19 to provide additional data) were analyzed for the presence of microbes using the polymerase chain reaction (PCR) test.

Field parameters measured during sampling included temperature, pH, specific conductance, DO, and oxidation-reduction potential (ORP) and are summarized in Table 2.

3.4 LABORATORY ANALYTICAL METHODS

Samples collected for laboratory analysis were submitted to Accutest Laboratories in San Jose, California for the following analyses: VOCs, total organic carbon, dissolved gases, and microbial testing. SiREM Laboratory based in Guelph, Ontario (Canada) performed the microbiological testing as a subcontractor to Accutest. The following laboratory methods were used:

- VOCs including chlorinated and aromatic hydrocarbons by USEPA Method 8260
- Total organic carbon (TOC) by USEPA SM 5310B
- Natural attenuation parameters:
 - Dissolved gases (ethene, ethane, and methane) by RSK 190
- Microbiological Parameters by SiREM quantitative PCR method (Gene-Trac[®])
 - Dehalococcoides (Dhc)
 - Dehalobacter (Dhb)
 - Vinyl chloride reductase (*vcrA*)

Samples collected during all monitoring events were submitted to the laboratories under the protocols outlined in the CMP. Microbiological samples were collected with low flow sampling techniques using a protocol and filters provided by SiREM. Field parameters, sampling times, and observations were recorded on groundwater sampling forms. Copies of the groundwater sampling forms, analytical lab reports, and data validation reports from each sampling event are provided in Appendix E.

4 GROUNDWATER QUALITY

4.1 GROUNDWATER ANALYTICAL RESULTS AND CONCLUSIONS

The tabulated chemistry results from 2010 (pre-injection testing) through the September 2015 monitoring event (including field parameters, VOCs, TOC, microbiological activity, and dissolved gases) are presented in Tables 2 through 5. Table 3 provides the laboratory VOC results for the 17 groundwater IHSs established in the Revised Remedial Investigation, Focused Feasibility Study Addendum, and Draft Cleanup Action Plan (PES 2009b), as well as the cleanup level (CUL) established for each IHS.

Historical field parameter measurements, general chemistry, and VOC results for all wells are presented in Appendix B in Tables B-1 through B-5. Appendix C provides plots showing the concentrations of select VOCs over time (Figures C1-C44) and along an inferred groundwater path through the deep treatment area (Figures C45-C48). The VOCs presented include 1,1,1-trichloroethane (TCA), tetrachloroethene (PCE), and breakdown products: 1,1-dichloroethane (1,1-DCA), 1,1-dichloroethene (1,1-DCE), chloroethane, trichloroethene (TCE), cis-1,2-dichloroethene (cis-1,2-DCE), and vinyl chloride. Select wells (MW-16, MW-17, MW-19, and MW-20) within or near the deep groundwater benzene plume also include results for benzene (Figures C31, C33, C37, and C39, respectively). Appendix C also provides microbial and vinyl chloride concentration graphs of 2015 and the previous three years (Figures C49-C51).

Figures 8 through 18 present isoconcentration contour maps for selected IHSs present in the shallow and deep groundwater zones in 2015. The isoconcentration contours are based on the highest IHS concentrations detected in each well during the 2015 monitoring period. IHS isoconcentration maps in shallow and deep aquifer zones were selected to:

- i. Represent the most widely distributed compounds detected in groundwater at the Site
- ii. Represent the most prominent compound from each of the three contaminant classes (aromatic, chlorinated ethanes, and chlorinated ethenes) present in groundwater in 2015
- iii. Illustrate the degradation pathways of source compounds, if possible

Five compounds (benzene, chloroethane, PCE, TCE, and vinyl chloride) were contoured for the shallow groundwater zone, and six compounds (benzene, toluene, 1,1-DCA, chloroethane, cis-1,2-DCE, and vinyl chloride) were contoured for the deep groundwater zone.

Following are discussions of the water quality data for the shallow and deep groundwater zones.

4.1.1 Shallow Groundwater Zone

During the 2015 monitoring period, one or more VOCs were detected above the applicable CULs in seven of the twelve shallow monitoring wells sampled (MW-1, MW-4, MW-5, MW-7, MW-8, MW-12, and MW-23). VOCs were not detected above the CULs in five shallow monitoring wells (MW-2, MW-3, MW-6, MW-9, and MW-10). The established VOC CULs for IHS in groundwater are provided in Table 3.

VOC concentrations in 2015 for the shallow groundwater zone (Table 3) were generally consistent with or lower than historical results. Concentrations of VOCs decreased significantly relative to recent years in monitoring well MW-1, MW-4, and MW-5 for one or more of the following constituents: TCE, cis-1,2-DCE, vinyl chloride, 1,1,1-TCA, and/or 1,1-DCA. The most dramatic change in concentrations in 2015 occurred in well MW-1. As shown by the isoconcentrations in Figures 9-12, the shallow plumes for chloroethane, PCE, TCE, and vinyl chloride were significantly reduced in area and/or in concentrations during 2015.

The plots of VOC concentrations over time in individual shallow groundwater zone monitoring wells (Figures C1 to C24, Appendix C) indicate that:

- VOC concentrations are generally decreasing over time in the source area wells (MW-1, MW-4, MW-5, and MW-12). In 2015, concentrations were within range of historical values with the following exceptions:
 - In well MW-1, concentrations of TCE and cis-1,2-DCE were significantly lower than concentrations in recent years (Figures C1-C2). During the March 2015 event, concentrations of TCE and cis-1,2-DCE were the lowest concentrations measured in MW-1 since monitoring began in 1996; concentrations rebounded slightly during the September 2015 event, but continue to show an overall decreasing trend. Concentrations of 1,1,1-TCA and 1,1-DCA were also the lowest concentrations measured since the beginning of monitoring.
 - In well MW-4, concentrations of 1,1-DCA were below pre-injection concentrations, as well as the lowest concentrations measured since the beginning of monitoring (Figures C7-C8).
 - In well MW-5, concentrations of cis-1,2-DCE continue to be greater than pre-injection concentrations; however, in 2015, the concentrations of cis-1,2-DCE decreased significantly in comparison to recent years (Figures C9-C10).
 - In well MW-12, concentrations of PCE and TCE showed consistent decreasing trends from pre-injection concentrations, with overall decreasing trends (Figures C21-C22).
- Breakdown product concentrations (chloroethane and vinyl chloride) have typically fluctuated or slightly increased in recent years in wells MW-1, MW-4, MW-5, and MW-12, which is consistent with the degradation of parent products in the source area. During March 2015, the concentration of vinyl chloride in MW-1 was the lowest concentration detected since the beginning of monitoring in 1996; while the concentration rebounded during the September 2015 event, the concentrations of vinyl chloride continue to show an overall decreasing trend (Figure C1).
- Variable to decreasing VOC concentrations over time near the shallow source area (MW-7, MW-8, MW-9, and MW-23).
- Relatively steady VOC concentrations at non-detectable to low levels in wells away from the source areas (MW-2, MW-3, MW-6, and MW-10).

The 2015 field parameter results (Table 2) and TOC results (Table 4) were generally within historical ranges.

Results for TOC in source area wells MW-5 and MW-12 and adjacent well MW-7 continue to show slightly increased concentrations of TOC, although the concentrations in MW-5 and MW-12 have stabilized within recent years and MW-7 shows seasonal fluctuations. In well MW-22, adjacent to the source area, TOC concentrations have also stabilized in recent years. In wells MW-5 and MW-12, methane concentrations continue to be orders of magnitude above pre-injection event concentrations (Table 4). For MW-5, the methane concentration has decreased by an order of magnitude in September 2014 and has remained relatively stable throughout 2015. Ethene and ethane concentrations continue to be modestly above pre-injection levels in MW-12. In MW-5, ethene and ethane were not detected in 2015. One well adjacent to the MW-5 source area (MW-23) shows continued methane concentrations above pre-injection event concentrations; however, in another adjacent well (MW-7), methane concentrations are fluctuating and near pre-injection levels.

Groundwater monitored since CA implementation has generally shown trends indicative of biodegradation in source area wells MW-5 and MW-12 and nearby wells MW-7 and MW-23:

- Initially increased concentrations of TOC after substrate injection with decreasing to steady concentrations of TOC thereafter;
- Steady to somewhat increased concentrations of dissolved gases (methane, and to a lesser degree, ethene and ethane); and
- ORP does not appear to have decreased significantly as would be expected after substrate injections; however, DO has decreased modestly since injection events.

Dissolved iron, dissolved manganese, alkalinity, nitrate, and sulfate were monitored during the substrate injection performance monitoring period, which was completed after two years of monitoring in 2013 (Table B-3). The final

2013 general chemistry results generally indicated increased concentrations of dissolved iron, dissolved manganese, and alkalinity and decreased concentrations of nitrate and sulfate. These trends were indicative of biodegradation in the MW-5 source area.

Similar to the 2013 results, the concentrations of *Dhc*, *Dhb*, and *vcrA* were low in shallow zone source area monitoring well MW-5 and nearby monitoring wells MW-7 and MW-23; specifically, the 2015 concentrations were at or less than 10^3 cells/liter or gene copies/liter. Concentrations were also low in source area monitoring well MW-12 at less than 10^5 cells/liter or gene copies/liter). In general, the concentration of microbes has decreased or remained relatively low from initial concentrations in 2011 and 2012.

4.1.2 Deep Groundwater Zone

During the 2015 monitoring period, one or more VOCs were detected above the applicable CULs in six of the twelve deep monitoring wells sampled in 2015 (MW-13, MW-17, and MW-19 through MW-22). VOCs were not detected above the CULs in six of the deep monitoring wells (MW-14 through MW-16, MW-18, MW-27, and MW-28). The number of VOCs detected above the CULs in the remaining six deep monitoring wells ranged from one (MW-19) to four (MW-21) in the source area. Ten of the 17 IHS VOCs (1,1-DCA, 1,1-DCE, 1,2,4-trimethylbenzene [TMB], 1,2-dichloropropane [DCP], chloroform, methylene chloride, PCE, 1,1,1-TCA, TCE, and toluene) were not detected above their respective CULs in deep groundwater zone wells in 2015. Chloroethane was detected above the CUL most frequently, with detections above CULs in five deep groundwater monitoring wells. Vinyl chloride and benzene were also detected above the CUL, with exceedances of the CUL in three wells each.

Similar to historical trends, the dominant VOCs detected in the MW-13/MW-21 source area in 2015 included toluene, ethylbenzene, total xylenes, PCE and TCE breakdown products (cis-1,2-DCE and vinyl chloride), and the TCA breakdown products (1,1-DCA and chloroethane). However, breakdown product concentrations appear to be declining or to be stabilizing at low concentrations in the source area, particularly cis-1,2-DCE, vinyl chloride, and 1,1-DCA in MW-13. In 2015, the concentration of vinyl chloride in MW-13 rebounded to slightly above the CUL after being below detection levels for four previous sampling events. As shown in Figures 13 through 18, the highest concentrations of VOCs in the deep groundwater zone generally are in the deep source area (near wells MW-13, MW-21, and MW-22), with progressively decreasing concentrations of VOCs in downgradient wells. In general, VOC concentrations have decreased at monitoring well MW-13 and MW-22 since 2010, with some rebound of PCE daughter products (cis-1,2-DCE and vinyl chloride), narrowing the extent of the contaminant plume and isolating high concentrations around the source area wells.

The plots of VOCs over time in individual deep groundwater zone monitoring wells (Figures C25-C48, Appendix C) indicate that:

- VOC concentration trends are generally decreasing over time in the source area wells (MW-13 and MW-21) and the well immediately downgradient of the source area (MW-22), with the following key trends and/or exceptions:
 - In well MW-13, concentrations of 1,1-DCA in 2015 were below pre-injection concentrations, as well as, the lowest concentrations detected since monitoring began at the well in 2003 (Figure C26). Concentrations of breakdown product chloroethane in 2015 were also significantly lower than recent years and the lowest concentrations detected since 2011.
 - In well MW-21, concentrations of cis-1,2-DCE and vinyl chloride in 2015 were below pre-injection concentrations and were the lowest concentrations detected since monitoring began at the well in 2006 (Figure C41). Concentrations of 1,1-DCA in 2015 also continued to show a consistent decreasing trend that were the lowest detected concentrations since monitoring began (Figure C42).
 - In well MW-22, concentrations of cis-1,2-DCE and vinyl chloride in 2015 increased from the 2014 historical lows, but were within range of concentrations in recent years (Figure C43). During the September 2015 event, the concentration of 1,1-DCA was the lowest concentration detected since monitoring began in the well in 2006 (Figure C44). Concentrations of chloroethane were also the lowest concentrations detected in recent years (since 2013) and continue to show a consistent and decreasing trend.
- VOC concentrations continued to fluctuate within the range of historical concentrations in wells further downgradient of the source area (MW-17 and MW-18). However, during the September 2015 event, the

concentration of breakdown product chloroethane in MW-18 was the lowest concentration since being non-detectable in 2012 (Figure C36).

- Concentrations of breakdown products (cis-1,2-DCE and vinyl chloride) in downgradient well MW-19 have continued to decrease significantly since mid-2013, with the exception of chloroethane (Figures C37-C38). Breakdown product concentrations increased significantly between 2010 and mid-2013, but have shown a consistent decreasing trend in recent years to near or below pre-injection event concentrations. Breakdown product chloroethane in MW-19 has been variable over time, with increasing concentrations in recent years.
- Chlorinated VOCs in off-property downgradient well MW-20 have been generally stable at low to non-detect concentrations with the exception of benzene and chloroethane, which continue to be detected at concentrations greater than the respective CULs (Figures C39-C40).
- VOC concentrations have been steady at non-detectable to low levels in wells away from the source area (MW-14, MW-15, and MW-16) (Figures C27-C32).
- VOC concentrations have been steady at non-detectable to low levels in wells MW-27 and MW-28, which were installed in September 2014 (Figures C45-C48). During 2015, 5 VOCs (1,1-DCA, chloroethane, cis-1,2-DCE, toluene, and total xylenes) were detected but below the CULs in one or both of the wells.

Plots of chlorinated VOC concentrations along a groundwater flow path through the deep source area for March and September 2015 (Figures C49-C52, Appendix C) generally show the following:

- Non-detectable to low concentrations of VOC parent products (PCE, TCE, and 1,1,1-TCA) in all wells along the groundwater flow path.
- Generally decreasing concentrations of degradation by-products (1,1-DCE, 1,1-DCA, cis-1,2-DCE, and vinyl chloride) in wells along the flow path through and downgradient of the treatment area, with the exception cis-1,2-DCE and vinyl chloride in downgradient well MW-22.
- Significantly lower concentrations of cis-1,2-DCE and vinyl chloride detected in MW-19, following elevated concentrations in previous years after CA implementation.
- The consistent presence of chloroethane in downgradient and off-property well MW-20.

The 2015 field parameter results (Table 2) were generally within historical ranges, with continued low DO and ORP results in monitoring wells in and downgradient of the MW-13/MW-21 treatment area. These results indicate continued anaerobic aquifer conditions in the deep aquifer zone.

Past TOC results (Table 4) in the MW-13/MW-21 deep source area indicate initially increased concentrations of TOC after substrate injection with decreasing to steady concentrations of TOC thereafter. Recently the TOC concentrations have decreased to pre-injection levels or lower in source area monitoring wells MW-13 and MW-21 and nearby downgradient monitoring well MW-22.

The concentrations of *Dhc* and *vcrA* were at moderate levels (10^6 cells/liter or gene copies/liter) in source area monitoring well MW-21 and in nearby downgradient monitoring well MW-22, and moderate in source area monitoring well MW-13 (10^5 – 10^6 cells/liter). The concentrations of *Dhb* were non-detectable to low (less than 10^3 – 10^4 cells/liter) in source area well MW-21 and nearby downgradient monitoring well MW-22 and non-detectable (less than 10^3 cells/liter) in source area well MW-13.

A comparison of microbial concentrations (*Dhc*, *Dhb*, and *vcrA*) to vinyl chloride concentrations over time from 2011 to 2015 is presented for select deep wells, MW-13, MW-21, and MW-22 (Figures C53-C55, Appendix C). As shown on these figures, the vinyl chloride concentrations have been significantly reduced in well MW-22. Between 2013 and 2014, vinyl chloride concentrations were also decreasing in wells MW-13 and MW-22; however, in 2015, the concentrations have rebounded slightly above the CUL in MW-13 and significantly above the CUL in MW-22. The recent increase in the vinyl chloride concentrations indicate further breakdown of chlorinated parent products.

4.2 ANALYTICAL DATA VALIDATION AND REVIEW

Laboratory data from each event was validated consistent with the USEPA guidelines for organic and inorganic data review (USEPA, 1999 and 2002). In summary, results for some analytes were qualified as estimated and assigned a 'J' flag by the laboratory because the results were reported at concentrations above the method detection limit (MDL) but below the method reporting limit (MRL). The data qualifiers for these detections were accepted during data validation and are included in the data tables. Other qualifiers assigned during data validation review included:

- **Lab Report C41842, Accutest.** Data from the VOC analyses of samples MW-19, DUP2 (MW-19 field duplicate), and MW-22 were qualified and assigned a 'J' or 'UJ' flag due to exceedance of the sample holding time by one day. Data from the VOC analysis of MW-10 was also qualified and assigned a "UJ" flag due to a potential low bias indicated by the surrogate recovery results.

Sample ID	Laboratory ID	Analyte	Laboratory Result	Units	Final Result
MW-10-091415	C41842-5	1,1,1-Trichloroethane	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	1,1-Dichloroethane	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	1,1-Dichloroethene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	1,2,4-Trimethylbenzene	2.0 U	µg/L	2.0 UJ
MW-10-091415	C41842-5	1,2-Dichloroethane	0.50 U	µg/L	0.50 UJ
MW-10-091415	C41842-5	1,2-Dichloropropane	0.50 U	µg/L	0.50 UJ
MW-10-091415	C41842-5	Benzene	0.50 U	µg/L	0.50 UJ
MW-10-091415	C41842-5	Chloroethane	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	Chloroform	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	cis-1,2-Dichloroethene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	Ethylbenzene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	m, p-Xylene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	Methylene chloride	5.0 U	µg/L	5.0 UJ
MW-10-091415	C41842-5	o-Xylene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	Tetrachloroethene	0.50 U	µg/L	0.50 UJ
MW-10-091415	C41842-5	Toluene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	Trichloroethene	1.0 U	µg/L	1.0 UJ
MW-10-091415	C41842-5	Vinyl chloride	0.50 U	µg/L	0.50 UJ
MW-19-091515	C41842-11	1,1,1-Trichloroethane	1.0 U	µg/L	1.0 UJ
MW-19-091515	C41842-11	1,1-Dichloroethane	1.3	µg/L	1.3 J
MW-19-091515	C41842-11	1,1-Dichloroethene	1.0 U	µg/L	1.0 UJ
MW-19-091515	C41842-11	1,2,4-Trimethylbenzene	16.3	µg/L	16.3 J
MW-19-091515	C41842-11	1,2-Dichloroethane	0.50 U	µg/L	0.50 UJ
MW-19-091515	C41842-11	1,2-Dichloropropane	0.50 U	µg/L	0.50 UJ
MW-19-091515	C41842-11	Benzene	1.0	µg/L	1.0 J
MW-19-091515	C41842-11	Chloroethane	14.5	µg/L	14.5 J
MW-19-091515	C41842-11	Chloroform	1.0 U	µg/L	1.0 UJ
MW-19-091515	C41842-11	cis-1,2-Dichloroethene	0.31 J	µg/L	0.31 J
MW-19-091515	C41842-11	Ethylbenzene	11.7	µg/L	11.7 J
MW-19-091515	C41842-11	m, p-Xylene	11.9	µg/L	11.9 J

Sample ID	Laboratory ID	Analyte	Laboratory Result	Units	Final Result
MW-19-091515	C41842-11	Methylene chloride	5.0 U	µg/L	5.0 UJ
MW-19-091515	C41842-11	o-Xylene	3.2	µg/L	3.2 J
MW-19-091515	C41842-11	Tetrachloroethene	0.50 U	µg/L	0.50 UJ
MW-19-091515	C41842-11	Toluene	6.8	µg/L	6.8 J
MW-19-091515	C41842-11	Trichloroethene	1.0 U	µg/L	1.0 UJ
MW-19-091515	C41842-11	Vinyl chloride	0.48 J	µg/L	0.48 J
DUP2-091515	C41842-12	1,1,1-Trichloroethane	1.0 U	µg/L	1.0 UJ
DUP2-091515	C41842-12	1,1-Dichloroethane	1.2	µg/L	1.2 J
DUP2-091515	C41842-12	1,1-Dichloroethene	1.0 U	µg/L	1.0 UJ
DUP2-091515	C41842-12	1,2,4-Trimethylbenzene	14.9	µg/L	14.9 J
DUP2-091515	C41842-12	1,2-Dichloroethane	0.50 U	µg/L	0.50 UJ
DUP2-091515	C41842-12	1,2-Dichloropropane	0.50 U	µg/L	0.50 UJ
DUP2-091515	C41842-12	Benzene	1.0	µg/L	1.0 J
DUP2-091515	C41842-12	Chloroethane	12.9	µg/L	12.9 J
DUP2-091515	C41842-12	Chloroform	1.0 U	µg/L	1.0 UJ
DUP2-091515	C41842-12	cis-1,2-Dichloroethene	0.30 J	µg/L	0.30 J
DUP2-091515	C41842-12	Ethylbenzene	10.4	µg/L	10.4 J
DUP2-091515	C41842-12	m, p-Xylene	10.5	µg/L	10.5 J
DUP2-091515	C41842-12	Methylene chloride	5.0 U	µg/L	5.0 UJ
DUP2-091515	C41842-12	o-Xylene	2.9	µg/L	2.9 J
DUP2-091515	C41842-12	Tetrachloroethene	0.50 U	µg/L	0.50 UJ
DUP2-091515	C41842-12	Toluene	5.9	µg/L	5.9 J
DUP2-091515	C41842-12	Trichloroethene	1.0 U	µg/L	1.0 UJ
DUP2-091515	C41842-12	Vinyl chloride	0.42 J	µg/L	0.42 J
MW-22-091515	C41842-13	1,1,1-Trichloroethane	2.0 U	µg/L	2.0 UJ
MW-22-091515	C41842-13	1,1-Dichloroethane	1.9 J	µg/L	1.9 J
MW-22-091515	C41842-13	1,1-Dichloroethene	2.0 U	µg/L	2.0 UJ
MW-22-091515	C41842-13	1,2,4-Trimethylbenzene	36.0	µg/L	36.0 J
MW-22-091515	C41842-13	1,2-Dichloroethane	1.0 U	µg/L	1.0 UJ
MW-22-091515	C41842-13	1,2-Dichloropropane	1.0 U	µg/L	1.0 UJ
MW-22-091515	C41842-13	Benzene	1.0 U	µg/L	1.0 UJ
MW-22-091515	C41842-13	Chloroethane	18.9	µg/L	18.9 J
MW-22-091515	C41842-13	Chloroform	2.0 U	µg/L	2.0 UJ
MW-22-091515	C41842-13	cis-1,2-Dichloroethene	64.1	µg/L	64.1 J
MW-22-091515	C41842-13	Ethylbenzene	6.6	µg/L	6.6 J
MW-22-091515	C41842-13	m, p-Xylene	233	µg/L	233 J
MW-22-091515	C41842-13	Methylene chloride	10 U	µg/L	10 UJ
MW-22-091515	C41842-13	o-Xylene	2.6	µg/L	2.6 J
MW-22-091515	C41842-13	Tetrachloroethene	1.0 U	µg/L	1.0 UJ
MW-22-091515	C41842-13	Toluene	11.4	µg/L	11.4 J
MW-22-091515	C41842-13	Trichloroethene	2.0 U	µg/L	2.0 UJ
MW-22-091515	C41842-13	Vinyl chloride	86.1	µg/L	86.1 J

No additional qualifications of the data were required. The data validation reviews concluded that all data (including the qualified data) were judged to be acceptable for their intended use. For Accutest lab reports C38997 and C41842 (March and September 2015), the MDLs associated with results for target analytes reported as not detected meet the final CULs with the exception of some analytes. These analytes are listed in the data validation memoranda for each report. Copies of the laboratory analytical reports and corresponding data validation memoranda for each sampling event are presented in Appendix D.

5 SUMMARY OF CONCLUSIONS AND RECOMMENDATIONS FOR 2016

5.1 SHALLOW GROUNDWATER ZONE SUMMARY

In 2015, VOC concentrations in the shallow aquifer groundwater zone were significantly lower than historical results. In source area wells MW-1 and MW-4, concentrations for one or more VOCs (TCE; cis-1,2-DCE; 1,1-DCA; and/or 1,1,1-TCA) were the lowest results detected since beginning monitoring. VOCs in other wells generally have continued decreasing concentrations, with breakdown products vinyl chloride and chloroethane concentrations fluctuating within range of previous results.

Consistent with historical results, the highest concentrations of VOCs continue to occur in the two source areas and significantly lower VOC concentrations occur in wells upgradient and downgradient of the source areas. In comparison to recent years, the shallow groundwater plumes have decreased in area and/or in maximum concentrations. The 2015 TOC, dissolved gas, and overall VOC concentrations reflect that biodegradation continues to occur in the source areas.

5.2 DEEP GROUNDWATER ZONE SUMMARY

In 2015, the highest VOC concentrations in the deep aquifer groundwater zone continued to occur in the source area near well MW-21 and immediately downgradient in well MW-22. VOC concentrations generally decreased, with significant decreases in one or more VOCs (cis-1,2-DCE; 1,1-DCA; and/or vinyl chloride). Previously increasing by-product trends in MW-19 and MW-22 reversed in 2015, possibly indicating further breakdown of chlorinated daughter products that previously had increasing concentrations.

The deep zone VOC plumes generally decreased in area and/or in maximum concentrations, with the exception of cis-1,2-DCE in the source area near well MW-22. VOC concentrations in the source area continued to decrease in 2015, and concentrations of TOC and dissolved gases continue to suggest that biodegradation is occurring in the deep aquifer zone. Concentrations of Dhc were detected in all but two wells (Wells MW-7 and MW-23, located north of the shallow injection zone). Although Dhb concentrations were not detected in six monitoring wells, overall concentrations of TOC, Dhc, *vcrA*, and Dhb suggest that sufficient substrate and chlorinated VOC-degrading microbes are present to support biodegradation. Wells MW-27 and MW-28, which were installed in 2014, continued to delineate the width of the deeper groundwater plume. Off-site well MW-20 continues to have reported benzene and chloroethane concentrations above the CULs, consistent with concentrations observed in prior years.

5.3 RECOMMENDATIONS FOR 2016

In accordance with the CMP, semi-annual groundwater monitoring will be conducted in March and September 2016. As previously referred to in the 4th Quarter 2015 Cleanup Progress Report, monitoring well MW-15 and two injection wells (IW-103 and IW-107) were decommissioned on February 16, 2016. Therefore, the March and September 2015 monitoring events will not include groundwater monitoring of MW-15. There are no current plans to replace this monitoring well because it is upgradient of the deep source area and has not had concentrations above the CULs in several years. In 2016 we will also review and respond to the Evaluation and Recommendation Report by Aspect Consulting dated June 23, 2015 that was provided to us on February 24, 2016.

6 REFERENCES

- PES Environmental, Inc. 2009a. *Groundwater Monitoring Plan, Univar USA Inc., Kent, Washington*. Prepared for Univar USA Inc. February 18.
- PES Environmental, Inc. 2009b. *Revised Remedial Investigation, Focused Feasibility Study Addendum, and Draft Cleanup Action Plan, Univar USA Inc., Kent, Washington*. March 13.
- PES Environmental, Inc. 2010. *Final Engineering Design Report, Final Cleanup Action, Univar USA Inc., Kent, Washington*. Prepared for Univar USA Inc. October 29.
- PES Environmental, Inc. 2012. *Construction Report, Final Cleanup Action, Univar USA Inc., Kent, Washington*. Prepared for Univar USA Inc. March 12.
- PES Environmental, Inc. 2013. *2012 Annual Groundwater Monitoring Report, Univar USA Inc., Kent, Washington*. Prepared for Univar USA Inc. March 7.
- URS Corporation. 2014a. *2014 Annual Groundwater Monitoring Report, Univar USA, Inc., 8201 South 212th Street, Kent, Washington*. Prepared for Univar USA Inc. February 27.
- URS Corporation. 2014b. *Technical Memorandum, Evaluation of Enhanced Reductive Dechlorination Remediation Performance, Univar USA, Inc., 8201 South 212th Street, Kent, Washington*. Prepared for Univar USA Inc. November 13.
- U.S. Environmental Protection Agency (USEPA). 1999. *USEPA Contract Laboratory Program National Functional Guidelines for Organic Data Review*. EPA 540-R-99-008. USEPA Office of Emergency and Remedial Response. October.
- U.S. Environmental Protection Agency. 2002. *USEPA Contract Laboratory Program National Functional Guidelines for Inorganic Data Review, Final*. EPA 540-R-01-008. USEPA Office of Emergency and Remedial Response. July.
- Washington State Department of Ecology (Ecology). 2008. *Agreed Order No. DE 5988, Univar USA Inc., 8201 South 212th Street, Kent, Washington*. November 28.

Tables

Table 1
Groundwater Levels
Univar USA Inc., Kent, Washington

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
Shallow On-Site Monitoring and Pilot Test Wells					
MW-1	33.15	03/16/15	11:02	4.41	28.74
		09/13/15	11:25	6.52	26.63
MW-2	33.79	03/16/15	11:17	5.47	28.32
		09/13/15	9:35	7.90	25.89
MW-3	32.94	03/16/15	9:52	5.19	27.75
		09/13/15	8:36	7.45	25.49
MW-4	32.86	03/16/15	10:54	4.61	28.25
		09/13/15	9:07	6.81	26.05
MW-5	32.60	03/16/15	10:25	4.74	27.86
		09/13/15	9:12	7.11	25.49
MW-6	33.05	03/16/15	11:15	4.85	28.20
		09/13/15	9:24	8.15	24.90
MW-7	32.96	03/16/15	9:55	5.11	27.85
		09/13/15	8:46	7.43	25.53
MW-8	33.57	03/16/15	10:28	4.68	28.89
		09/13/15	9:18	8.04	25.53
MW-9	33.77	03/16/15	10:30	5.76	28.01
		09/13/15	9:20	8.21	25.56
MW-10	32.89	03/16/15	9:58	4.79	28.10
		09/13/15	8:44	7.34	25.55
MW-11	32.79	03/16/15	10:52	4.89	27.90
		09/13/15	9:42	7.22	25.57
MW-12	32.81	03/16/15	10:53	4.90	27.91
		09/13/15	9:14	7.27	25.54
MW-23	32.78	03/16/15	9:56	4.91	27.87
		09/13/15	8:45	7.26	25.52
Deep On-Site Monitoring Wells and Piezometer					
MW-13	32.81	03/16/15	12:17	4.86	27.95
		09/13/15	11:18	7.16	25.65
MW-14	32.60	03/16/15	12:26	4.62	27.98
		09/13/15	11:28	6.94	25.66
MW-15	32.57	03/16/15	12:28	4.52	28.05
		09/13/15	11:29	6.82	25.75
MW-16	36.92	03/16/15	12:32	9.02	27.90
		09/13/15	11:20	11.32	25.60
MW-17	32.60	03/16/15	12:37	4.89	27.71
		09/13/15	11:05	7.08	25.52
MW-18	32.73	03/16/15	12:34	4.89	27.84
		09/13/15	11:02	7.19	25.54

Table 1
Groundwater Levels
Univar USA Inc., Kent, Washington

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-19	33.52	03/16/15	12:31	5.68	27.84
		09/13/15	11:04	7.97	25.55
MW-21	32.86	03/16/15	12:18	4.93	27.93
		09/14/15	14:22	7.22	25.64
MW-22	33.18	03/17/15	8:20	5.32	27.86
		09/13/15	11:14	7.61	25.57
MW-24	32.74	03/16/15	12:23	4.78	27.96
		09/13/15	14:23	7.05	25.69
MW-25	32.80	03/16/15	12:19	4.84	27.96
		09/13/15	11:17	7.16	25.64
P-1	33.62	03/16/15	12:36	5.69	27.93
		09/13/15	11:31	8.04	25.58
Deep Off-Site Monitoring Wells					
MW-20	33.15	03/16/15	12:19	5.50	27.65
		09/13/15	11:42	7.71	25.44
MW-27	32.98	03/16/15	12:22	5.29	27.69
		09/13/15	11:40	7.60	25.38
MW-28	34.63	03/16/15	12:27	7.03	27.60
		09/13/15	11:07	9.25	25.38
NOTE: Depth = depth to water relative to the top of PVC. Elev. = elevation relative to NAVD 88.					

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-1	03/29/10	6.97	842	11.4	NM	0.30	-8
	09/30/10	7.26	937	17.2	NM	0.24	-10
	03/03/11	7.49	510	9.2	7.0	0.23	-13
	09/23/11	6.61	523	18.0	3.0	0.10	-106
	03/08/12	6.99	494	8.2	7.9	0.22	-44
	10/01/12	6.56	507	15.5	5.7	0.22	349 ^a
	03/06/13	6.84	820	9.6	14.5	0.20	-7
	09/24/13	6.78	496	18.5	55.3	0.20	-84
	03/26/14	7.21	991	10.5	1.2	0.00	-129
	09/23/14	6.49	698	19.7	2.3	0.55	-126
	03/17/15	6.05	438	10.5	0.0	0.00	-227
	09/16/15	6.37	700	17.6	0.00	0.00	-121
MW-2	03/26/10	6.49	390	12.6	NM	0.82	7
	09/30/10	6.68	556	16.4	NM	0.28	27
	03/08/11	6.87	441	12.7	85.0	0.17	8
	09/21/11	6.30	443	18.0	9.8	0.09	-91
	03/06/12	6.56	396	11.2	NM	0.67	-65
	09/28/12	6.45	382	17.2	NM	0.29	342 ^a
	03/07/13	6.48	480	12.4	NM	0.15	20
	09/24/13	6.63	349	16.8	90.7	0.20	-50
	03/26/14	6.99	495	13.8	7.2	0.00	-106
	09/24/14	6.32	547	17.4	4.3	0.00	-119
	03/17/15	6.36	253	15.5	0.0	0.00	-153
	09/17/15	6.47	619	16.6	0.0	0.00	-70
MW-3	03/30/10	6.85	601	11.6	NM	0.99	-5
	09/28/10	6.98	647	15.6	NM	0.28	8
	03/07/11	7.33	426	12.1	2.0	0.20	32
	09/21/11	6.71	556	16.3	1.4	0.03	-127
	03/06/12	6.97	497	10.7	NM	0.11	-1
	10/01/12	6.81	519	16.2	NM	0.20	308 ^a
	03/07/13	6.87	662	11.7	NM	0.19	102
	09/24/13	7.03	404	13.6	57.2	0.40	-97
	03/27/14	7.29	616	12.4	0.0	0.00	-154
	09/25/14	6.82	681	15.1	14.6	0.00	-135
	03/19/15	6.06	318	11.6	0.0	0.00	-226
	09/16/15	7.13	618	17.4	0.0	0.00	-125
MW-4	03/29/10	6.71	1,094	9.9	NM	0.58	-8
	10/01/10	6.89	1,054	16.7	NM	0.55	10
	03/04/11	7.48	906	9.4	7.0	0.17	-8
	09/23/11	6.46	1,091	22.1	1.6	0.15	-64
	03/08/12	6.67	1,100	9.6	NM	0.36	-16
	10/01/12	6.56	1,109	16.8	NM	0.18	355 ^a
	03/06/13	6.73	1,436	9.7	4.3	0.22	24
	09/24/13	6.82	823	17.8	63.8	0.00	-63

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-4 (continued)	03/25/14	7.26	1,510	13.9	0.0	0.00	-141
	09/23/14	6.49	1,210	19.2	0.5	0.00	-107
	03/17/15	6.10	730	10.5	0.0	0.00	-225
	09/17/15	6.25	1,150	17.3	0.0	0.00	-104
MW-5	04/01/10	6.39	287	12.5	16.0	0.49	27
	04/09/10	NM	340	NM	3.0	NM	NM
	04/16/10	6.38	342	13.4	8.0	0.70	26
	05/06/10	6.52	297	12.7	6.0	2.35	23
	06/09/10	6.44	283	14.1	14.0	1.61	24
	09/28/10	6.55	262	18.4	NM	1.06	26
	03/03/11	6.76	203	11.6	6.0	0.55	12
	06/22/11	6.36	200	17.0	14.5	0.11	-7
	09/22/11	6.19	226	17.3	5.1	0.38	63
	10/21/11	6.11	267	15.8	9.0	0.41	34
	12/07/11	6.36	207	14.0	NM	0.15	73
	03/07/12	6.39	216	12.3	NM	0.29	53
	06/26/12	6.35	233	17.1	4.2	0.19	29
	09/27/12	6.14	266	18.5	0.8	0.25	346 ^a
	12/19/12	6.17	362	13.0	23.0	0.34	-29
	03/06/13	6.25	360	11.2	4.4	0.18	76
	06/06/13	6.63	379	17.9	17.0	0.63	23
09/24/13	6.45	302	14.8	54.6	0.03	20	
03/25/14	5.81	404	14.7	0.0	0.00	-141	
09/23/14	6.14	380	16.6	2.1	0.00	-49	
03/16/15	6.21	199	16.1	0.0	0.00	-100	
09/15/15	5.95	342	16.3	0.0	0.00	-34	
MW-6	03/30/10	6.53	533	11.5	NM	0.61	14
	09/30/10	6.55	936	15.9	NM	0.35	30
	03/04/11	6.84	331	10.6	4.0	0.21	11
	09/21/11	6.23	723	17.9	3.9	0.13	-68
	03/06/12	6.53	341	10.5	NM	0.25	-12
	09/28/12	6.21	717	15.3	NM	0.27	315 ^a
	03/07/13	6.49	511	11.1	NM	0.21	76
	09/24/13	6.50	634	14.3	106.0	0.00	-52
	03/26/14	6.70	420	13.1	7.3	0.00	-60
	09/24/14	6.18	887	15.7	3.2	0.00	-94
	03/17/15	5.39	270	11.9	0.0	0.00	-155
09/17/15	6.32	1,040	16.4	1.1	0.00	-62	
MW-7	04/01/10	6.81	255	12.4	NM	1.48	6
	09/28/10	6.71	318	17.4	NM	0.27	17
	03/02/11	6.48	235	11.4	10.0	5.72	3
	06/22/11	6.33	193	19.0	38.1	0.33	109
	09/22/11	6.33	248	16.6	1.9	0.19	158
	10/20/11	6.28	389	16.1	13.0	0.30	88
	12/07/11	6.55	273	13.4	NM	0.57	139

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-7 (continued)	03/07/12	6.54	200	12.3	NM	1.31	95
	06/26/12	6.47	196	16.1	5.7	0.18	43
	07/12/12	6.54	197	15.8	NM	0.23	-22
	09/27/12	6.26	245	18.2	1.8	0.30	383 ^a
	12/19/12	6.42	641	13.0	7.0	0.46	8
	03/05/13	6.32	374	12.6	16.6	0.17	19
	06/06/13	6.74	328	16.7	9.3	0.24	81
	09/24/13	5.97	427	17.7	0.0	0.00	45
	03/26/14	6.48	340	14.2	0.0	0.00	132
	09/25/14	6.36	402	17.5	0.0	0.00	116
	03/18/15	6.25	162	17.0	0.0	2.87	-2
09/14/15	6.68	433	17.8	0.4	0.00	76	
MW-8	04/01/10	6.29	949	11.9	NM	0.79	29
	09/28/10	6.44	1,217	18.1	NM	0.28	32
	03/04/11	6.81	1,317	11.0	2.0	0.50	13
	09/26/11	6.15	1,137	14.4	0.3	0.32	270
	03/06/12	6.55	1,106	11.6	NM	0.50	14
	09/28/12	6.27	1,101	17.1	NM	0.32	305 ^a
	03/08/13	6.45	1,271	12.3	NM	0.23	136
	09/24/13	6.43	854	15.9	57.0	0.69	57
	03/26/14	6.76	994	13.4	5.0	0.00	109
	09/23/14	6.27	1120	16.9	1.5	0.00	112
	03/16/15	6.40	486	15.8	0.0	0.00	-2
09/16/15	6.52	1,190	14.1	0.0	0.00	126	
MW-9	03/30/10	6.58	559	11.9	NM	0.72	17
	09/28/10	6.52	651	17.3	NM	0.24	27
	03/04/11	6.89	505	12.0	4.0	0.24	10
	09/26/11	6.41	544	13.4	85.4	0.12	-90
	03/06/12	6.37	392	11.3	NM	0.30	32
	09/28/12	6.57	641	15.3	NM	0.16	272 ^a
	03/08/13	6.47	557	11.9	NM	0.16	95
	09/24/13	6.87	365	15.1	128.0	0.00	-67
	03/26/14	6.42	388	15.0	0.0	0.00	67
	09/24/14	6.45	472	17.1	21.2	0.00	-93
	03/17/15	6.09	239	15.7	70.4	0.94	-40
09/16/15	6.54	769	15.9	20.7	0.00	-146	
MW-10	03/30/10	6.96	201	11.1	NM	1.33	-8
	09/28/10	6.98	185	17.7	NM	0.20	3
	03/04/11	7.24	160	10.7	7.0	0.15	-2
	09/26/11	6.61	152	14.9	37.8	0.32	-58
	03/07/12	6.86	141	11.2	NM	0.24	-7
	09/28/12	6.67	136	18.9	NM	0.21	292 ^a
	03/05/13	6.54	164	11.4	NM	0.16	2
	09/24/13	7.11	106	17.4	72.5	0.00	-72

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-10 (continued)	03/27/14	7.03	176	13.2	0.0	0.00	-88
	09/24/14	6.66	201	17.2	12.9	0.00	-94
	03/18/15	6.32	57	14.8	50.2	0.00	-56
	09/14/15	6.51	145	17.6	29.1	0.00	-110
MW-12	04/01/10	6.56	347	13.0	NM	0.87	27
	09/28/10	6.52	322	18.6	NM	0.35	26
	03/03/11	6.75	244	11.1	28.0	0.22	12
	06/22/11	6.87	348	16.1	41.2	0.04	-188
	09/22/11	6.51	359	16.4	12.4	0.05	-122
	10/21/11	6.41	411	15.0	35.0	0.38	11
	12/07/11	6.58	293	12.2	NM	0.20	-87
	03/07/12	6.38	316	12.9	NM	0.30	59
	06/27/12	6.44	533	15.5	18.4	0.22	32
	07/12/12	6.44	312	15.5	NM	0.14	16
	10/02/12	6.41	324	16.3	7.9	3.60 ^a	275 ^a
	12/19/12	6.29	444	13.1	11.0	0.37	15
	03/06/13	6.37	436	12.2	18.1	0.15	47
	06/06/13	6.61	431	20.4	33.4	0.25	-40
	09/24/13	6.79	417	14.9	54.4	0.00	-117
	03/25/14	5.90	413	15.4	0.0	0.00	-45
09/23/14	6.27	424	16.8	3.1	0.70	-108	
03/16/15	6.21	196	16.9	2.7	0.00	-82	
09/15/15	6.61	423	16.0	0.0	0.00	-41	
MW-13	03/29/10	6.53	639	12.4	15.0	0.58	18
	04/07/10	NM	720	NM	2.0	NM	NM
	04/16/10	6.67	682	14.2	9.0	0.49	24
	05/06/10	6.56	722	13.9	6.0	0.31	25
	06/09/10	6.52	753	15.7	4.0	0.20	22
	09/30/10	6.58	695	17.2	NM	0.14	17
	03/03/11	6.76	552	12.9	1.0	0.20	9
	06/23/11	6.09	365	14.4	9.2	0.16	-61
	09/22/11	6.26	680	19.7	13.3	0.02	-86
	10/20/11	6.27	882	16.3	17.0	0.35	-28
	12/07/11	6.45	566	12.7	NM	0.21	-89
	03/07/12	6.49	564	12.2	NM	0.27	-13
	06/27/12	6.44	533	15.5	18.4	0.22	32
	07/12/12	6.47	571	18.5	NM	0.16	-7
	10/02/12	6.39	541	16.9	6.4	0.20	221 ^a
	12/19/12	6.33	694	13.1	26.0	0.31	-91
	03/07/13	6.43	688	12.9	4.4	0.16	11
06/06/13	6.70	713	19.9	26.7	0.18	-95	
09/24/13	7.02	489	15.7	82.5	6.22	-92	
03/26/14	6.78	610	14.1	1.7	0.00	-99	
09/23/14	6.41	803	17.7	29.2	0.00	-129	
03/17/15	6.25	65	12.4	0.0	0.00	-45	

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-13 (continued)	09/15/15	6.34	485	17.8	0.0	0.00	-106
MW-14	03/30/10	6.58	360	13.2	NM	0.73	15
	09/30/10	6.72	555	17.4	NM	0.34	18
	03/04/11	6.96	316	12.0	6.0	0.15	9
	09/21/11	6.39	392	16.7	7.6	0.04	-72
	03/06/12	6.58	337	12.0	NM	0.27	0
	09/28/12	6.42	366	16.3	NM	0.28	294 ^a
	03/07/13	6.50	451	12.4	NM	0.18	49
	09/24/13	6.57	313	14.0	65.5	0.00	-23
	03/26/14	6.74	444	16.3	0.0	0.00	-86
	09/24/14	6.39	496	15.7	2.4	0.00	-89
	03/17/15	6.41	282	15.4	0.0	7.23	-144
09/16/15	6.71	593	14.6	0.0	0.00	-69	
MW-15	03/30/10	6.61	409	13.3	NM	0.77	14
	09/30/10	6.57	506	17.0	NM	0.38	19
	03/08/11	6.91	449	13.7	4.0	0.17	8
	09/21/11	6.42	462	17.2	3.0	0.06	-83
	03/06/12	6.57	403	11.3	NM	0.30	-32
	10/01/12	6.43	414	14.7	NM	0.31	370 ^a
	03/07/13	6.50	530	12.9	NM	0.17	30
	09/24/13	6.61	357	14.4	131.0	0.00	-48
	03/26/14	6.73	487	16.5	0.0	0.00	-94
	09/24/14	6.40	482	16.1	3.5	0.00	-94
	03/17/15	5.58	237	13.7	0.0	0.00	-174
09/17/15	5.69	509	15.1	0.0	0.00	-46	
MW-16	04/02/10	6.45	691	11.5	NM	0.59	24
	10/10/10	6.62	801	14.2	NM	0.39	21
	03/08/11	6.76	639	12.3	6.0	0.19	7
	09/26/11	6.29	681	13.5	0.6	0.20	-71
	03/08/12	6.42	666	11.8	NM	0.26	7
	10/01/12	6.28	678	13.7	NM	0.29	358 ^a
	03/08/13	6.54	607	11.2	NM	0.21	110
	09/24/13	6.59	428	12.9	62.1	0.00	-23
	03/27/14	6.67	889	13.3	25.4	0.00	-98
	09/25/14	6.30	901	14.9	98.7	0.00	-84
	03/18/15	6.30	480	15.2	3.1	0.00	-156
	09/17/15	6.08	999	13.7	4.8	0.00	-116
MW-17	03/30/10	6.37	667	10.1	NM	1.28	12
	10/01/10	6.68	1,111	14.2	NM	0.31	23
	03/07/11	6.88	564	11.6	5.0	0.15	8
	06/23/11	6.27	415	14.6	7.1	0.08	-40
	09/23/11	6.37	927	16.2	1.4	0.10	-60
	03/08/12	6.57	911	11.9	NM	0.23	-28
	06/27/12	6.57	936	15.3	14.8	0.12	-24

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-17 (continued)	07/12/12	6.53	1,033	15.9	NM	0.23	-26
	10/01/12	6.36	918	13.6	77.2	0.23	346 ^a
	12/19/12	6.35	1,349	10.9	16.0	0.39	-100
	03/07/12	6.47	1,128	11.4	4.4	0.18	21
	06/06/13	6.88	1,269	15.0	21.6	0.28	-89
	09/24/13	6.07	792	12.4	90.1	0.00	-55
	03/26/14	6.67	665	12.7	8.0	0.00	4
	09/25/14	6.49	914	14.6	43.1	0.00	-68
	03/19/15	6.50	499	12.3	44.3	0.00	-101
	09/17/15	6.57	1,100	14.5	5.5	0.00	-32
MW-18	03/30/10	6.62	494	12.0	NM	1.57	13
	09/28/10	6.68	616	16.6	NM	0.24	21
	03/04/11	6.95	464	12.3	3.0	0.18	7
	06/23/11	6.32	312	15.3	9.6	0.14	-7
	09/23/11	6.37	532	16.9	3.8	0.07	-70
	03/07/12	6.54	484	13.0	6.0	0.18	15
	06/27/12	6.55	554	17.4	4.9	0.20	-18
	07/12/12	6.54	567	14.8	NM	0.19	-41
	10/01/12	6.48	321	17.7	2.8	2.42 ^a	353 ^a
	12/19/12	6.44	697	12.3	9.0	0.42	-92
	03/05/13	6.40	657	12.7	6.7	0.17	9
	06/06/13	6.87	741	16.6	16.1	0.26	-84
	09/24/13	6.67	439	15.0	58.9	0.08	-60
	03/26/14	7.76	99	13.9	0.0	3.32	115
	09/24/14	6.38	579	16.7	7.1	0.00	-59
03/18/15	5.55	378	14.2	0.0	0.00	-178	
09/14/15	6.47	617	16.0	0.0	0.00	-82	
MW-19	03/30/10	6.33	528	11.9	NM	0.98	14
	09/28/10	6.53	722	16.4	NM	0.36	29
	03/03/11	6.92	413	13.5	4.0	0.15	10
	09/21/11	6.38	530	16.6	0.0	0.14	-103
	12/07/11	6.53	556	13.3	NM	0.26	-77
	03/08/12	5.65	596	15.0	NM	0.19	-29
	06/27/12	6.57	430	16.6	0.8	0.16	-22
	07/12/12	6.51	466	15.4	NM	0.23	21
	09/28/12	6.35	406	17.6	NM	0.28	322 ^a
	12/19/12	6.42	560	13.7	14.0	0.40	-93
	03/05/13	6.39	727	13.3	1.6	0.14	-31
	06/06/13	6.84	766	16.3	9.8	0.86	-72
	09/24/13	6.72	486	14.0	64.0	0.00	-98
	03/27/14	6.83	564	14.7	52.9	0.00	-90
	09/25/14	6.47	689	18.5	5.7	0.00	-87
03/19/15	6.56	440	13.4	5.5	0.00	-138	
09/15/15	6.37	797	16.4	1.5	0.00	-119	
MW-20	03/29/10	6.33	922	13.2	NM	0.48	17
	10/01/10	6.69	1,013	15.8	NM	0.40	21

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-20 (continued)	03/02/11	6.35	1,147	12.6	8.0	0.13	9
	09/26/11	6.36	930	16.6	33.0	0.29	-80
	03/08/12	6.53	946	14.0	NM	0.25	-5
	10/01/12	6.37	903	16.8	NM	0.14	321 ^a
	03/08/13	6.45	180	11.4	NM	0.19	97
	06/06/13	6.67	898	17.0	30.8	0.21	-75
	09/24/13	6.64	761	15.6	96.6	0.00	-68
	03/27/14	6.85	166	15.8	0.0	0.00	-32
	09/25/14	6.42	1010	17.8	62.3	0.00	-84
	03/18/15	6.33	589	14.4	0.0	0.00	-154
09/16/15	6.27	1090	19.5	2.0	0.00	130	
MW-21	03/26/10	6.31	664	13.2	10.0	0.68	19
	04/16/10	6.54	702	13.6	19.0	0.90	22
	05/06/10	6.50	716	13.9	30.0	0.20	29
	06/09/10	6.21	741	15.0	131.0	0.16	38
	09/30/10	5.90	965	16.9	NM	0.34	56
	03/02/11	6.13	779	11.4	2.0	0.31	24
	06/23/11	5.74	407	13.9	7.2	0.12	-46
	09/22/11	5.75	951	17.5	1.5	0.07	-21
	09/27/11	5.70	907	15.1	5.2	0.35	20
	10/20/11	6.67	1,205	15.0	11.0	0.31	-17
	12/07/11	5.88	845	12.6	NM	0.21	-49
	03/08/12	6.00	880	13.1	NM	0.19	20
	06/26/12	5.99	846	14.4	74.5	0.22	7
	07/12/12	6.03	887	15.6	NM	0.15	42
	10/02/12	5.94	876	14.5	>1000	1.41 ^a	238 ^a
	12/20/12	5.95	1,128	11.4	96.0	0.29	-50
	03/06/13	6.16	1,125	11.0	68.0	0.22	27
	06/06/13	6.61	1,120	18.8	52.6	0.25	-89
09/24/13	6.28	714	14.6	102.0	0.00	-56	
03/26/14	6.50	785	15.1	0.0	0.00	-110	
09/24/14	6.25	829	16.1	31.0	0.00	-88	
03/17/15	5.35	405	13.5	17.5	0.00	-172	
09/15/15	6.50	851	15.4	0.0	0.00	-85	
MW-22	03/29/10	6.20	665	12.0	NM	0.85	22
	09/30/10	6.57	821	17.6	NM	0.56	13
	03/04/11	6.77	543	12.2	45.0	0.15	12
	06/23/11	6.20	366	13.2	2.1	0.13	-30
	09/23/11	6.27	684	16.3	206.7	0.00	-85
	10/21/11	6.26	827	14.1	4.0	0.34	31
	12/07/11	6.27	583	12.5	NM	0.24	-50
	03/08/12	6.49	502	10.7	20.5	0.23	-17
	06/26/12	6.44	549	14.4	8.8	0.16	-33
	07/12/12	6.35	570	16.4	NM	0.20	15
	10/02/12	6.32	617	15.1	2.8	0.20	251 ^a

Table 2
Groundwater Field Parameters
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-22 (continued)	12/19/12	6.26	800	12.0	17.0	0.31	-96
	03/06/13	6.40	823	10.9	5.7	0.22	165
	06/06/13	6.79	881	15.9	11.6	0.32	-91
	09/25/13	6.53	564	13.7	89.1	0.00	-75
	03/26/14	6.59	769	15.0	0.0	0.00	-102
	09/24/14	6.22	769	14.9	12.2	0.00	-100
	03/17/15	6.16	430	11.9	0.0	0.00	-149
	09/15/15	6.64	833	17.4	0.8	0.00	-85
MW-23	04/01/10	6.57	428	13.0	NM	0.66	16
	09/28/10	6.67	495	19.0	NM	0.19	19
	03/02/11	6.25	399	11.8	5.0	0.25	16
	06/22/11	6.27	320	15.3	26.1	0.19	70
	09/23/11	6.35	431	17.8	7.8	0.14	82
	10/20/11	6.51	512	16.7	3.0	0.36	70
	12/07/11	6.57	356	13.7	NM	0.18	102
	03/07/12	6.59	386	13.1	5.2	0.18	58
	06/26/12	6.54	460	16.9	7.3	0.20	46
	07/12/12	6.54	465	15.8	NM	0.17	-18
	09/27/12	6.52	409	17.1	5.2	0.26	340 ^a
	12/19/12	6.51	430	13.5	64.0	0.34	65
	03/05/13	6.50	528	12.6	7.1	0.16	-15
	06/06/13	6.91	690	16.8	9.2	0.26	43
	09/24/13	6.72	364	17.0	52.4	2.17	67
	03/26/14	6.80	616	13.5	4.1	0.00	147
09/25/14	6.53	652	17.5	0.7	0.00	107	
03/18/15	6.50	326	16.0	1.5	0.00	-39	
09/14/15	6.05	650	18.7	0.4	0.00	35	
MW-27	09/24/14	6.38	566	16.2	64.3	0.00	-80
	03/18/15	6.22	339	13.5	17.8	0.00	-122
	09/16/15	6.75	631	19.5	2.2	0.00	-79
MW-28	09/25/14	6.56	1,010	14.6	257	0.00	-95
	03/19/15	5.72	575	11.4	127	0.00	-204
	09/17/15	6.32	985	16.2	11.7	0.00	-125

NOTE: NM = not measured

^a Likely meter malfunction

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected Solubility in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro- propane	Benzene	Chloro- ethane	Chloro- form	cis-1,2-DCE	Ethyl- benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1E+06	1,000	LNAPL	LNAPL	
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5	
MW-1	03/29/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	9.6 J	20 U	15	48	0.5 U	0.5 U	63	7.8 J	27	170	4.4	
	09/30/10		339	0.5 U	18.1	0.5 U	0.5 U	0.5 U	46.5	1.0 U	28.3	70.2	1.41 J	0.5 U	173	3.16	144	301	9.51	
	03/03/11		168	4.52	20.5	0.5 U	0.5 U	0.5 U	18.9	1.00	23.6	43.8	0.5 U	2.18	211	5.82	140	416	3.10	
	09/23/11		138	1.96	16.0	0.5 U	0.5 U	0.700	174	1.0 U	13.5	124	1.20	0.830	38.5	3.44	1,620	949	5.74	
	03/08/12		132	2.41	15.8	0.500 U	0.500 U	0.500 U	54.7	1.00 U	20.4	47.0	0.860	1.35	80.7	2.29	248	668	10.1	
	10/1/12 (DUP)		88.0	0.720	23.8	0.500 U	0.500 U	0.500 U	82.0	1.00 U	15.0	19.1	0.760	0.630 J	13.4	2.94	198	461	6.10	
	10/01/12		83.0	0.790	24.7	0.500 U	0.500 U	0.500 U	89.5	1.00 U	14.3	19.2	0.900	0.640 J	13.1	2.80	194	443	5.78	
	03/06/13		252	2.26	22.5	0.5 U	0.5 U	0.540	79.8	1.00 U	25.2	46.6	2.08	1.13	49.4	1.86	186	556	22.3 J	
	09/25/13		132	0.900	28.3	0.500 U	0.500 U	0.750	145	1.00 U	21.5	42.1	1.58	0.780	16.2	3.34	362	629	18.7	
	03/26/14		303	4.02	25.2	0.500 U	0.500 U	0.761	228	1.00 U	45.2	43.2	1.23	1.11	65.2	3.02	183	323	67.1	
	09/23/14		95.0	0.500 U	20.8	0.500 U	0.500 U	0.500 U	225	1.00 U	10.1	25.9	0.893	1.41	7.45	2.75	448	285.1	13.4	
	03/17/15		36.9	2.5 U	24.5	1.3 U	1.3 U	1.3 U	80.3	2.5 U	1.4 J	38.1	13 U	1.3 U	3.7	0.95 J	32.7	129.8	1.1 J	
	09/16/15		51.7	1.0 U	18.1	0.50 U	0.50 U	0.52	212	1.0 U	5.2	16.9	5.0 U	0.76	11.1	2.3	175	214.5	7.0	
MW-2	03/29/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	
	3/29/10 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.6	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	
	09/30/10		0.61	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.07	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	03/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.690	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/21/11		0.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.920	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/06/12		0.520	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.640	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.290
	09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.50 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.2 U
	03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.50 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.2 U
	09/26/13		0.590	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.786	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/24/14		0.517	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.528	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/17/15		0.36 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.72 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U
	09/17/15		0.47 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.37 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U
MW-3	03/30/10		16	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.9	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.3	
	09/28/10		8.47	0.5 U	0.5 U	0.5 U	0.5 U	0.33 J	0.5 U	1.0 U	1.49	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	03/07/11		9.50	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.39	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/21/11		7.07	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.41	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/06/12		5.06	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.14	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	10/01/12		7.24	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.45	0.500 U	0.500 U	0.500 UJ	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/07/13		4.75	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.03	0.500 U	0.500 U	0.500 UJ	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/27/13		3.76	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.900	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/27/14		2.51	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/25/14		5.38	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.21	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/19/15		2.2	1.0 U	2.0 U	0.50 U	0.50 U	0.25 J	1.0 U	1.0 U	0.61 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.23 J
	09/16/15		20 U	20 U	40 U	10 U	10 U	10 U	20 U	20 U	20 U	20 U	100 U	10 U	20 U	20 U	20 U	20 U	20 U	10 U
	MW-4	03/29/10		5.9	0.5 U	140	0.5 U	0.5 U	10	130	1.0 U	0.5 U	0.7	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5	0.2
10/01/10			5.74	0.5 U	43.4	0.5 U	0.5 U	6.78	78.1	1.0 U	0.5 U	2.17	0.63 J	0.5 U	0.5 U	0.5 U	0.53	3.80	0.19 J	
03/04/11			7.81	0.5 U	31.4	0.5 U	0.5 U	5.42	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.500 U	69.5	
09/23/11			4.00	0.5 U	34.1	0.5 U	0.5 U	5.24	50.4	1.0 U	1.30	3.33	0.5 U	0.5 U	0.5 U	0.5 U	2.07	9.66	1.46	
03/08/12			2.97	0.500 U	33.5	0.500 U	0.500 U	7.02	36.4	1.00 U	0.730	9.31	0.500 U	0.500 U	0.500 U	0.500 U	3.06	15.4	2.99	
10/01/12			2.71	0.500 U	21.5	0.500 U	0.500 U	4.72	31.3	1.00 U	0.500 U	4.29	0.500 UJ	0.500 U	0.500 U	2.23	8.54	2.19		
03/06/13			4.42	0.5 U	7.49	0.5 U	0.5 U	6.43	0.5 U	1.0 U	0.5 U	4.33	1.15	0.5 U	0.5 U	0.670	1.39	<0.2 U		
09/26/13			3.58	0.500 U	2.89	0.500 U	0.500 U	7.77	24.4 J	1.00 U	0.500 U	2.34	0.500 U	0.500 U	0.500 U	1.78	8.00	0.200 U		
03/25/14			5.84	0.500 U	1.66	0.500 U	0.500 U	5.66	165	1.00 U	0.500 U	0.524	0.500 U	0.500 U	0.500 U	0.781	1.11	0.200 U		
09/23/14			1.72	0.500 U	3.56	0.500 U	0.500 U	6.35	45.5	1.00 U	0.519	1.75	0.500 U	0.500 U	0.500 U	4.06	6.80	0.200 U		
03/17/15			0.64 J	1.0 U	1.2 J	0.50 U	0.50 U	5.4	58.5	1.0 U	1.0 U	0.25 J	5.0 U	0.50 U	1.0 U	1.0 U	0.44 J	1.01 J	0.50 U	
09/17/15			1.0 U	1.0 U	0.99 J	0.50 U	0.50 U	6.2	45.5	1.0 U	1.0 U	0.38 J	5.0 U	0.50 U	1.0 U	1.0 U	0.74 J	5.2	0.21 J	
MW-5		04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	3.9	0.5 U	0.5 U	340	0.5 U	42	0.5 U	0.5 U	0.2 U
	4/1/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	3.9	0.5 U	0.5 U	270	0.5 U	44	0.5 U	0.5 U	0.2 U	
	04/09/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10 U	10 U	10 U	1,100	10 U	35	10 U	10 U	4.0 U	
	04/16/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	5.0 J	10 U	10 U	780	10 U	42	10 U	10 U	4.0 U	
	05/06/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	3.2 J	10 U	10 U	640	10 U	36	10 U	10 U	2.0 U	

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected Solubility in Water:	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro- propane	Benzene	Chloro- ethane	Chloro- form	cis-1,2-DCE	Ethyl- benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1E+06	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600
MW-5 (continued)	06/09/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	3.2	0.5 U	0.5 U	670	0.5 U	33	0.5 U	0.5 U	0.2 U
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	4.6	0.5 U	0.5 U	640	0.5 U	31	0.5 U	0.5 U	0.2 U
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	4.6	0.5 U	0.5 U	640	0.5 U	31	0.5 U	0.5 U	0.2 U
	09/28/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	5.0 U	10 U	10 U	514	10 U	22.6	10 U	10 U	2.0 UJ
	9/28/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.43	0.5 U	0.5 U	514	0.5 U	21.7	0.5 U	0.5 U	0.2 UJ
	03/03/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.12	0.5 U	0.5 U	607	0.5 U	30.2	0.5 U	0.550	0.2 U
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.31	0.5 U	0.5 U	386	0.5 U	16.3	0.5 U	0.5 U	0.2 U
	09/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	7.28	0.5 U	0.5 U	682 J	0.5 U	30.2	0.5 U	0.5 U	0.590
	12/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	4.11	0.5 U	0.5 U	831	0.5 U	30.7	0.5 U	0.5 U	0.470
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	51.6	0.500 U	0.500 U	326	0.500 U	27.0	0.500 U	0.500 U	0.810
	06/26/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	50.0	0.500 U	0.500 U	316	0.500 U	37.9	0.500 U	0.500 U	1.40
	09/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	96.0	0.500 U	0.500 U	479	0.500 U	62.0	0.500 U	0.500 U	1.55
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	530	0.500 U	0.500 U	18.4	0.500 U	5.22	0.500 U	0.500 U	3.35
	03/06/13		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	286	0.5 U	0.5 U	106	0.5 U	55.4	0.500 U	0.5 U	4.57 J
	3/6/13 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	293	0.5 U	0.5 U	105	0.5 U	54.9	0.950	0.5 U	3.30 J
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	291	0.500 U	0.500 U	205	0.500 U	105	0.500 U	0.500 U	3.69
	09/26/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	209	0.500 U	0.500 U	297	0.500 U	273	0.500 U	0.500 U	2.67
	9/26/13 (DUP)		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	203	0.500 U	0.500 U	330	0.500 U	251	0.500 U	0.500 U	2.12
	03/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	453	0.500 U	0.500 U	86.8	0.500 U	14.9	0.500 U	0.500 U	10.1
	09/23/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	2.43	0.500 U	0.500 U	217	0.500 U	32.5	0.500 U	0.500 U	5.50
03/16/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	5.0 U	5.0 U	256	5.0 U	25 U	60.2	5.0 U	35.8	5.0 U	5.0 U	1.9 J	
09/15/15		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	35.4	10 U	50 U	335	10 U	37.0	10 U	10 U	5.0 U	
MW-6	03/30/10		0.6	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/30/10		1.51	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ
	09/21/11		1.15	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ
	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/28/12		1.74	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/27/13		1.59	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/24/14		1.46	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
09/17/15		1.4	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
MW-7	04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.3	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/28/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	1.38	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ
	03/02/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.98	0.5 U	0.5 U	4.18	0.5 U	0.5 U	0.920	1.16	0.2 U
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	1.88	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.07	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	12/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.86	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.94	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	06/26/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	5.38	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	3.02	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.52	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.63	0.500 U	0.920	0.500 U	0.500 U	0.200 U
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	4.79	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/24/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.89	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	6.56	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.14	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	5.0	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
09/14/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	1.3	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
MW-8	04/01/10		0.5 U	0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.4	0.5 U	0.5 U	0.5 U	0.5 U	5.0	0.5 U	0.5 U	0.3
	09/28/10		0.5 U	1.11	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.02	0.5 U	0.5 U	0.5 U	0.5 U	5.09	0.5 U	0.5 U	0.2 UJ
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.900	0.5 U	0.5 U	0.5 U	0.5 U	3.93	0.5 U	0.5 U	0.2 U
	09/26/11		0.5 U	1.25	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.98	0.5 U	0.5 U	0.5 U	0.5 U	3.91	0.5 U	0.5 U	0.700

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected Solubility in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro- propane	Benzene	Chloro- ethane	Chloro- form	cis-1,2-DCE	Ethyl- benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1E+06	1,000	LNAPL	LNAPL	
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5	
MW-8 (continued)	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.890	0.500 U	0.500 U	0.500 U	0.500 U	2.96	0.500 U	0.500 U	0.200 U	
	09/28/12		0.500 U	1.76	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	2.42 J	0.500 U	0.500 U	0.500 U	0.500 U	5.76	0.500 U	0.500 U	0.200 U	
	03/08/13		0.500 U	0.850	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.54	0.500 U	0.500 U	0.730	0.500 U	2.39 J	0.500 U	0.500 U	0.200 U	
	09/27/13		0.500 U	2.45	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.45	0.500 U	0.500 U	0.500 U	0.500 U	9.63	0.500 U	0.500 U	0.730	
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.99	0.500 U	0.500 U	0.200 U	
	09/23/14		0.500 U	1.65	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	6.07	0.500 U	0.500 U	0.500 U	0.500 U	6.47	0.500 U	0.500 U	0.200 U	
	03/16/15		1.0 U	0.41 J	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.70 J	1.0 U	5.0 U	0.32 J	1.0 U	2.1	1.0 U	1.0 U	0.50 U	
	09/16/15		1.0 U	1.7	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	2.8	1.0 U	5.0 U	0.50 U	1.0 U	7.4	1.0 U	1.0 U	0.31 J	
MW-9	03/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.8	0.5 U	1.0 U	15	0.5 U	0.5 U	0.5 U	0.5 U	1.3	0.5 U	0.5 U	3.9	
	09/28/10		0.51	0.5 U	0.5 U	0.5 U	0.5 U	1.70	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.38 J	0.5 U	0.5 U	0.2 UJ	
	9/28/10 (LAB DUP)		0.54	0.5 U	0.5 U	0.5 U	0.5 U	1.87	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.40 J	0.5 U	0.5 U	0.2 UJ	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.600	0.5 U	1.0 U	4.18	0.5 U	0.5 U	0.5 U	0.5 U	1.42	0.630	1.01	1.88	
	09/26/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.23	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.20 U	
	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.95	0.500 U	0.500 U	0.500 U	0.500 U	3.22	0.500 U	0.500 U	0.690
	09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.5 U	0.500 U	0.500 U	0.500 U	0.5 U	0.500 U	0.500 U	0.200 U	
	03/08/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.02	0.500 U	0.500 U	0.610	0.500 U	1.39 J	0.500 U	0.500 U	1.16 J
	09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.50	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.780
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.09	0.500 U	0.500 U	0.500 U	0.500 U	2.17	0.500 U	0.500 U	0.200 U
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.13	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.396	
03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.94 J	1.0 U	5.0 U	0.50 U	1.0 U	1.2	1.0 U	1.0 U	0.50 U		
09/16/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	2.5 U	
MW-10	03/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.1 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/28/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.630	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	09/26/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.02	0.500 U	0.500 U	0.610	0.500 U	1.39	0.500 U	0.500 U	0.200 U
	09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/26/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
03/27/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
09/14/15		1.0 UJ	1.0 UJ	2.0 UJ	0.50 UJ	0.50 UJ	0.50 UJ	1.0 UJ	1.0 UJ	1.0 UJ	1.0 UJ	5.0 UJ	0.50 UJ	1.0 UJ	1.0 UJ	1.0 UJ	1.0 UJ	1.0 UJ	0.50 UJ	
MW-11	04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	16	0.5 U	0.5 U	290	0.5 U	44	0.5 U	0.5 U	0.2 U	
	04/09/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10 U	10 U	10 U	850	10 U	35	10 U	10 U	4.0 U	
	04/16/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	22	10 U	10 U	500	10 U	66	10 U	10 U	4.0	
	05/06/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	24	10 U	10 U	530	10 U	43	10 U	10 U	1.0 J	
	06/09/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	11	0.5 U	0.5 U	680	0.5 U	33	0.5 U	0.5 U	0.28	
	6/9/10 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	9.3	0.5 U	0.5 U	580	0.5 U	31	0.5 U	0.5 U	0.21	
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	19	0.5 U	0.5 U	470	0.5 U	34	0.5 U	0.5 U	0.2 U	
MW-12	04/01/10		0.5 U	1.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	260	0.5 U	0.5 U	400	0.5 U	170	0.5 U	0.5 U	9.4	
	09/28/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	334	0.5 U	0.5 U	377	0.5 U	232	0.5 U	0.5 U	17.2	
	03/03/11		0.5 U	0.730	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	239	0.5 U	0.5 U	856	0.5 U	257	0.5 U	0.5 U	8.93	
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	314	0.5 U	0.5 U	429	0.5 U	215	0.5 U	0.5 U	11.7	
	09/22/11		0.5 U	2.33	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	747	0.5 U	0.5 U	128 J	0.5 U	461	0.5 U	0.5 U	94.6	
	9/22/11 (DUP)		0.5 U	2.11	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	680	0.5 U	0.5 U	200 J	0.5 U	529	0.5 U	0.5 U	93.3	
	12/07/11		0.5 U	1.35	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	478	0.5 U	0.5 U	461	0.5 U	409	0.5 U	0.5 U	47.5	
	03/07/12		0.500 U	1.32	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	579	0.500 U	0.500 U	337	0.500 U	155	0.500 U	0.500 U	26.3
	3/7/12 (DUP)		0.500 U	1.37	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	589	0.500 U	0.500 U	332	0.500 U	164	0.500 U	0.500 U	26.2
	06/26/12		0.500 U	1.31	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	636	0.500 U	0.500 U	407	0.500 U	218	0.500 U	0.500 U	35.2	
	10/02/12		0.500 U	2.71	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	961	0.500 U	0.500 U	47.6	0.500 U	217	0.500 U	0.500 U	100	
	12/19/12		0.500 U	2.36	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	676	0.500 U	0.500 U	151	0.500 U	225	0.500 U	0.500 U	41.1	
03/06/13		0.500 U	2.01	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	901	0.500 U	0.500 U	64.2	0.500 U	131	0.500 U	0.500 U	36.1		
06/06/13		0.500 U	1.34	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	576	0.500 U	0.500 U	293	0.500 U	312	0.500 U	0.500 U	34.7		

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected Solubility in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro- propane	Benzene	Chloro- ethane	Chloro- form	cis-1,2-DCE	Ethyl- benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1.E+06	1,000	LNAPL	LNAPL	
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5	
MW-12 (continued)	09/25/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	78.4	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	43.8	
	03/25/14		0.500 U	1.61	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	693	0.500 U	0.500 U	140	0.500 U	211	0.500 U	0.500 U	24.8	
	3/25/14 (DUP)		0.500 U	1.61	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	633	0.500 U	0.500 U	144	0.500 U	226	0.500 U	0.500 U	24.6	
	09/23/14		0.500 U	1.27	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	996	0.500 U	0.500 U	9.99	0.500 U	40.0	0.500 U	0.500 U	74.0	
	03/16/15		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	464	10 U	50 U	24.7	10 U	38.1	10 U	10 U	12.9	
	3/16/15 (DUP)		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	468	10 U	50 U	21.9	10 U	36.3	10 U	10 U	16.2	
	09/15/15		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	581	10 U	50 U	6.2	10 U	14.7	10 U	10 U	35.7	
09/15/15 (DUP)		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	595	10 U	50 U	10	10 U	15.9	10 U	10 U	41.0		
MW-13	03/29/10		180	10 U	86	10 U	10 U	10 U	280	20 U	500	710	10 U	10 U	10 U	10 U	2,200	1,700	900	
	3/29/10 (LAB DUP)		200	10 U	110	10 U	10 U	10 U	310	20 U	580	810	10 U	10 U	10 U	10 U	2,400	1,900	890	
	04/07/10		480	10 U	540	10 U	10 U	10 U	480	20 U	1,800	2,100	10 U	10 U	10 U	10 U	4,600	4,200	2,700	
	04/16/10		1,100	20	640	10 U	10 U	10 U	840	20 U	3,300	2,800	10 U	10 U	10 U	10 U	5,400	5,800	4,000	
	05/06/10		820	11	340	10 U	10 U	10 U	640	20 U	1,900	2,000	10 U	5.0 U	10 U	5.0 U	6,200	4,900	3,100	
	06/09/10		720	11	280	10 U	10 U	10 U	1,200	20 U	1,500	1,800	10 U	20	10 U	5.0 U	5,600	3,900	4,700	
	07/06/10		510	9.5	280	10 U	10 U	10 U	1,400	20 U	1,300	1,700	10 U	5.0 U	10 U	5.0 U	8,300	3,500	6,500	
	09/30/10		71.0	10 U	130	10 U	10 U	10 U	820	20 U	56.8	1,010	10.8	5.0 U	10 U	5.0 U	4,180	2,560	221	
	03/03/11		97.4	1.27	143	0.5 U	0.5 U	0.720	435	1.0 U	245	521	0.5 U	1.14	0.5 U	0.5 U	2,870	3,320	533	
	06/23/11		25.6	0.5 U	105	0.5 U	0.610 J	0.500	216	1.0 U	18.0	619	0.84	0.5 U	0.5 U	0.5 U	1,170	2,405	99.3	
	09/22/11		47.5	0.5 U	143	0.5 U	0.5 U	0.680	0.5 U	1.0 U	64.7	1,110	2.39	0.5 U	0.5 U	0.5 U	4,100	4,480	302	
	12/07/11		30.2	0.5 U	218	0.5 U	0.5 U	0.630	518	1.0 U	44.2	1,270	1.72	0.680	0.5 U	0.5 U	3,690	5,170	285	
	12/7/11 (DUP)		30.4	0.5 U	212	0.5 U	0.5 U	0.630	521	1.0 U	42.0	1,090	1.83	0.700	0.5 U	0.5 U	3,360	4,820	270	
	03/07/12		14.2	0.500 U	192	0.500 U	0.500 U	0.600	313	1.00 U	14.7	921	0.870	0.500 U	0.500 U	0.500 U	1,230	3,862	93.0	
	06/27/12		22.7	0.500 U	102	0.500 U	0.500 U	0.590	318	1.00 U	19.1	606	0.800	0.500 U	0.500 U	0.500 U	574	2,437	103	
	10/02/12		3.0	0.500 U	100	0.500 U	0.500 U	0.730	256	1.00 U	1.91	438	0.500 U	0.500 U	0.500 U	0.500 U	26.4	1,748	2.11	
	12/19/12		2.4	0.500 U	120	0.500 U	0.500 U	0.500 U	233	1.00 U	0.500 U	464	0.500 U	0.500 U	0.500 U	0.500 U	94.0	1,827	1.08	
	03/07/13		0.500 U	0.500 U	113 J	0.500 U	0.770	0.860	278	1.00 U	0.500 U	648 J	0.500 U	0.500 U	0.500 U	0.500 U	19.2	2,628 J	0.960 J	
	06/06/13		1.12	0.500 U	97.0	0.500 U	0.500 U	0.680	291	1.00 U	0.930	388	0.560	0.500 U	0.500 U	0.500 U	64.0	1,409	1.81	
	09/25/13		2.50	0.500 U	205	0.500 U	0.840	0.530	250	1.00 U	0.500 U	611	0.690	0.500 U	0.500 U	0.500 U	289	2,250	0.200 U	
03/26/14		0.500 U	0.500 U	74.2	0.500 U	0.500 U	0.500 U	147	1.00 U	1.04	205	0.500 U	0.500 U	0.500 U	0.500 U	1.71	504.67	0.200 U		
09/23/14		1.07	0.500 U	133	0.500 U	0.500 U	0.500 U	162	1.00 U	0.500 U	475	0.500 U	0.549	0.500 U	0.500 U	40.9	1,873	0.200 U		
03/17/15		0.21 J	1.0 U	11.1	0.50 U	0.50 U	0.50 U	6.0	1.0 U	1.3	32.3	5.0 U	0.50 U	1.0 U	1.0 U	1.8	89.1	0.50 U		
09/15/15		0.37 J	1.0 U	38.7	0.50 U	0.50 U	0.25 J	41.4	1.0 U	0.65 J	94.6	5.0 U	0.50 U	1.0 U	1.0 U	2.7	197.2	0.79		
MW-14	03/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	9/30/10 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.640	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/21/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
MW-15	03/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	3/30/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
09/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
03/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
3/7/11 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
09/21/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.240	
10/01/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected Solubility in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro- propane	Benzene	Chloro- ethane	Chloro- form	cis-1,2-DCE	Ethyl- benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride		
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1E+06	1,000	LNAPL	LNAPL		
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5		
MW-15 (continued)	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
	09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 UJ	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
	03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	0.61 J	1.0 U	0.50 U	
	09/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	0.28 J	1.0 U	0.50 U	
MW-16	04/02/10		0.5 U	0.5 U	0.9	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	2.6	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	6.6	7.9	0.9	
	10/01/10		0.42 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	10/1/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.66 J	
	03/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/26/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.650	
	03/08/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.520
	10/01/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 UJ	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.510
	03/08/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 UJ	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/27/14		0.880	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.700
	09/25/14		0.568	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
03/18/15		0.55 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	0.45 J	1.0 U	0.46 J		
09/17/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	5.0 U	5.0 U	5.0 U	1.8 J	5.0 U	2.5 U	2.5 U	5.0 U	2.5 J	5.0 U	5.0 U	2.5 U		
MW-17	03/30/10		1.7	0.5 U	7.7	1.3	0.5 U	9.0	110	1.0 U	0.5 U	0.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5	75	0.2	
	10/01/10		1.79	0.5 U	8.82	0.5 U	0.5 U	5.84	54.6	1.0 U	0.5 U	0.55	0.57 J	0.5 U	0.5 U	0.5 U	0.5 U	0.76	68.7	0.2 UJ	
	03/07/11		2.00	0.5 U	10.5	1.67	0.5 U	8.85	61.7	1.0 U	0.5 U	2.10	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.950	60.2	0.2 U	
	06/23/11		1.63	0.5 U	1.0 U	2.56	0.5 UJ	18.5	240	1.0 U	0.5 U	4.50	1.13	0.5 U	0.5 U	0.5 U	0.5 U	1.20	34.2	0.420	
	09/23/11		1.91	0.5 U	12.9	3.19	0.5 U	22.2	0.5 U	1.0 U	0.5 U	9.81	1.84	0.5 U	0.5 U	0.5 U	1.63	80.7	0.460		
	03/08/12		1.67	0.500 U	12.8	3.23	0.500 U	22.9	421	1.00 U	0.500 U	0.690	2.69	0.500 U	0.500 U	0.500 U	0.500 U	0.810	22.8	0.200 U	
	06/27/12		1.95	0.500 U	11.1	3.02	0.500 U	20.0	319	1.00 U	0.500 U	0.540	1.39	0.500 U	0.500 U	0.500 U	0.500 U	0.730	12.0	0.200 U	
	10/01/12		2.11	0.500 U	17.8	0.500 U	0.500 U	27.9	574	1.00 U	0.500 U	1.02	2.26	0.500 UJ	0.500 U	0.500 U	0.500 U	0.910	19.3	0.200 U	
	12/19/12		1.86	0.500 U	14.9	0.500 U	0.500 U	19.6	331	1.00 U	0.500 U	0.710	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.940	17.2	0.200 U	
	03/07/13		0.500 U	0.500 U	0.5 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.710	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	17.2	0.200 U	
	06/06/13		1.69	0.500 U	13.2	0.500 U	0.500 U	24.5	552	1.00 U	0.500 U	0.500 U	2.55	0.500 U	0.500 U	0.500 U	0.500 U	0.770	17.97	0.200 U	
	09/26/13		1.76	0.500 U	21.5	3.91	0.500 U	28.8	484	1.00 U	0.500 U	0.500 U	3.26	0.500 U	0.500 U	0.500 U	0.500 U	0.790	17.28	0.200 U	
	03/26/14		1.01	0.500 U	10.6	1.59	0.500 U	9.71	175	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	7.80	0.200 U	
09/25/14		1.63	0.500 U	24.7	0.500 U	0.500 U	14.3	202	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.656	10.74	0.200 U		
03/19/15		1.2 J	5.0 U	4.6 J	1.7 J	2.5 U	13.3	172	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	1.8 J	2.5 U		
09/17/15		5.0 U	5.0 U	7.7 J	1.8 J	2.5 U	16.2	219	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	3.4 J	2.5 U		
MW-18	03/30/10		1.1	0.5 U	0.5 U	0.5 U	0.5 U	0.6	4.5	1.0 U	0.2 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	0.09 J		
	09/28/10		0.34 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.39	1.0 U	4.40	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.26 J	0.62	5.33	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	2.77	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.29	0.2 U	
	3/4/11 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.21	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.42	0.2 U	
	06/23/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 UJ	0.5 U	0.99	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.37	0.590	
	09/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 UJ	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/07/12		0.56	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.95	1.00 U	213	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.86	0.770	115	
	06/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.81	1.00 U	4.48	0.550	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.08	1.090	5.34	
	10/01/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	14.8	0.500 U	0.500 U	0.500 UJ	0.500 U	0.500 U	1.13	0.500 U	0.500 U	22.7	
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.58	1.00 U	0.91	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.810	1.08	
	12/19/12 (DUP)		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.70	1.00 U	1.25	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.840	0.95	
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.570	1.00 U	0.690	0.930	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.790	0.590 J	
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.42	1.00 U	0.900	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.520	1.20	
09/26/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	2.85	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500	0.200 U		
03/26/14		0.500 U	0.500 U	0.504	0.500 U	0.500 U	0.500 U	1.34	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.970	0.200 U		
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.46	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.6	1.0 U	0.23 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.47 J	1.0 U	0.25 J	
09/14/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	0.26 J	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.22 J		
MW-19	03/30/10		0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.7	2.4	1.0 U	1.1	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	5.0		
	3/30/10 (LAB DUP)		0.9																		

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected Solubility in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro- propane	Benzene	Chloro- ethane	Chloro- form	cis-1,2-DCE	Ethyl- benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1E+06	1,000	LNAPL	LNAPL
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-19 (continued)	03/07/11		0.5 U	0.5 U	3.37	0.5 U	0.5 U	0.890	2.33	1.0 U	99.0	9.55	0.5 U	0.5 U	0.5 U	0.5 U	7.30	31.6	64.8
	09/21/11		2.71	3.26	1.96	0.5 U	0.5 U	1.01	6.56	1.0 U	1,330	6.29	0.5 U	0.5 U	0.5 U	0.5 U	16.8	13.27	633
	12/07/11		4.99	1.06	5.02	0.5 U	0.5 U	1.22	16.0	1.0 U	833	17.9	0.5 U	0.5 U	0.5 U	0.5 U	54.2	53.5	1,360
	03/08/12		4.70	0.500 U	6.48	0.500 U	0.500 U	1.42	11.1	1.00 U	324	30.5	0.500 U	0.500 U	0.500 U	0.500 U	64.3	85.2	572
	06/27/12		0.73	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	116	1.26	0.500 U	0.500 U	0.500 U	0.500 U	0.85	3.11	118
	09/28/12		1.45	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.76	1.00 U	73.0 J	2.42	0.500 U	0.500 U	0.500 U	0.500 U	1.14	4.73	81
	12/19/12		1.80	0.500 U	1.11	0.500 U	0.500 U	0.500 U	2.97	1.00 U	128	3.76	0.500 U	0.500 U	0.500 U	0.500 U	3.02	4.83	342
	03/05/13		10.4	4.33	8.80	0.500 U	0.500 U	2.31	0.500 U	1.00 U	1,890	43.0	0.750	0.500 U	0.500 U	0.500 U	54.3	93.1	1,420
	06/06/13		6.35 J	3.58	9.91	0.500 U	0.500 U	1.95	43.6	1.00 U	2,560 J	45.8	0.500 U	0.500 U	0.500 U	0.500 U	63.3	85.3	2,240 J
	6/6/13 (DUP)		8.65 J	4.68	11.3	0.500 U	0.500 U	2.46	59.0	1.00 U	4,300 J	52.5	0.570	0.500 U	0.500 U	0.500 U	75.8	97.2	3,620 J
	09/25/13		4.88	0.500 U	10.3	0.500 U	0.500 U	1.41	20.9	1.00 U	285	36.8	0.500 U	0.500 U	0.500 U	0.500 U	42.3	66.8	664
	03/27/14		0.500 U	0.500 U	1.05	0.500 U	0.500 U	0.500 U	0.850	1.00 U	1.79	3.28	0.500 U	0.500 U	0.500 U	0.500 U	1.91	6.81	4.63
	3/27/14 (DUP)		0.960	0.500 U	1.03	0.500 U	0.500 U	0.500 U	0.880	1.00 U	1.86	3.37	0.500 U	0.500 U	0.500 U	0.500 U	1.92	6.97	4.87
	09/25/14		2.17	0.500 U	11.2	0.500 U	0.500 U	0.688	5.47	1.00 U	0.620	9.91	0.500 U	0.500 U	0.500 U	0.500 U	0.648	35.82	0.200 U
	03/19/15		2.3	1.0 U	16.6	0.50 U	0.50 U	1.1	2.9	1.0 U	0.30 J	1.9	5.0 U	0.50 U	1.0 U	1.0 U	0.73 J	7.52	0.34 J
	3/19/15 (DUP)		2.1	1.0 U	13.8	0.50 U	0.50 U	1.0	2.4	1.0 U	0.28 J	1.3	5.0 U	0.50 U	1.0 U	1.0 U	0.68 J	6.53	0.31 J
	09/15/15		1.3 J	1.0 UJ	16.3 J	0.50 UJ	0.50 UJ	1.0 J	14.5 J	1.0 UJ	0.31 J	11.7 J	5.0 UJ	0.50 UJ	1.0 UJ	1.0 UJ	6.8 J	15.1 J	0.48 J
	09/15/15 (DUP)		1.2 J	1.0 UJ	14.9 J	0.50 UJ	0.50 UJ	1.0 J	12.9 J	1.0 UJ	0.30 J	10.4 J	5.0 UJ	0.50 UJ	1.0 UJ	1.0 UJ	5.9 J	13.4 J	0.42 J
MW-20	03/29/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	18 J	140	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0	7.1	0.2
	10/01/10		0.5 U	0.5 U	1.27	0.5 U	0.5 U	15.2	195	1.0 U	0.5 U	0.5 U	0.73 J	0.5 U	0.5 U	0.5 U	0.94	4.26	0.12 J
	03/02/11		0.5 U	0.5 U	1.05	0.5 U	0.5 U	12.8	75.5	1.0 U	1.38	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.58	17.7	0.2 U
	09/26/11		0.5 U	0.5 U	0.890	0.5 U	0.5 U	13.9	161	1.0 U	0.5 U	0.5 U	0.620	0.5 U	0.5 U	0.5 U	0.930	4.33	0.2 U
	03/08/12		0.500 U	0.500 U	0.600	0.500 U	0.500 U	10.9	71.6	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.880	4.69	0.200 U
	10/01/12		0.500 U	0.500 U	1.26	0.500 U	0.500 U	14.8	161	1.00 U	0.500 U	0.500 U	0.500 U	0.500 UJ	0.500 U	0.500 U	0.950	5.10	0.200 U
	03/08/13		0.500 U	0.500 U	0.5 U	0.500 U	0.500 U	0.500 U	4.40	1.00 U	0.500 U	0.890	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.790	0.200 U
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	10.3	100	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.530	3.28	0.200 U
	09/27/13		0.500 U	0.500 U	1.10	0.500 U	0.500 U	16.0	122	1.00 U	0.500 U	0.500 U	0.670	0.500 U	0.500 U	0.500 U	1.06	5.51	0.200 U
	03/27/14		0.500 U	0.500 U	1.15	0.500 U	0.500 U	11.7	92.0	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.830	5.00	0.200 U
	09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	11.7	127	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/18/15		1.0 U	1.0 U	0.41 J	0.50 U	0.50 U	9.5	70.2	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.85 J	2.26	0.50 U
09/16/15		1.0 U	1.0 U	0.31 J	0.50 U	0.50 U	14.8	171	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.72 J	3.9	0.50 U	
MW-21	03/26/10		10 U	10 U	58	0.5 U	0.5 U	18	400	1.0 U	280	740	0.5 U	0.5 U	8.8 J	0.5 U	2,400	1,800	350
	04/16/10		810	19	190	10 U	10 U	10 U	1,400	20 U	3,800	1,600	10 U	10 U	70	10 U	4,700	3,800	2,100
	05/06/10		220	5.0 U	190	10 U	10 U	10 U	1,200	20 U	370	1,900	10 U	5.0 U	34	5.0 U	5,400	4,600	490
	5/6/10 (DUP)		210	5.0 U	180	10 U	10 U	10 U	1,200	20 U	380	1,800	10 U	5.0 U	34	5.0 U	5,400	4,600	520
	06/09/10		110	5.0 U	49	10 U	10 U	10 U	1,000	20 U	67	540	10 U	5.0 U	16	5.0 U	3,200	1,400	150
	07/06/10		90	5.0 U	98	10 U	10 U	10 U	1,600	20 U	42	640	10 U	5.0 U	13	5.0 U	5,500	1,600	210
	7/6/10 (LAB DUP)		80	5.0 U	76	10 U	10 U	10 U	1,500	20 U	34	670	10 U	5.0 U	11	5.0 U	5,000	1,500	170
	09/30/10		90.6	5.0 U	142	10 U	10 U	10 U	1,120	20 U	131	1,120	11.0	5.0 U	10 U	5.0 U	4,890	2,880	243
	03/02/11		288	9.28	174	0.5 U	0.5 U	0.750	1,130	1.0 U	3,330	1,045	4.61	1.92	34.7	2.11	4,630 J	4,250	1,030
	3/2/11 (DUP)		295	9.09	175	0.5 U	0.5 U	0.820	921	1.0 U	2,820	899	4.93	1.81	35.5	1.95	3,830	3,640	875
	3/2/11 (LAB DUP)		286	9.12	177	0.5 U	0.5 U	0.780	869	1.0 U	2,760	873	4.73	1.85	34.3	1.97	3,760	3,560	912
	06/23/11		219	9.72	171	0.5 U	1.15 J	0.790	921	1.0 U	2,560	983	3.04	0.780	51.2	1.44	3,630	3,720	1,290
	6/23/11 (DUP)		243	9.83	200	0.5 U	0.5 UJ	0.800	983	1.0 U	2,630	1,050	3.06	0.630	48.9	1.38	3,760	4,020	1,350
	09/22/11		112	2.72	134	0.5 U	0.5 U	0.790	0.5 U	1.0 U	842	926	4.92	0.740	5.26	0.940	6,060	3,822	1,010
	12/07/11		115	5.62	185	0.5 U	0.5 U	0.770	1,190	1.0 U	1,890	1,350	3.82	1.12	8.73	1.15	6,720	5,520	1,460
	03/08/12		70.6	2.44	128	0.500 U	0.500 U	0.660	913	1.00 U	979	1,050	2.91	1.02	4.64	0.710	5,250	4,430	801
	06/26/12		96.0	5.01	158	0.500 U	0.500 U	0.810	962	1.00 U	2,000	1,460	2.24	1.86	7.19	0.940	5,940	5,930	1,040 J
	10/02/12		73.5	4.27	156	0.500 U	0.500 U	0.970	1,170	1.00 U	1,530	1,560	2.76	1.19	4.37	1.59	6,710	6,540	1,610
	10/2/12 (DUP)		76.0	4.26	154	0.500 U	0.500 U	0.960	1,130	1.00 U	1,500	1,540	2.68	1.07	4.04	0.810	6,280	6,340	1,590
	12/20/12		76.0	3.17	154	0.500 U	0.500 U	0.880	825	1.00 U	1,070	1,490	1.35	0.86	0.500 U	0.500 U	5,600	6,200	1,210
	03/06/13		72.5	2.85	82.0	0.500 U	0.500 U	0.530	615	1.00 U	1,240	1,470	2.27	1.55	1.42	1.26	4,360	6,450	1,120
06/06/13		89.0	0.500 U	121	0.500 U	0.500 U	0.810	928	1.00 U	988	1,290	2.27	1.17	2.81	0.500	4,520	5,310	663	
09/25/13		82.6	1.80	297	0.500 U	0.500 U	0.770	579	1.00 U	712	2,060	1.99	0.500 U	3.02	0.500 U	5,290	8,710	666	
03/26/14		58.9	0.500 U	237	0.500 U	0.500 U	0.810	615	1.00 U	227	1,380	0.880	1.17	0.500 U	0.500 U	2,650	5,840	449	

Table 3

**Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1E+06	1,000	LNAPL	LNAPL	LNAPL
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5	
MW-21 (continued)	09/24/14		60.0 J	0.500 U	317 J	0.500 U	2.29 J	0.810 J	477 J	1.00 UJ	57.9 J	1,670 J	1.36 J	0.500 U	0.500 U	0.500 U	1,480 J	7,900 J	184 J	
	03/17/15		30.8 J	50 U	163	25 U	25 U	25 U	317	50 U	50 U	1,120	250 U	25 U	50 U	50 U	270	4,922	13.1 J	
	09/15/15		25 U	25 U	207	13 U	13 U	13 U	350	25 U	6.7 J	951	130 U	13 U	25 U	25 U	189	5,257	13.4	
MW-22	03/29/10		24	0.5 U	44	0.5 U	0.5 U	0.5 U	480	1.0 U	0.5 U	650	10 U	25 U	0.5 U	0.5 U	840	1,500	7.4	
	09/30/10		10 U	0.5 U	45.2	10 U	10 U	10 U	611	20 U	2.6 J	296	10.8	5.0 U	10 U	0.5 U	24.4	751	2.0 UJ	
	03/04/11		26.9	0.780	161	0.540	0.5 U	1.20	531	1.0 U	184	531	0.5 U	0.500 U	0.5 U	16.7	596	2,750	74.1	
	06/23/11		3.98	0.660	45.9	0.5 U	0.5 UJ	0.64	173	1.0 U	2.27	148	0.580	0.5 U	0.5 U	0.5 U	55.4	1,008	1.13	
	09/23/11		7.40	0.5 U	74.2	0.5 U	0.5 U	0.920	0.5 U	1.0 U	2.10	422	1.19	0.5 U	0.5 U	0.5 U	79.0	1,828	9.27	
	12/07/11		13.1	0.5 U	137	0.5 U	0.5 U	0.550	272	1.0 U	10.1	760	0.770	0.5 U	0.5 U	0.5 U	1,390	3,081	32.4	
	03/08/12		13.1	0.500 U	169	0.500 U	0.500 U	0.500 U	286	1.00 U	1.15	815	0.520	0.500 U	0.500 U	0.500 U	1,630	3,388	6.8	
	06/26/12		38.9	0.560	166	0.500 U	0.500 U	0.730	280	1.00 U	1,300	807	0.510	0.500 U	0.500 U	0.500 U	1,910	3,336	1,750 J	
	6/26/12 (DUP)		38.3	0.500 U	178	0.500 U	0.500 U	0.720	282	1.00 U	1,030	743	0.500 U	0.500 U	0.500 U	0.500 U	1,750	3,002	1,230 J	
	10/02/12		30.4	0.500 U	136	0.500 U	0.500 U	0.680	204	1.00 U	623	552	0.500 U	0.500 U	0.500 U	0.500 U	728	2,643	1,520	
	12/19/12		9.76	1.63	172	0.500 U	0.500 U	0.500 U	278	1.00 U	244	732	0.500 U	1.05	0.500 U	0.500 U	64.5	260	3,455	208
	03/06/13		17.4	6.77	51.5 J	0.500 U	0.500 U	0.560	0.5 U	1.00 U	1,310	376 J	1.06	4.41	1.26	185	156	2,168 J	712	
	06/06/13		21.9	2.60	69.5	0.500 U	0.500 U	0.510	88.0	1.00 U	1,760	199	0.500 U	0.500 U	1.86	0.500 U	550	1,004	1,600	
	09/25/13		7.88	0.500 U	168	0.500 U	0.500 U	0.500 U	104	1.00 U	25.0	256	0.500 U	0.500 U	0.500 U	0.500 U	25.0	1,911	45.6	
	03/26/14		9.71	0.789	105	0.500 U	0.500 U	0.500 U	113	1.00 U	426	121	0.500 U	0.500 U	0.500 U	0.500 U	55.1	1,207.4	422	
09/24/14		3.14	0.500 U	121	0.500 U	0.500 U	0.500 U	45.1	1.00 U	0.500 U	48.3	0.500 U	0.500 U	0.500 U	0.500 U	2.90	1,423.1	0.200 U		
09/24/14 (DUP)		3.19	0.500 U	142	0.500 U	0.500 U	0.500 U	59.5	1.00 U	0.500 U	43.7	0.500 U	0.500 U	0.500 U	0.500 U	2.56	1,283.5	0.345		
03/17/15		7.5 J	25 U	68.4	13 U	13 U	13 U	22.7 J	25 U	1,100	40.5	130 U	13 U	25 U	25 U	81.3	556.1	535		
09/15/15		1.9 J	2.0 UJ	36.0 J	1.0 UJ	1.0 UJ	1.0 UJ	18.9 J	2.0 UJ	64.1 J	6.6 J	10 UJ	1.0 UJ	2.0 UJ	2.0 UJ	11.4 J	235.6 J	86.1 J		
MW-23	04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5	0.5 U	0.5 U	2.9	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/28/10		0.31 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.63	0.5 U	0.5 U	1.17	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	03/02/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.680	1.0 U	5.73	0.730	0.5 U	1.76	0.5 U	0.5 U	2.32	3.43	0.2 U	
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	0.5 U	3.16	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/23/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	0.5 U	2.16	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	12/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	0.5 U	3.56	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.04	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	06/26/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	4.86	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.64	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.83	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.42	1.08	0.500 U	1.85	0.500 U	1.03	0.650	1.68	0.200 U	
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	5.46	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/24/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.26	0.500 U	0.500 U	2.17	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	7.36	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	3.32	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
09/25/14 (DUP)		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	3.23	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	6.4	1.0 U	0.33 J	1.0 U	1.0 U	0.50 U		
09/14/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	5.1	1.0 U	0.27 J	1.0 U	1.0 U	0.50 U		
MW-24	03/26/10		540	17	230	0.5 U	0.5 U	0.9	160	4.5	4,100	1,900	0.5 U	0.5 U	680	160	4,800	3,600	1,200	
	04/16/10		260	10 U	18	10 U	10 U	10 U	1,100	20 U	80	1,300	10 U	10 U	10 U	5.0 U	3,800	3,300	320	
	05/06/10		820	5.0 U	72	10 U	10 U	10 U	900	20 U	930	1,800	10 U	5.0 U	10 U	5.0 U	6,200	4,000	1,900	
	5/6/10 (LAB DUP)		850	5.0 U	71	10 U	10 U	10 U	970	20 U	980	1,800	10 U	5.0 U	10 U	5.0 U	6,800	4,400	2,000	
	06/09/10		1,300	22	130	10 U	10 U	10 U	89	20 U	2,200	1,600	10 U	2.2 J	97	5.2	5,900	3,600	3,400	
	07/06/10		940	14	180	10 U	10 U	10 U	1,200	20 U	2,100	1,200 J	10 U	5.0 U	120	5.0 U	7,300	2,900	4,200	
	7/6/10 (DUP)		1,100	14	140	10 U	10 U	10 U	1,100	20 U	2,400	830 J	10 U	5.0 U	130	5.0 U	6,600	2,300	3,400	
MW-25	03/29/10		25	0.5 U	160	0.9	0.5 U	1.9	410	1.1	2.2	940	0.5 U	0.5 U	0.5 U	0.4	1,200	1,600	2.7	
	04/07/10		48	10 U	180	10 U	10 U	10 U	730	20 U	10 U	1,700	10 U	10 U	10 U	10 U	3,100	2,900	12	
	04/16/10		74	10 U	310	10 U	10 U	10 U	1,900	20 U	10 U	2,200	10 U	10 U	10 U	10 U	4,100	5,100	10	
	4/16/10 (LAB DUP)		70	10 U	290	10 U	10 U	10 U	1,800	20 U	10 U	2,100	10 U	10 U	10 U	10 U	4,000	5,000	9.2	
	05/06/10		32	5.0 U	130	10 U	10 U	10 U	1,100	20 U	5.0 U	1,200	10 U	5.0 U	10 U	5.0 U	2,900	3,200	2.0	
	06/09/10		29	5.0 U	110	10 U	10 U	10 U	820	20 U	5.0 U	680	10 U	21	10 U	5.0 U	1,200	1,700	2.0 U	
	07/06/10		25	0.5 U	79	0.5 U	0.5 U	0.5 U	640	1.0 U	0.5 U	480	0.5 U	2.9	0.5 U	0.5 U	800	980	4.0	

Table 3

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected Solubility in Water: Final Cleanup Levels	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5.1E+06	3,350,000	LNAPL	8.7E+06		0.8	LNAPL	8.2E+06	4E+06	LNAPL	2.0E+07	200,000	7E+05	1.E+06	1,000	LNAPL	LNAPL
			800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-26	04/01/10		0.5 U	1.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	20	0.5 U	0.5 U	380	0.5 U	37	0.5 U	0.5 U	0.2 U
	04/09/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10	10 U	10 U	570	10 U	28	10 U	10 U	6.4
	4/9/10 (LAB DUP)		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10	10 U	10 U	550	10 U	27	10 U	10 U	6.2
	04/16/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	16	10 U	10 U	320	10 U	32	10 U	10 U	8.8
	05/06/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	11	10 U	10 U	300	10 U	28	10 U	10 U	5.2
	06/09/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	14	10 U	10 U	350	10 U	31	10 U	10 U	12
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	12	0.5 U	0.5 U	300	0.5 U	29	0.5 U	0.5 U	9.0
MW-27	09/24/14		0.569	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/18/15		0.33 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.43 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.45 J	1.0 U	0.50 U
	09/16/15		0.46 J	1.0 U	2.0 U	0.50 U	0.50 U	0.43 J	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	0.38 J	0.50 U
MW-28	09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/19/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	0.60 J	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.56 J	1.0 U	0.50 U
	09/17/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	2.6 J	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	2.5 U
INJ-1	07/09/01		9.3	0.65 J	NA	0.58 U	0.62 U	0.5 U	25	0.48 U	29	NA	U	620	0.56 U	97	NA	NA	2.9
	11/20/01		1.2	0.5 U	NA	0.5 U	0.5 U	0.21 U	2.8	0.5 U	8.1	0.5 U	1 U	17	0.5 U	30	0.5 U	0.5 U	0.50 U
	06/11/02		0.60 J	1.9	0.29 U	0.23 U	0.26 U	NA	0.46 U	0.2 U	520	0.26 U	0.39 U	8.5	0.23 U	3.7	0.2 U	0.6 U	0.44 J
INJ-2	07/09/01		< 2.3 U	3 U	NA	2.9 U	3.1 U	0.5 U	4.4 U	2.4 U	200	NA	4.9 U	6,300	2.8 U	240	NA	NA	5.5 J
	10/15/01	18	<0.5 U	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	1.1	1.6	1 U	33	0.5 U	1.8	0.5 U	6	0.5 U
	10/22/01	18	<0.5 U	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	2	2.9	1 U	57	0.5 U	2.8	0.53	11.3	0.5 U
	10/29/01	18	<0.5 U	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	2.9	1.4	1 U	68	0.5 U	4.3	0.65	6.8	0.5 U
	11/19/01		<0.5 U	0.5 U	NA	0.5 U	0.5 U	1.1 U	0.50 U	0.5 U	7.3	0.89	1 U	230	0.5 U	9.2	0.5 U	4.4	0.5 U
	06/11/02		< 0.91 U	5.4	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,100	1.3 U	2 U	1,000	1.2 U	600	0.98 U	2.9 U	2.2 U
	06/10/03		< 0.91 U	5.3	1.5 U	1.2 U	1.3 U	NA	2.3 U	0.96 U	2,100	1.3 U	2 U	2,700	1.2 U	610	1.1 JB	2.9 U	2.2 U
INJ-3	07/09/01		3.4	0.95 J	NA	0.58 U	0.62 U	1 U	5.9	0.48 U	39	NA	0.97 U	520	0.56 U	250	NA	NA	7.3
	11/20/01		1.0 U	1.0 U	NA	1.0 U	1.0 U	0.53 U	1.0 U	1.0 U	49	1.0 U	2 U	670	1.0 U	130	1.0 U	1.0 U	1.8
	06/11/02		1.2 J	3.4	0.71 U	0.57 U	0.62 U	1.3	1.2 U	0.48 U	1,200	0.65 U	0.97 U	530	0.57 U	240	0.49 U	1.5 U	180
	12/17/02		2.0	0.53	2 U	0.5 U	0.5 U	1.2	0.50 U	0.5 U	250	0.5 U	2 U	150	0.5 U	100	0.5 U	0.5 U	90
	12/17/02 (DUP)		1.9	0.6	2 U	0.5 U	0.5 U	0.21 U	0.50 U	0.5 U	270	0.5 U	2 U	180	0.5 U	120	0.5 U	0.5 U	91
06/10/03		0.40 J	0.98 J	0.29 U	0.23 U	0.25 U	0.11 U	2.2	0.2 U	350	0.26 U	0.39 U	390	0.23 U	140	0.8 B	0.44 U	78	
P-1	09/24/04		0.28 J	0.12 U	0.15 U	0.12 U	0.13 U	NA	0.23 U	0.096 U	1.2	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U

NOTE:

All results in ug/L.
 1995 analyses performed using EPA Method 8240A.
 Analyses from 1996 to 2014 performed using EPA Method 8260A.
 Starting in March 2015, the laboratory was switched to Accutest and VOCs were analyzed by EPA Method 8260B.
 Only indicator hazardous substances shown.
 Detections shown in bold.
 Shaded results above their respective cleanup level.
 Bromodichloromethane detected (0.54 µg/L) below the MRL in MW-15 on 9/24/04; result likely due to instrument noise so not reported in table.
 Results from June 2000 and from December 2000 to September 2008 are reported relative to the method detection limits (MDLs).
 B = the analyte was also detected in an associated blank.
 DUP = duplicate sample collected in the field and blind labeled.
 E = laboratory estimated concentration.
 J = the associated numerical value is an estimated quantity based on data review or laboratory estimate above the MDL but below the MRL.
 LAB DUP = laboratory duplicate sample.

NA = not analyzed or not quantitated
 U = not detected above associated method reporting limit.
 UJ - Compound was analyzed for, but not detected above the reporting limit. The reporting limit is an estimated value.
 1,1,1-TCA = 1,1,1-trichloroethane.
 1,1-DCA = 1,1-dichloroethane.
 1,1-DCE = 1,1-dichloroethene.
 1,2,3-TCP = 1,2,3-trichloropropane.
 1,2,4-TCB = 1,2,4-trichlorobenzene.
 1,2,4-TMB = 1,2,4-trimethylbenzene.
 1,2-DCA = 1,2-dichloroethane.
 1,3,5-TMB = 1,3,5-trimethylbenzene.
 cis-1,2-DCE = cis-1,2-dichloroethene.
 PCE = tetrachloroethene.
 TCE = trichloroethene.

Table 4

**Total Organic Carbon and Dissolved Organic Gases in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Total Organic Carbon (mg/L)		Dissolved Gases (µg/L)		
		EPA Method 415.1 or SM 5310		Method AM20GAX or RSK-175		
		B/C		Methane	Ethane	Ethene
MW-1	09/23/11	NA		9,400	12	8.2
	03/08/12	NA		15,000	18	34
	10/01/12	NA		9,900	11	10
	03/06/13	NA		14,000	16	34
	09/25/13	NA		16,000	12	10
	03/26/14	NA		17,000	26	39
	09/23/14	NA		15,000	14	19
	03/17/15	NA		6,540	9.1	7.7
	09/16/15	NA		4,190	14.7	13.0
MW-4	09/23/11	19		14,000	360	240
	03/08/12	13.4		18,000	360	500
	10/01/12	NA		14,000	270	310
	03/06/13	NA		16,000	240	89
	09/26/13	NA		15,000	400	14
	03/25/14	NA		9,000	320	0.58
	09/23/14	NA		16,000	380	32
	03/17/15	NA		5,680	103	1.0 U
	09/17/15	NA		3,110	155	2.6
MW-5	04/01/10	6.3		NA	NA	NA
	04/09/10	5.7		NA	NA	NA
	04/16/10	6.0		NA	NA	NA
	04/16/10 (LAB DUP)	NA		NA	NA	NA
	05/06/10	5.9		NA	NA	NA
	06/09/10	5.0		NA	NA	NA
	07/06/10	4.8		NA	NA	NA
	07/06/10	5.6		NA	NA	NA
	03/03/11	4.40		43	0.017 J	0.041
	06/22/11	4.32		550	0.010 J	0.053
	09/22/11	3.87		730	0.10	0.035
	12/07/11	5.65		NA	NA	NA
	03/07/12	5.07		4,100	0.20	0.17
	06/26/12	4.94		NA	NA	NA
	07/12/12	NA		6,600	0.31	0.38
	09/27/12	6.38		6,200	0.33	0.16
	12/19/12	8.92		5,500	0.37 J	0.097 J
	03/06/13	5.08		6,700	0.40	0.13
	03/06/13 (DUP)	5.39		5,700	0.33	0.10
	06/06/13	6.51		NA	NA	NA
	09/26/13	7.11		1,500	0.38	0.24
	09/26/13 (DUP)	7.20		1,700	0.38	0.27
	03/25/14	7.09		1,800	0.57	0.14
	09/23/14	8.75		430	0.38	0.16
03/16/15	6.8		142	1.0 U	1.0 U	
09/15/15	7.9		160	1.0 U	1.0 U	
MW-7	03/02/11	3.65		0.18	0.025 U	0.026
	06/22/11	5.30		0.59	0.025 U	0.019 J
	09/22/11	7.04		8.2	0.025 U	0.046
	12/07/11	9.44		NA	NA	NA
	03/07/12	5.13		0.24	0.0032 J	0.016 J
	06/26/12	5.52		NA	NA	NA
	07/12/12	NA		0.48	0.025 U	0.014 J
	09/27/12	11.2		28	0.0085 J	0.028
	12/19/12	18.3		1,200	0.028 J	0.034 J
	03/05/13	8.58		200	0.052	0.029
	06/06/13	6.37		NA	NA	NA
	09/24/13	11.1		240	0.055	0.024 J
	03/26/14	2.66		1.2	0.0092 J	0.010 J

Table 4

**Total Organic Carbon and Dissolved Organic Gases in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Total Organic Carbon (mg/L)		Dissolved Gases (µg/L)		
		EPA Method 415.1 or SM 5310		Method AM20GAX or RSK-175		
		B/C		Methane	Ethane	Ethene
MW-7 (continued)	09/25/14	12.3		26	0.021 J	0.012 J
	03/18/15	2.6		0.50 U	1.0 U	1.0 U
	09/14/15	11.0		8.5	1.0 U	1.0 U
MW-11	04/01/10	5.8		NA	NA	NA
	04/09/10	4.9		NA	NA	NA
	04/16/10	5.7		NA	NA	NA
	05/06/10	5.4		NA	NA	NA
	05/06/10 (LAB DUP)	6.4		NA	NA	NA
	06/09/10	5.2		NA	NA	NA
	06/09/10 (LAB DUP)	5.0		NA	NA	NA
	07/06/10	5.6		NA	NA	NA
MW-12	03/03/11	9.80		3.1	0.017 J	0.20
	06/22/11	47.7		9.3	0.080	0.54
	09/22/11	16.1		1,000	0.15	4.3
	09/22/11 (DUP)	20.8		1,600	0.20	4.7
	09/22/11 (LAB DUP)	NA		1,500	0.19	4.4
	12/07/11	16.0		NA	NA	NA
	03/07/12	13.5		4,000	0.88	0.67
	03/07/12 (DUP)	14.7		4,000	0.85	0.63
	06/26/12	17.9		NA	NA	NA
	07/12/12	NA		13,000	1.2	3.1
	10/02/12	20.0		14,000	1.4	4.9
	12/19/12	15.1		7,500	0.78 J	6.8
	03/06/13	12.0		11,000	1.1	7.1
	06/06/13	11.5		NA	NA	NA
	09/25/13	13.9		13,000	2.7	150
	03/25/14	11.7		7,800	1.6	5.3
	03/25/14 (DUP)	11.6		7,900	1.5	5.3
	09/23/14	15.6		12,000	4.7	6.4
	03/16/15	10.4		1,780	0.71 J	0.88 J
	3/16/15 (DUP)	NA		1,360	0.75 J	0.57 J
09/15/15	12.8		3,140	1.8	1.2	
09/15/15 (DUP)	NA		2,270	2.1	1.3	
MW-13	03/29/10	29		NA	NA	NA
	03/29/10 (LAB DUP)	NA		NA	NA	NA
	04/07/10	30		NA	NA	NA
	04/07/10 (LAB DUP)	30		NA	NA	NA
	04/16/10	30		NA	NA	NA
	05/06/10	32		NA	NA	NA
	06/09/10	34		NA	NA	NA
	07/06/10	32		NA	NA	NA
	03/03/11	47.1		22,000	310	1,000
	03/03/11 (LAB DUP)	48.3		NA	NA	NA
	06/23/11	72.0		17,000	280	510
	09/22/11	63.5		16,000	240	1,000
	12/07/11	47.7		NA	NA	NA
	03/07/12	31.0		29,000	540	440
	06/27/12	31.0		NA	NA	NA
	07/12/12	NA		18,000	450	160
	10/02/12	19.6		22,000	450	29
	12/19/12	20.2		20,000	420	80
	03/07/13	15.8		20,000	570	3.2
	06/06/13	16.1		NA	NA	NA
09/25/13	11.3		19,000	410	230	
03/26/14	12.5		16,000	440	2.2	
09/23/14	15.2		27,000	690	220	
03/17/15	1.9		1,620	18.9	1.0 U	

Table 4

**Total Organic Carbon and Dissolved Organic Gases in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Total Organic Carbon (mg/L)	Dissolved Gases (µg/L)		
		EPA Method 415.1 or SM 5310 B/C	Method AM20GAX or RSK-175		
			Methane	Ethane	Ethene
MW-13 (continued)	09/15/15	7.7	14,400	206	37.3
MW-17	03/07/11	34.8	21,000	470	21
	03/07/11 (LAB DUP)	34.7	NA	NA	NA
	06/23/11	31.9	18,000	670	8.6
	09/22/11	25.1	19,000	530	12
	03/08/12	41.8	20,000	550	4.2
	06/27/12	37.1	NA	NA	NA
	07/12/12	NA	16,000	580	14
	10/01/12	32.5	18,000	440	13
	12/19/12	42.6	18,000	520	7.6
	03/07/13	30.5	18,000	570	3.6
	06/06/13	32.3	NA	NA	NA
	09/26/13	29.7	20,000	390	3.6
	03/26/14	19.1	14,000	300	3.0
	09/25/14	35.4	21,000	240	1.6
	03/19/15	26.6	9,630	122	0.82
09/17/15	26.9	8,220	194	1.5	
MW-18	03/04/11	16.1	10,000	260	67
	06/23/11	17.9	9,000	24	0.42
	09/22/11	13.0	8,000	20	0.19
	03/07/12	18.8	9,700	39	36
	06/27/12	20.0	NA	NA	NA
	07/12/12	NA	10,000	100	35
	10/01/12	21.9	750	2.0	0.98
	12/19/12	21.2	12,000	50	6.2
	12/19/12 (DUP)	20.4	NA	NA	NA
	03/05/13	17.8	11,000	22	0.18
	06/06/13	18.4	NA	NA	NA
	09/26/13	< 20.0 E	10,000	220	0.18
	03/26/14	18.1	14,000	44	0.14
	09/24/14	14.4	8,200	26	0.61
	03/18/15	18.8	9,520	24.9	1.0 U
09/14/15	16.9	3,160	28.8	0.77 J	
MW-19	06/27/12	16.1	NA	NA	NA
	07/12/12	NA	1,000	140	270
	12/19/12	15.7	18,000	230	520
	03/05/13	NA	12,000	270	840
	06/06/13	16.7	NA	NA	NA
	06/06/13 (DUP)	16.0	NA	NA	NA
	09/25/14	20.5	NA	NA	NA
	03/19/15	16.2	NA	NA	NA
09/15/15	16.4	NA	NA	NA	
MW-20	06/06/13	25.3	NA	NA	NA
MW-21	03/26/10	32	NA	NA	NA
	04/07/10	2,400	NA	NA	NA
	04/16/10	33	NA	NA	NA
	05/06/10	69	NA	NA	NA
	05/06/10 (DUP)	67	NA	NA	NA
	06/09/10	82	NA	NA	NA
	07/06/10	150	NA	NA	NA
	03/02/11	124	17,000	140	1,600
	03/02/11 (DUP)	120	16,000	130	1,400
	03/02/11 (LAB DUP)	122	NA	NA	NA
	06/23/11	136	18,000	100	1,400
	06/23/11 (DUP)	137	20,000	110	1,600
09/22/11	366	21,000	120	1,500	

Table 4

**Total Organic Carbon and Dissolved Organic Gases in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Total Organic Carbon (mg/L)		Dissolved Gases (µg/L)		
		EPA Method 415.1 or SM 5310		Method AM20GAX or RSK-175		
		B/C		Methane	Ethane	Ethene
MW-21 (continued)	12/07/11	386		NA	NA	NA
	03/08/12	455		17,000	150	720
	06/26/12	399		NA	NA	NA
	07/12/12	NA		14,000	94	970
	10/01/12	313		NA	NA	NA
	10/01/12 (DUP)	330		NA	NA	NA
	10/02/12	NA		14,000	84	1,200
	10/02/12	NA		12,000	73	1,100
	12/20/12	33.5		14,000	89	830
	03/06/13	186		18,000	96	1,200
	06/06/13	111		NA	NA	NA
	09/25/13	67.1		20,000	60	1,000
	03/26/14	59.5		25,000	140	830
	09/24/14	62.8		25,000	280	730
03/17/15	22.4		12,200	185	73.5	
09/15/15	26.6		16,400	211	13.3	
MW-22	03/04/11	19.9		16,000	880	940
	06/23/11	21.5		15,000	780	140
	09/23/11	35.1		18,000	1,100	220
	12/07/11	50.9		NA	NA	NA
	03/08/12	39.6		27,000	620	900
	06/26/12	32.6		NA	NA	NA
	06/26/12 (DUP)	32.4		NA	NA	NA
	07/12/12	NA		18,000	470	860
	10/02/12	24.7		22,000	600	810
	12/19/12	18.3		24,000	640	120
	03/06/13	15.1		24,000	520	330
	06/06/13	17.6		NA	NA	NA
	09/25/13	11.7		23,000	430	290
	03/26/14	14.3		25,000	480	170
09/24/14	18.9		26,000	390	37	
03/17/15	14.8		11,300	104	111	
09/15/15	15.6		9,420	68.3	25.1	
MW-23	03/02/11	9.86		8.6	0.039	0.11
	06/22/11	8.94		4.4	0.016 J	0.042
	09/23/11	7.94		5.8	0.091	0.24
	12/07/11	11.0		NA	NA	NA
	03/07/12	11.4		160	0.21	0.05
	06/26/12	10.2		NA	NA	NA
	07/12/12	NA		2,200	1.1	0.028
	09/27/12	16.6		4,800	3.0	0.040
	12/19/12	20.2		670	0.35 J	0.044 J
	03/05/13	16.5		210	0.15	0.039
	06/06/13	9.86		NA	NA	NA
	09/24/13	16.3		97	0.070	0.026
	03/26/14	11.8		110	0.22	0.0200 J
	09/25/14	16.5		360	0.072	0.018 J
09/25/14 (DUP)	NA		300	0.063	0.025	
03/18/15	9.4		144	1.0 U	1.0 U	
09/14/15	9.4		123	1.0 U	1.0 U	
MW-24	03/26/10	27		NA	NA	NA
	04/07/10	2,200		NA	NA	NA
	04/16/10	23		NA	NA	NA
	05/06/10	58		NA	NA	NA
	06/09/10	68		NA	NA	NA
	07/06/10	74		NA	NA	NA
	7/6/10 (DUP)	72		NA	NA	NA

Table 4

**Total Organic Carbon and Dissolved Organic Gases in Groundwater
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Total Organic Carbon (mg/L)		Dissolved Gases (µg/L)		
		EPA Method 415.1 or SM 5310		Method AM20GAX or RSK-175		
		B/C		Methane	Ethane	Ethene
MW-25	03/29/10	23		NA	NA	NA
	04/07/10	24		NA	NA	NA
	04/16/10	23		NA	NA	NA
	05/06/10	26		NA	NA	NA
	06/09/10	33		NA	NA	NA
	07/06/10	43		NA	NA	NA
MW-26	04/01/10	3.7		NA	NA	NA
	4/1/10 (LAB DUP)	3.7		NA	NA	NA
	04/09/10	4.0		NA	NA	NA
	04/16/10	3.8		NA	NA	NA
	05/06/10	4.2		NA	NA	NA
	06/09/10	4.6		NA	NA	NA
	07/06/10	7.0		NA	NA	NA
	07/06/10 (LAB DUP)	NA		NA	NA	NA
IW-206-8	10/04/12	401		NA	NA	NA
IW-206-17	10/04/12	275		NA	NA	NA
IW-209-8	10/04/12	29.9		NA	NA	NA
IW-209-17	10/04/12	28.8		NA	NA	NA
IW-137-28	10/04/12	55.0		NA	NA	NA
IW-137-38	10/04/12	49.0		NA	NA	NA
IW-212-8	10/05/12	53.3		NA	NA	NA
IW-212-17	10/05/12	42.8		NA	NA	NA
IW-217-8	10/05/12	30.2		NA	NA	NA
IW-217-17	10/05/12	30.2		NA	NA	NA
IW-130-27	10/05/12	81.4		NA	NA	NA
IW-130-37	10/05/12	86.0		NA	NA	NA
IW-115-27	10/08/12	61.2		NA	NA	NA
IW-115-37	10/08/12	55.4		NA	NA	NA
IW-106-37	10/08/12	57.2		NA	NA	NA
IW-106-27	10/08/12	60.0		NA	NA	NA

NOTE: Analyses prior to 2011 and after 2014 performed using Modified RSK Method 175.

Analyses from 2011 to 2014 performed using Microseeps Method AM20GAX.

Starting in March 2015, the laboratory was switched to Accutest.

mg/L = milligrams per liter

µg/L = micrograms per liter

< or U = not detected, the associated value is the quantification limit.

E = The result exceeded calibration curve.

J = the associated numerical value is an estimated quantity based on data review or laboratory estimate above the MDL but below the MRL.

DUP = duplicate sample collected in the field and blind labeled.

LAB DUP = laboratory duplicate sample.

NA = not analyzed.

Table 5

**Groundwater Microbiological Test Results
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Dhc		<i>vcrA</i>		Dhb	
		(cells/L)	Percent Dhc	(gene copies/L)	Percent <i>vcrA</i>	(cells/L)	Percent Dhb
MW-5 Area							
MW-5	10/21/11	3 x 10 ³	0.0007 - 0.002	2 x 10 ³ U	NA	2 x 10 ³ U	NA
	09/27/12	1 x 10 ³ U	NA	–	–	4 x 10 ⁴	0.007 - 0.02
	09/26/13	1 x 10 ⁴ J	0.003 - 0.008 J	2 x 10 ⁴ C	0.003 - 0.01	1 x 10 ³	0.0002 - 0.0006
	09/23/14	1 x 10 ³ U	NA	–	–	1 x 10 ³ U	NA
	09/15/15	4 X 10 ³	0.0005 - 0.001	1 x 10 ⁴	0.001 - 0.004	1 x 10 ³ U	NA
MW-7	10/20/11	1 x 10 ³ J	0.0004 - 0.001	2 x 10 ³ U	NA	2 x 10 ³ U	NA
	09/27/12	1 x 10 ³ U	NA	–	–	2 x 10 ³ U	NA
	09/24/13	1 x 10 ³ J	0.0005 - 0.002 J	1 x 10 ³ U	NA	1 x 10 ³ U	NA
	09/25/14	1 x 10 ³ U	NA	–	–	1 x 10 ³ U	NA
	09/14/15	1 x 10 ³ U	NA	–	–	1 x 10 ³ U	NA
MW-12	10/21/11	7 x 10 ⁵	0.04 - 0.1	2 x 10 ⁵	0.01 - 0.04	2 x 10 ⁵	0.01 - 0.04
	10/02/12	4 x 10 ⁶	0.2 - 0.5	5 x 10 ⁶	0.2 - 0.6	4 x 10 ⁵	0.02 - 0.05
	09/25/13	4 x 10 ⁷	4 - 12	2 x 10 ⁷	2 - 7	1 X 10 ⁶	0.2 - 0.5
	09/23/14	4 x 10 ³	0.0006 - 0.002	9 x 10 ³ J	0.001 - 0.004 J	1 x 10 ³ J	0.0002-0.0006 J
	09/15/15	6 x 10 ⁴	0.005 - 0.02	2 x 10 ⁴	0.002 - 0.006	3 x 10 ³	0.0002 - 0.0007
MW-23	10/20/11	1 x 10 ³ J	0.0007 - 0.002	2 x 10 ³ U	NA	2 x 10 ³ U	NA
	09/27/12	1 x 10 ³	0.0002 - 0.0005	1 x 10 ³ U	NA	2 x 10 ³ U	NA
	09/24/13	1 x 10 ³ U	NA	–	–	1 x 10 ³ U	NA
	09/25/14	1 x 10 ³ U	NA	–	–	1 x 10 ³ U	NA
	09/14/15	1 x 10 ³ U	NA	–	–	1 x 10 ³ U	NA
IW-211	10/21/11	3 x 10 ⁷	2 - 7	3 x 10 ⁷	2 - 7	4 x 10 ⁵	0.04 - 0.1
	10/02/12	2 x 10 ⁹	4 - 12	2 x 10 ⁹	5 - 15	3 x 10 ⁵	0.0007 - 0.002
MW-13/MW-21 Area							
MW-13	10/20/11	5 x 10 ⁷	3 - 10	4 x 10 ⁷	3 - 9	2 x 10 ⁵	0.01 - 0.04
	10/02/12	1 x 10 ⁷	0.8 - 2	2 x 10 ⁷	1 - 3	9 x 10 ⁴	0.005 - 0.02
	09/25/13	4 x 10 ⁶ J	0.4 - 1 J	3 x 10 ⁵	0.3 - 1	4 x 10 ⁴	0.004 - 0.01
	09/23/14	3 x 10 ⁵	0.04 - 0.1	7 x 10 ⁵ J	0.09 - 0.3 J	1 x 10 ³ U	NA
	09/15/15	2 x 10 ⁵	0.01 - 0.04	1 x 10 ⁶	0.1 - 0.4	1 x 10 ³ U	NA
MW-21	10/20/11	4 x 10 ⁷	6 - 16	4 x 10 ⁷	5 - 14	2 x 10 ⁶	0.3 - 0.8
	10/02/12	5 x 10 ⁷	1 - 3	7 x 10 ⁷	2 - 5	8 x 10 ⁶	0.2 - 0.6
	09/25/13	1 x 10 ⁸	5 - 14	9 x 10 ⁷	4 - 11	3 x 10 ⁵	0.01 - 0.04
	09/24/14	6 x 10 ⁵	0.06 - 0.2	2 x 10 ⁶ J	0.2 - 0.7 J	4 x 10 ⁴ J	0.003 - 0.01 J
	09/15/15	3 x 10 ⁶	0.2 - 0.6	4 x 10 ⁶	0.2 - 0.7	3 x 10 ⁴	0.002 - 0.005
MW-22	10/21/11	1 x 10 ⁷	4 - 13	8 x 10 ⁶	3 - 9	4 x 10 ⁴	0.02 - 0.05
	10/02/12	3 x 10 ⁷	3 - 8	6 x 10 ⁷	5 - 14	3 x 10 ⁴	0.003 - 0.008
	09/25/13	3 x 10 ⁷	6 - 16	2 x 10 ⁷	4 - 12	1 x 10 ⁵	0.03 - 0.08

Table 5

**Groundwater Microbiological Test Results
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	Dhc		<i>vcrA</i>		Dhb	
		(cells/L)	Percent Dhc	(gene copies/L)	Percent <i>vcrA</i>	(cells/L)	Percent Dhb
MW-22 (continued)	09/24/14	4 x 10 ⁵	0.05 - 0.1	9 x 10 ⁵ J	0.1 - 0.3 J	1 x 10 ³ J	0.0002 - 0.0005 J
	09/15/15	3 x 10 ⁶	0.3 - 0.9	3 x 10 ⁶	0.4 - 1	2 x 10 ³ U	0.0002 - 0.0005
IW-117	10/20/11	5 x 10 ⁵	0.02 - 0.06	5 x 10 ⁵	0.02 - 0.06	4 x 10 ⁴	0.002 - 0.005
	10/02/12	3 x 10 ⁵	0.0005 - 0.002	2 x 10 ⁶ C	0.003 - 0.008	3 x 10 ⁵	0.0005 - 0.002
IW-140	10/21/11	5 x 10 ⁵	0.007 - 0.02	5 x 10 ⁵ C	0.008 - 0.02	3 x 10 ⁵	0.004 - 0.01
	10/02/12	3 x 10 ⁴	0.00009 - 0.0003	6 x 10 ⁵ C	0.002 - 0.005	7 x 10 ⁴	0.0002 - 0.0006
MW-19 Area							
MW-19	09/25/14	2 x 10 ⁵	0.03 - 0.09	4 x 10 ⁵ J	0.06 - 0.2 J	1 x 10 ³ U	NA
	09/15/15	2 x 10 ⁴	0.003 - 0.010	4 x 10 ⁴	0.006 - 0.02	1 x 10 ³ U	NA

NOTE: Samples analyzed by SiREM using SiREM's Gene-Trac[®] qPCR method.

Dhc = *Dehalococcoides* ; based on quantification of Dhc 16S ribosomal ribonucleic acid (rRNA) gene copies. Dhc are generally reported to contain one 16s rRNA gene copy per cell; therefore, this number is often interpreted to represent the number of Dhc cells present in the sample.

vcrA = vinyl chloride reductase gene.

Dhb = *Dehalobacter* ; based on quantification of Dhb 16S rRNA gene copies.

Percent Dhc, Dhb, and *vcrA* = percent Dhc or Dhb in the microbial population and the percent of the microbial population harboring the *vcrA* gene.

U = not detected, the associated value is the quantification limit.

J = estimated value

C = correction factor applied to correct for non-PCR amplification products.

– = not analyzed.

NA = not applicable as either not detected or quantifiable DNA not extracted from the sample.


Values of Dhc at or below 10⁴ gene copies/L are low, indicating that the conditions are suboptimal for high rates of dechlorination.

Values of 10⁵ - 10⁶ Dhc gene copies/L are moderate and may or may not be associated with observable dechlorination activity.

Values at or above 10⁷ Dhc gene copies/L are high and are often associated with high rates of dechlorination.

Values of 10⁹ Dhc gene copies/L are generally the highest observed for groundwater samples with rare exceptions.

Figures

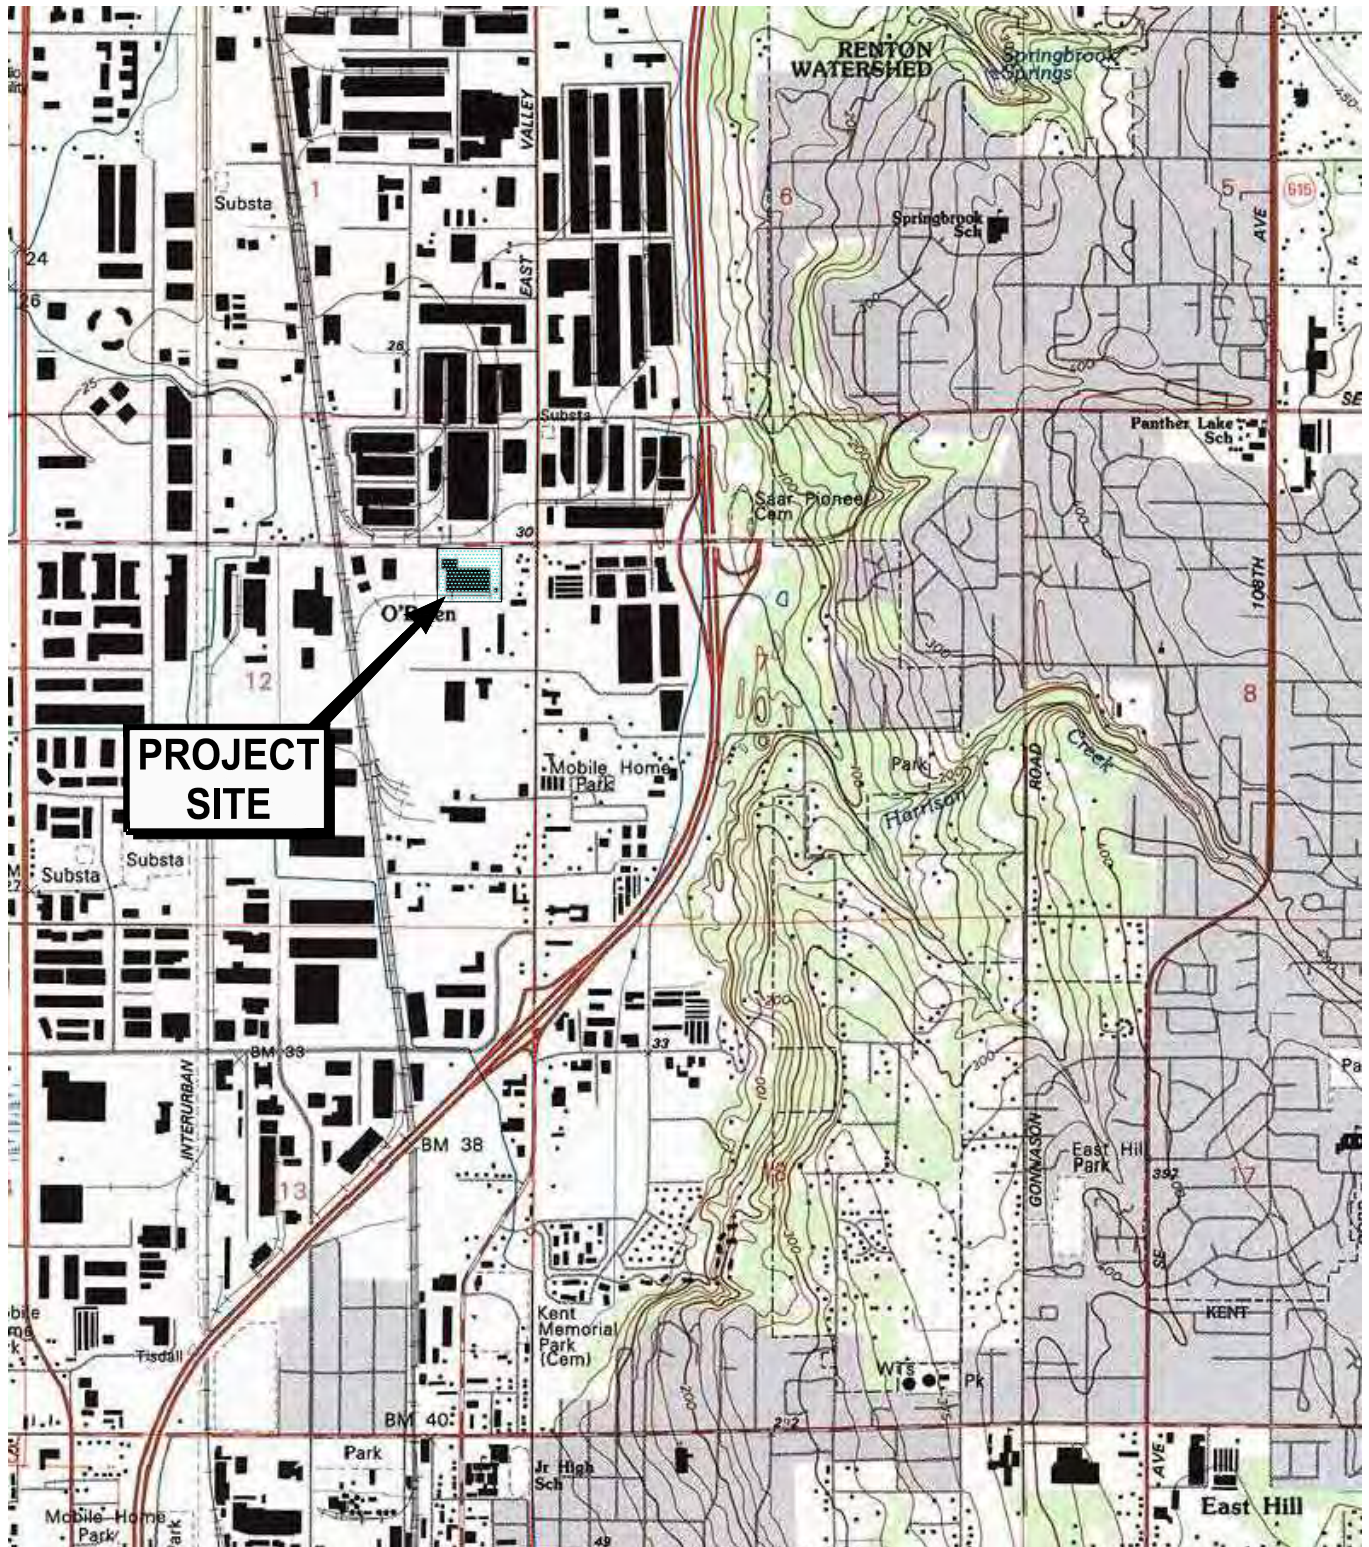

U.S.G.S. Topo Map - Renton, Washington 7.5-minute quadrangle.1994




Figure 1
Site Location Map



- LEGEND:**
- MW-1 Shallow Groundwater Monitoring Well Location
 - MW-16 Deep Groundwater Monitoring Well Location
 - P-1 Piezometer Location
 - Approximate Property Boundary





Figure 2
Groundwater Monitoring Network



Source: PES Environmental, Inc. 2012 Annual Groundwater Monitoring Report

Figure 3
Groundwater Contour Map
Monitoring Well and Injection Well Layout

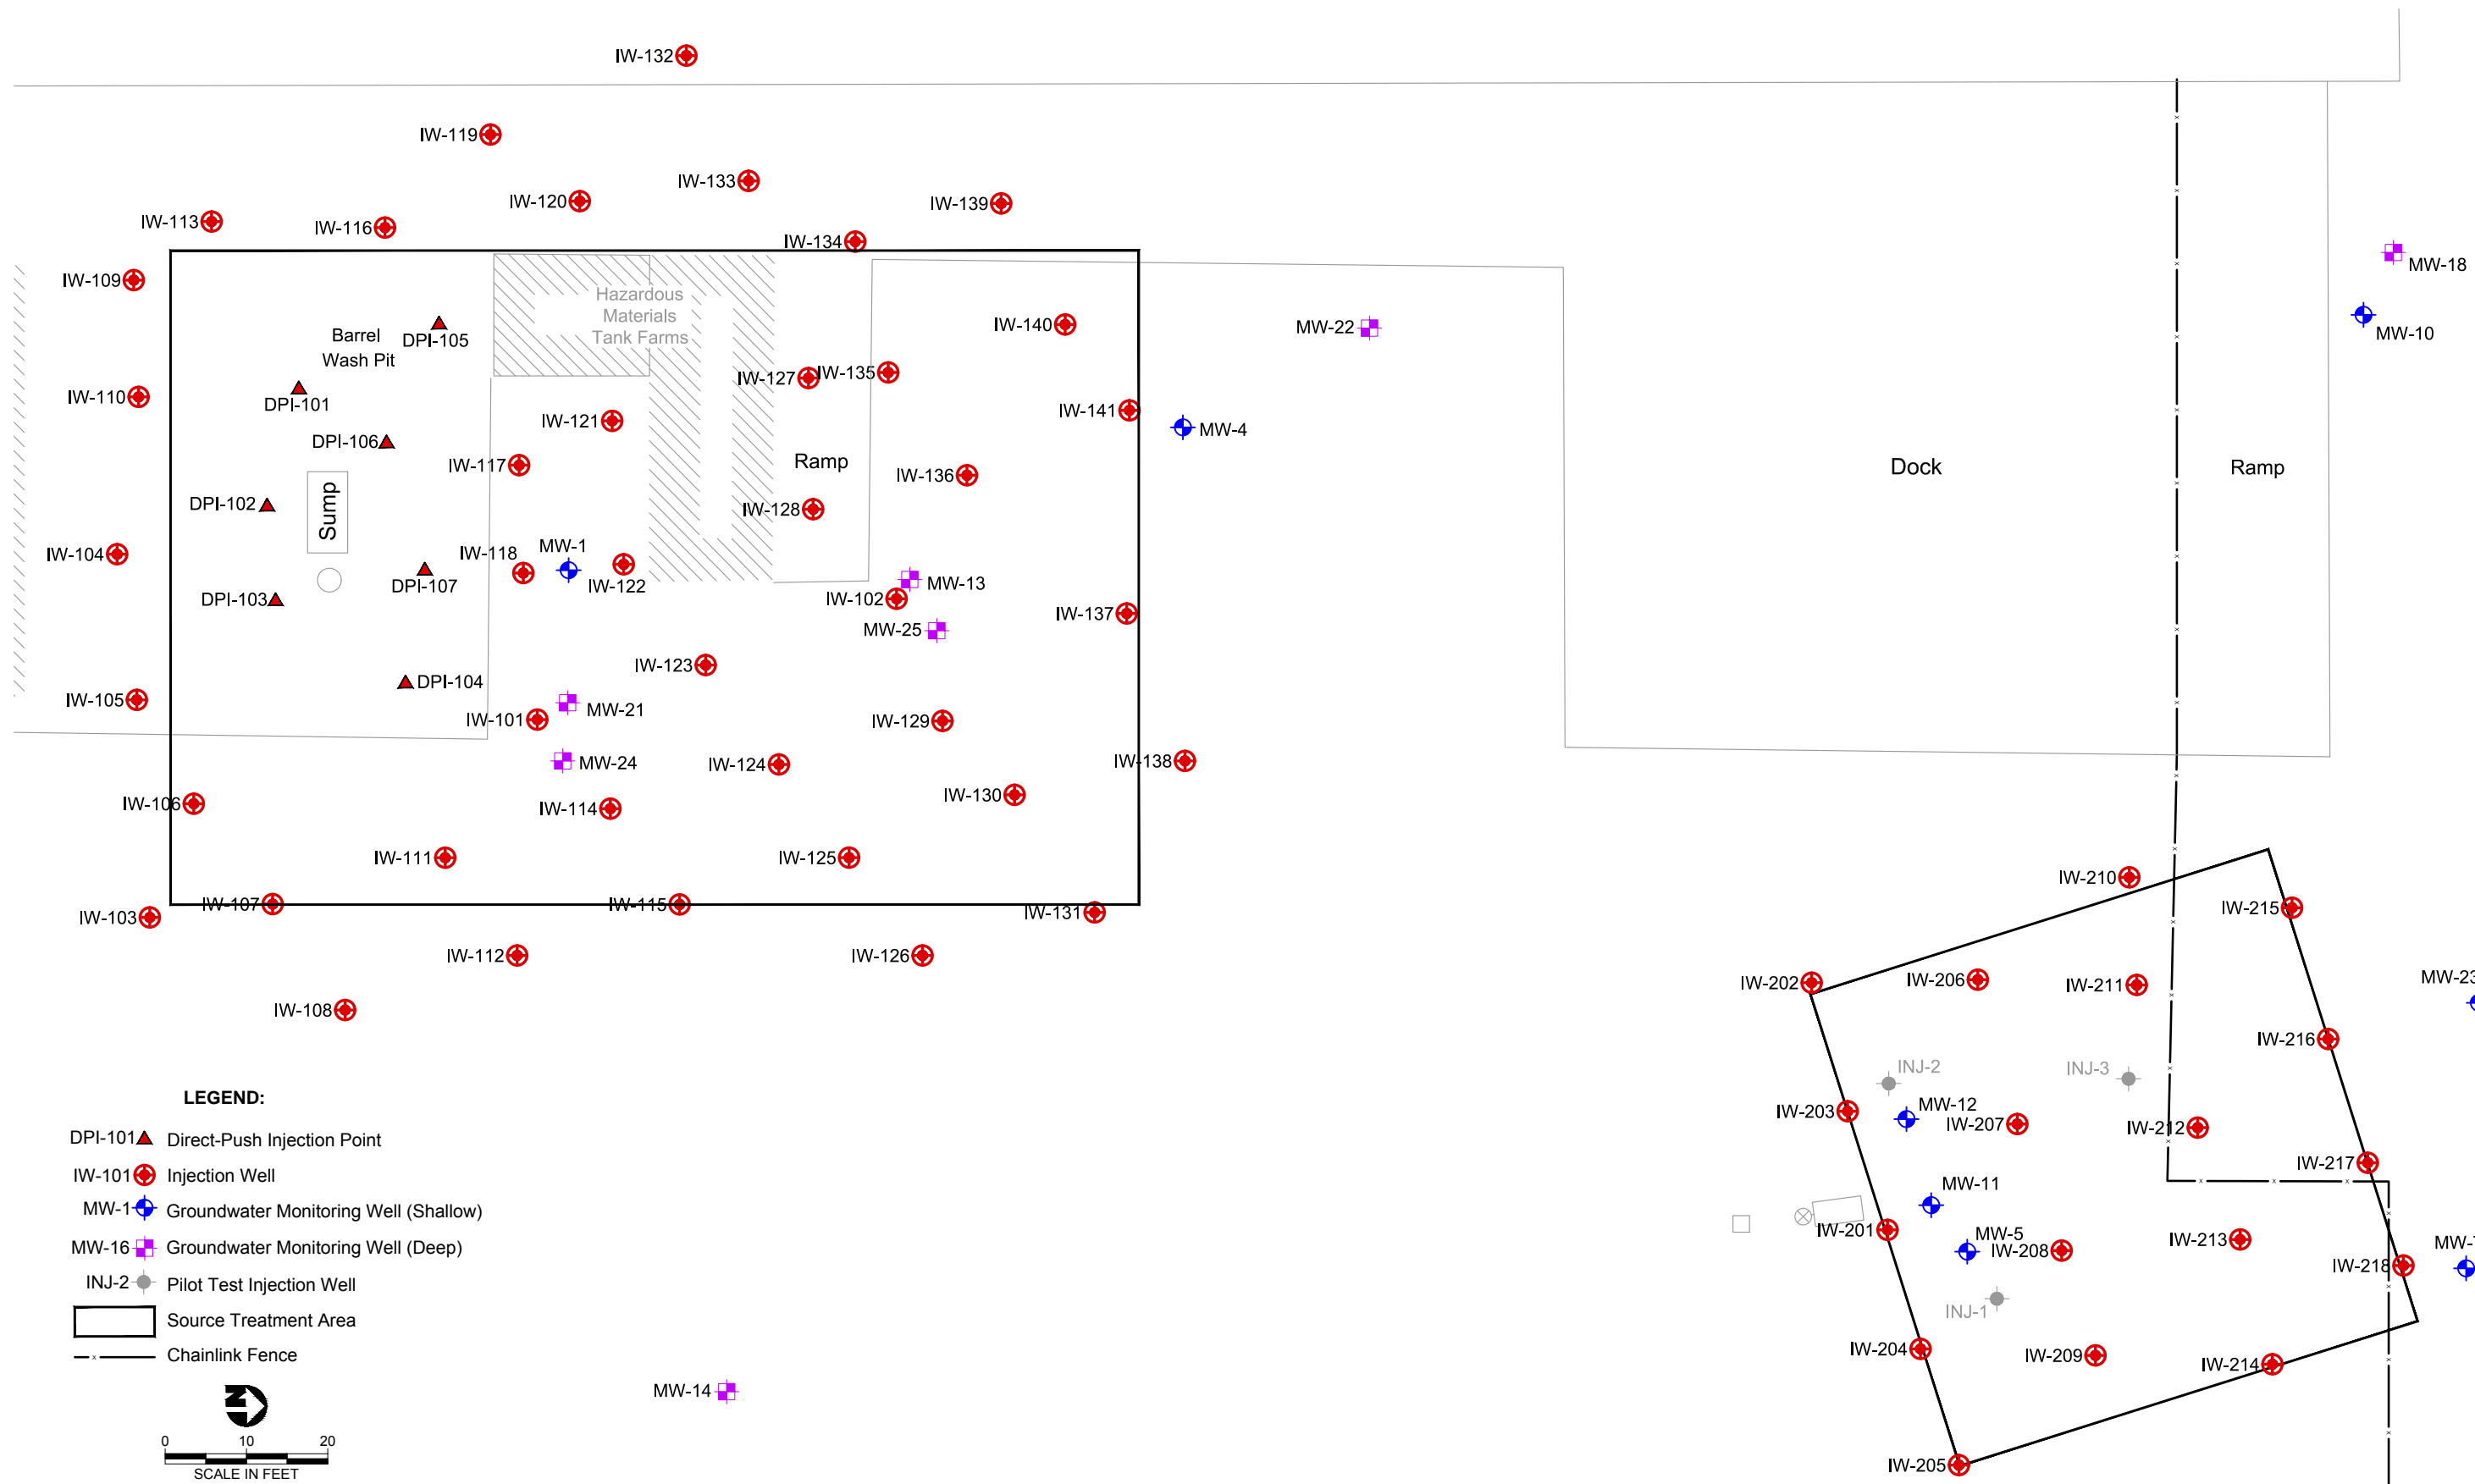

- LEGEND:**
- MW-1 Shallow Groundwater Monitoring Well Location
 - Approximate Property Boundary
 - Groundwater Contours (feet above mean sea level)
 - Inferred Groundwater Flow




Figure 4
Groundwater Contour Map
Shallow Zone - March 16, 2015



- LEGEND:**
- MW-1 Shallow Groundwater Monitoring Well Location
 - Approximate Property Boundary
 - Groundwater Contours (feet above mean sea level)
 - Inferred Groundwater Flow




Figure 5
Groundwater Contour Map
Shallow Zone - September 13, 2015




Figure 6
Groundwater Contour Map
Deep Zone - March 16, 2015




LEGEND:

- MW-16 Deep Groundwater Monitoring Well Location
- P-1 Piezometer Location
- Approximate Property Boundary
- Groundwater Contours (feet above mean sea level)
- Inferred Groundwater Flow

N

0 50 100
SCALE IN FEET

Figure 7
Groundwater Contour Map
Deep Zone - September 13, 2015

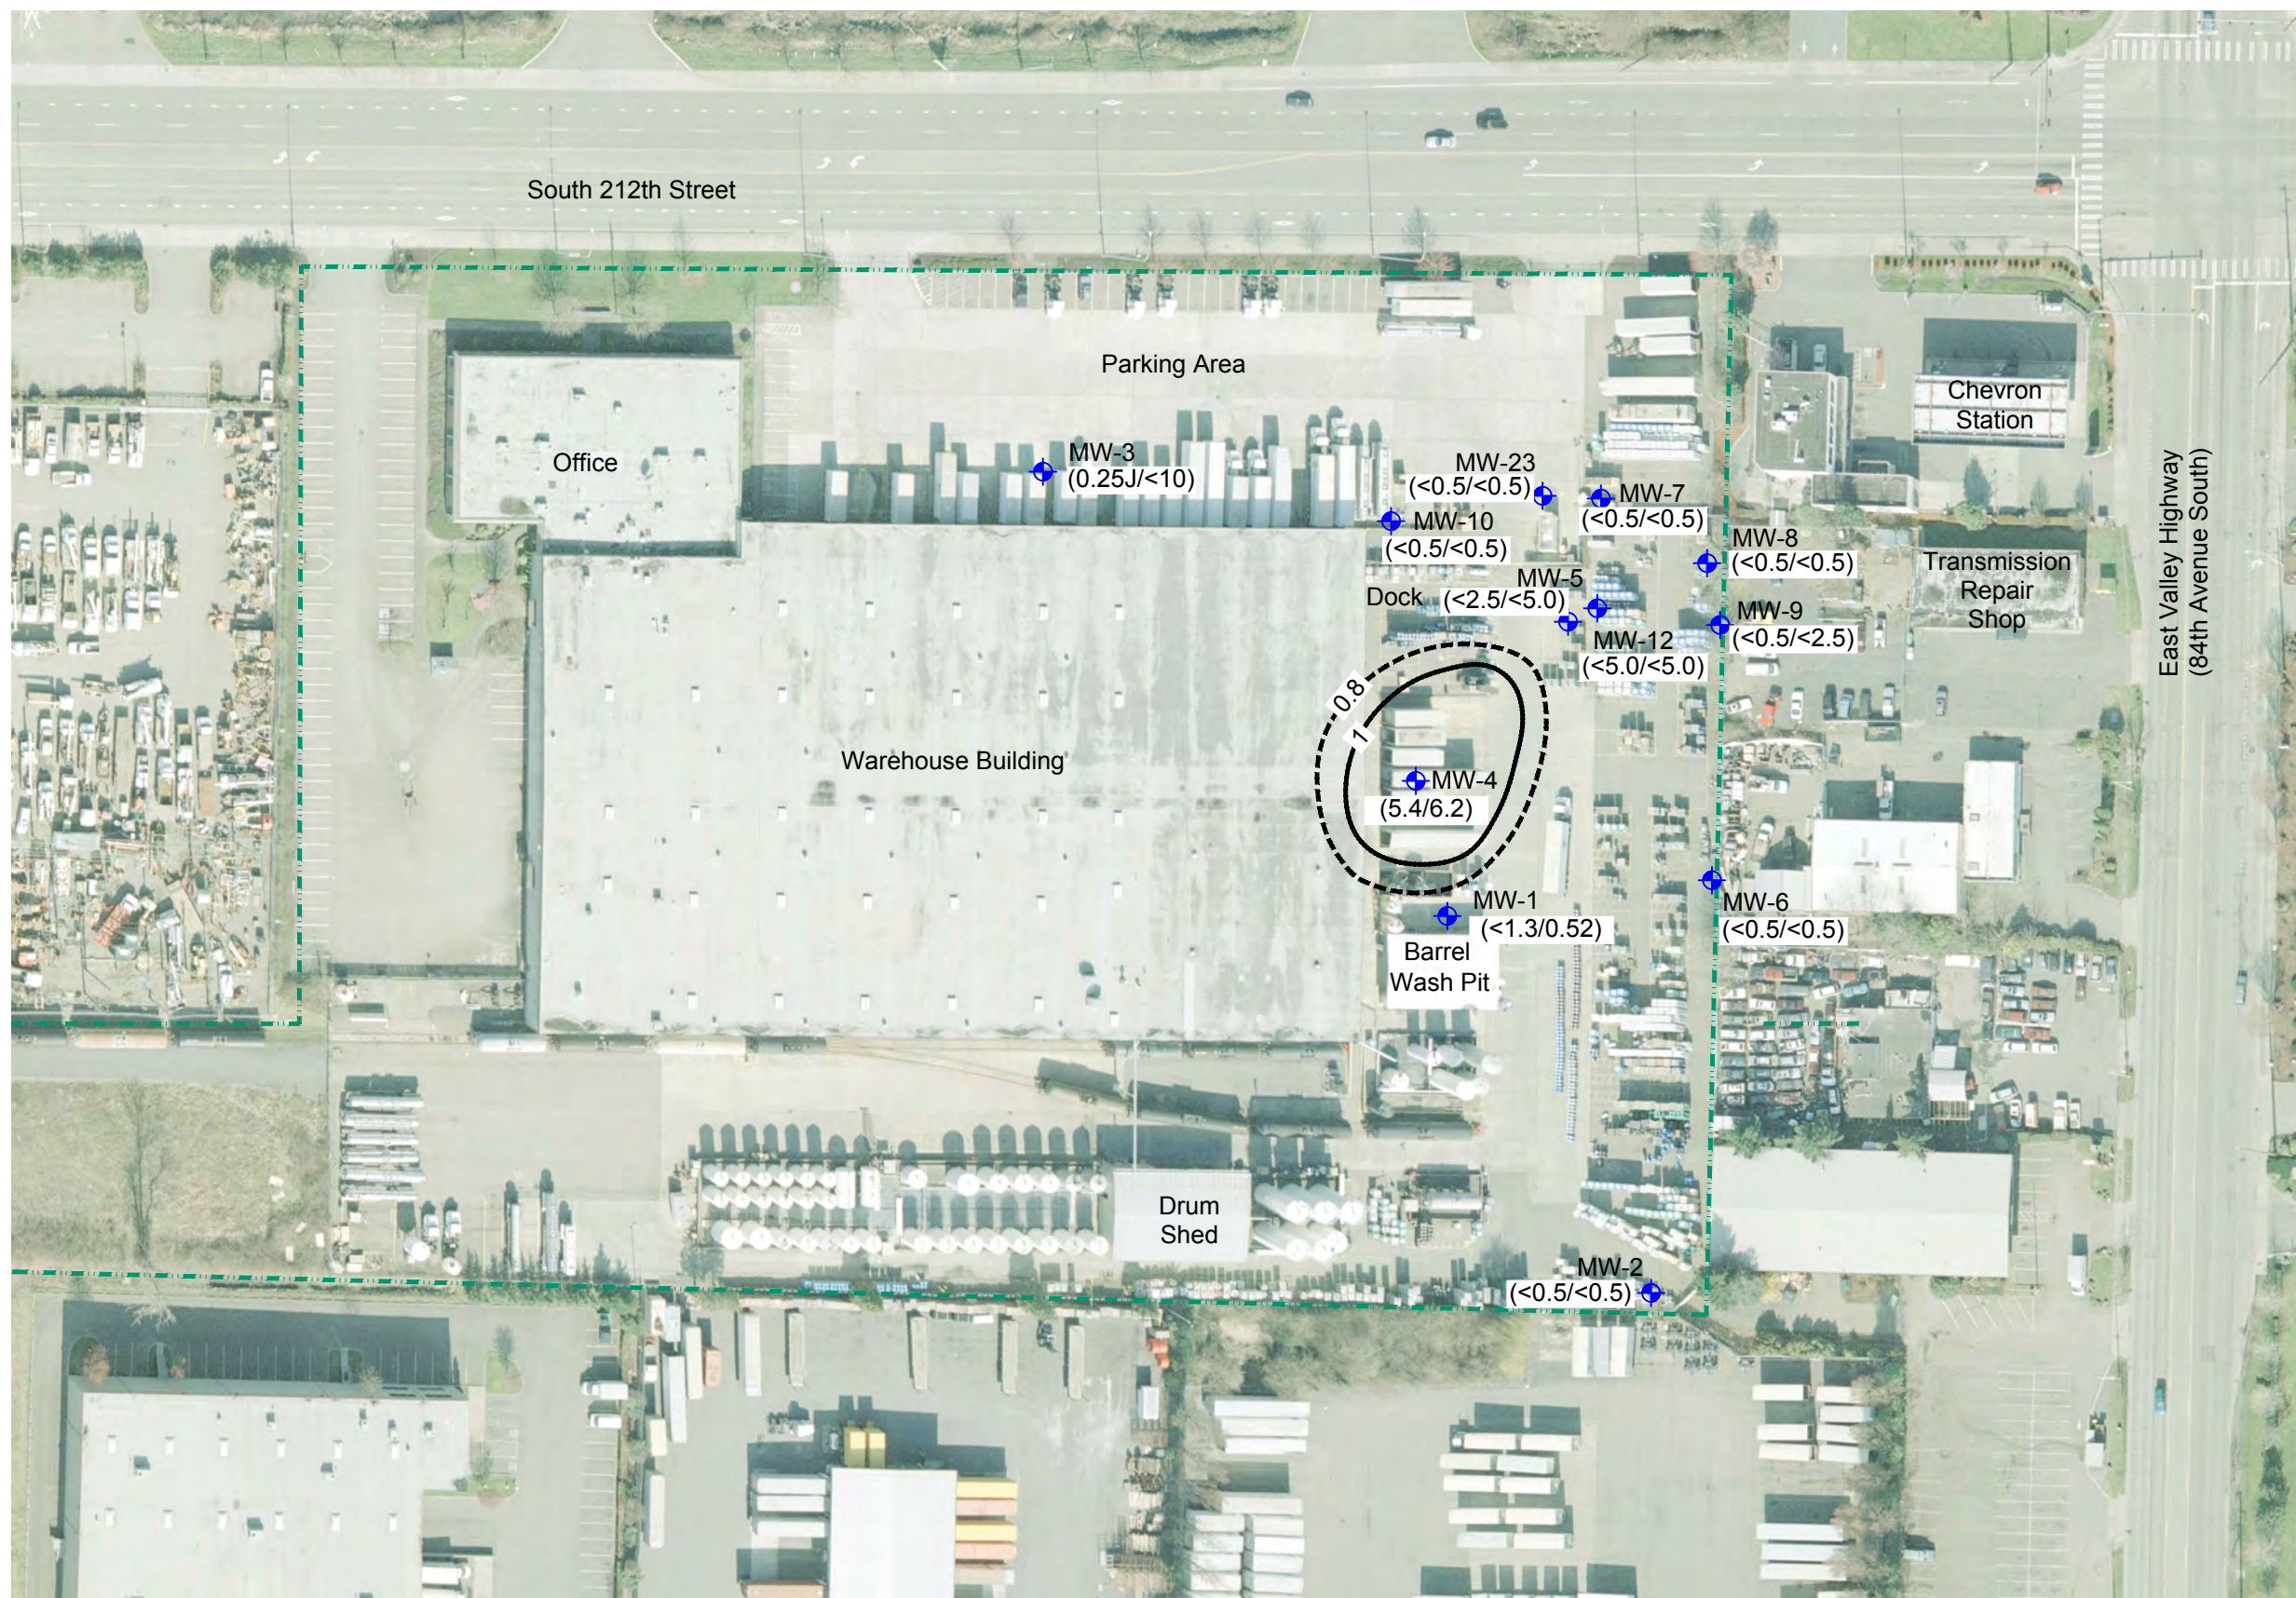

LEGEND:

- MW-1 Shallow Groundwater Monitoring Well
- Approximate Property Boundary
- Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
- Benzene Groundwater Cleanup Level Contour (0.8 ug/L)
- (<0.5/<0.5) Concentration of Benzene in Groundwater (March/Sept 2015)
- < Less than the Concentration Shown
- J Estimated Concentration

Note: All Concentrations in ug/L




Figure 8
Benzene Concentrations in Shallow Groundwater



LEGEND:

- MW-1 Shallow Groundwater Monitoring Well
- Approximate Property Boundary
- Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
- Chloroethane Groundwater Cleanup Level Contour (15 ug/L)
- (<0.5/<0.5) Concentration of Chloroethane in Groundwater (March/Sept 2015)
- < Less than the Concentration Shown
- J Estimated Concentration

Note: All Concentrations in ug/L





Figure 9
Chloroethane Concentrations in Shallow Groundwater

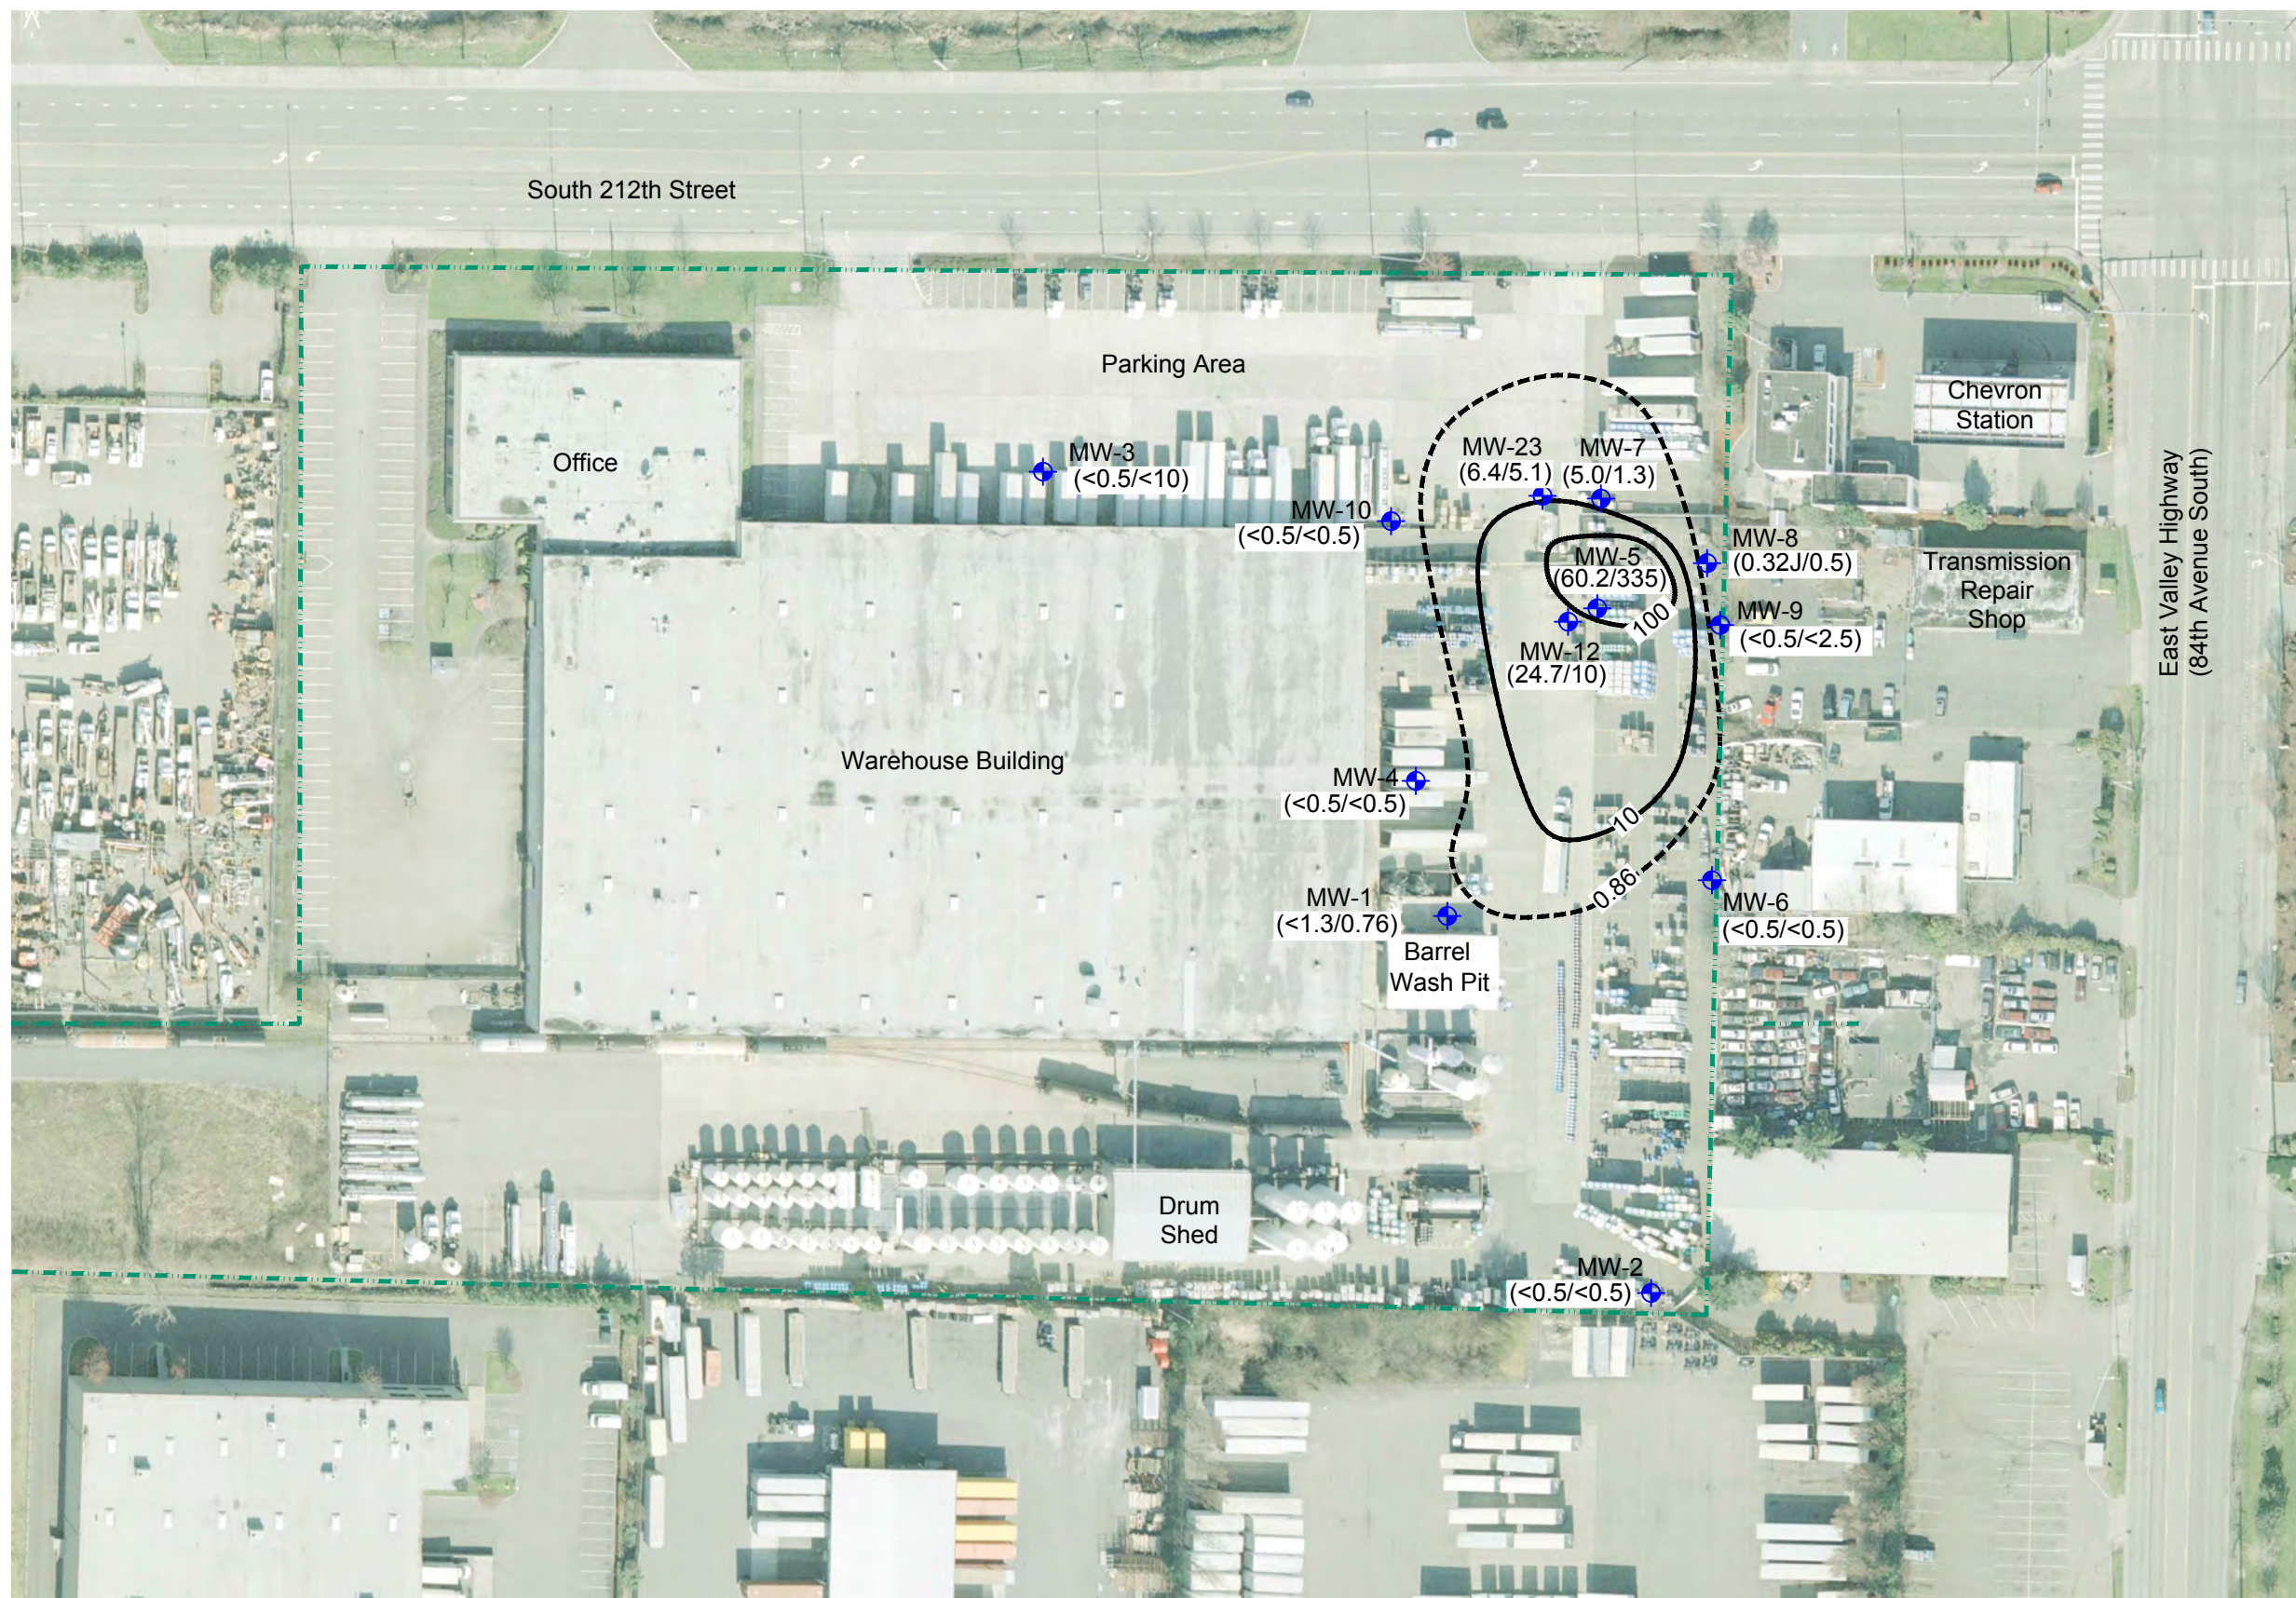

- LEGEND:**
- MW-1 Shallow Groundwater Monitoring Well
 - Approximate Property Boundary
 - Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
 - Tetrachloroethene Groundwater Cleanup Level Contour (0.86 ug/L)
 - (<0.5/<0.5) Concentration of Tetrachloroethene in Groundwater (March/Sept 2015)
 - < Less than the Concentration Shown
 - J Estimated Concentration
- Note: All Concentrations in ug/L




Figure 10
Tetrachloroethene Concentrations in Shallow Groundwater



- LEGEND:**
- MW-1 Shallow Groundwater Monitoring Well
 - Approximate Property Boundary
 - Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
 - Trichloroethene Groundwater Cleanup Level Contour (4 ug/L)
 - (<0.5/<0.5) Concentration of Trichloroethene in Groundwater (March/Sept 2015)
 - < Less than the Concentration Shown
 - J Estimated Concentration
- Note: All Concentrations in ug/L




Figure 11
Trichloroethene Concentrations in Shallow Groundwater



- LEGEND:**
- MW-1 Shallow Groundwater Monitoring Well
 - Approximate Property Boundary
 - Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
 - Vinyl Chloride Groundwater Cleanup Level Contour (0.5 ug/L)
 - (<0.2/<0.2) Concentration of Vinyl Chloride in Groundwater (March/Sept 2015)
 - < Less than the Concentration Shown
 - J Estimated Concentration
- Note: All Concentrations in ug/L




Figure 12
Vinyl Chloride Concentrations in Shallow Groundwater



- LEGEND:**
- MW-16 Deep Groundwater Monitoring Well
 - Approximate Property Boundary
 - Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
 - Benzene Groundwater Cleanup Level Contour (0.8 ug/L)
 - (<0.5/<0.5) Concentration of Benzene in Groundwater (March/Sept 2015)
 - < Less than the Concentration Shown
 - J Estimated Concentration

Note: All Concentrations in ug/L




Figure 13
Benzene Concentrations in Deep Groundwater



- LEGEND:**
- MW-16 Deep Groundwater Monitoring Well
 - Approximate Property Boundary
 - Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
 - Toulene Groundwater Cleanup Level Contour (1,000 ug/L)
 - (<0.5/<0.5) Concentration of Toulene in Groundwater (March/Sept 2015)
 - < Less than the Concentration Shown
 - J Estimated Concentration
- Note: All Concentrations in ug/L




Figure 14
Toulene Concentrations in Deep Groundwater



LEGEND:

- MW-16 Deep Groundwater Monitoring Well
- Approximate Property Boundary
- Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
- 1,1-Dichloroethane Groundwater Cleanup Level Contour (800 ug/L)
- (<0.5/<0.5) Concentration of 1,1-Dichloroethane in Groundwater (March/Sept 2015)
- < Less than the Concentration Shown
- J Estimated Concentration

Note: All Concentrations in ug/L






Figure 15
1,1-Dichloroethane Concentrations in Deep Groundwater

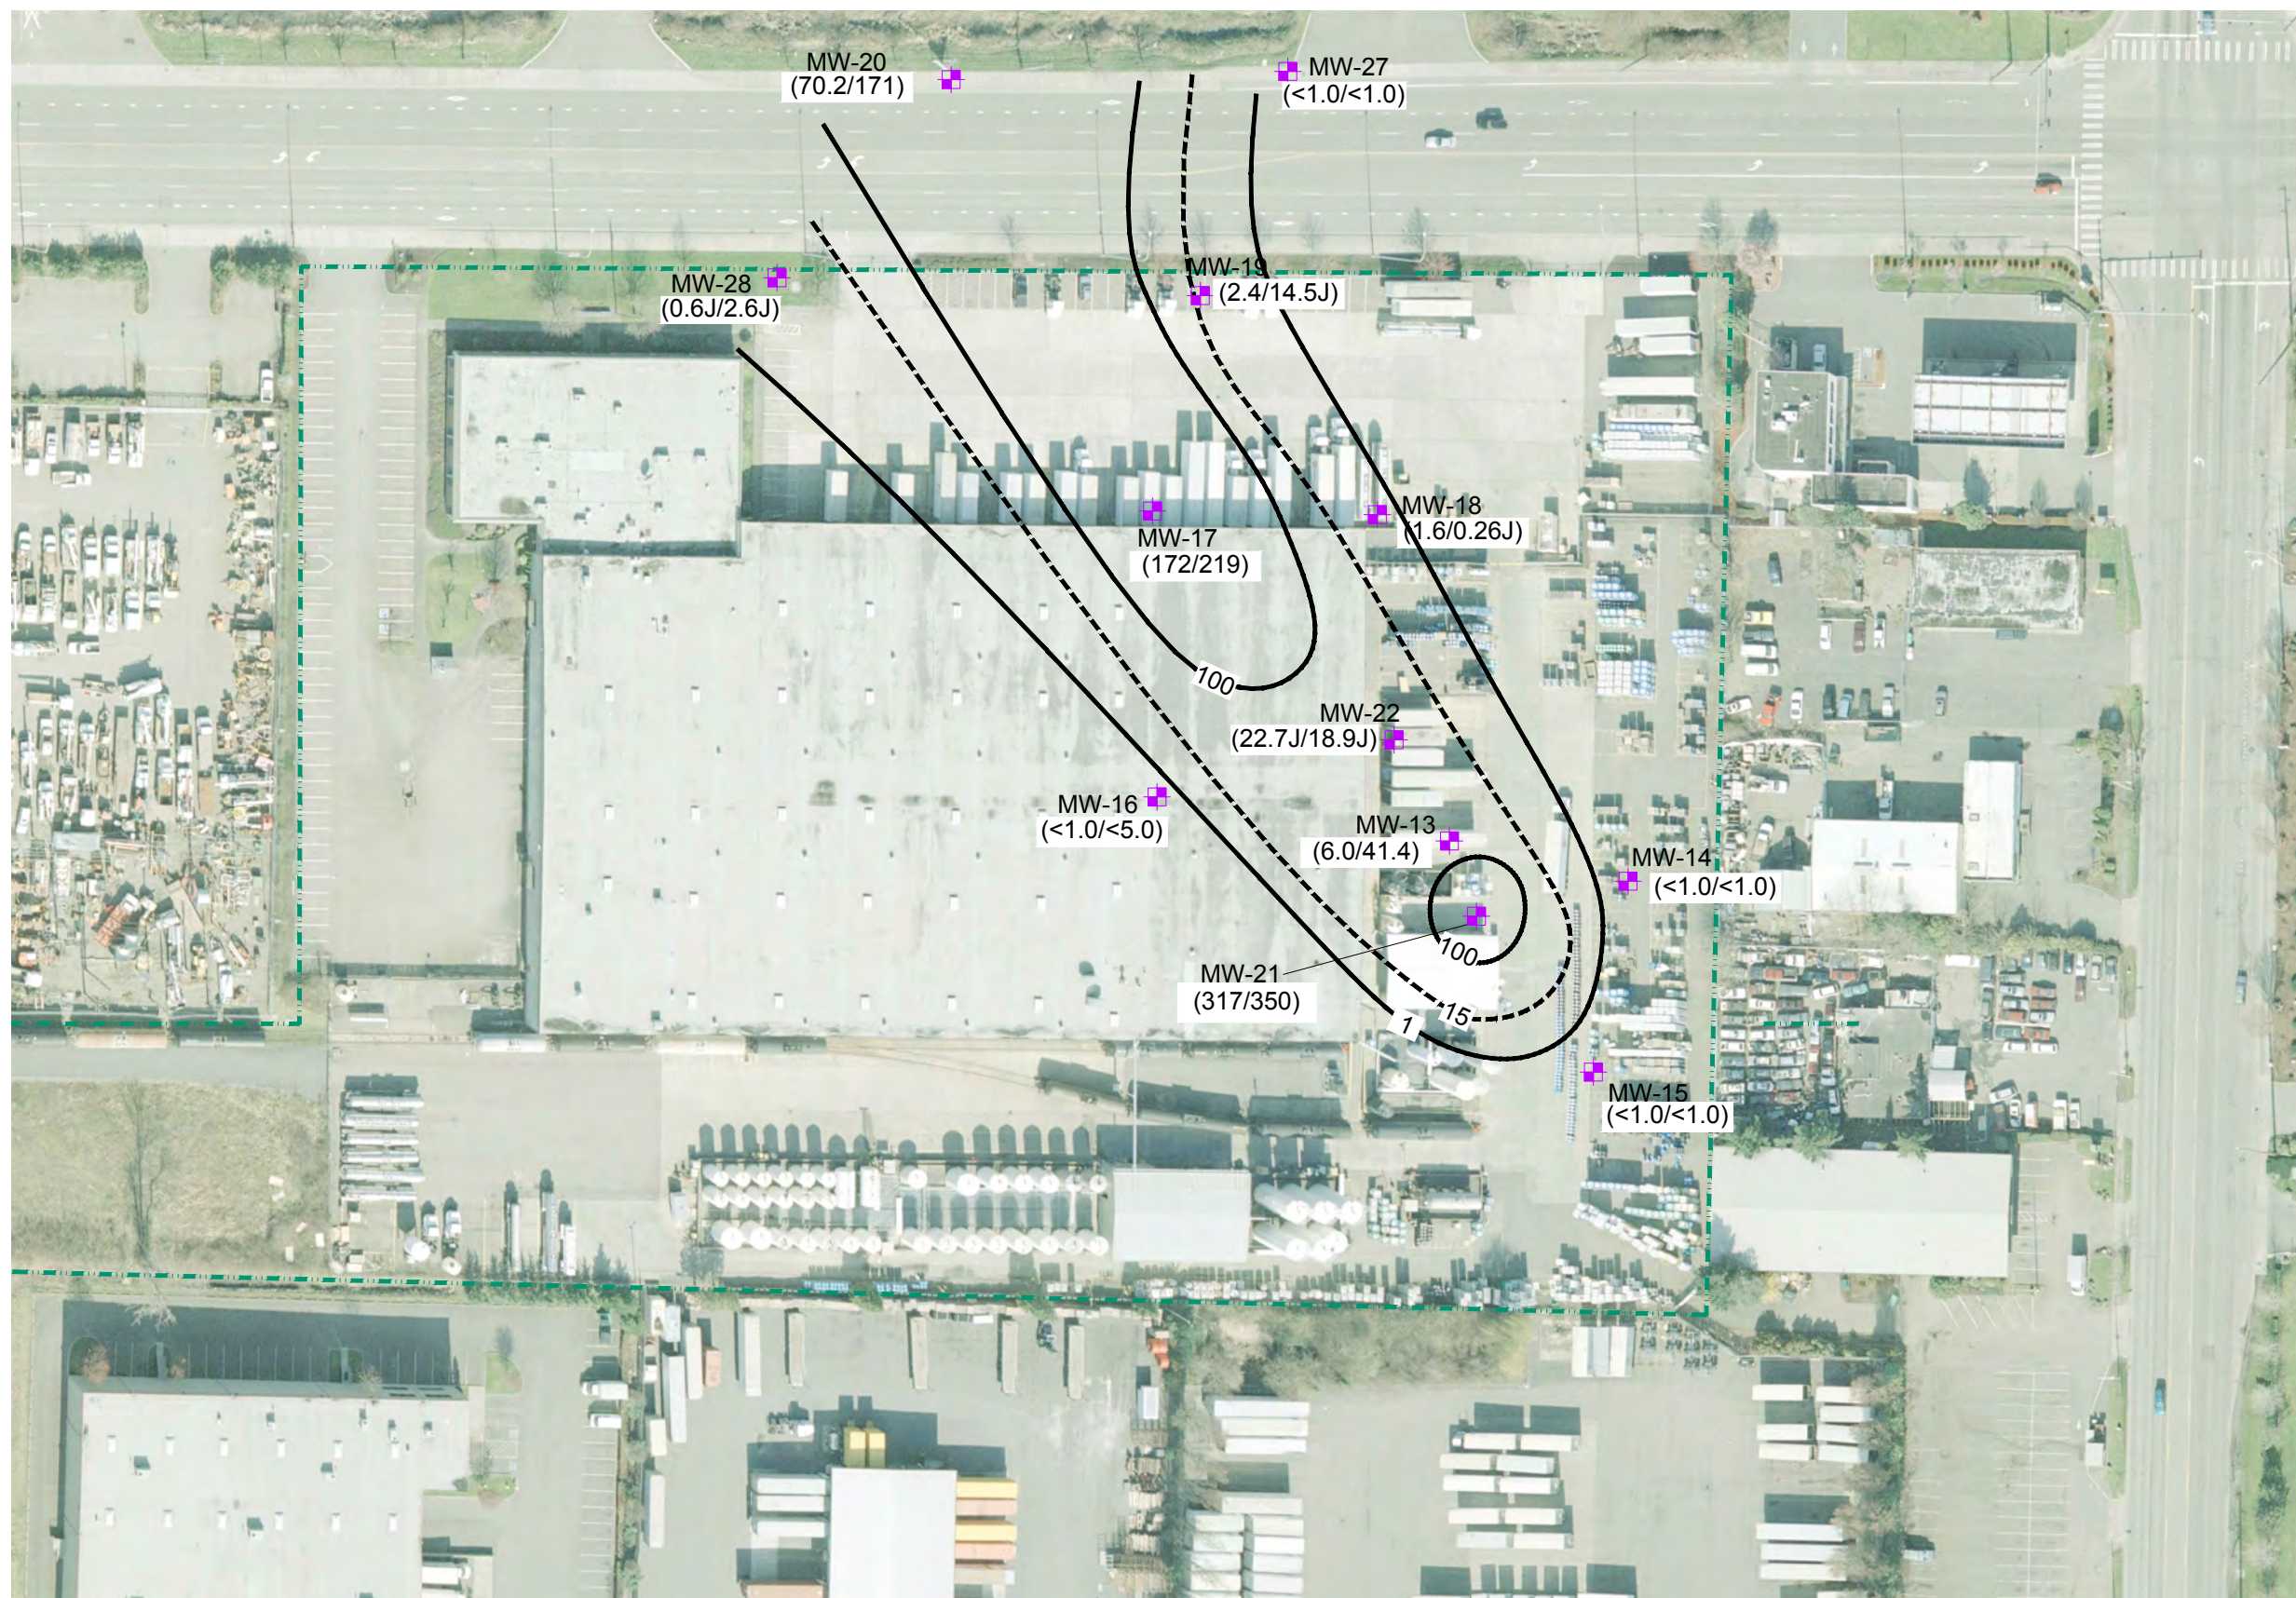

- LEGEND:**
- MW-16 Deep Groundwater Monitoring Well
 - Approximate Property Boundary
 - Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
 - Chloroethane Groundwater Cleanup Level Contour (15 ug/L)
 - (<0.5/<0.5) Concentration of Chloroethane in Groundwater (March/Sept 2015)
 - < Less than the Concentration Shown
 - J Estimated Concentration



Note: All Concentrations in ug/L

Figure 16
Chloroethane Concentrations in Deep Groundwater



LEGEND:

- MW-16 Deep Groundwater Monitoring Well
- Approximate Property Boundary
- Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
- cis-1,2-Dichloroethene Groundwater Cleanup Level Contour (70 ug/L)
- (<0.5/<0.5) Concentration of cis-1,2-Dichloroethene in Groundwater (March/Sept 2015)
- < Less than the Concentration Shown
- J Estimated Concentration

Note: All Concentrations in ug/L




Figure 17
cis-1,2-Dichloroethene Concentrations in Deep Groundwater



LEGEND:

- MW-16 Deep Groundwater Monitoring Well
- Approximate Property Boundary
- Isoconcentration Contour Based on Highest Detected Concentration (ug/L)
- Vinyl Chloride Groundwater Cleanup Level Contour (0.5 ug/L)
- (<0.2/<0.2) Concentration of Vinyl Chloride in Groundwater (March/Sept 2015)
- < Less than the Concentration Shown
- J Estimated Concentration

Note: All Concentrations in ug/L




Figure 18
Vinyl Chloride Concentrations in Deep Groundwater

Appendix A
Historical Groundwater Elevation Data

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
Shallow On-Site Monitoring and Pilot Test Wells					
MW-1	33.45	04/17/95	12:14	4.70	28.75
		09/07/95	NR	6.24	27.21
		11/10/95	NR	5.86	27.59
		12/07/95	NR	5.13	28.32
		01/29/96	NR	4.57	28.88
		09/04/96	13:50	6.04	27.41
		10/11/96	11:00	6.04	27.41
		11/06/96	9:25	5.53	27.92
		12/10/96	10:55	4.46	28.99
		01/10/97	NR	4.20	29.25
		02/21/97	12:45	4.33	29.12
		03/04/97	9:55	4.33	29.12
		06/27/97	10:57	4.81	28.64
		09/04/97	11:08	5.63	27.82
		12/22/97	8:46	4.82	28.63
		03/06/98	10:03	4.50	28.95
		06/18/98	9:19	5.02	28.43
		09/29/98	9:25	6.52	26.93
		12/15/98	9:45	4.78	28.67
		01/07/99	9:02	4.33	29.12
		01/13/99	9:29	4.35	29.10
		03/02/99	12:43	3.60	29.85
		06/16/99	10:26	4.87	28.58
		09/16/99	10:43	5.72	27.73
		12/08/99	8:43	4.63	28.82
		03/07/00	8:58	4.28	29.17
		06/21/00	9:45	4.80	28.65
	09/12/00	9:30	5.81	27.64	
	12/07/00	8:45	5.36	28.09	
	03/15/01	9:30	4.91	28.54	
	07/12/01	11:00	5.10	28.35	
	09/24/01	11:29	5.95	27.50	
	33.15	01/02/02	11:07	4.35	28.80
		03/27/02	9:55	4.12	29.03
		06/11/02	10:42	4.75	28.40
		09/17/02	12:36	6.03	27.12
		12/16/02	11:40	5.60	27.55
		03/17/03	11:00	4.91	28.24
		06/10/03	NR	5.11	28.04
		09/11/03	10:05	6.66	26.49
		12/04/03	7:30	4.96	28.19
		01/12/04	11:12	4.70	28.45
		03/16/04	12:20	4.80	28.35
		06/10/04	8:25	5.25	27.90
		09/22/04	11:15	5.88	27.27
		04/04/05	13:40	5.03	28.12
		09/20/05	9:40	6.77	26.38
		01/25/06	15:15	4.45	28.70
		03/14/06	10:30	4.60	28.55
		03/15/06	0:00	4.56	28.59
		05/19/06	12:30	4.91	28.24
		06/09/06	14:12	4.70	28.45
		09/12/06	12:32	6.85	26.30
04/03/07		10:30	4.51	28.64	
04/03/07		12:04	4.40	28.75	
09/24/07		10:55	6.40	26.75	
09/24/07		12:47	6.38	26.77	
05/01/08		11:08	4.85	28.30	
09/29/08	NR	5.92	27.23		
03/23/09	10:25	4.65	28.50		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-1 (continued)	33.15	09/28/09	13:45	6.21	26.94
		03/25/10	8:39	4.75	28.40
		04/05/10	10:28	4.51	28.64
		05/06/10	NR	NM	NM
		07/13/10	14:35	4.81	28.34
		09/27/10	10:10	5.35	27.80
		02/28/11	14:55	4.29	28.86
		03/22/11	14:05	4.00	29.15
		04/25/11	8:22	NM	NM
		05/04/11	8:36	3.99	29.16
		06/22/11	8:25	4.21	28.94
		09/20/11	13:20	6.06	27.09
		12/06/11	11:10	5.02	28.13
		03/05/12	12:39	4.06	29.09
		03/05/12	14:16	3.76	29.39
		03/05/12	14:50	3.79	29.36
		06/26/12	12:50	4.06	29.09
		06/26/12	12:55	3.97	29.18
		06/26/12	14:07	3.94	29.21
		10/03/12	15:55	6.54	26.61
		12/18/12	13:42	4.50	28.65
		12/18/12	15:25	4.28	28.87
		03/04/13	14:32	4.43	28.72
		03/04/13	14:53	4.28	28.87
		03/04/13	15:10	4.23	28.92
		03/04/13	16:07	4.20	28.95
		06/06/13	7:35	4.45	28.70
		09/24/13	12:43	5.89	27.26
		03/25/14	12:50	4.00	29.15
		09/22/14	15:25	6.10	27.05
03/16/15	11:02	4.41	28.74		
09/13/15	11:25	6.52	26.63		
MW-2	34.07	04/17/95	12:09	6.26	27.81
		09/07/95	NR	7.72	26.35
		11/10/95	NR	7.21	26.86
		12/07/95	NR	6.01	28.06
		01/29/96	NR	5.37	28.70
		09/04/96	9:00	7.93	26.14
		10/11/96	10:30	7.71	26.36
		11/06/96	8:50	7.02	27.05
		12/10/96	10:50	5.55	28.52
		01/10/97	NR	5.02	29.05
		02/21/97	12:10	5.31	28.76
		03/04/97	9:50	5.29	28.78
		06/27/97	10:53	6.11	27.96
		09/04/97	11:04	7.07	27.00
		12/22/97	8:44	5.92	28.15
		03/06/98	2:20	5.67	28.40
		06/18/98	9:22	6.54	27.53
		09/29/98	9:28	7.95	26.12
		12/15/98	9:52	5.71	28.36
		01/07/99	8:50	5.51	28.56
		01/13/99	9:25	5.62	28.45
		03/02/99	9:29	4.73	29.34
		06/16/99	10:31	6.40	27.67
		09/16/99	10:41	7.39	26.68
		12/08/99	8:40	5.84	28.23
		03/07/00	8:52	5.36	28.71
		06/21/00	9:54	6.43	27.64
09/12/00	11:25	7.92	26.15		
12/07/00	8:40	7.11	26.96		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-2 (continued)	34.07	03/15/01	9:40	6.44	27.63
		07/12/01	13:00	6.83	27.24
		09/24/01	11:33	7.64	26.43
	33.79	01/02/02	10:30	5.61	28.18
		03/27/02	10:00	5.49	28.30
		06/11/02	10:45	6.28	27.51
		09/17/02	12:33	7.67	26.12
		12/16/02	11:37	7.07	26.72
		03/17/03	10:55	5.75	28.04
		06/10/03	NR	6.68	27.11
		09/10/03	9:10	8.16	25.63
		12/04/03	9:30	6.24	27.55
		01/12/04	10:55	5.75	28.04
		03/15/04	11:15	5.90	27.89
		06/10/04	8:10	6.50	27.29
		09/23/04	8:10	7.12	26.67
		04/04/05	13:35	6.00	27.79
		09/20/05	9:35	7.74	26.05
		03/14/06	10:20	5.45	28.34
		03/15/06	7:55	5.45	28.34
		09/12/06	12:26	7.99	25.80
		04/03/07	10:25	5.35	28.44
		04/03/07	11:58	5.38	28.41
		09/24/07	10:44	7.76	26.03
		05/01/08	11:30	6.11	27.68
		09/29/08	NR	7.45	26.34
		03/23/09	10:06	5.77	28.02
		09/28/09	13:20	7.53	26.26
		03/25/10	8:47	6.53	27.26
		04/05/10	10:45	7.66	26.13
		05/06/10	8:15	7.02	26.77
		07/13/10	14:37	6.55	27.24
		09/27/10	10:05	6.75	27.04
		02/28/11	16:09	5.32	28.47
		03/17/11	12:43	5.14	28.65
		04/25/11	8:32	5.21	28.58
		05/04/11	8:39	5.43	28.36
		06/22/11	8:32	5.96	27.83
		09/20/11	13:28	7.50	26.29
		12/06/11	11:20	6.58	27.21
		03/05/12	12:47	5.46	28.33
		03/05/12	14:00	5.45	28.34
	06/25/12	12:15	5.92	27.87	
10/03/12	15:30	7.79	26.00		
12/18/12	13:39	5.57	28.22		
12/18/12	15:14	5.58	28.21		
03/04/13	14:35	5.80	27.99		
03/04/13	14:45	5.80	27.99		
06/06/13	7:30	6.20	27.59		
09/24/13	12:32	7.21	26.58		
03/25/14	12:38	4.93	28.86		
09/22/14	15:16	7.60	26.19		
03/16/15	11:17	5.47	28.32		
09/13/15	9:35	7.90	25.89		
MW-3	33.21	04/17/95	12:01	6.54	26.67
		09/07/95	NR	7.34	25.87
		11/10/95	NR	6.93	26.28
		12/07/95	NR	6.24	26.97
		01/29/96	NR	5.73	27.48
		09/04/96	14:50	7.17	26.04
		10/11/96	10:20	7.32	25.89

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-3 (continued)	33.21	11/06/96	9:10	6.85	26.36
		12/10/96	10:25	5.75	27.46
		01/10/97	NR	5.30	27.91
		02/21/97	11:55	5.51	27.70
		03/04/97	9:27	5.50	27.71
		06/27/97	10:30	6.24	26.97
		09/04/97	10:47	6.87	26.34
		12/22/97	8:10	6.03	27.18
		03/06/98	9:34	5.90	27.31
		06/18/98	8:57	6.51	26.70
		09/29/98	9:05	5.73	27.48
		12/14/98	9:32	5.92	27.29
		01/07/99	8:44	5.81	27.40
		01/13/99	9:12	5.93	27.28
		03/02/99	9:04	5.21	28.00
		06/16/99	9:55	6.48	26.73
		09/16/99	10:23	7.20	26.01
		12/08/99	8:24	6.08	27.13
		03/07/00	8:23	5.74	27.47
		06/21/00	9:15	6.48	26.73
	09/12/00	10:30	7.40	25.81	
	12/07/00	9:25	6.94	26.27	
	03/15/01	9:57	6.41	26.80	
	07/12/01	15:55	6.77	26.44	
	09/24/01	11:37	7.48	25.73	
	01/02/02	11:12	5.71	27.23	
	03/27/02	10:05	5.65	27.29	
	06/11/02	10:27	6.28	26.66	
	09/17/02	12:00	7.41	25.53	
	12/16/02	11:05	6.81	26.13	
	03/17/03	10:05	5.84	27.10	
	06/10/03	NR	6.60	26.34	
	09/11/03	9:50	7.82	25.12	
	12/03/03	12:00	6.26	26.68	
	01/12/04	11:59	5.80	27.14	
	03/15/04	10:00	5.98	26.96	
	06/10/04	7:00	6.22	26.72	
	09/22/04	10:05	7.87	25.07	
	04/04/05	12:10	5.92	27.02	
	09/20/05	8:10	7.45	25.49	
	01/25/06	15:30	5.24	27.70	
	03/14/06	11:40	5.57	27.37	
	03/14/06	11:53	5.57	27.37	
	09/12/06	11:10	7.70	25.24	
	04/03/07	9:35	5.52	27.42	
	04/03/07	11:10	5.51	27.43	
	09/24/07	11:35	7.43	25.51	
	05/01/08	9:24	5.96	26.98	
	09/29/08	NR	7.08	25.86	
	03/23/09	8:58	5.74	27.20	
09/28/09	13:00	7.22	25.72		
03/25/10	9:30	5.75	27.19		
04/05/10	11:30	5.96	26.98		
05/06/10	8:56	6.25	26.69		
07/13/10	14:50	5.90	27.04		
09/27/10	11:20	6.36	26.58		
02/28/11	NM	NM	-		
03/17/11	13:45	5.15	27.79		
04/25/11	9:38	5.11	27.83		
05/04/11	9:24	5.35	27.59		
06/22/11	7:52	5.74	27.20		
	32.94				

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-3 (continued)	32.94	09/20/11	12:58	7.10	25.84
		12/06/11	10:56	6.35	26.59
		03/05/12	13:50	5.35	27.59
		03/05/12	15:10	5.35	27.59
		06/25/12	11:55	5.71	27.23
		06/25/12	11:57	5.70	27.24
		10/03/12	16:30	7.47	25.47
		12/18/12	11:52	5.40	27.54
		12/18/12	12:31	5.40	27.54
		03/04/13	14:05	5.70	27.24
		03/04/13	15:18	5.68	27.26
		06/06/13	8:02	6.03	26.91
		09/24/13	11:50	6.74	26.20
		03/25/14	11:46	6.11	26.83
		09/22/14	16:00	7.20	25.74
		03/16/15	9:52	5.19	27.75
09/13/15	8:36	7.45	25.49		
MW-4	33.20	09/04/96	13:00	5.89	27.31
		10/11/96	10:40	6.21	26.99
		11/06/96	9:15	5.75	27.45
		12/10/96	10:40	4.68	28.52
		01/10/97	NR	3.95	29.25
		02/21/97	12:40	4.10	29.10
		03/04/97	11:35	4.16	29.04
		06/27/97	10:44	4.59	28.61
		09/04/97	10:55	5.44	27.76
		12/22/97	8:39	4.78	28.42
		03/06/98	9:51	4.28	28.92
		06/18/98	9:16	5.00	28.20
		09/29/98	9:20	6.44	26.76
		12/14/98	9:43	5.16	28.04
		01/07/99	9:06	4.38	28.82
		01/13/99	9:17	4.38	28.82
		03/02/99	9:26	3.73	29.47
		06/16/99	10:23	4.77	28.43
		09/16/99	10:45	5.78	27.42
		12/08/99	8:45	4.81	28.39
	03/07/00	9:03	4.17	29.03	
	06/21/00	9:41	4.85	28.35	
	09/12/00	9:40	6.22	26.98	
	12/07/00	8:50	6.78	26.42	
	03/15/01	9:35	5.10	28.10	
	07/12/01	10:00	5.14	28.06	
	09/24/01	11:41	6.02	27.18	
	32.86	01/02/02	11:05	4.41	28.45
		03/27/02	9:53	4.17	28.69
		06/11/02	10:37	4.69	28.17
		09/17/02	12:38	6.25	26.61
		12/16/02	11:45	6.22	26.64
		03/17/03	11:02	4.74	28.12
		06/10/03	NR	5.17	27.69
		09/10/03	9:20	7.02	25.84
		12/04/03	7:25	5.49	27.37
		01/12/04	11:20	4.88	27.98
		03/15/04	11:25	4.83	28.03
		06/10/04	8:35	5.33	27.53
		09/22/04	11:30	6.11	26.75
04/04/05		13:50	5.28	27.58	
09/20/05		9:55	6.65	26.21	
01/25/06		15:25	4.41	28.45	
03/14/06		10:50	4.58	28.28	

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-4 (continued)	32.86	03/15/06	12:05	4.64	28.22
		05/19/06	12:25	5.00	27.86
		06/09/06	14:20	4.80	28.06
		09/12/06	12:45	6.96	25.90
		04/03/07	10:45	4.46	28.40
		04/03/07	12:15	4.40	28.46
		09/24/07	11:05	6.67	26.19
		05/01/08	10:30	5.00	27.86
		09/29/08	NR	6.29	26.57
		03/23/09	10:58	4.80	28.06
		09/28/09	14:00	6.53	26.33
		03/25/10	10:28	4.60	28.26
		04/05/10	10:30	4.67	28.19
		05/06/10	8:21	5.32	27.54
		07/13/10	14:42	4.98	27.88
		09/27/10	10:27	5.70	27.16
		02/28/11	14:08	4.40	28.46
		03/17/11	14:13	4.10	28.76
		04/25/11	8:10	4.11	28.75
		05/04/11	8:31	3.90	28.96
		06/22/11	8:20	4.58	28.28
		09/20/11	13:52	6.31	26.55
		12/06/11	11:08	5.51	27.35
		03/05/12	13:03	4.26	28.60
		03/05/12	14:25	4.27	28.59
		06/25/12	13:07	4.50	28.36
		10/03/12	13:12	6.70	26.16
		12/18/12	13:47	4.82	28.04
		12/18/12	15:21	4.80	28.06
		03/04/13	14:28	4.75	28.11
		03/04/13	15:11	4.73	28.13
06/06/13	7:38	4.82	28.04		
09/24/13	12:51	6.20	26.66		
03/25/14	13:02	3.93	28.93		
09/22/14	15:29	6.37	26.49		
03/16/15	10:54	4.61	28.25		
09/13/15	9:07	6.81	26.05		
MW-5	32.77	09/04/96	11:50	6.74	26.03
		10/11/96	10:45	6.82	25.95
		11/06/96	9:05	6.24	26.53
		12/10/96	10:30	5.01	27.76
		01/10/97	NR	4.54	28.23
		02/21/97	12:30	4.79	27.98
		03/04/97	9:40	4.78	27.99
		06/27/97	10:40	5.54	27.23
		09/04/97	10:59	6.29	26.48
		12/22/97	8:32	5.36	27.41
		03/06/98	9:43	5.15	27.62
		06/18/98	9:11	5.89	26.88
		09/29/98	9:39	7.13	25.64
		12/15/98	9:38	5.18	27.59
		01/07/99	9:08	5.04	27.73
		01/13/99	9:00	5.97	26.80
		03/02/99	9:16	4.38	28.39
		06/16/99	10:07	5.81	26.96
		09/16/99	10:36	6.58	26.19
		12/08/99	8:34	5.33	27.44
		03/07/00	8:44	4.92	27.85
		06/21/00	9:24	5.31	27.46
		09/12/00	10:05	6.84	25.93
		12/07/00	8:55	6.42	26.35

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-5 (continued)	32.77	03/15/01	9:55	5.82	26.95
		07/09/01	10:08	6.22	26.55
		08/27/01	10:11	6.67	26.10
		09/24/01	11:43	6.98	25.79
		10/22/01	11:37	6.94	25.83
		11/19/01	13:10	6.31	26.46
	32.60	01/02/02	10:57	5.14	27.46
		03/27/02	10:36	5.05	27.55
		06/11/02	10:13	5.75	26.85
		09/17/02	12:15	6.98	25.62
		12/16/02	11:22	6.31	26.29
		03/17/03	10:30	5.31	27.29
		06/10/03	NR	6.08	26.52
		09/11/03	9:55	7.39	25.21
		12/03/03	11:40	5.70	26.90
		01/12/04	10:23	5.24	27.36
		03/15/04	10:45	5.39	27.21
		09/22/04	11:00	6.44	26.16
		04/04/05	12:55	5.34	27.26
		09/20/05	9:00	6.99	25.61
		03/14/06	9:30	5.04	27.56
		03/14/06	13:40	5.03	27.57
		09/12/06	11:52	7.25	25.35
		04/03/07	11:35	5.01	27.59
		09/24/07	10:26	7.01	25.59
		05/01/08	10:05	5.50	27.10
		09/29/08	NR	6.71	25.89
		03/23/09	9:35	5.39	27.21
		09/28/09	14:10	6.80	25.80
		03/25/10	10:12	5.52	27.08
		04/05/10	10:34	5.91	26.69
		05/06/10	8:10	6.02	26.58
		07/13/10	14:42	5.79	26.81
		09/27/10	10:19	5.95	26.65
		02/28/11	13:47	4.69	27.91
	03/22/11	13:05	4.63	27.97	
04/25/11	8:53	4.65	27.95		
05/04/11	8:56	4.85	27.75		
06/22/11	8:57	5.30	27.30		
09/20/11	13:45	6.71	25.89		
12/06/11	11:34	5.91	26.69		
03/05/12	12:16	4.89	27.71		
03/05/12	14:30	4.90	27.70		
06/25/12	12:40	5.27	27.33		
10/03/12	15:00	7.03	25.57		
12/18/12	13:31	4.92	27.68		
12/18/12	15:28	4.93	27.67		
03/04/13	15:02	5.22	27.38		
03/04/13	16:12	5.22	27.38		
06/06/13	7:50	5.56	27.04		
09/24/13	12:18	6.51	26.09		
03/25/14	12:02	4.52	28.08		
09/22/14	16:23	6.80	25.80		
03/16/15	10:25	4.74	27.86		
09/13/15	9:12	7.11	25.49		
MW-6	33.33	09/04/96	9:50	6.26	27.07
		10/11/96	10:35	6.55	26.78
		11/06/96	8:58	5.98	27.35
		12/10/96	10:45	5.08	28.25
		01/10/97	NR	4.17	29.16
		02/21/97	12:15	4.33	29.00

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-6 (continued)	33.33	03/04/97	9:45	4.42	28.91
		06/27/97	10:49	5.05	28.28
		09/04/97	11:01	5.87	27.46
		12/22/97	8:36	5.11	28.22
		03/06/98	9:49	4.57	28.76
		06/18/98	9:26	5.48	27.85
		09/29/98	9:32	6.87	26.46
		12/15/98	9:50	5.15	28.18
		01/07/99	8:55	4.39	28.94
		01/13/99	9:20	4.44	28.89
		03/02/99	9:24	3.64	29.69
		06/16/99	10:19	5.04	28.29
		09/16/99	10:39	6.03	27.30
		12/08/99	8:37	4.82	28.51
		03/07/00	8:48	4.44	28.89
		06/21/00	9:50	5.08	28.25
		09/12/00	11:15	6.24	27.09
		12/07/00	9:05	5.85	27.48
		03/15/01	9:45	5.25	28.08
		07/12/01	15:30	5.61	27.72
	09/24/01	11:46	6.35	26.98	
	01/02/02	10:37	4.52	28.53	
	03/27/02	9:50	4.00	29.05	
	06/11/02	10:51	4.87	28.18	
	06/11/02	12:30	6.39	26.66	
	12/16/02	11:35	6.27	26.78	
	03/17/03	10:46	4.67	28.38	
	06/10/03	NR	5.65	27.40	
	09/10/03	8:55	7.90	25.15	
	12/04/03	8:00	5.91	27.14	
	01/12/04	10:45	5.62	27.43	
	03/15/04	11:10	5.33	27.72	
	06/10/04	8:05	6.40	26.65	
	09/22/04	11:10	7.27	25.78	
	04/04/05	13:20	5.74	27.31	
	09/20/05	9:20	7.72	25.33	
	01/25/06	15:15	4.93	28.12	
	03/14/06	10:00	5.20	27.85	
	03/14/06	14:40	5.20	27.85	
	05/19/06	12:40	5.88	27.17	
	06/09/06	14:00	5.75	27.30	
	09/12/06	12:12	8.00	25.05	
	04/03/07	10:15	4.89	28.16	
	04/03/07	11:50	4.89	28.16	
	09/24/07	10:42	7.87	25.18	
	05/02/08	10:18	5.75	27.30	
	09/29/08	NR	7.64	25.41	
	03/23/09	9:54	5.23	27.82	
	09/28/09	13:30	7.93	25.12	
	03/25/10	10:15	5.32	27.73	
04/05/10	10:42	5.20	27.85		
05/06/10	8:19	6.02	27.03		
07/13/10	14:39	6.13	26.92		
09/27/10	9:49	6.84	26.21		
02/28/11	16:13	5.11	27.94		
03/17/11	12:57	4.50	28.55		
04/25/11	8:28	4.70	28.35		
05/04/11	8:44	4.58	28.47		
06/22/11	8:43	5.48	27.57		
09/20/11	13:33	7.41	25.64		
12/06/11	11:25	6.23	26.82		
	33.05				

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-6 (continued)	33.05	03/05/12	12:50	5.00	28.05
		03/05/12	14:03	4.95	28.10
		06/25/12	12:22	5.58	27.47
		10/03/12	15:30	7.80	25.25
		12/18/12	13:37	5.31	27.74
		12/18/12	15:10	5.31	27.74
		03/04/13	14:30	5.33	27.72
		03/04/13	15:09	5.30	27.75
		06/06/13	7:34	5.79	27.26
		09/24/13	12:26	7.35	25.70
		03/25/14	12:26	4.30	28.75
		09/22/14	15:21	7.80	25.25
		03/16/15	11:15	4.85	28.20
		09/13/15	9:24	8.15	24.90
MW-7	33.24	12/22/97	8:26	5.86	27.38
		03/06/98	9:41	5.66	27.58
		06/18/98	9:04	6.38	26.86
		09/29/98	9:15	7.62	25.62
		12/14/98	9:36	5.66	27.58
		01/07/99	8:34	5.58	27.66
		01/13/99	9:05	5.68	27.56
		03/02/99	9:09	4.89	28.35
		06/16/99	10:03	6.32	26.92
		09/16/99	10:30	7.09	26.15
		12/08/99	8:28	5.89	27.35
		03/07/00	8:38	5.45	27.79
		06/21/00	10:00	6.47	26.77
		09/12/00	10:25	7.31	25.93
		12/07/00	9:20	6.91	26.33
		03/15/01	10:00	6.32	26.92
		07/12/01	13:45	6.75	26.49
		08/27/01	10:30	7.09	26.15
		09/24/01	11:49	7.33	25.91
		10/22/01	18:37	7.20	26.04
	11/19/01	12:50	6.33	26.91	
	32.96	01/02/02	10:23	5.55	27.41
		03/27/02	10:12	5.45	27.51
		06/11/02	10:23	6.16	26.80
		09/17/02	12:41	7.34	25.62
		12/16/02	11:10	6.71	26.25
		03/17/03	10:15	5.70	27.26
		06/10/03	NR	6.48	26.48
		09/10/03	8:23	7.80	25.16
		12/03/03	11:30	6.17	26.79
		01/12/04	10:07	5.64	27.32
		03/15/04	10:23	5.79	27.17
		06/10/04	7:25	6.22	26.74
		09/22/04	10:35	6.84	26.12
		04/04/05	12:30	5.73	27.23
		09/20/05	8:35	7.38	25.58
		01/25/06	14:55	5.06	27.90
		03/14/06	9:00	5.41	27.55
		03/14/06	12:20	5.44	27.52
		05/19/06	13:00	5.99	26.97
		06/09/06	13:36	5.81	27.15
		09/12/06	11:35	7.62	25.34
04/03/07		9:45	5.31	27.65	
04/03/07	11:20	5.32	27.64		
09/24/07	10:13	7.36	25.60		
05/01/08	9:46	5.86	27.10		
09/29/08	NR	7.07	25.89		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-7 (continued)	32.96	03/23/09	9:25	5.61	27.35
		09/28/09	12:42	7.18	25.78
		03/25/10	8:12	5.86	27.10
		04/05/10	10:51	6.22	26.74
		05/06/10	8:47	6.35	26.61
		07/13/10	14:15	6.13	26.83
		09/27/10	11:30	6.35	26.61
		02/28/11	15:25	5.07	27.89
		03/17/11	13:30	5.00	27.96
		04/25/11	9:13	5.05	27.91
		05/04/11	9:07	5.25	27.71
		06/22/11	8:06	5.64	27.32
		09/20/11	13:10	7.08	25.88
		12/06/11	11:48	6.30	26.66
		03/05/12	13:42	5.27	27.69
		03/05/12	15:01	5.28	27.68
		06/25/12	12:12	5.65	27.31
		06/25/12	12:14	5.64	27.32
		10/03/12	16:30	7.41	25.55
		12/18/12	12:12	5.30	27.66
		12/18/12	12:50	5.30	27.66
		03/04/13	14:20	5.63	27.33
		03/04/13	15:14	5.60	27.36
		06/06/13	7:55	5.96	27.00
		09/24/13	12:03	6.73	26.23
		03/25/14	11:58	4.48	28.48
09/22/14	12:05	7.17	25.79		
03/16/15	9:55	5.11	27.85		
09/13/15	8:46	7.43	25.53		
MW-8	33.83	12/22/97	8:30	6.39	27.44
		03/06/98	9:46	6.20	27.63
		06/18/98	9:13	6.94	26.89
		09/29/98	9:42	8.22	25.61
		12/14/98	9:55	6.21	27.62
		01/07/99	9:12	6.10	27.73
		01/13/99	8:55	6.22	27.61
		03/02/99	9:21	5.38	28.45
		06/16/99	10:12	6.88	26.95
		09/16/99	10:33	7.65	26.18
		12/08/99	8:33	6.42	27.41
		03/07/00	8:42	5.97	27.86
		06/21/00	10:06	6.77	27.06
		09/12/00	10:20	7.90	25.93
		12/07/00	9:10	7.46	26.37
		03/15/01	9:50	6.95	26.88
		07/12/01	12:00	7.31	26.52
	08/27/01	10:27	7.65	26.18	
	09/24/01	11:52	7.98	25.85	
	10/22/01	17:50	7.95	25.88	
	11/19/01	14:15	6.88	26.95	
	01/02/02	10:48	6.07	27.50	
	03/27/02	10:21	5.98	27.59	
	06/11/02	10:08	6.71	26.86	
	09/17/02	12:26	7.94	25.63	
	12/16/02	11:28	7.29	26.28	
	03/17/03	10:37	6.58	26.99	
	06/10/03	NR	7.05	26.52	
	09/10/03	8:44	8.38	25.19	
	12/03/03	11:00	6.70	26.87	
01/12/04	10:33	6.19	27.38		
03/15/04	11:00	6.32	27.25		
	33.57				

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-8 (continued)	33.57	06/10/04	7:55	6.78	26.79
		09/23/04	8:05	7.40	26.17
		04/04/05	13:10	6.29	27.28
		09/20/05	9:10	7.94	25.63
		03/14/06	9:45	6.03	27.54
		03/15/06	10:55	6.03	27.54
		05/19/06	12:50	6.52	27.05
		06/09/06	13:54	6.37	27.20
		09/12/06	12:04	8.20	25.37
		04/03/07	10:08	5.88	27.69
		04/03/07	11:43	5.89	27.68
		09/24/07	10:34	7.95	25.62
		05/01/08	15:15	6.42	27.15
		09/29/08	NR	7.64	25.93
		03/23/09	9:43	6.15	27.42
		09/28/09	14:15	7.75	25.82
		03/25/10	10:20	6.43	27.14
		04/05/10	10:37	6.85	26.72
		05/06/10	8:10	6.97	26.60
		07/13/10	14:41	6.71	26.86
		09/27/10	9:41	6.93	26.64
		02/28/11	13:01	5.62	27.95
		03/17/11	13:00	5.55	28.02
		04/25/11	8:45	5.60	27.97
		05/04/11	8:50	5.80	27.77
		06/22/11	8:48	6.24	27.33
		09/20/11	13:38	7.65	25.92
		12/06/11	11:30	6.86	26.71
		03/05/12	13:20	5.84	27.73
		03/05/12	14:06	5.84	27.73
		06/25/12	12:27	6.21	27.36
		10/03/12	15:35	7.98	25.59
		12/18/12	13:34	5.86	27.71
12/18/12	15:07	5.86	27.71		
03/04/13	15:05	6.17	27.40		
03/04/13	16:13	6.18	27.39		
06/06/13	7:52	6.51	27.06		
09/24/13	12:14	7.25	26.32		
03/25/14	12:22	5.39	28.18		
09/22/14	16:27	7.72	25.85		
03/16/15	10:28	4.68	28.89		
09/13/15	9:18	8.04	25.53		
MW-9	33.77	08/27/01	10:26	7.80	25.97
		10/22/01	16:55	7.95	25.82
		11/19/01	14:23	7.02	26.75
		01/02/02	10:44	6.21	27.56
		03/27/02	10:25	6.06	27.71
		06/11/02	10:05	6.84	26.93
		09/17/02	12:28	8.11	25.66
		12/16/02	11:30	7.51	26.26
		03/17/03	10:41	6.36	27.41
		06/10/03	NR	7.20	26.57
		09/10/03	8:49	8.61	25.16
		12/03/03	11:05	6.90	26.87
		01/12/04	10:40	6.34	27.43
		03/15/04	11:05	6.41	27.36
		06/10/04	8:00	7.00	26.77
		09/22/04	11:05	7.81	25.96
		04/04/05	13:15	6.45	27.32
		09/20/05	9:15	8.15	25.62
01/25/06	15:10	5.74	28.03		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-9 (continued)	33.77	03/14/06	9:50	6.09	27.68
		03/14/06	14:10	6.09	27.68
		05/19/06	12:45	6.71	27.06
		06/09/06	13:58	6.54	27.23
		09/12/06	12:08	8.42	25.35
		04/03/07	10:10	6.00	27.77
		04/03/07	11:47	6.01	27.76
		09/24/07	10:37	8.15	25.62
		05/01/08	12:12	6.57	27.20
		09/29/08	NR	7.89	25.88
		03/23/09	9:50	6.28	27.49
		09/28/09	14:20	7.98	25.79
		03/25/10	10:24	6.55	27.22
		04/05/10	10:39	6.89	26.88
		05/06/10	8:11	7.10	26.67
		07/13/10	14:40	6.88	26.89
		09/27/10	9:45	7.12	26.65
		02/28/11	16:15	5.77	28.00
		03/17/11	12:59	5.61	28.16
		04/25/11	8:34	5.69	28.08
		05/04/11	8:48	5.89	27.88
		06/22/11	8:46	6.37	27.40
		09/20/11	13:36	7.84	25.93
		12/06/11	11:28	7.01	26.76
		03/05/12	13:25	5.96	27.81
		03/05/12	14:05	5.96	27.81
		06/25/12	12:25	6.37	27.40
		10/03/12	15:30	8.15	25.62
		12/18/12	13:35	6.00	27.77
		12/18/12	15:08	6.00	27.77
		03/04/13	15:07	6.30	27.47
		03/04/13	16:14	6.30	27.47
		06/06/13	7:53	6.61	27.16
09/24/13	12:15	7.50	26.27		
03/25/14	12:14	5.52	28.25		
09/22/14	16:31	7.90	25.87		
03/16/15	10:30	5.76	28.01		
09/13/15	9:20	8.21	25.56		
MW-10	32.89	01/02/02	10:18	5.48	27.41
		03/27/02	10:08	5.42	27.47
		06/11/02	10:25	6.08	26.81
		09/17/02	12:46	7.25	25.64
		12/16/02	11:07	6.58	26.31
		03/17/03	10:10	5.62	27.27
		06/10/03	NR	6.40	26.49
		09/10/03	8:20	7.72	25.17
		12/03/03	10:30	6.07	26.82
		01/12/04	10:03	5.58	27.31
		03/15/04	10:17	5.73	27.16
		06/10/04	7:15	6.13	26.76
		09/22/04	10:25	6.71	26.18
		04/04/05	12:25	5.66	27.23
		09/20/05	8:30	7.29	25.60
		01/25/06	14:50	5.05	27.84
		03/14/06	11:05	5.35	27.54
		03/15/06	11:25	5.42	27.47
		05/19/06	12:15	5.90	26.99
		06/09/06	13:30	5.74	27.15
		09/12/06	11:28	7.53	25.36
		04/03/07	9:20	5.31	27.58
		04/03/07	11:00	5.27	27.62

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-10 (continued)	32.89	09/24/07	10:08	7.25	25.64
		05/01/08	9:35	5.76	27.13
		09/29/08	NR	6.96	25.93
		03/23/09	8:31	5.54	27.35
		09/28/09	12:51	7.06	25.83
		03/25/10	8:10	5.65	27.24
		04/05/10	10:53	6.00	26.89
		05/06/10	8:46	6.22	26.67
		07/13/10	14:06	6.03	26.86
		09/27/10	11:35	6.21	26.68
		02/28/11	15:31	4.96	27.93
		03/17/11	13:39	4.93	27.96
		04/25/11	9:25	4.94	27.95
		05/04/11	9:09	5.07	27.82
		06/22/11	8:01	5.55	27.34
		09/20/11	13:03	6.96	25.93
		12/06/11	11:50	6.20	26.69
		03/05/12	13:32	5.16	27.73
		03/05/12	15:05	5.17	27.72
		06/25/12	12:05	5.57	27.32
		06/25/12	12:15	5.54	27.35
		10/03/12	16:30	7.31	25.58
		12/18/12	12:10	5.30	27.59
		12/18/12	12:45	5.20	27.69
		12/18/12	14:00	5.19	27.70
		03/04/13	14:16	5.52	27.37
		03/04/13	15:15	5.50	27.39
		06/06/13	7:59	5.85	27.04
		09/24/13	11:59	6.60	26.29
		03/25/14	11:42	4.83	28.06
09/22/14	16:38	7.05	25.84		
03/16/15	9:58	4.79	28.10		
09/13/15	8:44	7.34	25.55		
MW-11	32.79	08/27/01	10:16	6.88	25.91
		10/15/02	11:50	8.20	24.59
		10/22/01	12:20	7.14	25.65
		10/29/01	16:04	6.98	25.81
		11/19/01	12:55	6.27	26.52
		01/02/02	11:00	5.34	27.45
		03/27/02	10:34	5.25	27.54
		06/11/02	10:16	5.95	26.84
		09/17/02	12:14	7.16	25.63
		12/16/02	11:21	6.50	26.29
		03/17/03	10:25	5.48	27.31
		06/10/03	NR	6.28	26.51
		09/10/03	8:36	7.61	25.18
		12/03/03	10:44	5.94	26.85
		01/12/04	10:18	5.43	27.36
		03/15/04	10:40	5.57	27.22
		06/10/04	7:45	6.01	26.78
		09/22/04	10:55	6.62	26.17
		04/04/05	12:50	5.57	27.22
		09/20/05	8:55	7.16	25.63
		03/14/06	9:20	5.21	27.58
		03/14/06	13:15	5.21	27.58
		06/09/06	13:45	5.63	27.16
		09/12/06	11:48	7.42	25.37
		04/03/07	9:59	5.13	27.66
		04/03/07	11:33	5.14	27.65
		09/24/07	10:24	7.16	25.63
05/01/08	10:02	5.65	27.14		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-11 (continued)	32.79	09/29/08	NR	6.86	25.93
		03/23/09	9:32	5.41	27.38
		09/28/09	14:06	6.99	25.80
		03/25/10	9:00	5.67	27.12
		04/05/10	10:33	6.07	26.72
		05/06/10	8:09	6.17	26.62
		07/13/10	14:39	5.94	26.85
		09/27/10	10:15	6.10	26.69
		02/28/11	13:40	4.84	27.95
		03/17/11	13:07	4.80	27.99
		04/25/11	8:54	4.81	27.98
		05/04/11	8:57	5.01	27.78
		06/22/11	9:00	5.43	27.36
		09/20/11	13:47	6.84	25.95
		12/06/11	11:36	6.07	26.72
		06/25/12	12:40	5.42	27.37
		10/03/12	15:00	7.18	25.61
03/25/14	12:10	4.65	28.14		
03/16/15	10:52	4.89	27.90		
09/13/15	9:42	7.22	25.57		
MW-12	32.81	08/27/01	10:15	6.89	25.92
		10/15/01	11:40	8.24	24.57
		10/22/01	14:05	7.13	25.68
		10/29/01	14:17	7.12	25.69
		11/19/01	11:07	6.22	26.59
		01/02/02	11:02	5.36	27.45
		03/27/02	10:31	5.28	27.53
		06/11/02	10:18	5.97	26.84
		09/17/02	12:11	7.16	25.65
		12/16/02	11:19	6.51	26.30
		03/17/03	10:23	5.50	27.31
		06/10/03	NR	6.30	26.51
		09/10/03	8:33	7.64	25.17
		12/03/03	10:42	5.98	26.83
		01/12/04	10:16	5.45	27.36
		03/15/04	10:35	5.60	27.21
		06/10/04	7:40	6.03	26.78
		09/22/04	10:50	6.64	26.17
		04/04/05	12:45	5.55	27.26
		09/20/05	8:50	7.19	25.62
		01/25/06	15:00	4.85	27.96
		03/14/06	9:15	5.20	27.61
		03/14/06	12:50	5.23	27.58
		05/19/06	12:20	5.78	27.03
		06/09/06	13:48	5.61	27.20
		09/12/06	11:46	7.45	25.36
		04/03/07	9:57	5.15	27.66
		04/03/07	11:30	5.14	27.67
		09/24/07	10:22	7.18	25.63
		05/01/08	9:57	5.68	27.13
		09/29/08	NR	6.88	25.93
		03/23/09	9:30	5.44	27.37
		09/28/09	14:03	7.00	25.81
03/25/10	10:07	5.69	27.12		
04/05/10	10:32	6.08	26.73		
05/06/10	8:00	6.20	26.61		
07/13/10	14:40	5.94	26.87		
09/27/10	10:20	6.12	26.69		
02/28/11	13:20	4.86	27.95		
03/17/11	13:09	4.80	28.01		
04/25/11	8:56	4.85	27.96		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-12 (continued)	32.81	05/04/11	8:58	5.05	27.76
		06/22/11	9:03	5.46	27.35
		09/20/11	13:49	6.87	25.94
		12/06/11	11:38	6.10	26.71
		03/05/12	13:17	5.09	27.72
		03/05/12	14:29	5.07	27.74
		06/25/12	12:42	5.44	27.37
		10/03/12	15:17	7.20	25.61
		12/18/12	13:30	5.12	27.69
		12/18/12	15:27	5.10	27.71
		03/04/13	15:03	5.40	27.41
		03/04/13	16:11	5.40	27.41
		06/06/13	7:50	5.75	27.06
		09/24/13	12:19	6.55	26.26
		03/25/14	12:06	4.69	28.12
		09/22/14	16:19	6.98	25.83
		03/16/15	10:53	4.90	27.91
09/13/15	9:14	7.27	25.54		
MW-23	32.78	09/12/06	11:30	7.44	25.34
		04/03/07	9:40	5.17	27.61
		04/03/07	11:14	5.16	27.62
		09/24/07	10:11	7.17	25.61
		05/01/08	9:42	5.66	27.12
		09/29/08	NR	6.87	25.91
		03/23/09	9:17	5.43	27.35
		09/28/09	12:47	6.98	25.80
		03/25/10	8:14	5.63	27.15
		04/05/10	10:49	5.98	26.80
		05/06/10	8:48	6.13	26.65
		07/13/10	14:10	5.93	26.85
		09/27/10	11:30	6.13	26.65
		02/28/11	14:19	4.86	27.92
		03/17/11	13:32	4.83	27.95
		04/25/11	9:11	4.85	27.93
		05/04/11	9:06	5.04	27.74
		06/22/11	8:04	5.48	27.30
		09/20/11	13:07	6.88	25.90
		12/06/11	11:45	6.10	26.68
		03/05/12	13:40	5.07	27.71
		03/05/12	15:00	5.08	27.70
		06/25/12	12:10	5.45	27.33
		06/25/12	12:14	5.45	27.33
		10/03/12	16:30	7.21	25.57
		12/18/12	13:55	5.10	27.68
		12/18/12	15:30	5.10	27.68
03/04/13	15:13	5.41	27.37		
03/04/13	16:13	5.41	27.37		
06/06/13	7:56	5.77	27.01		
09/24/13	12:01	6.53	26.25		
03/25/14	11:54	4.72	28.06		
09/22/14	16:35	6.96	25.82		
03/16/15	9:56	4.91	27.87		
09/13/15	8:45	7.26	25.52		
MW-26	32.65	03/25/10	8:56	5.52	27.13
		04/05/10	11:05	5.91	26.74
		05/06/10	8:06	6.00	26.65
		06/09/10	8:57	5.10	27.55
Well Abandoned July 6, 2010					
Shallow On-Site Injection Wells					
INJ-1	32.77	11/19/01	14:27	6.50	26.27
		03/27/02	10:38	5.23	27.54

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
INJ-1 (continued)	32.77	06/11/02	10:11	5.94	26.83
		09/17/02	12:16	7.14	25.63
		12/16/02	11:24	6.48	26.29
		03/17/03	10:32	5.47	27.30
		06/10/03	NR	6.09	26.68
		09/11/03	10:00	7.56	25.21
		01/12/04	10:27	5.44	27.33
		03/15/04	10:50	5.55	27.22
		04/04/05	13:00	5.49	27.28
		09/12/06	11:55	7.41	25.36
		04/03/07	10:03	5.06	27.71
		04/25/11	8:52	4.75	28.02
		05/04/11	8:54	4.83	27.94
		09/20/11	13:43	7.15	25.62
12/06/11	11:35	6.09	26.68		
INJ-2	32.81	10/15/01	11:35	8.22	24.59
		10/22/01	15:43	7.12	25.69
		10/29/01	13:10	7.02	25.79
		11/19/01	11:05	6.30	26.51
		03/27/02	10:28	5.29	27.52
		06/11/02	10:20	5.99	26.82
		09/17/02	12:10	7.18	25.63
		12/16/02	11:17	6.52	26.29
		03/17/03	10:20	5.51	27.30
		06/10/03	NR	6.31	26.50
		09/10/03	8:30	7.65	25.16
		12/03/03	10:40	6.00	26.81
		01/12/04	10:14	5.46	27.35
		03/15/04	10:30	5.62	27.19
		06/10/04	7:35	6.05	26.76
		09/22/04	10:45	6.65	26.16
		04/04/05	12:40	5.58	27.23
		09/20/05	NR	7.20	25.61
		03/14/06	9:10	5.25	27.56
		09/12/06	11:44	7.47	25.34
		04/03/07	9:55	5.12	27.69
		09/24/07	10:20	7.19	25.62
		05/01/08	9:53	5.70	27.11
		03/25/10	10:05	5.69	27.12
		05/06/10	8:05	6.20	26.61
		09/27/10	10:21	6.15	26.66
		02/28/11	13:16	4.87	27.94
03/17/11	13:06	4.83	27.98		
04/25/11	8:58	4.86	27.95		
05/04/11	8:59	5.05	27.76		
09/20/11	13:50	6.89	25.92		
12/06/11	11:39	6.10	26.71		
10/03/12	15:17	7.20	25.61		
INJ-3	33.01	11/19/01	14:40	6.45	26.56
		06/11/02	10:21	6.19	26.82
		09/17/02	12:43	7.38	25.63
		12/16/02	11:15	7.00	26.01
		03/17/03	10:17	5.74	27.27
		06/10/03	NR	6.50	26.51
		09/10/03	8:27	7.73	25.28
		12/03/03	10:50	6.32	26.69
		01/12/03	10:11	5.70	27.31
		03/15/04	10:27	5.81	27.20
		06/10/04	7:30	6.18	26.83
		09/22/04	10:40	6.90	26.11
		04/04/05	12:35	5.58	27.43

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
INJ-3 (continued)	33.01	09/20/05	NR	7.32	25.69
		03/14/06	9:05	5.37	27.64
		06/09/06	13:39	5.72	27.29
		09/12/06	11:40	7.65	25.36
		04/03/07	9:50	5.30	27.71
		09/24/07	10:16	7.25	25.76
		05/01/08	9:51	5.78	27.23
		09/29/08	NR	7.02	25.99
		03/25/10	10:00	5.84	27.17
		05/06/10	8:04	6.28	26.73
		02/28/11	13:55	5.09	27.92
		03/17/11	13:05	5.01	28.00
		04/25/11	8:59	5.15	27.86
		05/04/11	9:01	5.11	27.90
		09/20/11	13:55	6.83	26.18
		12/06/11	11:44	6.40	26.61
10/03/12	15:25	7.42	25.59		
IW-201	32.71	03/25/10	8:58	5.59	27.12
		04/05/10	11:03	5.99	26.72
		05/06/10	8:07	6.08	26.63
		09/27/10	10:22	5.96	26.75
		02/28/11	13:29	4.82	27.89
		10/03/12	15:00	7.08	25.63
IW-202	32.61	10/03/12	15:24	7.10	25.51
IW-202	32.61	12/18/12	14:25	5.00	27.61
IW-202	32.61	12/18/12	16:00	5.00	27.61
IW-203	32.45	10/03/12	15:17	6.94	25.51
IW-204	32.73	10/03/12	15:35	7.20	25.53
IW-205	32.92	10/03/12	15:35	7.39	25.53
		12/18/12	14:27	5.30	27.62
		12/18/12	16:05	5.30	27.62
IW-206	32.68	10/03/12	15:17	7.15	25.53
IW-207	32.53	10/03/12	NR	NM	NM
IW-208	32.73	10/03/12	15:40	7.21	25.52
IW-209	32.95	10/03/12	15:35	7.42	25.53
IW-210	32.87	10/03/12	15:24	7.37	25.50
		12/18/12	14:26	5.28	27.59
		12/18/12	16:02	5.28	27.59
IW-211	32.81	10/03/12	15:24	7.28	25.53
IW-212	32.81	10/03/12	16:50	7.35	25.46
IW-213	33.02	10/03/12	15:40	7.50	25.52
IW-214	33.08	10/03/12	15:40	7.58	25.50
		12/18/12	14:26	5.49	27.59
		12/18/12	16:04	5.49	27.59
IW-215	32.72	10/03/12	NR	NM	NM
IW-216	32.9	10/03/12	NR	NM	NM
IW-217	32.82	10/03/12	16:30	7.37	25.45
IW-218	33.19	10/03/12	NR	NM	NM
Deep On-Site Monitoring Wells and Piezometer					
MW-13	32.81	03/31/03	13:05	5.43	27.38
		06/10/03	NR	6.09	26.72
		09/10/03	9:26	7.65	25.16

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-13 (continued)	32.81	12/03/03	11:20	5.91	26.90
		01/12/04	11:23	5.37	27.44
		03/15/04	11:20	5.55	27.26
		06/10/04	8:30	6.44	26.37
		09/22/04	11:25	6.60	26.21
		04/04/05	13:45	5.50	27.31
		07/28/05	10:35	6.27	26.54
		09/20/05	9:45	7.10	25.71
		03/14/06	10:40	6.20	26.61
		03/15/06	8:55	6.14	26.67
		06/09/06	14:15	5.54	27.27
		09/12/06	12:40	7.44	25.37
		04/03/07	10:43	6.04	26.77
		04/03/07	12:10	4.40	28.41
		09/24/07	11:02	10.60	22.21
		09/24/07	12:42	7.11	25.70
		05/01/08	11:00	5.61	27.20
		09/29/08	NR	7.70	25.11
		09/29/08	NR	6.78	26.03
		03/23/09	10:30	5.43	27.38
		03/23/09	12:30	5.34	27.47
		09/28/09	13:50	6.87	25.94
		09/28/09	14:40	6.87	25.94
		03/25/10	8:20	5.82	26.99
		03/25/10	10:40	5.73	27.08
		03/25/10	16:00	5.74	27.07
		03/29/10	8:05	5.73	27.08
		03/29/10	9:02	5.62	27.19
		04/05/10	1116	6.21	26.60
		05/06/10	8:27	6.37	26.44
		05/06/10	9:00	6.17	26.64
		06/18/10	11:30	5.48	27.33
		06/18/10	12:33	5.45	27.36
		07/06/10	11:15	5.60	27.21
		07/06/10	13:23	5.76	27.05
		07/13/10	14:21	5.90	26.91
		09/27/10	10:40	6.40	26.41
		09/27/10	12:05	6.07	26.74
		02/28/11	14:12	5.31	27.50
		02/28/11	16:29	4.81	28.00
		03/17/11	14:00	4.74	28.07
		04/25/11	8:14	4.78	28.03
		04/25/11	10:06	4.73	28.08
		05/04/11	8:29	4.98	27.83
		05/04/11	9:44	4.96	27.85
		06/22/11	8:14	5.24	27.57
		06/22/11	9:36	5.35	27.46
		09/20/11	13:16	6.71	26.10
		09/20/11	14:20	6.76	26.05
		12/06/11	11:03	7.71	25.10
		12/06/11	12:05	6.01	26.80
		03/05/12	12:30	6.01	26.80
		03/05/12	14:10	4.99	27.82
		03/05/12	14:50	5.00	27.81
		06/25/12	13:05	5.42	27.39
		06/25/12	14:10	5.38	27.43
		10/03/12	13:12	7.10	25.71
		12/18/12	13:43	7.20	25.61
		12/18/12	13:45	5.60	27.21
		12/18/12	15:20	5.05	27.76
		12/18/12	15:45	5.05	27.76

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-13 (continued)	32.81	03/04/13	14:25	5.20	27.61
		03/04/13	16:09	5.30	27.51
		03/08/13	12:31	5.30	27.51
		06/06/13	7:37	5.66	27.15
		06/06/13	8:40	5.75	27.06
		09/24/13	12:48	6.42	26.39
		03/25/14	13:55	4.62	28.19
		09/22/14	15:03	6.88	25.93
		03/16/15	12:17	4.86	27.95
		09/13/15	11:18	7.16	25.65
MW-14	32.60	12/03/03	10:03	5.65	26.95
		01/12/04	11:30	5.07	27.53
		03/16/04	13:00	5.21	27.39
		06/10/04	8:20	5.68	26.92
		09/23/04	8:20	6.30	26.30
		04/04/05	13:25	5.25	27.35
		07/28/05	10:20	6.01	26.59
		09/20/05	9:25	6.86	25.74
		03/14/06	10:05	4.90	27.70
		03/14/06	15:30	4.85	27.75
		06/09/06	14:05	5.27	27.33
		09/12/06	12:16	7.13	25.47
		04/03/07	10:17	4.39	28.21
		04/03/07	11:52	4.75	27.85
		09/24/07	10:51	6.85	25.75
		09/24/07	12:51	6.86	25.74
		05/01/08	10:55	5.34	27.26
		09/29/08	NR	6.56	26.04
		09/29/08	NR	6.57	26.03
		03/23/09	13:15	5.08	27.52
		03/23/09	14:25	5.08	27.52
		09/28/09	13:35	6.62	25.98
		09/28/09	14:47	6.61	25.99
		03/25/10	10:30	5.57	27.03
		03/25/10	11:30	5.57	27.03
		03/25/10	16:02	5.59	27.01
		03/29/10	8:15	5.42	27.18
		03/29/10	9:20	5.41	27.19
		04/05/10	11:20	6.15	26.45
		05/06/10	8:17	5.93	26.67
		05/06/10	9:07	5.92	26.68
		06/18/10	11:25	5.25	27.35
		06/18/10	12:30	5.25	27.35
		07/06/10	10:50	5.53	27.07
		07/06/10	12:22	5.53	27.07
		07/13/10	14:41	5.67	26.93
		09/27/10	9:59	5.85	26.75
		09/27/10	12:00	5.84	26.76
		02/28/11	15:00	4.55	28.05
		02/28/11	16:15	NM	NM
03/17/11	13:52	4.48	28.12		
04/25/11	8:29	NM	NM		
05/04/11	8:42	4.69	27.91		
05/04/11	9:51	4.71	27.89		
06/22/11	8:39	5.15	27.45		
06/22/11	9:50	5.15	27.45		
09/20/11	13:30	6.55	26.05		
09/20/11	14:36	6.56	26.04		
12/06/11	11:23	5.81	26.79		
12/06/11	12:23	5.78	26.82		
03/05/12	12:56	4.72	27.88		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-14 (continued)	32.60	03/05/12	14:20	4.74	27.86
		06/25/12	12:20	5.14	27.46
		06/25/12	14:00	5.14	27.46
		10/03/12	15:30	6.88	25.72
		12/18/12	13:37	4.79	27.81
		12/18/12	15:11	4.80	27.80
		03/04/13	14:48	5.08	27.52
		03/04/13	16:05	5.06	27.54
		03/08/13	12:28	5.05	27.55
		06/06/13	7:33	5.42	27.18
		06/06/13	8:47	5.43	27.17
		09/24/13	12:24	6.24	26.36
		03/25/14	13:59	4.33	28.27
		09/22/14	15:10	6.67	25.93
		03/16/15	12:26	4.62	27.98
		09/13/15	11:28	6.94	25.66
MW-15	32.57	12/03/03	10:00	5.46	27.11
		01/12/04	11:09	4.86	27.71
		03/16/04	13:35	4.98	27.59
		06/10/04	8:15	5.50	27.07
		09/23/04	8:15	6.23	26.34
		04/04/05	13:30	5.07	27.50
		07/28/05	10:25	5.84	26.73
		09/20/05	9:30	6.69	25.88
		03/14/06	10:10	4.96	27.61
		03/14/06	15:55	4.65	27.92
		06/09/06	14:09	5.07	27.50
		09/12/06	12:20	6.97	25.60
		04/03/07	10:22	4.82	27.75
		04/03/07	11:55	4.55	28.02
		09/24/07	10:48	6.87	25.70
		09/24/07	12:55	6.70	25.87
		05/01/08	11:20	5.20	27.37
		09/29/08	NR	6.51	26.06
		09/29/08	NR	6.38	26.19
		03/23/09	13:20	4.95	27.62
		03/23/09	14:40	4.90	27.67
		09/28/09	13:25	6.50	26.07
		09/28/09	14:50	6.45	26.12
		03/25/10	10:33	5.57	27.00
		03/25/10	11:32	5.58	26.99
		03/25/10	16:05	5.62	26.95
		03/29/10	8:17	5.40	27.17
		03/29/10	9:23	5.39	27.18
		04/05/10	11:22	6.35	26.22
		05/06/10	8:16	5.85	26.72
		05/06/10	9:07	5.82	26.75
		06/18/10	11:22	5.18	27.39
		06/18/10	12:32	5.18	27.39
07/06/10	11:00	5.42	27.15		
07/06/10	12:20	5.42	27.15		
07/13/10	14:40	5.51	27.06		
09/27/10	10:02	5.71	26.86		
09/27/10	12:25	5.70	26.87		
02/28/11	15:07	4.41	28.16		
02/28/11	16:37	4.41	28.16		
03/17/11	13:50	4.30	28.27		
04/25/11	8:25	4.31	28.26		
04/25/11	10:10	4.32	28.25		
05/04/11	8:37	4.54	28.03		
05/04/11	9:50	4.55	28.02		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-15 (continued)	32.57	06/22/11	8:35	4.96	27.61
		06/22/11	9:42	4.99	27.58
		09/20/11	13:29	6.56	26.01
		09/20/11	14:32	6.51	26.06
		12/06/11	11:18	5.73	26.84
		12/06/11	12:20	5.61	26.96
		03/05/12	12:43	4.55	28.02
		03/05/12	14:22	4.56	28.01
		06/25/12	12:18	4.96	27.61
		06/25/12	13:58	4.99	27.58
		10/03/12	NR	NM	NM
		12/18/12	13:38	4.64	27.93
		12/18/12	15:13	4.65	27.92
		03/04/13	14:50	4.91	27.66
		03/04/13	16:06	4.90	27.67
		03/08/13	12:28	4.90	27.67
		06/06/13	7:32	5.27	27.30
		06/06/13	8:50	5.27	27.30
		09/24/13	12:29	6.11	26.46
		03/25/14	14:03	4.15	28.42
09/22/14	15:42	6.51	26.06		
03/16/15	12:28	4.52	28.05		
09/13/15	11:29	6.82	25.75		
MW-16	36.92	12/03/03	10:10	10.11	26.81
		01/12/04	11:40	9.56	27.36
		03/15/04	11:30	9.68	27.24
		06/10/04	8:40	10.12	26.80
		09/22/04	11:35	10.72	26.20
		04/04/05	13:55	9.70	27.22
		07/28/05	10:30	10.48	26.44
		09/20/05	9:50	11.31	25.61
		03/14/06	11:00	9.30	27.62
		03/15/06	12:45	9.30	27.62
		06/09/06	14:30	9.70	27.22
		09/12/06	12:50	11.56	25.36
		04/03/07	10:55	9.25	27.67
		04/03/07	12:25	9.28	27.64
		09/24/07	11:17	11.29	25.63
		05/01/08	11:40	9.80	27.12
		09/29/08	NR	10.95	25.97
		09/29/08	NR	10.90	26.02
		03/23/09	11:05	9.54	27.38
		03/23/09	12:50	9.51	27.41
		09/28/09	13:15	11.03	25.89
		09/28/09	14:35	11.03	25.89
		03/25/10	8:17	9.77	27.15
		03/25/10	10:45	9.74	27.18
		03/25/10	16:09	9.74	27.18
		03/29/10	8:22	9.63	27.29
		03/29/10	9:30	9.59	27.33
		04/05/10	11:40	10.21	26.71
		05/06/10	8:25	10.26	26.66
		05/06/10	9:12	10.27	26.65
		06/18/10	11:45	9.54	27.38
		06/18/10	12:50	9.52	27.40
		07/06/10	11:10	9.91	27.01
		07/06/10	13:20	9.92	27.00
07/13/10	14:20	10.04	26.88		
09/27/10	10:52	10.25	26.67		
09/27/10	12:15	10.25	26.67		
02/28/11	15:14	8.97	27.95		
02/28/11	16:40	8.99	27.93		
03/17/11	14:30	8.92	28.00		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-16 (continued)	36.92	04/25/11	8:40	8.88	28.04
		04/25/11	10:15	8.90	28.02
		05/04/11	9:04	9.12	27.80
		05/04/11	10:06	9.12	27.80
		06/22/11	8:12	9.51	27.41
		06/22/11	9:33	9.54	27.38
		09/20/11	13:14	10.98	25.94
		09/20/11	14:16	10.99	25.93
		12/06/11	11:01	10.17	26.75
		12/06/11	12:04	10.16	26.76
		03/05/12	13:15	9.11	27.81
		03/05/12	14:50	9.12	27.80
		06/25/12	13:12	9.53	27.39
		06/25/12	14:15	9.53	27.39
		10/03/12	16:50	11.33	25.59
		12/18/12	13:46	9.22	27.70
		12/18/12	15:18	9.22	27.70
		03/04/13	14:23	9.58	27.34
		03/04/13	16:09	9.45	27.47
		03/08/13	11:30	9.45	27.47
06/06/13	7:45	9.77	27.15		
06/06/13	8:43	9.81	27.11		
09/24/13	12:53	10.63	26.29		
03/25/14	14:07	8.69	28.23		
09/22/14	15:40	11.05	25.87		
03/16/15	12:32	9.02	27.90		
09/13/15	11:20	11.32	25.60		
MW-17	32.60	12/03/03	10:20	5.91	26.69
		01/12/04	12:05	5.43	27.17
		03/15/04	10:05	5.59	27.01
		06/10/04	7:05	5.95	26.65
		09/22/04	10:15	6.50	26.10
		04/04/05	12:15	5.50	27.10
		07/28/05	10:10	6.28	26.32
		09/20/05	8:15	7.18	25.42
		03/14/06	11:30	5.17	27.43
		03/15/06	9:25	5.24	27.36
		06/09/06	14:45	5.53	27.07
		09/12/06	11:15	7.31	25.29
		04/03/07	9:25	5.15	27.45
		04/03/07	11:05	5.13	27.47
		09/24/07	10:03	7.03	25.57
		09/24/07	12:35	7.03	25.57
		05/01/08	9:30	5.57	27.03
		09/29/08	NR	6.72	25.88
		09/29/08	NR	6.71	25.89
		03/23/09	8:38	5.35	27.25
		03/23/09	12:17	5.33	27.27
		09/28/09	12:58	6.86	25.74
		09/28/09	14:21	6.85	25.75
		03/25/10	9:35	5.37	27.23
		03/25/10	10:55	5.38	27.22
		03/25/10	16:25	5.38	27.22
		03/29/10	8:00	5.30	27.30
		03/29/10	8:45	5.30	27.30
		04/05/10	11:27	5.65	26.95
		05/06/10	8:55	5.98	26.62
05/06/10	9:12	5.98	26.62		
06/18/10	11:15	5.22	27.38		
06/18/10	12:10	5.22	27.38		
07/06/10	10:38	5.66	26.94		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-17 (continued)	32.60	07/06/10	13:55	5.67	26.93
		07/13/10	14:05	5.80	26.80
		09/27/10	11:15	5.99	26.61
		09/27/10	12:25	6.00	26.60
		02/28/11	15:37	4.76	27.84
		02/28/11	16:47	4.78	27.82
		03/17/11	13:42	4.75	27.85
		04/25/11	9:31	4.73	27.87
		04/25/11	11:12	4.75	27.85
		05/04/11	9:21	4.99	27.61
		05/04/11	10:22	5.00	27.60
		06/22/11	7:50	5.34	27.26
		06/22/11	9:27	5.35	27.25
		09/20/11	13:01	6.72	25.88
		09/20/11	14:06	6.70	25.90
		12/06/11	10:58	5.70	26.90
		12/06/11	12:01	5.99	26.61
		03/05/12	13:47	4.96	27.64
		03/05/12	15:10	4.98	27.62
		06/25/12	12:00	5.32	27.28
		06/25/12	13:45	5.34	27.26
		10/03/12	16:30	7.10	25.50
		12/18/12	11:55	4.90	27.70
		12/18/12	12:01	5.02	27.58
		12/18/12	12:06	5.02	27.58
		03/04/13	14:09	5.30	27.30
		03/04/13	16:20	5.30	27.30
		03/08/13	12:24	5.27	27.33
		06/06/13	8:00	5.43	27.17
		06/06/13	9:03	5.66	26.94
		09/24/13	11:54	6.30	26.30
03/25/14	14:11	4.60	28.00		
09/22/14	13:43	6.82	25.78		
03/16/15	12:37	4.89	27.71		
09/13/15	11:05	7.08	25.52		
MW-18	32.73	12/03/03	11:50	5.94	26.79
		01/12/04	10:00	5.43	27.30
		03/15/04	10:15	5.60	27.13
		06/10/04	7:10	6.00	26.73
		09/22/04	10:20	6.57	26.16
		04/04/05	12:20	5.53	27.20
		07/28/05	10:05	6.31	26.42
		09/20/05	8:25	7.13	25.60
		03/14/06	11:10	5.23	27.50
		03/15/06	10:25	5.29	27.44
		06/09/06	13:32	5.60	27.13
		09/12/06	11:25	7.40	25.33
		04/03/07	11:03	5.15	27.58
		09/24/07	10:06	7.11	25.62
		09/24/07	12:37	7.11	25.62
		05/01/08	9:07	5.61	27.12
		09/29/08	NR	6.80	25.93
		09/29/08	NR	6.79	25.94
		03/23/09	8:27	5.38	27.35
		03/23/09	12:15	5.37	27.36
		09/28/09	12:56	6.91	25.82
		09/28/09	14:25	6.90	25.83
		03/25/10	8:00	5.53	27.20
03/25/10	11:00	5.47	27.26		
03/25/10	16:13	5.47	27.26		
03/29/10	7:56	5.40	27.33		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-18 (continued)	32.73	03/29/10	8:50	5.37	27.36
		04/05/10	11:25	5.84	26.89
		05/06/10	8:45	6.02	26.71
		05/06/10	9:25	6.01	26.72
		06/18/10	11:10	5.32	27.41
		06/18/10	12:05	5.34	27.39
		07/06/10	10:43	5.72	27.01
		07/06/10	14:00	5.73	27.00
		07/13/10	14:07	5.88	26.85
		09/27/10	11:35	6.06	26.67
		09/27/10	12:30	6.06	26.67
		02/28/11	15:29	4.82	27.91
		02/28/11	16:45	4.82	27.91
		03/17/11	14:40	4.78	27.95
		04/25/11	9:23	4.85	27.88
		04/25/11	11:07	4.80	27.93
		05/04/11	9:10	5.00	27.73
		05/04/11	10:10	5.00	27.73
		06/22/11	7:59	5.42	27.31
		06/22/11	9:28	5.41	27.32
		09/20/11	13:05	6.81	25.92
		09/20/11	14:09	6.78	25.95
		12/06/11	11:52	6.03	26.70
		12/06/11	12:53	6.05	26.68
		03/05/12	13:30	5.01	27.72
		03/05/12	15:06	5.01	27.72
		06/25/12	NR	NM	NM
		10/03/12	16:30	7.16	25.57
		12/18/12	12:08	5.05	27.68
		12/18/12	12:52	5.05	27.68
		03/04/13	14:15	5.37	27.36
		03/04/13	15:16	5.35	27.38
		03/08/13	12:26	5.30	27.43
06/06/13	7:59	5.70	27.03		
06/06/13	9:02	5.70	27.03		
09/24/13	11:58	6.44	26.29		
03/25/14	14:16	4.68	28.05		
09/22/14	13:48	6.91	25.82		
03/16/15	12:34	4.89	27.84		
09/13/15	11:02	7.19	25.54		
MW-19	33.52	03/16/04	10:10	6.54	26.98
		06/10/04	7:20	6.87	26.65
		09/22/04	10:30	7.44	26.08
		04/04/05	12:05	6.37	27.15
		07/28/05	10:15	7.20	26.32
		09/20/05	8:20	7.98	25.54
		03/14/06	11:20	6.15	27.37
		03/15/06	9:55	6.21	27.31
		06/09/06	14:36	6.49	27.03
		09/12/06	11:20	8.25	25.27
		04/03/07	9:30	6.10	27.42
		04/03/07	11:07	6.07	27.45
		09/24/07	10:00	7.94	25.58
		09/24/07	12:30	7.95	25.57
		05/01/08	9:20	6.50	27.02
		09/29/08	NR	7.66	25.86
		09/29/08	NR	7.64	25.88
		03/23/09	9:15	6.29	27.23
		03/23/09	12:20	6.27	27.25
		09/28/09	12:35	7.79	25.73
09/28/09	14:20	7.79	25.73		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-19 (continued)	33.52	03/25/10	9:25	6.25	27.27
		03/25/10	10:50	6.27	27.25
		03/25/10	16:28	6.29	27.23
		03/29/10	7:40	6.15	27.37
		03/29/10	8:40	6.18	27.34
		04/05/10	11:28	6.46	27.06
		05/06/10	7:30	6.60	26.92
		05/06/10	9:40	6.61	26.91
		06/18/10	11:05	6.11	27.41
		06/18/10	12:00	6.11	27.41
		07/06/10	10:34	6.58	26.94
		07/06/10	13:53	6.59	26.93
		07/13/10	14:00	6.71	26.81
		09/27/10	11:10	6.92	26.60
		09/27/10	12:34	6.90	26.62
		02/28/11	15:45	5.68	27.84
		02/28/11	16:50	5.69	27.83
		03/17/11	14:50	5.70	27.82
		04/25/11	9:28	5.65	27.87
		04/25/11	11:10	5.64	27.88
		05/04/11	9:12	5.89	27.63
		05/04/11	10:13	5.88	27.64
		06/22/11	7:47	6.28	27.24
		06/22/11	9:19	6.28	27.24
		09/20/11	12:55	7.63	25.89
		09/20/11	14:03	7.61	25.91
		12/06/11	10:50	6.89	26.63
		12/06/11	11:59	6.89	26.63
		03/05/12	13:45	5.88	27.64
		03/05/12	15:12	5.90	27.62
		06/25/12	11:50	6.27	27.25
		06/25/12	13:48	6.25	27.27
		10/03/12	16:30	8.02	25.50
		12/18/12	11:50	5.94	27.58
		12/18/12	12:36	5.93	27.59
		12/18/12	13:00	5.93	27.59
		03/04/13	14:00	6.23	27.29
		03/04/13	15:20	6.21	27.31
		03/08/13	12:22	6.16	27.36
		06/06/13	8:05	6.55	26.97
		06/06/13	9:00	6.57	26.95
09/24/13	11:40	7.26	26.26		
03/25/14	14:24	5.55	27.97		
09/22/14	13:40	7.74	25.78		
03/16/15	12:31	5.68	27.84		
09/13/15	11:04	7.97	25.55		
MW-21	32.86	09/12/06	12:35	7.45	25.41
		04/03/07	10:40	5.23	27.63
		04/03/07	12:06	5.06	27.80
		09/24/07	10:58	7.11	25.75
		09/24/07	12:44	7.15	25.71
		05/01/08	11:05	5.62	27.24
		09/29/08	NR	6.84	26.02
		09/29/08	NR	6.82	26.04
		03/23/09	10:15	5.40	27.46
		03/23/09	12:35	5.39	27.47
		09/28/09	13:40	6.98*	25.88*
		09/28/09	14:45	6.22*	26.64*
		09/30/09	14:40	7.07*	25.79*
		03/25/10	8:36	5.82	27.04
		03/25/10	10:38	5.82	27.04

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-21 (continued)	32.86	03/25/10	16:20	5.82	27.04
		03/29/10	8:15	5.68	27.18
		03/29/10	9:15	5.67	27.19
		04/05/10	11:10	6.38	26.48
		05/06/10	8:33	6.28	26.58
		05/06/10	9:06	6.28	26.58
		06/18/10	11:20	5.50	27.36
		06/18/10	12:35	5.50	27.36
		07/06/10	11:30	5.70	27.16
		07/06/10	12:00	5.85	27.01
		07/13/10	14:31	5.98	26.88
		09/27/10	10:12	6.05	26.81
		09/27/10	12:10	6.15	26.71
		02/28/11	14:40	4.93	27.93
		02/28/11	16:33	4.85	28.01
		03/17/11	14:50	4.78	28.08
		04/25/11	8:21	4.84	28.02
		04/25/11	10:08	4.77	28.09
		05/04/11	8:35	5.00	27.86
		05/04/11	9:48	4.99	27.87
		06/22/11	8:27	5.48	27.38
		06/22/11	9:38	5.42	27.44
		09/20/11	13:25	6.89	25.97
		09/20/11	13:28	6.85	26.01
		12/06/11	11:12	8.00	24.86
		12/06/11	12:14	6.06	26.80
		03/05/12	12:35	5.39	27.47
		03/05/12	14:18	5.03	27.83
		03/05/12	14:50	5.05	27.81
		06/25/12	12:57	5.47	27.39
		06/25/12	14:07	5.45	27.41
		10/03/12	15:55	7.17	25.69
		12/18/12	13:42	5.22	27.64
		12/18/12	15:24	5.10	27.76
		12/18/12	15:43	5.10	27.76
		03/04/13	14:33	5.41	27.45
		03/04/13	14:52	5.37	27.49
		03/04/13	16:08	5.35	27.51
		03/08/13	12:30	5.35	27.51
		06/06/13	7:35	5.77	27.09
		06/06/13	8:40	5.74	27.12
09/24/13	12:40	6.53	26.33		
03/25/14	14:28	4.67	28.19		
09/22/14	15:07	6.96	25.90		
03/16/15	12:18	4.93	27.93		
09/14/15	14:22	7.22	25.64		
MW-22	33.18	09/12/06	12:47	7.85	25.33
		04/03/07	10:50	5.55	27.63
		04/03/07	12:20	5.55	27.63
		09/24/07	11:10	7.58	25.60
		05/01/08	10:24	6.07	27.11
		09/29/08	NR	7.26	25.92
		09/29/08	NR	7.24	25.94
		03/23/09	10:51	5.83	27.35
		03/23/09	12:40	5.81	27.37
		09/28/09	NR	NM	NM
		03/25/10	10:35	6.07	27.11
		03/25/10	11:55	6.08	27.10
		03/25/10	16:11	6.10	27.08
		03/29/10	8:10	5.96	27.22
		03/29/10	9:10	5.96	27.22

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-22 (continued)	33.18	04/05/10	11:35	6.52	26.66
		05/06/10	8:22	6.55	26.63
		05/06/10	9:00	6.55	26.63
		06/18/10	11:31	5.85	27.33
		06/18/10	12:37	5.75	27.43
		07/06/10	12:00	6.24	26.94
		07/06/10	13:35	6.22	26.96
		07/13/10	14:45	6.35	26.83
		09/27/10	10:25	6.54	26.64
		09/27/10	12:07	6.54	26.64
		02/28/11	14:03	5.26	27.92
		02/28/11	16:23	5.28	27.90
		03/17/11	14:10	5.21	27.97
		04/25/11	8:15	NM	NM
		05/04/11	8:32	5.42	27.76
		05/04/11	9:46	5.42	27.76
		06/22/11	NR	NM	NM
		09/20/11	NR	NM	NM
		12/06/11	11:42	6.46	26.72
		12/06/11	12:43	6.49	26.69
		03/05/12	13:00	5.44	27.74
		03/05/12	14:26	5.47	27.71
		03/05/12	14:50	5.48	27.70
		06/25/12	13:15	5.83	27.35
		06/25/12	14:12	5.85	27.33
		10/03/12	13:10	7.59	25.59
		12/18/12	13:48	5.50	27.68
		12/18/12	15:22	5.50	27.68
		03/04/13	NR	NM	NM
		03/08/13	12:32	5.76	27.42
		06/06/13	7:41	6.14	27.04
		06/06/13	8:41	6.17	27.01
		09/24/13	13:06	6.64	26.54
03/26/14	11:05	5.12	28.06		
09/22/14	14:53	7.35	25.83		
03/17/15	8:20	5.32	27.86		
09/13/15	11:14	7.61	25.57		
MW-24	32.74	03/25/10	8:39	5.69	27.05
		03/25/10	10:50	5.64	27.10
		03/25/10	16:41	5.68	27.06
		03/29/10	8:17	5.53	27.21
		03/29/10	9:17	5.50	27.24
		04/05/10	11:13	6.26	26.48
		05/06/10	8:31	6.01	26.73
		05/06/10	9:05	6.01	26.73
		06/09/10	10:15	5.21	27.53
		06/18/10	11:36	5.39	27.35
		06/18/10	12:38	5.38	27.36
		07/06/10	11:35	5.70	27.04
		07/06/10	12:02	5.70	27.04
		07/13/10	14:32	5.80	26.94
		09/27/10	10:12	5.99	26.75
		09/27/10	12:10	5.99	26.75
		02/28/11	14:50	4.70	28.04
		02/28/11	16:32	4.70	28.04
		03/17/11	NR	NM	NM
		04/25/11	8:20	4.75	27.99
		04/25/11	10:07	4.61	28.13
		05/04/11	8:34	4.85	27.89
		05/04/11	9:49	4.85	27.89
06/22/11	6:29	5.28	27.46		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation		
MW-24 (continued)	32.74	06/22/11	9:40	5.26	27.48		
		09/20/11	13:22	6.71	26.03		
		09/20/11	14:29	6.70	26.04		
		12/06/11	11:15	5.90	26.84		
		12/06/11	12:16	5.89	26.85		
		06/25/12	13:00	5.27	27.47		
		06/25/12	14:06	5.27	27.47		
		10/03/12	15:55	7.01	25.73		
		03/25/14	12:42	4.42	28.32		
		09/22/14	15:06	6.81	25.93		
		03/16/15	12:23	4.78	27.96		
09/13/15	14:23	7.05	25.69				
MW-25	32.80	03/25/10	8:30	5.69	27.11		
		03/25/10	10:55	5.71	27.09		
		03/25/10	16:41	5.72	27.08		
		03/29/10	8:06	5.56	27.24		
		03/29/10	9:05	5.57	27.23		
		04/05/10	11:18	6.21	26.59		
		05/06/10	8:28	6.12	26.68		
		05/06/10	9:01	6.12	26.68		
		06/09/10	11:15	5.28	27.52		
		06/18/10	11:35	5.45	27.35		
		06/18/10	12:40	5.45	27.35		
		07/06/10	11:17	5.76	27.04		
		07/06/10	13:25	5.78	27.02		
		07/13/10	14:22	5.90	26.90		
		09/27/10	10:41	6.08	26.72		
		09/27/10	12:05	6.08	26.72		
		02/28/11	14:25	4.80	28.00		
		02/28/11	16:25	4.82	27.98		
		03/17/11	14:06	4.75	28.05		
		04/25/11	8:11	4.75	28.05		
		04/25/11	10:05	4.75	28.05		
		05/04/11	8:30	4.97	27.83		
		05/04/11	9:45	4.95	27.85		
		06/22/11	8:16	5.43	27.37		
		06/22/11	9:37	5.40	27.40		
		09/20/11	13:18	6.73	26.07		
		09/20/11	14:22	6.81	25.99		
		12/06/11	11:05	6.05	26.75		
		12/06/11	12:07	6.02	26.78		
		06/25/12	13:03	5.60	27.20		
06/25/12	14:09	5.39	27.41				
10/03/12	13:20	7.11	25.69				
03/25/14	12:54	4.57	28.23				
09/22/14	15:01	6.86	25.94				
03/16/15	12:19	4.84	27.96				
09/13/15	11:17	7.16	25.64				
P-1	33.85	01/13/99	8:55	6.25	27.60		
		03/02/99	9:19	5.42	28.43		
		06/16/99	10:15	6.82	27.03		
		09/16/99	10:34	7.57	26.28		
		12/08/99	8:32	6.49	27.36		
		03/07/00	8:41	6.15	27.70		
		06/21/00	9:33	6.96	26.89		
		09/12/00	10:15	7.91	25.94		
		12/07/00	9:15	7.50	26.35		
		03/15/01	9:52	6.10	27.75		
		01/02/02	10:55	6.12	27.50		
		09/17/02	12:18	7.94	25.68		
			33.62				

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
P-1 (continued)	33.62	12/16/02	11:26	7.28	26.34
		03/17/03	10:35	6.28	27.34
		09/10/03	8:42	8.40	25.22
		12/03/03	10:53	7.03	26.59
		01/12/04	10:35	6.20	27.42
		03/15/04	10:55	6.35	27.27
		06/10/04	7:50	6.81	26.81
		09/23/04	8:00	7.41	26.21
		04/04/05	13:05	6.30	27.32
		09/20/05	9:05	7.95	25.67
		03/14/06	9:40	5.99	27.63
		06/09/06	13:52	6.37	27.25
		09/12/06	12:00	8.21	25.41
		04/03/07	10:06	5.90	27.72
		04/03/07	11:42	5.90	27.72
		09/24/07	10:30	7.95	25.67
		05/01/08	10:10	6.44	27.18
		09/29/08	NR	7.64	25.98
		03/23/09	9:45	6.19	27.43
		09/28/09	14:12	7.75	25.87
		03/25/10	10:18	6.47	27.15
		03/25/10	11:20	6.47	27.15
		03/29/10	8:20	6.35	27.27
		03/29/10	9:28	6.35	27.27
		04/05/10	11:07	6.89	26.73
		05/06/10	8:10	6.97	26.65
		05/06/10	9:10	6.96	26.66
		07/06/10	12:05	6.60	27.02
		07/06/10	12:25	6.60	27.02
		07/13/10	14:42	6.73	26.89
		09/27/10	9:43	6.92	26.70
		09/27/10	12:20	6.93	26.69
		02/28/11	13:09	5.63	27.99
		02/28/11	16:20	5.64	27.98
		03/17/11	14:18	5.57	28.05
		04/25/11	8:36	5.62	28.00
		04/25/11	10:12	5.65	27.97
		05/04/11	8:51	5.81	27.81
		05/04/11	9:54	5.80	27.82
		06/22/11	8:50	6.24	27.38
		09/20/11	13:40	7.65	25.97
09/20/11	14:45	7.66	25.96		
12/06/11	11:32	6.92	26.70		
12/06/11	12:33	6.87	26.75		
03/05/12	13:18	5.84	27.78		
03/05/12	14:31	5.85	27.77		
06/25/12	12:30	6.23	27.39		
06/25/12	14:03	6.23	27.39		
10/03/12	15:35	7.97	25.65		
12/18/12	13:32	5.90	27.72		
12/18/12	15:05	5.88	27.74		
03/04/13	15:05	6.18	27.44		
03/04/13	16:13	6.18	27.44		
03/08/13	12:28	6.13	27.49		
06/06/13	7:52	6.53	27.09		
06/06/13	8:52	6.52	27.10		
09/25/13	7:13	7.32	26.30		
03/25/14	12:18	5.47	28.15		
09/22/14	16:25	7.75	25.87		
03/16/15	12:36	5.69	27.93		
09/13/15	11:31	8.04	25.58		
Deep Off-Site Monitoring Well					
MW-20	33.15	07/28/05	10:00	6.92	26.23

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-20 (continued)	33.15	09/20/05	NR	7.74	25.41
		03/14/06	12:00	5.97	27.18
		03/15/06	13:25	6.03	27.12
		06/09/06	15:00	6.28	26.87
		09/12/06	13:05	7.96	25.19
		04/03/07	9:00	5.98	27.17
		04/03/07	12:35	5.94	27.21
		09/24/07	11:30	7.71	25.44
		05/01/08	11:45	6.23	26.92
		09/29/08	NR	7.36	25.79
		09/29/08	NR	7.36	25.79
		03/23/09	9:10	6.07	27.08
		03/24/09	15:00	6.05	27.10
		09/28/09	13:05	7.52	25.63
		09/28/09	14:30	7.52	25.63
		03/25/10	9:20	5.90	27.25
		03/25/10	16:30	5.92	27.23
		03/29/10	7:12	5.75	27.40
		03/29/10	9:00	5.74	27.41
		04/05/10	12:34	6.05	27.10
		05/06/10	7:30	6.60	26.55
		05/06/10	9:40	6.61	26.54
		06/18/10	10:50	5.77	27.38
		06/18/10	13:00	5.77	27.38
		07/06/10	10:30	6.29	26.86
		07/06/10	13:50	6.30	26.85
		07/13/10	15:05	6.45	26.70
		09/27/10	11:40	6.60	26.55
		09/27/10	12:45	6.60	26.55
		02/28/11	15:50	5.44	27.71
		02/28/11	16:55	5.45	27.70
		03/17/11	14:50	5.48	27.67
		04/25/11	9:50	5.45	27.70
		04/25/11	11:20	5.37	27.78
		05/04/11	9:29	5.56	27.59
		05/04/11	10:30	5.56	27.59
		06/22/11	7:56	6.05	27.10
		06/22/11	9:23	6.03	27.12
		09/20/11	12:40	7.30	25.85
		09/20/11	14:42	7.32	25.83
		12/06/11	10:50	6.65	26.50
		12/06/11	12:45	6.61	26.54
03/05/12	13:26	5.62	27.53		
03/05/12	15:32	5.65	27.50		
06/25/12	13:20	6.06	27.09		
06/25/12	14:50	6.00	27.15		
09/27/12	7:57	7.62	25.53		
10/01/12	NR	7.67	25.48		
10/03/12	17:00	7.49	25.66		
12/18/12	11:00	5.70	27.45		
12/18/12	16:37	5.71	27.44		
03/04/13	13:45	5.99	27.16		
03/04/13	16:45	5.97	27.18		
03/08/13	9:15	5.92	27.23		
06/06/13	9:20	6.30	26.85		
06/06/13	17:00	6.31	26.84		
09/24/13	11:44	7.00	26.15		
03/25/14	14:24	5.37	27.78		
09/22/14	16:59	7.46	25.69		
03/16/15	12:19	5.50	27.65		
09/13/15	11:42	7.71	25.44		

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
MW-27	32.98	09/22/14	16:56	7.37	25.61
		03/16/15	12:22	5.29	27.69
		09/13/15	11:40	7.60	25.38
MW-28	34.63	09/22/14	13:29	9.02	25.61
		03/16/15	12:27	7.03	27.60
		09/13/15	11:07	9.25	25.38
Deep On-Site Injection Wells					
IW-101	32.77	03/25/10	8:38	5.73	27.04
		03/25/10	10:52	5.70	27.07
		03/25/10	16:40	5.70	27.07
		03/29/10	8:16	5.56	27.21
		03/29/10	9:18	5.55	27.22
		04/05/10	11:12	6.29	26.48
		05/06/10	8:30	6.12	26.65
		05/06/10	9:05	6.10	26.67
		06/18/10	11:37	5.55	27.22
		06/18/10	12:40	5.45	27.32
		07/06/10	11:35	5.62	27.15
		07/06/10	12:01	5.70	27.07
		07/13/10	14:30	5.84	26.93
IW-101 (continued)	32.77	09/27/10	10:11	6.01	26.76
		09/27/10	12:10	6.01	26.76
		02/28/11	14:43	4.81	27.96
		02/28/11	16:34	4.73	28.04
		10/03/12	15:55	7.05	25.72
IW-102	32.68	03/25/10	8:23	5.55	27.13
		03/25/10	10:57	5.59	27.09
		03/25/10	16:04	5.60	27.08
		03/29/10	8:08	5.45	27.23
		03/29/10	9:07	5.43	27.25
		04/05/10	11:15	6.10	26.58
		05/06/10	8:29	6.00	26.68
		05/06/10	9:02	6.02	26.66
		06/18/10	11:37	5.44	27.24
		06/18/10	12:40	5.33	27.35
		07/06/10	11:37	5.62	27.06
		07/06/10	13:27	5.62	27.06
		07/13/10	14:20	5.75	26.93
		09/27/10	10:39	5.90	26.78
		09/27/10	12:06	5.90	26.78
02/28/11	14:30	4.78	27.90		
02/28/11	16:28	4.68	28.00		
10/03/12	13:20	7.00	25.68		
IW-103	32.45	10/03/12	15:40	6.73	25.72
		12/18/12	14:30	4.70	27.75
		12/18/12	16:20	4.74	27.71
IW-104	36.32	10/03/12	13:32	10.69	25.63
IW-105	35.96	12/18/12	14:32	8.25	27.71
		12/18/12	16:20	8.27	27.69
IW-106	32.51	10/03/12	15:40	6.82	25.69
IW-107	32.36	10/03/12	NR	NM	NM
IW-108	32.34	10/03/12	16:10	6.60	25.74
IW-109	36.30	10/03/12	13:40	10.65	25.65
		12/18/12	14:34	8.59	27.71
		12/18/12	16:18	8.60	27.70
IW-110	35.98	10/03/12	13:32	10.42	25.56

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
IW-111	32.47	10/03/12	15:55	6.84	25.63
IW-112	32.64	10/03/12	15:40	7.04	25.60
		12/18/12	14:41	4.97	27.67
		12/18/12	16:27	4.98	27.66
IW-113	36.72	10/03/12	13:40	11.09	25.63
IW-114	32.83	10/03/12	16:10	7.22	25.61
IW-115	32.65	10/03/12	16:10	7.07	25.58
IW-116	36.93	10/03/12	13:50	11.32	25.61
IW-117	32.91	10/03/12	16:10	7.31	25.60
IW-118	33.03	10/03/12	16:10	7.40	25.63
IW-119	36.77	10/03/12	13:50	11.05	25.72
IW-120	36.69	10/03/12	14:05	11.16	25.53
		12/18/12	14:36	9.05	27.64
		12/18/12	16:16	9.07	27.62
IW-121	33.43	10/03/12	16:10	7.87	25.56
		12/18/12	14:40	5.80	27.63
		12/18/12	16:25	5.78	27.65
IW-122	33.03	10/03/12	16:10	7.42	25.61
IW-123	32.77	10/03/12	NR	NM	NM
IW-124	32.62	10/03/12	NR	NM	NM
IW-125	32.52	10/03/12	NR	NM	NM
IW-126	32.72	10/03/12	16:30	7.18	25.54
IW-127	35.46	10/03/12	15:55	9.95	25.51
IW-128	33.93	10/03/12	15:55	8.38	25.55
IW-129	32.69	10/03/12	16:30	7.07	25.62
		12/18/12	14:39	5.01	27.68
		12/18/12	16:11	5.01	27.68
IW-130	32.61	10/03/12	16:30	7.27	25.34
IW-131	32.49	10/03/12	16:30	6.94	25.55
IW-132	36.74	10/03/12	14:05	11.20	25.54
IW-133	36.89	10/03/12	14:05	11.35	25.54
IW-134	37.04	10/03/12	13:20	11.50	25.54
IW-135	33.02	10/03/12	15:55	7.46	25.56
		12/18/12	14:38	5.40	27.62
		12/18/12	16:12	5.38	27.64
IW-136	32.90	10/03/12	15:55	7.15	25.75
IW-137	32.79	10/03/12	NR	NM	NM
IW-138	32.58	10/03/12	16:30	7.09	25.49
		12/18/12	14:40	5.00	27.58
		12/18/12	16:10	5.00	27.58
IW-139	36.79	10/03/12	13:29	11.27	25.52
		12/18/12	14:38	9.21	27.58
		12/18/12	16:15	9.21	27.58
IW-140	33.00	10/03/12	13:12	7.44	25.56
IW-141	33.04	10/03/12	16:30	7.47	25.57
Barrel Wash Sump					
Sump Wash	34.17	09/04/96	NR	6.50	27.67
		10/11/96	10:55	6.11	28.06
		11/06/96	NR	6.57	27.60
		12/10/96	11:00	5.54	28.63

**Table A-1
Historical Groundwater Elevation Data
Univar USA Inc., Kent, Washington**

Location	Measuring Point Elevation	Date	Time	Depth to Water	Water Elevation
Sump Wash (continued)	34.17	01/10/97	NR	5.84	28.33
		02/21/97	12:50	4.48	29.69
		03/04/97	NR	6.36	27.81
		06/27/97	11:00	5.42	28.75
		09/04/97	11:07	4.46	29.71
		12/22/97	NR	4.00	30.17
		03/06/98	10:06	5.17	29.00
		06/16/99	10:35	4.98	29.19
		12/08/99	8:40	3.66	30.51
		03/07/00	8:55	5.17	29.00
		06/21/00	10:09	5.03	29.14
		09/12/00	10:00	5.60	28.57
		12/07/00	8:48	dry	dry
		03/15/01	9:20	5.20	28.97
		NOTE: Depth = depth to water relative to the top of PVC. Elev. = elevation relative to NAVD 88. NR = not recorded. NM = not measured.			

Appendix B
Historical Field Parameters and Groundwater Analytical Data
(Indicator Hazardous Substances, General Chemistry, Dissolved
Gases, and Fatty Acids)

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-1	04/17/95	6.37	2,310	11.0	NM	NM	NM
	09/04/96	6.49	1,620	18.5	227.0	1.20	NM
	12/10/96	6.37	1,653	9.8	427.0	1.18	NM
	03/04/97	6.65	1,359	11.0	37.1	1.70	NM
	06/27/97	6.62	1,195	15.0	> 1,000	1.00	NM
	09/04/97	6.78	837	18.0	40.0	1.71	NM
	12/04/97	6.23	1,076	12.0	16.2	8.85	NM
	03/06/98	6.83	1,284	10.0	16.0	2.15	NM
	06/18/98	6.85	1,045	15.5	60.7	2.60	NM
	09/29/98	6.58	851	18.5	45.8	1.27	NM
	12/14/98	6.50	973	13.1	16.4	1.14	-147
	03/03/99	6.70	849	10.0	55.0	3.02	-148
	06/17/99	6.51	790	14.0	6.7	1.30	-176
	09/16/99	6.60	905	17.0	14.1	0.10	-189
	12/08/99	7.12	408	12.9	9.8	0.30	-158
	03/07/00	7.51	599	10.0	5.9	0.20	-126
	06/21/00	7.10	505	16.0	4.6	1.20	7
	09/12/00	6.80	790	14.5	NM	2.60	-69
	12/07/00	7.04	830	12.0	6.9	1.10	-60
	03/15/01	7.06	999	10.0	4.9	2.00	-48
	07/12/01	7.03	925	15.6	7.8	2.65	-141
	09/24/01	6.54	NM	20.2	4.3	1.08	NM
	01/02/02	7.19	1,150	11.8	NM	NM	NM
	03/28/02	7.26	351	10.2	NM	0.20	NM
	06/11/02	7.34	613	15.2	NM	0.22	NM
	09/18/02	6.93	771	18.6	NM	0.04	-200
	12/17/02	7.01	601	12.6	3.5	0.19	NM
	03/20/03	7.19	517	10.9	5.8	0.13	-111
	05/14/03	7.00	493	12.9	NM	0.74	-75
	06/11/03	7.02	405	15.0	8.0	0.23	NM
	09/11/03	7.03	474	18.7	4.0	0.21	NM
	12/04/03	7.00	451	13.7	4.2	0.23	-51
	03/16/04	6.71	391	11.0	4.6	0.32	-63
	09/22/04	6.49	500	16.0	NM	0.21	4
	04/05/05	6.75	465	12.3	NM	1.10	5
	09/21/05	7.26	624	17.8	NM	0.26	5
	03/15/06	6.88	550	11.0	18.8	< 0.01	NM
	09/14/06	6.82	630	16.8	NM	0.22	56
	04/04/07	7.16	737	11.6	5.7	< 0.01	-64
	09/25/07	6.80	687	15.7	6.2	0.18	-240

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-1 (continued)	05/02/08	6.87	883	12.3	NM	0.19	-66
	09/30/08	6.93	843	16.2	NM	7.57 ^a	-101
	03/25/09	7.11	843	9.4	NM	0.30	-45
	09/30/09	6.96	346	18.1	NM	0.08	3
	03/29/10	6.97	842	11.4	NM	0.30	-8
	09/30/10	7.26	937	17.2	NM	0.24	-10
	03/03/11	7.49	510	9.2	7.0	0.23	-13
	09/23/11	6.61	523	18.0	3.0	0.10	-106
	03/08/12	6.99	494	8.2	7.9	0.22	-44
	10/01/12	6.56	507	15.5	5.7	0.22	349 ^a
	03/06/13	6.84	820	9.6	14.5	0.20	-7
	09/24/13	6.78	496	18.5	55.3	0.20	-84
	03/26/14	7.21	991	10.5	1.2	0.00	-129
	09/23/14	6.49	698	19.7	2.3	0.55	-126
	03/17/15	6.05	438	10.5	0.0	0.00	-227
09/16/15	6.37	700	17.6	0.00	0.00	-121	
MW-2	04/17/95	6.30	1,000	13.0	NM	NM	NM
	09/04/96	6.11	964	14.8	8.5	1.00	NM
	12/10/96	6.27	704	13.1	1000.0	0.92	NM
	03/04/97	6.20	754	13.0	9.4	1.77	NM
	06/27/97	6.54	667	14.0	322.0	3.00	NM
	09/04/97	6.41	638	15.0	332.0	1.17	NM
	12/04/97	5.25	612	14.0	74.4	1.80	NM
	03/06/98	6.48	826	12.0	66.9	1.12	NM
	06/18/98	6.60	899	14.0	334.0	3.50	NM
	09/29/98	6.35	705	17.0	16.6	16.6 ^a	NM
	12/14/98	6.20	632	15.1	NM	1.14	-84
	03/02/99	6.29	560	12.0	59.4	1.30	-91.9
	06/16/99	6.02	663	13.0	NM	0.90	-76
	09/16/99	6.39	734	13.0	11.5	< 0.1	-475
	12/08/99	6.74	421	14.8	15.5	1.30	-121
	03/07/00	6.40	491	12.0	18.9	0.40	-70
	06/21/00	6.55	320	15.0	6.1	1.51	8
	09/12/00	6.10	667	13.0	10.9	3.90	-57
	12/07/00	6.21	574	13.0	6.1	1.90	-18
	03/15/01	6.60	556	12.0	39.0	0.60	-49
	07/12/01	6.53	652	15.1	76.7	2.54	-116
	09/24/01	6.69	NM	19.5	5.0	1.10	NM
01/03/02	5.81	531	13.7	12.3	0.00	NM	
03/28/02	6.28	229	12.6	6.2	0.63	NM	
06/11/02	6.72	526	14.2	7.1	0.43	NM	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-2 (continued)	09/18/02	6.63	597	17.9	NM	0.08	-11
	12/16/02	6.04	480	15.2	5.1	0.34	NM
	03/20/03	6.63	413	12.5	28.9	0.12	-57
	06/11/03	6.59	306	13.9	10.2	0.31	NM
	09/10/03	6.33	416	15.9	4.2	0.34	NM
	12/05/03	6.58	293	14.3	5.3	0.31	-20
	03/16/04	6.54	306	12.8	25.4	0.30	-23
	09/24/04	6.46	376	17.0	NM	0.37	30
	04/05/05	6.39	438	12.5	NM	1.04	24
	09/21/05	6.71	512	17.1	NM	0.26	-3
	03/15/06	6.57	403	12.4	52.8	< 0.01	NM
	09/13/06	6.33	472	15.5	NM	0.15	68
	04/03/07	6.64	421	13.9	64.8	0.11	116
	09/26/07	6.44	608	15.8	42.3	0.21	-178
	05/02/08	6.29	567	12.2	NM	0.25	-23
	09/29/08	6.43	607	19.6	NM	0.20	-121
	03/26/09	5.99	543	9.6	NM	0.31	-9
	09/29/09	6.44	55 ^a	15.6	NM	8.1 ^a	32
	03/26/10	6.49	390	12.6	NM	0.82	7
	09/30/10	6.68	556	16.4	NM	0.28	27
	03/08/11	6.87	441	12.7	85.0	0.17	8
	09/21/11	6.30	443	18.0	9.8	0.09	-91
	03/06/12	6.56	396	11.2	NM	0.67	-65
	09/28/12	6.45	382	17.2	NM	0.29	342 ^a
	03/07/13	6.48	480	12.4	NM	0.15	20
	09/24/13	6.63	349	16.8	90.7	0.20	-50
03/26/14	6.99	495	13.8	7.2	0.00	-106	
09/24/14	6.32	547	17.4	4.3	0.00	-119	
03/17/15	6.36	253	15.5	0.0	0.00	-153	
09/17/15	6.47	619	16.6	0.0	0.00	-70	
MW-3	04/17/95	6.40	1,580	12.0	NM	NM	NM
	09/04/96	6.33	1,357	14.9	5.1	1.60	NM
	12/11/96	6.48	979	12.4	14.7	1.00	NM
	03/04/97	6.44	1,152	13.0	9.4	1.69	NM
	06/27/97	6.64	937	13.0	423.0	1.00	NM
	09/04/97	6.47	765	15.0	132.0	1.81	NM
	12/04/97	6.20	844	13.5	7.5	1.29	NM
	03/06/98	6.53	1,255	12.0	3.4	1.90	NM
	06/18/98	6.55	1,225	13.0	5.3	0.90	NM
	09/29/98	6.41	947	14.0	7.9	1.22	NM

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-3 (continued)	12/14/98	6.25	1,054	13.5	0.9	1.14	-79
	03/03/99	6.45	765	12.0	4.7	NM	-105
	06/16/99	6.31	837	12.0	NM	1.00	-120
	09/17/99	6.48	964	14.0	4.2	0.10	-129
	12/08/99	6.80	137	13.5	6.7	1.50	-63
	03/07/00	6.62	766	12.0	8.0	0.80	-75
	06/21/00	6.92	452	14.0	7.5	1.25	-81
	09/12/00	6.70	836	10.7	NM	1.40	-36
	12/07/00	6.09	732	12.0	2.7	1.80	-62
	03/15/01	6.80	809	11.0	7.5	0.90	NM
	07/12/01	6.63	746	13.1	8.2	1.36	-42
	09/24/01	6.49	NM	16.9	11.8	0.16	NM
	01/03/02	6.52	955	13.1	2.0	0.00	NM
	03/28/02	6.74	330	12.3	5.8	0.19	NM
	06/11/02	6.89	786	12.8	14.3	0.38	NM
	09/17/02	6.80	773	15.2	NM	0.10	-135
	12/17/02	6.44	821	13.0	7.5	0.40	NM
	03/20/03	6.85	521	12.1	3.3	0.12	-73
	06/11/03	7.17	411	13.8	3.6	0.24	NM
	09/11/03	6.72	395	16.1	2.5	0.24	NM
	12/04/03	6.69	388	13.2	2.2	0.68	94
	03/15/04	6.61	425	12.3	2.1	0.32	-81
	09/24/04	6.56	448	15.6	NM	NM	2
	04/05/05	6.95	726	13.0	NM	0.33	-4
	09/21/05	7.11	560	15.6	NM	0.42	-6
	03/14/06	7.14	519	11.9	1.0	< 0.01	NM
	09/12/06	6.50	606	15.8	NM	0.19	-21
	04/04/07	6.40	515	12.1	13.3	0.06	-1
	09/25/07	6.43	540	14.2	6.8	0.40	-183
	05/01/08	6.63	688	11.9	NM	0.17	-74
	10/01/08	6.77	662	17.2	NM	0.04	-118
	03/24/09	6.64	727	11.3	NM	0.26	-81
	09/29/09	6.82	220	17.0	NM	0.37	10
03/30/10	6.85	601	11.6	NM	0.99	-5	
09/28/10	6.98	647	15.6	NM	0.28	8	
03/07/11	7.33	426	12.1	2.0	0.20	32	
09/21/11	6.71	556	16.3	1.4	0.03	-127	
03/06/12	6.97	497	10.7	NM	0.11	-1	
10/01/12	6.81	519	16.2	NM	0.20	308 ^a	
03/07/13	6.87	662	11.7	NM	0.19	102	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-3 (continued)	09/24/13	7.03	404	13.6	57.2	0.40	-97
	03/27/14	7.29	616	12.4	0.0	0.00	-154
	09/25/14	6.82	681	15.1	14.6	0.00	-135
	03/19/15	6.06	318	11.6	0.0	0.00	-226
	09/16/15	7.13	618	17.4	0.0	0.00	-125
MW-4	09/04/96	6.29	1,452	17.9	98.5	1.50	NM
	12/10/96	6.29	1,690	11.9	427.0	0.83	NM
	03/04/97	6.75	1,868	10.0	2.6	2.82	NM
	06/27/97	6.78	1,431	11.0	55.0	1.00	NM
	09/04/97	6.82	1,120	19.0	51.0	1.40	NM
	12/04/97	6.33	1,578	13.0	6.5	1.80	NM
	03/06/98	6.88	1,847	10.0	3.6	1.92	NM
	06/18/98	6.79	1,862	15.0	4.5	2.20	NM
	09/29/98	6.63	1,288	18.0	10.8	1.26	NM
	12/14/98	6.18	1,560	13.9	2.6	1.16	-150
	03/03/99	6.69	1,288	9.0	9.6	NM	155
	06/17/99	6.69	NM	13.0	1.9	0.10	-186
	09/17/99	6.57	1,623	17.0	2.5	1.90	-178
	12/08/99	6.94	394	13.6	4.3	0.50	-109
	03/07/00	6.92	1,344	12.0	5.8	1.10	-68
	06/21/00	6.90	992	15.0	2.4	1.29	-67
	09/12/00	6.58	1,450	14.0	1.6	2.20	-86
	12/07/00	6.60	1,210	13.0	3.6	2.40	15
	03/15/01	6.60	1,361	10.0	5.2	1.50	-24
	07/12/01	6.70	1,594	15.2	6.2	2.73	-108
	09/25/01	6.17	NM	17.7	47.9	1.04	NM
	01/02/02	6.73	1,840	11.9	74.0	NM	NM
	03/28/02	6.95	655	10.5	24.7	0.39	NM
	06/11/02	6.97	817	13.3	NM	0.17	NM
	09/18/02	6.81	1,452	18.1	NM	0.04	-106
	12/17/02	6.54	1,011	12.4	2.7	0.34	NM
	03/20/03	6.74	877	10.8	3.6	0.07	-78
05/14/03	6.70	864	12.2	NM	0.74	-45	
06/11/03	6.89	776	13.9	4.0	0.21	NM	
09/11/03	6.60	756	17.1	3.7	0.25	NM	
12/04/03	6.68	437	13.1	4.2	0.22	-52	
03/15/04	6.60	518	10.6	1.9	0.46	-58	
09/24/04	6.45	596	15.4	NM	0.62	36	
04/04/05	6.71	945	11.6	NM	1.20	58	
09/21/05	6.56	881	17.5	NM	0.71	-1	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-4 (continued)	03/15/06	6.82	907	10.1	8.3	0.01	NM
	09/14/06	6.49	907	15.5	NM	0.33	98
	04/04/07	6.85	891	11.2	5.9	< 0.01	-68
	09/26/07	6.51	992	16.7	4.2	< 0.01	-210
	05/02/08	6.46	1,076	11.1	NM	0.19	-39
	10/01/08	6.48	1,073	15.8	NM	0.26	-68
	03/25/09	6.81	1,256	9.5	NM	0.30	-45
	09/30/09	6.59	369	17.9	NM	0.11	24
	03/29/10	6.71	1,094	9.9	NM	0.58	-8
	10/01/10	6.89	1,054	16.7	NM	0.55	10
	03/04/11	7.48	906	9.4	7.0	0.17	-8
	09/23/11	6.46	1,091	22.1	1.6	0.15	-64
	03/08/12	6.67	1,100	9.6	NM	0.36	-16
	10/01/12	6.56	1,109	16.8	NM	0.18	355 ^a
	03/06/13	6.73	1,436	9.7	4.3	0.22	24
	09/24/13	6.82	823	17.8	63.8	0.00	-63
	03/25/14	7.26	1,510	13.9	0.0	0.00	-141
	09/23/14	6.49	1,210	19.2	0.5	0.00	-107
	03/17/15	6.10	730	10.5	0.0	0.00	-225
09/17/15	6.25	1,150	17.3	0.0	0.00	-104	
MW-5	09/04/96	6.23	422	15.9	21.7	2.10	NM
	12/10/96	6.15	463	12.7	984.0	1.53	NM
	03/04/97	6.22	506	13.0	8.9	2.48	NM
	06/27/97	6.46	329	15.0	245.0	2.00	NM
	09/04/97	6.79	285	16.0	51.0	1.39	NM
	12/04/97	5.90	367	13.0	3.6	1.35	NM
	03/06/98	6.38	425	12.0	4.9	1.97	NM
	06/18/98	6.36	439	14.0	8.5	2.20	NM
	09/29/98	6.29	326	17.0	8.7	1.54	NM
	12/15/98	5.94	394	14.8	3.6	1.72	111
	03/02/99	5.87	301	12.0	8.9	1.47	237
	06/16/99	5.99	375	12.0	< 10	0.20	161
	09/16/99	6.19	449	14.0	2.9	0.40	-159
	12/08/99	6.59	238	14.9	5.1	0.20	72
	03/07/00	6.34	278	12.0	7.9	1.10	67
	06/21/00	6.45	185	14.0	1.6	1.68	-8
	09/12/00	7.24	349	12.4	1.9	1.20	-18
	12/07/00	6.15	314	13.0	14.4	2.30	-45
03/15/01	6.55	371	11.0	9.1	3.50	-61	
07/09/01	6.32	352	14.2	4.6	1.01	111	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-5	09/24/01	6.16	256	18.1	63.7	6.17	NM
(continued)	01/02/02	6.09	468	15.3	NM	NM	NM
	03/27/02	6.51	5,000	9.7	5.1	3.84	NM
	06/11/02	6.29	439	13.9	2.4	1.05	NM
	09/18/02	6.28	429	15.6	NM	0.25	-4
	12/16/02	6.18	341	14.2	2.7	0.48	NM
	03/17/03	6.29	350	13.4	3.4	0.36	79
	05/14/03	6.42	286	12.3	NM	0.69	34
	06/10/03	6.35	218	13.8	11.6	0.30	NM
	09/11/03	6.32	267	16.5	1.4	0.37	NM
	12/05/03	6.40	219	13.8	7.1	0.34	281
	03/16/04	6.40	219	12.7	7.1	0.77	73
	09/22/04	6.27	337	13.9	NM	0.66	60
	04/04/05	6.41	290	13.1	NM	1.55	100
	09/20/05	6.59	324	18.5	NM	0.36	11
	03/14/06	6.45	312	12.4	12.1	0.61	NM
	09/13/06	6.34	296	15.7	NM	0.32	124
	04/05/07	6.47	327	12.2	7.7	0.73	128
	09/26/07	6.22	351	15.1	6.2	0.58	92
	05/01/08	6.10	436	12.9	NM	0.84	74
	09/30/08	6.17	397	15.7	NM	0.33	116
	03/25/09	6.29	463	10.6	NM	0.57	106
	09/29/09	6.36	127	16.5	NM	1.73	37
	04/01/10	6.39	287	12.5	16.0	0.49	27
	04/09/10	NM	340	NM	3.0	NM	NM
	04/16/10	6.38	342	13.4	8.0	0.70	26
	05/06/10	6.52	297	12.7	6.0	2.35	23
	06/09/10	6.44	283	14.1	14.0	1.61	24
	09/28/10	6.55	262	18.4	NM	1.06	26
	03/03/11	6.76	203	11.6	6.0	0.55	12
	06/22/11	6.36	200	17.0	14.5	0.11	-7
	09/22/11	6.19	226	17.3	5.1	0.38	63
	10/21/11	6.11	267	15.8	9.0	0.41	34
	12/07/11	6.36	207	14.0	NM	0.15	73
	03/07/12	6.39	216	12.3	NM	0.29	53
	06/26/12	6.35	233	17.1	4.2	0.19	29
	09/27/12	6.14	266	18.5	0.8	0.25	346 ^a
	12/19/12	6.17	362	13.0	23.0	0.34	-29
	03/06/13	6.25	360	11.2	4.4	0.18	76
	06/06/13	6.63	379	17.9	17.0	0.63	23
	09/24/13	6.45	302	14.8	54.6	0.03	20

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-5 (continued)	03/25/14	5.81	404	14.7	0.0	0.00	-141
	09/23/14	6.14	380	16.6	2.1	0.00	-49
	03/16/15	6.21	199	16.1	0.0	0.00	-100
	09/15/15	5.95	342	16.3	0.0	0.00	-34
MW-6	09/04/96	6.30	1,930	14.5	23.0	4.80	NM
	12/10/96	6.17	1,909	12.0	> 1,000	1.02	NM
	03/04/97	6.32	1,683	11.0	6.1	3.44	NM
	06/27/97	6.41	1,469	14.0	73.0	1.00	NM
	09/04/97	6.30	1,157	15.0	98.0	1.15	NM
	12/04/97	5.92	1,286	14.0	5.7	1.05	NM
	03/06/98	6.33	1,620	11.0	5.7	1.10	NM
	06/18/98	6.33	1,804	14.0	7.0	1.80	NM
	09/29/98	6.25	1,440	17.5	7.9	1.91	NM
	12/15/98	5.93	1,390	14.4	NM	1.26	-89
	03/02/99	6.03	1,107	11.0	7.7	1.38	-85
	06/16/99	6.15	1,441	12.0	< 10	< 0.1	-117
	09/16/99	6.27	1,621	13.0	9.1	0.60	-476
	12/08/99	6.63	315	13.7	3.7	0.70	-91
	03/07/00	6.36	1,147	11.0	5.5	0.60	-54
	06/21/00	6.66	810	14.0	1.0	1.75	-37
	09/12/00	6.50	1,378	12.0	NM	2.30	-43
	12/07/00	5.79	1,270	14.0	3.6	1.60	-15
	03/15/01	6.35	1,079	11.0	16.1	0.40	-31
	07/12/01	6.39	1,210	14.1	7.6	1.07	-44
	09/25/01	6.63	NM	16.4	18.9	1.02	NM
	01/03/02	6.19	1,120	12.9	1.5	0.00	NM
	03/27/02	6.32	NM	9.0	NM	0.45	NM
	06/11/02	6.78	891	13.5	NM	0.34	NM
	09/18/02	6.49	1,312	16.7	NM	0.16	-157
	12/16/02	6.25	1,179	14.2	8.8	0.24	NM
	03/20/03	6.53	721	12.1	5.3	0.17	-70
	06/11/03	6.74	387	14.1	21.3	0.33	NM
	09/10/03	6.44	601	16.9	4.2	0.31	NM
	12/04/03	6.60	393	14.3	6.2	0.26	-12
03/16/04	6.75	286	12.9	6.9	0.25	-37	
09/23/04	6.36	635	16.3	NM	0.55	13	
04/05/05	6.61	541	13.3	NM	0.61	-17	
09/21/05	6.47	1,045	15.4	NM	0.66	40	
03/14/06	6.70	445	12.7	12.6	< 0.01	NM	
09/13/06	6.39	868	15.4	NM	0.25	64	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-6 (continued)	04/05/07	6.50	377	12.6	19.0	0.07	23
	09/26/07	6.39	1,010	15.0	12.2	0.06	-190
	05/02/08	6.39	578	11.9	NM	0.19	-26
	09/30/08	6.26	1,011	14.9	NM	0.14	-85
	03/26/09	6.84	573	11.9	NM	0.41	6
	09/29/09	6.30	99 ^a	14.3	NM	6.9 ^a	39
	03/30/10	6.53	533	11.5	NM	0.61	14
	09/30/10	6.55	936	15.9	NM	0.35	30
	03/04/11	6.84	331	10.6	4.0	0.21	11
	09/21/11	6.23	723	17.9	3.9	0.13	-68
	03/06/12	6.53	341	10.5	NM	0.25	-12
	09/28/12	6.21	717	15.3	NM	0.27	315 ^a
	03/07/13	6.49	511	11.1	NM	0.21	76
	09/24/13	6.50	634	14.3	106.0	0.00	-52
	03/26/14	6.70	420	13.1	7.3	0.00	-60
	09/24/14	6.18	887	15.7	3.2	0.00	-94
	03/17/15	5.39	270	11.9	0.0	0.00	-155
09/17/15	6.32	1,040	16.4	1.1	0.00	-62	
MW-7	12/22/97	6.56	550	11.0	139.0	2.15	NM
	03/06/98	6.63	536	12.0	13.4	1.53	NM
	06/18/98	6.36	543	14.0	13.0	2.40	NM
	09/29/98	6.38	438	17.0	20.5	1.41	NM
	12/14/98	5.98	409	15.2	3.2	1.23	68
	03/03/99	7.07	288	12.0	5.5	NM	-8.4
	06/17/99	6.07	462	13.0	NM	0.80	1
	09/17/99	6.13	506	16.0	11.4	< 0.1	-72
	12/08/99	6.71	342	15.3	7.6	1.30	-2
	03/07/00	6.44	362	12.0	6.7	0.80	-11
	06/21/00	6.57	241	14.0	0.7	2.04	24
	09/12/00	6.00	493	13.0	12.6	1.40	5
	12/07/00	6.46	505	14.0	31.0	2.60	-39
	03/15/01	6.58	425	12.0	20.2	1.50	NM
	07/12/01	6.45	493	14.1	10.5	1.87	54
	09/25/01	6.48	NM	15.6	2.8	1.12	NM
	01/03/02	6.17	628	13.9	4.1	0.00	NM
	03/28/02	6.37	184	12.3	4.7	2.61	NM
	06/11/02	6.66	383	13.2	5.7	0.70	NM
	09/17/02	6.56	427	16.0	NM	0.15	4
12/17/02	6.46	351	13.2	2.4	0.32	NM	
03/17/03	6.49	436	13.3	19.7	0.13	27	
06/10/03	6.88	282	13.8	52.1	0.18	NM	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-7 (continued)	09/10/03	6.27	257	16.0	3.0	0.49	NM
	12/04/03	6.68	239	13.4	4.7	0.29	159
	03/16/04	6.62	268	13.9	7.3	0.84	34
	09/22/04	7.00	469	16.0	NM	0.21	103
	04/04/05	6.71	388	13.0	NM	0.86	40
	09/20/05	6.75	404	18.3	NM	0.68	-11
	03/14/06	7.11	312	12.5	3.7	2.78	NM
	09/13/06	6.33	345	16.0	NM	0.26	115
	04/03/07	6.56	220	12.6	15.2	5.06	222
	09/25/07	6.43	313	17.1	8.7	0.59	44
	05/01/08	6.30	337	13.4	NM	1.40	41
	10/01/08	6.41	389	17.3	NM	0.13	30
	03/24/09	6.12	450	11.3	NM	0.97	94
	09/29/09	6.51	141	15.9	NM	1.83	28
	04/01/10	6.81	255	12.4	NM	1.48	6
	09/28/10	6.71	318	17.4	NM	0.27	17
	03/02/11	6.48	235	11.4	10.0	5.72	3
	06/22/11	6.33	193	19.0	38.1	0.33	109
	09/22/11	6.33	248	16.6	1.9	0.19	158
	10/20/11	6.28	389	16.1	13.0	0.30	88
	12/07/11	6.55	273	13.4	NM	0.57	139
	03/07/12	6.54	200	12.3	NM	1.31	95
	06/26/12	6.47	196	16.1	5.7	0.18	43
	07/12/12	6.54	197	15.8	NM	0.23	-22
	09/27/12	6.26	245	18.2	1.8	0.30	383 ^a
	12/19/12	6.42	641	13.0	7.0	0.46	8
	03/05/13	6.32	374	12.6	16.6	0.17	19
	06/06/13	6.74	328	16.7	9.3	0.24	81
	09/24/13	5.97	427	17.7	0.0	0.00	45
	03/26/14	6.48	340	14.2	0.0	0.00	132
09/25/14	6.36	402	17.5	0.0	0.00	116	
03/18/15	6.25	162	17.0	0.0	2.87	-2	
09/14/15	6.68	433	17.8	0.4	0.00	76	
MW-8	12/22/97	6.37	495	12.0	66.5	4.06	NM
	03/06/98	6.49	758	12.0	70.1	2.72	NM
	06/18/98	6.66	662	13.0	243.0	2.80	NM
	09/29/98	6.33	428	14.5	48.3	1.70	NM
	12/14/98	6.11	413	13.9	13.8	1.83	72
	03/02/99	6.10	442	12.0	90.5	2.11	117
	06/16/99	5.95	534	11.0	< 10	0.10	132

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-8	09/16/99	6.22	588	13.0	10.5	1.80	-205
(continued)	12/08/99	6.50	140	13.9	133.0	2.40	55
	03/07/00	6.90	455	12.0	25.3	1.50	38
	06/21/00	6.30	313	14.0	1.2	1.73	37
	09/12/00	6.52	447	11.6	2.6	3.50	52
	12/07/00	6.99	387	14.0	6.5	1.80	-10
	03/15/01	6.45	433	11.0	8.3	2.70	-50
	07/12/01	6.30	427	13.8	5.0	2.03	53
	09/25/01	6.48	NM	14.4	22.0	1.02	NM
	01/03/02	5.64	468	13.4	2.8	0.00	NM
	03/27/02	6.31	NM	8.9	5.1	1.95	NM
	06/11/02	6.41	576	12.9	6.4	0.40	NM
	09/18/02	6.32	415	15.0	NM	0.15	-88
	12/16/02	6.23	294	13.6	11.6	0.35	NM
	03/17/03	6.31	279	12.4	2.4	0.28	87
	05/14/03	6.36	338	13.6	NM	0.83	35
	06/11/03	6.54	249	13.4	3.5	0.54	NM
	09/10/03	6.12	249	15.5	1.3	0.70	NM
	12/04/03	6.62	165	13.5	4.7	0.17	153
	03/16/04	6.48	292	12.6	6.1	0.72	47
	09/24/04	6.60	309	16.0	NM	0.18	66
	04/05/05	6.48	385	12.9	NM	1.31	-1
	09/20/05	6.52	349	18.1	NM	0.53	31
	03/15/06	6.60	433	12.0	26.5	0.42	NM
	09/13/06	6.41	411	14.9	NM	0.25	52
	04/05/07	6.32	690	12.4	6.7	0.44	176
	09/26/07	6.30	506	14.7	10.3	0.50	-1
	05/01/08	6.07	812	12.8	NM	1.14	94
	09/30/08	6.25	584	15.2	NM	0.18	60
	03/26/09	6.70	906	12.3	NM	0.96	90
	09/29/09	6.27	135	15.3	NM	7.6 ^a	40
	04/01/10	6.29	949	11.9	NM	0.79	29
	09/28/10	6.44	1,217	18.1	NM	0.28	32
	03/04/11	6.81	1,317	11.0	2.0	0.50	13
	09/26/11	6.15	1,137	14.4	0.3	0.32	270
	03/06/12	6.55	1,106	11.6	NM	0.50	14
	09/28/12	6.27	1,101	17.1	NM	0.32	305 ^a
	03/08/13	6.45	1,271	12.3	NM	0.23	136
	09/24/13	6.43	854	15.9	57.0	0.69	57
	03/26/14	6.76	994	13.4	5.0	0.00	109

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-8 (continued)	09/23/14	6.27	1120	16.9	1.5	0.00	112
	03/16/15	6.40	486	15.8	0.0	0.00	-2
	09/16/15	6.52	1,190	14.1	0.0	0.00	126
MW-9	07/09/01	6.24	812	13.9	8.2	2.28	-63
	09/25/01	6.33	NM	14.7	52.2	1.06	NM
	01/03/02	6.13	763	13.4	1.4	0.00	NM
	03/27/02	6.37	NM	8.2	NM	0.59	NM
	06/11/02	6.61	700	12.8	NM	0.61	NM
	09/17/02	6.41	728	14.7	NM	0.13	-131
	12/16/02	6.24	614	13.7	27.7	0.26	NM
	03/17/03	6.52	460	12.7	18.8	0.08	-47
	06/11/03	6.28	395	13.3	64.7	0.41	NM
	09/10/03	6.12	494	15.1	21.6	0.33	NM
	12/04/03	6.49	351	14.5	16.0	0.18	21
	03/16/04	6.46	269	12.4	5.1	0.44	46
	09/23/04	6.48	488	15.5	NM	0.17	55
	04/05/05	6.53	710	13.2	NM	1.15	-5
	09/20/05	6.25	550	16.7	NM	0.21	24
	03/14/06	6.51	416	12.7	347.0	< 0.01	NM
	09/13/06	6.43	548	14.7	NM	0.18	59
	04/05/07	6.26	438	12.5	110.0	0.01	50
	09/26/07	6.18	596	14.2	89.1	0.35	-166
	05/01/08	6.28	753	13.1	NM	0.24	78
	09/30/08	6.29	707	14.7	NM	0.15	-79
	03/26/09	6.69	649	11.8	NM	0.29	66
	09/29/09	6.38	111	14.9	NM	7.7 ^a	35
	03/30/10	6.58	559	11.9	NM	0.72	17
	09/28/10	6.52	651	17.3	NM	0.24	27
	03/04/11	6.89	505	12.0	4.0	0.24	10
	09/26/11	6.41	544	13.4	85.4	0.12	-90
	03/06/12	6.37	392	11.3	NM	0.30	32
09/28/12	6.57	641	15.3	NM	0.16	272 ^a	
03/08/13	6.47	557	11.9	NM	0.16	95	
09/24/13	6.87	365	15.1	128.0	0.00	-67	
03/26/14	6.42	388	15.0	0.0	0.00	67	
09/24/14	6.45	472	17.1	21.2	0.00	-93	
03/17/15	6.09	239	15.7	70.4	0.94	-40	
09/16/15	6.54	769	15.9	20.7	0.00	-146	
MW-10	07/09/01	6.47	463	14.2	14.2	2.11	72
	09/25/01	6.53	NM	15.6	184.0	0.98	NM

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-10 (continued)	01/03/02	6.33	460	13.6	3.2	0.00	NM
	03/28/02	6.57	159	12.0	NM	0.32	NM
	06/11/02	6.90	397	13.1	NM	0.22	NM
	09/17/02	6.76	390	15.1	NM	0.10	-97
	12/17/02	6.65	300	13.5	20.2	0.21	NM
	03/20/02	6.82	336	12.9	3.2	0.10	-62
	06/10/03	6.97	222	14.1	15.9	0.18	NM
	09/10/03	6.09	267	16.3	9.0	0.49	NM
	12/04/03	6.61	179	13.4	7.6	0.37	44
	03/16/04	6.51	245	11.7	3.4	0.56	-24
	09/22/04	6.80	282	17.0	NM	0.61	10
	04/05/05	7.68	315	12.1	NM	0.89	-10
	09/20/05	6.62	284	18.1	NM	0.67	1
	03/15/06	6.71	268	11.2	6.7	0.16	NM
	09/12/06	6.59	281	20.3	NM	0.30	-67
	04/03/07	6.95	215	13.7	11.7	< 0.01	46
	09/24/07	6.61	238	16.9	7.7	0.45	-138
	05/01/08	6.56	268	11.8	NM	0.12	-54
	10/01/08	6.72	237	15.3	NM	0.11	-62
	03/24/09	6.53	266	11.2	NM	0.27	-36
	09/30/09	6.73	96 ^a	15.7	NM	0.23	13
	03/30/10	6.96	201	11.1	NM	1.33	-8
	09/28/10	6.98	185	17.7	NM	0.20	3
	03/04/11	7.24	160	10.7	7.0	0.15	-2
	09/26/11	6.61	152	14.9	37.8	0.32	-58
	03/07/12	6.86	141	11.2	NM	0.24	-7
	09/28/12	6.67	136	18.9	NM	0.21	292 ^a
	03/05/13	6.54	164	11.4	NM	0.16	2
	09/24/13	7.11	106	17.4	72.5	0.00	-72
	03/27/14	7.03	176	13.2	0.0	0.00	-88
09/24/14	6.66	201	17.2	12.9	0.00	-94	
03/18/15	6.32	57	14.8	50.2	0.00	-56	
09/14/15	6.51	145	17.6	29.1	0.00	-110	
MW-11	07/09/01	6.69	406	12.8	134.0	0.89	22
	09/24/01	6.28	418	17.5	112.0	6.13	NM
	01/02/02	6.24	431	14.8	NM	NM	NM
	03/27/02	6.58	5,000	9.1	12.0	4.42	NM
	06/11/02	6.35	444	14.2	6.4	2.74	NM
	09/17/02	6.22	530	16.3	NM	0.14	83
	12/16/02	6.00	593	14.0	1.8	0.30	NM

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-11 (continued)	03/17/03	6.15	539	13.4	4.6	0.16	26
	06/10/03	6.20	321	13.7	8.7	0.35	NM
	09/10/03	6.08	411	15.4	5.0	0.31	NM
	12/05/03	6.25	337	13.5	5.1	0.29	260
	03/16/04	6.36	269	12.7	1.7	0.50	73
	09/22/04	6.44	285	16.6	NM	0.38	85
	04/04/05	6.51	320	13.2	NM	1.84	94
	09/20/05	6.33	352	18.6	NM	0.51	-8
	03/14/06	6.80	345	13.0	41.5	< 0.01	NM
	04/04/07	5.85	315	12.1	23.5	0.28	208
	09/26/07	6.27	312	14.9	18.3	0.39	85
	05/01/08	6.11	486	13.5	NM	0.46	69
	09/30/08	6.13	703	16.2	NM	0.19	107
	04/01/10	6.40	286	12.0	13.0	0.46	23
	04/09/10	NM	330	NM	3.0	NM	NM
	04/16/10	6.41	326	13.6	21.0	0.12	26
	05/06/10	6.55	285	13.0	13.0	0.30	24
	06/09/10	6.43	278	14.3	13.0	0.65	25
MW-12	07/09/01	6.67	590	14.5	95.2	1.40	37
	09/24/01	6.41	NM	19.2	78.9	1.17	NM
	01/03/02	5.37	1,480	16.2	7.9	NM	NM
	03/27/02	5.59	NM	12.3	15.8	0.43	NM
	06/11/02	6.33	865	14.6	5.4	0.31	NM
	09/17/02	6.29	737	16.8	NM	0.18	-147
	12/16/02	6.14	475	14.7	2.1	0.12	NM
	03/17/03	6.13	620	14.1	47.3	0.21	1
	05/14/03	6.21	383	13.7	NM	0.66	31
	06/10/03	6.30	367	13.8	66.7	0.45	NM
	09/10/03	6.06	419	15.9	27.8	0.35	NM
	12/05/03	6.18	410	13.4	9.2	0.33	40
	03/16/04	6.40	317	12.5	3.4	0.30	60
	09/22/04	6.58	408	16.5	NM	2.00	59
	04/04/05	6.93	416	13.0	NM	1.39	88
	09/20/05	6.70	460	18.4	NM	0.37	-12
	03/14/06	6.91	410	12.8	36.4	0.38	NM
	09/13/06	6.31	390	15.6	NM	0.19	132
	04/04/07	5.82	420	12.5	34.1	0.10	196
	09/26/07	6.42	383	15.3	28.7	0.20	62
05/01/08	6.07	592	14.0	NM	0.35	71	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-12 (continued)	09/30/08	6.25	511	16.6	NM	0.19	97
	03/26/09	6.32	672	13.3	NM	0.34	9
	09/29/09	6.40	196	16.7	NM	1.55	33
	04/01/10	6.56	347	13.0	NM	0.87	27
	09/28/10	6.52	322	18.6	NM	0.35	26
	03/03/11	6.75	244	11.1	28.0	0.22	12
	06/22/11	6.87	348	16.1	41.2	0.04	-188
	09/22/11	6.51	359	16.4	12.4	0.05	-122
	10/21/11	6.41	411	15.0	35.0	0.38	11
	12/07/11	6.58	293	12.2	NM	0.20	-87
	03/07/12	6.38	316	12.9	NM	0.30	59
	06/27/12	6.44	533	15.5	18.4	0.22	32
	07/12/12	6.44	312	15.5	NM	0.14	16
	10/02/12	6.41	324	16.3	7.9	3.60 ^a	275 ^a
	12/19/12	6.29	444	13.1	11.0	0.37	15
	03/06/13	6.37	436	12.2	18.1	0.15	47
	06/06/13	6.61	431	20.4	33.4	0.25	-40
	09/24/13	6.79	417	14.9	54.4	0.00	-117
	03/25/14	5.90	413	15.4	0.0	0.00	-45
	09/23/14	6.27	424	16.8	3.1	0.70	-108
03/16/15	6.21	196	16.9	2.7	0.00	-82	
09/15/15	6.61	423	16.0	0.0	0.00	-41	
MW-13	03/31/03	6.41	506	14.3	76.0	0.22	-37
	05/14/03	6.29	491	13.8	NM	0.84	-53
	06/11/03	6.63	425	14.7	15.5	0.25	NM
	09/11/03	6.60	470	16.8	23.1	0.58	NM
	12/04/03	6.86	379	13.1	5.7	0.28	-11
	03/15/04	6.58	458	12.8	9.7	0.31	-44
	06/10/04	6.55	383	14.4	NM	0.62	-21
	09/23/04	6.38	427	15.6	NM	0.17	18
	04/05/05	7.02	242	12.9	NM	1.43	9
	09/21/05	6.92	367	16.9	NM	0.22	-15
	03/15/06	7.07	301	13.2	4.0	< 0.01	NM
	09/14/06	6.58	490	16.0	NM	0.20	59
	04/04/07	6.76	557	13.6	5.0	0.03	-39
	09/25/07	6.50	617	15.6	4.8	-0.11	-210
	05/02/08	6.29	758	14.0	NM	0.24	-20
	09/30/08	6.36	687	17.1	NM	0.07	-84
	03/25/09	6.33	763	11.7	NM	0.31	-7
	09/30/09	6.47	273	17.0	NM	0.13	30
03/29/10	6.53	639	12.4	15.0	0.58	18	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-13 (continued)	04/07/10	NM	720	NM	2.0	NM	NM
	04/16/10	6.67	682	14.2	9.0	0.49	24
	05/06/10	6.56	722	13.9	6.0	0.31	25
	06/09/10	6.52	753	15.7	4.0	0.20	22
	09/30/10	6.58	695	17.2	NM	0.14	17
	03/03/11	6.76	552	12.9	1.0	0.20	9
	06/23/11	6.09	365	14.4	9.2	0.16	-61
	09/22/11	6.26	680	19.7	13.3	0.02	-86
	10/20/11	6.27	882	16.3	17.0	0.35	-28
	12/07/11	6.45	566	12.7	NM	0.21	-89
	03/07/12	6.49	564	12.2	NM	0.27	-13
	06/27/12	6.44	533	15.5	18.4	0.22	32
	07/12/12	6.47	571	18.5	NM	0.16	-7
	10/02/12	6.39	541	16.9	6.4	0.20	221 ^a
	12/19/12	6.33	694	13.1	26.0	0.31	-91
	03/07/13	6.43	688	12.9	4.4	0.16	11
	06/06/13	6.70	713	19.9	26.7	0.18	-95
	09/24/13	7.02	489	15.7	82.5	6.22	-92
	03/26/14	6.78	610	14.1	1.7	0.00	-99
	09/23/14	6.41	803	17.7	29.2	0.00	-129
03/17/15	6.25	65	12.4	0.0	0.00	-45	
09/15/15	6.34	485	17.8	0.0	0.00	-106	
MW-14	12/04/03	6.80	207	13.5	8.2	0.22	44
	03/16/04	6.52	294	13.6	1.6	0.57	-9
	06/10/04	6.68	274	14.4	NM	0.55	-3
	09/24/04	6.97	343	14.5	NM	0.21	155
	04/05/05	6.84	369	13.8	NM	0.85	21
	09/21/05	6.71	495	15.1	NM	0.56	11
	03/14/06	6.92	341	13.5	4.9	0.05	NM
	09/13/06	6.81	396	15.7	NM	0.23	33
	04/04/07	6.64	393	14.5	0.8	0.21	-32
	09/26/07	6.56	358	14.8	2.2	0.26	-184
	05/02/08	6.28	412	12.7	NM	0.50	-27
	09/30/08	6.41	425	13.9	NM	0.35	-75
	03/23/09	6.23	498	11.4	NM	0.27	-28
	09/29/09	6.58	60 ^a	14.2	NM	6.6 ^a	24
	03/30/10	6.58	360	13.2	NM	0.73	15
	09/30/10	6.72	555	17.4	NM	0.34	18
	03/04/11	6.96	316	12.0	6.0	0.15	9
	09/21/11	6.39	392	16.7	7.6	0.04	-72
	03/06/12	6.58	337	12.0	NM	0.27	0
	09/28/12	6.42	366	16.3	NM	0.28	294 ^a

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-14 (continued)	03/07/13	6.50	451	12.4	NM	0.18	49
	09/24/13	6.57	313	14.0	65.5	0.00	-23
	03/26/14	6.74	444	16.3	0.0	0.00	-86
	09/24/14	6.39	496	15.7	2.4	0.00	-89
	03/17/15	6.41	282	15.4	0.0	7.23	-144
	09/16/15	6.71	593	14.6	0.0	0.00	-69
MW-15	12/04/03	7.00	259	13.2	9.1	0.18	48
	03/16/04	6.92	290	13.4	2.8	0.39	-25
	06/10/04	6.66	297	14.1	NM	0.56	-17
	09/24/04	6.68	311	14.9	NM	0.21	74
	04/05/05	6.79	370	13.8	NM	0.70	15
	09/21/05	6.91	682	16.4	NM	0.56	-9
	03/14/06	6.80	334	13.7	NM	< 0.01	NM
	09/13/06	6.77	367	15.3	NM	0.50	55
	04/04/07	6.71	396	14.2	1.2	0.06	-39
	09/26/07	6.51	390	15.4	NM	0.01	-205
	05/02/08	6.30	491	13.7	NM	0.21	-24
	09/29/08	6.47	499	18.5	NM	2.86	-97
	03/26/09	6.66	519	12.0	NM	0.23	-13
	09/29/09	6.52	59 ^a	15.3	NM	7.7 ^a	25
	03/30/10	6.61	409	13.3	NM	0.77	14
	09/30/10	6.57	506	17.0	NM	0.38	19
	03/08/11	6.91	449	13.7	4.0	0.17	8
	09/21/11	6.42	462	17.2	3.0	0.06	-83
	03/06/12	6.57	403	11.3	NM	0.30	-32
	10/01/12	6.43	414	14.7	NM	0.31	370 ^a
03/07/13	6.50	530	12.9	NM	0.17	30	
09/24/13	6.61	357	14.4	131.0	0.00	-48	
03/26/14	6.73	487	16.5	0.0	0.00	-94	
09/24/14	6.40	482	16.1	3.5	0.00	-94	
03/17/15	5.58	237	13.7	0.0	0.00	-174	
09/17/15	5.69	509	15.1	0.0	0.00	-46	
MW-16	12/05/03	6.35	385	12.7	6.1	0.59	19
	03/16/04	6.42	370	12.7	7.2	0.39	-14
	06/10/04	6.36	366	14.4	NM	0.54	-5
	09/23/04	6.50	488	14.0	NM	0.24	27
	04/05/05	6.56	645	13.0	NM	1.09	38
	09/21/05	6.48	555	14.6	NM	0.47	21
	03/15/06	6.91	569	12.4	2.1	< 0.01	NM
	09/13/06	6.58	459	14.0	NM	0.19	68
	04/05/07	6.46	659	12.7	1.0	< 0.01	-62

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-16 (continued)	09/26/07	6.52	621	15.8	1.6	0.43	-202
	05/02/08	6.13	790	12.8	NM	0.18	0
	10/01/08	6.35	820	14.6	NM	0.17	-57
	03/25/09	6.09	892	11.5	NM	0.32	-36
	09/30/09	6.41	254	13.7	NM	0.16	32
	04/02/10	6.45	691	11.5	NM	0.59	24
	10/10/10	6.62	801	14.2	NM	0.39	21
	03/08/11	6.76	639	12.3	6.0	0.19	7
	09/26/11	6.29	681	13.5	0.6	0.20	-71
	03/08/12	6.42	666	11.8	NM	0.26	7
	10/01/12	6.28	678	13.7	NM	0.29	358 ^a
	03/08/13	6.54	607	11.2	NM	0.21	110
	09/24/13	6.59	428	12.9	62.1	0.00	-23
	03/27/14	6.67	889	13.3	25.4	0.00	-98
	09/25/14	6.30	901	14.9	98.7	0.00	-84
	03/18/15	6.30	480	15.2	3.1	0.00	-156
09/17/15	6.08	999	13.7	4.8	0.00	-116	
MW-17	12/04/03	6.59	384	12.0	5.7	0.51	93
	03/15/04	6.32	619	12.3	7.1	0.78	-24
	06/10/04	6.41	489	13.1	NM	0.68	-12
	09/23/04	6.42	521	13.4	NM	0.01	10
	04/05/05	6.60	920	12.6	NM	0.97	30
	09/21/05	6.52	882	13.6	NM	0.31	16
	03/15/06	6.92	804	11.4	2.7	0.73	NM
	09/12/06	6.27	908	16.7	NM	0.14	-1
	04/03/07	6.24	766	11.7	1.9	0.65	96
	09/24/07	6.45	922	13.9	2.1	0.40	-175
	05/01/08	6.27	1,286	12.3	NM	0.24	105
	09/29/08	6.46	967	14.9	NM	4.61	-98
	03/24/09	6.12	1,282	11.9	NM	0.42	-22
	09/30/09	6.52	152	12.9	NM	0.31	27
	03/30/10	6.37	667	10.1	NM	1.28	12
	10/01/10	6.68	1,111	14.2	NM	0.31	23
	03/07/11	6.88	564	11.6	5.0	0.15	8
	06/23/11	6.27	415	14.6	7.1	0.08	-40
	09/23/11	6.37	927	16.2	1.4	0.10	-60
	03/08/12	6.57	911	11.9	NM	0.23	-28
06/27/12	6.57	936	15.3	14.8	0.12	-24	
07/12/12	6.53	1,033	15.9	NM	0.23	-26	
10/01/12	6.36	918	13.6	77.2	0.23	346 ^a	
12/19/12	6.35	1,349	10.9	16.0	0.39	-100	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-17 (continued)	03/07/12	6.47	1,128	11.4	4.4	0.18	21
	06/06/13	6.88	1,269	15.0	21.6	0.28	-89
	09/24/13	6.07	792	12.4	90.1	0.00	-55
	03/26/14	6.67	665	12.7	8.0	0.00	4
	09/25/14	6.49	914	14.6	43.1	0.00	-68
	03/19/15	6.50	499	12.3	44.3	0.00	-101
	09/17/15	6.57	1,100	14.5	5.5	0.00	-32
MW-18	12/04/03	6.54	308	13.0	8.1	0.33	21
	03/16/04	6.46	363	12.4	19.4	0.36	-14
	06/10/04	6.41	415	13.8	NM	0.66	-3
	09/23/04	6.31	373	15.3	NM	0.01	7
	04/05/05	6.94	463	12.9	NM	0.83	18
	09/20/05	6.84	183	17.3	NM	0.72	21
	03/15/06	6.68	430	12.3	2.5	0.22	NM
	09/12/06	6.07	519	17.0	NM	0.42	NM
	04/03/07	6.50	464	14.5	2.7	< 0.01	48
	09/24/07	6.57	566	15.5	2.1	0.41	-152
	05/01/08	6.32	637	12.6	NM	0.38	-43
	10/01/08	6.46	599	15.6	NM	0.12	-53
	03/24/09	6.20	626	12.3	NM	0.42	-29
	09/30/09	6.53	190	15.0	NM	0.38	26
	03/30/10	6.62	494	12.0	NM	1.57	13
	09/28/10	6.68	616	16.6	NM	0.24	21
	03/04/11	6.95	464	12.3	3.0	0.18	7
	06/23/11	6.32	312	15.3	9.6	0.14	-7
	09/23/11	6.37	532	16.9	3.8	0.07	-70
	03/07/12	6.54	484	13.0	6.0	0.18	15
	06/27/12	6.55	554	17.4	4.9	0.20	-18
	07/12/12	6.54	567	14.8	NM	0.19	-41
	10/01/12	6.48	321	17.7	2.8	2.42 ^a	353 ^a
	12/19/12	6.44	697	12.3	9.0	0.42	-92
	03/05/13	6.40	657	12.7	6.7	0.17	9
	06/06/13	6.87	741	16.6	16.1	0.26	-84
	09/24/13	6.67	439	15.0	58.9	0.08	-60
03/26/14	7.76	99	13.9	0.0	3.32	115	
09/24/14	6.38	579	16.7	7.1	0.00	-59	
03/18/15	5.55	378	14.2	0.0	0.00	-178	
09/14/15	6.47	617	16.0	0.0	0.00	-82	
MW-19	03/16/04	6.49	403	13.2	12.0	0.38	-23
	06/10/04	6.31	379	14.5	NM	0.89	-15
	09/23/04	6.66	368	15.4	NM	0.26	5
	04/05/05	6.87	571	14.2	NM	0.39	-21

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-19 (continued)	09/21/05	6.80	636	15.7	NM	0.44	31
	03/15/06	6.78	510	12.6	3.7	0.14	NM
	09/12/06	6.40	563	18.1	NM	0.18	-22
	04/03/07	6.05	505	13.9	3.9	0.21	40
	09/24/07	6.31	317	15.6	3.4	0.41	-218
	05/02/08	6.32	698	13.5	NM	0.23	-32
	10/01/08	6.48	573	18.0	NM	0.10	-83
	03/23/09	6.23	610	12.6	NM	0.34	-71
	09/29/09	6.54	29 ^a	15.3	NM	7.5 ^a	29
	03/30/10	6.33	528	11.9	NM	0.98	14
	09/28/10	6.53	722	16.4	NM	0.36	29
	03/03/11	6.92	413	13.5	4.0	0.15	10
	09/21/11	6.38	530	16.6	0.0	0.14	-103
	12/07/11	6.53	556	13.3	NM	0.26	-77
	03/08/12	5.65	596	15.0	NM	0.19	-29
	06/27/12	6.57	430	16.6	0.8	0.16	-22
	07/12/12	6.51	466	15.4	NM	0.23	21
	09/28/12	6.35	406	17.6	NM	0.28	322 ^a
	12/19/12	6.42	560	13.7	14.0	0.40	-93
	03/05/13	6.39	727	13.3	1.6	0.14	-31
	06/06/13	6.84	766	16.3	9.8	0.86	-72
	09/24/13	6.72	486	14.0	64.0	0.00	-98
	03/27/14	6.83	564	14.7	52.9	0.00	-90
09/25/14	6.47	689	18.5	5.7	0.00	-87	
03/19/15	6.56	440	13.4	5.5	0.00	-138	
09/15/15	6.37	797	16.4	1.5	0.00	-119	
MW-20	07/28/05	7.01	1,053	14.7	10.8	NM	NM
	09/20/05	6.71	957	15.1	NM	0.42	45
	03/15/06	6.82	861	12.7	3.2	< 0.01	NM
	09/12/06	6.32	958	17.1	NM	0.39	-64
	04/05/07	6.54	972	14.1	5.0	< 0.01	-70
	09/26/07	6.34	961	15.1	NM	0.20	-169
	05/02/08	6.27	1,037	13.1	NM	0.21	-42
	09/29/08	6.41	1,130	18.9	NM	2.48	-125
	03/23/09	6.18	1,235	12.8	NM	0.37	-39
	09/30/09	6.58	119 ^a	14.4	NM	0.22	27
	03/29/10	6.33	922	13.2	NM	0.48	17
	10/01/10	6.69	1,013	15.8	NM	0.40	21
	03/02/11	6.35	1,147	12.6	8.0	0.13	9
	09/26/11	6.36	930	16.6	33.0	0.29	-80
	03/08/12	6.53	946	14.0	NM	0.25	-5

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-20 (continued)	10/01/12	6.37	903	16.8	NM	0.14	321 ^a
	03/08/13	6.45	180	11.4	NM	0.19	97
	06/06/13	6.67	898	17.0	30.8	0.21	-75
	09/24/13	6.64	761	15.6	96.6	0.00	-68
	03/27/14	6.85	166	15.8	0.0	0.00	-32
	09/25/14	6.42	1010	17.8	62.3	0.00	-84
	03/18/15	6.33	589	14.4	0.0	0.00	-154
	09/16/15	6.27	1090	19.5	2.0	0.00	130
MW-21	09/14/06	6.65	624	14.9	NM	0.34	85
	04/04/07	6.68	657	13.3	14.9	< 0.01	-47
	09/25/07	6.58	636	14.7	12.2	0.06	-231
	05/02/08	6.28	746	13.8	NM	0.25	-29
	09/30/08	6.35	788	15.6	NM	0.12	-79
	03/25/09	6.46	687	11.6	NM	0.32	6
	09/30/09	6.46	310	14.6	NM	0.08	30
	03/26/10	6.31	664	13.2	10.0	0.68	19
	04/16/10	6.54	702	13.6	19.0	0.90	22
	05/06/10	6.50	716	13.9	30.0	0.20	29
	06/09/10	6.21	741	15.0	131.0	0.16	38
	09/30/10	5.90	965	16.9	NM	0.34	56
	03/02/11	6.13	779	11.4	2.0	0.31	24
	06/23/11	5.74	407	13.9	7.2	0.12	-46
	09/22/11	5.75	951	17.5	1.5	0.07	-21
	09/27/11	5.70	907	15.1	5.2	0.35	20
	10/20/11	6.67	1,205	15.0	11.0	0.31	-17
	12/07/11	5.88	845	12.6	NM	0.21	-49
	03/08/12	6.00	880	13.1	NM	0.19	20
	06/26/12	5.99	846	14.4	74.5	0.22	7
	07/12/12	6.03	887	15.6	NM	0.15	42
	10/02/12	5.94	876	14.5	>1000	1.41 ^a	238 ^a
	12/20/12	5.95	1,128	11.4	96.0	0.29	-50
	03/06/13	6.16	1,125	11.0	68.0	0.22	27
	06/06/13	6.61	1,120	18.8	52.6	0.25	-89
	09/24/13	6.28	714	14.6	102.0	0.00	-56
03/26/14	6.50	785	15.1	0.0	0.00	-110	
09/24/14	6.25	829	16.1	31.0	0.00	-88	
03/17/15	5.35	405	13.5	17.5	0.00	-172	
09/15/15	6.50	851	15.4	0.0	0.00	-85	
MW-22	09/14/06	6.40	581	14.0	NM	0.62	121
	04/04/07	5.92	525	12.4	8.2	0.04	-40
	09/26/07	6.40	621	15.0	9.2	0.07	-178

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-22 (continued)	05/02/08	6.11	774	12.7	NM	0.19	-7.4
	10/01/08	6.32	815	13.9	NM	0.19	-74
	03/25/09	6.25	824	11.3	NM	0.26	-26
	09/30/09	6.39	287	14.9	NM	0.09	34
	03/29/10	6.20	665	12.0	NM	0.85	22
	09/30/10	6.57	821	17.6	NM	0.56	13
	03/04/11	6.77	543	12.2	45.0	0.15	12
	06/23/11	6.20	366	13.2	2.1	0.13	-30
	09/23/11	6.27	684	16.3	206.7	0.00	-85
	10/21/11	6.26	827	14.1	4.0	0.34	31
	12/07/11	6.27	583	12.5	NM	0.24	-50
	03/08/12	6.49	502	10.7	20.5	0.23	-17
	06/26/12	6.44	549	14.4	8.8	0.16	-33
	07/12/12	6.35	570	16.4	NM	0.20	15
	10/02/12	6.32	617	15.1	2.8	0.20	251 ^a
	12/19/12	6.26	800	12.0	17.0	0.31	-96
	03/06/13	6.40	823	10.9	5.7	0.22	165
	06/06/13	6.79	881	15.9	11.6	0.32	-91
	09/25/13	6.53	564	13.7	89.1	0.00	-75
	03/26/14	6.59	769	15.0	0.0	0.00	-102
09/24/14	6.22	769	14.9	12.2	0.00	-100	
03/17/15	6.16	430	11.9	0.0	0.00	-149	
09/15/15	6.64	833	17.4	0.8	0.00	-85	
MW-23	09/13/06	6.07	433	16.2	NM	0.52	122
	04/04/07	6.04	414	12.6	63.9	0.65	185
	09/25/07	6.47	432	15.9	31.2	0.49	1.1
	05/01/08	6.24	552	13.8	NM	0.29	38
	10/01/08	6.40	458	17.7	NM	0.13	46
	03/24/09	6.08	487	11.8	NM	0.41	90
	09/29/09	6.48	170	16.8	NM	0.75	29
	04/01/10	6.57	428	13.0	NM	0.66	16
	09/28/10	6.67	495	19.0	NM	0.19	19
	03/02/11	6.25	399	11.8	5.0	0.25	16
	06/22/11	6.27	320	15.3	26.1	0.19	70
	09/23/11	6.35	431	17.8	7.8	0.14	82
	10/20/11	6.51	512	16.7	3.0	0.36	70
	12/07/11	6.57	356	13.7	NM	0.18	102
	03/07/12	6.59	386	13.1	5.2	0.18	58
	06/26/12	6.54	460	16.9	7.3	0.20	46
07/12/12	6.54	465	15.8	NM	0.17	-18	
09/27/12	6.52	409	17.1	5.2	0.26	340 ^a	

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
MW-23 (continued)	12/19/12	6.51	430	13.5	64.0	0.34	65
	03/05/13	6.50	528	12.6	7.1	0.16	-15
	06/06/13	6.91	690	16.8	9.2	0.26	43
	09/24/13	6.72	364	17.0	52.4	2.17	67
	03/26/14	6.80	616	13.5	4.1	0.00	147
	09/25/14	6.53	652	17.5	0.7	0.00	107
	03/18/15	6.50	326	16.0	1.5	0.00	-39
	09/14/15	6.05	650	18.7	0.4	0.00	35
MW-24	03/26/10	6.39	651	13.4	153.0	0.31	17
	04/16/10	6.59	671	14.0	13.0	0.36	21
	05/06/10	6.47	670	15.1	2.0	0.20	28
	06/09/10	6.52	799	15.9	10.0	0.19	24
MW-25	03/29/10	6.56	703	12.2	57.0	0.67	12
	04/07/10	NM	720	NM	2.0	NM	NM
	04/16/10	6.51	687	14.2	2.0	0.22	24
	05/06/10	6.62	744	14.0	2.0	0.31	26
	06/09/10	6.52	896	15.8	7.0	0.27	25
MW-26	04/01/10	6.44	269	12.7	34.0	0.74	19
	04/09/10	NM	290	NM	4.0	NM	NM
	04/16/10	6.49	270	13.6	21.0	0.19	23
	05/06/10	6.67	218	12.6	18.0	0.31	28
	06/09/10	6.47	207	14.9	41.7	0.76	28
MW-27	09/24/14	6.38	566	16.2	64.3	0.00	-80
	03/18/15	6.22	339	13.5	17.8	0.00	-122
	09/16/15	6.75	631	19.5	2.2	0.00	-79
MW-28	09/25/14	6.56	1,010	14.6	257	0.00	-95
	03/19/15	5.72	575	11.4	127	0.00	-204
	09/17/15	6.32	985	16.2	11.7	0.00	-125
P-1	09/24/04	6.54	401	15.4	NM	0.24	33
Inj-1	07/09/01	6.39	703	14.2	47.8	1.55	-18
Inj-2	07/09/01	6.45	384	15.1	61.9	1.20	17
	06/11/02	6.49	950	15.6	13.8	0.23	NM
	06/10/03	6.38	381	14.5	10.4	0.25	NM
Inj-3	07/09/01	6.37	407	14.2	30.1	1.51	17
	06/11/02	6.59	1,971	15.1	13.8	0.11	NM
	12/17/02	6.27	417	13.4	12.3	0.11	NM
	06/10/03	6.50	634	14.2	23.8	0.21	NM
IW-106	10/08/12	6.19	851	17.6	NM	0.11	370 ^a

**Table B-1
Groundwater Field Parameters
Univar USA Inc., Kent, Washington**

Sample Location	Date Collected	pH	Specific Conductance (µS/cm)	Temperature (°C)	Turbidity (NTUs)	Dissolved Oxygen (mg/L)	Oxidation Reduction Potential (mv)
IW-115	10/08/12	6.16	948	16.9	NM	0.22	419 ^a
IW-117	10/20/11	5.33	1,484	14.7	200.0	0.48	19
	10/02/12	6.30	916	15.3	High	0.18	253 ^a
IW-130	10/05/12	6.43	1,551	17.0	NM	0.19	300 ^a
IW-137	10/04/12	6.36	1,179	17.9	Low	0.20	303 ^a
IW-140	10/21/11	5.66	2,241	15.8	520.0	0.54	13
	10/02/12	6.24	1,189	18.1	High	0.19	267 ^a
IW-206	10/04/12	6.20	1,129	17.5	Low	0.25	353 ^a
IW-209	10/04/12	6.36	820	17.5	Low	0.24	346 ^a
IW-211	10/21/11	6.37	1,215	15.6	38.0	0.41	-8
	10/02/12	6.81	744	17.0	NM	2.17 ^a	282 ^a
	10/02/12	6.81	744	17.0		2.17	282
IW-212	10/05/12	6.26	514	14.1	NM	0.35	392 ^a
IW-217	10/05/12	6.65	629	15.0	NM	0.23	312 ^a

NOTE: NM = not measured

^a Likely meter malfunction

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600
MW-1	04/17/95		710	53	NA	25 U	25 U	25 U	560	25 U	1400	1,300	29	180	540	150	2,900	3,600	120
	4/17/95 (DUP)		770	65	NA	25 U	25 U	25 U	610	25 U	1600	1,500	31	230	640	180	3,100	3,900	130
	09/04/96		1,300	50 U	200 U	50 U	50 U	50 U	220	50 U	700	1,300	100 U	50 U	180	50 U	1,600	4,400	82
	12/10/96		1,400 J	67 J	210 J	1.5 J	0.5 U	7.7 J	120 J	5.1 J	2700 J	1,600 J	9 JB	31 J	1,200 J	62 J	3,500 J	6,300 J	91 J
	03/04/97		640 J	24 J	210 EJ	1.2 J	0.5 UJ	5.3 J	73 J	2.1 J	1000 J	1,600 J	5 JB	66 J	420 J	68 J	4,700 J	7,100 J	80 J
	06/27/97		900	21	200	5 U	5 U	8.0	200	5 U	860	2,000	10 U	34	290	26	3,000	7,400	120
	09/04/97		790	7.6	2 U	0.5 U	0.5 U	7.5	150	0.9	350	1,500	2.9	12	74	12	1,500	4,200	52
	12/04/97		540 J	27 J	97 J	0.8 J	0.5 UJ	4.5 J	31 J	2.4 J	320 J	1,800 J	3 JB	22 J	250 J	20 J	4,700 J	7,000 J	38 J
	03/06/98		420	9	110	5 U	5 U	8.0	320	5 U	340	1,500	10 U	10	160	7	1,600	4,400	50
	3/6/98 (DUP)		400	10	120	5 U	5 U	8.0	380	5 U	400	1,500	10 U	8	190	8	1,500	4,300	56
	06/18/98		420	16	190	10 U	10 U	10 U	120	10 U	450	1,700	20 U	14	400	10	2,900	6,700	120
	09/29/98		330 J	2 UJ	81 J	2 UJ	2 UJ	7 J	300 J	2 UJ	94 J	1,800 J	5 UJ	2 UJ	46 J	2 J	1,400 J	5,400 J	14 J
	12/15/98		330	14	110	5 U	5 U	6	190	5 U	390	1,600	10 U	6	270	6	2,000	4,600	54
	03/02/99		320	11	94	5 U	5 U	5	390	5 U	490	1,700	10 U	6	220	7	1,600 B	5,970	73
	06/17/99		230	50 U	200 U	50 U	50 U	50 U	140	50 U	400	1,400	500 U	50 U	270	50 U	2,500	6,000	180
	09/17/99		250	6.4	110	0.2 U	0.2 U	4 E	200	0.2 U	210	1,400	0.3 U	7.8 B	240	8.9	1,500	4,100	88
	12/08/99		310	12 U	130	12 U	12 U	12 U	79 J	12 U	330	1,300 J	25 U	12 UJ	240	12 UJ	860 J	5,500 J	110
	03/07/00		310	17	220	2 U	2 U	2 U	22	2 U	1,100	970	5 U	14	300	17	1,100	4,310	450
	06/21/00		290	9 J	260	6 U	7 U	6 U	32	5 U	380	860	50 J	10 J	390	10 J	1,300	3,700	290
	6/21/00 (DUP)		210	7 J	170	3 U	4 U	3 U	58	3 U	340	860	20 J	10 J	310	10 J	1,300	3,420	290
	09/12/00		190	5	91	1 U	1 U	3	110	2	170	1,100	5 U	4	180	8	980	3,730	61
	12/07/00		310	20 J	130	6 U	7 U	6 U	42 J	9 J	390	830	10 U	10 J	270	10 J	630	3,290	100
	12/7/00 (DUP)		260	10 J	120	6 U	7 U	6 U	76 J	8 J	300	890	10 U	10 J	250	9 J	480	3,330	79
	03/15/01		350 J	27	190	2 U	2 U	2 U	13	31	500	690	12	14 J	480 J	23	290	2,890	110 J
	3/15/01 (DUP)		450	35	230	2 U	2 U	2 U	13	43	620	740	13	20	610	27	320	2,830	150
	07/12/01		370	16	120	2.9 U	3.1 U	2.7 U	12 J	21	290	480	9.5 J	8.8 J	610	31	130	1,930	210
	09/25/01		790	23	NA	5 U	5 U	5 U	17	18	460	480	10	16	480	41	320	1,970	240
	01/02/02		660	30	130	0.57 U	0.62 U	0.5 U	27	22	690	570	2.2 J	9.1	510	22	270	2,300	300
	03/28/02		540	25	160	0.57 U	0.62 U	0.75 J	18	28	800	690	2.8 J	14	510	25	240	2,620	390
	06/11/02		250	5.5	160	0.57 U	0.62 U	1 U	12	10	240	500	1.0 J	6.4	230	7.8	170	1,570	270
	09/18/02		130	2.3 J	70	0.57 U	0.62 U	2.0 J	81	1.7 J	100	880	2.5 J	3.8	44	7.2	58	2,840	35
	12/17/02		560	22	130	1.3 U	1.30 U	1.3 U	7.8	4.3 B	340	520	5 U	10	600	25	80	1,030	100
	03/20/03		490	16	110	0.5 U	0.5 U	0.5 U	7.5	3.2	160	380	2 U	7.3	440	15	69	940	120
	06/11/03		270	5.4	120	0.12 U	0.13 U	0.35 J	4.4	1.3	64	330	1.0 J	4.2	260	6.7	200	730	60
	09/11/03		610	12	93	0.23 U	0.25 U	0.82 JB	19	1.3	170	510	2.9 J	5	290	15	1,200	1,480	71
	12/04/03		1,300	36	120	2.0	0.31 U	0.8 J	38	9	390	370	8.6	7.6	1,200	29	360	1,170	140
	03/16/04		410	11	110	2.1	0.5 U	0.56 J	14	5.3	66	390	5.4 J	5.8	370	13	520	1,590	50
	09/23/04		790	15	60	1.1 J	0.31 U	0.90 J	31	1.7	200	320	3.7 J	4.2	410	16	850	1,440	60
	04/05/05		350	12	45	0.85 J	0.7 U	0.85 J	22	50	120	290	11	7.4	540	23	1,500	900	26
	09/21/05		590	6.3	33	0.25 J	0.14 U	0.86	30	3.4	65	260	2.2	2.1	130	8	1,100	1,100	24
03/15/06		580	6.5	60	0.35 J	0.35 U	0.73 J	44	8.5	55	300	9.6	3.9	240	15	710	1,680	24	
09/14/06		830	6.4	37	0.33 J	0.35 U	0.78 J	71	8.0	49	200	5.6	3.1	160	7.6	62	1,590	21	
04/04/07		240	4.9	47	0.57 U	0.7 U	0.68 U	17	8.9	44	400	6.6 J	3.6	210	9.3	69	2,080	12	
09/25/07		300	4.4	34	0.57 U	0.7 U	1.0 J	100	3.3	49	290	3.5 J	2.7	150	8.9	1,500	1,360	8.5	
09/25/07		300	4.4	34	0.57 U	0.7 U	1.0 J	100	3.3	49	290	3.5 J	2.7	150	8.9	1,500	1,360	8.5	
05/02/08		250	6.3	29	0.11 J	0.042 U	0.65	25	5.3	48	180	3.5	3.0	220	8.7	290	1,010	12	
09/30/08		320	4.3	27	0.19 U	0.11 U	0.63 J	60	2.7	37	170	3.4 J	2.3	130	7.1	300	910	10	
03/25/09		240	4.0	27	0.50 U	0.50 U	3.2	60	4.0	22	140	0.5 U	3.8	109	7.1	43	740	10	
09/30/09		500	12	14	5.0 U	5.0 U	5.0 U	86	4.5 J	38	180	5.0 U	1.7 J	190	5.6 J	610	1,400	14	
03/29/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	9.6 J	20 U	15	48	0.5 U	0.5 U	63	7.8 J	27	170	4.4	
09/30/10		339	0.5 U	18.1	0.5 U	0.5 U	0.5 U	46.5	1.0 U	28.3	70.2	1.41 J	0.5 U	173	3.16	144	301	9.51	
03/03/11		168	4.52	20.5	0.5 U	0.5 U	0.5 U	18.9	1.0	23.6	43.8	0.5 U	2.18	211	5.82	140	416	3.10	
09/23/11		138	1.96	16.0	0.5 U	0.5 U	0.700	174	1.0 U	13.5	124	1.20	0.830	38.5	3.44	1,620	949	5.74	
03/08/12		132	2.41	15.8	0.500 U	0.500 U	0.500 U	54.7	1.00 U	20.4	47.0	0.860	1.35	80.7	2.29	248	668	10.1	
10/1/12 (DUP)		88.0	0.720	23.8	0.500 U	0.500 U	0.500 U	82.0	1.00 U	15.0	19.1	0.760	0.630 J	13.4	2.94	198	461	6.10	
10/01/12		83.0	0.790	24.7	0.500 U	0.500 U	0.500 U	89.5	1.00 U	14.3	19.2	0.900	0.640 J	13.1	2.80	194	443	5.78	
03/06/13		252	2.26	22.5	0.5 U	0.5 U	0.540	79.8	1.00 U	25.2	46.6	2.08	1.13	49.4	1.86	186	556	22.3 J	
09/25/13		132	0.900	28.3	0.500 U	0.500 U	0.750	145	1.00 U	21.5	42.1	1.58	0.780	16.2	3.34	362	629	18.7	
03/26/14		303	4.02	25.2	0.500 U	0.500 U	0.761	228	1.00 U	45.2	43.2	1.23	1.11	65.2	3.02	183	323	67.1	
09/23/14		95.0	0.500 U	20.8	0.500 U	0.500 U	0.500 U	225	1.00 U	10.1	25.9	0.893	1.41	7.45	2.75	448	285.1	13.4	
03/17/15		36.9	2.500 U	24.5	1.300 U	1.300 U	1.300 U	80.3	2.50 U	1.4 J	38.1	13 U	1.3 U	3.7	0.95 J	32.7	129.8	1.1 J	
09/16/15		51.7	1.000 U	18.1	0.500 U	0.500 U	0.520	212	1.00 U	5.2	16.9	5 U	0.76	11.1	2.3	175	214.5	7	
MW-2	04/17/95		5 U	5 U	NA	5 U	5 U	5 U	10 U	9									

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-2 (continued)	06/27/97		1.0	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	7.2	0.5 U	1.0 U	1.9	0.5 U	2.1	0.5 U	0.5 U	0.5 U	
	09/04/97		0.8	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.1	0.5 U	1.0 U	0.5 U	0.5 U	0.5	0.5 U	0.5 U	0.5 U	
	12/04/97		0.6	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.8	0.5 U	1.0 U	0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	03/06/98		0.8	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	5.9	0.5 U	1.0 U	2.5	0.5 U	2.8	0.5 U	0.5 U	0.5 U	
	06/18/98		0.9	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.8	0.5 U	1.0 U	1.8	0.5 U	2.0	0.5 U	0.5 U	0.5 U	
	09/29/98		1.1	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	2.9	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	12/15/98		1.0	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	5.7	0.5 U	1.0 U	0.7	0.5 U	1.7	0.5 U	0.5 U	0.5 U	
	03/02/99		0.9	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	8.5	0.5 U	1.0 U	2.2	0.5 U	1.5	0.5 U	0.5 U	0.5 U	
	06/16/99		0.6	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.3	0.5 U	5.0 U	3.4	0.5 U	1.5	0.5 U	0.5 U	0.5 U	
	6/16/99 (DUP)		0.7	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.4	0.5 U	5.0 U	2.8	0.5 U	1.4	0.5 U	0.5 U	0.5 U	
	09/16/99		0.9	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	2.5	0.2 U	0.3 U	0.3 EB	0.3 U	0.3 U	0.2 U	0.4 U	0.3 U	
	12/08/99		0.9	0.2 U	2 U	0.5 U	0.5 U	0.5 U	0.2 U	0.2 U	4.4	0.5 U	1.0 U	0.5 U	0.5 U	1.1	0.5 U	0.5 U	0.5 U	
	03/07/00		0.8	0.2 U	2 U	0.5 U	0.5 U	0.5 U	0.2 U	0.2 U	3.6	0.5 U	1.0 U	3.7	0.5 U	1.2	0.5 U	0.5 U	0.5 U	
	06/21/00		0.67	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	3.3	0.1 U	0.2 U	3.2	0.2 U	2.4	0.1 U	0.2 U	0.3 U	
	09/12/00		1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	5.00 U	1.0 U	1.0 U	1.0 U	1.0 U	3.0 U	1.0 U	
	12/07/00		1.1	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	1.5	0.1 U	0.2 U	0.2 U	0.2 U	0.1 J	0.2 U	0.2 U	0.4 J	
	03/15/01		1.2 J	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.1 U	1.3	0.1 U	0.20 J	1.0 J	0.2 U	0.5 J	0.2 U	0.2 U	0.68	
	07/12/01		1.0	0.12 U	0.15 U	0.12 U	0.1 U	0.11 U	0.18 U	0.096 U	2.0	0.098 U	0.20 U	0.1 U	0.12 U	0.14 J	0.13 J	0.19 U	0.44 J	
	09/25/01		2.1	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.57	0.5 U	2.1	0.75	
	01/03/02		1.1	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.7	0.098 U	0.20 U	1.5	0.12 U	0.57	0.12 U	0.19 U	1.0	
	03/28/02		1.0	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.8	0.13 U	0.20 U	1.7	0.12 U	1.0	0.1 U	0.22 U	0.79	
	06/14/02		0.71	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.5	0.13 U	0.20 U	1.5	0.12 U	1.1	0.1 U	0.22 U	0.59	
	09/18/02		1.2	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.3	0.13 U	0.20 U	0.1 U	0.12 U	0.12 U	0.1 U	0.22 U	0.79	
	12/16/02		1.2	0.50 U	2.0 U	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	1.1	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.50 U	1.4	
	03/20/03		0.86	0.50 U	2.0 U	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	1.0	0.5 U	2.0 U	0.6	0.5 U	0.5 U	0.5 U	0.50 U	1.0	
	06/11/03		0.88	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.1	0.13 U	0.2 U	0.1 U	0.12 U	0.22 J	0.8 B	0.22 U	1.2	
	09/10/03		1.3	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.75	0.13 U	0.2 U	0.1 U	0.12 U	0.3 B	0.22 U	0.69	0.69	
	12/05/03		1.0	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.5	0.13 U	0.2 U	0.1 U	0.12 U	0.13 J	0.1 U	0.22 U	0.89	
	03/16/04		0.7	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.3	0.13 U	0.2 U	2.2	0.12 U	0.59	0.1 J	0.22 U	0.75	
	09/24/04		0.79	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.61	0.13 U	0.2 U	0.1 U	0.12 U	0.16 J	0.1 U	0.22 U	0.8	
	04/05/05		0.8	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.82	0.13 U	0.2 U	1.0	0.12 U	0.32 J	0.2 J	0.22 U	0.71	
	09/21/05		0.79	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.57	0.13 U	0.2 U	0.1 U	0.12 U	0.24 J	0.2 J	0.22 U	0.77	
	03/15/06		0.27 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.93	0.13 U	0.2 U	4.4	0.12 U	0.97	0.1 U	0.22 U	0.37 J	
	09/13/06		0.98	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	1.2	0.13 U	0.2 U	0.1 U	0.12 U	0.14 U	0.1 U	0.22 U	0.60	
	04/04/07		0.2 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	1.1	0.13 U	0.2 U	3.9	0.12 U	0.77	0.1 U	0.22 U	0.22 J	
	09/26/07		0.86	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.8	0.13 U	0.2 U	0.1 U	0.12 U	0.14 U	0.1 U	0.22 U	0.37 J	
	05/02/08		0.65	0.10 U	0.04 U	0.073 U	0.042 U	0.042 U	0.13 U	0.042 U	0.55	0.042 U	0.23 U	0.36 J	0.05 U	0.18 J	0.2 JB	0.16 J	0.51	
	09/29/08		0.61	0.10 U	0.04 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.71	0.042 U	0.23 U	0.1 U	0.05 U	0.10 J	0.2 JB	0.13 J	0.44 J	
	03/26/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	
	09/29/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.6 J	
	03/29/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	
	3/29/10 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.6	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	
09/30/10		0.61	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.07	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U		
03/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.690	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U		
09/21/11		0.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.920	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U		
03/06/12		0.520	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.640	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.290	
09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.50 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U		
03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.50 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U		
09/26/13		0.590	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.786	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
09/24/14		0.517	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.528	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/17/15		0.36 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.72 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U		
09/17/15		0.47 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.37 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U		
MW-3	04/17/95		230	5 U	NA U	5.0 U	5.0 U	5.0 U	30	5.0 U	42	5.0 U	5 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	10 U	
	09/04/96		330	5 U	20 U	5.0 U	5.0 U	5.0 U	9	5.0 U	56	5.0 U	10 U	5.0 U	5.0 U	5.0	5.0	5.0 U	5 U	
	9/4/96 (DUP)		460	5 U	20 U	5.0 U	5.0 U	5.0 U	13	5.0 U	7.2	5.0 U	10 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5	
	12/11/96		120	0.5 U	2 U	0.5 U	0.5 U	0.5	4	0.5 U	9.7	0.5 U	2 B	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	
	03/04/97		73	0.5 U	2 U	0.5 U	0.5 U	0.5	4.5	0.5 U										

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5,100,000	3,350,000	LNAPL	8,690,000		LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	1,600	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600
MW-3 (continued)	09/17/99		97 J	0.2 U	0.2 U	0.2 U	0.2 U	0.4 E	0.8	0.2 U	6.5	0.2 U	0.3 U	0.2 U	0.3 U	0.3 U	0.2 U	0.4 U	0.6
	12/08/99		26	0.5 U	2 U	0.5 U	0.5 U	0.5 U	7.9	0.5 U	1.1	0.5 U	1 U	0.6 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5
	03/07/00		33	0.5 U	2 U	0.5 U	0.5 U	0.5 U	17	0.5 U	1.7	0.5 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.6
	06/21/00		24	0.2 U	0.2 U	0.2 U	0.2 U	0.5 J	0.2 U	0.1 U	1.3	0.1 U	0.2 U	0.2 U	0.2 U	0.2 U	0.1 U	0.2 U	0.4 J
	09/12/00		54	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	2	1.0 U	3.0	1.0 U	5 U	1.0 U	1.0 U	1.0 U	1.0 U	2.0 U	1 U
	9/12/00 (DUP)		61	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	2	1.0 U	3.0	1.0 U	5 U	1.0 U	1.0 U	1.0 U	1.0 U	3.0 U	1 U
	12/07/00		26	0.2 U	0.2 U	0.2 U	0.2 U	0.4 J	0.2 U	0.1 U	1.7	0.1 U	0.2 U	0.2 U	0.2 U	0.2 U	0.1 U	0.2 U	0.3 J
	03/15/01		46 J	0.2 U	0.2 U	0.2 U	0.2 U	0.4 J	0.2 U	0.1 U	2.3	0.1 U	0.2 J	0.2 U	0.2 U	0.2 U	0.2 U	0.1 J	0.6
	07/12/01		27	0.1 U	0.15 U	0.12 U	0.13 U	0.43 J	0.2 U	0.1 U	1.9	0.098 U	0.2 U	0.11 U	0.12 U	0.12 U	0.31 J	0.19 U	0.31 J
	09/24/01		37	0.5 U	NA U	0.50 U	0.50 U	0.51	0.5 U	0.5 U	3.0	0.5 U	1 U	0.5 U	0.50 U	0.50 U	0.5 U	0.59 U	0.5 U
	01/03/02		16	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.47 J	0.10 U	1.0	0.098 U	0.2 U	0.11 U	0.12 U	0.12 U	0.46 JB	0.19 U	0.25 J
	03/28/02		22	0.12 U	0.15 U	0.12 U	0.13 U	0.41 J	0.23 U	0.10 U	1.4	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.16 J	0.22 U	0.26 J
	06/14/02		19	0.12 U	0.15 U	0.12 U	0.13 U	0.35 J	0.23 U	0.10 U	1.3	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.25 J
	09/17/02		27	0.12 U	0.15 U	0.12 U	0.13 U	0.43 J	0.23 U	0.10 U	2.1	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.32 J
	12/17/02		38	0.5 U	2 U	0.5 U	0.5 U	0.5 U	18	0.5 U	0.9	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.58
	03/20/03		12	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.8	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
	06/11/03		9.5	0.12 U	0.15 U	0.12 U	0.13 U	0.41 J	0.23 U	0.096 U	0.9	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.47 JB	0.22 U	0.25 J
	09/11/03		9.9	0.12 U	0.15 U	0.12 U	0.13 U	0.41 JB	0.23 U	0.096 U	0.9	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.32 JB	0.22 U	0.27 J
	12/04/03		19	0.12 U	0.15 U	0.12 U	0.13 U	0.35 J	19	0.096 U	1.0	0.13 U	0.27 J	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.46 J
	03/15/04		16	0.12 U	0.15 U	0.12 U	0.13 U	0.48 J	0.23 U	0.096 U	1.5	0.29 J	0.20 U	0.11 U	0.12 U	0.12 U	0.17 J	2.4	0.36 J
	09/24/04		9.9	0.12 U	0.15 U	0.12 U	0.13 U	0.43 J	0.23 U	0.096 U	1.5	0.13 U	0.20 U	0.11 U	0.12 U	0.12 U	0.15 J	0.22 U	0.31 J
	04/05/05		9.1	0.13 U	0.15 U	0.12 U	0.14 U	0.33 J	0.23 U	0.14 U	0.9	0.13 U	0.20 U	0.13 U	0.12 U	0.14 U	0.82 U	0.22 U	0.29 J
	09/21/05		10	0.13 U	0.15 U	0.12 U	0.14 U	0.44 J	0.23 U	0.14 U	1.6	0.13 U	0.20 U	0.13 U	0.12 U	0.14 U	0.34 J	0.22 U	0.27 J
	03/14/06		12	0.13 U	0.15 U	0.12 U	0.14 U	0.36 J	0.23 U	0.14 U	1.2	0.13 U	0.20 U	0.13 U	0.12 U	0.14 U	0.15 J	0.22 U	0.31 J
	09/12/06		27	0.13 U	0.15 U	0.12 U	0.14 U	0.39 J	0.23 U	0.14 U	2.7	0.13 U	0.20 U	0.13 U	0.12 U	0.14 U	0.11 U	0.22 U	0.42 J
	04/03/07		7.7	0.13 U	0.15 U	0.12 U	0.14 U	0.31 J	0.23 U	0.14 U	1.0	0.13 U	0.20 U	0.13 U	0.12 U	0.14 U	0.11 U	0.22 U	0.23 J
	09/25/07		18	0.13 U	0.15 U	0.12 U	0.14 U	0.37 J	0.23 U	0.14 U	2.1	0.13 U	0.20 U	0.13 U	0.12 U	0.14 U	0.11 U	0.22 U	0.28 J
	05/01/08		4.6	0.10 U	0.037 U	0.07 U	0.04 U	0.34 J	0.13 U	0.042 U	0.8	0.042 U	0.23 U	0.077 U	0.05 U	0.06 U	0.34 JB	0.12 J	0.25 J
	10/01/08		11	0.10 U	0.037 U	0.07 U	0.04 U	0.36 J	0.13 U	0.042 U	1.8	0.042 U	0.23 U	0.077 U	0.05 U	0.06 U	0.18 JB	0.08 J	0.28 J
	03/24/09		8.7	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.1
	09/29/09		15	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.8 J
	03/30/10		16	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.3
	09/28/10		8.47	0.5 U	0.5 U	0.5 U	0.5 U	0.33 J	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ
03/07/11		9.50	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.39	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
09/21/11		7.07	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.41	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
03/06/12		5.06	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.14	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
10/01/12		7.24	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.45	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/07/13		4.75	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.03	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/27/13		3.76	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.900	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/27/14		2.51	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/25/14		5.38	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.21	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/19/15		2.2	1.0 U	2.0 U	0.50 U	0.50 U	0.25 J	1.0 U	1.0 U	0.61 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.23 J	
09/16/15		20 U	20 U	40 U	10 U	10 U	10 U	10 U	20 U	20 U	20 U	100 U	10 U	20 U	20 U	20 U	20 U	10 U	
MW-4	09/04/96		76	50 U	200 U	50 U	50 U	50 U	830	50 U	50 U	200	100 U	50 U	50 U	50 U	2,000	1,500	50 U
	12/10/96		33	0.5 U	110 E	2.6	0.5 U	38	950	0.5 U	2.1	430	7 B	0.5 U	0.5 U	0.5 U	310	340	6.1
	03/04/97		140	0.5 U	170	1.9	0.5 U	29	1,100	0.5 U	12	580	7	0.5 U	4.8	1	160	210	15.0
	06/27/97		160	0.5 U	230	1.2	0.5 U	31	2,000	0.5 U	2.8	900	9.6	0.5 U	2.6	2	62	53	6.3
	09/04/97		52	0.5 U	2 U	1.4	0.5 U	23	820	0.5 U	2.5	570	7	0.5 U	0.5 U	0.8	120	42	6.9
	9/4/97 (DUP)		47	0.5 U	510	1.5	0.5 U	22	2,100	0.5 U	0.5 U	1,300	7.1	0.5 U	0.5 U	0.7	300	110	6.5
	12/04/97		22 J	0.5 UJ	180 J	1.3 J	0.5 UJ	23 J	960 J	0.5 UJ	1.2 J	860 J	7 J	0.5 UJ	0.5 UJ	1 J	320 J	250 J	3.4 J
	03/06/98		84	1 U	220	1 U	1 U	29	1,400	1 U	4	970	10	1 U	11	1	48	140	8.0
	06/18/98		410	12 U	260	12 U	12 U	140	1,700	12 U	12 U	1,200	45	12 U	12 U	12 U	390	1,800	12 U
	09/29/98		33 J	2 U	240 J	2 U	2 U	23 J	1,000 J	2 U	2 U	780 J	8 J	2 U	2 U	2 U	1,600 J	1,300 J	2 U
	12/14/98		26	2 U	250	2 U	2 U	37	1,000	2 U	2 U	840	7	2 U	2 U	2 U	1,100	1,900	2 U
	03/03/99		72	2 U	110	2 U	2 U	18	1,300	4 U	6	790	9	2 U	2 U	2 U	8 B	13 B	8
	06/17/99		210	25 U	240	25 U	25 U	18	1,200	25 U	25 U	1,200	250 U	25 U	25 U	25 U	110	142	25 U
	09/17/99		36	0.2 U	220	0.2 U	0.2 U	25	820 J	0.2 U	1.4 E	850 J	9	0.2 U	0.3 U	0.3 U	540	1,230	0 U
	12/08/99		19	5 U	270	5 U	5 U	24	1,000 J	5 U	5 U	980 J	10 U	5 U	5 U	5 UJ	380 J	1,570 J	5 U
	12/8/99 (DUP)		20	5 U	260	5 U	5 U	23	1,100 J	5 U	5 U	970 J	10 U	5 U	5 U	5 UJ	360 J	1,560 J	5 U
	03/07/00		29	2 U	240	2 U	2 U	17	1,200	2 U	2 U	1,200	9	2 U	2 U	2 U	8	389	2 U
	3/7/00 (DUP)		28	2 U	240	2 U	2 U	17	1,200	2 U	2 U	1,200	9	2 U	2 U	2 U	8	389	2 U
06/21/00		43	3 U	230	3 U	3 U	17	980	2 U	3 U	1,100	20	3 U	3 U	3 U	58	1,040	5 U	
09/12/00		14	1.0 U	140	1.0 U	1.0 U	10	840	1.0 U	1.0 U	610	6	1.0 U	1.0 U	1.0 U	25	820	1.0	
12/07/00		10 J	6 U	230	6 U	7 U	10 J	750 J	5 U	6 U	850	10 J	6 U	6 U	6 U	32	2,540	20 U	
03/15/01		23 J	0.6 U	210	2.0 J	0.7 U	19	770	0.5 U	0.7 J	820	11	0.6 U	0.6 U	0.6 U	37	850	2.0 U	
07/12/01		43	3 U	93	2.9 U	3.1 U	14	710	2.4 U	3 U	960	16 J	2.8 U	2.8 U	3 U	5 J	370	5.3 U	

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000	0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-4 (continued)	09/25/01		27	0.5 U	27	0.71	0.5 U	6.5	340	0.5 U	0.74	230	5.9	0.5 U	0.5 U	2.1	38	3.6		
	01/02/02		25	0.6 U	55	0.57 U	0.62 U	10	570	0.48 U	1.4 J	450	7.5 J	0.55 U	0.56 U	1.2 J	5.5	164	1.6 J	
	03/28/02		87	0.6 U	65	0.57 U	0.62 U	12	810	0.48 U	2.6	700	13	0.55 U	0.57 U	2.3 J	18	184	6.2	
	06/11/02		58	0.6 U	36	0.57 U	0.62 U	12	760	0.48 U	0.58 U	630	9.2 J	1.6 J	0.57 U	1.7 J	6.7	64	1.1 U	
	09/18/02		20	0.3 U	160	0.29 U	0.31 U	11	570	0.24 U	1.1 J	690	7.6	0.28 U	0.29 U	0.70 J	11	1,640	1.9	
	12/17/02		18	1 U	150	1.0 U	1.0 U	14	500	1 U	1.0	620	6.2	1.0 U	1.0 U	1.0 U	10	1,290	3.1	
	03/20/03		13	1 U	140	1.0 U	1.0 U	16	530	1 U	1.0 U	740	5.3	1.0 U	1.0 U	1.0 U	2.3	325	1.3	
	06/11/03		24	0.3 U	120	0.58 J	0.31 U	13	530	0.24 U	1.0 J	750	7.2	0.28 U	0.29 U	0.68 J	1.8 B	114	1.5	
	09/11/03		18	0.24 U	200	0.23 U	0.25 U	13	460	0.2 U	1.1	780	6.8	0.22 U	0.23 U	0.34 J	9.3	1,990	2.3	
	12/04/03		11	0.24 U	180	0.23 U	0.25 U	27	370	0.2 U	0.56 J	800	4.2	0.22 U	0.23 U	0.32 J	11	1,787	0.7 J	
	03/15/04		15	0.12 U	160	0.12 U	0.13 U	24	420	0.096 U	0.67	730	6.2	0.11 U	0.12 U	0.48 J	5.6	702	0.59	
	09/24/04		12	0.12 U	19	0.75	0.13 U	13	270	0.096 U	0.56	350	2.6	0.11 U	0.12 U	0.31 J	0.8	11.3	0.78	
	04/04/05		10	0.25 U	170	0.86 J	0.28 U	21	400	0.28 U	0.42 J	730	3.9	0.46 J	0.24 U	0.34 J	3.6	690	0.66 J	
	09/21/05		15	0.13 U	120	0.63	0.14 U	17	230	0.14 U	0.79	270	3.1	0.13 U	0.12 U	0.29 J	2.9	328	0.58	
	03/15/06		12	0.13 U	140	0.66	0.14 U	20	300	0.14 U	0.46 J	81	3.7	0.13 U	0.12 U	0.19 J	2.1	376	0.86	
	09/14/06		10	0.13 U	120	0.59	0.14 U	12	190	0.14 U	0.51	61	2.2	0.13 U	0.12 U	0.17 J	1.4	343	1.60	
	04/04/07		7.2	0.13 U	140	0.49 J	0.14 U	17	110	0.14 U	0.25 J	22	1.3 J	0.13 U	0.12 U	0.15 J	0.78	151	0.09 J	
	09/26/07		9.0	0.13 U	120	0.85 U	0.14 U	14	85	0.14 U	0.31 J	62	0.62 J	0.13 U	0.12 U	0.18 J	2.2	38.5	0.54	
	05/02/08		4.5	0.1 U	100	0.76 U	0.042 U	13	96	0.042 U	0.13 J	18	0.61 J	0.077 U	0.05 U	0.16 U	1.1	6.9	0.1 J	
	10/01/08		7.3	0.1 U	79	0.36	0.042 U	11	140	0.042 U	0.24 J	7.8	0.82 J	0.077 U	0.05 U	0.20 J	1.1	8.1	0.29 J	
	03/25/09		4.8	0.5 U	128	0.5 U	0.5 U	11	206	1.0 U	0.5 U	4.1	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	2.2	1.0	
	3/25/09 (DUP)		4.5	0.5 U	120	0.5 U	0.5 U	11	220	1.0 U	0.5 U	3.9	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	2.7	1.0	
	09/30/09		6.1	0.5 U	210	0.5 U	0.5 U	10	450	1.0 U	0.5 U	8.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	8.0	1.1	
	03/29/10		5.9	0.5 U	140	0.5 U	0.5 U	10	130	1.0 U	0.5 U	0.7	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5	0.2	
	10/01/10		5.74	0.5 U	43.4	0.5 U	0.5 U	6.78	78.1	1.0 U	0.5 U	2.17	0.63 J	0.5 U	0.5 U	0.5 U	0.53	3.80	0.19 J	
	03/04/11		7.81	0.5 U	31.4	0.5 U	0.5 U	5.42	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.500	69.5	
	09/23/11		4.00	0.5 U	34.1	0.5 U	0.5 U	5.24	50.4	1.0 U	1.30	3.33	0.5 U	0.5 U	0.5 U	0.5 U	2.07	9.66	1.46	
	03/08/12		2.97	0.500 U	33.5	0.500 U	0.500 U	7.02	36.4	1.00 U	0.730	9.31	0.500 U	0.500 U	0.500 U	0.500 U	3.06	15.4	2.99	
	10/01/12		2.71	0.500 U	21.5	0.500 U	0.500 U	4.72	31.3	1.00 U	0.500 U	4.29	0.500 U	0.500 U	0.500 U	0.500 U	2.23	8.54	2.19	
	03/06/13		4.42	0.5 U	7.49	0.5 U	0.5 U	6.43	0.5 U	1.0 U	0.5 U	4.33	1.15	0.5 U	0.5 U	0.5 U	0.670	1.39	0.200 U	
	09/26/13		3.58	0.500 U	2.89	0.500 U	0.500 U	7.77	24.4 J	1.00 U	0.500 U	2.34	0.500 U	0.500 U	0.500 U	0.500 U	1.78	8.00	0.200 U	
	03/25/14		5.84	0.500 U	1.66	0.500 U	0.500 U	5.66	165	1.00 U	0.500 U	0.524	0.500 U	0.500 U	0.500 U	0.500 U	0.781	1.11	0.200 U	
	09/23/14		1.72	0.500 U	3.56	0.500 U	0.500 U	6.35	45.5	1.00 U	0.519	1.75	0.500 U	0.500 U	0.500 U	0.500 U	4.06	6.80	0.200 U	
	03/17/15		0.64 J	1.0 U	1.2 J	0.50 U	0.50 U	5.4	58.5	1.0 U	1.0 U	0.25 J	5.0 U	0.50 U	1.0 U	1.0 U	0.44 J	1.01 J	0.50 U	
	09/17/15		1.0 U	1.0 U	0.99 J	0.50 U	0.50 U	6.2	45.5	1.0 U	1.0 U	0.38 J	5.0 U	0.50 U	1.0 U	1.0 U	0.74 J	5.2	0.21 J	
	MW-5	09/04/96		25 U	25 U	100 U	25 U	25 U	25 U	25 U	25 U	34	25 U	50 U	2,600	25 U	180	25 U	25 U	25 U
12/10/96			0.7	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.9	28	1.0	1 U	3,400	3.4	130	1.3 B	1.6 B	0.5 U	
12/10/96 (DUP)			0.8	0.6	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.9	34	0.5 U	1 U	3,300	3.4	130	0.5 U	0.5 U	0.5 U	
03/04/97			0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	21	0.5 U	1 U	3,100	3.1	100	0.5 U	0.5 U	0.5 U	
06/27/97			5 UJ	5 UJ	20 UJ	5 UJ	5 UJ	5 UJ	5.0 UJ	5 UJ	32	5 UJ	10 UJ	4,700 J	5 UJ	140 J	5 UJ	5 UJ	5.0 UJ	
09/04/97			0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	30	0.9	1 U	4,800	3.2	150	0.5 U	0.9	0.5 U	
12/04/97			0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.6	18	1 U	1 U	4,400	3	120	0.5 U	0.5 U	0.5 U	
03/06/98			5 U	5 U	20 U	5 U	5 U	5 U	5.0 U	5 U	30	5 U	10 U	4,000	5 U	140	5 U	5 U	5.0 U	
06/18/98			12 U	12 U	50 U	12 U	12 U	12 U	12 U	12 U	28	12 U	25 U	4,100	12 U	130	12 U	12 U	12 U	
09/29/98			10 U	10 U	40 U	10 U	10 U	10 U	10 U	10 U	25	10 U	20 U	3,800	10 U	130	10 U	10 U	10 U	
12/15/98			5 U	5 U	20 U	5 U	5 U	5 U	5.0 U	5 U	34	5 U	10 U	3,300	5 U	120	5 U	5 U	7	
03/02/99			12 U	12 U	50 U	12 U	12 U	12 U	12 U	12 U	14	12 U	25 U	4,400	12 U	96	12 U	24 U	12 U	
06/16/99			10 U	10 U	40 U	10 U	10 U	10 U	10 U	10 U	12	10 U	100 U	3,400	10 U	110	10 U	10 U	10 U	
09/16/99			0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.3 U	0.2 U	0.3 U	3,000	0.3 U	120	0.2 U	0.4 U	0.3 U	
9/16/99 (DUP)			0.2 U	0.3 E	0.2 U	0.3 E	0.2 U	0.2 U	0.2 U	0.2 U	0.4 E	15	0.2 U	0.3 U	2,500	1.6	94	0.2 U	0.4 U	0.3 U
12/08/99			0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 UJ	0.5 UJ	23	0.5 U	1 U	2,600 J	1.2	120 J	0.5 U	0.5 U	0.5 U	
03/07/00			0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	17	0.5 U	1 U	2,700	1.3	94	0.5 U	0.5 U	0.5 U	
06/21/00			5 U	6 U	8 U	6 U	7 U	6 U	9 U	5 U	6 J	5 U	30 J	2,900	6 U	92	5 U	14 U	20 U	
09/12/00			1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	11	1.0 U	5 U	2,500	1.0	99	1.0 U	3 U	1.0 U	
12/07/00			5 U	6 U	8 U	6 U	7 U	6 U	9 U	5 U	10 J	5 U	10 U	2,600	6 U	88	5 U	14 U	20 U	
03/15/01			1 U	2 U	2 U	2 U	2 U	2 U	2 U	1 U	8.2	3 J	5 J	2,300 J	2 U	87	1.0 U	2 J	3 U	
07/12/01			0.91 U	1.2 U	1.5 U	1.2 U	1.3 U	1.1 U	1.8 U	0.96 U	5.4	0.98 U	2 U	2,800	1.2 U	84	0.98 U	1.9 U	2.2 U	
08/27/01			5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	7.4	5 U	10 U	1,800	5 U	68	5 U	5 U	5 U	
09/24/01			5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	5 U	5 U	10 U	1,800	5 U	74	5 U	5 U	5 U	
10/22/01			5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	7.1	5 U	10 U	1,600	5 U	76	5 U	5 U	5 U	
11/19/01			5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	12	5 U	10 U	2,000	5 U	75	5 U	5 U	5 U	
01/02/02																				

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-5 (continued)	09/11/03		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	1.5 J	0.65 U	0.97 U	2,400	0.57 U	86	0.49 U	1.1 U	1.1 U	
	12/05/03		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	5	0.65 U	0.97 U	1,600	0.57 U	76	0.49 U	1.1 U	1.1 U	
	03/16/04		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	0.8 J	0.65 U	0.97 U	1,700	0.7 J	47	0.49 U	1.1 U	1.1 U	
	09/22/04		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	1.2 J	0.65 U	0.97 U	2,200	0.85 J	57	0.49 U	1.1 U	1.1 U	
	04/04/05		0.26 U	0.31 U	0.36 U	0.29 U	0.35 U	0.34 U	0.57 U	0.34 U	1.5	0.33 U	0.49 U	1,300	0.43 J	45	0.28 J	0.55 U	0.53 U	
	09/20/05		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	2.0	0.13 U	0.2 U	1,300	0.53	48	0.32 J	0.22 U	0.042 U	
	03/14/06		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	3.1	0.65 U	0.97 U	1,300	0.58 U	47	0.54 U	1.1 U	0.21 U	
	09/13/06		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	3.6	0.65 U	0.97 U	1,600	0.58 U	59	0.54 U	1.1 U	0.21 U	
	04/05/07		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	4.5	0.65 U	1.2 J	1,200	0.58 U	43	0.54 U	1.1 U	0.21 U	
	09/26/07		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	6.7	0.65 U	0.97 U	1,300	0.58 U	49	0.54 U	1.1 U	0.21 U	
	05/01/08		0.11 U	0.28 J	0.093 U	0.19 U	0.11 U	0.12 U	0.3 U	0.11 U	6.1	0.11 U	0.58 U	990	0.28 J	37	0.13 JB	0.2 U	0.18 U	
	09/30/08		0.21 U	0.5 U	0.19 U	0.37 U	0.21 U	0.23 U	0.65 U	0.21 U	8.1	0.21 U	1.2 U	1,500	0.25 J	46	0.25 JB	0.39 U	0.36 U	
	03/25/09		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	5.4 J	10 U	10 U	1,200	10 U	27	10 U	10 U	4.0 U	
	09/29/09		5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	10 U	4.6 J	5.0 U	5.0 U	850	5.0 U	31 J	5.0 U	5.0 U	2.0 U	
	9/29/09 (DUP)		5.0 UJ	5.0 UJ	5.0 U	5.0 UJ	5.0 UJ	5.0 UJ	5.0 UJ	10 UJ	6.0 J	5.0 UJ	5.0 UJ	900	5.0 UJ	48 J	5.0 UJ	5.0 UJ	2.0 UJ	
	04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	3.9	0.5 U	0.5 U	340	0.5 U	42	0.5 U	0.5 U	0.2 U	
	4/1/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	270	0.5 U	0.5 U	270	0.5 U	44	0.5 U	0.5 U	0.2 U	
	04/09/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10 U	10 U	10 U	1,100	10 U	35	10 U	10 U	4.0 U	
	04/16/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	5.0 J	10 U	10 U	780	10 U	42	10 U	10 U	4.0 U	
	05/06/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	3.2 J	10 U	10 U	640	10 U	36	10 U	10 U	2.0 U	
	06/09/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	3.2	0.5 U	0.5 U	670	0.5 U	33	0.5 U	0.5 U	0.2 U	
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	4.6	0.5 U	0.5 U	640	0.5 U	31	0.5 U	0.5 U	0.2 U	
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	4.6	0.5 U	0.5 U	640	0.5 U	31	0.5 U	0.5 U	0.2 U	
	09/28/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	5.0 U	10 U	10 U	514	10 U	22.6	10 U	10 U	2.0 UJ	
	9/28/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.43	0.5 U	0.5 U	514	0.5 U	21.7	0.5 U	0.5 U	0.2 UJ	
	03/03/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.12	0.5 U	0.5 U	607	0.5 U	30.2	0.5 U	0.550	0.2 U	
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.31	0.5 U	0.5 U	386	0.5 U	16.3	0.5 U	0.5 U	0.2 U	
	09/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	7.28	0.5 U	0.5 U	682 J	0.5 U	30.2	0.5 U	0.5 U	0.590	
	12/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	4.11	0.5 U	0.5 U	831	0.5 U	30.7	0.5 U	0.5 U	0.470	
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	51.6	0.500 U	0.500 U	326	0.500 U	27.0	0.500 U	0.500 U	0.810	
	06/26/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	50.0	0.500 U	0.500 U	316	0.500 U	37.9	0.500 U	0.500 U	1.40	
	09/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	96.0	0.500 U	0.500 U	479	0.500 U	62.0	0.500 U	0.500 U	1.55	
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	53.0	0.500 U	0.500 U	18.4	0.500 U	5.22	0.500 U	0.500 U	3.35	
	03/06/13		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	286	0.5 U	0.5 U	106	0.5 U	55.4	0.500 U	0.5 U	4.57 J	
	3/6/13 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	293	0.5 U	0.5 U	105	0.5 U	54.9	0.950	0.5 U	3.30 J	
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	291	0.500 U	0.500 U	205	0.500 U	105	0.500 U	0.500 U	3.69	
	09/26/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	209	0.500 U	0.500 U	297	0.500 U	273	0.500 U	0.500 U	2.67	
	9/26/13 (DUP)		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	203	0.500 U	0.500 U	330	0.500 U	251	0.500 U	1.27	2.12	
03/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	453	0.500 U	0.500 U	86.8	0.500 U	14.9	0.500 U	0.500 U	10.1		
09/23/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	392	0.500 U	0.500 U	217	0.500 U	32.5	0.500 U	0.500 U	5.50		
03/16/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	5.0 U	5.0 U	256	5.0 U	25 U	60.2	5.0 U	35.8	5.0 U	5.0 U	1.9 J		
09/15/15		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	35.4	10 U	50 U	335	10 U	37.0	10 U	10 U	5.0 U		
MW-6	09/04/96		12	0.5 U	2 U	3.2	0.5 U	1.7	460	0.5 U	0.6	0.5 U	2 B	0.5 U	0.5 U	31	0.5 U	0.5 U		
	12/10/96		13	0.5 U	2 U	2.1	0.5 U	1.2	240	0.5 U	0.7	0.5 U	1 B	1 U	0.5 U	26	0.5 U	0.5 U		
	03/04/97		12	0.5 U	2 U	1.4	0.5 U	0.7	190 J	0.5 U	0.5	0.5 U	1 U	1 U	0.5 U	5.0	0.5 U	0.5 U		
	06/27/97		13	0.5 U	2 U	2.2	0.5 U	1.2	370	0.5 U	0.9	0.5 U	1 U	1 U	0.5 U	7.3	0.5 U	0.5 U		
	09/04/97		9.5	0.5 U	2 U	2.4	0.5 U	1.6	320	0.5 U	0.5 U	0.5 U	1 U	2.7	0.5 U	13	0.5	0.5 U		
	12/04/97		9.1	0.5 U	2 U	1.4	0.5 U	0.7	180	0.5 U	0.6	0.5 U	1 U	0.5 U	0.5 U	4.9	0.5 U	0.5 U		
	03/06/98		11	0.5 U	2 U	1.8	0.5 U	1.1 B	150	0.5 U	0.6	0.5 U	2.5 B	0.5 U	0.5 U	9.4 B	0.5 U	0.5 U		
	06/18/98		12	0.5 U	2 U	2.6	0.5 U	1.7 B	190	0.5 U	0.8	0.5 U	1 U	0.5 U	0.5 U	11 B	0.5 U	0.5 U		
	09/29/98		10	0.5 U	2 U	2.1	0.5 U	1.5	190 E	0.5 U	0.7	0.5 U	1 U	0.5 U	0.5 U	8.9	0.5 U	0.5 U		
	12/15/98		9.9	0.5 U	2 U	0.9	0.5 U	0.5 U	110	0.5 U	0.6	0.5 U	1 U	0.5 U	0.5 U	3.7 B	0.5 U	0.5 U		
	03/02/99		10	0.5 U	2 U	0.9	0.5 U	0.5 U	180	0.5 U	0.6	0.5 U	1 U	0.5 U	0.5 U	3.2 B	0.5 U	0.5 U		
	3/2/99 (DUP)		9.5	0.5 U	2 U	0.8	0.5 U	0.5 U	170	0.5 U	0.6	0.5 U	1 U	0.5 U	0.5 U	3.1 B	0.5 U	0.5 U		
	06/16/99		7.4	0.5 U	2 U	0.5 U	0.9	0.5 B	100	0.5 U	0.5	0.5 U	5 U	0.5 U	0.5 U	2.3 B	0.5 U	0.5 U		
	09/16/99		7.5	0.2 U	0.2 U	0.8	0.2 U	0.5 E	81	0.2 U	0.5	0.2 U	0.3 U	0.2 U	0.3 U	2.3 E	0.4 U	0.3 U		
	12/08/99		7.2	0.5 U	2 U	0.7	0.5 U	0.50 U	73 J	0.5 U	0.6	0.5 U	1 U	0.5 U	0.5 U	1.5	0.5 U	0.5 U		
	03/07/00		6.9	0.5 U	2 U	0.8	0.5 U	0.5 U	72	0.5 U	0.5	0.5 U	1 U	0.5 U	0.5 U	1.8	0.5 U	0.5 U		
	06/21/00		6.6	0.2 U	0.2 U	0.4 J	0.2 U	0.2 U	29	0.1 U	0.3 J	0.78	0.2 U	2.6	0.2 U	0.3 J	0.7	0.7 J	0.3 U	
	09/12/00		5	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	53											

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-6 (continued)	06/14/02		3.4	0.12 U	0.15 U	0.15 J	0.13 U	0.11 U	11	0.096 U	0.22 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	0.37 J	0.22 U	0.22 U
	09/18/02		4.9	0.12 U	0.15 U	0.52	0.13 U	0.50	36	0.096 U	0.4 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	1.2	0.22 U	0.22 U
	12/16/02		4.6	0.5 U	2.0 U	0.76	0.5 U	0.58	51	0.5 U	0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	0.5 U	0.5 U
	03/20/03		3.4	0.5 U	2.0 U	0.5 U	0.5 U	0.50 U	31	0.5 U	0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.6	0.5 U	0.5 U
	06/11/03		2.7	0.12 U	0.12 U	0.12 U	0.13 U	0.11 U	0.72	0.096 U	0.13 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	0.8 B	0.22 U	0.22 U
	09/10/03		3.4	0.12 U	0.15 U	0.12 U	0.13 U	0.20 JB	4.9	0.096 U	0.2 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	0.59 B	0.22 U	0.22 U
	12/04/03		3.2	0.12 U	0.15 U	0.34 J	0.13 U	0.23 J	13	0.096 U	0.26 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	0.45 J	0.22 U	0.22 U
	03/16/04		1.5	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	2.2	0.096 U	0.13 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	0.16 J	0.22 U	0.22 U
	09/23/04		3.6	0.12 U	0.15 U	0.57	0.13 U	0.31 J	19	0.096 U	0.34 J	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.12 U	0.73	0.22 U	0.22 U
	04/05/05		1.3	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.72	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.40 J	0.22 U	0.22 U
	09/21/05		3.8	0.13 U	0.15 U	0.44 J	0.14 U	0.31 J	12	0.14 U	0.31 J	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.54	0.22 U	0.042 U
	03/14/06		0.74	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.13 J	0.22 U	0.042 U
	3/14/06 (DUP)		0.73	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.042 U
	09/13/06		3.3	0.13 U	0.15 U	0.46 J	0.14 U	0.27 J	10	0.14 U	0.31 J	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.17 J	0.22 U	0.042 U
	04/05/07		0.39 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.15 J	0.11 U	0.22 U	0.042 U	
	09/26/07		2.4	0.13 U	0.15 U	0.25 J	0.14 U	0.21 J	1.3	0.14 U	0.23 J	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.14 J	0.22 U	0.042 U
	05/02/08		0.34 J	0.1 U	0.037 U	0.073 U	0.042 U	0.05 J	0.13 U	0.042 U	0.1 J	0.042 U	0.23 U	0.077 U	0.05 U	0.061 U	0.11 JB	0.078 U	0.071 U	
	09/30/08		1.8	0.1 U	0.037 U	0.21 J	0.042 U	0.2 J	1.3	0.042 U	0.19 J	0.05 J	0.23 U	0.077 U	0.05 U	0.07 J	0.32 JB	0.21 J	0.071 U	
	03/26/09		1.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/29/09		3.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	6.2	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/30/10		0.6	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 J	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/30/10		1.51	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.87	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/21/11		1.15	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/28/12		1.74	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
09/27/13		1.59	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/24/14		1.46	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
09/17/15		1.4	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
MW-7	12/22/97		0.5 U	0.5 U	2 U	0.5 U	2.0	0.5 U	0.5 U	0.9 U	0.5 U	0.5 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	03/06/98		0.5 U	0.5 U	2 U	0.5 U	1.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	2.4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	06/18/98		0.5 U	0.5 U	2 U	0.5 U	1.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	4.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	6/18/98 (DUP)		0.5 U	0.5 U	2 U	0.5 U	1.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	4.4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	09/29/98		0.5 U	0.5 U	2 U	0.5 U	1.1	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1.7	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	12/14/98		0.5 U	0.5 U	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	03/03/99		0.5 U	0.5 U	2 U	0.5 U	2.1	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	3.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	06/17/99		0.5 U	0.5 U	2 U	0.5 U	0.6	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	5 U	4.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	09/17/99		0.2 U	0.2 U	0.2 U	0.2 U	0.9	0.2 U	0.2 U	0.2 U	0.3 U	0.2 E	0.3 U	2	0.3 U	0.3 U	0.2 EB	0.4 U	0.3 U	
	12/08/99		0.5 U	0.5 U	2 U	0.5 U	2.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	14	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	03/07/00		0.5 U	0.5 U	2 U	0.5 U	2.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1.4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	06/21/00		0.1 J	0.2 U	0.2 U	0.2 U	0.3 J	0.2 U	0.82	0.1 U	0.2 U	0.58	0.2 U	9	0.2 U	0.2 U	0.1 U	0.4 J	0.3 U	
	09/12/00		1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	5 U	5	1.0 U	1.0 U	1.0 U	3 U	1.0 U	
	12/07/00		0.1 U	0.2 U	0.2 U	0.2 U	1.7	0.2 U	0.2 U	0.1 U	0.09 U	0.1 U	0.2 U	0.82	0.2 U	0.2 U	0.1 U	0.2 U	0.3 U	
	03/15/01		0.1 U	0.2 U	0.2 U	0.2 U	0.91	0.2 U	0.2 U	0.1 U	0.09 U	0.1 U	0.2 U	2.1	0.2 U	0.2 U	0.1 J	0.2 U	0.3 U	
	07/12/01		0.091 U	0.12 U	0.15 U	0.12 U	0.28 J	0.11 U	0.18 U	0.096 U	0.12 U	0.098 U	0.2 U	4.9	0.12 U	0.12 U	0.11 J	0.19 U	0.22 U	
	08/27/01		0.5 U	0.5 U	2.0 U	0.5 U	0.72	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	3	0.5 U	0.5 U	0.5 U	0.5 U	0.50 U	
	09/25/01		0.5 U	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	10/22/01		0.5 U	0.5 U	2.0 U	0.5 U	0.69	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	11/20/01		0.5 U	0.5 U	2.0 U	0.5 U	1.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	01/03/02		0.091 U	0.12 U	0.15 U	0.12 U	1.2	0.11 U	0.23 U	0.096 U	0.12 U	0.098 U	0.2 U	1.4	0.12 U	0.12 U	0.2 JB	0.19 U	0.22 U	
	03/28/02		0.091 U	0.12 U	0.15 U	0.12 U	0.58	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	3.5	0.12 U	0.12 U	0.2 J	0.22 U	0.22 U	
	06/14/02		0.091 U	0.12 U	0.15 U	0.12 U	0.31 J	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	4.7	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U	
	09/17/02		0.091 U	0.12 U	0.15 U	0.12 U	0.37													

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL	
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-7 (continued)	03/14/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	6.9	0.12 U	0.14 U	0.14 U	0.14 J	0.22 U	0.042 U
	09/13/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	4.2	0.12 U	0.14 U	0.11 U	0.22 U	0.042 U	
	04/03/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.27 J	1.8	0.12 U	0.14 U	4.3 U	0.22 U	0.042 U	
	09/25/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	3.2	0.12 U	0.14 U	0.11 U	0.22 U	0.042 U	
	05/01/08		0.042 U	0.1 U	0.037 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.045 U	0.042 U	0.23 U	5.4	0.05 U	0.09 J	0.11 JB	0.078 U	0.071 U	
	10/01/08		0.042 U	0.1 U	0.037 U	0.073 U	0.10 J	0.045 U	0.13 U	0.042 U	0.045 U	0.05 J	0.23 U	2.5	0.05 U	0.17 J	0.24 JB	0.13 J	0.071 U	
	03/24/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.3	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/29/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	1.4	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.3	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/28/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	1.38	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/02/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.98	0.5 U	0.5 U	4.18	0.5 U	0.5 U	0.920	1.16	0.2 U	
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	1.88	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.07	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	12/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	2.86	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.94	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	06/26/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	5.38	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	3.02	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.52	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.63	0.500 U	0.920	0.500 U	0.500 U	0.200 U	
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	4.79	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/24/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.89	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	6.56	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.14	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U		
09/14/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.3	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U		
MW-8	12/22/97		0.5 U	3.3	2 U	0.5 U	0.5 U	0.5 U	0.5 U	1.4	2.9	0.5 U	1 U	0.5 U	0.5 U	33	0.5 U	0.5 U	0.7	
	03/06/98		0.5 U	1.2	2 U	0.5 U	0.5 U	0.5 U	0.5 U	1.3	0.5 U	1 U	0.5 U	0.5 U	0.5 U	20	0.5 U	0.5 U	0.7	
	06/18/98		0.5 U	3	2 U	0.5 U	0.5 U	0.5 U	0.5 U	2.5	0.5 U	1 U	0.5 U	0.5 U	0.5 U	34	0.5 U	0.5 U	0.8	
	09/29/98		0.5 U	3.2	2 U	0.5 U	0.5 U	0.5 U	0.5 U	2.8	0.5 U	1 U	0.5 U	0.5 U	0.5 U	35	0.5 U	0.5 U	0.6	
	12/14/98		0.5 U	2.9	2 U	0.5 U	0.5 U	0.5 U	0.5 U	2.6	0.5 U	1 U	0.5 U	0.5 U	0.5 U	35	0.5 U	0.5 U	0.6	
	12/14/98 (DUP)		0.5 U	3	2 U	0.5 U	0.5 U	0.5 U	0.5 U	2.8	0.5 U	1 U	0.5 U	0.5 U	0.5 U	35	0.5 U	0.5 U	0.6	
	03/02/99		0.5 U	1.9	2 U	0.5 U	0.5 U	0.5 U	0.5 U	1.9	0.5 U	1 U	0.5 U	0.5 U	0.5 U	29	0.5 U	0.5 U	0.6	
	06/16/99		0.5 U	1.3	2 U	0.5 U	0.5 U	0.5 U	0.5 U	1.3	0.5 U	5 U	0.5 U	0.5 U	0.5 U	16	0.5 U	0.5 U	0.6	
	09/16/99		0.2 U	1.1	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	1.3	0.2 U	0.3 U	0.2 U	0.2 EB	0.3 U	15	0.2 U	0.4 U	0.3 E	
	12/08/99		0.5 U	2.0	2 U	0.5 U	0.5 U	0.5 U	0.5 U	2.3	0.5 U	1 U	0.5 U	0.5 U	0.5 U	25	0.5 U	0.5 U	0.5 U	
	03/07/00		0.5 U	1.2	2 U	0.5 U	0.5 U	0.5 U	0.5 U	1.4	0.5 U	1 U	0.5 U	0.5 U	0.5 U	18	0.5 U	0.5 U	0.5 U	
	06/21/00		0.1 U	1.3	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	0.5 J	1.2	0.4 J	0.2 U	1.2	0.2 U	16	0.1 U	0.3 J	0.3 U	
	09/12/00		1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	2.0	1.0 U	5.0 U	1.0 U	1.0 U	1.0 U	19	1.0 U	3.0 U	1.0 U	
	12/07/00		0.1 U	2.0	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	2.4	0.1 U	0.2 U	0.2 U	0.2 U	0.2 U	23	0.2 U	0.2 U	0.3 J	
	03/15/01		0.1 U	1.4	0.2 U	0.2 U	0.2 U	0.2 U	0.2 U	1.4	0.1 U	0.2 U	0.2 U	0.2 U	0.2 U	18	0.2 U	0.2 U	0.3 U	
	07/12/01		0.091 U	2.5	0.15 U	0.12 U	0.13 U	0.11 U	0.18 U	0.096 U	2.3	0.098 U	0.2 U	0.11 U	0.12 U	28	0.14 J	0.19 U	0.37 J	
	08/27/01		0.5 U	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.91	0.5 U	0.5 U	0.5 U	
	09/25/01		0.5 U	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.59	
	10/22/01		0.5 U	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5	
	11/20/01		0.5 U	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.50 U	
	01/03/02		0.091 U	2.0	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.3	0.098 U	0.2 U	0.11 U	0.12 U	27	0.31 JB	0.19 U	0.22 U	
	03/27/02		0.091 U	0.72	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.0	0.13 U	0.2 U	0.17 J	0.12 U	14	0.098 U	0.22 U	0.22 U	
	06/14/02		0.091 U	0.77	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.0	0.13 U	0.2 U	0.13 J	0.12 U	11	0.098 U	0.22 U	0.22 U	
	09/18/02		0.091 U	2.5	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.8	0.13 U	0.2 U	0.21 J	0.12 U	29	0.098 U	0.22 U	0.5	
	12/16/02		0.5 U	3.1	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	3.0	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	34	0.5 U	0.5 U	0.62	
	03/17/03		0.091 U	2.5	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.6	0.13 U	0.2 U	0.12 J	0.12 U	29	0.098 U	0.22 U	0.22 U	
	06/11/03		0.091 U	1.2	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	1.7	0.13 U	0.2 U	0.51	0.12 U	16	0.66 B	0.22 U	0.22 U	
	09/10/03		0.091 U	2.2	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.4	0.13 U	0.2 U	0.26 J	0.12 U	32	0.39 JB	0.22 U	0.41 J	
	9/10/03 (DUP)		0.091 U	2.3	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.5	0.13 U	0.2 U	0.21 J	0.12 U	32	0.22 JB	0.22 U	0.45 J	
	12/04/03		0.091 U	2.8	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	3.2	0.13 U	0.2 U	0.11 U	0.12 U	36	0.098 U	0.22 U	0.6	
	03/16/04		0.091 U	0.59	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.92	0.13 U	0.2 U	0.31 J	0.12 U	11	0.12 J	0.22 U	0.22 U	
	09/24/04		0.091 U	1.7	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	2.4	0.13 U	0.2 U	0.11 U	0.12 U	20	0.098 U	0.22 U	0.38 J	
04/05/05		0.11 U	0.99	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	1.6	0.13 U	0.2 U	0.26 J	0.12 U	15	0.34 J	0.22 U	0.22 U		
09/20/05		0.11 U	1.3	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	2.3	0.13 U	0.2 U	0.43 J	0.12 U	19	0.23 J	0.22 U	0.13 J		
03/15/06		0.11 U	0.60	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	1.1	0.13 U	0.2 U	0.26 J	0.12 U	9.8	0.18 J	0.22 U	0.08 J		
09/13/06		0.11 U	1.1	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	2.2	0.13 U	0.2 U	0.39 J	0.12 U	14	0.11 U	0.22 U	0.36 J		
04/05/07		0.11 U	0.5 J	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.90	0.13 U	0.2 U	0.31 J	0.12 U	7.4	0.11 U	0.22 U	0.05 J		
09/26/07		0.11 U	1.1	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	1.9	0.13 U	0.2 U	0.23 J	0.12 U	13	0.11 U	0.22 U	0.25 J		
05/01/08		0.042 U	0.65	0.037 U	0.073 U															

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-8 (continued)	09/29/09		0.5 U	1.3	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.7	0.5 U	0.5 U	0.5 U	0.5 U	9.1 J	0.5 U	0.5 U	0.4 J	
	04/01/10		0.5 U	0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.4	0.5 U	0.5 U	0.5 U	0.5 U	5.0	0.5 U	0.5 U	0.3	
	09/28/10		0.5 U	1.11	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	2.02	0.5 U	0.5 U	0.5 U	0.5 U	5.09	0.5 U	0.5 U	0.2 UJ	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.900	0.5 U	0.5 U	0.5 U	0.5 U	3.93	0.5 U	0.5 U	0.2 U	
	09/26/11		0.5 U	1.25	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.98	0.5 U	0.5 U	0.5 U	0.5 U	3.91	0.5 U	0.5 U	0.700	
	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.890	0.500 U	0.500 U	0.500 U	0.500 U	2.96	0.500 U	0.500 U	0.200 U	
	09/28/12		0.500 U	1.76	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	2.42 J	0.500 U	0.500 U	0.500 U	0.500 U	5.76	0.500 U	0.500 U	0.200 U	
	03/08/13		0.500 U	0.850	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.54	0.500 U	0.500 U	0.500 U	0.500 U	2.39 J	0.500 U	0.500 U	0.200 U	
	09/27/13		0.500 U	2.45	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.45	0.500 U	0.500 U	0.500 U	0.500 U	9.63	0.500 U	0.500 U	0.730	
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.99	0.500 U	0.500 U	0.200 U	
	09/23/14		0.500 U	1.65	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	6.07	0.500 U	0.500 U	0.500 U	0.500 U	6.47	0.500 U	0.500 U	0.200 U	
	03/16/15		1.0 U	0.41 J	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.70 J	1.0 U	5.0 U	0.32 J	1.0 U	2.1	1.0 U	1.0 U	0.50 U	
	09/16/15		1.0 U	1.7	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	2.8	1.0 U	5.0 U	0.50 U	1.0 U	7.4	1.0 U	1.0 U	0.31 J	
	MW-9	07/12/01		2.3	0.12 U	0.15 U	0.12 U	0.13 U	3.5	15	0.1 J	4.1	0.12 J	0.2 U	0.15 J	0.12 U	0.28 J	1.2	0.18 J	0.26 J
7/12/01 (DUP)			2.3	0.12 U	0.15 U	0.12 U	0.13 U	3.4	14	0.15 J	3.4	0.098 U	0.2 U	0.18 J	0.12 U	0.28 J	1.0	0.13 J	0.23 J	
08/27/01			2.4	0.5 U	2.0 U	0.5 U	0.5 U	4.0	12	0.5 U	5.2	0.5 U	1 U	0.5 U	0.5 U	1.7	0.5 U	0.5 U		
09/25/01			2.3	0.5 U	2.0 U	0.5 U	0.5 U	3.6	12	0.5 U	4.8	0.5 U	1 U	0.5 U	0.5 U	1.2	0.5 U	0.5 U		
10/22/01			2.3	0.5 U	2.0 U	0.5 U	0.5 U	4.1	12	0.5 U	5.9	0.5 U	1 U	0.5 U	0.5 U	1.4	0.5 U	0.5 U		
11/20/01			1.8	0.5 U	2.0 U	0.5 U	0.5 U	4.5	10	0.5 U	8.4	0.5 U	1 U	0.5 U	0.5 U	1.4	0.5 U	0.5 U		
01/03/02			0.65	0.78	0.15 U	0.12 U	0.13 U	1.8	2.9	0.096 U	31	0.098 U	0.2 U	0.11 U	0.12 U	18	0.59 B	0.19 U	0.29 J	
03/27/02			0.091 U	0.95	0.15 U	0.12 U	0.13 U	0.11 U	0.38 J	0.096 U	27	0.13 U	0.21 J	0.11 U	0.12 U	45	0.14 J	0.22 U	0.26 J	
06/14/02			1.8	0.25 J	0.15 U	0.21 J	0.13 U	2.6	19	0.096 U	12	0.13 J	0.28 J	0.11 U	0.12 U	6.2	1.0	0.23 J	0.25 J	
09/17/02			2.2	0.12 U	0.15 U	0.12 U	0.13 U	2.9	21	0.096 U	5.5	0.20 J	0.27 J	0.11 U	0.12 U	2.0	1.2	0.28 J	0.23 J	
12/16/02			2.4	0.5 U	2.0 U	0.5 U	0.5 U	2.7	21	0.5 U	4.2	0.5 U	2 U	0.5 U	0.5 U	0.9	0.93	0.5 U	0.5 U	
03/17/03			0.48 J	0.74	0.15 U	0.12 U	0.13 U	1.4	2.7	0.096 U	27	0.13 U	0.2 U	0.11 U	0.12 U	12	0.33 J	0.12 J	0.22 U	
06/11/03			2.3	0.12 U	0.15 U	0.41 J	0.13 U	1.9	34	0.096 U	4.3	0.13 U	0.4 J	0.11 U	0.12 U	1.7	0.99 B	0.13 J	0.22 J	
09/10/03			2.5	0.12 U	0.15 U	0.43 J	0.13 U	2.3 B	32	0.096 U	6.3	0.13 U	0.32 J	0.11 U	0.12 U	1.2	1.1 B	0.22 U	0.32 J	
12/04/03			2.5	0.12 U	0.15 U	0.12 U	0.13 U	3.1	27	0.096 U	6.4	0.13 U	0.24 J	0.11 U	0.12 U	0.48 J	0.88	0.21 J	0.22 U	
03/16/04			0.79	0.39 J	0.15 U	0.12 U	0.13 U	0.98	2.2	0.096 U	14	0.13 U	0.2 U	0.11 U	0.12 U	11	0.24 J	0.22 U	0.23 J	
09/23/04			1.9	0.12 U	0.15 U	0.35 J	0.13 U	2.0	18	0.096 U	2.5	0.13 U	0.27 J	0.11 U	0.12 U	0.16 J	0.71	0.15 J	0.49 J	
04/05/05			1.2	0.18 J	0.15 U	0.12 U	0.14 U	2.1	0.42 J	0.14 U	13	0.13 U	0.2 U	0.13 U	0.12 U	1.5	0.78	0.22 U	1.6	
09/20/05			1.9	0.13 U	0.15 U	0.34 J	0.14 U	2.2	15	0.14 U	1.1	0.13 U	0.25 J	0.13 U	0.12 U	0.14 U	0.86	0.13 J	0.35 J	
03/14/06			0.63	0.13 U	0.15 U	0.12 U	0.14 U	0.4 J	0.23 U	0.14 U	5.7	0.13 U	0.2 U	0.13 U	0.12 U	7.7	0.12 J	0.22 U	0.96	
09/13/06			1.6	0.13 U	0.15 U	0.35 J	0.14 U	2.0	12	0.14 U	1.1	0.13 U	0.22 J	0.13 U	0.12 U	0.19 J	0.63	0.22 U	0.59	
04/05/07			0.31 J	0.23 J	0.15 U	0.12 U	0.14 U	0.3 J	0.23 U	0.14 U	9.9	0.13 U	0.2 U	0.13 U	0.12 U	7.6	0.11 U	0.22 U	0.78	
09/26/07			1.3	0.13 U	0.15 U	0.28 J	0.14 U	1.8	4.5	0.14 U	0.62	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.53	0.22 U	0.43 J	
05/01/08			0.43 J	0.22 J	0.037 U	0.073 U	0.042 U	1.2	0.13 U	0.042 U	13	0.042 U	0.23 U	0.077 U	0.05 U	0.57	0.39 JB	0.18 J	2.7	
09/30/08			1.0	0.1 U	0.037 U	0.18 J	0.042 U	2.0	2.7	0.042 U	0.46 J	0.08 J	0.23 U	0.077 U	0.05 U	0.061 U	0.63	0.27 J	0.38 J	
03/26/09			0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	0.5 U	1.0 U	4.0	0.5 U	0.5 U	0.5 U	0.5 U	1.3	0.5 U	0.5 U	2.3	
09/29/09			0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	0.5 U	1.0 U	0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.3 J	
03/30/10			0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.8	0.5 U	1.0 U	15	0.5 U	0.5 U	0.5 U	0.5 U	1.3	0.5 U	0.5 U	3.9	
09/28/10			0.51	0.5 U	0.5 U	0.5 U	0.5 U	1.70	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.38 J	0.5 U	0.2 UJ	
9/28/10 (LAB DUP)			0.54	0.5 U	0.5 U	0.5 U	0.5 U	1.87	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.40 J	0.5 U	0.2 UJ	
03/04/11			0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.600	0.5 U	1.0 U	4.18	0.5 U	0.5 U	0.5 U	0.5 U	1.42	0.630	1.01	1.88	
09/26/11			0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.23	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.20 U	
03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.95	0.500 U	0.500 U	0.500 U	0.500 U	3.22	0.500 U	0.500 U	0.690		
09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.5 U	0.500 U	0.500 U	0.500 U	0.500 U	0.5 U	0.500 U	0.500 U	0.200 U		
03/08/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	3.02	0.500 U	0.500 U	0.610	0.500 U	1.39 J	0.500 U	0.500 U	1.16 J		
09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.50	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.780		
03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.09	0.500 U	0.500 U	0.500 U	0.500 U	2.17	0.500 U	0.500 U	0.200 U		
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.13	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.396		
03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.94 J	1.0 U	5.0 U	0.50 U	1.0 U	1.2	1.0 U	1.0 U	0.50 U		
09/16/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	2.5 U		
MW-10	07/12/01		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.18 U	0.096 U	0.65	0.098 U	0.2 U	0.11 U	0.12 U	0.12 U	0.14 J	0.19 U	0.22 U	
	09/25/01		0.5 U	0.5 U	2.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.59	0.5 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	
	01/03/02		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.48 J	0.098 U	0.2 U	0.11 U	0.12 U	0.12 U	0.45 JB	0.19 U	0.22 U	
	1/3/02 (DUP)		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U</										

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride		
			5,100,000	3,350,000	LNAPL	8,690,000		LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	1,000	1,600	LNAPL	LNAPL	
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5	
MW-10 (continued)	09/20/05		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.14 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.16	0.22 U	0.042 U	
	03/15/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.14 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.16 J	0.22 U	0.042 U	
	09/12/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.14 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.042 U	
	04/03/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.14 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.042 U	
	09/24/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.14 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.042 U	
	05/01/08		0.042 U	0.1 U	0.037 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.042 U	0.17 J	0.042 U	0.23 U	0.077 U	0.05 U	0.061 U	0.15 JB	0.078 U	0.071 U	
	10/01/08		0.042 U	0.1 U	0.037 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.042 U	0.22 J	0.042 U	0.23 U	0.077 U	0.05 U	0.061 U	0.14 JB	0.078 U	0.071 U	
	03/24/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/30/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/28/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/26/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	3.02	0.500 U	0.500 U	0.610	0.500 U	1.39	0.500 U	0.500 U	0.500 U	0.200 U
	09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/26/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/27/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U		
09/14/15		1.0 UJ	1.0 UJ	2.0 UJ	0.50 UJ	0.50 UJ	0.50 UJ	1.0 UJ	1.0 UJ	1.0 UJ	1.0 UJ	1.0 UJ	5.0 UJ	0.50 UJ	1.0 UJ	1.0 UJ	1.0 UJ	1.0 UJ	0.50 UJ		
MW-11	07/12/01		0.91 U	1.2 U	NA	1.2 U	1.3 U	NA	1.8 U	0.96 U	19	NA	2 U	2,000	1.2 U	78	NA	NA	2.5 J		
	08/27/01		5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	19	5 U	10 U	1,600	5 U	69	5 U	5 U	5 U		
	09/24/01		5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	22	5 U	10 U	1,900	5 U	84	5 U	5 U	5 U		
	10/15/01	12	1.4	0.53	NA	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	28	0.5 U	1 U	1,600	0.5 U	83	0.5 U	0.5 U	1.2		
	10/15/01	18	1.4	0.54	NA	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	29	0.5 U	1 U	1,700	0.5 U	86	0.5 U	0.5 U	1.2		
	10/22/01	12	5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	25	5 U	10 U	2,000	5 U	92	5 U	5 U	5 U		
	10/22/01	18	2.5 U	2.5 U	NA	2.5 U	2.5 U	2.5 U	2.5 U	2.5 U	25	2.5 U	5 U	2,000	2.5 U	92	2.5 U	2.5 U	2.5 U		
	10/29/01	12	5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	25	5 U	10 U	1,700	5 U	91	5 U	5 U	5 U		
	10/29/01	18	5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	25	5 U	10 U	1,800	5 U	92	5 U	5 U	5 U		
	11/19/01		5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	20	5 U	10 U	1,900	5 U	78	5 U	5 U	5 U		
	01/02/02		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	18	0.49 U	0.97 U	1,900	0.56 U	78	0.49 U	0.93 U	1.1 U		
	03/27/02		0.91 U	1.2 U	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	19	1.3 U	4 J	1,800	1.2 U	67	0.98 U	2.2 U	2.2 U		
	06/11/02		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	19	0.49 U	0.97 U	1,500	0.57 U	64	0.49 U	1.5 U	1.1 U		
	09/17/02		0.91 U	1.2 U	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	16	1.3 U	2 U	2,000	1.2 U	67	0.98 U	2.2 U	2.2 U		
	12/16/02		2.2	1 U	4.0 U	1.0 U	1.0 U	1.1 U	1 U	1.0 U	7.9	1.0 U	4 U	680	1.0 U	40	1.0 U	1.0 U	1.7		
	03/17/03		1.0 J	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	7.5	0.65 U	1.3 J	1,100	0.57 U	46	0.49 U	1.1 U	1.10 U		
	03/17/03		1.0 J	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	7.5	0.65 U	1.3 J	1,100	0.57 U	45	0.49 U	1.1 U	1.10 U		
	06/10/03		0.9 J	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.5 J	7.4	0.65 U	0.97 U	1,500	0.57 U	53	0.85 JB	1.1 U	1.5 J		
	09/10/03		0.46 U	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.5 J	6.0	0.65 U	0.97 U	1,700	0.75 J	62	0.49 U	1.1 U	1.6 J		
	12/05/03		2.9	0.4 J	0.29 U	0.23 U	0.25 U	0.86 J	0.46 U	0.2 J	8.8	0.26 U	0.39 U	1,100	0.3 J	58	0.2 U	0.44 U	2.1		
	03/16/04		0.55 J	0.6 U	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.55 J	5.2	0.65 U	0.97 U	1,500	0.65 J	47	0.49 U	1.5 U	1.1 U		
	09/22/04		0.7 J	0.3 U	0.36 U	0.29 U	0.31 U	0.27 U	0.57 U	0.43 J	6.3	0.33 U	0.49 U	1,300	0.58 J	47	0.25 U	0.55 U	0.78 J		
	04/04/05		0.68 J	0.31 U	0.36 U	0.29 U	0.35 U	0.34 U	0.57 U	0.34 U	13	0.33 U	0.49 U	1,300	0.50 J	48	0.58 J	0.55 U	0.53 U		
	09/20/05		0.45 J	0.19 J	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.21 J	29	0.13 U	0.2 U	1,400	0.61	52	0.17 J	0.22 U	0.35 J		
	03/14/06		0.65 J	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	51	0.65 U	0.97 U	1,000	0.60 J	50	0.54 U	1.1 U	0.8 J		
	09/13/06		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	28	0.65 U	0.97 U	1,100	0.58 U	50	0.54 U	1.1 U	0.7 J		
	04/04/07		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	50	0.65 U	0.97 U	1,200	0.58 U	38	0.54 U	1.1 U	2.1 U		
	09/26/07		0.51 U	0.61 U	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	41	0.65 U	0.97 U	1,200	0.58 U	42	0.54 U	1.1 U	2.1 U		
	05/01/08		0.11 U	0.25 U	0.093 U	0.19 U	0.11 U	0.12 U	0.33 U	0.2 J	26	0.11 U	0.58 U	910	0.28 J	35	0.13 JB	0.2 U	0.18 U		
09/30/08		0.21 U	0.5 U	0.19 U	0.37 U	0.21 U	0.23 U	0.65 U	0.21 U	27	0.21 U	1.2 U	1,000	0.25 J	41	0.25 JB	0.39 U	0.36 U			
04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	16	0.5 U	0.5 U	290	0.5 U	44	0.5 U	0.5 U	0.2 U			
04/09/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10 U	10 U	10 U	850	10 U	35	10 U	10 U	4.0 U			
04/16/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	22	10 U	10 U	500	10 U	66	10 U	10 U	4.0			
05/06/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	24	10 U	10 U	530	10 U	43	10 U	10 U	1.0 J			
06/09/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	11	0.5 U	0.5 U	680	0.5 U	33	0.5 U	0.5 U	0.28			
6/9/10 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	9.3	0.5 U	0.5 U	580</								

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-12 (continued)	10/29/01 (DUP)	18	5 U	5 U	NA	5 U	5 U	5 U	5 U	5 U	60	5 U	10 U	2,100	5 U	70	5 U	5 U	5 U	
	11/19/01		10 U	10 U	NA	10 U	10 U	10 U	10 U	10 U	190	10 U	20 U	3,300	10 U	210	10 U	10 U	10 U	
	01/03/02		0.52 J	1.1	0.29 U	0.23 U	0.25 U	0.21 U	2.6	0.22 J	340	0.2 U	0.39 U	440	0.23 U	72	0.4 JB	0.62 J	0.43 U	
	03/27/02		0.91 U	7.7	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,700	1.3 U	2 U	2,100	1.2 U	640	0.98 U	2.2 U	2.2 U	
	3/27/02 (DUP)		0.91 U	8.5	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,800	1.3 U	2 U	2,300	1.2 U	660	0.98 U	2.2 U	2.2 U	
	06/11/02		0.91 U	5.5	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,000	1.3 U	2 U	2,400	1.2 U	600	0.98 U	2.2 U	2.2 U	
	6/11/02 (DUP)		0.91 U	5.6	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,000	1.3 U	2 U	2,400	1.2 U	580	0.98 U	2.2 U	2.2 U	
	09/17/02		0.91 U	9.4	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	3,500	1.3 U	2 U	1,300	1.2 U	720	0.98 U	2.2 U	2.2 U	
	12/16/02		5 U	9.3	20 U	5 U	5 U	5 U	5 U	5 U	3,600	5 U	20 U	430	5 U	1,300	5 U	5 U	5 U	
	03/17/03		0.46 U	5.5	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	2,500	0.65 U	1.5 J	460	0.57 U	1,200	0.49 U	1.1 U	1.1 U	
	06/10/03		0.91 U	4.8 J	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,200	1.3 U	2 U	2,100	1.2 U	1,500	0.98 U	2.2 U	2.2 U	
	09/10/03		0.91 U	4.5 J	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,400	1.3 U	2 U	900	1.2 U	3,500	1.0 JB	2.2 U	12	
	12/05/03		0.46 U	4.7	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	2,000	0.65 U	1.3 J	1,500	0.57 U	2,100	0.49 U	1.1 U	37	
	03/16/04		0.37 U	4.8	0.57 U	0.46 U	0.5 U	0.42 U	0.91 U	0.39 U	2,500	0.52 U	0.78 U	2,100	0.46 U	1,200	0.39 U	1.2 U	57	
	09/22/04		0.46 U	4.1	0.71 U	0.57 U	0.62 U	0.53 U	1.2 U	0.48 U	2,300	0.65 U	0.97 U	880	0.57 U	1,700	0.49 U	1.1 U	60	
	04/04/05		0.51 U	3.2	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	2,200	0.65 U	0.97 U	760	0.58 U	1,000	0.54 U	1.1 U	18	
	09/20/05		1.1 U	4.4 J	1.5 U	1.2 U	1.4 U	1.4 U	2.3 U	1.4 U	2,800	1.3 U	2 U	390	1.2 U	1,500	1.1 U	2.2 U	38	
	03/14/06		0.51 U	2.4 J	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	1,700	0.65 U	0.97 U	1,100	0.58 U	500	0.54 U	1.1 U	15	
	09/13/06		0.15 J	4.2	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	2,600	0.13 U	0.2 U	400	0.12 U	1,400	0.11 U	0.22 U	54	
	04/04/07		0.51 U	1.5 J	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	1,200	0.65 U	0.97 U	1,200	0.58 U	450	0.54 U	1.1 U	3.8	
	09/26/07		0.51 U	3.0	0.71 U	0.57 U	0.7 U	0.68 U	1.2 U	0.68 U	1,700	0.65 U	0.97 U	470	0.58 U	1,100	0.54 U	1.1 U	39	
	05/01/08		0.11 U	1.4	0.093 U	0.19 U	0.11 U	0.15 J	0.33 U	0.15 J	1,000	0.11 U	0.58 U	850	0.13 U	390	0.18 JB	0.2 U	5.9	
	09/30/08		0.42 U	2.7 J	0.37 U	0.73 U	0.42 U	0.45 U	1.3 U	0.42 U	1,500	0.42 U	2.3 U	580	0.5 U	780	0.48 U	0.78 U	54	
	03/26/09		25 U	25 U	25 U	25 U	25 U	25 U	25 U	25 U	843	25 U	25 U	710	25 U	600	25 U	25 U	93	
	09/29/09		5.0 U	4.5 J	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	5.0 U	2,200	5.0 U	5.0 U	320	5.0 U	1,400	5.0 U	5.0 U	150	
	04/01/10		0.5 U	1.0	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	400	0.5 U	170	0.5 U	0.5 U	9.4	
	09/28/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	334	0.5 U	0.5 U	377	0.5 U	232	0.5 U	0.5 U	17.2	
	03/03/11		0.5 U	0.730	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	856	0.5 U	257	0.5 U	0.5 U	8.93	
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	429	0.5 U	215	0.5 U	0.5 U	11.7	
	09/22/11		0.5 U	2.33	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	128 J	0.5 U	461	0.5 U	0.5 U	94.6	
	9/22/11 (DUP)		0.5 U	2.11	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	200 J	0.5 U	529	0.5 U	0.5 U	93.3	
	12/07/11		0.5 U	1.35	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	461	0.5 U	409	0.5 U	0.5 U	47.5	
	03/07/12		0.500 U	1.32	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	337	0.500 U	155	0.500 U	0.500 U	26.3	
3/7/12 (DUP)		0.500 U	1.37	0.500 U	0.500 U	0.500 U	0.500 U	0.630	0.500 U	1.00 U	0.500 U	0.500 U	332	0.500 U	164	0.500 U	0.500 U	26.2		
06/26/12		0.500 U	1.31	0.500 U	0.500 U	0.500 U	0.500 U	1.47	0.500 U	1.00 U	0.500 U	0.500 U	407	0.500 U	218	0.500 U	0.500 U	35.2		
10/02/12		0.500 U	2.71	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	47.6	0.500 U	217	0.500 U	0.500 U	100		
12/19/12		0.500 U	2.36	0.500 U	0.500 U	0.500 U	0.500 U	1.35	0.500 U	1.00 U	0.500 U	0.500 U	151	0.500 U	225	0.500 U	0.500 U	41.1		
03/06/13		0.500 U	2.01	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	64.2	0.500 U	131	0.500 U	0.500 U	36.1		
06/06/13		0.500 U	1.34	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	293	0.500 U	312	0.500 U	0.500 U	34.7		
09/25/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	78.4	0.500 U	0.500 U	0.500 U	0.500 U	43.8		
03/25/14		0.500 U	1.61	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	140	0.500 U	211	0.500 U	0.500 U	24.8		
3/25/14 (DUP)		0.500 U	1.61	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	144	0.500 U	226	0.500 U	0.500 U	24.6		
09/23/14		0.500 U	1.27	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	9.99	4.500 U	40.0	0.500 U	0.500 U	74.0		
03/16/15		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	464	10 U	50 U	24.7	10 U	38.1	10 U	10 U	12.9		
3/16/15 (DUP)		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	468	10 U	50 U	21.9	10 U	36.3	10 U	10 U	16.2		
09/15/15		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	581	10 U	50 U	6.2	10 U	14.7	10 U	10 U	35.7		
09/15/15 (DUP)		10 U	10 U	20 U	5.0 U	5.0 U	5.0 U	10 U	10 U	595	10 U	50 U	10	10 U	15.9	10 U	10 U	41.0		
MW-13	03/31/03		2,700	320	260	25 U	25 U	25 U	260	25 U	23,000	1,600	100 U	25 U	2,900	25 U	21,000	6,900	1,100	
	05/14/03		3,600	440	320	12 U	13 U	11 U	440	9.6 U	25,000	1,900	23 J	11 U	3,700	12 U	21,000	8,100	1,200	
	06/11/03		3,900	440	370	12 U	13 U	11 U	490	9.6 U	26,000	2,300	25 J	11 U	3,600	12 U	20,000	9,800	1,200	
	6/11/03 (DUP)		4,000	450	410	12 U	13 U	11 U	470	9.6 U	29,000	2,500	30 J	11 U	3,800	12 U	22,000	10,600	1,300	
	09/11/03		4,400	460	400	5.7 U	6.2 U	5.5 J	490	4.8 U	30,000	2,400	25 J	5.5 U	4,100	5.9 U	25,000	10,200	1,400	
	12/04/03		5,600	490	510	5.7 U	6.2 U	6.5 J	380	4.8 U	33,000	2,900	25 J	5.5 U	3,300	5.9 U	29,000	12,300	1,800	
	03/15/04		6,200	490	540	5.7 U	6.2 U	7 J	310	4.8 U	38,000	2,900	26 J	5.5 U	2,900	5.9 U	32,000	14,000	1,700	
	06/10/04		5,300	470	310	12 U	13 U	11 U	260	9.6 U	31,000	2,300	58 J	11 U	2,800	12 U	25,000	10,300	2,200	
	09/23/04		4,500	370	320	12 U	13 U	11 U	380	9.6 U	22,000	2,000	25 J	11 U	2,600	12 U	17,000	8,900	2,100	
	04/05/05		100	7.4	5.7	0.12 U	0.14 U	0.14 U	5.3	0.14 U	470	34	0.39 J	0.23 J	26	0.14 U	210	120	86	
	09/21/05		930	44	70	0.5 J	0.28 U	1.4	340	0.28 U	2,900	620	3.2 J	0.48 J	28					

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL	
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-13 (continued)	04/07/10		480	10 U	540	10 U	10 U	10 U	480	20 U	1,800	2,100	10 U	10 U	10 U	10 U	4,600	4,200	2,700	
	04/16/10		1,100	20	640	10 U	10 U	10 U	840	20 U	3,300	2,800	10 U	10 U	10 U	10 U	5,400	5,800	4,000	
	05/06/10		820	11	340	10 U	10 U	10 U	640	20 U	1,900	2,000	10 U	5.0 U	10 U	5.0 U	6,200	4,900	3,100	
	06/09/10		720	11	280	10 U	10 U	10 U	1,200	20 U	1,500	1,800	10 U	20	10 U	5.0 U	5,600	3,900	4,700	
	07/06/10		510	9.5	280	10 U	10 U	10 U	1,400	20 U	1,300	1,700	10 U	5.0 U	10 U	5.0 U	8,300	3,500	6,500	
	09/30/10		71.0	10 U	130	10 U	10 U	10 U	820	20 U	56.8	1,010	10.8	5.0 U	10 U	5.0 U	4,180	2,560	221	
	03/03/11		97.4	1.27	143	0.5 U	0.5 U	0.720	435	1.0 U	245	521	0.5 U	1.14	0.5 U	0.5 U	2,870	3,320	533	
	06/23/11		25.6	0.5 U	105	0.5 U	0.610 J	0.500	216	1.0 U	18.0	619	0.84	0.5 U	0.5 U	0.5 U	1,170	2,405	99.3	
	09/22/11		47.5	0.5 U	143	0.5 U	0.5 U	0.680	0.5 U	1.0 U	64.7	1,110	2.39	0.5 U	0.5 U	0.5 U	4,100	4,480	302	
	12/07/11		30.2	0.5 U	218	0.5 U	0.5 U	0.630	518	1.0 U	44.2	1,270	1.72	0.680	0.5 U	0.5 U	3,690	5,170	285	
	12/7/11 (DUP)		30.4	0.5 U	212	0.5 U	0.5 U	0.630	521	1.0 U	42.0	1,090	1.83	0.700	0.5 U	0.5 U	3,360	4,820	270	
	03/07/12		14.2	0.500 U	192	0.500 U	0.500 U	0.600	313	1.00 U	14.7	921	0.870	0.500 U	0.500 U	0.500 U	1,230	3,862	93.0	
	06/27/12		22.7	0.500 U	102	0.500 U	0.500 U	0.590	318	1.00 U	19.1	606	0.800	0.500 U	0.500 U	0.500 U	574	2,437	103	
	10/02/12		3.0	0.500 U	100	0.500 U	0.500 U	0.730	256	1.00 U	1.91	438	0.500 U	0.500 U	0.500 U	0.500 U	26.4	1,748	2.11	
	12/19/12		2.4	0.500 U	120	0.500 U	0.500 U	0.500 U	233	1.00 U	0.500 U	464	0.500 U	0.500 U	0.500 U	0.500 U	94.0	1,827	1.08	
	03/07/13		0.500 U	0.500 U	113 J	0.500 U	0.770	0.860	278	1.00 U	0.500 U	648 J	0.500 U	0.500 U	0.500 U	0.500 U	19.2	2,628 J	0.960 J	
	06/06/13		1.12	0.500 U	97.0	0.500 U	0.500 U	0.680	291	1.00 U	0.930	388	0.560	0.500 U	0.500 U	0.500 U	64.0	1,409	1.81	
	09/25/13		2.50	0.500 U	205	0.500 U	0.840	0.530	250	1.00 U	0.500 U	611	0.690	0.500 U	0.500 U	0.500 U	289	2,250	0.200 U	
	03/26/14		0.500 U	0.500 U	74.2	0.500 U	0.500 U	0.500 U	147	1.00 U	1.04	205	0.500 U	0.500 U	0.500 U	0.500 U	1.71	504.67	0.200 U	
	09/23/14		1.07	0.500 U	133	0.500 U	0.500 U	0.500 U	162	1.00 U	0.500 U	475	0.500 U	0.549	0.500 U	0.500 U	40.9	1,873	0.200 U	
03/17/15		0.21 J	1.0 U	11.1	0.50 U	0.50 U	0.50 U	6.0	1.0 U	1.3	32.3	5.0 U	0.50 U	1.0 U	1.0 U	1.8	89.1	0.50 U		
09/15/15		0.37 J	1.0 U	38.7	0.50 U	0.50 U	0.25 J	41.4	1.0 U	0.65 J	94.6	5.0 U	0.50 U	1.0 U	1.0 U	2.7	197.2	0.79		
MW-14	10/30/03		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U	
	12/04/03		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U	
	03/16/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U	
	06/10/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U	
	09/24/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U	
	04/05/05		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.12 J	0.22 U	0.22 U
	09/21/05		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.14 J	0.22 U	0.042 U
	03/14/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.12 J	0.22 U	0.042 U
	09/13/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	1.3	0.22 U	0.042 U
	04/04/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.042 U
	09/26/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.042 U
	05/02/08		0.07 J	0.1 U	0.05 J	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.045 U	0.042 U	0.23 U	0.077 U	0.05 U	0.061 U	0.14 JB	0.18 J	0.071 U	
	09/30/08		0.05 J	0.1 U	0.037 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.045 U	0.06 J	0.23 U	0.077 U	0.05 U	0.12 J	0.26 JB	0.31 J	0.071 U	
	03/23/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	3/23/09 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/29/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	9/30/10 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.640	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
09/21/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/28/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.54 J	1.0 U	1.0 U	0.50 U	
09/16/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.50 U	
MW-15	10/30/03		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.14 J	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.29 J	
	12/04/03		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.14 J	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.35 J	
	03/16/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.14 J	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.24 J	
	06/10/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0											

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride		
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	1,600	LNAPL	LNAPL	
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5	
MW-15 (continued)	09/30/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	03/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	3/7/11 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/21/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/06/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.240	
	10/01/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/07/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 UJ	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
	03/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.61 J	1.0 U	0.50 U
	09/17/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	1.0 U	1.0 U	1.0 U	1.0 U	0.28 J	1.0 U	0.50 U
MW-16	10/30/03		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.27 J	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U		
	12/05/03		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U		
	03/16/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U		
	06/10/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.096 U	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U		
	09/23/04		0.091 U	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.23 U	0.1 J	0.12 U	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U		
	04/05/05		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.34 J	0.22 U	0.22 U
	09/21/05		0.11 U	0.13 U	0.16 J	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.33 J	0.12 J	
	03/15/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.18 J	0.22 U	0.28 J
	09/13/06		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.45 J	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.28 J	
	04/05/07		0.14 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.26 J	
	09/26/07		0.11 U	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.41 J	0.12 U	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.14 U	0.11 U	0.22 U	0.26 J	
	05/02/08		0.16 J	0.1 U	0.037 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.045 U	0.042 U	0.23 U	0.077 U	0.5 U	0.06 U	0.10 JB	0.078 U	0.55		
	10/01/08		0.18 J	0.1 U	0.037 U	0.073 U	0.042 U	0.045 U	0.13 U	0.042 U	0.045 U	0.05 J	0.23 U	0.077 U	0.5 U	0.10 J	0.24 JB	0.14 J	0.61		
	03/25/09		0.5 U	1.2	0.5 U	0.5 U	0.5 U	1.3	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.1	1.2	0.5 U	1.2	
	09/30/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.4 J	
	9/30/09 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.4 J	
	04/02/10		0.5 U	0.5 U	0.9	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	2.6	0.5 U	0.5 U	0.5 U	0.5 U	6.6	7.9	0.9		
	10/01/10		0.42 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ	
	10/1/10 (DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.66 J	
	03/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	09/26/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.650	
03/08/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.520		
10/01/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.510		
03/08/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
09/27/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/27/14		0.880	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.700		
09/25/14		0.568	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/18/15		0.55 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.45 J	1.0 U	1.0 U	0.46 J		
09/17/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	5.0 U	5.0 U	1.8 J	5.0 U	25 U	2.5 U	5.0 U	2.5 J	5.0 U	5.0 U	5.0 U	2.5 U		
MW-17	10/30/03		4.3	0.24 U	22	2.1	0.25 U	15	190	0.34 J	2.8	260	1.5 J	0.22 U	0.23 U	0.24 U	5.8	1,616	9.1		
	12/04/03		4.1	0.24 U	17	1.4	0.25 U	11	140	0.2 U	0.24 U	180	0.68 J	0.22 U	0.23 U	0.24 U	5.8	1,412	0.54 J		
	03/15/04		5.3	0.12 U	29	2.5	0.13 U	21	230	0.34 J	13	170	2.7	0.11 U	0.12 U	0.12 U	9.6	1,428	57		
	06/10/04		4.1	0.12 U	22	1.9	0.13 U	14	180	0.096 U	0.32 J	190	1.4 J	0.11 U	0.12 U	0.12 U	5.4	2,114	0.93		
	09/23/04		3.6	0.6 U	21	1.8 J	0.62 U	12	170	0.48 U	0.58 U	220	1.8 J	0.55 U	0.57 U	0.59 U	4.1	1,616	1.1 U		
	9/23/04 (DUP)		3.7	0.6 U	22	2.0 J	0.62 U	13	180	0.48 U	0.58 U	230	1.8 J	0.55 U	0.57 U	0.59 U	4.2	1,617	1.1 U		
	04/05/05		2.9	0.31 U	16	1.4	0.35 U	11	140	0.34 U	0.29 U	120	0.95 J	0.32 U	0.29 U	0.34 U	4.6	1,200	0.53 U		
	09/21/05		3.4	0.13 U	26	1.5	0.14 U	13	180	0.14 U	0.12 J	150	0.84 J	0.13 U	0.12 U	0.14 U	4.9	1,413	0.24 J		
	03/15/06		4.1	0.61 U	22 J	2.6	0.70 U	19	280	2.5 U	0.58 U	200 J	1.7 J	0.63 U	0.58 U	0.67 U	3.1	1,614 J	0.55 J		
	09/12/06		3.2	0.13 U	9.6	1.4	0.14 U	12	170	0.14 U	2.1	63	0.78 J	0.13 U	0.12 U	0.14 U	1.4	448	10		
	04/04/07		2.9	0.31 U	23	2.6	0.35 U	20	230	0.34 U	0.7 J	75	1.4 J	0.32 U	0.29 U	0.34 U	2.1	1,013	2.3		
	09/24/07		2.7	0.31 U	19	2.2	0.14 U	14	150	0.14 U	0.12 U	8.1	0.99 J	0.13 U	0.12 U	0.14 U	0.93	377	0.13 J		
	05/01/08		2.7	0.1 U	12	1.1 U	0.042 U	7.9	77	0.042 U	0.05 J	50	0.33 J								

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride	
			5,100,000	3,350,000	LNAPL	8,690,000		LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600	0.5
MW-17 (continued)	09/26/13		1.76	0.500 U	21.5	3.91	0.500 U	28.8	484	1.00 U	0.500 U	0.500 U	3.26	0.500 U	0.500 U	0.500 U	0.500 U	0.790	17.28	0.200 U
	03/26/14		1.01	0.500 U	10.6	1.59	0.500 U	9.71	175	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	7.80	0.200 U
	09/25/14		1.63	0.500 U	24.7	0.500 U	0.500 U	14.3	202	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.656	10.74	0.200 U
	03/19/15		1.2 J	5.0 U	4.6 J	1.7 J	2.5 U	13.3	172	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	1.8 J	2.5 U
09/17/15		1.8 J	5.0 U	7.7 J	1.8 J	2.5 U	16.2	219	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	3.4 J	2.5 U	
MW-18	10/30/03		12	6.2 J	2.9 U	2.3 U	2.5 U	2.1 U	14	2 U	5,400	14	3.9 U	2.2 U	2.3 U	2.4 U	120	93	7,900	
	12/04/03		15	3.7 J	1.5 U	1.2 U	1.3 U	1.6 J	23	0.96 U	3,500	9	2 U	1.1 U	1.2 U	1.2 U	71	50	4,700	
	12/4/03 (DUP)		14	3.7 J	1.5 U	1.2 U	1.3 U	1.6 J	20	0.96 U	3,700	8.5	2 U	1.1 U	1.2 U	1.2 U	68	48	5,400	
	03/16/04		4.9	0.12 U	0.28 J	0.12 U	0.13 U	0.17 J	1.8	0.096 U	16	1.7	0.2 U	0.11 U	0.12 U	0.12 U	1.4	6.4	23	
	06/10/04		2.7	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	0.91	0.096 U	5	0.83	0.2 U	0.11 U	0.12 U	0.12 U	0.42 J	3.6	6.6	
	09/23/04		2.4	0.12 U	0.15 U	0.12 U	0.13 U	0.11 U	1.2	0.096 U	4.5	0.86	0.2 U	0.16 J	0.12 U	0.13 J	0.24 J	3.6	4.4	
	04/05/05		1.8	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	1.4	0.14 U	7.2	0.49 J	0.2 U	0.13 U	0.12 U	0.44 J	0.33 J	1.4	5.1	
	4/5/05 (DUP)		1.7	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	1.3	0.14 U	6	0.46 J	0.2 U	0.13 U	0.12 U	0.37 J	0.65	1.3	4.3	
	09/20/05		0.37 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.36 J	6.2	0.13 U	0.2 U	2.2	0.12 U	2.1	0.35 J	0.22 U	5.3	
	03/15/06		0.92	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.66	0.14 U	0.6	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.18 J	1.12	0.85	
	09/12/06		0.48 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	1.0	0.14 U	0.77	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.11 U	0.8 J	1.3	
	04/03/07		0.31 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.36 J	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.15 J	0.71 J	0.36 J	
	09/24/07		0.21 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.46 J	0.14 U	0.52	0.13 U	0.2 U	0.13 U	0.12 U	0.14 U	0.11 U	0.93 J	0.55	
	05/01/08		0.27 J	0.1 U	0.10 J	0.073 U	0.042 U	0.07 J	0.25 J	0.042 U	0.36 J	0.042 U	0.23 U	0.077 U	0.05 U	0.061 U	0.25 J	0.79 J	0.34 J	
	10/01/08		0.26 J	0.1 U	0.04 J	0.073 U	0.042 U	0.06	0.85	0.042 U	0.49 J	0.06 J	0.23 U	0.09 J	0.05 U	0.14 J	0.61 B	1.03 J	0.42 J	
	03/24/09		2.5	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.0	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	1.1	
	09/30/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 J	
	03/30/10		1.1	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.6	4.5	1.0 U	0.2 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	0.09 J	
	09/28/10		0.34 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.39	1.0 U	4.40	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.26 J	5.33	
	03/04/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	2.77	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.29	0.2 U	
	3/4/11 (LAB DUP)		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	3.21	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.42	0.2 U	
	06/23/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.99	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.37	0.590	
	09/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U	
	03/07/12		0.56	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.95	1.00 U	213	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.86	0.770	115
	06/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.81	1.00 U	4.48	0.550	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.08	1.090	5.34
	10/01/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	14.8	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.13	0.500 U	22.7
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.58	1.00 U	0.91	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.810	1.08	
	12/19/12 (DUP)		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.70	1.00 U	1.25	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.840	0.95	
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.570	1.00 U	0.690	0.930	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.790	0.590 J
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.42	1.00 U	0.900	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.520	1.20	
09/26/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	2.85	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U		
03/26/14		0.500 U	0.500 U	0.504	0.500 U	0.500 U	0.500 U	1.34	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.970	0.200 U		
09/24/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.46	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U		
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.6	1.0 U	0.23 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.47 J	1.0 U	0.25 J		
09/14/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	0.26 J	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	0.22 J		
MW-19	02/20/04		11	0.12 U	1.3 J	0.12 U	0.13 U	3.1 J	11	0.096 U	0.51	13	0.23 J	0.11 U	0.12 U	0.12 U	180	73	3	
	03/16/04		9.2	0.12 U	0.9 J	0.12 U	0.13 U	3.0	5.8	0.096 U	0.32 J	9.5	0.2 U	0.11 U	0.12 U	0.12 U	110	42	12	
	3/16/04 (DUP)		9.6	0.12 U	1.0 J	0.12 U	0.13 U	3.0	6.1	0.096 U	0.39 J	10	0.2 U	0.11 U	0.12 U	0.12 U	99	44	12	
	06/10/04		1.4	0.12 U	0.15 U	0.12 U	0.13 U	1.6	0.23 U	0.096 U	2.7	0.47 J	0.2 U	0.11 U	0.12 U	0.12 U	1.3	2.06	42	
	09/23/04		3.4	0.12 U	0.19 J	0.12 U	0.13 U	1.2	2.7	0.096 U	4.1	2.4	0.2 U	0.11 U	0.12 U	0.12 U	17	10.4	38	
	04/05/05		1.9	0.13 U	0.15 U	0.12 U	0.14 U	1.2	0.28 J	0.14 U	11	0.27 J	0.2 U	0.13 U	0.12 U	0.14 U	1.2	0.49 J	44	
	09/21/05		2.2	0.13 U	0.47 J	0.12 U	0.14 U	1.4	1.4	0.14 U	74	2.4	0.2 U	0.13 U	0.12 U	0.14 U	1.1	6.9	47	
	03/15/06		1.6	0.13 U	0.15 U	0.12 U	0.14 U	1.1	0.34 J	0.14 U	9.7	0.39 J	0.2 U	0.13 U	0.12 U	0.14 U	1.1	1.92	30	
	09/12/06		2.6	0.13 U	1.1 J	0.12 U	0.14 U	1.4	4.5	0.14 U	18	7.9	0.2 U	0.13 U	0.12 U	0.14 U	1.1	18.2	20	
	04/03/07		2.0	0.13 U	0.71 J	0.12 U	0.14 U	1.1	0.90	0.14 U	39	1.4	0.2 U	0.13 U	0.12 U	0.14 U	0.58	12.6	72	
	09/24/07		1.1	0.13 U	0.84 J	0.12 U	0.14 U	0.9	0.92	0.14 U	3.9	0.97	0.2 U	0.13 U	0.12 U	0.14 U	0.62 J	11.5	37	
	05/02/08		1.9	0.1 U	1.8 J	0.073 U	0.042 U	1.0	1.6	0.042 U	0.18 J	0.58	0.23 U	0.077 U	0.05 U	0.061 U	0.59 B	21.4	1.6	
	10/01/08		0.84	0.1 U	0.49 J	0.073 U	0.042 U	0.77	0.96	0.042 U	30	0.1 J	0.23 U	0.077 U	0.05 U	0.10 J	0.44 JB	4.17	75	
	03/23/09		0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.5	2.3	
	09/29/09		2.4	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.9	3.2	1.0 U	2.3	3.0	0.5 U	0.5 U	0.5 U	0.5 U	4.1	18	
	03/30/10		0.8	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.7	2.4	1.0 U	1.1	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.2	5.0	
	3/30/10 (LAB DUP)	</																		

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600
MW-19 (continued)	09/25/13		4.88	0.500 U	10.3	0.500 U	0.500 U	1.41	20.9	1.00 U	285	36.8	0.500 U	0.500 U	0.500 U	0.500 U	42.3	66.8	664
	03/27/14		0.500 U	0.500 U	1.05	0.500 U	0.500 U	0.500 U	0.850	1.00 U	1.79	3.28	0.500 U	0.500 U	0.500 U	0.500 U	1.91	6.81	4.63
	3/27/14 (DUP)		0.960	0.500 U	1.03	0.500 U	0.500 U	0.500 U	0.880	1.00 U	1.86	3.37	0.500 U	0.500 U	0.500 U	0.500 U	1.92	6.97	4.87
	09/25/14		2.17	0.500 U	11.2	0.500 U	0.500 U	0.688	5.47	1.00 U	0.62	9.91	0.500 U	0.500 U	0.500 U	0.500 U	0.648	35.82	0.200 U
	03/19/15		2.3	1.0 U	16.6	0.50 U	0.50 U	1.1	2.9	1.0 U	0.30 J	1.9	5.0 U	0.50 U	1.0 U	1.0 U	0.73 J	7.52	0.34 J
	3/19/15 (DUP)		2.1	1.0 U	13.8	0.50 U	0.50 U	1.0	2.4	1.0 U	0.28 J	1.3	5.0 U	0.50 U	1.0 U	1.0 U	0.68 J	6.53	0.31 J
	09/15/15		1.3 J	1.0 UJ	16.3 J	0.50 UJ	0.50 UJ	1.0 J	14.5 J	1.0 UJ	0.31 J	11.7 J	5.0 UJ	0.50 UJ	1.0 UJ	1.0 UJ	6.8 J	15.1 J	0.48 J
	09/15/15 (DUP)		1.2 J	1.0 UJ	14.9 J	0.50 UJ	0.50 UJ	1.0 J	12.9 J	1.0 UJ	0.30 J	10.4 J	5.0 UJ	0.50 UJ	1.0 UJ	1.0 UJ	5.9 J	13.4 J	0.42 J
MW-20	07/28/05		1.6	0.5 U	2 U	0.5 U	0.5 U	18	140	0.5 U	0.5	4.3	2 U	0.5 U	0.5 U	0.5 U	1.7	124	0.5 U
	09/20/05		0.39 J	0.13 U	1.1 J	0.12 U	0.14 U	16	130	0.14 U	0.14 U	1.4	0.57 J	0.13 U	0.12 U	0.14 U	1.5	92	0.14 J
	9/20/05 (DUP)		0.35 J	0.13 U	1.0 J	0.12 U	0.14 U	16	130	0.14 U	0.15 J	1.5	0.57 J	0.13 U	0.12 U	0.14 U	1.4	91.9	0.16 J
	03/15/06		1.7 J	0.13 U	0.87 J	0.12 U	0.14 U	16	140	0.14 U	0.12 J	3.0	0.86 J	0.13 U	0.12 U	0.14 U	1.5	144	0.23 J
	09/12/06		0.12 J	0.13 U	0.44 J	0.12 U	0.14 U	15	140	0.14 U	0.15 J	0.17 J	0.56 J	0.13 U	0.12 U	0.14 U	0.86	35	0.22 J
	04/05/07		0.93 J	0.13 U	1.2 J	0.12 U	0.14 U	15	88	0.14 U	0.15 J	0.57	0.74 J	0.13 U	0.12 U	0.14 U	1.6	114	0.21 J
	09/26/07		0.11 U	0.13 U	0.96 J	0.12 U	0.14 U	13	85	0.14 U	0.12 J	0.22 J	0.46 J	0.13 U	0.12 U	0.14 U	1.2	22.7	0.13 J
	05/02/08		0.19 J	0.1 U	0.81 J	0.34 U	0.042 U	11	76	0.042 U	0.16 J	0.26 J	0.46 J	0.077 U	0.05 U	0.07 J	0.93	71	0.14 J
	5/2/08 (DUP)		0.18 J	0.1 U	0.85 J	0.34 U	0.042 U	12	72	0.042 U	0.11 J	0.29 J	0.46 J	0.077 U	0.05 U	0.061 U	1.0	75.2	0.15 J
	09/29/08		0.04 U	0.1 U	0.47	0.073 U	0.042 U	15	110	0.042 U	0.13 J	0.17 J	0.53 J	0.077 U	0.05 U	0.061 U	1.2	8.9	0.13 J
	03/23/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	13	89	1.0 U	0.5 U	65	0.5 U	0.5 U	0.5 U	0.5 U	1.3	86	1.0
	09/30/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	14	190	1.0 U	0.5 U	1.3	0.5 U	0.5 U	0.5 U	0.5 U	0.7	4.0	0.31 J
	03/29/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	18 J	140	1.0 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0	7.1	0.2
	10/01/10		0.5 U	0.5 U	1.27	0.5 U	0.5 U	15.2	195	1.0 U	0.5 U	0.5 U	0.73 J	0.5 U	0.5 U	0.5 U	0.94	4.26	0.12 J
	03/02/11		0.5 U	0.5 U	1.05	0.5 U	0.5 U	12.8	75.5	1.0 U	1.38	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.58	17.7	0.2 U
	09/26/11		0.5 U	0.5 U	0.890	0.5 U	0.5 U	13.9	161	1.0 U	0.5 U	0.5 U	0.620	0.5 U	0.5 U	0.5 U	0.930	4.33	0.2 U
	03/08/12		0.500 U	0.500 U	0.600	0.500 U	0.500 U	10.9	71.6	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.880	4.69	0.200 U
	10/01/12		0.500 U	0.500 U	1.26	0.500 U	0.500 U	14.8	161	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.950	5.10	0.200 U
	03/08/13		0.500 U	0.500 U	0.5 U	0.500 U	0.500 U	0.500 U	4.40	1.00 U	0.500 U	0.890	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.790	0.200 U
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	10.3	100	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.530	3.28
09/27/13		0.500 U	0.500 U	1.10	0.500 U	0.500 U	16.0	122	1.00 U	0.500 U	0.500 U	0.670	0.500 U	0.500 U	0.500 U	1.06	5.51	0.200 U	
03/27/14		0.500 U	0.500 U	1.15	0.500 U	0.500 U	11.7	92.0	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.830	5.00	0.200 U	
09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	11.7	127	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
03/18/15		1.0 U	1.0 U	0.41 J	0.50 U	0.50 U	9.5	70.2	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.85 J	2.26	0.50 U	
09/16/15		1.0 U	1.0 U	0.31 J	0.50 U	0.50 U	14.8	171	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.72 J	3.9	0.50 U	
MW-21	09/14/06		1,700	71	210	5.7 U	7 U	6.8 U	210	6.8 U	8,400	1,700	15 J	160	1,200	190	9,300	8,100	1,500
	9/14/06 (DUP)		1,600	63	200	5.7 U	7 U	6.8 U	210	6.8 U	8,500	1,600	15 J	140	1,000	160	9,300	7,400	1,400
	04/04/07		2,200	57	260	0.5 J	0.35 U	1.3 J	140	0.8 J	8,400	1,900	12	2.5	470	16	11,000	7,600	1,500
	09/25/07		2,400	42	220	2.9 U	3.5 U	3.4 U	230	3.4 U	5,900	1,500	15 J	3 U	100	3.4 U	7,400	6,300	3,100
	05/02/08		2,200	32	190	1.5 U	0.84 U	1.6 J	440	0.84 U	4,000	1,400	9 J	2 U	59	1.3 U	7,000	6,100	3,800
	09/30/08		780	15	220	1.9 U	1.1 U	1.2 U	1,000	1.1 U	2,500	1,700	10 J	2 U	9 J	1.6 U	6,100	7,200	2,600
	03/25/09		700	9.5	240	25 U	25 U	12	1,600	50 U	1,200	1,800	25 U	25 U	8.5 J	7.5	5,800	7,500	1,900
	09/30/09		10 U	25	280	10 U	10 U	10 U	2,600	20 U	4,100	2,100	10 U	10 U	37	10 U	6,200	8,100	8,200
	03/26/10		10 U	10 U	58	0.5 U	0.5 U	18	400	1.0 U	280	740	0.5 U	0.5 U	8.8 J	0.5 U	2,400	1,800	350
	04/16/10		810	19	190	10 U	10 U	10 U	1,400	20 U	3,800	1,600	10 U	10 U	70	10 U	4,700	3,800	2,100
	05/06/10		220	5.0 U	190	10 U	10 U	10 U	1,200	20 U	370	1,900	10 U	5.0 U	34	5.0 U	5,400	4,600	490
	5/6/10 (DUP)		210	5.0 U	180	10 U	10 U	10 U	1,200	20 U	380	1,800	10 U	5.0 U	34	5.0 U	5,400	4,600	520
	06/09/10		110	5.0 U	49	10 U	10 U	10 U	1,000	20 U	67	540	10 U	5.0 U	16	5.0 U	3,200	1,400	150
	07/06/10		90	5.0 U	98	10 U	10 U	10 U	1,600	20 U	42	640	10 U	5.0 U	13	5.0 U	5,500	1,600	210
	7/6/10 (LAB DUP)		80	5.0 U	76	10 U	10 U	10 U	1,500	20 U	34	670	10 U	5.0 U	11	5.0 U	5,000	1,500	170
	09/30/10		90.6	5.0 U	142	10 U	10 U	10 U	1,120	20 U	131	1,120	11.0	5.0 U	10 U	5.0 U	4,890	2,880	243
	03/02/11		288	9.28	174	0.5 U	0.5 U	0.750	1,130	1.0 U	3,330	1,045	4.61	1.92	34.7	2.11	4,630 J	4,250	1,030
	3/2/11 (DUP)		295	9.09	175	0.5 U	0.5 U	0.820	921	1.0 U	2,820	899	4.93	1.81	35.5	1.95	3,830	3,640	875
	3/2/11 (LAB DUP)		286	9.12	177	0.5 U	0.5 U	0.780	869	1.0 U	2,760	873	4.73	1.85	34.3	1.97	3,760	3,560	912
	06/23/11		219	9.72	171	0.5 U	0.5 U	1.15 J	921	1.0 U	2,560	983	3.04	0.780	51.2	1.44	3,630	3,720	1,290
	6/23/11 (DUP)		243	9.83	200	0.5 U	0.5 U	0.800	983	1.0 U	2,630	1,050	3.06	0.630	48.9	1.38	3,760	4,020	1,350
	09/22/11		112	2.72	134	0.5 U	0.5 U	0.790	842	1.0 U	842	926	4.92	0.740	5.26	0.940	6,060	3,822	1,010
	12/07/11		115	5.62	185	0.5 U	0.5 U	0.770	1,190	1.0 U	1,890	1,350	3.82	1.12	8.73	1.15	6,720	5,520	1,460
03/08/12		70.6	2.44	128	0.500 U	0.500 U	0.660	913	1.00 U	979	1,050	2.91	1.02	4.64	0.710	5,250	4,430	801	
06/26/12		96.0	0.810	158	0.500 U	0.500 U	0.8												

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600
MW-22	09/14/06		1,500	14 J	130	5.7 U	7 U	6.8 U	1,700	6.8 U	1,900	1,300	9.7 U	6.3 U	5.8 U	6.7 U	7,700	5,900	2,600
	04/04/07		3,700	22 J	330	5.7 U	7 U	6.8 U	610	6.8 U	3,300	2,300	9.7 U	6.3 U	5.8 U	6.7 U	17,000	9,900	4,800
	4/4/07 (DUP)		3,600	22 J	330	5.7 U	7 U	6.8 U	610	6.8 U	3,100	2,300	9.7 U	6.3 U	5.8 U	6.7 U	17,000	9,900	4,600
	09/26/07		370	18	130	1.2 U	5 U	3 J	1,800	1.4 U	1,600	920	2.2 J	1.3 U	1.4 U	1.4 U	4,000	3,650	1,100
	05/02/08		780	7.2 J	200	1.5 U	0.84 U	3.6 J	2,100	0.84 U	540	1,400	7.6 J	1.6 U	1 U	1.3 U	7,000	5,800	1,400
	10/01/08		12	0.5 U	52	0.85 J	0.21 U	1.6 J	1,100	0.21 U	7.9	610	1.5 J	0.39 U	0.25 U	0.31 U	38	2,170	30
	10/1/08 (DUP)		12	1 U	61	1.0 J	0.42 U	1.7	1,100	0.42 U	6.9	650	2.3 U	0.77 U	0.5 U	0.61 U	34	2,290	27
	03/25/09		72	0.5 U	140	0.5 U	0.5 U	19	1,400	1.0 U	11	960	0.5 U	0.5 U	0.5 U	0.5 U	1,600	3,700	160
	09/30/09		17 J	25 U	39	25 U	25 U	25 U	1,100	50 U	17 J	730	25 U	25 U	25 U	25 U	170	3,100	960
	03/29/10		24	0.5 U	44	0.5 U	0.5 U	0.5 U	480	1.0 U	0.5 U	650	10 U	25 U	0.5 U	0.5 U	840	1,500	7.4
	09/30/10		10 U	0.5 U	45.2	10 U	10 U	10 U	611	20 U	2.6 J	296	10.8	5.0 U	10 U	0.5 U	24.4	751	2.0 UJ
	03/04/11		26.9	0.780	161	0.540	0.5 U	1.20	531	1.0 U	184	531	0.5 U	0.500	0.5 U	16.7	596	2,750	74.1
	06/23/11		3.98	0.660	45.9	0.5 U	0.5 UJ	0.64	173	1.0 U	2.27	148	0.580	0.5 U	0.5 U	0.5 U	55.4	1,008	1.13
	09/23/11		7.40	0.5 U	74.2	0.5 U	0.5 U	0.920	173	1.0 U	2.10	422	1.19	0.5 U	0.5 U	0.5 U	79.0	1,828	9.27
	12/07/11		13.1	0.5 U	137	0.5 U	0.5 U	0.550	272	1.0 U	10.1	760	0.770	0.5 U	0.5 U	0.5 U	1,390	3,081	32.4
	03/08/12		13.1	0.500 U	169	0.500 U	0.500 U	0.500 U	286	1.00 U	1.15	815	0.520	0.500 U	0.500 U	0.500 U	1,630	3,388	6.8
	06/26/12		38.9	0.560	166	0.500 U	0.500 U	0.730	280	1.00 U	1,300	807	0.510	0.500 U	2.06	0.500 U	1,910	3,336	1,750 J
	6/26/12 (DUP)		38.3	0.500 U	178	0.500 U	0.500 U	0.720	282	1.00 U	1,030	743	0.500 U	0.500 U	1.93	0.500 U	1,750	3,002	1,230 J
	10/02/12		30.4	0.500 U	136	0.500 U	0.500 U	0.680	204	1.00 U	623	552	0.500 U	0.500 U	0.500 U	0.500 U	728	2,643	1,520
	12/19/12		9.76	1.63	172	0.500 U	0.500 U	0.500 U	278	1.00 U	244	732	0.500 U	1.05	0.500 U	64.5	260	3,455	208
	03/06/13		17.4	0.677	51.5 J	0.500 U	0.500 U	0.560	0.5 U	1.00 U	1,310	376 J	1.06	4.41	1.26	185	156	2,168 J	712
	06/06/13		21.9	2.60	69.5	0.500 U	0.500 U	0.510	88.0	1.00 U	1,760	199	0.500 U	0.500 U	1.86	0.500 U	550	1,004	1,600
	09/25/13		7.88	0.500 U	168	0.500 U	0.500 U	0.500 U	104	1.00 U	25.0	256	0.500 U	0.500 U	0.500 U	0.500 U	25.0	1,911	45.6
03/26/14		9.71	0.789	105	0.500 U	0.500 U	0.500 U	113	1.00 U	426	121	0.500 U	0.500 U	0.500 U	0.500 U	55.1	1,207.4	422	
09/24/14		3.14	0.500 U	121	0.500 U	0.500 U	0.500 U	45.1	1.00 U	0.500 U	48.3	0.500 U	0.500 U	0.500 U	0.500 U	2.90	1,423.1	0.200 U	
09/24/14 (DUP)		3.19	0.500 U	142	0.500 U	0.500 U	0.500 U	59.5	1.00 U	0.500 U	43.7	0.500 U	0.500 U	0.500 U	0.500 U	2.56	1,283.5	0.345	
03/17/15		7.5 J	25 U	68.4	13 U	13 U	13 U	22.7 J	25 U	1,100	40.5	130 U	13 U	25 U	25 U	81.3	556.1	535	
09/15/15		1.9 J	2.0 UJ	36.0 J	1.0 UJ	1.0 UJ	1.0 UJ	18.9 J	2.0 UJ	64.1 J	6.6 J	10 UJ	1.0 UJ	2.0 UJ	2.0 UJ	11.4 J	235.6 J	86.1 J	
MW-23	09/13/06		0.36 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	0.96	0.13 U	0.2 U	0.28 J	0.12 U	0.14 U	0.11 U	0.22 U	0.09 J
	04/04/07		0.14 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	3.2	0.13 U	0.2 U	1.8	0.12 U	0.22 J	0.11 U	0.22 U	0.09 J
	09/25/07		0.25 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	2.4	0.13 U	0.2 U	1.7	0.12 U	0.17 J	0.11 U	0.22 U	0.13 J
	9/25/07 (DUP)		0.26 J	0.13 U	0.15 U	0.12 U	0.14 U	0.14 U	0.23 U	0.14 U	2.1	0.13 U	0.2 U	1.9	0.12 U	0.17 J	0.11 U	0.22 U	0.12 J
	05/01/08		0.18 J	0.18 J	0.037 U	0.073 U	0.12 J	0.045 U	0.13 U	0.042 U	3.2	0.042 U	0.23 U	2.9	0.05 U	0.25 J	0.07 JB	0.078 U	0.08 J
	10/01/08		0.26 J	0.1 U	0.037 U	0.073 U	0.12 J	0.045 U	0.13 U	0.042 U	1.7	0.042 U	0.23 U	3.3	0.05 U	0.23 J	0.17 JB	0.078 U	0.10 J
	03/24/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.9	0.5 U	0.5 U	1.2	0.5 U	0.5 U	0.5 U	0.5 U	1.0
	09/29/09		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	1.1	0.5 U	0.5 U	2.2	0.5 U	0.5 U	0.5 U	0.5 U	0.20 J
	04/01/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.5	0.5 U	0.5 U	2.9	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/28/10		0.31 J	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.63	0.5 U	0.5 U	1.17	0.5 U	0.5 U	0.5 U	0.5 U	0.2 UJ
	03/02/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.680	1.0 U	5.73	0.730	0.5 U	1.76	0.5 U	0.5 U	2.32	3.43	0.2 U	
	06/22/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	3.16	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	09/23/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	2.16	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	12/07/11		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	0.50 U	0.5 U	3.56	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.2 U
	03/07/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.04	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	06/26/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	4.86	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/27/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	2.64	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	12/19/12		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	1.83	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/05/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.42	1.08	0.500 U	1.85	0.500 U	1.03	0.650	1.68	0.200 U
	06/06/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	5.46	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/24/13		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	1.26	0.500 U	0.500 U	2.17	0.500 U	0.500 U	0.500 U	0.920	0.200 U
	03/26/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	7.36	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	3.32	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
09/25/14 (DUP)		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	3.23	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U	
03/18/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	6.4	1.0 U	0.33 J	1.0 U	1.0 U	0.50 U	
09/14/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	5.1	1.0 U	0.27 J	1.0 U	1.0 U	0.50 U	
MW-24	03/26/10		540	17	230	0.5 U	0.5 U	0.9	160	4.5	4,100	1,900	0.5 U	0.5 U	680	160	4,800	3,600	1,200
	04/16/10		260	10 U	18	10 U	10 U	10 U	1,100	20 U	80	1,300	10 U	10 U	10 U	5.0 U	3,800	3,300	320
	05/06/10		820	5.0 U	72	10 U	10 U												

Table B-2

Indicator Hazardous Substances in Groundwater
Univar USA Inc., Kent, Washington

Sample Location	Date Collected	Intake Depth (ft bgs)	1,1-DCA	1,1-DCE	1,2,4-TMB	1,2-DCA	1,2-Dichloro-propane	Benzene	Chloro-ethane	Chloro-form	cis-1,2-DCE	Ethyl-benzene	Methylene Chloride	PCE	1,1,1-TCA	TCE	Toluene	Total Xylenes	Vinyl Chloride
			5,100,000	3,350,000	LNAPL	8,690,000		0.8	LNAPL	8,200,000	3,500,000	LNAPL	20,000,000	200,000	720,000	1,100,000	1,000	LNAPL	LNAPL
			Final Cleanup Levels	800	7.0	400	0.5	0.64	0.8	15	7.2	70	700	5.0	0.86	200	4.0	1,000	1,600
MW-26 (continued)	4/9/10 (LAB DUP)		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	10	10 U	10 U	550	10 U	27	10 U	10 U	6.2
	04/16/10		10 U	10 U	10 U	10 U	10 U	10 U	10 U	20 U	16	10 U	10 U	320	10 U	32	10 U	10 U	8.8
	05/06/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	11	10 U	10 U	300	10 U	28	10 U	10 U	5.2
	06/09/10		10 U	5.0 U	10 U	10 U	10 U	10 U	10 U	20 U	14	10 U	10 U	350	10 U	31	10 U	10 U	12
	07/06/10		0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U	1.0 U	12	0.5 U	0.5 U	300	0.5 U	29	0.5 U	0.5 U	9.0
MW-27	09/24/14		0.569	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/18/15		0.33 J	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	1.0 U	1.0 U	0.43 J	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.45 J	1.0 U	0.50 U
	09/16/15		0.46 J	1.0 U	2.0 U	0.50 U	0.50 U	0.43 J	1.0 U	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.38 J	0.50 U	
MW-28	09/25/14		0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	1.00 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.500 U	0.200 U
	03/19/15		1.0 U	1.0 U	2.0 U	0.50 U	0.50 U	0.50 U	0.60 J	1.0 U	1.0 U	1.0 U	5.0 U	0.50 U	1.0 U	1.0 U	0.56 J	1.0 U	0.50 U
	09/17/15		5.0 U	5.0 U	10 U	2.5 U	2.5 U	2.5 U	2.6 J	5.0 U	5.0 U	5.0 U	25 U	2.5 U	5.0 U	5.0 U	5.0 U	5.0 U	2.5 U
INJ-1	07/09/01		9.3	0.65 J	NA	0.58 U	0.62 U	0.5 U	25	0.48 U	29	NA	U	620	0.56 U	97	NA	NA	2.9
	11/20/01		1.2	0.5 U	NA	0.5 U	0.5 U	0.21 U	2.8	0.5 U	8.1	0.5 U	1 U	17	0.5 U	30	0.5 U	0.5 U	0.50 U
	06/11/02		0.60 J	1.9	0.29 U	0.23 U	0.26 U	NA	0.46 U	0.2 U	520	0.26 U	0.39 U	8.5	0.23 U	3.7	0.2 U	0.6 U	0.44 J
INJ-2	07/09/01		< 2.3 U	3 U	NA	2.9 U	3.1 U	0.5 U	4.4 U	2.4 U	200	NA	4.9 U	6,300	2.8 U	240	NA	NA	5.5 J
	10/15/01	18	< 0.5 U	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	1.1	1.6	1 U	33	0.5 U	1.8	0.5 U	6	0.5 U
	10/22/01	18	< 0.5 U	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	2	2.9	1 U	57	0.5 U	2.8	0.53	11.3	0.5 U
	10/29/01	18	< 0.5 U	0.5 U	NA	0.5 U	0.5 U	0.5 U	0.50 U	0.5 U	2.9	1.4	1 U	68	0.5 U	4.3	0.65	6.8	0.5 U
	11/19/01		< 0.5 U	0.5 U	NA	0.5 U	0.5 U	1.1 U	0.50 U	0.5 U	7.3	0.89	1 U	230	0.5 U	9.2	0.5 U	4.4	0.5 U
	06/11/02		< 0.91 U	5.4	1.5 U	1.2 U	1.3 U	1.1 U	2.3 U	0.96 U	2,100	1.3 U	2 U	1,000	1.2 U	600	0.98 U	2.9 U	2.2 U
	06/10/03		< 0.91 U	5.3	1.5 U	1.2 U	1.3 U	NA	2.3 U	0.96 U	2,100	1.3 U	2 U	2,700	1.2 U	610	1.1 JB	2.9 U	2.2 U
INJ-3	07/09/01		3.4	0.95 J	NA	0.58 U	0.62 U	1 U	5.9	0.48 U	39	NA	0.97 U	520	0.56 U	250	NA	NA	7.3
	11/20/01		1.0 U	1.0 U	NA	1.0 U	1.0 U	0.53 U	1.0 U	1.0 U	49	1.0 U	2 U	670	1.0 U	130	1.0 U	1.0 U	1.8
	06/11/02		1.2 J	3.4	0.71 U	0.57 U	0.62 U	1.3	1.2 U	0.48 U	1,200	0.65 U	0.97 U	530	0.57 U	240	0.49 U	1.5 U	180
	12/17/02		2.0	0.53	2 U	0.5 U	0.5 U	1.2	0.50 U	0.5 U	250	0.5 U	2 U	150	0.5 U	100	0.5 U	0.5 U	90
	12/17/02 (DUP)		1.9	0.6	2 U	0.5 U	0.5 U	0.21 U	0.50 U	0.5 U	270	0.5 U	2 U	180	0.5 U	120	0.5 U	0.5 U	91
P-1	09/24/04		0.40 J	0.98 J	0.29 U	0.23 U	0.25 U	0.11 U	2.2	0.2 U	350	0.26 U	0.39 U	390	0.23 U	140	0.8 B	0.44 U	78
P-1	09/24/04		0.28 J	0.12 U	0.15 U	0.12 U	0.13 U	NA	0.23 U	0.096 U	1.2	0.13 U	0.2 U	0.11 U	0.12 U	0.12 U	0.098 U	0.22 U	0.22 U

NOTES: All results in ug/L. E = laboratory estimated concentration.
 1995 analyses performed using EPA Method 8240 Results from June 2000 and from December 2000 to September 2008 are reported relative to the method detection limits (MDLs).
 Analyses since 1996 performed using EPA Method 8240 are reported relative to the method detection limits (MDLs).
 Only indicator hazardous substances shown. 1,2,4-TMB = 1,2,4-trimethylbenzene.
 Detections shown in bold. 1,1-DCA = 1,1-dichloroethane.
 Shaded results above their respective cleanup level. 1,2-DCA = 1,2-dichloroethane.
 U = not detected above associated method reporting limit. 1,1-DCE = 1,1-dichloroethane.
 NA = not analyzed or not quantitated. cis-1,2-DCE = cis-1,2-dichloroethane.
 DUP = duplicate sample collected in the field and TCA = 1,1,1-trichloroethane.
 LAB DUP = laboratory duplicate sample. TCE = trichloroethane.
 B = the analyte was also detected in an associated PCE = tetrachloroethane.
 J = the associated numerical value is an estimated quantity based on data review or laboratory estimate above the MDL but below the MRL.

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity			Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1	
MW-1	09/04/96	130	NA	NA	88.0	NA	NA	NA	NA	2.1	29.6	NA	NA	NA	NA	NA	NA	990	
	12/15/98	68.5	NA	< 0.2	4.3	0.070	500	NA	47.0	NA	NA	23.4	24.6	NA	NA	NA	NA	NA	
	03/02/99	64.5	NA	0.2	5.8	0.266	540	NA	37.0	NA	NA	29.4	18.2	NA	NA	NA	NA	NA	
	06/17/99	49	NA	0.3	6.7	0.110	460	NA	40.5	NA	NA	24.0	20.8	NA	NA	NA	NA	NA	
	09/16/99	59.8	NA	< 0.2	7.2	0.249	400	NA	42.1	NA	NA	11.0	18.8	NA	NA	NA	NA	NA	
	09/18/02	NA	NA	NA	NA	NA	NA	NA	37	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/08/12	27.1	NA	< 0.100	3.50	< 0.500	NA	352	NA	NA	NA	NA	1.0	10.4	1.87	NA	NA	NA	
	10/01/12	28.9	NA	< 0.100	21.0	< 0.500	NA	290	NA	NA	NA	NA	2.0	7.86	1.64	NA	NA	NA	
03/13/13	17.8	NA	< 0.100	3.2	< 0.500	NA	362	NA	NA	NA	NA	1.8	11.4	1.66	NA	NA	NA		
MW-2	09/04/96	18.0	NA	NA	0.3	NA	NA	NA	NA	3.21	112	NA	NA	NA	NA	NA	NA	576	
	12/15/98	13.6	NA	0.3	5.3	0.017	260	NA	26.4	NA	NA	23.9	30.4	NA	NA	NA	NA	NA	
	03/02/99	14.3	NA	0.9	13.1	0.037	360	NA	22.8	NA	NA	46.4	23.0	NA	NA	NA	NA	NA	
	06/16/99	13	NA	1.0	7.5	0.054	420	NA	24.2	NA	NA	86.5	66.7	NA	NA	NA	NA	NA	
	6/16/99 (DUP)	12.2	NA	1.3	12.8	NA	NA	NA	25.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/16/99	14.6	NA	< 0.2	< 0.2	0.037	400	NA	27.2	NA	NA	94.6	61.9	NA	NA	NA	NA	NA	
09/18/02	NA	NA	NA	NA	NA	NA	NA	33	NA	NA	NA	NA	NA	NA	NA	NA	NA		
MW-3	09/04/96	26.0	NA	NA	0.9	NA	NA	NA	NA	3.17	36.3	NA	NA	NA	NA	NA	NA	952	
	9/4/96 (DUP)	26.0	NA	NA	1.1	NA	NA	NA	NA	3.13	38.5	NA	NA	NA	NA	NA	NA	976	
	12/14/98	29.8	NA	< 0.2	< 0.2	< 0.001	660	NA	44.5	NA	NA	34.4	34.2	NA	NA	NA	NA	NA	
	03/03/99	25.6	NA	< 0.2	0.3	0.013	640	NA	52.8	NA	NA	33.0	31.7	NA	NA	NA	NA	NA	
	06/17/99	17.1	NA	< 0.2	< 0.2	0.013	640	NA	57.9	NA	NA	59.7	38.0	NA	NA	NA	NA	NA	
	09/17/99	14.5	NA	< 0.2	< 0.2	0.047	520	NA	62.4	NA	NA	100.1	47.7	NA	NA	NA	NA	NA	
MW-4	09/04/96	110	NA	NA	37.0	NA	NA	NA	NA	9.89	83.9	NA	NA	NA	NA	NA	NA	796	
	12/14/98	89.7	NA	< 0.2	15.6	0.026	840	NA	23.4	NA	NA	59.8	59.1	NA	NA	NA	NA	NA	
	03/03/99	45.0	NA	< 0.2	183	0.880	900	NA	12.8	NA	NA	12.9	7.5	NA	NA	NA	NA	NA	
	06/17/99	60.9	NA	0.3	61.7	0.159	840	NA	18.2	NA	NA	6.99	4.75	NA	NA	NA	NA	NA	
	09/17/99	77.3	NA	< 0.2	2.0	0.071	870	NA	18.4	NA	NA	24.3	13.4	NA	NA	NA	NA	NA	
	09/18/02	NA	NA	NA	NA	NA	NA	NA	19	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/23/11	NA	NA	NA	NA	NA	NA	NA	19	NA	NA	NA	3.2	NA	NA	NA	NA	NA	
	03/08/12	31.9	NA	1.63	18.2	< 0.500	NA	878	13.4	NA	NA	NA	3.0	24.7	3.65	NA	NA	NA	
	10/01/12	30.9	NA	< 0.100	14.2	< 0.500	NA	758	NA	NA	NA	NA	NA	11.5	2.62	NA	NA	NA	
03/06/13	27.1	NA	< 0.100	37.6	< 0.500	NA	844	NA	NA	NA	NA	3.7	18.9	2.80	NA	NA	NA		
MW-5	09/04/96	17.0	NA	NA	32	NA	NA	NA	NA	0.34	0.107	NA	NA	NA	NA	NA	NA	332	
	12/15/98	17.5	NA	< 0.2	17.3	0	200	NA	7.8	NA	NA	0.090	0.024	NA	NA	NA	NA	NA	
	03/02/99	6.9	NA	2.4	22.0	0.002	145	NA	4.8	NA	NA	0.137	0.060	NA	NA	NA	NA	NA	
	06/16/99	6.2	NA	2.5	20.5	0.002	180	NA	6.0	NA	NA	0.125	0.042	NA	NA	NA	NA	NA	
	09/16/99	6.8	NA	1.5	20.7	0.001	160	NA	5.9	NA	NA	0.052	0.008	NA	NA	NA	NA	NA	
	9/16/99 (DUP)	6.2	NA	1.5	20.4	NA	NA	NA	5.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/18/02	NA	NA	NA	NA	NA	NA	NA	7.2	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/13/06	NA	NA	0.6	34.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/01/10	NA	< 0.1	NA	NA	NA	NA	NA	6.3	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/09/10	NA	< 0.1	NA	NA	NA	NA	NA	5.7	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/16/10	NA	< 0.1	NA	NA	NA	NA	NA	6.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	4/16/10 (LAB DUP)	NA	< 0.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	05/06/10	NA	< 2.0	NA	NA	NA	NA	NA	5.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	06/09/10	NA	< 0.1	NA	NA	NA	NA	NA	5.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	
07/06/10	NA	< 0.1	NA	NA	NA	NA	NA	4.8	NA	NA	NA	NA	NA	NA	NA	NA	NA		
07/06/10	NA	NA	NA	NA	NA	NA	NA	5.6	NA	NA	NA	NA	NA	NA	NA	NA	NA		

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity			Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1	
MW-5 (continued)	03/03/11	3.68	NA	0.645	24.8	< 0.5	NA	109	4.40	NA	NA	NA	NA	0.0564	0.0128	NA	NA	NA	
	3/3/11 (LAB DUP)	3.68	NA	0.666	24.7	NA	NA	108	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	06/22/11	2.26	NA	0.743	11.2	< 0.500	NA	111	4.32	NA	NA	NA	NA	< 0.1	0.105	NA	NA	NA	
	09/22/11	2.32	NA	0.161	11.6	< 0.500	NA	142	3.87	NA	NA	NA	2.8	0.376	0.252	NA	NA	NA	
	12/07/11	2.27	NA	0.146	11.5	< 0.500	NA	118	5.65	NA	NA	NA	0.8	0.241	0.316	NA	NA	NA	
	03/07/12	2.50	NA	< 0.100	15.3	< 0.500	NA	124	5.07	NA	NA	NA	0.8	0.425	0.635	NA	NA	NA	
	06/26/12	2.74	NA	< 0.100	16.1	< 0.500	NA	142	4.94	NA	NA	NA	NA	1.82	0.304	NA	NA	NA	
	09/27/12	2.66	NA	< 0.100	12.1	< 0.500	NA	154	6.38	NA	NA	NA	1.0	1.33	0.215	NA	NA	NA	
	12/19/12	3.30	NA	< 0.100	10.1	< 0.500	NA	158	8.92	NA	NA	NA	NA	9.49	0.555	NA	NA	NA	
	3/6/2013 (DUP)	3.02	NA	< 0.100	11.5	< 0.500	NA	162	5.39	NA	NA	NA	3.4	6.66	0.320	NA	NA	NA	
	03/06/13	3.09	NA	< 0.100	11.4	< 0.500	NA	159	5.08	NA	NA	NA	NA	6.15	0.304	NA	NA	NA	
	06/06/13	NA	NA	NA	NA	NA	NA	NA	6.51	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/26/13	NA	NA	NA	NA	NA	NA	NA	7.11	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	9/26/13 (DUP)	NA	NA	NA	NA	NA	NA	NA	7.20	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/25/14	NA	NA	NA	NA	NA	NA	NA	7.09	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/23/14	NA	NA	NA	NA	NA	NA	NA	8.75	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/16/15	NA	NA	NA	NA	NA	NA	NA	6.8	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/15/15	NA	NA	NA	NA	NA	NA	NA	7.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
MW-6	09/04/96	340	NA	NA	0.6	NA	NA	NA	NA	9.28	222	NA	NA	NA	NA	NA	NA	1,260	
	12/15/98	199	NA	< 0.2	11.7	0.014	460	NA	22.6	NA	NA	114	125	NA	NA	NA	NA	NA	
	03/02/99	213	NA	0.6	19.8	0.015	500	NA	15.8	NA	NA	170	63	NA	NA	NA	NA	NA	
	3/2/99 (DUP)	208	NA	0.6	46.6	NA	NA	NA	15.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	06/16/99	232	NA	0.3	11.6	0.009	520	NA	21	NA	NA	192	120	NA	NA	NA	NA	NA	
	09/16/99	130	NA	< 0.5	27.3	0.047	480	NA	18.5	NA	NA	169	95	NA	NA	NA	NA	NA	
	09/18/02	NA	NA	NA	NA	NA	NA	NA	20	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-7	12/14/98	5.4	NA	< 0.2	1.6	0.003	260	NA	9.4	NA	NA	3.36	3.17	NA	NA	NA	NA	NA	
	03/03/99	5.7	NA	1.3	12.7	0.010	180	NA	6.5	NA	NA	1.79	1.72	NA	NA	NA	NA	NA	
	06/17/99	6.8	NA	2.3	25.1	0.005	200	NA	9.2	NA	NA	2.21	1.86	NA	NA	NA	NA	NA	
	09/17/99	8.1	NA	0.3	21.4	0.004	240	NA	10.6	NA	NA	3.58	2.98	NA	NA	NA	NA	NA	
	03/02/11	2.63	NA	2.77	9.10	< 0.5	NA	94.7	3.65	NA	NA	NA	NA	< 0.1	< 0.002	NA	NA	NA	
	3/2/11 (LAB DUP)	2.61	NA	2.79	9.18	NA	NA	93.2	NA	NA	NA	NA	NA	< 0.1	< 0.002	NA	NA	NA	
	06/22/11	3.16	NA	1.37	9.88	NA	NA	110	5.30	NA	NA	NA	NA	< 0.1	0.00406	NA	NA	NA	
	09/22/11	3.55	NA	0.132	10.1	< 0.500	NA	144	7.04	NA	NA	NA	3.00	0.272	0.150	NA	NA	NA	
	12/07/11	4.02	NA	0.344	14.5	< 0.500	NA	186	9.44	NA	NA	NA	1.5	0.161	0.227	NA	NA	NA	
	03/07/12	2.93	NA	1.49	8.72	< 0.500	NA	108	5.13	NA	NA	NA	0.0	0.154	0.005	NA	NA	NA	
	06/26/12	2.63	NA	1.04	8.28	< 0.500	NA	126	5.52	NA	NA	NA	NA	0.119	0.044	NA	NA	NA	
	09/27/12	3.23	NA	< 0.100	11.3	< 0.500	NA	150	11.2	NA	NA	NA	0.1	0.181	0.363	NA	NA	NA	
	12/19/12	5.93	NA	< 0.100	24.6	< 0.500	NA	326	18.3	NA	NA	NA	NA	0.0739	0.964	NA	NA	NA	
	03/05/13	3.12 J	NA	< 0.100	10.1	< 0.500	NA	186	8.58	NA	NA	NA	0.4	0.308	0.792	NA	NA	NA	
	06/06/13	NA	NA	NA	NA	NA	NA	NA	6.37	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/24/13	NA	NA	NA	NA	NA	NA	NA	11.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/26/14	NA	NA	NA	NA	NA	NA	NA	2.66	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
09/25/14	NA	NA	NA	NA	NA	NA	NA	12.3	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
03/18/15	NA	NA	NA	NA	NA	NA	NA	2.6	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/14/15	NA	NA	NA	NA	NA	NA	NA	11.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-8	12/14/98	9.2	NA	< 0.2	20.4	NA	260	NA	10.0	NA	NA	1.13	0.98	NA	NA	NA	NA	NA	
	12/14/98 (DUP)	9.3	NA	< 0.2	20.4	NA	NA	NA	10.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/02/99	12.7	NA	0.3	29.7	0.023	260	NA	8.9	NA	NA	2.03	0.77	NA	NA	NA	NA	NA	

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity			Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1	
MW-8 (continued)	06/16/99	12.8	NA	< 0.2	29.1	0.009	240	NA	9.6	NA	NA	0.70	0.50	NA	NA	NA	NA	NA	
	09/16/99	10.5	NA	< 0.2	21.1	0.007	260	NA	10.5	NA	NA	1.02	0.45	NA	NA	NA	NA	NA	
	09/18/02	NA	NA	NA	NA	NA	NA	NA	11.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-11	04/01/10	NA	< 0.1	NA	NA	NA	NA	NA	5.8	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/09/10	NA	0.35	NA	NA	NA	NA	NA	4.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/16/10	NA	0.35	NA	NA	NA	NA	NA	5.7	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	05/06/10	NA	2.6	NA	NA	NA	NA	NA	5.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	5/6/10 (LAB DUP)	NA	2.6	NA	NA	NA	NA	NA	6.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	06/09/10	NA	3.9	NA	NA	NA	NA	NA	5.2	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	6/9/10 (LAB DUP)	NA	3.9	NA	NA	NA	NA	NA	5.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	
07/06/10	NA	8.1	NA	NA	NA	NA	NA	5.6	NA	NA	NA	NA	NA	NA	NA	NA	NA		
MW-12	03/03/11	3.81	NA	7.85	20.8	< 0.5	NA	102	9.80	NA	NA	NA	NA	0.244	0.0283	NA	NA	NA	
	06/22/11	2.51	NA	0.176	13.8	< 0.500	NA	176	47.7	NA	NA	NA	NA	56.4	0.734	NA	NA	NA	
	09/22/11	3.42	NA	< 0.100	12.1	< 0.500	NA	157	16.1	NA	NA	NA	3.2	34.7 J	0.187	NA	NA	NA	
	9/22/11 (DUP)	3.52	NA	< 0.100	11.6	< 0.500	NA	127	20.8	NA	NA	NA	NA	24.1 J	0.169	NA	NA	NA	
	12/07/11	3.75	NA	< 0.100	8.75	< 0.500	NA	159	16.0	NA	NA	NA	1.8	21.6	0.144	NA	NA	NA	
	03/07/12	2.82	NA	< 0.100	11.5	< 0.500	NA	190	13.5	NA	NA	NA	3.0	15.7	0.159	NA	NA	NA	
	3/7/12 (DUP)	2.81	NA	< 0.100	11.4	< 0.500	NA	186	14.7	NA	NA	NA	NA	15.8	0.172	NA	NA	NA	
	06/26/12	5.22	NA	< 0.100	9.52	< 0.500	NA	230	17.9	NA	NA	NA	NA	14.1	0.274	NA	NA	NA	
	10/02/12	4.98	NA	< 0.100	6.57	< 0.500	NA	201	20.0	NA	NA	NA	1.8	17.1	0.154	NA	NA	NA	
	12/19/12	5.22	NA	< 0.100	7.93	< 0.500	NA	199	15.1	NA	NA	NA	NA	16.4	0.181	NA	NA	NA	
	03/06/13	4.79	NA	< 0.100	7.62	< 0.500	NA	167	12.0	NA	NA	NA	3.8	14.6	0.143	NA	NA	NA	
	06/06/13	NA	NA	NA	NA	NA	NA	NA	11.5	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/25/13	NA	NA	NA	NA	NA	NA	NA	13.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/25/14	NA	NA	NA	NA	NA	NA	NA	NA	11.7	NA	NA	NA	NA	NA	NA	NA	NA	NA
	3/25/14 (DUP)	NA	NA	NA	NA	NA	NA	NA	NA	11.6	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/23/14	NA	NA	NA	NA	NA	NA	NA	NA	15.6	NA	NA	NA	NA	NA	NA	NA	NA	NA
03/16/15	NA	NA	NA	NA	NA	NA	NA	NA	10.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/15/15	NA	NA	NA	NA	NA	NA	NA	NA	12.8	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-13	09/24/04	56.1	NA	< 0.2	0.6	0.05	260	NA	40.3	1.40	37.1	NA	1.5	NA	NA	NA	NA	NA	
	04/05/05	4.3	NA	< 0.1	6.1	< 0.01	50	NA	5.8	0.145	3.3	NA	2.4	NA	NA	NA	NA	NA	
	09/14/06	NA	NA	< 0.1	< 0.2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/29/10	NA	0.45	NA	NA	NA	NA	NA	29	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	3/29/10 (LAB DUP)	NA	0.48	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/07/10	NA	0.44	NA	NA	NA	NA	NA	30	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	4/7/10 (LAB DUP)	NA	0.46	NA	NA	NA	NA	NA	30	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	04/16/10	NA	0.47	NA	NA	NA	NA	NA	30	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	05/06/10	NA	< 2.0	NA	NA	NA	NA	NA	32	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	06/09/10	NA	0.64	NA	NA	NA	NA	NA	34	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	07/06/10	NA	0.66	NA	NA	NA	NA	NA	32	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/03/11	42.2	NA	< 0.1	0.253	< 0.5	NA	242	47.1	NA	NA	NA	NA	33.7	1.87	NA	NA	NA	
	3/3/11 (LAB DUP)	NA	NA	NA	NA	NA	NA	NA	48.3	NA	NA	NA	NA	34.4	1.84	NA	NA	NA	
	06/23/11	32.1	NA	< 0.1 J	0.894	< 0.500	NA	274	72.0	NA	NA	NA	NA	54.3	2.67	NA	NA	NA	
09/22/11	39.4	NA	< 0.1	0.563	< 0.500	NA	264	63.5	NA	NA	NA	2.6	63.6	2.36	NA	NA	NA		
12/07/11	38.6	NA	< 0.1	0.801	< 0.500	NA	303	47.7	NA	NA	NA	4.9	49.8	2.09	NA	NA	NA		
03/07/12	35.1	NA	< 0.100	< 0.300	< 0.500	NA	324	31.0	NA	NA	NA	5.0	49.6	1.77	NA	NA	NA		
06/27/12	32.7	NA	0.856	< 0.300	< 0.500	NA	306	31.0	NA	NA	NA	NA	45.0	1.89	NA	NA	NA		
10/02/12	29.6	NA	< 0.100	0.630	< 0.500	NA	292	19.6	NA	NA	NA	1.9	32.3	1.38	NA	NA	NA		
12/19/12	30	NA	< 0.100	0.788	< 0.500	NA	267	20.2	NA	NA	NA	NA	38.4	1.35	NA	NA	NA		

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity		Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS	
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1	
MW-13 (continued)	03/07/13	28.6	NA	< 0.100	< 0.300	< 0.500	NA	386	15.8	NA	NA	NA	1.8	38.1	1.39	NA	NA	NA	
	06/06/13	NA	NA	NA	NA	NA	NA	NA	16.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/25/13	NA	NA	NA	NA	NA	NA	NA	11.3	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/26/14	NA	NA	NA	NA	NA	NA	NA	12.5	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/23/14	NA	NA	NA	NA	NA	NA	NA	15.2	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/17/15	NA	NA	NA	NA	NA	NA	NA	1.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/15/15	NA	NA	NA	NA	NA	NA	NA	7.7	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-14	09/24/04	6.2	NA	< 0.2	< 0.2	< 0.01	240	NA	11.8	1.12	32.7	NA	2.0	NA	NA	NA	NA	NA	
	04/05/05	6.3	NA	< 0.1	< 0.2	< 0.01	215	NA	12.8	1.24	35.7	NA	1.8	NA	NA	NA	NA	NA	
MW-15	09/24/04	6.6	NA	< 0.2	< 0.2	< 0.01	240	NA	7.9	1.33	34.8	NA	1.6		NA	NA	NA	NA	
	04/05/05	7.5	NA	< 0.1	< 0.2	< 0.01	190	NA	8.0	1.41	35.9	NA	2.0		NA	NA	NA	NA	
	09/13/06	NA	NA	< 0.1	< 0.2	NA	NA	NA	NA	NA	NA	NA	NA		NA	NA	NA	NA	
MW-16	09/23/04	33.5	NA	< 0.2	8.1	< 0.01	420	NA	24.1	3.71	108	NA	2.0	NA	NA	NA	NA	NA	
	04/05/05	36.2	NA	< 0.1	1.1	< 0.01	295	NA	23.6	3.92	114	NA	2.2	NA	NA	NA	NA	NA	
MW-17	09/23/04	49.7	NA	< 0.2	< 0.2	< 0.01	1,320	NA	32.9	1.77	55.7	NA	2.4	NA	NA	NA	NA	NA	
	9/23/04 (DUP)	46.9	NA	< 0.2	< 0.2	NA	NA	NA	32.8	1.75	54.9	NA	NA	NA	NA	NA	NA	NA	
	04/05/05	50.0	NA	< 0.1	< 0.2	< 0.01	230	NA	32.7	0.92	40.1	NA	2.5	NA	NA	NA	NA	NA	
	09/12/06	NA	NA	< 0.1	0.3	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	3/7/11 (LAB DUP)	03/07/11	49.4	NA	< 0.1	0.240	< 0.5	NA	707	34.8	NA	NA	NA	NA	50.3	2.18	34.1	13.5	NA
		06/23/11	51.8	NA	< 0.1	0.239	< 0.5	NA	691	34.7	NA	NA	NA	NA	50.8	2.16	37.0	15.7	NA
		09/23/11	51.1	NA	< 0.1	0.627	< 0.500	NA	436	25.1	NA	NA	NA	2.8	37.4	1.11	NA	NA	NA
	03/08/12	56.7	NA	0.130	0.312	< 0.500	NA	582	41.8	NA	NA	NA	2.0	51.6	1.44	NA	NA	NA	
	06/27/12	64.6	NA	1.34	0.335	< 0.500	NA	597	37.1	NA	NA	NA	NA	54.3	1.87	NA	NA	NA	
	10/01/12	49.6	NA	< 0.100	0.622	< 0.500	NA	536	32.5	NA	NA	NA	3.0	24.7	0.843	NA	NA	NA	
	12/19/12	54.7	NA	0.601	0.743	< 0.500	NA	582	42.6	NA	NA	NA	NA	58.4	1.98	NA	NA	NA	
	03/07/13	64.3	NA	0.103	< 0.300	< 0.500	NA	445	30.5	NA	NA	NA	5.6	48.0	1.26	NA	NA	NA	
	06/06/13	NA	NA	NA	NA	NA	NA	NA	32.3	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	09/26/13	NA	NA	NA	NA	NA	NA	NA	29.7	NA	NA	NA	NA	NA	NA	NA	NA	NA	
	03/26/14	NA	NA	NA	NA	NA	NA	NA	19.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
09/25/14	NA	NA	NA	NA	NA	NA	NA	35.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
03/19/15	NA	NA	NA	NA	NA	NA	NA	26.6	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/17/15	NA	NA	NA	NA	NA	NA	NA	26.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-18	09/23/04	8.7	NA	< 0.2	< 0.2	< 0.01	380	NA	17.1	1.64	54.4	NA	2.3	NA	NA	NA	NA	NA	
	04/05/05	8.9	NA	< 0.1	< 0.2	< 0.01	295	NA	17.7	1.62	50.2	NA	2.4	NA	NA	NA	NA	NA	
	4/5/05 (DUP)	8.8	NA	< 0.1	< 0.2	NA	NA	NA	17.2	1.61	50.0	NA	NA	NA	NA	NA	NA	NA	
	3/4/11 (LAB DUP)	03/04/11	16.1	NA	< 0.1	0.227	< 0.5	NA	264	16.1	NA	NA	NA	NA	38.4	1.94	18.5	24.2	NA
		06/23/11	8.58	NA	0.138 J	NA	< 0.500	NA	262	17.9	NA	NA	NA	NA	39.8	1.81	NA	NA	NA
		09/22/11	10.6	NA	< 0.100	0.580	< 0.500	NA	243	13.0	NA	NA	NA	3.6	45.7	1.62	NA	NA	NA
	03/07/12	28.1	NA	< 0.100	1.65	< 0.500	NA	248	18.8	NA	NA	NA	3.6	51.2	1.58	NA	NA	NA	
	06/27/12	13.4	NA	0.835	< 0.300	< 0.500	NA	329	20.0	NA	NA	NA	NA	49.6	2.16	NA	NA	NA	
	10/01/12	16.6	NA	0.113	1.10	< 0.500	NA	320	21.9	NA	NA	NA	0.6	39.7	1.37	NA	NA	NA	
	12/19/12	13.8	NA	< 0.100	0.750	< 0.500	NA	292	21.2	NA	NA	NA	NA	46.6	1.54	NA	NA	NA	
	12/19/12 (DUP)	13.4	NA	0.123	0.769	< 0.500	NA	295	20.4	NA	NA	NA	NA	45.6	1.50	NA	NA	NA	
	03/05/13	9.75	NA	< 0.100	0.889	< 0.500	NA	318	17.8	NA	NA	NA	2.8	37.0	1.22	NA	NA	NA	
	06/06/13	NA	NA	NA	NA	NA	NA	NA	18.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/26/13	NA	NA	NA	NA	NA	NA	NA	> 20.0 E	NA	NA	NA	NA	NA	NA	NA	NA	NA		

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity		Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1
MW-18 (continued)	03/26/14	NA	NA	NA	NA	NA	NA	NA	18.1	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/24/14	NA	NA	NA	NA	NA	NA	NA	14.4	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/18/15	NA	NA	NA	NA	NA	NA	NA	18.8	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/14/15	NA	NA	NA	NA	NA	NA	NA	16.9	NA	NA	NA	NA	NA	NA	NA	NA	NA
MW-19	09/23/04	23.0	NA	< 0.2	0.3	< 0.01	340	NA	19.2	1.44	64.0	NA	1.8	NA	NA	NA	NA	NA
	04/05/05	18.9	NA	< 0.100	3.7	< 0.01	250	NA	19.9	1.31	65.8	NA	2.6	NA	NA	NA	NA	NA
	06/27/12	15.4	NA	< 0.100	0.82	< 0.500	NA	255	16.1	1.31	65.8	NA	NA	52.5	1.5	NA	NA	NA
	12/19/12	18.4	NA	< 0.100	1.23	< 0.500	NA	232	15.7	NA	NA	NA	1.8	44.4	1.14	NA	NA	NA
	06/06/13	NA	NA	NA	NA	NA	NA	NA	16.7	NA	NA	NA	NA	NA	NA	NA	NA	NA
	6/6/13 (DUP)	NA	NA	NA	NA	NA	NA	NA	16.0	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/25/14	NA	NA	NA	NA	NA	NA	NA	20.5	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/19/15	NA	NA	NA	NA	NA	NA	NA	16.2	NA	NA	NA	NA	NA	NA	NA	NA	NA
09/15/15	NA	NA	NA	NA	NA	NA	NA	16.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-20	09/20/05	50.7	NA	< 0.1	1.4	< 0.01	355	NA	29.1	3.60	88	NA	2.2	NA	NA	NA	NA	NA
	06/06/13	NA	NA	NA	NA	NA	NA	NA	25.3	NA	NA	NA	NA	NA	NA	NA	NA	NA
MW-21	09/14/06	NA	NA	< 0.1	4.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	9/14/06 (DUP)	NA	NA	< 0.1	3.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/26/10	NA	< 0.1	NA	NA	NA	NA	NA	32	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/07/10	NA	20	NA	NA	NA	NA	NA	2,400	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/16/10	NA	0.59	NA	NA	NA	NA	NA	33	NA	NA	NA	NA	NA	NA	NA	NA	NA
	05/06/10	NA	2.7	NA	NA	NA	NA	NA	69	NA	NA	NA	NA	NA	NA	NA	NA	NA
	5/6/10 (DUP)	NA	2.6	NA	NA	NA	NA	NA	67	NA	NA	NA	NA	NA	NA	NA	NA	NA
	06/09/10	NA	8.5	NA	NA	NA	NA	NA	82	NA	NA	NA	NA	NA	NA	NA	NA	NA
	07/06/10	NA	8.4	NA	NA	NA	NA	NA	150	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/02/11	71.8	NA	< 0.1	0.245	< 0.5	NA	268	124	NA	NA	NA	NA	60.6	3.05	NA	NA	NA
	3/2/11 (DUP)	72.1	NA	< 0.1	0.210	< 0.5	NA	259	120	NA	NA	NA	NA	58.3	3.01	NA	NA	NA
	3/2/11 (LAB DUP)	NA	NA	NA	NA	< 0.5	NA	NA	122	NA	NA	NA	NA	NA	NA	NA	NA	NA
	06/23/11	70.5	NA	0.830 J	0.912	< 0.500	NA	270	136	NA	NA	NA	NA	81.0	3.36	NA	NA	NA
	6/23/11 (DUP)	70.3	NA	0.146 J	0.897	< 0.500	NA	281	137	NA	NA	NA	NA	79.6	3.51	NA	NA	NA
	09/22/11	66.5	NA	< 0.1	0.577	< 0.500	NA	312	366	NA	NA	NA	3.6	96.8	3.35	NA	NA	NA
	12/07/11	72.5	NA	< 0.1	0.768	< 0.500	NA	334	386	NA	NA	NA	2.0	93.6	3.39	NA	NA	NA
	03/08/12	67.5	NA	< 0.100	< 0.100 J	< 0.500	NA	318	455	NA	NA	NA	2.0	123	3.55	NA	NA	NA
	06/26/12	68.2	NA	0.871	< 0.300	< 0.500	NA	346	399	NA	NA	NA	NA	117	4.09	NA	NA	NA
	10/01/12	70.3	NA	< 0.100	0.524	< 0.500	NA	328	313	NA	NA	NA	2.6	108	2.48	NA	NA	NA
	10/1/12 (DUP)	71.2	NA	< 0.100	0.535	< 0.500	NA	339	330	NA	NA	NA	NA	115	2.65	NA	NA	NA
12/20/12	62.0	NA	< 0.100	0.797	< 0.500	NA	405	33.5	NA	NA	NA	NA	104	2.69	NA	NA	NA	
03/06/13	57.6	NA	< 0.100	1.13	< 0.500	NA	353	186	NA	NA	NA	3.7	102	2.69	NA	NA	NA	
06/06/13	NA	NA	NA	NA	NA	NA	NA	111	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/25/13	NA	NA	NA	NA	NA	NA	NA	67.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	
03/26/14	NA	NA	NA	NA	NA	NA	NA	59.5	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/24/14	NA	NA	NA	NA	NA	NA	NA	62.8	NA	NA	NA	NA	NA	NA	NA	NA	NA	
03/17/15	NA	NA	NA	NA	NA	NA	NA	22.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
09/15/15	NA	NA	NA	NA	NA	NA	NA	26.6	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-22	09/14/06	NA	NA	0.4	49.9	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/04/11	45.0	NA	< 0.1	0.260	< 0.5	NA	252	19.9	NA	NA	NA	NA	52.8	2.50	NA	NA	NA
	06/23/11	34.6	NA	1.10 J	< 0.1	< 0.500	NA	306	21.5	NA	NA	NA	NA	77.2	3.36	NA	NA	NA
	09/23/11	34.2	NA	< 0.1	0.591	< 0.500	NA	262	35.1	NA	NA	NA	3.0	75.3	2.64	NA	NA	NA
	12/07/11	35.8	NA	< 0.1	< 0.1	< 0.500	NA	290	50.9	NA	NA	NA	4.2	59.7	2.21	NA	NA	NA

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity		Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1
MW-22 (continued)	03/08/12	32.4	NA	< 0.1	< 0.1	< 0.500	NA	282	39.6	NA	NA	NA	6.0	66.8	1.99	NA	NA	NA
	06/26/12	42.3	NA	0.737	< 0.300	< 0.500	NA	295	32.6	NA	NA	NA	59.4	2.29	NA	NA	NA	
	6/26/12 (DUP)	42.1	NA	0.707	< 0.300	< 0.500	NA	303	32.4	NA	NA	NA	61.0	2.25	NA	NA	NA	
	10/02/12	37.2	NA	< 0.100	0.622	< 0.500	NA	367	24.7	NA	NA	NA	2.0	62.4	1.92	NA	NA	NA
	12/19/12	30.5	NA	< 0.100	0.761	< 0.500	NA	369	18.3	NA	NA	NA	68.8	2.05	NA	NA	NA	
	03/06/13	31.1	NA	< 0.100	0.756	< 0.500	NA	347	15.1	NA	NA	NA	3.8	66.0	2.02	NA	NA	NA
	06/06/13	NA	NA	NA	NA	NA	NA	NA	17.6	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/25/13	NA	NA	NA	NA	NA	NA	NA	11.7	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/26/14	NA	NA	NA	NA	NA	NA	NA	14.3	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/24/14	NA	NA	NA	NA	NA	NA	NA	18.9	NA	NA	NA	NA	NA	NA	NA	NA	NA
	03/17/15	NA	NA	NA	NA	NA	NA	NA	14.8	NA	NA	NA	NA	NA	NA	NA	NA	NA
	09/15/15	NA	NA	NA	NA	NA	NA	NA	15.6	NA	NA	NA	NA	NA	NA	NA	NA	NA
	MW-23	09/13/06	NA	NA	< 0.1	29.0	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
03/02/11		15.7	NA	2.71	33.3	< 0.5	NA	140	9.86	NA	NA	NA	0.259	0.383	NA	NA	NA	
06/22/11		27.0	NA	6.38	54.4	< 0.500	NA	144	8.94	NA	NA	NA	0.164	0.304	NA	NA	NA	
09/23/11		23.0	NA	2.51	49.6 J	< 0.500	NA	173	7.94	NA	NA	NA	3.0	0.321	0.476	NA	NA	
12/07/11		14.3	NA	1.21	30.1	< 0.500	NA	169	11.0	NA	NA	NA	1.4	0.425	0.429	NA	NA	
03/07/12		25.9	NA	4.11	45.1	< 0.500	NA	150	11.4	NA	NA	NA	0.0	0.366	0.344	NA	NA	
06/26/12		38.4	NA	6.34	58.6	< 0.500	NA	173	10.2	NA	NA	NA	0.37	0.417	NA	NA	NA	
09/27/12		27.7	NA	1.96	42.3	< 0.500	NA	192	16.6	NA	NA	NA	2.0	1.27	0.470	NA	NA	
12/19/12		15.3	NA	0.530	19.3	< 0.500	NA	177	20.2	NA	NA	NA	NA	0.681	0.558	NA	NA	
03/05/13		22.4	NA	1.55	25.6	< 0.500	NA	200	16.5	NA	NA	NA	0.6	0.305	0.575	NA	NA	
06/06/13		NA	NA	NA	NA	NA	NA	NA	9.86	NA	NA	NA	NA	NA	NA	NA	NA	NA
09/24/13		NA	NA	NA	NA	NA	NA	NA	16.3	NA	NA	NA	NA	NA	NA	NA	NA	NA
03/26/14		NA	NA	NA	NA	NA	NA	NA	11.8	NA	NA	NA	NA	NA	NA	NA	NA	NA
09/25/14		NA	NA	NA	NA	NA	NA	NA	16.5	NA	NA	NA	NA	NA	NA	NA	NA	NA
03/18/15		NA	NA	NA	NA	NA	NA	NA	9.4	NA	NA	NA	NA	NA	NA	NA	NA	NA
09/14/15	NA	NA	NA	NA	NA	NA	NA	9.4	NA	NA	NA	NA	NA	NA	NA	NA	NA	
MW-24	03/26/10	NA	< 0.1	NA	NA	NA	NA	NA	27	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/07/10	NA	50	NA	NA	NA	NA	NA	2,200	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/16/10	NA	0.46	NA	NA	NA	NA	NA	23	NA	NA	NA	NA	NA	NA	NA	NA	NA
	05/06/10	NA	< 2.0	NA	NA	NA	NA	NA	58	NA	NA	NA	NA	NA	NA	NA	NA	NA
	06/09/10	NA	6.3	NA	NA	NA	NA	NA	68	NA	NA	NA	NA	NA	NA	NA	NA	NA
	07/06/10	NA	8.6	NA	NA	NA	NA	NA	74	NA	NA	NA	NA	NA	NA	NA	NA	NA
	7/6/10 (DUP)	NA	8.9	NA	NA	NA	NA	NA	72	NA	NA	NA	NA	NA	NA	NA	NA	NA
MW-25	03/29/10	NA	0.45	NA	NA	NA	NA	NA	23	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/07/10	NA	0.43	NA	NA	NA	NA	NA	24	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/16/10	NA	0.37	NA	NA	NA	NA	NA	23	NA	NA	NA	NA	NA	NA	NA	NA	NA
	05/06/10	NA	< 2.0	NA	NA	NA	NA	NA	26	NA	NA	NA	NA	NA	NA	NA	NA	NA
	06/09/10	NA	1.2	NA	NA	NA	NA	NA	33	NA	NA	NA	NA	NA	NA	NA	NA	NA
	07/06/10	NA	2.5	NA	NA	NA	NA	NA	43	NA	NA	NA	NA	NA	NA	NA	NA	NA
MW-26	04/01/10	NA	< 0.1	NA	NA	NA	NA	NA	3.7	NA	NA	NA	NA	NA	NA	NA	NA	NA
	4/1/10 (LAB DUP)	NA	NA	NA	NA	NA	NA	NA	3.7	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/09/10	NA	< 0.1	NA	NA	NA	NA	NA	4.0	NA	NA	NA	NA	NA	NA	NA	NA	NA
	04/16/10	NA	0.43	NA	NA	NA	NA	NA	3.8	NA	NA	NA	NA	NA	NA	NA	NA	NA
	05/06/10	NA	< 2.0	NA	NA	NA	NA	NA	4.2	NA	NA	NA	NA	NA	NA	NA	NA	NA
	06/09/10	NA	< 0.1	NA	NA	NA	NA	NA	4.6	NA	NA	NA	NA	NA	NA	NA	NA	NA
	07/06/10	NA	< 0.1	NA	NA	NA	NA	NA	7.0	NA	NA	NA	NA	NA	NA	NA	NA	NA

Table B-3

General Chemistry Parameters in Groundwater
Univar USA Inc. Facility, Kent, Washington

Sample Location	Date Collected	Anions (EPA Method 300.0)				Sulfide	Total Alkalinity		Total Organic Carbon	Total Manganese	Total Iron		Ferrous Iron	Dissolved Metals (EPA Method 200.8)				TDS
		Chloride	Bromide	Nitrate as Nitrogen	Sulfate	Hach Method 8131 or SM 4500-S2-F	Hach Method AL AP MG-L	SM 2320B	EPA Method 415.1 or SM 5310B	EPA Method 6010A/6010B	EPA Method 6010A/6010B	Hach Method 8008	Hach Method 8146	Iron	Manganese	Sodium	Potassium	EPA Method 160.1
MW-26 (continued)	7/6/10 (LAB DUP)	NA	< 0.1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
P-1	09/24/04	8.8	NA	< 0.2	< 0.2	< 0.01	220	NA	20.7	1.10	38.1	NA	2.0					NA
IW-206-8	10/04/12	NA	NA	NA	NA	NA	NA	NA	401	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-206-17	10/04/12	NA	NA	NA	NA	NA	NA	NA	275	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-209-8	10/04/12	NA	NA	NA	NA	NA	NA	NA	29.9	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-209-17	10/04/12	NA	NA	NA	NA	NA	NA	NA	28.8	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-137-28	10/04/12	NA	NA	NA	NA	NA	NA	NA	55.0	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-137-38	10/04/12	NA	NA	NA	NA	NA	NA	NA	49.0	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-212-8	10/05/12	NA	NA	NA	NA	NA	NA	NA	53.3	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-212-17	10/05/12	NA	NA	NA	NA	NA	NA	NA	42.8	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-217-8	10/05/12	NA	NA	NA	NA	NA	NA	NA	30.2	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-217-17	10/05/12	NA	NA	NA	NA	NA	NA	NA	30.2	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-130-27	10/05/12	NA	NA	NA	NA	NA	NA	NA	81.4	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-130-37	10/05/12	NA	NA	NA	NA	NA	NA	NA	86.0	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-115-27	10/08/12	NA	NA	NA	NA	NA	NA	NA	61.2	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-115-37	10/08/12	NA	NA	NA	NA	NA	NA	NA	55.4	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-106-37	10/08/12	NA	NA	NA	NA	NA	NA	NA	57.2	NA	NA	NA	NA	NA	NA	NA	NA	NA
IW-106-27	10/08/12	NA	NA	NA	NA	NA	NA	NA	60.0	NA	NA	NA	NA	NA	NA	NA	NA	NA

NOTES: All results in mg/L.
NA = not analyzed.

< = less than the method reporting limit shown.
DUP = duplicate sample collected in the field and blind labeled.
E = The result exceeded calibration curve.

LAB DUP = laboratory duplicate sample.
J = the associated numerical value is an estimated quantity based on data review or laboratory estimate above the MDL but below the MRL.
TDS = Total Dissolved Solids

Table B-4

**Dissolved Organic Gases in Groundwater
Univar USA Inc. Facility, Kent, Washington**

Sample Location	Date Collected	Method AM20GAX (µg/L)		
		Methane	Ethane	Ethene
MW-1	12/15/98	18,000	110	310
	03/02/99	15,000	75	270
	06/17/99	8,400	44	170
	09/17/99	14,000	83	230
	09/23/11	9,400	12	8.2
	03/08/12	15,000	18	34
	10/01/12	9,900	11	10
	03/06/13	14,000	16	34
	09/25/13	16,000	12	10
	03/26/14	17,000	26	39
	09/23/14	15,000	14	19
	03/17/15	6,540	9.1	7.7
	09/16/15	4,190	14.7	13.0
MW-2	12/15/98	13,000	1.1	0.5 U
	03/02/99	8,600	0.88	0.5 U
	06/16/99	13,000	1.0	0.5 U
	06/16/99 (DUP)	13,000	0.97	0.5 U
	09/16/99	17,000	1.2	0.5 U
MW-3	12/14/98	10,000	6.9	0.95
	03/03/99	5,700	9.3	1.2
	06/17/99	3,800	3.2	0.93
	09/17/99	4,300	6.8	0.88
MW-4	12/14/98	16,000	130	1,500
	03/03/99	10,000	110	730
	06/17/99	12,000	110	1,300
	09/17/99	14,000	150	1,000
	09/23/11	14,000	360	240
	03/08/12	18,000	360	500
	10/01/12	14,000	270	310
	03/06/13	16,000	240	89
	09/26/13	15,000	400	14
	03/25/14	9,000	320	0.58
	09/23/14	16,000	380	32
	03/17/15	5,680	103	1.0 U
	09/17/15	3,110	155	2.6
MW-5	12/15/98	0.5 U	0.5 U	0.5 U
	03/02/99	66	0.5 U	0.5 U
	06/16/99	7.8	0.5 U	0.5 U
	09/16/99	28	0.5 U	0.5 U
	09/16/99 (DUP)	26	0.5 U	0.5 U
	03/03/11	43	0.017 J	0.041
	06/22/11	550	0.010 J	0.053
	09/22/11	730	0.10	0.035
	03/07/12	4,100	0.20	0.17
	07/12/12	6,600	0.31	0.38

Table B-4

**Dissolved Organic Gases in Groundwater
Univar USA Inc. Facility, Kent, Washington**

Sample Location	Date Collected	Method AM20GAX (µg/L)		
		Methane	Ethane	Ethene
MW-5 (continued)	09/27/12	6,200	0.33	0.16
	12/19/12	5,500	0.37 J	0.097 J
	03/06/13	6,700	0.40	0.13
	03/06/13 (DUP)	5,700	0.33	0.10
	09/26/13	1,500	0.38	0.24
	09/26/13 (DUP)	1,700	0.38	0.27
	03/25/14	1,800	0.57	0.14
	09/23/14	430	0.38	0.16
	03/16/15	142	1.0 U	1.0 U
09/15/15	160	1.0 U	1.0 U	
MW-6	12/15/98	14,000	130	31
	03/02/99	9,800	94	15
	03/02/99 (DUP)	12,000	120	16
	06/16/99	11,000	100	10
	09/16/99	13,000	98	8.2
MW-7	12/14/98	1.9	0.5 U	0.5 U
	03/03/99	34	0.5 U	0.5 U
	06/17/99	7.9	0.5 U	0.5 U
	09/17/99	15	0.5 U	0.5 U
	03/02/11	0.18	0.025 U	0.026
	06/22/11	0.59	0.025 U	0.019 J
	09/22/11	8.2	0.025 U	0.046
	03/07/12	0.24	0.0032 J	0.016 J
	07/12/12	0.48	0.025 U	0.014 J
	09/27/12	28	0.0085 J	0.028
	12/19/12	1,200	0.028 J	0.034 J
	03/05/13	200	0.052	0.029
	09/24/13	240	0.055	0.024 J
	03/26/14	1.2	0.0092 J	0.010 J
	09/25/14	26	0.021 J	0.012 J
03/18/15	0.50 U	1.0 U	1.0 U	
09/14/15	8.5	1.0 U	1.0 U	
MW-8	12/14/98	23	0.5 U	0.5 U
	12/14/98 (DUP)	25	0.5 U	0.5 U
	03/02/99	12	0.5 U	0.5 U
	06/16/99	5.2	0.5 U	0.5 U
	09/16/99	18	0.5 U	0.5 U
MW-12	03/03/11	3.1	0.017 J	0.20
	06/22/11	9.3	0.080	0.54
	09/22/11	1,000	0.15	4.3
	09/22/11 (DUP)	1,600	0.20	4.7
	09/22/11 (LAB DUP)	1,500	0.19	4.4
	03/07/12	4,000	0.88	0.67
	03/07/12 (DUP)	4,000	0.85	0.63
	07/12/12	13,000	1.2	3.1

Table B-4

**Dissolved Organic Gases in Groundwater
Univar USA Inc. Facility, Kent, Washington**

Sample Location	Date Collected	Method AM20GAX (µg/L)		
		Methane	Ethane	Ethene
MW-12 (continued)	10/02/12	14,000	1.4	4.9
	12/19/12	7,500	0.78 J	6.8
	03/06/13	11,000	1.1	7.1
	09/25/13	13,000	2.7	150
	03/25/14	7,800	1.6	5.3
	03/25/14 (DUP)	7,900	1.5	5.3
	09/23/14	12,000	4.7	6.4
	03/16/15	1,780	0.71 J	0.88 J
	03/16/15 (DUP)	1,360	0.75 J	0.57 J
	09/15/15	3,140	1.8	1.2
	09/15/15 (DUP)	2,270	2.1	1.3
MW-13	09/24/04	13,000	15	680
	04/05/05	520	1.9	27
	03/03/11	22,000	310	1,000
	06/23/11	17,000	280	510
	09/22/11	16,000	240	1,000
	03/07/12	29,000	540	440
	07/12/12	18,000	450	160
	10/02/12	22,000	450	29
	12/19/12	20,000	420	80
	03/07/13	20,000	570	3.2
	09/25/13	19,000	410	230
	03/26/14	16,000	440	2.2
	09/23/14	27,000	690	220
	03/17/15	1,620	18.9	1.0 U
09/15/15	14,400	206	37.3	
MW-14	09/24/04	5,800	2.2	1.2
	04/05/05	5,900	0.41	0.55 U
MW-15	09/24/04	7,700	1.7	0.8 U
	04/05/05	6,500	1.5	0.55 U
MW-16	09/23/04	16,000	3.2	1.3
	04/05/05	17,000	3.7	2.0
MW-17	09/23/04	13,000	290	61
	09/23/04 (DUP)	13,000	290	60
	04/05/05	13,000	290	70
	03/07/11	21,000	470	21
	06/23/11	18,000	670	8.6
	09/22/11	19,000	530	12
	03/08/12	20,000	550	4.2
	07/12/12	16,000	580	14
	10/01/12	18,000	440	13
	12/19/12	18,000	520	7.6
	03/07/13	18,000	570	3.6
	09/26/13	20,000	390	3.6

Table B-4

**Dissolved Organic Gases in Groundwater
Univar USA Inc. Facility, Kent, Washington**

Sample Location	Date Collected	Method AM20GAX (µg/L)		
		Methane	Ethane	Ethene
MW-17 (continued)	03/26/14	14,000	300	3.0
	09/25/14	21,000	240	1.6
	03/19/15	9,630	122	0.82
	09/17/15	8,220	194	1.5
MW-18	09/23/04	4,500	25	3.2
	04/05/05	4,800	16	1.5
	04/05/05 (DUP)	5,700	19	1.8
	03/04/11	10,000	260	67
	06/23/11	9,000	24	0.42
	09/22/11	8,000	20	0.19
	03/07/12	9,700	39	36
	07/12/12	10,000	100	35
	10/01/12	750	2.0	0.98
	12/19/12	12,000	50	6.2
	03/05/13	11,000	22	0.18
	09/26/13	10,000	220	0.18
	03/26/14	14,000	44	0.14
	09/24/14	8,200	26	0.61
03/18/15	9,520	24.9	1.0 U	
09/14/15	3,160	28.8	0.77 J	
MW-19	09/23/04	5,600	32	870
	04/05/05	5,400	40	97
	07/12/12	1,000	140	270
	12/19/12	18,000	230	520
	03/05/13	12,000	270	840
MW-20	09/20/05	13,000	240	10
MW-21	03/02/11	17,000	140	1,600
	03/02/11 (DUP)	16,000	130	1,400
	06/23/11	18,000	100	1,400
	06/23/11 (DUP)	20,000	110	1,600
	09/22/11	21,000	120	1,500
	03/08/12	17,000	150	720
	07/12/12	14,000	94	970
	10/02/12	14,000	84	1,200
	10/02/12	12,000	73	1,100
	12/20/12	14,000	89	830
	03/06/13	18,000	96	1,200
	09/25/13	20,000	60	1,000
	03/26/14	25,000	140	830
	09/24/14	25,000	280	730
03/17/15	12,200	185	73.5	
09/15/15	16,400	211	13.3	
MW-22	03/04/11	16,000	880	940
	06/23/11	15,000	780	140

Table B-4

**Dissolved Organic Gases in Groundwater
Univar USA Inc. Facility, Kent, Washington**

Sample Location	Date Collected	Method AM20GAX (µg/L)		
		Methane	Ethane	Ethene
MW-22 (continued)	09/23/11	18,000	1,100	220
	03/08/12	27,000	620	900
	07/12/12	18,000	470	860
	10/02/12	22,000	600	810
	12/19/12	24,000	640	120
	03/06/13	24,000	520	330
	09/25/13	23,000	430	290
	03/26/14	25,000	480	170
	09/24/14	26,000	390	37
	03/17/15	11,300	104	111
09/15/15	9,420	68.3	25.1	
MW-23	03/02/11	8.6	0.039	0.11
	06/22/11	4.4	0.016 J	0.042
	09/23/11	5.8	0.091	0.24
	03/07/12	160	0.21	0.05
	07/12/12	2,200	1.1	0.028
	09/27/12	4,800	3.0	0.040
	12/19/12	670	0.35 J	0.044 J
	03/05/13	210	0.15	0.039
	09/24/13	97	0.070	0.026
	03/26/14	110	0.22	0.0200 J
	09/25/14	360	0.072	0.018 J
	09/25/14 (DUP)	300	0.063	0.025
	03/18/15	144	1.0 U	1.0 U
09/14/15	123	1.0 U	1.0 U	
P-1	09/24/04	5,100	3.0	0.8 U

NOTES: Analyses prior to 2011 performed using Modified RSK Method 175.
 Analyses from 2011 on performed using Microseeps Method AM20GAX.
 µg/L = micrograms per liter
 U = not detected, the associated value is the quantification limit.
 J = estimated concentration between the method detection and reporting limits.
 (DUP) = duplicate sample collected in the field and blind labeled.

Table B-5


**Volatile Fatty Acids in Groundwater
Univar USA Inc. Facility, Kent, Washington**

Location	Date	Lactic Acid	Acetic Acid	Propionic Acid	Butyric Acid	Pyruvic Acid	i-Pentanoic Acid	Pentanoic Acid	i-Hexanoic Acid	Hexanoic Acid
MW-12	10/02/12	0.10 U	0.070 U	0.050 U	0.055	0.15 U	0.15 U	0.070 U	0.050 U	0.10 U
MW-13	10/02/12	0.10 U	0.25	0.050 U	0.050 U	0.15 U	0.15 U	0.070 U	0.050 U	0.10 U
MW-21	10/02/12	1.0 U	380	56	30	8.1	0.74 J	5.6	0.54	2.5
(DUP)	10/02/12	1.0 U	380	56	30	8.8	0.76 J	5.6	0.60	2.5

- NOTES:
1. All results in mg/L; detections are shown in bold.
 2. < = not detected at or above the method reporting limit.
 3. J = result is an estimate based on laboratory quality control results or data quality review.
 4. DUP = duplicate sample.
 5. All analyses performed by Microseeps, Inc., of Pittsburgh, PA, using Microseeps Method AM23G.

Appendix C
Analytical Data Plots of Constituents and Microbial Populations


**Figure C1. Constituent vs Time
Monitoring Well MW-1
Univar USA Inc., Kent, Washington**

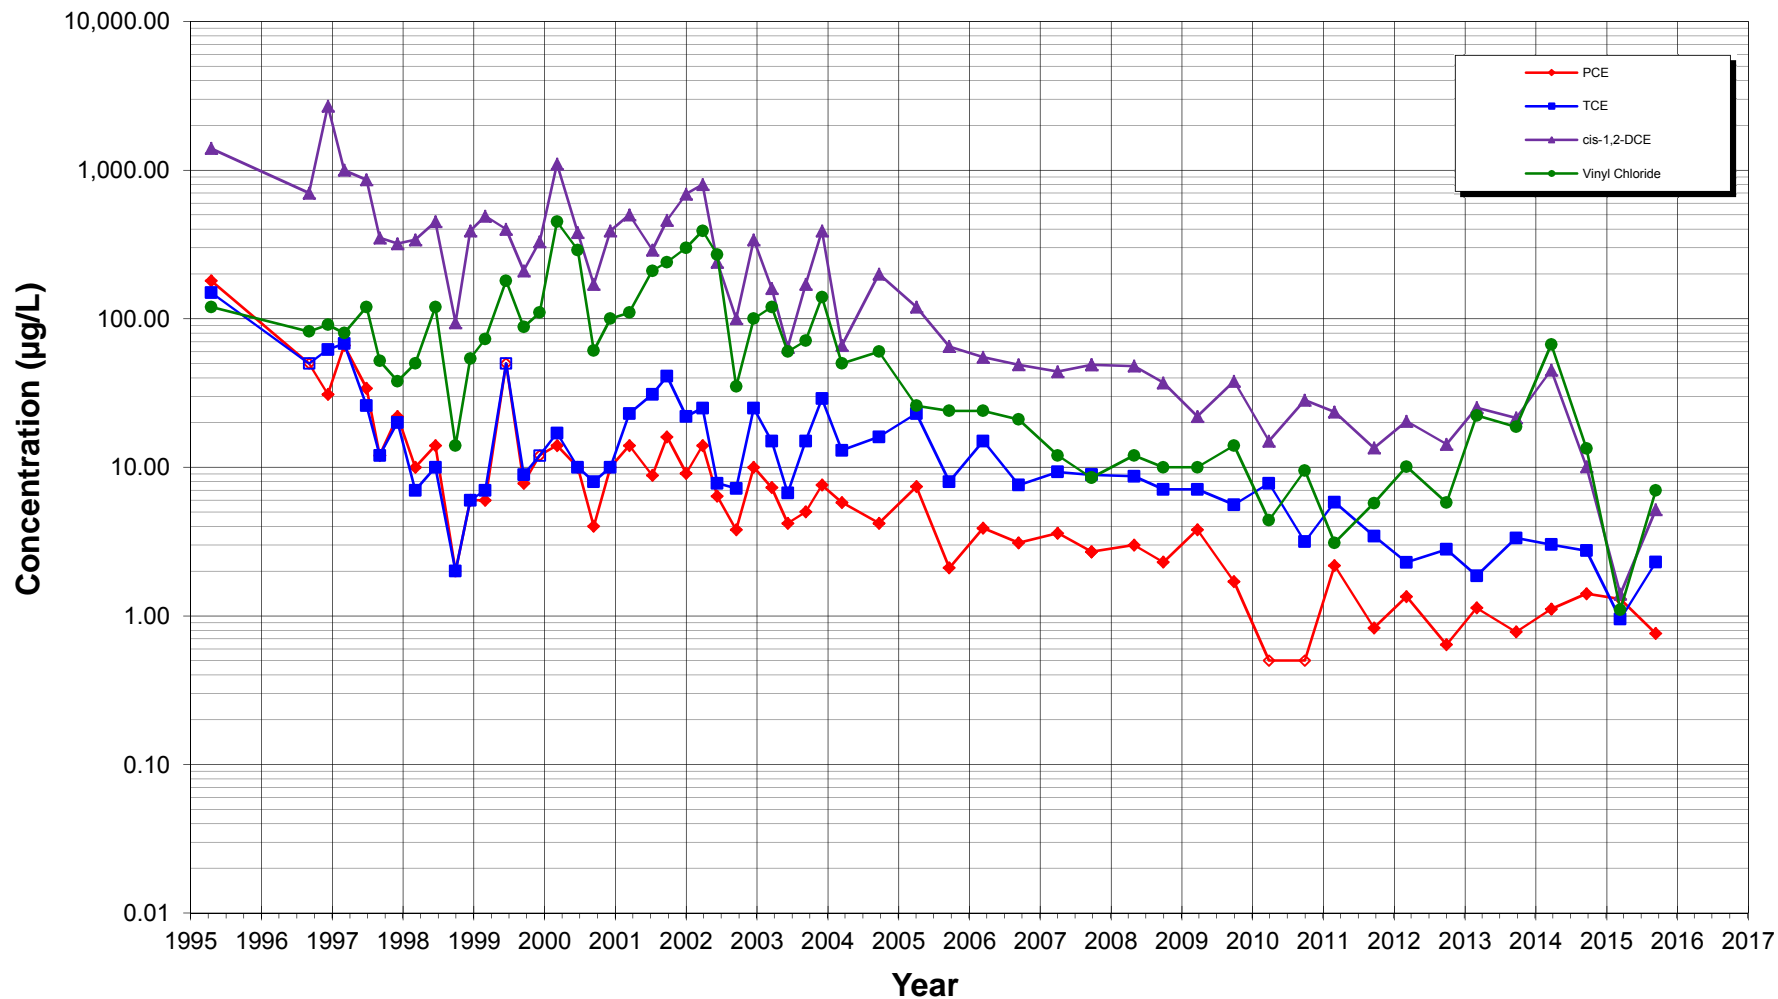

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C2. Constituent vs Time
Monitoring Well MW-1
Univar USA Inc., Kent, Washington**

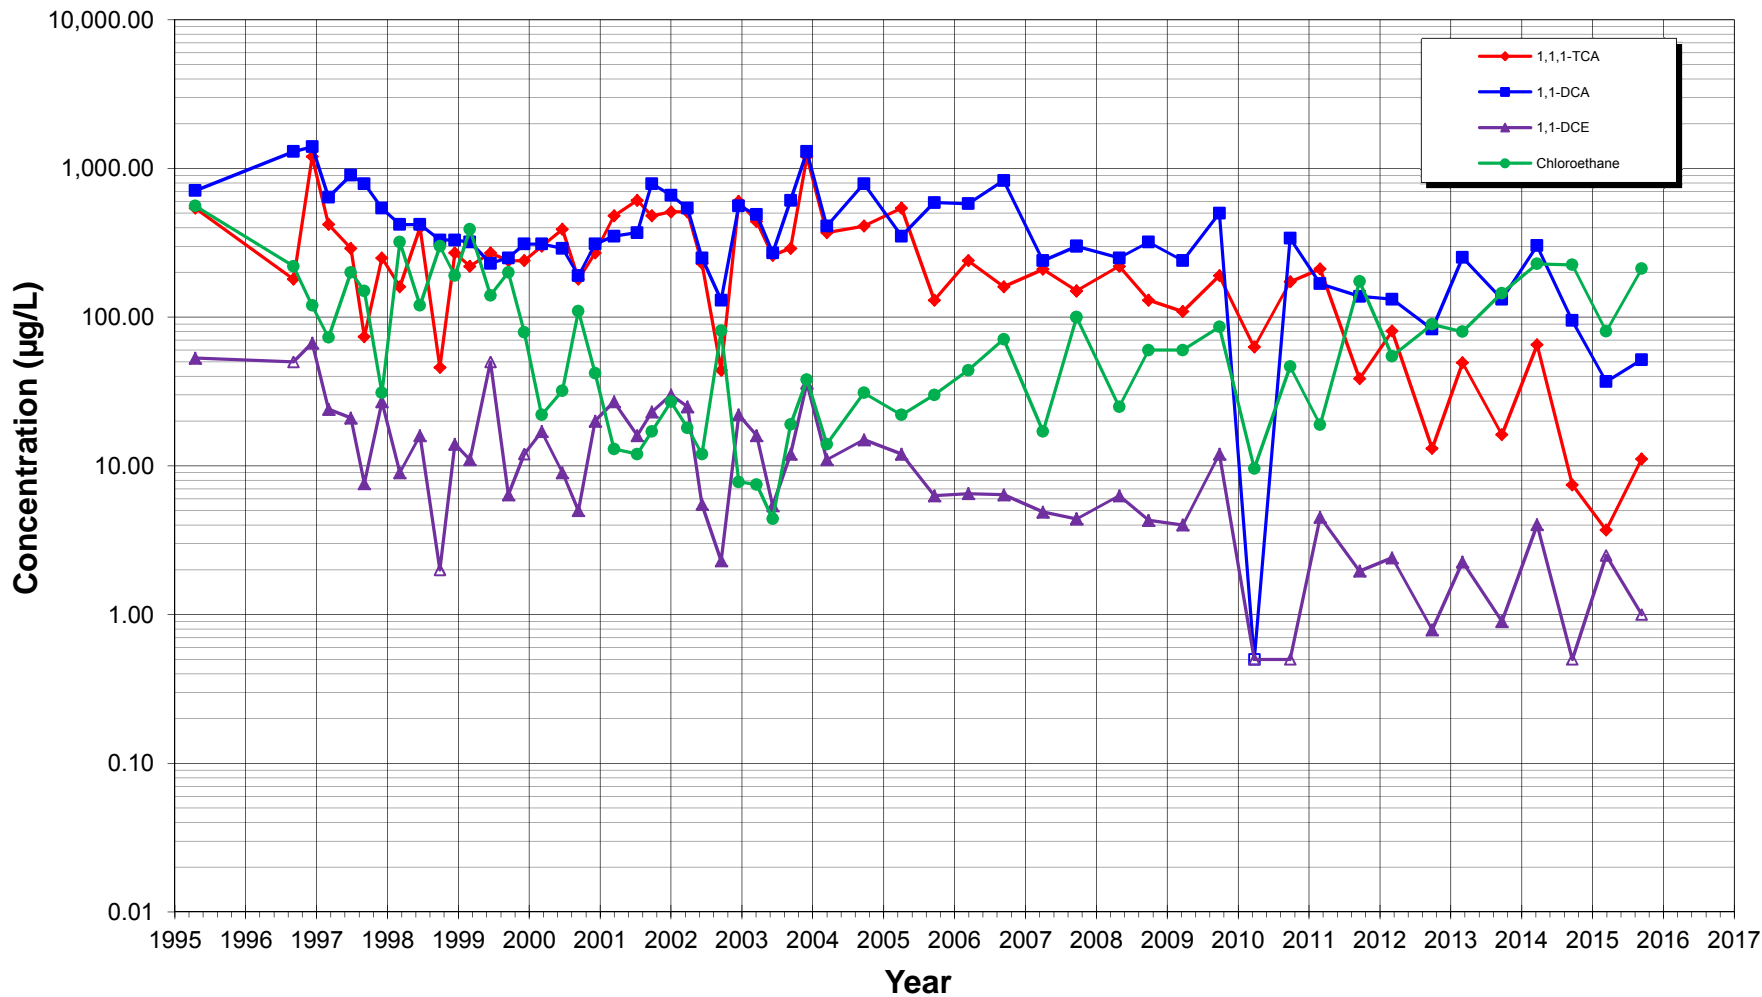

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C3. Constituent vs Time
Monitoring Well MW-2
Univar USA Inc., Kent, Washington**

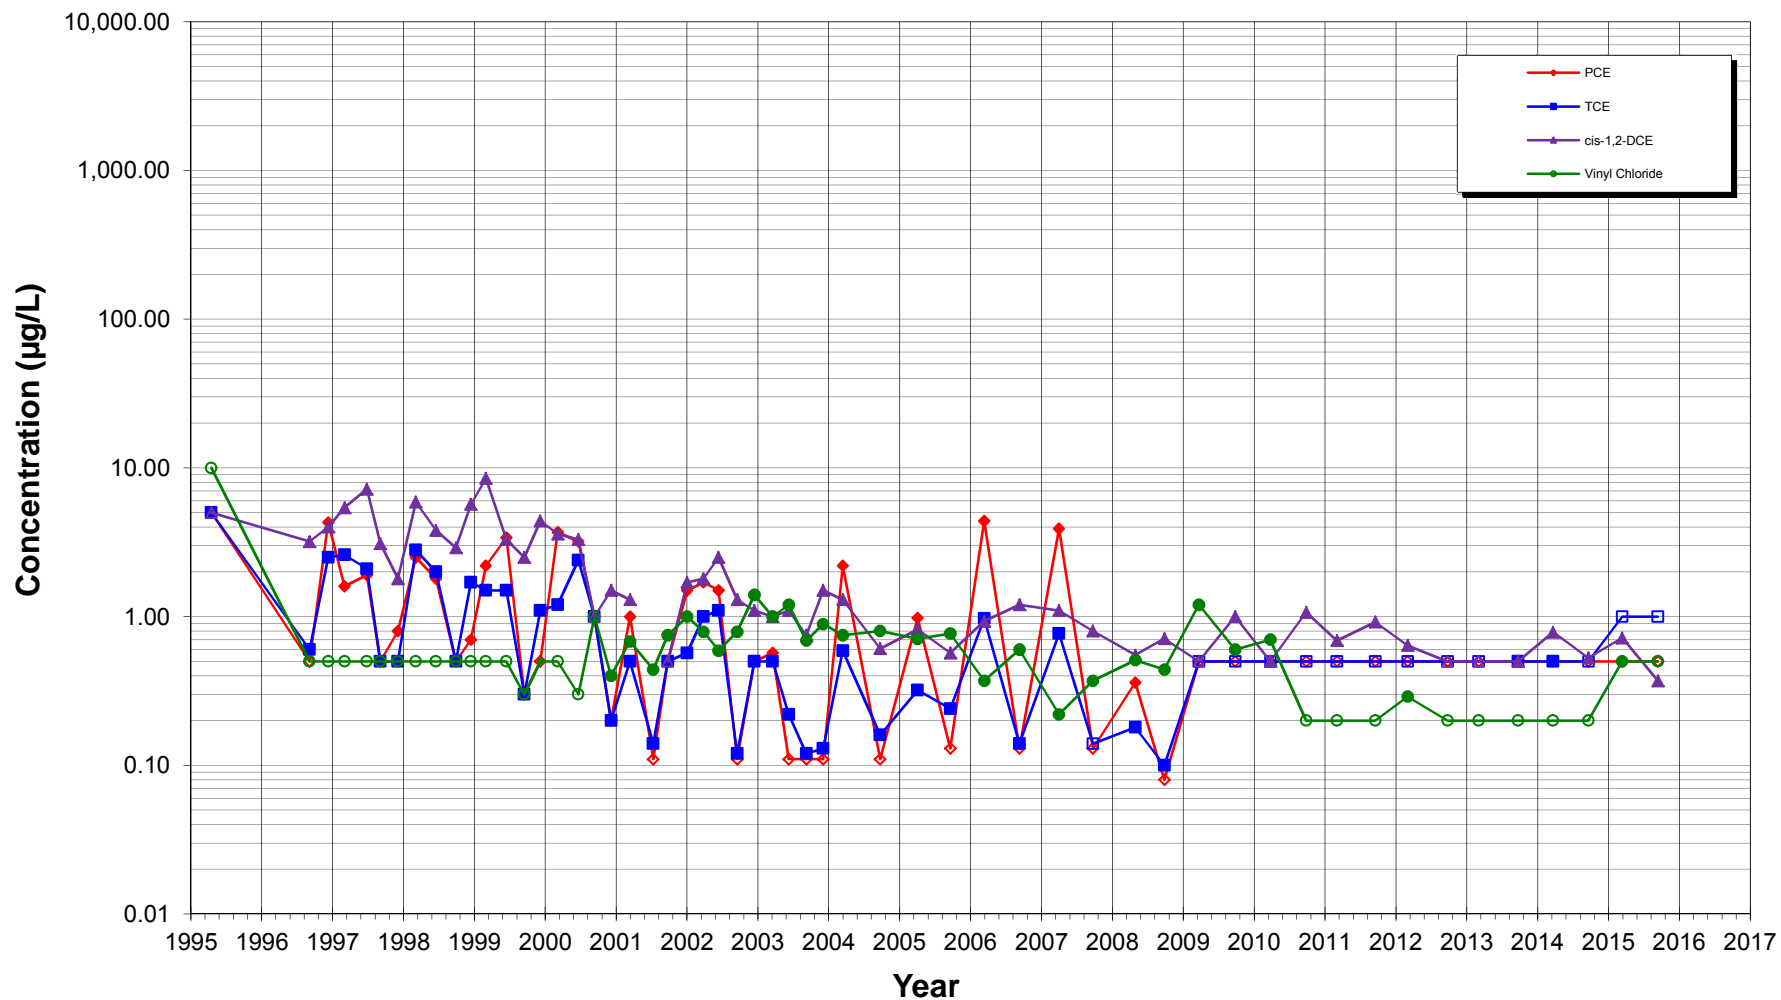

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C4. Constituent vs Time
Monitoring Well MW-2
Univar USA Inc., Kent, Washington**

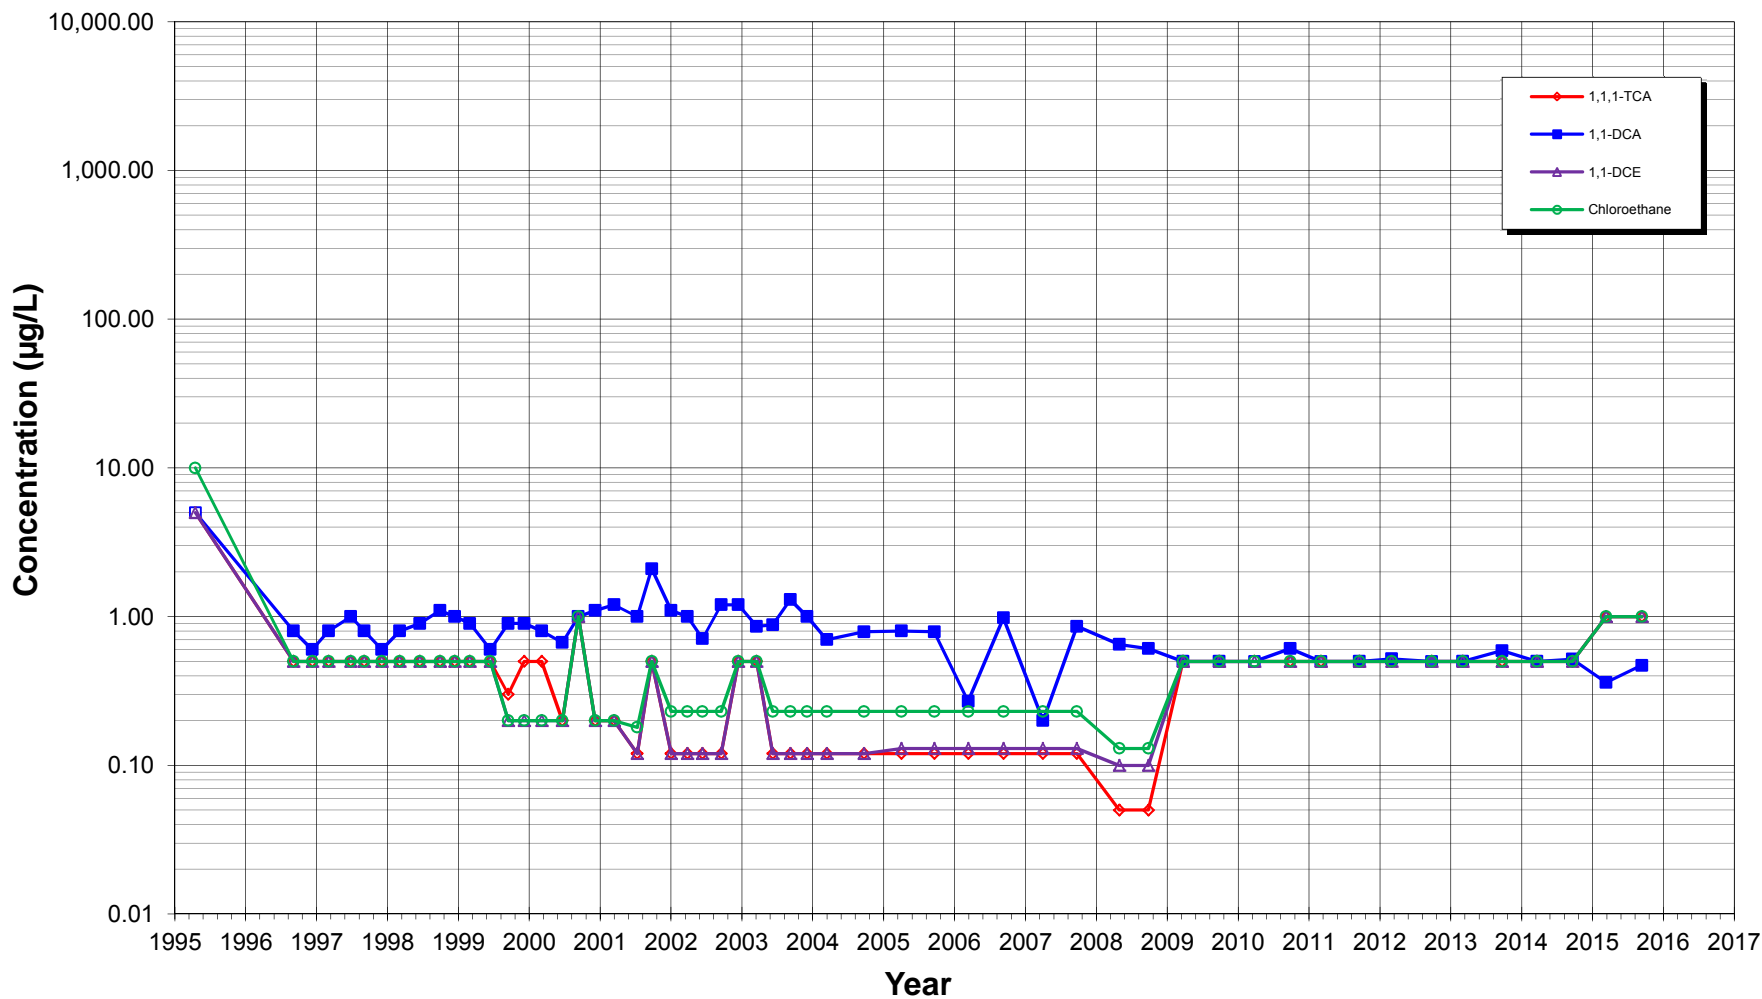

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C5. Constituent vs Time
Monitoring Well MW-3
Univar USA Inc., Kent, Washington**

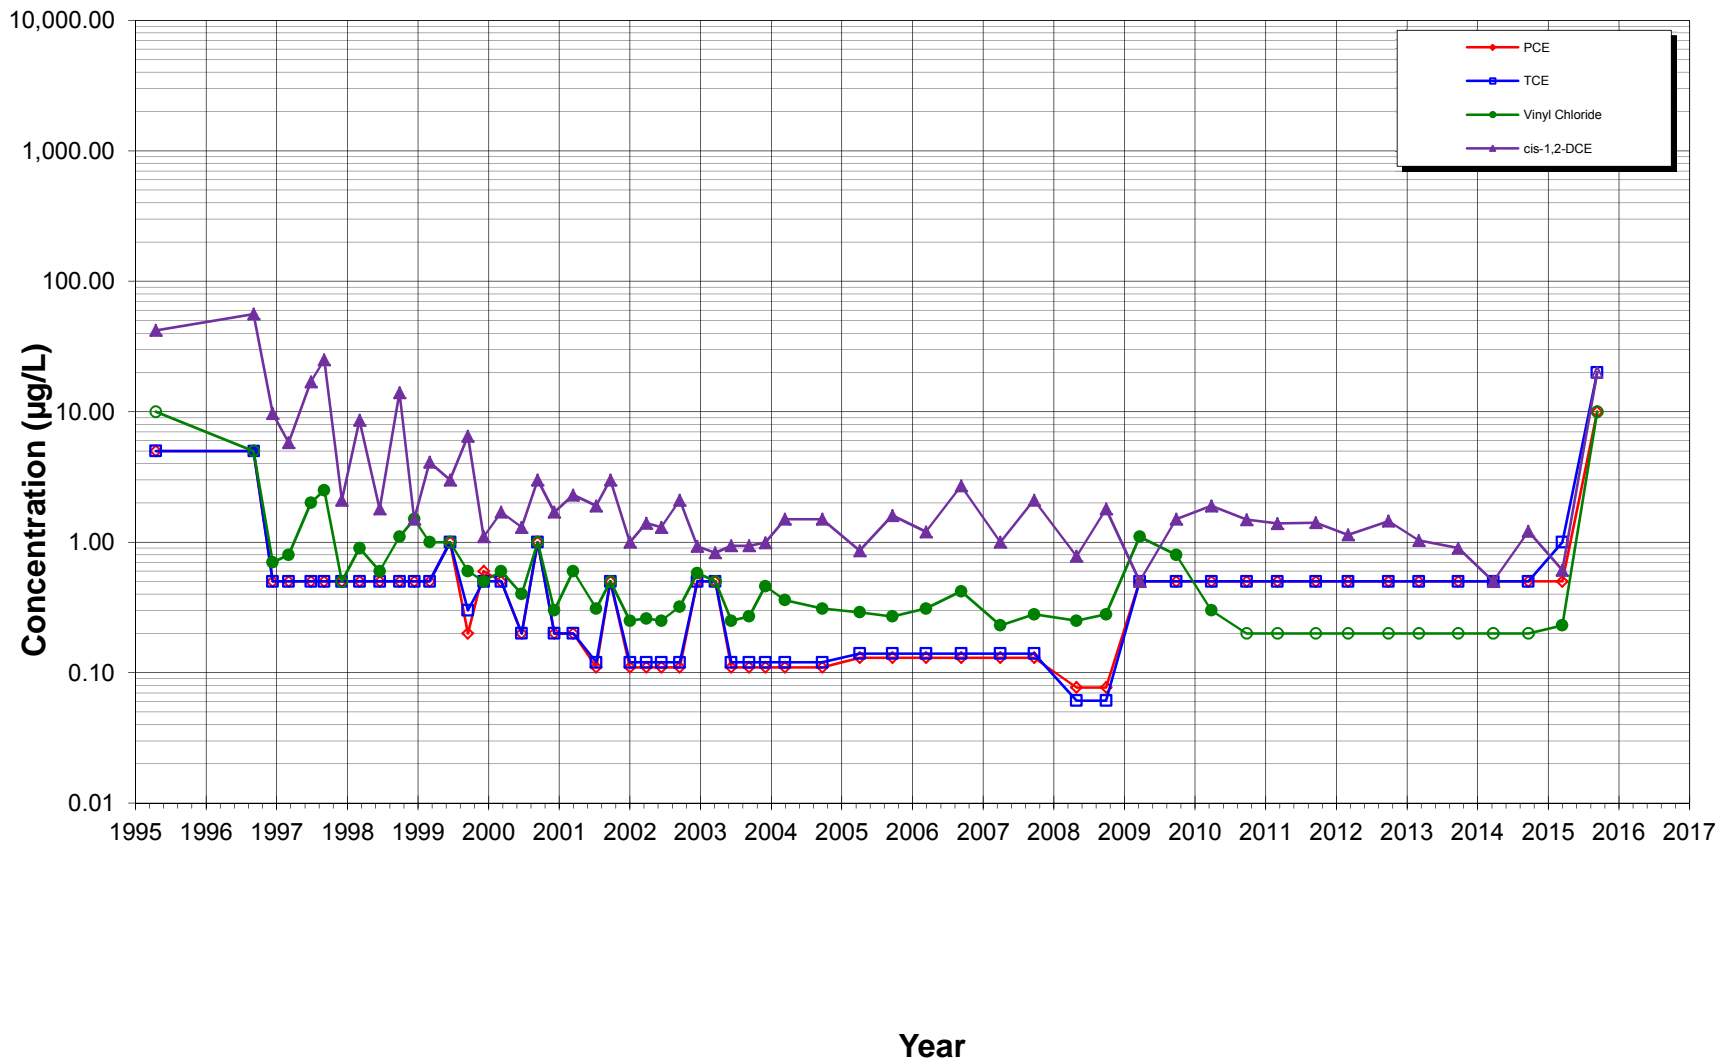

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C6. Constituent vs Time
Monitoring Well MW-3
Univar USA Inc., Kent, Washington**

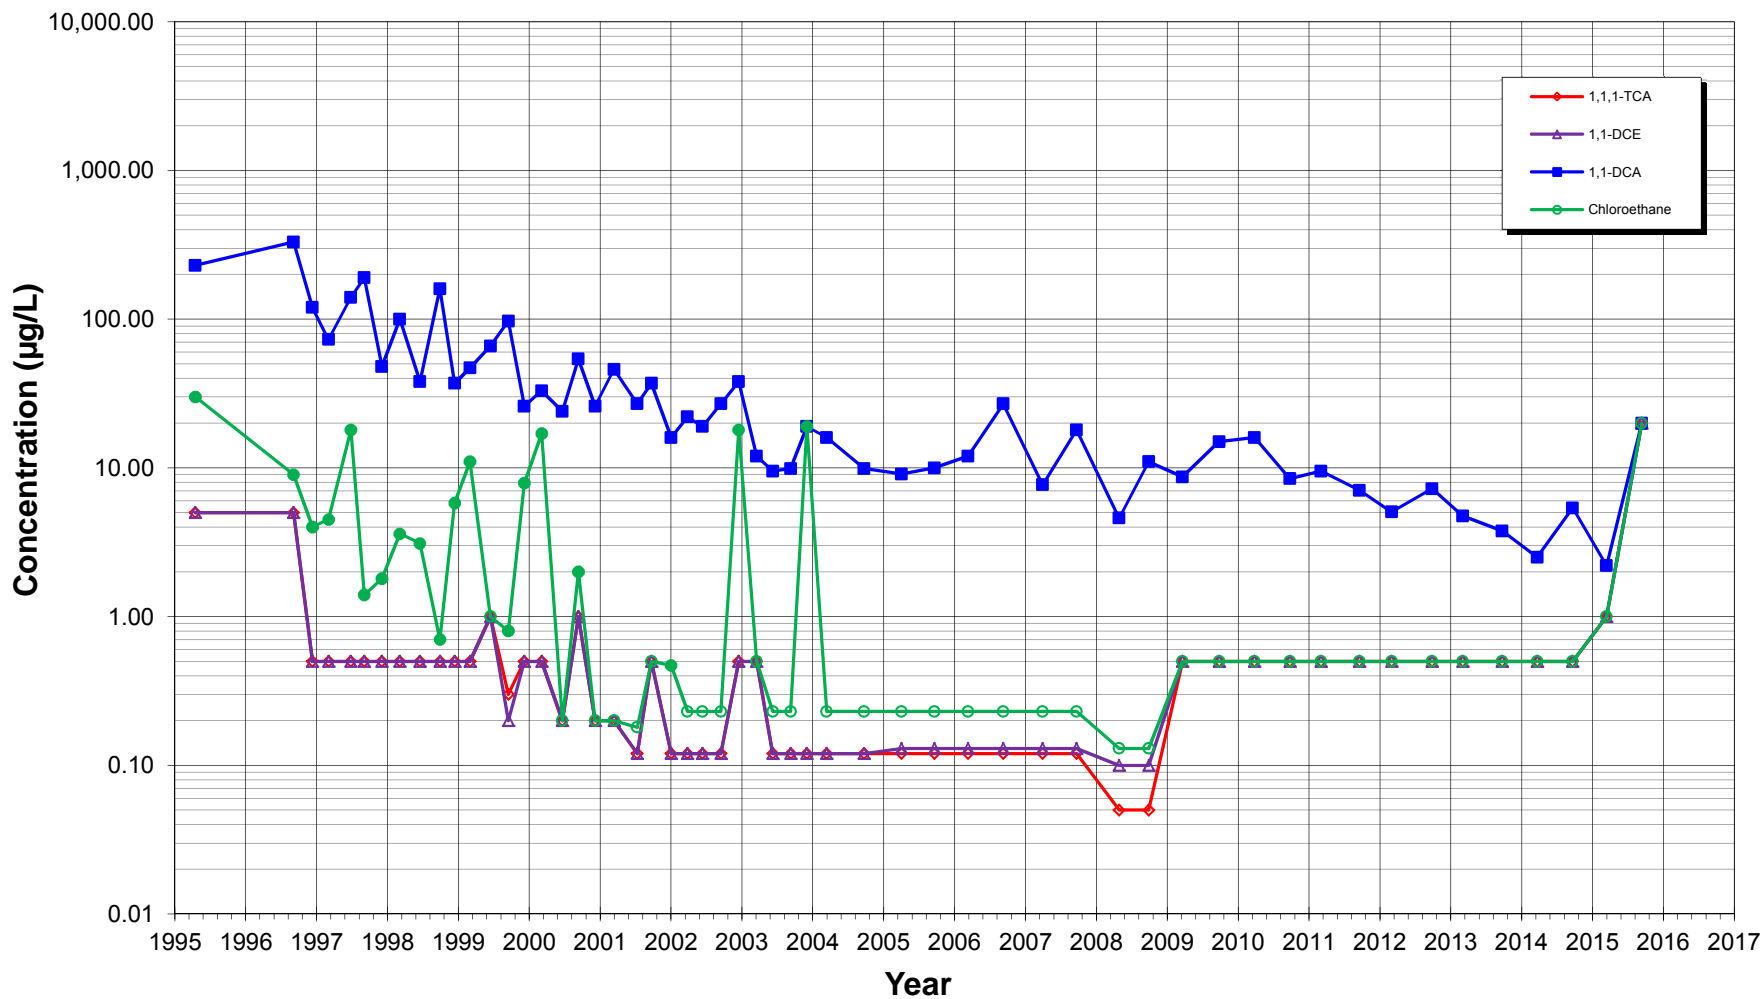

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C7. Constituent vs Time
Monitoring Well MW-4
Univar USA Inc., Kent, Washington**

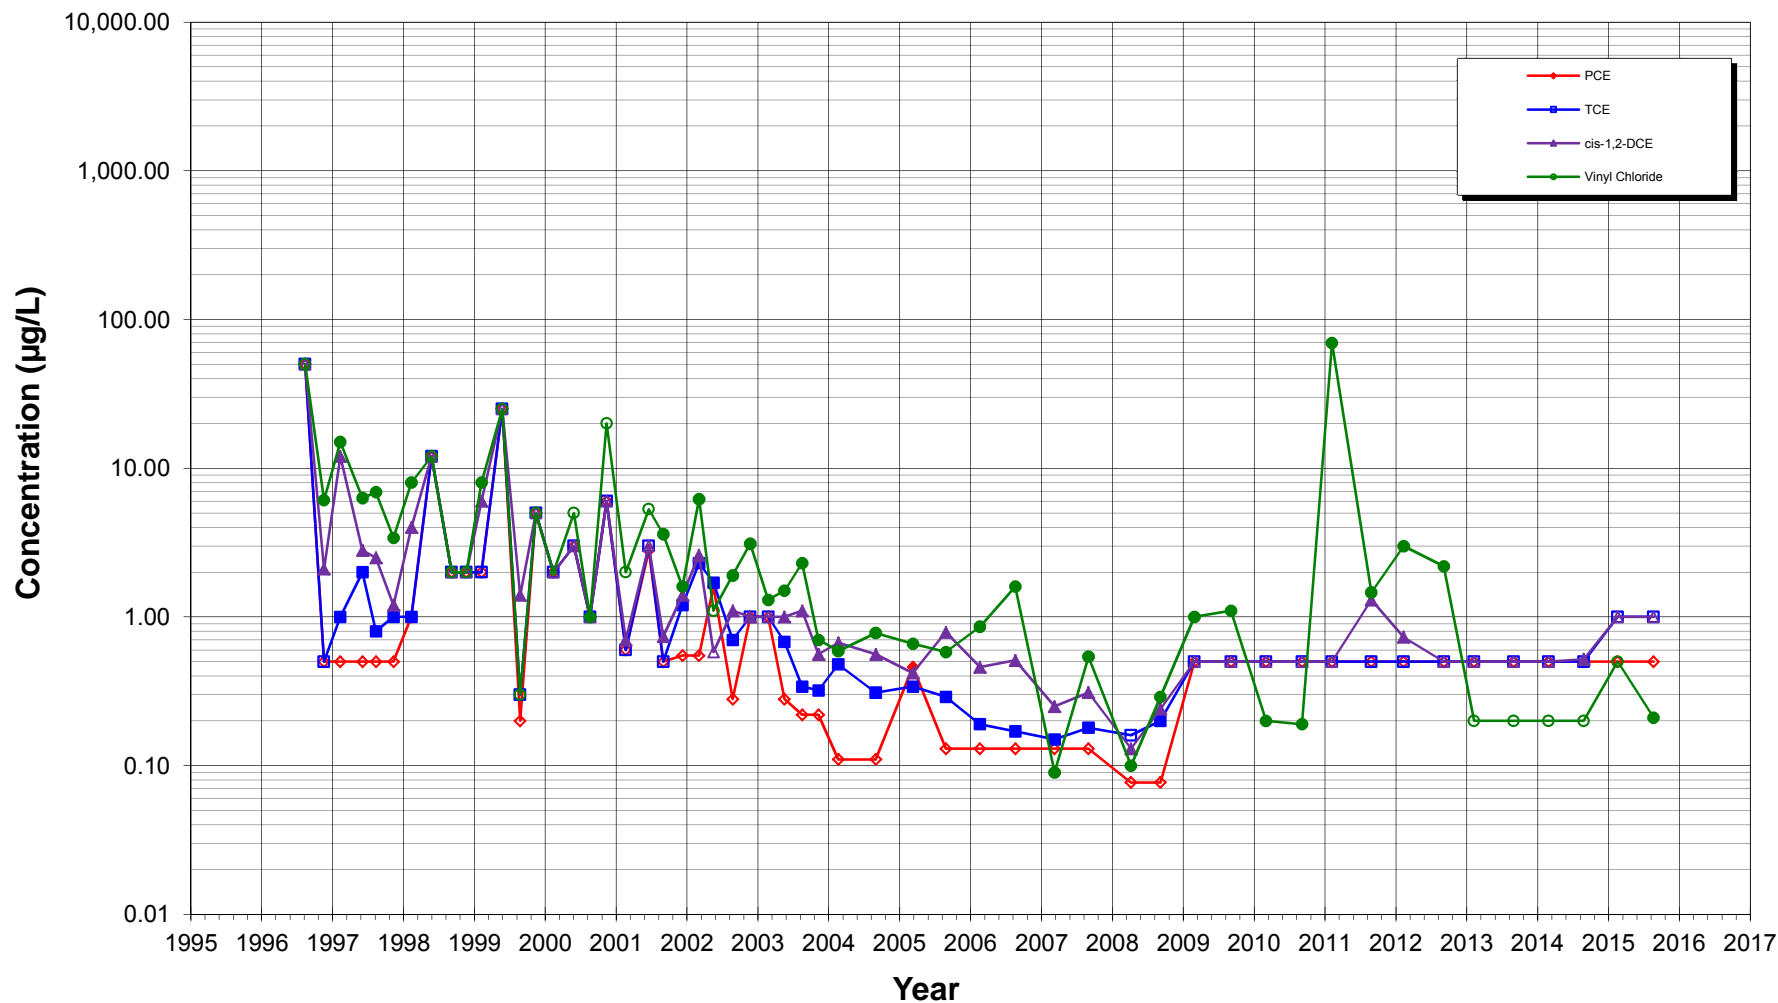

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C8. Constituent vs Time
Monitoring Well MW-4
Univar USA Inc., Kent, Washington**

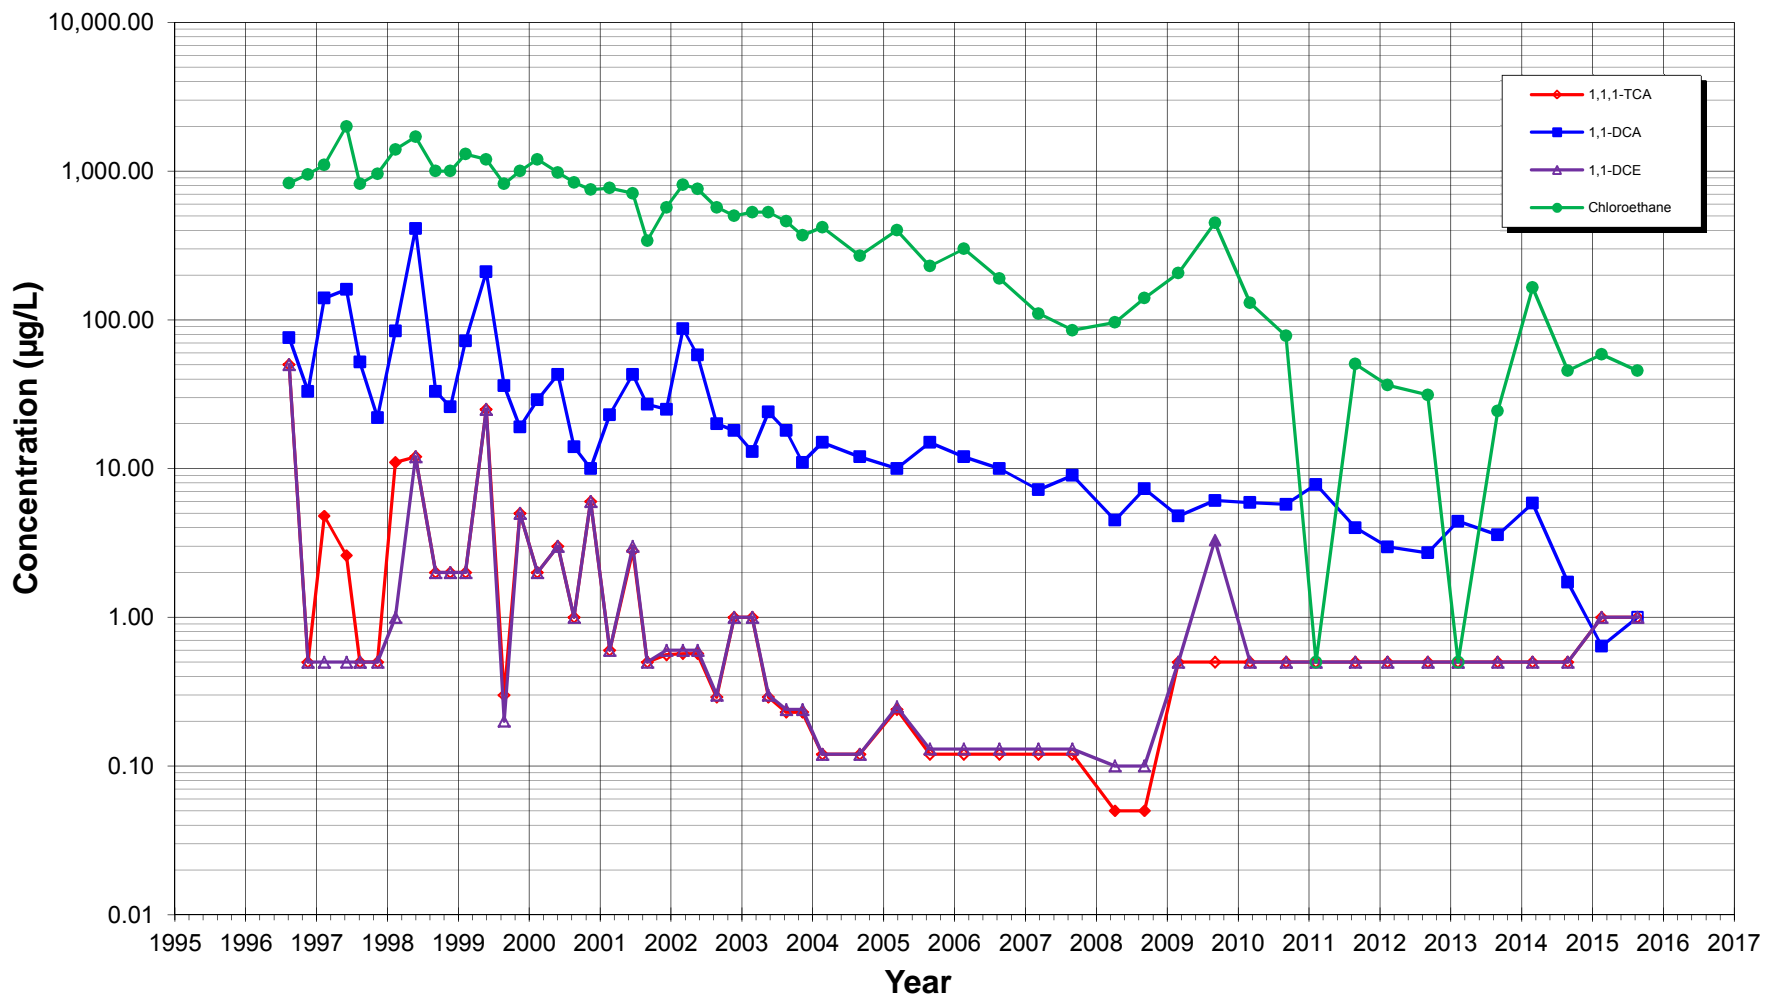

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C9. Constituent vs Time
Monitoring Well MW-5
Univar USA Inc., Kent, Washington**

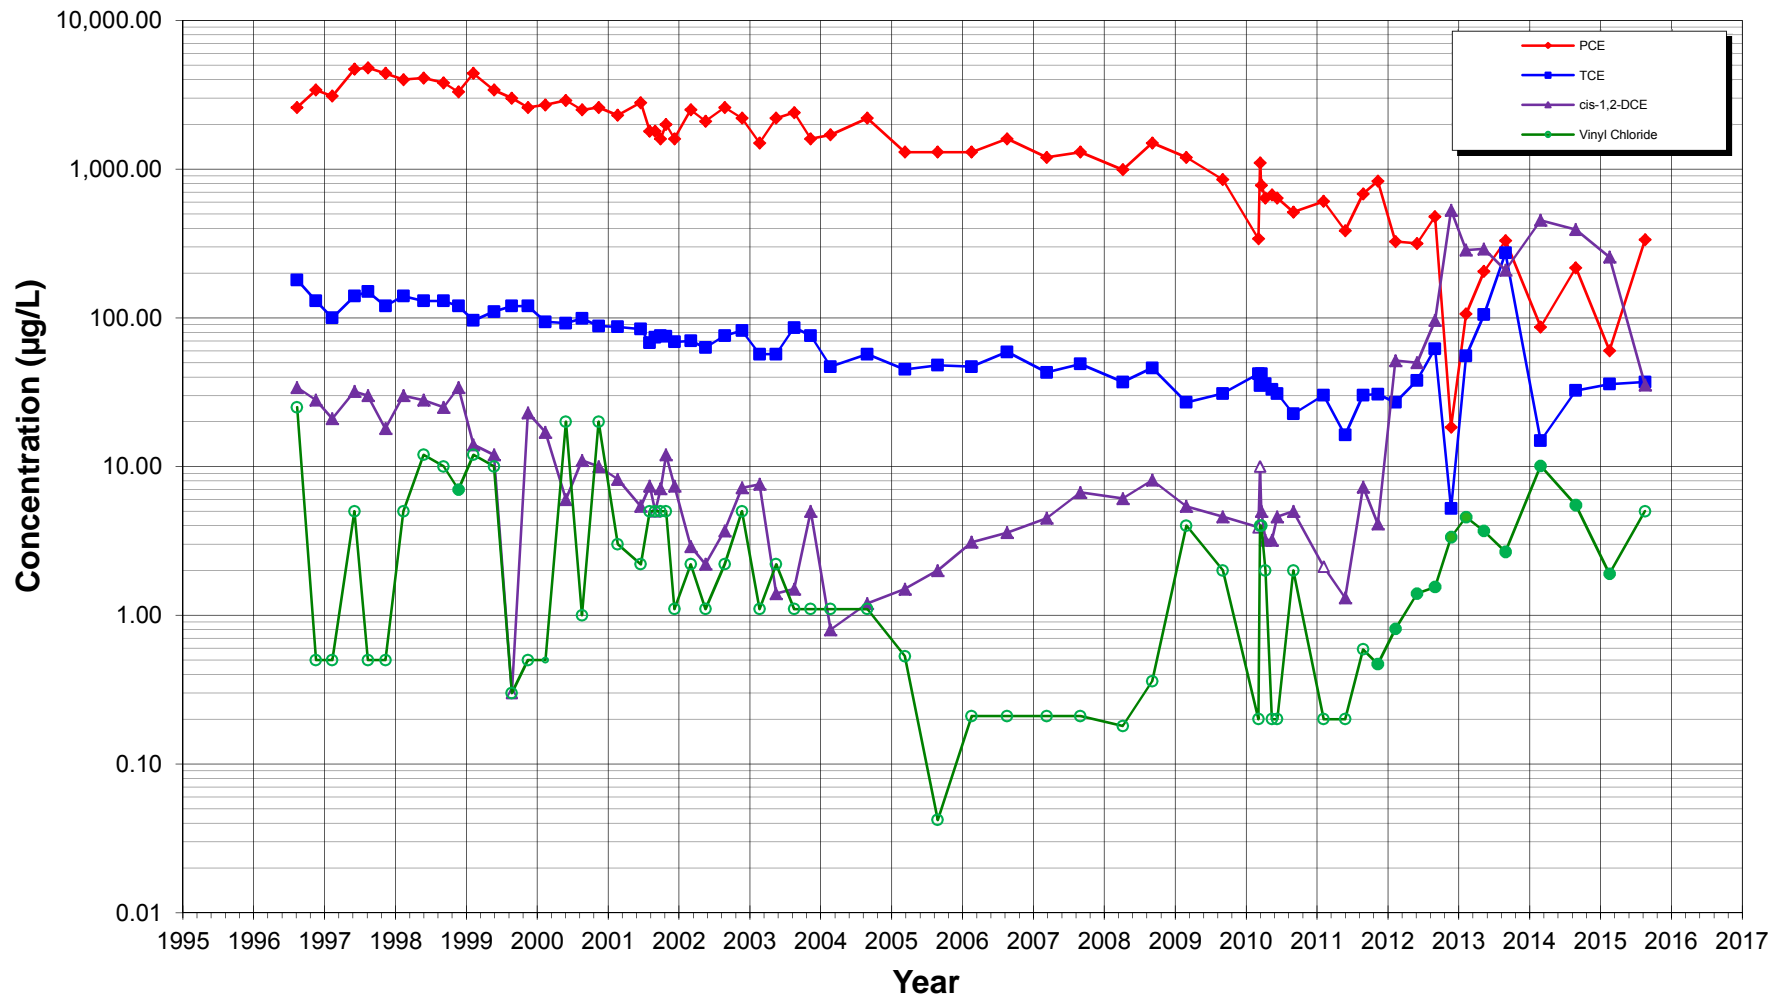

Notes:

- 1) Initial shallow injection in March and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C10. Constituent vs Time
Monitoring Well MW-5
Univar USA Inc., Kent, Washington**

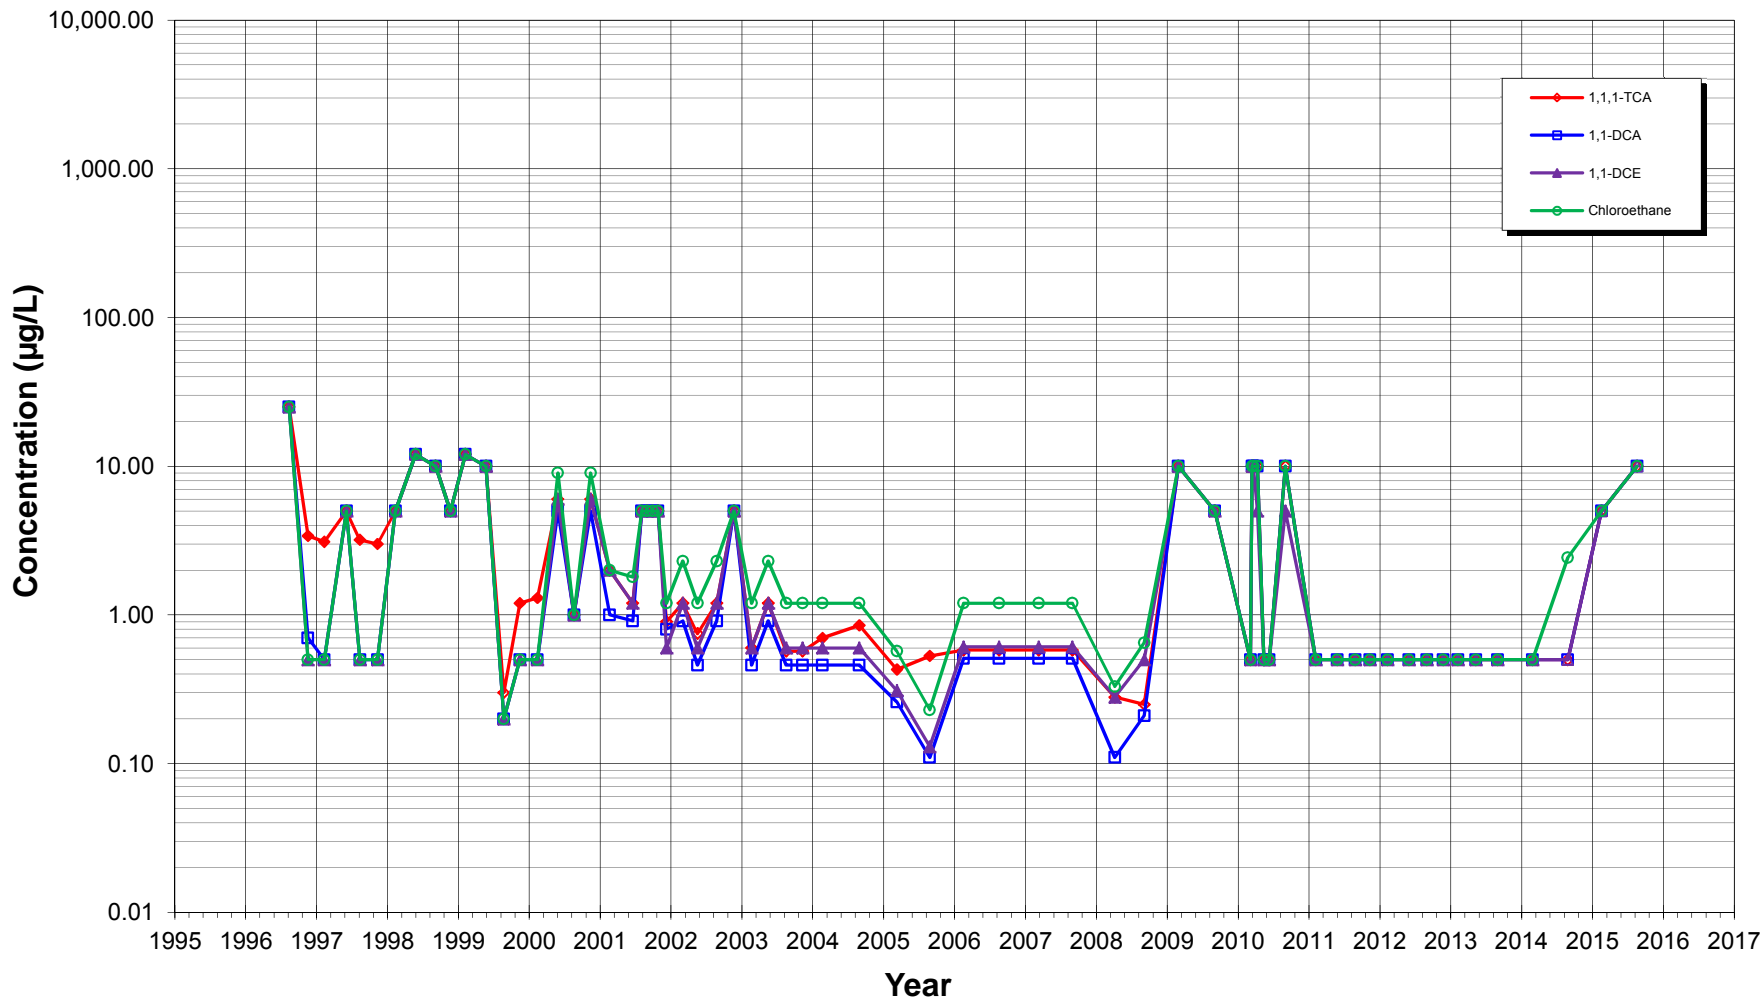

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


Figure C11. Constituent vs Time
Monitoring Well MW-6
Univar USA Inc., Kent, Washington

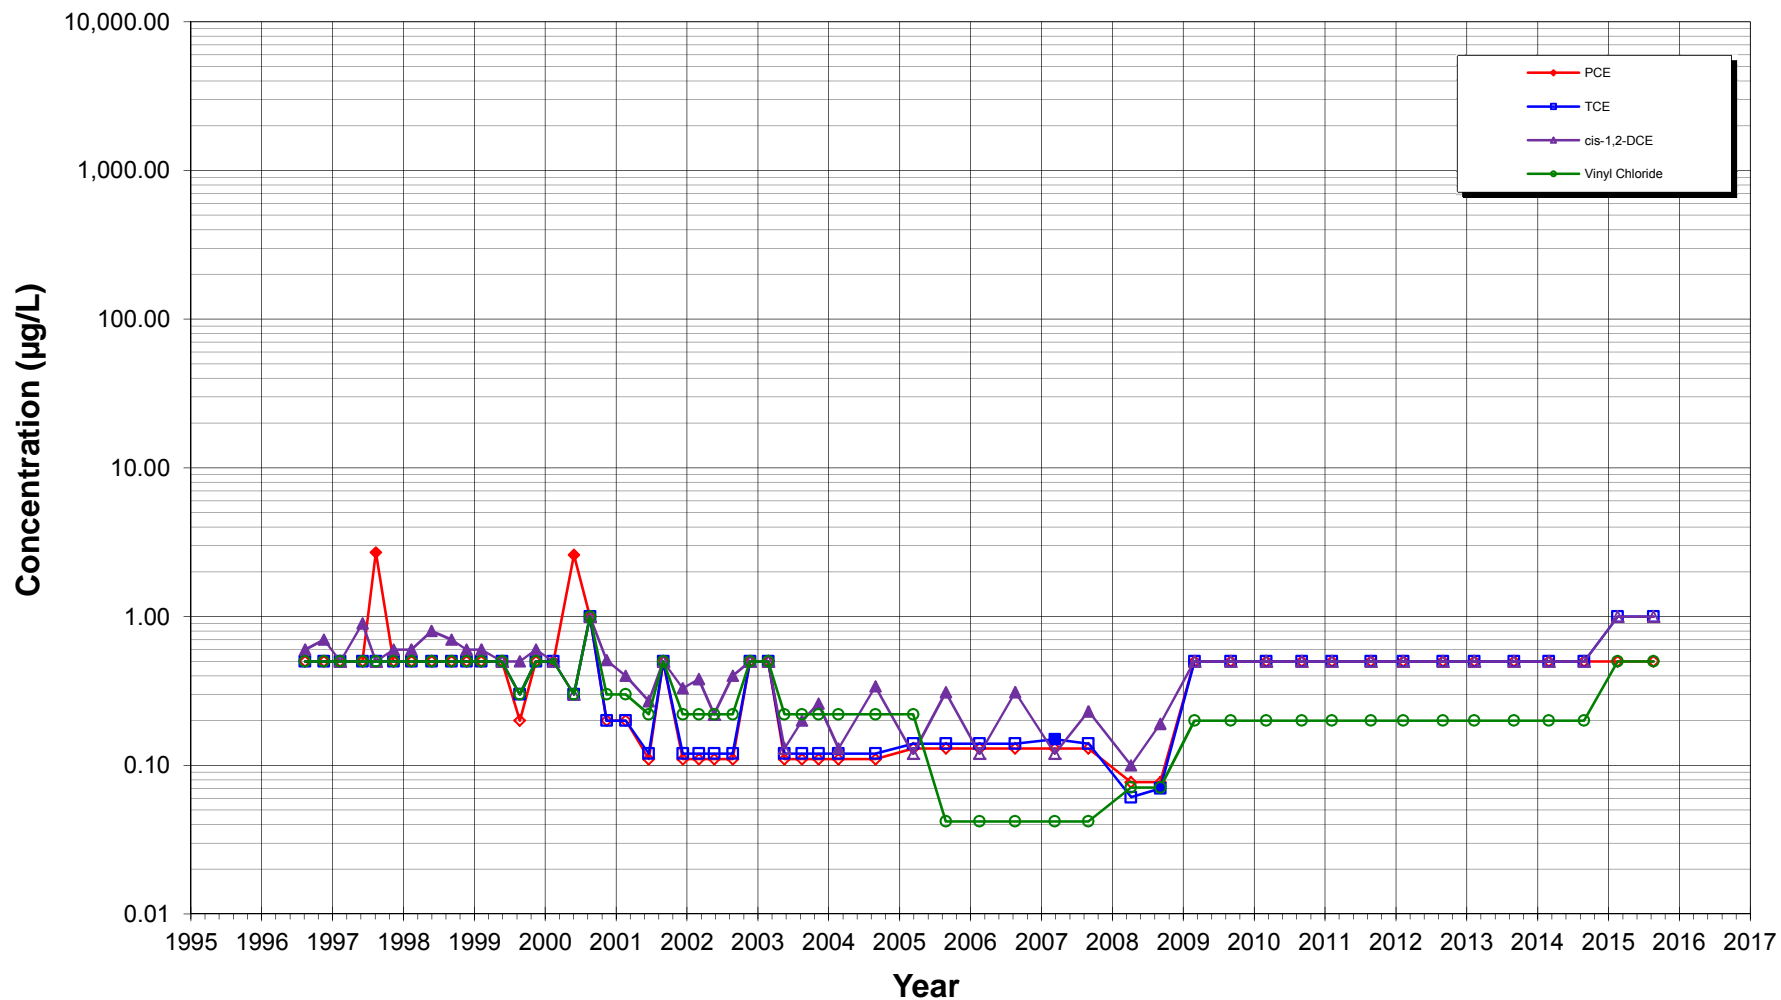

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C12. Constituent vs Time
Monitoring Well MW-6
Univar USA Inc., Kent, Washington**

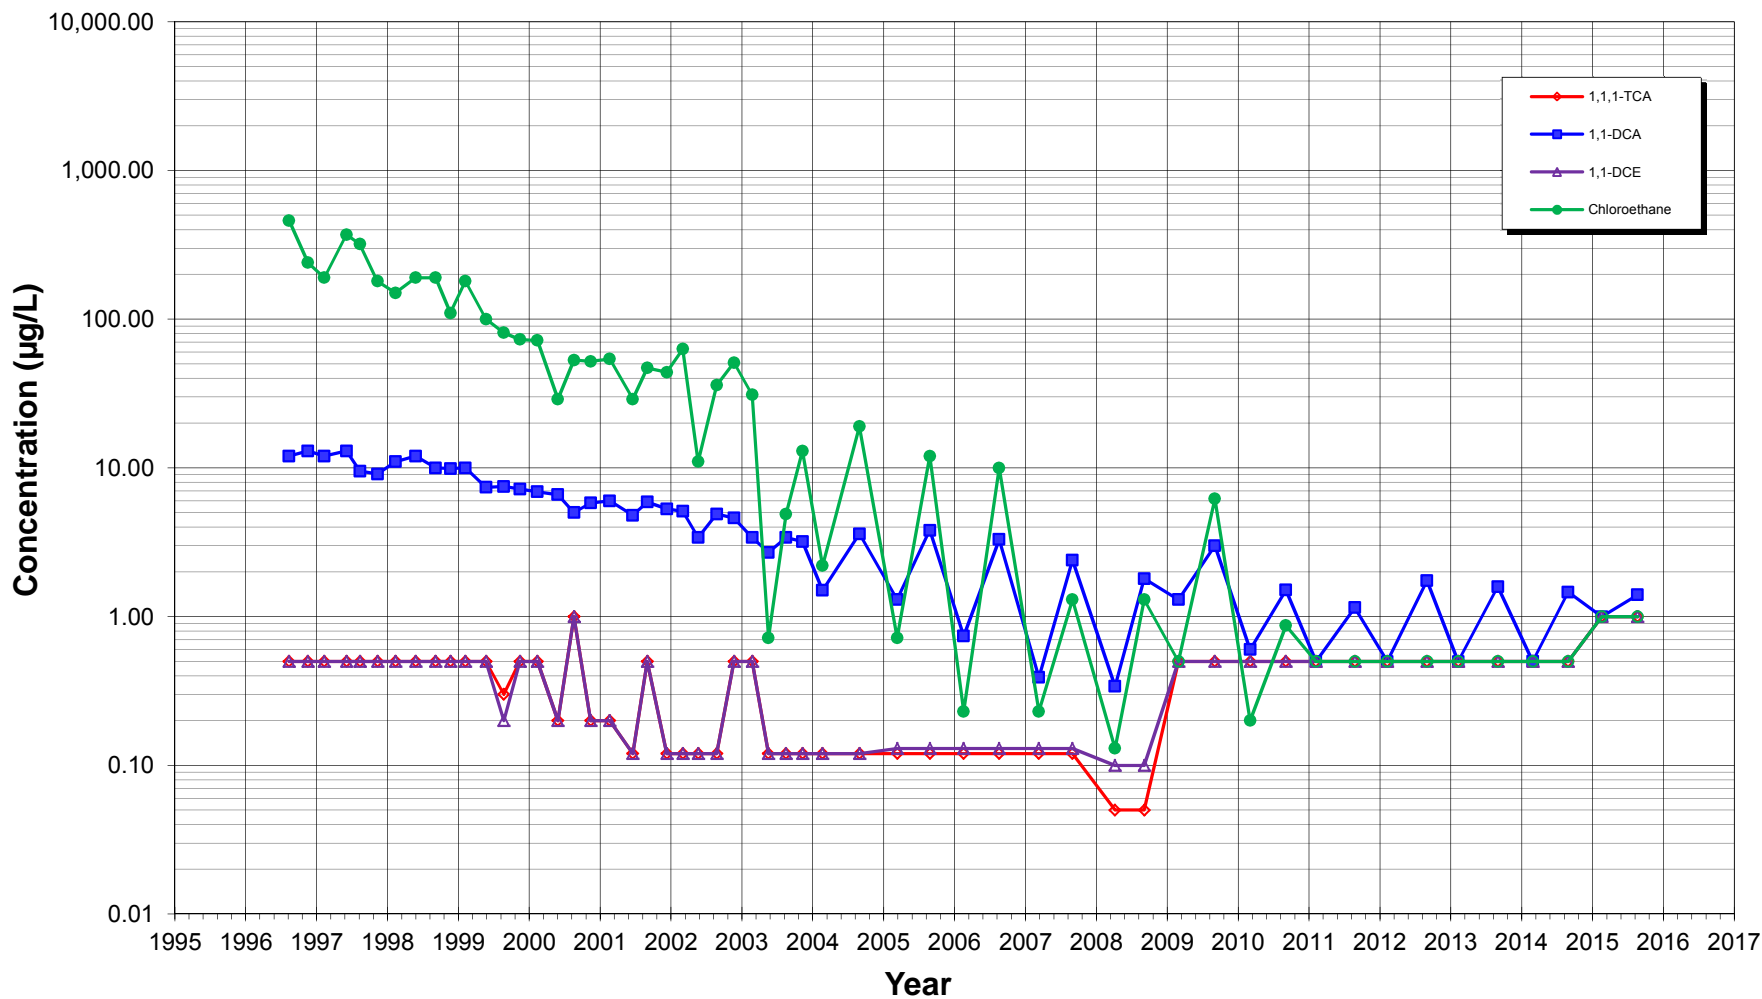

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C13. Constituent vs Time
Monitoring Well MW-7
Univar USA Inc., Kent, Washington**

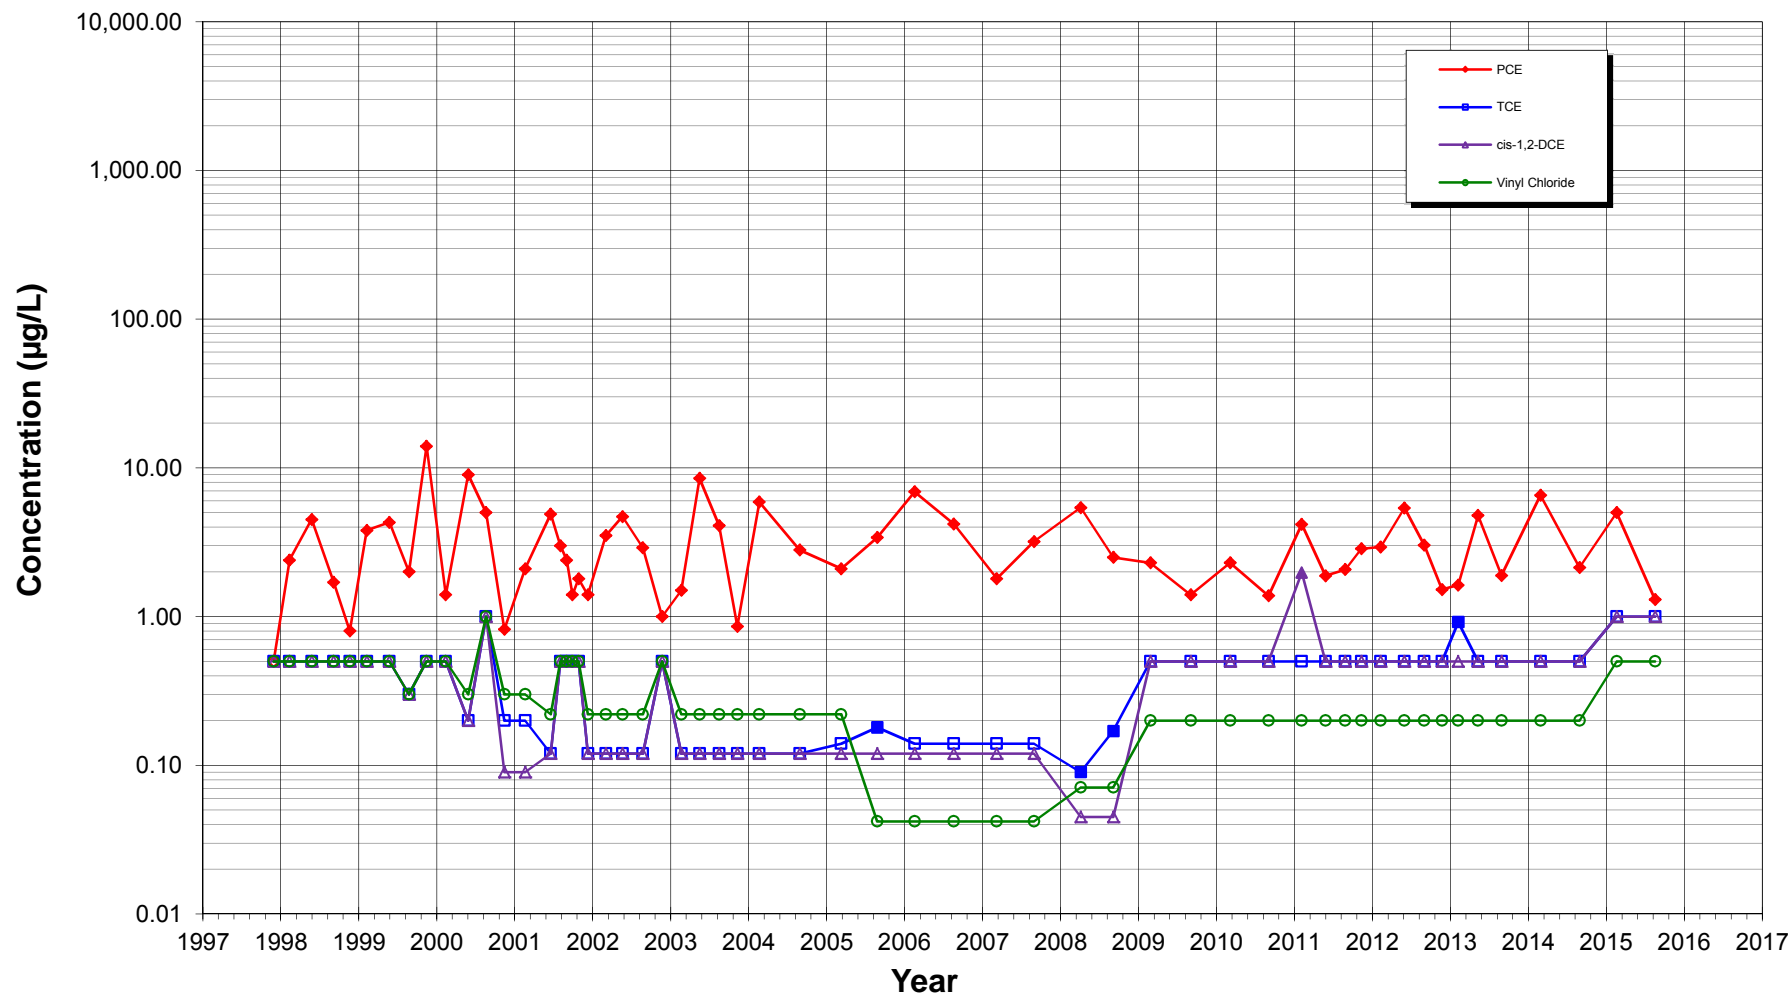

Notes:

- 1) Initial shallow injection in March and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


Figure C14. Constituent vs Time
Monitoring Well MW-7
Univar USA Inc., Kent, Washington

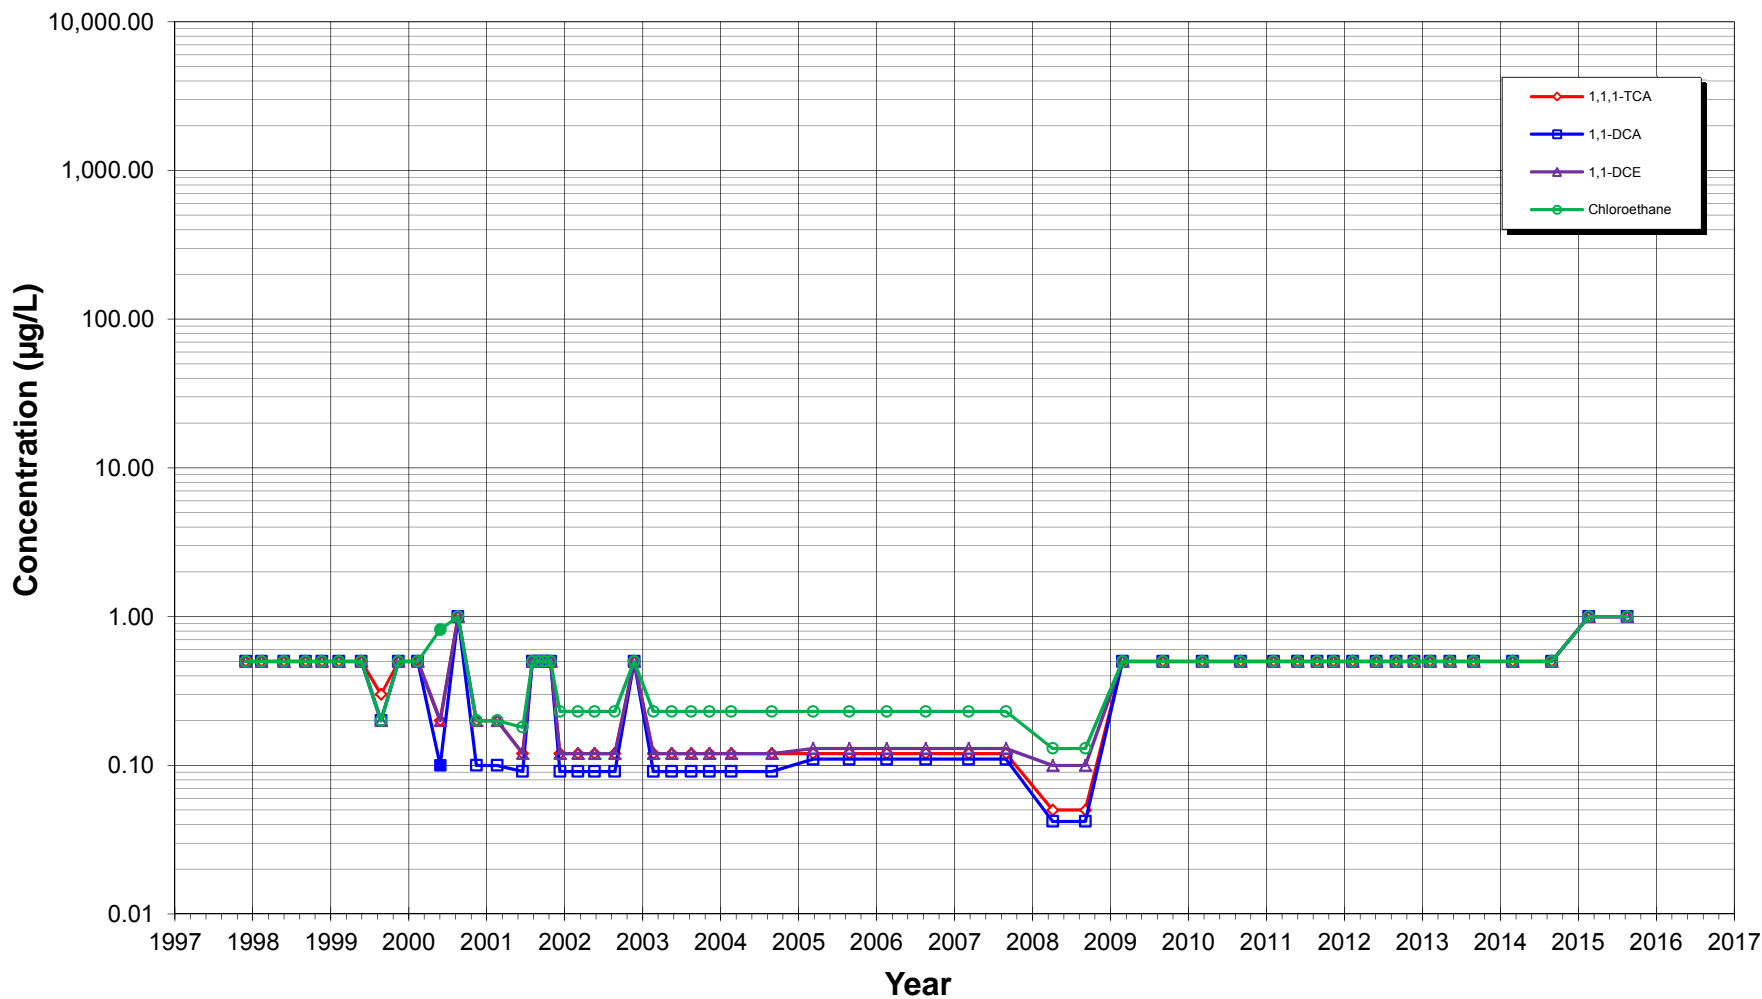

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C15. Constituent vs Time
Monitoring Well MW-8
Univar USA Inc., Kent, Washington**

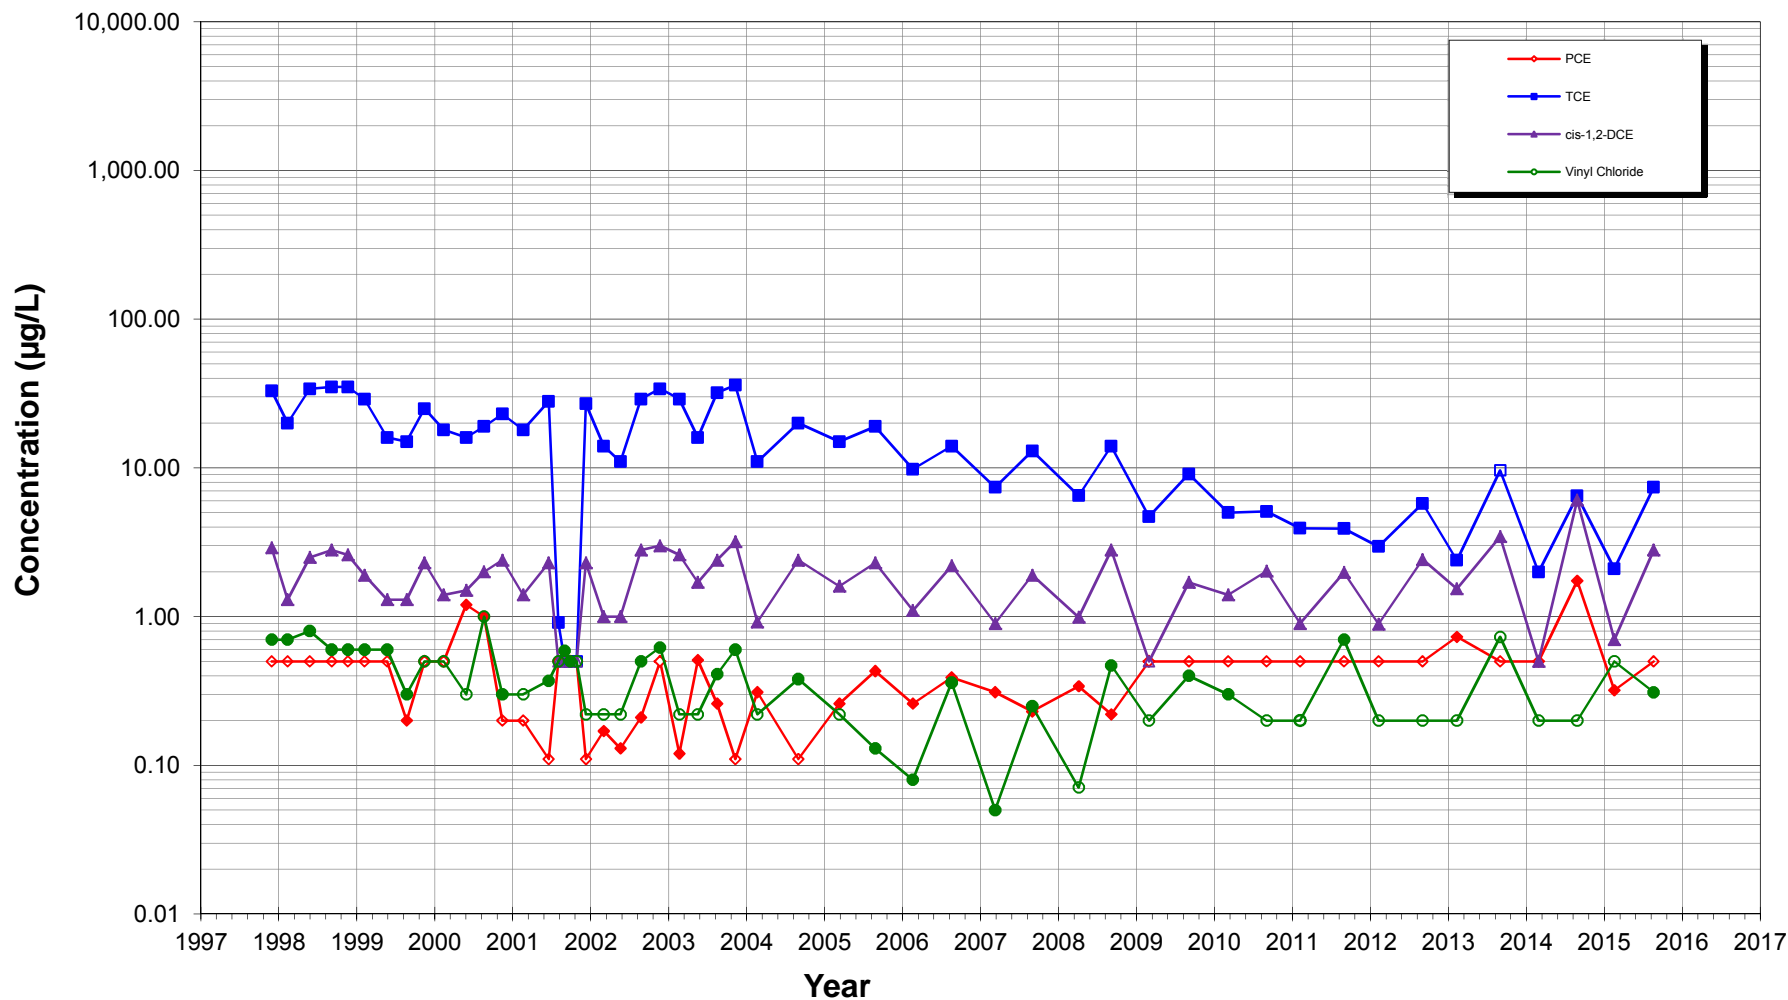

Notes:

- 1) Initial shallow injection in March and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C16. Constituent vs Time
Monitoring Well MW-8
Univar USA Inc., Kent, Washington**

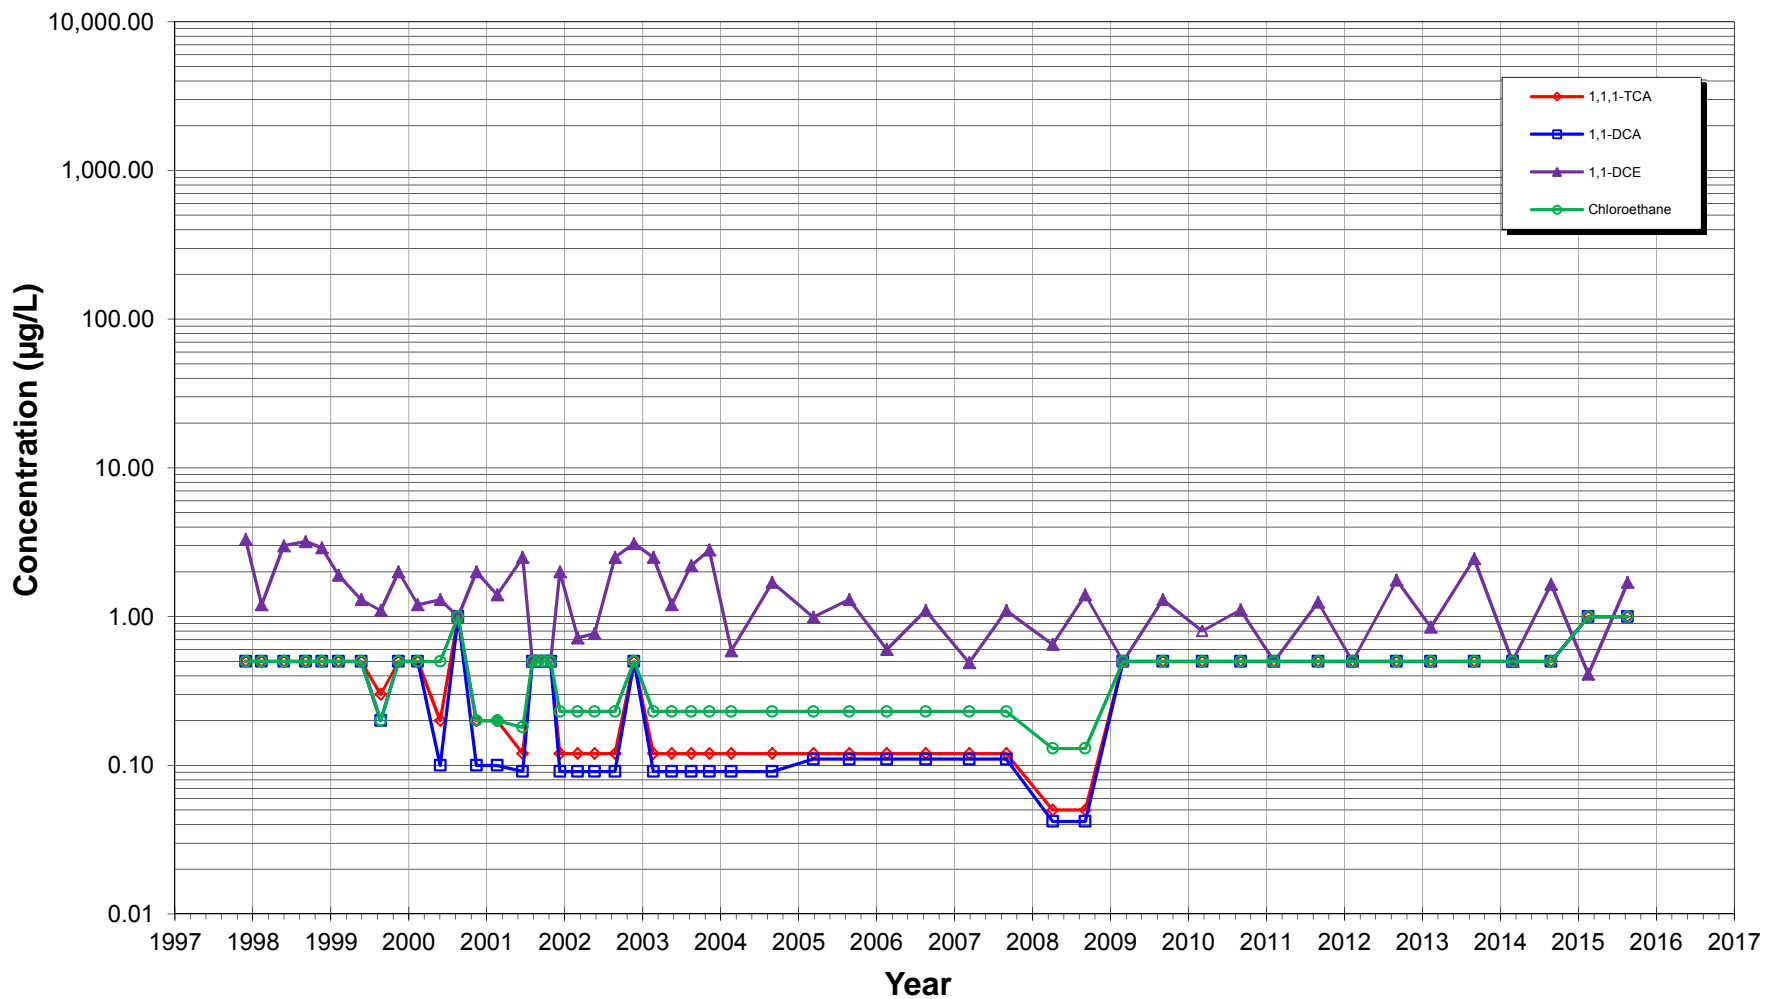

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C17. Constituent vs Time
Monitoring Well MW-9
Univar USA Inc., Kent, Washington**

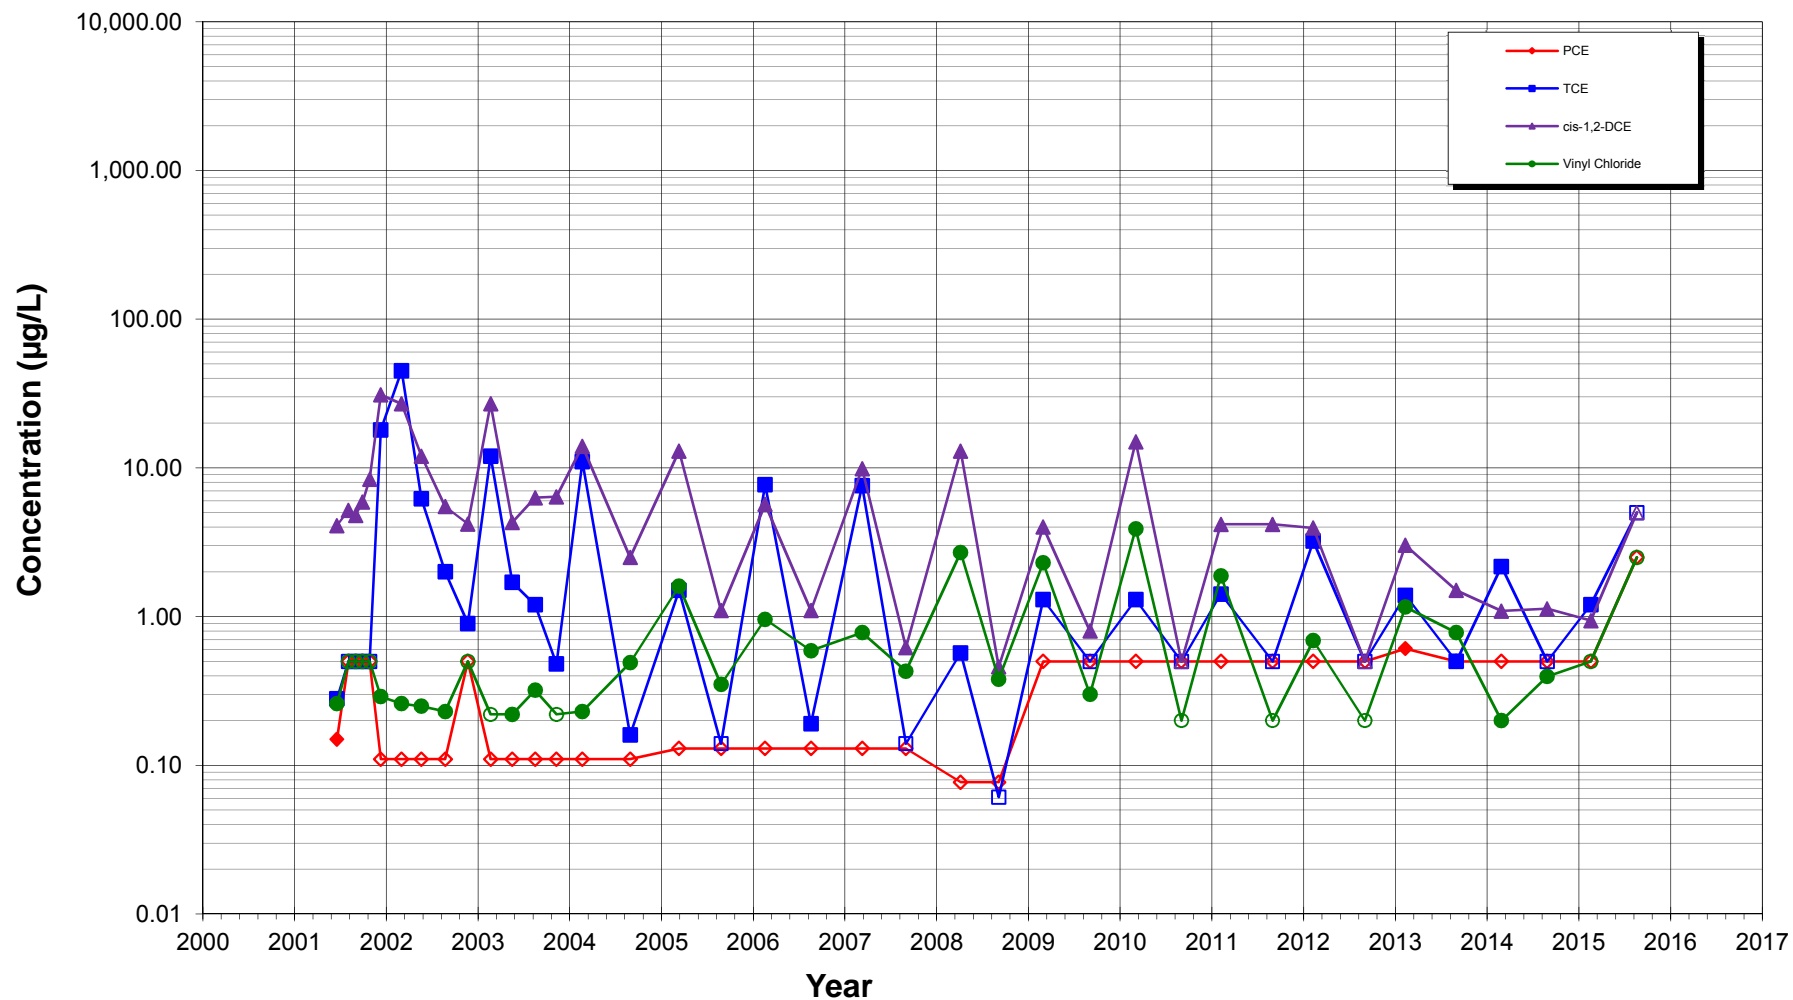

Notes:

- 1) Initial shallow injection in March and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C18. Constituent vs Time
Monitoring Well MW-9
Univar USA Inc., Kent, Washington**

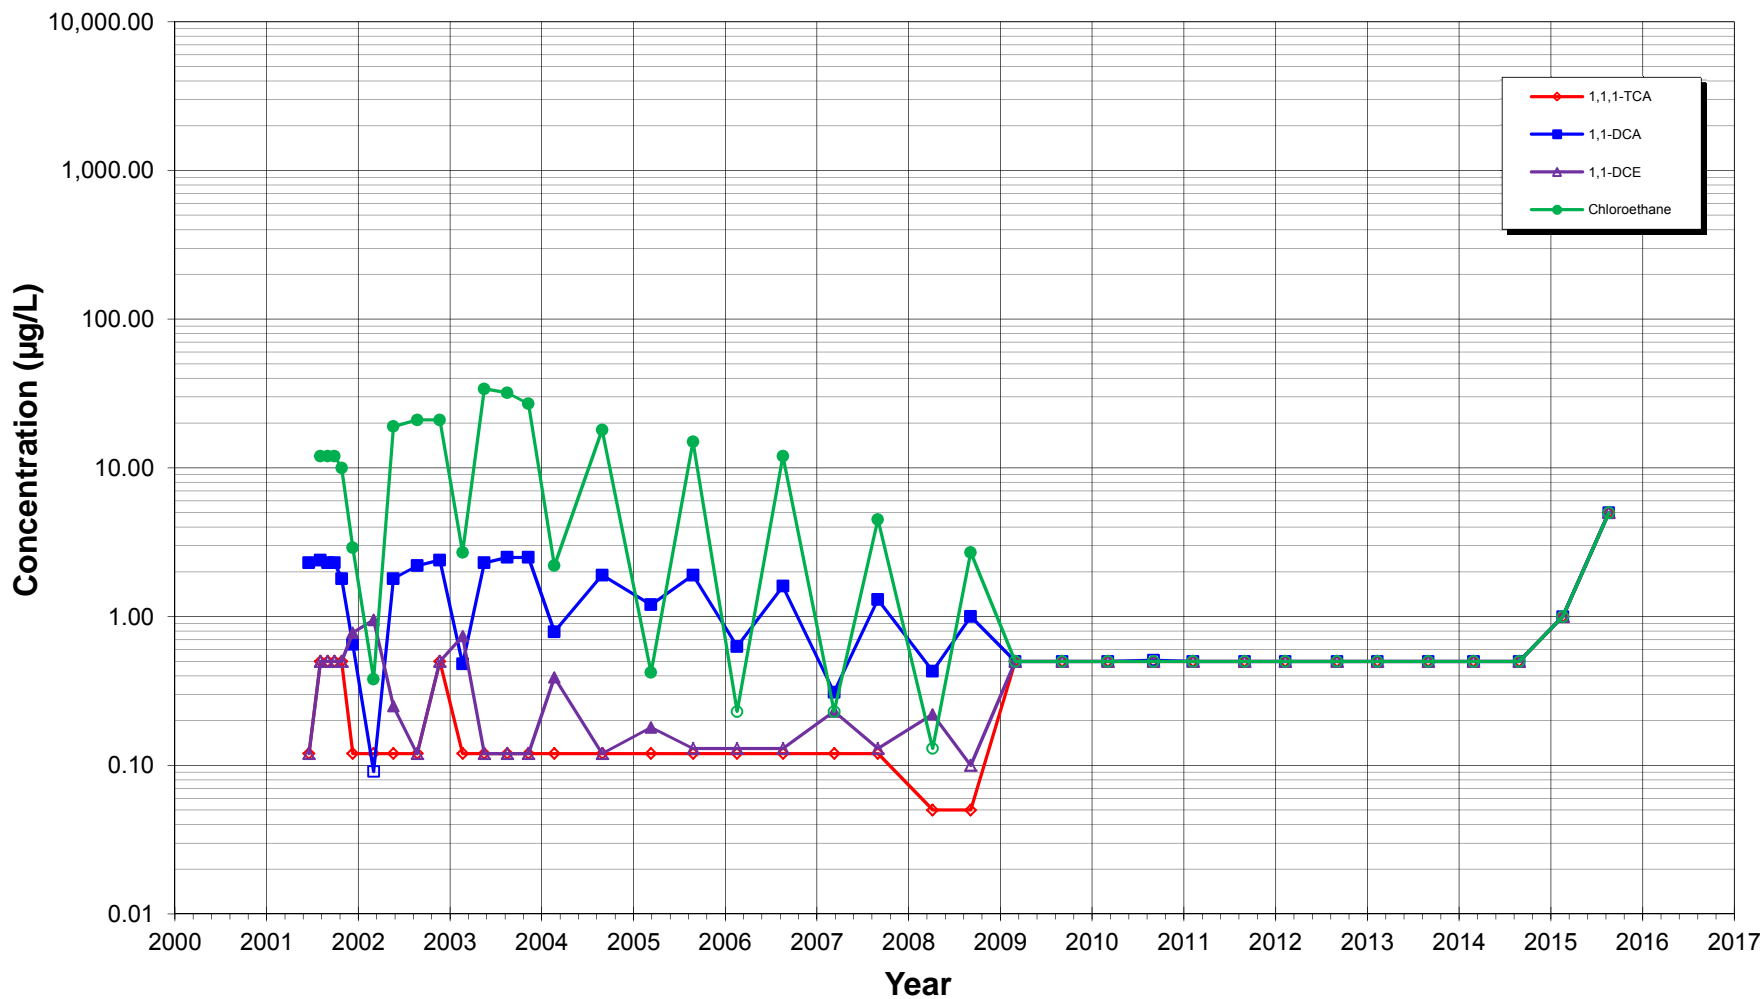

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C19. Constituent vs Time
Monitoring Well MW-10
Univar USA Inc., Kent, Washington**

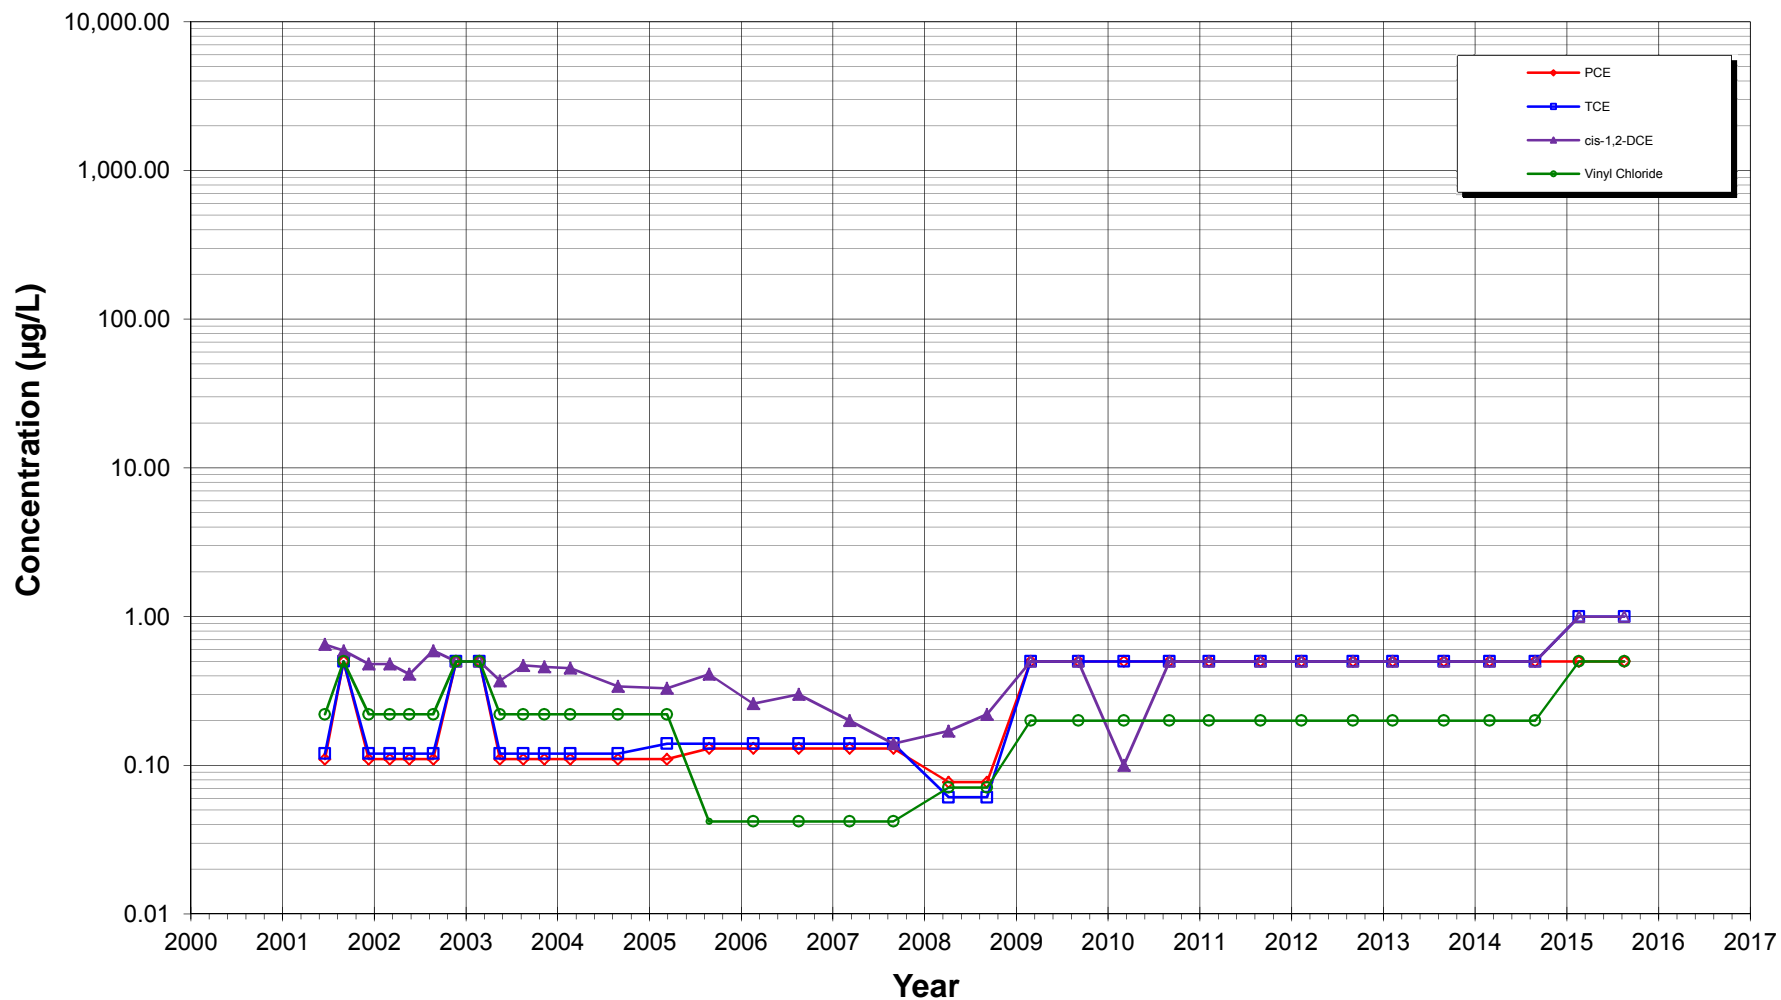

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C20. Constituent vs Time
Monitoring Well MW-10
Univar USA Inc., Kent, Washington**

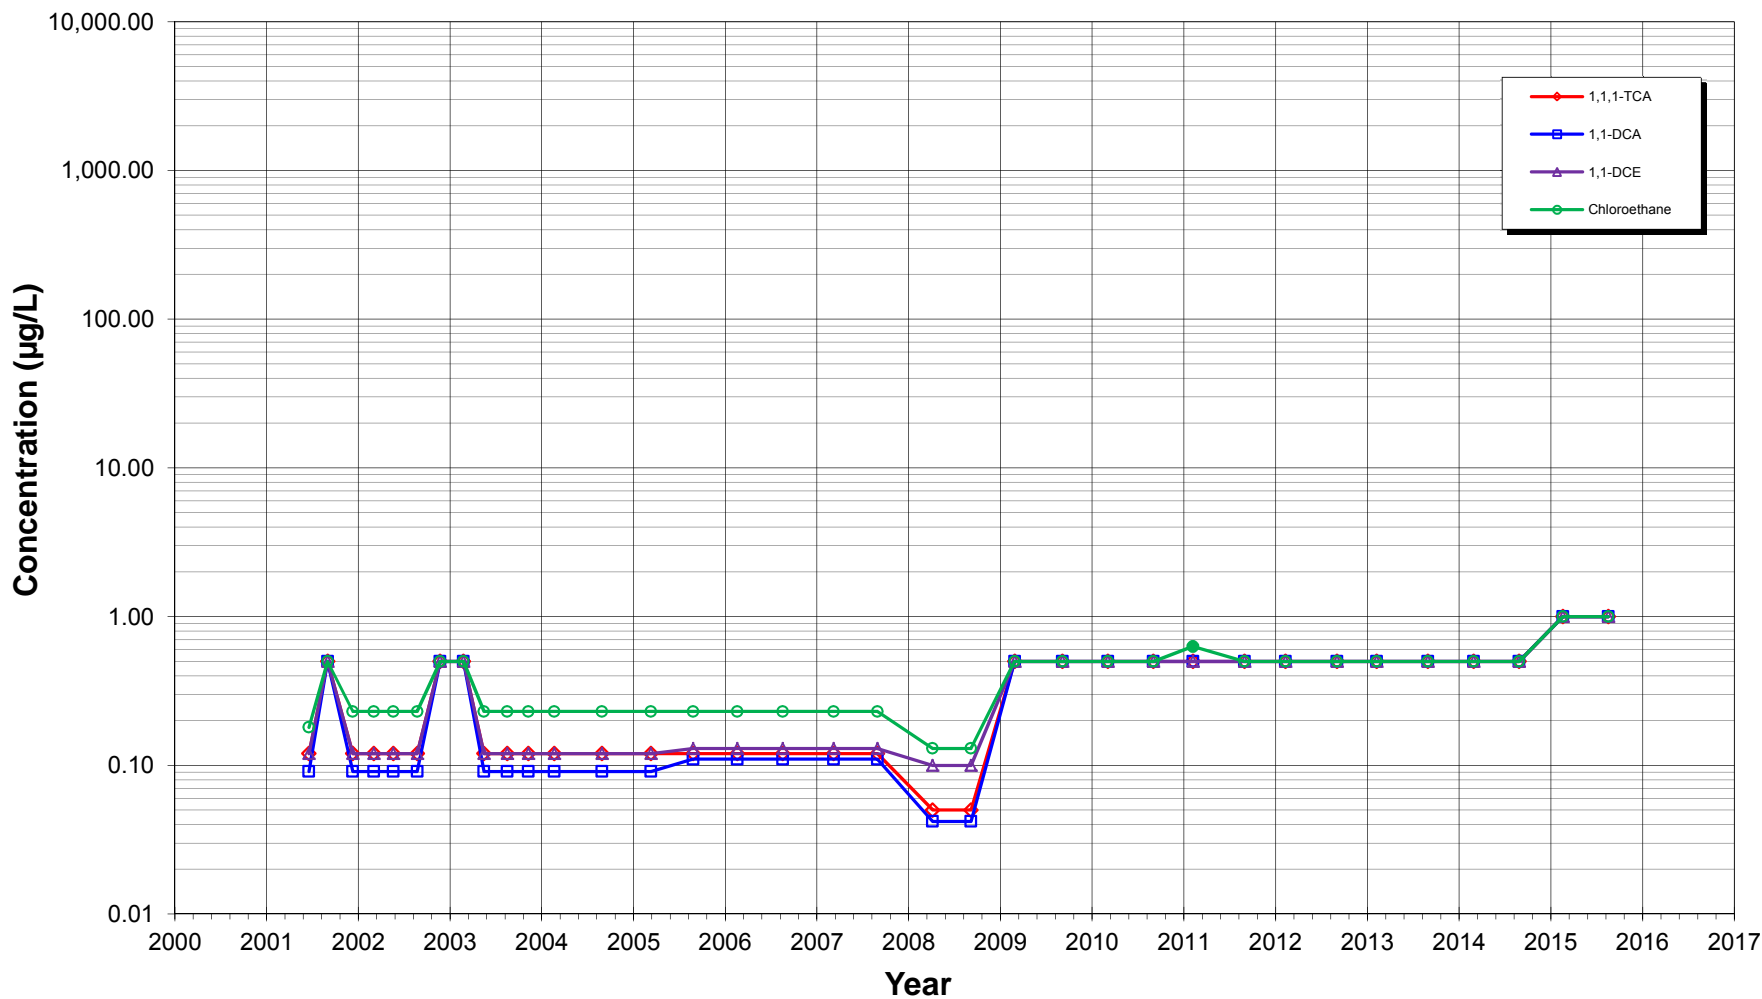

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C21. Constituent vs Time
Monitoring Well MW-12
Univar USA Inc., Kent, Washington**

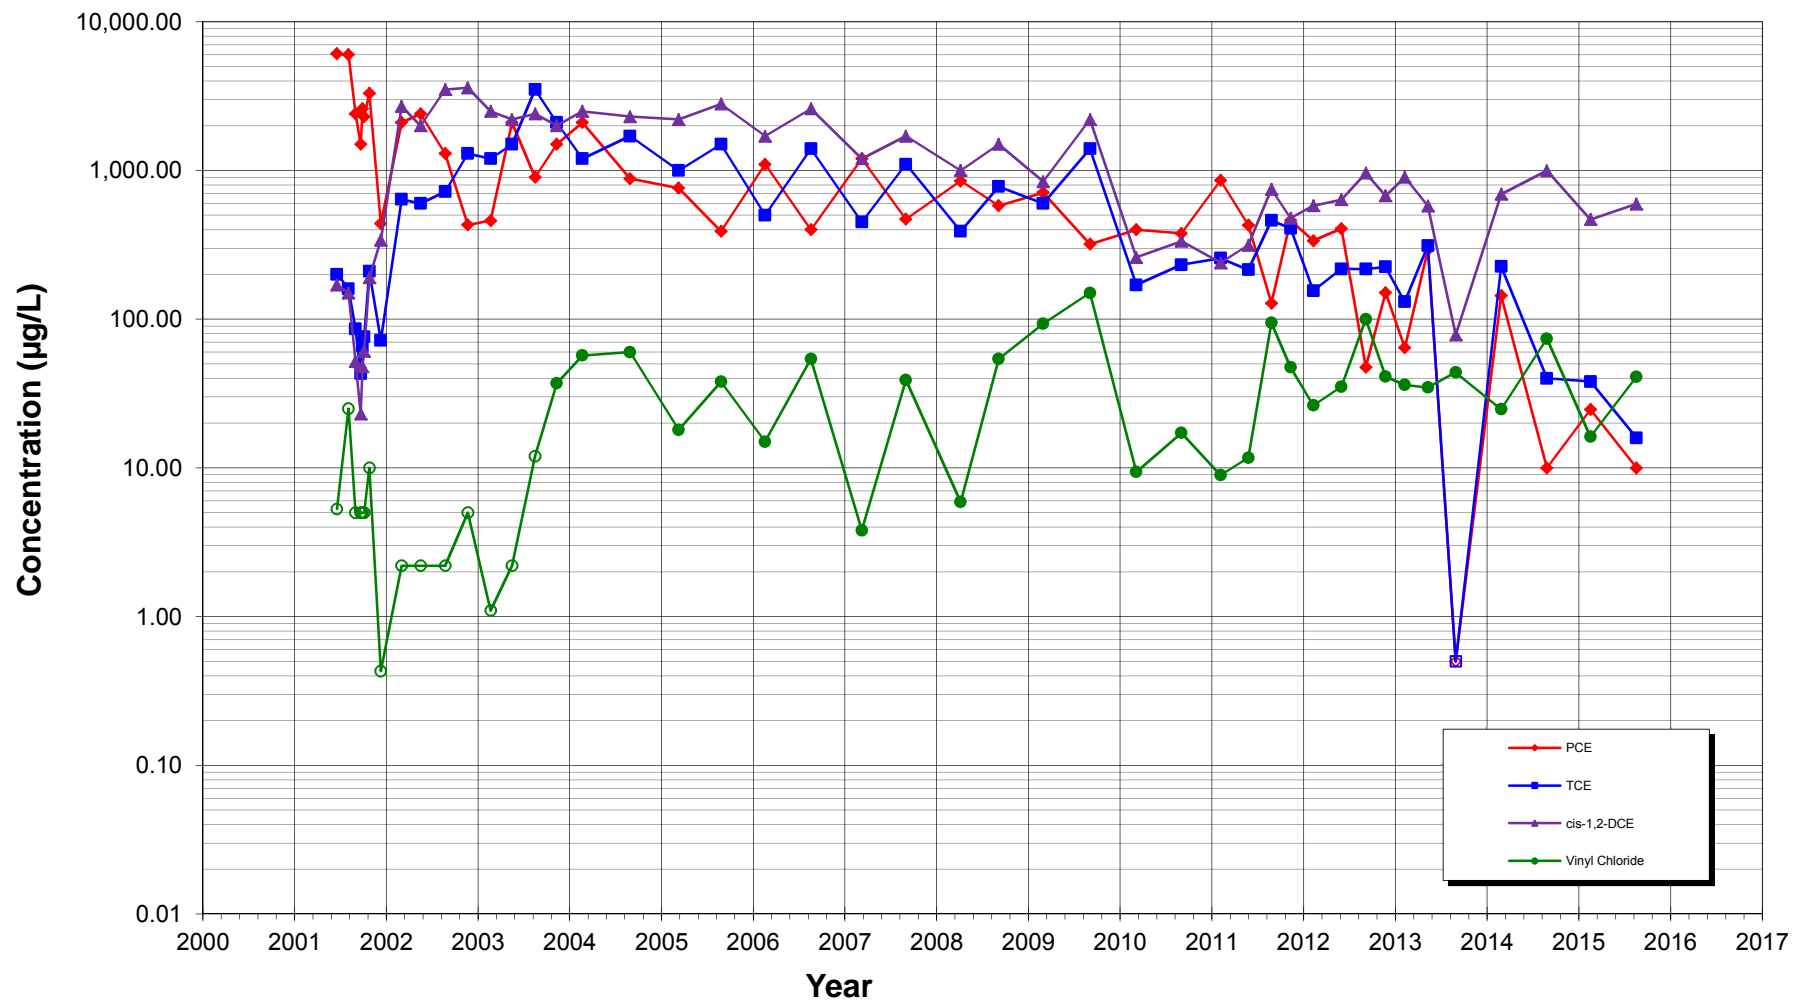

Notes:

- 1) Initial shallow injection in March and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C22. Constituent vs Time
Monitoring Well MW-12
Univar USA Inc., Kent, Washington**

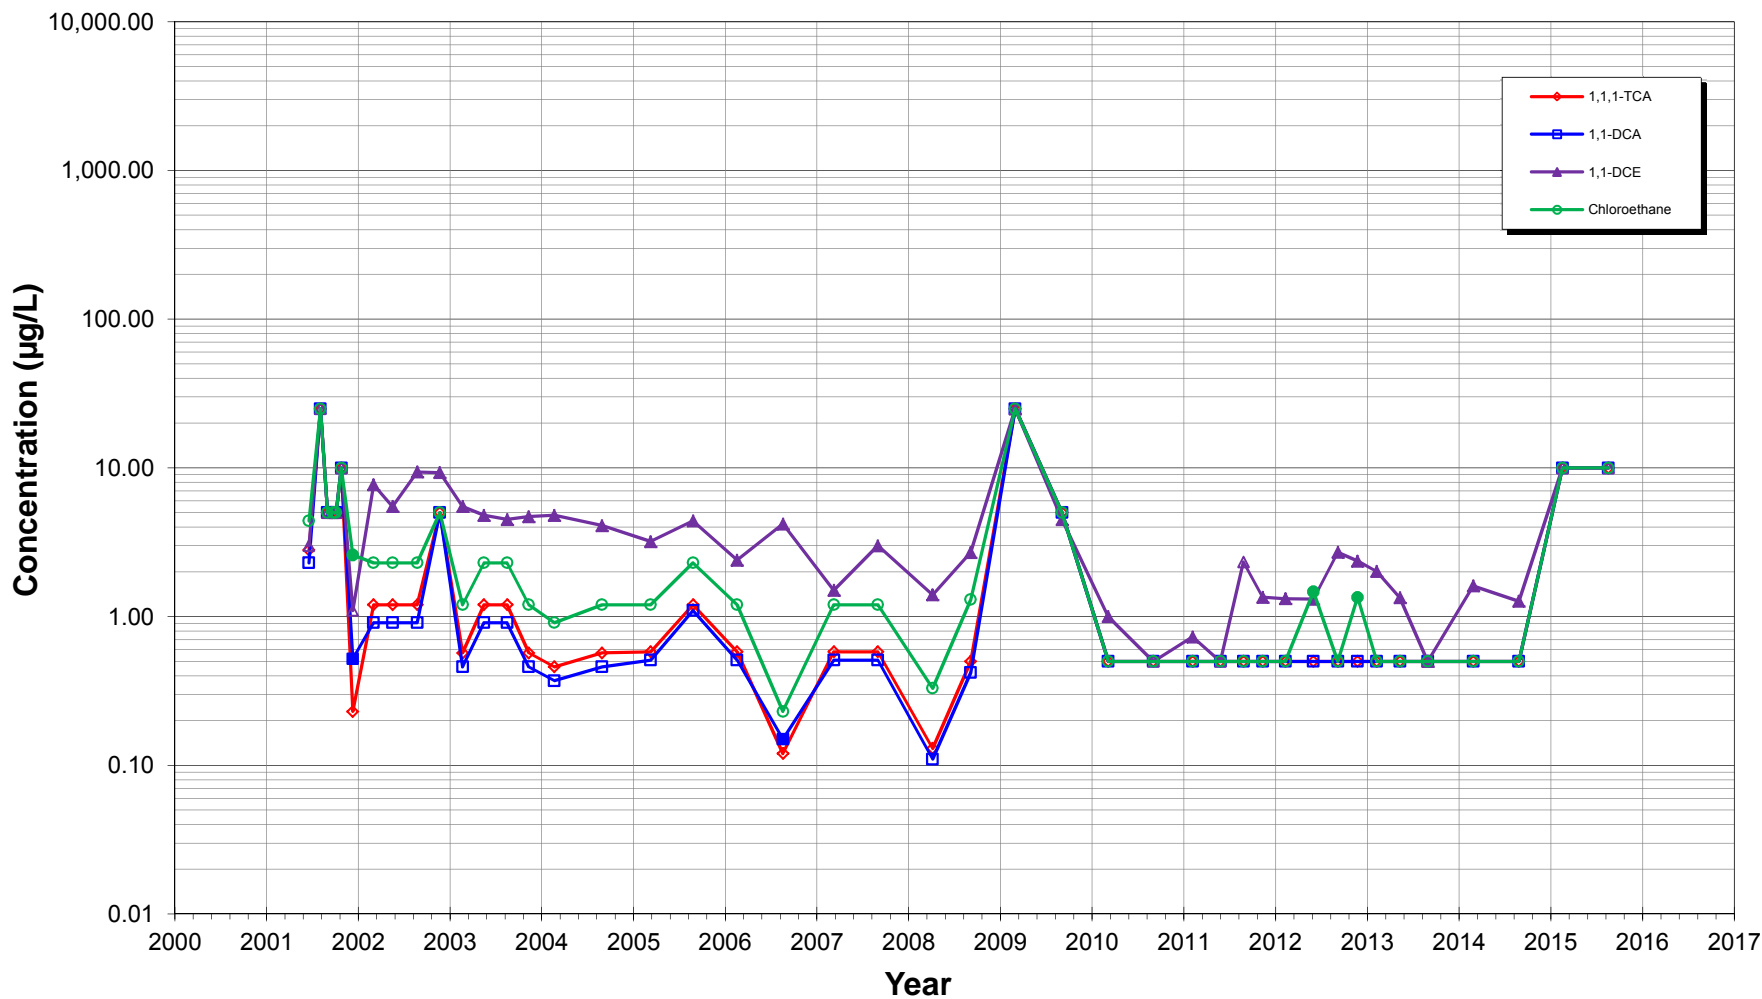

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C23. Constituent vs Time
Monitoring Well MW-23
Univar USA Inc., Kent, Washington**

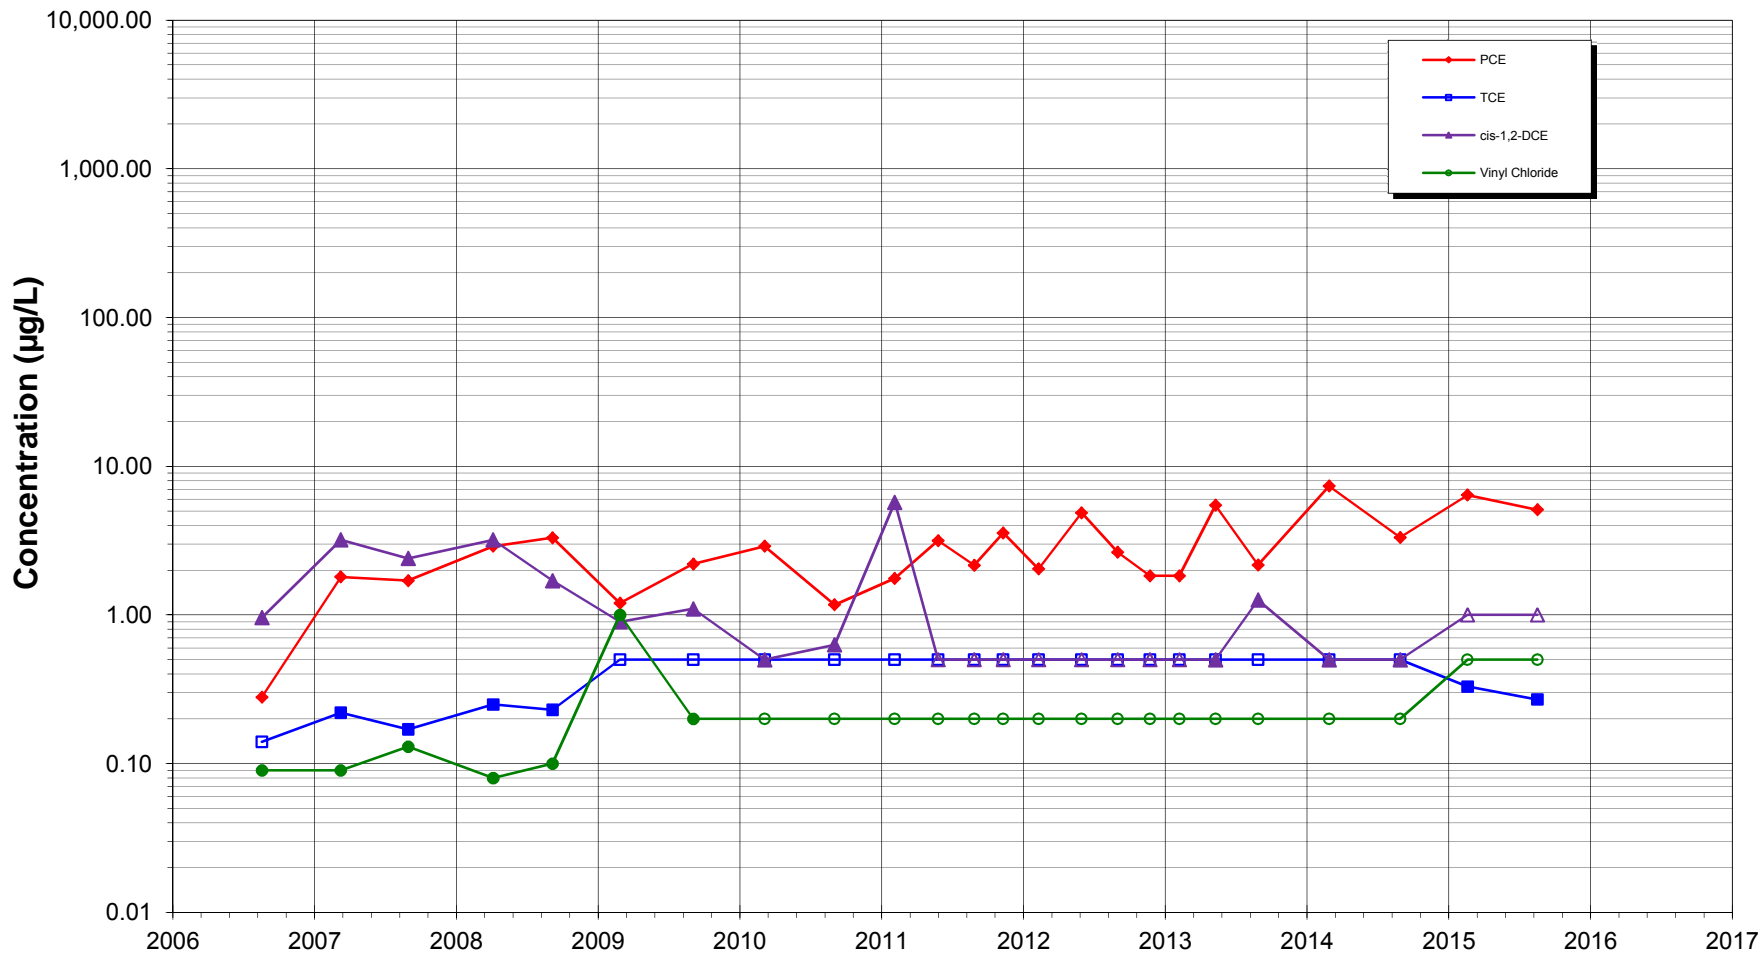

Notes:

- 1) Initial shallow injection in March and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L and Vinyl Chloride = 0.5 µg/L.


**Figure C24. Constituent vs Time
Monitoring Well MW-23
Univar USA Inc., Kent, Washington**

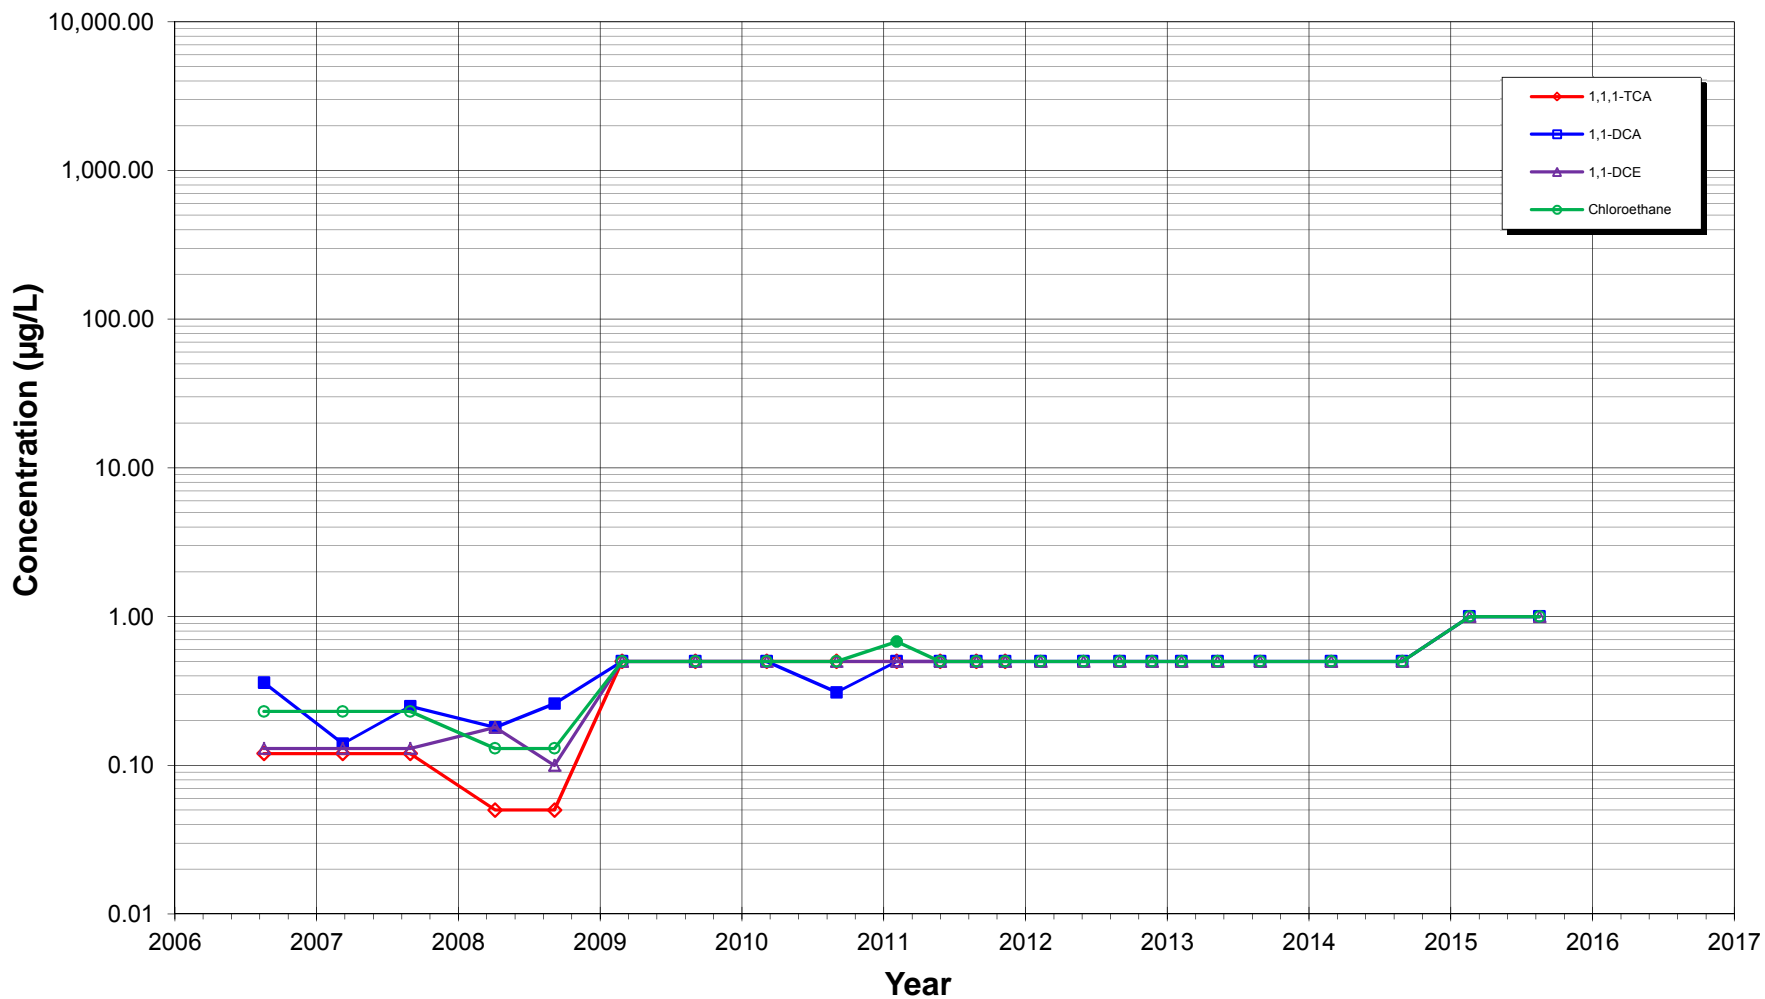

Notes:

- 1) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 2) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


Figure C25. Constituent vs Time
Monitoring Well MW-13
Univar USA Inc., Kent, Washington

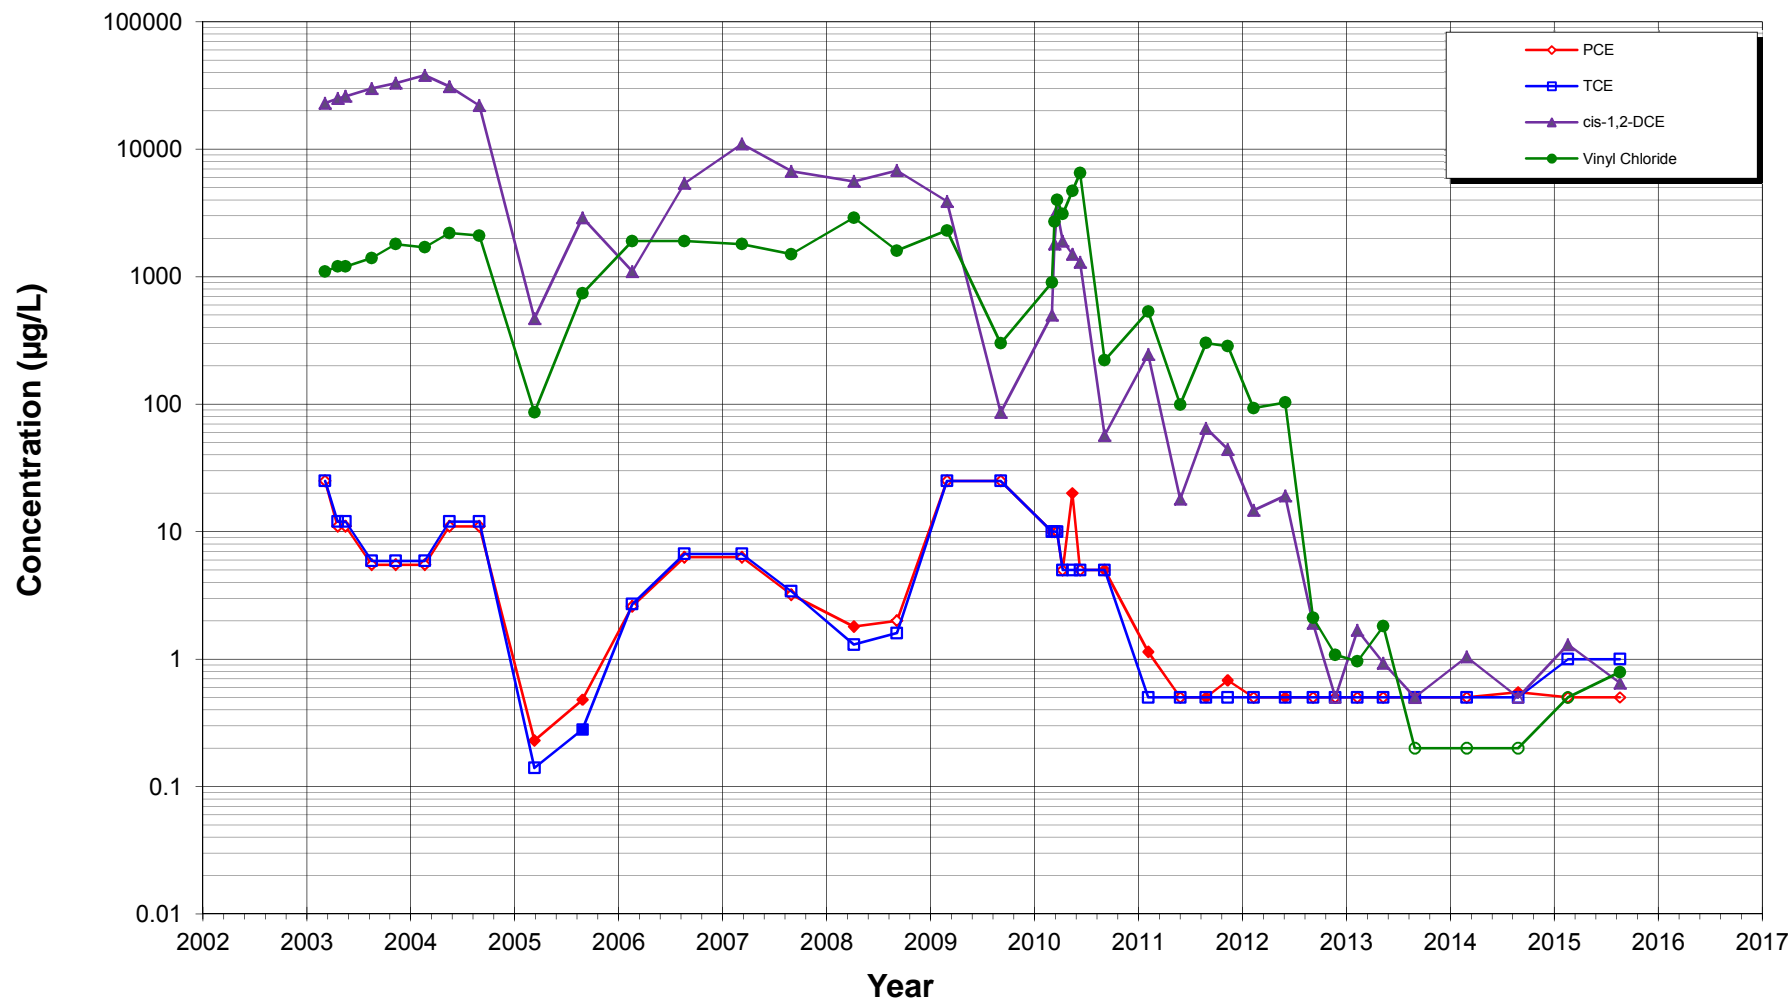

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C26. Constituent vs Time
Monitoring Well MW-13
Univar USA Inc., Kent, Washington**

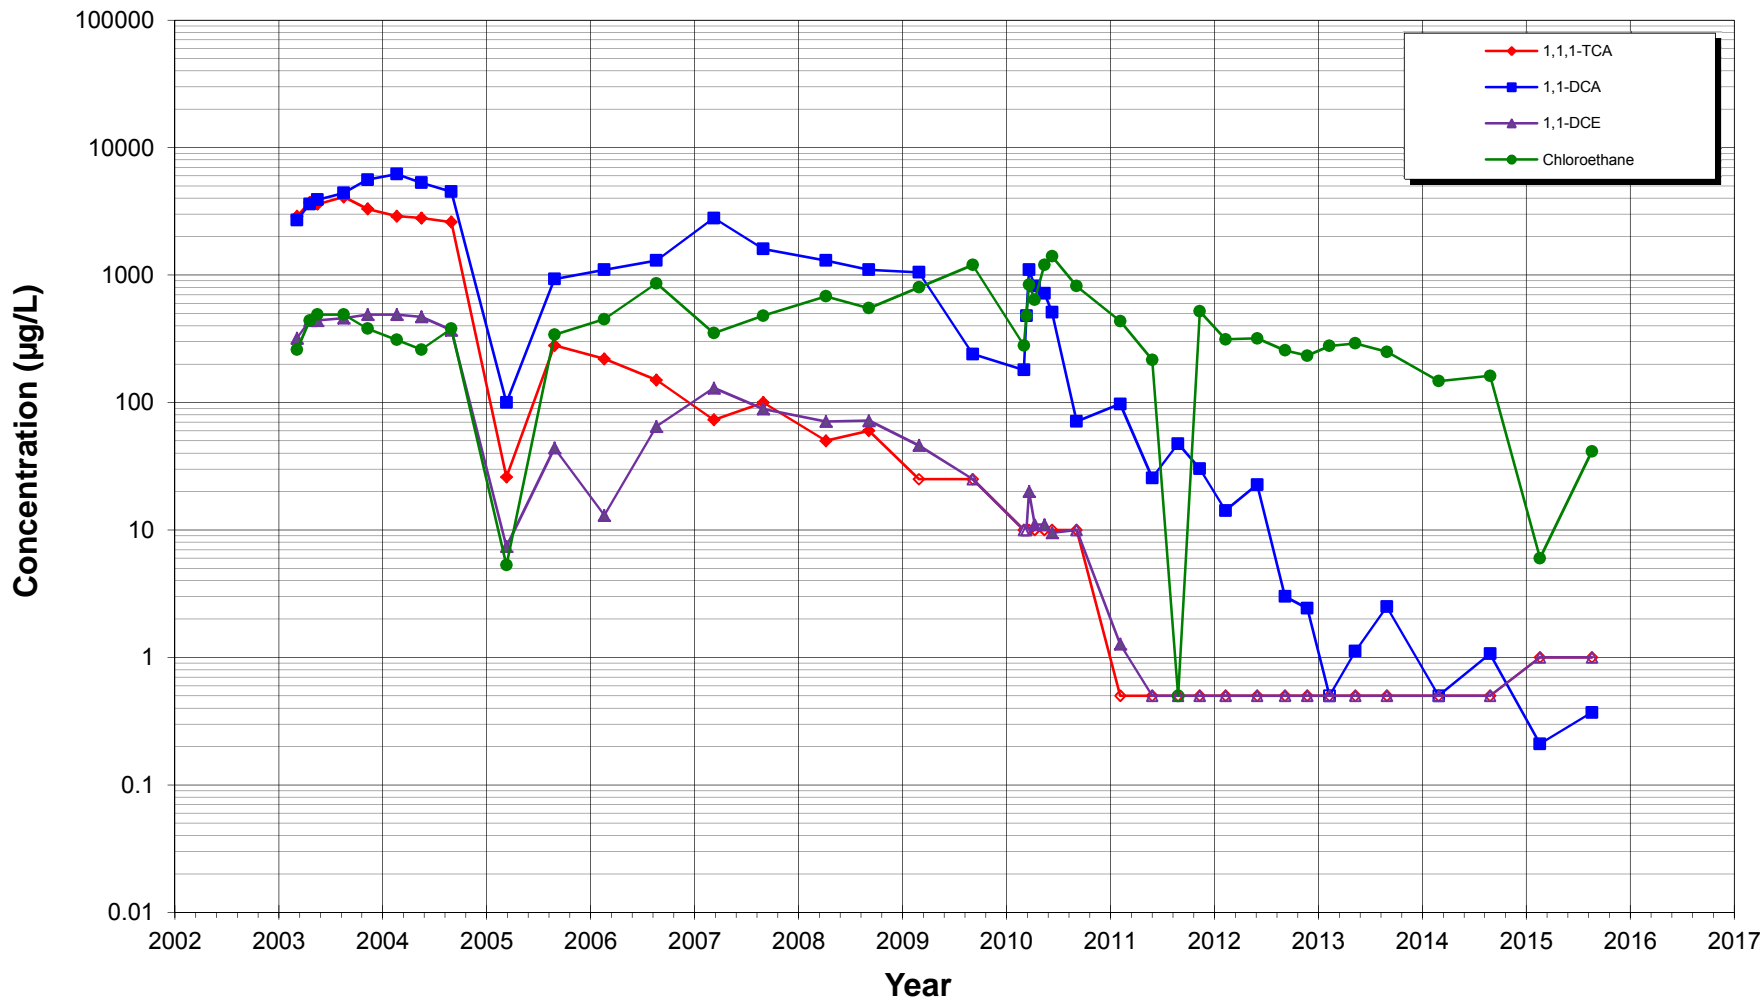

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C27. Constituent vs Time
Monitoring Well MW-14
Univar USA Inc., Kent, Washington**

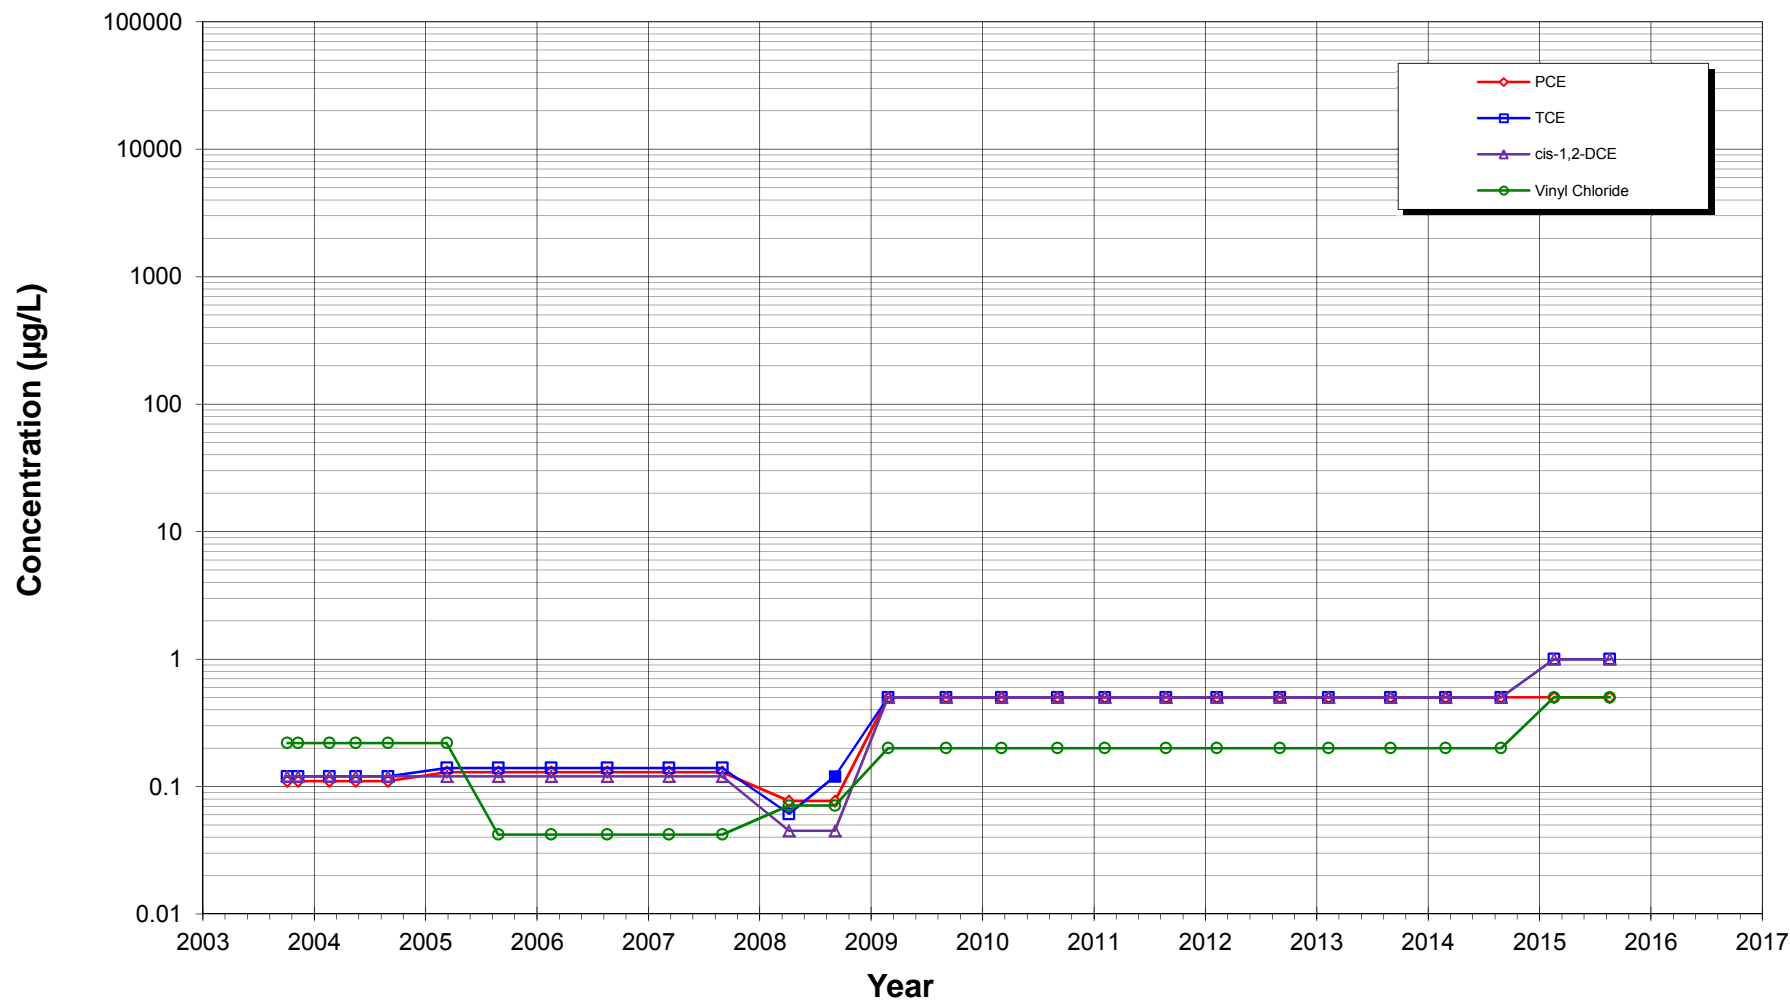

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L..


Figure C28. Constituent vs Time
Monitoring Well MW-14
Univar USA Inc., Kent, Washington

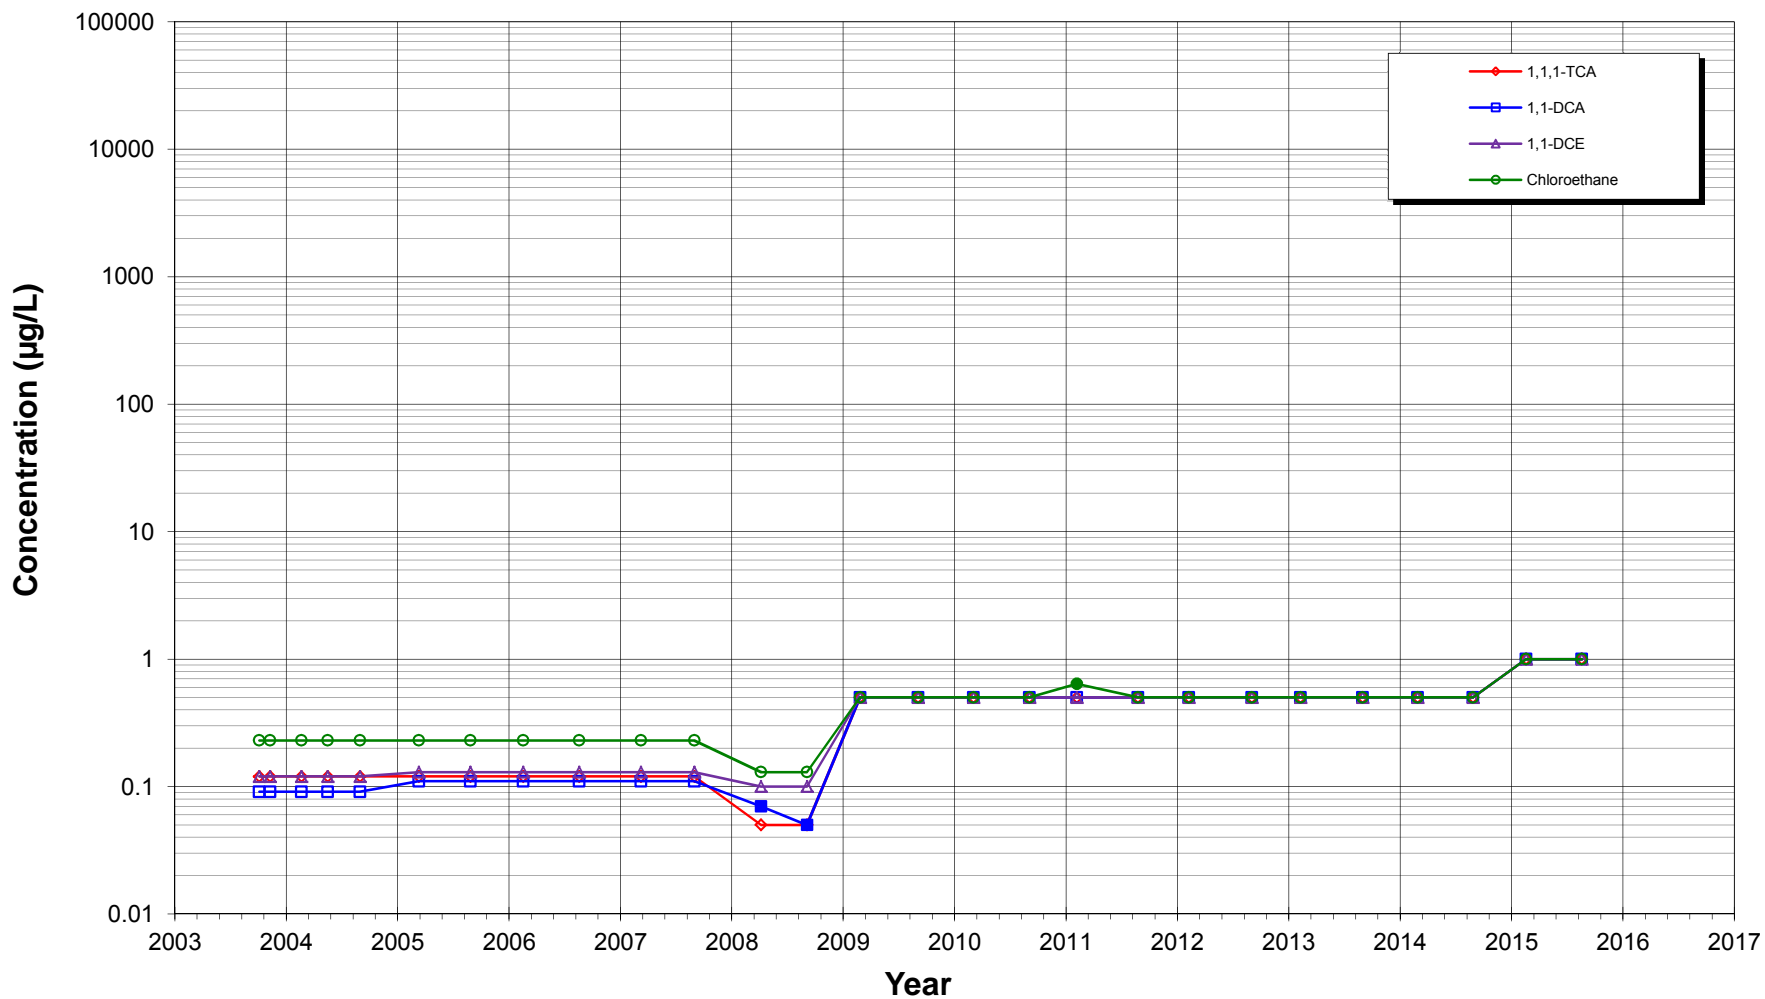

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C29. Constituent vs Time
Monitoring Well MW-15
Univar USA Inc., Kent, Washington**

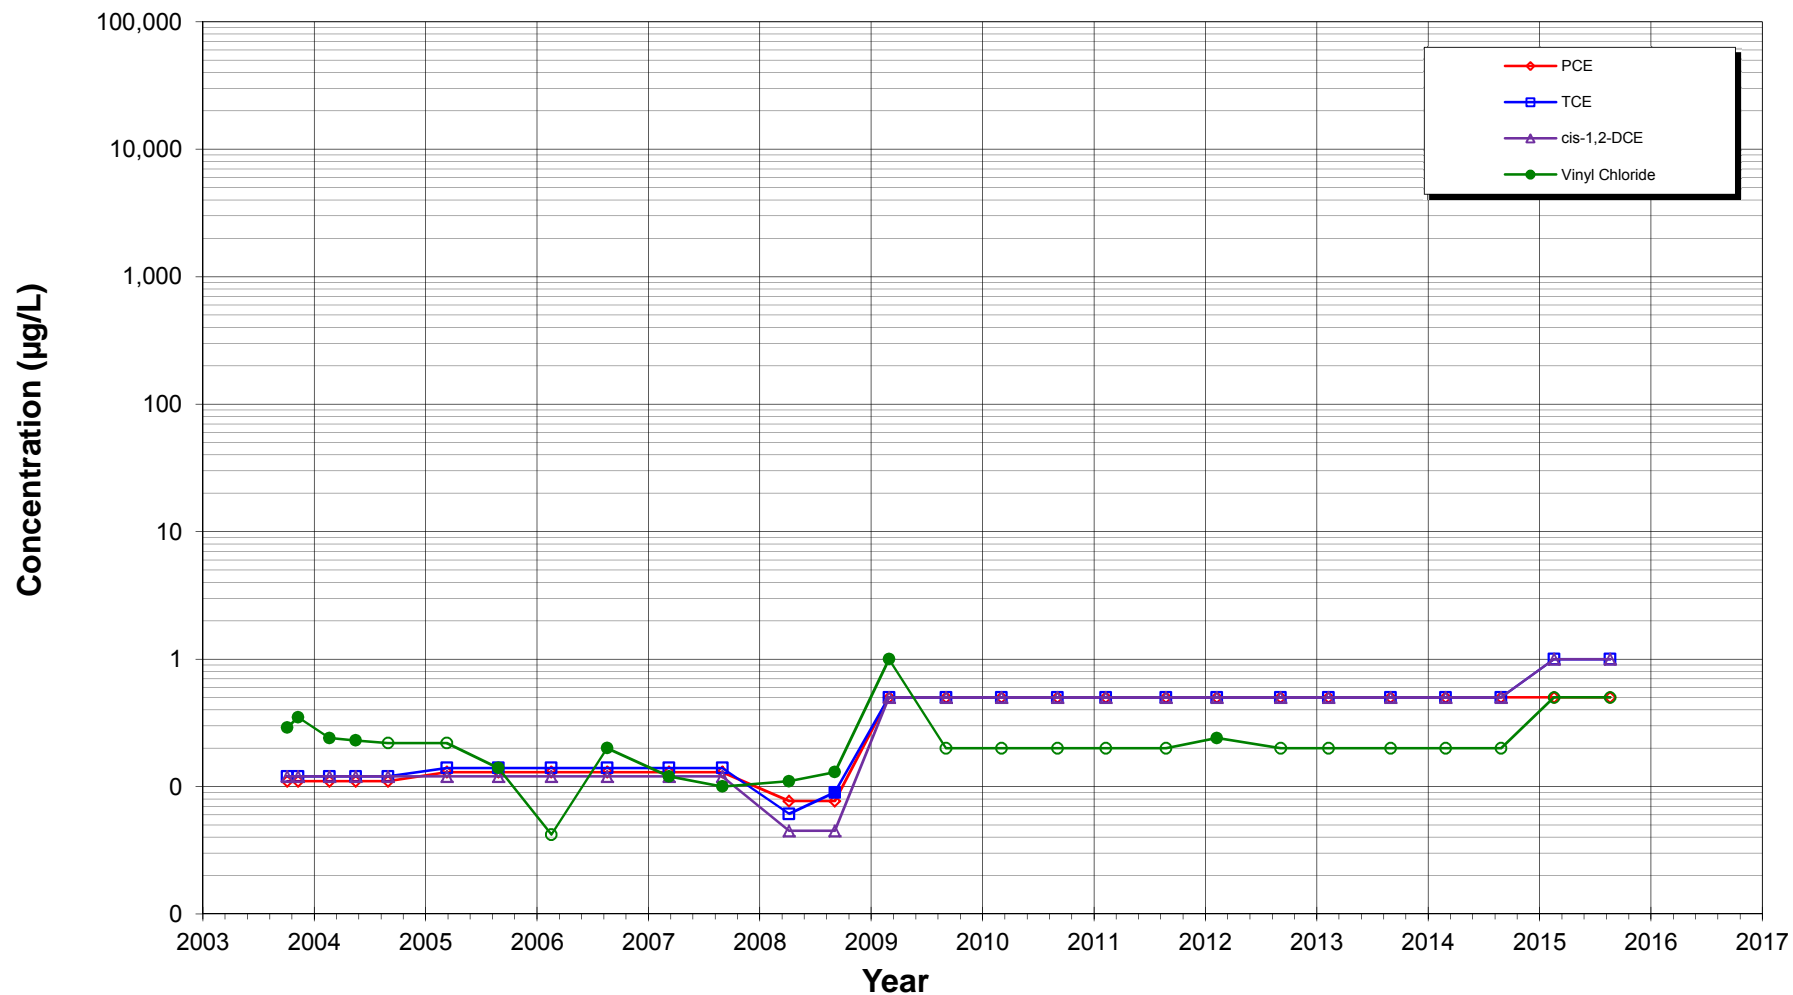

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C30. Constituent vs Time
Monitoring Well MW-15
Univar USA Inc., Kent, Washington**

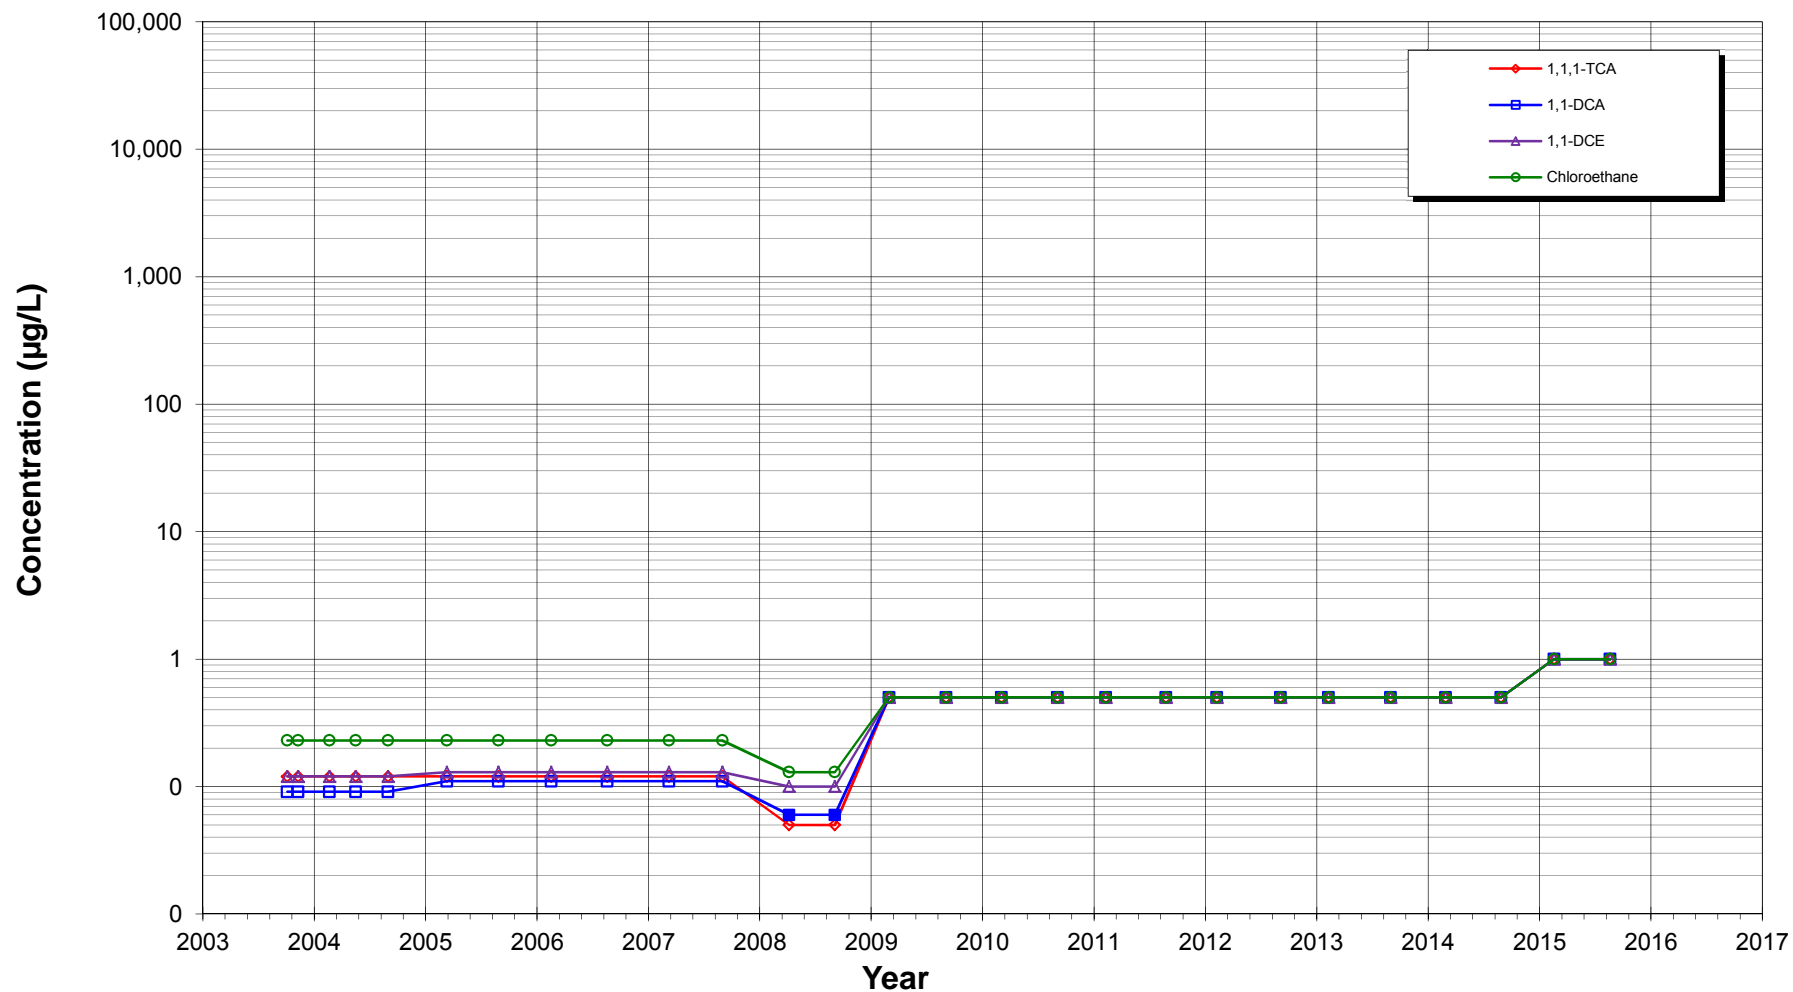

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C31. Constituent vs Time
Monitoring Well MW-16
Univar USA Inc., Kent, Washington**

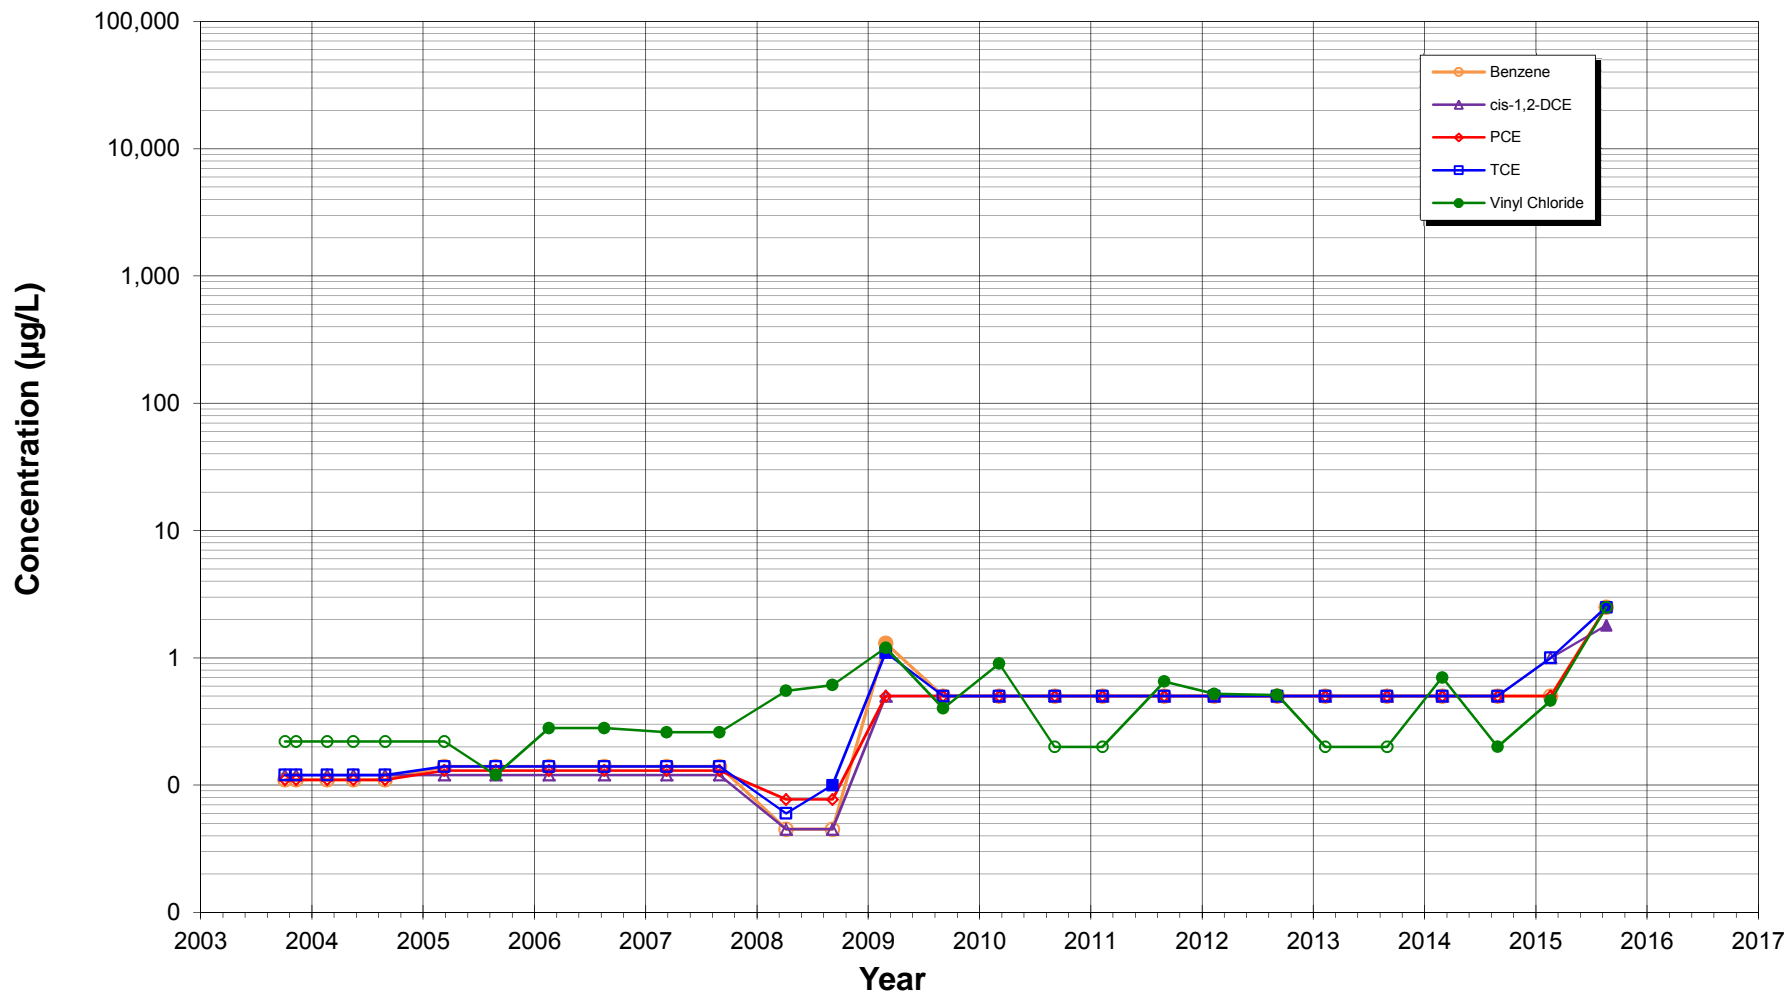

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, Vinyl Chloride = 0.5 µg/L, and Benzene = 0.8 µg/L.


**Figure C32. Constituent vs Time
Monitoring Well MW-16
Univar USA Inc., Kent, Washington**

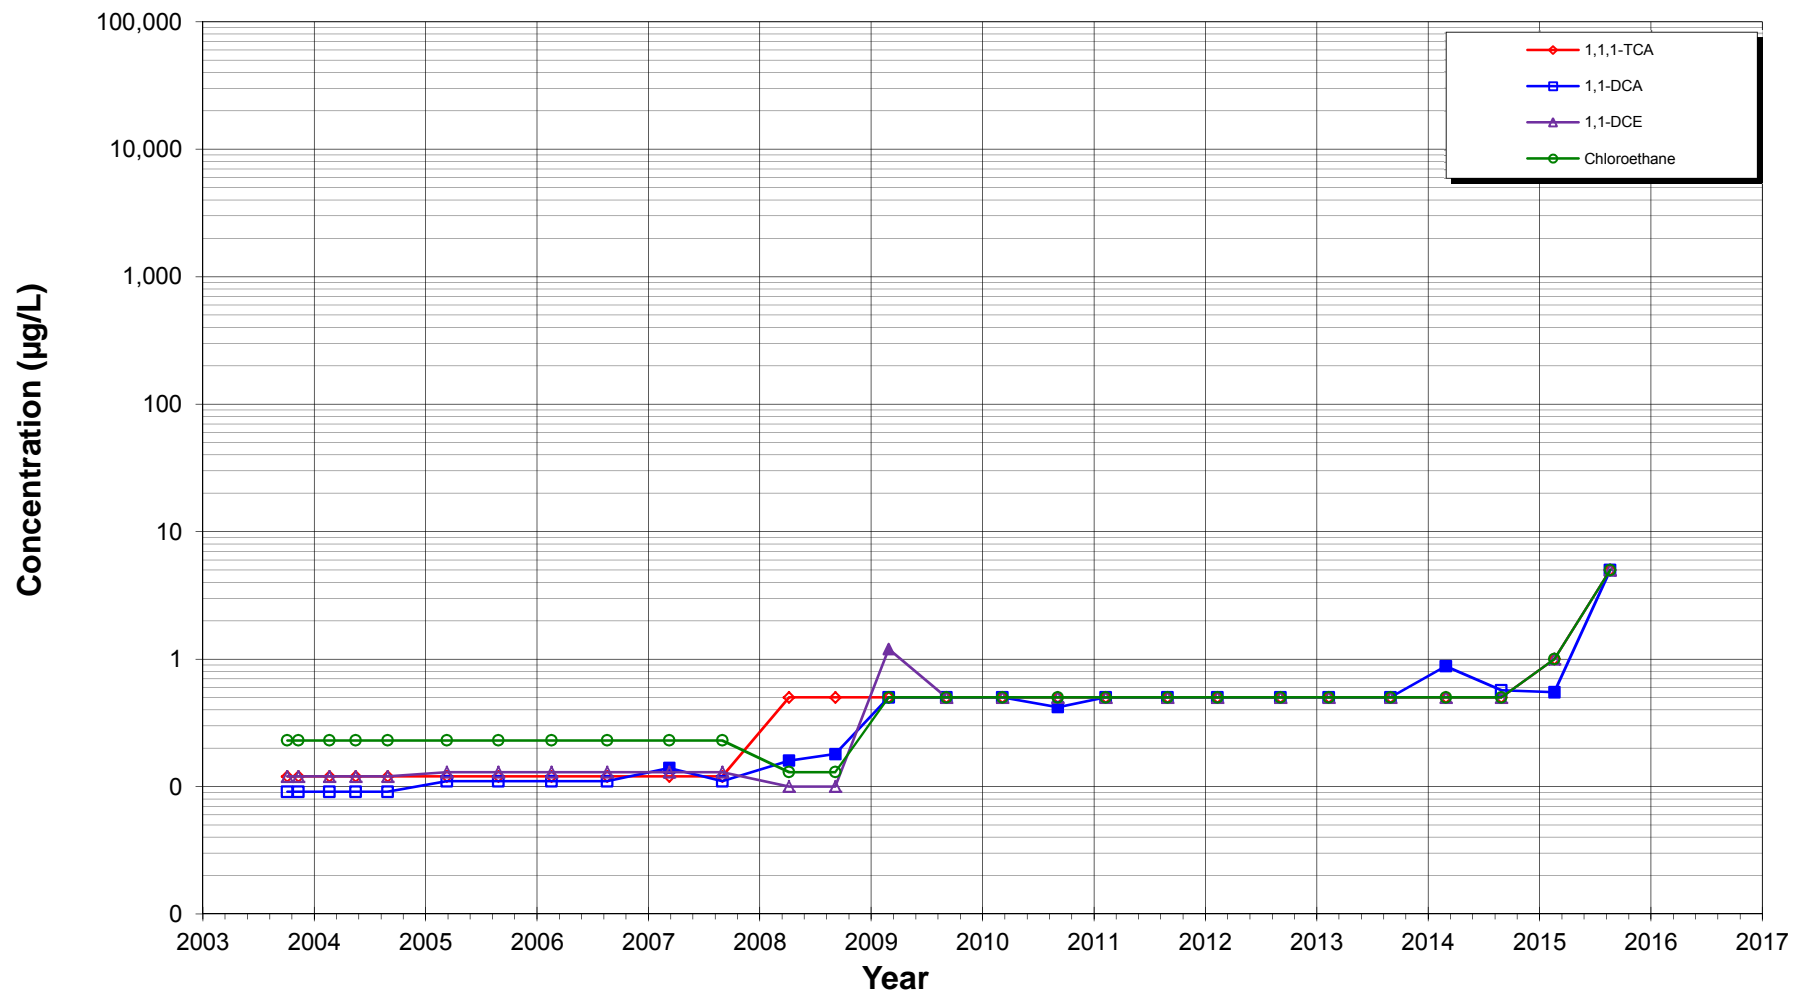

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C33. Constituent vs Time
Monitoring Well MW-17
Univar USA Inc., Kent, Washington**

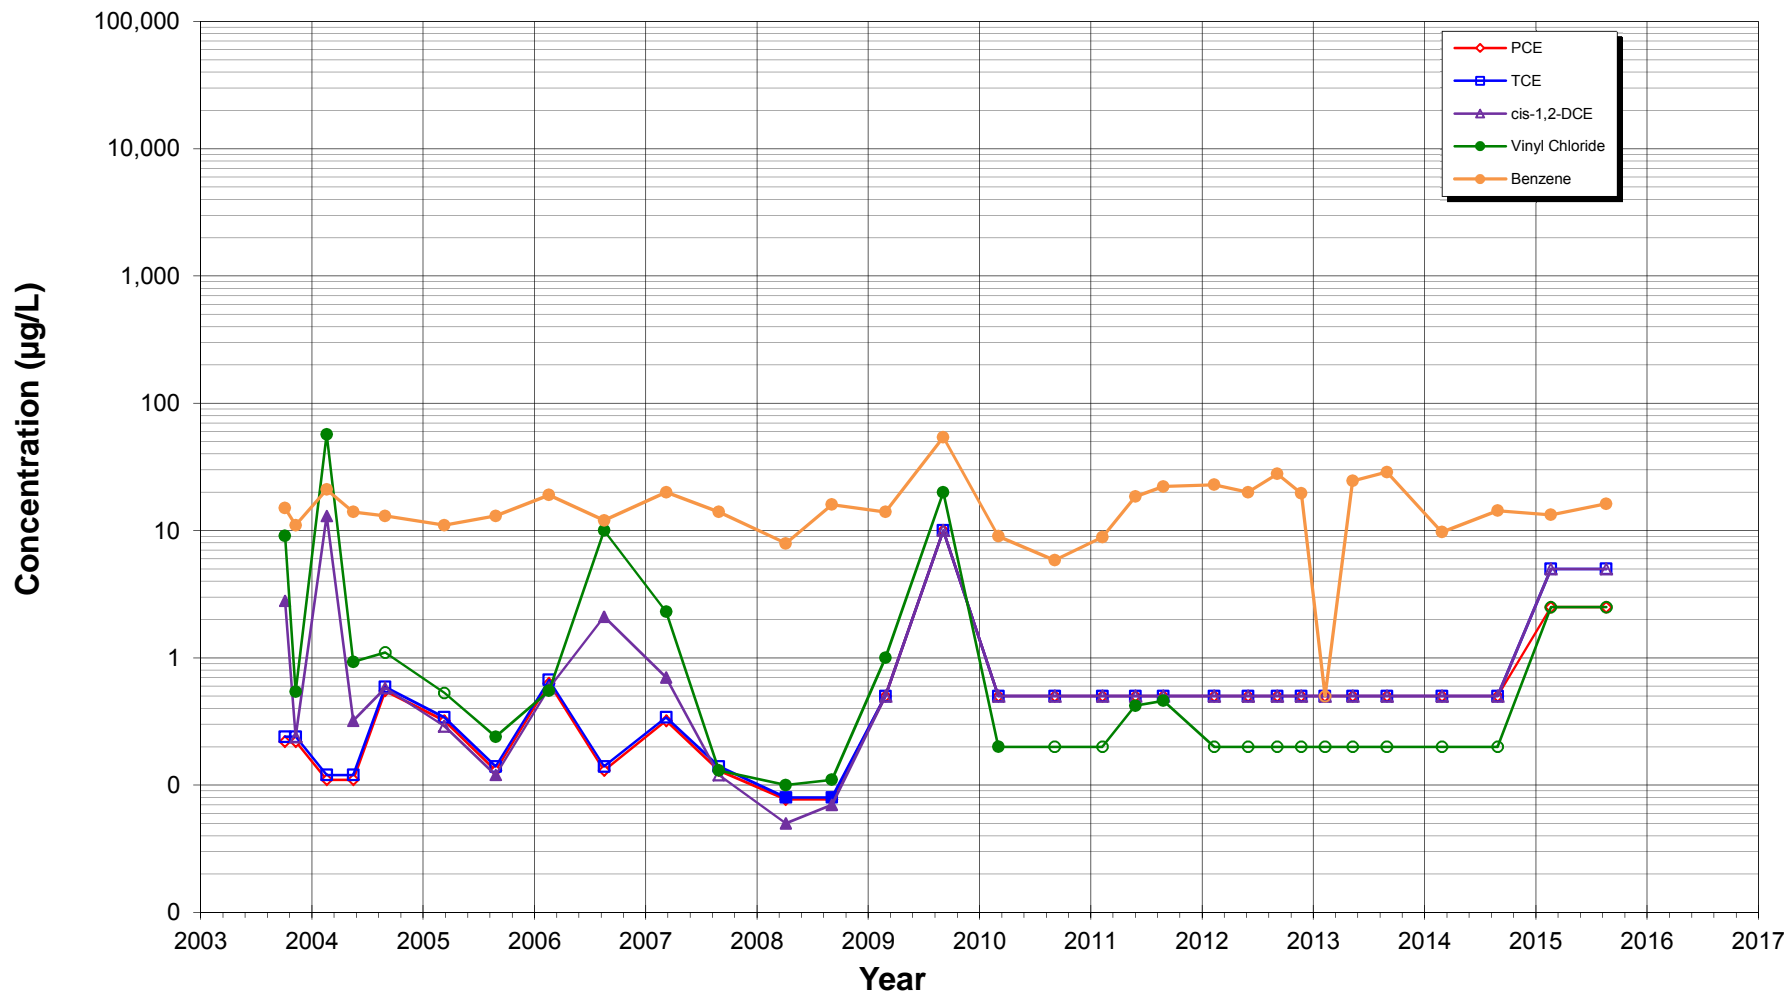

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, Vinyl Chloride = 0.5 µg/L, and Benzene = 0.8 µg/L.


**Figure C34. Constituent vs Time
Monitoring Well MW-17
Univar USA Inc., Kent, Washington**

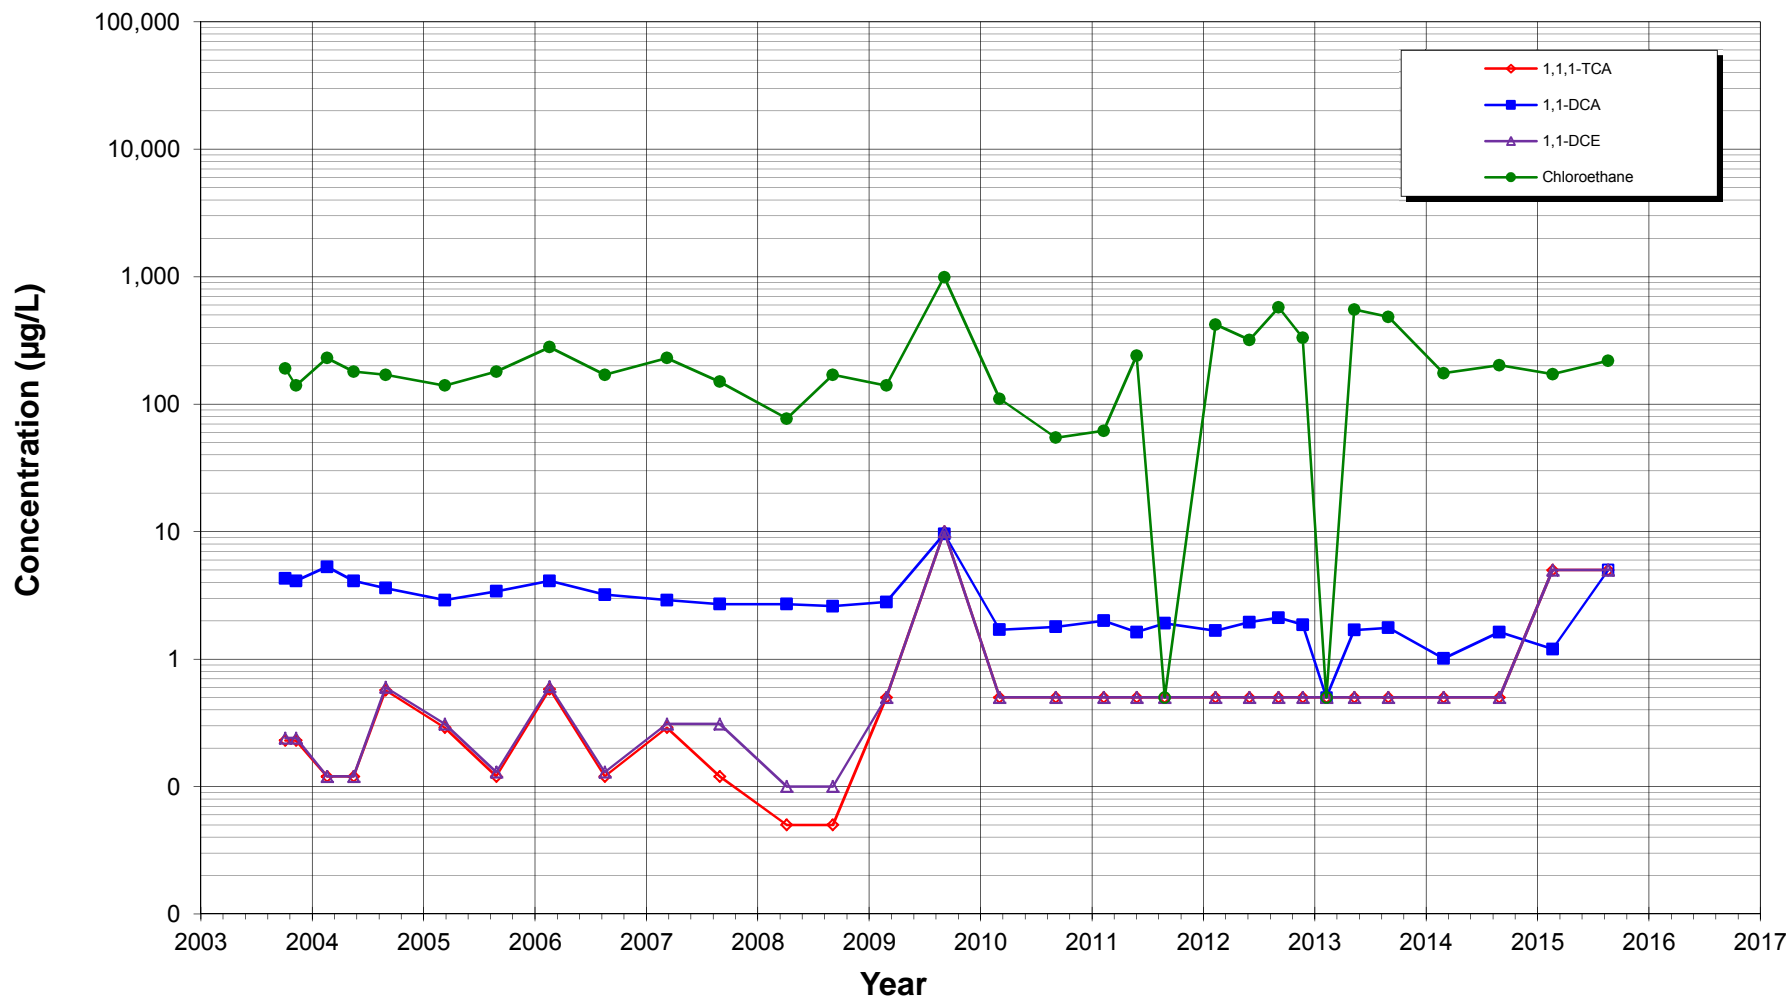

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


Figure C35. Constituent vs Time
Monitoring Well MW-18
Univar USA Inc., Kent, Washington

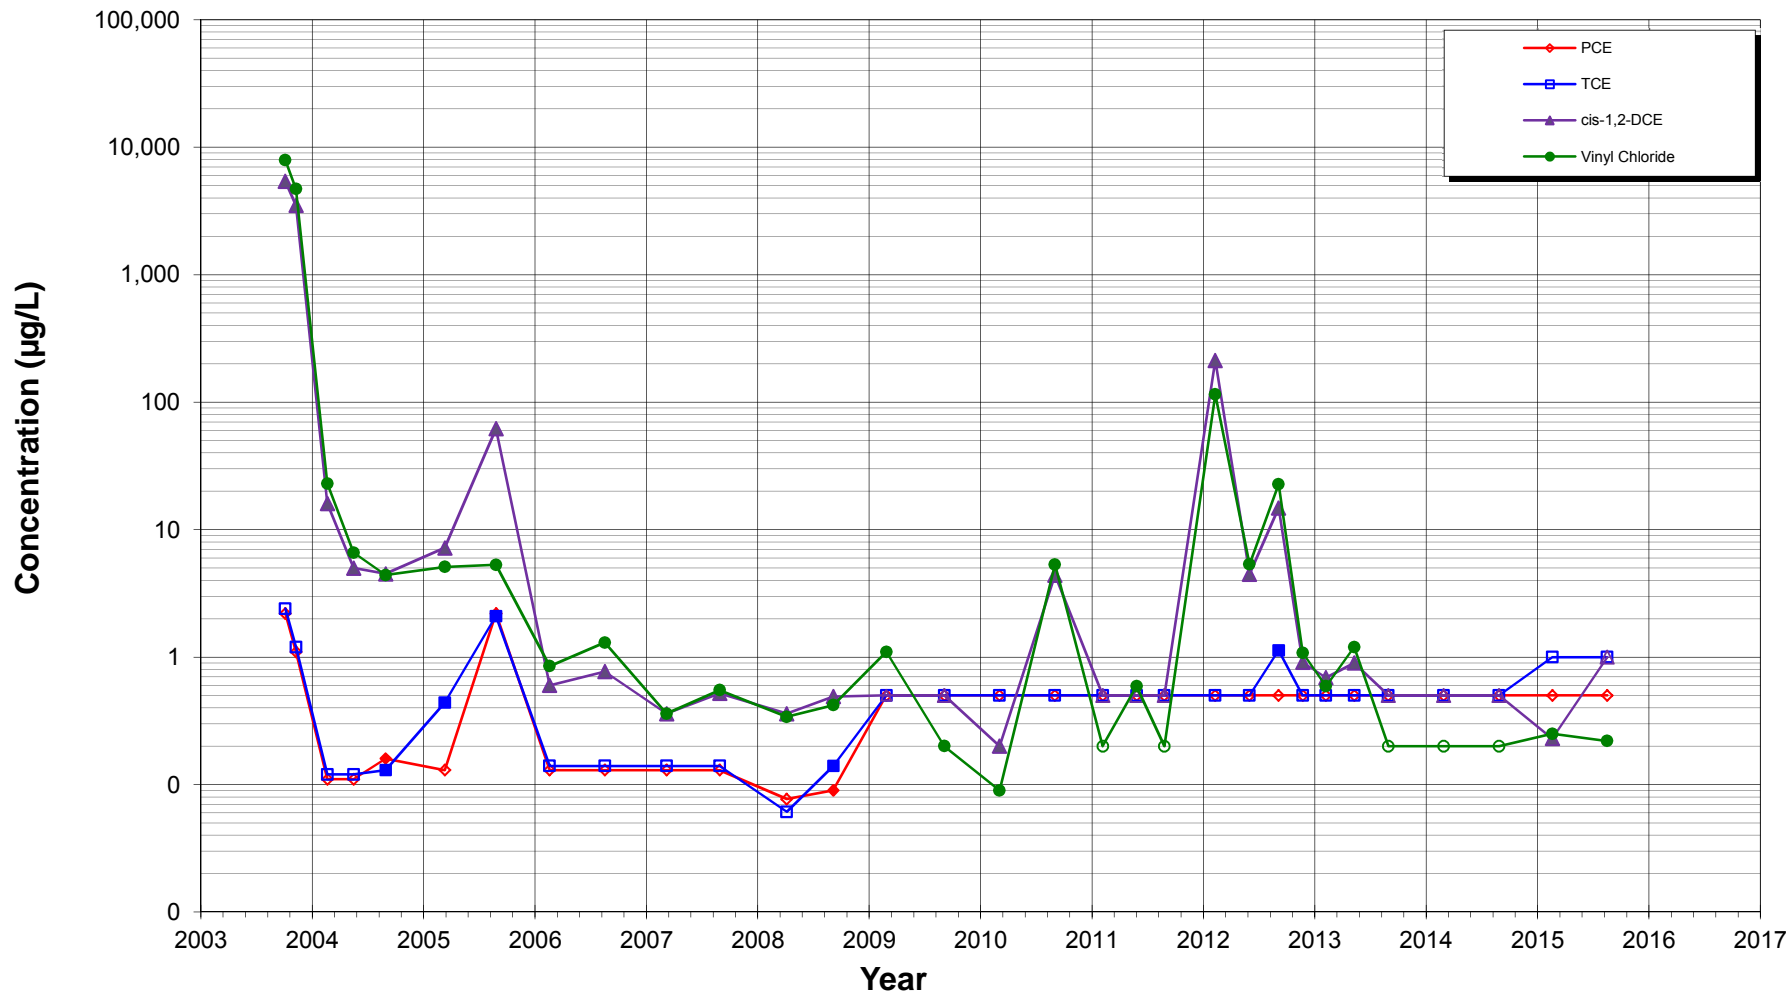

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C36. Constituent vs Time
Monitoring Well MW-18
Univar USA Inc., Kent, Washington**

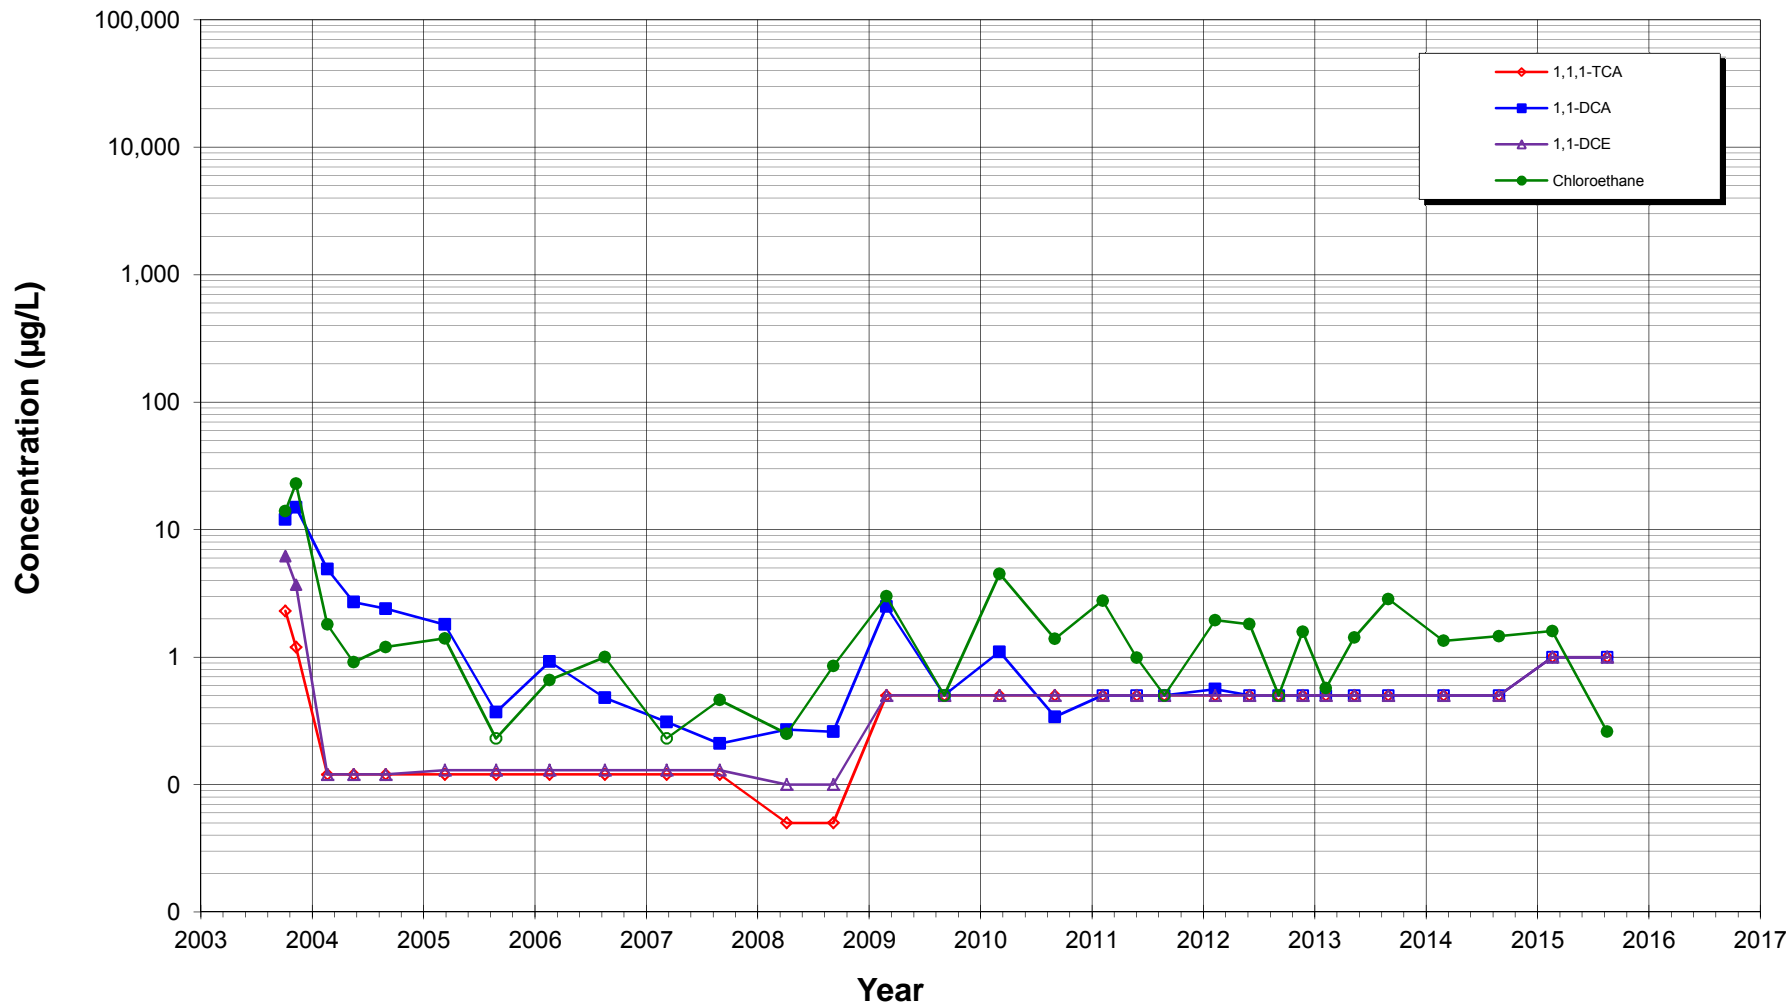

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C37. Constituent vs Time
Monitoring Well MW-19
Univar USA Inc., Kent, Washington**

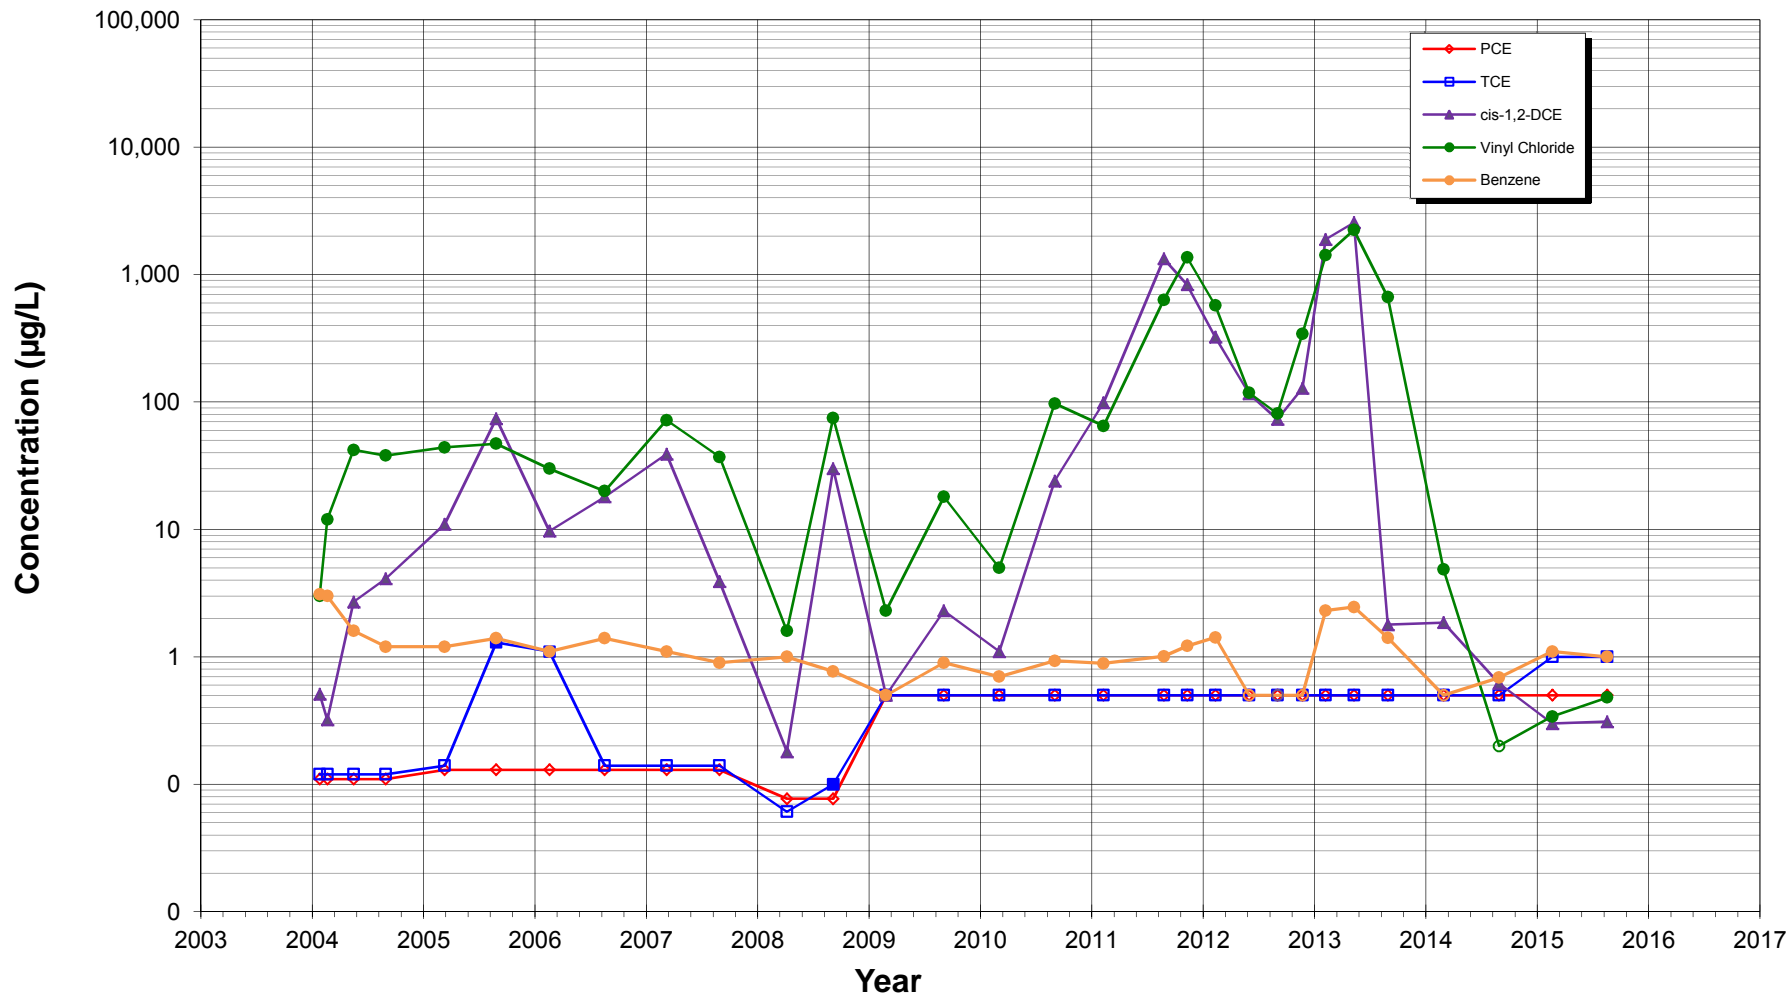

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, Vinyl Chloride = 0.5 µg/L, and Benzene = 0.8 µg/L.


**Figure C38. Constituent vs Time
Monitoring Well MW-19
Univar USA Inc., Kent, Washington**

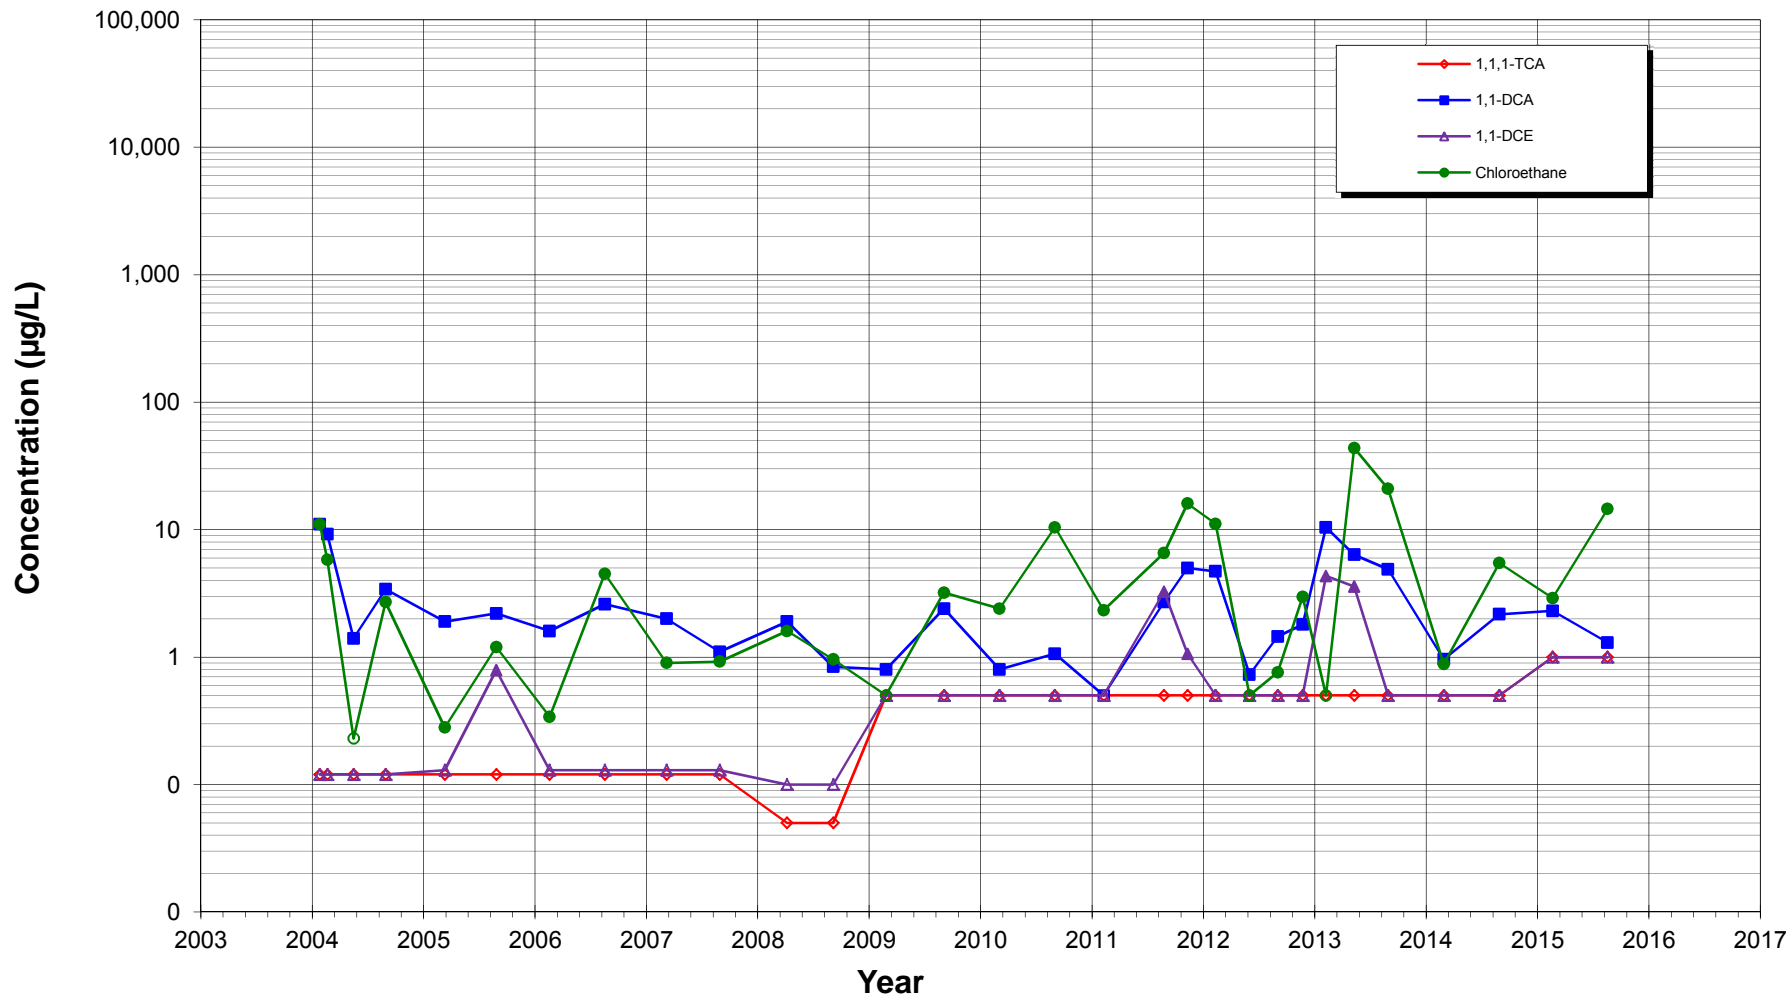

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C39. Constituent vs Time
Monitoring Well MW-20
Univar USA Inc., Kent, Washington**

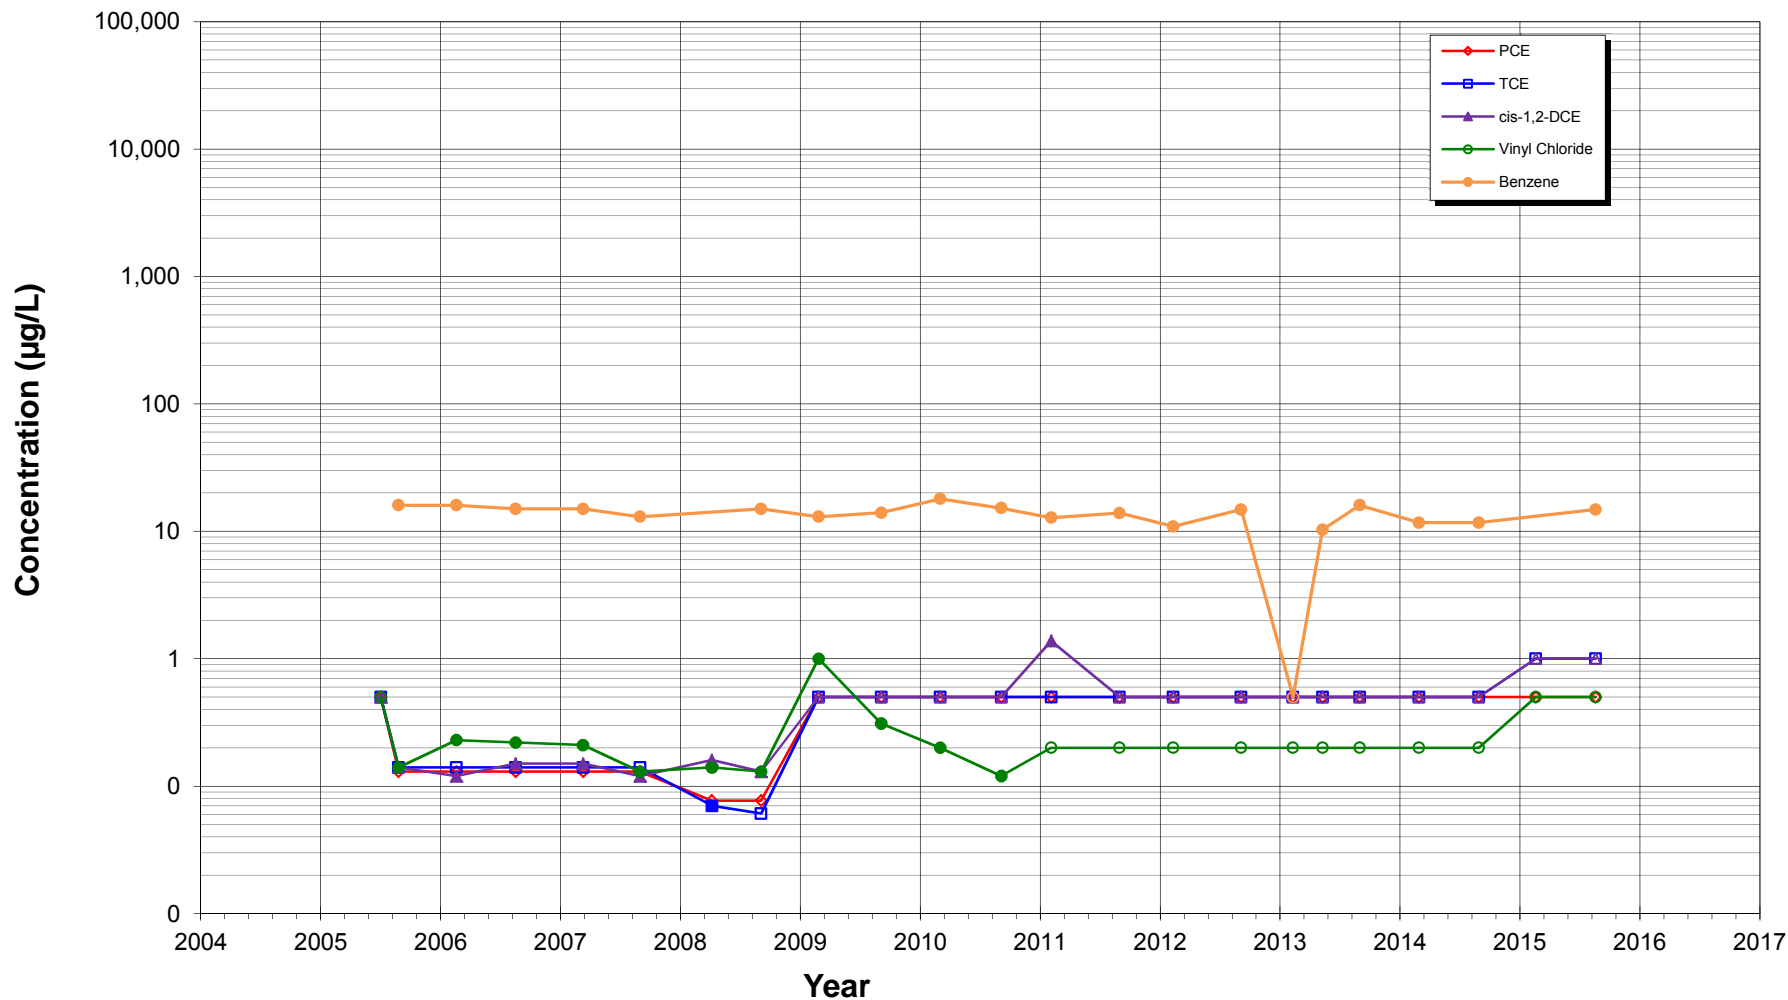

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, Vinyl Chloride = 0.5 µg/L, and Benzene = 0.8 µg/L.


**Figure C40. Constituent vs Time
Monitoring Well MW-20
Univar USA Inc., Kent, Washington**

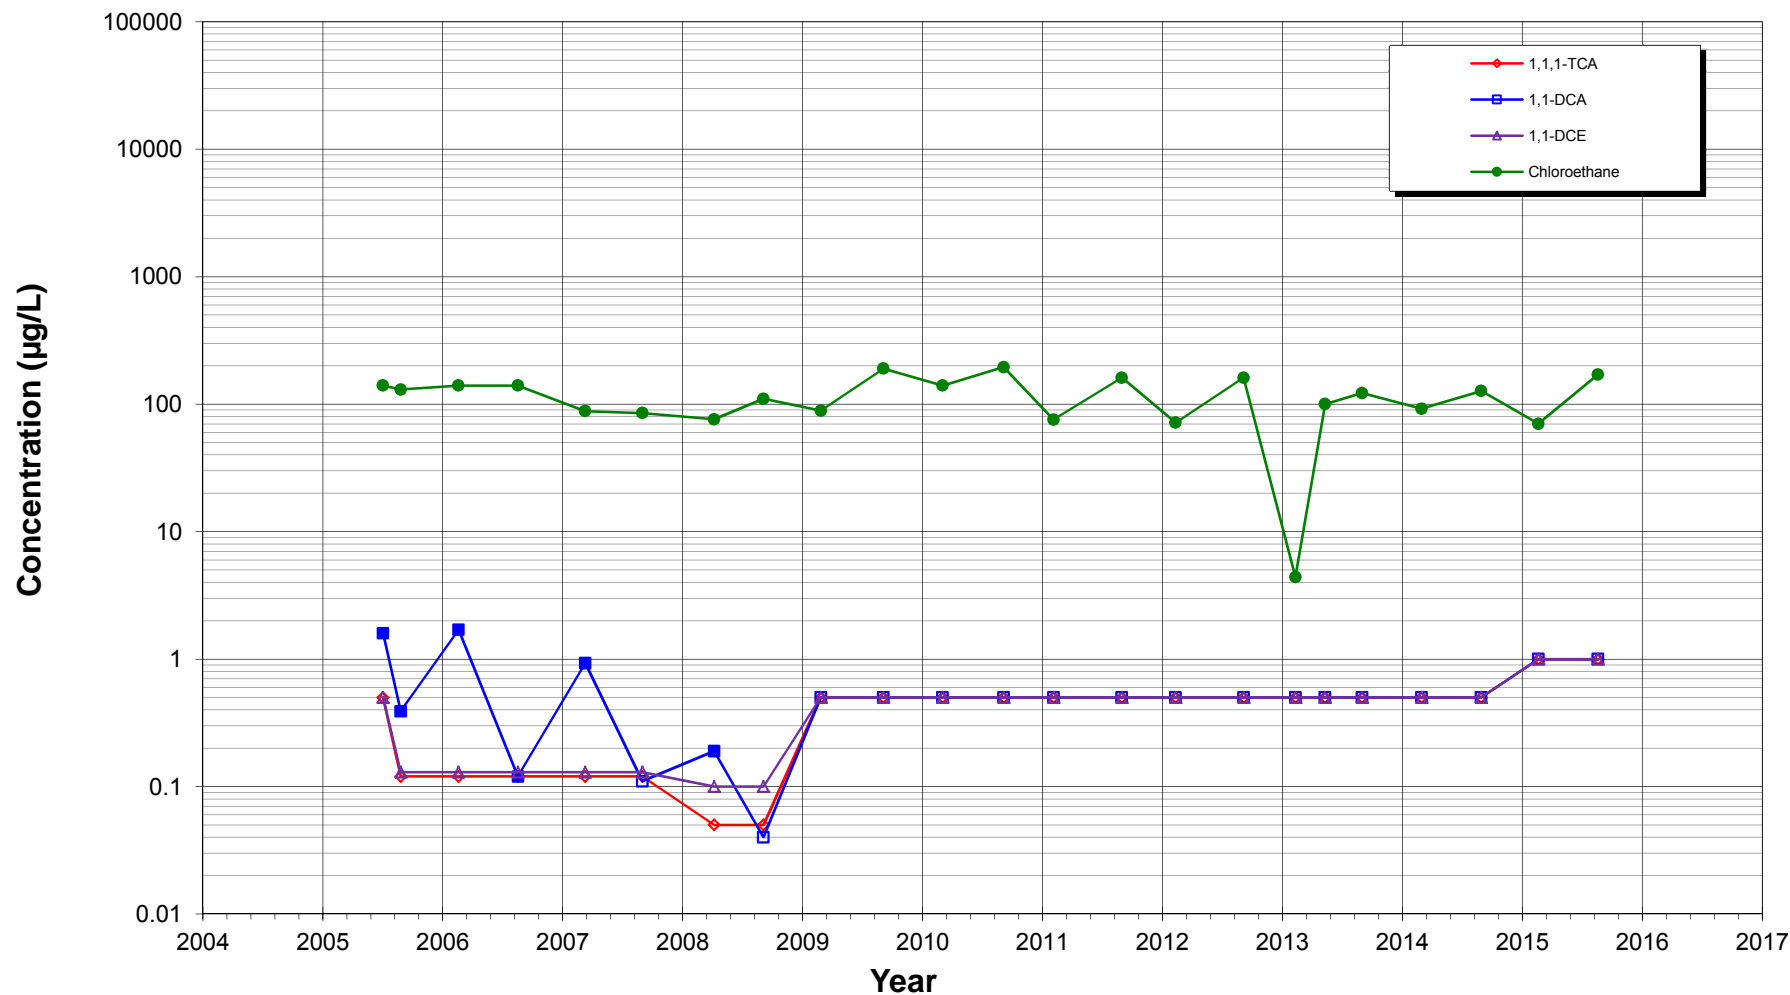

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C41. Constituent vs Time
Monitoring Well MW-21
Univar USA Inc., Kent, Washington**

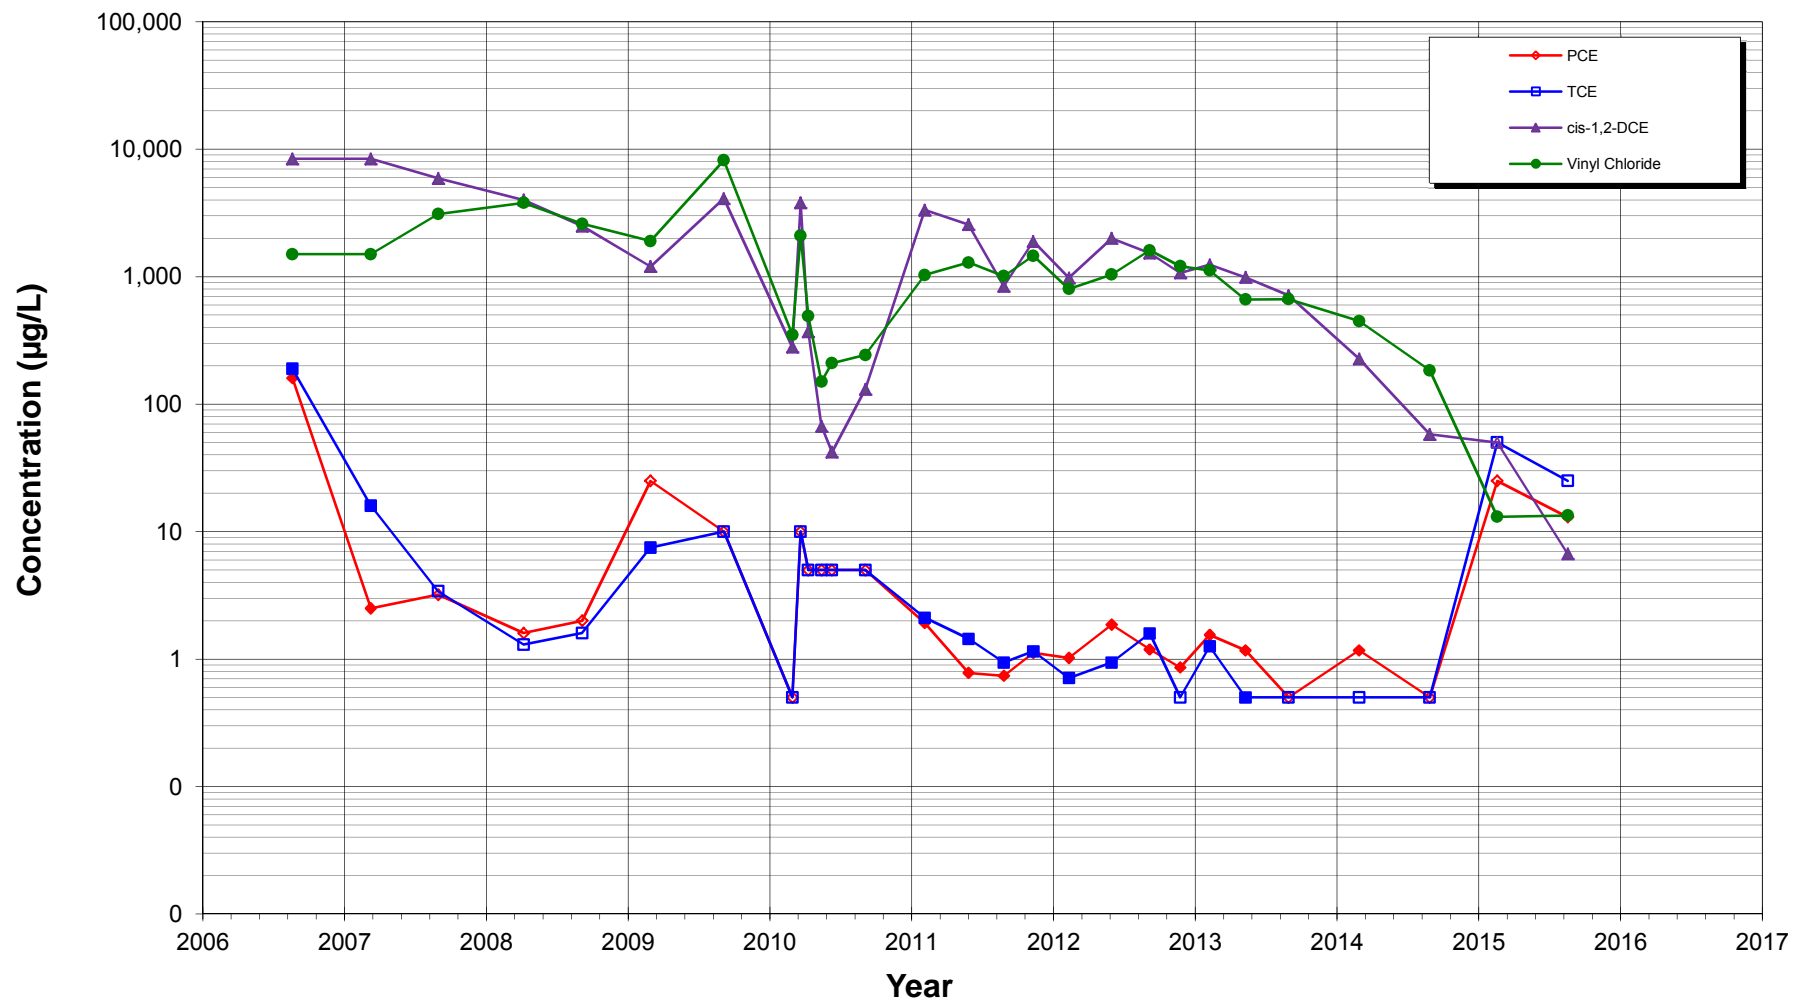

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C42. Constituent vs Time
Monitoring Well MW-21
Univar USA Inc., Kent, Washington**

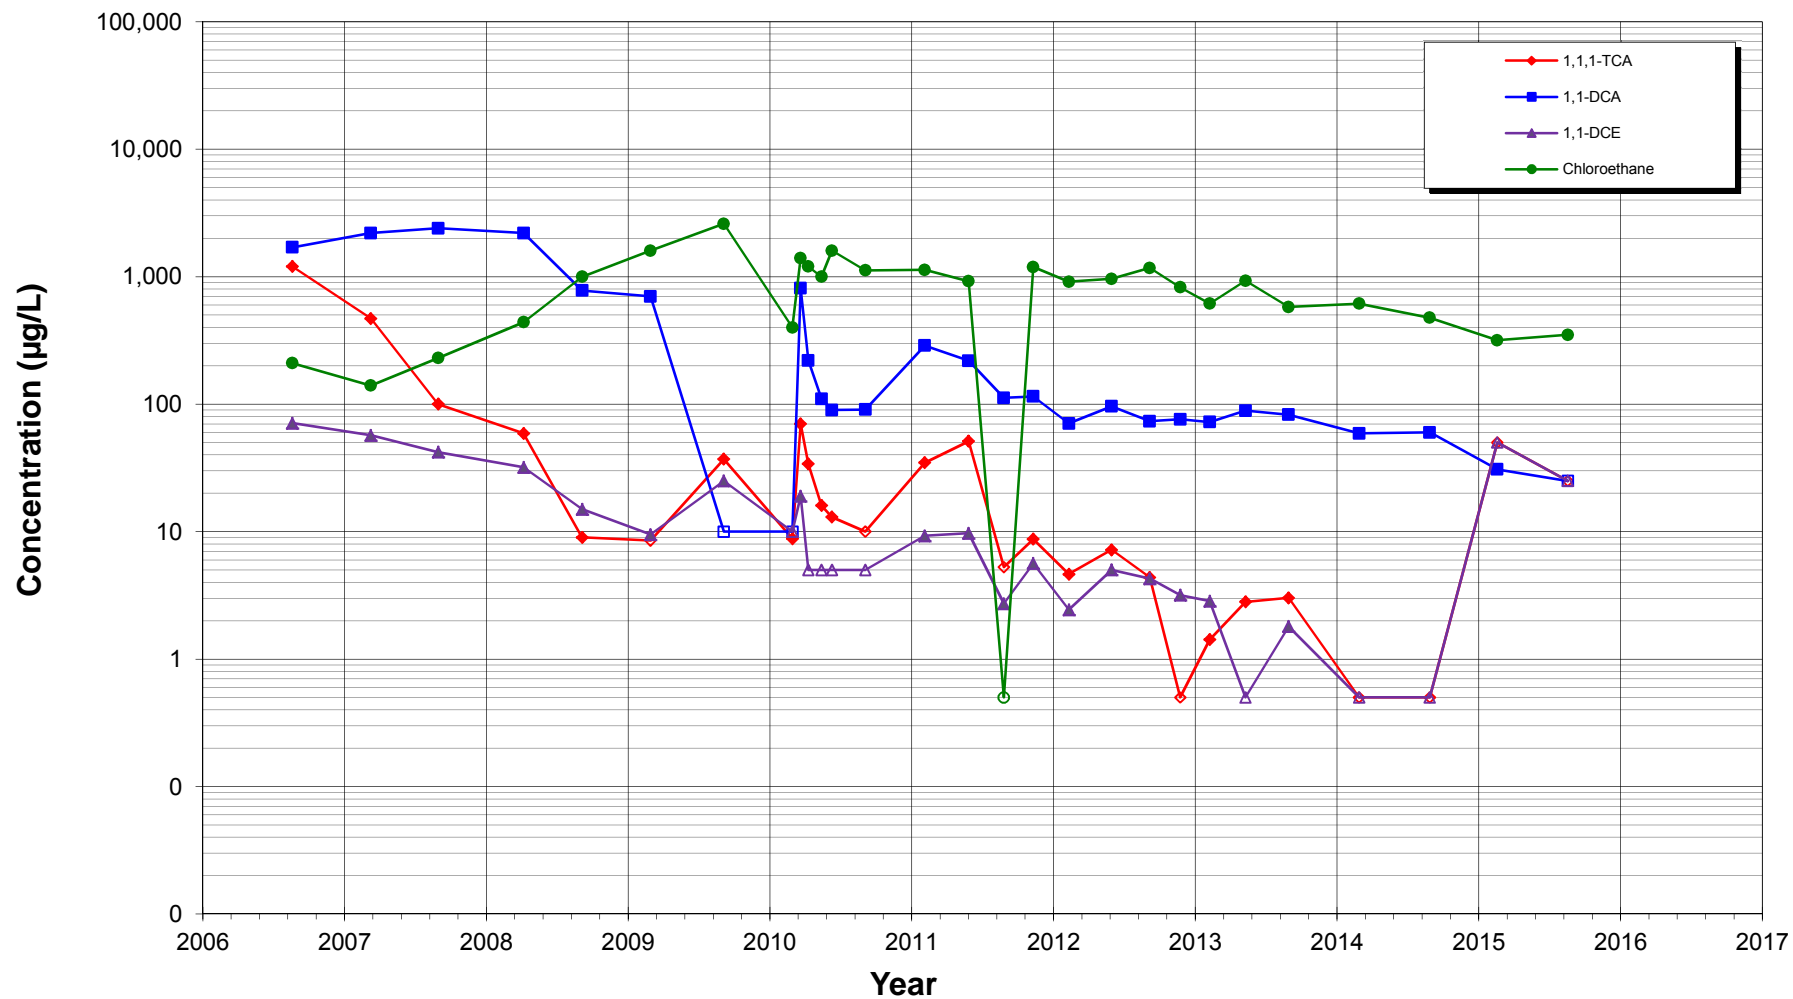

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C43. Constituent vs Time
Monitoring Well MW-22
Univar USA Inc., Kent, Washington**

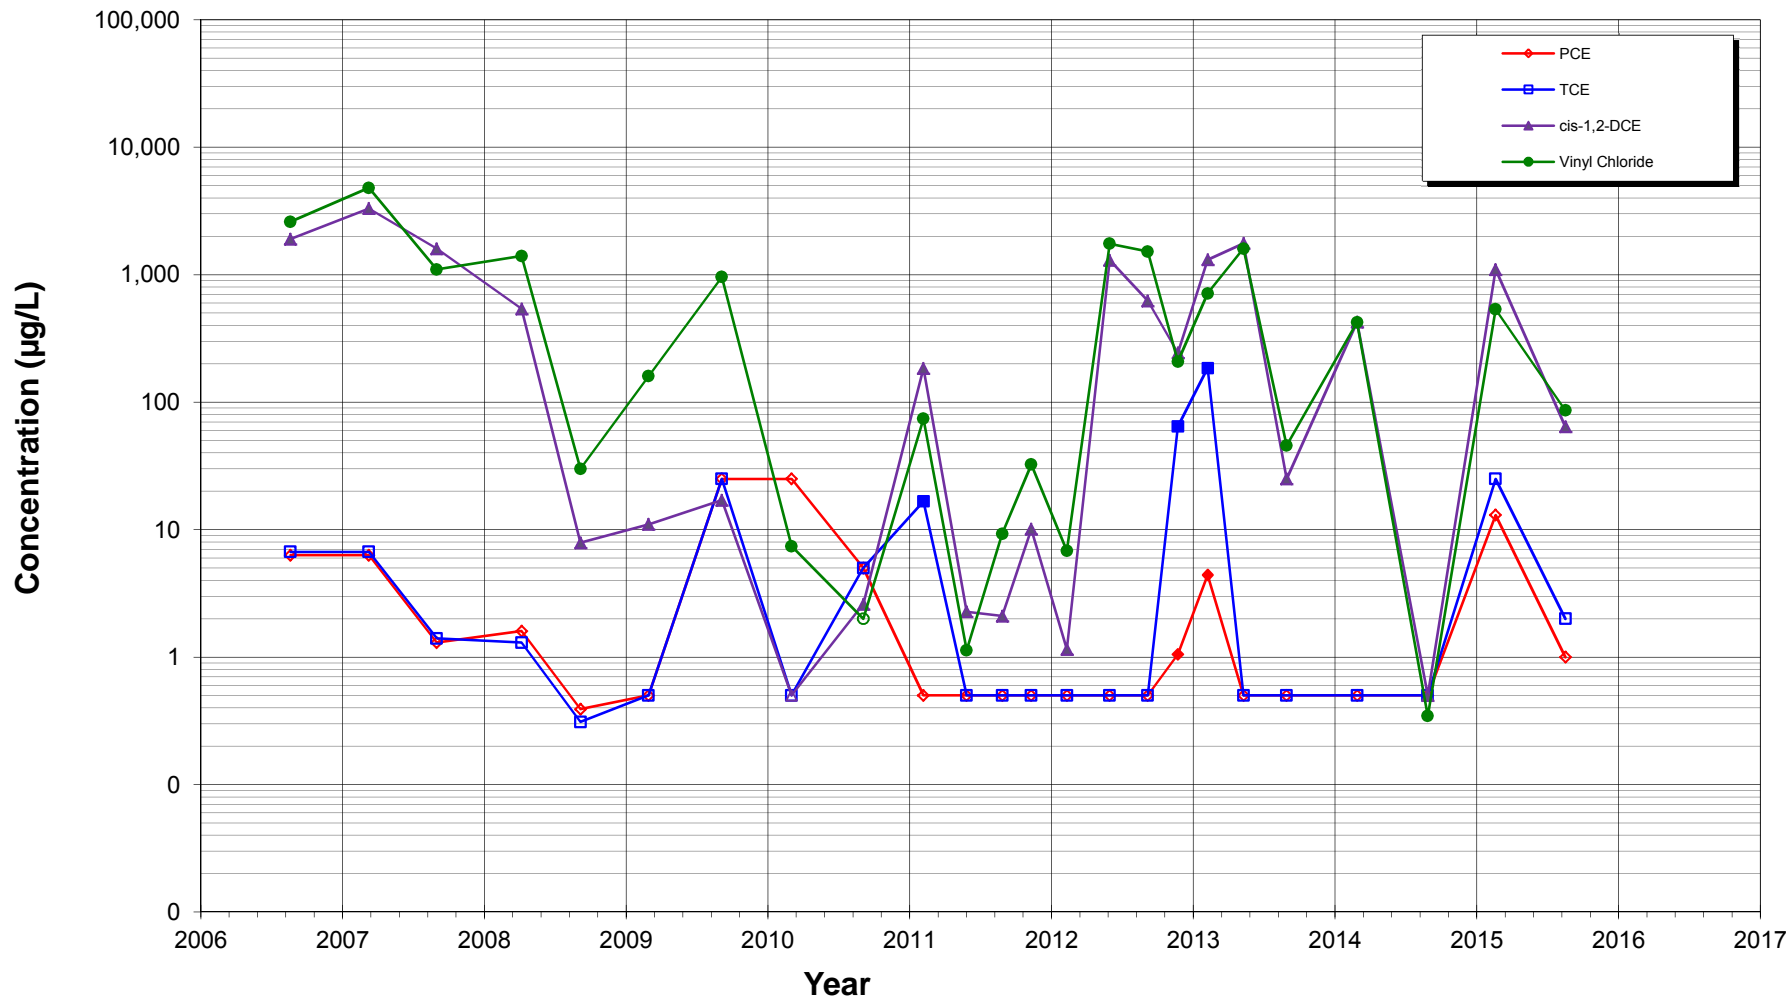

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C44. Constituent vs Time
Monitoring Well MW-22
Univar USA Inc., Kent, Washington**

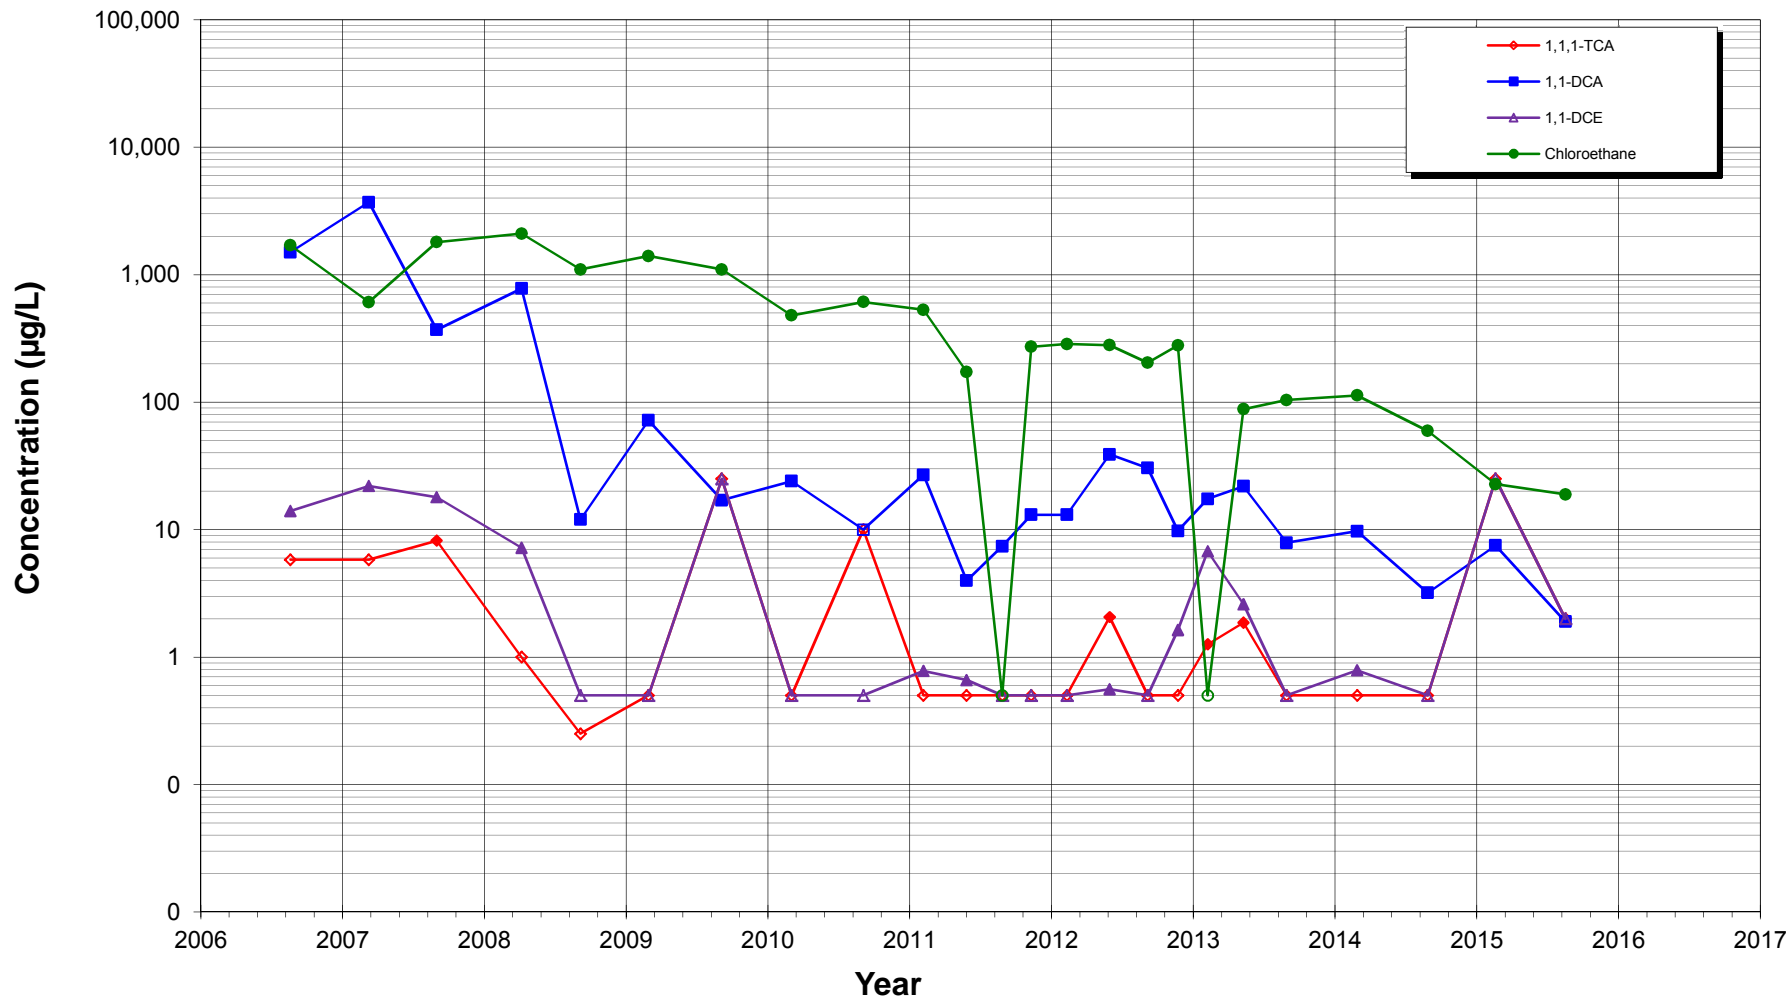

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C45. Constituent vs Time
Monitoring Well MW-27
Univar USA Inc., Kent, Washington**

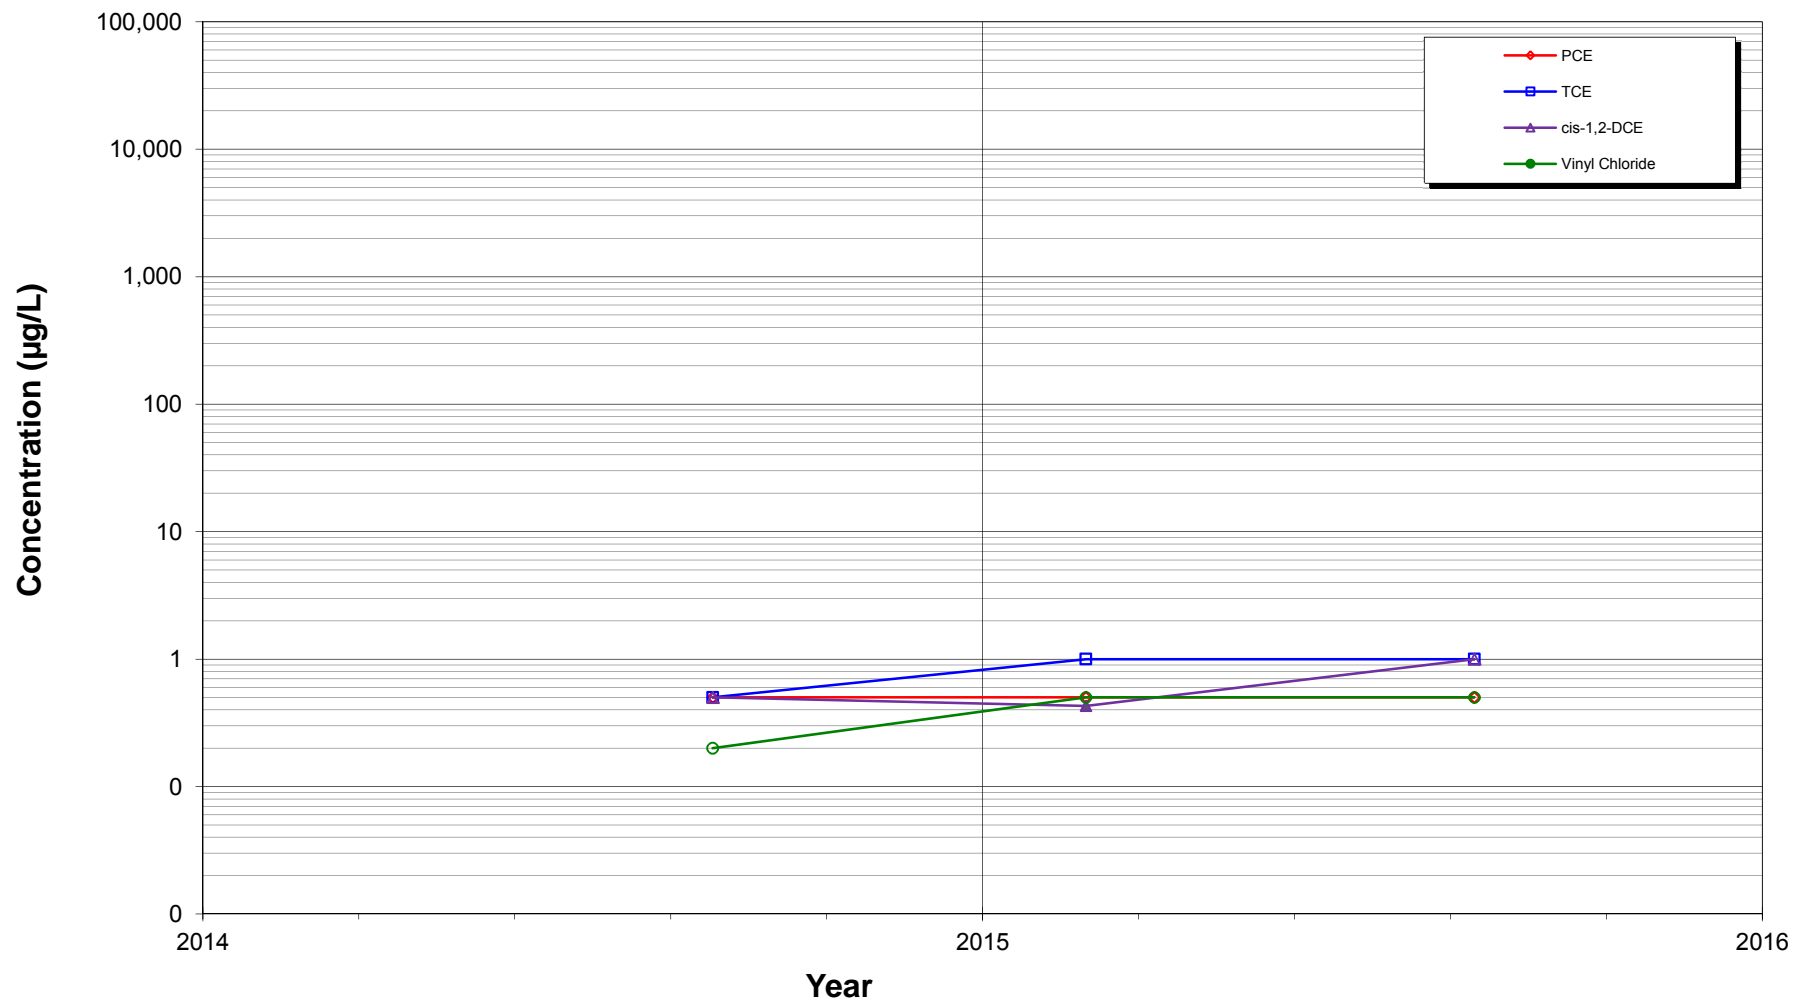

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C46. Constituent vs Time
Monitoring Well MW-27
Univar USA Inc., Kent, Washington**

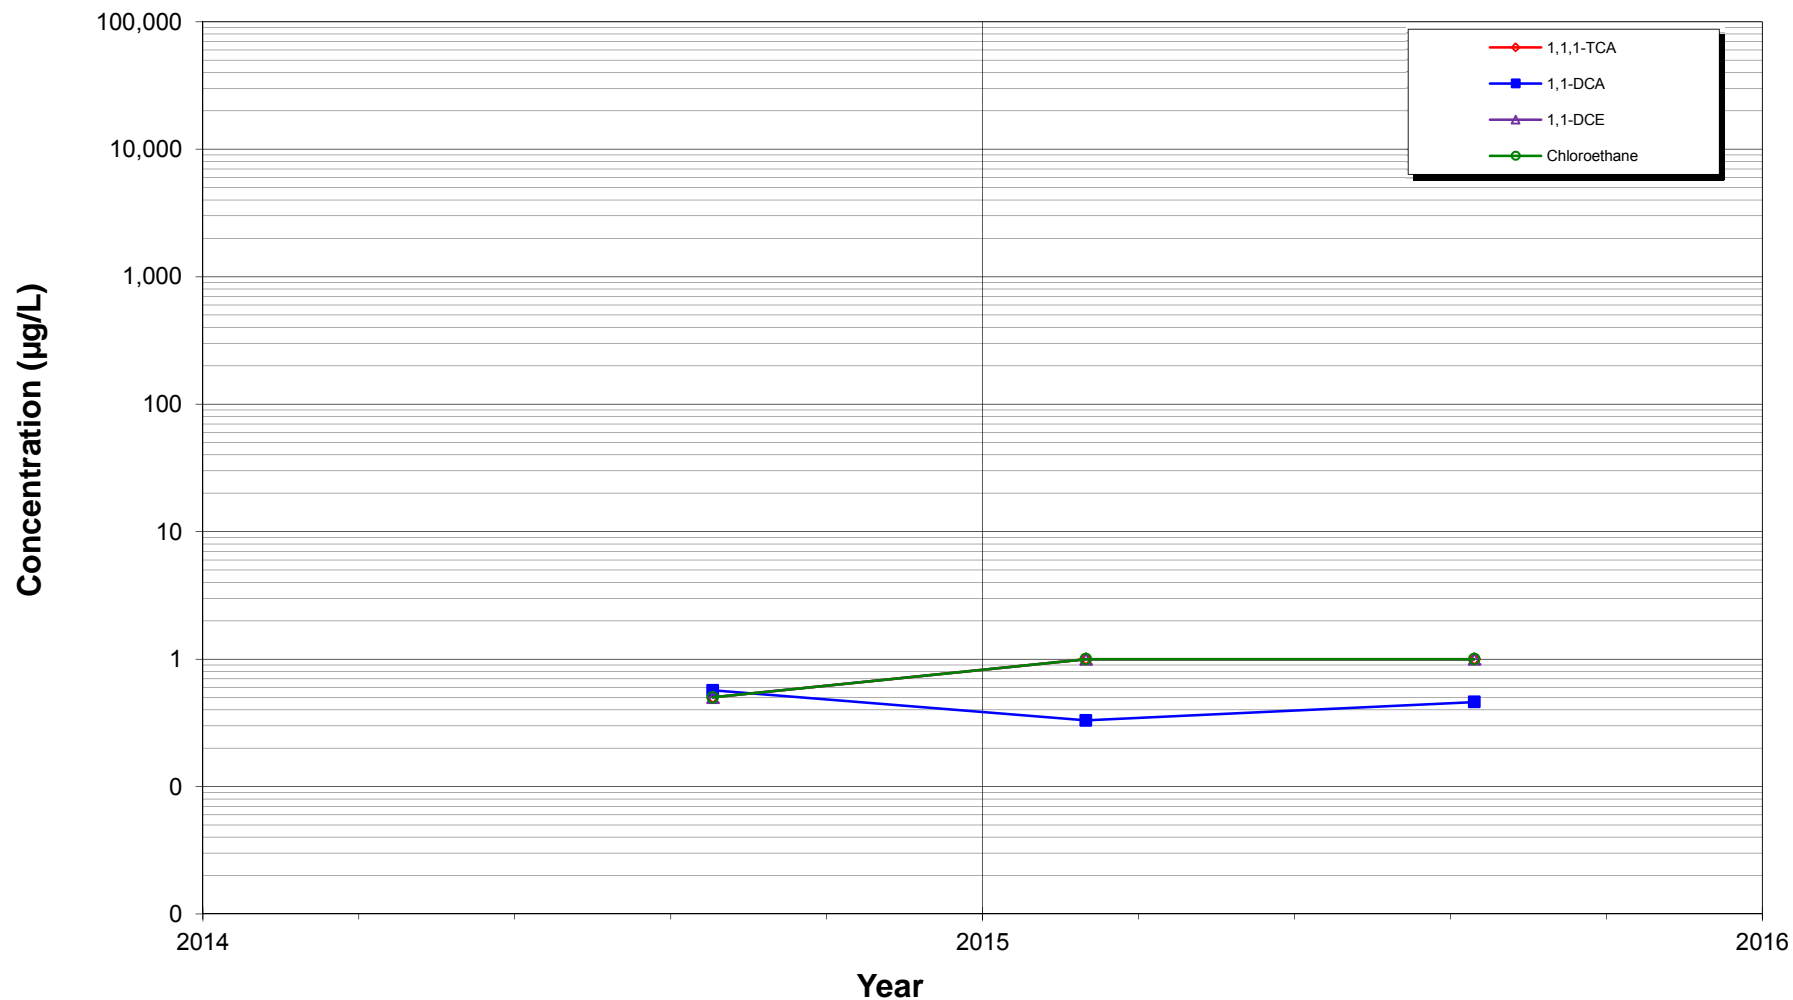

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C47. Constituent vs Time
Monitoring Well MW-28
Univar USA Inc., Kent, Washington**

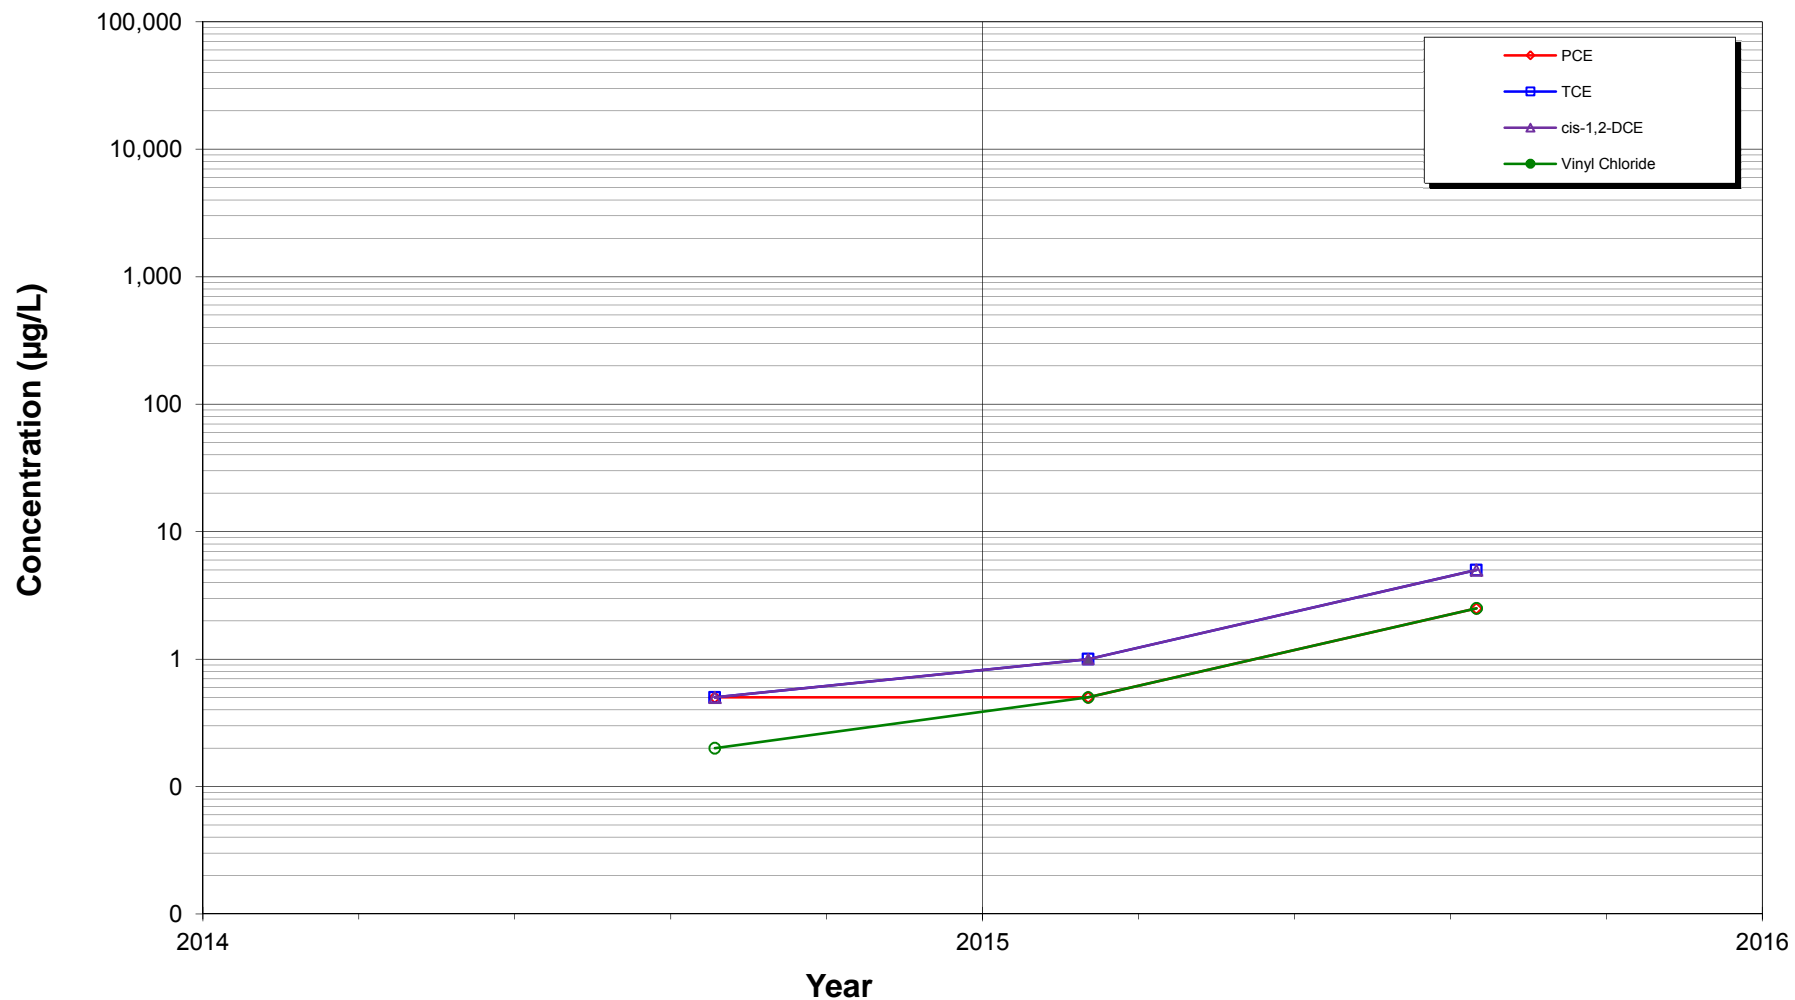

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: PCE = 0.86 µg/L, TCE = 4.0 µg/L, cis-1,2-DCE = 70 µg/L, and Vinyl Chloride = 0.5 µg/L.


**Figure C48. Constituent vs Time
Monitoring Well MW-28
Univar USA Inc., Kent, Washington**

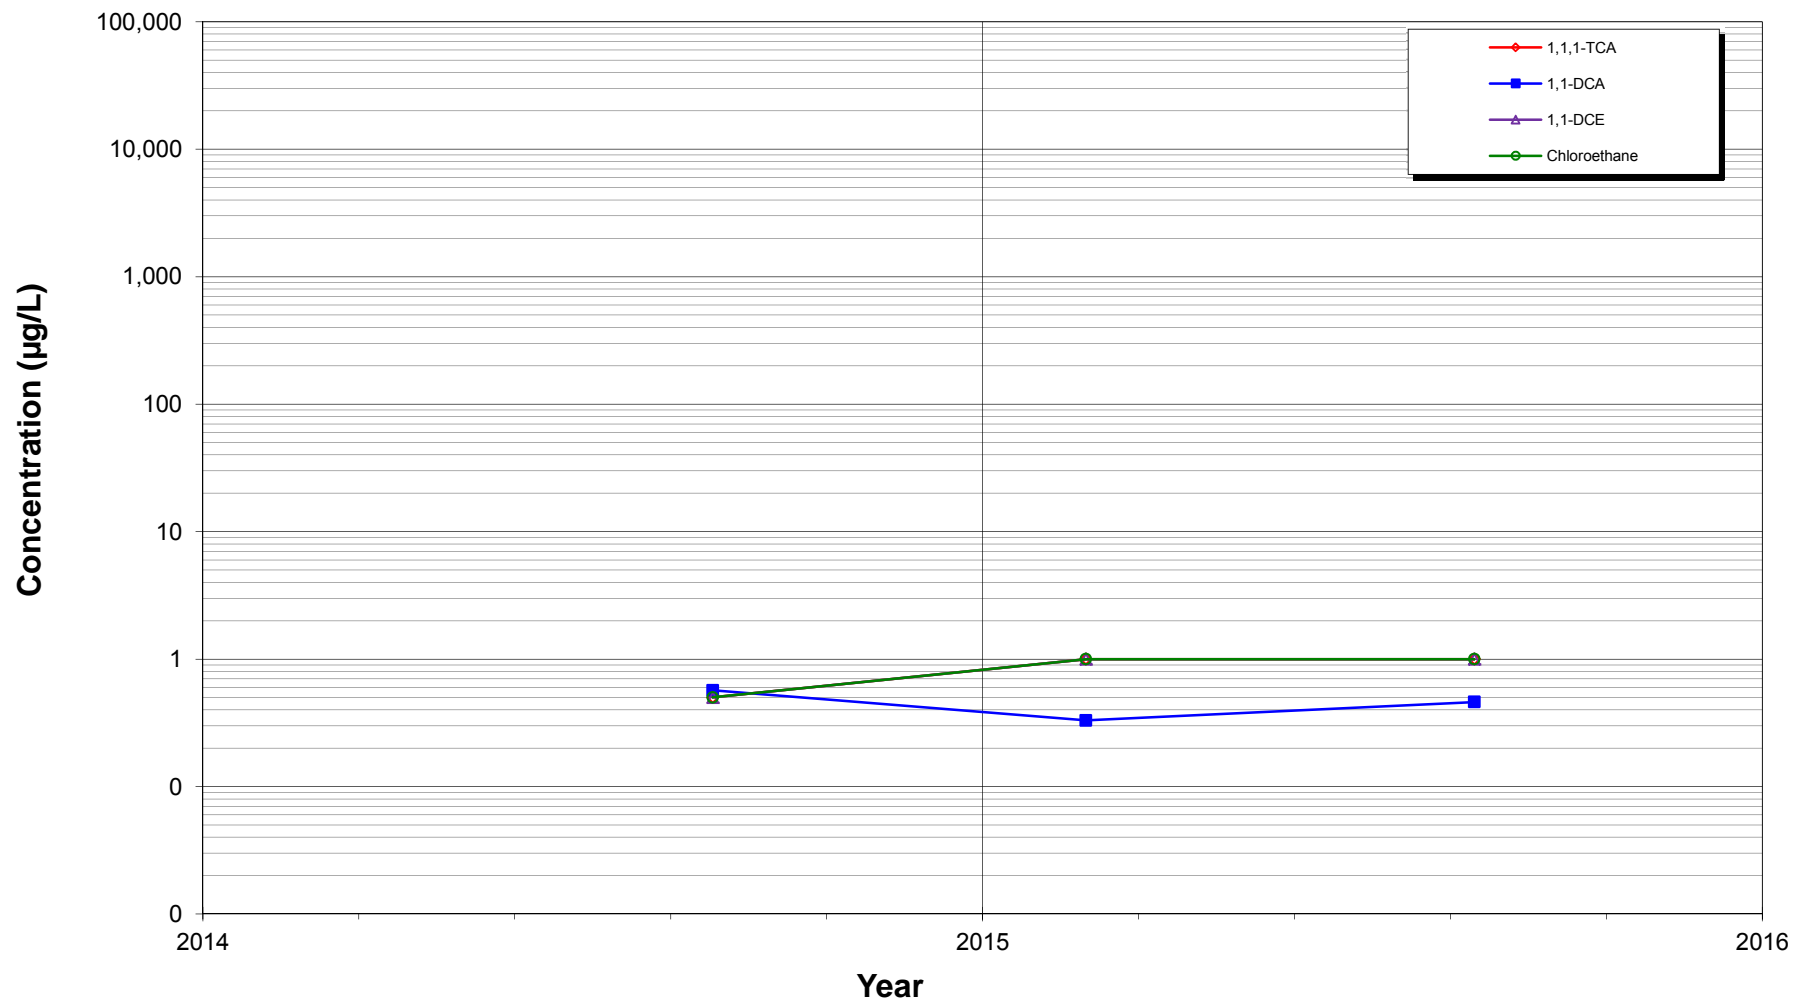

Notes:

- 1) Initial deep injection in April and May 2011.
- 2) All results that were not detected at the lowest reported limit (MDL or MRL) are shown as hollow data points.
- 3) Final Site Cleanup Levels: 1,1,1-TCA = 200 µg/L, 1,1-DCA = 800 µg/L, 1,1-DCE = 7 µg/L, and Chloroethane = 15 µg/L.


**Figure C49. Concentrations of Chloroethanes vs Distance from Deep Treatment Area
March 2015
Univar USA Inc., Kent, Washington**

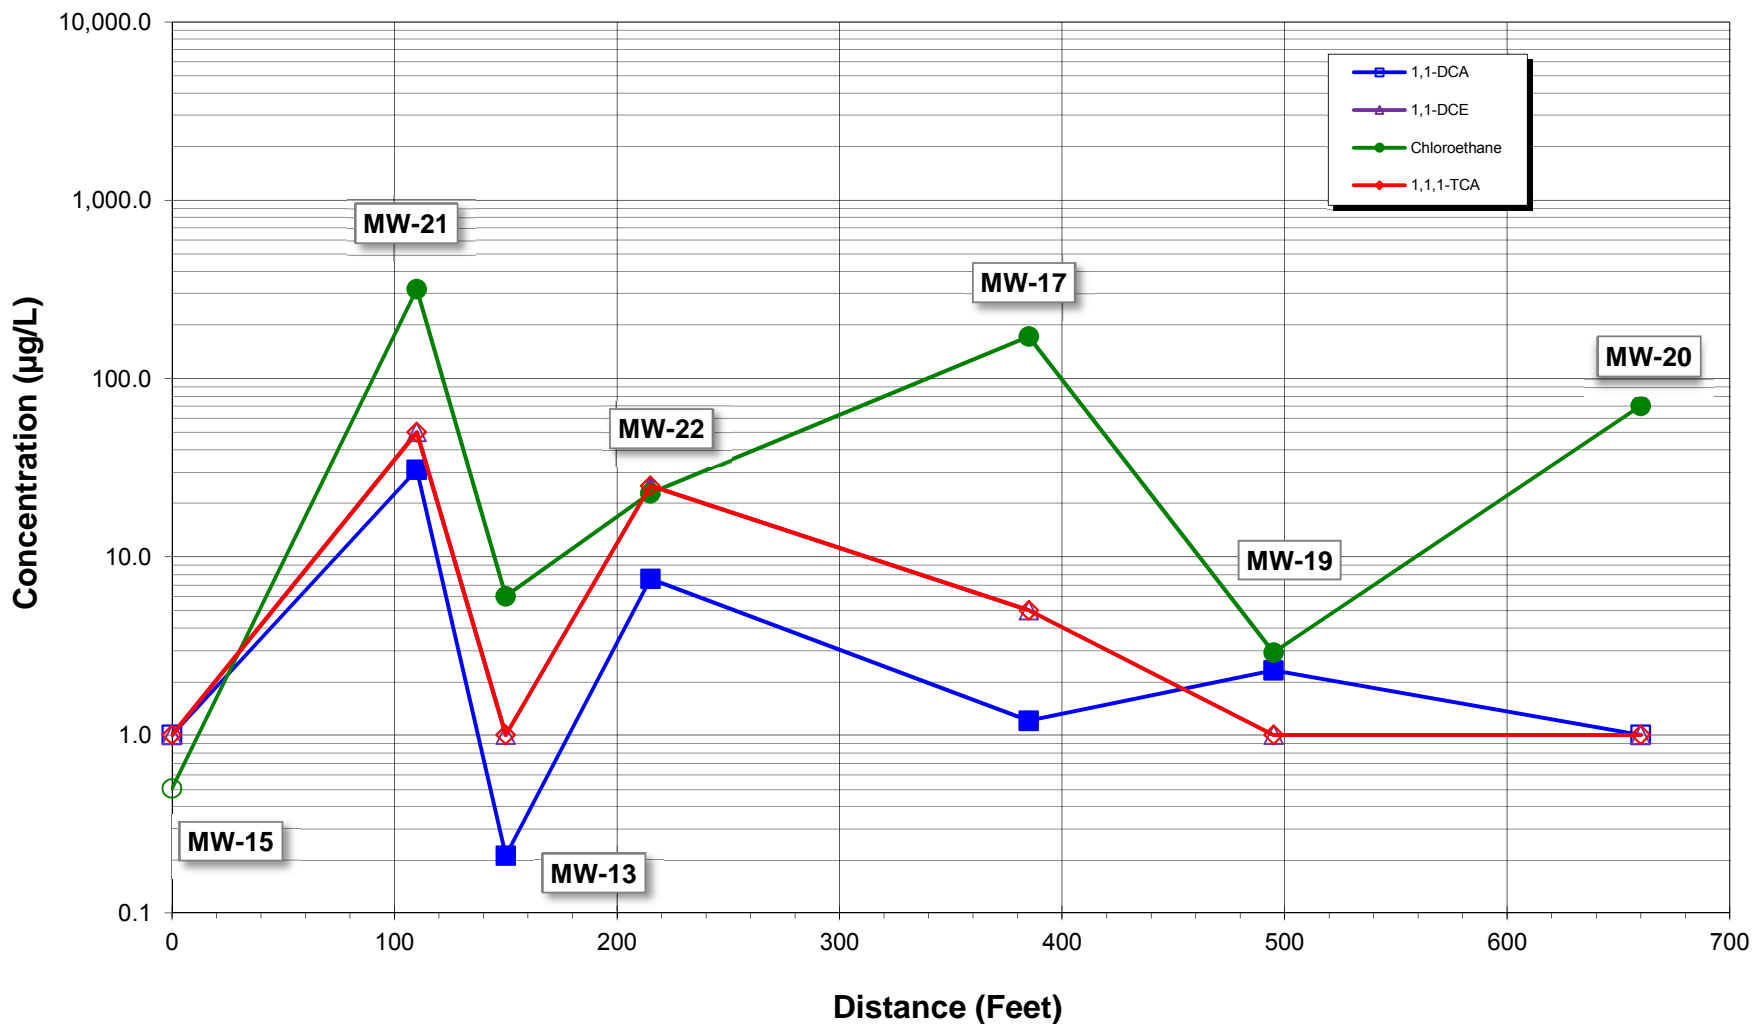

Notes:


- 1) MW-15 located upgradient of deep source treatment area.
- 2) Non-detect results below the MRLs are shown as hollow data points.

**Figure C50. Concentrations of Chlorinated Ethenes vs Distance from Deep Treatment Area
March 2015
Univar USA Inc., Kent, Washington**

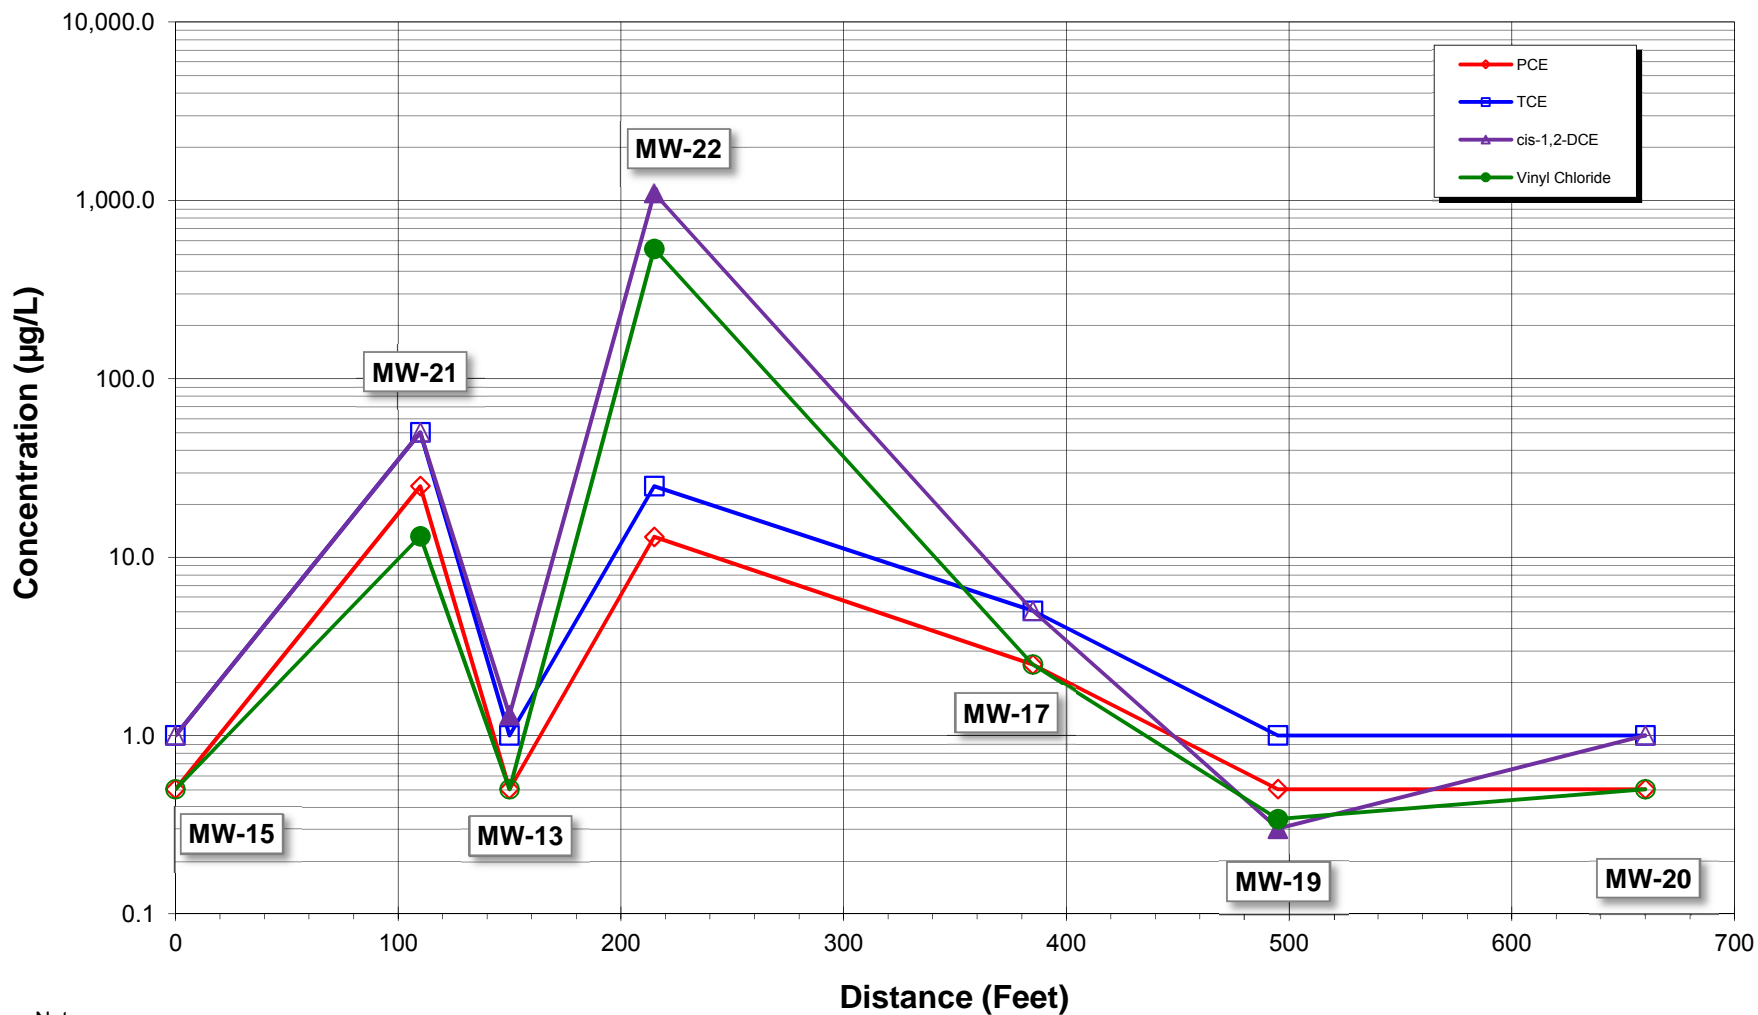

Notes:
 1) MW-15 located upgradient of deep source treatment area.
 2) Non-detect results below the MRLs are shown as hollow data points.


**Figure C51. Concentrations of Chloroethanes vs Distance from Deep Treatment Area
September 2015
Univar USA Inc., Kent, Washington**

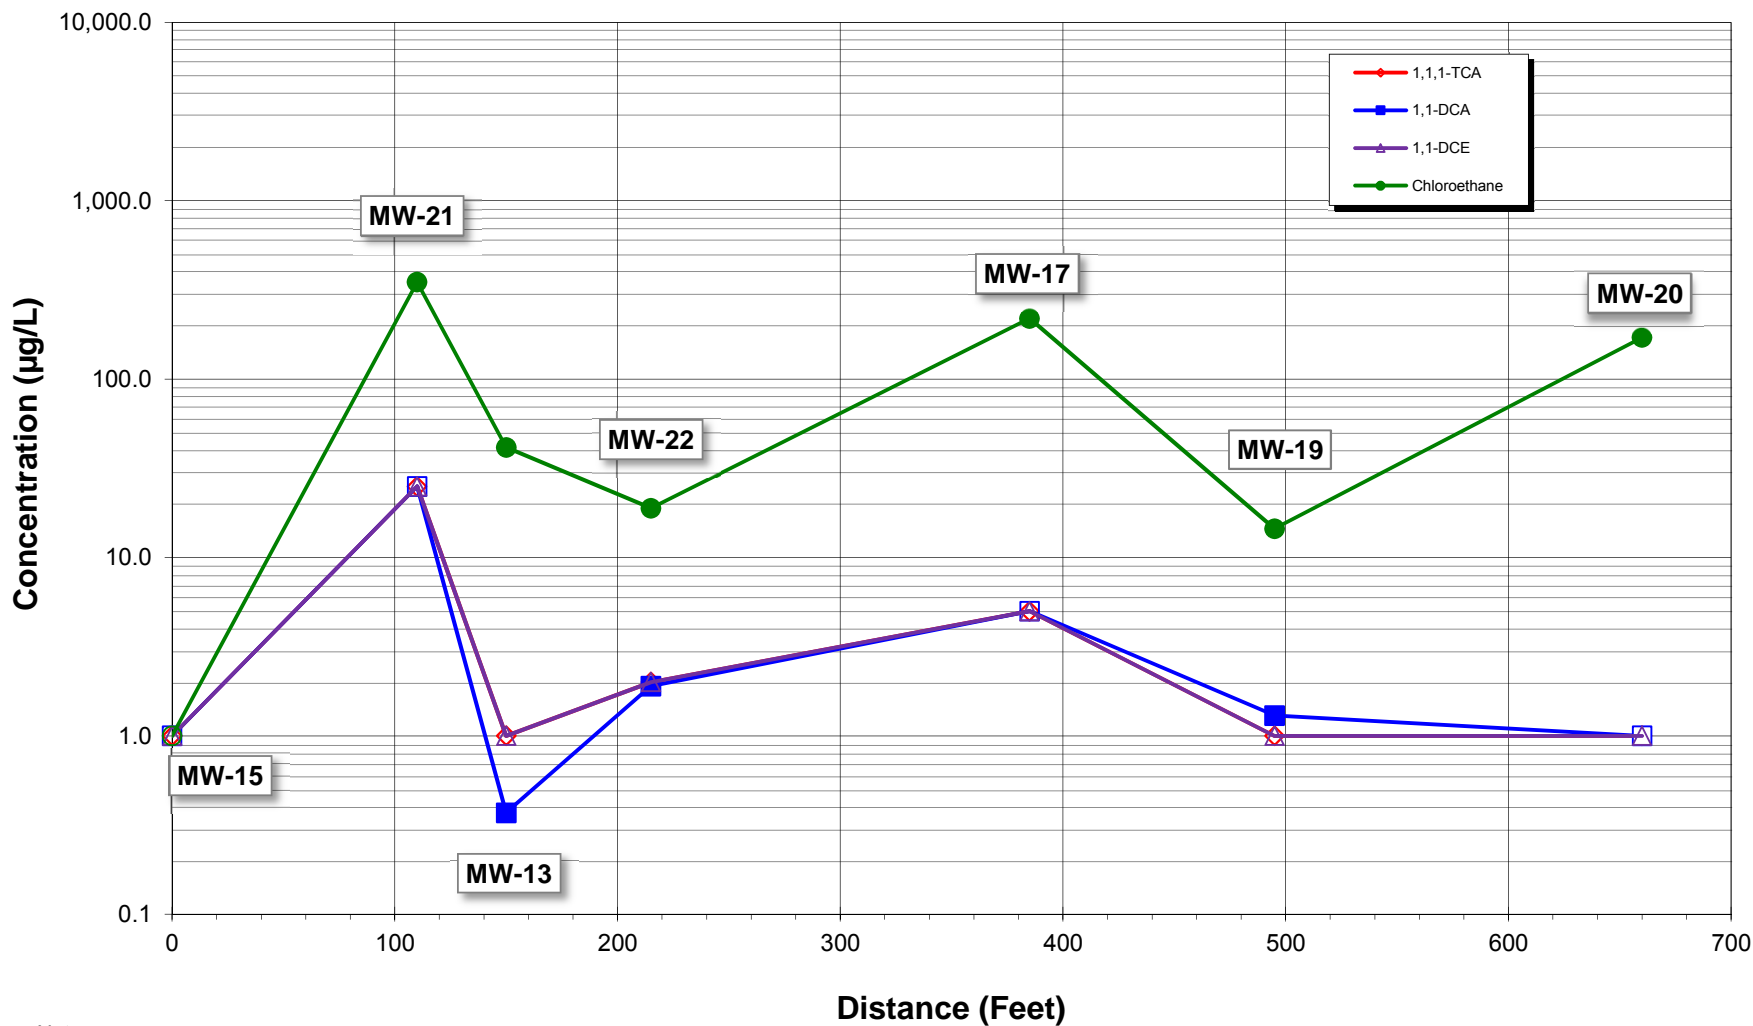

Notes:

- 1) MW-15 located upgradient of deep source treatment area.
- 2) Non-detect results below the MRLs are shown as hollow data points.

**Figure C52. Concentrations of Chlorinated Ethenes vs Distance from Deep Treatment Area
September 2015
Univar USA Inc., Kent, Washington**

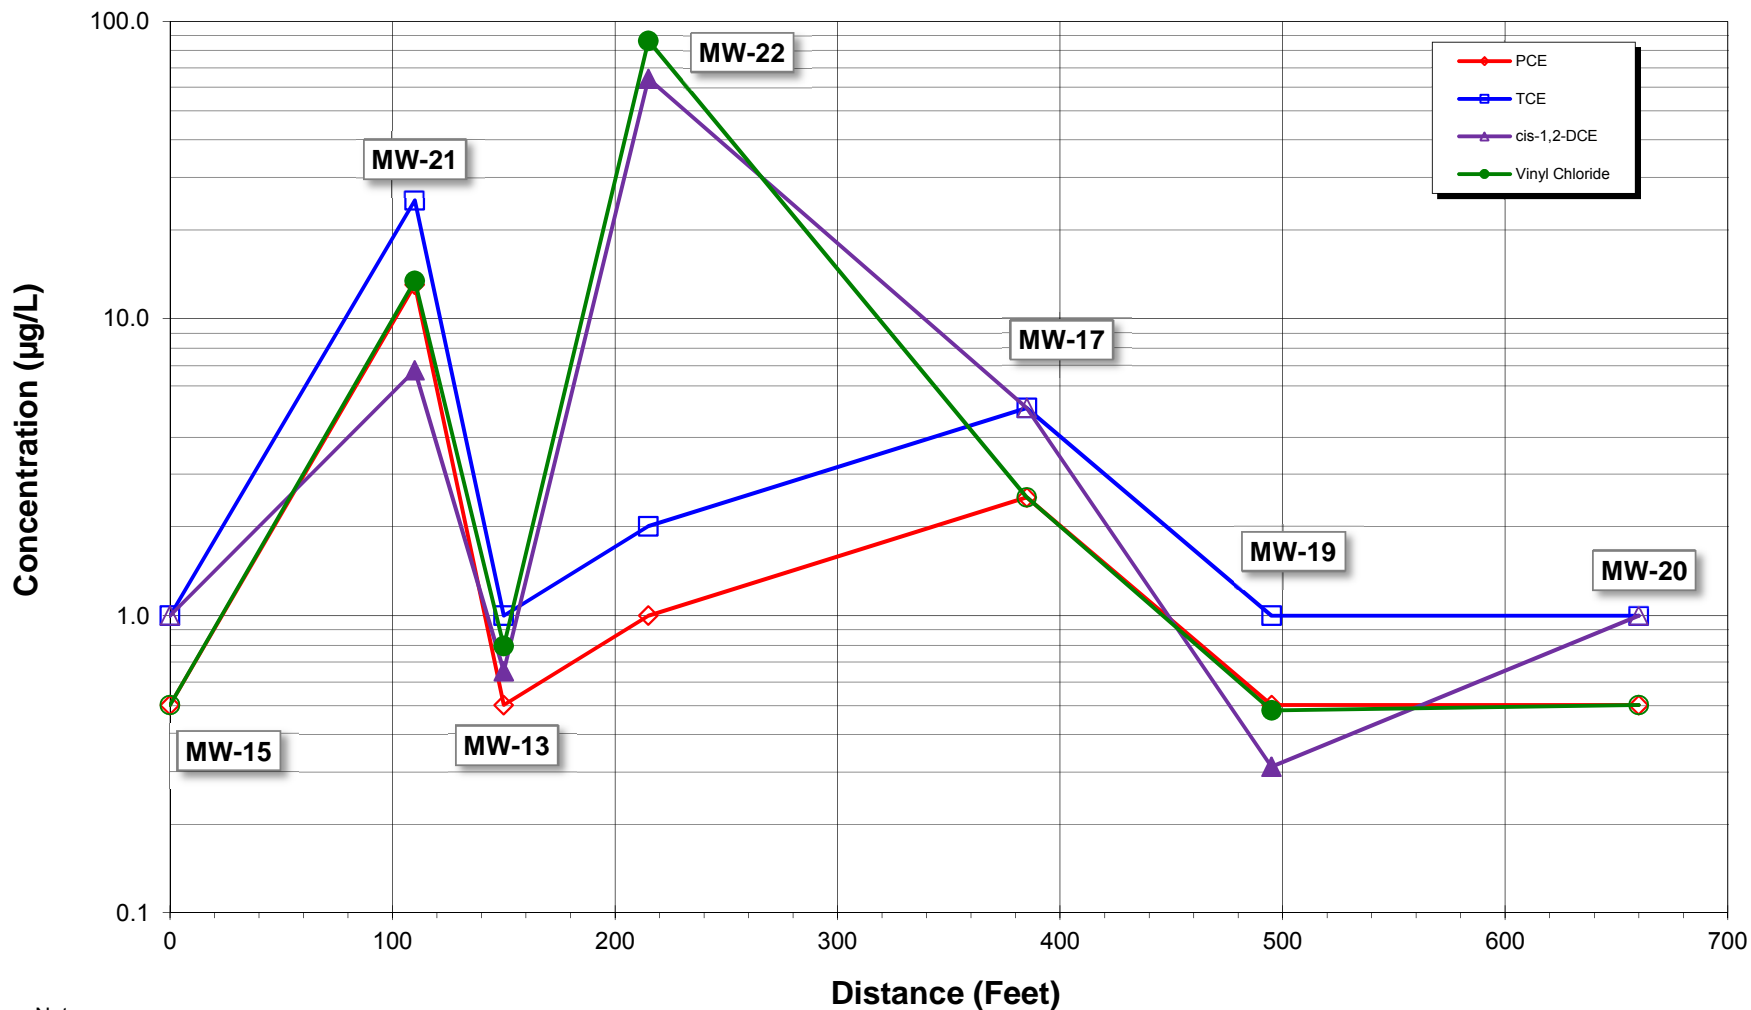

Notes:

- 1) MW-15 located upgradient of deep source treatment area.
- 2) Non-detect results below the MRLs are shown as hollow data points.

Figure C53. Microbial and Vinyl Chloride Concentrations Well MW-13

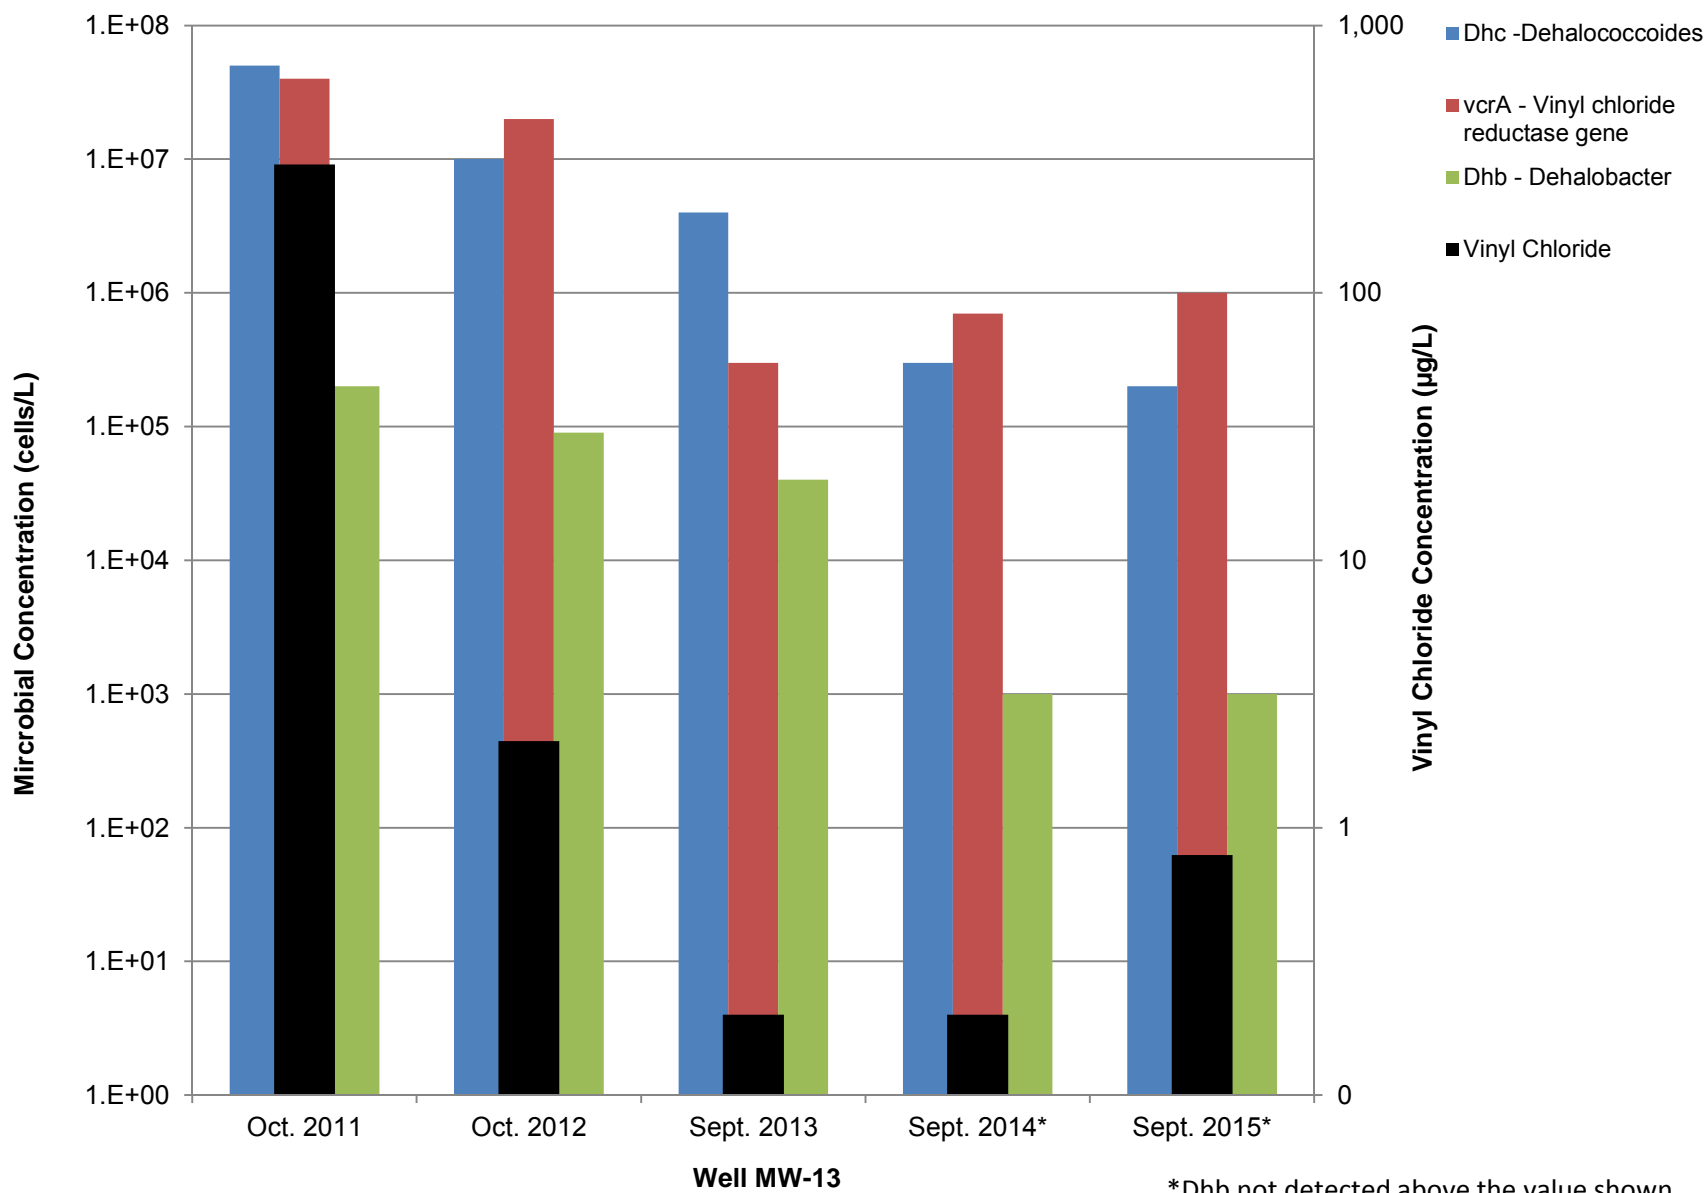


Figure C54. Microbial and Vinyl Chloride Concentrations Well MW-21


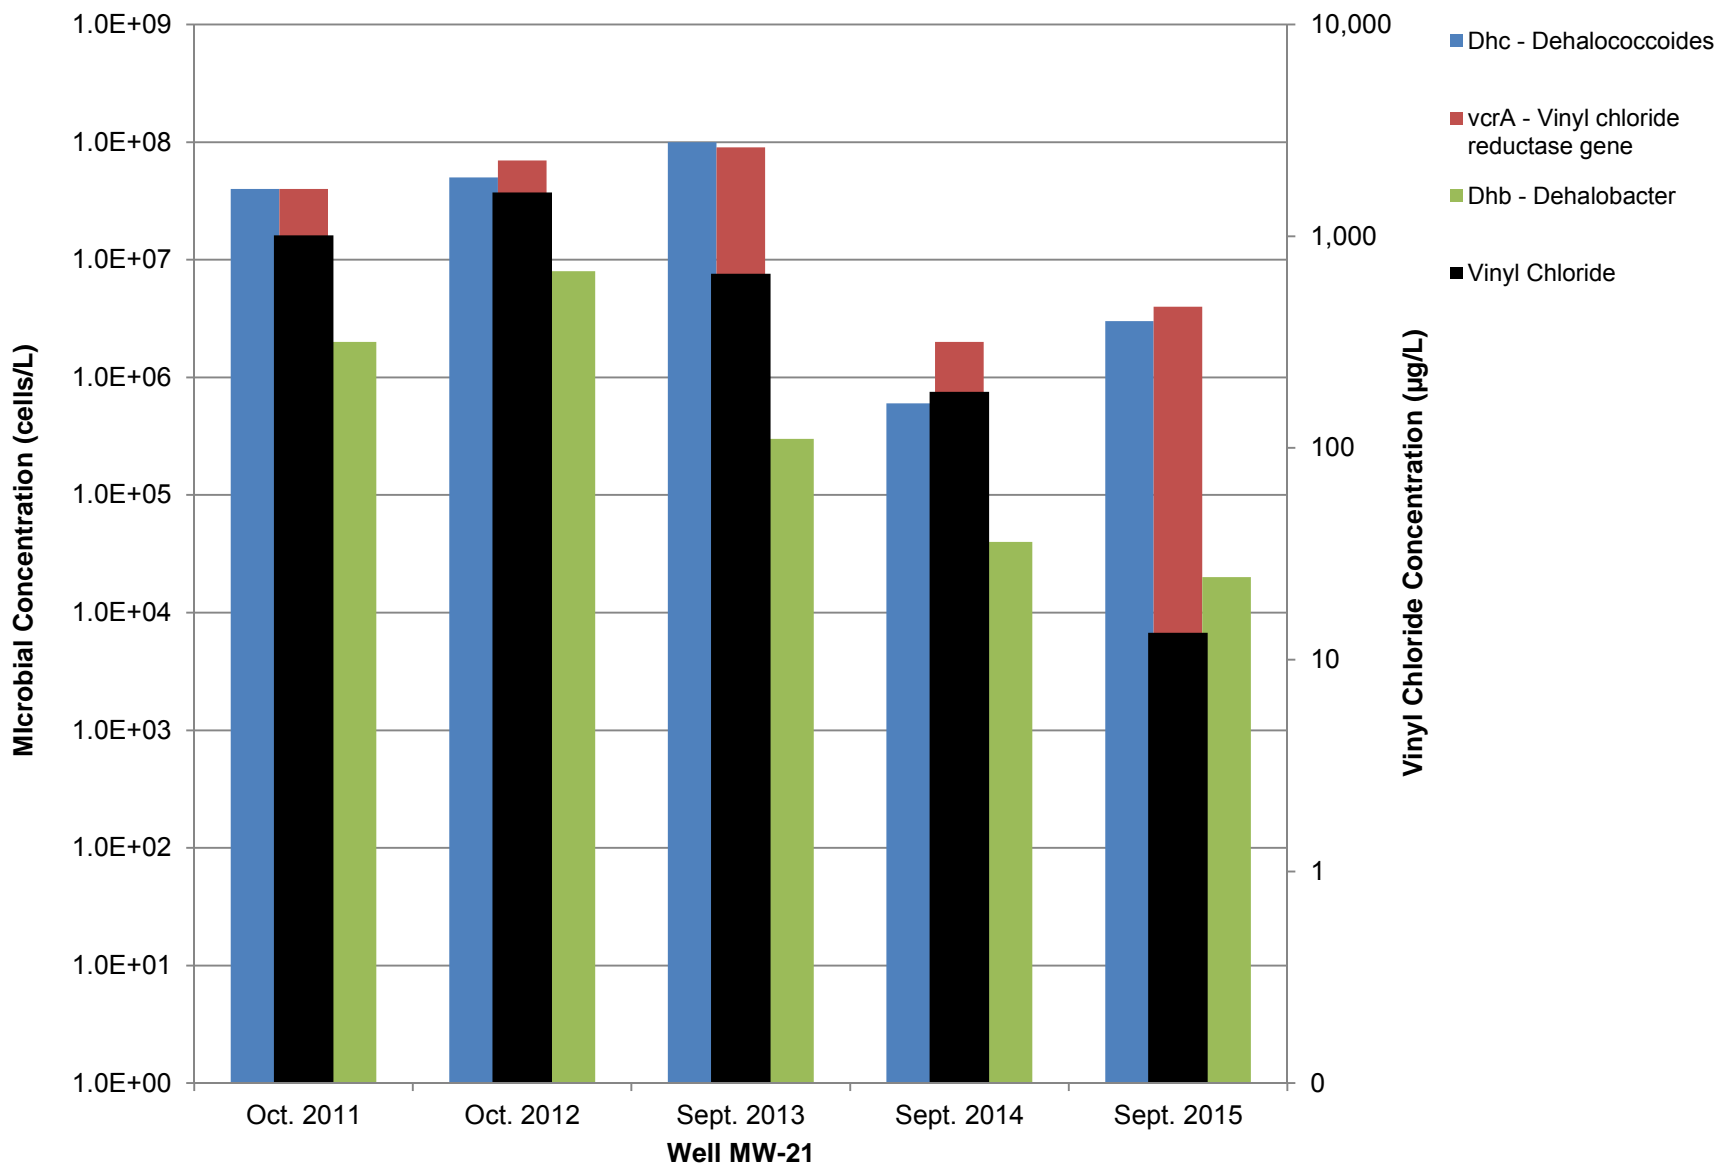


Figure C55. Microbial and Vinyl Chloride Concentrations Well MW-22

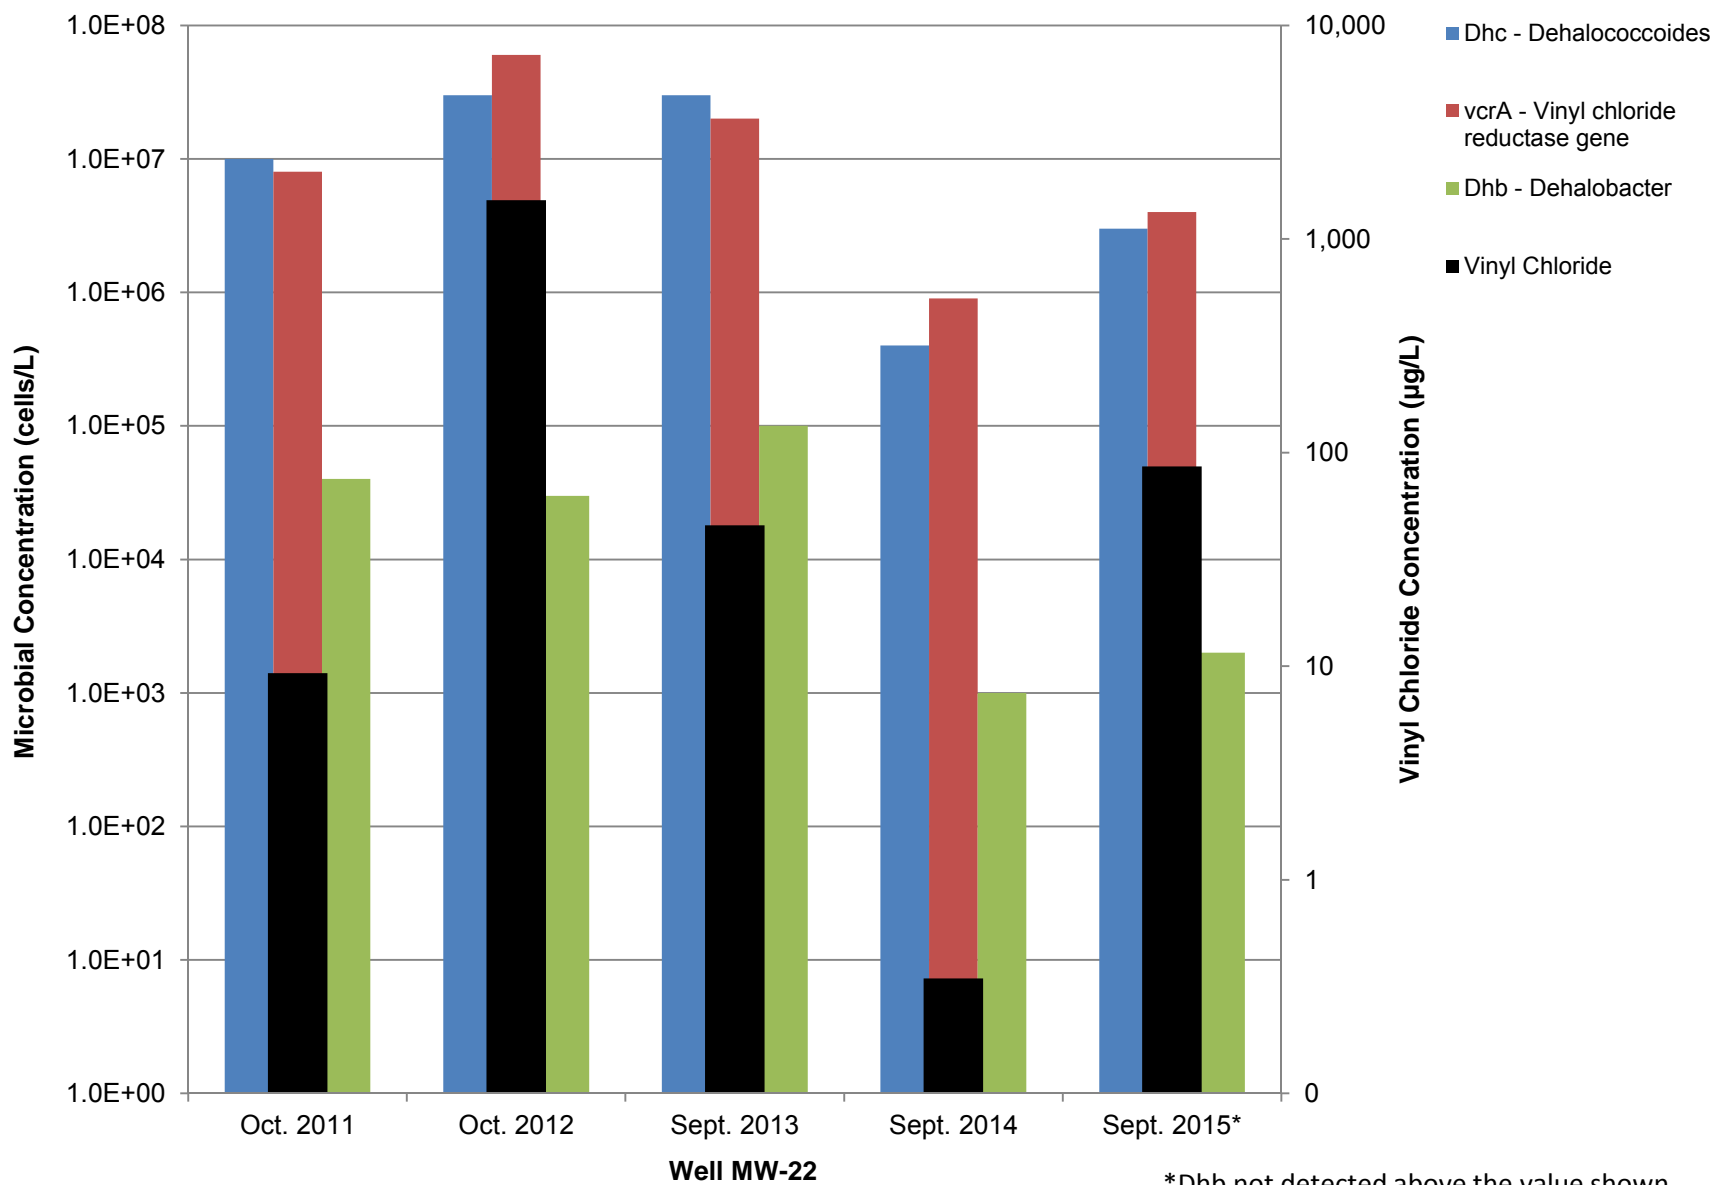

Appendix D
Groundwater Sampling Field Forms, Data Validation Reports,
and Analytical Lab Reports