
Cathcart Landfill Environmental Monitoring Report

Second
Semiannual and
Annual Summary

2021



Table of Contents

Table of Contents	2
Tables	2
Figures	2
Appendices	3
1.0 INTRODUCTION	4
1.1 BACKGROUND	4
1.2 MONITORING PROGRAM	4
2.0 GROUNDWATER MONITORING	6
2.2 GROUNDWATER SAMPLING.....	6
2.3 EVALUATION OF GROUNDWATER ANALYTICAL RESULTS	7
2.4 STATISTICAL EVALUATION	11
3.0 SURFACE WATER MONITORING	18
3.1 SURFACE WATER SAMPLING	18
4.0 LANDFILL GAS MONITORING	18
5.0 LEACHATE MONITORING	18
5.1 LEACHATE SAMPLING	20
6.0 SUMMARY AND RECOMMENDATIONS	22
6.1 SUMMARY	22
6.2 CONCLUSIONS/RECOMMENDATIONS	23
6.4 SIGNATURES AND LICENSES	23

Tables

Table 1 – Second Semiannual 2021 Groundwater Measurements	6
Table 2 – Summary of Annual 2021 Shallow Well Standard Exceedances	7
Table 3 – Summary of Annual 2021 Deep Well Standard Exceedances	9
Table 4 – Summary of Annual 2021 Shallow Well Prediction Limit Exceedances	11
Table 5 – Significant Trends, Shallow Wells 2021	13
Table 6 – Summary of Annual 2021 Deep Well Prediction Limit Exceedances	15
Table 7 – Significant Trends, Deep Wells 2021	17
Table 8 – Second Semiannual 2021 Surface Water Analytical Results	18
Table 9 – Cathcart Landfill Leachate Flow Totals, 2021.....	19
Table 10 – Leachate Vault Results – Inorganics	21
Table 11 – Leachate Vault Results – Metals	21
Table 12 – Leachate Vault Results – VOCs	21
Table 13 – Leachate Vault Results – SVOCs	21

Figures

Figure 1 – Vicinity Map
Figure 2 – Site Map
Figure 3 – Site Topography Map
Figure 4 – Geologic Map
Figure 5 – Monitoring Network Map
Figure 6a – Shallow Aquifer Groundwater Elevation Contours – Second Quarter 2021
Figure 6b – Deep Aquifer Groundwater Elevation Contours – Second Quarter 2021
Figure 6c – Shallow Aquifer Groundwater Elevation Contours – Fourth Quarter 2021
Figure 6d – Deep Aquifer Groundwater Elevation Contours – Fourth Quarter 2021
Figure 7 – Leachate Pretreatment System Flow Diagram

Appendices

Appendix A – Hydrographs

Appendix B – Groundwater Analytical Summary Tables

Appendix C – Groundwater Statistical Analyses

Appendix D – Field Monitoring Forms

1.0 INTRODUCTION

The following report presents the results of groundwater, surface water, landfill gas, and associated infrastructure monitoring for the second semiannual monitoring period (*July through December*) of 2021 and the annual 2021 summary environmental monitoring report for the Cathcart Sanitary Landfill (*Landfill, site*). The site is located at 8915 Cathcart Way, just west of the intersection of Cathcart Way and State Route 9 in south-central Snohomish County, Washington. The location of the site relative to existing municipal improvements is shown on the **Vicinity Map (Figure 1)**.

1.1 BACKGROUND

The Cathcart Landfill was designed and permitted in the late 1970s and was operated as a solid waste landfill for 12 years and ceased accepting any new solid waste in June 1992.

The closed landfill is approximately 60 acres in area and is part of a larger County parcel. The Cathcart Landfill is bounded by private residential property to the northwest, north and east and by other Snohomish County facilities to the south and west. Existing site improvements and the site layout are shown on the **Site Map (Figure 2)**, and existing site topography is shown on the **Site Topographic Map (Figure 3)**. Surficial geology of the site area is shown on the **Geologic Map (Figure 4)**.

Leachate is collected and gravity flows to a pretreatment facility, after which it is pumped to the **City of Everett's** Wastewater Treatment Plant for final treatment and discharge. Gas generated by the landfill is collected and extracted through a negatively pressurized system and discharged through an on-site gas flaring facility.

The Landfill is currently permitted for post-closure monitoring by the Snohomish Health District (*SHD*) with a Solid Waste Facility Permit (*SW-011, SHD 2021*). Monitoring results are reviewed by both the SHD and the Department of Ecology.

1.2 MONITORING PROGRAM

The site is currently monitored following the procedures outlined in the current Sampling and Analysis Plan (**SAP, Snohomish County, 2020**), which was approved by Ecology and SHD in their letters dated December 11 and 17, 2020, respectively. The SAP includes changes to the monitoring program that were proposed in the County's Application of Variance, which was submitted to the SHD in 2018; the changes were conditionally approved by SHD with input from Ecology in their letter dated December 6, 2018. These changes to the monitoring program are summarized as follows:

- **Groundwater Monitoring:** Sample frequency at all wells (*except for G-09S, G-09D, G-10S, and G-10D*) reduced from quarterly to semiannual; reporting for all wells will be completed on a semiannual basis. Chemical analytical suites will remain unchanged from those specified in the 2006 SAP.
 - Wells G-09S, G-09D, G-10S, and G-10D will continue to be sampled quarterly and will be reported in the semiannual monitoring reports. Due to a gap in the data

for wells G-09S, G-09D, and G-10S between the third quarter 2013 and the third quarter of 2018, eight additional quarters of monitoring will be conducted to determine if a reduction to semiannual sampling frequency is warranted at those wells. Additionally, low vinyl chloride concentrations detected in those wells historically will be further evaluated during the additional quarterly monitoring period.

- **Landfill Gas Monitoring:** Quarterly monitoring at all currently monitored gas probes, barholes, vaults, and lift stations will be maintained, and new soil gas probe GP-6 will be integrated into the gas probe monitoring program to monitor for landfill gas migration on the northern edge of the Cathcart property, near the closest residences. Monitoring results will be included in the semiannual monitoring reports.
- **Surface Water Sampling:** Sample frequency at all monitoring points was reduced to semiannual; two monitoring points (*CC-D1 and CC-J*) were eliminated from the surface water monitoring program based on redundancy/accessibility concerns for those locations. Monitoring results will be included in the semiannual monitoring reports. Chemical analytical suites remain unchanged.

1.2.1 Groundwater Monitoring Network

Currently, a total of 17 groundwater monitoring wells (*eight shallow wells and nine deep wells*), are monitored on a semiannual basis. Of these wells, four-(4) are considered upgradient, and 13 are considered to be within the landfill footprint or downgradient site wells. Well locations are shown on the **Monitoring Network Map (Figure 5)**. Groundwater monitoring results are summarized in **Section 2.0** of this report.

1.2.2 Surface Water Monitoring Network

Surface water monitoring stations have been established along Garden Creek and in the site stormwater detention ponds per the **SAP**. The seven surface water sampling locations consist of one sampling location upgradient of the site and six sampling locations within and downgradient of the site. Sampling locations are shown on **Monitoring Network Map (Figure 5)**. Semiannual surface water monitoring results are summarized in **Section 3.0** of this report.

1.2.3 Landfill Gas Monitoring Network

Per the **SAP**, landfill gas monitoring is conducted quarterly and includes measurement of methane, oxygen, and carbon dioxide. The existing gas monitoring system consists of eight gas probes, six permanently-installed barhole probes, seven vaults, 19 manholes, and two lift stations, which surround the landfill. The gas monitoring locations are shown on the **Monitoring Network Maps (Figures 5 and 5a)**. Quarterly landfill gas monitoring results are summarized and discussed in **Section 4.0** of this report.

2.0 GROUNDWATER MONITORING

The second semiannual groundwater monitoring events for 2021 were performed by Snohomish County personnel on July 14 and October 19 and 20, 2021.

Depths to water were measured and groundwater samples were collected in accordance with the approved **SAP**. Hydrographs of the historical and current groundwater elevations and precipitation totals are included in **Appendix A**. The **Second Semiannual 2021 Groundwater Measurements** and comparison with the previous monitoring event elevation data (*delta*) are shown in **Table 1** below.

Table 1 – Second Semiannual 2021 Groundwater Measurements

Well Number	Sample Date	Top of Casing Elevation (feet above MSL)	Water Elevation (feet above MSL)	Delta* (feet)
Shallow Wells – Third Quarter 2021				
G-09S	7/14/21	273.08	241.79	-1.39
G-10S	7/14/21	266.94	242.99	-0.61
Shallow Wells – Fourth Quarter 2021				
G-01A	10/19/21	229.00	221.89	3.06
G-04A	10/19/21	286.52	DRY	--
G-08D1	10/19/21	222.02	192.67	-5.63
G-09S	10/20/21	273.08	240.57	-1.22
G-10S	10/20/21	266.94	244.32	1.33
G-11S	10/19/21	250.74	232.19	2.39
G-14S	10/19/21	328.76	311.78	-7.57
G-24S	10/19/21	321.13	306.47	-0.96
Deep Wells – Third Quarter 2021				
G-09D	7/14/21	274.60	220.92	-1.77
G-10D	7/14/21	268.32	236.80	-0.70
Deep Wells – Fourth Quarter 2021				
G-01D	10/19/21	229.96	206.76	1.38
G-02D	10/19/21	242.10	210.77	-2.09
G-06B	10/19/21	246.24	212.21	2.06
G-08D2	10/19/21	221.62	212.15	-3.43
G-09D	10/20/21	274.60	219.80	-1.12
G-10D	10/20/21	268.32	237.92	1.12
G-13D	10/20/21	232.17	221.35	0.22
G-14D	10/19/21	329.58	297.68	-1.27
G-24D	10/19/21	320.51	301.00	-1.41

MSL = Mean sea level

* Delta = Change in groundwater elevation from previous sampling event; wells 09S/09D and 10S/10D are sampled quarterly

Groundwater Contour Maps for the shallow and deep zones during 2021 (*i.e.*, for the second and fourth quarter monitoring events) are included as **Figures 6a through 6d** of this report.

2.2 GROUNDWATER SAMPLING

Four wells were sampled during the first and third quarters (*G-09S, G-09D, G-10S, and G-10D*); and 16 wells were sampled during the second and fourth quarters in accordance with the procedures outlined in the **SAP** and the modified schedule in the approved Variance. Well sampling field sheets for the second and fourth quarter are included in **Appendix D**. Well performance was consistent with recent sampling events at all wells.

Samples were transported to Am Test, Inc. of Kirkland, Washington under chain-of-custody for analysis of dissolved metals, volatile organic compounds (VOCs), and conventional chemistry parameters. The analytical results are tabulated in **Appendix B** of this report and discussed below.

2.3 EVALUATION OF GROUNDWATER ANALYTICAL RESULTS

Each of the groundwater samples collected during 2021 are compared to the applicable groundwater quality standards which are summarized in **Tables 2 and 3** below and in **Appendix B**. Notable observations or deviations from scope are noted below:

2.3.1 Shallow Wells

- The TOC concentration in the second quarter 2021 sample from well G-09S (13.0 mg/L) increased significantly from the previous quarter but decreased consistently from the second quarter to the fourth quarter 2021.
- The VOCs detected in shallow wells during the 2021 sampling events include:
 - Cis-1,2-dichloroethene (*cis*-1,2-DCE) – well G-09S (*first and fourth quarters*) and G-10S (*first, third, and fourth quarters*)
 - 1,2-Dichloropropane (1,2-DCP) – well G-09S (*fourth quarter*); did not exceed the 1,2-DCP standard of 0.6 µg/L

Table 2 – Summary of Annual 2021 Shallow Well Standard Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Groundwater Standard
Downgradient	G-01A	4/21/21	pH	std units	6.34	6.5-8.5
			Arsenic	mg/L	0.00015	0.00005
		10/19/21	pH	std units	5.58	6.5-8.5
			Arsenic	mg/L	0.000173	0.00005
	G-04A	4/20/21	Insufficient water for sampling			
		10/19/21	Insufficient water for sampling			
	G-08D1	4/20/21	pH	std units	9.59	6.5-8.5
			Sodium	mg/L	103	20
		10/19/21	Arsenic	mg/L	0.00088	0.00005
			pH	std units	9.14	6.5-8.5
	G-09S	1/12/21	Sodium	mg/L	104	20
			Arsenic	mg/L	0.00161	0.00005
			Conductivity	µmhos/cm	980	700
			pH	std units	6.43	6.5-8.5
4/20/21		Sodium	mg/L	88.5	20	
		TDS	mg/L	680	500	
		Arsenic	mg/L	0.000607	0.00005	
		Manganese	mg/L	0.054	0.05	
4/20/21	Conductivity	µmhos/cm	950	700		
	pH	std units	6.42	6.5-8.5		
	Sodium	mg/L	79.0	20		
	TDS	mg/L	660	500		
		Arsenic	mg/L	0.00075	0.00005	

Table 2 – Summary of Annual 2021 Shallow Well Standard Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Groundwater Standard
Downgradient	G-09S	7/14/21	Conductivity	µmhos/cm	970	700
			pH	std units	6.15	6.5-8.5
	Sodium		mg/L	90.4	20	
	TDS		mg/L	640	500	
	Arsenic		mg/L	0.000774	0.00005	
	Thallium		mg/L	0.00382	0.002	
	10/20/21	Conductivity	µmhos/cm	920	700	
		pH	std units	6.06	6.5-8.5	
	G-10S	1/12/21	Sodium	mg/L	94.4	20
			TDS	mg/L	600	500
			Arsenic	mg/L	0.000549	0.00005
			Conductivity	µmhos/cm	1400	700
			Sodium	mg/L	181	20
			Sulfate	mg/L	294	250
4/20/21	TDS	mg/L	970	500		
	Arsenic	mg/L	0.00501	0.00005		
	Iron	mg/L	9.44	0.3		
	Manganese	mg/L	3.22	0.05		
	Conductivity	µmhos/cm	1400	700		
	Sodium	mg/L	193	20		
7/14/21	Sulfate	mg/L	298	250		
	TDS	mg/L	970	500		
	Arsenic	mg/L	0.00564	0.00005		
	Iron	mg/L	10.3	0.3		
	Manganese	mg/L	3.41	0.05		
	Conductivity	µmhos/cm	1400	700		
10/20/21	Sodium	mg/L	183	20		
	Sulfate	mg/L	271	250		
	TDS	mg/L	960	500		
	Arsenic	mg/L	0.00573	0.00005		
	Iron	mg/L	10.2	0.3		
	Manganese	mg/L	3.35	0.05		
G-11S	4/20/21	Conductivity	µmhos/cm	1300	700	
		pH	std units	6.37	6.5-8.5	
10/19/21	Sodium	mg/L	186	20		
	Sulfate	mg/L	260	250		
	TDS	mg/L	860	500		
	Arsenic	mg/L	0.00501	0.00005		
G-14S	4/20/21	Iron	mg/L	12.2	0.3	
		Manganese	mg/L	3.52	0.05	
Upgradient	G-14S	4/20/21	Sodium	mg/L	30.9	20
			Arsenic	mg/L	0.000495	0.00005
Upgradient	G-14S	4/20/21	pH	std units	6.26	6.5-8.5
			Sodium	mg/L	42.9	20
			Arsenic	mg/L	0.000319	0.00005
			Manganese	mg/L	0.056	0.05
Upgradient	G-14S	4/20/21	pH	std units	9.25	6.5-8.5
			Sodium	mg/L	83.5	20
			Arsenic	mg/L	0.00352	0.00005

Table 2 – Summary of Annual 2021 Shallow Well Standard Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Groundwater Standard
Upgradient	G-14S	10/19/21	Sodium	mg/L	107.0	20
			Arsenic	mg/L	0.00285	0.00005
	G-24S	4/20/21	Sodium	mg/L	78.9	20
10/19/21		Arsenic	mg/L	0.000624	0.00005	
			Sodium	mg/L	97.0	20
			Arsenic	mg/L	0.000552	0.00005

2.3.2 Deep Wells

- The VOCs detected in deep wells during the 2021 sampling events include:
 - Cis-1,2-DCE – well G-09D (*first and fourth quarters*) and well G-10D (*fourth quarter*)
 - 1,2-DCP – well G-09D (*first and fourth quarters*); none of the 1,2-DCP concentrations exceeded the groundwater standard of 0.6 µg/L
 - Vinyl chloride – well G-09D (*second, third, and fourth quarters*); all three vinyl chloride detections exceeded the groundwater standard of 0.02 µg/L

Table 3 – Summary of Annual 2021 Deep Well Standard Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Groundwater Standard
Downgradient	G-01D	4/21/21	pH	std units	9.27	6.5-8.5
			Sodium	mg/L	205	20
			TDS	mg/L	540	500
			Arsenic	mg/L	0.00121	0.00005
	G-02D	4/21/21	pH	std units	8.98	6.5-8.5
		10/19/21	Sodium	mg/L	140	20
	G-06B	4/21/21	Arsenic	mg/L	0.000708	0.00005
		10/19/21	Sodium	mg/L	79.4	20
	G-08D2	4/21/21	Arsenic	mg/L	0.00373	0.00005
		10/19/21	Sodium	mg/L	80.8	20
	G-09D	4/21/21	Arsenic	mg/L	0.00364	0.00005
		10/19/21	Sodium	mg/L	178	20
	G-09D	4/21/21	Arsenic	mg/L	0.00415	0.00005
		10/19/21	Sodium	mg/L	181	20
	G-09D	4/21/21	Arsenic	mg/L	0.00341	0.00005
		10/19/21	pH	std units	9.90	6.5-8.5
G-09D	4/20/21	Sodium	mg/L	106	20	
	10/19/21	Arsenic	mg/L	0.00134	0.00005	
G-09D	4/20/21	pH	std units	9.27	6.5-8.5	
	10/19/21	Sodium	mg/L	115	20	
G-09D	1/12/21	Arsenic	mg/L	0.000519	0.00005	
	4/20/21	pH	std units	9.35	6.5-8.5	
G-09D	4/20/21	Sodium	mg/L	164	20	
	4/20/21	Arsenic	mg/L	0.00276	0.00005	
G-09D	4/20/21	pH	std units	8.58	6.5-8.5	
	4/20/21	Sodium	mg/L	176	20	
G-09D	4/20/21	Arsenic	mg/L	0.00349	0.00005	
	4/20/21	Vinyl chloride	µg/L	0.19	0.02	

Table 3 – Summary of Annual 2021 Deep Well Standard Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Groundwater Standard
Downgradient	G-09D	7/14/21	Conductivity	µmhos/cm	710	700
			pH	std units	8.73	6.5-8.5
	Sodium		mg/L	174	20	
	Arsenic		mg/L	0.00438	0.00005	
	G-09D	10/20/21	Vinyl chloride	µg/L	0.57	0.02
			pH	std units	8.97	6.5-8.5
	Sodium		mg/L	182	20	
	Arsenic		mg/L	0.00268	0.00005	
	G-10D	1/12/21	Vinyl chloride	µg/L	0.12	0.02
			Conductivity	µmhos/cm	1500	700
			Sodium	mg/L	364	20
			Sulfate	mg/L	286	250
			TDS	mg/L	1000	500
			Arsenic	mg/L	0.00105	0.00005
4/20/21		Iron	mg/L	0.499	0.3	
		Manganese	mg/L	0.37	0.05	
		Conductivity	µmhos/cm	1500	700	
		Sodium	mg/L	376	20	
		Sulfate	mg/L	289	250	
		TDS	mg/L	1000	500	
7/14/21	Arsenic	mg/L	0.00125	0.00005		
	Iron	mg/L	0.493	0.3		
	Manganese	mg/L	0.367	0.05		
	Conductivity	µmhos/cm	1500	700		
	Sodium	mg/L	369	20		
	Sulfate	mg/L	268	250		
10/20/21	TDS	mg/L	970	500		
	Arsenic	mg/L	0.00128	0.00005		
	Iron	mg/L	0.499	0.3		
	Manganese	mg/L	0.354	0.05		
	Conductivity	µmhos/cm	1400	700		
	Sodium	mg/L	377	20		
G-13D	4/21/21	Sulfate	mg/L	252	250	
		TDS	mg/L	1000	500	
	10/20/21	Arsenic	mg/L	0.000716	0.00005	
		Iron	mg/L	0.536	0.3	
G-13D	4/21/21	Manganese	mg/L	0.354	0.05	
		pH	std units	9.31	6.5-8.5	
G-13D	10/20/21	Sodium	mg/L	106	20	
		Arsenic	mg/L	0.00019	0.00005	
G-14D	4/20/21	pH	std units	8.84	6.5-8.5	
		Sodium	mg/L	104	20	
G-14D	10/19/21	Arsenic	mg/L	0.000109	0.00005	
		pH	std units	9.72	6.5-8.5	
Upgradient	G-14D	4/20/21	Sodium	mg/L	115	20
			Arsenic	mg/L	0.000907	0.00005
Upgradient	G-14D	10/19/21	pH	std units	9.11	6.5-8.5
			Sodium	mg/L	123	20
Upgradient	G-14D	10/19/21	Arsenic	mg/L	0.000638	0.00005

Table 3 – Summary of Annual 2021 Deep Well Standard Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Groundwater Standard
Upgradient	G-24D	4/20/21	pH	std units	8.64	6.5-8.5
			Sodium	mg/L	111	20
			Arsenic	mg/L	0.00006	0.00005
		10/19/21	Sodium	mg/L	121	20
			Arsenic	mg/L	0.00006	0.00005

2.4 STATISTICAL EVALUATION

Where exceedances to the WAC groundwater standards occur, statistical analysis is performed as specified in the **SAP** using **DUMPStat Statistical Software** (*Version 3.0 by Robert D. Gibbons Ltd., 2018*) to determine the significance of the change.

Details regarding the statistical analyses are found in the SAP and in monitoring reports submitted prior to 2019. Per **Ecology** and **Snohomish Health District** request, the statistical prediction limits for each groundwater zone were previously updated in the first quarter of the year and subsequent data sets were compared against that prediction limit. However, since the first semiannual monitoring event for all wells does not occur until the second quarter, the prediction limits are updated annually following the second quarter sampling event.

2.4.1 Shallow Groundwater Well Statistical Results

Analytes that exceeded the calculated prediction limits in the shallow zone wells and the observed concentration trends are summarized in **Tables 4 and 5** below and **Appendix B**. Plots of the shallow zone groundwater statistical analyses are included in **Appendix C**.

Table 4 – Summary of Annual 2021 Shallow Well Prediction Limit Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Prediction Limit
Downgradient	G-01A	4/21/21	None	--	--	--
		10/19/21	pH	std units	5.58	6.00-9.39
	G-04A	4/20/21	Not sampled due to insufficient water			
		10/19/21	Not sampled due to insufficient water			
	G-08D1	4/20/21	pH	std units	9.59	6.00-9.39
		10/19/21	Nitrite nitrogen	mg/L	0.035	0.021
	G-09S	1/12/21	Alkalinity	mg/L	360	200
			Bicarbonate	mg/L	360	200
			Calcium	mg/L	79.7	23.8526
			Conductivity	µmhos/cm	980	540
			Potassium	mg/L	4.82	2.7509
Sulfate			mg/L	187	169	
		TDS	mg/L	680	404.5425	

Table 4 – Summary of Annual 2021 Shallow Well Prediction Limit Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Prediction Limit
Downgradient	G-09S	4/20/21	Alkalinity	mg/L	340	230
			Bicarbonate	mg/L	340	200
			Calcium	mg/L	63.2	23.7546
			COD	mg/L	24	18
			Conductivity	µmhos/cm	950	546.7776
			Potassium	mg/L	4.51	2.6282
			TDS	mg/L	660	395.6869
		7/14/21	Alkalinity	mg/L	350	230
			Bicarbonate	mg/L	350	200
	10/20/21	Calcium	mg/L	78.4	23.7546	
		Conductivity	µmhos/cm	970	546.7776	
		Potassium	mg/L	4.96	2.6282	
TDS		mg/L	640	395.6869		
Nickel		mg/L	0.05	0.038		
Thallium		mg/L	0.00382	0.00009		
G-10S	1/12/21	Alkalinity	mg/L	350	230	
		Bicarbonate	mg/L	350	200	
		Calcium	mg/L	88.1	23.7546	
		Conductivity	µmhos/cm	920	546.7776	
		Potassium	mg/L	5.19	2.6282	
		TDS	mg/L	600	395.6869	
		Alkalinity	mg/L	480	200	
		Bicarbonate	mg/L	480	200	
		Calcium	mg/L	104	23.8526	
4/20/21	Conductivity	µmhos/cm	1400	540		
	Potassium	mg/L	3.69	2.7509		
	Sodium	mg/L	181	123		
	Sulfate	mg/L	294	169		
	TDS	mg/L	970	404.5425		
	Arsenic	mg/L	0.00501	0.0038		
	Alkalinity	mg/L	480	230		
	Bicarbonate	mg/L	480	200		
	Calcium	mg/L	91.8	23.7546		
	Conductivity	µmhos/cm	1400	546.7776		
Potassium	mg/L	3.34	2.6282			
Sodium	mg/L	193	121.1148			
TDS	mg/L	970	395.6869			
Arsenic	mg/L	0.00564	0.004			
Cobalt	mg/L	0.013	0.003			
Iron	mg/L	10.3	9.783			

Table 4 – Summary of Annual 2021 Shallow Well Prediction Limit Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Prediction Limit
Downgradient	G-10S	7/14/21	Alkalinity	mg/L	480	230
			Bicarbonate	mg/L	480	200
			Calcium	mg/L	105	23.7546
			Conductivity	µmhos/cm	1400	546.7776
			Nitrite nitrogen	mg/L	0.022	0.021
			Potassium	mg/L	3.64	2.6282
			Sodium	mg/L	183	121.1148
			TDS	mg/L	960	395.6869
			Arsenic	mg/L	0.00573	0.004
	Iron	mg/L	10.2	9.783		
Downgradient	G-10S	10/20/21	Alkalinity	mg/L	520	230
			Bicarbonate	mg/L	520	200
			Calcium	mg/L	116.0	23.7546
			Conductivity	µmhos/cm	1300	546.7776
			Potassium	mg/L	3.9	2.6282
			Sodium	mg/L	186	121.1148
			TDS	mg/L	860	395.6869
			Arsenic	mg/L	0.00501	0.004
			Iron	mg/L	12.2	9.783
Downgradient	G-11S	4/20/21	Cobalt	mg/L	0.011	0.003
		10/19/21	None	--	--	--
Upgradient	G-14S	4/20/21	None	--	--	--
		10/19/21	Bicarbonate	mg/L	210	200
	G-24S	10/19/21	Nitrite nitrogen	mg/L	0.073	0.021
			None	--	--	--
			None	--	--	--

Significant increasing and decreasing concentration trends for the second semiannual 2021 monitoring events and for 2021 overall were noted in shallow groundwater, as summarized in **Table 5** below.

Table 5 – Significant Trends, Shallow Wells 2021

Well	Date	Significant Trends			
		Second Semiannual 2021		2021 Overall	
		Increasing	Decreasing	Increasing	Decreasing
Downgradient Wells					
G-01A	10/19/21	None	None	pH	None
G-04A	10/19/21	NS	NS	NS	NS
G-08D1	10/19/21	Iron	Chloride	Calcium, iron	Chloride

Table 5 – Significant Trends, Shallow Wells 2021

Well	Date	Significant Trends			
		Second Semiannual 2021		2021 Overall	
		Increasing	Decreasing	Increasing	Decreasing
G-09S	7/14/21	Alkalinity, bicarbonate, pH, TOC	Calcium, chloride, conductivity, magnesium, potassium, sulfate, TDS	Alkalinity, bicarbonate, pH, TOC	Calcium, chloride, conductivity, magnesium, potassium, sulfate, TDS, selenium
G-09S	10/20/21	Alkalinity, bicarbonate, pH	Calcium, chloride, conductivity , magnesium, potassium, sulfate, TDS		
G-10S	7/14/21	Alkalinity, ammonia, bicarbonate	Calcium, chloride, magnesium, sulfate, TDS , manganese	Alkalinity, ammonia, bicarbonate	Calcium, chloride, magnesium, sulfate, TDS, manganese
G-10S	10/20/21	Alkalinity, ammonia, bicarbonate	Calcium, chloride, magnesium, sulfate, TDS, manganese		
G-11S	10/19/21	Calcium, magnesium, manganese	Conductivity, sodium, sulfate	Calcium, magnesium, manganese	Alkalinity, bicarbonate, conductivity, sodium, sulfate
Upgradient Wells					
G-14S	10/19/21	pH, arsenic, manganese	Chloride, nitrate, sulfate	pH, arsenic, manganese	Chloride, nitrate
G-24S	10/19/21	None	Calcium, chloride, magnesium, sulfate	None	Calcium, chloride, magnesium, sulfate

Constituents in **bold** (if any) indicate a new trend noted since the previous monitoring period

Decreasing trends in the shallow wells outnumbered increasing trends during all four 2021 sampling events, including the first quarter sampling event (13 decreasing/6 increasing), second quarter sampling event (22 decreasing/14 increasing), third quarter sampling event (13 decreasing/7 increasing), and fourth quarter sampling event (24 decreasing/13 increasing). Three increasing trends were noted in upgradient well G-14S during the fourth quarter event.

2.4.2 Deep Groundwater Well Statistical Results

Analytes that exceeded the calculated prediction limits in the deep zone wells and the observed concentration trends for the second semiannual 2021 events are summarized in **Tables 6 and 7** below and in **Appendix B**. Plots of the deep zone groundwater statistical analyses are included in **Appendix C**.

Table 6 – Summary of Annual 2021 Deep Well Prediction Limit Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Prediction Limit
Downgradient	G-01D	4/21/21	Alkalinity	mg/L	290	280
			Conductivity	µmhos/cm	650	530
	Sodium		mg/L	205	130.7721	
	TDS		mg/L	540	460	
	Zinc		mg/L	0.018	0.012	
	G-02D	10/19/21	Conductivity	µmhos/cm	590	530
			Sodium	mg/L	140	130.7721
	G-02D	4/21/21	Nitrate	mg/L	0.32	0.21
			Sulfate	mg/L	70.2	66.05
	Arsenic		mg/L	0.00373	0.0021	
	G-06B	10/19/21	Arsenic	mg/L	0.00364	0.0021
			4/21/21	Conductivity	µmhos/cm	650
	Sodium	mg/L		178	130.7721	
	Sulfate	mg/L		67.6	66.05	
	Arsenic	mg/L		0.00415	0.0021	
	G-08D2	10/19/21		Conductivity	µmhos/cm	660
			Sodium	mg/L	181	130.7721
			Arsenic	mg/L	0.00341	0.0021
	G-09D	4/20/21	pH	std units	9.90	6.02-9.88
			Nitrite	mg/L	0.067	0.054
1/12/21		Conductivity	µmhos/cm	660	510	
		Sodium	mg/L	164	127.8505	
4/20/21		Conductivity	µmhos/cm	680	530	
		Sodium	mg/L	176	130.7721	
		Sulfate	mg/L	128	66.05	
7/14/21		Arsenic	mg/L	0.00349	0.0021	
		Conductivity	µmhos/cm	710	510	
		Nitrate	mg/L	0.33	0.21	
10/20/21	Sodium	mg/L	174	130.7721		
	Sulfate	mg/L	129	66.05		
	Arsenic	mg/L	0.00438	0.0021		
	Conductivity	µmhos/cm	660	510		
10/20/21	Sodium	mg/L	182	130.7721		
	Sulfate	mg/L	127	66.05		
	Arsenic	mg/L	0.00268	0.0021		

Table 6 – Summary of Annual 2021 Deep Well Prediction Limit Exceedances

Well Type	Well ID	Sample Date	Parameter	Units	Result	Prediction Limit
Downgradient	G-10D	1/12/21	Alkalinity	mg/L	540	280
			Ammonia	mg/L	0.337	0.2403
			Bicarbonate	mg/L	540	280
			Calcium	mg/L	21.7	6.32
			Chloride	mg/L	16.7	6.86
			Conductivity	µmhos/cm	1500	510
			Potassium	mg/L	1.66	1.6
			Sodium	mg/L	364	127.8505
			Sulfate	mg/L	286	230.291
			TDS	mg/L	1000	460
		4/20/21	Alkalinity	mg/L	540	280
			Bicarbonate	mg/L	540	280
	7/14/21	Calcium	mg/L	18.9	6.32	
		Chloride	mg/L	17.1	8.7455	
		Conductivity	µmhos/cm	1500	530	
		Sodium	mg/L	376	130.7721	
Sulfate		mg/L	289	66.05		
TDS		mg/L	1000	460		
Alkalinity		mg/L	530	280		
Ammonia		mg/L	0.381	0.2927		
10/20/21	Bicarbonate	mg/L	530	280		
	Calcium	mg/L	21.0	6.32		
	Chloride	mg/L	18.8	8.7455		
	Conductivity	µmhos/cm	1500	530		
	Sodium	mg/L	369	130.7721		
	Sulfate	mg/L	268	66.05		
	TDS	mg/L	970	460		
	Barium	mg/L	0.0075	0.0046		
	Nickel	mg/L	0.04	0.026		
	Alkalinity	mg/L	510	280		
Ammonia	mg/L	0.394	0.2927			
Bicarbonate	mg/L	510	280			
Calcium	mg/L	23.1	6.32			
Chloride	mg/L	20.7	8.7455			
Conductivity	µmhos/cm	1400	530			
Sodium	mg/L	377	130.7721			
Sulfate	mg/L	252	66.05			
TDS	mg/L	1000	460			
Vanadium	mg/L	0.012	0.01			
G-13D	4/21/21	Chloride	mg/L	12.2	8.7455	
		Cobalt	mg/L	0.01	0.005	
	10/20/21	Chloride	mg/L	11.9	8.7455	
Upgradient	G-14D	4/20/21	TOC	mg/L	38	26
		10/19/21	Nitrate	mg/L	0.28	0.21
	G-24D	4/20/21	Barium	mg/L	0.104	0.0046
		10/19/21	None	--	--	--

The trends noted during the first semiannual event are summarized in **Table 7** below and in **Appendix B**. Decreasing trends in the deep wells outnumbered increasing trends during all four

2021 sampling events, including the first quarter sampling event (9 decreasing/1 increasing), second quarter event (27 decreasing/10 increasing), third quarter sampling event (9 decreasing/1 increasing), and fourth quarter sampling event (25 decreasing/9 increasing). Three of the increasing trends were noted in upgradient wells G-14D and G-24D during the fourth quarter event.

Table 7 – Significant Trends, Deep Wells 2021

Well	Date	Significant Trends			
		Second Semiannual 2021		2021 Overall	
		Increasing	Decreasing	Increasing	Decreasing
Downgradient Wells					
G-01D	10/19/21	Ammonia , pH	Bicarbonate, chloride	Ammonia, pH	Bicarbonate, chloride
G-02D	10/19/21	None	Calcium, chloride, conductivity, nitrate, sodium, TDS	Iron	Calcium, chloride, conductivity, nitrate, sodium, TDS
G-06B	10/19/21	Arsenic	Chloride, sulfate	Arsenic	Chloride, sulfate, TDS
G-08D2	10/19/21	pH , arsenic	Chloride	pH, sulfate, arsenic	Chloride
G-09D	7/14/21	Ammonia	Bicarbonate , calcium, arsenic, lead	Ammonia	Bicarbonate, calcium, nitrate, sulfate, TDS, arsenic, lead
	10/20/21	Ammonia	Bicarbonate, calcium, sulfate , TDS		
G-10D	7/14/21	None	Calcium, chloride, magnesium, sulfate, manganese	None	Calcium, chloride, magnesium, sulfate, manganese
	10/20/21	None	Calcium, chloride, magnesium, sulfate, manganese		
G-13D	10/20/21	pH	Sulfate	pH, manganese	Ammonia, sulfate
Upgradient Wells					
G-14D	10/19/21	None	Sulfate	Manganese	Chloride, sulfate
G-24D	10/19/21	Ammonia , pH	None	Ammonia, pH	Chloride

Constituents in **bold** indicate a new trend noted since the previous monitoring period

3.0 SURFACE WATER MONITORING

Snohomish County performed surface water sampling during the second half of 2021 as required by the landfill permit and consistent with the **SAP** and approved Application of Variance.

3.1 SURFACE WATER SAMPLING

Snohomish County field personnel collected surface water samples from five locations on January 12, 2021 and from one location on July 14, 2021 in accordance with the **SAP** procedures. The 2021 surface water analytical results were compared to applicable criteria in **Chapter 173-201A WAC** as summarized **Table 8** below.

Table 8 – Second Semiannual 2021 Surface Water Analytical Results

Parameter	Units	Criteria	CC-A1	CC-B1	CC-D	CC-F	CC-NSDP
Date	--	--	1/12/21	1/12/21	1/12/21	1/12/21	1/12/21
Coliform	(CFU/100 mL)	200	150	61	--	160	12
Conductivity	µmhos/cm	--	87	93	--	93	130
Nitrate N	mg/L	--	2.0	1.7	--	1.8	0.43
pH	std units	5.5-6.5	6.86	6.87	--	6.85	6.69
Parameter	Units	Criteria	CC-A1	CC-B1	CC-D	CC-F	CC-NSDP
Date	--	--	7/14/21	7/14/21	7/14/21	7/14/21	7/14/21
Coliform	(CFU/100 mL)	200	--	--	--	--	50
Conductivity	µmhos/cm	--	--	--	--	--	300
Nitrate N	mg/L	--	--	--	--	--	ND<0.01
pH	std units	5.5-6.5	--	--	--	--	6.35

NS = Not sampled - location dry; ND = not detected; Values in **bold** exceed the listed water quality criteria

Four of the five pH concentrations detected during the 2021 surface water sampling events slightly exceeded the surface water quality criteria. None of the fecal coliform concentrations exceeded the surface water quality criteria during the 2021 surface water sampling events.

4.0 LANDFILL GAS MONITORING

During the second semiannual sampling events, landfill gas readings were collected from eight gas probes in accordance with the *SAP (Landau 2006)* on August 18 and October 6, 2021. Landfill gas readings were also collected from seven vaults, six barhole probes, and two lift station vaults on those dates. The 2021 landfill gas monitoring results are summarized in separate quarterly letter reports to SHD and on the field sheets in **Appendix D**.

As shown on the field sheets, no detectable methane concentrations were detected from any of the monitoring points during 2021.

5.0 LEACHATE MONITORING

Cathcart Sanitary Landfill is authorized under City of Everett Industrial Waste Discharge Permit #7701-17 to discharge pretreated industrial wastewater (*landfill leachate and vector liquid*

wastes) to the City of Everett sewer system via connection through the Silver Lake Water and Sewage District sewer.

As shown on the pretreatment system flow diagram (**Figure 7**), landfill leachate and condensate drains to a pump station (*designated SP-1*), from which the leachate and condensate are pumped to a grit chamber and combined with groundwater from the landfill underdrain system to pump station SP-1. The combined leachate and groundwater is then pumped through a flow meter vault (*designated P-FV-2*), where the total daily flow is measured using an electromagnetic flow meter (*mag meter*). The flow is then discharged into either of two pretreatment lagoons. The lagoons are constructed of concrete equipped with underdrain systems that are connected to leak detection vaults (*designated P-MH-3 and P-MH-4*), which are monitored monthly for the presence of liquid, which could indicate a leak from the lagoons. A total of 16 manholes and vaults within the leachate collection system are monitored monthly for the presence of excess sediment (*or fluid, in the case of leak detection vaults*) and maintenance issues. The completed inspection forms are included in **Appendix D**. No fluid was observed in either of the leak detection vaults during 2021.

The maximum design capacity of each lagoon is approximately 2.5 million gallons. Combined leachate and vector liquid is treated in one or both of the leachate collection lagoons by settlement and aeration. Each lagoon has two aerators installed, which operate hourly for 15 minutes. The aerated liquid is then routed via a sampling vault (*P-MH-9*) to a discharge point to the sewer. Liquid samples are collected from P-MH-9 on a monthly basis and the results are summarized in a monthly report, which is submitted to the City of Everett per the IWDP permit.

During 2021, a total of 3,493,100 gallons of landfill leachate were pumped to the pretreatment lagoons for treatment and eventual discharge to the sewer. Leachate was pumped to the pretreatment lagoons at an average rate of 291,092 gallons per month, which varied from 17,100 gallons in August to 1,353,900 gallons in March. Overall, the rate of leachate production and flow correlates with seasonal rainfall totals. The leachate flow totals are included in **Table 9** below.

Table 9 – Cathcart Landfill Leachate Flow Totals, 2021

Month	Total (gallons)
January	644,600
February	458,700
March	1,353,900
April	171,200
May	106,900
June	43,400
July	25,500
August	17,100
September	17,800
October	36,800

Table 9 – Cathcart Landfill Leachate Flow Totals, 2021

Month	Total (gallons)
November	272,200
December	345,000
Maximum:	1,353,900
Minimum:	17,100
Monthly Average:	291,092
2021 Total:	3,493,100

5.1 LEACHATE SAMPLING

On January 26, 2021, Snohomish County Solid Waste personnel collected annual samples from the leachate pump station vaults designated SP-1 and SP-4 to characterize leachate from above (*SP-1*) and below (*SP-4*) the landfill liner. The leachate samples were analyzed for the following constituents:

- pH by USEPA Method 150.2
- Biological oxygen demand (*BOD*) by Method SM 5210B
- Conductivity by Method SM 2510B
- Total cyanide by USEPA Method 335.4
- Oil and Grease (*HEM*) by USEPA Method 1664 HEM
- Total Petroleum Hydrocarbons (*Polar/Non-Polar*) by USEPA Method 1664 SGT-HEM
- Total Suspended Solids (*TSS*) by Method SM 2540D
- Flashpoint by USEPA Method 1020
- Metals by USEPA Method 200.7/200.8/245.1, including:
 - Arsenic
 - Cadmium
 - Chromium
 - Copper
 - Mercury
 - Lead
 - Nickel
 - Silver
 - Zinc

In addition, the sample from vault SP-1 was analyzed for the standard groundwater constituent suite and priority pollutants, which included:

- Total Cyanide by SM 4500CN-E99
- Total Phenol by EPA Method 420.4
- Metals by USEPA Methods 200.7/200.8, including the above-listed metals and:
 - Antimony
 - Barium

- Beryllium
- Cobalt
- Iron
- Manganese
- Selenium
- Thallium
- Vanadium
- VOCs by USEPA Method 8260/8260 SIM/624
- Semivolatile Organic Compounds (SVOCs) by USEPA Method 625/625-SIM
- Polynuclear Aromatic Hydrocarbons (PAHs) by USEPA Method 625-SIM
- Organochlorine Pesticides (OCPs) by USEPA Method 608
- Polychlorinated Biphenyls (PCBs) by USEPA Method 608

Tabulated summaries of the leachate vault sample analytical results are included below as **Tables 10 through 13**. Only constituents that were detected are shown in the tables; none of the leachate vault samples collected during the current monitoring year contained detectable concentrations of PAHs, OPPs, or PCBs.

Table 10 – Leachate Vault Results – Inorganics

Location ID	Date	pH	BOD	Conductivity	Oil & Grease	TSS
Units		std. units	mg/L	µmhos/cm	mg/L	mg/L
SP-1	1/26/21	6.52	26	1300	5.2	110
SP-4	1/26/21	6.64	6.4	660	ND<5	8.0

ND = Not detected at the indicated detection limit

Table 11 – Leachate Vault Results – Metals

Location ID	Date	Antimony	Arsenic	Barium	Chromium	Iron	Lead	Mercury	Manganese	Zinc
Units		µg/L	mg/L	mg/L	mg/L	mg/L	µg/L	µg/L	mg/L	mg/L
SP-1	1/26/21	0.39	0.0044	0.32	0.0103	75.4	0.35	0.00031	0.838	0.0392
SP-4	1/26/21	--	ND<0.005	--	ND<0.01	--	ND<0.01	0.00017	--	0.0179

-- = not analyzed; ND = Not detected at the indicated detection limit

Table 12 – Leachate Vault Results – VOCs

Location ID	Date	1,4-Dichlorobenzene	Acetone	Benzene	Chlorobenzene
Units		µg/L	µg/L	µg/L	µg/L
SP-1	1/26/21	1.9	5.9	1.2	1.65
SP-4	1/26/21	--	--	--	--

-- = not analyzed

Table 13 – Leachate Vault Results – SVOCs

Location ID	Date	bis(2-Ethylhexyl) phthalate	Diethyl phthalate	Di-n-butyl phthalate	2-Methyl naphthalene	Acenaphthene	Fluorine	Naphthalene
Units		µg/L	µg/L	µg/L	µg/L	µg/L	µg/L	µg/L
SP-1	1/26/21	0.68	0.31	0.2	0.32	0.17	0.12	0.39
SP-4	1/26/21	--	--	--	--	--	--	--

-- = not analyzed

6.0 SUMMARY AND RECOMMENDATIONS

6.1 SUMMARY

The groundwater, surface water, leachate, and landfill gas monitoring data collected during the 2021 monitoring events indicate the following:

- The groundwater elevations, flow direction, and gradient measured during the 2021 semiannual monitoring events were generally consistent with those measured historically at the site.
- The most common groundwater standard exceedances were pH, sodium, and arsenic, which is consistent with historical site data.
- The majority of statistical limit exceedances in the shallow zone were noted in wells G-09S and G-10S, which is consistent with recent historical data. No statistical exceedances were noted in shallow wells G-01A, G-11S, G-14S, and G-24S during one or more 2021 monitoring events.
- Overall, significantly more decreasing trends were noted in both zones during all four monitoring events (*72 decreasing/40 increasing trends in the shallow zone, and 70 decreasing/21 increasing trends in the deep zone*).
- Most decreasing concentration trends noted in the shallow and deep zones during the second and fourth quarters occurred in downgradient wells – 33 of 46 decreasing trends in shallow downgradient wells and 48 of 52 decreasing trends in deep downgradient wells. Two of the increasing trends noted during the second quarter and fourth quarter occurred in upgradient wells G-14D and G-24D.
- VOC concentrations were limited to the wells located immediately downgradient of the landfill (*G-09S, G-09D, G-10S, and G-10D*). Low concentrations of vinyl chloride were detected in the second, third, and fourth quarter samples from deep well G-09D. Two other VOCs (*cis-1,2-DCE and/or 1,2-DCP*) were also present in one or more of these wells during the first, third, and fourth quarter 2021 monitoring events. These detections are consistent with recent results at these wells.
- Slight exceedances of the surface water quality goals for pH were noted in 4 of the 5 surface water samples collected during 2021. None of the surface water fecal coliform concentrations exceeded the quality goal of 200 CFU/100 mL.
- The monitoring results at the perimeter gas probe locations, vaults, and manholes and did not indicate the presence of detectable concentrations of landfill gas during 2021.
- Landfill settlement surveys were discontinued in 2019 after six years of annual measurements. During the previous six years, no significant settlement was noted across the landfill mass that exceeded tolerance levels established in the Department of Ecology's Uniform Guidance document.

6.2 CONCLUSIONS/RECOMMENDATIONS

- The groundwater elevation data and fluctuations with seasonal rainfall totals (*as shown on the hydrographs in Appendix A*) suggest that the shallow and deep groundwater zones are hydraulically continuous and may in fact represent one complex water-bearing zone.
- There is no indication of groundwater impacts extending beyond the site boundaries of the Cathcart Landfill.
- The analytical data indicate that there is likely a leachate impact in monitoring wells G-09S, G-09D, G-10S, and G-10D.
- In accordance with the SAP and the approved variance, Snohomish County Solid Waste will continue to monitor groundwater and surface water semiannually.
- Landfill gas will continue to be monitored quarterly until the stratigraphy and hydrogeology of the site are evaluated for landfill gas migration potential. The data from probe GP-6 confirms that landfill gas is not migrating near the northwest perimeter of the landfill.
- Leachate production was similar to previous years and corresponded to rainfall totals at the landfill. There was no indication of leachate leakage based on the monthly vault inspections.
- The leachate analytical results for 2021 were similar to previous years and indicated the presence of low concentrations of metals, VOCs, and SVOCs/PAHs.

6.4 SIGNATURES AND LICENSES



Brian K. Eytcheson, LG
SCPW – Solid Waste Division

3/10/22





Date



BRIAN K. EYTCHESON

Figures




Cathcart Landfill Vicinity Map

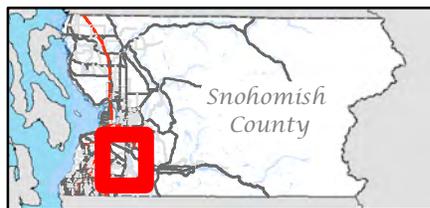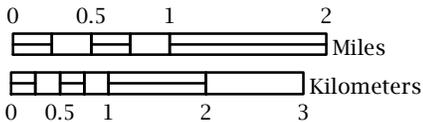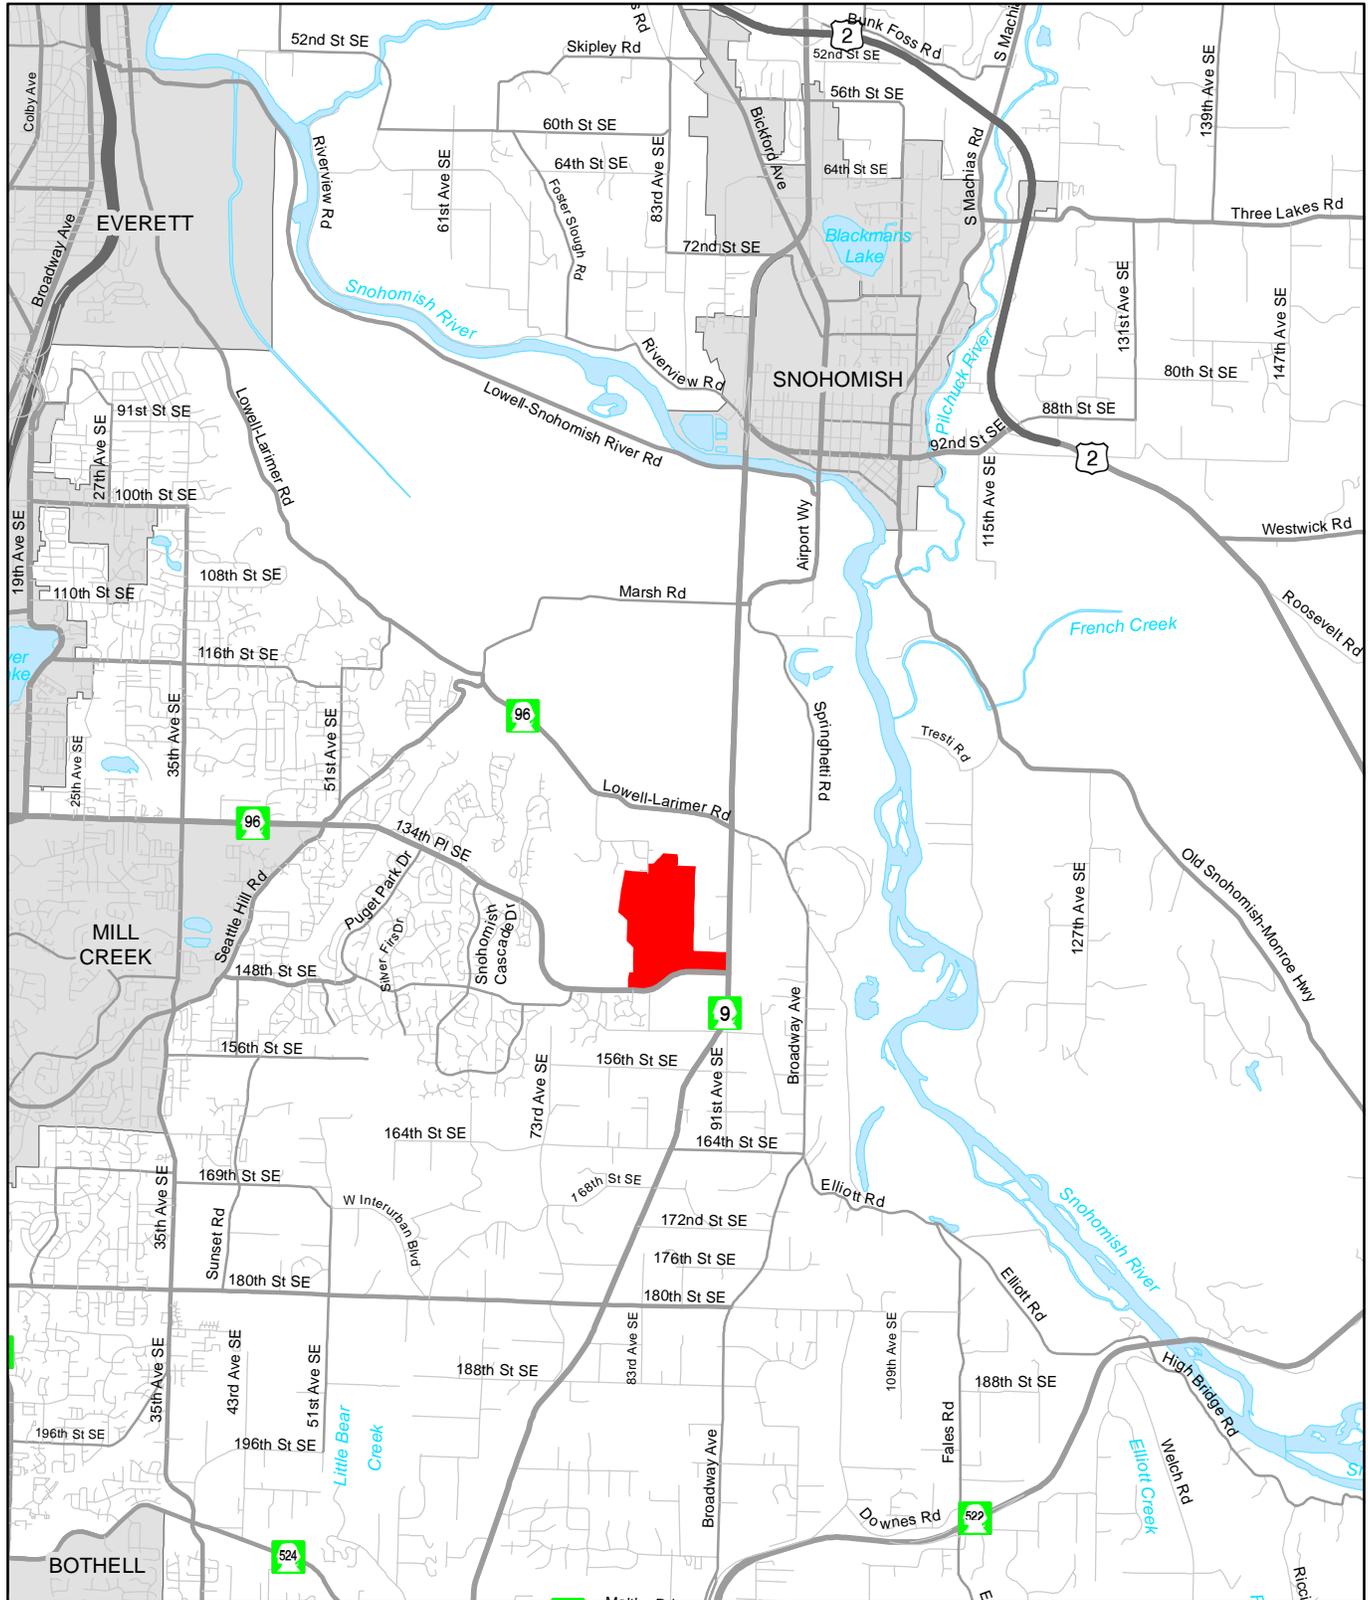


Snohomish County
Public Works
Solid Waste Division
March 16, 2010

Snohomish County disclaims any warranty of merchantability or warranty of fitness of this map for any particular purpose, either express or implied. No representation or warranty is made concerning the accuracy, currency, completeness or quality of data depicted on this map. Any use of this map assumes all responsibility for use thereof, and further agrees to hold Snohomish County harmless from and against any damage, loss, or liability arising from any use of this map.

Cathcart Landfill Site Map

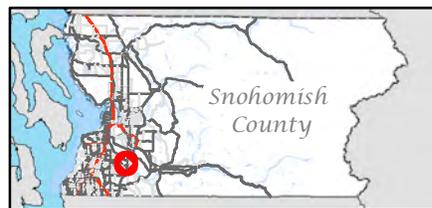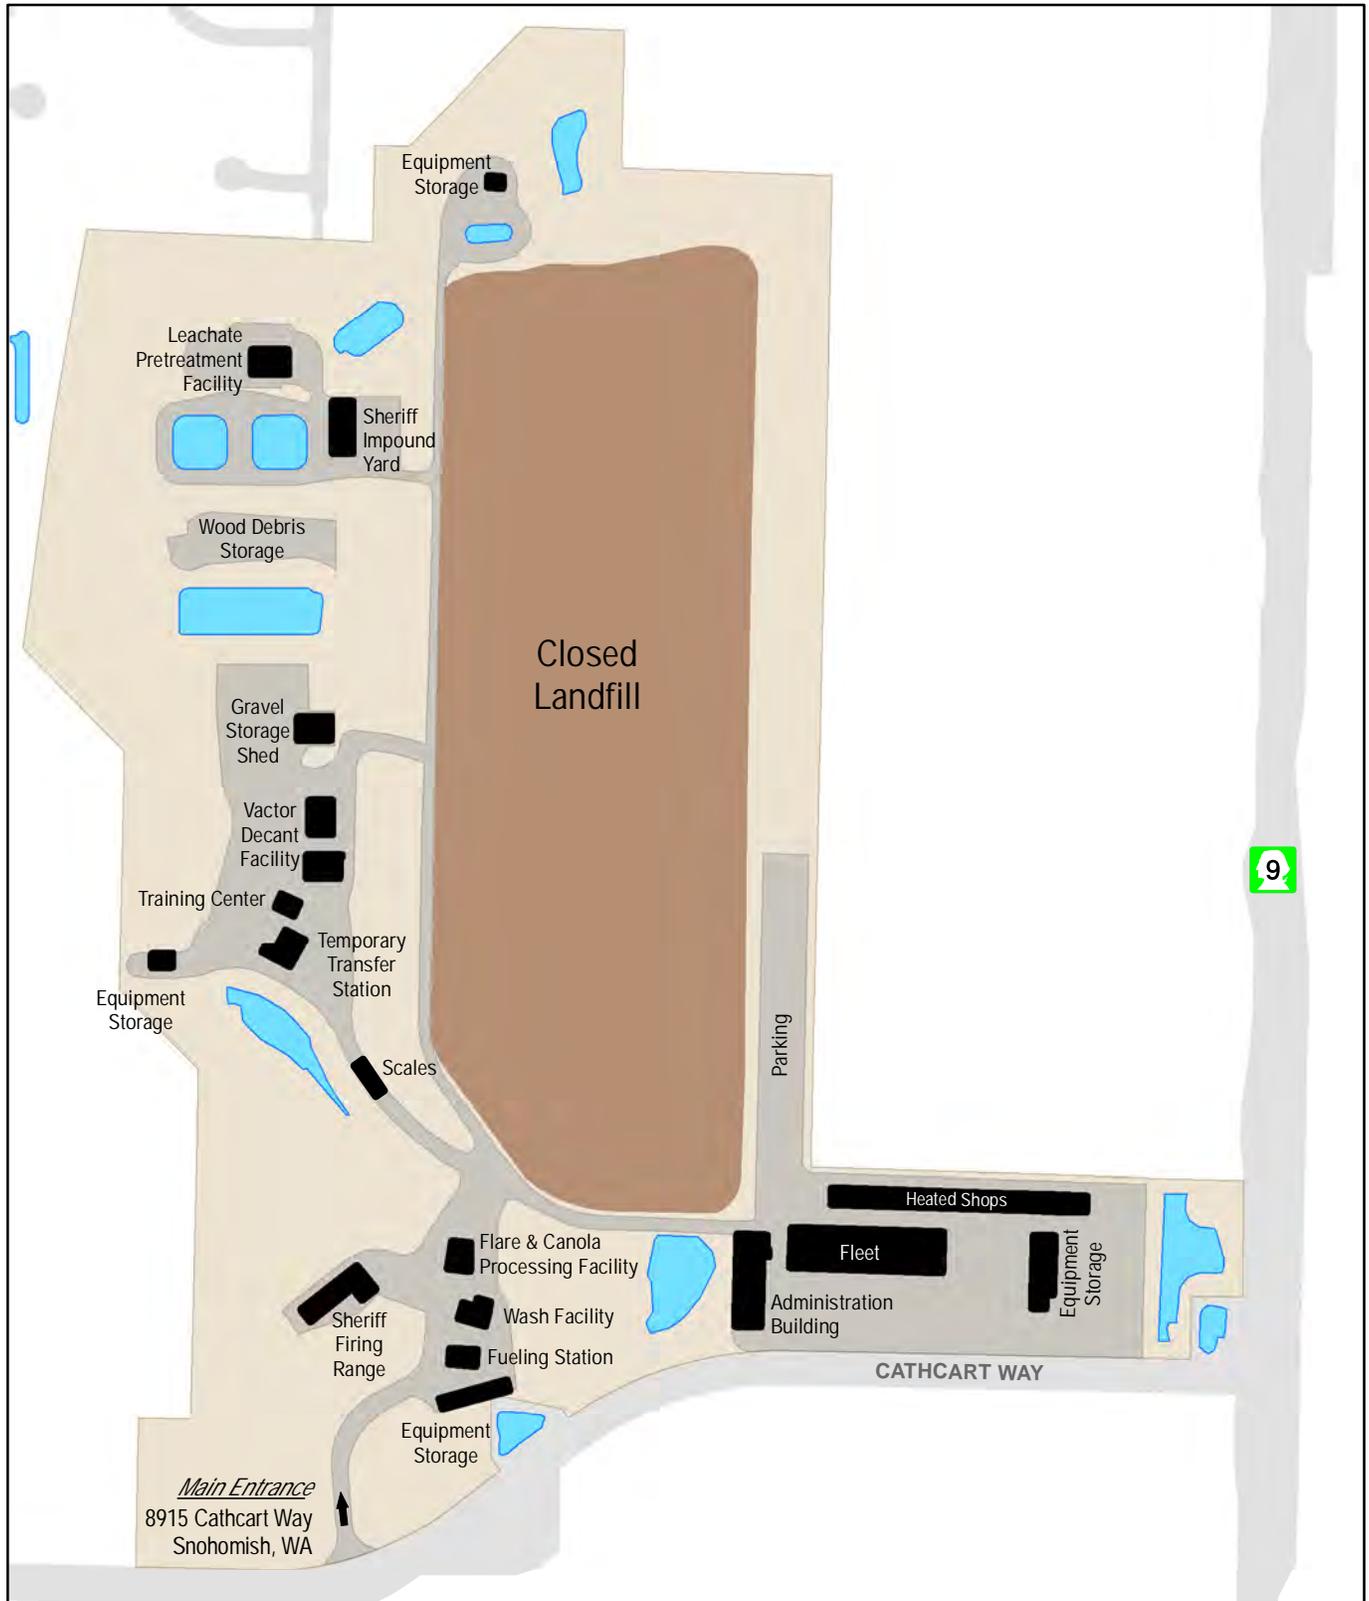


Snohomish County
Public Works
Solid Waste Division
March 16, 2010

Snohomish County disclaims any warranty of merchantability or warranty of fitness of this map for any particular purpose, either express or implied. No representation or warranty is made concerning the accuracy, currency, completeness or quality of data depicted on this map. Any use of the map assumes all responsibility for use thereof, and further agrees to hold Snohomish County harmless from and against any damage, loss, or liability arising from any use of this map.


Figure 3

Cathcart Landfill Topography





Map Features

-  Parcel Boundary
-  Subject Property Boundary
-  5 Foot Contours



1 inch = 350 feet

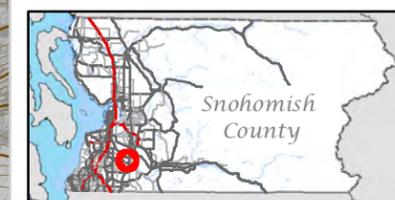



Snohomish County
Public Works
Solid Waste Division
March 24, 2010

Snohomish County disclaims any warranty of merchantability or warranty of fitness of this map for any particular purpose, either express or implied. No representation or warranty is made concerning the accuracy, currency, completeness or quality of data depicted on this map. Any user of this map assumes all responsibility for use thereof, and further agrees to hold Snohomish County harmless from and against any damage, loss, or liability arising from any use of this map.

Figure 4

Cathcart Landfill Geologic Map

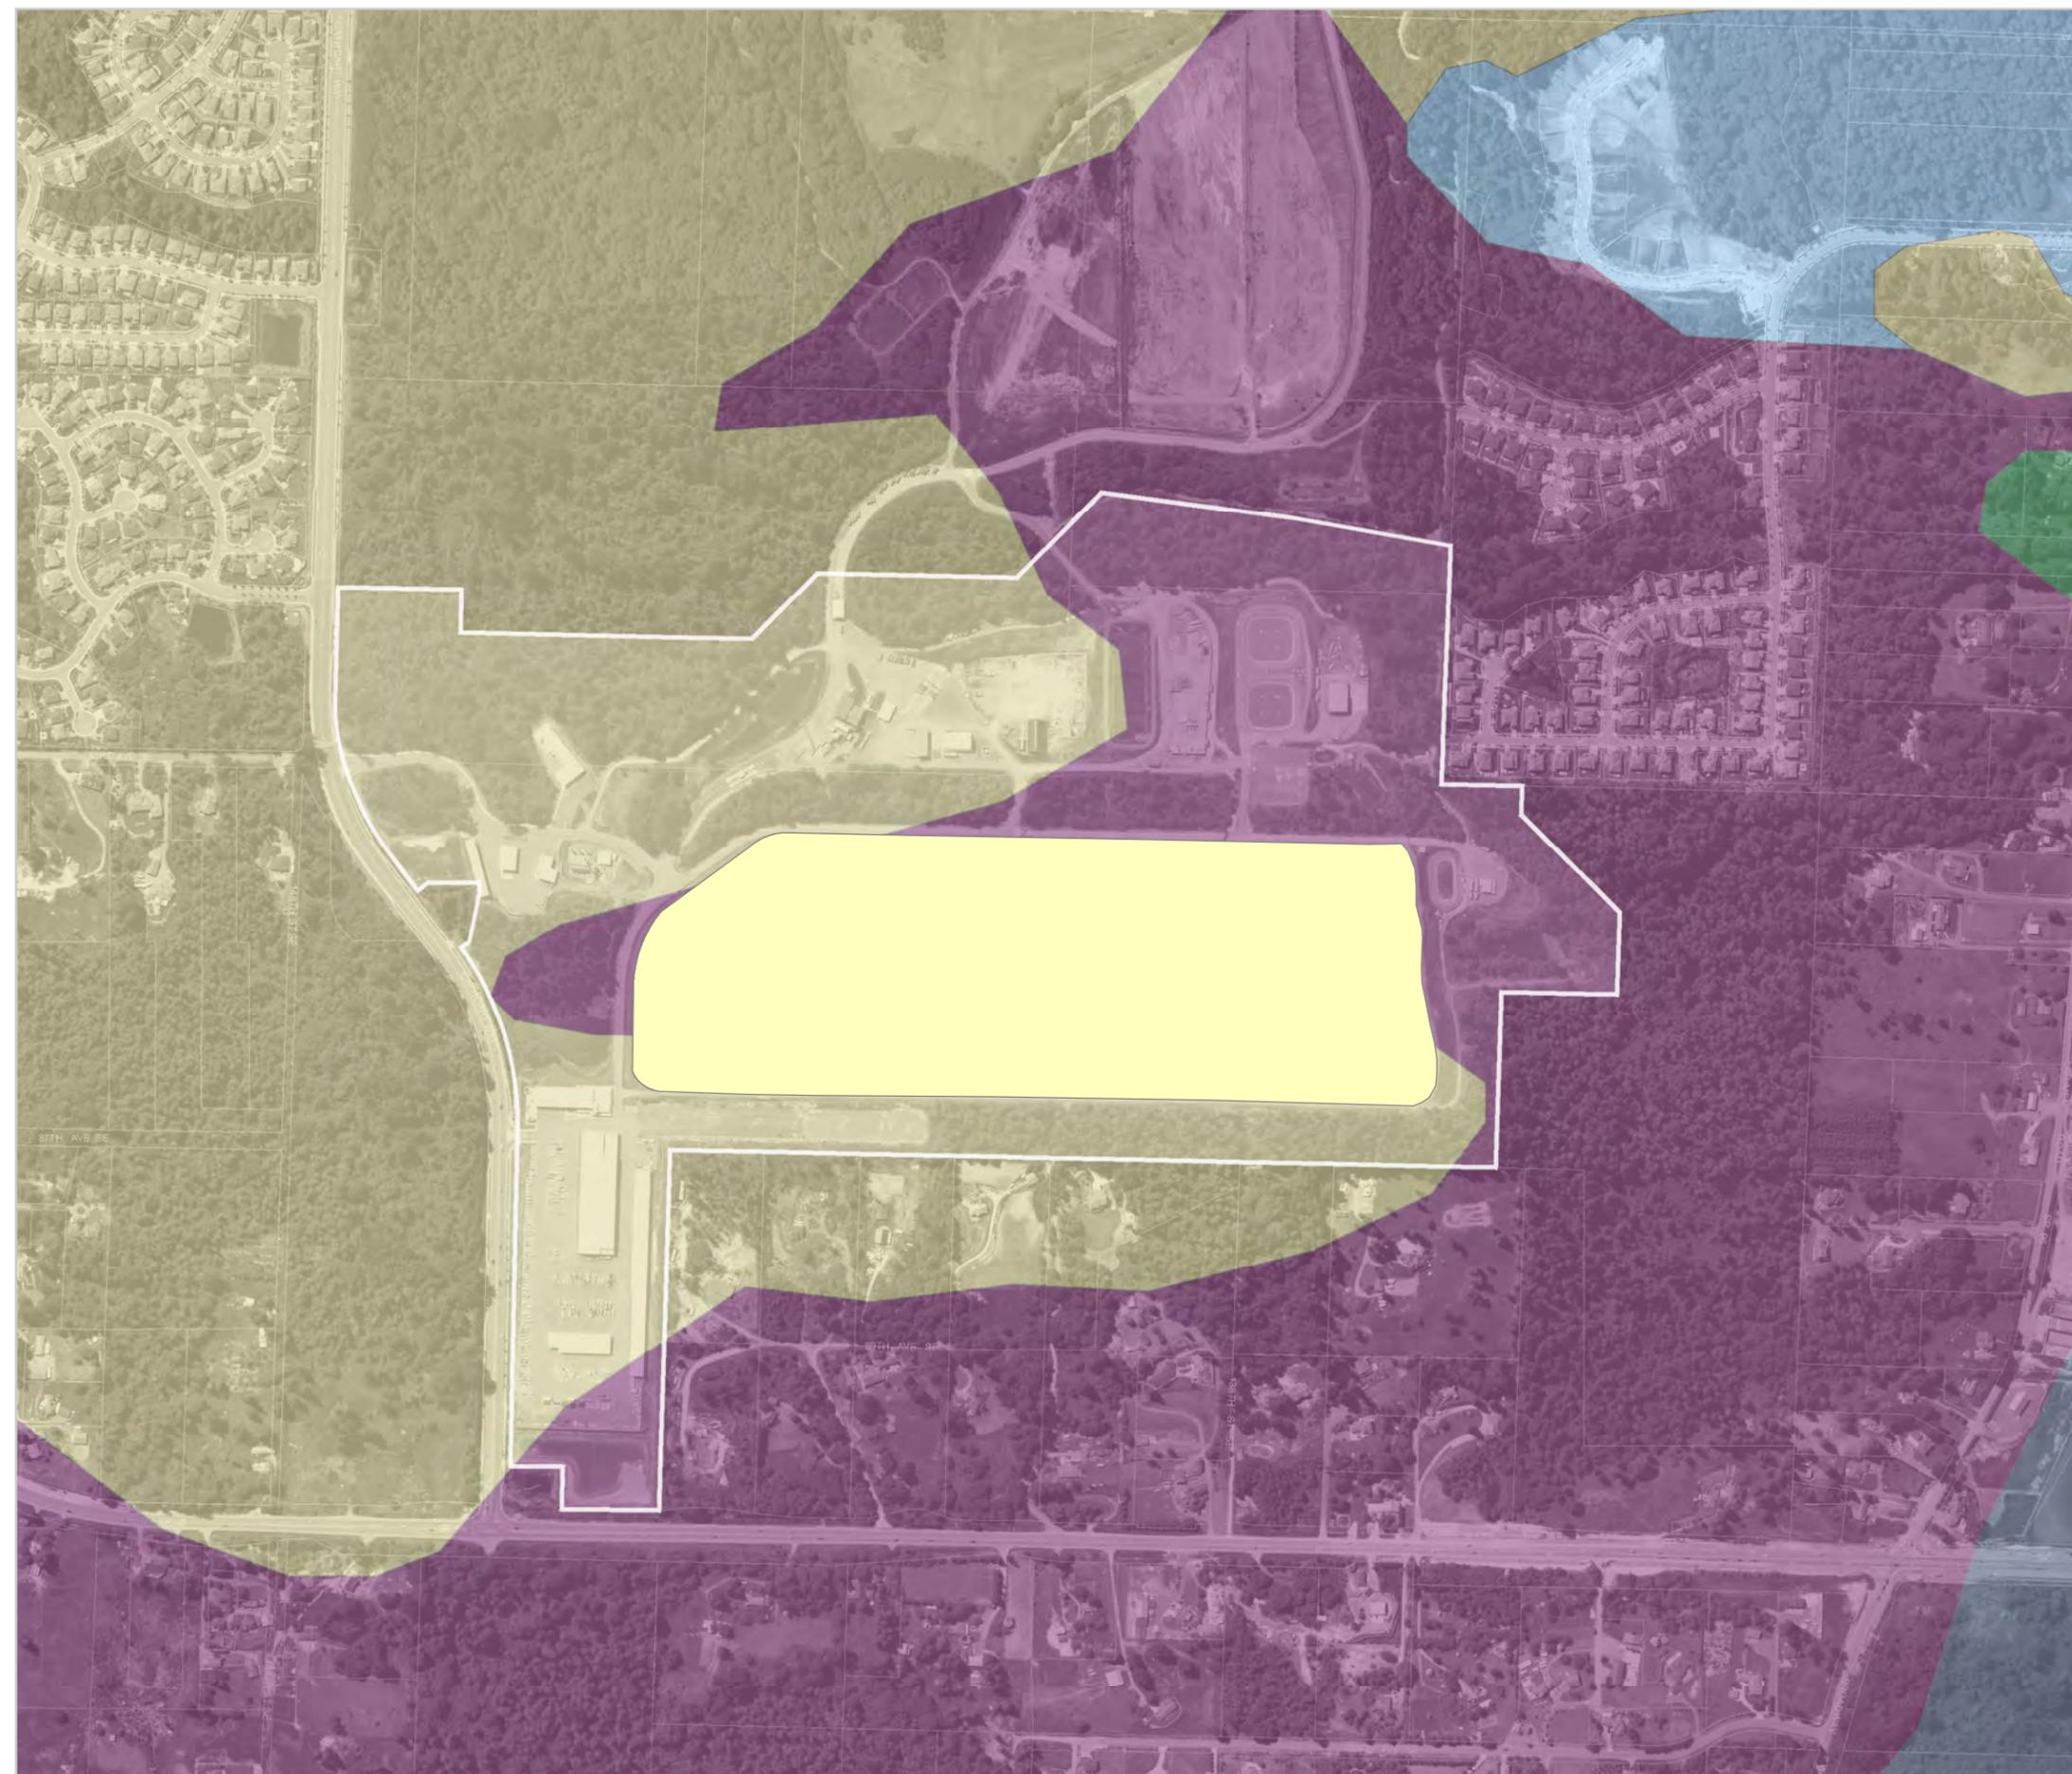


Map Features

-  Parcel Boundary
-  Subject Property Boundary

Geologic Description

-  Recent Alluvium (Qyal)
-  Vashon Recessional Outwash (Qvr)
-  Vashon Glacial Till (Qvt)
-  Vashon Advance Outwash (Qva)
-  Transitional Beds (Qtb)
-  Modified Land



1 inch = 600 feet


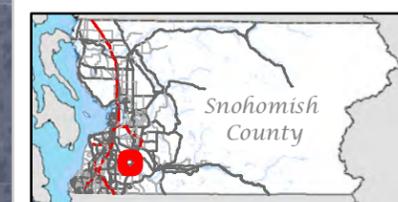


Figure 5

Cathcart Landfill Monitoring Network

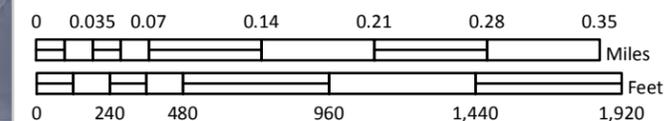

Map Features

- Parcel Boundary
- Subject Property Boundary

Aquifer Unit (Active Wells)



- Deep Aquifer
- Shallow Aquifer

Inactive / Removed Wells

- Abandoned / Decommissioned
- Inactive

Additional Sampling Points


- Gas Probe
- Surface Water Sample Locations

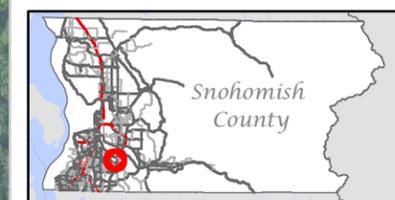


All maps, data, and information set forth herein ("Data"), are for illustrative purposes only and are not to be considered an official citation to, or representation of, the Snohomish County Code. Amendments and updates to the Data, together with other applicable County Code provisions, may apply which are not depicted herein. Snohomish County makes no representation or warranty concerning the content, accuracy, currency, completeness or quality of the Data contained herein and expressly disclaims any warranty of merchantability or fitness for any particular purpose. All persons accessing or otherwise using this Data assume all responsibility for use thereof and agree to hold Snohomish County harmless from and against any damages, loss, claim or liability arising out of any error, defect or omission contained within said Data. Washington State Law, Ch. 42.56 RCW, prohibits state and local agencies from providing access to lists of individuals intended for use for commercial purposes and, thus, no commercial use may be made of any Data comprising lists of individuals contained herein.

Figure 5a

Cathcart Landfill Monitoring Network

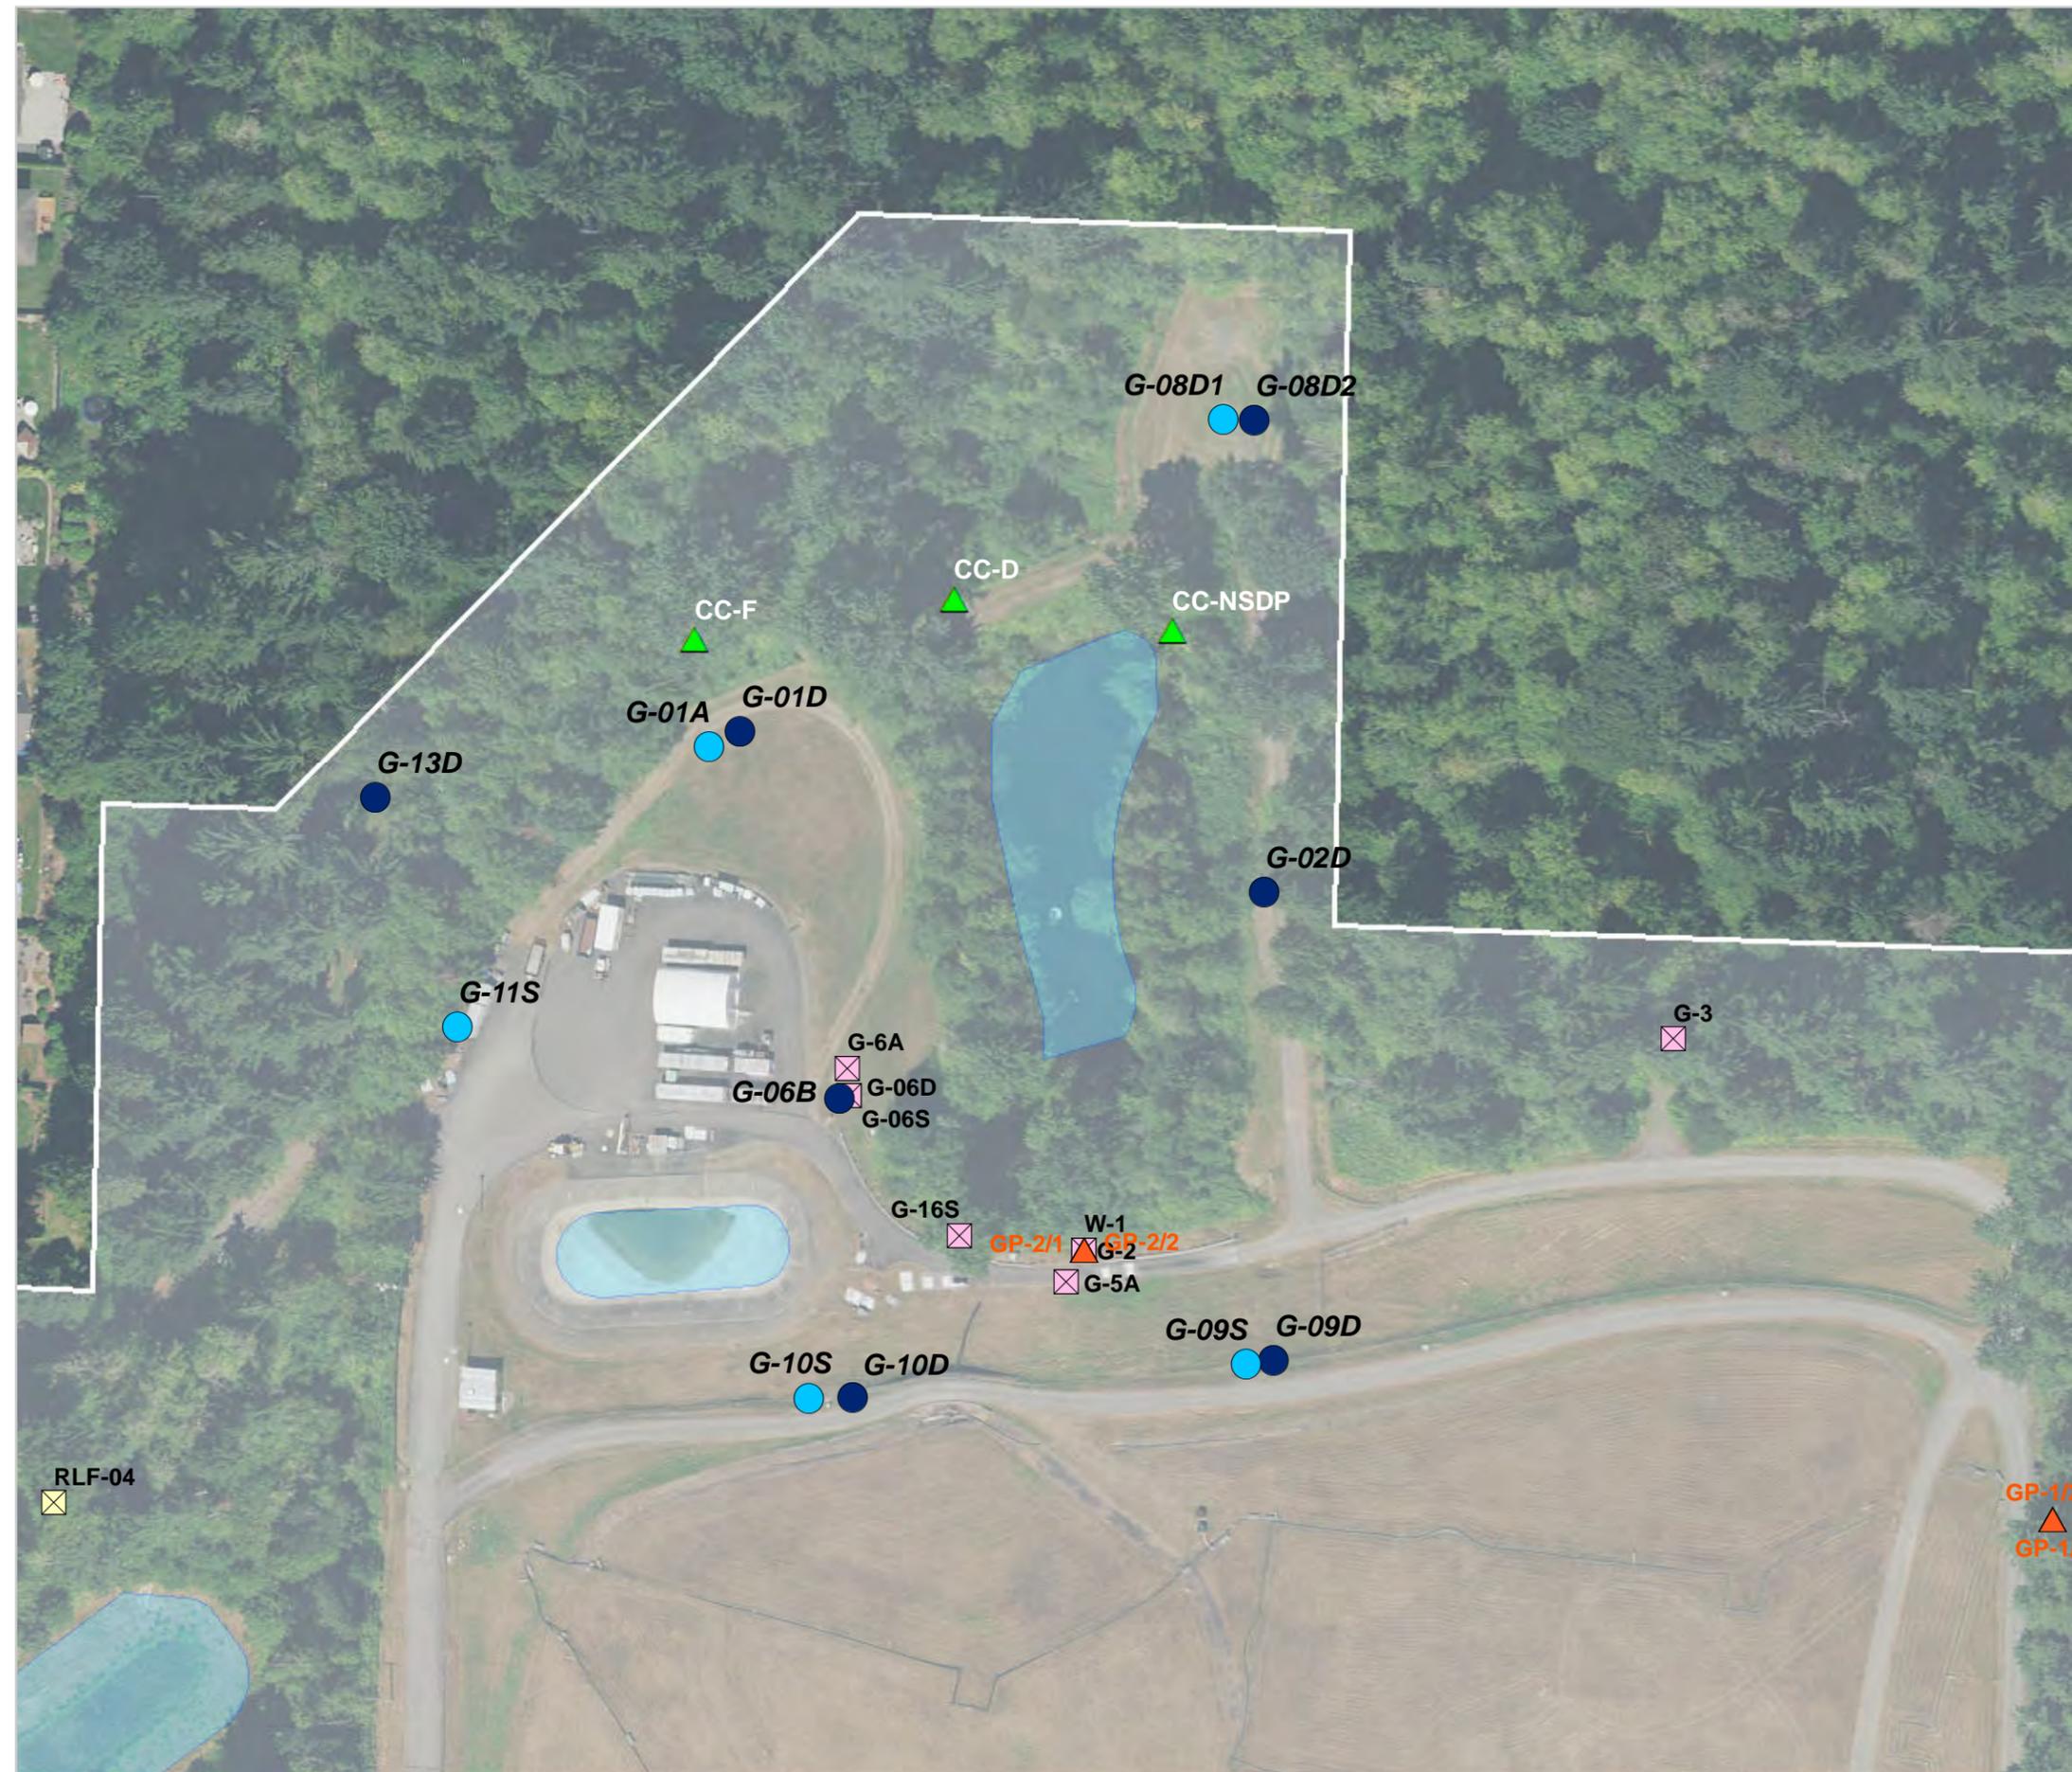

Map Features

-  Parcel Boundary
-  Subject Property Boundary

Aquifer Unit (Active Wells)



-  Deep Aquifer
-  Shallow Aquifer

Inactive / Removed Wells

-  Abandoned / Decommissioned
-  Inactive

Additional Sampling Points

-  Gas Probe
-  Water Sample Locations

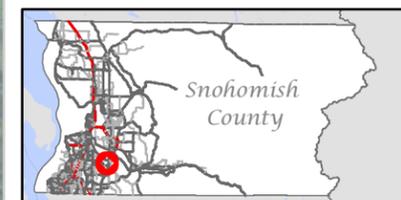

All maps, data, and information set forth herein ("Data"), are for illustrative purposes only and are not to be considered an official citation to, or representation of, the Snohomish County Code. Amendments and updates to the Data, together with other applicable County Code provisions, may apply which are not depicted herein. Snohomish County makes no representation or warranty concerning the content, accuracy, currency, completeness or quality of the Data contained herein and expressly disclaims any warranty of merchantability or fitness for any particular purpose. All persons accessing or otherwise using this Data assume all responsibility for use thereof and agree to hold Snohomish County harmless from and against any damages, loss, claim or liability arising out of any error, defect or omission contained within said Data. Washington State Law, Ch. 42.56 RCW, prohibits state and local agencies from providing access to lists of individuals intended for use for commercial purposes and, thus, no commercial use may be made of any Data comprising lists of individuals contained herein.

Figure 6a




Cathcart Landfill

Shallow Aquifer
Groundwater Elevation Contours
Second Quarter 2021

 DIRECTION OF GROUNDWATER FLOW
0.000461 ft / day
0.168 ft / year
143.18 degrees to the positive x - axis

-  PARCEL BOUNDARY
-  SUBJECT PROPERTY BOUNDARY
-  5 FT CONTOUR
-  WELL LOCATION


WELL_ID	SAMP_DATE	MEAS_HEAD
G-01A	4/20/2021	218.83
G-08D1	4/20/2021	198.30
G-09S	4/20/2021	243.18
G-10S	4/20/2021	243.60
G-11S	4/20/2021	229.80
G-14S	4/20/2021	319.35
G-24S	4/20/2021	307.43

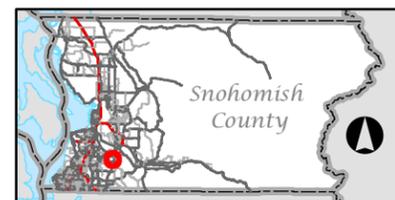

All maps, data, and information set forth herein ("Data"), are for illustrative purposes only and are not to be considered an official citation to, or representation of, the Snohomish County Code. Amendments and updates to the Data, together with other applicable County Code provisions, may apply which are not depicted herein. Snohomish County makes no representation or warranty concerning the content, accuracy, currency, completeness or quality of the Data contained herein and expressly disclaims any warranty of merchantability or fitness for any particular purpose. All persons accessing or otherwise using this Data assume all responsibility for use thereof and agree to hold Snohomish County harmless from and against any damages, loss, claim or liability arising out of any error, defect or omission contained within said Data. Washington State Law, Ch. 42.56 RCW, prohibits state and local agencies from providing access to lists of individuals intended for use for commercial purposes and, thus, no commercial use may be made of any Data comprising lists of individuals contained herein.

Figure 6b
Cathcart Landfill



Deep Aquifer
 Groundwater Elevation Contours
 Second Quarter 2021

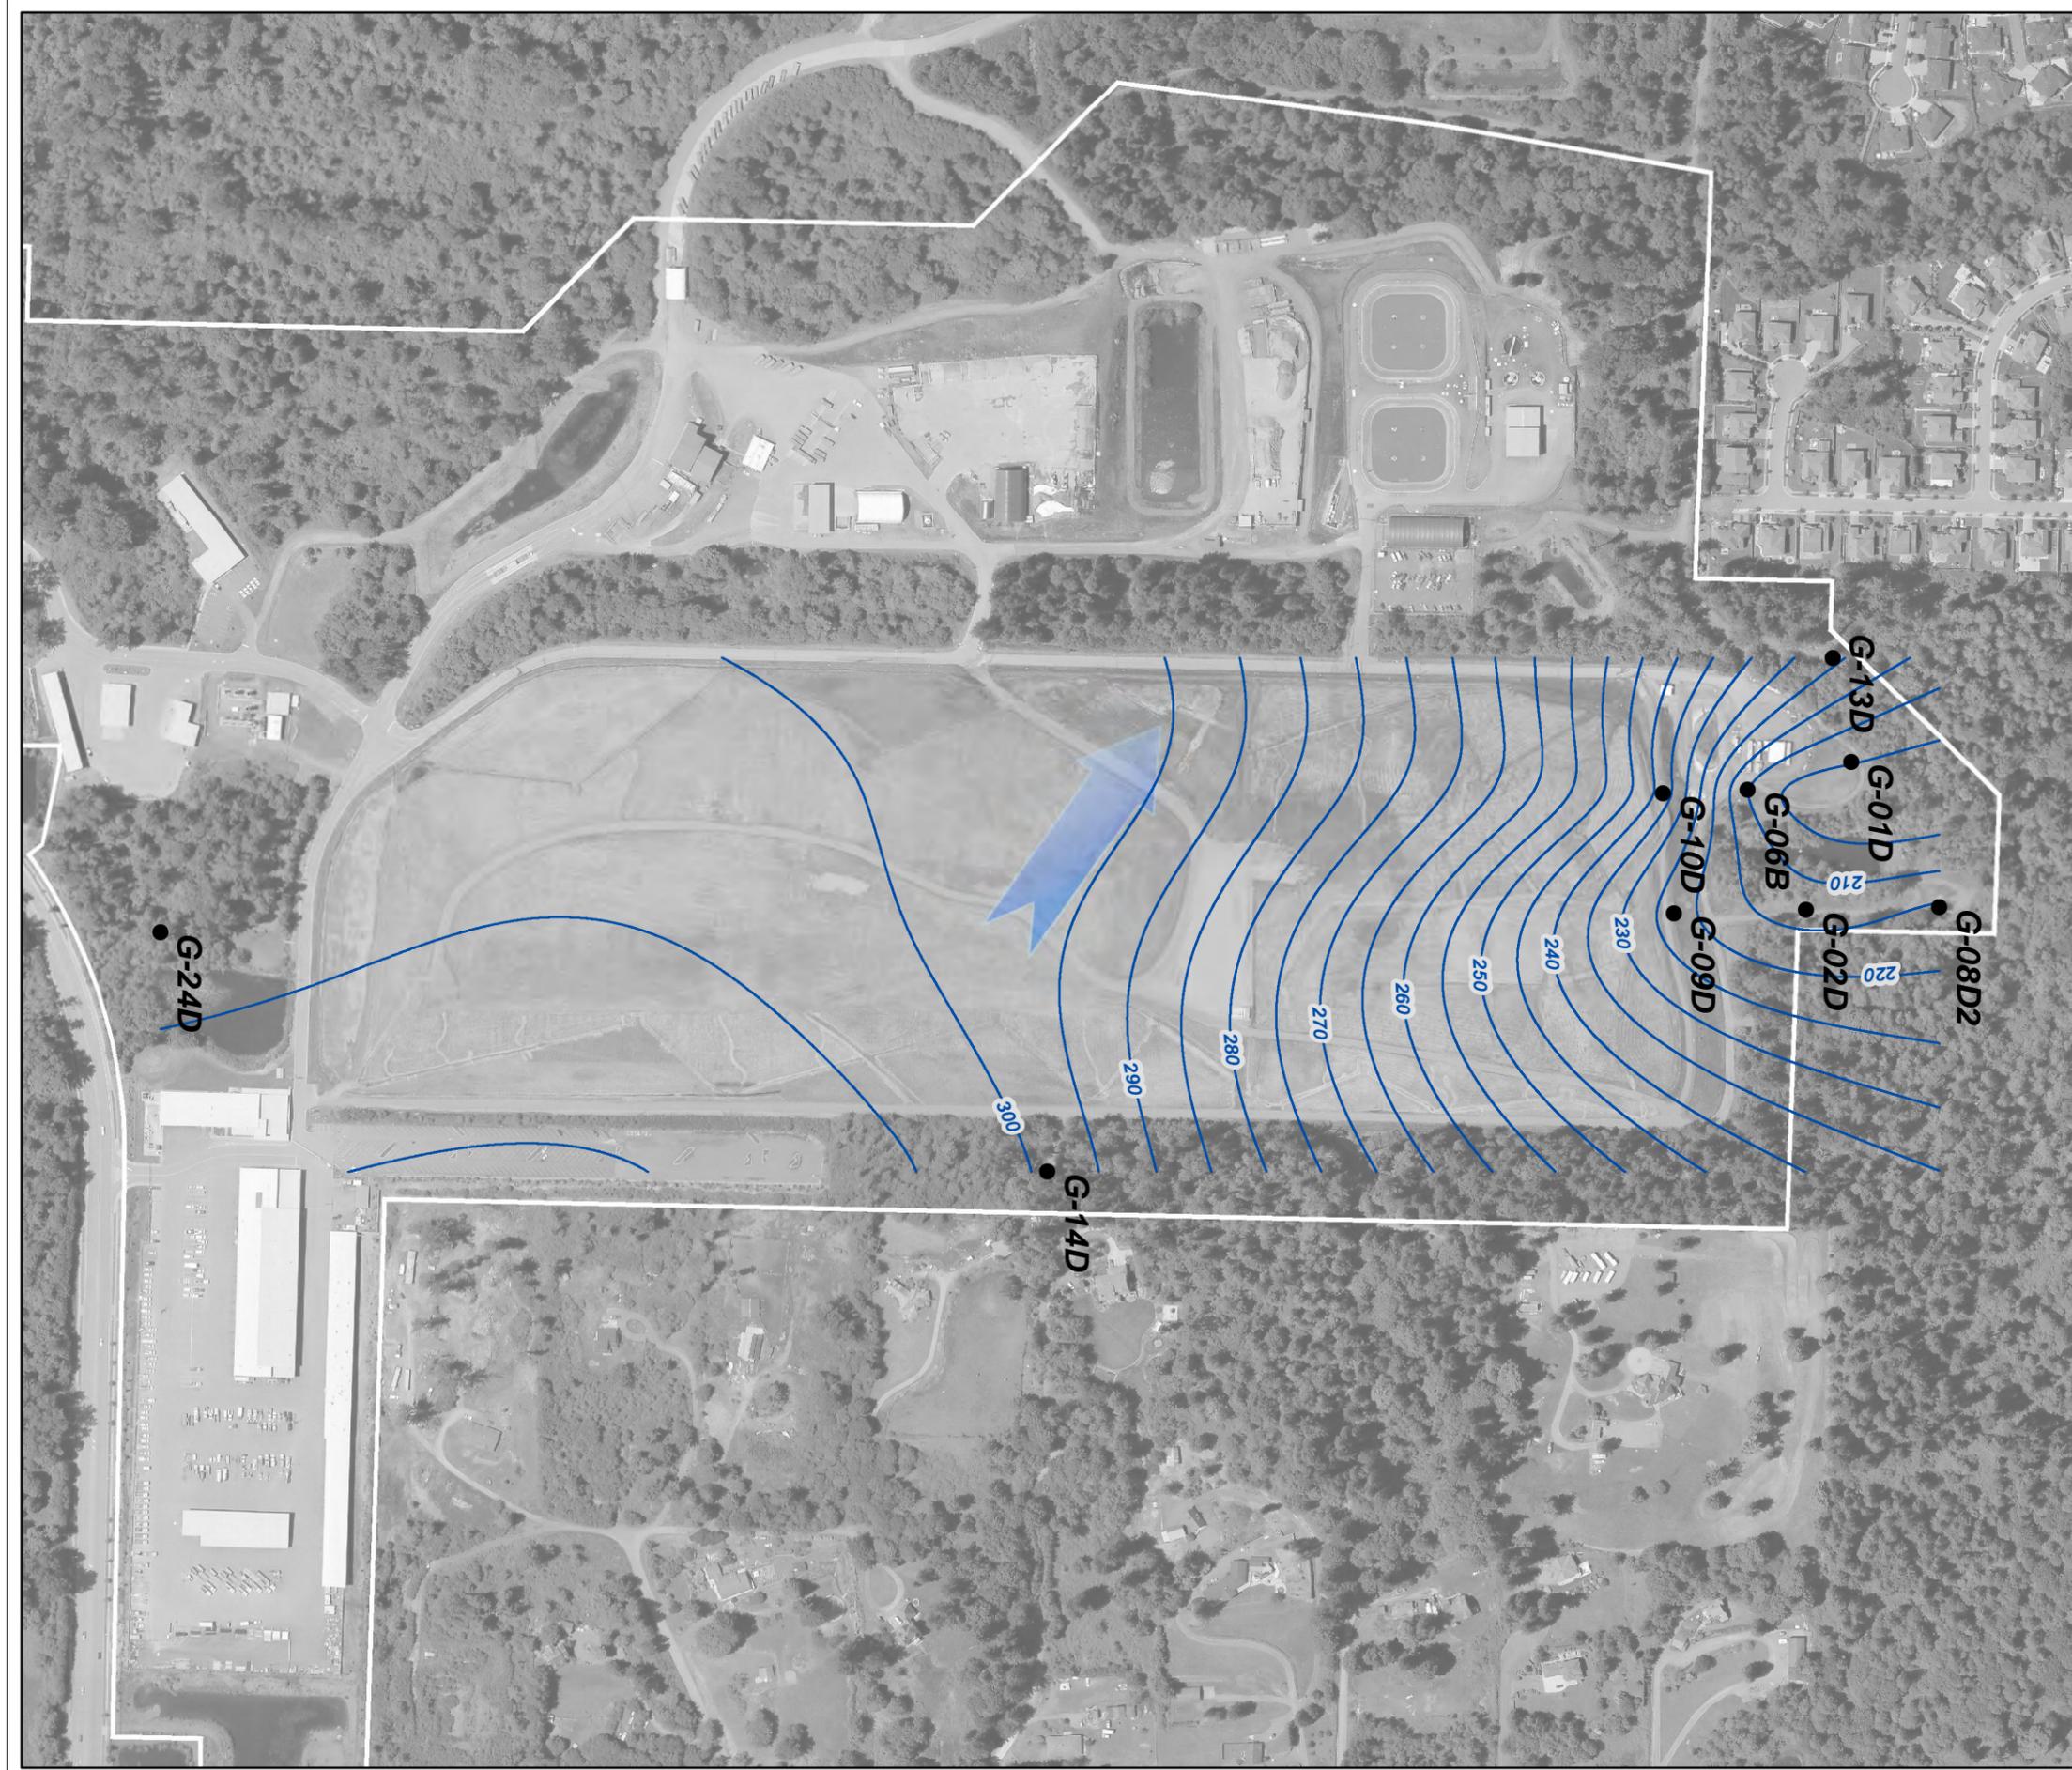

 DIRECTION OF GROUNDWATER FLOW
 0.0116 ft / day
 4.25 ft / year
 137.98 degrees to the positive x - axis

-  PARCEL BOUNDARY
-  SUBJECT PROPERTY BOUNDARY
-  5 FT CONTOUR
-  WELL LOCATION

WELL_ID	SAMP_DATE	MEAS_HEAD
G-01D	4/20/2021	205.38
G-02D	4/20/2021	212.86
G-06B	4/20/2021	210.15
G-08D2	4/20/2021	215.58
G-09D	4/20/2021	222.69
G-10D	4/20/2021	237.50
G-13D	4/20/2021	221.13
G-14D	4/20/2021	298.95
G-24D	4/20/2021	302.41

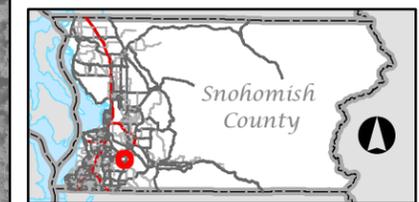

All maps, data, and information set forth herein ("Data"), are for illustrative purposes only and are not to be considered an official citation to, or representation of, the Snohomish County Code. Amendments and updates to the Data, together with other applicable County Code provisions, may apply which are not depicted herein. Snohomish County makes no representation or warranty concerning the content, accuracy, currency, completeness or quality of the Data contained herein and expressly disclaims any warranty of merchantability or fitness for any particular purpose. All persons accessing or otherwise using this Data assume all responsibility for use thereof and agree to hold Snohomish County harmless from and against any damages, loss, claim or liability arising out of any error, defect or omission contained within said Data. Washington State Law, Ch. 42.56 RCW, prohibits state and local agencies from providing access to lists of individuals intended for use for commercial purposes and, thus, no commercial use may be made of any Data comprising lists of individuals contained herein.

Document Path: I:\pw\swaste\projects\GroundwaterContours\ArcMaps\CathcartWater\ElevationContours_Deep.mxd




Figure 6c

Cathcart Landfill

Shallow Aquifer
Groundwater Elevation Contours
Fourth Quarter 2021

-  DIRECTION OF GROUNDWATER FLOW
0.000368 ft / day
0.134 ft / year
128.26 degrees to the positive x - axis
-  PARCEL BOUNDARY
-  SUBJECT PROPERTY BOUNDARY
-  5 FT CONTOUR
-  WELL LOCATION

WELL_ID	SAMP_DATE	MEAS_HEAD
G-01A	10/19/2021	221.89
G-08D1	10/19/2021	192.67
G-09S	10/19/2021	240.57
G-10S	10/19/2021	244.32
G-11S	10/19/2021	232.19
G-14S	10/19/2021	311.78
G-24S	10/19/2021	306.47

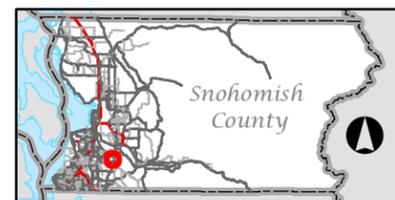

All maps, data, and information set forth herein ("Data"), are for illustrative purposes only and are not to be considered an official citation to, or representation of, the Snohomish County Code. Amendments and updates to the Data, together with other applicable County Code provisions, may apply which are not depicted herein. Snohomish County makes no representation or warranty concerning the content, accuracy, currency, completeness or quality of the Data contained herein and expressly disclaims any warranty of merchantability or fitness for any particular purpose. All persons accessing or otherwise using this Data assume all responsibility for use thereof and agree to hold Snohomish County harmless from and against any damages, loss, claim or liability arising out of any error, defect or omission contained within said Data. Washington State Law, Ch. 42.56 RCW, prohibits state and local agencies from providing access to lists of individuals intended for use for commercial purposes and, thus, no commercial use may be made of any Data comprising lists of individuals contained herein.

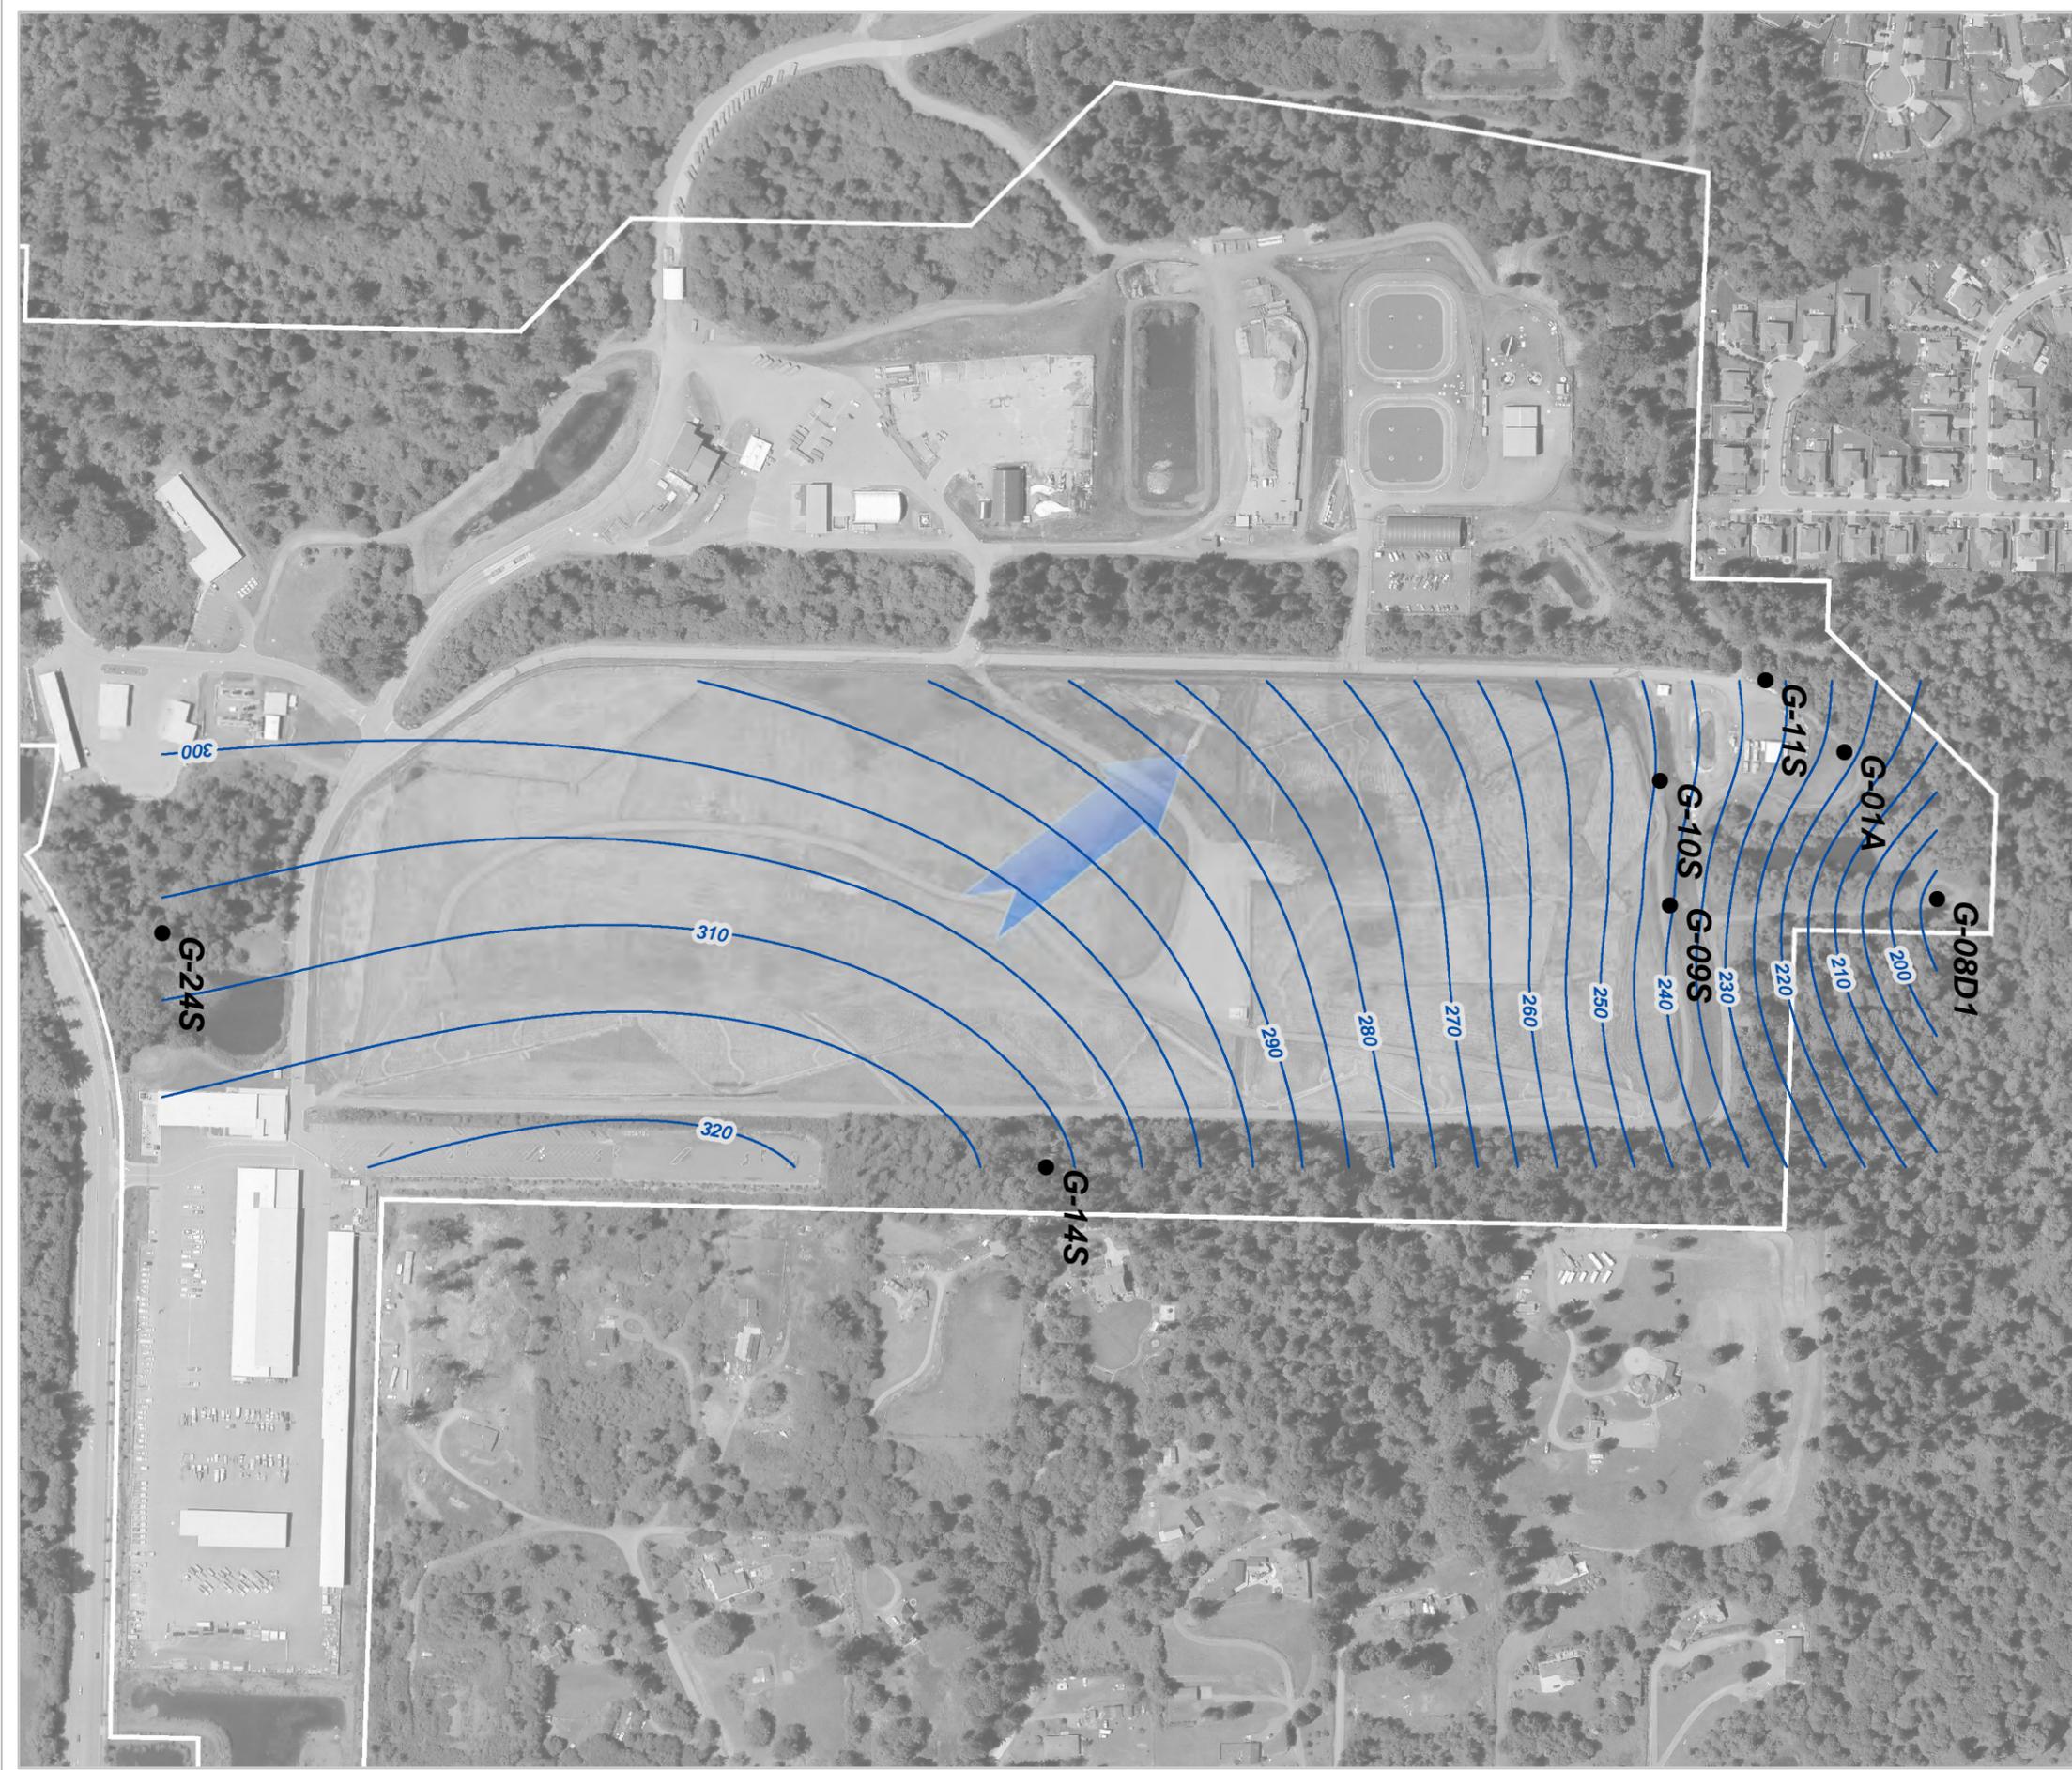


Figure 6d




Cathcart Landfill

Deep Aquifer Groundwater Elevation Contours Fourth Quarter 2021

 DIRECTION OF GROUNDWATER FLOW
0.0108 ft / day
3.93 ft / year
132.74 degrees to the positive x - axis

-  PARCEL BOUNDARY
-  SUBJECT PROPERTY BOUNDARY
-  10 FT CONTOUR
-  WELL LOCATION

WELL_ID	SAMP_DATE	MEAS_HEAD
G-01D	10/19/2021	206.76
G-02D	10/19/2021	210.77
G-06B	10/19/2021	212.21
G-08D2	10/19/2021	212.15
G-09D	10/19/2021	219.80
G-10D	10/19/2021	237.92
G-13D	10/19/2021	221.35
G-14D	10/19/2021	297.68
G-24D	10/19/2021	301.00

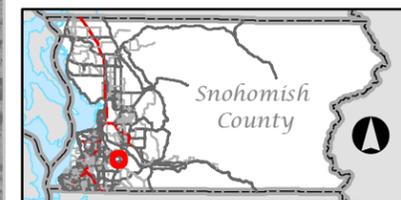

All maps, data, and information set forth herein ("Data"), are for illustrative purposes only and are not to be considered an official citation to, or representation of, the Snohomish County Code. Amendments and updates to the Data, together with other applicable County Code provisions, may apply which are not depicted herein. Snohomish County makes no representation or warranty concerning the content, accuracy, currency, completeness or quality of the Data contained herein and expressly disclaims any warranty of merchantability or fitness for any particular purpose. All persons accessing or otherwise using this Data assume all responsibility for use thereof and agree to hold Snohomish County harmless from and against any damages, loss, claim or liability arising out of any error, defect or omission contained within said Data. Washington State Law, Ch. 42.56 RCW, prohibits state and local agencies from providing access to lists of individuals intended for use for commercial purposes and, thus, no commercial use may be made of any Data comprising lists of individuals contained herein.

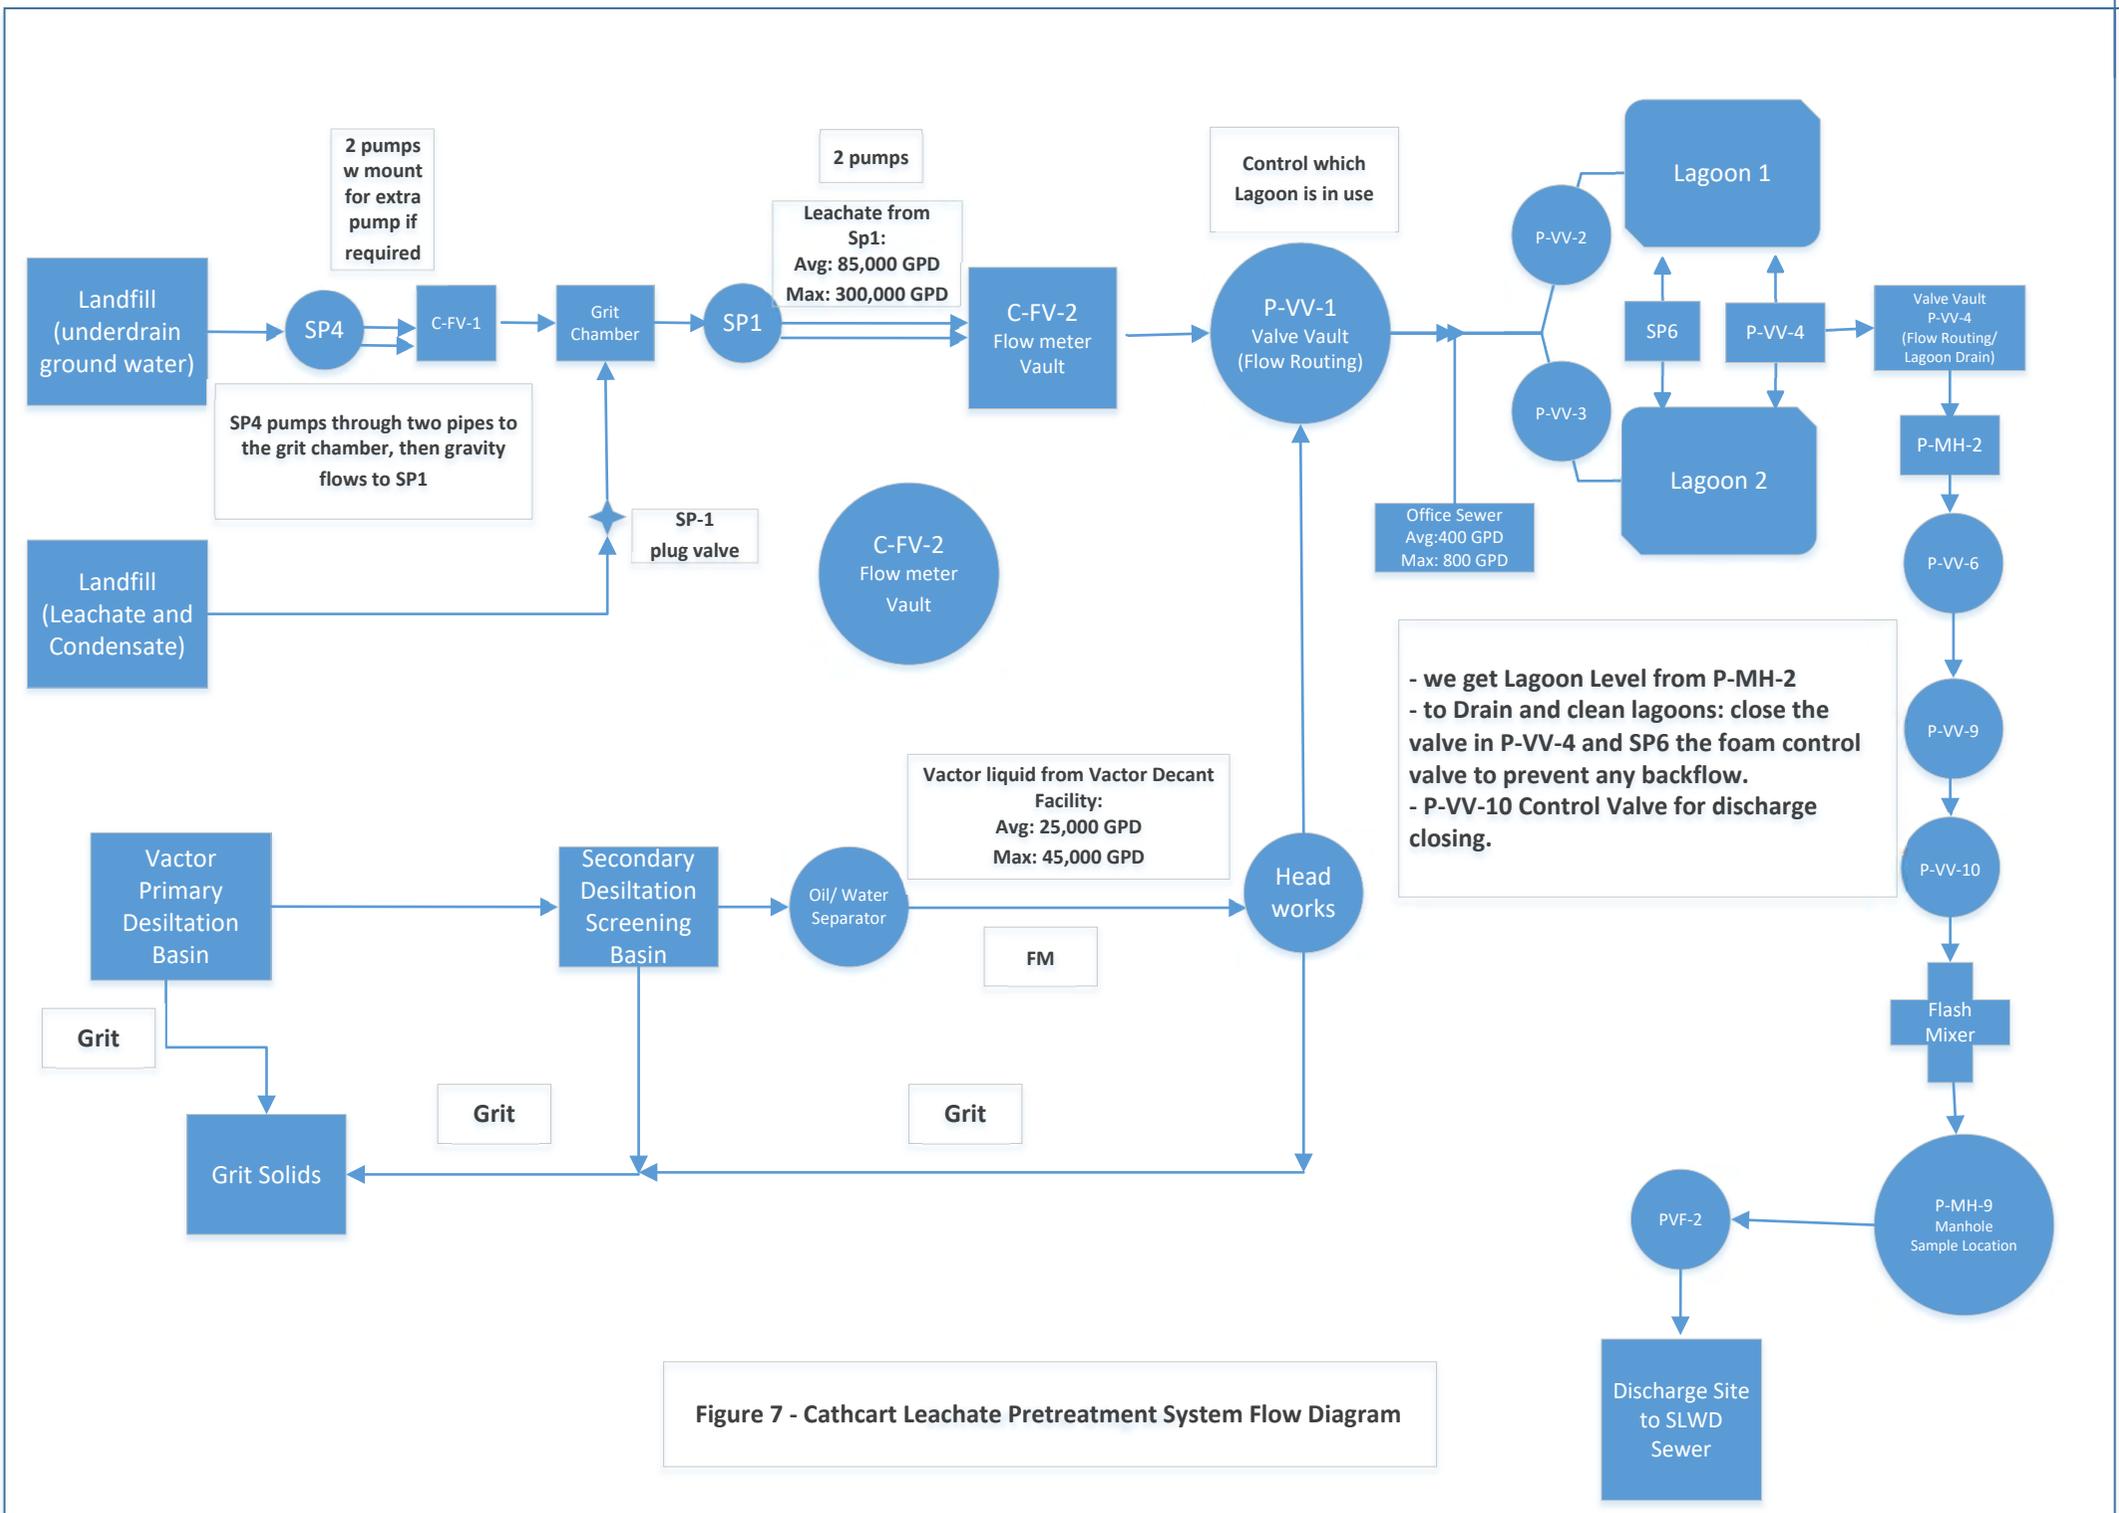



Figure 7 - Cathcart Leachate Pretreatment System Flow Diagram

Appendix A


Hydrographs

Shallow Wells


Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-01A

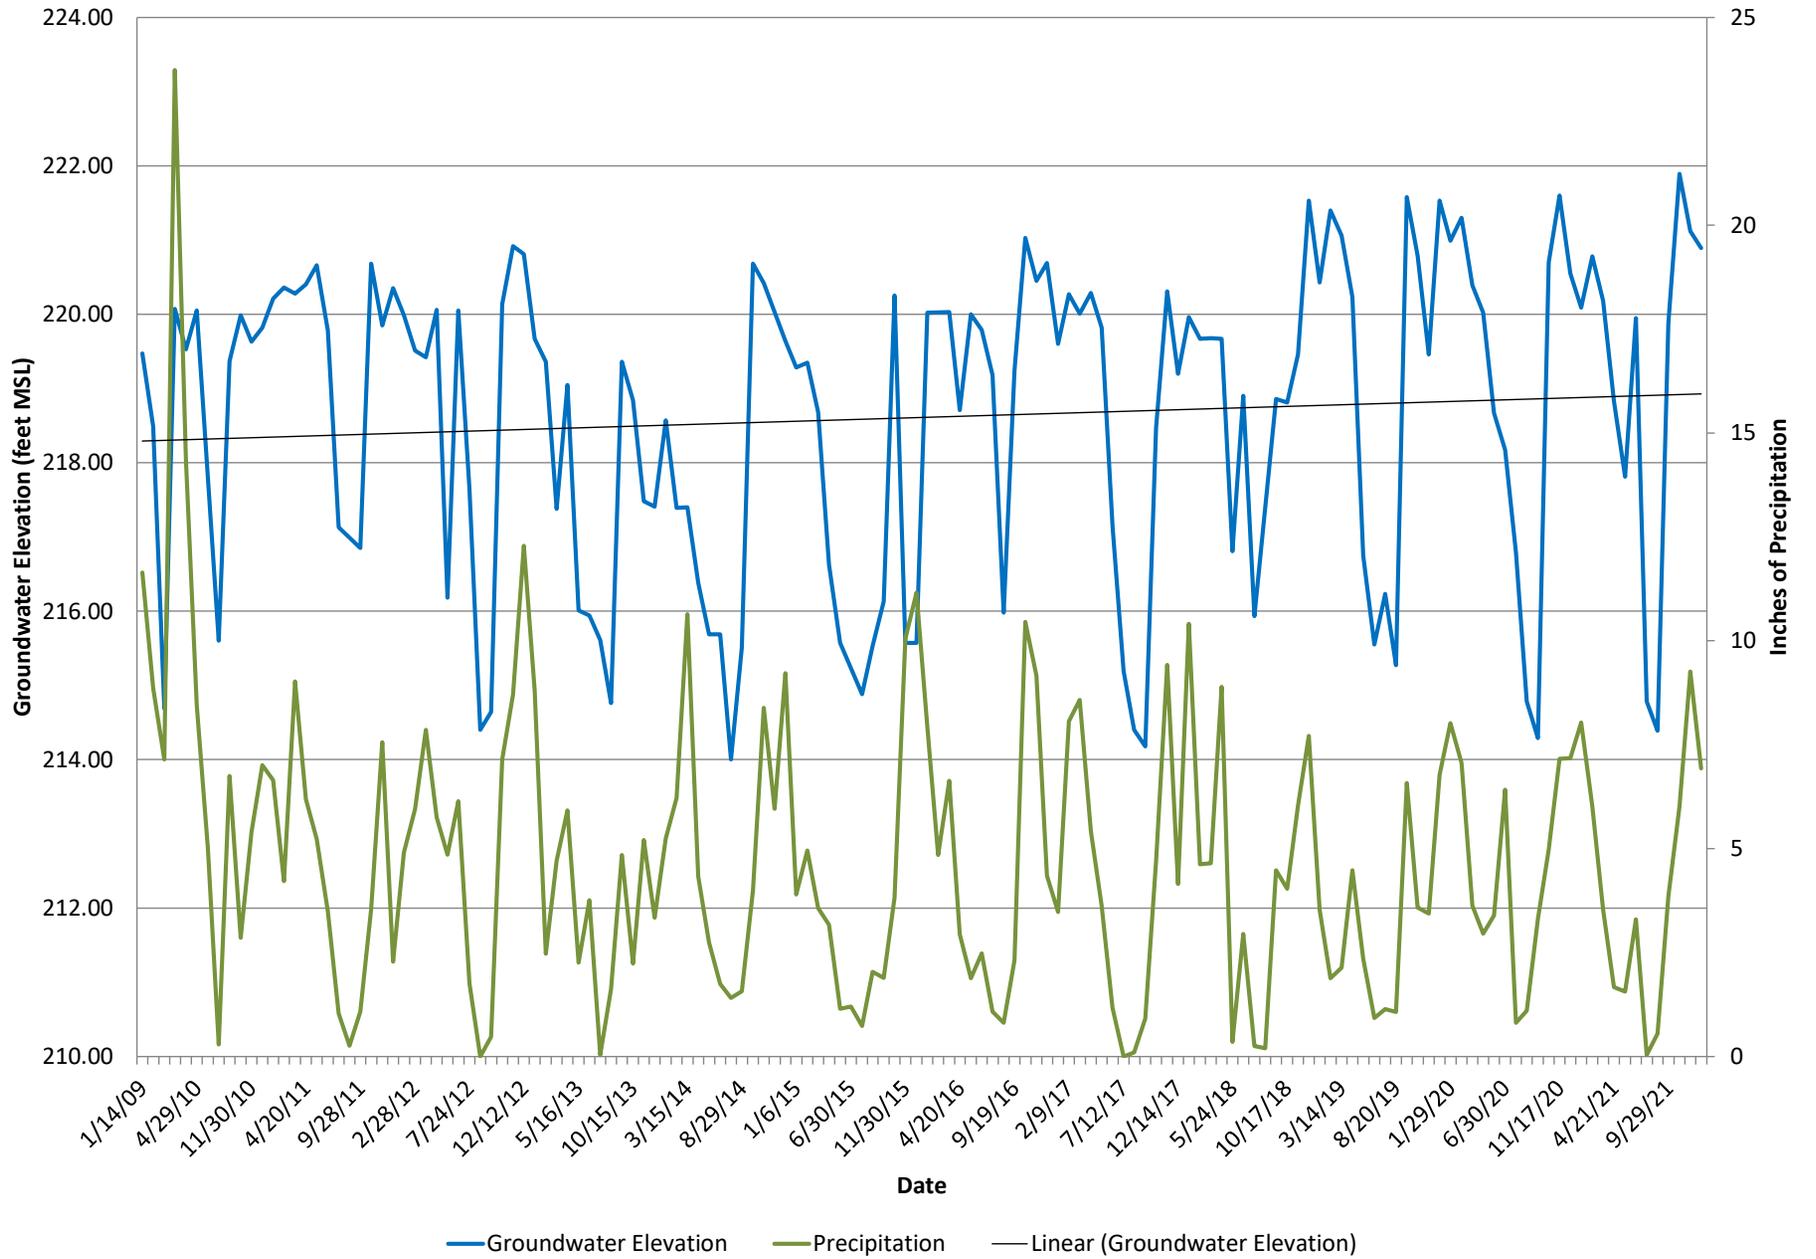


Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-04A

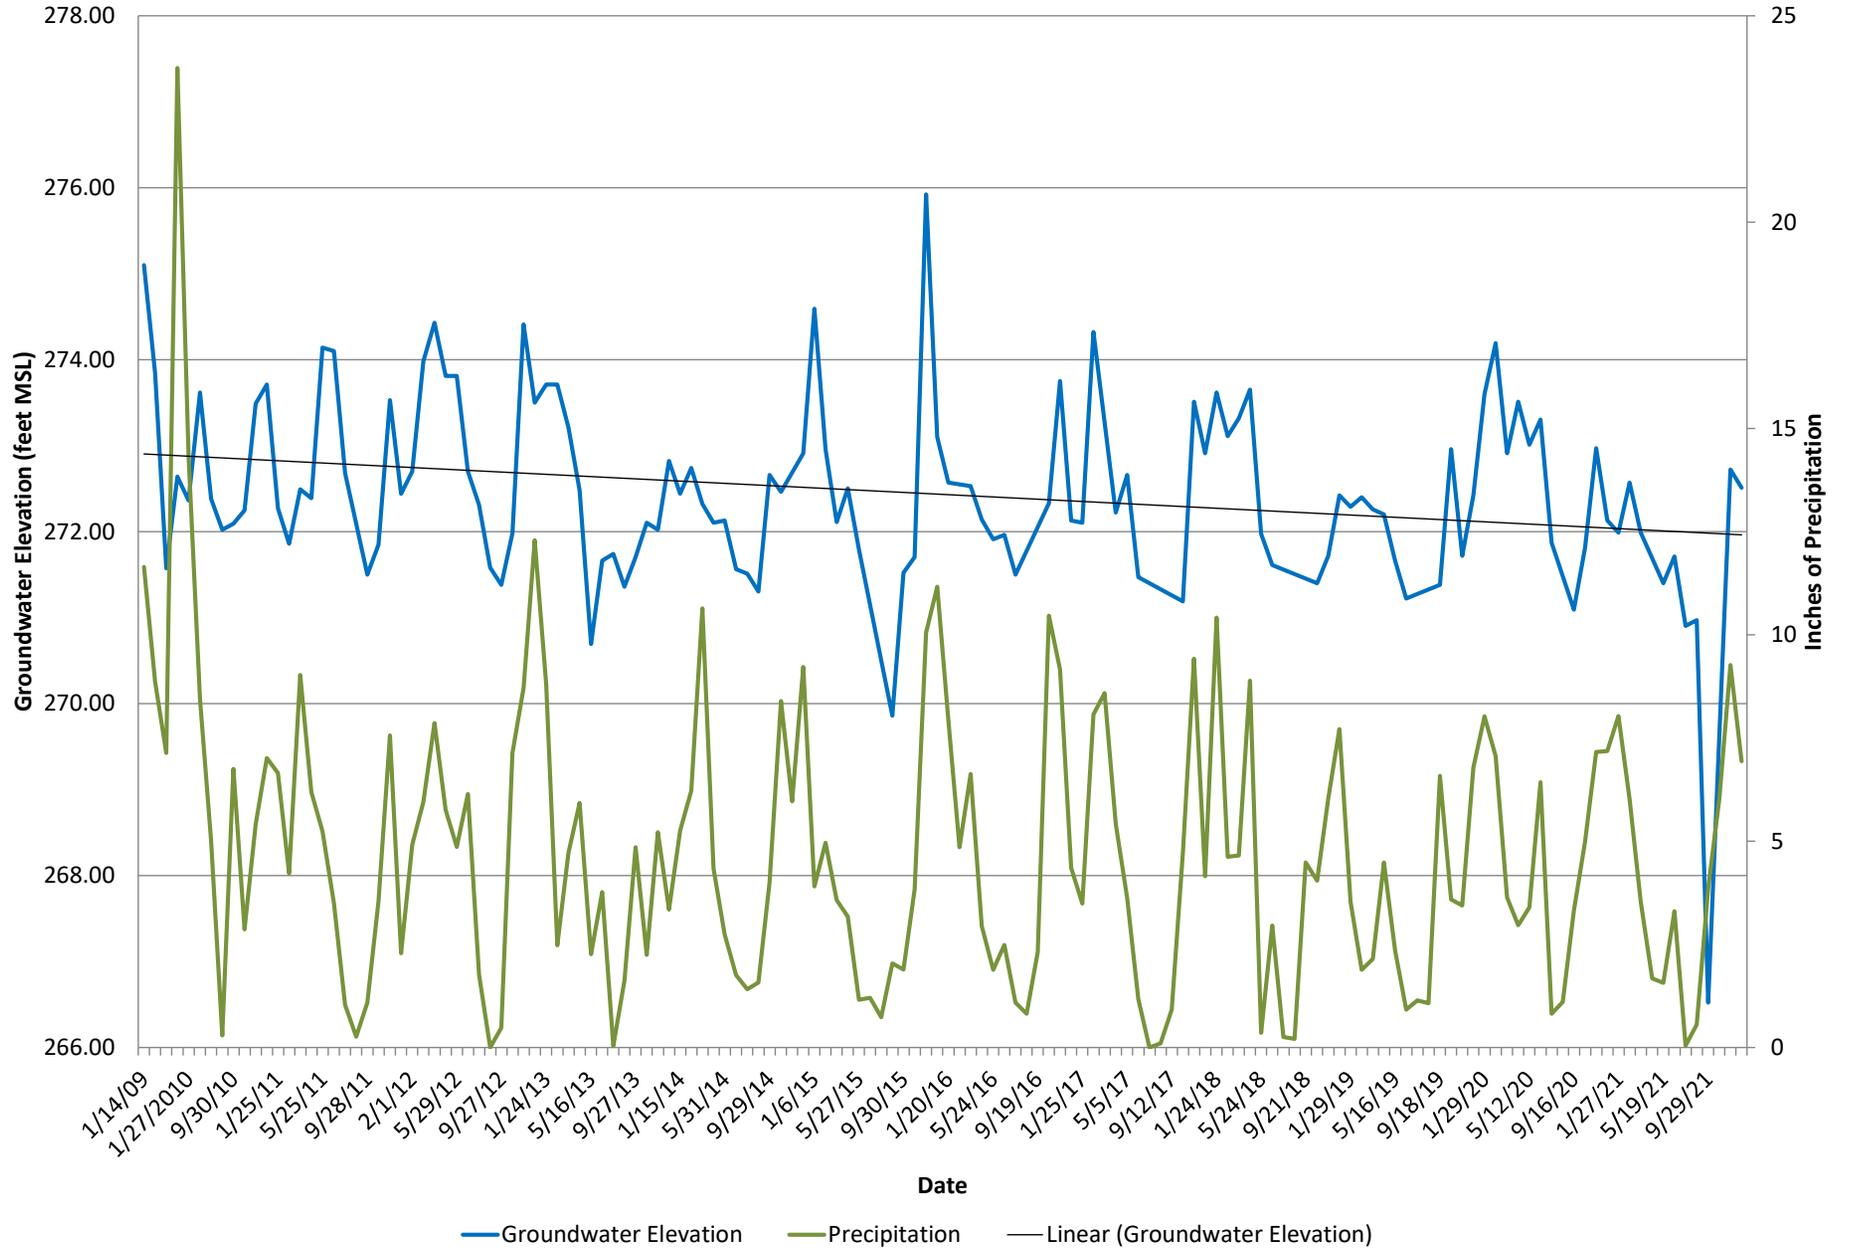


Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-08D1

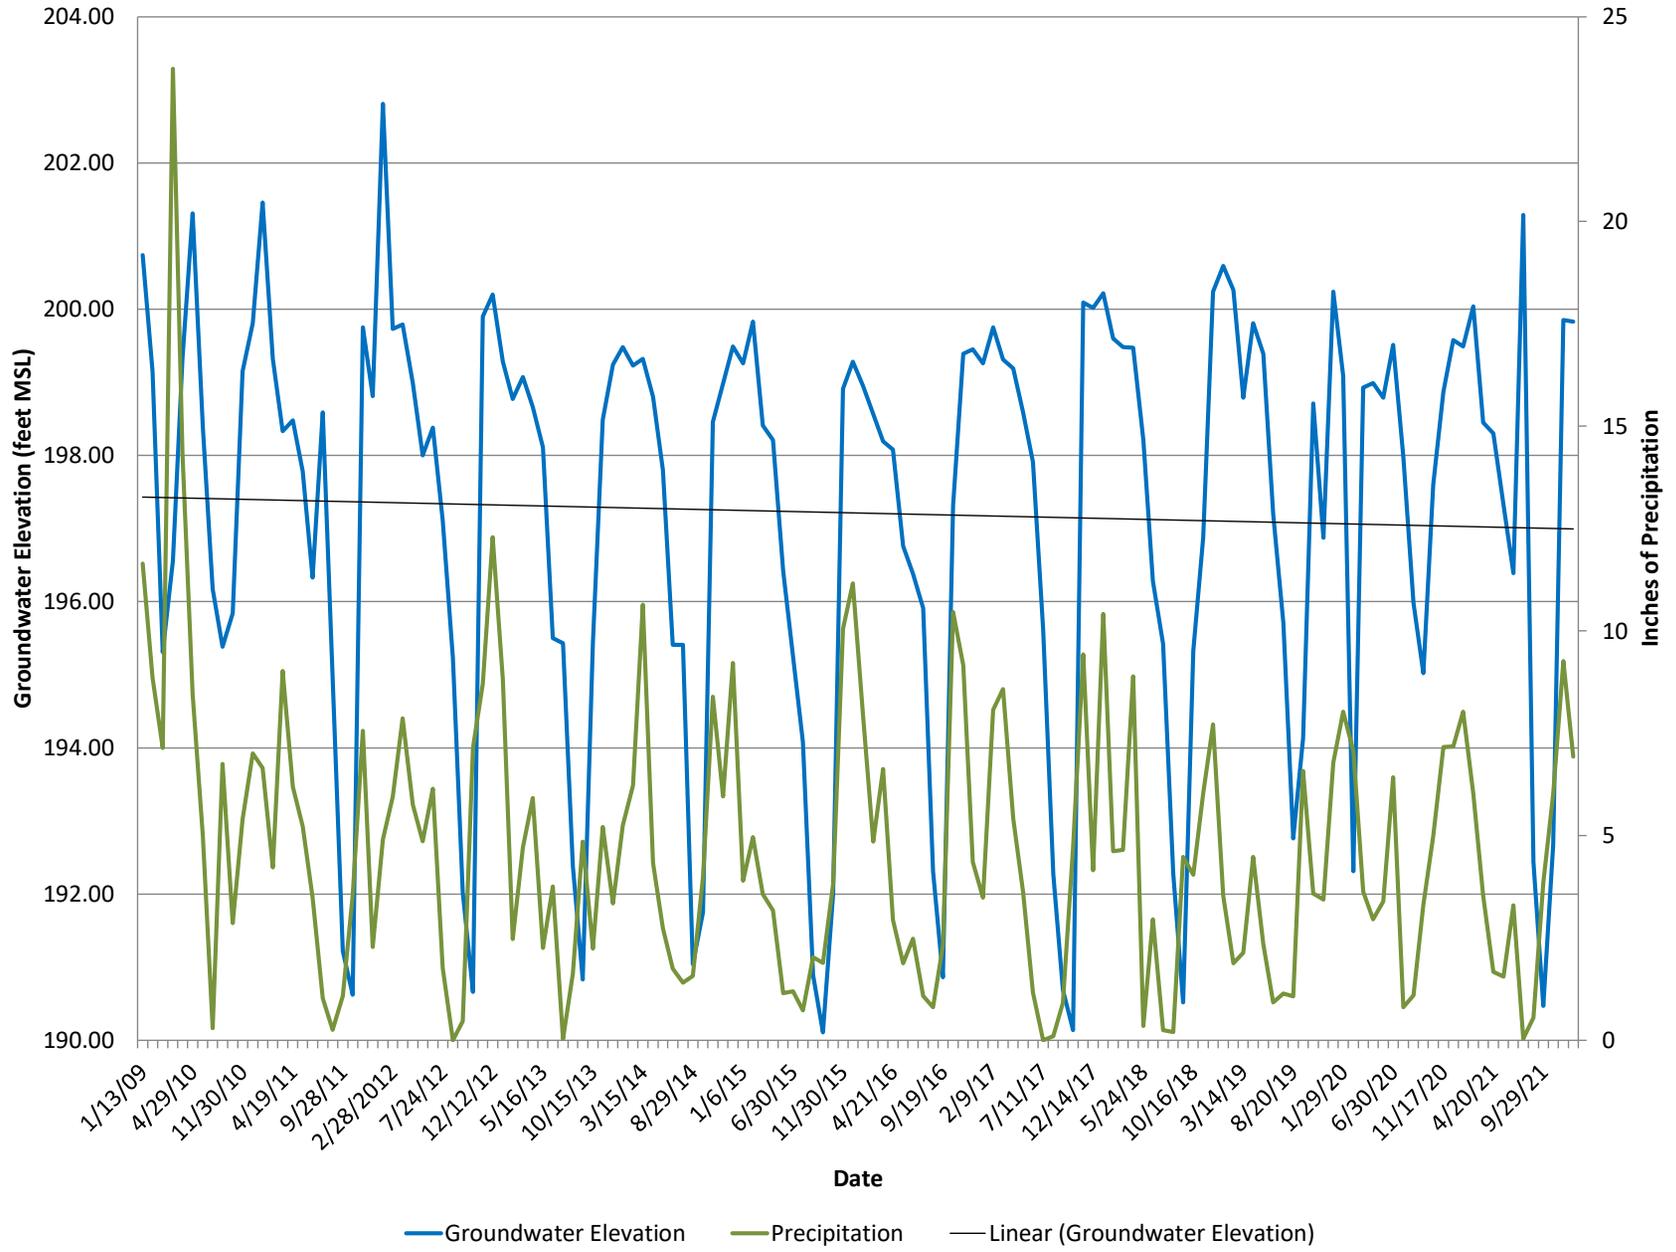


Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-09S

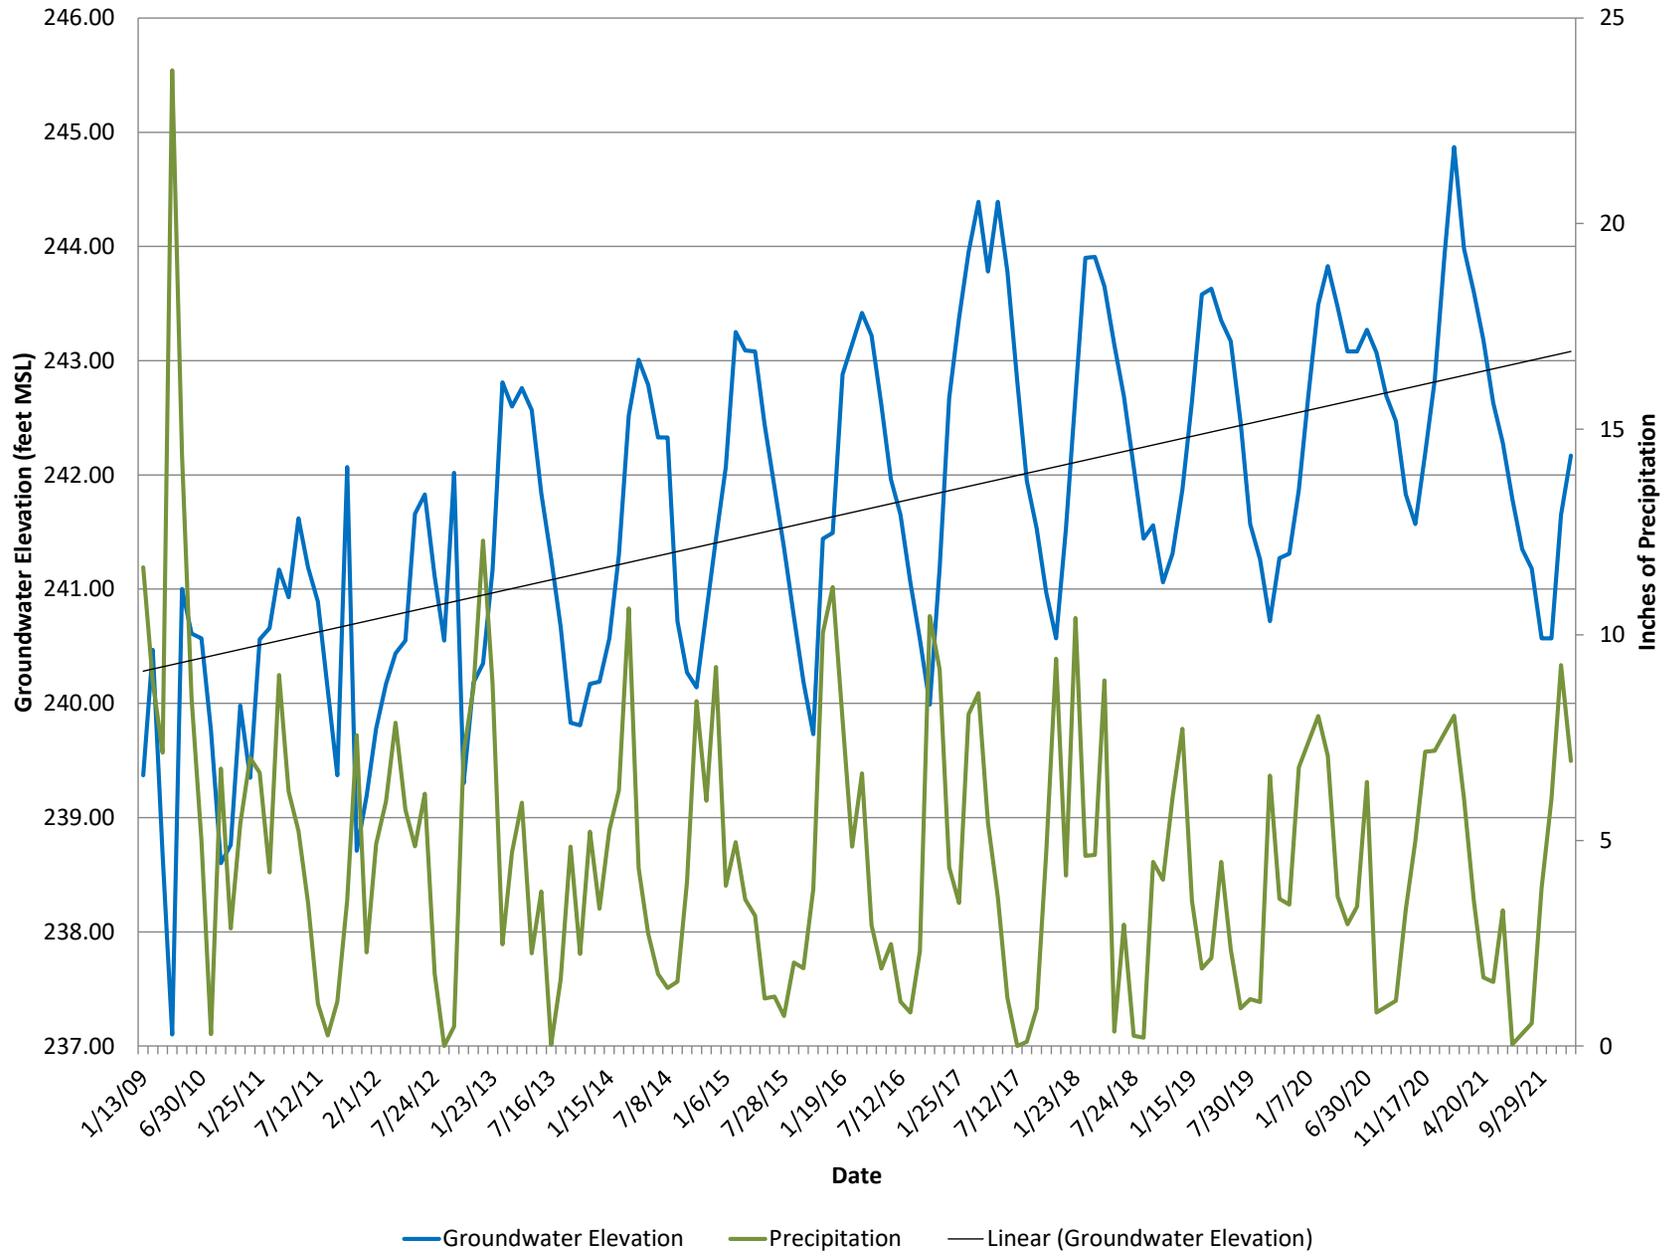


Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-10S

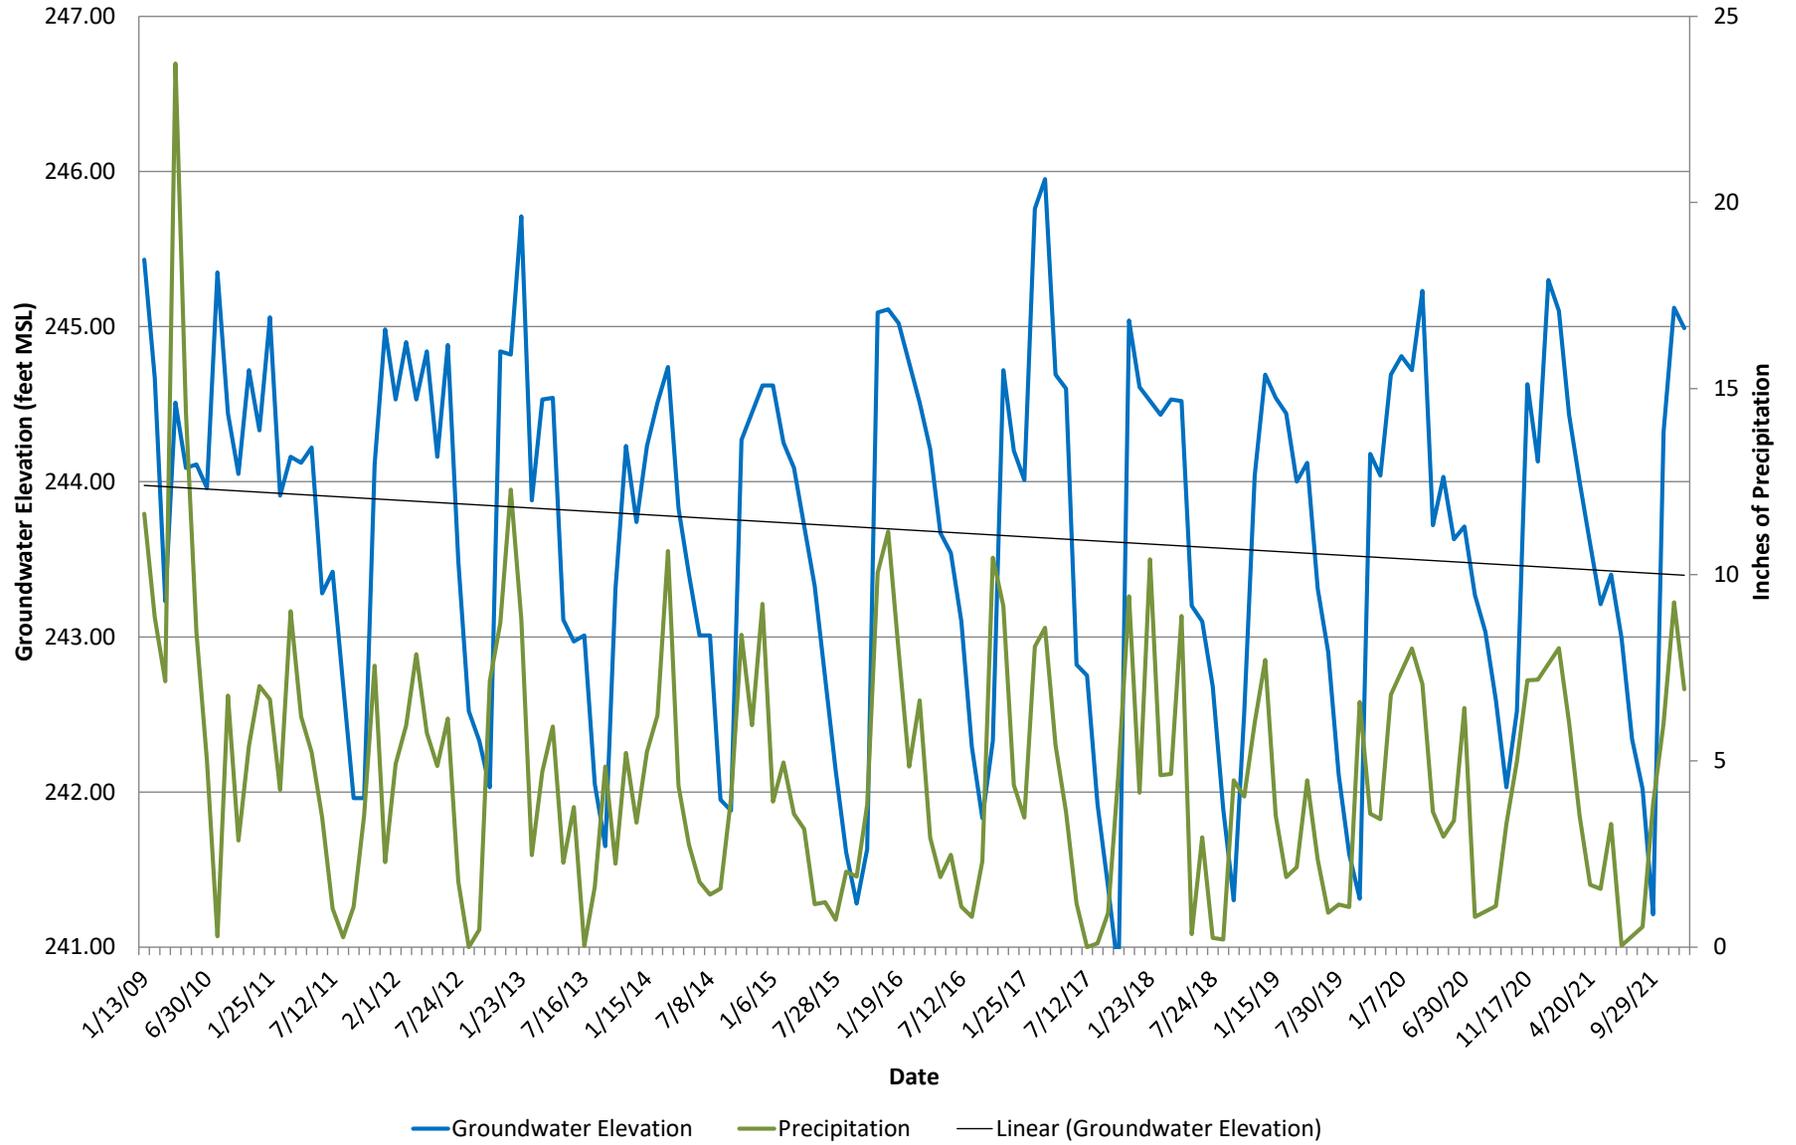


Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-11S

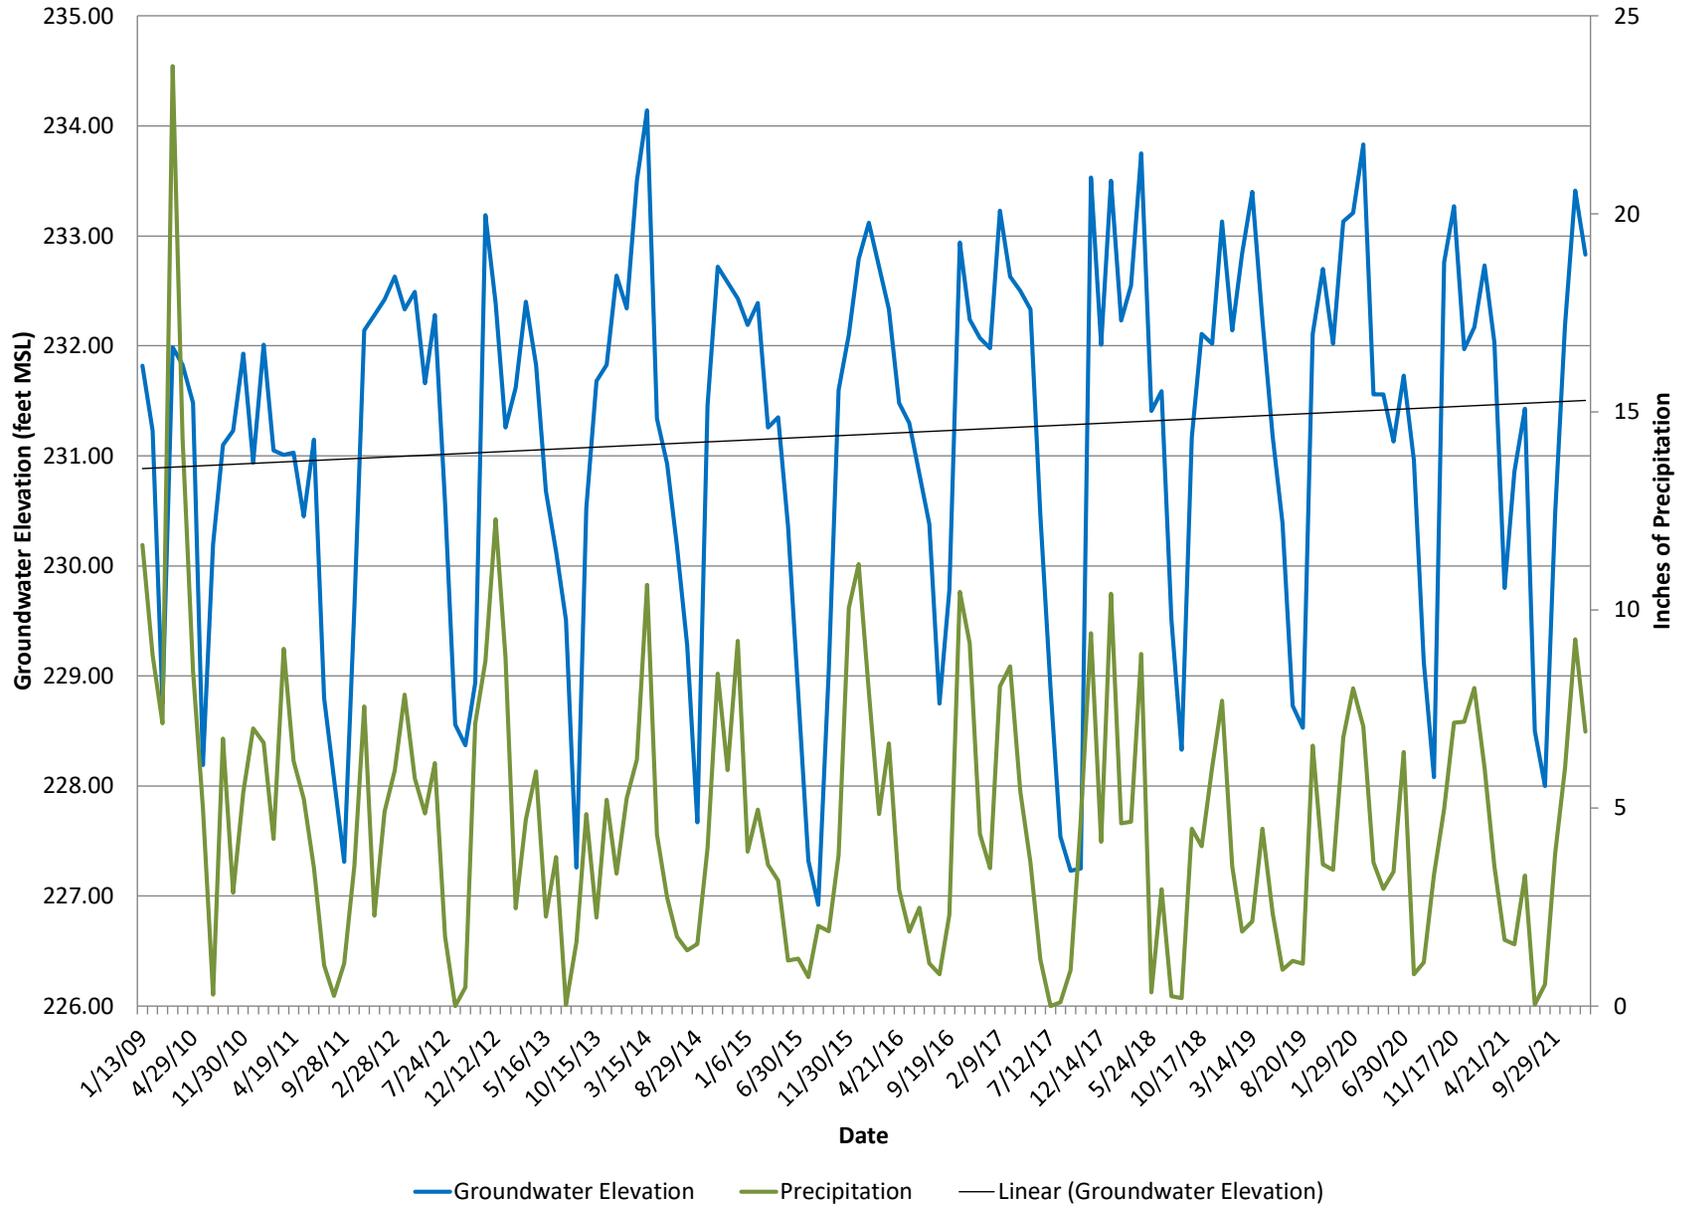

Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-14S

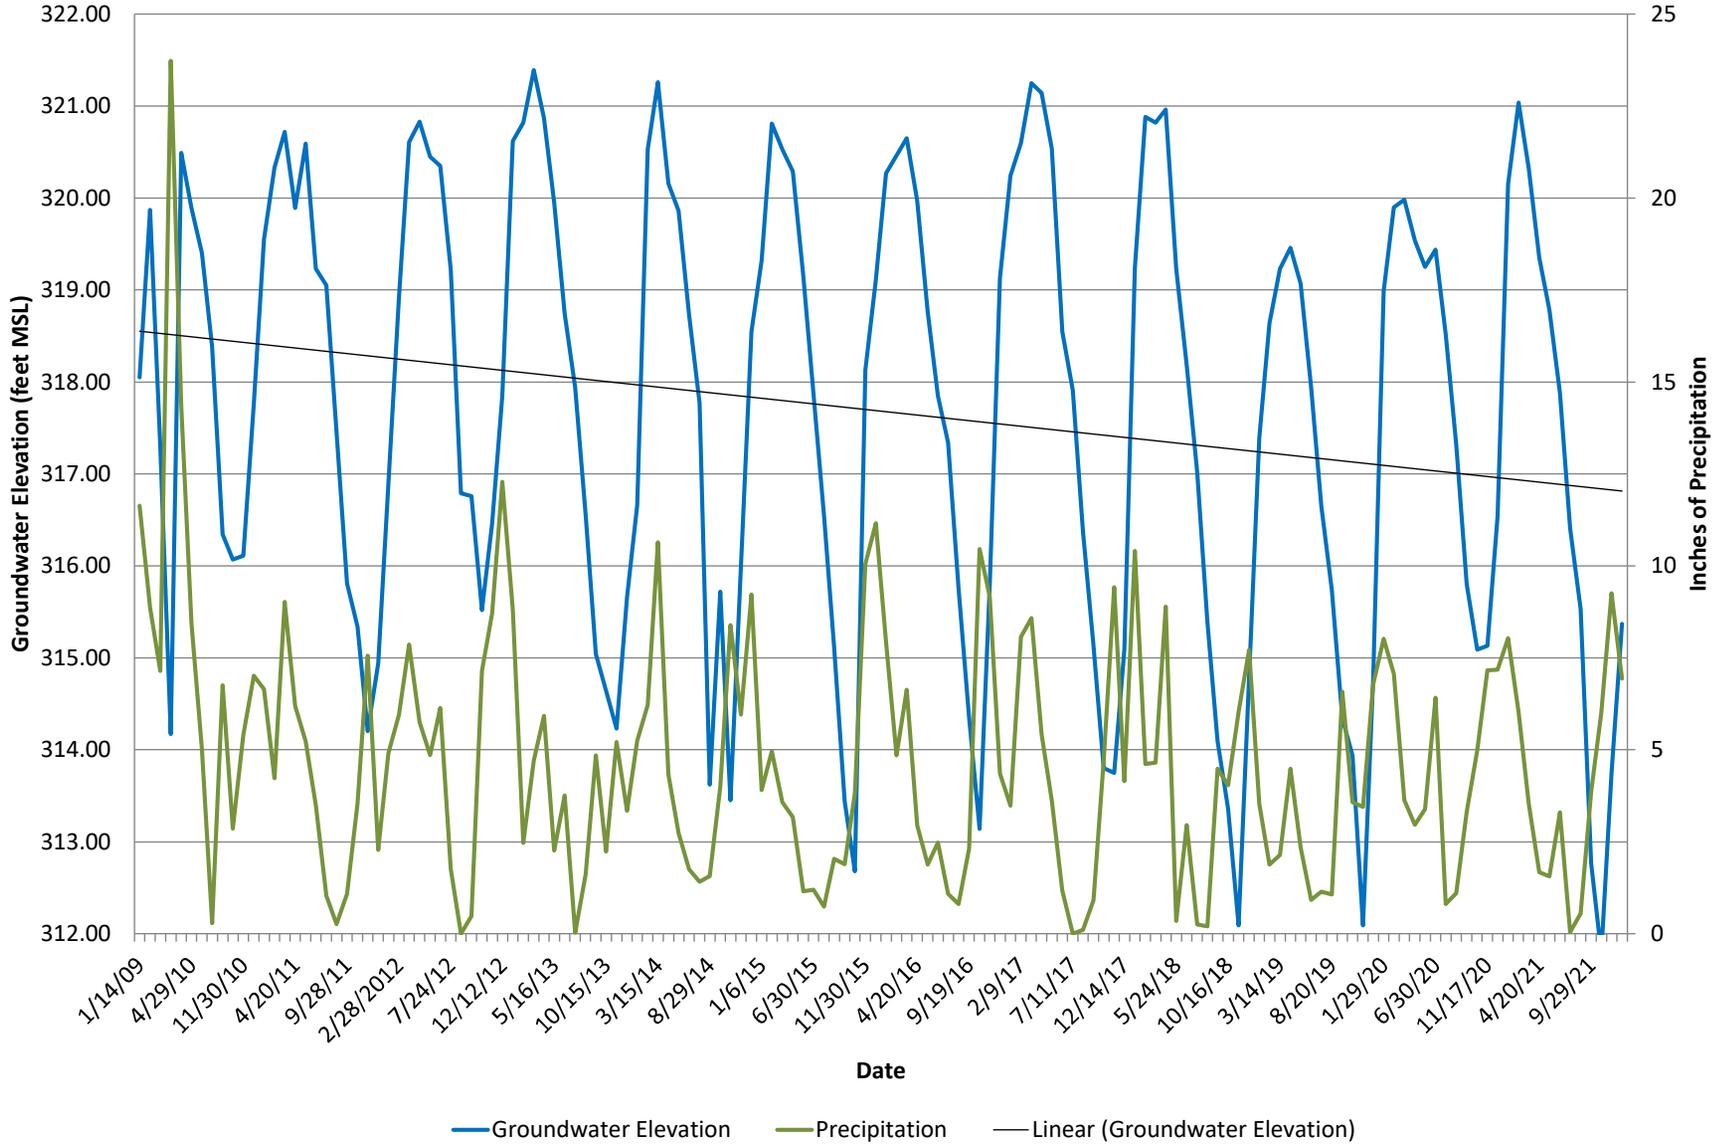

Hydrograph
Cathcart Landfill Shallow Aquifer
Well G-24S

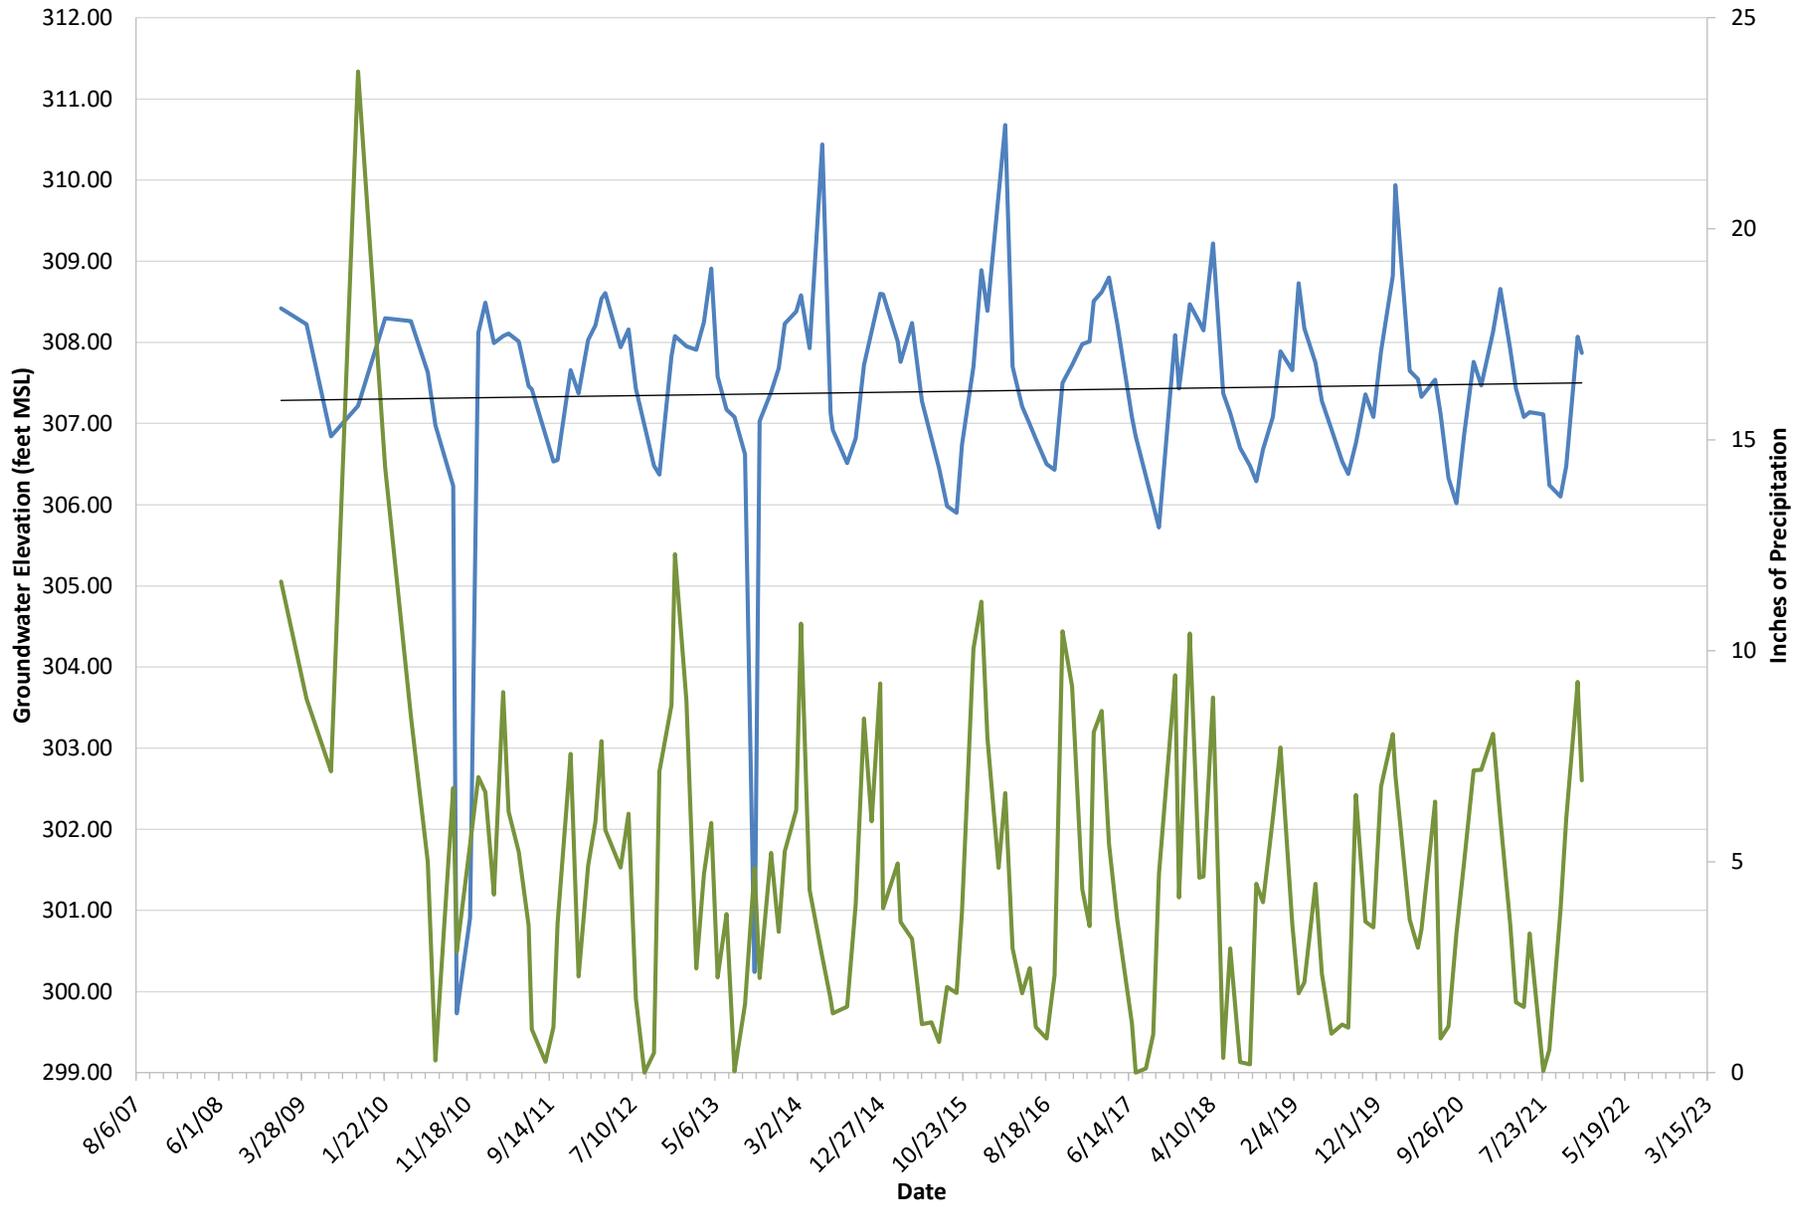

— Groundwater Elevation — Precipitation — Linear (Groundwater Elevation)

Site: **Cathcart Landfill - Shallow Aquifer**

Measurement Date: **4/20/2021**

Well ID	[X] matrix		[D] matrix		Pt										
	X-axis	Y-axis	GW Elev.	D											
G-01A	413.12	3968.37	218.83	1											
G-08D1	710.11	4157.06	198.30	1		413.12	710.11	723.45	470.79	267.66	1256.3	778.15	0		
G-09S	723.45	3612.73	243.18	1		3968.37	4157.06	3612.73	3595.1	3807.05	2341	538.89	0		
G-10S	470.79	3595.13	243.60	1		218.83	198.3	243.18	243.6	229.8	319.35	307.43	0		
G-11S	267.66	3807.05	229.80	1											
G-14S	1256.30	2341.04	319.35	1	{{P}{t}{P}}										
G-24S	778.15	538.89	307.43	1		3675396.461	13276944.47	1223765.2							
8	0	0	0	1		13276944.47	79270386.49	5235202.9							
9	0	0	0	1		1223765.205	5235202.921	454992.6							
10	0	0	0	1											
11	0	0	0	1	{{P}{t}{P}'										
12	0	0	0	1		2.85745E-06	1.20681E-07	-9.07E-06							
13	0	0	0	1		1.20681E-07	5.76358E-08	-9.88E-07							
14	0	0	0	1		-9.07409E-06	-9.87753E-07	3.797E-05							
15	0	0	0	1											
16	0	0	0	1	{{P}{t}{P}]{P}{t}										
17	0	0	0	1		-0.000326304	0.000731393	0.0002966	-4E-04	-0.000860961	0.001	-5E-04	0		
18	0	0	0	1		6.2426E-05	0.000129421	5.533E-05	2E-05	2.47383E-05	-3E-05	-2E-04	0		
19	0	0	0	1		0.000640312	-0.003020485	-0.0009	0.0014	0.002536094	-0.002	0.0041	0		
20	0	0	0	1											

{{P}{t}{P}]{P}{t} [D] = [A] matrix

A -0.000117174

B 8.77221E-05

C 0.003175084

Groundwater Gradient:	0.0461	
Conductivity (ft/day):	0.001	
Effective porosity:	10%	
GW velocity:	0.000461	ft/day
	0.168	ft/year
Flow direction:	143.18	degrees from the positive x-axis

This spreadsheet is from the paper, "A Spreadsheet Method For Estimating Hydraulic Gradient With Heads From Multiple Wells" submitted to Ground Water, March, 2002. To use the program, enter the coordinates for the well locations in the columns labeled x and y (part of the [X] matrix), and the water levels in the z column. The matrices are automatically updated and the gradient magnitude and direction are calculated in cell H30 and H35.

Site: **Cathcart Landfill - Shallow Aquifer**

Measurement Date: **10/19/2021**

Well ID	X-axis	Y-axis	GW Elev.	D									
G-01A	413.12	3968.37	221.89	1	Pt								
G-08D1	710.11	4157.06	192.67	1		413.12	710.11	723.45	470.79	267.66	1256.3	778.15	0
G-09S	723.45	3612.73	240.57	1		3968.37	4157.06	3612.73	3595.1	3807.05	2341	538.89	0
G-10S	470.79	3595.13	244.32	1		221.89	192.67	240.57	244.32	232.19	311.78	306.47	0
G-11S	267.66	3807.05	232.19	1									
G-14S	1256.30	2341.04	311.78	1	{{P}{t}{P}}								
G-24S	778.15	538.89	306.47	1		3675396.461	13276944.47	1209864.7					
8	0	0	0	1		13276944.47	79270386.49	5207961					
9	0	0	0	1		1209864.69	5207960.996	448965.91					
10	0	0	0	1									
11	0	0	0	1	{{P}{t}{P}'								
12	0	0	0	1		2.5997E-06	1.04405E-07	-8.22E-06					
13	0	0	0	1		1.04405E-07	5.72193E-08	-9.45E-07					
14	0	0	0	1		-8.2167E-06	-9.45088E-07	3.533E-05					
15	0	0	0	1									
16	0	0	0	1	{{P}{t}{P}'}{P}{t}								
17	0	0	0	1		-0.000334899	0.000696977	0.0002812	-4E-04	-0.000814526	0.0009	-4E-04	0
18	0	0	0	1		6.04938E-05	0.000129913	5.489E-05	2E-05	2.6342E-05	-3E-05	-2E-04	0
19	0	0	0	1		0.000694982	-0.00295604	-0.000859	0.0014	0.00240657	-0.002	0.0039	0
20	0	0	0	1									

{{P}{t}{P}'}{P}{t} [D] = [A] matrix


- A -6.97886E-05
- B 8.84936E-05
- C 0.003059149

Groundwater Gradient:	0.0368
Conductivity (ft/day):	0.001
Effective porosity:	10%
GW velocity:	0.000368 ft/day
	0.134 ft/year
Flow direction:	128.26 degrees from the positive x-axis


This spreadsheet is from the paper, "A Spreadsheet Method For Estimating Hydraulic Gradient With Heads From Multiple Wells" submitted to Ground Water, March, 2002. To use the program, enter the coordinates for the well locations in the columns labeled x and y (part of the [X] matrix), and the water levels in the z column. The matrices are automatically updated and the gradient magnitude and direction are calculated in cell H30 and H35.

Deep Wells


Hydrograph
Cathcart Landfill Deep Aquifer
Well G-01D

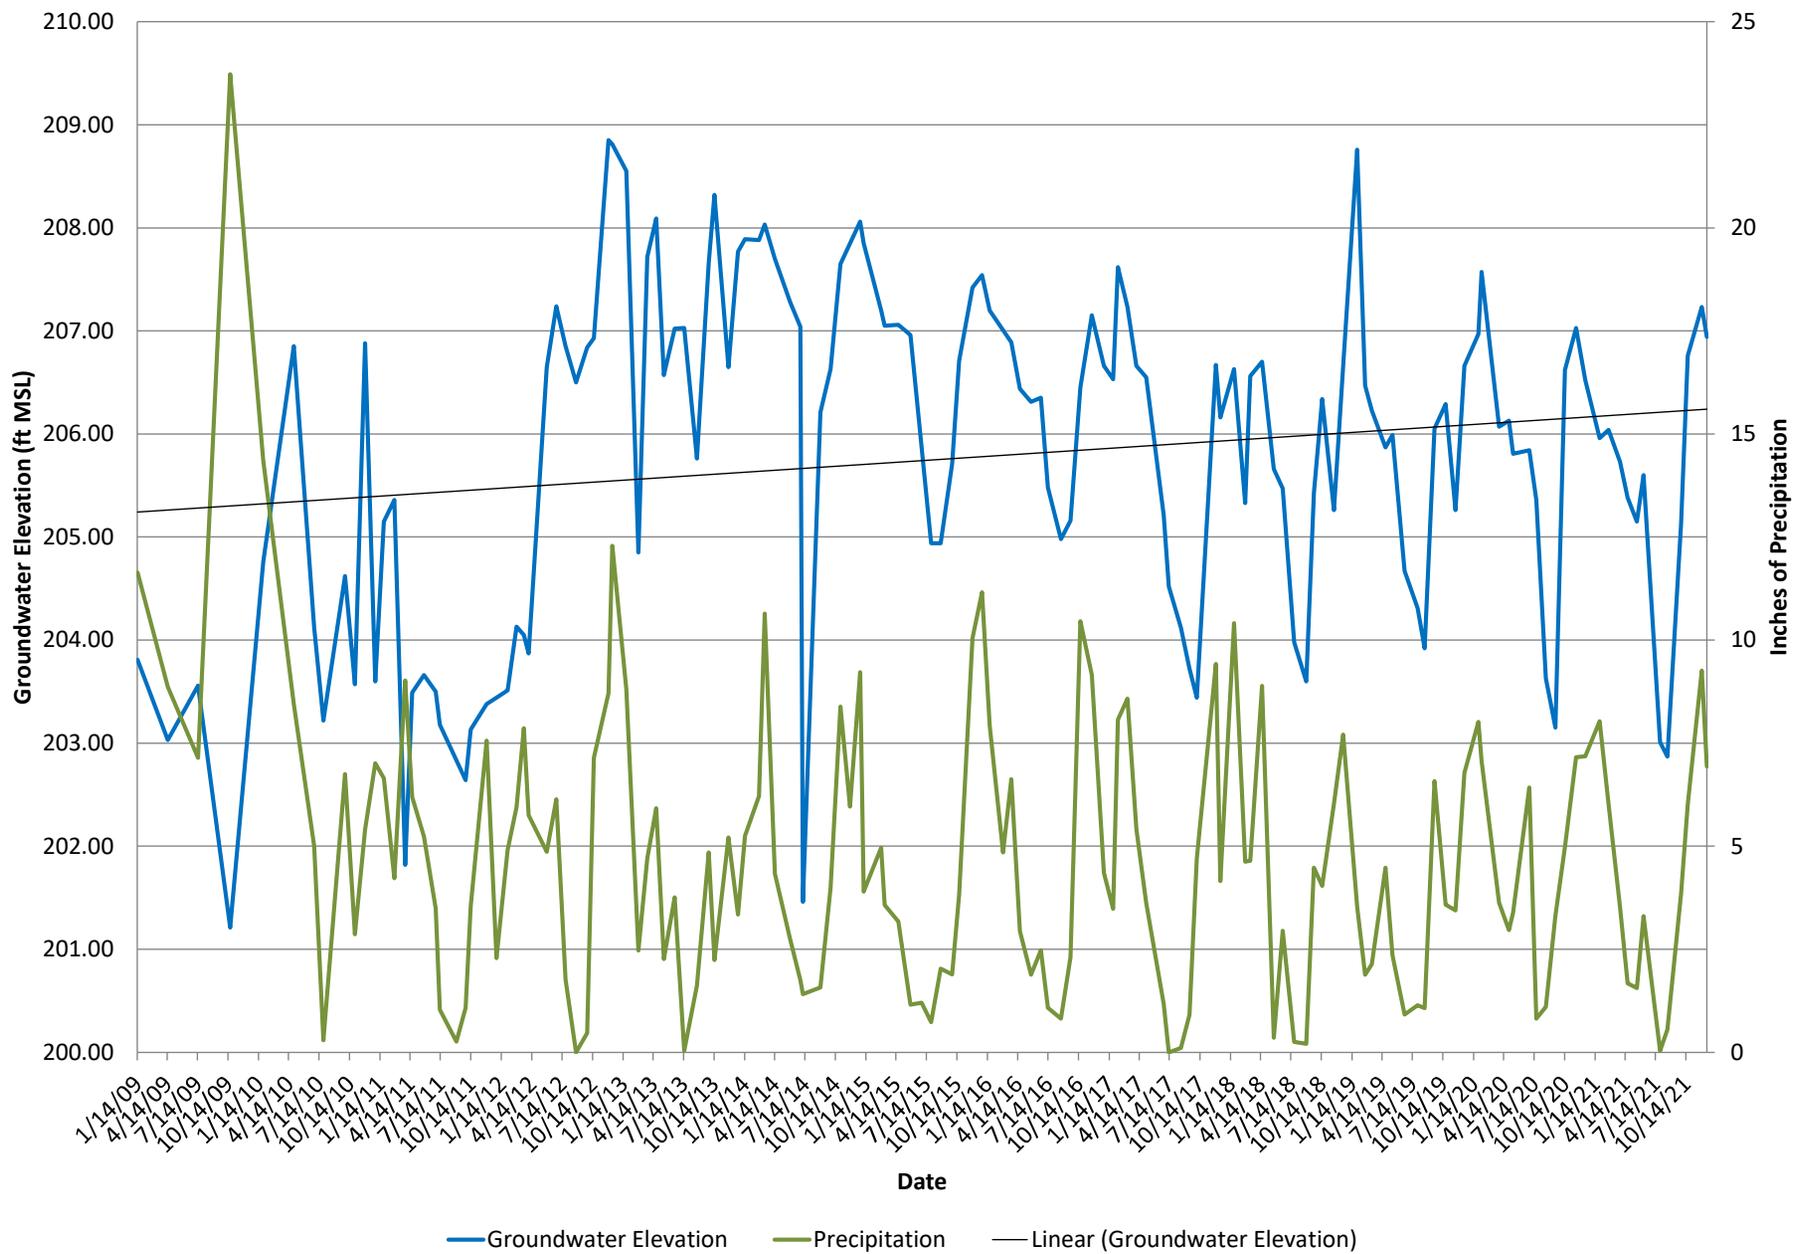


Hydrograph
Cathcart Landfill Deep Aquifer
Well G-02D

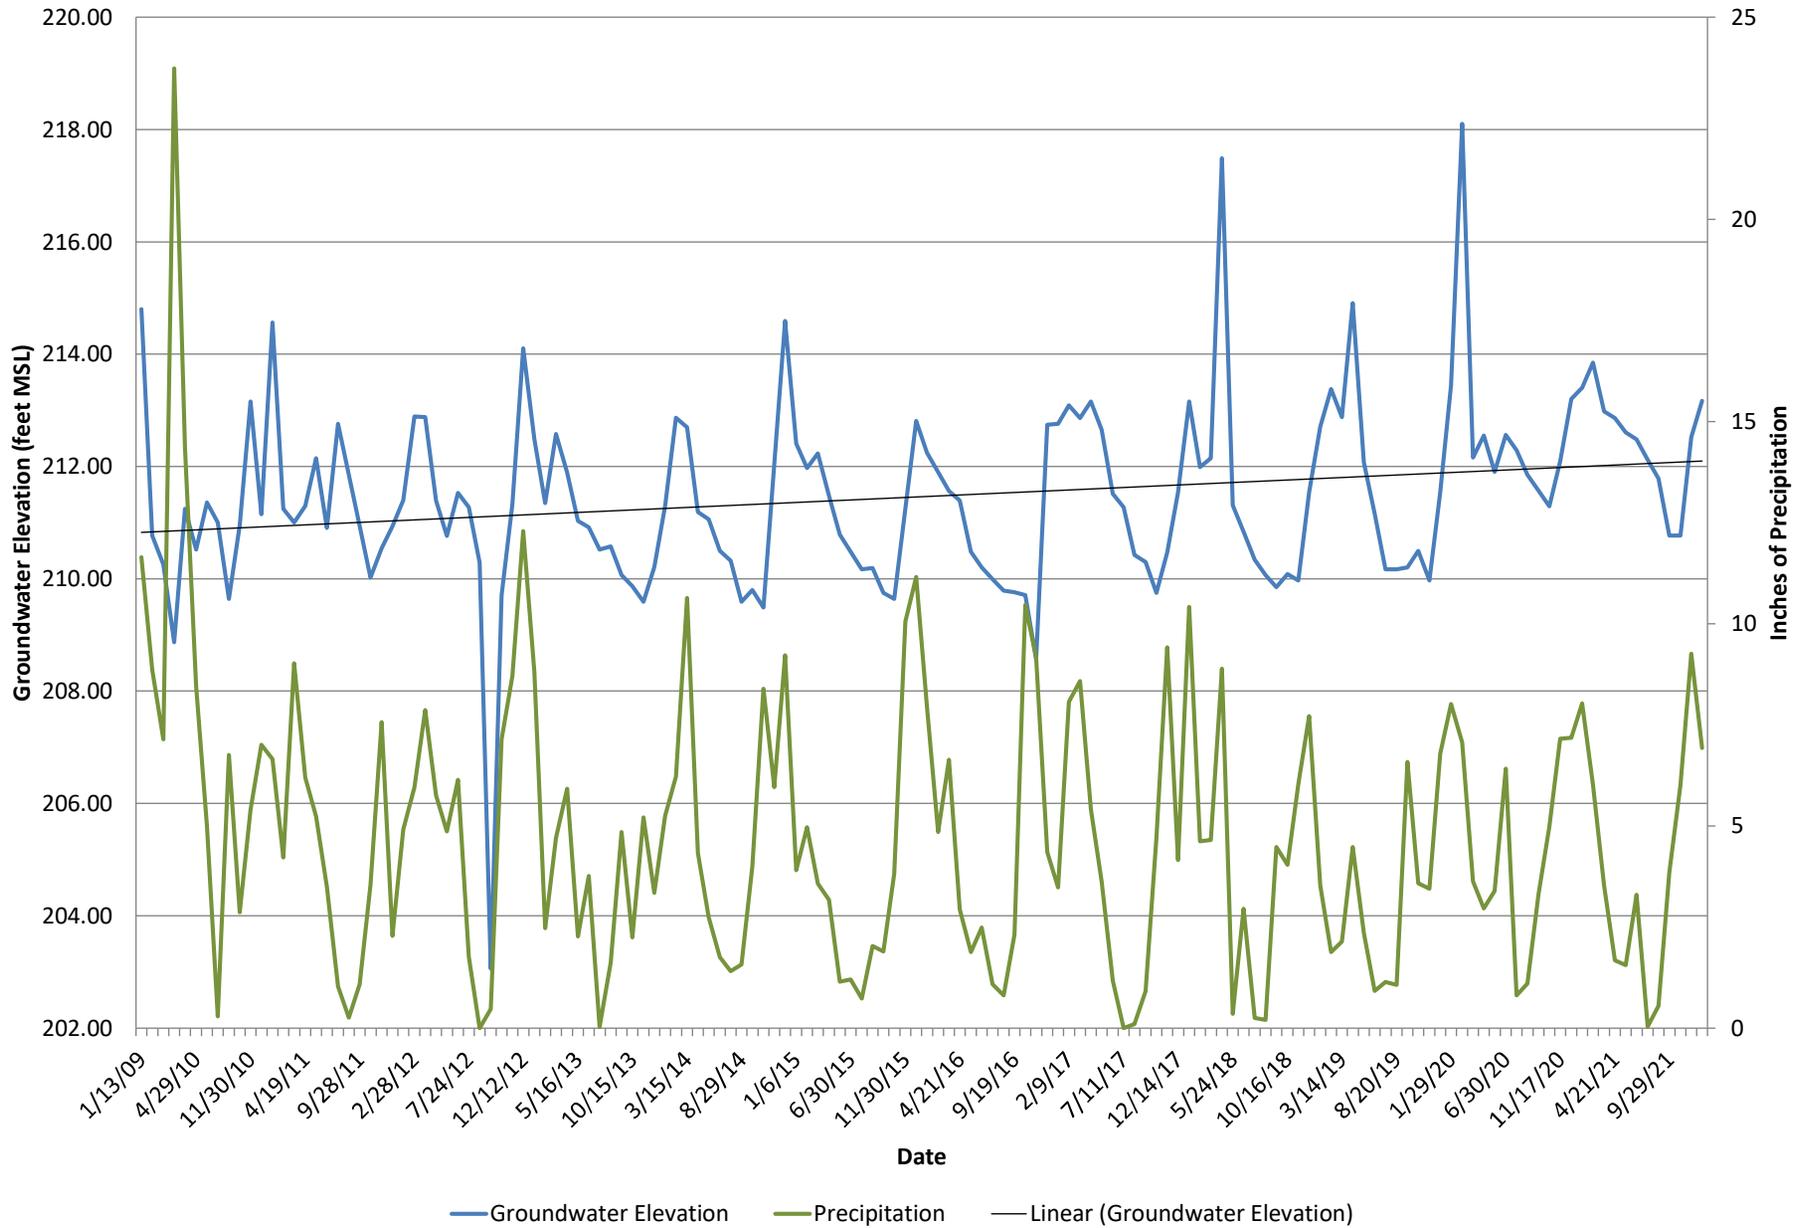


Hydrograph
Cathcart Landfill Deep Aquifer
Well G-06B

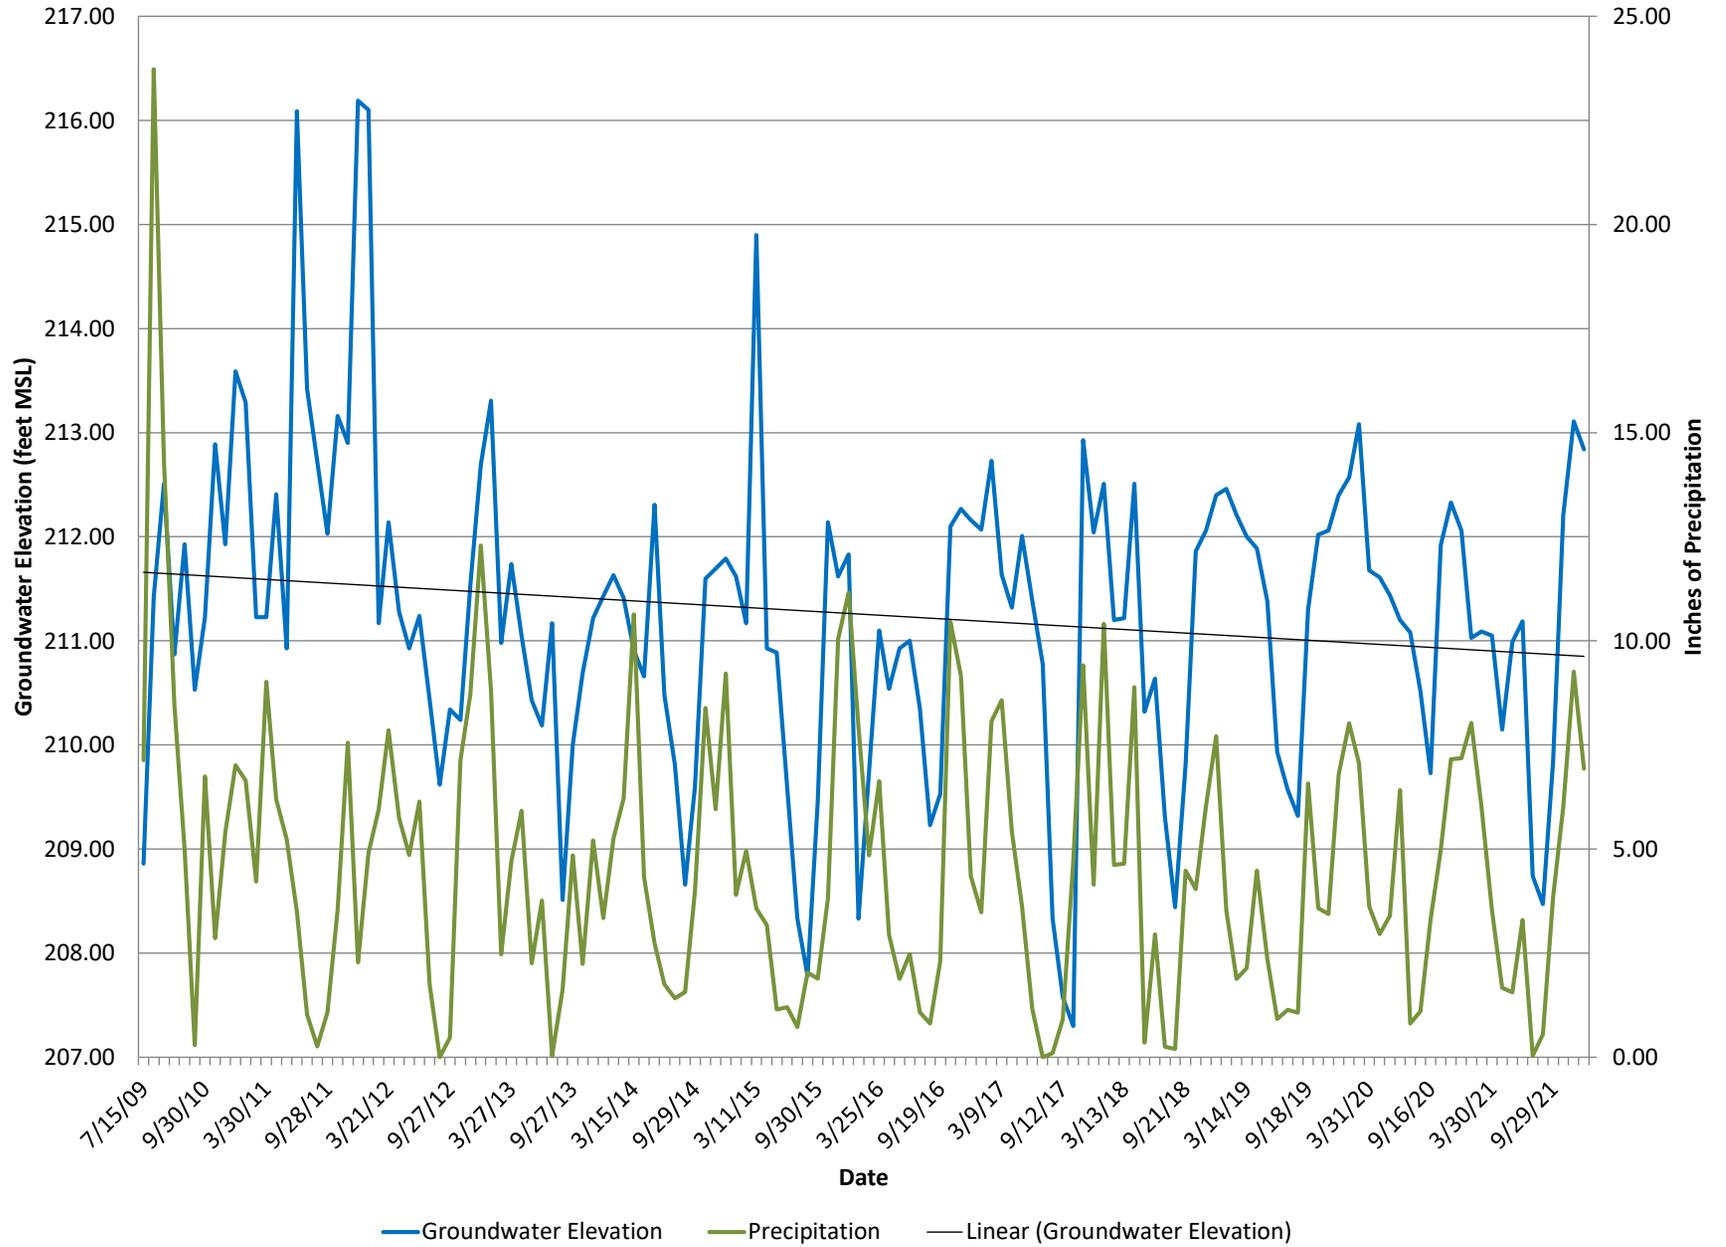

Hydrograph
Cathcart Landfill Deep Aquifer
Well G-08D2

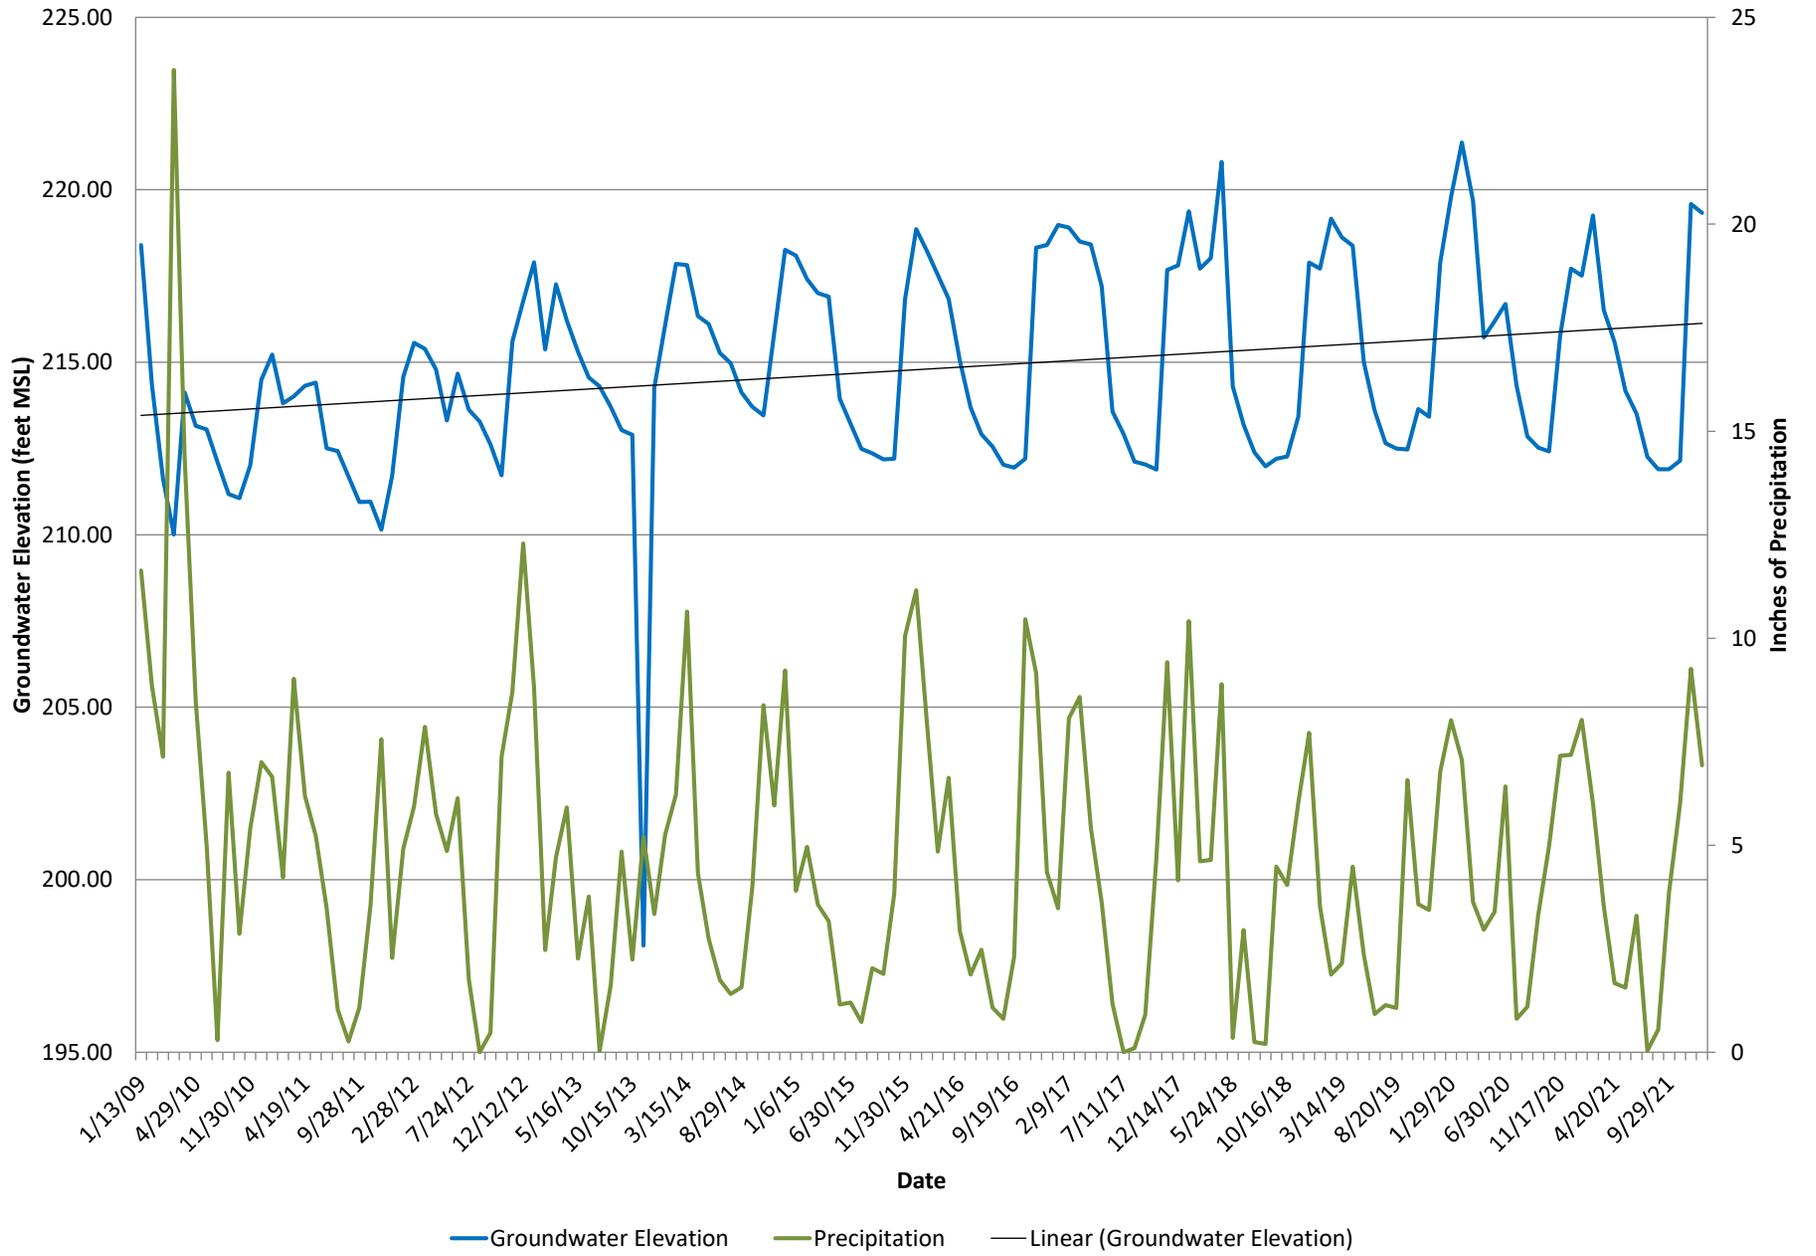


Hydrograph
Cathcart Landfill Deep Aquifer
Well G-09D

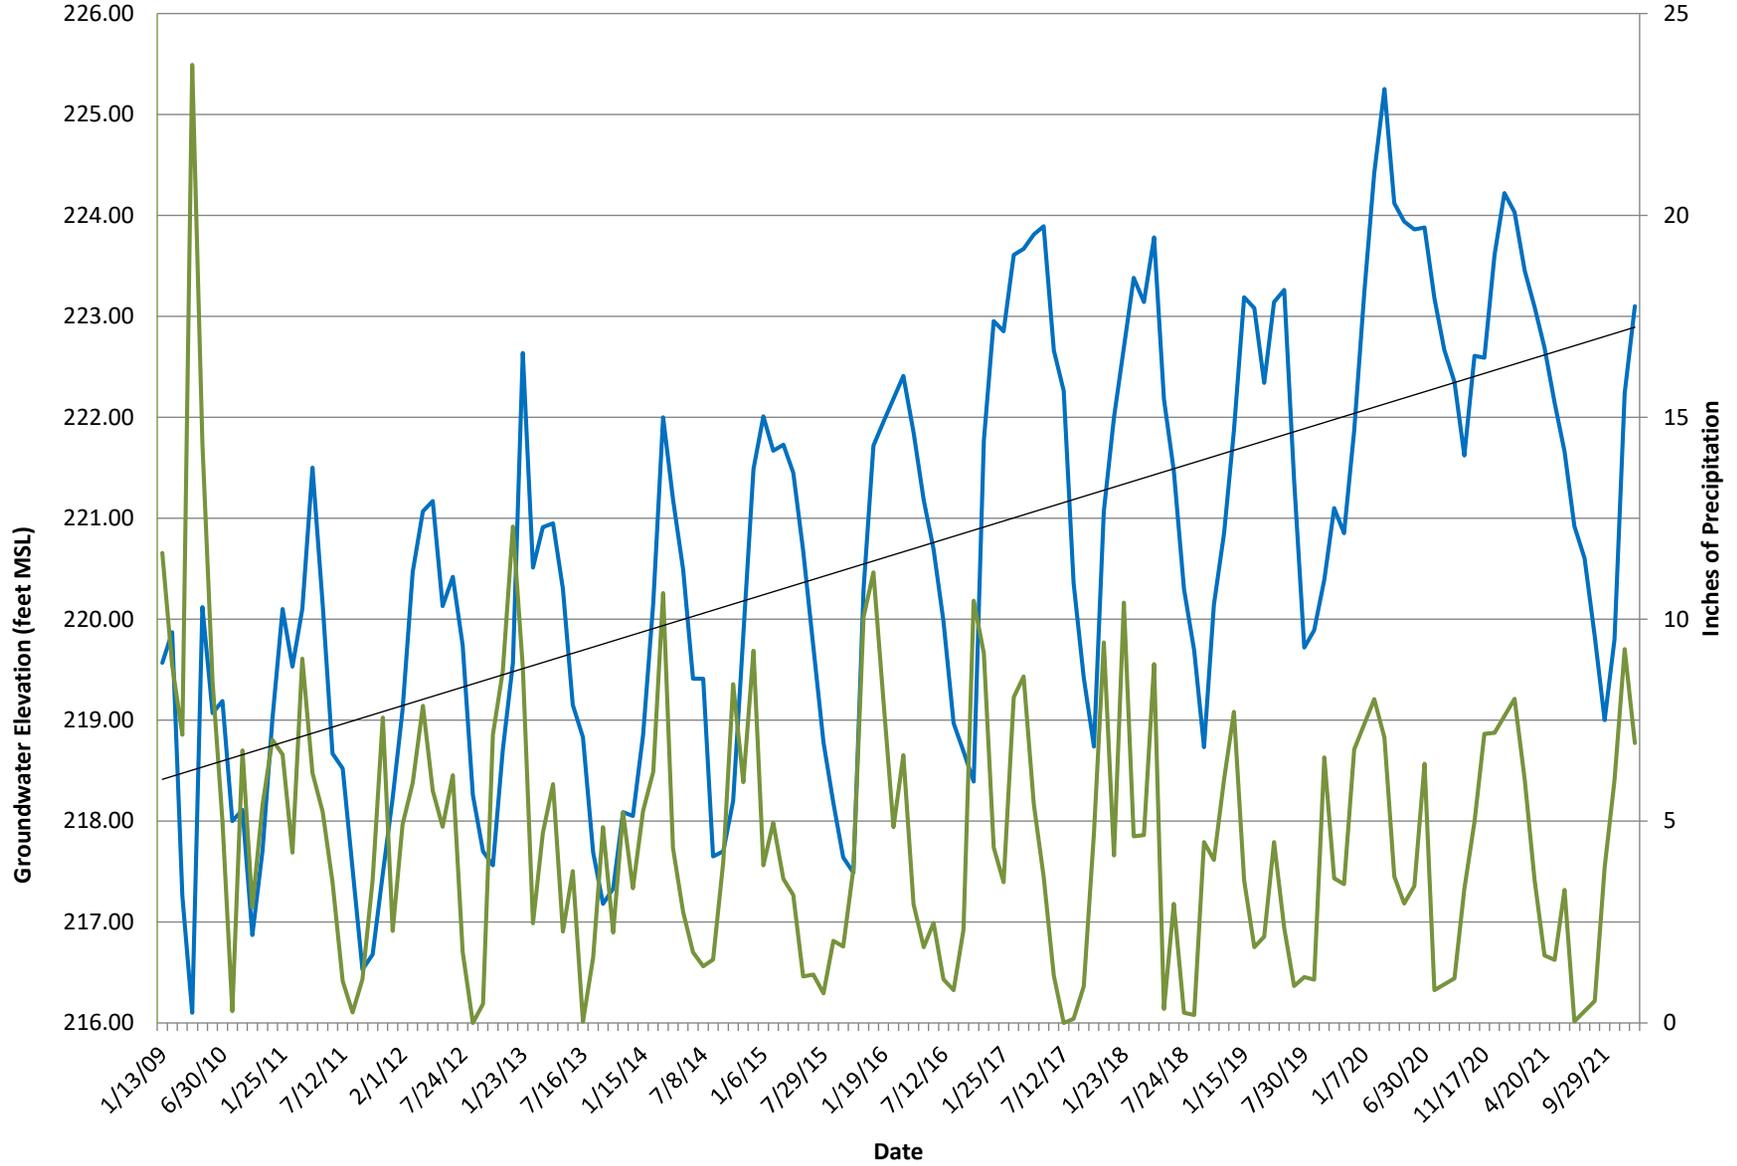


— Groundwater Elevation — Precipitation — Linear (Groundwater Elevation)


Hydrograph
Cathcart Landfill Deep Aquifer
Well G-10D

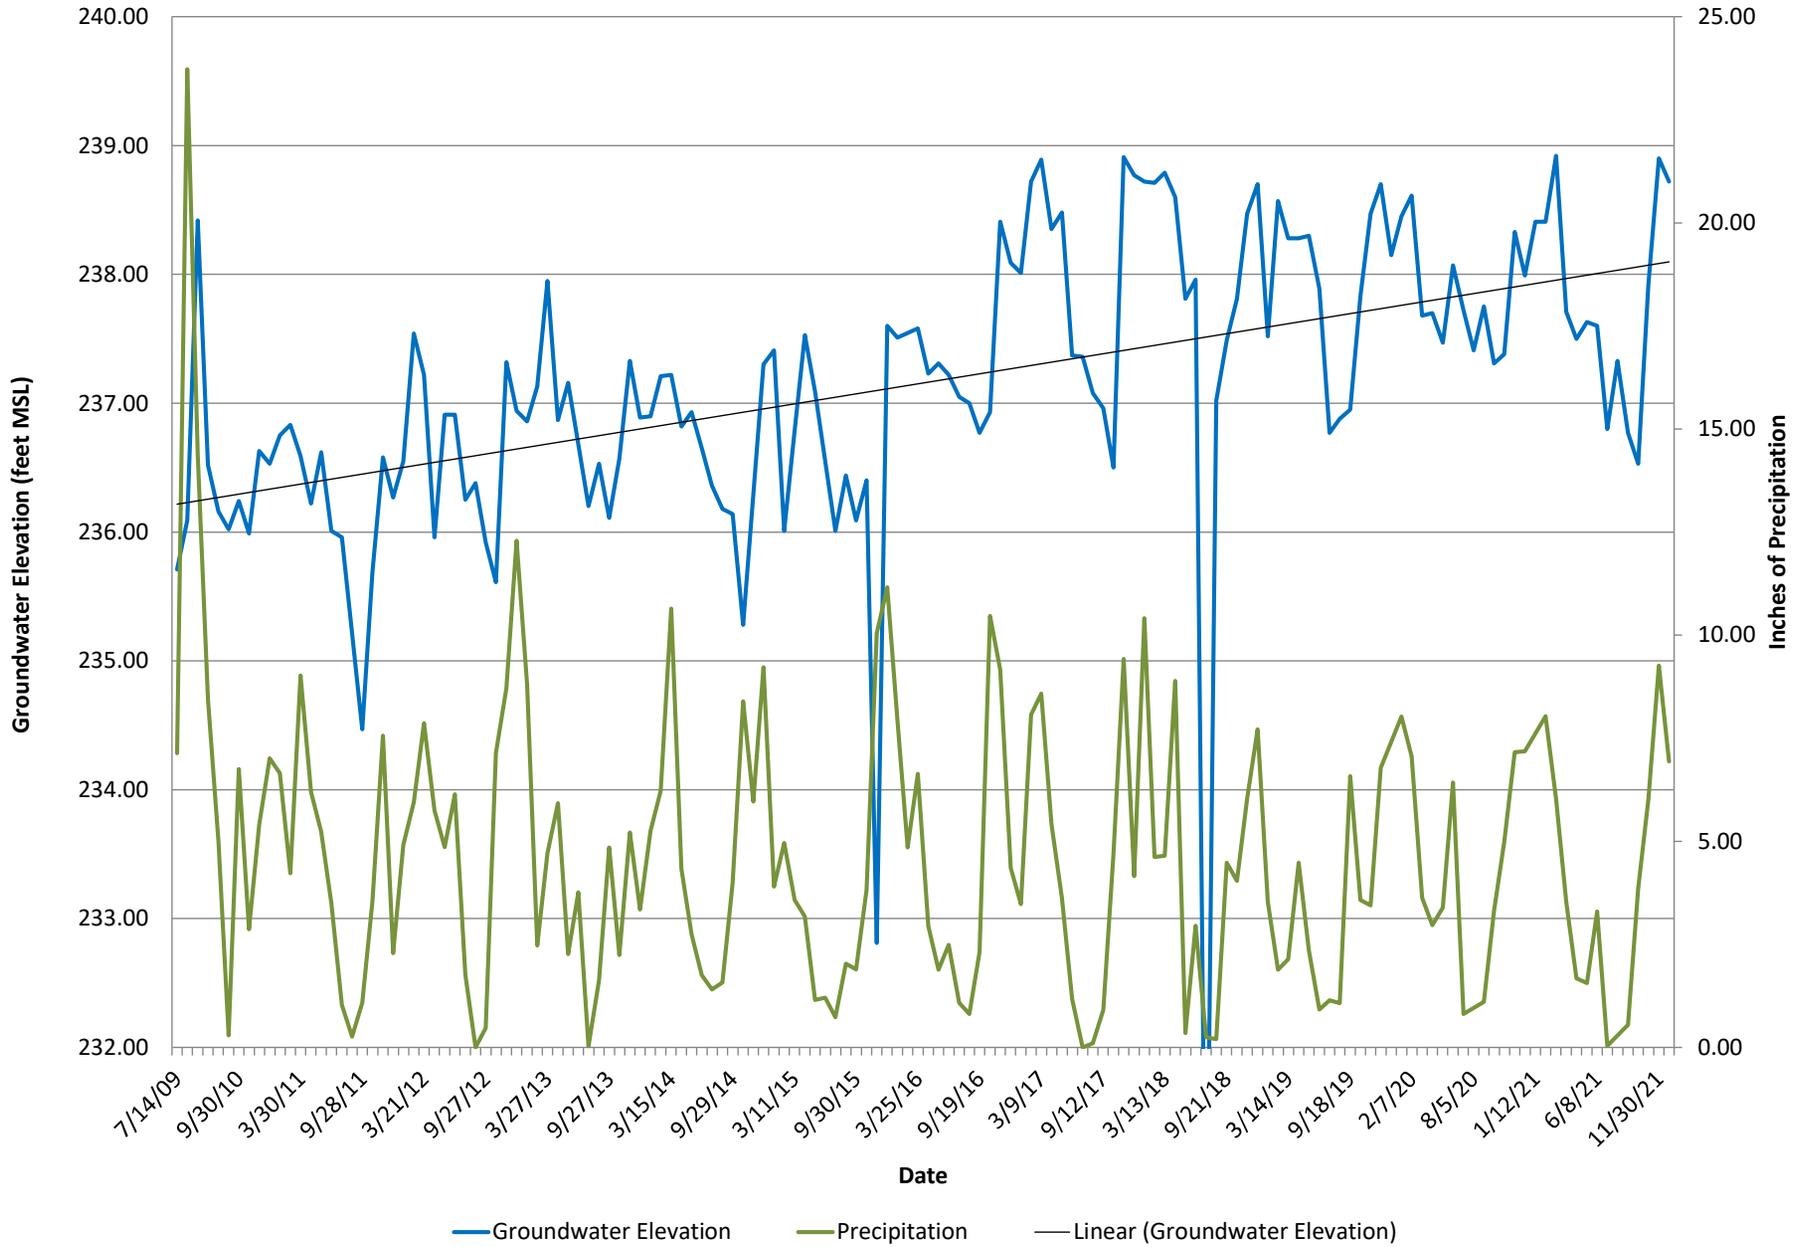


Hydrograph
Cathcart Landfill Deep Aquifer
Well G-13D

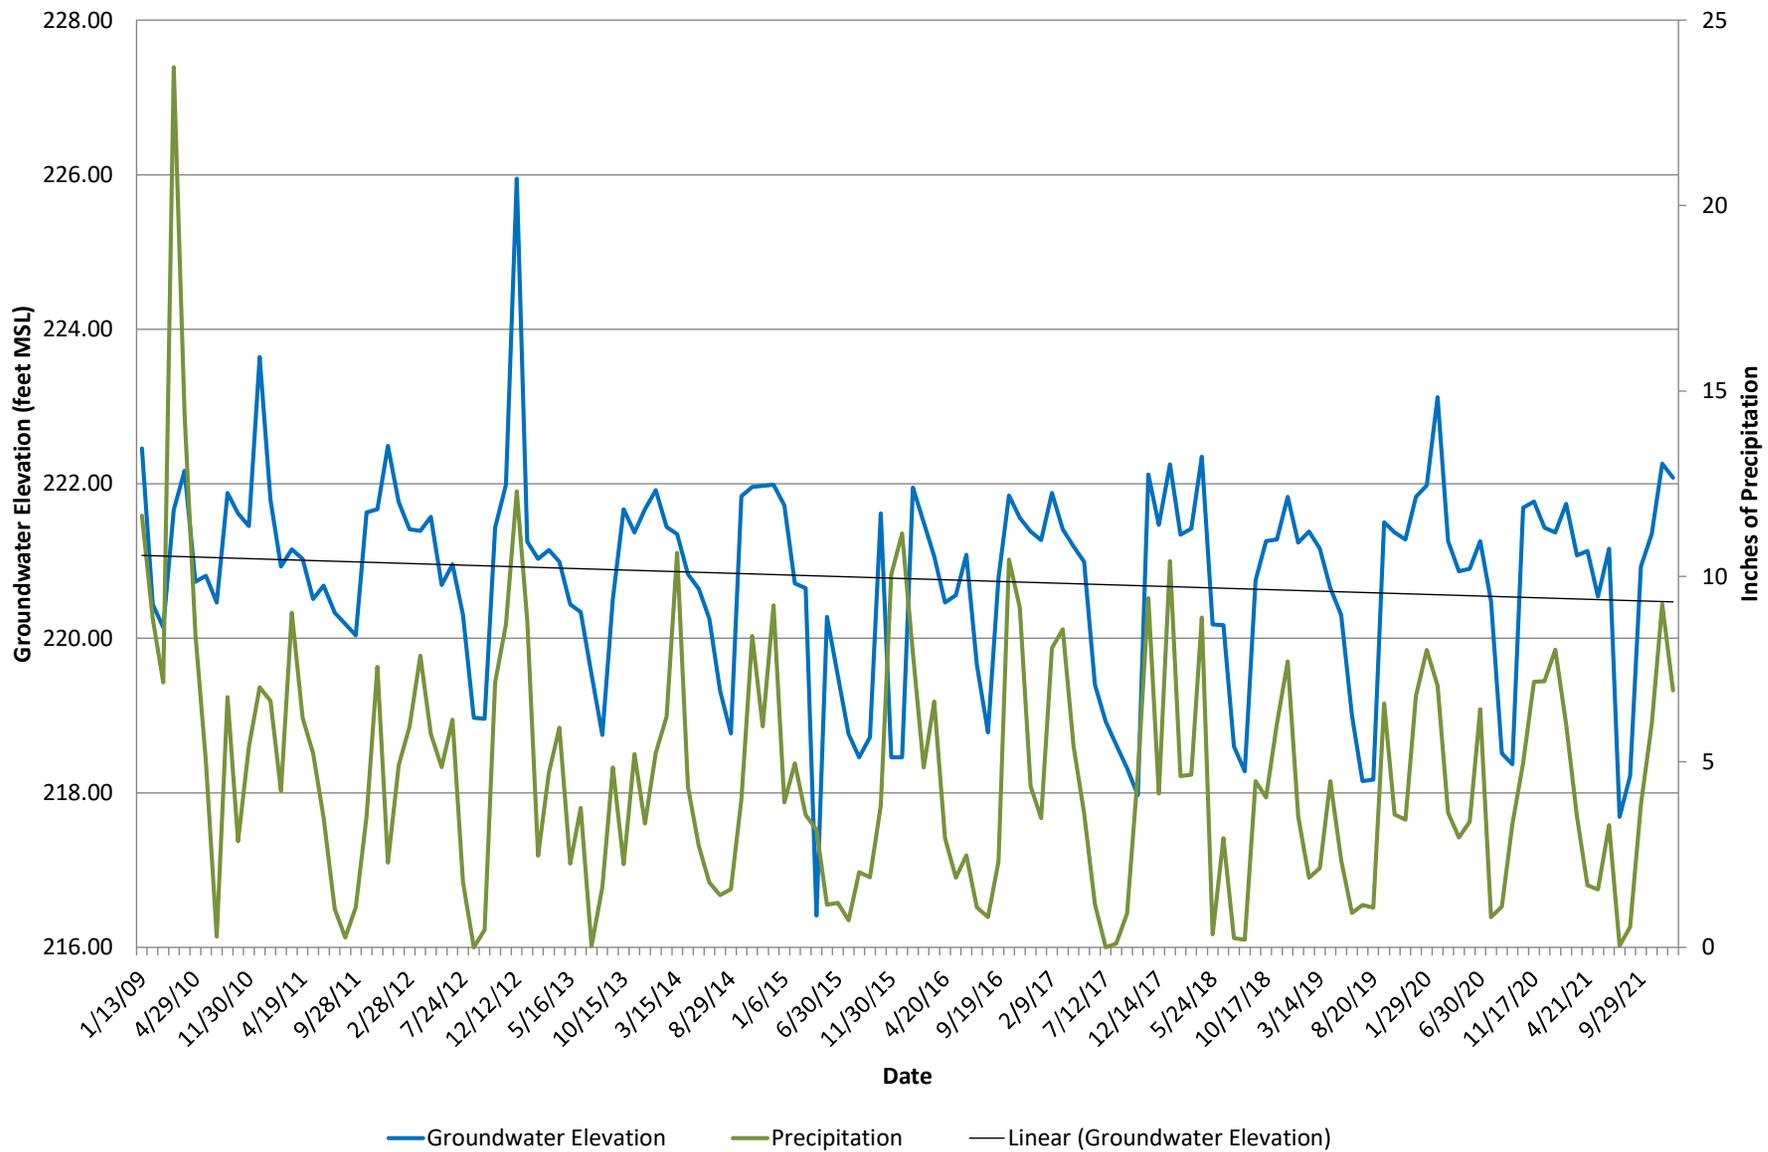

Hydrograph
Cathcart Landfill Deep Aquifer
Well G-14D

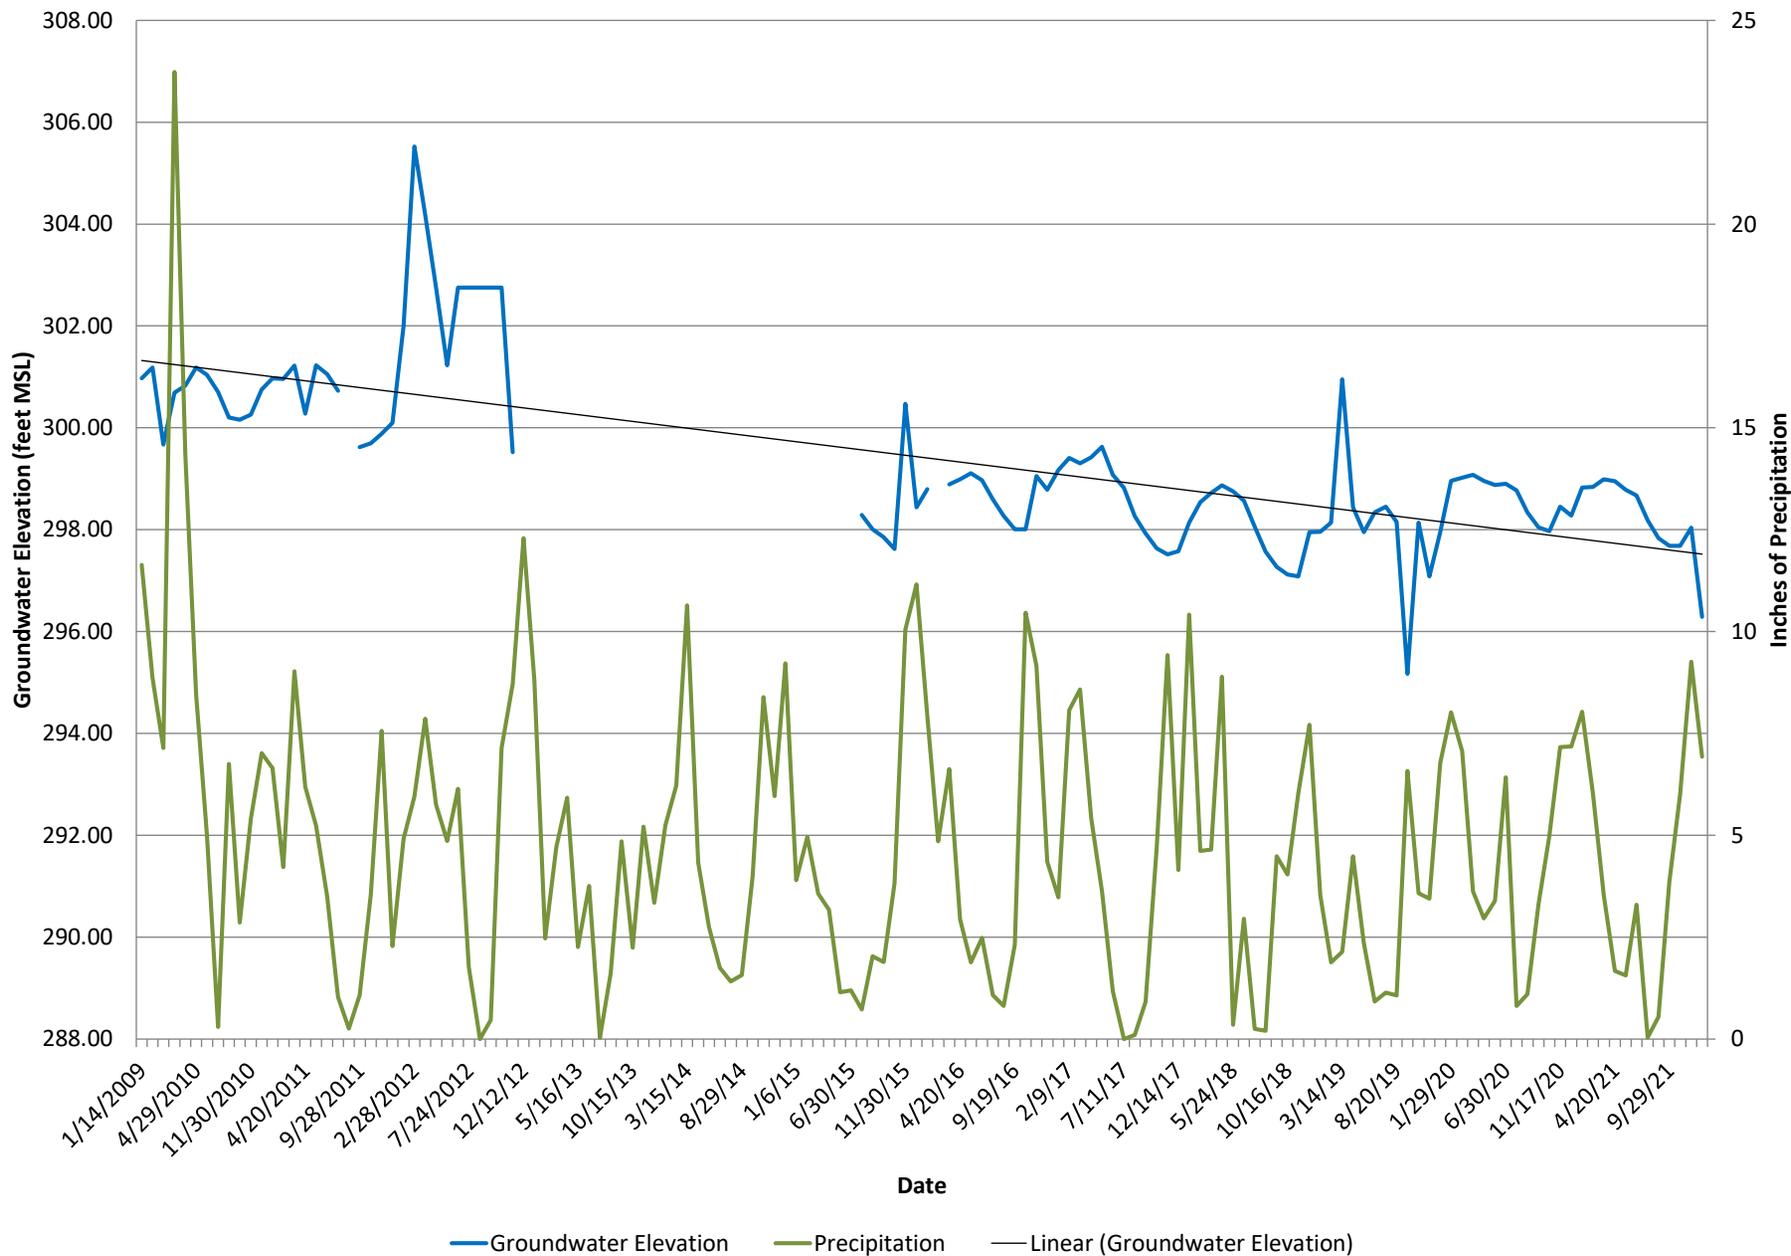

Hydrograph
Cathcart Landfill Deep Aquifer
Well G-24D

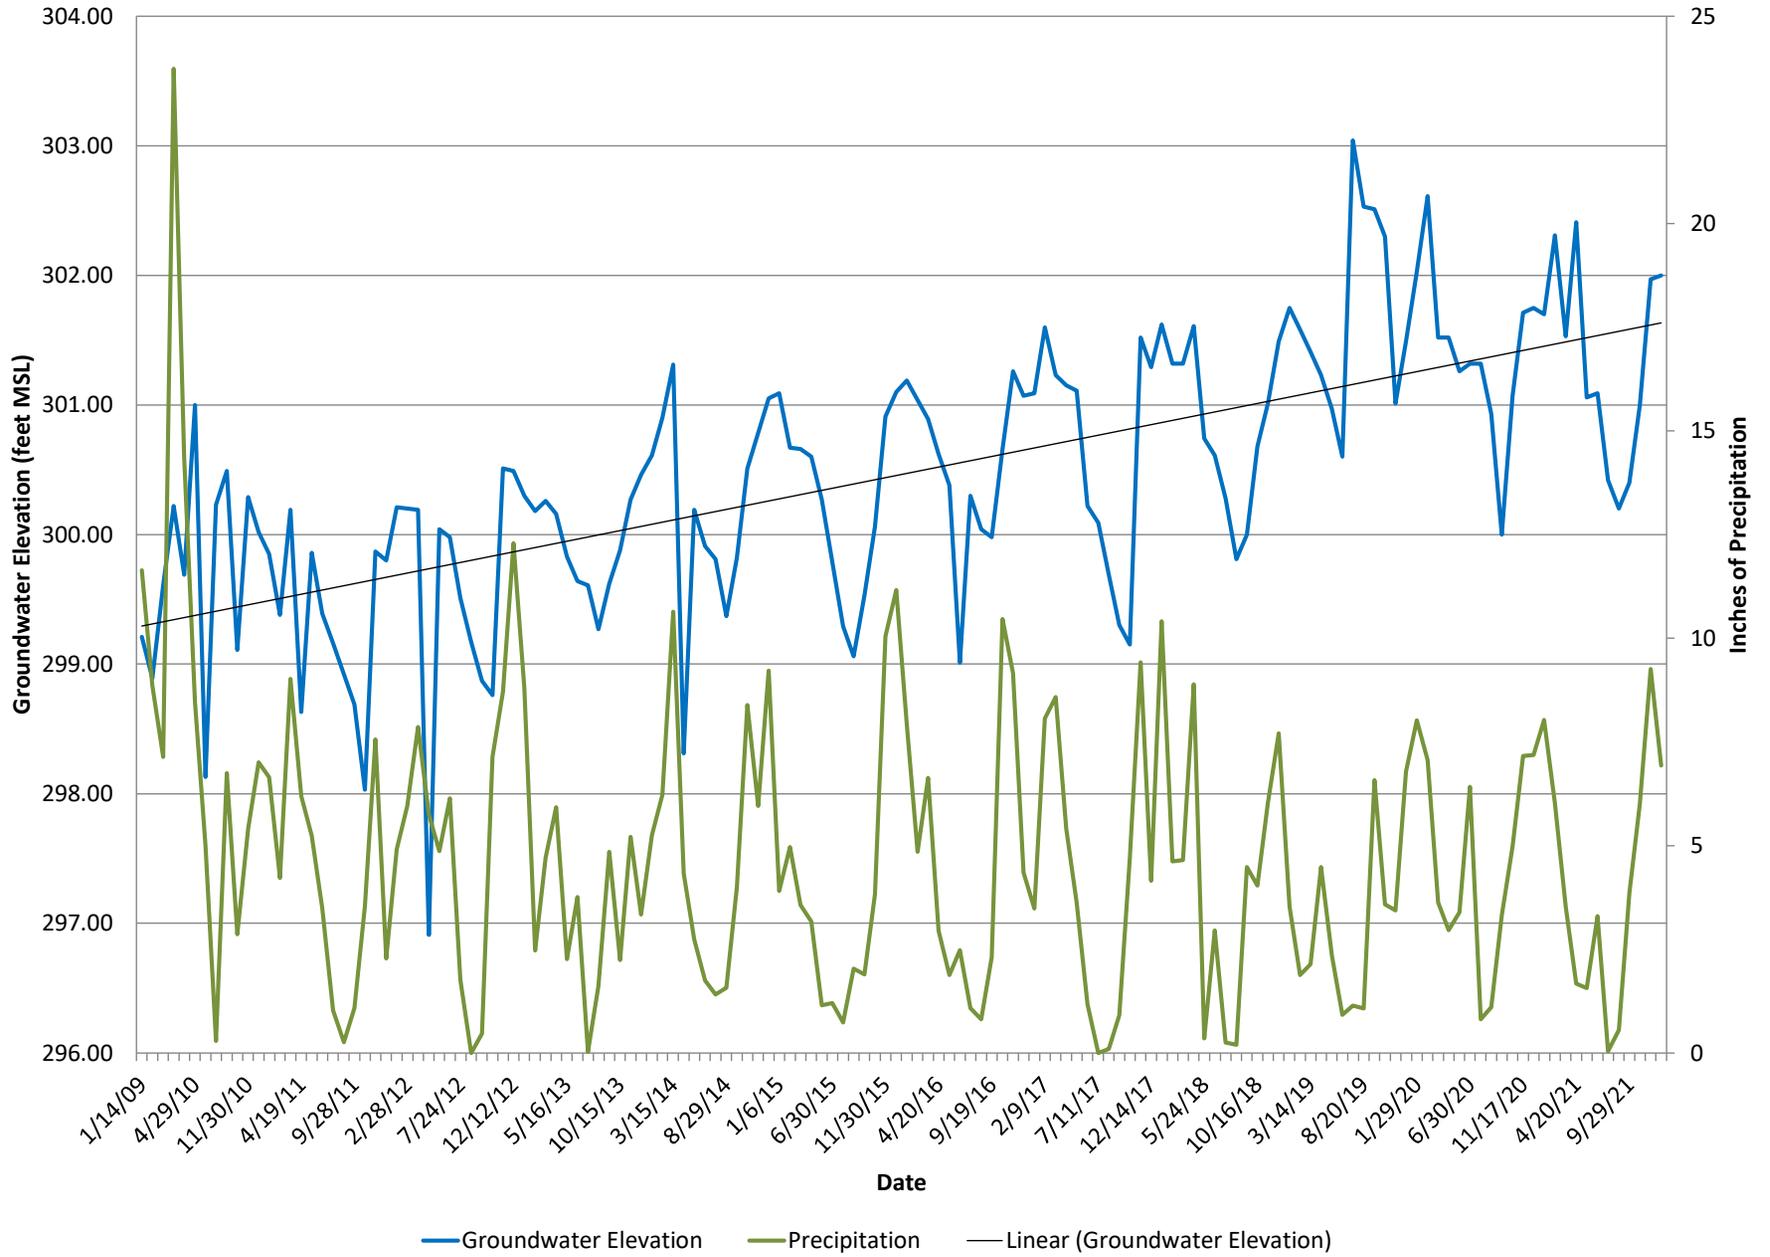

Site: **Cathcart Landfill - Deep Aquifer**

Measurement Date: **4/20/2021**

Well ID	[X] matrix			[D] matrix	Pt										
	X-axis	Y-axis	GW Elev.	D											
G-01D	431.12	3977.30	205.38	1											
G-02D	733.79	3884.79	212.86	1		431.12	733.79	488.43	728.1	739.2	496	220.3	1266	781	
G-06B	488.43	3765.90	210.15	1		3977.3	3884.79	3765.9	4156	3614.85	3593	3939	2338	528.9	
G-08D2	728.12	4156.36	215.58	1		205.38	212.86	210.15	215.6	222.69	237.5	221.1	299	302.4	
G-09D	739.20	3614.85	222.69	1											
G-10D	495.97	3593.41	237.50	1	{[P]t{[P]}										
G-13D	220.31	3939.18	221.13	1		4546675.575	18125521.98	1450122							
G-14D	1266.00	2337.53	298.95	1		18125521.98	109608443.7	6719437							
G-24D	780.99	528.85	302.41	1		1450121.998	6719437.064	513846.6							
10	0	0	0	1											
11	0	0	0	1	{[P]t{[P]}										
12	0	0	0	1		2.3694E-06	9.12601E-08	-7.88E-06							
13	0	0	0	1		9.12601E-08	4.95129E-08	-9.05E-07							
14	0	0	0	1		-7.88005E-06	-9.05011E-07	3.6E-05							
15	0	0	0	1											
16	0	0	0	1	{[P]t{[P]}{[P]t										
17	0	0	0	1		-0.00023394	0.000415822	-0.000155	4E-04	0.000326544	-4E-04	-9E-04	9E-04	-5E-04	
18	0	0	0	1		5.04004E-05	6.66722E-05	4.08E-05	8E-05	4.49041E-05	8E-06	2E-05	-4E-05	-2E-04	
19	0	0	0	1		0.000400819	-0.001631093	0.000312	-0.002	-0.001075359	0.001	0.003	-0.001	0.004	
20	0	0	0	1											

{[P]t{[P]}{[P]t [D] = [A] matrix

- A -9.73368E-05
- B 8.77189E-05
- C 0.003266303

Groundwater Gradient:	0.0401
Conductivity (ft/day):	0.029
Effective porosity:	10%
GW velocity:	0.0116 ft/day
	4.25 ft/year
Flow direction:	137.98 degrees from the positive x-axis

This spreadsheet is from the paper, "A Spreadsheet Method For Estimating Hydraulic Gradient With Heads From Multiple Wells" submitted to Ground Water, March, 2002. To use the program, enter the coordinates for the well locations in the columns labeled x and y (part of the [X] matrix), and the water levels in the z column. The matrices are automatically updated and the gradient magnitude and direction are calculated in cell H30 and H35.

Site: **Cathcart Landfill - Deep Aquifer**

Measurement Date: **10/19/2021**

Well ID	[X] matrix			[D] matrix	Pt															
	X-axis	Y-axis	GW Elev.	D																
G-01D	431.12	3977.30	206.76	1																
G-02D	733.79	3884.79	210.77	1		431.12	733.79	488.43	728.1	739.2	496	220.3	1266	781						
G-06B	488.43	3765.90	212.21	1		3977.3	3884.79	3765.9	4156	3614.85	3593	3939	2338	528.9						
G-08D2	728.12	4156.36	212.15	1		206.76	210.77	212.21	212.2	219.8	237.9	221.4	297.7	301						
G-09D	739.20	3614.85	219.80	1																
G-10D	495.97	3593.41	237.92	1	{{P}t{P}}															
G-13D	220.31	3939.18	221.35	1		4546675.575	18125521.98	1443104												
G-14D	1266.00	2337.53	297.68	1		18125521.98	109608443.7	6698523												
G-24D	780.99	528.85	301.00	1		1443103.509	6698522.56	510342.6												
10	0	0	0	1																
11	0	0	0	1	{{P}t{P}}															
12	0	0	0	1		2.29734E-06	8.64405E-08	-7.63E-06												
13	0	0	0	1		8.64405E-08	4.93636E-08	-8.92E-07												
14	0	0	0	1		-7.63079E-06	-8.92354E-07	3.52E-05												
15	0	0	0	1																
16	0	0	0	1	{{P}t{P}}{P}t															
17	0	0	0	1		-0.000243515	0.000413224	-0.000172	4E-04	0.000333412	-4E-04	-8E-04	8E-04	-5E-04						
18	0	0	0	1		4.90972E-05	6.71152E-05	3.88E-05	8E-05	4.61996E-05	8E-06	2E-05	-4E-05	-2E-04						
19	0	0	0	1		0.000449303	-0.001636405	0.000393	-0.002	-0.0011185	0.001	0.003	-0.001	0.004						
20	0	0	0	1																

{{P}t{P}}{P}t [D] = [A] matrix

- A -8.13961E-05
- B 8.80875E-05
- C 0.003227335

Groundwater Gradient:	0.0372	
Conductivity (ft/day):	0.029	
Effective porosity:	10%	
GW velocity:	0.0108	ft/day
	3.93	ft/year
Flow direction:	132.74	degrees from the positive x-axis

This spreadsheet is from the paper, "A Spreadsheet Method For Estimating Hydraulic Gradient With Heads From Multiple Wells" submitted to Ground Water, March, 2002. To use the program, enter the coordinates for the well locations in the columns labeled x and y (part of the [X] matrix), and the water levels in the z column. The matrices are automatically updated and the gradient magnitude and direction are calculated in cell H30 and H35.

Appendix B

Groundwater Analytical Summary Tables

Shallow Wells

Groundwater Analytical Summary - Shallow Wells: First Quarter 2021
Cathcart Landfill, Snohomish County, WA

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09S				G-10S						
						1/12/21	D	V	Tr	Ch	1/12/21	D	V	Tr	Ch	
CONVENTIONAL CHEMISTRY PARAMETERS (mg/L)																
Alkalinity (as CaCO3)	nonpar	77	77	200	--	360		V	I	N	480		V	I	Y	
Ammonia Nitrogen	lognor	73	42	16.6482	--	0.02	U				0.274			I	N	
Bicarbonate	nonpar	77	77	200	--	360		V	I	N	480		V	I	Y	
Calcium, Dissolved	normal	75	75	23.8526	--	79.7		V	D	N	104		V	D	N	
Chemical Oxygen Demand	nonpar	77	10	16	--	10	U				10	U				
Chloride	nonpar	77	76	18.3	250	3.96				D	N	10.6			D	N
Conductivity (umhos/cm)	nonpar	76	76	540	700	980		V	D	N	1400		V			
Magnesium, Dissolved	lognor	73	64	53.3909	--	31.4				D	N	24.7			D	N
Nitrate Nitrogen (mg-N/L)	lognor	74	69	2.2263	10	0.024					0.01	U				
Nitrite Nitrogen (mg-N/L)	lognor	69	43	36.85	1	0.002	U				0.002	U				
pH (std units)	normal	77	77	6.00-9.39	6.5-8.5	6.43			I	N	6.70					
Potassium, Dissolved	lognor	75	74	2.7509	--	4.82		V	D	N	3.69		V			
Sodium, Dissolved	normal	75	75	123	20	88.5					181		V			
Sulfate	normal	76	76	169	250	187				D	N	294			D	N
Total Dissolved Solids	normal	77	77	404.5425	500	680		V	D	N	970		V			
Total Organic Carbon	nonpar	77	68	16	--	5.1					4.6					
DISSOLVED METALS EPA Methods 200.7/200.8 (mg/L)																
Antimony	nonpar	77	34	0.0019	0.006	0.0003	U				0.0003	U				
Arsenic	nonpar	72	68	0.0038	0.00005	0.000607					0.00501		V		Y	
Barium	lognor	70	55	2.8609	1	0.005	U			Y	0.0053					
Beryllium	nonpar	77	0	0.0005	0.004	0.005	U				0.005	U				
Cadmium	nonpar	72	35	0.001	0.005	0.00005	U				0.00005	U				
Chromium	nonpar	75	28	0.015	0.05	0.01	U				0.01	U				
Cobalt	nonpar	76	5	0.003	--	0.01	U				0.01	U				
Copper	nonpar	73	39	0.115	1	0.02	U			Y	0.02	U				
Iron	lognor	74	46	10.4257	0.3	0.02	U				9.44				Y	
Lead	nonpar	77	33	0.0027	0.05	0.0001	U				0.00019					
Manganese	lognor	70	55	6.9361	0.05	0.054					3.22			D	N	
Nickel	nonpar	75	19	0.038	0.1	0.02					0.01	U				
Selenium	nonpar	76	6	0.002	0.01	0.0005	U			D	Y	0.0005	U			
Silver	nonpar	71	4	0.0002	0.05	0.0001	U				0.0001	U				
Thallium	nonpar	76	6	0.0001	0.002	0.00005	U				0.00005	U				
Vanadium	nonpar	77	2	0.005	--	0.01	U				0.01	U				
Zinc	nonpar	76	33	0.03	5	0.01	U				0.01	U				
TOTAL METALS EPA Methods 200.7/200.8 (mg/L)																
Antimony					0.006	0.0003	U				0.0003	U				
Arsenic					0.00005	0.000717					0.0048					
Barium					1	0.0057					0.005	U				
Beryllium					0.004	0.005	U				0.005	U				
Cadmium					0.005	0.00005	U				0.00005	U				
Chromium					0.05	0.01	U				0.01	U				
Cobalt					--	0.01	U				0.01	U				
Copper					1	0.01	U				0.01	U				
Iron					0.3	0.373					9.49					
Lead					0.05	0.000535					0.0001	U				
Manganese					0.05	0.087					3.16					
Nickel					0.1	0.025					0.01	U				
Selenium					0.01	0.0005	U				0.0005	U				
Silver					0.05	0.0001	U				0.0001	U				
Thallium					0.002	0.0001	U				0.0001	U				
Vanadium					--	0.02	U				0.02	U				
Zinc					5	0.01	U				0.01	U				
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260/8260 SIM (µg/L)																
1,1,1-Trichloroethane					200	1	U				1	U				
1,1,2,2-Tetrachloroethane					--	1	U				1	U				
1,1,2-Trichloroethane					--	1	U				1	U				
1,1-Dichloroethane					1	1	U				1	U				
1,1-Dichloroethylene					--	1	U				1	U				
1,2,3-Trichloropropane					--	1	U				1	U				
1,2-Dibromo-3-chloropropane					0.2	0.05	U				0.05	U				
1,2-Dibromoethane					0.001	0.01	U				0.01	U				
1,2-Dichlorobenzene					--	1	U				1	U				

Groundwater Analytical Summary - Shallow Wells: First Quarter 2021
Cathcart Landfill, Snohomish County, WA

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09S				G-10S					
						1/12/21	D	V	Tr	Ch	1/12/21	D	V	Tr	Ch
						VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260/8260 SIM (µg/L) (cont.)									
1,2-Dichloroethane					0.5	0.03	U				0.03	U			
1,2-Dichloropropane					0.6	0.02	U				0.02	U			
1,4-Dichlorobenzene					4	1	U				1	U			
2-Butanone					--	5	U				5	U			
2-Hexanone					--	5	U				5	U			
4-Methyl-2-Pentanone (MIBK)					--	5	U				5	U			
Acetone					--	5	U				5	U			
Acrylonitrile					0.07	0.03	U				0.03	U			
Benzene					1	1	U				1	U			
Bromodichloromethane					0.3	0.02	U				0.02	U			
Bromoform					5	1	U				1	U			
Bromomethane					--	1	U				1	U			
Carbon Disulfide					--	1	U				1	U			
Carbon Tetrachloride					0.3	0.02	U				0.02	U			
Chlorobenzene					--	0.03	U				0.03	U			
Chlorodibromomethane					0.5	0.5	U				0.5	U			
Chloroethane					--	1	U				1	U			
Chloroform					7	1	U				1	U			
Chloromethane					--	2	U				2	U			
cis-1,2-Dichloroethene					--	0.08					0.1				
cis-1,3-Dichloropropene					0.2	0.03	U				0.03	U			
Dibromomethane					--	0.02	U				0.02	U			
Ethyl Benzene					--	1	U				1	U			
m,p-Xylene					--	1	U				1	U			
Methyl Iodide					--	1	U				1	U			
Methylene Chloride					5	2	U				2	U			
o-Xylene					--	1	U				1	U			
Styrene					--	1	U				1	U			
Tetrachloroethylene					0.8	0.02	U				0.02	U			
Toluene					--	2	U				2	U			
trans-1,2-Dichloroethene					--	1	U				1	U			
trans-1,3-Dichloropropene					0.2	0.02	U				0.02	U			
trans-1,4-Dichloro-2-butene					--	5	U				5	U			
Trichlorethene (1,1,2-Trichloroethylene)					3	1	U				1	U			
Trichlorofluoromethane					--	1	U				1	U			
Vinyl Acetate					--	5	U				5	U			
Vinyl Chloride					0.02	0.01	U				0.01	U			

D: U = Indicates compound was not detected at the given reporting limit; X indicates that the compound was detected in the trip blank and contamination is suspected.
V: E= Exceedance, waiting verification based on subsequent lab data; V= Exceedance verified based on previous lab data; P=Passed, previous exceedance not verified based on current lab data.
Tr: I=increasing Trend, D=Decreasing Trend;
Ch: Y indicates a change in trend from previous quarter; N means no change in trend.
Values in purple exceed the prediction limit; indicates that a value exceeded the Groundwater Standards
The groundwater standards listed are based on the Washington Administrative Code (WAC) 173-200 groundwater limits as modified by the TMS 91-11 standards - the most restrictive of the two is used.
B = Methylene chloride was measured in the lab blank at a similar concentration - contamination during analysis suspected.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01A	10/15/2020		34.0000		230.0000
Ammonia nitrogen	mg-N/L	G-01A	10/15/2020		0.0720		12.5375
Bicarbonate	mg/L	G-01A	10/15/2020		34.0000		200.0000
Chemical oxygen demand	mg/L	G-01A	10/15/2020	ND	10.0000		16.0000
Chloride	mg/L	G-01A	10/15/2020		2.4800		18.3000
Conductivity	umhos/cm	G-01A	10/15/2020		160.0000		548.9315
Dissolved antimony	mg/L	G-01A	10/15/2020	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-01A	10/15/2020		0.0002		0.0035
Dissolved barium	mg/L	G-01A	10/15/2020	ND	0.0050		3.7002
Dissolved beryllium	mg/L	G-01A	10/15/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01A	10/15/2020	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-01A	10/15/2020		14.9000		23.8179
Dissolved chromium	mg/L	G-01A	10/15/2020	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-01A	10/15/2020	ND	0.0100		0.0030
Dissolved copper	mg/L	G-01A	10/15/2020	ND	0.0100		0.1150
Dissolved iron	mg/L	G-01A	10/15/2020	ND	0.0500		9.8243
Dissolved lead	mg/L	G-01A	10/15/2020		0.0002		0.0027
Dissolved magnesium	mg/L	G-01A	10/15/2020		3.9800		51.3609
Dissolved manganese	mg/L	G-01A	10/15/2020	ND	0.0050		6.4627
Dissolved nickel	mg/L	G-01A	10/15/2020	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-01A	10/15/2020		1.2100		2.6321
Dissolved selenium	mg/L	G-01A	10/15/2020	ND	0.0005		0.0003
Dissolved silver	mg/L	G-01A	10/15/2020	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-01A	10/15/2020		6.7700		121.6395
Dissolved thallium	mg/L	G-01A	10/15/2020	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-01A	10/15/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01A	10/15/2020	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-01A	10/15/2020		0.3900		1.3000
Nitrite nitrogen	mg-N/L	G-01A	10/15/2020	ND	0.0020		0.0210
pH	std units	G-01A	10/15/2020		6.0100		6.00 - 9.39
Sulfate	mg/L	G-01A	10/15/2020		36.0000		338.8047
Total dissolved solids	mg/L	G-01A	10/15/2020		120.0000		397.5917
Total organic carbon	mg/L	G-01A	10/15/2020		5.2000		14.0000
Alkalinity (as caco3)	mg/L	G-04A	10/15/2020		230.0000		230.0000
Ammonia nitrogen	mg-N/L	G-04A	10/15/2020		0.1910		12.5375
Bicarbonate	mg/L	G-04A	10/15/2020		230.0000	*	200.0000
Chemical oxygen demand	mg/L	G-04A	10/15/2020	ND	10.0000	**	16.0000
Chloride	mg/L	G-04A	10/15/2020		5.5100		18.3000
Conductivity	umhos/cm	G-04A	10/15/2020		510.0000		548.9315
Dissolved antimony	mg/L	G-04A	10/15/2020	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-04A	10/15/2020		0.0108	***	0.0035
Dissolved barium	mg/L	G-04A	10/15/2020	ND	0.0050		3.7002
Dissolved beryllium	mg/L	G-04A	10/15/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-04A	10/15/2020	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-04A	10/15/2020		46.5000	***	23.8179
Dissolved chromium	mg/L	G-04A	10/15/2020	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-04A	10/15/2020		0.0110	***	0.0030
Dissolved copper	mg/L	G-04A	10/15/2020	ND	0.0100		0.1150
Dissolved iron	mg/L	G-04A	10/15/2020		16.9000	***	9.8243
Dissolved lead	mg/L	G-04A	10/15/2020	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-04A	10/15/2020		27.1000		51.3609
Dissolved manganese	mg/L	G-04A	10/15/2020		6.8300	*	6.4627
Dissolved nickel	mg/L	G-04A	10/15/2020		0.0120		0.0380
Dissolved potassium	mg/L	G-04A	10/15/2020		2.4200		2.6321
Dissolved selenium	mg/L	G-04A	10/15/2020	ND	0.0005		0.0003
Dissolved silver	mg/L	G-04A	10/15/2020	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-04A	10/15/2020		14.4000		121.6395
Dissolved thallium	mg/L	G-04A	10/15/2020	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-04A	10/15/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-04A	10/15/2020	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0020		0.0210
pH	std units	G-04A	10/15/2020		6.7100		6.00 - 9.39
Sulfate	mg/L	G-04A	10/15/2020		32.3000		338.8047
Total dissolved solids	mg/L	G-04A	10/15/2020		330.0000		397.5917
Total organic carbon	mg/L	G-04A	10/15/2020		8.6000	**	14.0000
Alkalinity (as caco3)	mg/L	G-08D1	10/14/2020		180.0000		230.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-08D1	10/14/2020		0.1720		12.5375
Bicarbonate	mg/L	G-08D1	10/14/2020		80.0000		200.0000
Chemical oxygen demand	mg/L	G-08D1	10/14/2020	ND	10.0000		16.0000
Chloride	mg/L	G-08D1	10/14/2020		3.1600		18.3000
Conductivity	umhos/cm	G-08D1	10/14/2020		460.0000		548.9315
Dissolved antimony	mg/L	G-08D1	10/14/2020	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-08D1	10/14/2020		0.0019		0.0035
Dissolved barium	mg/L	G-08D1	10/14/2020	ND	0.0050		3.7002
Dissolved beryllium	mg/L	G-08D1	10/14/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D1	10/14/2020	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-08D1	10/14/2020		0.7200		23.8179
Dissolved chromium	mg/L	G-08D1	10/14/2020	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-08D1	10/14/2020	ND	0.0100		0.0030
Dissolved copper	mg/L	G-08D1	10/14/2020	ND	0.0100		0.1150
Dissolved iron	mg/L	G-08D1	10/14/2020	ND	0.0500		9.8243
Dissolved lead	mg/L	G-08D1	10/14/2020	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-08D1	10/14/2020	ND	0.2000		51.3609
Dissolved manganese	mg/L	G-08D1	10/14/2020	ND	0.0050		6.4627
Dissolved nickel	mg/L	G-08D1	10/14/2020	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-08D1	10/14/2020	ND	0.5000		2.6321
Dissolved selenium	mg/L	G-08D1	10/14/2020	ND	0.0005		0.0003
Dissolved silver	mg/L	G-08D1	10/14/2020	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-08D1	10/14/2020		110.0000		121.6395
Dissolved thallium	mg/L	G-08D1	10/14/2020	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-08D1	10/14/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D1	10/14/2020	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-08D1	10/14/2020		0.4700		1.3000
Nitrite nitrogen	mg-N/L	G-08D1	10/14/2020		0.0030		0.0210
pH	std units	G-08D1	10/14/2020		9.6700	***	6.00 - 9.39
Sulfate	mg/L	G-08D1	10/14/2020		49.1000		338.8047
Total dissolved solids	mg/L	G-08D1	10/14/2020		300.0000		397.5917
Total organic carbon	mg/L	G-08D1	10/14/2020		1.3000		14.0000
Alkalinity (as cacO3)	mg/L	G-09S	01/12/2021		360.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-09S	01/12/2021	ND	0.0200		12.5375
Bicarbonate	mg/L	G-09S	01/12/2021		360.0000	***	200.0000
Chemical oxygen demand	mg/L	G-09S	01/12/2021	ND	10.0000		16.0000
Chloride	mg/L	G-09S	01/12/2021		3.9600		18.3000
Conductivity	umhos/cm	G-09S	01/12/2021		980.0000	***	548.9315
Dissolved antimony	mg/L	G-09S	01/12/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-09S	01/12/2021		0.0006		0.0035
Dissolved barium	mg/L	G-09S	01/12/2021	ND	0.0050		3.7002
Dissolved beryllium	mg/L	G-09S	01/12/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09S	01/12/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-09S	01/12/2021		79.7000	***	23.8179
Dissolved chromium	mg/L	G-09S	01/12/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-09S	01/12/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-09S	01/12/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-09S	01/12/2021	ND	0.0200		9.8243
Dissolved lead	mg/L	G-09S	01/12/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-09S	01/12/2021		31.4000		51.3609
Dissolved manganese	mg/L	G-09S	01/12/2021		0.0540		6.4627
Dissolved nickel	mg/L	G-09S	01/12/2021		0.0200		0.0380
Dissolved potassium	mg/L	G-09S	01/12/2021		4.8200	***	2.6321
Dissolved selenium	mg/L	G-09S	01/12/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-09S	01/12/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-09S	01/12/2021		88.5000		121.6395
Dissolved thallium	mg/L	G-09S	01/12/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-09S	01/12/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09S	01/12/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-09S	01/12/2021		0.0240		1.3000
Nitrite nitrogen	mg-N/L	G-09S	01/12/2021	ND	0.0020		0.0210
pH	std units	G-09S	01/12/2021		6.4300		6.00 - 9.39
Sulfate	mg/L	G-09S	01/12/2021		187.0000		338.8047
Total dissolved solids	mg/L	G-09S	01/12/2021		680.0000	***	397.5917
Total organic carbon	mg/L	G-09S	01/12/2021		5.1000		14.0000
Alkalinity (as cacO3)	mg/L	G-10S	01/12/2021		480.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-10S	01/12/2021		0.2740		12.5375

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-10S	01/12/2021		480.0000	***	200.0000
Chemical oxygen demand	mg/L	G-10S	01/12/2021	ND	10.0000		16.0000
Chloride	mg/L	G-10S	01/12/2021		10.6000		18.3000
Conductivity	umhos/cm	G-10S	01/12/2021		1400.0000	***	548.9315
Dissolved antimony	mg/L	G-10S	01/12/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-10S	01/12/2021		0.0050	***	0.0035
Dissolved barium	mg/L	G-10S	01/12/2021		0.0053		3.7002
Dissolved beryllium	mg/L	G-10S	01/12/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10S	01/12/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-10S	01/12/2021		104.0000	***	23.8179
Dissolved chromium	mg/L	G-10S	01/12/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-10S	01/12/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-10S	01/12/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-10S	01/12/2021		9.4400		9.8243
Dissolved lead	mg/L	G-10S	01/12/2021		0.0002		0.0027
Dissolved magnesium	mg/L	G-10S	01/12/2021		24.7000		51.3609
Dissolved manganese	mg/L	G-10S	01/12/2021		3.2200		6.4627
Dissolved nickel	mg/L	G-10S	01/12/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-10S	01/12/2021		3.6900	***	2.6321
Dissolved selenium	mg/L	G-10S	01/12/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-10S	01/12/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-10S	01/12/2021		181.0000	***	121.6395
Dissolved thallium	mg/L	G-10S	01/12/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-10S	01/12/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10S	01/12/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-10S	01/12/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-10S	01/12/2021	ND	0.0020		0.0210
pH	std units	G-10S	01/12/2021		6.7000		6.00 - 9.39
Sulfate	mg/L	G-10S	01/12/2021		294.0000		338.8047
Total dissolved solids	mg/L	G-10S	01/12/2021		970.0000	***	397.5917
Total organic carbon	mg/L	G-10S	01/12/2021		4.6000		14.0000
Alkalinity (as cacO3)	mg/L	G-11S	10/14/2020		80.0000		230.0000
Ammonia nitrogen	mg-N/L	G-11S	10/14/2020		0.0360		12.5375
Bicarbonate	mg/L	G-11S	10/14/2020		80.0000		200.0000
Chemical oxygen demand	mg/L	G-11S	10/14/2020	ND	10.0000		16.0000
Chloride	mg/L	G-11S	10/14/2020		5.2900		18.3000
Conductivity	umhos/cm	G-11S	10/14/2020		250.0000		548.9315
Dissolved antimony	mg/L	G-11S	10/14/2020	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-11S	10/14/2020		0.0005		0.0035
Dissolved barium	mg/L	G-11S	10/14/2020	ND	0.0050		3.7002
Dissolved beryllium	mg/L	G-11S	10/14/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-11S	10/14/2020	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-11S	10/14/2020		11.5000		23.8179
Dissolved chromium	mg/L	G-11S	10/14/2020	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-11S	10/14/2020	ND	0.0100		0.0030
Dissolved copper	mg/L	G-11S	10/14/2020	ND	0.0100		0.1150
Dissolved iron	mg/L	G-11S	10/14/2020	ND	0.0500		9.8243
Dissolved lead	mg/L	G-11S	10/14/2020	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-11S	10/14/2020		2.5800		51.3609
Dissolved manganese	mg/L	G-11S	10/14/2020		0.0440		6.4627
Dissolved nickel	mg/L	G-11S	10/14/2020	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-11S	10/14/2020		1.0600		2.6321
Dissolved selenium	mg/L	G-11S	10/14/2020	ND	0.0005		0.0003
Dissolved silver	mg/L	G-11S	10/14/2020	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-11S	10/14/2020		41.0000		121.6395
Dissolved thallium	mg/L	G-11S	10/14/2020	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-11S	10/14/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-11S	10/14/2020	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-11S	10/14/2020	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-11S	10/14/2020	ND	0.0020		0.0210
pH	std units	G-11S	10/14/2020		6.7300		6.00 - 9.39
Sulfate	mg/L	G-11S	10/14/2020		29.0000		338.8047
Total dissolved solids	mg/L	G-11S	10/14/2020		160.0000		397.5917

Table 2**Most Current Downgradient Monitoring Data**

Constituent	Units	Well	Date	Result	Pred. Limit
Total organic carbon	mg/L	G-11S	10/14/2020	3.2000	14.0000

- * - Current value failed - awaiting verification.
 - ** - Current value passed - previous exceedance not verified.
 - *** - Current value failed - exceedance verified.
 - **** - Current value passed - awaiting one more verification.
 - ***** - Insufficient background data to compute prediction limit.
- ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	69	69					230.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	41	69	-2.2960	2.0106	0.0100	2.3996	12.5375	lognor		
Bicarbonate	mg/L	69	69					200.0000	nonpar		0.99
Chemical oxygen demand	mg/L	10	69					16.0000	nonpar		0.99
Chloride	mg/L	68	69					18.3000	nonpar		0.99
Conductivity	umhos/cm	68	68	418.3824	54.3787	0.0100	2.4007	548.9315	normal		
Dissolved antimony	mg/L	32	67					0.0006	nonpar		0.99
Dissolved arsenic	mg/L	69	69					0.0035	nonpar		0.99
Dissolved barium	mg/L	54	68	-4.6000	2.4611	0.0100	2.4007	3.7002	lognor		
Dissolved beryllium	mg/L	0	65					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	30	69					0.0010	nonpar		0.99
Dissolved calcium	mg/L	67	67	7.1127	6.9550	0.0100	2.4019	23.8179	normal		
Dissolved chromium	mg/L	26	69					0.0150	nonpar		0.99
Dissolved cobalt	mg/L	4	69					0.0030	nonpar		0.99
Dissolved copper	mg/L	36	68					0.1150	nonpar		0.99
Dissolved iron	mg/L	48	69	-1.9861	1.7798	0.0100	2.3996	9.8243	lognor		
Dissolved lead	mg/L	33	69					0.0027	nonpar		0.99
Dissolved magnesium	mg/L	58	68	-0.1479	1.7023	0.0100	2.4007	51.3609	lognor		
Dissolved manganese	mg/L	52	69	-3.9782	2.4355	0.0100	2.3996	6.4627	lognor		
Dissolved nickel	mg/L	20	69					0.0380	nonpar		0.99
Dissolved potassium	mg/L	63	68	-0.6160	0.6597	0.0100	2.4007	2.6321	lognor		
Dissolved selenium	mg/L	1	65					0.0003	nonpar		0.99
Dissolved silver	mg/L	3	66					0.0002	nonpar		0.99
Dissolved sodium	mg/L	69	69	89.8551	13.2456	0.0100	2.3996	121.6395	normal		
Dissolved thallium	mg/L	3	69					0.0000	nonpar		0.99
Dissolved vanadium	mg/L	0	69					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	31	69					0.0300	nonpar		0.99
Nitrate nitrogen	mg-N/L	65	69					1.3000	nonpar		0.99
Nitrite nitrogen	mg-N/L	39	69					0.0210	nonpar		0.99
pH	std units	70	70					6.00- 9.39	nonpar		0.99
Sulfate	mg/L	68	68	3.8047	0.8417	0.0100	2.4007	338.8047	lognor		
Total dissolved solids	mg/L	69	69	279.8551	49.0646	0.0100	2.3996	397.5917	normal		
Total organic carbon	mg/L	63	69					14.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result	Pred. Limit
Alkalinity (as caco3)	mg/L	G-01A	04/21/2021		32.0000	230.0000
Ammonia nitrogen	mg-N/L	G-01A	04/21/2021	ND	0.0200	12.5265
Bicarbonate	mg/L	G-01A	04/21/2021		32.0000	200.0000
Chemical oxygen demand	mg/L	G-01A	04/21/2021	ND	10.0000	18.0000
Chloride	mg/L	G-01A	04/21/2021		0.2800	18.3000
Conductivity	umhos/cm	G-01A	04/21/2021		120.0000	546.7776
Dissolved antimony	mg/L	G-01A	04/21/2021	ND	0.0003	0.0006
Dissolved arsenic	mg/L	G-01A	04/21/2021		0.0001	0.0040
Dissolved barium	mg/L	G-01A	04/21/2021	ND	0.0050	5.1339
Dissolved beryllium	mg/L	G-01A	04/21/2021	ND	0.0050	0.0005
Dissolved cadmium	mg/L	G-01A	04/21/2021	ND	0.0001	0.0010
Dissolved calcium	mg/L	G-01A	04/21/2021		10.2000	23.7546
Dissolved chromium	mg/L	G-01A	04/21/2021	ND	0.0100	0.0150
Dissolved cobalt	mg/L	G-01A	04/21/2021	ND	0.0100	0.0030
Dissolved copper	mg/L	G-01A	04/21/2021	ND	0.0200	0.1150
Dissolved iron	mg/L	G-01A	04/21/2021		0.0270	9.7830
Dissolved lead	mg/L	G-01A	04/21/2021		0.0005	0.0027
Dissolved magnesium	mg/L	G-01A	04/21/2021		2.8500	50.1666
Dissolved manganese	mg/L	G-01A	04/21/2021	ND	0.0050	8.2026
Dissolved nickel	mg/L	G-01A	04/21/2021	ND	0.0100	0.0380
Dissolved potassium	mg/L	G-01A	04/21/2021		0.5800	2.6282
Dissolved selenium	mg/L	G-01A	04/21/2021	ND	0.0005	0.0003
Dissolved silver	mg/L	G-01A	04/21/2021	ND	0.0001	0.0002
Dissolved sodium	mg/L	G-01A	04/21/2021		4.2100	121.1148
Dissolved thallium	mg/L	G-01A	04/21/2021	ND	0.0001	0.0000
Dissolved vanadium	mg/L	G-01A	04/21/2021	ND	0.0100	0.0100
Dissolved zinc	mg/L	G-01A	04/21/2021		0.0120	0.0300
Nitrate nitrogen	mg-N/L	G-01A	04/21/2021		0.1000	1.3000
Nitrite nitrogen	mg-N/L	G-01A	04/21/2021	ND	0.0020	0.0210
pH	std units	G-01A	04/21/2021		6.3400	6.00 - 9.39
Sulfate	mg/L	G-01A	04/21/2021		26.5000	339.0862
Total dissolved solids	mg/L	G-01A	04/21/2021		78.0000	395.6869
Total organic carbon	mg/L	G-01A	04/21/2021		2.9000	14.0000
Alkalinity (as caco3)	mg/L	G-04A	10/15/2020		230.0000	230.0000
Ammonia nitrogen	mg-N/L	G-04A	10/15/2020		0.1910	12.5265
Bicarbonate	mg/L	G-04A	10/15/2020		230.0000	200.0000
Chemical oxygen demand	mg/L	G-04A	10/15/2020	ND	10.0000	18.0000
Chloride	mg/L	G-04A	10/15/2020		5.5100	18.3000
Conductivity	umhos/cm	G-04A	10/15/2020		510.0000	546.7776
Dissolved antimony	mg/L	G-04A	10/15/2020	ND	0.0003	0.0006
Dissolved arsenic	mg/L	G-04A	10/15/2020		0.0108	0.0040
Dissolved barium	mg/L	G-04A	10/15/2020	ND	0.0050	5.1339
Dissolved beryllium	mg/L	G-04A	10/15/2020	ND	0.0050	0.0005
Dissolved cadmium	mg/L	G-04A	10/15/2020	ND	0.0001	0.0010
Dissolved calcium	mg/L	G-04A	10/15/2020		46.5000	23.7546
Dissolved chromium	mg/L	G-04A	10/15/2020	ND	0.0100	0.0150
Dissolved cobalt	mg/L	G-04A	10/15/2020		0.0110	0.0030
Dissolved copper	mg/L	G-04A	10/15/2020	ND	0.0100	0.1150
Dissolved iron	mg/L	G-04A	10/15/2020		16.9000	9.7830
Dissolved lead	mg/L	G-04A	10/15/2020	ND	0.0001	0.0027
Dissolved magnesium	mg/L	G-04A	10/15/2020		27.1000	50.1666
Dissolved manganese	mg/L	G-04A	10/15/2020		6.8300	8.2026
Dissolved nickel	mg/L	G-04A	10/15/2020		0.0120	0.0380
Dissolved potassium	mg/L	G-04A	10/15/2020		2.4200	2.6282
Dissolved selenium	mg/L	G-04A	10/15/2020	ND	0.0005	0.0003
Dissolved silver	mg/L	G-04A	10/15/2020	ND	0.0001	0.0002
Dissolved sodium	mg/L	G-04A	10/15/2020		14.4000	121.1148
Dissolved thallium	mg/L	G-04A	10/15/2020	ND	0.0001	0.0000
Dissolved vanadium	mg/L	G-04A	10/15/2020	ND	0.0100	0.0100
Dissolved zinc	mg/L	G-04A	10/15/2020	ND	0.0100	0.0300
Nitrate nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0100	1.3000
Nitrite nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0020	0.0210
pH	std units	G-04A	10/15/2020		6.7100	6.00 - 9.39
Sulfate	mg/L	G-04A	10/15/2020		32.3000	339.0862
Total dissolved solids	mg/L	G-04A	10/15/2020		330.0000	395.6869
Total organic carbon	mg/L	G-04A	10/15/2020		8.6000	14.0000
Alkalinity (as caco3)	mg/L	G-08D1	04/20/2021		160.0000	230.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-08D1	04/20/2021		0.1100		12.5265
Bicarbonate	mg/L	G-08D1	04/20/2021		13.0000		200.0000
Chemical oxygen demand	mg/L	G-08D1	04/20/2021		12.0000		18.0000
Chloride	mg/L	G-08D1	04/20/2021		2.8600		18.3000
Conductivity	umhos/cm	G-08D1	04/20/2021		410.0000		546.7776
Dissolved antimony	mg/L	G-08D1	04/20/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-08D1	04/20/2021		0.0009		0.0040
Dissolved barium	mg/L	G-08D1	04/20/2021	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-08D1	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-08D1	04/20/2021		0.6600		23.7546
Dissolved chromium	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-08D1	04/20/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-08D1	04/20/2021	ND	0.0200		9.7830
Dissolved lead	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-08D1	04/20/2021		0.1800		50.1666
Dissolved manganese	mg/L	G-08D1	04/20/2021	ND	0.0050		8.2026
Dissolved nickel	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-08D1	04/20/2021	ND	0.2000		2.6282
Dissolved selenium	mg/L	G-08D1	04/20/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-08D1	04/20/2021		103.0000		121.1148
Dissolved thallium	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-08D1	04/20/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-08D1	04/20/2021		0.0030		0.0210
pH	std units	G-08D1	04/20/2021		9.5900	***	6.00 - 9.39
Sulfate	mg/L	G-08D1	04/20/2021		46.1000		339.0862
Total dissolved solids	mg/L	G-08D1	04/20/2021		280.0000		395.6869
Total organic carbon	mg/L	G-08D1	04/20/2021	ND	0.5000		14.0000
Alkalinity (as cacO3)	mg/L	G-09S	04/20/2021		340.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-09S	04/20/2021	ND	0.0200		12.5265
Bicarbonate	mg/L	G-09S	04/20/2021		340.0000	***	200.0000
Chemical oxygen demand	mg/L	G-09S	04/20/2021		24.0000	*	18.0000
Chloride	mg/L	G-09S	04/20/2021		3.6600		18.3000
Conductivity	umhos/cm	G-09S	04/20/2021		950.0000	***	546.7776
Dissolved antimony	mg/L	G-09S	04/20/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-09S	04/20/2021		0.0008		0.0040
Dissolved barium	mg/L	G-09S	04/20/2021	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-09S	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09S	04/20/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-09S	04/20/2021		63.2000	***	23.7546
Dissolved chromium	mg/L	G-09S	04/20/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-09S	04/20/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-09S	04/20/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-09S	04/20/2021		0.0200		9.7830
Dissolved lead	mg/L	G-09S	04/20/2021		0.0003		0.0027
Dissolved magnesium	mg/L	G-09S	04/20/2021		24.2000		50.1666
Dissolved manganese	mg/L	G-09S	04/20/2021		0.0200		8.2026
Dissolved nickel	mg/L	G-09S	04/20/2021		0.0190		0.0380
Dissolved potassium	mg/L	G-09S	04/20/2021		4.5100	***	2.6282
Dissolved selenium	mg/L	G-09S	04/20/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-09S	04/20/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-09S	04/20/2021		79.0000		121.1148
Dissolved thallium	mg/L	G-09S	04/20/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-09S	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09S	04/20/2021		0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-09S	04/20/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-09S	04/20/2021	ND	0.0020		0.0210
pH	std units	G-09S	04/20/2021		6.4200		6.00 - 9.39
Sulfate	mg/L	G-09S	04/20/2021		188.0000		339.0862
Total dissolved solids	mg/L	G-09S	04/20/2021		660.0000	***	395.6869
Total organic carbon	mg/L	G-09S	04/20/2021		13.0000		14.0000
Alkalinity (as cacO3)	mg/L	G-10S	04/20/2021		480.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-10S	04/20/2021		0.2950		12.5265

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-10S	04/20/2021		480.0000	***	200.0000
Chemical oxygen demand	mg/L	G-10S	04/20/2021		18.0000		18.0000
Chloride	mg/L	G-10S	04/20/2021		10.7000		18.3000
Conductivity	umhos/cm	G-10S	04/20/2021		1400.0000	***	546.7776
Dissolved antimony	mg/L	G-10S	04/20/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-10S	04/20/2021		0.0056	*	0.0040
Dissolved barium	mg/L	G-10S	04/20/2021		0.0083		5.1339
Dissolved beryllium	mg/L	G-10S	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10S	04/20/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-10S	04/20/2021		91.8000	***	23.7546
Dissolved chromium	mg/L	G-10S	04/20/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-10S	04/20/2021		0.0130	*	0.0030
Dissolved copper	mg/L	G-10S	04/20/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-10S	04/20/2021		10.3000	*	9.7830
Dissolved lead	mg/L	G-10S	04/20/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-10S	04/20/2021		22.0000		50.1666
Dissolved manganese	mg/L	G-10S	04/20/2021		3.4100		8.2026
Dissolved nickel	mg/L	G-10S	04/20/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-10S	04/20/2021		3.3400	***	2.6282
Dissolved selenium	mg/L	G-10S	04/20/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-10S	04/20/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-10S	04/20/2021		193.0000	***	121.1148
Dissolved thallium	mg/L	G-10S	04/20/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-10S	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10S	04/20/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-10S	04/20/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-10S	04/20/2021	ND	0.0020		0.0210
pH	std units	G-10S	04/20/2021		6.6200		6.00 - 9.39
Sulfate	mg/L	G-10S	04/20/2021		298.0000		339.0862
Total dissolved solids	mg/L	G-10S	04/20/2021		970.0000	***	395.6869
Total organic carbon	mg/L	G-10S	04/20/2021		9.3000		14.0000
Alkalinity (as cacO3)	mg/L	G-11S	04/21/2021		72.0000		230.0000
Ammonia nitrogen	mg-N/L	G-11S	04/21/2021	ND	0.0200		12.5265
Bicarbonate	mg/L	G-11S	04/21/2021		72.0000		200.0000
Chemical oxygen demand	mg/L	G-11S	04/21/2021	ND	10.0000		18.0000
Chloride	mg/L	G-11S	04/21/2021		2.1200		18.3000
Conductivity	umhos/cm	G-11S	04/21/2021		190.0000		546.7776
Dissolved antimony	mg/L	G-11S	04/21/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-11S	04/21/2021		0.0005		0.0040
Dissolved barium	mg/L	G-11S	04/21/2021	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-11S	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-11S	04/21/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-11S	04/21/2021		7.6400		23.7546
Dissolved chromium	mg/L	G-11S	04/21/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-11S	04/21/2021		0.0110	*	0.0030
Dissolved copper	mg/L	G-11S	04/21/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-11S	04/21/2021	ND	0.0200		9.7830
Dissolved lead	mg/L	G-11S	04/21/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-11S	04/21/2021		1.8500		50.1666
Dissolved manganese	mg/L	G-11S	04/21/2021		0.0380		8.2026
Dissolved nickel	mg/L	G-11S	04/21/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-11S	04/21/2021		0.7600		2.6282
Dissolved selenium	mg/L	G-11S	04/21/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-11S	04/21/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-11S	04/21/2021		30.9000		121.1148
Dissolved thallium	mg/L	G-11S	04/21/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-11S	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-11S	04/21/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-11S	04/21/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-11S	04/21/2021	ND	0.0020		0.0210
pH	std units	G-11S	04/21/2021		6.8500		6.00 - 9.39
Sulfate	mg/L	G-11S	04/21/2021		25.6000		339.0862
Total dissolved solids	mg/L	G-11S	04/21/2021		140.0000		395.6869

Table 2**Most Current Downgradient Monitoring Data**

Constituent	Units	Well	Date	Result	Pred. Limit
Total organic carbon	mg/L	G-11S	04/21/2021	2.7000	14.0000

- * - Current value failed - awaiting verification.
 - ** - Current value passed - previous exceedance not verified.
 - *** - Current value failed - exceedance verified.
 - **** - Current value passed - awaiting one more verification.
 - ***** - Insufficient background data to compute prediction limit.
- ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	71	71					230.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	42	71	-2.2802	2.0054	0.0100	2.3975	12.5265	lognor		
Bicarbonate	mg/L	71	71					200.0000	nonpar		0.99
Chemical oxygen demand	mg/L	11	71					18.0000	nonpar		0.99
Chloride	mg/L	70	71					18.3000	nonpar		0.99
Conductivity	umhos/cm	70	70	418.1429	53.6303	0.0100	2.3985	546.7776	normal		
Dissolved antimony	mg/L	32	69					0.0006	nonpar		0.99
Dissolved arsenic	mg/L	71	71	0.0015	0.0010	0.0100	2.3975	0.0040	normal		
Dissolved barium	mg/L	54	70	-4.4686	2.5451	0.0100	2.3985	5.1339	lognor		
Dissolved beryllium	mg/L	0	65					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	30	71					0.0010	nonpar		0.99
Dissolved calcium	mg/L	68	68	7.1581	6.9131	0.0100	2.4007	23.7546	normal		
Dissolved chromium	mg/L	26	71					0.0150	nonpar		0.99
Dissolved cobalt	mg/L	4	71					0.0030	nonpar		0.99
Dissolved copper	mg/L	36	70					0.1150	nonpar		0.99
Dissolved iron	mg/L	49	71	-1.9691	1.7726	0.0100	2.3975	9.7830	lognor		
Dissolved lead	mg/L	34	71					0.0027	nonpar		0.99
Dissolved magnesium	mg/L	60	70	-0.1538	1.6965	0.0100	2.3985	50.1666	lognor		
Dissolved manganese	mg/L	52	71	-3.8661	2.4903	0.0100	2.3975	8.2026	lognor		
Dissolved nickel	mg/L	20	71					0.0380	nonpar		0.99
Dissolved potassium	mg/L	64	70	-0.6041	0.6547	0.0100	2.3985	2.6282	lognor		
Dissolved selenium	mg/L	1	67					0.0003	nonpar		0.99
Dissolved silver	mg/L	3	68					0.0002	nonpar		0.99
Dissolved sodium	mg/L	71	71	89.6113	13.1402	0.0100	2.3975	121.1148	normal		
Dissolved thallium	mg/L	3	71					0.0000	nonpar		0.99
Dissolved vanadium	mg/L	0	71					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	31	71					0.0300	nonpar		0.99
Nitrate nitrogen	mg-N/L	66	71					1.3000	nonpar		0.99
Nitrite nitrogen	mg-N/L	39	71					0.0210	nonpar		0.99
pH	std units	72	72					6.00- 9.39	nonpar		0.99
Sulfate	mg/L	70	70	3.7938	0.8474	0.0100	2.3985	339.0862	lognor		
Total dissolved solids	mg/L	71	71	279.4366	48.4882	0.0100	2.3975	395.6869	normal		
Total organic carbon	mg/L	65	71					14.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Groundwater Analytical Summary - Shallow Wells: Third Quarter 2021
Cathcart Landfill, Snohomish County, WA

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09S					G-10S				
						7/14/21	D	V	Tr	Ch	7/14/21	D	V	Tr	Ch
						CONVENTIONAL CHEMISTRY PARAMETERS (mg/L)									
Alkalinity (as CaCO3)	nonpar	71	71	230	--	350			I	N	480			I	N
Ammonia Nitrogen	lognor	71	42	12.5265	--	0.02	U				0.296			I	N
Bicarbonate	nonpar	71	71	200	--	350			I	N	480			I	N
Calcium, Dissolved	normal	68	68	23.7546	--	78.4			D	N	105			D	N
Chemical Oxygen Demand	nonpar	71	11	18	--	10	U				10	U			
Chloride	nonpar	71	70	18.3	250	4.62			D	N	10.4			D	N
Conductivity (umhos/cm)	normal	70	70	546.7776	700	970			D	N	1400				
Magnesium, Dissolved	lognor	70	60	50.1666	--	30.4			D	N	25.2			D	N
Nitrate Nitrogen (mg-N/L)	nonpar	71	66	1.3	10	0.010	U				0.01	U			
Nitrite Nitrogen (mg-N/L)	nonpar	71	39	0.021	1	0.006					0.022				
pH (std units)	nonpar	72	72	6.00-9.39	6.5-8.5	6.15			I	N	6.51				
Potassium, Dissolved	lognor	70	64	2.6282	--	4.96			D	N	3.64				
Sodium, Dissolved	normal	71	71	121.1148	20	90.4					183				
Sulfate	lognor	70	70	339.0862	250	178			D	N	271			D	N
Total Dissolved Solids	normal	71	71	395.6869	500	640			D	N	960			D	Y
Total Organic Carbon	nonpar	71	65	14	--	11			I	Y	10				
DISSOLVED METALS EPA Methods 200.7/200.8 (mg/L)															
Antimony	nonpar	69	32	0.0006	0.006	0.0003	U				0.0003	U			
Arsenic	normal	71	71	0.004	0.00005	0.000774					0.00573				
Barium	lognor	70	54	5.1339	1	0.0051					0.0088				
Beryllium	nonpar	65	0	0.0005	0.004	0.005	U				0.005	U			
Cadmium	nonpar	71	30	0.001	0.005	0.00005	U				0.00005	U			
Chromium	nonpar	71	26	0.015	0.05	0.01	U				0.01	U			
Cobalt	nonpar	71	4	0.003	--	0.01	U				0.01	U			
Copper	nonpar	70	36	0.115	1	0.02	U				0.02	U			
Iron	lognor	71	49	9.783	0.3	0.02	U				10.2				
Lead	nonpar	71	34	0.0027	0.05	0.0001	U				0.0001	U			
Manganese	lognor	71	52	8.2026	0.05	0.027					3.35			D	N
Nickel	nonpar	71	20	0.038	0.1	0.05					0.03				
Selenium	nonpar	67	1	0.0003	0.01	0.0005	U		Y		0.0005	U			
Silver	nonpar	68	3	0.0002	0.05	0.0001	U				0.0001	U			
Thallium	nonpar	71	3	0.00009	0.002	0.00382					0.00005	U			
Vanadium	nonpar	71	0	0.01	--	0.01	U				0.01	U			
Zinc	nonpar	71	31	0.03	5	0.01	U				0.01	U			
TOTAL METALS EPA Methods 200.7/200.8 (mg/L)															
Antimony					0.006	0.0003	U				0.0003	U			
Arsenic					0.00005	0.00057					0.00487				
Barium					1	0.0068					0.0058				
Beryllium					0.004	0.005	U				0.005	U			
Cadmium					0.005	0.00005	U				0.00005	U			
Chromium					0.05	0.01	U				0.0103				
Cobalt					--	0.01	U				0.01	U			
Copper					1	0.01	U				0.01	U			
Iron					0.3	0.465					10.2				
Lead					0.05	0.00129					0.0001	U			
Manganese					0.05	0.134					3.28				
Nickel					0.1	0.067					0.037				
Selenium					0.01	0.0005	U				0.0005	U			
Silver					0.05	0.0001	U				0.0001	U			
Thallium					0.002	0.0001	U				0.0001	U			
Vanadium					--	0.02	U				0.02	U			
Zinc					5	0.01	U				0.01	U			
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260/8260 SIM (µg/L)															
1,1,1-Trichloroethane					200	1	U				1	U			
1,1,2,2-Tetrachloroethane					--	1	U				1	U			
1,1,2-Trichloroethane					--	1	U				1	U			
1,1-Dichloroethane					1	1	U				1	U			
1,1-Dichloroethylene					--	1	U				1	U			
1,2,3-Trichloropropane					--	1	U				1	U			
1,2-Dibromo-3-chloropropane					0.2	0.05	U				0.05	U			
1,2-Dibromoethane					0.001	0.01	U				0.01	U			
1,2-Dichlorobenzene					--	1	U				1	U			

**Groundwater Analytical Summary - Shallow Wells: Third Quarter 2021
Cathcart Landfill, Snohomish County, WA**

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09S					G-10S				
						7/14/21	D	V	Tr	Ch	7/14/21	D	V	Tr	Ch
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260/8260 SIM (µg/L) (cont.)															
1,2-Dichloroethane					0.5	0.03	U				0.03	U			
1,2-Dichloropropane					0.6	0.02	U				0.02	U			
1,4-Dichlorobenzene					4	1	U				1	U			
2-Butanone					--	5	U				5	U			
2-Hexanone					--	5	U				5	U			
4-Methyl-2-Pentanone (MIBK)					--	5	U				5	U			
Acetone					--	5	U				5	U			
Acrylonitrile					0.07	0.03	U				0.03	U			
Benzene					1	1	U				1	U			
Bromodichloromethane					0.3	0.02	U				0.02	U			
Bromoform					5	1	U				1	U			
Bromomethane					--	1	U				1	U			
Carbon Disulfide					--	1	U				1	U			
Carbon Tetrachloride					0.3	0.02	U				0.02	U			
Chlorobenzene					--	0.03	U				0.03	U			
Chlorodibromomethane					0.5	0.5	U				0.5	U			
Chloroethane					--	1	U				1	U			
Chloroform					7	1	U				1	U			
Chloromethane					--	2	U				2	U			
cis-1,2-Dichloroethene					--	0.02	U				0.11				
cis-1,3-Dichloropropene					0.2	0.03	U				0.03	U			
Dibromomethane					--	0.02	U				0.02	U			
Ethyl Benzene					--	1	U				1	U			
m,p-Xylene					--	1	U				1	U			
Methyl Iodide					--	1	U				1	U			
Methylene Chloride					5	2	U				2	U			
o-Xylene					--	1	U				1	U			
Styrene					--	1	U				1	U			
Tetrachloroethylene					0.8	0.02	U				0.02	U			
Toluene					--	2	U				2	U			
trans-1,2-Dichloroethene					--	1	U				1	U			
trans-1,3-Dichloropropene					0.2	0.02	U				0.02	U			
trans-1,4-Dichloro-2-butene					--	5	U				5	U			
Trichlorethene (1,1,2-Trichloroethylene)					3	1	U				1	U			
Trichlorofluoromethane					--	1	U				1	U			
Vinyl Acetate					--	5	U				5	U			
Vinyl Chloride					0.02	0.01	U				0.01	U			

D: U = Indicates compound was not detected at the given reporting limit; X indicates that the compound was detected in the trip blank and contamination is suspected.
V: E= Exceedance, waiting verification based on subsequent lab data; V= Exceedance verified based on previous lab data; P=Passed, previous exceedance not verified based on current lab data.
Tr: I=increasing Trend, D=Decreasing Trend;
Ch: Y indicates a change in trend from previous quarter; N means no change in trend.
Values in purple exceed the prediction limit; [red box] indicates that a value exceeded the Groundwater Standards
The groundwater standards listed are based on the Washington Administrative Code (WAC) 173-200 groundwater limits as modified by the TMS 91-11 standards - the most restrictive of the two is used.
B = Methylene chloride was measured in the lab blank at a similar concentration - contamination during analysis suspected.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01A	04/21/2021		32.0000		230.0000
Ammonia nitrogen	mg-N/L	G-01A	04/21/2021	ND	0.0200		12.5265
Bicarbonate	mg/L	G-01A	04/21/2021		32.0000		200.0000
Chemical oxygen demand	mg/L	G-01A	04/21/2021	ND	10.0000		18.0000
Chloride	mg/L	G-01A	04/21/2021		0.2800		18.3000
Conductivity	umhos/cm	G-01A	04/21/2021		120.0000		546.7776
Dissolved antimony	mg/L	G-01A	04/21/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-01A	04/21/2021		0.0001		0.0040
Dissolved barium	mg/L	G-01A	04/21/2021	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-01A	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01A	04/21/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-01A	04/21/2021		10.2000		23.7546
Dissolved chromium	mg/L	G-01A	04/21/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-01A	04/21/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-01A	04/21/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-01A	04/21/2021		0.0270		9.7830
Dissolved lead	mg/L	G-01A	04/21/2021		0.0005		0.0027
Dissolved magnesium	mg/L	G-01A	04/21/2021		2.8500		50.1666
Dissolved manganese	mg/L	G-01A	04/21/2021	ND	0.0050		8.2026
Dissolved nickel	mg/L	G-01A	04/21/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-01A	04/21/2021		0.5800		2.6282
Dissolved selenium	mg/L	G-01A	04/21/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-01A	04/21/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-01A	04/21/2021		4.2100		121.1148
Dissolved thallium	mg/L	G-01A	04/21/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-01A	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01A	04/21/2021		0.0120		0.0300
Nitrate nitrogen	mg-N/L	G-01A	04/21/2021		0.1000		1.3000
Nitrite nitrogen	mg-N/L	G-01A	04/21/2021	ND	0.0020		0.0210
pH	std units	G-01A	04/21/2021		6.3400		6.00 - 9.39
Sulfate	mg/L	G-01A	04/21/2021		26.5000		339.0862
Total dissolved solids	mg/L	G-01A	04/21/2021		78.0000		395.6869
Total organic carbon	mg/L	G-01A	04/21/2021		2.9000		14.0000
Alkalinity (as caco3)	mg/L	G-04A	10/15/2020		230.0000		230.0000
Ammonia nitrogen	mg-N/L	G-04A	10/15/2020		0.1910		12.5265
Bicarbonate	mg/L	G-04A	10/15/2020		230.0000	*	200.0000
Chemical oxygen demand	mg/L	G-04A	10/15/2020	ND	10.0000	**	18.0000
Chloride	mg/L	G-04A	10/15/2020		5.5100		18.3000
Conductivity	umhos/cm	G-04A	10/15/2020		510.0000		546.7776
Dissolved antimony	mg/L	G-04A	10/15/2020	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-04A	10/15/2020		0.0108	***	0.0040
Dissolved barium	mg/L	G-04A	10/15/2020	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-04A	10/15/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-04A	10/15/2020	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-04A	10/15/2020		46.5000	***	23.7546
Dissolved chromium	mg/L	G-04A	10/15/2020	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-04A	10/15/2020		0.0110	***	0.0030
Dissolved copper	mg/L	G-04A	10/15/2020	ND	0.0100		0.1150
Dissolved iron	mg/L	G-04A	10/15/2020		16.9000	***	9.7830
Dissolved lead	mg/L	G-04A	10/15/2020	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-04A	10/15/2020		27.1000		50.1666
Dissolved manganese	mg/L	G-04A	10/15/2020		6.8300		8.2026
Dissolved nickel	mg/L	G-04A	10/15/2020		0.0120		0.0380
Dissolved potassium	mg/L	G-04A	10/15/2020		2.4200		2.6282
Dissolved selenium	mg/L	G-04A	10/15/2020	ND	0.0005		0.0003
Dissolved silver	mg/L	G-04A	10/15/2020	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-04A	10/15/2020		14.4000		121.1148
Dissolved thallium	mg/L	G-04A	10/15/2020	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-04A	10/15/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-04A	10/15/2020	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0020		0.0210
pH	std units	G-04A	10/15/2020		6.7100		6.00 - 9.39
Sulfate	mg/L	G-04A	10/15/2020		32.3000		339.0862
Total dissolved solids	mg/L	G-04A	10/15/2020		330.0000		395.6869
Total organic carbon	mg/L	G-04A	10/15/2020		8.6000	**	14.0000
Alkalinity (as caco3)	mg/L	G-08D1	04/20/2021		160.0000		230.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-08D1	04/20/2021		0.1100		12.5265
Bicarbonate	mg/L	G-08D1	04/20/2021		13.0000		200.0000
Chemical oxygen demand	mg/L	G-08D1	04/20/2021		12.0000		18.0000
Chloride	mg/L	G-08D1	04/20/2021		2.8600		18.3000
Conductivity	umhos/cm	G-08D1	04/20/2021		410.0000		546.7776
Dissolved antimony	mg/L	G-08D1	04/20/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-08D1	04/20/2021		0.0009		0.0040
Dissolved barium	mg/L	G-08D1	04/20/2021	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-08D1	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-08D1	04/20/2021		0.6600		23.7546
Dissolved chromium	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-08D1	04/20/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-08D1	04/20/2021	ND	0.0200		9.7830
Dissolved lead	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-08D1	04/20/2021		0.1800		50.1666
Dissolved manganese	mg/L	G-08D1	04/20/2021	ND	0.0050		8.2026
Dissolved nickel	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-08D1	04/20/2021	ND	0.2000		2.6282
Dissolved selenium	mg/L	G-08D1	04/20/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-08D1	04/20/2021		103.0000		121.1148
Dissolved thallium	mg/L	G-08D1	04/20/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D1	04/20/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-08D1	04/20/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-08D1	04/20/2021		0.0030		0.0210
pH	std units	G-08D1	04/20/2021		9.5900	***	6.00 - 9.39
Sulfate	mg/L	G-08D1	04/20/2021		46.1000		339.0862
Total dissolved solids	mg/L	G-08D1	04/20/2021		280.0000		395.6869
Total organic carbon	mg/L	G-08D1	04/20/2021	ND	0.5000		14.0000
Alkalinity (as cacO3)	mg/L	G-09S	07/14/2021		350.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-09S	07/14/2021	ND	0.0200		12.5265
Bicarbonate	mg/L	G-09S	07/14/2021		350.0000	***	200.0000
Chemical oxygen demand	mg/L	G-09S	07/14/2021	ND	10.0000	**	18.0000
Chloride	mg/L	G-09S	07/14/2021		4.6200		18.3000
Conductivity	umhos/cm	G-09S	07/14/2021		970.0000	***	546.7776
Dissolved antimony	mg/L	G-09S	07/14/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-09S	07/14/2021		0.0008		0.0040
Dissolved barium	mg/L	G-09S	07/14/2021		0.0051		5.1339
Dissolved beryllium	mg/L	G-09S	07/14/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09S	07/14/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-09S	07/14/2021		78.4000	***	23.7546
Dissolved chromium	mg/L	G-09S	07/14/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-09S	07/14/2021	ND	0.0100		0.0030
Dissolved copper	mg/L	G-09S	07/14/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-09S	07/14/2021	ND	0.0200		9.7830
Dissolved lead	mg/L	G-09S	07/14/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-09S	07/14/2021		30.4000		50.1666
Dissolved manganese	mg/L	G-09S	07/14/2021		0.0270		8.2026
Dissolved nickel	mg/L	G-09S	07/14/2021		0.0500	*	0.0380
Dissolved potassium	mg/L	G-09S	07/14/2021		4.9600	***	2.6282
Dissolved selenium	mg/L	G-09S	07/14/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-09S	07/14/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-09S	07/14/2021		90.4000		121.1148
Dissolved thallium	mg/L	G-09S	07/14/2021		0.0038	*	0.0000
Dissolved vanadium	mg/L	G-09S	07/14/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09S	07/14/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-09S	07/14/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-09S	07/14/2021		0.0060		0.0210
pH	std units	G-09S	07/14/2021	ND	0.1000		6.00 - 9.39
Sulfate	mg/L	G-09S	07/14/2021		178.0000		339.0862
Total dissolved solids	mg/L	G-09S	07/14/2021		640.0000	***	395.6869
Total organic carbon	mg/L	G-09S	07/14/2021		11.0000		14.0000
Alkalinity (as cacO3)	mg/L	G-10S	07/14/2021		485.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-10S	07/14/2021		0.2880		12.5265

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-10S	07/14/2021		485.0000	***	200.0000
Chemical oxygen demand	mg/L	G-10S	07/14/2021	ND	10.0000		18.0000
Chloride	mg/L	G-10S	07/14/2021		10.2500		18.3000
Conductivity	umhos/cm	G-10S	07/14/2021		1400.0000	***	546.7776
Dissolved antimony	mg/L	G-10S	07/14/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-10S	07/14/2021		0.0057	***	0.0040
Dissolved barium	mg/L	G-10S	07/14/2021		0.0091		5.1339
Dissolved beryllium	mg/L	G-10S	07/14/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10S	07/14/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-10S	07/14/2021		106.0000	***	23.7546
Dissolved chromium	mg/L	G-10S	07/14/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-10S	07/14/2021	ND	0.0100	**	0.0030
Dissolved copper	mg/L	G-10S	07/14/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-10S	07/14/2021		10.2000	*	9.7830
Dissolved lead	mg/L	G-10S	07/14/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-10S	07/14/2021		25.3000		50.1666
Dissolved manganese	mg/L	G-10S	07/14/2021		3.3650		8.2026
Dissolved nickel	mg/L	G-10S	07/14/2021		0.0300		0.0380
Dissolved potassium	mg/L	G-10S	07/14/2021		3.7250	***	2.6282
Dissolved selenium	mg/L	G-10S	07/14/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-10S	07/14/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-10S	07/14/2021		187.0000	***	121.1148
Dissolved thallium	mg/L	G-10S	07/14/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-10S	07/14/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10S	07/14/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-10S	07/14/2021		0.0115		1.3000
Nitrite nitrogen	mg-N/L	G-10S	07/14/2021		0.0200		0.0210
pH	std units	G-10S	07/14/2021	ND	0.1000		6.00 - 9.39
Sulfate	mg/L	G-10S	07/14/2021		273.5000		339.0862
Total dissolved solids	mg/L	G-10S	07/14/2021		935.0000	***	395.6869
Total organic carbon	mg/L	G-10S	07/14/2021		10.0000		14.0000
Alkalinity (as cacO3)	mg/L	G-11S	04/21/2021		72.0000		230.0000
Ammonia nitrogen	mg-N/L	G-11S	04/21/2021	ND	0.0200		12.5265
Bicarbonate	mg/L	G-11S	04/21/2021		72.0000		200.0000
Chemical oxygen demand	mg/L	G-11S	04/21/2021	ND	10.0000		18.0000
Chloride	mg/L	G-11S	04/21/2021		2.1200		18.3000
Conductivity	umhos/cm	G-11S	04/21/2021		190.0000		546.7776
Dissolved antimony	mg/L	G-11S	04/21/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-11S	04/21/2021		0.0005		0.0040
Dissolved barium	mg/L	G-11S	04/21/2021	ND	0.0050		5.1339
Dissolved beryllium	mg/L	G-11S	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-11S	04/21/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-11S	04/21/2021		7.6400		23.7546
Dissolved chromium	mg/L	G-11S	04/21/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-11S	04/21/2021		0.0110	*	0.0030
Dissolved copper	mg/L	G-11S	04/21/2021	ND	0.0200		0.1150
Dissolved iron	mg/L	G-11S	04/21/2021	ND	0.0200		9.7830
Dissolved lead	mg/L	G-11S	04/21/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-11S	04/21/2021		1.8500		50.1666
Dissolved manganese	mg/L	G-11S	04/21/2021		0.0380		8.2026
Dissolved nickel	mg/L	G-11S	04/21/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-11S	04/21/2021		0.7600		2.6282
Dissolved selenium	mg/L	G-11S	04/21/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-11S	04/21/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-11S	04/21/2021		30.9000		121.1148
Dissolved thallium	mg/L	G-11S	04/21/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-11S	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-11S	04/21/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-11S	04/21/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-11S	04/21/2021	ND	0.0020		0.0210
pH	std units	G-11S	04/21/2021		6.8500		6.00 - 9.39
Sulfate	mg/L	G-11S	04/21/2021		25.6000		339.0862
Total dissolved solids	mg/L	G-11S	04/21/2021		140.0000		395.6869

Table 2**Most Current Downgradient Monitoring Data**

Constituent	Units	Well	Date	Result	Pred. Limit
Total organic carbon	mg/L	G-11S	04/21/2021	2.7000	14.0000

- * - Current value failed - awaiting verification.
 - ** - Current value passed - previous exceedance not verified.
 - *** - Current value failed - exceedance verified.
 - **** - Current value passed - awaiting one more verification.
 - ***** - Insufficient background data to compute prediction limit.
- ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	71	71					230.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	42	71	-2.2802	2.0054	0.0100	2.3975	12.5265	lognor		
Bicarbonate	mg/L	71	71					200.0000	nonpar		0.99
Chemical oxygen demand	mg/L	11	71					18.0000	nonpar		0.99
Chloride	mg/L	70	71					18.3000	nonpar		0.99
Conductivity	umhos/cm	70	70	418.1429	53.6303	0.0100	2.3985	546.7776	normal		
Dissolved antimony	mg/L	32	69					0.0006	nonpar		0.99
Dissolved arsenic	mg/L	71	71	0.0015	0.0010	0.0100	2.3975	0.0040	normal		
Dissolved barium	mg/L	54	70	-4.4686	2.5451	0.0100	2.3985	5.1339	lognor		
Dissolved beryllium	mg/L	0	65					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	30	71					0.0010	nonpar		0.99
Dissolved calcium	mg/L	68	68	7.1581	6.9131	0.0100	2.4007	23.7546	normal		
Dissolved chromium	mg/L	26	71					0.0150	nonpar		0.99
Dissolved cobalt	mg/L	4	71					0.0030	nonpar		0.99
Dissolved copper	mg/L	36	70					0.1150	nonpar		0.99
Dissolved iron	mg/L	49	71	-1.9691	1.7726	0.0100	2.3975	9.7830	lognor		
Dissolved lead	mg/L	34	71					0.0027	nonpar		0.99
Dissolved magnesium	mg/L	60	70	-0.1538	1.6965	0.0100	2.3985	50.1666	lognor		
Dissolved manganese	mg/L	52	71	-3.8661	2.4903	0.0100	2.3975	8.2026	lognor		
Dissolved nickel	mg/L	20	71					0.0380	nonpar		0.99
Dissolved potassium	mg/L	64	70	-0.6041	0.6547	0.0100	2.3985	2.6282	lognor		
Dissolved selenium	mg/L	1	67					0.0003	nonpar		0.99
Dissolved silver	mg/L	3	68					0.0002	nonpar		0.99
Dissolved sodium	mg/L	71	71	89.6113	13.1402	0.0100	2.3975	121.1148	normal		
Dissolved thallium	mg/L	3	71					0.0000	nonpar		0.99
Dissolved vanadium	mg/L	0	71					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	31	71					0.0300	nonpar		0.99
Nitrate nitrogen	mg-N/L	66	71					1.3000	nonpar		0.99
Nitrite nitrogen	mg-N/L	39	71					0.0210	nonpar		0.99
pH	std units	72	72					6.00- 9.39	nonpar		0.99
Sulfate	mg/L	70	70	3.7938	0.8474	0.0100	2.3985	339.0862	lognor		
Total dissolved solids	mg/L	71	71	279.4366	48.4882	0.0100	2.3975	395.6869	normal		
Total organic carbon	mg/L	65	71					14.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Groundwater Analytical Summary - Shallow Wells: Fourth Quarter 2021
Cathcart Landfill, Snohomish County, WA

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	Downgradient Wells												Upgradient Wells																			
						G-01A				G-04A				G-08D1				G-09S				G-10S				G-11S				G-14S				G-24S			
						10/19/21	D	V	Tr	Ch	D	V	Tr	Ch	10/19/21	D	V	Tr	Ch	10/20/21	D	V	Tr	Ch	10/20/21	D	V	Tr	Ch	10/19/21	D	V	Tr	Ch	10/19/21	D	V
CONVENTIONAL CHEMISTRY PARAMETERS (mg/L)																																					
Alkalinity (as CaCO3)	nonpar	69	69	230	--	35																															
Ammonia Nitrogen	lognor	69	40	12.5265	--	0.02	U																														
Bicarbonate	nonpar	69	69	200	--	35																															
Calcium, Dissolved	normal	66	66	23.7546	--	19.0																															
Chemical Oxygen Demand	nonpar	69	10	18	--	10	U																														
Chloride	lognor	69	68	18.3	250	4.68																															
Conductivity (umhos/cm)	normal	68	68	546.7776	700	190																															
Magnesium, Dissolved	lognor	68	58	50.1666	--	5.07																															
Nitrate Nitrogen (mg-N/L)	nonpar	69	63	1.3	10	1.0																															
Nitrite Nitrogen (mg-N/L)	lognor	68	36	0.021	1	0.002	U																														
pH (std units)	nonpar	70	70	6.00-9.39	6.5-8.5	5.58		V		Y																											
Potassium, Dissolved	lognor	68	61	2.6282	--	1.49																															
Sodium, Dissolved	normal	69	69	121.1148	20	7.11																															
Sulfate	lognor	68	68	339.0862	250	42.4																															
Total Dissolved Solids	normal	69	69	395.6869	500	120																															
Total Organic Carbon	nonpar	69	64	14	--	4.0																															
DISSOLVED METALS EPA Methods 200.7/200.8 (mg/L)																																					
Antimony	nonpar	67	28	0.0006	0.006	0.0003	U																														
Arsenic	nonpar	69	69	0.004	0.00005	0.000173																															
Barium	lognor	68	51	5.1339	1	0.005	U																														
Beryllium	nonpar	69	0	0.0005	0.004	0.005	U																														
Cadmium	nonpar	68	27	0.001	0.005	0.00005	U																														
Chromium	nonpar	69	24	0.015	0.05	0.01	U																														
Cobalt	nonpar	69	4	0.003	--	0.01	U																														
Copper	lognor	68	34	0.115	1	0.02	U																														
Iron	lognor	69	47	9.783	0.3	0.023																															
Lead	nonpar	69	30	0.0027	0.05	0.0001	U																														
Manganese	lognor	69	50	8.2026	0.05	0.005	U																														
Nickel	nonpar	69	19	0.038	0.1	0.01	U																														
Selenium	nonpar	65	1	0.0003	0.01	0.0005	U																														
Silver	nonpar	67	2	0.0002	0.05	0.0001	U																														
Thallium	nonpar	69	3	0.00009	0.002	0.00005	U																														
Vanadium	nonpar	69	0	0.01	--	0.01	U																														
Zinc	nonpar	69	30	0.03	5	0.01	U																														
TOTAL METALS EPA Methods 200.7/200.8 (mg/L)																																					
Antimony	--	--	--	--	0.006	0.0003	U																														
Arsenic	--	--	--	--	0.00005	0.000313																															
Barium	--	--	--	--	1	0.005	U																														
Beryllium	--	--	--	--	0.004	0.005	U																														
Cadmium	--	--	--	--	0.005	0.00005	U																														
Chromium	--	--	--	--	0.05	0.01	U																														
Cobalt	--	--	--	--	--	0.01	U																														
Copper	--	--	--	--	1	0.01	U																														
Iron	--	--	--	--	0.3	0.469																															
Lead	--	--	--	--	0.05	0.000105																															
Manganese	--	--	--	--	0.05	0.0092																															
Nickel	--	--	--	--	0.1	0.01	U																														
Selenium	--	--	--	--	0.01	0.0005	U																														
Silver	--	--	--	--	0.05	0.0001	U																														
Thallium	--	--	--	--	0.002	0.0001	U																														
Vanadium	--	--	--	--	--	0.02	U																														
Zinc	--	--	--	--	5	0.01	U																														
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260 (µg/L)																																					
1,1,1-Trichloroethane	--	--	--	--	200	1	U																														
1,1,2,2-Tetrachloroethane	--	--	--	--	--	1	U																														
1,1,2-Trichloroethane	--	--	--	--	--	1	U																														
1,1-Dichloroethane	--	--	--	--	1	1	U																														

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01A	10/19/2021		35.0000		230.0000
Ammonia nitrogen	mg-N/L	G-01A	10/19/2021	ND	0.0200		13.2976
Bicarbonate	mg/L	G-01A	10/19/2021		35.0000		210.0000
Chemical oxygen demand	mg/L	G-01A	10/19/2021	ND	10.0000		18.0000
Chloride	mg/L	G-01A	10/19/2021		4.6800		18.3725
Conductivity	umhos/cm	G-01A	10/19/2021		190.0000		543.3391
Dissolved antimony	mg/L	G-01A	10/19/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-01A	10/19/2021		0.0002		0.0035
Dissolved barium	mg/L	G-01A	10/19/2021	ND	0.0050		6.9450
Dissolved beryllium	mg/L	G-01A	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01A	10/19/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-01A	10/19/2021		19.0000		23.6663
Dissolved chromium	mg/L	G-01A	10/19/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-01A	10/19/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-01A	10/19/2021	ND	0.0200		46.2274
Dissolved iron	mg/L	G-01A	10/19/2021		0.0230		9.9951
Dissolved lead	mg/L	G-01A	10/19/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-01A	10/19/2021		5.0700		47.7851
Dissolved manganese	mg/L	G-01A	10/19/2021	ND	0.0050		8.9972
Dissolved nickel	mg/L	G-01A	10/19/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-01A	10/19/2021		1.4900		2.6292
Dissolved selenium	mg/L	G-01A	10/19/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-01A	10/19/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-01A	10/19/2021		7.1100		119.9159
Dissolved thallium	mg/L	G-01A	10/19/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-01A	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01A	10/19/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-01A	10/19/2021		1.0000		1.3000
Nitrite nitrogen	mg-N/L	G-01A	10/19/2021	ND	0.0020		47.6219
pH	std units	G-01A	10/19/2021		5.5800	***	6.60 - 9.39
Sulfate	mg/L	G-01A	10/19/2021		42.4000		346.8839
Total dissolved solids	mg/L	G-01A	10/19/2021		120.0000		391.0438
Total organic carbon	mg/L	G-01A	10/19/2021		4.0000		14.0000
Alkalinity (as caco3)	mg/L	G-04A	10/15/2020		230.0000		230.0000
Ammonia nitrogen	mg-N/L	G-04A	10/15/2020		0.1910		13.2976
Bicarbonate	mg/L	G-04A	10/15/2020		230.0000	*	210.0000
Chemical oxygen demand	mg/L	G-04A	10/15/2020	ND	10.0000	**	18.0000
Chloride	mg/L	G-04A	10/15/2020		5.5100		18.3725
Conductivity	umhos/cm	G-04A	10/15/2020		510.0000		543.3391
Dissolved antimony	mg/L	G-04A	10/15/2020	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-04A	10/15/2020		0.0108	***	0.0035
Dissolved barium	mg/L	G-04A	10/15/2020	ND	0.0050		6.9450
Dissolved beryllium	mg/L	G-04A	10/15/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-04A	10/15/2020	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-04A	10/15/2020		46.5000	***	23.6663
Dissolved chromium	mg/L	G-04A	10/15/2020	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-04A	10/15/2020		0.0110	***	0.0050
Dissolved copper	mg/L	G-04A	10/15/2020	ND	0.0100		46.2274
Dissolved iron	mg/L	G-04A	10/15/2020		16.9000	***	9.9951
Dissolved lead	mg/L	G-04A	10/15/2020	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-04A	10/15/2020		27.1000		47.7851
Dissolved manganese	mg/L	G-04A	10/15/2020		6.8300		8.9972
Dissolved nickel	mg/L	G-04A	10/15/2020		0.0120		0.0380
Dissolved potassium	mg/L	G-04A	10/15/2020		2.4200		2.6292
Dissolved selenium	mg/L	G-04A	10/15/2020	ND	0.0005		0.0003
Dissolved silver	mg/L	G-04A	10/15/2020	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-04A	10/15/2020		14.4000		119.9159
Dissolved thallium	mg/L	G-04A	10/15/2020	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-04A	10/15/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-04A	10/15/2020	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-04A	10/15/2020	ND	0.0020		47.6219
pH	std units	G-04A	10/15/2020		6.7100	**	6.60 - 9.39
Sulfate	mg/L	G-04A	10/15/2020		32.3000		346.8839
Total dissolved solids	mg/L	G-04A	10/15/2020		330.0000		391.0438
Total organic carbon	mg/L	G-04A	10/15/2020		8.6000	**	14.0000
Alkalinity (as caco3)	mg/L	G-08D1	10/19/2021		160.0000		230.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-08D1	10/19/2021		0.1290		13.2976
Bicarbonate	mg/L	G-08D1	10/19/2021		160.0000		210.0000
Chemical oxygen demand	mg/L	G-08D1	10/19/2021	ND	10.0000		18.0000
Chloride	mg/L	G-08D1	10/19/2021		2.9800		18.3725
Conductivity	umhos/cm	G-08D1	10/19/2021		450.0000		543.3391
Dissolved antimony	mg/L	G-08D1	10/19/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-08D1	10/19/2021		0.0016		0.0035
Dissolved barium	mg/L	G-08D1	10/19/2021	ND	0.0050		6.9450
Dissolved beryllium	mg/L	G-08D1	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D1	10/19/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-08D1	10/19/2021		0.6700		23.6663
Dissolved chromium	mg/L	G-08D1	10/19/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-08D1	10/19/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-08D1	10/19/2021	ND	0.0200		46.2274
Dissolved iron	mg/L	G-08D1	10/19/2021	ND	0.0200		9.9951
Dissolved lead	mg/L	G-08D1	10/19/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-08D1	10/19/2021	ND	0.0500		47.7851
Dissolved manganese	mg/L	G-08D1	10/19/2021	ND	0.0050		8.9972
Dissolved nickel	mg/L	G-08D1	10/19/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-08D1	10/19/2021		0.3100		2.6292
Dissolved selenium	mg/L	G-08D1	10/19/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-08D1	10/19/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-08D1	10/19/2021		104.0000		119.9159
Dissolved thallium	mg/L	G-08D1	10/19/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-08D1	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D1	10/19/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-08D1	10/19/2021		0.1600		1.3000
Nitrite nitrogen	mg-N/L	G-08D1	10/19/2021		0.0350		47.6219
pH	std units	G-08D1	10/19/2021		9.1400	**	6.60 - 9.39
Sulfate	mg/L	G-08D1	10/19/2021		49.1000		346.8839
Total dissolved solids	mg/L	G-08D1	10/19/2021		250.0000		391.0438
Total organic carbon	mg/L	G-08D1	10/19/2021		0.5500		14.0000
Alkalinity (as cacO3)	mg/L	G-09S	10/20/2021		350.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-09S	10/20/2021	ND	0.0200		13.2976
Bicarbonate	mg/L	G-09S	10/20/2021		350.0000	***	210.0000
Chemical oxygen demand	mg/L	G-09S	10/20/2021	ND	10.0000		18.0000
Chloride	mg/L	G-09S	10/20/2021		4.3600		18.3725
Conductivity	umhos/cm	G-09S	10/20/2021		920.0000	***	543.3391
Dissolved antimony	mg/L	G-09S	10/20/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-09S	10/20/2021		0.0005		0.0035
Dissolved barium	mg/L	G-09S	10/20/2021		0.0065		6.9450
Dissolved beryllium	mg/L	G-09S	10/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09S	10/20/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-09S	10/20/2021		88.1000	***	23.6663
Dissolved chromium	mg/L	G-09S	10/20/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-09S	10/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-09S	10/20/2021	ND	0.0200		46.2274
Dissolved iron	mg/L	G-09S	10/20/2021	ND	0.0200		9.9951
Dissolved lead	mg/L	G-09S	10/20/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-09S	10/20/2021		33.3000		47.7851
Dissolved manganese	mg/L	G-09S	10/20/2021		0.0200		8.9972
Dissolved nickel	mg/L	G-09S	10/20/2021		0.0360	**	0.0380
Dissolved potassium	mg/L	G-09S	10/20/2021		5.1900	***	2.6292
Dissolved selenium	mg/L	G-09S	10/20/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-09S	10/20/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-09S	10/20/2021		94.4000		119.9159
Dissolved thallium	mg/L	G-09S	10/20/2021	ND	0.0001	**	0.0000
Dissolved vanadium	mg/L	G-09S	10/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09S	10/20/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-09S	10/20/2021	ND	0.0100		1.3000
Nitrite nitrogen	mg-N/L	G-09S	10/20/2021		0.0030		47.6219
pH	std units	G-09S	10/20/2021		6.0600	*	6.60 - 9.39
Sulfate	mg/L	G-09S	10/20/2021		185.0000		346.8839
Total dissolved solids	mg/L	G-09S	10/20/2021		600.0000	***	391.0438
Total organic carbon	mg/L	G-09S	10/20/2021		4.0000		14.0000
Alkalinity (as cacO3)	mg/L	G-10S	10/20/2021		520.0000	***	230.0000
Ammonia nitrogen	mg-N/L	G-10S	10/20/2021		0.2790		13.2976

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-10S	10/20/2021		520.0000	***	210.0000
Chemical oxygen demand	mg/L	G-10S	10/20/2021	ND	10.0000		18.0000
Chloride	mg/L	G-10S	10/20/2021		10.5000		18.3725
Conductivity	umhos/cm	G-10S	10/20/2021		1300.0000	***	543.3391
Dissolved antimony	mg/L	G-10S	10/20/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-10S	10/20/2021		0.0050	***	0.0035
Dissolved barium	mg/L	G-10S	10/20/2021		0.0072		6.9450
Dissolved beryllium	mg/L	G-10S	10/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10S	10/20/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-10S	10/20/2021		116.0000	***	23.6663
Dissolved chromium	mg/L	G-10S	10/20/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-10S	10/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-10S	10/20/2021	ND	0.0200		46.2274
Dissolved iron	mg/L	G-10S	10/20/2021		12.2000	***	9.9951
Dissolved lead	mg/L	G-10S	10/20/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-10S	10/20/2021		27.2000		47.7851
Dissolved manganese	mg/L	G-10S	10/20/2021		3.5200		8.9972
Dissolved nickel	mg/L	G-10S	10/20/2021		0.0220		0.0380
Dissolved potassium	mg/L	G-10S	10/20/2021		3.9000	***	2.6292
Dissolved selenium	mg/L	G-10S	10/20/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-10S	10/20/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-10S	10/20/2021		186.0000	***	119.9159
Dissolved thallium	mg/L	G-10S	10/20/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-10S	10/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10S	10/20/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-10S	10/20/2021		0.0500		1.3000
Nitrite nitrogen	mg-N/L	G-10S	10/20/2021		0.0070		47.6219
pH	std units	G-10S	10/20/2021		6.3700	*	6.60 - 9.39
Sulfate	mg/L	G-10S	10/20/2021		260.0000		346.8839
Total dissolved solids	mg/L	G-10S	10/20/2021		860.0000	***	391.0438
Total organic carbon	mg/L	G-10S	10/20/2021		3.7000		14.0000
Alkalinity (as cacO3)	mg/L	G-11S	10/19/2021		84.0000		230.0000
Ammonia nitrogen	mg-N/L	G-11S	10/19/2021	ND	0.0200		13.2976
Bicarbonate	mg/L	G-11S	10/19/2021		84.0000		210.0000
Chemical oxygen demand	mg/L	G-11S	10/19/2021	ND	10.0000		18.0000
Chloride	mg/L	G-11S	10/19/2021		6.1100		18.3725
Conductivity	umhos/cm	G-11S	10/19/2021		270.0000		543.3391
Dissolved antimony	mg/L	G-11S	10/19/2021	ND	0.0003		0.0006
Dissolved arsenic	mg/L	G-11S	10/19/2021		0.0003		0.0035
Dissolved barium	mg/L	G-11S	10/19/2021	ND	0.0050		6.9450
Dissolved beryllium	mg/L	G-11S	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-11S	10/19/2021	ND	0.0001		0.0010
Dissolved calcium	mg/L	G-11S	10/19/2021		14.5000		23.6663
Dissolved chromium	mg/L	G-11S	10/19/2021	ND	0.0100		0.0150
Dissolved cobalt	mg/L	G-11S	10/19/2021	ND	0.0100	**	0.0050
Dissolved copper	mg/L	G-11S	10/19/2021	ND	0.0200		46.2274
Dissolved iron	mg/L	G-11S	10/19/2021	ND	0.0200		9.9951
Dissolved lead	mg/L	G-11S	10/19/2021	ND	0.0001		0.0027
Dissolved magnesium	mg/L	G-11S	10/19/2021		2.9900		47.7851
Dissolved manganese	mg/L	G-11S	10/19/2021		0.0560		8.9972
Dissolved nickel	mg/L	G-11S	10/19/2021	ND	0.0100		0.0380
Dissolved potassium	mg/L	G-11S	10/19/2021		1.1700		2.6292
Dissolved selenium	mg/L	G-11S	10/19/2021	ND	0.0005		0.0003
Dissolved silver	mg/L	G-11S	10/19/2021	ND	0.0001		0.0002
Dissolved sodium	mg/L	G-11S	10/19/2021		42.9000		119.9159
Dissolved thallium	mg/L	G-11S	10/19/2021	ND	0.0001		0.0000
Dissolved vanadium	mg/L	G-11S	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-11S	10/19/2021	ND	0.0100		0.0300
Nitrate nitrogen	mg-N/L	G-11S	10/19/2021		0.0460		1.3000
Nitrite nitrogen	mg-N/L	G-11S	10/19/2021	ND	0.0020		47.6219
pH	std units	G-11S	10/19/2021		6.2600	*	6.60 - 9.39
Sulfate	mg/L	G-11S	10/19/2021		41.2000		346.8839
Total dissolved solids	mg/L	G-11S	10/19/2021		180.0000		391.0438

Table 2**Most Current Downgradient Monitoring Data**

Constituent	Units	Well	Date	Result	Pred. Limit
Total organic carbon	mg/L	G-11S	10/19/2021	2.1000	14.0000

- * - Current value failed - awaiting verification.
 - ** - Current value passed - previous exceedance not verified.
 - *** - Current value failed - exceedance verified.
 - **** - Current value passed - awaiting one more verification.
 - ***** - Insufficient background data to compute prediction limit.
- ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	69	69					230.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	40	69	-2.2437	2.0133	0.0100	2.3996	13.2976	lognor		
Bicarbonate	mg/L	69	69					210.0000	nonpar		0.99
Chemical oxygen demand	mg/L	10	69					18.0000	nonpar		0.99
Chloride	mg/L	68	69	1.4340	0.6154	0.0100	2.3996	18.3725	lognor		
Conductivity	umhos/cm	68	68	415.8824	53.0906	0.0100	2.4007	543.3391	normal		
Dissolved antimony	mg/L	28	67					0.0006	nonpar		0.99
Dissolved arsenic	mg/L	69	69					0.0035	nonpar		0.99
Dissolved barium	mg/L	51	68	-4.3626	2.6245	0.0100	2.4007	6.9450	lognor		
Dissolved beryllium	mg/L	0	69					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	27	68					0.0010	nonpar		0.99
Dissolved calcium	mg/L	66	66	7.1002	6.8937	0.0100	2.4031	23.6663	normal		
Dissolved chromium	mg/L	24	69					0.0150	nonpar		0.99
Dissolved cobalt	mg/L	4	69					0.0050	nonpar	***	0.99
Dissolved copper	mg/L	34	68	-2.4871	2.6328	0.0100	2.4007	46.2274	lognor		
Dissolved iron	mg/L	47	69	-1.9020	1.7520	0.0100	2.3996	9.9951	lognor		
Dissolved lead	mg/L	30	69					0.0027	nonpar		0.99
Dissolved magnesium	mg/L	58	68	-0.1421	1.6698	0.0100	2.4007	47.7851	lognor		
Dissolved manganese	mg/L	50	69	-3.8234	2.5088	0.0100	2.3996	8.9972	lognor		
Dissolved nickel	mg/L	19	69					0.0380	nonpar		0.99
Dissolved potassium	mg/L	61	68	-0.5762	0.6427	0.0100	2.4007	2.6292	lognor		
Dissolved selenium	mg/L	1	65					0.0003	nonpar		0.99
Dissolved silver	mg/L	2	67					0.0002	nonpar		0.99
Dissolved sodium	mg/L	69	69	89.2652	12.7731	0.0100	2.3996	119.9159	normal		
Dissolved thallium	mg/L	3	69					0.0000	nonpar		0.99
Dissolved vanadium	mg/L	0	69					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	30	69					0.0300	nonpar		0.99
Nitrate nitrogen	mg-N/L	63	69					1.3000	nonpar		0.99
Nitrite nitrogen	mg-N/L	36	68	-2.9407	2.8341	0.0100	2.4007	47.6219	lognor		
pH	std units	70	70					6.60- 9.39	nonpar		0.99
Sulfate	mg/L	68	68	3.7678	0.8669	0.0100	2.4007	346.8839	lognor		
Total dissolved solids	mg/L	69	69	276.8116	47.6042	0.0100	2.3996	391.0438	normal		
Total organic carbon	mg/L	64	69					14.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Deep Wells

**Groundwater Analytical Summary - Deep Wells: First Quarter 2021
Cathcart Landfill, Snohomish County, WA**

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09D										G-10D									
						1/12/21					D					1/12/21					D				
						D	V	Tr	Ch		D	V	Tr	Ch		D	V	Tr	Ch		D	V	Tr	Ch	
CONVENTIONAL CHEMISTRY PARAMETERS (mg/L)																									
Alkalinity (as CaCO3)	nonpar	66	66	280	--	200															540				
Ammonia Nitrogen	nonpar	59	59	0.2403	--	0.162				I	N										0.337				
Bicarbonate	nonpar	66	66	280	--	100															540				
Calcium, Dissolved	nonpar	63	63	6.32	--	1.25				D	Y									D	N				
Chemical Oxygen Demand	nonpar	66	16	28	--	15													U						
Chloride	lognor	66	65	6.86	250	6.65				P										D	N				
Conductivity (umhos/cm)	nonpar	66	66	510	700	660				V											1500				
Magnesium, Dissolved	nonpar	62	40	2.33	--	0.05	U														D	N			
Nitrate Nitrogen (mg-N/L)	nonpar	65	14	0.21	10	0.13				D	N								U						
Nitrite Nitrogen (mg-N/L)	nonpar	59	29	0.47	1	0.003													U						
pH (std units)	nonpar	65	65	6.02-10.02	6.5-8.5	9.35																			
Potassium, Dissolved	nonpar	66	62	1.6	--	0.43															1.66				
Sodium, Dissolved	nonpar	63	63	127.8505	20	164															364				
Sulfate	nonpar	65	65	230.291	250	113															D	Y			
Total Dissolved Solids	nonpar	66	66	460	500	430																			
Total Organic Carbon	nonpar	66	62	26	--	2.5															7.3				
DISSOLVED METALS EPA Methods 200.7/200.8 (mg/L)																									
Antimony	nonpar	66	11	0.0015	0.006	0.0003	U												U						
Arsenic	lognor	62	45	10.0722	0.00005	0.00276				D	N								U						
Barium	nonpar	63	13	0.0037	1	0.005	U												U						
Beryllium	nonpar	66	0	0.0005	0.004	0.005	U												U						
Cadmium	nonpar	58	9	0.0001	0.005	0.00005	U												U						
Chromium	nonpar	66	8	0.0136	0.05	0.01	U												U						
Cobalt	nonpar	66	4	0.004	--	0.01	U												U						
Copper	nonpar	63	10	0.055	1	0.02	U												U						
Iron	lognor	60	30	19.5342	0.3	0.02	U												U		Y				
Lead	nonpar	66	20	0.0023	0.05	0.000113				D	N								U						
Manganese	lognor	57	43	11.7351	0.05	0.005	U												U		D	N			
Nickel	nonpar	65	2	0.006	0.1	0.01	U												U						
Selenium	nonpar	65	16	0.0025	0.01	0.0005	U												U						
Silver	nonpar	62	6	0.0007	0.05	0.0001	U												U						
Thallium	nonpar	65	7	0.0001	0.002	0.00005	U												U						
Vanadium	nonpar	66	0	0.01	--	0.01	U												U						
Zinc	nonpar	65	17	0.012	5	0.01	U												U						
TOTAL METALS EPA Methods 200.7/200.8 (mg/L)																									
Antimony					0.006	0.0003	U												U						
Arsenic					0.00005	0.0024													U						
Barium					1	0.0053													U						
Beryllium					0.004	0.005	U												U						
Cadmium					0.005	0.00005	U												U						
Chromium					0.05	0.01	U												U						
Cobalt					--	0.01	U												U						
Copper					1	0.01	U												U						
Iron					0.3	0.62													U						
Lead					0.05	0.00113													U						
Manganese					0.05	0.0646													U						
Nickel					0.1	0.01	U												U						
Selenium					0.01	0.0005	U												U						
Silver					0.05	0.0001	U												U						
Thallium					0.002	0.0001	U												U						
Vanadium					--	0.02	U												U						
Zinc					5	0.01	U												U						
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260 (µg/L)																									
1,1,1-Trichloroethane					200	1	U												U						
1,1,2,2-Tetrachloroethane					--	1	U												U						
1,1,2-Trichloroethane					--	1	U												U						
1,1-Dichloroethane					1	1	U												U						

**Groundwater Analytical Summary - Deep Wells: First Quarter 2021
Cathcart Landfill, Snohomish County, WA**

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200										
						G-09D					G-10D				
						1/12/21	D	V	Tr	Ch	1/12/21	D	V	Tr	Ch
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260 (µg/L) (cont.)															
1,1-Dichloroethylene					--	1	U				1	U			
1,2,3-Trichloropropane					--	1	U				1	U			
1,2-Dibromo-3-chloropropane					0.2	0.05	U				0.05	U			
1,2-Dibromoethane					0.001	0.01	U				0.01	U			
1,2-Dichlorobenzene					--	1	U				1	U			
1,2-Dichloroethane					0.5	0.03	U				0.03	U			
1,2-Dichloropropane					0.6	0.13					0.02	U			
1,4-Dichlorobenzene					4	1	U				1	U			
2-Butanone					--	5	U				5	U			
2-Hexanone					--	5	U				5	U			
4-Methyl-2-Pentanone (MIBK)					--	5	U				5	U			
Acetone					--	5	U				5	U			
Acrylonitrile					0.07	0.03	U				0.03	U			
Benzene					1	1	U				1	U			
Bromodichloromethane					0.3	0.02	U				0.02	U			
Bromoform					5	1	U				1	U			
Bromomethane					--	1	U				1	U			
Carbon Disulfide					--	1	U				1	U			
Carbon Tetrachloride					0.3	0.02	U				0.02	U			
Chlorobenzene					--	0.03	U				0.03	U			
Chlorodibromomethane					0.5	0.5	U				0.5	U			
Chloroethane					--	1	U				1	U			
Chloroform					7	1	U				1	U			
Chloromethane					--	2	U				2	U			
cis-1,2-Dichloroethene					--	0.07					0.02	U			
cis-1,3-Dichloropropene					0.2	0.03	U				0.03	U			
Dibromomethane					--	0.02	U				0.02	U			
Ethyl Benzene					--	1	U				1	U			
m,p-Xylene					--	1	U				1	U			
Methyl Iodide					--	1	U				1	U			
Methylene Chloride					5	2	U				2	U			
o-Xylene					--	1	U				1	U			
Styrene					--	1	U				1	U			
Tetrachloroethylene					0.8	0.02	U				0.02	U			
Toluene					--	2	U				2	U			
trans-1,2-Dichloroethene					--	1	U				1	U			
trans-1,3-Dichloropropene					0.2	0.02	U				0.02	U			
trans-1,4-Dichloro-2-butene					--	5	U				5	U			
Trichlorethene (1,1,2-Trichloroethylene)					3	1	U				1	U			
Trichlorofluoromethane					--	1	U				1	U			
Vinyl Acetate					--	5	U				5	U			
Vinyl Chloride					0.02	0.01	U				0.01	U			

D: U = Indicates compound was not detected at the given reporting limit; X indicates that the compound was detected in the trip blank and contamination is suspected.
V: E= Exceedance, waiting verification based on subsequent lab data; V= Exceedance verified based on previous lab data; P=Passed, previous exceedance not verified based on current lab data.
Tr: I=increasing Trend, D=Decreasing Trend;
Ch: Y indicates a change in trend from previous quarter; N means no change in trend.
Values in purple exceed the prediction limit; indicates that a value exceeded the Groundwater Standards
The groundwater standards listed are based on the Washington Administrative Code (WAC) 173-200 groundwater limits as modified by the TMS 91-11 standards.
B = Methylene chloride was measured in the lab blank at a similar concentration - contamination during analysis suspected.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01D	10/15/2020		240.0000		280.0000
Ammonia nitrogen	mg-N/L	G-01D	10/15/2020	ND	0.0200		0.2931
Bicarbonate	mg/L	G-01D	10/15/2020		120.0000		280.0000
Chemical oxygen demand	mg/L	G-01D	10/15/2020	ND	10.0000		28.0000
Chloride	mg/L	G-01D	10/15/2020		7.8100		8.8360
Conductivity	umhos/cm	G-01D	10/15/2020		610.0000	***	530.0000
Dissolved antimony	mg/L	G-01D	10/15/2020	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-01D	10/15/2020		0.0004		0.0021
Dissolved barium	mg/L	G-01D	10/15/2020	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-01D	10/15/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01D	10/15/2020	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-01D	10/15/2020		0.7300		6.3200
Dissolved chromium	mg/L	G-01D	10/15/2020	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-01D	10/15/2020	ND	0.0100		0.0050
Dissolved copper	mg/L	G-01D	10/15/2020	ND	0.0100		0.0550
Dissolved iron	mg/L	G-01D	10/15/2020	ND	0.0500		19.4192
Dissolved lead	mg/L	G-01D	10/15/2020		0.0001		0.0023
Dissolved magnesium	mg/L	G-01D	10/15/2020	ND	0.2000		2.3300
Dissolved manganese	mg/L	G-01D	10/15/2020	ND	0.0050		10.2259
Dissolved nickel	mg/L	G-01D	10/15/2020	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-01D	10/15/2020	ND	0.5000		1.7013
Dissolved selenium	mg/L	G-01D	10/15/2020	ND	0.0005		0.0014
Dissolved silver	mg/L	G-01D	10/15/2020	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-01D	10/15/2020		145.0000	***	131.0645
Dissolved thallium	mg/L	G-01D	10/15/2020	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-01D	10/15/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01D	10/15/2020	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-01D	10/15/2020	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-01D	10/15/2020	ND	0.0020		0.0540
pH	std units	G-01D	10/15/2020		10.0400	*	6.02 - 9.88
Sulfate	mg/L	G-01D	10/15/2020		49.8000		66.0500
Total dissolved solids	mg/L	G-01D	10/15/2020		380.0000		460.0000
Total organic carbon	mg/L	G-01D	10/15/2020		1.9000		26.0000
Alkalinity (as caco3)	mg/L	G-02D	10/14/2020		90.0000		280.0000
Ammonia nitrogen	mg-N/L	G-02D	10/14/2020		0.0530		0.2931
Bicarbonate	mg/L	G-02D	10/14/2020		90.0000		280.0000
Chemical oxygen demand	mg/L	G-02D	10/14/2020	ND	10.0000		28.0000
Chloride	mg/L	G-02D	10/14/2020		5.3700		8.8360
Conductivity	umhos/cm	G-02D	10/14/2020		360.0000		530.0000
Dissolved antimony	mg/L	G-02D	10/14/2020	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-02D	10/14/2020		0.0042	***	0.0021
Dissolved barium	mg/L	G-02D	10/14/2020	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-02D	10/14/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-02D	10/14/2020	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-02D	10/14/2020		0.4400		6.3200
Dissolved chromium	mg/L	G-02D	10/14/2020	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-02D	10/14/2020	ND	0.0100		0.0050
Dissolved copper	mg/L	G-02D	10/14/2020	ND	0.0100		0.0550
Dissolved iron	mg/L	G-02D	10/14/2020		0.1050		19.4192
Dissolved lead	mg/L	G-02D	10/14/2020	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-02D	10/14/2020	ND	0.2000		2.3300
Dissolved manganese	mg/L	G-02D	10/14/2020	ND	0.0050		10.2259
Dissolved nickel	mg/L	G-02D	10/14/2020	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-02D	10/14/2020	ND	0.5000		1.7013
Dissolved selenium	mg/L	G-02D	10/14/2020	ND	0.0005		0.0014
Dissolved silver	mg/L	G-02D	10/14/2020	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-02D	10/14/2020		83.5000		131.0645
Dissolved thallium	mg/L	G-02D	10/14/2020	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-02D	10/14/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-02D	10/14/2020	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-02D	10/14/2020		0.4200	*	0.2100
Nitrite nitrogen	mg-N/L	G-02D	10/14/2020		0.0030		0.0540
pH	std units	G-02D	10/14/2020		7.6100		6.02 - 9.88
Sulfate	mg/L	G-02D	10/14/2020		69.1000	***	66.0500
Total dissolved solids	mg/L	G-02D	10/14/2020		240.0000		460.0000
Total organic carbon	mg/L	G-02D	10/14/2020		1.2000		26.0000
Alkalinity (as caco3)	mg/L	G-06B	10/14/2020		290.0000	*	280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-06B	10/14/2020		0.0700		0.2931
Bicarbonate	mg/L	G-06B	10/14/2020		230.0000		280.0000
Chemical oxygen demand	mg/L	G-06B	10/14/2020	ND	10.0000		28.0000
Chloride	mg/L	G-06B	10/14/2020		7.8500		8.8360
Conductivity	umhos/cm	G-06B	10/14/2020		710.0000	***	530.0000
Dissolved antimony	mg/L	G-06B	10/14/2020	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-06B	10/14/2020		0.0042	***	0.0021
Dissolved barium	mg/L	G-06B	10/14/2020	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-06B	10/14/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-06B	10/14/2020	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-06B	10/14/2020		1.0200		6.3200
Dissolved chromium	mg/L	G-06B	10/14/2020	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-06B	10/14/2020	ND	0.0100		0.0050
Dissolved copper	mg/L	G-06B	10/14/2020	ND	0.0100		0.0550
Dissolved iron	mg/L	G-06B	10/14/2020	ND	0.0500		19.4192
Dissolved lead	mg/L	G-06B	10/14/2020		0.0001		0.0023
Dissolved magnesium	mg/L	G-06B	10/14/2020	ND	0.2000		2.3300
Dissolved manganese	mg/L	G-06B	10/14/2020	ND	0.0050		10.2259
Dissolved nickel	mg/L	G-06B	10/14/2020	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-06B	10/14/2020		0.5000		1.7013
Dissolved selenium	mg/L	G-06B	10/14/2020	ND	0.0005		0.0014
Dissolved silver	mg/L	G-06B	10/14/2020	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-06B	10/14/2020		176.0000	***	131.0645
Dissolved thallium	mg/L	G-06B	10/14/2020	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-06B	10/14/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-06B	10/14/2020	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-06B	10/14/2020		0.2400	*	0.2100
Nitrite nitrogen	mg-N/L	G-06B	10/14/2020	ND	0.0020		0.0540
pH	std units	G-06B	10/14/2020		8.8400		6.02 - 9.88
Sulfate	mg/L	G-06B	10/14/2020		74.6000	***	66.0500
Total dissolved solids	mg/L	G-06B	10/14/2020		460.0000	**	460.0000
Total organic carbon	mg/L	G-06B	10/14/2020		3.6000		26.0000
Alkalinity (as cacO3)	mg/L	G-08D2	10/14/2020		190.0000		280.0000
Ammonia nitrogen	mg-N/L	G-08D2	10/14/2020		0.2470		0.2931
Bicarbonate	mg/L	G-08D2	10/14/2020		72.0000		280.0000
Chemical oxygen demand	mg/L	G-08D2	10/14/2020	ND	10.0000		28.0000
Chloride	mg/L	G-08D2	10/14/2020		0.9200		8.8360
Conductivity	umhos/cm	G-08D2	10/14/2020		490.0000		530.0000
Dissolved antimony	mg/L	G-08D2	10/14/2020	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-08D2	10/14/2020		0.0006		0.0021
Dissolved barium	mg/L	G-08D2	10/14/2020	ND	0.0050	**	0.0046
Dissolved beryllium	mg/L	G-08D2	10/14/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D2	10/14/2020	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-08D2	10/14/2020		0.5700		6.3200
Dissolved chromium	mg/L	G-08D2	10/14/2020	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-08D2	10/14/2020	ND	0.0100		0.0050
Dissolved copper	mg/L	G-08D2	10/14/2020	ND	0.0100		0.0550
Dissolved iron	mg/L	G-08D2	10/14/2020	ND	0.0500		19.4192
Dissolved lead	mg/L	G-08D2	10/14/2020	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-08D2	10/14/2020	ND	0.2000		2.3300
Dissolved manganese	mg/L	G-08D2	10/14/2020	ND	0.0050		10.2259
Dissolved nickel	mg/L	G-08D2	10/14/2020	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-08D2	10/14/2020	ND	0.5000		1.7013
Dissolved selenium	mg/L	G-08D2	10/14/2020	ND	0.0005		0.0014
Dissolved silver	mg/L	G-08D2	10/14/2020	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-08D2	10/14/2020		111.0000		131.0645
Dissolved thallium	mg/L	G-08D2	10/14/2020	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-08D2	10/14/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D2	10/14/2020	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-08D2	10/14/2020	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-08D2	10/14/2020	ND	0.0020		0.0540
pH	std units	G-08D2	10/14/2020		9.8500	**	6.02 - 9.88
Sulfate	mg/L	G-08D2	10/14/2020		45.5000		66.0500
Total dissolved solids	mg/L	G-08D2	10/14/2020		320.0000		460.0000
Total organic carbon	mg/L	G-08D2	10/14/2020		1.2000		26.0000
Alkalinity (as cacO3)	mg/L	G-09D	01/12/2021		200.0000		280.0000
Ammonia nitrogen	mg-N/L	G-09D	01/12/2021		0.1625		0.2931

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-09D	01/12/2021		110.0000		280.0000
Chemical oxygen demand	mg/L	G-09D	01/12/2021		12.5000		28.0000
Chloride	mg/L	G-09D	01/12/2021		6.5950	**	8.8360
Conductivity	umhos/cm	G-09D	01/12/2021		645.0000	***	530.0000
Dissolved antimony	mg/L	G-09D	01/12/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-09D	01/12/2021		0.0027	***	0.0121
Dissolved barium	mg/L	G-09D	01/12/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-09D	01/12/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09D	01/12/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-09D	01/12/2021		1.1450		6.3200
Dissolved chromium	mg/L	G-09D	01/12/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-09D	01/12/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-09D	01/12/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-09D	01/12/2021	ND	0.0200		19.4192
Dissolved lead	mg/L	G-09D	01/12/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-09D	01/12/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-09D	01/12/2021	ND	0.0050		10.2259
Dissolved nickel	mg/L	G-09D	01/12/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-09D	01/12/2021		0.4450		1.7013
Dissolved selenium	mg/L	G-09D	01/12/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-09D	01/12/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-09D	01/12/2021		165.5000	***	131.0645
Dissolved thallium	mg/L	G-09D	01/12/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-09D	01/12/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09D	01/12/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-09D	01/12/2021		0.1400		0.2100
Nitrite nitrogen	mg-N/L	G-09D	01/12/2021		0.0030		0.0540
pH	std units	G-09D	01/12/2021		9.3500		6.02 - 9.88
Sulfate	mg/L	G-09D	01/12/2021		112.0000	***	66.0500
Total dissolved solids	mg/L	G-09D	01/12/2021		425.0000		460.0000
Total organic carbon	mg/L	G-09D	01/12/2021		2.8500		26.0000
Alkalinity (as cacO3)	mg/L	G-10D	01/12/2021		540.0000	***	280.0000
Ammonia nitrogen	mg-N/L	G-10D	01/12/2021		0.3370	***	0.2931
Bicarbonate	mg/L	G-10D	01/12/2021		540.0000	***	280.0000
Chemical oxygen demand	mg/L	G-10D	01/12/2021	ND	10.0000		28.0000
Chloride	mg/L	G-10D	01/12/2021		16.7000	***	8.8360
Conductivity	umhos/cm	G-10D	01/12/2021		1500.0000	***	530.0000
Dissolved antimony	mg/L	G-10D	01/12/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-10D	01/12/2021		0.0011		0.0021
Dissolved barium	mg/L	G-10D	01/12/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-10D	01/12/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10D	01/12/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-10D	01/12/2021		21.7000	***	6.3200
Dissolved chromium	mg/L	G-10D	01/12/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-10D	01/12/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-10D	01/12/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-10D	01/12/2021		0.4990		19.4192
Dissolved lead	mg/L	G-10D	01/12/2021	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-10D	01/12/2021		1.8000		2.3300
Dissolved manganese	mg/L	G-10D	01/12/2021		0.3700		10.2259
Dissolved nickel	mg/L	G-10D	01/12/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-10D	01/12/2021		1.6600		1.7013
Dissolved selenium	mg/L	G-10D	01/12/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-10D	01/12/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-10D	01/12/2021		364.0000	***	131.0645
Dissolved thallium	mg/L	G-10D	01/12/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-10D	01/12/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10D	01/12/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-10D	01/12/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-10D	01/12/2021	ND	0.0020		0.0540
pH	std units	G-10D	01/12/2021		7.1100		6.02 - 9.88
Sulfate	mg/L	G-10D	01/12/2021		286.0000	***	66.0500
Total dissolved solids	mg/L	G-10D	01/12/2021		1000.0000	***	460.0000
Total organic carbon	mg/L	G-10D	01/12/2021		7.3000		26.0000
Alkalinity (as cacO3)	mg/L	G-13D	10/15/2020		180.0000		280.0000
Ammonia nitrogen	mg-N/L	G-13D	10/15/2020		0.0740		0.2931
Bicarbonate	mg/L	G-13D	10/15/2020		100.0000		280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Chemical oxygen demand	mg/L	G-13D	10/15/2020	ND	10.0000		28.0000
Chloride	mg/L	G-13D	10/15/2020		14.1000	***	8.8360
Conductivity	umhos/cm	G-13D	10/15/2020		450.0000		530.0000
Dissolved antimony	mg/L	G-13D	10/15/2020	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-13D	10/15/2020		0.0001		0.0021
Dissolved barium	mg/L	G-13D	10/15/2020	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-13D	10/15/2020	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-13D	10/15/2020	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-13D	10/15/2020		0.5100		6.3200
Dissolved chromium	mg/L	G-13D	10/15/2020	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-13D	10/15/2020	ND	0.0100		0.0050
Dissolved copper	mg/L	G-13D	10/15/2020	ND	0.0100		0.0550
Dissolved iron	mg/L	G-13D	10/15/2020	ND	0.0500		19.4192
Dissolved lead	mg/L	G-13D	10/15/2020	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-13D	10/15/2020	ND	0.2000		2.3300
Dissolved manganese	mg/L	G-13D	10/15/2020	ND	0.0050		10.2259
Dissolved nickel	mg/L	G-13D	10/15/2020	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-13D	10/15/2020	ND	0.5000		1.7013
Dissolved selenium	mg/L	G-13D	10/15/2020	ND	0.0005		0.0014
Dissolved silver	mg/L	G-13D	10/15/2020	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-13D	10/15/2020		107.0000		131.0645
Dissolved thallium	mg/L	G-13D	10/15/2020	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-13D	10/15/2020	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-13D	10/15/2020	ND	0.0100	**	0.0120
Nitrate nitrogen	mg-N/L	G-13D	10/15/2020	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-13D	10/15/2020	ND	0.0020		0.0540
pH	std units	G-13D	10/15/2020		10.1300	*	6.02 - 9.88
Sulfate	mg/L	G-13D	10/15/2020		32.6000		66.0500
Total dissolved solids	mg/L	G-13D	10/15/2020		300.0000		460.0000
Total organic carbon	mg/L	G-13D	10/15/2020		1.3000		26.0000

* - Current value failed - awaiting verification.
 ** - Current value passed - previous exceedance not verified.
 *** - Current value failed - exceedance verified.
 **** - Current value passed - awaiting one more verification.
 ***** - Insufficient background data to compute prediction limit.
 ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	58	58					280.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	55	55	-2.2071	0.4050	0.0100	2.4191	0.2931	lognor		
Bicarbonate	mg/L	58	58					280.0000	nonpar		0.99
Chemical oxygen demand	mg/L	9	57					28.0000	nonpar		0.99
Chloride	mg/L	57	58	1.2681	0.3773	0.0100	2.4141	8.8360	lognor		
Conductivity	umhos/cm	58	58					530.0000	nonpar		0.99
Dissolved antimony	mg/L	9	56					0.0008	nonpar		0.99
Dissolved arsenic	mg/L	47	57					0.0021	nonpar		0.99
Dissolved barium	mg/L	16	58					0.0046	nonpar		0.99
Dissolved beryllium	mg/L	0	54					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	8	54					0.0001	nonpar		0.99
Dissolved calcium	mg/L	55	55					6.3200	nonpar		0.99
Dissolved chromium	mg/L	7	58					0.0136	nonpar		0.99
Dissolved cobalt	mg/L	2	58					0.0050	nonpar	***	0.99
Dissolved copper	mg/L	11	58					0.0550	nonpar		0.99
Dissolved iron	mg/L	30	55	-1.7421	1.9464	0.0100	2.4191	19.4192	lognor		
Dissolved lead	mg/L	19	56					0.0023	nonpar		0.99
Dissolved magnesium	mg/L	39	56					2.3300	nonpar		0.99
Dissolved manganese	mg/L	40	56	-3.9817	2.6089	0.0100	2.4173	10.2259	lognor		
Dissolved nickel	mg/L	3	58					0.0260	nonpar		0.99
Dissolved potassium	mg/L	48	58	-1.1431	0.6936	0.0100	2.4141	1.7013	lognor		
Dissolved selenium	mg/L	15	56					0.0014	nonpar		0.99
Dissolved silver	mg/L	2	55					0.0001	nonpar		0.99
Dissolved sodium	mg/L	57	57	109.2719	9.0213	0.0100	2.4157	131.0645	normal		
Dissolved thallium	mg/L	4	58					0.0001	nonpar		0.99
Dissolved vanadium	mg/L	1	58					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	15	58					0.0120	nonpar		0.99
Nitrate nitrogen	mg-N/L	15	57					0.2100	nonpar		0.99
Nitrite nitrogen	mg-N/L	26	58					0.0540	nonpar		0.99
pH	std units	58	58					6.02- 9.88	nonpar		0.99
Sulfate	mg/L	57	57					66.0500	nonpar		0.99
Total dissolved solids	mg/L	58	58					460.0000	nonpar		0.99
Total organic carbon	mg/L	58	58					26.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01D	04/21/2021		290.0000	*	280.0000
Ammonia nitrogen	mg-N/L	G-01D	04/21/2021		0.2230		0.2927
Bicarbonate	mg/L	G-01D	04/21/2021		190.0000		280.0000
Chemical oxygen demand	mg/L	G-01D	04/21/2021		15.0000		28.0000
Chloride	mg/L	G-01D	04/21/2021		7.6400		8.7455
Conductivity	umhos/cm	G-01D	04/21/2021		650.0000	***	530.0000
Dissolved antimony	mg/L	G-01D	04/21/2021		0.0004		0.0008
Dissolved arsenic	mg/L	G-01D	04/21/2021		0.0012		0.0021
Dissolved barium	mg/L	G-01D	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-01D	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01D	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-01D	04/21/2021		1.9000		6.3200
Dissolved chromium	mg/L	G-01D	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-01D	04/21/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-01D	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-01D	04/21/2021		0.0610		19.6852
Dissolved lead	mg/L	G-01D	04/21/2021		0.0004		0.0023
Dissolved magnesium	mg/L	G-01D	04/21/2021		0.2600		2.3300
Dissolved manganese	mg/L	G-01D	04/21/2021		0.0110		13.3342
Dissolved nickel	mg/L	G-01D	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-01D	04/21/2021		0.3300		1.8490
Dissolved selenium	mg/L	G-01D	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-01D	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-01D	04/21/2021		205.0000	***	130.7721
Dissolved thallium	mg/L	G-01D	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-01D	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01D	04/21/2021		0.0180	*	0.0120
Nitrate nitrogen	mg-N/L	G-01D	04/21/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-01D	04/21/2021		0.0160		0.0540
pH	std units	G-01D	04/21/2021		9.2700	**	6.02 - 9.88
Sulfate	mg/L	G-01D	04/21/2021		58.2000		66.0500
Total dissolved solids	mg/L	G-01D	04/21/2021		540.0000	*	460.0000
Total organic carbon	mg/L	G-01D	04/21/2021		11.0000		26.0000
Alkalinity (as caco3)	mg/L	G-02D	04/21/2021		90.0000		280.0000
Ammonia nitrogen	mg-N/L	G-02D	04/21/2021	ND	0.0200		0.2927
Bicarbonate	mg/L	G-02D	04/21/2021		90.0000		280.0000
Chemical oxygen demand	mg/L	G-02D	04/21/2021	ND	10.0000		28.0000
Chloride	mg/L	G-02D	04/21/2021		6.3400		8.7455
Conductivity	umhos/cm	G-02D	04/21/2021		360.0000		530.0000
Dissolved antimony	mg/L	G-02D	04/21/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-02D	04/21/2021		0.0037	***	0.0021
Dissolved barium	mg/L	G-02D	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-02D	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-02D	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-02D	04/21/2021		0.3700		6.3200
Dissolved chromium	mg/L	G-02D	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-02D	04/21/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-02D	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-02D	04/21/2021		0.0280		19.6852
Dissolved lead	mg/L	G-02D	04/21/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-02D	04/21/2021		0.2100		2.3300
Dissolved manganese	mg/L	G-02D	04/21/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-02D	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-02D	04/21/2021	ND	0.2000		1.8490
Dissolved selenium	mg/L	G-02D	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-02D	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-02D	04/21/2021		79.4000		130.7721
Dissolved thallium	mg/L	G-02D	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-02D	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-02D	04/21/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-02D	04/21/2021		0.3200	*	0.2100
Nitrite nitrogen	mg-N/L	G-02D	04/21/2021	ND	0.0020		0.0540
pH	std units	G-02D	04/21/2021		7.9900		6.02 - 9.88
Sulfate	mg/L	G-02D	04/21/2021		70.2000	***	66.0500
Total dissolved solids	mg/L	G-02D	04/21/2021		220.0000		460.0000
Total organic carbon	mg/L	G-02D	04/21/2021		1.9000		26.0000
Alkalinity (as caco3)	mg/L	G-06B	04/21/2021		270.0000	**	280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-06B	04/21/2021		0.0810		0.2927
Bicarbonate	mg/L	G-06B	04/21/2021		270.0000		280.0000
Chemical oxygen demand	mg/L	G-06B	04/21/2021		15.0000		28.0000
Chloride	mg/L	G-06B	04/21/2021		7.2600		8.7455
Conductivity	umhos/cm	G-06B	04/21/2021		650.0000	***	530.0000
Dissolved antimony	mg/L	G-06B	04/21/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-06B	04/21/2021		0.0042	***	0.0021
Dissolved barium	mg/L	G-06B	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-06B	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-06B	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-06B	04/21/2021		1.3600		6.3200
Dissolved chromium	mg/L	G-06B	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-06B	04/21/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-06B	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-06B	04/21/2021		0.0360		19.6852
Dissolved lead	mg/L	G-06B	04/21/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-06B	04/21/2021		0.2400		2.3300
Dissolved manganese	mg/L	G-06B	04/21/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-06B	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-06B	04/21/2021		0.2000		1.8490
Dissolved selenium	mg/L	G-06B	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-06B	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-06B	04/21/2021		178.0000	***	130.7721
Dissolved thallium	mg/L	G-06B	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-06B	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-06B	04/21/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-06B	04/21/2021		0.1800	**	0.2100
Nitrite nitrogen	mg-N/L	G-06B	04/21/2021		0.0020		0.0540
pH	std units	G-06B	04/21/2021		8.3500		6.02 - 9.88
Sulfate	mg/L	G-06B	04/21/2021		67.6000	***	66.0500
Total dissolved solids	mg/L	G-06B	04/21/2021		410.0000		460.0000
Total organic carbon	mg/L	G-06B	04/21/2021		3.4000		26.0000
Alkalinity (as cacO3)	mg/L	G-08D2	04/20/2021		270.0000		280.0000
Ammonia nitrogen	mg-N/L	G-08D2	04/20/2021		0.1980		0.2927
Bicarbonate	mg/L	G-08D2	04/20/2021		110.0000		280.0000
Chemical oxygen demand	mg/L	G-08D2	04/20/2021		15.0000		28.0000
Chloride	mg/L	G-08D2	04/20/2021		2.9600		8.7455
Conductivity	umhos/cm	G-08D2	04/20/2021		470.0000		530.0000
Dissolved antimony	mg/L	G-08D2	04/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-08D2	04/20/2021		0.0013		0.0021
Dissolved barium	mg/L	G-08D2	04/20/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-08D2	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D2	04/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-08D2	04/20/2021		0.4000		6.3200
Dissolved chromium	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-08D2	04/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-08D2	04/20/2021		0.0590		19.6852
Dissolved lead	mg/L	G-08D2	04/20/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-08D2	04/20/2021		0.1800		2.3300
Dissolved manganese	mg/L	G-08D2	04/20/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-08D2	04/20/2021	ND	0.2000		1.8490
Dissolved selenium	mg/L	G-08D2	04/20/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-08D2	04/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-08D2	04/20/2021		106.0000		130.7721
Dissolved thallium	mg/L	G-08D2	04/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-08D2	04/20/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-08D2	04/20/2021		0.0060		0.0540
pH	std units	G-08D2	04/20/2021		9.9000	*	6.02 - 9.88
Sulfate	mg/L	G-08D2	04/20/2021		43.3000		66.0500
Total dissolved solids	mg/L	G-08D2	04/20/2021		330.0000		460.0000
Total organic carbon	mg/L	G-08D2	04/20/2021		0.9100		26.0000
Alkalinity (as cacO3)	mg/L	G-09D	04/20/2021		190.0000		280.0000
Ammonia nitrogen	mg-N/L	G-09D	04/20/2021		0.1510		0.2927

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-09D	04/20/2021		69.0000		280.0000
Chemical oxygen demand	mg/L	G-09D	04/20/2021		26.0000		28.0000
Chloride	mg/L	G-09D	04/20/2021		7.9700		8.7455
Conductivity	umhos/cm	G-09D	04/20/2021		680.0000	***	530.0000
Dissolved antimony	mg/L	G-09D	04/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-09D	04/20/2021		0.0035	***	0.0021
Dissolved barium	mg/L	G-09D	04/20/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-09D	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09D	04/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-09D	04/20/2021		1.3100		6.3200
Dissolved chromium	mg/L	G-09D	04/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-09D	04/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-09D	04/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-09D	04/20/2021	ND	0.0200		19.6852
Dissolved lead	mg/L	G-09D	04/20/2021		0.0001		0.0023
Dissolved magnesium	mg/L	G-09D	04/20/2021		0.1500		2.3300
Dissolved manganese	mg/L	G-09D	04/20/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-09D	04/20/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-09D	04/20/2021		0.3400		1.8490
Dissolved selenium	mg/L	G-09D	04/20/2021		0.0008		0.0014
Dissolved silver	mg/L	G-09D	04/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-09D	04/20/2021		176.0000	***	130.7721
Dissolved thallium	mg/L	G-09D	04/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-09D	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09D	04/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-09D	04/20/2021		0.1400		0.2100
Nitrite nitrogen	mg-N/L	G-09D	04/20/2021		0.0110		0.0540
pH	std units	G-09D	04/20/2021		8.5800		6.02 - 9.88
Sulfate	mg/L	G-09D	04/20/2021		128.0000	***	66.0500
Total dissolved solids	mg/L	G-09D	04/20/2021		450.0000		460.0000
Total organic carbon	mg/L	G-09D	04/20/2021		5.3000		26.0000
Alkalinity (as cacO3)	mg/L	G-10D	04/20/2021		540.0000	***	280.0000
Ammonia nitrogen	mg-N/L	G-10D	04/20/2021		0.0380	**	0.2927
Bicarbonate	mg/L	G-10D	04/20/2021		540.0000	***	280.0000
Chemical oxygen demand	mg/L	G-10D	04/20/2021		21.0000		28.0000
Chloride	mg/L	G-10D	04/20/2021		17.1000	***	8.7455
Conductivity	umhos/cm	G-10D	04/20/2021		1500.0000	***	530.0000
Dissolved antimony	mg/L	G-10D	04/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-10D	04/20/2021		0.0013		0.0021
Dissolved barium	mg/L	G-10D	04/20/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-10D	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10D	04/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-10D	04/20/2021		18.9000	***	6.3200
Dissolved chromium	mg/L	G-10D	04/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-10D	04/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-10D	04/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-10D	04/20/2021		0.4930		19.6852
Dissolved lead	mg/L	G-10D	04/20/2021	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-10D	04/20/2021		1.7000		2.3300
Dissolved manganese	mg/L	G-10D	04/20/2021		0.3670		13.3342
Dissolved nickel	mg/L	G-10D	04/20/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-10D	04/20/2021		1.2400		1.8490
Dissolved selenium	mg/L	G-10D	04/20/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-10D	04/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-10D	04/20/2021		376.0000	***	130.7721
Dissolved thallium	mg/L	G-10D	04/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-10D	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10D	04/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-10D	04/20/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-10D	04/20/2021	ND	0.0020		0.0540
pH	std units	G-10D	04/20/2021		7.3400		6.02 - 9.88
Sulfate	mg/L	G-10D	04/20/2021		289.0000	***	66.0500
Total dissolved solids	mg/L	G-10D	04/20/2021		1000.0000	***	460.0000
Total organic carbon	mg/L	G-10D	04/20/2021		12.0000		26.0000
Alkalinity (as cacO3)	mg/L	G-13D	04/21/2021		180.0000		280.0000
Ammonia nitrogen	mg-N/L	G-13D	04/21/2021		0.0890		0.2927
Bicarbonate	mg/L	G-13D	04/21/2021		75.0000		280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Chemical oxygen demand	mg/L	G-13D	04/21/2021	ND	10.0000		28.0000
Chloride	mg/L	G-13D	04/21/2021		12.2000	***	8.7455
Conductivity	umhos/cm	G-13D	04/21/2021		460.0000		530.0000
Dissolved antimony	mg/L	G-13D	04/21/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-13D	04/21/2021		0.0002		0.0021
Dissolved barium	mg/L	G-13D	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-13D	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-13D	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-13D	04/21/2021		0.6300		6.3200
Dissolved chromium	mg/L	G-13D	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-13D	04/21/2021		0.0100	*	0.0050
Dissolved copper	mg/L	G-13D	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-13D	04/21/2021		0.0370		19.6852
Dissolved lead	mg/L	G-13D	04/21/2021	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-13D	04/21/2021		0.1700		2.3300
Dissolved manganese	mg/L	G-13D	04/21/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-13D	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-13D	04/21/2021		0.3200		1.8490
Dissolved selenium	mg/L	G-13D	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-13D	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-13D	04/21/2021		106.0000		130.7721
Dissolved thallium	mg/L	G-13D	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-13D	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-13D	04/21/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-13D	04/21/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-13D	04/21/2021	ND	0.0020		0.0540
pH	std units	G-13D	04/21/2021		9.3100	**	6.02 - 9.88
Sulfate	mg/L	G-13D	04/21/2021		34.2000		66.0500
Total dissolved solids	mg/L	G-13D	04/21/2021		300.0000		460.0000
Total organic carbon	mg/L	G-13D	04/21/2021		2.1000		26.0000

* - Current value failed - awaiting verification.
** - Current value passed - previous exceedance not verified.
*** - Current value failed - exceedance verified.
**** - Current value passed - awaiting one more verification.
***** - Insufficient background data to compute prediction limit.
ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	60	60					280.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	57	57	-2.2001	0.4021	0.0100	2.4157	0.2927	lognor		
Bicarbonate	mg/L	60	60					280.0000	nonpar		0.99
Chemical oxygen demand	mg/L	10	59					28.0000	nonpar		0.99
Chloride	mg/L	59	60	1.2645	0.3749	0.0100	2.4110	8.7455	lognor		
Conductivity	umhos/cm	60	60					530.0000	nonpar		0.99
Dissolved antimony	mg/L	9	58					0.0008	nonpar		0.99
Dissolved arsenic	mg/L	48	59					0.0021	nonpar		0.99
Dissolved barium	mg/L	16	59					0.0046	nonpar		0.99
Dissolved beryllium	mg/L	0	54					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	8	56					0.0001	nonpar		0.99
Dissolved calcium	mg/L	57	57					6.3200	nonpar		0.99
Dissolved chromium	mg/L	7	60					0.0136	nonpar		0.99
Dissolved cobalt	mg/L	2	60					0.0050	nonpar	***	0.99
Dissolved copper	mg/L	11	60					0.0550	nonpar		0.99
Dissolved iron	mg/L	31	59	-1.6843	1.9333	0.0100	2.4125	19.6852	lognor		
Dissolved lead	mg/L	22	60					0.0023	nonpar		0.99
Dissolved magnesium	mg/L	41	58					2.3300	nonpar		0.99
Dissolved manganese	mg/L	40	58	-3.8444	2.6655	0.0100	2.4141	13.3342	lognor		
Dissolved nickel	mg/L	3	60					0.0260	nonpar		0.99
Dissolved potassium	mg/L	49	60	-1.1046	0.7131	0.0100	2.4110	1.8490	lognor		
Dissolved selenium	mg/L	15	58					0.0014	nonpar		0.99
Dissolved silver	mg/L	2	57					0.0001	nonpar		0.99
Dissolved sodium	mg/L	59	59	109.3559	8.8770	0.0100	2.4125	130.7721	normal		
Dissolved thallium	mg/L	4	60					0.0001	nonpar		0.99
Dissolved vanadium	mg/L	1	60					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	15	60					0.0120	nonpar		0.99
Nitrate nitrogen	mg-N/L	15	59					0.2100	nonpar		0.99
Nitrite nitrogen	mg-N/L	27	60					0.0540	nonpar		0.99
pH	std units	60	60					6.02- 9.88	nonpar		0.99
Sulfate	mg/L	59	59					66.0500	nonpar		0.99
Total dissolved solids	mg/L	60	60					460.0000	nonpar		0.99
Total organic carbon	mg/L	60	60					26.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Groundwater Analytical Summary - Deep Wells: Third Quarter 2021
Cathcart Landfill, Snohomish County, WA

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09D					G-10D				
						7/14/21	D	V	Tr	Ch	7/14/21	D	V	Tr	Ch
CONVENTIONAL CHEMISTRY PARAMETERS (mg/L)															
Alkalinity (as CaCO3)	nonpar	60	60	280	--	160					530				
Ammonia Nitrogen	lognor	57	57	0.2927	--	0.145			I	N	0.381				
Bicarbonate	nonpar	60	60	280	--	140			D	Y	530				
Calcium, Dissolved	nonpar	57	57	6.32	--	1.6			D	N	21.0			D N	
Chemical Oxygen Demand	nonpar	59	10	28	--	10	U				10	U			
Chloride	lognor	60	59	8.7455	250	8.12					18.8			D N	
Conductivity (umhos/cm)	nonpar	60	60	530	700	710					1500				
Magnesium, Dissolved	nonpar	58	41	2.33	--	0.05					1.75			D N	
Nitrate Nitrogen (mg-N/L)	nonpar	59	15	0.21	10	0.33				Y	0.01	U			
Nitrite Nitrogen (mg-N/L)	nonpar	60	27	0.054	1	0.05					0.002	U			
pH (std units)	nonpar	60	60	6.02-9.88	6.5-8.5	8.73					7.30				
Potassium, Dissolved	lognor	60	49	1.849	--	0.48					1.70				
Sodium, Dissolved	normal	59	59	130.7721	20	174					369				
Sulfate	nonpar	59	59	66.05	250	129					268			D N	
Total Dissolved Solids	nonpar	60	60	460	500	450					970				
Total Organic Carbon	nonpar	60	60	26	--	4.9					6.7				
DISSOLVED METALS EPA Methods 200.7/200.8 (mg/L)															
Antimony	nonpar	58	9	0.0008	0.006	0.0003	U				0.0003	U			
Arsenic	nonpar	59	48	0.0021	0.00005	0.00438			D	N	0.00128				
Barium	nonpar	59	16	0.0046	1	0.005	U				0.0075				
Beryllium	nonpar	54	0	0.0005	0.004	0.005	U				0.005	U			
Cadmium	nonpar	56	8	0.0001	0.005	0.00005	U				0.00005	U			
Chromium	nonpar	60	7	0.0136	0.05	0.01	U				0.01	U			
Cobalt	nonpar	60	2	0.005	--	0.01	U				0.01	U			
Copper	nonpar	60	11	0.055	1	0.02	U				0.02	U			
Iron	lognor	59	31	19.6852	0.3	0.022					0.499				
Lead	nonpar	60	22	0.0023	0.05	0.000329			D	N	0.0001	U			
Manganese	lognor	58	40	13.3342	0.05	0.005	U				0.354			D N	
Nickel	nonpar	60	3	0.026	0.1	0.017					0.04				
Selenium	nonpar	58	15	0.0014	0.01	0.0005	U				0.0005	U			
Silver	nonpar	57	2	0.0001	0.05	0.0001	U				0.0001	U			
Thallium	nonpar	60	4	0.0001	0.002	0.00005	U				0.00005	U			
Vanadium	nonpar	60	1	0.01	--	0.01	U				0.01	U			
Zinc	nonpar	60	15	0.012	5	0.01	U				0.01	U			
TOTAL METALS EPA Methods 200.7/200.8 (mg/L)															
Antimony					0.006	0.0003	U				0.0003	U			
Arsenic					0.00005	0.0032					0.0011				
Barium					1	0.0092					0.005	U			
Beryllium					0.004	0.005	U				0.005	U			
Cadmium					0.005	0.00005	U				0.00005	U			
Chromium					0.05	0.01	U				0.01	U			
Cobalt					--	0.01	U				0.01	U			
Copper					1	0.11					0.01	U			
Iron					0.3	1.62					0.494				
Lead					0.05	0.00245					0.0001	U			
Manganese					0.05	0.148					0.34				
Nickel					0.1	0.01	U				0.046				
Selenium					0.01	0.0005	U				0.0005	U			
Silver					0.05	0.0001	U				0.0001	U			
Thallium					0.002	0.0001	U				0.0001	U			
Vanadium					--	0.02	U				0.02	U			
Zinc					5	0.01	U				0.01	U			
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260 (µg/L)															
1,1,1-Trichloroethane					200	1	U				1	U			
1,1,2,2-Tetrachloroethane					--	1	U				1	U			
1,1,2-Trichloroethane					--	1	U				1	U			
1,1-Dichloroethane					1	1	U				1	U			

**Groundwater Analytical Summary - Deep Wells: Third Quarter 2021
Cathcart Landfill, Snohomish County, WA**

	Statistical Method	Number of Samples	Number of Detects	Prediction Limit	Primary GW Stds 173-200	G-09D					G-10D					
						7/14/21	D	V	Tr	Ch	7/14/21	D	V	Tr	Ch	
VOLATILE ORGANIC COMPOUNDS (VOCs) EPA Method 8260 (µg/L) (cont.)																
1,1-Dichloroethylene					--	1	U				1	U				
1,2,3-Trichloropropane					--	1	U				1	U				
1,2-Dibromo-3-chloropropane					0.2	0.05	U				0.05	U				
1,2-Dibromoethane					0.001	0.01	U				0.01	U				
1,2-Dichlorobenzene					--	1	U				1	U				
1,2-Dichloroethane					0.5	0.03	U				0.03	U				
1,2-Dichloropropane					0.6	0.02	U				0.02	U				
1,4-Dichlorobenzene					4	1	U				1	U				
2-Butanone					--	5	U				5	U				
2-Hexanone					--	5	U				5	U				
4-Methyl-2-Pentanone (MIBK)					--	5	U				5	U				
Acetone					--	5	U				5	U				
Acrylonitrile					0.07	0.03	U				0.03	U				
Benzene					1	1	U				1	U				
Bromodichloromethane					0.3	0.02	U				0.02	U				
Bromoform					5	1	U				1	U				
Bromomethane					--	1	U				1	U				
Carbon Disulfide					--	1	U				1	U				
Carbon Tetrachloride					0.3	0.02	U				0.02	U				
Chlorobenzene					--	0.03	U				0.03	U				
Chlorodibromomethane					0.5	0.5	U				0.5	U				
Chloroethane					--	1	U				1	U				
Chloroform					7	1	U				1	U				
Chloromethane					--	2	U				2	U				
cis-1,2-Dichloroethene					--	0.02	U				0.02	U				
cis-1,3-Dichloropropene					0.2	0.03	U				0.03	U				
Dibromomethane					--	0.02	U				0.02	U				
Ethyl Benzene					--	1	U				1	U				
m,p-Xylene					--	1	U				1	U				
Methyl Iodide					--	1	U				1	U				
Methylene Chloride					5	2	U				2	U				
o-Xylene					--	1	U				1	U				
Styrene					--	1	U				1	U				
Tetrachloroethylene					0.8	0.02	U				0.02	U				
Toluene					--	2	U				2	U				
trans-1,2-Dichloroethene					--	1	U				1	U				
trans-1,3-Dichloropropene					0.2	0.02	U				0.02	U				
trans-1,4-Dichloro-2-butene					--	5	U				5	U				
Trichlorethene (1,1,2-Trichloroethylene)					3	1	U				1	U				
Trichlorofluoromethane					--	1	U				1	U				
Vinyl Acetate					--	5	U				5	U				
Vinyl Chloride					0.02	0.57					0.01	U				

D: U = Indicates compound was not detected at the given reporting limit; X indicates that the compound was detected in the trip blank and contamination is suspected.
V: E= Exceedance, waiting verification based on subsequent lab data; V= Exceedance verified based on previous lab data; P=Passed, previous exceedance not verified based on current lab data.
Tr: I=increasing Trend, D=Decreasing Trend;
Ch: Y indicates a change in trend from previous quarter; N means no change in trend.
Values in purple exceed the prediction limit; indicates that a value exceeded the Groundwater Standards
The groundwater standards listed are based on the Washington Administrative Code (WAC) 173-200 groundwater limits as modified by the TMS 91-11 standards.
B = Methylene chloride was measured in the lab blank at a similar concentration - contamination during analysis suspected.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01D	04/21/2021		290.0000	*	280.0000
Ammonia nitrogen	mg-N/L	G-01D	04/21/2021		0.2230		0.2927
Bicarbonate	mg/L	G-01D	04/21/2021		190.0000		280.0000
Chemical oxygen demand	mg/L	G-01D	04/21/2021		15.0000		28.0000
Chloride	mg/L	G-01D	04/21/2021		7.6400		8.7455
Conductivity	umhos/cm	G-01D	04/21/2021		650.0000	***	530.0000
Dissolved antimony	mg/L	G-01D	04/21/2021		0.0004		0.0008
Dissolved arsenic	mg/L	G-01D	04/21/2021		0.0012		0.0021
Dissolved barium	mg/L	G-01D	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-01D	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01D	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-01D	04/21/2021		1.9000		6.3200
Dissolved chromium	mg/L	G-01D	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-01D	04/21/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-01D	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-01D	04/21/2021		0.0610		19.6852
Dissolved lead	mg/L	G-01D	04/21/2021		0.0004		0.0023
Dissolved magnesium	mg/L	G-01D	04/21/2021		0.2600		2.3300
Dissolved manganese	mg/L	G-01D	04/21/2021		0.0110		13.3342
Dissolved nickel	mg/L	G-01D	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-01D	04/21/2021		0.3300		1.8490
Dissolved selenium	mg/L	G-01D	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-01D	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-01D	04/21/2021		205.0000	***	130.7721
Dissolved thallium	mg/L	G-01D	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-01D	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01D	04/21/2021		0.0180	*	0.0120
Nitrate nitrogen	mg-N/L	G-01D	04/21/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-01D	04/21/2021		0.0160		0.0540
pH	std units	G-01D	04/21/2021		9.2700	**	6.02 - 9.88
Sulfate	mg/L	G-01D	04/21/2021		58.2000		66.0500
Total dissolved solids	mg/L	G-01D	04/21/2021		540.0000	*	460.0000
Total organic carbon	mg/L	G-01D	04/21/2021		11.0000		26.0000
Alkalinity (as caco3)	mg/L	G-02D	04/21/2021		90.0000		280.0000
Ammonia nitrogen	mg-N/L	G-02D	04/21/2021	ND	0.0200		0.2927
Bicarbonate	mg/L	G-02D	04/21/2021		90.0000		280.0000
Chemical oxygen demand	mg/L	G-02D	04/21/2021	ND	10.0000		28.0000
Chloride	mg/L	G-02D	04/21/2021		6.3400		8.7455
Conductivity	umhos/cm	G-02D	04/21/2021		360.0000		530.0000
Dissolved antimony	mg/L	G-02D	04/21/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-02D	04/21/2021		0.0037	***	0.0021
Dissolved barium	mg/L	G-02D	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-02D	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-02D	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-02D	04/21/2021		0.3700		6.3200
Dissolved chromium	mg/L	G-02D	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-02D	04/21/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-02D	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-02D	04/21/2021		0.0280		19.6852
Dissolved lead	mg/L	G-02D	04/21/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-02D	04/21/2021		0.2100		2.3300
Dissolved manganese	mg/L	G-02D	04/21/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-02D	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-02D	04/21/2021	ND	0.2000		1.8490
Dissolved selenium	mg/L	G-02D	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-02D	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-02D	04/21/2021		79.4000		130.7721
Dissolved thallium	mg/L	G-02D	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-02D	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-02D	04/21/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-02D	04/21/2021		0.3200	*	0.2100
Nitrite nitrogen	mg-N/L	G-02D	04/21/2021	ND	0.0020		0.0540
pH	std units	G-02D	04/21/2021		7.9900		6.02 - 9.88
Sulfate	mg/L	G-02D	04/21/2021		70.2000	***	66.0500
Total dissolved solids	mg/L	G-02D	04/21/2021		220.0000		460.0000
Total organic carbon	mg/L	G-02D	04/21/2021		1.9000		26.0000
Alkalinity (as caco3)	mg/L	G-06B	04/21/2021		270.0000	**	280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-06B	04/21/2021		0.0810		0.2927
Bicarbonate	mg/L	G-06B	04/21/2021		270.0000		280.0000
Chemical oxygen demand	mg/L	G-06B	04/21/2021		15.0000		28.0000
Chloride	mg/L	G-06B	04/21/2021		7.2600		8.7455
Conductivity	umhos/cm	G-06B	04/21/2021		650.0000	***	530.0000
Dissolved antimony	mg/L	G-06B	04/21/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-06B	04/21/2021		0.0042	***	0.0021
Dissolved barium	mg/L	G-06B	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-06B	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-06B	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-06B	04/21/2021		1.3600		6.3200
Dissolved chromium	mg/L	G-06B	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-06B	04/21/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-06B	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-06B	04/21/2021		0.0360		19.6852
Dissolved lead	mg/L	G-06B	04/21/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-06B	04/21/2021		0.2400		2.3300
Dissolved manganese	mg/L	G-06B	04/21/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-06B	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-06B	04/21/2021		0.2000		1.8490
Dissolved selenium	mg/L	G-06B	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-06B	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-06B	04/21/2021		178.0000	***	130.7721
Dissolved thallium	mg/L	G-06B	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-06B	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-06B	04/21/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-06B	04/21/2021		0.1800	**	0.2100
Nitrite nitrogen	mg-N/L	G-06B	04/21/2021		0.0020		0.0540
pH	std units	G-06B	04/21/2021		8.3500		6.02 - 9.88
Sulfate	mg/L	G-06B	04/21/2021		67.6000	***	66.0500
Total dissolved solids	mg/L	G-06B	04/21/2021		410.0000		460.0000
Total organic carbon	mg/L	G-06B	04/21/2021		3.4000		26.0000
Alkalinity (as cacO3)	mg/L	G-08D2	04/20/2021		270.0000		280.0000
Ammonia nitrogen	mg-N/L	G-08D2	04/20/2021		0.1980		0.2927
Bicarbonate	mg/L	G-08D2	04/20/2021		110.0000		280.0000
Chemical oxygen demand	mg/L	G-08D2	04/20/2021		15.0000		28.0000
Chloride	mg/L	G-08D2	04/20/2021		2.9600		8.7455
Conductivity	umhos/cm	G-08D2	04/20/2021		470.0000		530.0000
Dissolved antimony	mg/L	G-08D2	04/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-08D2	04/20/2021		0.0013		0.0021
Dissolved barium	mg/L	G-08D2	04/20/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-08D2	04/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D2	04/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-08D2	04/20/2021		0.4000		6.3200
Dissolved chromium	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-08D2	04/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-08D2	04/20/2021		0.0590		19.6852
Dissolved lead	mg/L	G-08D2	04/20/2021		0.0002		0.0023
Dissolved magnesium	mg/L	G-08D2	04/20/2021		0.1800		2.3300
Dissolved manganese	mg/L	G-08D2	04/20/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-08D2	04/20/2021	ND	0.2000		1.8490
Dissolved selenium	mg/L	G-08D2	04/20/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-08D2	04/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-08D2	04/20/2021		106.0000		130.7721
Dissolved thallium	mg/L	G-08D2	04/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D2	04/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-08D2	04/20/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-08D2	04/20/2021		0.0060		0.0540
pH	std units	G-08D2	04/20/2021		9.9000	*	6.02 - 9.88
Sulfate	mg/L	G-08D2	04/20/2021		43.3000		66.0500
Total dissolved solids	mg/L	G-08D2	04/20/2021		330.0000		460.0000
Total organic carbon	mg/L	G-08D2	04/20/2021		0.9100		26.0000
Alkalinity (as cacO3)	mg/L	G-09D	07/14/2021		160.0000		280.0000
Ammonia nitrogen	mg-N/L	G-09D	07/14/2021		0.1450		0.2927

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-09D	07/14/2021		140.0000		280.0000
Chemical oxygen demand	mg/L	G-09D	07/14/2021	ND	10.0000		28.0000
Chloride	mg/L	G-09D	07/14/2021		8.1200		8.7455
Conductivity	umhos/cm	G-09D	07/14/2021		710.0000	***	530.0000
Dissolved antimony	mg/L	G-09D	07/14/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-09D	07/14/2021		0.0044	***	0.0214
Dissolved barium	mg/L	G-09D	07/14/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-09D	07/14/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09D	07/14/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-09D	07/14/2021		1.6000		6.3200
Dissolved chromium	mg/L	G-09D	07/14/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-09D	07/14/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-09D	07/14/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-09D	07/14/2021		0.0220		19.6852
Dissolved lead	mg/L	G-09D	07/14/2021		0.0003		0.0023
Dissolved magnesium	mg/L	G-09D	07/14/2021		0.0500		2.3300
Dissolved manganese	mg/L	G-09D	07/14/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-09D	07/14/2021		0.0170		0.0260
Dissolved potassium	mg/L	G-09D	07/14/2021		0.4800		1.8490
Dissolved selenium	mg/L	G-09D	07/14/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-09D	07/14/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-09D	07/14/2021		174.0000	***	130.7721
Dissolved thallium	mg/L	G-09D	07/14/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-09D	07/14/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-09D	07/14/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-09D	07/14/2021		0.3300	*	0.2100
Nitrite nitrogen	mg-N/L	G-09D	07/14/2021		0.0500		0.0540
pH	std units	G-09D	07/14/2021	ND	0.1000		6.02 - 9.88
Sulfate	mg/L	G-09D	07/14/2021		129.0000	***	66.0500
Total dissolved solids	mg/L	G-09D	07/14/2021		450.0000		460.0000
Total organic carbon	mg/L	G-09D	07/14/2021		4.9000		26.0000
Alkalinity (as cacO3)	mg/L	G-10D	07/14/2021		530.0000	***	280.0000
Ammonia nitrogen	mg-N/L	G-10D	07/14/2021		0.3810	*	0.2927
Bicarbonate	mg/L	G-10D	07/14/2021		530.0000	***	280.0000
Chemical oxygen demand	mg/L	G-10D	07/14/2021	ND	10.0000		28.0000
Chloride	mg/L	G-10D	07/14/2021		18.8000	***	8.7455
Conductivity	umhos/cm	G-10D	07/14/2021		1500.0000	***	530.0000
Dissolved antimony	mg/L	G-10D	07/14/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-10D	07/14/2021		0.0013		0.0021
Dissolved barium	mg/L	G-10D	07/14/2021		0.0075	*	0.0046
Dissolved beryllium	mg/L	G-10D	07/14/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10D	07/14/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-10D	07/14/2021		21.0000	***	6.3200
Dissolved chromium	mg/L	G-10D	07/14/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-10D	07/14/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-10D	07/14/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-10D	07/14/2021		0.4990		19.6852
Dissolved lead	mg/L	G-10D	07/14/2021	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-10D	07/14/2021		1.7500		2.3300
Dissolved manganese	mg/L	G-10D	07/14/2021		0.3540		13.3342
Dissolved nickel	mg/L	G-10D	07/14/2021		0.0400	*	0.0260
Dissolved potassium	mg/L	G-10D	07/14/2021		1.7000		1.8490
Dissolved selenium	mg/L	G-10D	07/14/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-10D	07/14/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-10D	07/14/2021		369.0000	***	130.7721
Dissolved thallium	mg/L	G-10D	07/14/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-10D	07/14/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-10D	07/14/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-10D	07/14/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-10D	07/14/2021	ND	0.0020		0.0540
pH	std units	G-10D	07/14/2021	ND	0.1000		6.02 - 9.88
Sulfate	mg/L	G-10D	07/14/2021		268.0000	***	66.0500
Total dissolved solids	mg/L	G-10D	07/14/2021		970.0000	***	460.0000
Total organic carbon	mg/L	G-10D	07/14/2021		6.7000		26.0000
Alkalinity (as cacO3)	mg/L	G-13D	04/21/2021		180.0000		280.0000
Ammonia nitrogen	mg-N/L	G-13D	04/21/2021		0.0890		0.2927
Bicarbonate	mg/L	G-13D	04/21/2021		75.0000		280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Chemical oxygen demand	mg/L	G-13D	04/21/2021	ND	10.0000		28.0000
Chloride	mg/L	G-13D	04/21/2021		12.2000	***	8.7455
Conductivity	umhos/cm	G-13D	04/21/2021		460.0000		530.0000
Dissolved antimony	mg/L	G-13D	04/21/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-13D	04/21/2021		0.0002		0.0021
Dissolved barium	mg/L	G-13D	04/21/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-13D	04/21/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-13D	04/21/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-13D	04/21/2021		0.6300		6.3200
Dissolved chromium	mg/L	G-13D	04/21/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-13D	04/21/2021		0.0100	*	0.0050
Dissolved copper	mg/L	G-13D	04/21/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-13D	04/21/2021		0.0370		19.6852
Dissolved lead	mg/L	G-13D	04/21/2021	ND	0.0001		0.0023
Dissolved magnesium	mg/L	G-13D	04/21/2021		0.1700		2.3300
Dissolved manganese	mg/L	G-13D	04/21/2021	ND	0.0050		13.3342
Dissolved nickel	mg/L	G-13D	04/21/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-13D	04/21/2021		0.3200		1.8490
Dissolved selenium	mg/L	G-13D	04/21/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-13D	04/21/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-13D	04/21/2021		106.0000		130.7721
Dissolved thallium	mg/L	G-13D	04/21/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-13D	04/21/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-13D	04/21/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-13D	04/21/2021	ND	0.0100		0.2100
Nitrite nitrogen	mg-N/L	G-13D	04/21/2021	ND	0.0020		0.0540
pH	std units	G-13D	04/21/2021		9.3100	**	6.02 - 9.88
Sulfate	mg/L	G-13D	04/21/2021		34.2000		66.0500
Total dissolved solids	mg/L	G-13D	04/21/2021		300.0000		460.0000
Total organic carbon	mg/L	G-13D	04/21/2021		2.1000		26.0000

* - Current value failed - awaiting verification.
** - Current value passed - previous exceedance not verified.
*** - Current value failed - exceedance verified.
**** - Current value passed - awaiting one more verification.
***** - Insufficient background data to compute prediction limit.
ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	60	60					280.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	57	57	-2.2001	0.4021	0.0100	2.4157	0.2927	lognor		
Bicarbonate	mg/L	60	60					280.0000	nonpar		0.99
Chemical oxygen demand	mg/L	10	59					28.0000	nonpar		0.99
Chloride	mg/L	59	60	1.2645	0.3749	0.0100	2.4110	8.7455	lognor		
Conductivity	umhos/cm	60	60					530.0000	nonpar		0.99
Dissolved antimony	mg/L	9	58					0.0008	nonpar		0.99
Dissolved arsenic	mg/L	48	59					0.0021	nonpar		0.99
Dissolved barium	mg/L	16	59					0.0046	nonpar		0.99
Dissolved beryllium	mg/L	0	54					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	8	56					0.0001	nonpar		0.99
Dissolved calcium	mg/L	57	57					6.3200	nonpar		0.99
Dissolved chromium	mg/L	7	60					0.0136	nonpar		0.99
Dissolved cobalt	mg/L	2	60					0.0050	nonpar	***	0.99
Dissolved copper	mg/L	11	60					0.0550	nonpar		0.99
Dissolved iron	mg/L	31	59	-1.6843	1.9333	0.0100	2.4125	19.6852	lognor		
Dissolved lead	mg/L	22	60					0.0023	nonpar		0.99
Dissolved magnesium	mg/L	41	58					2.3300	nonpar		0.99
Dissolved manganese	mg/L	40	58	-3.8444	2.6655	0.0100	2.4141	13.3342	lognor		
Dissolved nickel	mg/L	3	60					0.0260	nonpar		0.99
Dissolved potassium	mg/L	49	60	-1.1046	0.7131	0.0100	2.4110	1.8490	lognor		
Dissolved selenium	mg/L	15	58					0.0014	nonpar		0.99
Dissolved silver	mg/L	2	57					0.0001	nonpar		0.99
Dissolved sodium	mg/L	59	59	109.3559	8.8770	0.0100	2.4125	130.7721	normal		
Dissolved thallium	mg/L	4	60					0.0001	nonpar		0.99
Dissolved vanadium	mg/L	1	60					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	15	60					0.0120	nonpar		0.99
Nitrate nitrogen	mg-N/L	15	59					0.2100	nonpar		0.99
Nitrite nitrogen	mg-N/L	27	60					0.0540	nonpar		0.99
pH	std units	60	60					6.02- 9.88	nonpar		0.99
Sulfate	mg/L	59	59					66.0500	nonpar		0.99
Total dissolved solids	mg/L	60	60					460.0000	nonpar		0.99
Total organic carbon	mg/L	60	60					26.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.

For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Alkalinity (as caco3)	mg/L	G-01D	10/19/2021		230.0000	**	280.0000
Ammonia nitrogen	mg-N/L	G-01D	10/19/2021		0.1600		0.2793
Bicarbonate	mg/L	G-01D	10/19/2021		230.0000		280.0000
Chemical oxygen demand	mg/L	G-01D	10/19/2021	ND	10.0000		28.0000
Chloride	mg/L	G-01D	10/19/2021		7.6100	***	6.8600
Conductivity	umhos/cm	G-01D	10/19/2021		590.0000	***	530.0000
Dissolved antimony	mg/L	G-01D	10/19/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-01D	10/19/2021		0.0007		0.0021
Dissolved barium	mg/L	G-01D	10/19/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-01D	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-01D	10/19/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-01D	10/19/2021		1.0400		6.3200
Dissolved chromium	mg/L	G-01D	10/19/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-01D	10/19/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-01D	10/19/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-01D	10/19/2021	ND	0.0200		0.8710
Dissolved lead	mg/L	G-01D	10/19/2021	ND	0.0001		0.0007
Dissolved magnesium	mg/L	G-01D	10/19/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-01D	10/19/2021	ND	0.0050		0.0120
Dissolved nickel	mg/L	G-01D	10/19/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-01D	10/19/2021		0.4600		2.0190
Dissolved selenium	mg/L	G-01D	10/19/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-01D	10/19/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-01D	10/19/2021		140.0000	***	131.9680
Dissolved thallium	mg/L	G-01D	10/19/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-01D	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-01D	10/19/2021	ND	0.0100	**	0.0120
Nitrate nitrogen	mg-N/L	G-01D	10/19/2021	ND	0.0100		0.2800
Nitrite nitrogen	mg-N/L	G-01D	10/19/2021		0.0470		0.0540
pH	std units	G-01D	10/19/2021		8.9800		7.27 - 9.88
Sulfate	mg/L	G-01D	10/19/2021		51.4000		66.0500
Total dissolved solids	mg/L	G-01D	10/19/2021		340.0000	**	460.0000
Total organic carbon	mg/L	G-01D	10/19/2021		1.3000		25.0000
Alkalinity (as caco3)	mg/L	G-02D	10/19/2021		96.0000		280.0000
Ammonia nitrogen	mg-N/L	G-02D	10/19/2021	ND	0.0200		0.2793
Bicarbonate	mg/L	G-02D	10/19/2021		96.0000		280.0000
Chemical oxygen demand	mg/L	G-02D	10/19/2021	ND	10.0000		28.0000
Chloride	mg/L	G-02D	10/19/2021		5.4600		6.8600
Conductivity	umhos/cm	G-02D	10/19/2021		340.0000		530.0000
Dissolved antimony	mg/L	G-02D	10/19/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-02D	10/19/2021		0.0036	***	0.0021
Dissolved barium	mg/L	G-02D	10/19/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-02D	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-02D	10/19/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-02D	10/19/2021		0.4200		6.3200
Dissolved chromium	mg/L	G-02D	10/19/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-02D	10/19/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-02D	10/19/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-02D	10/19/2021		0.0290		0.8710
Dissolved lead	mg/L	G-02D	10/19/2021	ND	0.0001		0.0007
Dissolved magnesium	mg/L	G-02D	10/19/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-02D	10/19/2021	ND	0.0050		0.0120
Dissolved nickel	mg/L	G-02D	10/19/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-02D	10/19/2021		0.2400		2.0190
Dissolved selenium	mg/L	G-02D	10/19/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-02D	10/19/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-02D	10/19/2021		80.8000		131.9680
Dissolved thallium	mg/L	G-02D	10/19/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-02D	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-02D	10/19/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-02D	10/19/2021	ND	0.0100	**	0.2800
Nitrite nitrogen	mg-N/L	G-02D	10/19/2021		0.0140		0.0540
pH	std units	G-02D	10/19/2021		7.0500	*	7.27 - 9.88
Sulfate	mg/L	G-02D	10/19/2021		57.3000	**	66.0500
Total dissolved solids	mg/L	G-02D	10/19/2021		200.0000		460.0000
Total organic carbon	mg/L	G-02D	10/19/2021		0.6000		25.0000
Alkalinity (as caco3)	mg/L	G-06B	10/19/2021		270.0000		280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Ammonia nitrogen	mg-N/L	G-06B	10/19/2021		0.0780		0.2793
Bicarbonate	mg/L	G-06B	10/19/2021		270.0000		280.0000
Chemical oxygen demand	mg/L	G-06B	10/19/2021	ND	10.0000		28.0000
Chloride	mg/L	G-06B	10/19/2021		7.1200	***	6.8600
Conductivity	umhos/cm	G-06B	10/19/2021		660.0000	***	530.0000
Dissolved antimony	mg/L	G-06B	10/19/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-06B	10/19/2021		0.0034	***	0.0021
Dissolved barium	mg/L	G-06B	10/19/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-06B	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-06B	10/19/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-06B	10/19/2021		1.0500		6.3200
Dissolved chromium	mg/L	G-06B	10/19/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-06B	10/19/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-06B	10/19/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-06B	10/19/2021		0.0350		0.8710
Dissolved lead	mg/L	G-06B	10/19/2021	ND	0.0001		0.0007
Dissolved magnesium	mg/L	G-06B	10/19/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-06B	10/19/2021	ND	0.0050		0.0120
Dissolved nickel	mg/L	G-06B	10/19/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-06B	10/19/2021		0.4200		2.0190
Dissolved selenium	mg/L	G-06B	10/19/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-06B	10/19/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-06B	10/19/2021		181.0000	***	131.9680
Dissolved thallium	mg/L	G-06B	10/19/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-06B	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-06B	10/19/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-06B	10/19/2021		0.1900		0.2800
Nitrite nitrogen	mg-N/L	G-06B	10/19/2021		0.0110		0.0540
pH	std units	G-06B	10/19/2021		7.6700		7.27 - 9.88
Sulfate	mg/L	G-06B	10/19/2021		63.5000	**	66.0500
Total dissolved solids	mg/L	G-06B	10/19/2021		410.0000		460.0000
Total organic carbon	mg/L	G-06B	10/19/2021		2.2000		25.0000
Alkalinity (as cacO3)	mg/L	G-08D2	10/19/2021		180.0000		280.0000
Ammonia nitrogen	mg-N/L	G-08D2	10/19/2021		0.1830		0.2793
Bicarbonate	mg/L	G-08D2	10/19/2021		180.0000		280.0000
Chemical oxygen demand	mg/L	G-08D2	10/19/2021	ND	10.0000		28.0000
Chloride	mg/L	G-08D2	10/19/2021		2.5350		6.8600
Conductivity	umhos/cm	G-08D2	10/19/2021		480.0000		530.0000
Dissolved antimony	mg/L	G-08D2	10/19/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-08D2	10/19/2021		0.0005		0.0021
Dissolved barium	mg/L	G-08D2	10/19/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-08D2	10/19/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-08D2	10/19/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-08D2	10/19/2021		0.5550		6.3200
Dissolved chromium	mg/L	G-08D2	10/19/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-08D2	10/19/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-08D2	10/19/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-08D2	10/19/2021	ND	0.0200		0.8710
Dissolved lead	mg/L	G-08D2	10/19/2021	ND	0.0001		0.0007
Dissolved magnesium	mg/L	G-08D2	10/19/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-08D2	10/19/2021	ND	0.0050		0.0120
Dissolved nickel	mg/L	G-08D2	10/19/2021	ND	0.0100		0.0260
Dissolved potassium	mg/L	G-08D2	10/19/2021		0.2550		2.0190
Dissolved selenium	mg/L	G-08D2	10/19/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-08D2	10/19/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-08D2	10/19/2021		114.5000		131.9680
Dissolved thallium	mg/L	G-08D2	10/19/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-08D2	10/19/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-08D2	10/19/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-08D2	10/19/2021	ND	0.0100		0.2800
Nitrite nitrogen	mg-N/L	G-08D2	10/19/2021		0.0635	*	0.0540
pH	std units	G-08D2	10/19/2021		9.2700	**	7.27 - 9.88
Sulfate	mg/L	G-08D2	10/19/2021		43.8000		66.0500
Total dissolved solids	mg/L	G-08D2	10/19/2021		295.0000		460.0000
Total organic carbon	mg/L	G-08D2	10/19/2021		0.5900		25.0000
Alkalinity (as cacO3)	mg/L	G-09D	10/20/2021		190.0000		280.0000
Ammonia nitrogen	mg-N/L	G-09D	10/20/2021		0.1400		0.2793

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Bicarbonate	mg/L	G-09D	10/20/2021		190.0000		280.0000
Chemical oxygen demand	mg/L	G-09D	10/20/2021	ND	10.0000		28.0000
Chloride	mg/L	G-09D	10/20/2021		8.2700	***	6.8600
Conductivity	umhos/cm	G-09D	10/20/2021		660.0000	***	530.0000
Dissolved antimony	mg/L	G-09D	10/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-09D	10/20/2021		0.0027	***	0.0021
Dissolved barium	mg/L	G-09D	10/20/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-09D	10/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-09D	10/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-09D	10/20/2021		1.6000		6.3200
Dissolved chromium	mg/L	G-09D	10/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-09D	10/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-09D	10/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-09D	10/20/2021	ND	0.0200		0.8710
Dissolved lead	mg/L	G-09D	10/20/2021		0.0001		0.0007
Dissolved magnesium	mg/L	G-09D	10/20/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-09D	10/20/2021	ND	0.0050		0.0120
Dissolved nickel	mg/L	G-09D	10/20/2021		0.0130		0.0260
Dissolved potassium	mg/L	G-09D	10/20/2021		0.5300		2.0190
Dissolved selenium	mg/L	G-09D	10/20/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-09D	10/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-09D	10/20/2021		182.0000	***	131.9680
Dissolved thallium	mg/L	G-09D	10/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-09D	10/20/2021		0.0100		0.0100
Dissolved zinc	mg/L	G-09D	10/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-09D	10/20/2021		0.1700	**	0.2800
Nitrite nitrogen	mg-N/L	G-09D	10/20/2021		0.0310		0.0540
pH	std units	G-09D	10/20/2021		8.9700		7.27 - 9.88
Sulfate	mg/L	G-09D	10/20/2021		127.0000	***	66.0500
Total dissolved solids	mg/L	G-09D	10/20/2021		400.0000		460.0000
Total organic carbon	mg/L	G-09D	10/20/2021		2.3000		25.0000
Alkalinity (as cacO3)	mg/L	G-10D	10/20/2021		510.0000	***	280.0000
Ammonia nitrogen	mg-N/L	G-10D	10/20/2021		0.3940	*	0.2793
Bicarbonate	mg/L	G-10D	10/20/2021		510.0000	***	280.0000
Chemical oxygen demand	mg/L	G-10D	10/20/2021	ND	10.0000		28.0000
Chloride	mg/L	G-10D	10/20/2021		20.7000	***	6.8600
Conductivity	umhos/cm	G-10D	10/20/2021		1400.0000	***	530.0000
Dissolved antimony	mg/L	G-10D	10/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-10D	10/20/2021		0.0007		0.0021
Dissolved barium	mg/L	G-10D	10/20/2021	ND	0.0050	**	0.0046
Dissolved beryllium	mg/L	G-10D	10/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-10D	10/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-10D	10/20/2021		23.1000	***	6.3200
Dissolved chromium	mg/L	G-10D	10/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-10D	10/20/2021	ND	0.0100		0.0050
Dissolved copper	mg/L	G-10D	10/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-10D	10/20/2021		0.5360		0.8710
Dissolved lead	mg/L	G-10D	10/20/2021	ND	0.0001		0.0007
Dissolved magnesium	mg/L	G-10D	10/20/2021		1.8400		2.3300
Dissolved manganese	mg/L	G-10D	10/20/2021		0.3540	***	0.0120
Dissolved nickel	mg/L	G-10D	10/20/2021		0.0240	**	0.0260
Dissolved potassium	mg/L	G-10D	10/20/2021		1.7500		2.0190
Dissolved selenium	mg/L	G-10D	10/20/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-10D	10/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-10D	10/20/2021		377.0000	***	131.9680
Dissolved thallium	mg/L	G-10D	10/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-10D	10/20/2021		0.0120	*	0.0100
Dissolved zinc	mg/L	G-10D	10/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-10D	10/20/2021	ND	0.0100		0.2800
Nitrite nitrogen	mg-N/L	G-10D	10/20/2021	ND	0.0020		0.0540
pH	std units	G-10D	10/20/2021		6.8300	*	7.27 - 9.88
Sulfate	mg/L	G-10D	10/20/2021		252.0000	***	66.0500
Total dissolved solids	mg/L	G-10D	10/20/2021		1000.0000	***	460.0000
Total organic carbon	mg/L	G-10D	10/20/2021		3.6000		25.0000
Alkalinity (as cacO3)	mg/L	G-13D	10/20/2021		170.0000		280.0000
Ammonia nitrogen	mg-N/L	G-13D	10/20/2021		0.1030		0.2793
Bicarbonate	mg/L	G-13D	10/20/2021		170.0000		280.0000

Table 2

Most Current Downgradient Monitoring Data

Constituent	Units	Well	Date		Result		Pred. Limit
Chemical oxygen demand	mg/L	G-13D	10/20/2021	ND	10.0000		28.0000
Chloride	mg/L	G-13D	10/20/2021		11.9000	***	6.8600
Conductivity	umhos/cm	G-13D	10/20/2021		430.0000		530.0000
Dissolved antimony	mg/L	G-13D	10/20/2021	ND	0.0003		0.0008
Dissolved arsenic	mg/L	G-13D	10/20/2021		0.0001		0.0021
Dissolved barium	mg/L	G-13D	10/20/2021	ND	0.0050		0.0046
Dissolved beryllium	mg/L	G-13D	10/20/2021	ND	0.0050		0.0005
Dissolved cadmium	mg/L	G-13D	10/20/2021	ND	0.0001		0.0001
Dissolved calcium	mg/L	G-13D	10/20/2021		0.6200		6.3200
Dissolved chromium	mg/L	G-13D	10/20/2021	ND	0.0100		0.0136
Dissolved cobalt	mg/L	G-13D	10/20/2021	ND	0.0100	**	0.0050
Dissolved copper	mg/L	G-13D	10/20/2021	ND	0.0200		0.0550
Dissolved iron	mg/L	G-13D	10/20/2021		0.0290		0.8710
Dissolved lead	mg/L	G-13D	10/20/2021	ND	0.0001		0.0007
Dissolved magnesium	mg/L	G-13D	10/20/2021	ND	0.0500		2.3300
Dissolved manganese	mg/L	G-13D	10/20/2021	ND	0.0050		0.0120
Dissolved nickel	mg/L	G-13D	10/20/2021		0.0200		0.0260
Dissolved potassium	mg/L	G-13D	10/20/2021		0.2600		2.0190
Dissolved selenium	mg/L	G-13D	10/20/2021	ND	0.0005		0.0014
Dissolved silver	mg/L	G-13D	10/20/2021	ND	0.0001		0.0001
Dissolved sodium	mg/L	G-13D	10/20/2021		104.0000		131.9680
Dissolved thallium	mg/L	G-13D	10/20/2021	ND	0.0001		0.0001
Dissolved vanadium	mg/L	G-13D	10/20/2021	ND	0.0100		0.0100
Dissolved zinc	mg/L	G-13D	10/20/2021	ND	0.0100		0.0120
Nitrate nitrogen	mg-N/L	G-13D	10/20/2021	ND	0.0100		0.2800
Nitrite nitrogen	mg-N/L	G-13D	10/20/2021		0.0030		0.0540
pH	std units	G-13D	10/20/2021		8.8400		7.27 - 9.88
Sulfate	mg/L	G-13D	10/20/2021		35.1000		66.0500
Total dissolved solids	mg/L	G-13D	10/20/2021		330.0000		460.0000
Total organic carbon	mg/L	G-13D	10/20/2021		1.0000		25.0000

* - Current value failed - awaiting verification.
** - Current value passed - previous exceedance not verified.
*** - Current value failed - exceedance verified.
**** - Current value passed - awaiting one more verification.
***** - Insufficient background data to compute prediction limit.
ND = Not Detected, Result = detection limit.

Table 5

Summary Statistics and Prediction Limits

Constituent	Units	Detect	N	Mean	SD	alpha	Factor	Pred Limit	Type		Conf
Alkalinity (as caco3)	mg/L	58	58					280.0000	nonpar		0.99
Ammonia nitrogen	mg-N/L	55	55	-2.2197	0.3904	0.0100	2.4191	0.2793	lognor		
Bicarbonate	mg/L	58	58					280.0000	nonpar		0.99
Chemical oxygen demand	mg/L	10	57					28.0000	nonpar		0.99
Chloride	mg/L	57	58					6.8600	nonpar		0.99
Conductivity	umhos/cm	58	58					530.0000	nonpar		0.99
Dissolved antimony	mg/L	7	56					0.0008	nonpar		0.99
Dissolved arsenic	mg/L	45	57					0.0021	nonpar		0.99
Dissolved barium	mg/L	14	57					0.0046	nonpar		0.99
Dissolved beryllium	mg/L	0	58					0.0005	nonpar	***	0.99
Dissolved cadmium	mg/L	8	56					0.0001	nonpar		0.99
Dissolved calcium	mg/L	55	55					6.3200	nonpar		0.99
Dissolved chromium	mg/L	6	58					0.0136	nonpar		0.99
Dissolved cobalt	mg/L	2	58					0.0050	nonpar	***	0.99
Dissolved copper	mg/L	9	56					0.0550	nonpar		0.99
Dissolved iron	mg/L	28	57					0.8710	nonpar		0.99
Dissolved lead	mg/L	18	58					0.0007	nonpar		0.99
Dissolved magnesium	mg/L	39	56					2.3300	nonpar		0.99
Dissolved manganese	mg/L	37	56	0.0032	0.0037	0.0100	2.4173	0.0120	normal		
Dissolved nickel	mg/L	3	58					0.0260	nonpar		0.99
Dissolved potassium	mg/L	46	58	-1.0623	0.7311	0.0100	2.4141	2.0190	lognor		
Dissolved selenium	mg/L	15	57					0.0014	nonpar		0.99
Dissolved silver	mg/L	1	56					0.0001	nonpar	***	0.99
Dissolved sodium	mg/L	57	57	109.6842	9.2247	0.0100	2.4157	131.9680	normal		
Dissolved thallium	mg/L	4	58					0.0001	nonpar		0.99
Dissolved vanadium	mg/L	1	58					0.0100	nonpar	***	0.99
Dissolved zinc	mg/L	14	58					0.0120	nonpar		0.99
Nitrate nitrogen	mg-N/L	15	57					0.2800	nonpar		0.99
Nitrite nitrogen	mg-N/L	24	58					0.0540	nonpar		0.99
pH	std units	58	58					7.27- 9.88	nonpar		0.99
Sulfate	mg/L	57	57					66.0500	nonpar		0.99
Total dissolved solids	mg/L	58	58					460.0000	nonpar		0.99
Total organic carbon	mg/L	58	58					25.0000	nonpar		0.99

Conf = confidence level for passing initial test or one of two verification resamples at all downgradient wells for a single constituent (nonparametric test only).

* - Insufficient Data.

** - Calculated limit raised to Manual Reporting Limit.

*** - Nonparametric limit based on ND value.

For transformed data, mean and SD in transformed units and prediction limit in original units.

All sample sizes and statistics are based on outlier free data.


For nonparametric limits, median reporting limits are substituted for extreme reporting limit values.

Appendix C


Groundwater Statistical Analyses

Shallow Wells


False Positive and False Negative Rates for Current Intra-Well Prediction Limits Monitoring Program

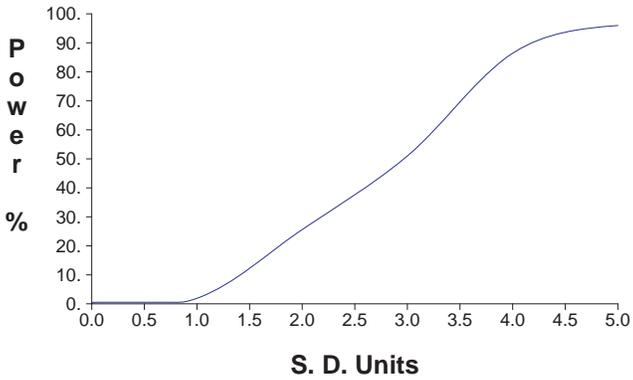


False Positive and False Negative Rates for Current Upgradient vs. Downgradient Monitoring Program

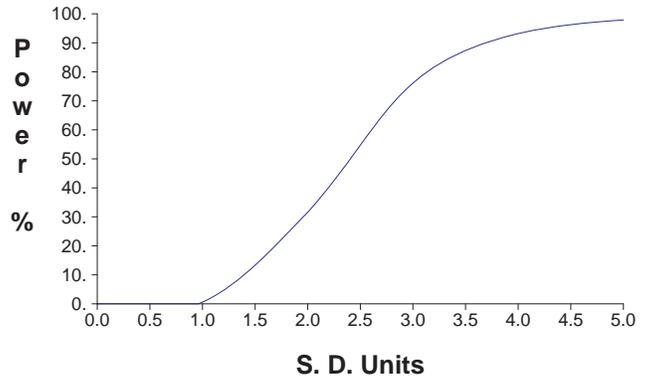

Cathcart Landfill

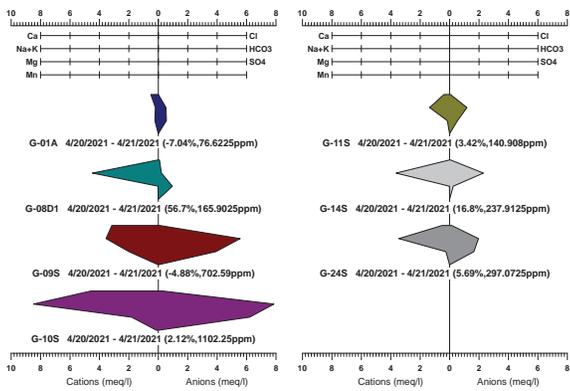


Cathcart Landfill

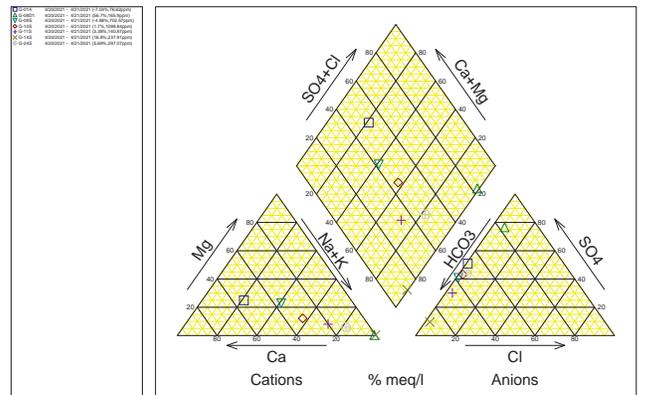

Time Series


- Detect
- ND
- Outlier

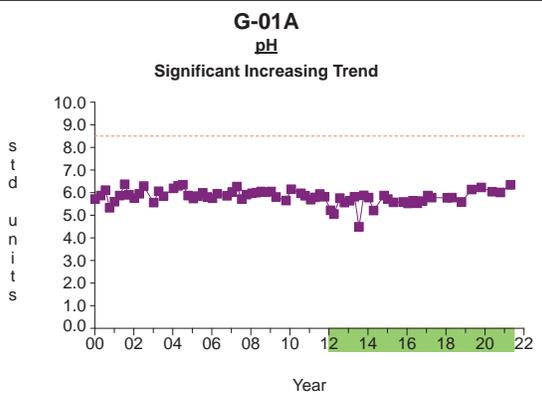

Graph 30

Time Series


- Detect
- ND
- Outlier

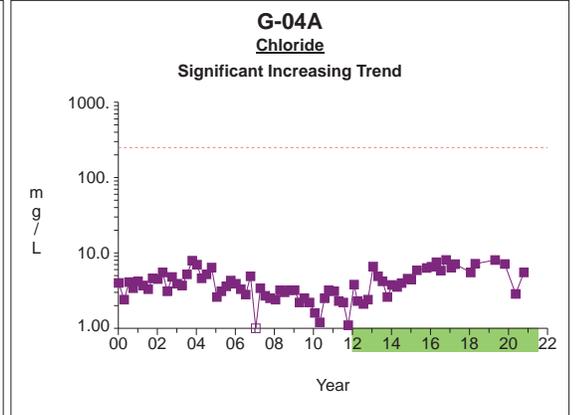

Graph 38

Time Series


- Detect
- ND
- Outlier

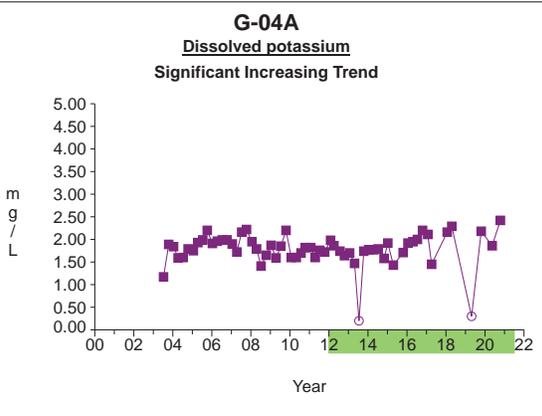

Graph 54

Time Series

- Detect
- ND
- Outlier

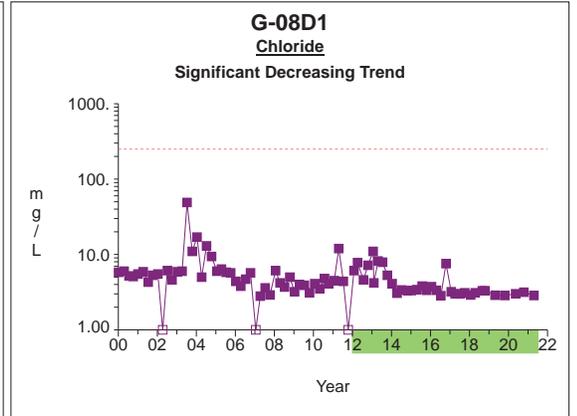


Graph 71

Time Series

- Detect
- ND
- Outlier

- Trend test
- MCL Limit
- Samples

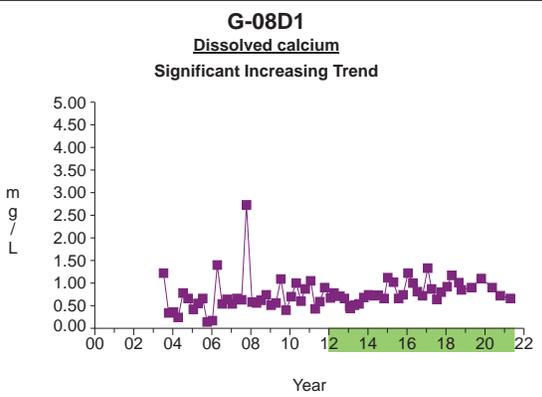


Graph 78

Time Series

- Detect
- ND
- Outlier

- Trend test
- MCL Limit
- Samples

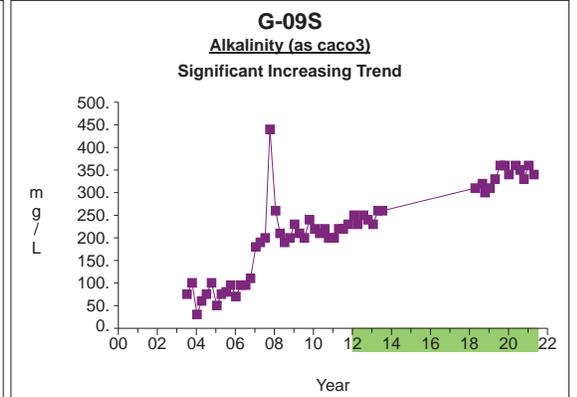


Graph 100

Time Series

- Detect
- ND
- Outlier

- Trend test
- MCL Limit
- Samples

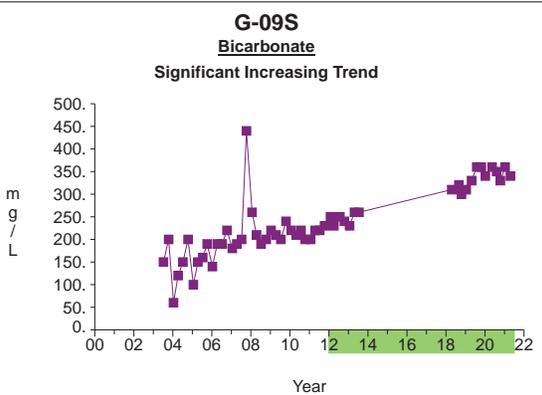


Graph 102





Time Series

- Detect
- ND
- Outlier


- Trend test
- MCL Limit
- Samples

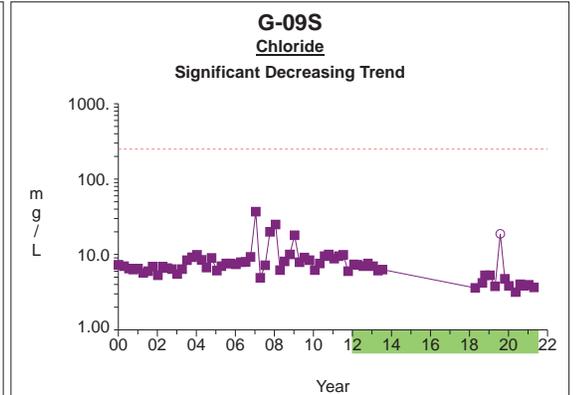

Graph 104

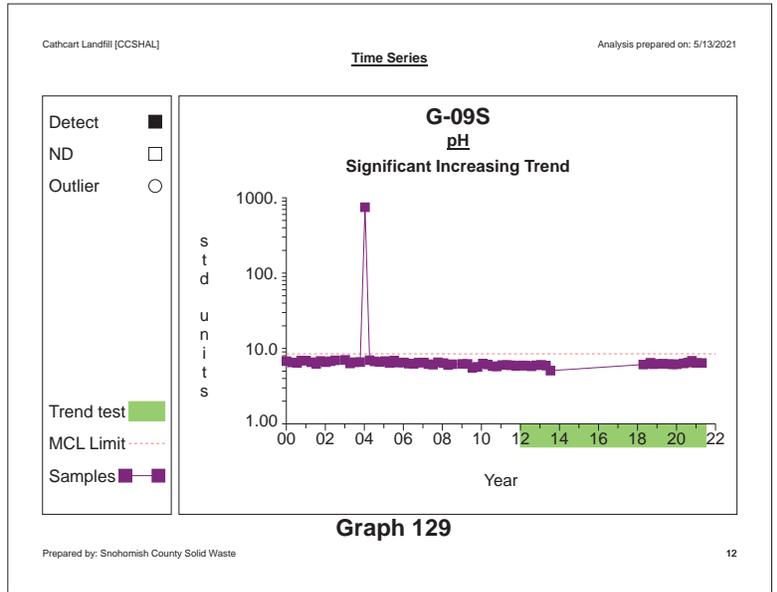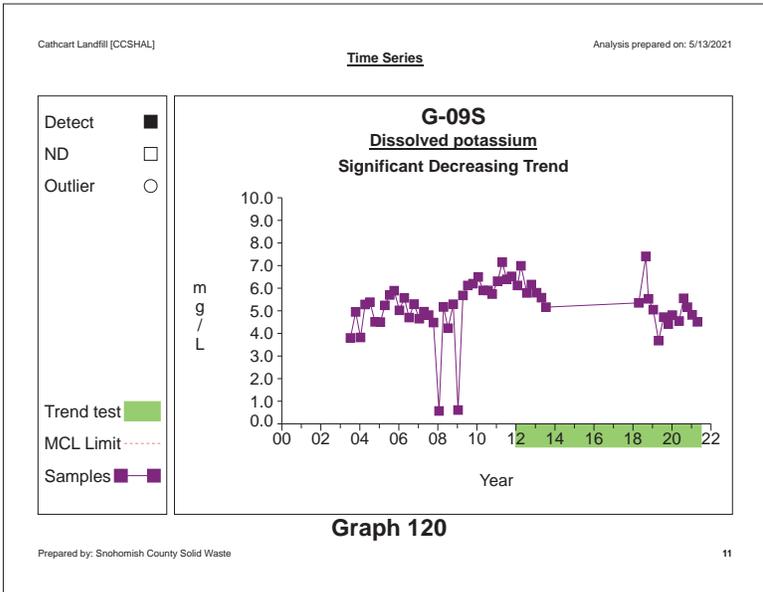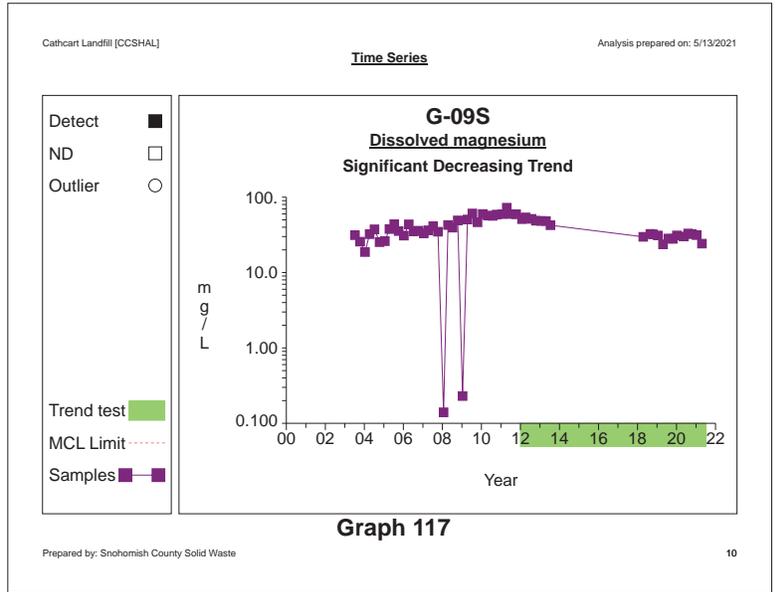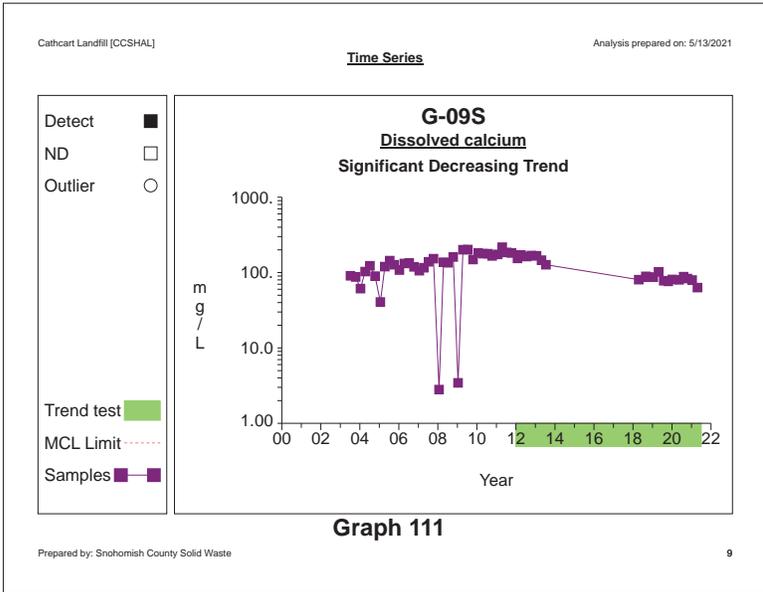


Time Series

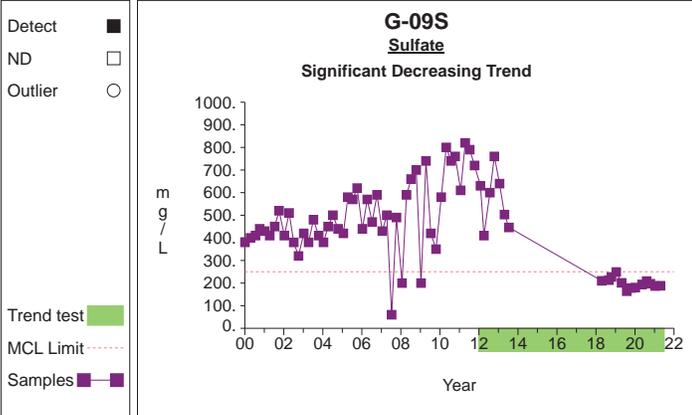


Graph 130

Time Series

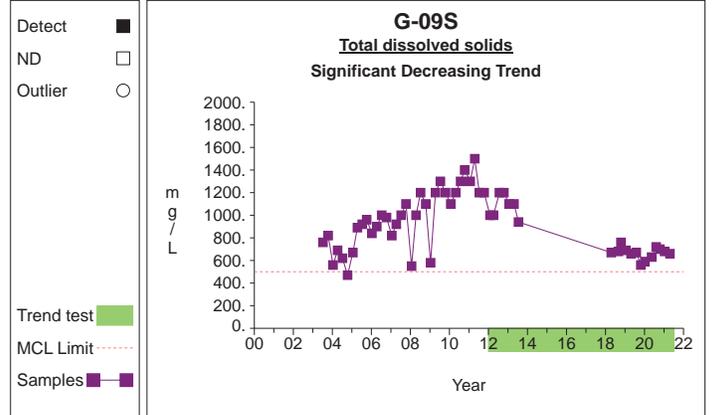


Graph 131

Time Series

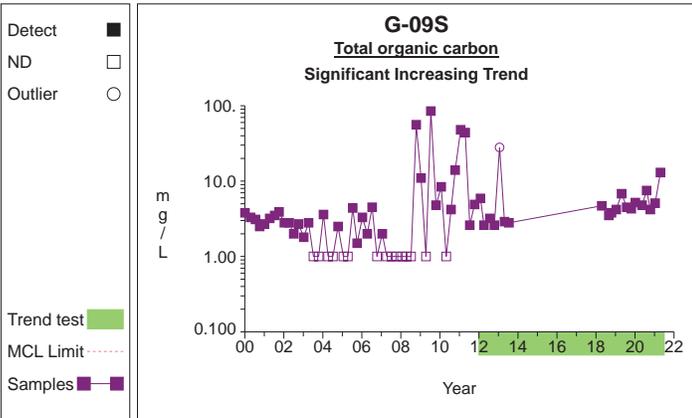


Graph 132

Time Series

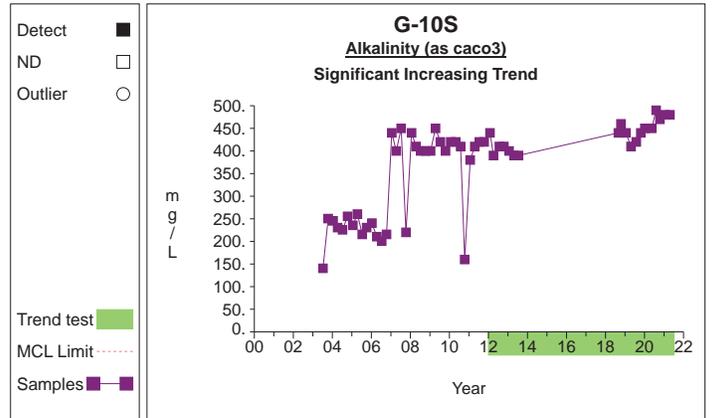


Graph 133

Time Series

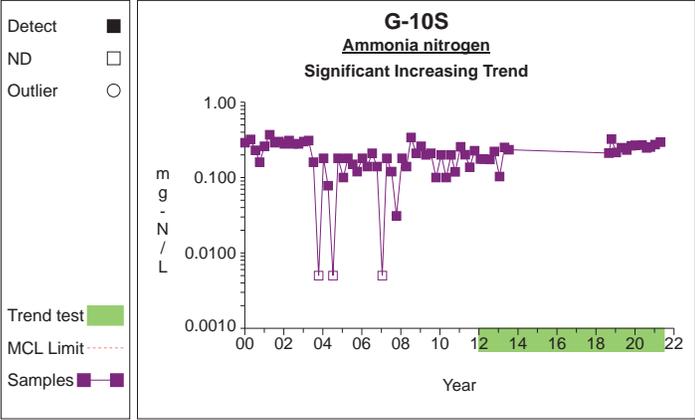


Graph 134

Time Series

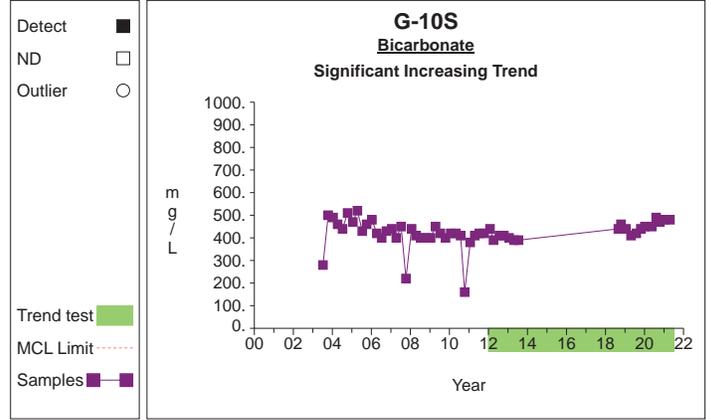


Graph 135

Time Series

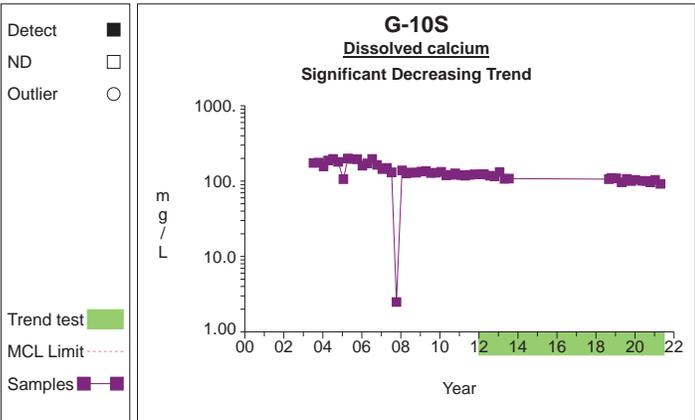


Graph 144

Time Series

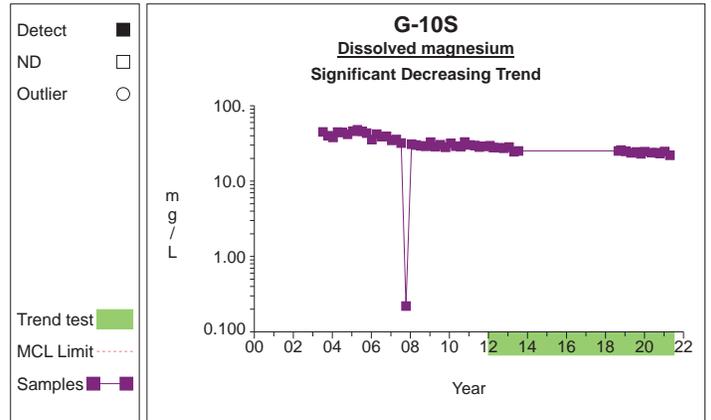


Graph 150

Time Series

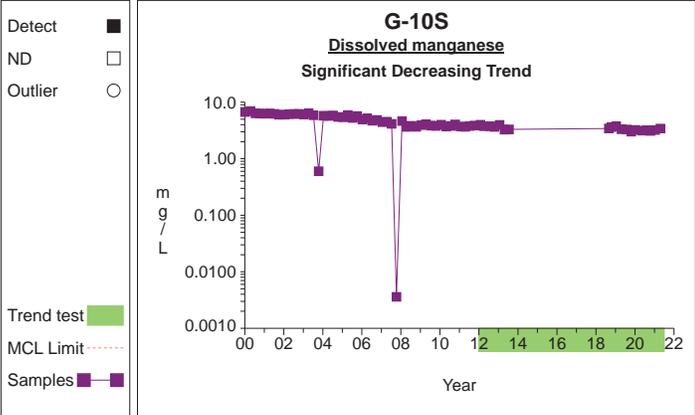


Graph 151

Time Series

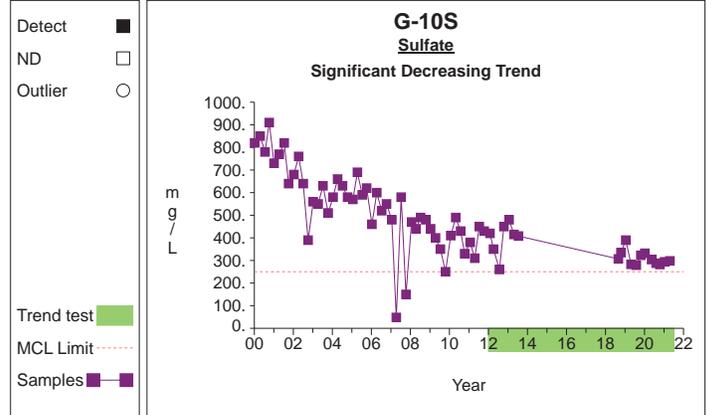


Graph 163

Time Series

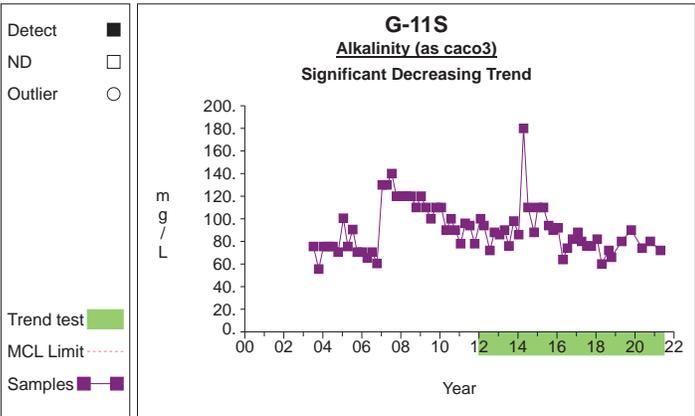

Graph 166


Time Series

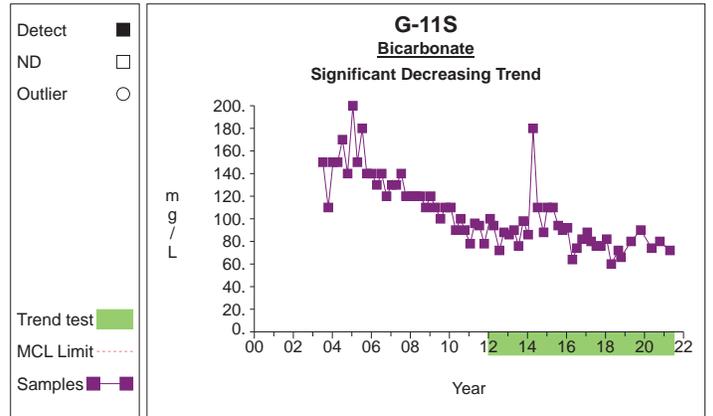

Graph 168

Time Series


- Detect
- ND
- Outlier

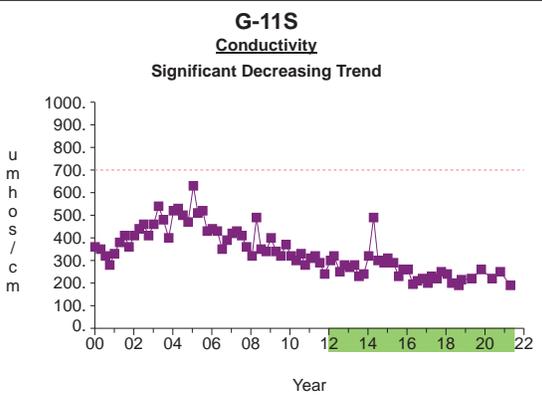

Graph 171

Time Series


- Detect
- ND
- Outlier

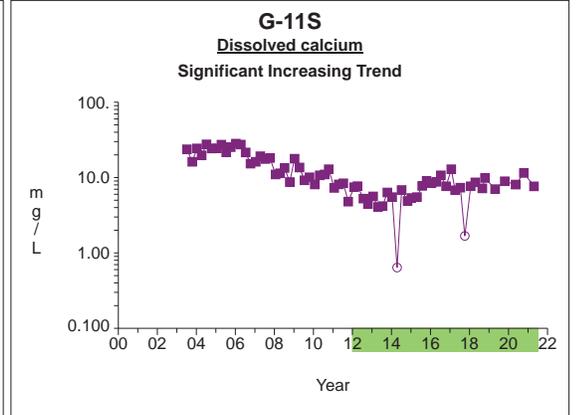

Graph 177

Time Series


- Detect
- ND
- Outlier

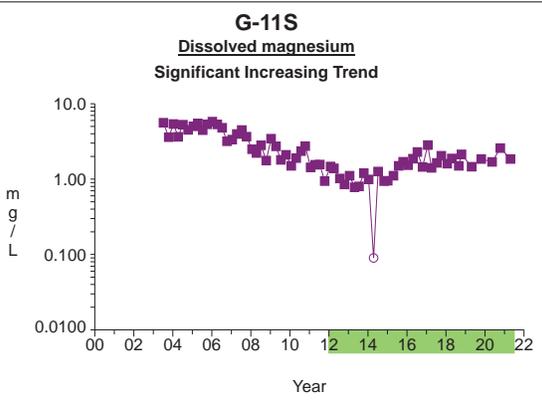

Graph 183


Time Series

- Detect
- ND
- Outlier

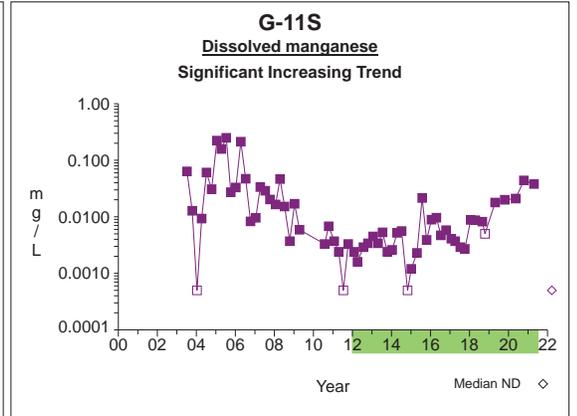


Graph 184

Time Series

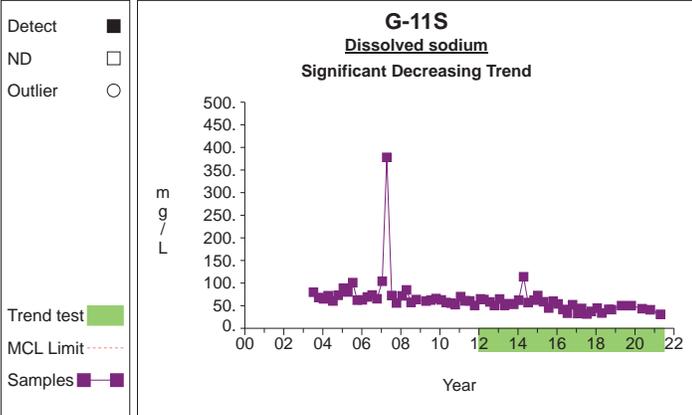


Graph 189

Time Series

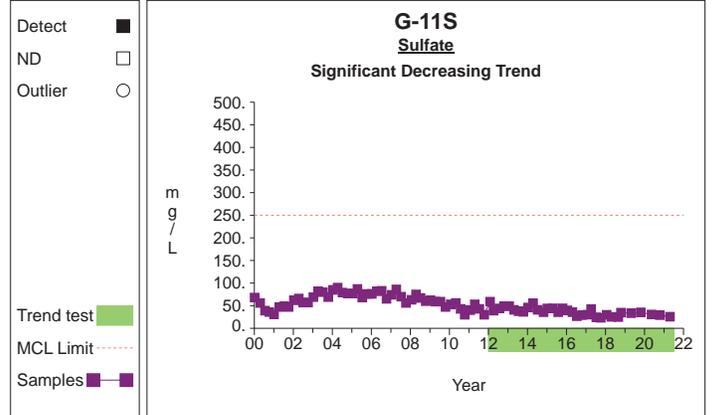


Graph 196

Time Series

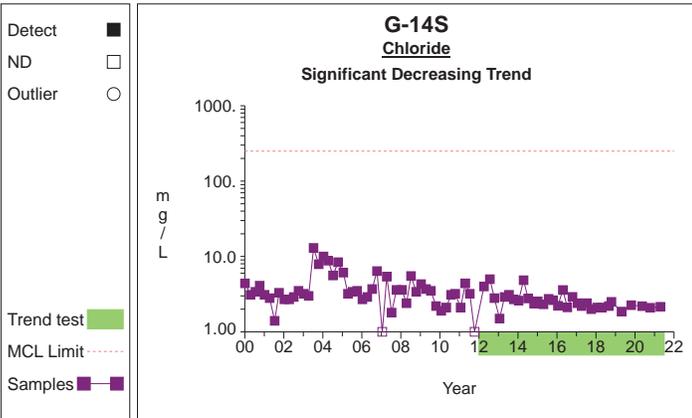


Graph 203

Time Series

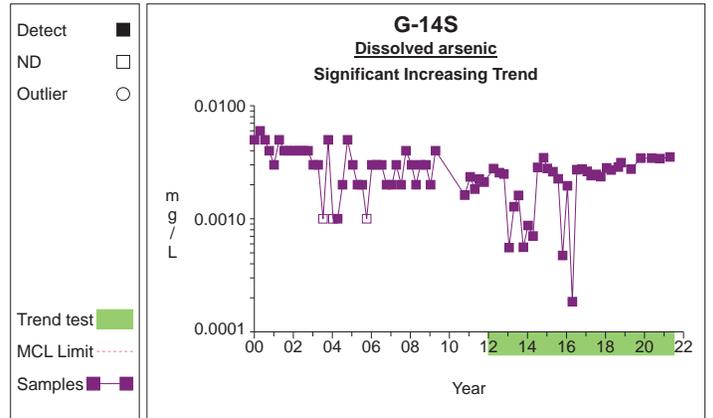


Graph 206

Time Series

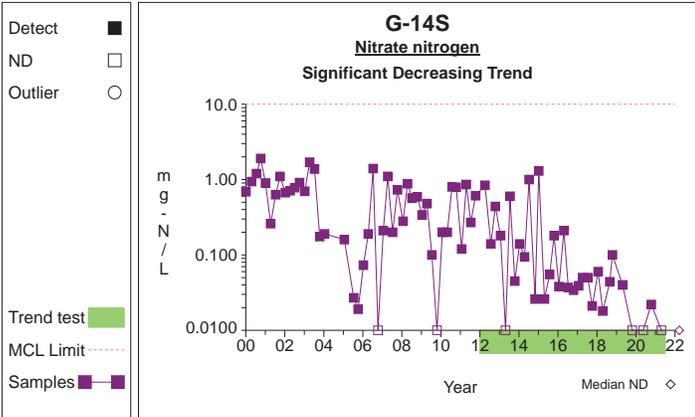


Graph 226

Time Series

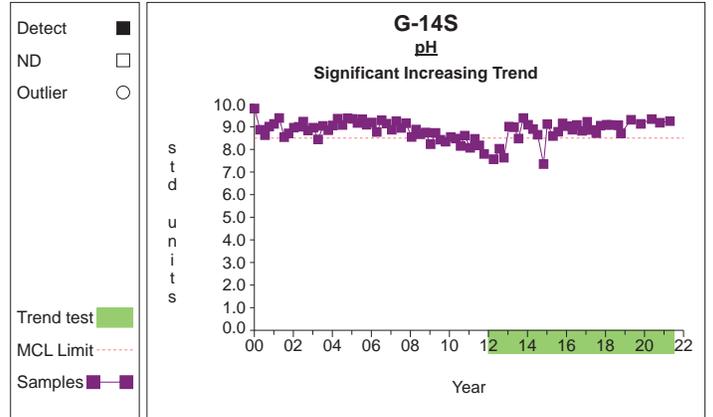


Graph 228

Time Series

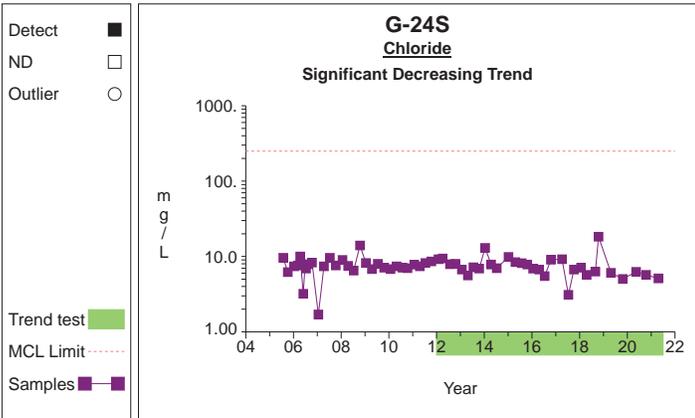


Graph 236

Time Series

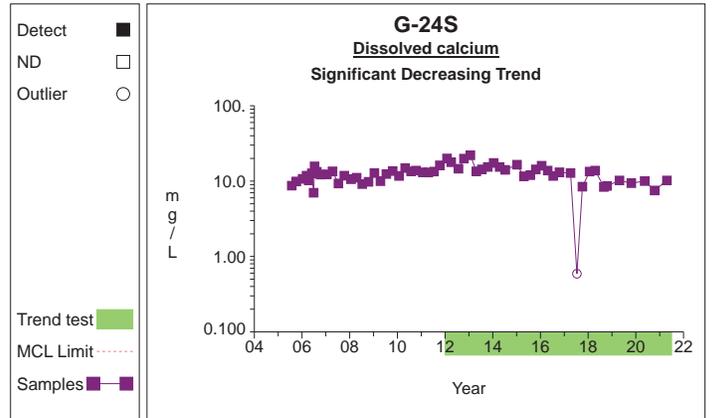


Graph 243

Time Series

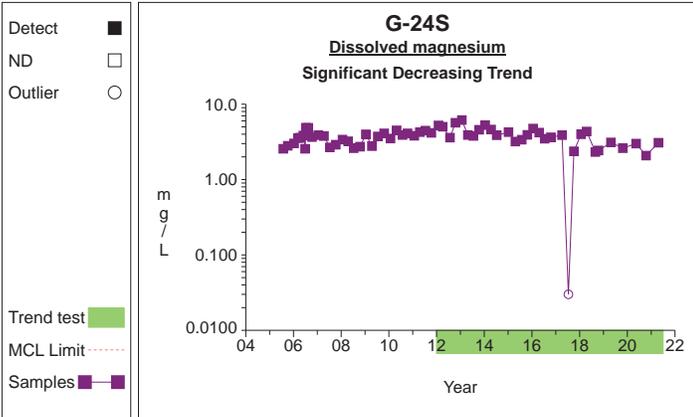

Graph 249


Time Series

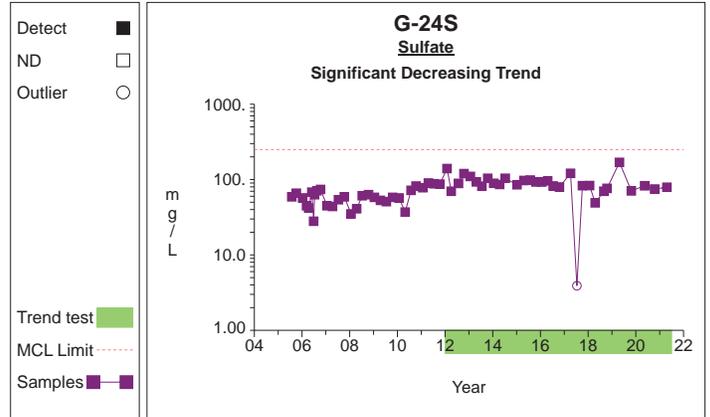

Graph 262


Cathcart Landfill

Time Series Plot for G-01A

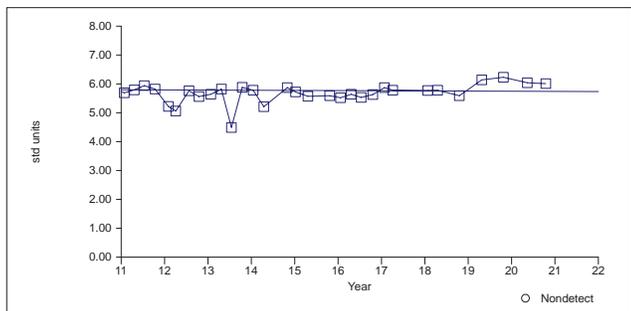


Cathcart Landfill

Time Series Plot for G-08D1

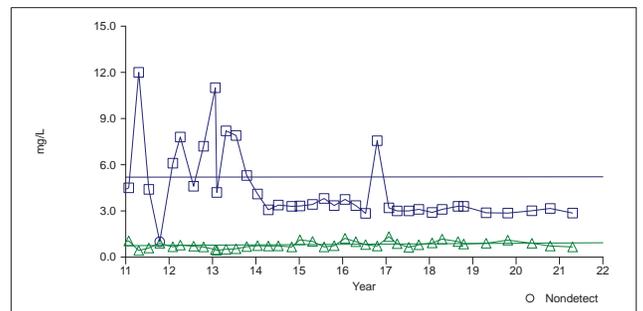


Cathcart Landfill

Time Series Plot for G-09S

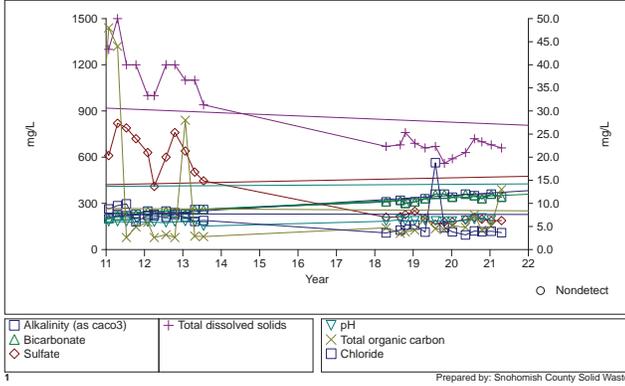


Cathcart Landfill

Time Series Plot for G-09S

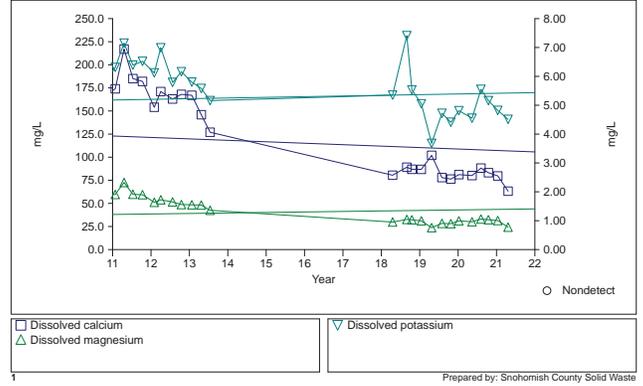


Cathcart Landfill

Time Series Plot for G-10S

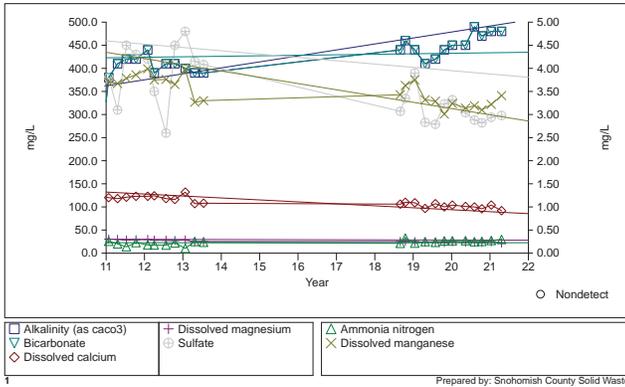


Cathcart Landfill

Time Series Plot for G-11S

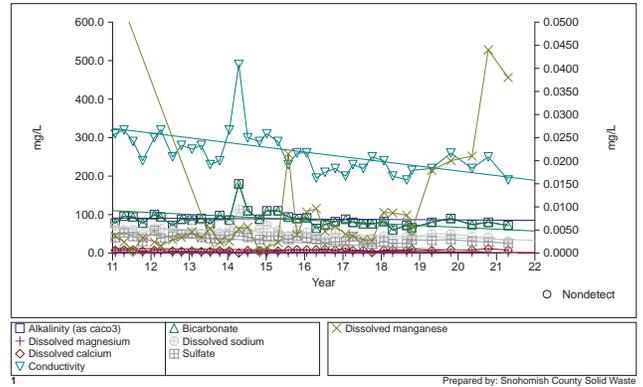

Cathcart Landfill



Time Series Plot for G-14S

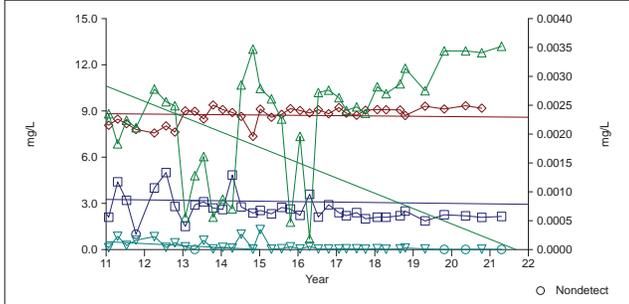

Prepared by: Snohomish County Solid Waste


Cathcart Landfill

Time Series Plot for G-24S

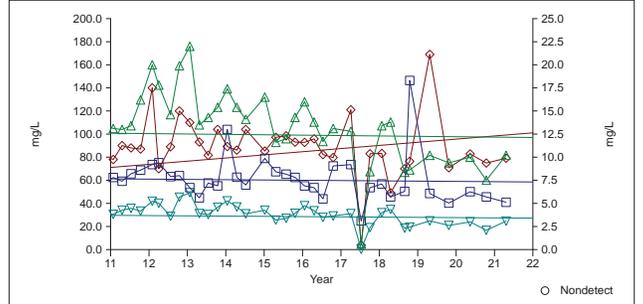


Prepared by: Snohomish County Solid Waste


False Positive and False Negative Rates for Current Intra-Well Prediction Limits Monitoring Program

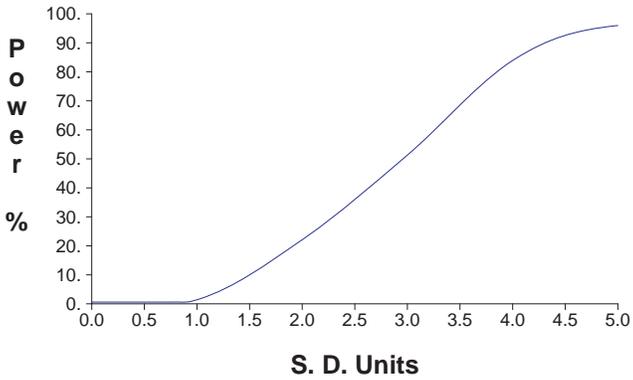


False Positive and False Negative Rates for Current Upgradient vs. Downgradient Monitoring Program

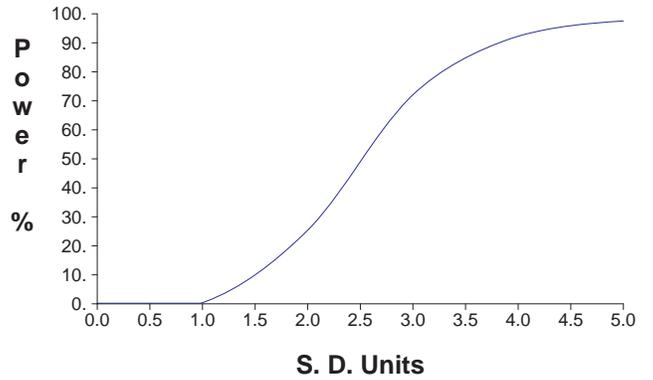


Cathcart Landfill

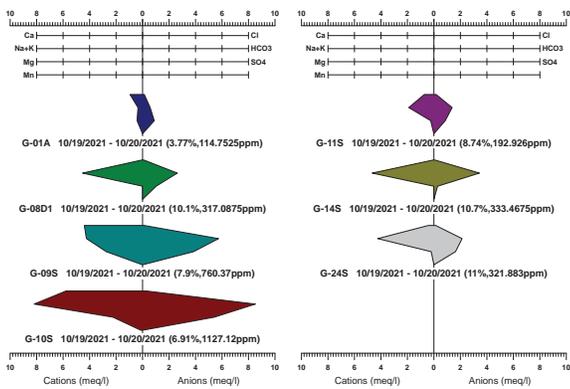

Cathcart Landfill

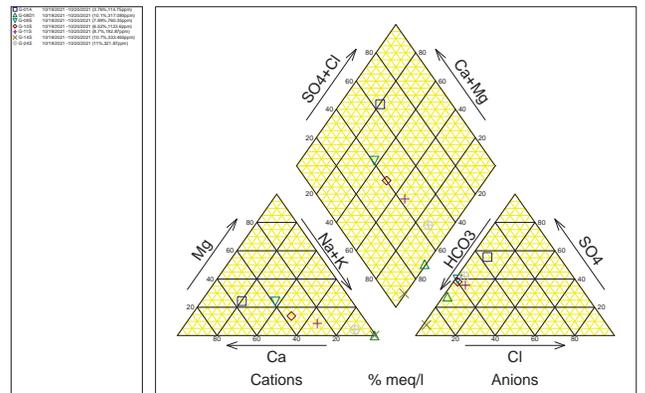


Time Series

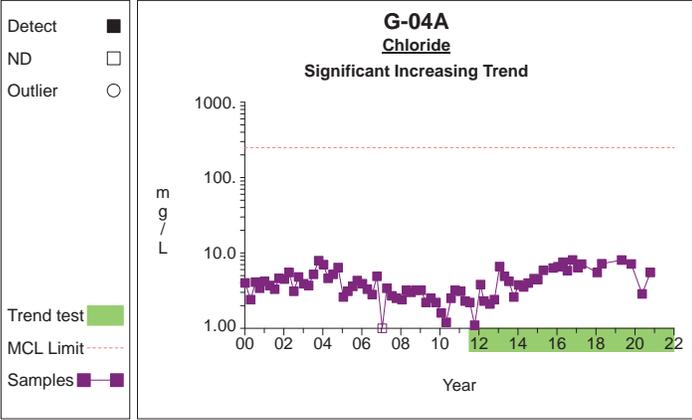


Graph 38

Time Series

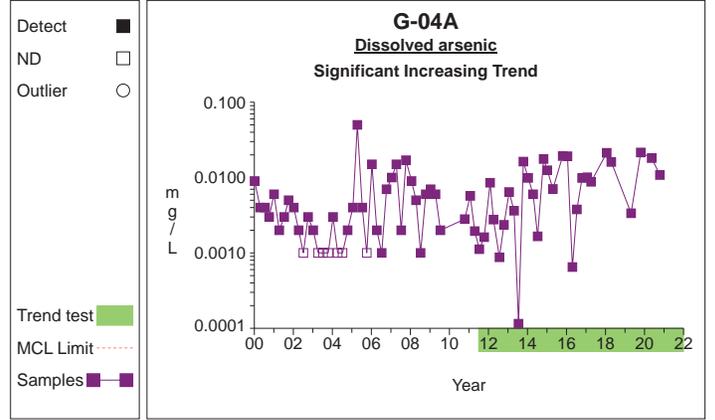


Graph 41

Time Series

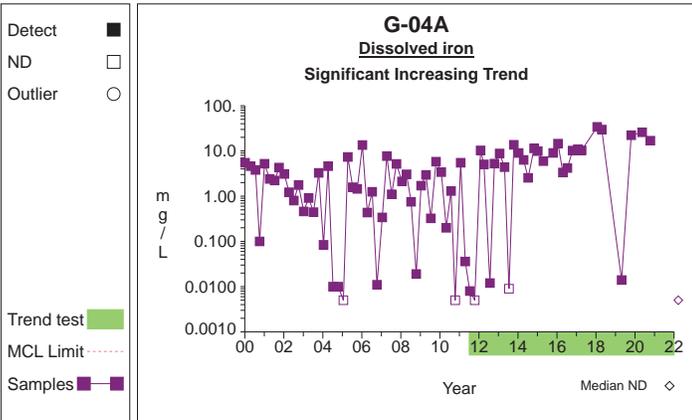


Graph 49

Time Series

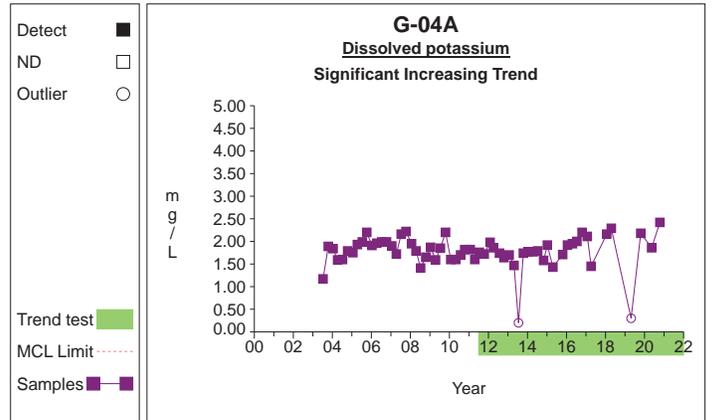


Graph 54

Time Series

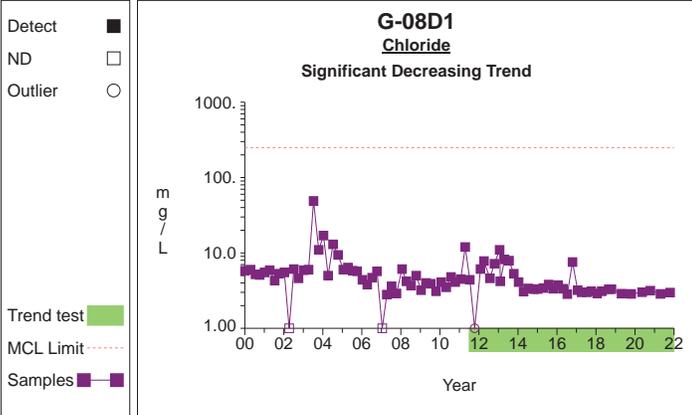


Graph 71

Time Series

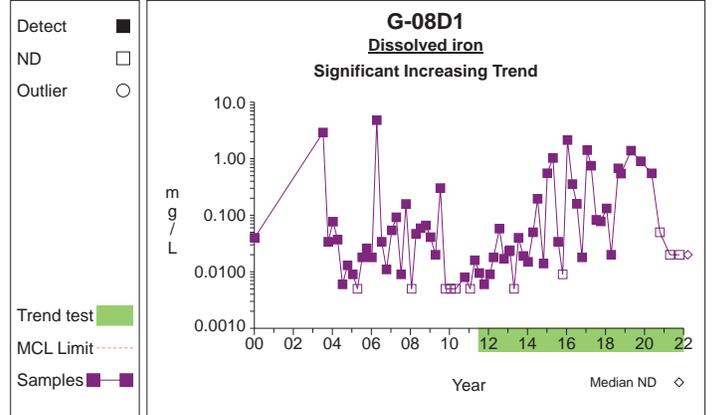


Graph 82

Time Series

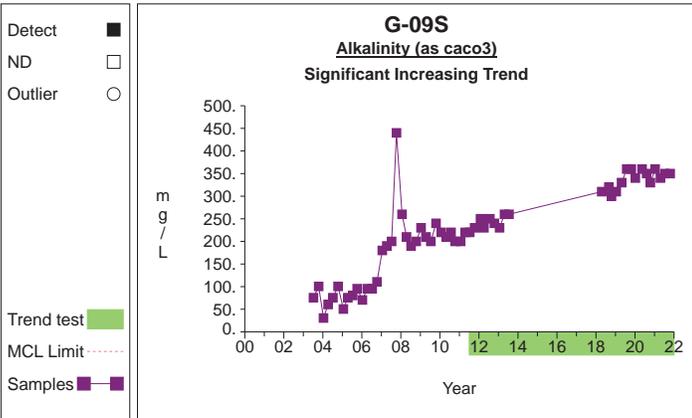

Graph 100


Time Series

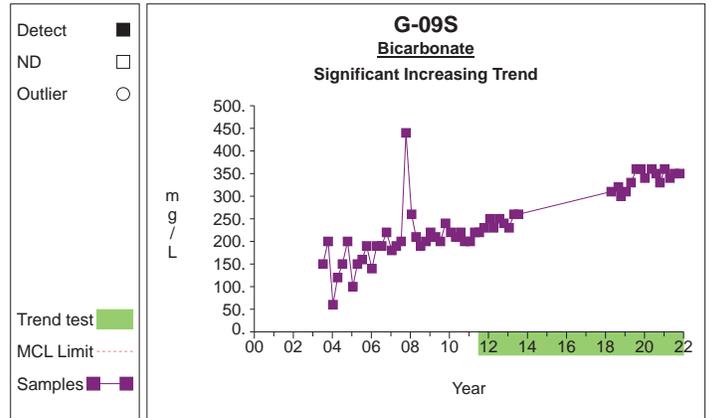

Graph 102

Time Series

- Detect
- ND
- Outlier

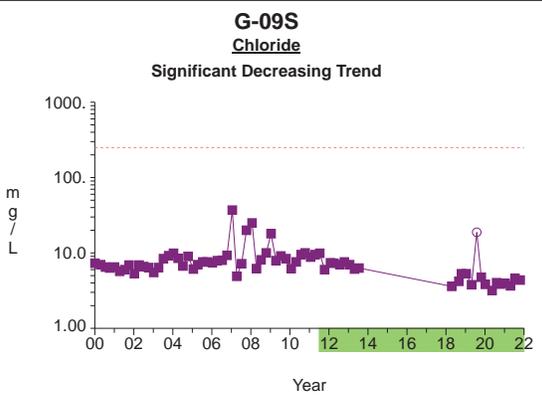


- Trend test
- MCL Limit
- Samples

Graph 104

Time Series

- Detect
- ND
- Outlier

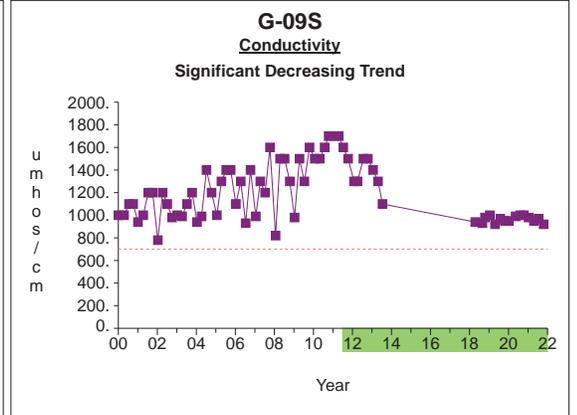


- Trend test
- MCL Limit
- Samples

Graph 105

Time Series

- Detect
- ND
- Outlier

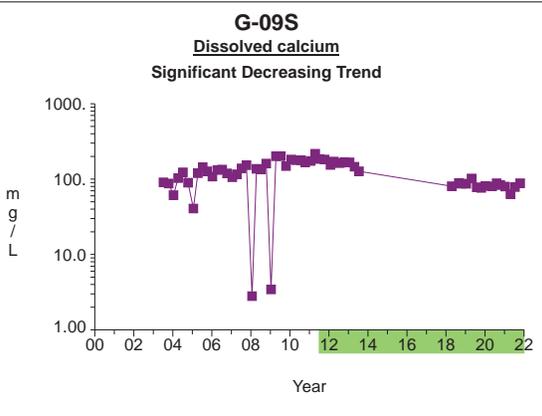


- Trend test
- MCL Limit
- Samples

Graph 111





Time Series

- Detect
- ND
- Outlier

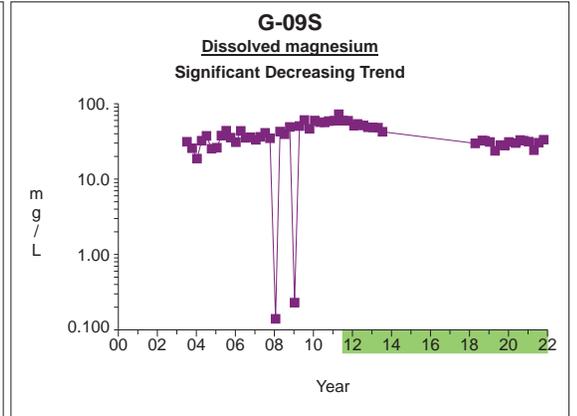


- Trend test
- MCL Limit
- Samples

Graph 117

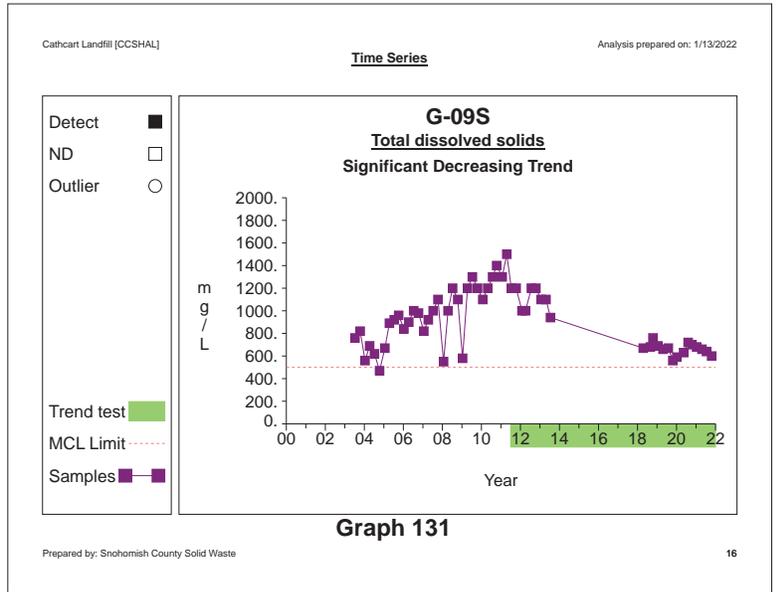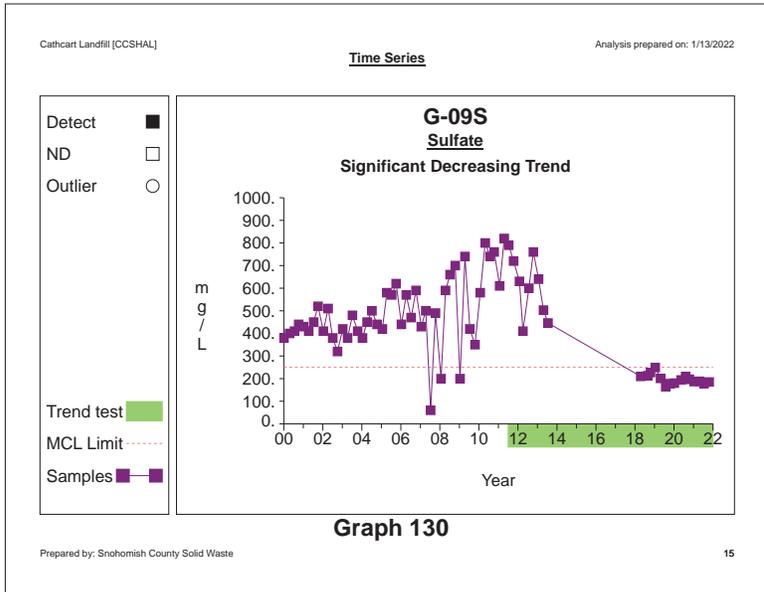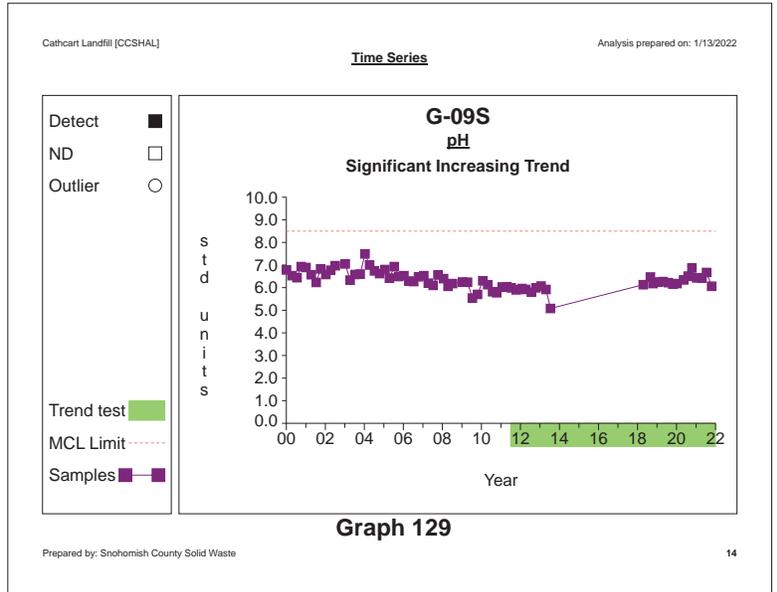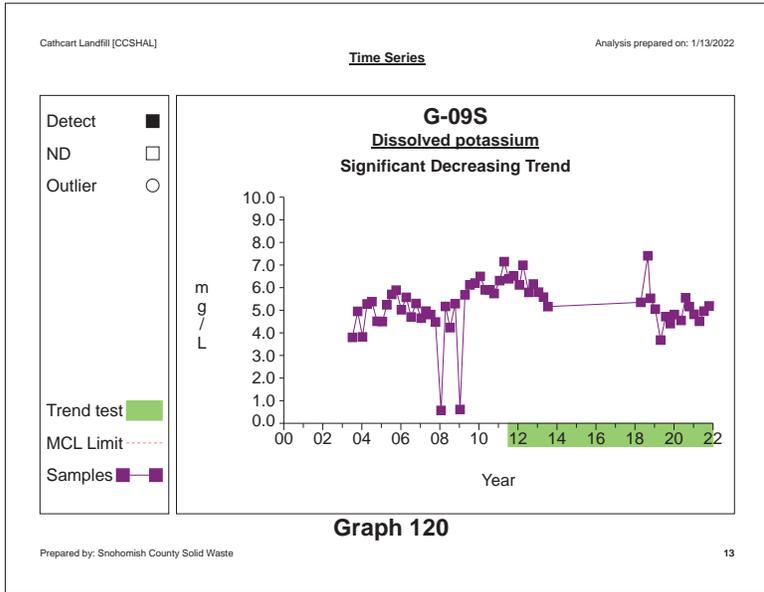


Time Series

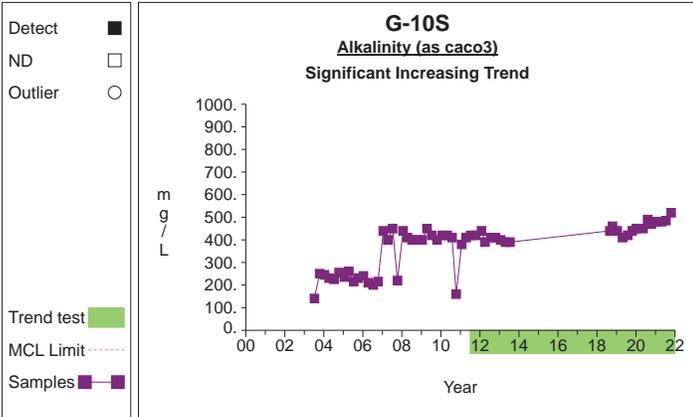


Graph 133

Time Series

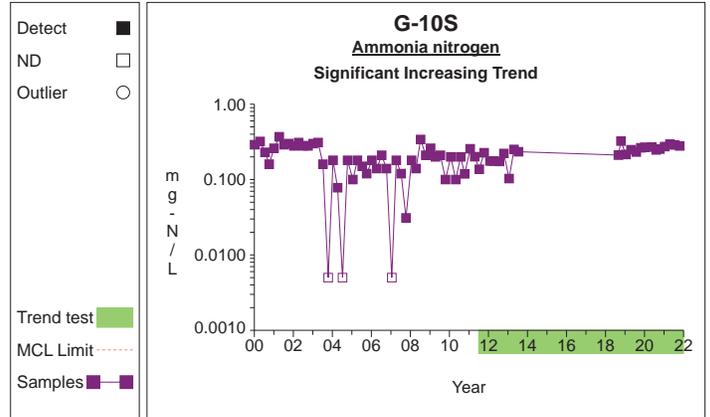


Graph 134

Time Series

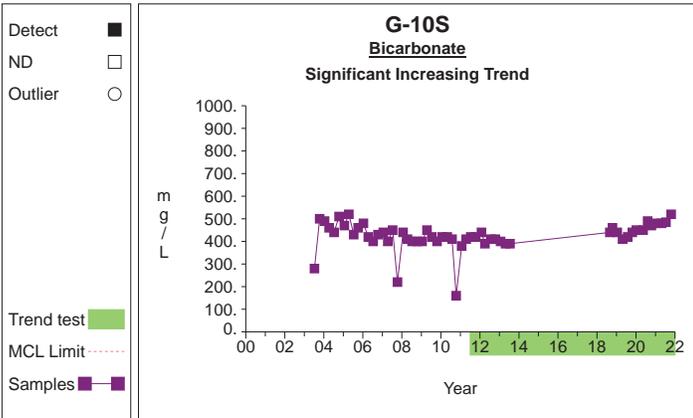


Graph 135

Time Series

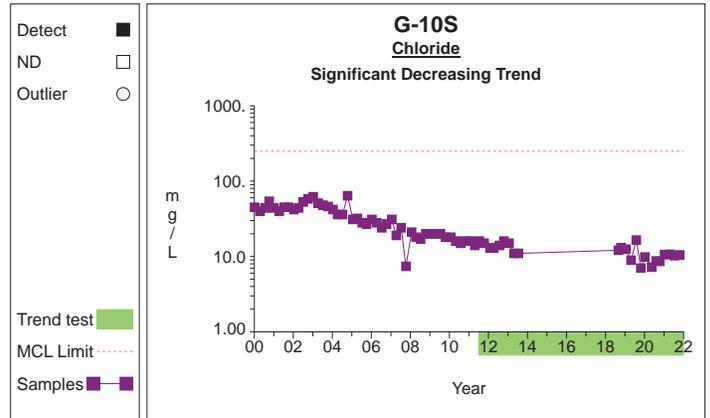


Graph 137

Time Series

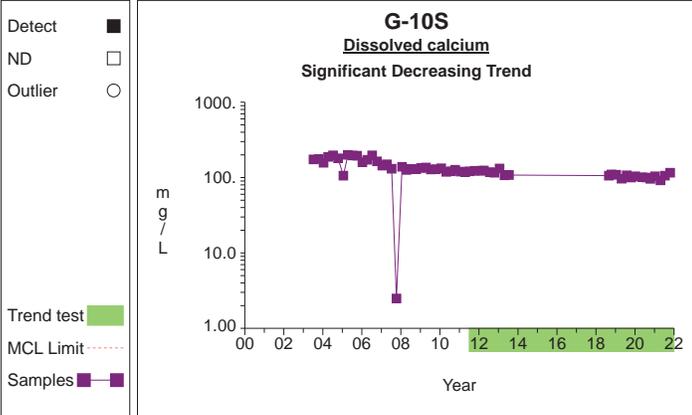


Graph 144

Time Series

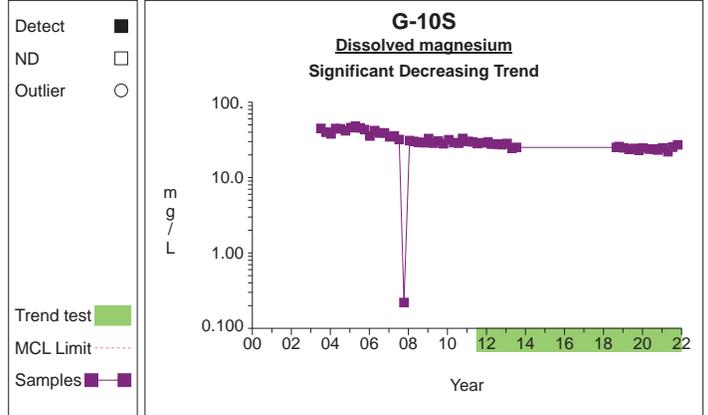


Graph 150

Time Series

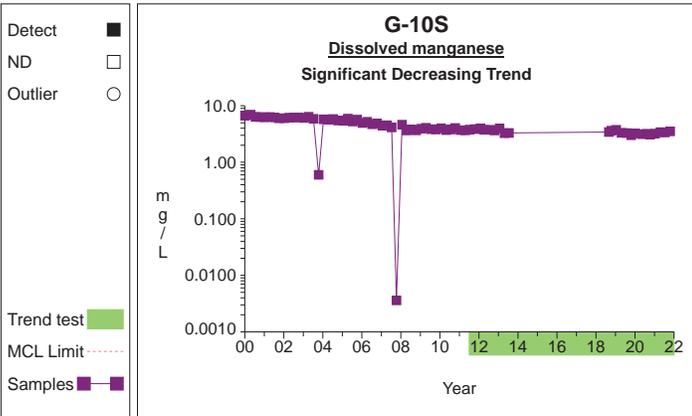

Graph 151


Time Series

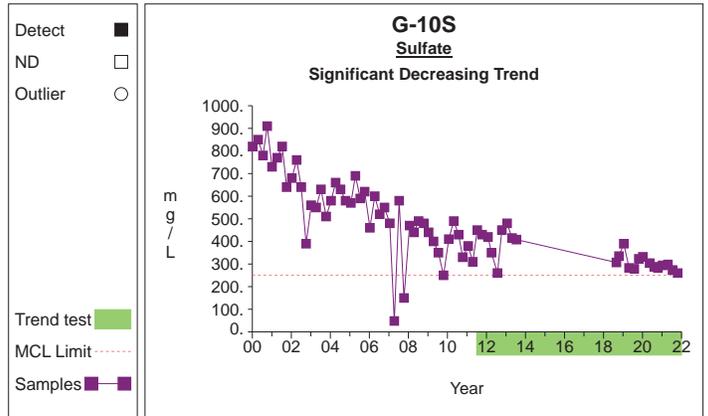

Graph 163

Time Series


- Detect
- ND
- Outlier

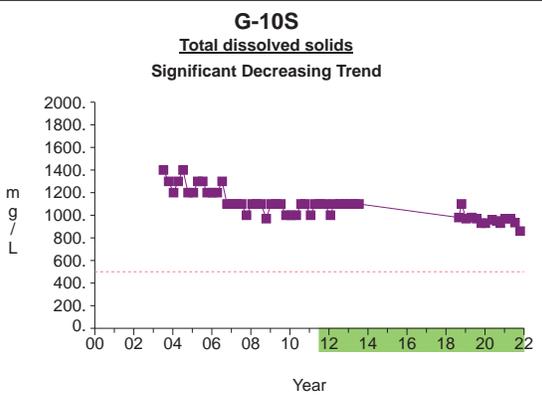

Graph 164

Time Series


- Detect
- ND
- Outlier

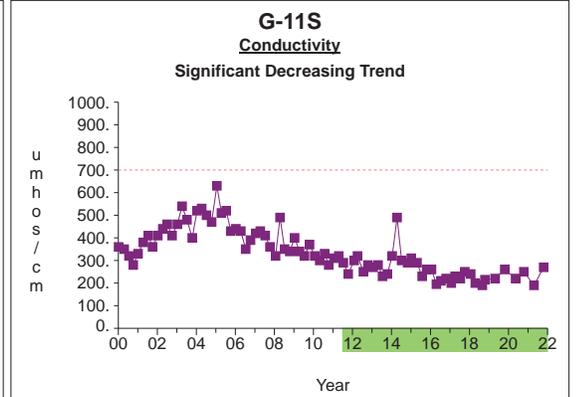

Graph 171

Time Series


- Detect
- ND
- Outlier

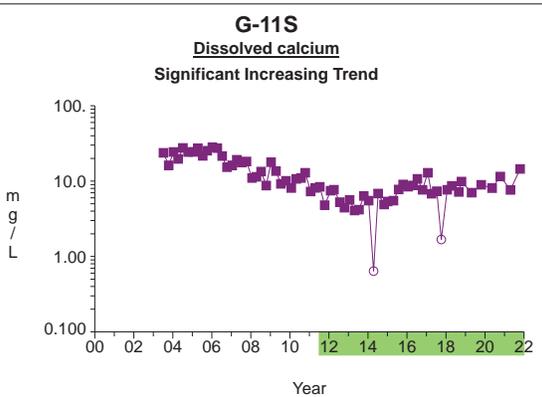





Graph 177

Time Series


- Detect
- ND
- Outlier

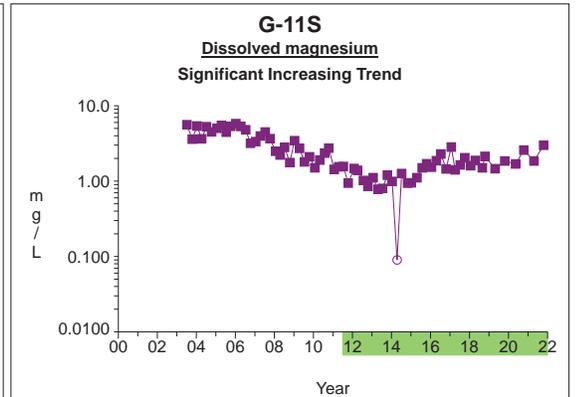

Graph 183

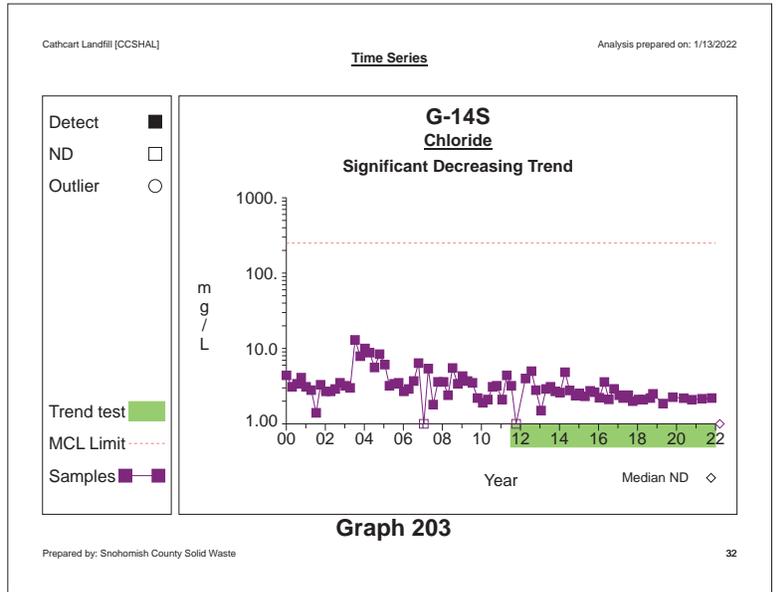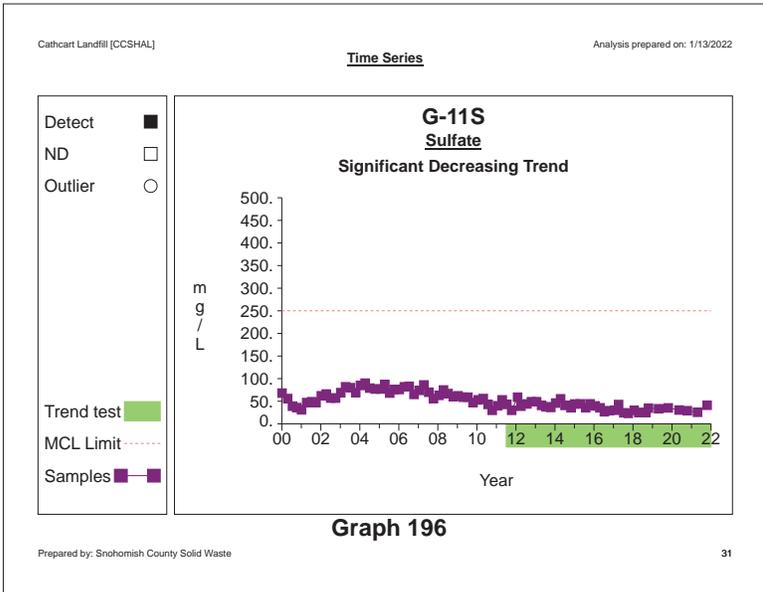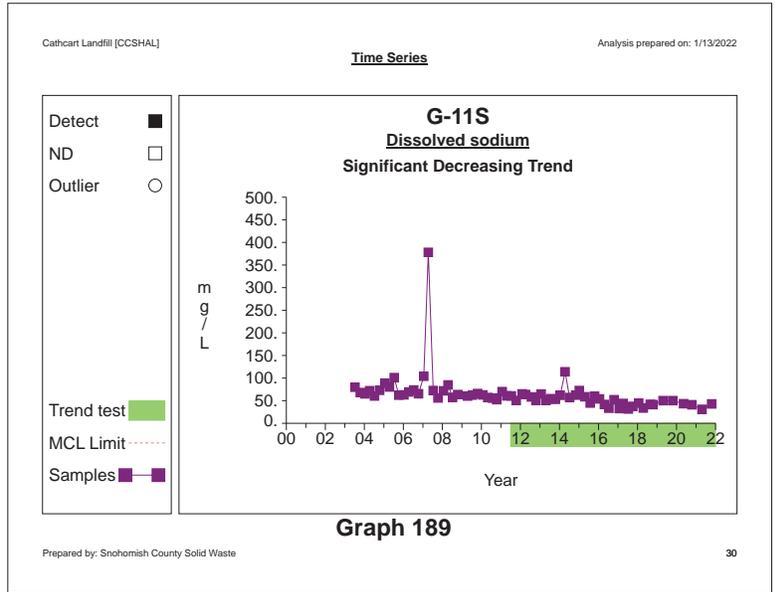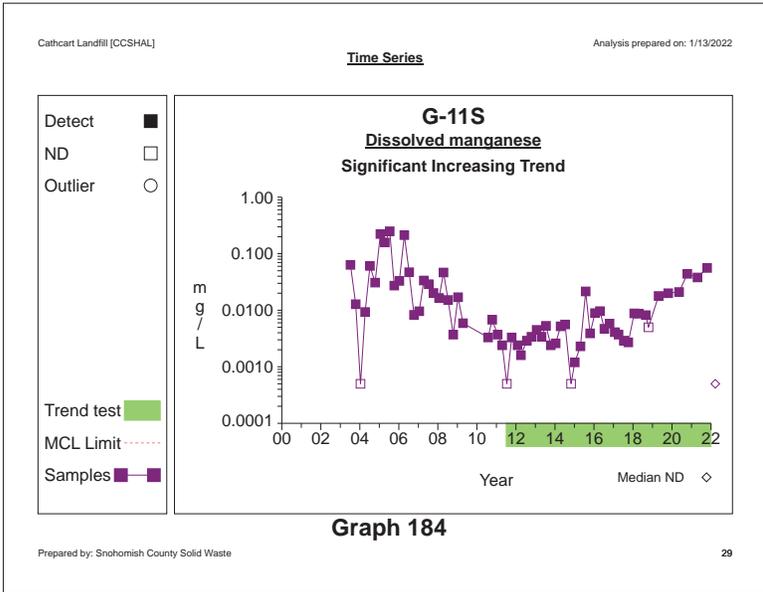


Time Series

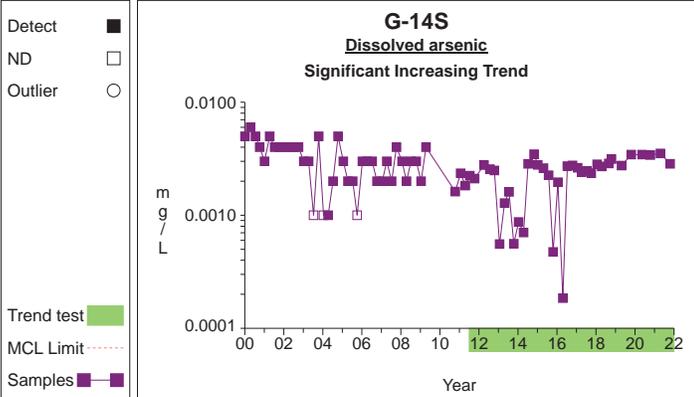


Graph 206

Time Series

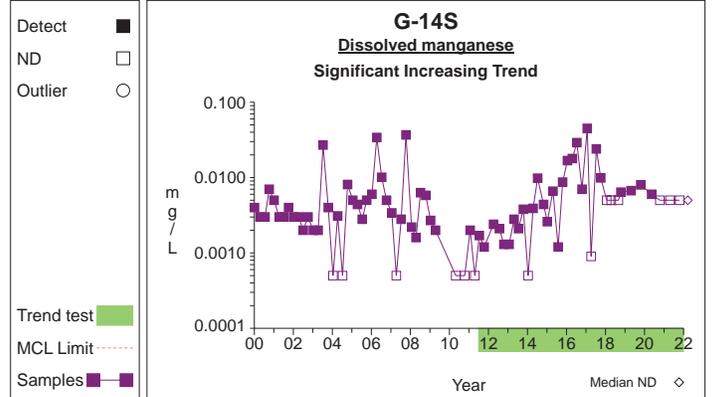


Graph 217

Time Series

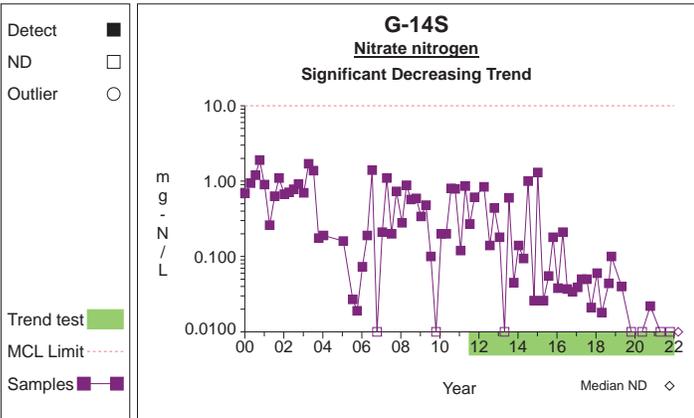


Graph 226

Time Series

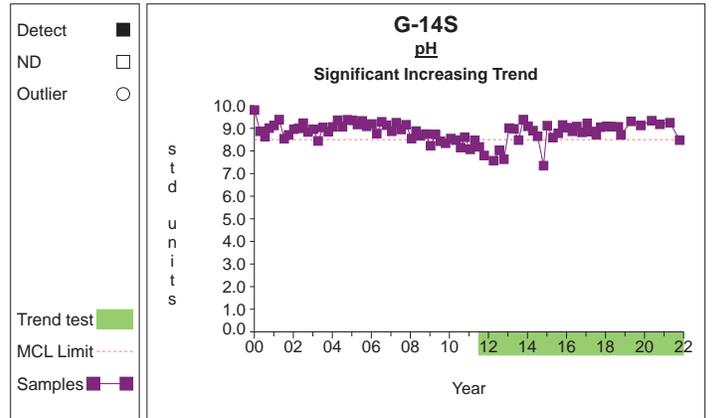


Graph 228

Time Series

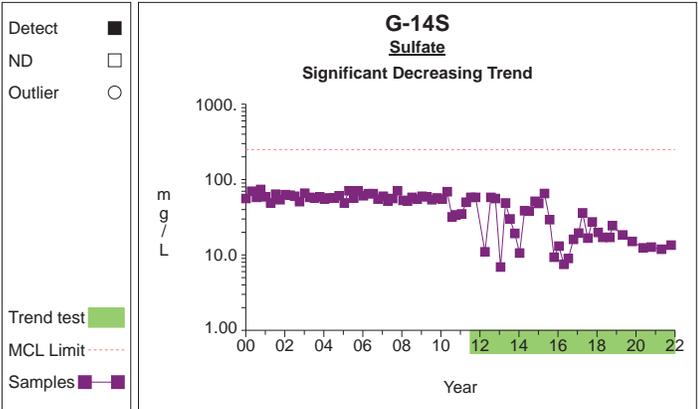


Graph 229

Time Series

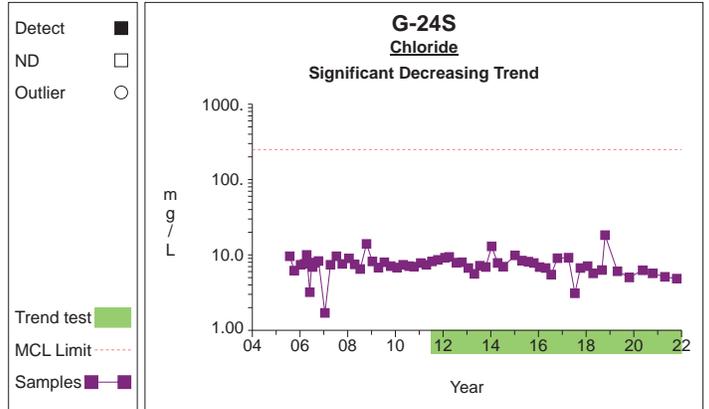


Graph 236

Time Series

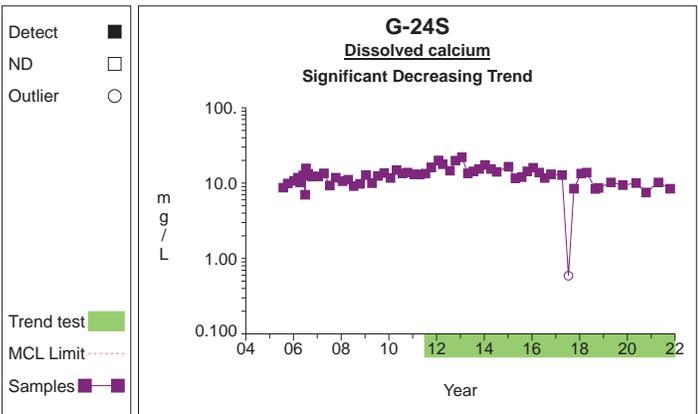


Graph 243

Time Series

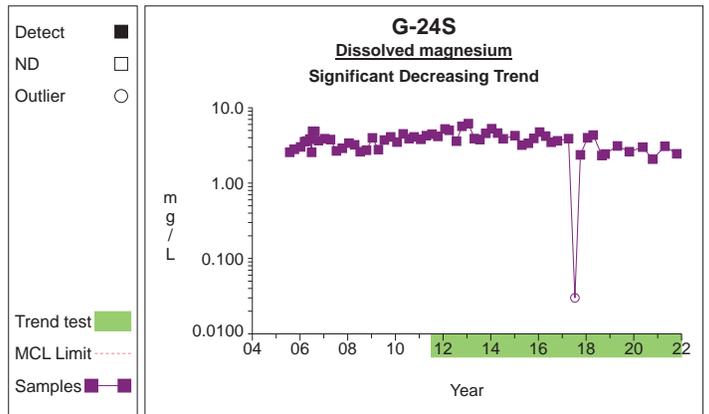

Graph 249


Time Series

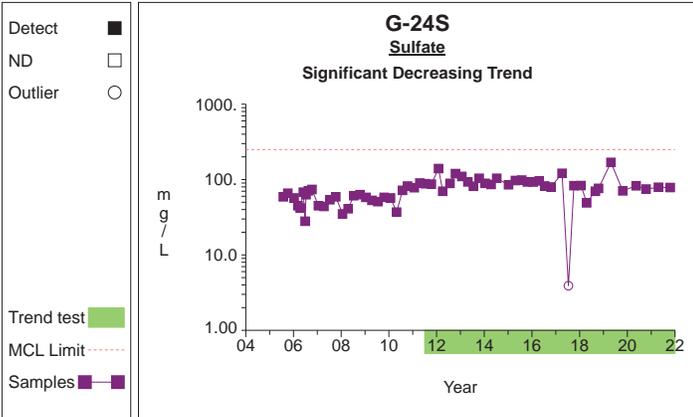

Graph 262


Cathcart Landfill

Time Series Plot for G-08D1

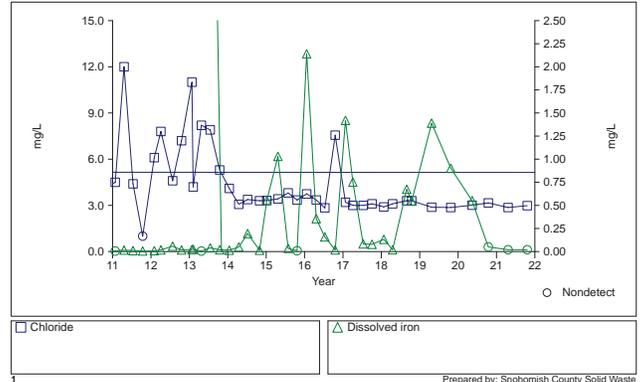


Cathcart Landfill

Time Series Plot for G-09S

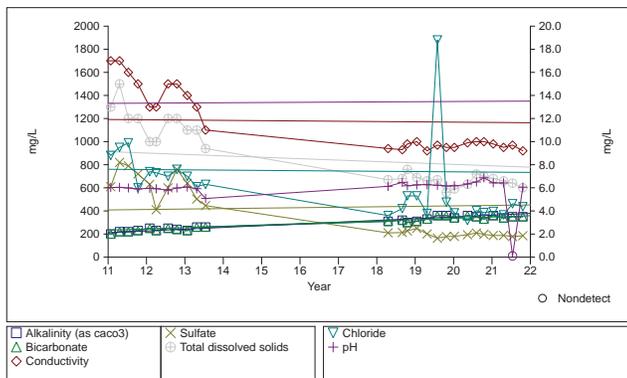


Cathcart Landfill

Time Series Plot for G-09S

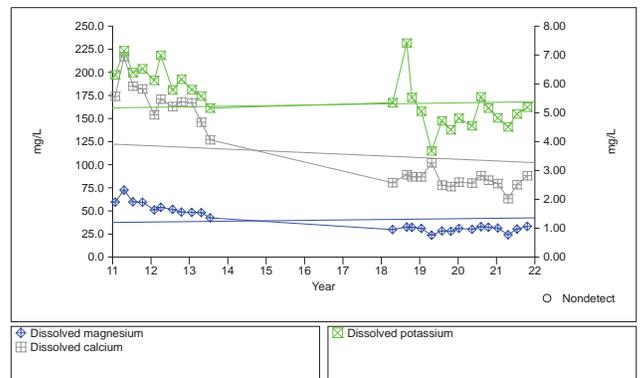


Cathcart Landfill

Time Series Plot for G-10S

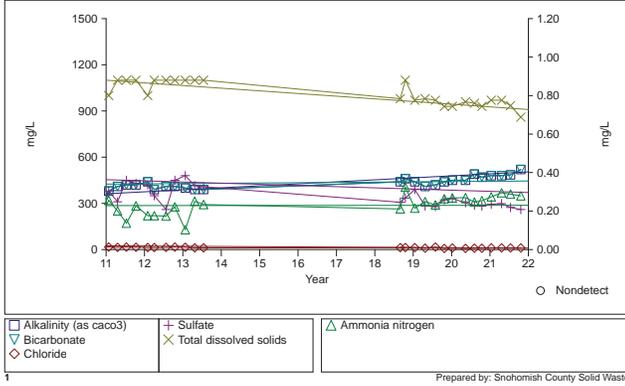


Cathcart Landfill

Time Series Plot for G-10S

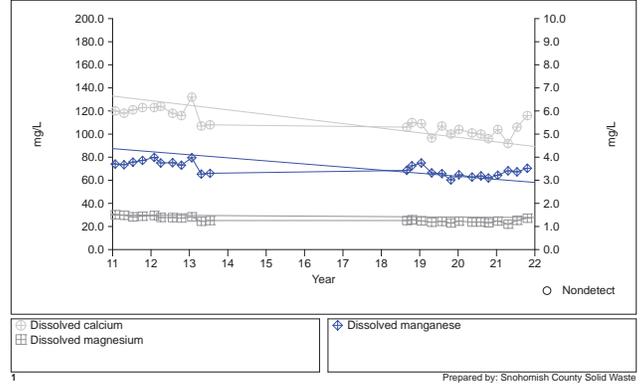


Cathcart Landfill

Time Series Plot for G-11S

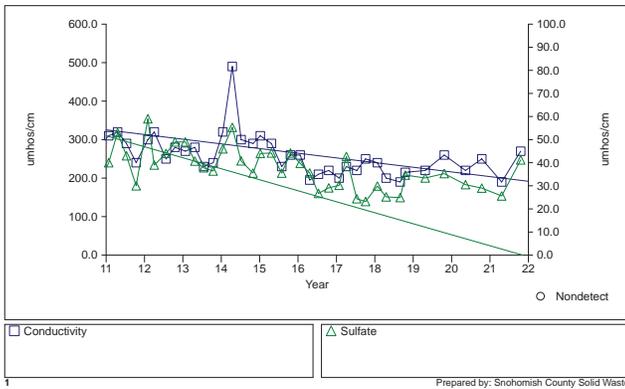


Cathcart Landfill

Time Series Plot for G-11S

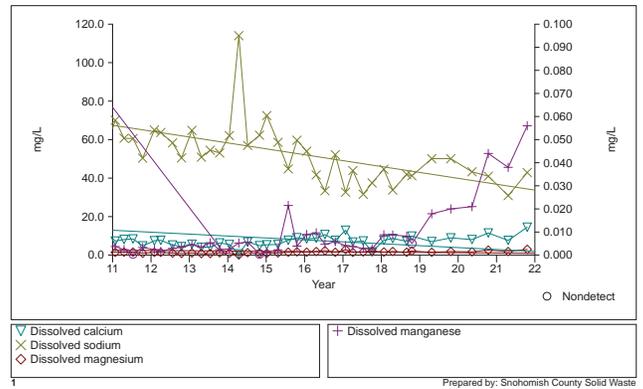


Cathcart Landfill

Time Series Plot for G-14S

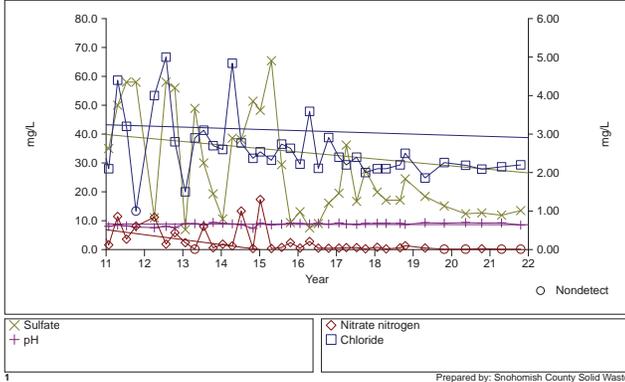


Cathcart Landfill

Time Series Plot for G-14S

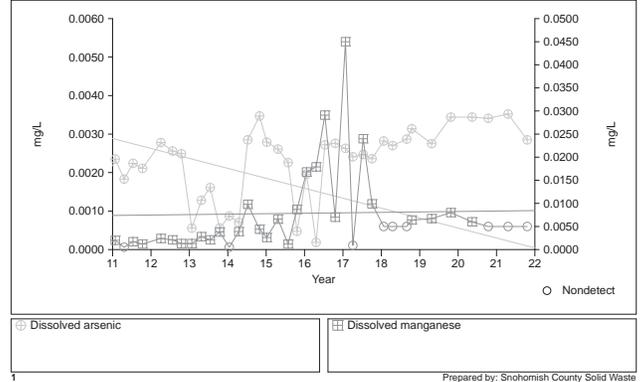


Cathcart Landfill

Time Series Plot for G-24S

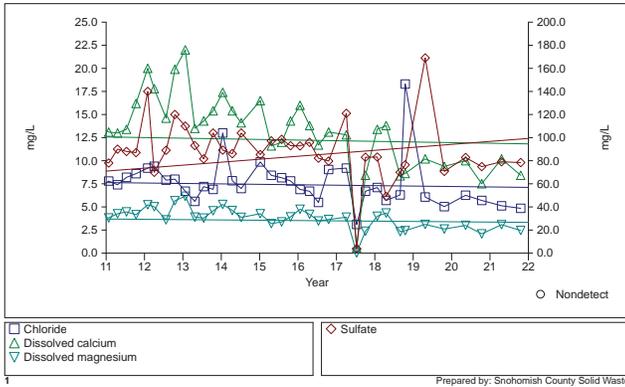


Deep Wells


False Positive and False Negative Rates for Current Intra-Well Prediction Limits Monitoring Program

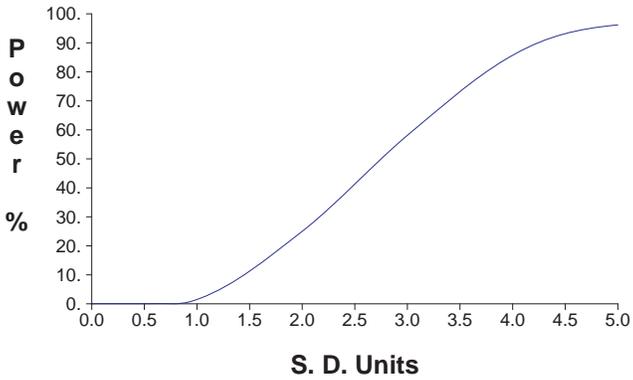


False Positive and False Negative Rates for Current Upgradient vs. Downgradient Monitoring Program




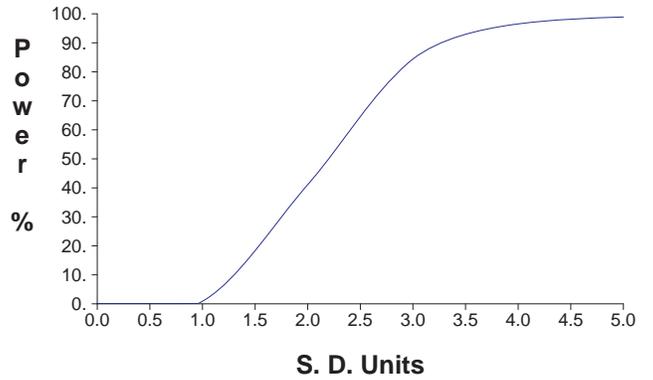






Cathcart Landfill

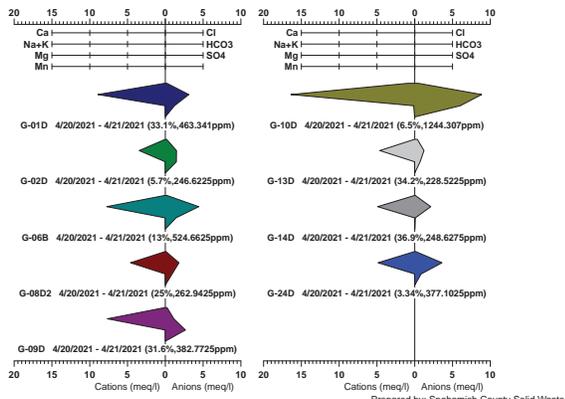


Cathcart Landfill

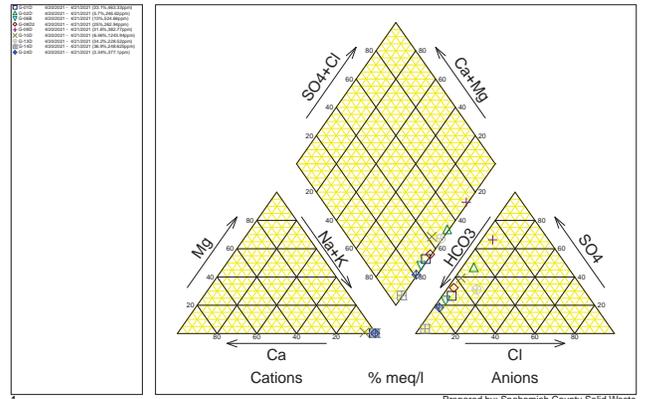

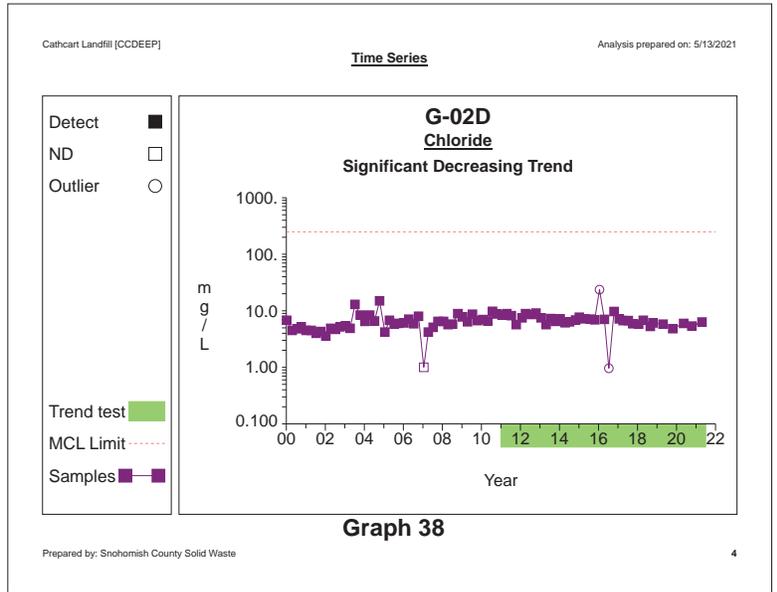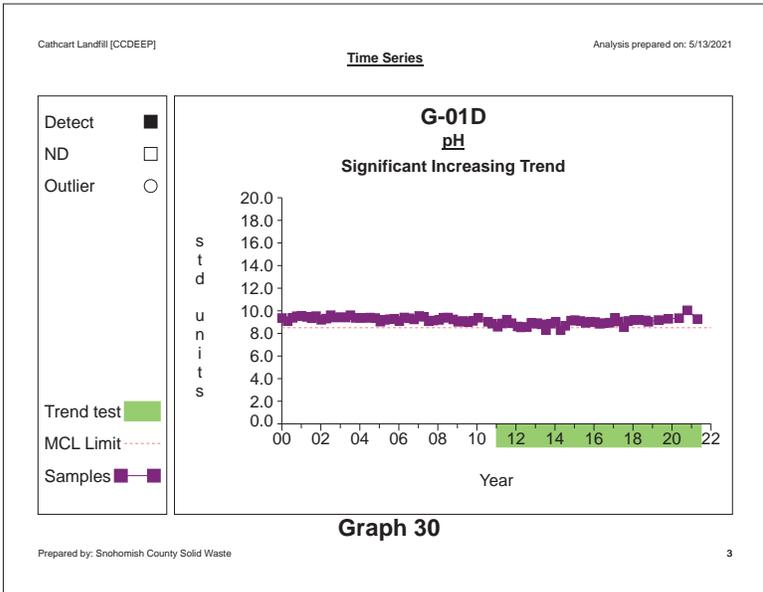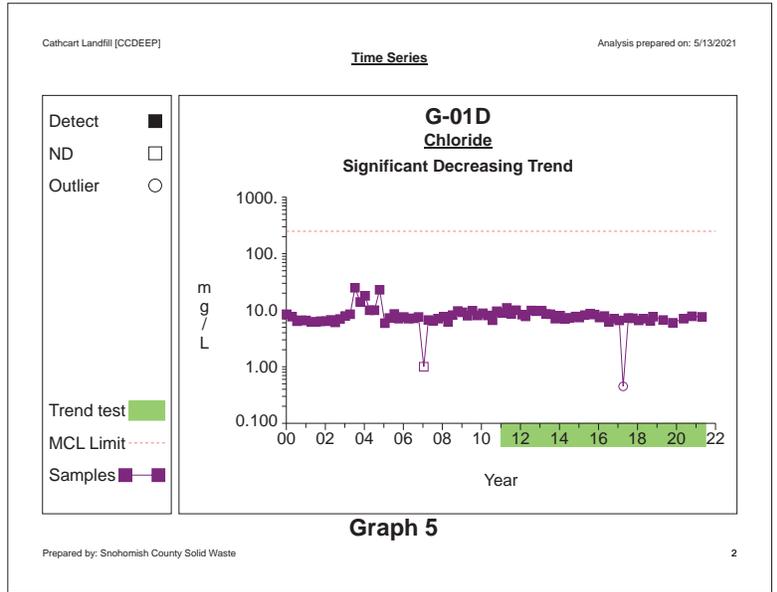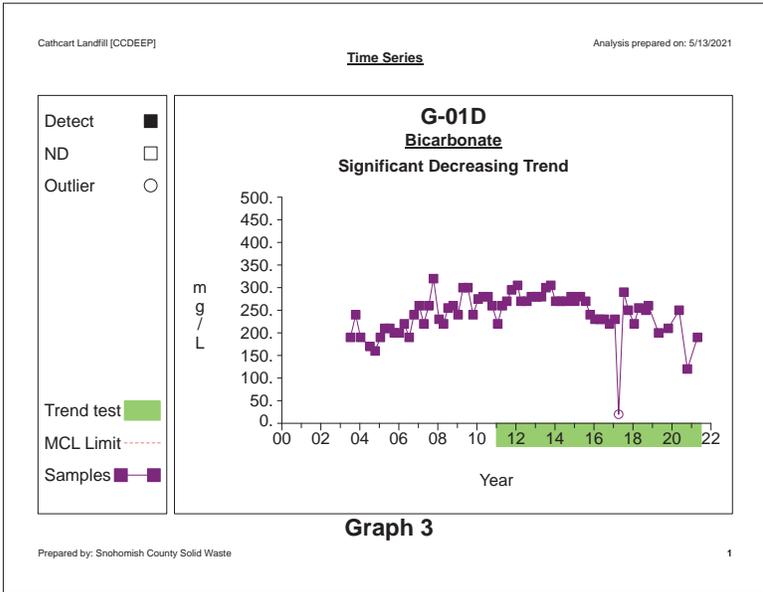

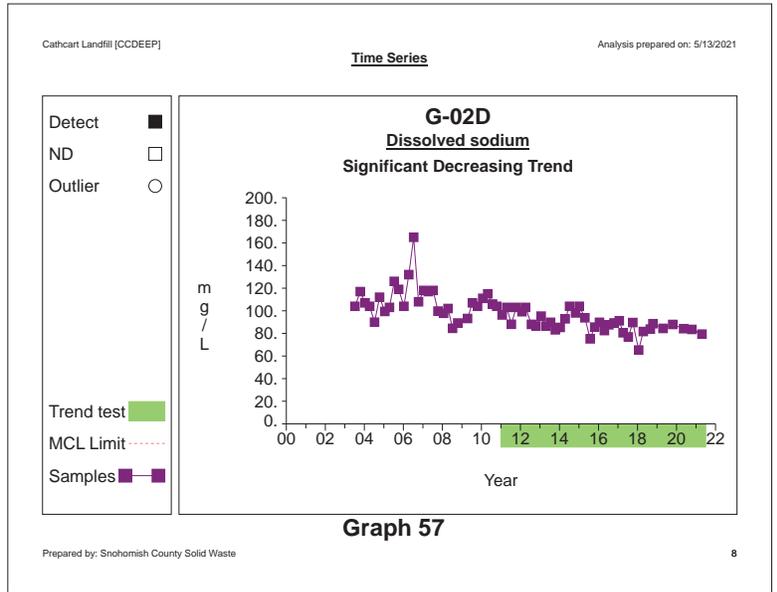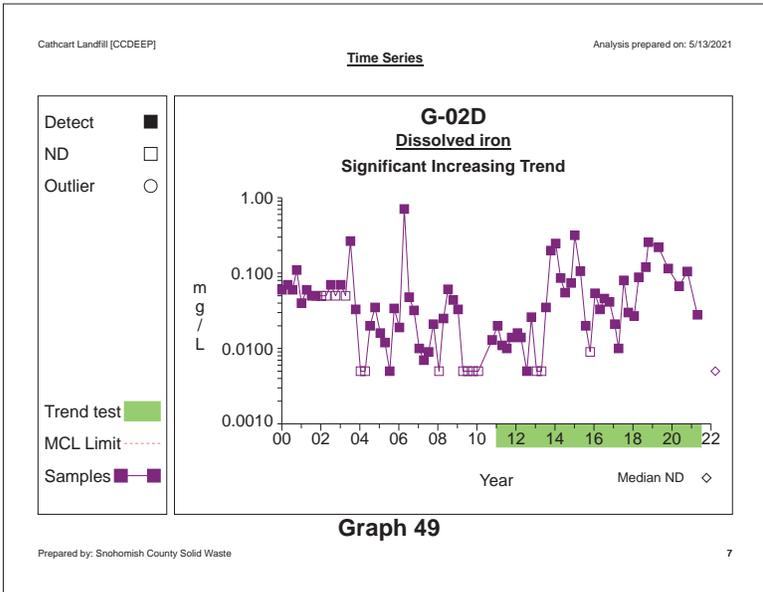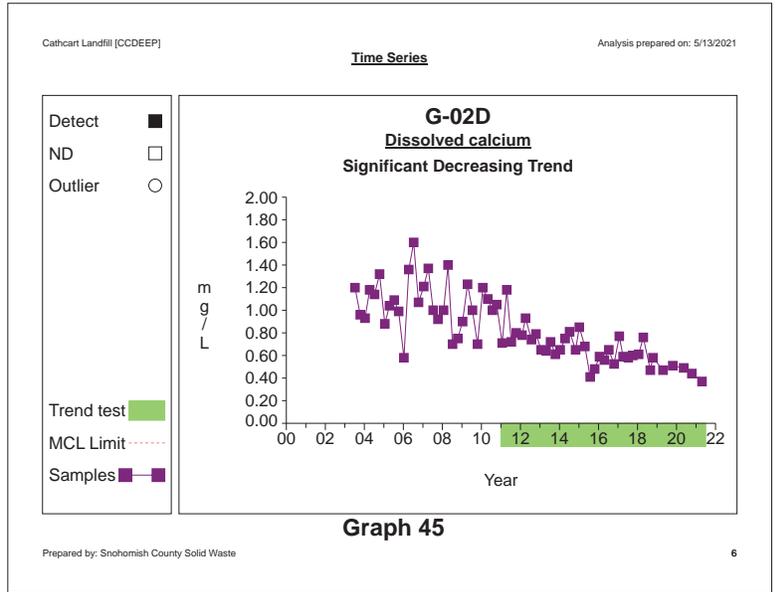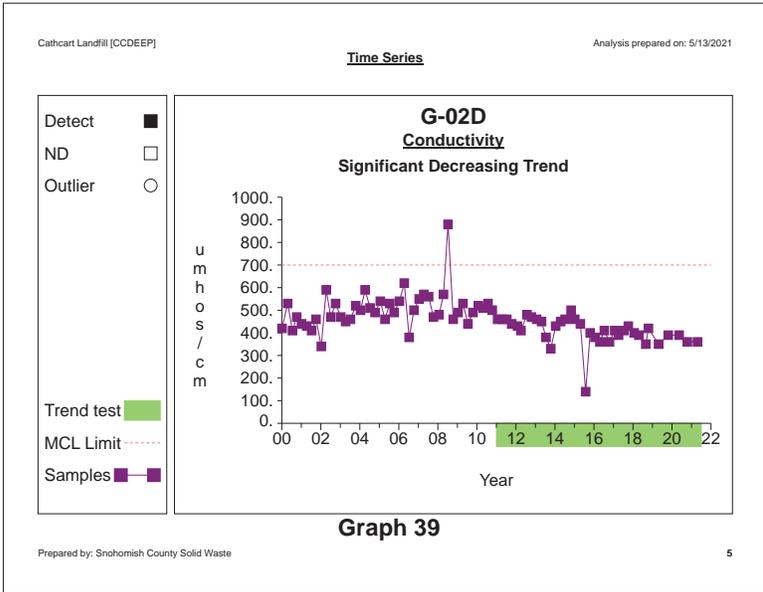


Time Series

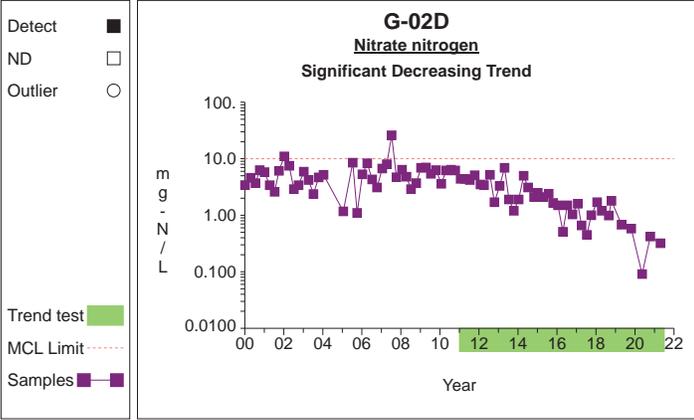


Graph 61

Time Series

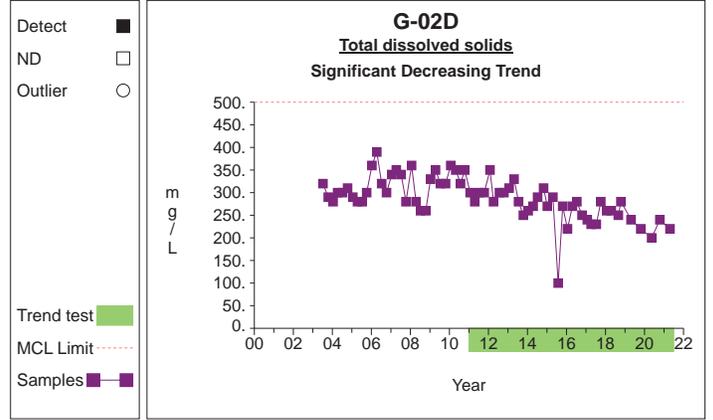


Graph 65

Time Series




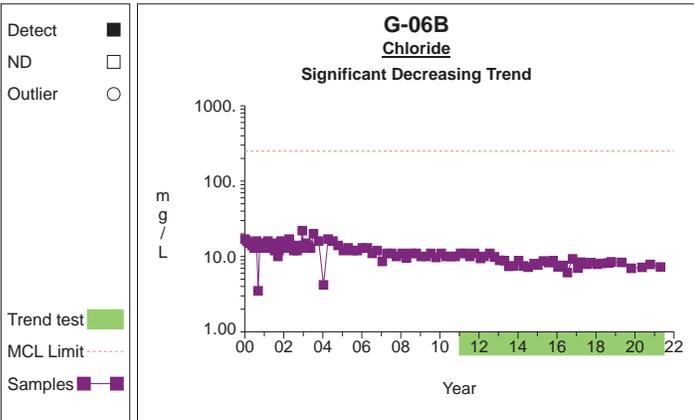






Graph 71

Time Series

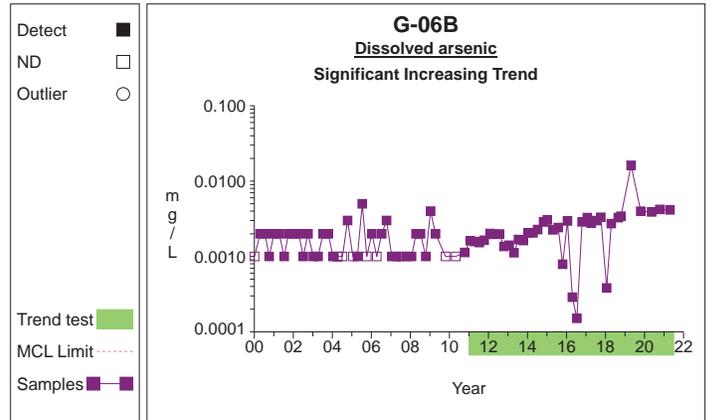


Graph 74

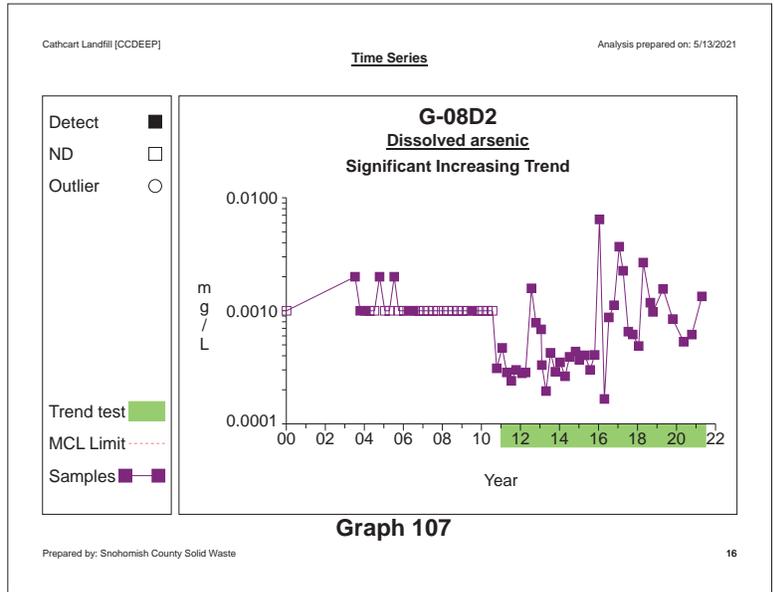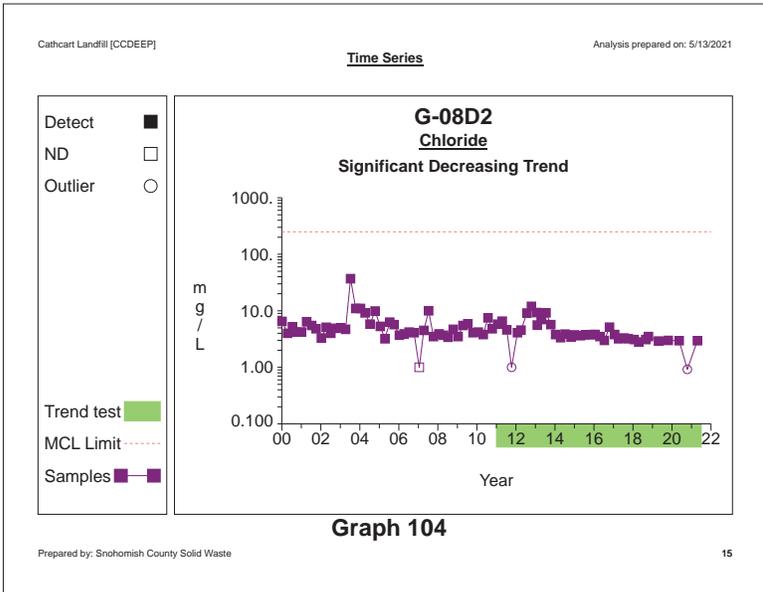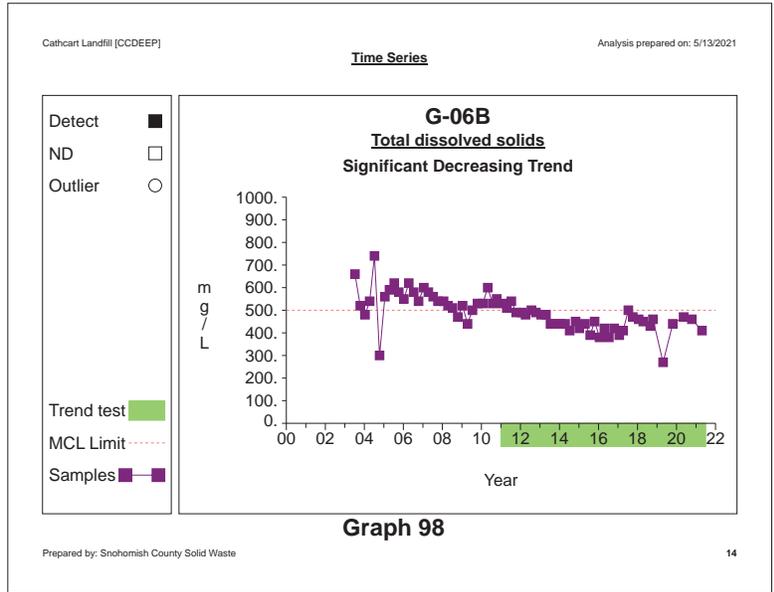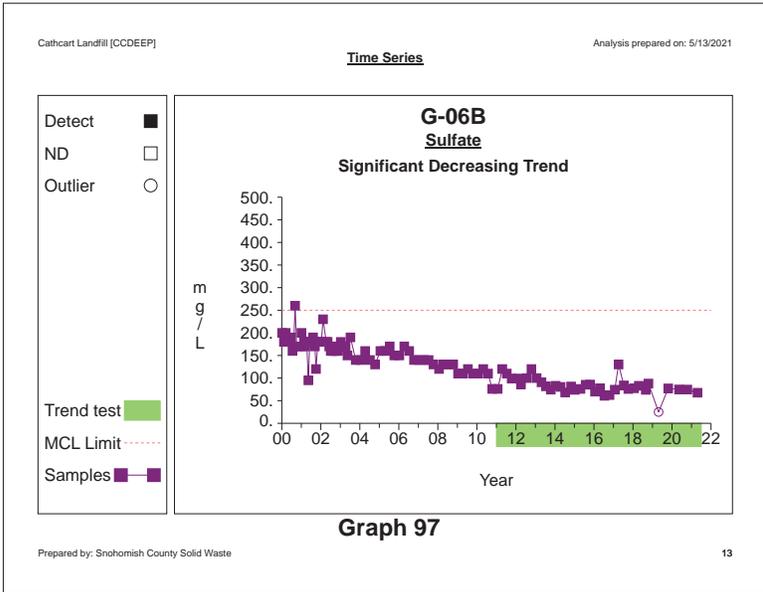

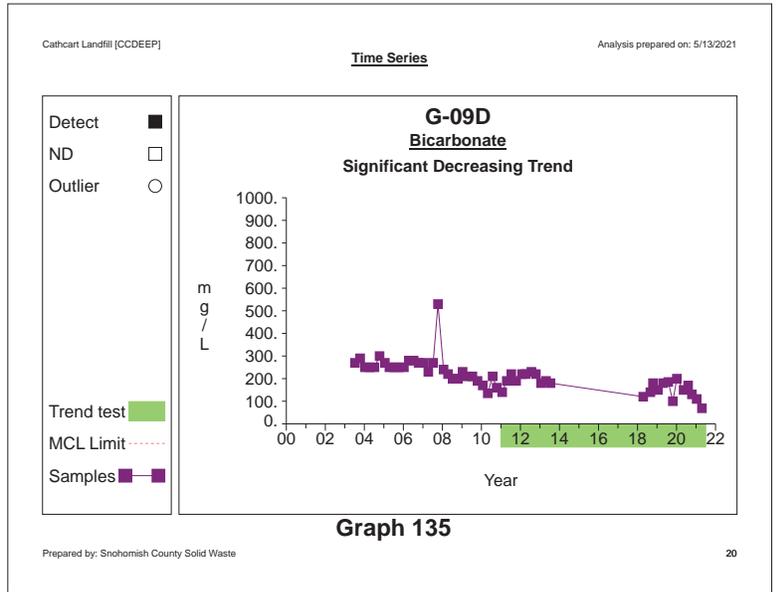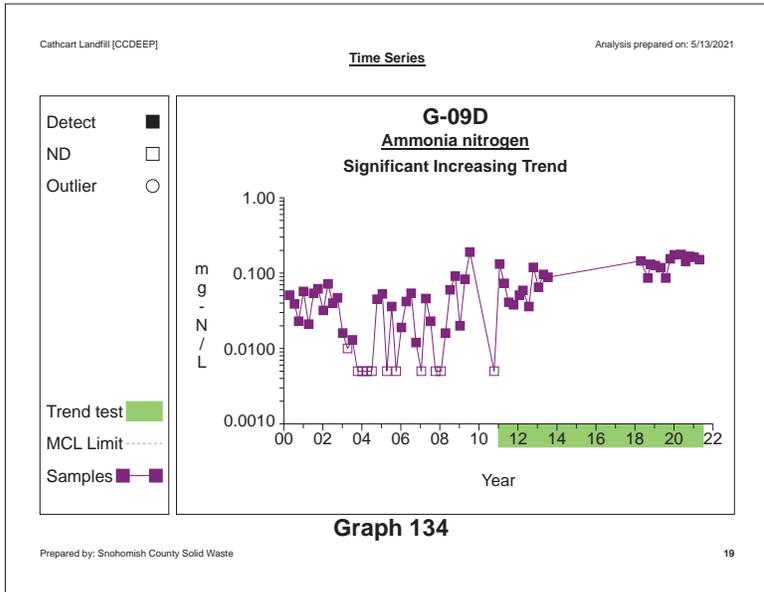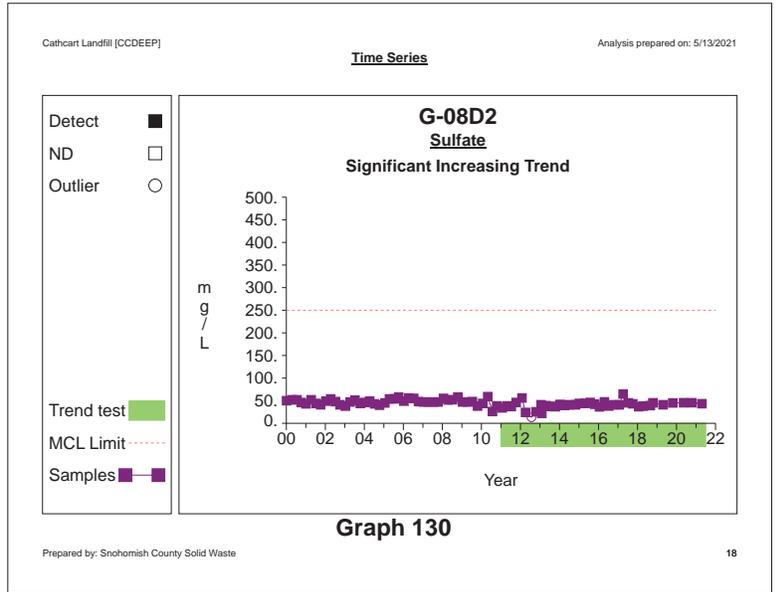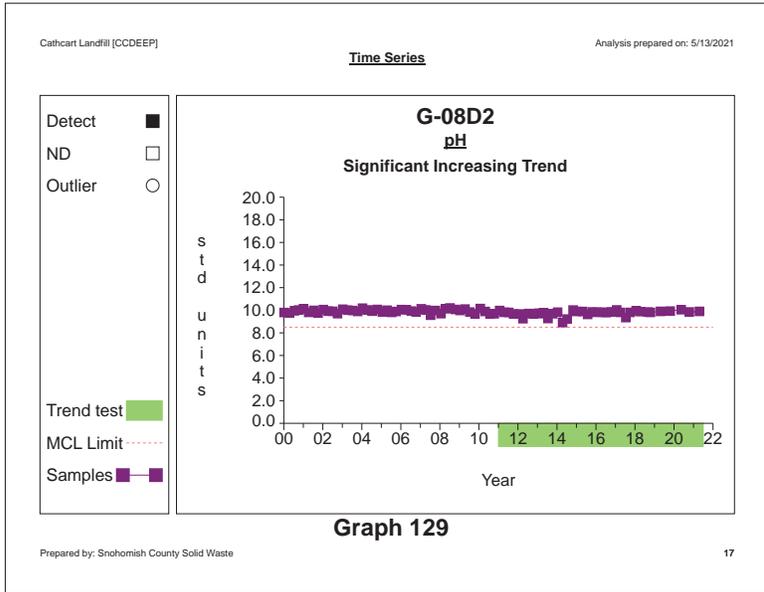

Time Series


- Detect
- ND
- Outlier

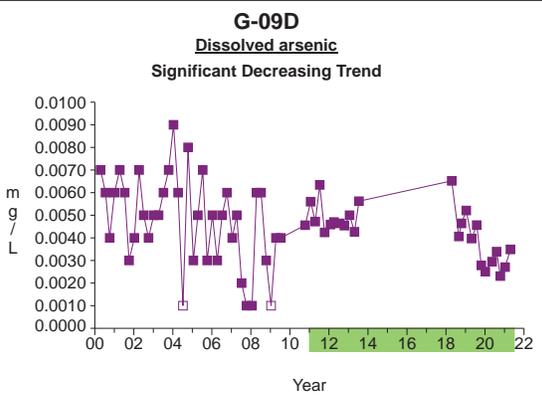

Graph 140

Time Series


- Detect
- ND
- Outlier

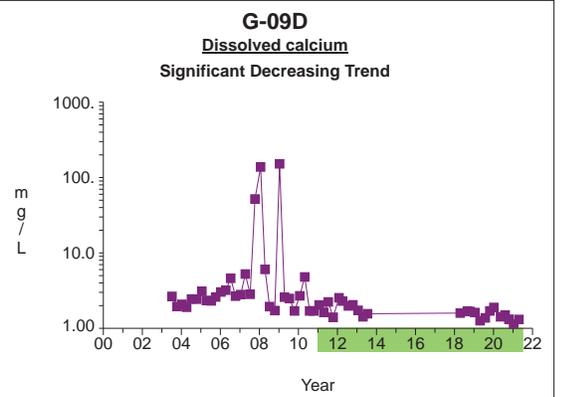

Graph 144

Time Series


- Detect
- ND
- Outlier

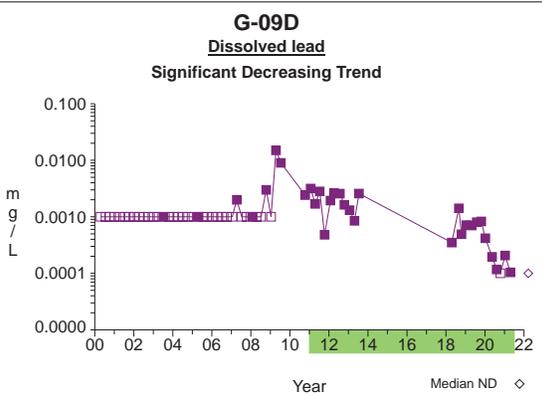





Graph 149





Time Series

- Detect
- ND
- Outlier

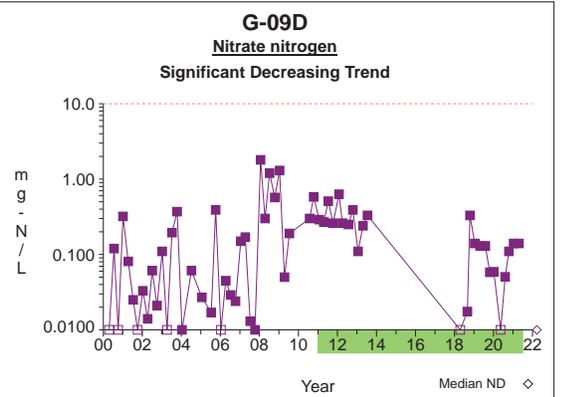


Graph 160

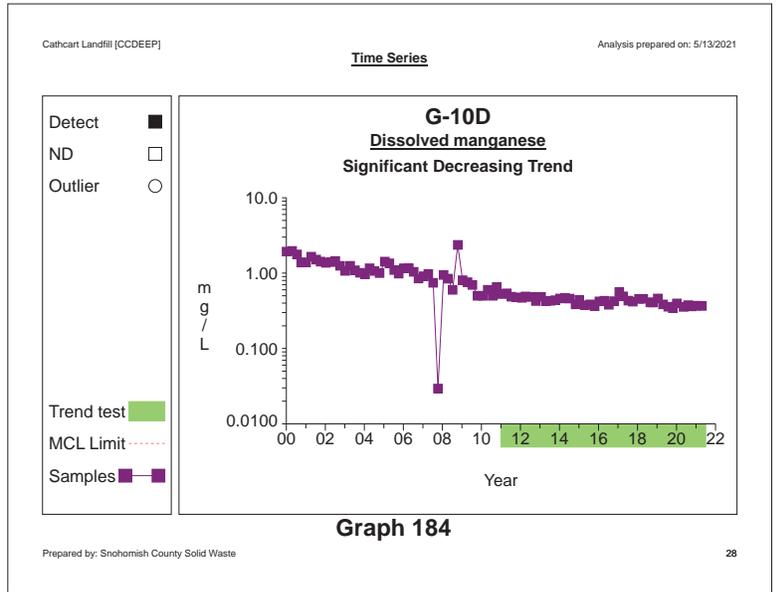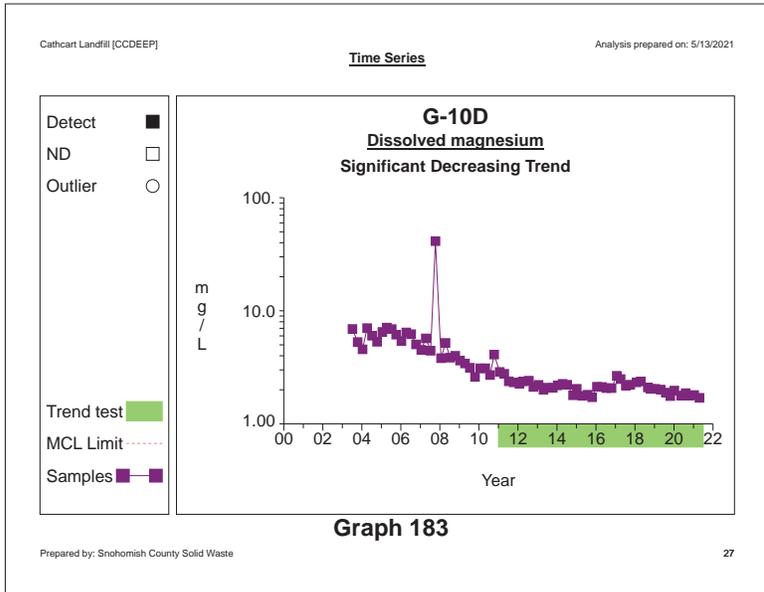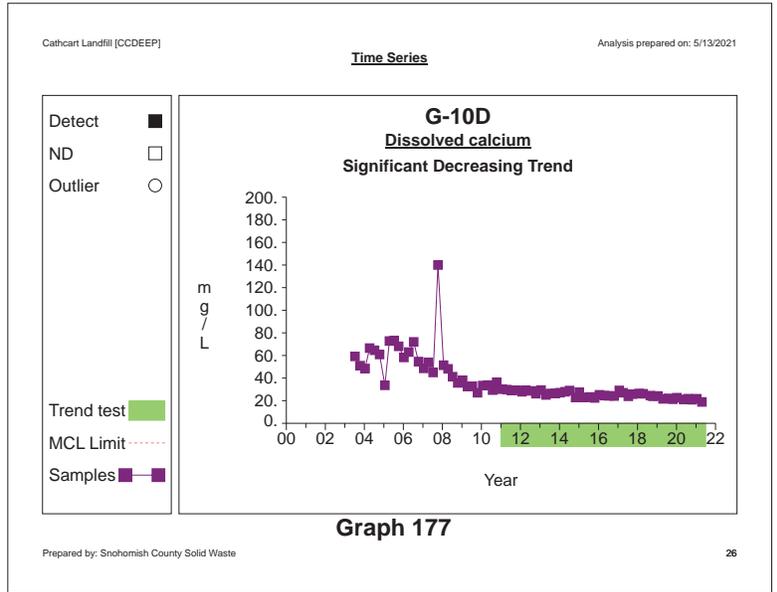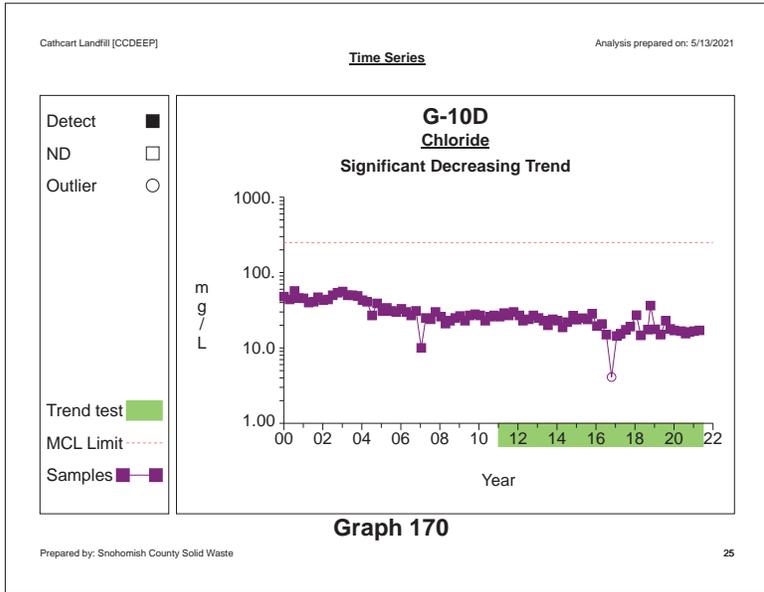

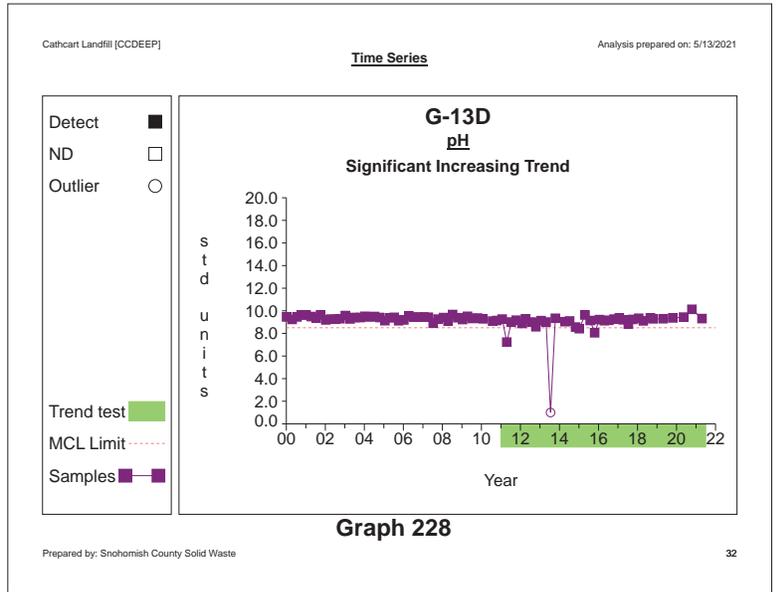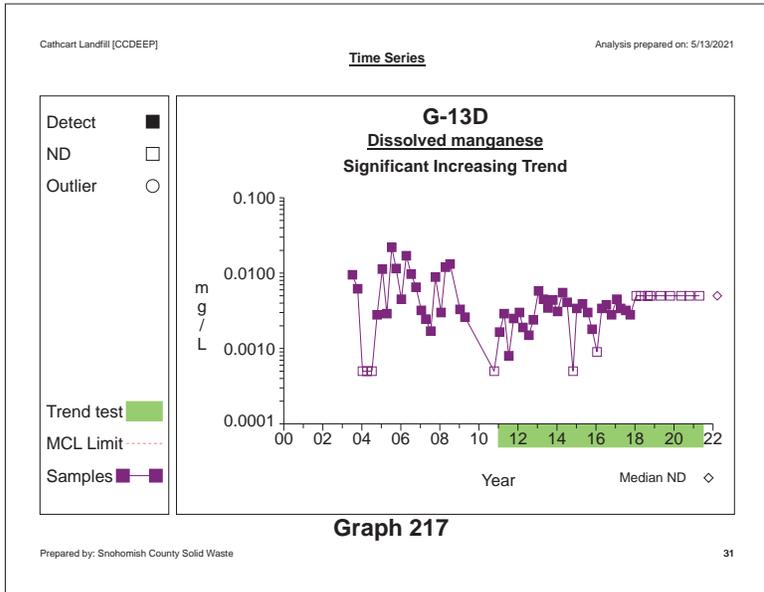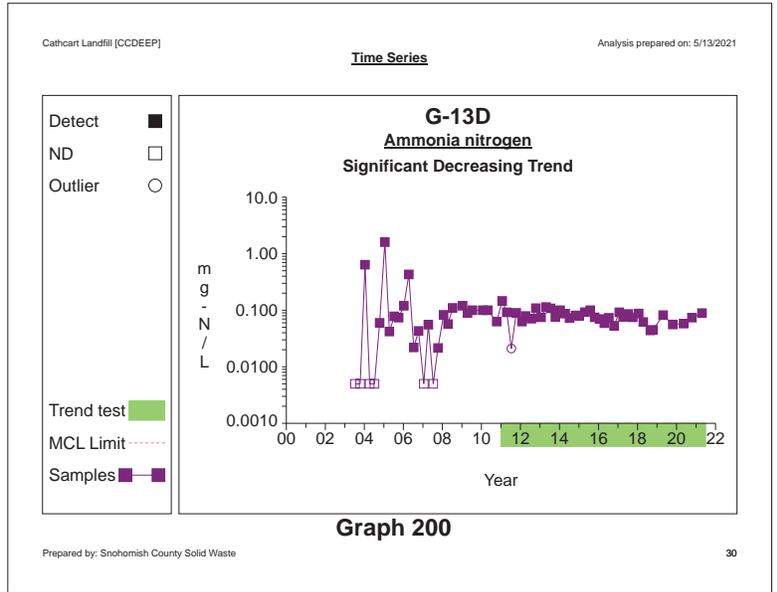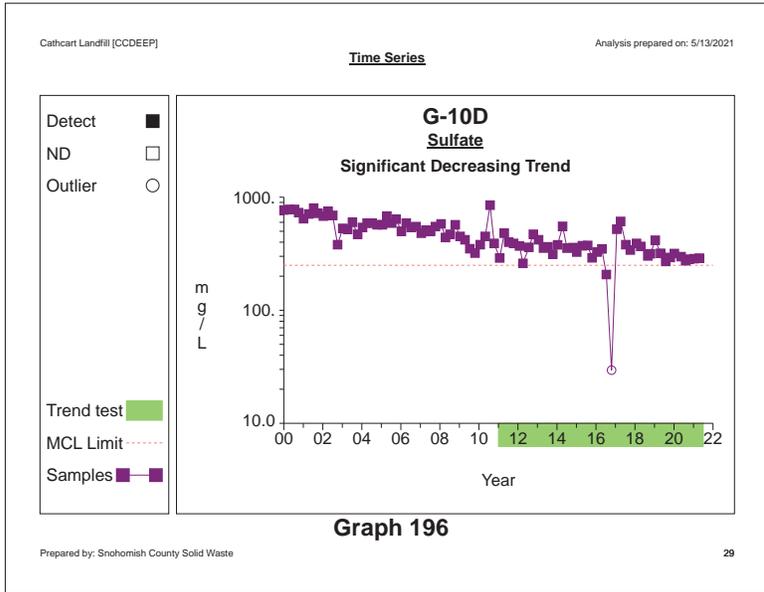


Time Series

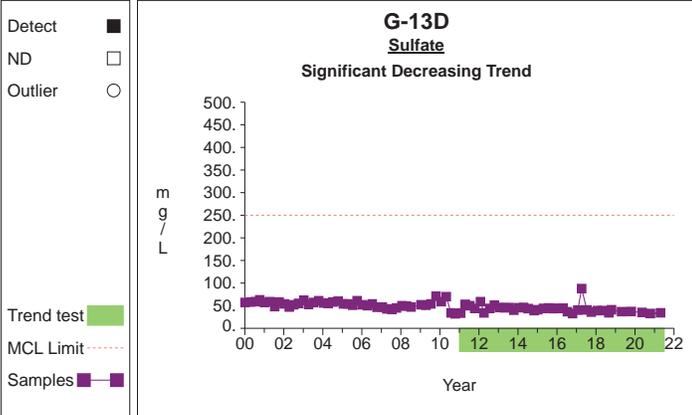


Graph 229

Time Series

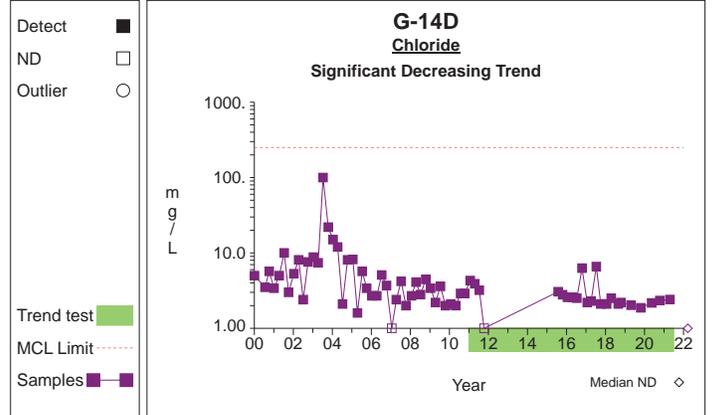


Graph 236

Time Series

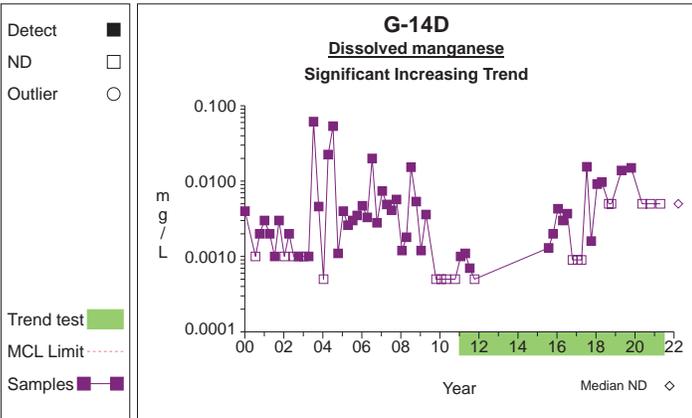


Graph 250

Time Series

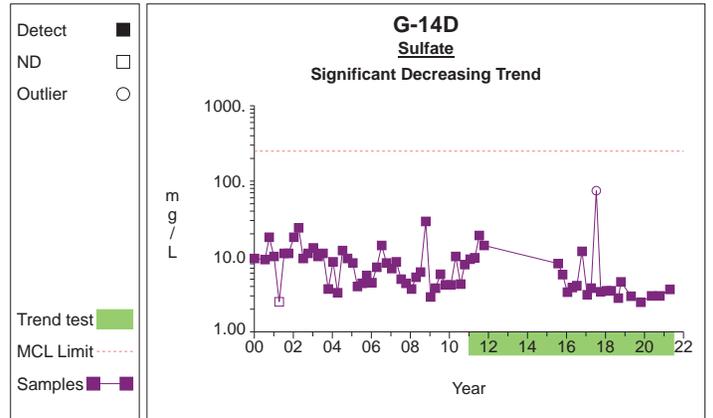


Graph 262

Time Series

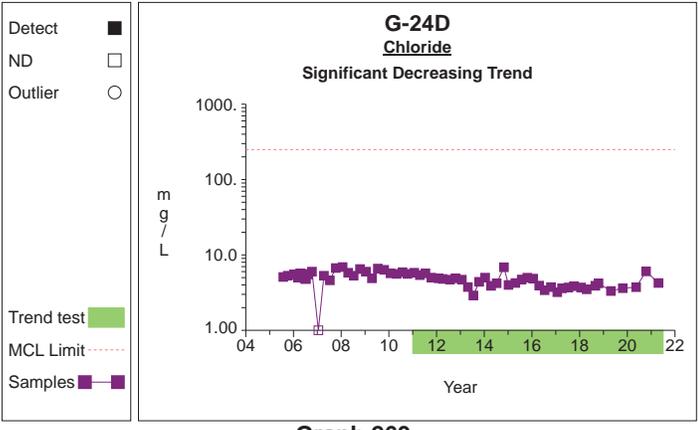

Graph 269


Time Series

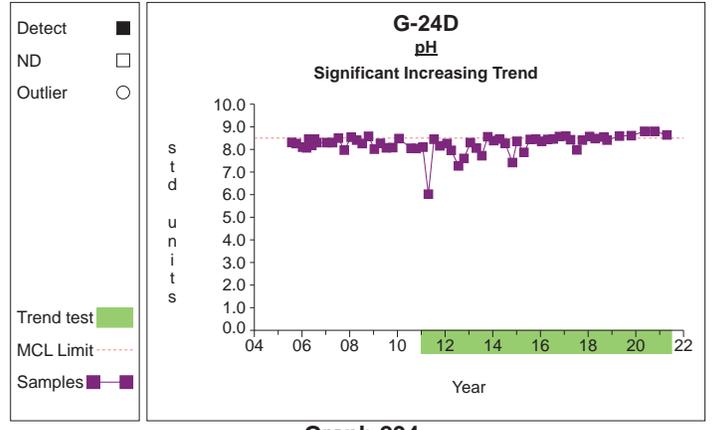

Graph 294


Cathcart Landfill

Time Series Plot for G-01D

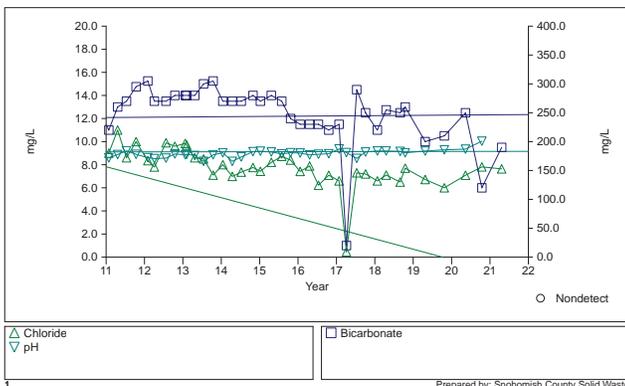


Cathcart Landfill

Time Series Plot for G-02D

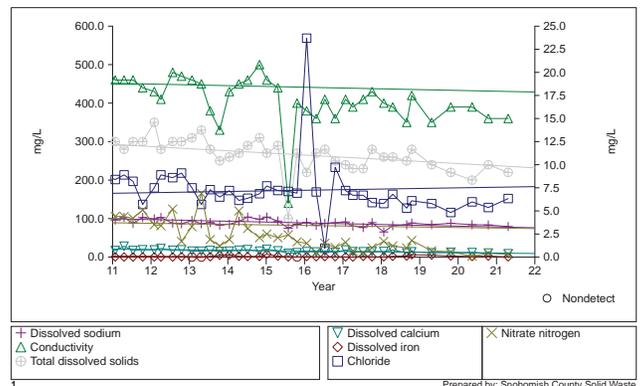

Cathcart Landfill


Time Series Plot for G-06B

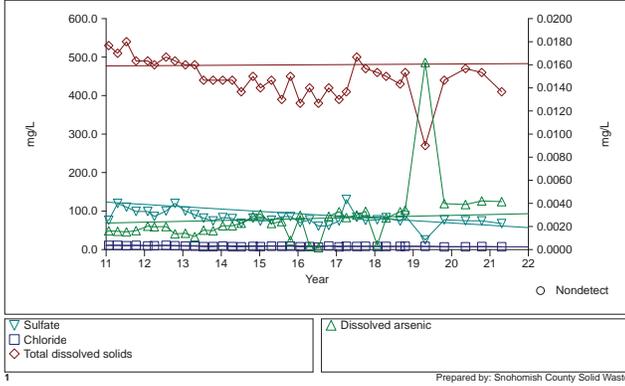

Prepared by: Snohomish County Solid Waste

Cathcart Landfill


Time Series Plot for G-08D2

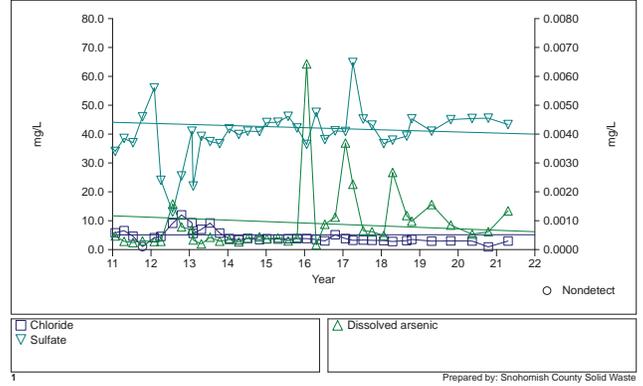

Prepared by: Snohomish County Solid Waste

Cathcart Landfill


Time Series Plot for G-09D

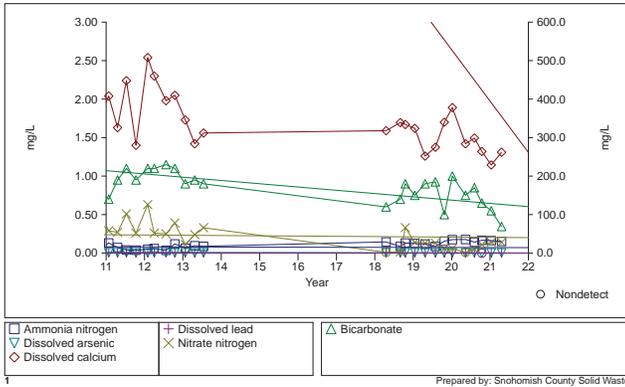

Prepared by: Snohomish County Solid Waste

Cathcart Landfill


Time Series Plot for G-10D

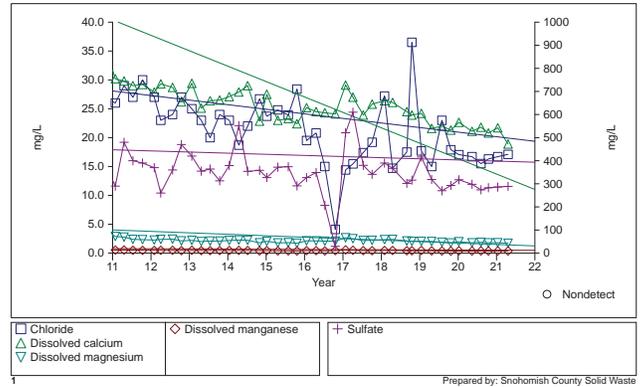

Prepared by: Snohomish County Solid Waste


Cathcart Landfill

Time Series Plot for G-13D

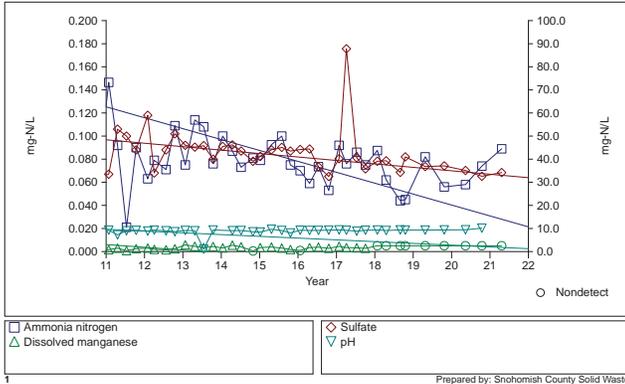


Cathcart Landfill

Time Series Plot for G-14D

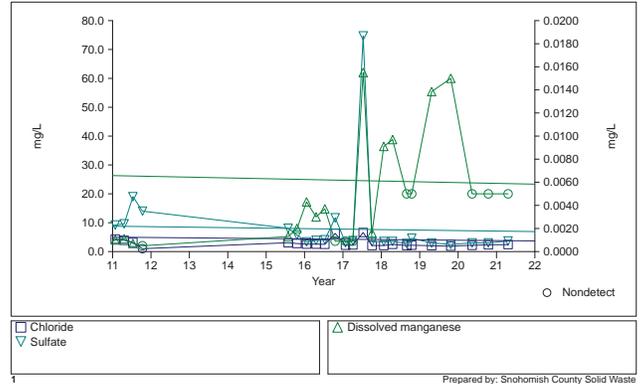


Cathcart Landfill


Time Series Plot for G-24D

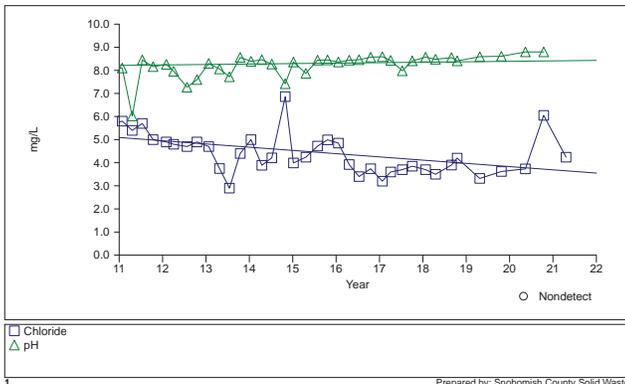


False Positive and False Negative Rates for Current Intra-Well Prediction Limits Monitoring Program

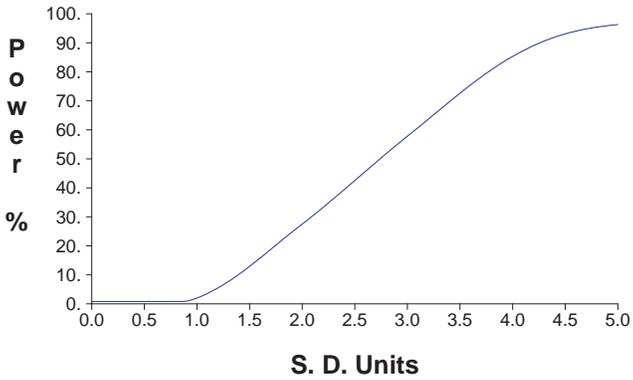


False Positive and False Negative Rates for Current Upgradient vs. Downgradient Monitoring Program




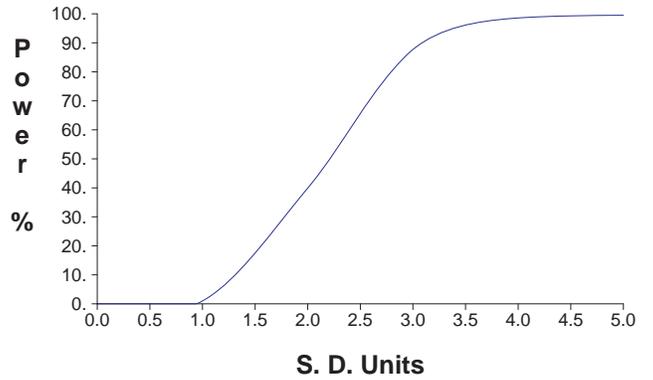






Cathcart Landfill

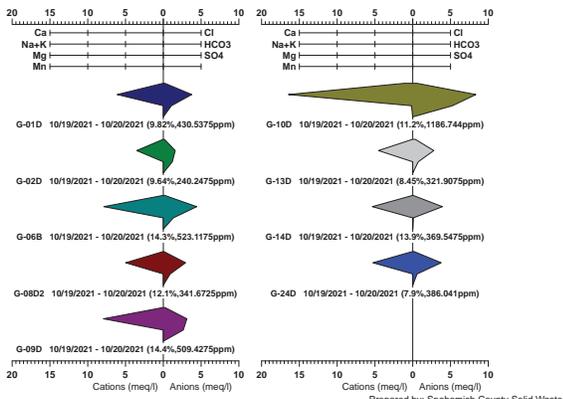


Cathcart Landfill

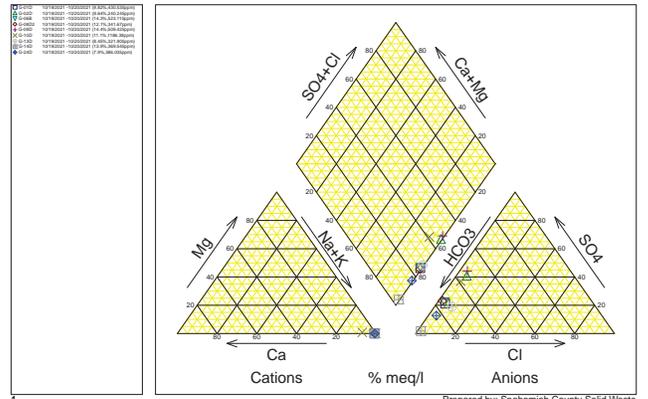

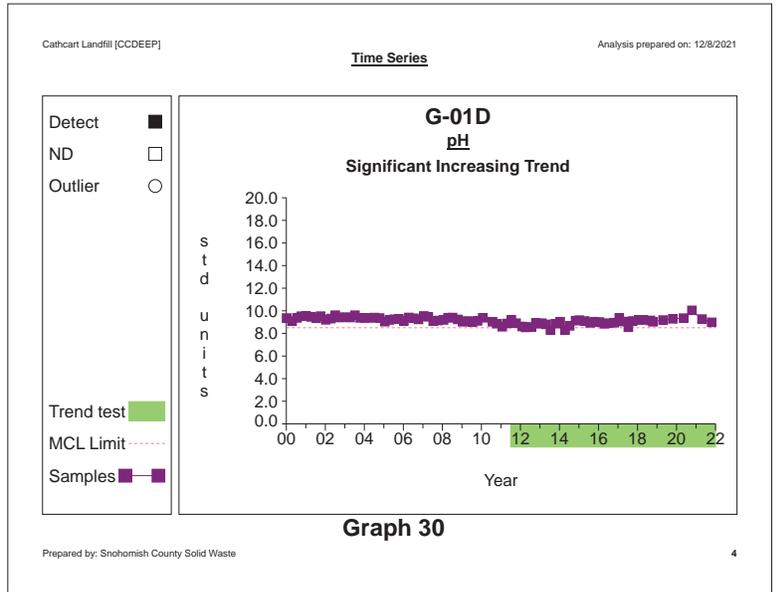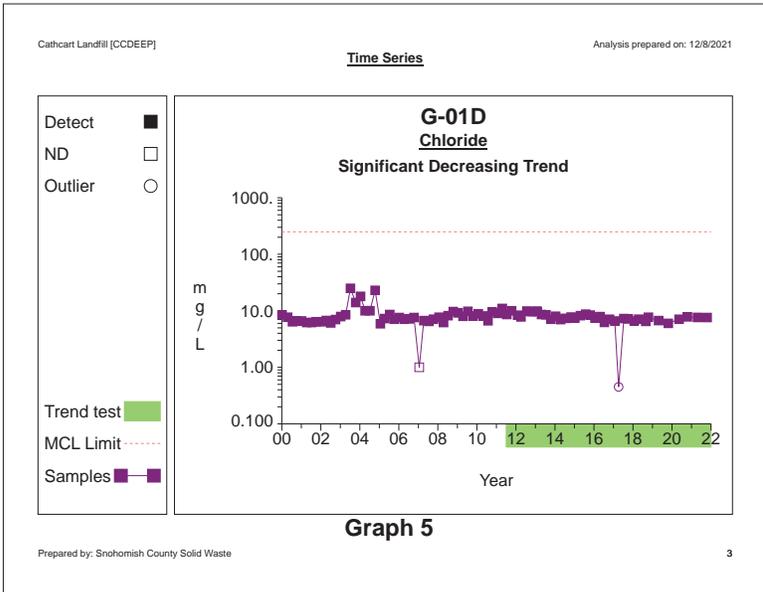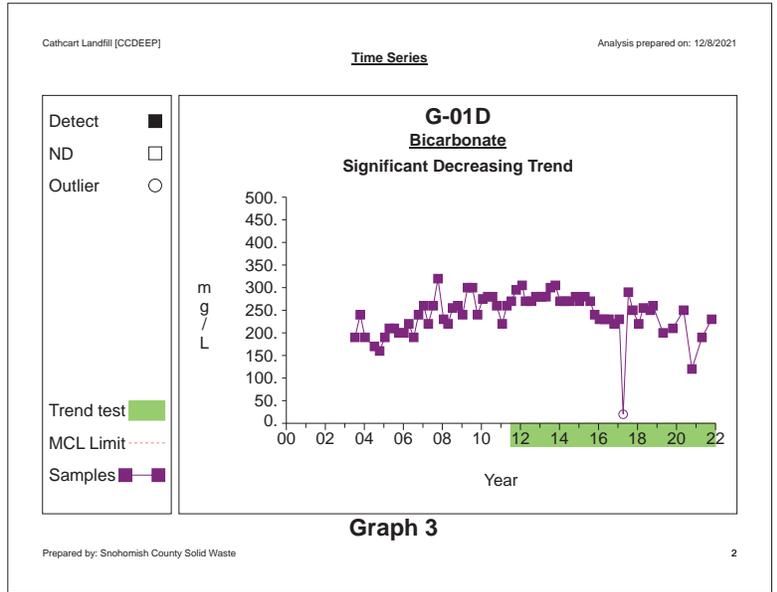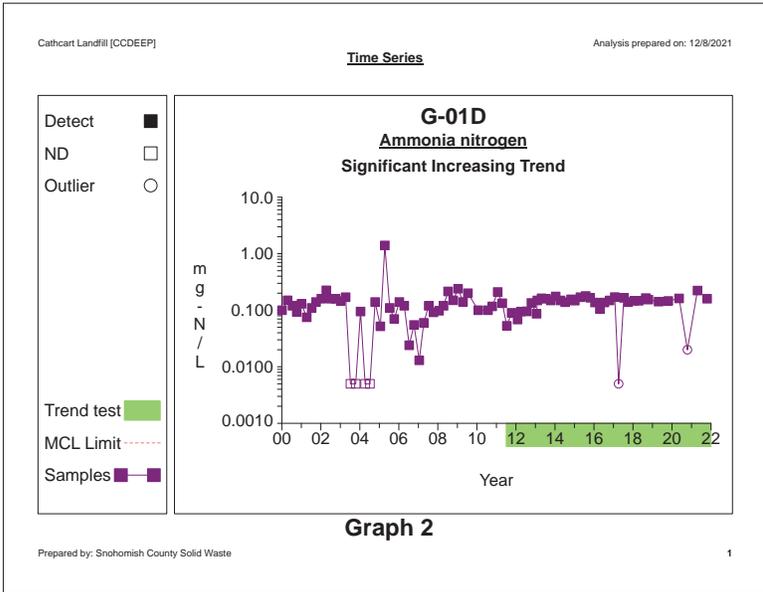

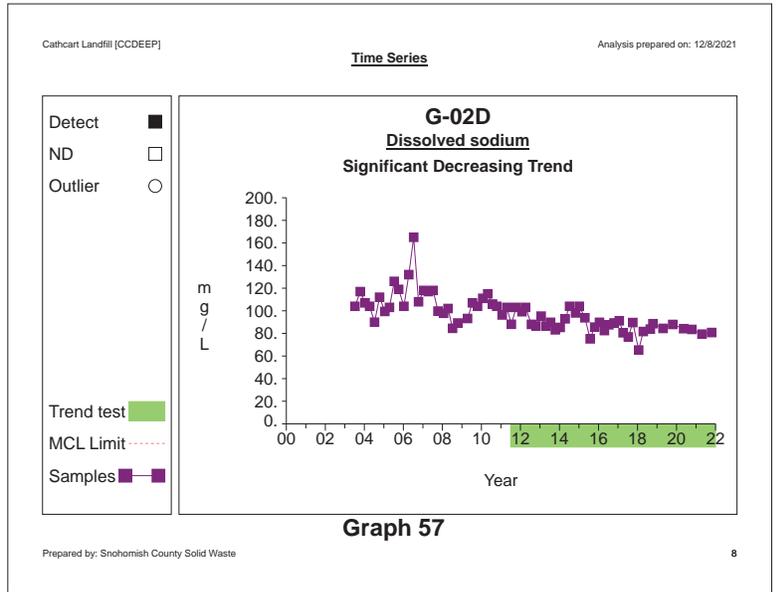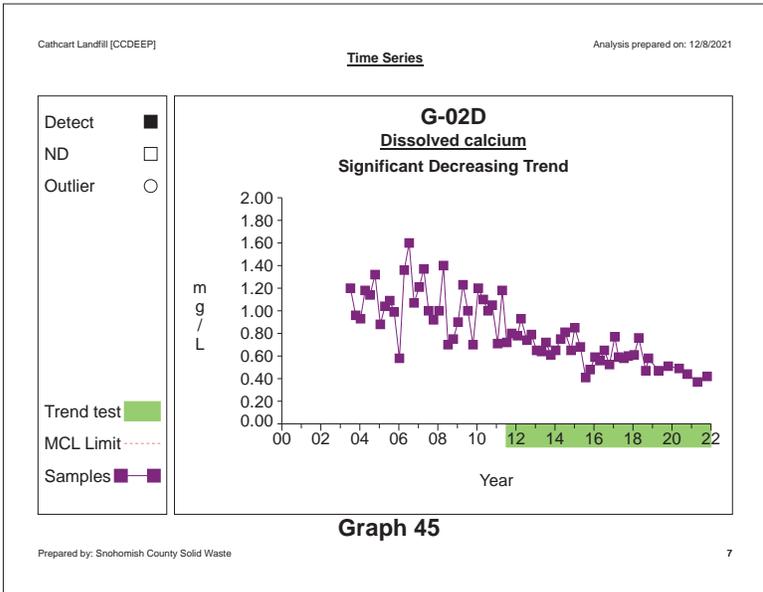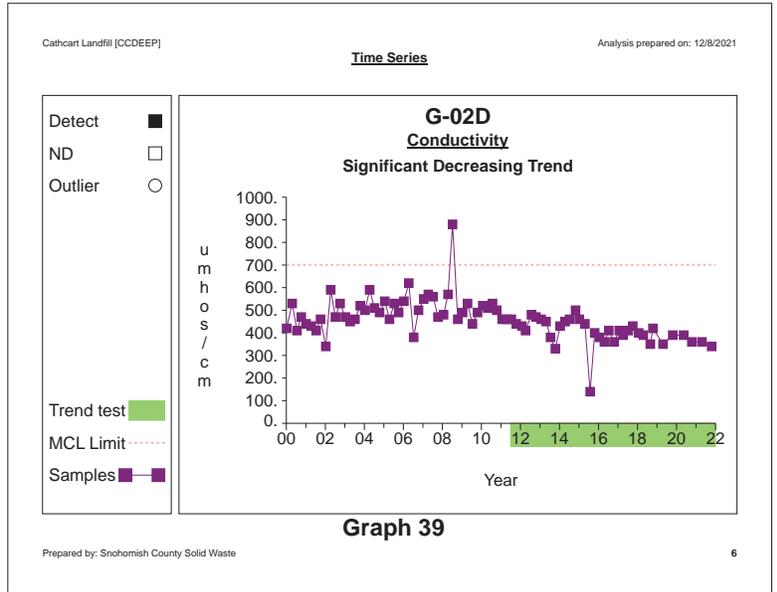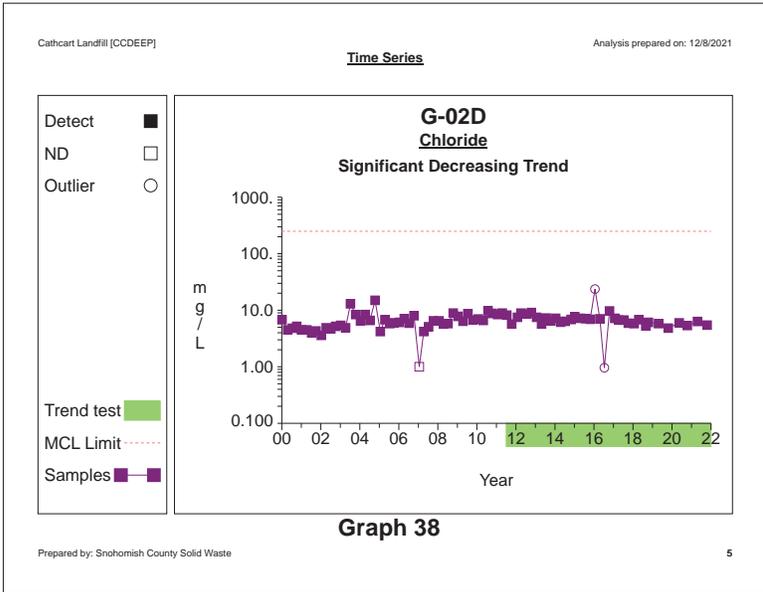


Time Series

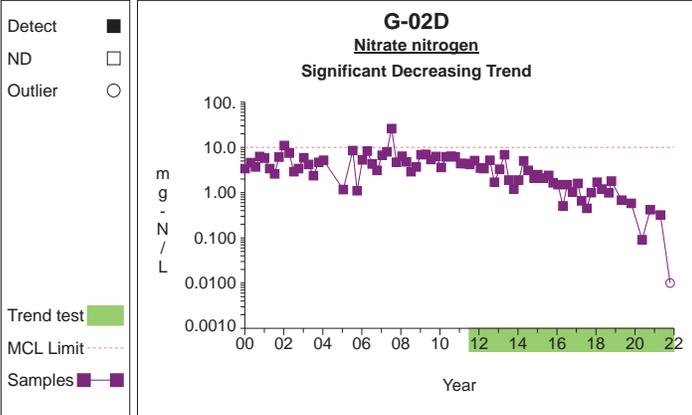


Graph 61

Time Series

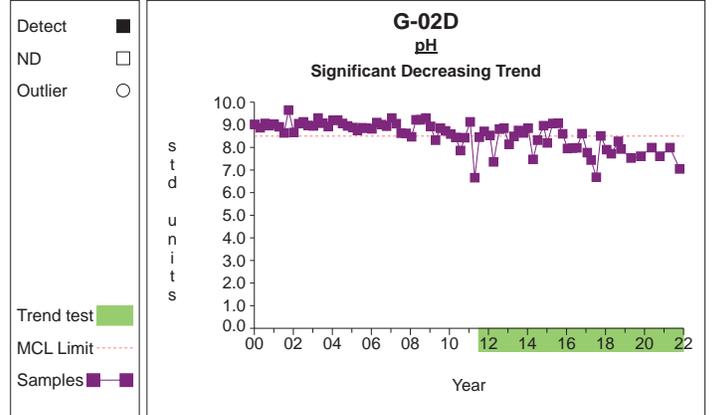


Graph 63

Time Series

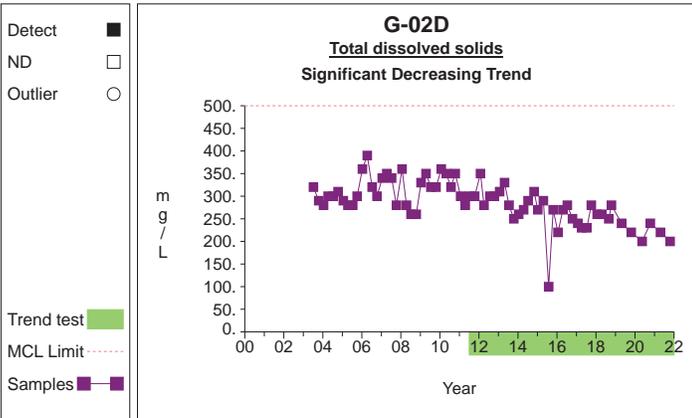

Graph 65


Time Series

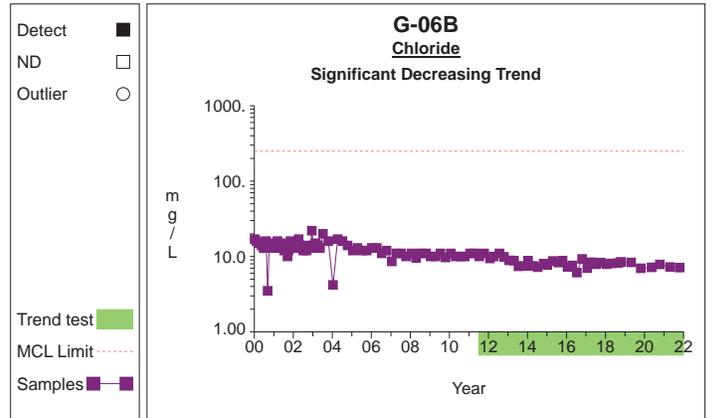

Graph 71

Time Series


- Detect
- ND
- Outlier

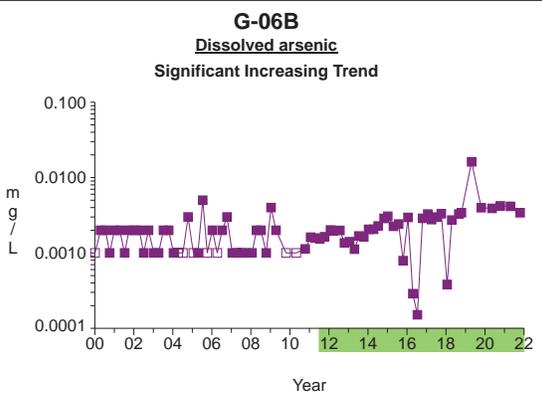

Graph 74

Time Series


- Detect
- ND
- Outlier

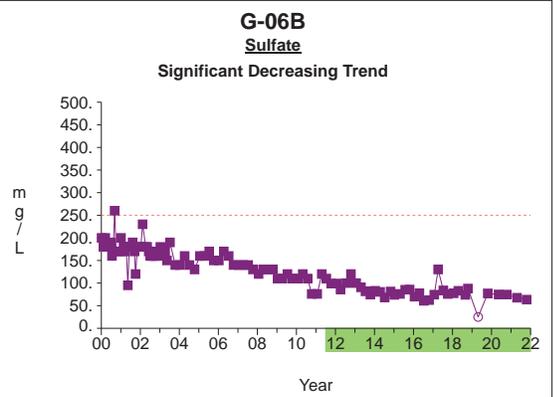

Graph 97

Time Series


- Detect
- ND
- Outlier

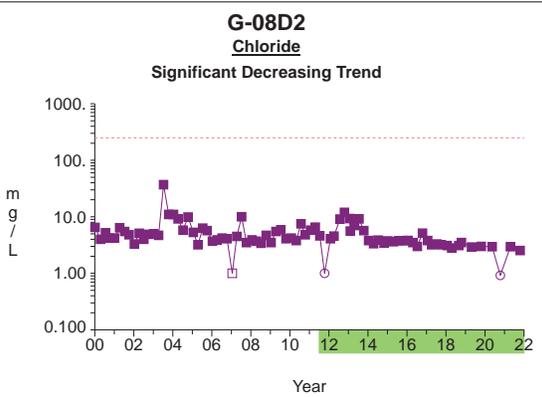

Graph 104


Time Series

- Detect
- ND
- Outlier

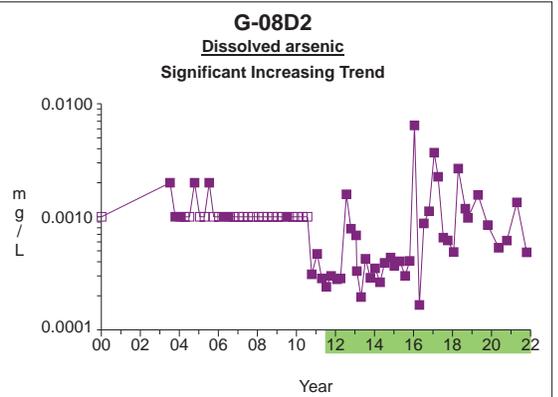


Graph 107

Time Series

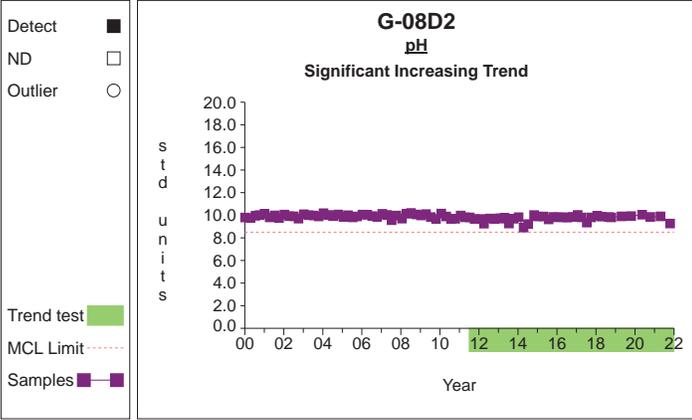


Graph 129

Time Series

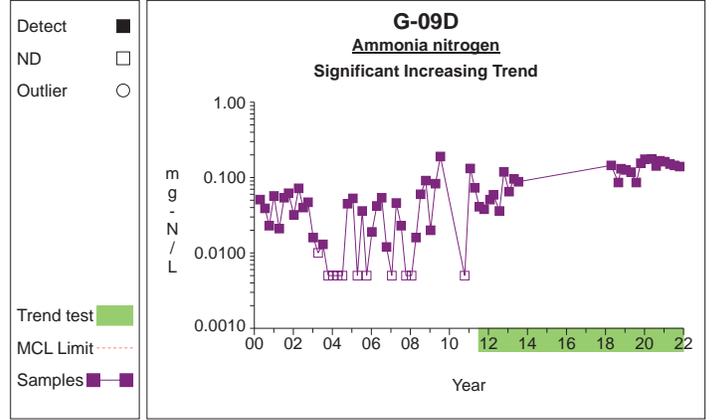


Graph 134

Time Series

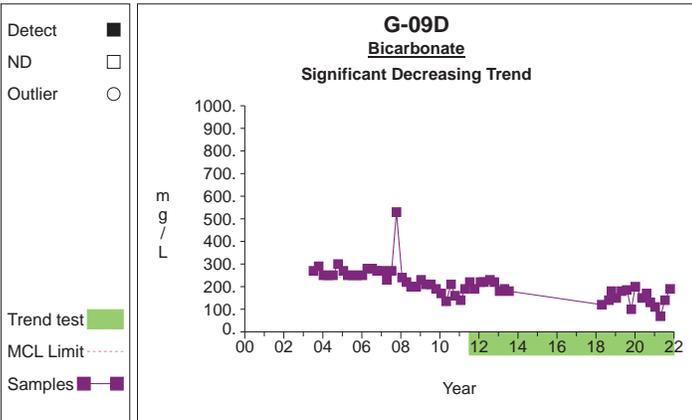


Graph 135

Time Series

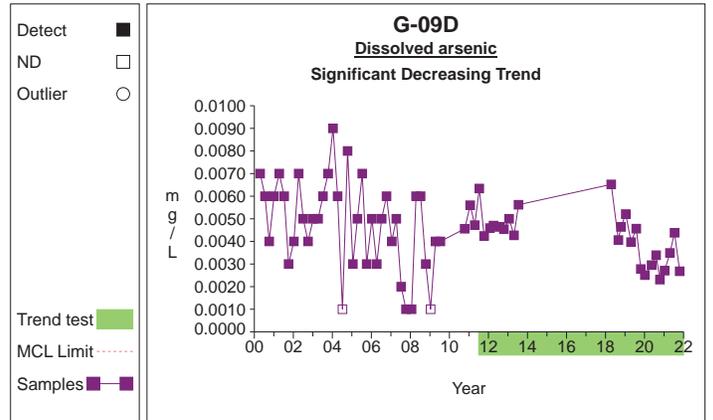


Graph 140

Time Series

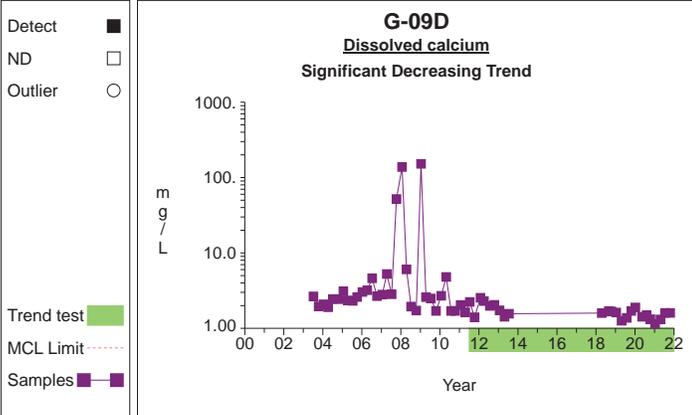


Graph 144

Time Series

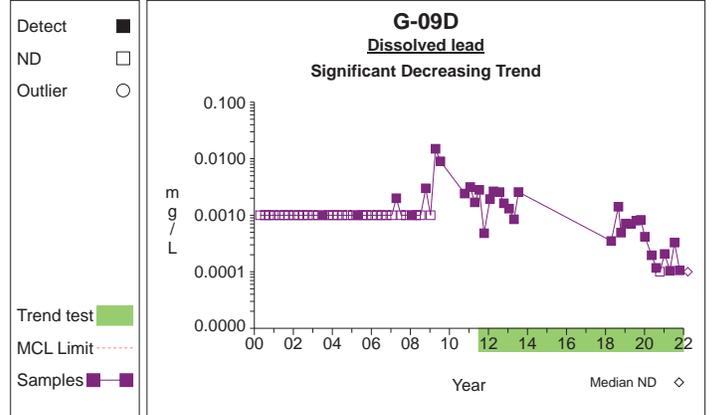


Graph 149

Time Series

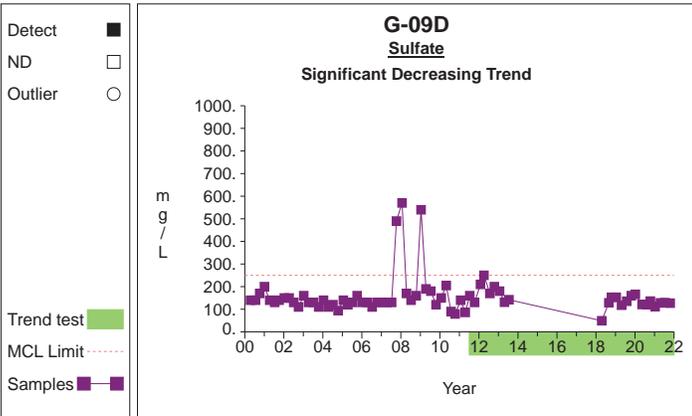

Graph 163


Time Series

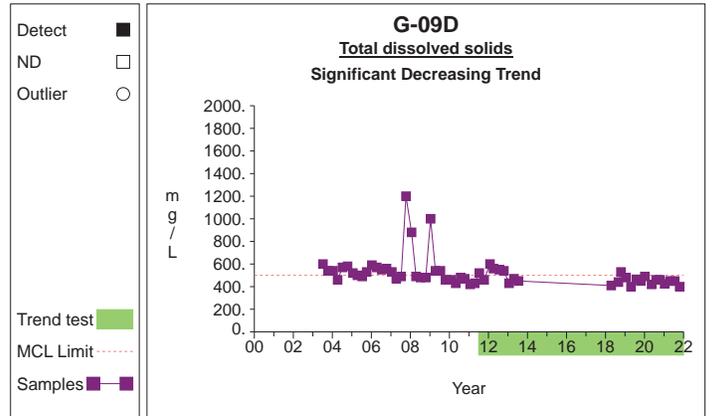

Graph 164

Time Series


- Detect
- ND
- Outlier

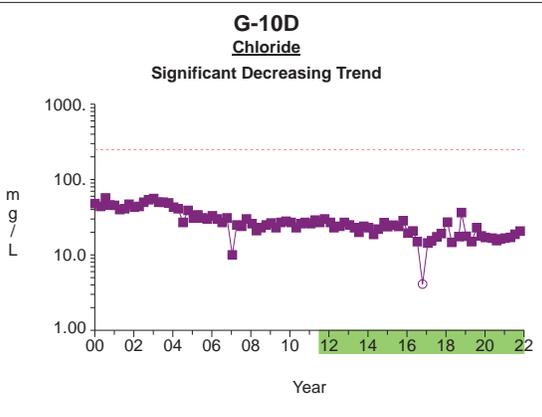

Graph 170

Time Series


- Detect
- ND
- Outlier

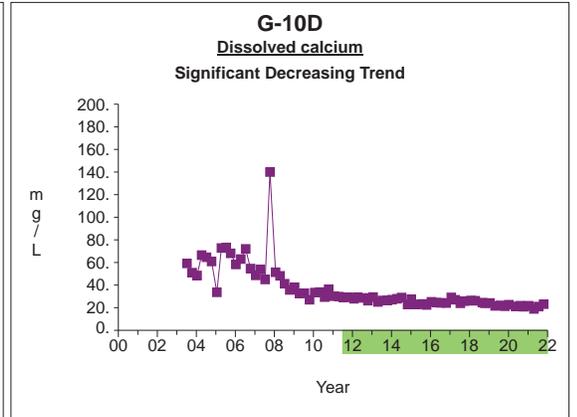

Graph 177

Time Series


- Detect
- ND
- Outlier

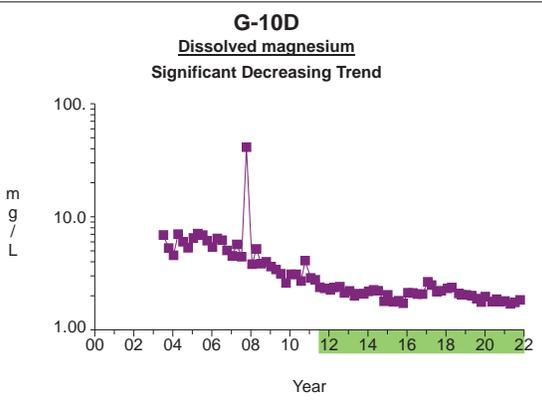

Graph 183


Time Series

- Detect
- ND
- Outlier

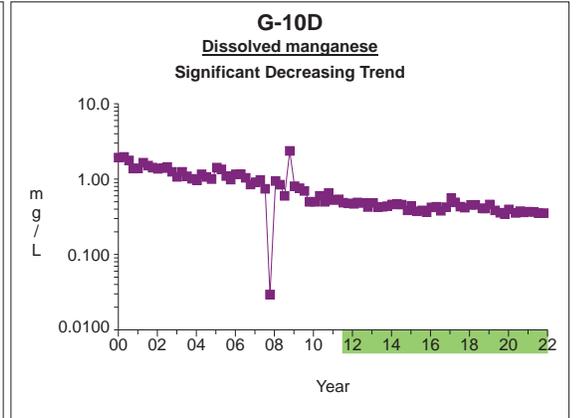


Graph 184

Time Series

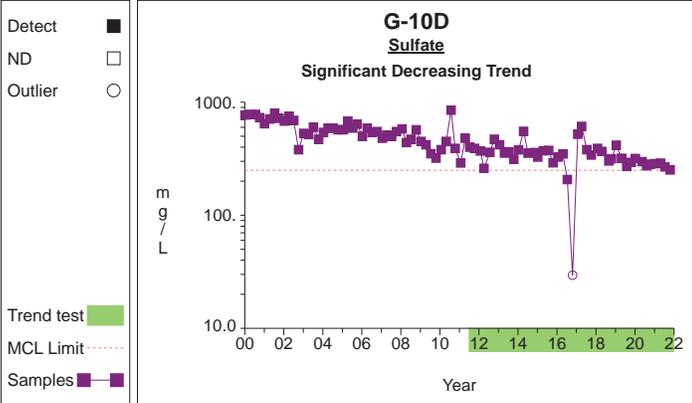


Graph 196

Time Series

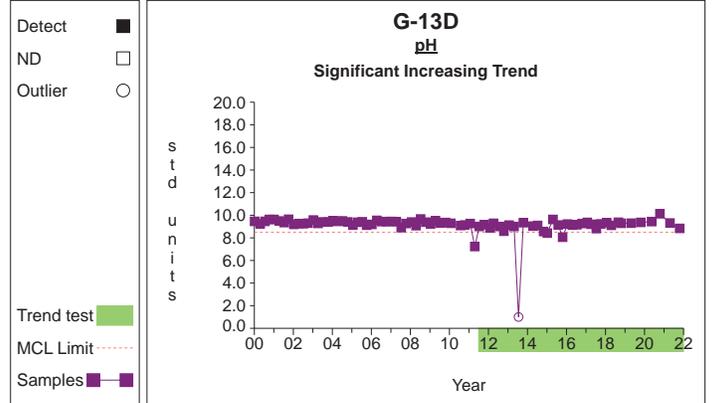


Graph 228

Time Series

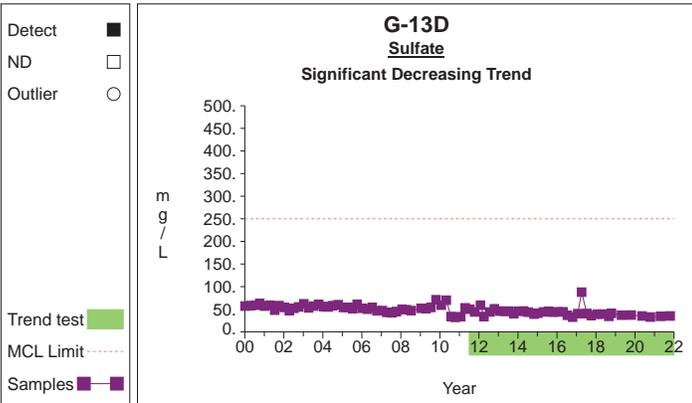


Graph 229

Time Series

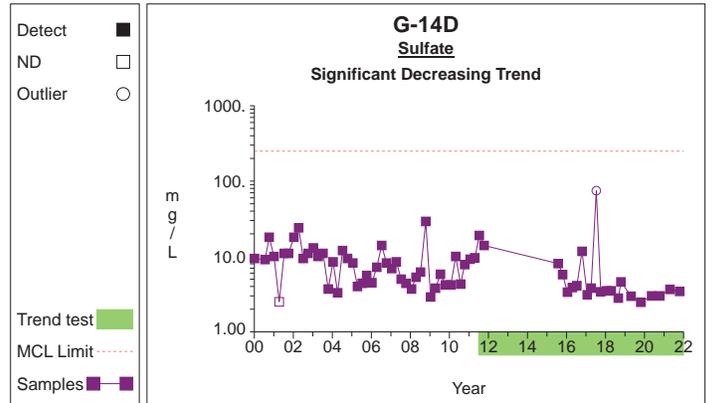


Graph 262

Time Series

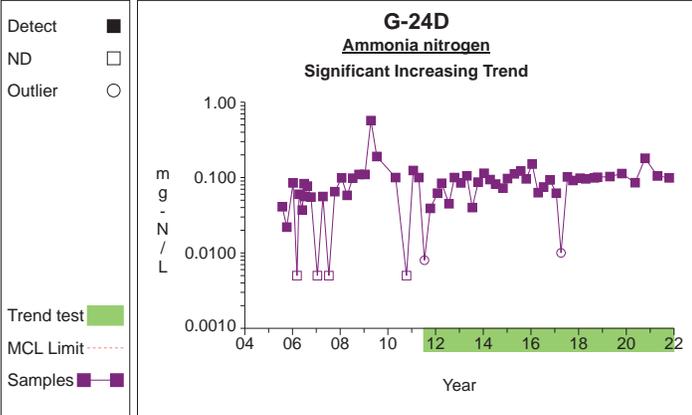

Graph 266


Time Series

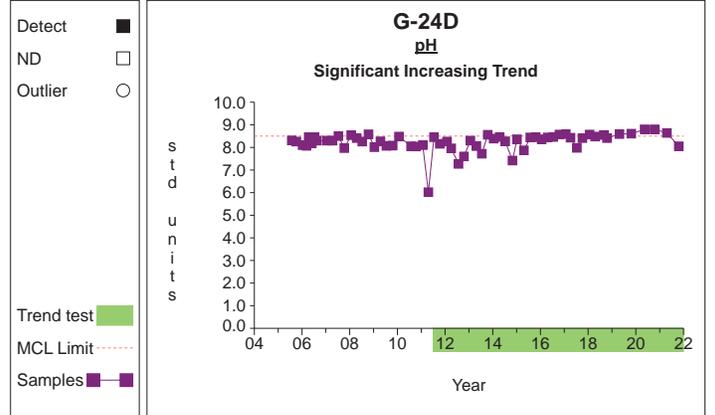

Graph 294


Cathcart Landfill

Time Series Plot for G-01D

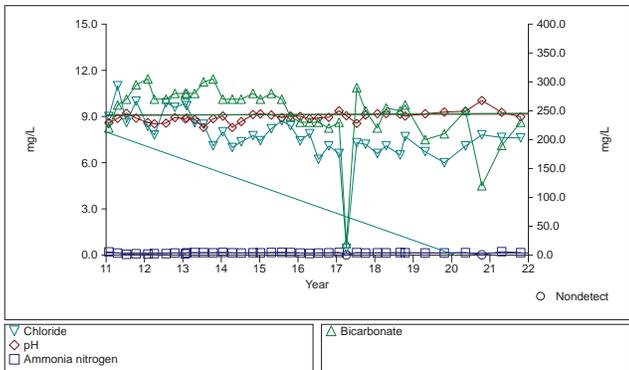


Cathcart Landfill

Time Series Plot for G-02D

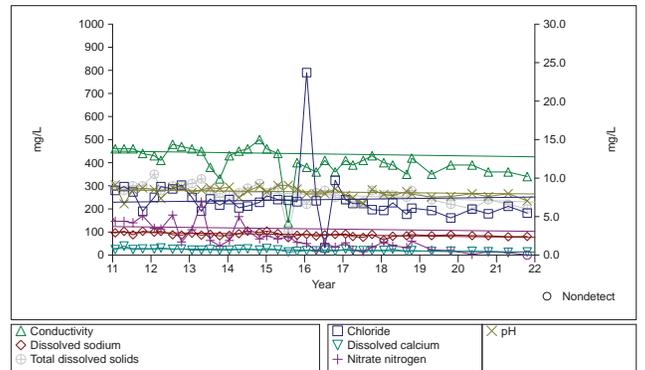


Cathcart Landfill

Time Series Plot for G-06B

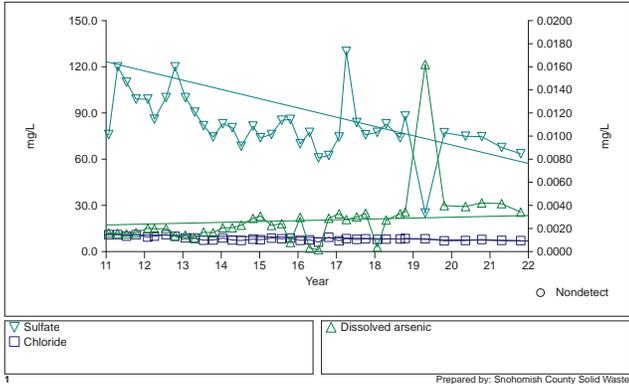


Cathcart Landfill

Time Series Plot for G-08D2

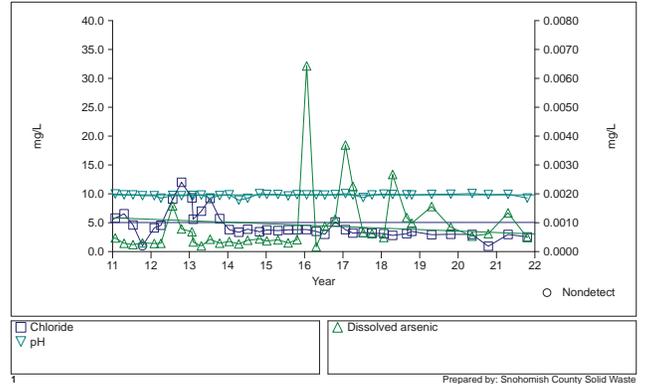


Cathcart Landfill

Time Series Plot for G-09D

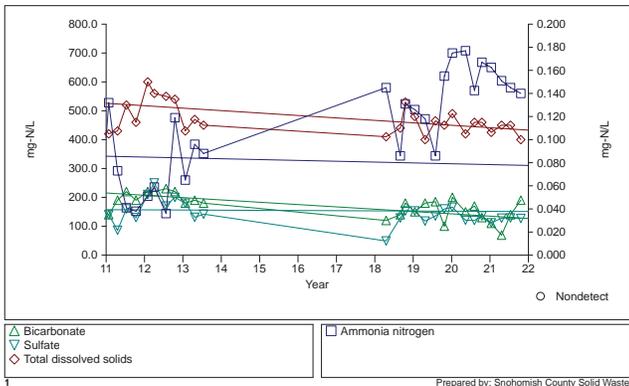


Cathcart Landfill

Time Series Plot for G-09D

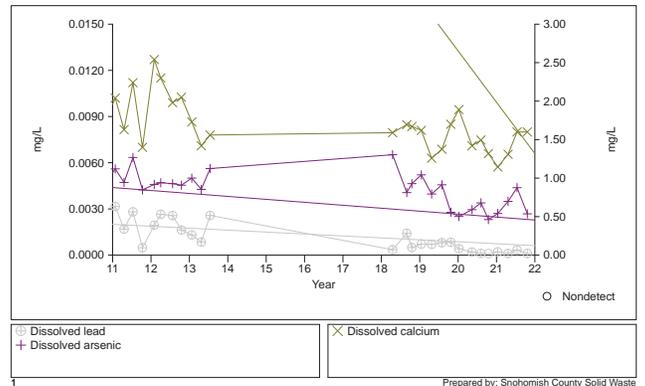


Cathcart Landfill

Time Series Plot for G-10D

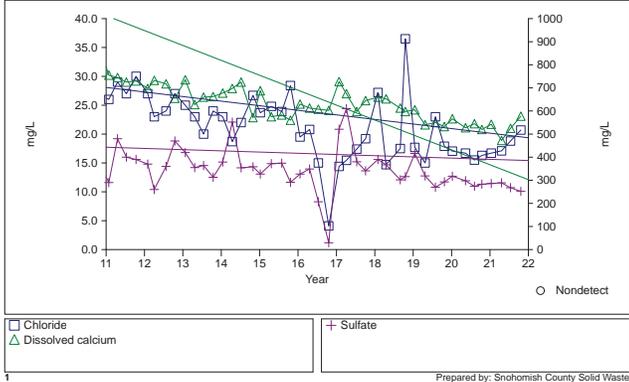


Cathcart Landfill

Time Series Plot for G-13D

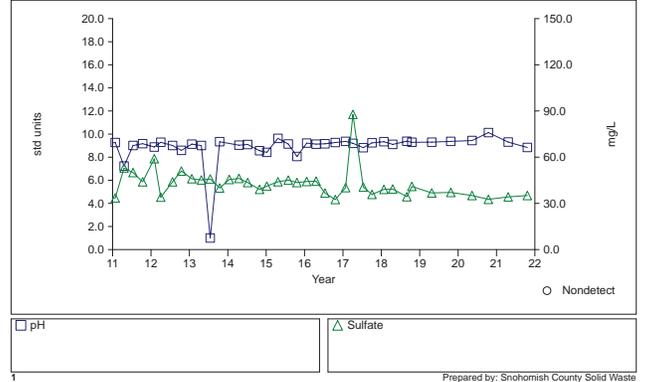


Cathcart Landfill

Time Series Plot for G-14D

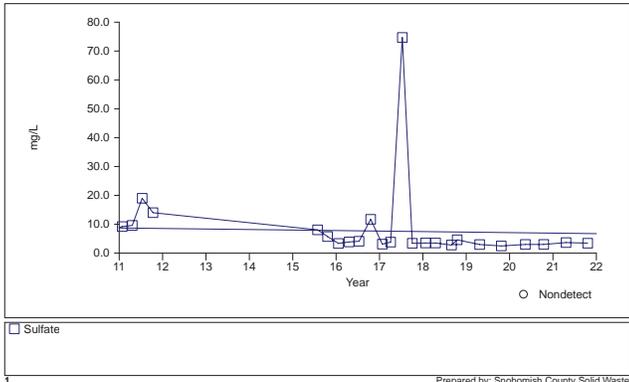

Cathcart Landfill

Time Series Plot for G-24D

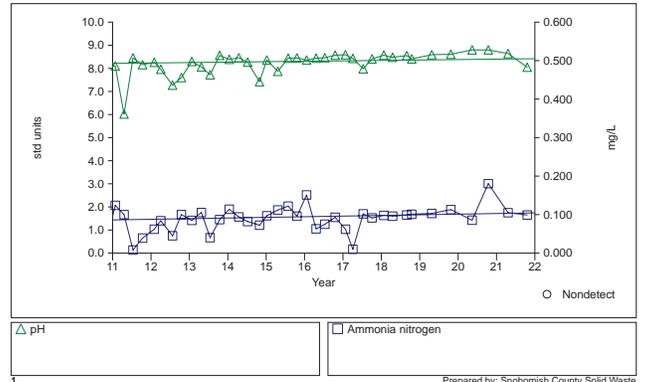

Appendix D

Field Monitoring Forms

- **Groundwater Monitoring**
- **Quarterly Landfill Gas Monitoring**
- **Monthly Vault Inspections**

Groundwater Monitoring Forms



Sample Number: 21405 **Conditions:** Precip - rain
Date: 1/12/2021 **Site:** Cathcart
Time: 11:40 **Location:** G-09S

Well Information:

Well Depth: 51.5 ft **Water Depth:** 29.15 ft

Surface Measurements:

Flow Rate: **Measure Method:** [Undefined]

Field Chemistry Tests:

Purge Volume: 3.58 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.43	995	13.6	Clear	Very Fine				

Sampling:

Sample Depth: 51.5 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:50

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after first purge.

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Trina Arnold



Sample Number: 21404 **Conditions:** Precip - rain
Date: 1/12/2021 **Site:** Cathcart
Time: 11:30 **Location:** G-09D

Well Information:

Well Depth: **Water Depth:**

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume:

Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
------	----	------	------	-------	-----------	-----------	-------------	-----	------

Sampling:

Sample Depth: 81 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:45

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Split sample. See field data on 21403.

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Matt Lawless



Sample Number: 21403 **Conditions:** Precip - rain
Date: 1/12/2021 **Site:** Cathcart
Time: 11:30 **Location:** G-09D

Well Information:

Well Depth: 81 ft **Water Depth:** 50.38 ft

Surface Measurements:

Flow Rate: **Measure Method:** [Undefined]

Field Chemistry Tests:

Purge Volume: 4.9 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	9.05	742	13.1	Clear	Fine				
Test 2	Grab	9.35	717	13.6	Clear	Fine				

Sampling:

Sample Depth: 81 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:45

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Split sample with 21404. Dry after second purge.

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Trina Arnold



Sample Number: 21402 **Conditions:** Precip - rain
Date: 1/12/2021 **Site:** Cathcart
Time: 10:55 **Location:** G-10S

Well Information:

Well Depth: 44 ft **Water Depth:** 21.64 ft

Surface Measurements:

Flow Rate: **Measure Method:** [Undefined]

Field Chemistry Tests:

Purge Volume: 3.58 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.71	1451	12.4	Clear	Very Fine				
Test 2	Grab	6.77	1427	12.6	Clear	Very Fine				
Test 3	Grab	6.7	1422	12.7	Clear	Very Fine				

Sampling:

Sample Depth: 22.63 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:05

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Trina Arnold



Sample Number: 21401 **Conditions:** Precip - rain
Date: 1/12/2021 **Site:** Cathcart
Time: 10:45 **Location:** G-10D

Well Information:

Well Depth: 82 ft **Water Depth:** 29.71 ft

Surface Measurements:

Flow Rate: **Measure Method:** [Undefined]

Field Chemistry Tests:

Purge Volume: 8.37 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	7.11	1561	12.2	Clear	Very Fine				

Sampling:

Sample Depth: 34.2 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Trina Arnold



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21501 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 10:08 **Location:** G-04A

Well information:

WellDepth: 20 **Water Depth:**

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol:

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0										
Test 1										
Test 2										

Sampling:

SampDepth: **Sample Type:**

SampTime:

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1					
Bottle 2					
Bottle 3					
Bottle 4					
Bottle 5					
Bottle 6					
Bottle 7					
Bottle 8					
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Not enough water to sample.

NumbBot: 0

Witness: Trina Arnold

Signature: Scott Wells



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21500 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 9:50 **Location:** G-13D

Well information:

WellDepth: 44.9 **Water Depth:** 11.04

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 5.42

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	9.35	447	11.5	Clear	Fine				
Test 1	Grab	9.34	446	11.2	Clear	Medium				
Test 2	Grab	9.31	445	11.2	Clear	Medium				

Sampling:

SampDepth: 16.04 **Sample Type:** Standard Ground - Water

SampTime: 10:05

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes:

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Sample Number: 21499 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 9:30 **Location:** G-11S

Well information:

WellDepth: 41.2 **Water Depth:** 20.94

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 3.24

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	6.64	185	12.1	Clear	Very Fine				
Test 1	Grab	6.85	207	11.8	Clear	Very Fine				
Test 2										

Sampling:

SampDepth: 41.2 **Sample Type:** Standard Ground - Water
SampTime: 9:45

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after second purge.

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Sample Number: 21498 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 9:00 **Location:** G-01D

Well information:

WellDepth: 67.2 **Water Depth:** 24.58

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 6.82

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	9.4	569	12.4	Clear	Fine				
Test 1	Grab	9.4	571	11.6	Clear	Medium				
Test 2	Grab	9.27	651	11.5	Clear	Heavy				

Sampling:

SampDepth: 45.01 **Sample Type:** Standard Ground - Water

SampTime: 9:15

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes:

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21497 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 8:56 **Location:** G-01A

Well information:

WellDepth: 15.65 **Water Depth:** 10.17

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 0.88

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	6.36	124	10.7	Clear	Very Fine				
Test 1	Grab	6.34	122	11.5	Clear	Very Fine				
Test 2										

Sampling:

SampDepth: 15.65 **Sample Type:** Standard Ground - Water
SampTime: 10:15

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after second purge.

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21496 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 8:33 **Location:** G-06B

Well information:

WellDepth: 88 **Water Depth:** 36.09

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 8.31

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	7.76	407	12.9	Clear	Very Fine				
Test 1	Grab	8.35	658	12.3	Clear	Very Fine				
Test 2										

Sampling:

SampDepth: 88 **Sample Type:** Standard Ground - Water
SampTime: 8:50

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after second purge.

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21495 **Conditions:** Sunny
Date: 4/21/2021 **Site:** Cathcart
Time: 8:15 **Location:** G-02D

Well information:

WellDepth: 56.5 **Water Depth:** 29.24

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 4.36

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	7.99	361	11.8	Clear	Fine				
Test 1										
Test 2										

Sampling:

SampDepth: 56.5 **Sample Type:** Standard Ground - Water
SampTime: 8:30

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after first purge.

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Snohomish County Solid Waste
Environmental Services Section
8915 Cathcart Way
Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21494 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 12:00 **Location:** G-08D1

Well information:

WellDepth: 56.4 **Water Depth:** 23.72

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 5.23

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	9.06	428	12.7	Clear	Fine				
Test 1	Grab	9.47	442	11.7	Clear	Fine				
Test 2	Grab	9.59	436	11.4	Clear	Medium				

Sampling:

SampDepth: 56.4 **Sample Type:** Standard Ground - Water

SampTime: 12:10

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after 4 gal of 3rd purge.

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Sample Number: 21493 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 11:30 **Location:** G-08D2

Well information:

WellDepth: 112.5 **Water Depth:** 6.04

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 17.03

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	9.96	462	12.1	Clear	Medium				
Test 1	Grab	9.92	457	11.5	Clear	Medium				
Test 2	Grab	9.9	456	11.7	Clear	Medium				

Sampling:

SampDepth: 47.2 **Sample Type:** Standard Ground - Water

SampTime: 11:45

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes:

NumbBot: 8

Witness: Trina Arnold

Signature: Scott Wells



Snohomish County Solid Waste
Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21492 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 11:10 **Location:** G-10S

Well information:

WellDepth: 44 **Water Depth:** 23.34

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 3.31

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	6.51	1383	14.7	Clear	Very Fine				
Test 1	Grab	6.65	1409	13.2	Clear	Very Fine				
Test 2	Grab	6.62	1409	13.1	Clear	Very Fine				

Sampling:

SampDepth: 24.36 **Sample Type:** Standard Ground - Water

SampTime: 11:20

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes:

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Snohomish County Solid Waste
Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21491 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 11:05 **Location:** G-10D

Well information:

WellDepth: 82 **Water Depth:** 30.82

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 8.19

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	7.34	1548	14.3	Clear	Very Fine				
Test 1										
Test 2										

Sampling:

SampDepth: 34.97 **Sample Type:** Standard Ground - Water
SampTime: 11:40

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes:

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Sample Number: 21490 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 10:50 **Location:** G-09S

Well information:

WellDepth: 51.5 **Water Depth:** 29.9

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 3.46

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	6.27	950	14.2	Clear	Very Fine				
Test 1	Grab	6.42	966	14.3	Clear	Very Fine				
Test 2										

Sampling:

SampDepth: 51.5 **Sample Type:** Standard Ground - Water

SampTime: 11:00

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after second purge.

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Snohomish County Solid Waste
Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21489 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 10:40 **Location:** G-09D

Well information:

WellDepth: 81 **Water Depth:** 51.91

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 4.65

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	8.58	699	14.9	Clear	Fine				
Test 1										
Test 2										

Sampling:

SampDepth: 81 **Sample Type:** Standard Ground - Water
SampTime: 10:55

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after first purge.

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Snohomish County Solid Waste
Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21488 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 10:20 **Location:** G-14S

Well information:

WellDepth: 68.5 **Water Depth:** 9.41

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 9.45

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	9.3	364	11.6	Clear	Very Fine				
Test 1	Grab	9.25	366	11.2	Clear	Very Fine				
Test 2										

Sampling:

SampDepth: 68.5 **Sample Type:** Standard Ground - Water
SampTime: 10:40

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry 1 gallon second purge.

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21487 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 10:05 **Location:** G-14D

Well information:

WellDepth: 110 **Water Depth:** 30.63

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 12.70

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0										
Test 1										
Test 2										

Sampling:

SampDepth: 110 **Sample Type:** Standard Ground - Water
SampTime: 10:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Split sample. See field data on 21486. Dry after 11 gal of second purge

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Sample Number: 21486 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 10:05 **Location:** G-14D

Well information:

WellDepth: 110 **Water Depth:** 30.63

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 12.70

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	9.42	465	12.1	Clear	Medium				
Test 1	Grab	9.72	471	11.9	Clear	Heavy				
Test 2										

Sampling:

SampDepth: 110 **Sample Type:** Standard Ground - Water
SampTime: 10:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Split sample with 21487. Dry after 11 gal. of second purge.

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Snohomish County Solid Waste
Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21485 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 9:50 **Location:** G-24S

Well information:

WellDepth: 26.5 **Water Depth:** 13.7

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 2.05

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	7.24	418	12.4	Clear	Very Fine				
Test 1	Grab	7.34	429	11.2	Clear	Very Fine				
Test 2										

Sampling:

SampDepth: 23.47 **Sample Type:** Standard Ground - Water
SampTime: 13:30

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes: Dry after second purge.

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Snohomish County Solid Waste
 Environmental Services Section
 8915 Cathcart Way
 Snohomish, WA 98296

Field Sampling Data

Tel: (360) 668-6595

Sample Number: 21484 **Conditions:** Sunny
Date: 4/20/2021 **Site:** Cathcart
Time: 9:20 **Location:** G-24D

Well information:

WellDepth: 85 **Water Depth:** 18.1

Surface Measurements:

FlowRate: **Measure Meth:**

Field Chemistry Tests:

PurgeVol: 10.70

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 0	Grab	8.45	500	12.7	Clear	Very Fine				
Test 1	Grab	8.69	503	12.1	Clear	Very Fine				
Test 2	Grab	8.64	496	12.4	Clear	Very Fine				

Sampling:

SampDepth: 34.65 **Sample Type:** Standard Ground - Water

SampTime: 9:40

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL
Bottle 9					
Bottle 10					
Bottle 11					
Bottle 12					

Notes:

NumbBot: 8

Witness: Matt Lawless

Signature: Scott Wells



Sample Number: 21571 **Conditions:** Sunny
Date: 7/14/2021 **Site:** Cathcart
Time: 10:00 **Location:** G-10D

Well Information:

Well Depth: 82 ft **Water Depth:** 31.52 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 8.08 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	7.3	1541	15.2	Clear	Fine				

Sampling:

Sample Depth: 35.96 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:40

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Scott Wells



Sample Number: 21570 **Conditions:** Sunny
Date: 7/14/2021 **Site:** Cathcart
Time: 10:15 **Location:** G-10S

Well Information:

Well Depth: **Water Depth:**

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume:

Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
------	----	------	------	-------	-----------	-----------	-------------	-----	------

Sampling:

Sample Depth: 44 ft **Sample Type:** Standard Ground - Water
Sample Time: 10:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Split sample with 21569. See sheet 21569 for field chemistry.

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Scott Wells



Sample Number: 21569 **Conditions:** Sunny
Date: 7/14/2021 **Site:** Cathcart
Time: 10:15 **Location:** G-10S

Well Information:

Well Depth: 44 ft **Water Depth:** 23.95 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 3.21 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.32	1354	14.2	Clear	Fine				
Test 2	Grab	6.41	1403	13.2	Clear	Fine				
Test 3	Grab	6.51	1410	12.5	Clear	Fine				

Sampling:

Sample Depth: 44 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Split sample with 21570

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Scott Wells



Sample Number: 21568 **Conditions:** Sunny
Date: 7/14/2021 **Site:** Cathcart
Time: 10:00 **Location:** G-09S

Well Information:

Well Depth: 51.5 ft **Water Depth:** 31.29 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 3.23 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.01	930	16.6	Clear	Fine				
Test 2	Grab	6.15	962	14.9	Clear	Fine				

Sampling:

Sample Depth: 51.5 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:10

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Well is dry after 1/2 gallon into 2nd purge

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Scott Wells



Sample Number: 21567 **Conditions:** Sunny
Date: 7/14/2021 **Site:** Cathcart
Time: 09:45 **Location:** G-09D

Well Information:

Well Depth: 81 ft **Water Depth:** 53.68 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 4.37 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	8.73	694	15.8	Clear	Fine				

Sampling:

Sample Depth: 81 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:00

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Well is dry after 1 purge

Number of Bottles: 8

Operator/Witness: Matt Lawless

Sampler: Scott Wells



Sample Number: 21663 **Conditions:** Precip - rain
Date: 10/20/2021 **Site:** Cathcart
Time: 09:35 **Location:** G-13D

Well Information:

Well Depth: 44.9 ft **Water Depth:** 10.82 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 5.45 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	8.86	442	11.1	Clear	Fine				
Test 2	Grab	8.88	442	10.9	Clear	Fine				
Test 3	Grab	8.84	441	10.8	Clear	Fine				

Sampling:

Sample Depth: 15.75 ft **Sample Type:** Standard Ground - Water

Sample Time: 09:55

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Matt Lawless



Sample Number: 21662 **Conditions:** Precip - rain
Date: 10/20/2021 **Site:** Cathcart
Time: 09:05 **Location:** G-10D

Well Information:

Well Depth: 82 ft **Water Depth:** 30.4 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 8.26 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.83	1521	12.7	Clear	Very Fine				

Sampling:

Sample Depth: 36.01 ft **Sample Type:** Standard Ground - Water

Sample Time: 09:55

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Matt Lawless



Sample Number: 21661 **Conditions:** Precip - rain
Date: 10/20/2021 **Site:** Cathcart
Time: 09:05 **Location:** G-10S

Well Information:

Well Depth: 44 ft **Water Depth:** 22.62 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 3.42 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.37	1408	12.5	Clear	Very Fine				

Sampling:

Sample Depth: 44 ft **Sample Type:** Standard Ground - Water

Sample Time: 09:20

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after first purge.

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Matt Lawless



Sample Number: 21660 **Conditions:** Precip - rain
Date: 10/20/2021 **Site:** Cathcart
Time: 08:40 **Location:** G-09D

Well Information:

Well Depth: 81 ft **Water Depth:** 54.8 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 4.19 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	8.69	7.03	13.8	Clear	Fine				
Test 2	Grab	8.97	714	13.6	Clear	Fine				

Sampling:

Sample Depth: 81 ft **Sample Type:** Standard Ground - Water

Sample Time: 08:55

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry one gallon into second purge

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Matt Lawless



Sample Number: 21659 **Conditions:** Precip - rain
Date: 10/20/2021 **Site:** Cathcart
Time: 08:30 **Location:** G-09S

Well Information:

Well Depth: 51.5 ft **Water Depth:** 32.51 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 3.04 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.06	972	13.7	Clear	Very Fine				

Sampling:

Sample Depth: 51.5 ft **Sample Type:** Standard Ground - Water

Sample Time: 09:00

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after first purge.

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Matt Lawless



Sample Number: 21658 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 01:35 **Location:** G-06B

Well Information:

Well Depth: 88 ft **Water Depth:** 34.03 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 8.64 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	7.52	640	13.2	Clear	Very Fine				
Test 2	Grab	7.67	686	12.8	Clear	Very Fine				

Sampling:

Sample Depth: 88 ft **Sample Type:** Standard Ground - Water

Sample Time: 01:50

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after second purge

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21657 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 01:00 **Location:** G-01A

Well Information:

Well Depth: 15.65 ft **Water Depth:** 7.11 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 1.37 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	5.3	156	13.4	Clear	Very Fine				
Test 2	Grab	5.52	173	13.3	Clear	Very Fine				
Test 3	Grab	5.58	180	13.1	Clear	Very Fine				

Sampling:

Sample Depth: 14.6 ft **Sample Type:** Standard Ground - Water

Sample Time: 01:20

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL
Bottle 8	Grab	P-pump	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21656 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 01:00 **Location:** G-01D

Well Information:

Well Depth: 67.2 ft **Water Depth:** 23.2 ft

Surface Measurements:

Flow Rate: 0 **Measure Method:**

Field Chemistry Tests:

Purge Volume: 7.04 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	9.06	569	11.8	Clear	Medium				
Test 2	Grab	9.02	570	11.7	Clear	Medium				
Test 3	Grab	8.98	571	11.5	Clear	Medium				

Sampling:

Sample Depth: 45.25 ft **Sample Type:** Standard Ground - Water

Sample Time: 01:15

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21655 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 12:45 **Location:** G-04A

Well Information:

Well Depth: **Water Depth:**

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume:

Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
------	----	------	------	-------	-----------	-----------	-------------	-----	------

Sampling:

Sample Depth: **Sample Type:**

Sample Time:

Sample Type	Sample Method	Volume	Bottle Type	Preservative
-------------	---------------	--------	-------------	--------------

Notes: No water to sample

Number of Bottles:

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21654 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 11:25 **Location:** G-11S

Well Information:

Well Depth: 41.2 ft **Water Depth:** 18.55 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 3.62 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	5.88	270	11.3	Clear	Very Fine				
Test 2	Grab	6.14	263	11.2	Clear	Very Fine				
Test 3	Grab	6.26	271	11.2	Clear	Very Fine				

Sampling:

Sample Depth: 41.2 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:40

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry 1 gallon into third purge

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21653 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 11:15 **Location:** G-02D

Well Information:

Well Depth: 56.5 ft **Water Depth:** 31.33 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 4.03 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	7.05	338	10.4	Clear	Very Fine				

Sampling:

Sample Depth: 56.5 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after one purge.

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21652 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 11:00 **Location:** G-08D1

Well Information:

Well Depth: 56.4 ft **Water Depth:** 29.35 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 4.33 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	8.56	448	10.7	Clear	Very Fine				
Test 2	Grab	9.14	476	10.6	Clear	Medium				

Sampling:

Sample Depth: 56.4 ft **Sample Type:** Standard Ground - Water

Sample Time: 11:10

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21651 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 10:30 **Location:** G-08D2

Well Information:

Well Depth: 112.5 ft **Water Depth:** 9.47 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 16.48 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	9.23	476	10.8	Clear	Medium				
Test 2	Grab	9.28	468	10.6	Clear	Medium				
Test 3	Grab	9.27	464	10.6	Clear	Medium				

Sampling:

Sample Depth: 30.73 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:50

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Split Sample with 21650

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21650 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 10:30 **Location:** G-08D2

Well Information:

Well Depth: 112.5 ft **Water Depth:** 9.47 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 16.48 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	9.23	476	10.8	Clear	Medium				
Test 2	Grab	9.28	468	10.6	Clear	Medium				
Test 3	Grab	9.27	464	10.6	Clear	Medium				

Sampling:

Sample Depth: 30.73 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:50

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Split Sample with 21651

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21649 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 10:10 **Location:** G-14S

Well Information:

Well Depth: 68.5 ft **Water Depth:** 16.98 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 8.24 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	8.48	371	11.6	Clear	Very Fine				

Sampling:

Sample Depth: 68.5 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:25

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after first purge.

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21648 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 09:55 **Location:** G-14D

Well Information:

Well Depth: 110 ft **Water Depth:** 31.9 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 12.5 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	9.07	476	11.5	Clear	Very Fine				
Test 2	Grab	9.11	479	11.6	Lt Brown	Very Heavy				

Sampling:

Sample Depth: 110 ft **Sample Type:** Standard Ground - Water

Sample Time: 10:15

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after 11 gallons of second purge

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21647 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 09:40 **Location:** G-24S

Well Information:

Well Depth: 26.5 ft **Water Depth:** 14.66 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 1.89 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	6.47	415	11.5	Clear	Very Fine				
Test 2	Grab	6.75	434	11.3	Clear	Very Fine				

Sampling:

Sample Depth: 22.82 ft **Sample Type:** Standard Ground - Water

Sample Time: 12:55

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes: Dry after second purge.

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells



Sample Number: 21646 **Conditions:** Sunny
Date: 10/19/2021 **Site:** Cathcart
Time: 09:10 **Location:** G-24D

Well Information:

Well Depth: 85 ft **Water Depth:** 19.51 ft

Surface Measurements:

Flow Rate: **Measure Method:**

Field Chemistry Tests:

Purge Volume: 10.48 gallons

	Type	pH	Cond	Temp	Color	Turbidity	Purge Vol	Water Depth	ORP	Time
Test 1	Grab	7.93	516	11.8	Clear	Very Fine				
Test 2	Grab	8.07	510	11.4	Clear	Very Fine				
Test 3	Grab	8.05	508	11.2	Clear	Very Fine				

Sampling:

Sample Depth: 26.66 ft **Sample Type:** Standard Ground - Water

Sample Time: 09:20

	Sample Type	Sample Method	Volume	Bottle Type	Preservative
Bottle 1	Grab	Dedicator	1000	Clpl	None
Bottle 2	Grab	Dedicator	250	Clpl	HNO3R
Bottle 3	Grab	Dedicator	250	Clpl	H2SO4
Bottle 4	Grab	Dedicator	250	Clpl	HNO3
Bottle 5	Grab	Dedicator	40	Glass	HCL
Bottle 6	Grab	Dedicator	40	Glass	HCL
Bottle 7	Grab	Dedicator	40	Glass	HCL
Bottle 8	Grab	Dedicator	40	Glass	HCL

Notes:

Number of Bottles: 8

Operator/Witness: Trina Arnold

Sampler: Scott Wells

Landfill Gas Monitoring Forms

QUARTERLY GAS ROUND	
DATE:	03/19/21

Site	Location: Probe	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	GP-4	1410	0%	20%	0%		29.54	
	GP-5(1)	1450	0%	5%	15%		"	
	GP-5(2)	1450	0%	12%	5%		"	
	GP-1(1)	1420	0%	20%	0%		"	
	GP-1(2)	1420	0%	20%	0%		"	
	GP-2(1)	1445	0%	21%	0%		"	
	GP-2(2)	1445	0%	21%	0%		"	
	GP-3	1500	0%	21%	1%		"	
	GP-6	1455	0%	20%	0%		"	
	Main Man	1400	31%	8%	17%	260	"	
Site	Location: Barhole	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	BH-3	1415	0%	20%	0%		29.54	
	BH-4	1425	0%	21%	1%		"	
	BH-5	1430	0%	21%	0%		"	
	BH-6	1440	0%	21%	1%		"	
	BH-7	1445	0%	21%	1%		"	
	BH-8	1435	0%	21%	0%		"	
Site	Location: Structure	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	SP-4	1505	0%	21%	0%		29.54	
	C-FV-1	1505	0%	21%	0%		"	
	C-COV-2	1505	0%	21%	0%		"	
	C-VV-2	1506	0%	21%	0%		"	
	SP-1	1506	0%	21%	0%		"	
	C-VV-3	1506	0%	21%	0%		"	
	Grit Chamber	1506	0%	21%	0%		"	
	C-FV-2	1507	0%	21%	0%		"	
	C-VV-5	1507	0%	21%	0%		"	

Methane/Oxygen Meter Used =

Technician Name =

Page =

GEM 5000
ML
2 of 2

QUARTERLY GAS ROUND

DATE: 06/08/21

Site	Location: Probe	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	GP-4	1247	0%	21%	0%		29.56	
	GP-5(1)	1256	0%	21%	0%		"	
	GP-5(2)	1256	0%	21%	0%		"	
	GP-1(1)	1316	0%	21%	0%		"	
	GP-1(2)	1316	0%	21%	0%		"	
	GP-2(1)	1344	0%	21%	0%		"	
	GP-2(2)	1345	0%	14%	3%		"	
	GP-3	1445	0%	21%	0%		"	
	GP-6	1440	0%	21%	0%		"	
	Main Man	1240	30%	7%	16%	585	"	
Site	Location: Barhole	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	BH-3	1250	0%	21%	0%		29.56	
	BH-4	1253	0%	20%	1%		"	
	BH-5	1307	0%	21%	0%		"	
	BH-6	1310	0%	19%	2%		"	
	BH-7	1315	0%	20%	1%		"	
	BH-8	1309	0%	21%	0%		"	
Site	Location: Structure	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	SP-4	1346	0%	21%	0%		29.56	
	C-FV-1	1347	0%	21%	0%		"	
	C-COV-2	1348	0%	21%	0%		"	
	C-VV-2	1349	0%	21%	0%		"	
	SP-1	1350	0%	21%	0%		"	
	C-VV-3	1351	0%	21%	0%		"	
	Grit Chamber	1352	0%	21%	0%		"	
	C-FV-2	1353	0%	21%	0%		"	
	C-VV-5	1354	0%	21%	0%		"	

Methane/Oxygen Meter Used =

Technician Name =

Page =

GEM 5000

SW/ML

2 of 2

Site	Location: Probe	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	GP-4	1040	0%	21%	0%		29.72	
	GP-5(1)	1058	0%	21%	0%		"	
	GP-5(2)	1058	0%	21%	0%		"	
	GP-1(1)	1112	0%	21%	0%		"	
	GP-1(2)	1112	0%	21%	0%		"	
	GP-2(1)	1116	0%	21%	0%		"	
	GP-2(2)	1116	0%	21%	0%		"	
	GP-3	1130	0%	21%	0%		"	
	GP-6	1125	0%	21%	0%		"	
	Main Man	1135	26%	7%	17%	530	"	
Site	Location: Barhole	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	BH-3	1055	0%	21%	0%		29.72	
	BH-4	1057	0%	21%	0%		"	
	BH-5	1101	0%	21%	0%		"	
	BH-6	1105	0%	21%	0%		"	
	BH-7	1113	0%	21%	0%		"	
	BH-8	1109	0%	21%	0%		"	
Site	Location: Structure	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	SP-4	1118	0%	21%	0%		29.72	
	C-FV-1	1118	0%	21%	0%		"	
	C-COV-2	1118	0%	21%	0%		"	
	C-VV-2	1119	0%	21%	0%		"	
	SP-1	1119	0%	21%	0%		"	
	C-VV-3	1120	0%	21%	0%		"	
	Grit Chamber	1120	0%	21%	0%		"	
	C-FV-2	1121	0%	21%	0%		"	
	C-VV-5	1121	0%	21%	0%		"	

Methane/Oxygen Meter Used =

Technician Name =

Page =

GEM 5000

SW/ML

2 of 2

Site	Location: Probe	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	GP-4	0744	0%	21%	0%		29.64	
	GP-5(1)	0752	0%	20%	0%		"	
	GP-5(2)	0751	0%	21%	2%		"	
	GP-1(1)	0759	0%	21%	0%		"	
	GP-1(2)	0759	0%	21%	1%		"	
	GP-2(1)	0802	0%	20%	5%		"	
	GP-2(2)	0803	0%	18%	7%		"	
	GP-3	0815	0%	21%	1%		"	
	GP-6	0817	0%	21%	0%		"	
	Main Man	0825	19%	12%	12%	761	"	
Site	Location: Barhole	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	BH-3	0746	0%	20%	1%		29.64	
	BH-4	0750	0%	20%	1%		"	
	BH-5	0752	0%	21%	0%		"	
	BH-6	0756	0%	20%	1%		"	
	BH-7	0758	0%	21%	1%		"	
	BH-8	0754	0%	21%	0%		"	
Site	Location: Structure	Time (Military)	Methane (% VOL)	Oxygen (% VOL, % LEL, PPM)	Carbon Diox. (% VOL)	Velocity	Pressure	Comments
CATHCART	SP-4	0804	0%	21%	0%		29.64	
	C-FV-1	0805	0%	21%	0%		"	
	C-COV-2	0806	0%	21%	0%		"	
	C-VV-2	0807	0%	21%	0%		"	
	SP-1	0806	0%	21%	1%		"	
	C-VV-3	0808	0%	21%	0%		"	
	Grit Chamber	0807	0%	21%	1%		"	
	C-FV-2	0808	0%	21%	0%		"	
	C-VV-5	0809	0%	21%	0%		"	

Methane/Oxygen Meter Used =

Technician Name =

Page =

GEM 5000

SW/ML

2 of 2

Monthly Vault Inspection Forms

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: January 20, 2021

INSPECTOR(S): TA

LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	?	No	NONE	—	—	How should we label this It is the flash mixer?
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	3'-4'	NO	YES	—	-----	Needs Vactoring
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	

COMMENTS:

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: February 23, 2021		INSPECTOR(S):		TA			
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	Over Pipes	NO	YES	—	-----	Needs Vactoring
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: March 22, 2021

INSPECTOR(S): TA

LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	Over Pipes	NO	YES	—	-----	Needs Vactoring
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	

COMMENTS:

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: April 28, 2021		INSPECTOR(S): TA					
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	Over Pipes	NO	YES	—	-----	Needs Vactoring
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

**LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:**

DATE: May 17, 2021		INSPECTOR(S): TA					
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	0"	NO	NONE	—	-----	
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: June 29, 2021		INSPECTOR(S):		TA		COMMENTS:	
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	
			ODORS	DEFECTS			
FD-1	Flow Distribution	Empty	No	NONE	—	—	PVV-10 is closed
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	?	NO	NONE	—	-----	Half-way past the bottom Wheel crank
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

**LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:**

DATE: July 21, 2021		INSPECTOR(S):		TA		COMMENTS:	
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	
			ODORS	DEFECTS			
FD-1	Flow Distribution	Empty	No	NONE	—	—	PVV-10 is closed.
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	?'	NO	NONE	—	-----	Half-way past the bottom Wheel crank
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: August 24, 2021		INSPECTOR(S):		TA			
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Empty	No	NONE	—	—	PVV-10 is closed.
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	?'	NO	NONE	—	-----	Half-way past the bottom Wheel crank
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

**LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:**

DATE: September 28, 2021		INSPECTOR(S):		TA		COMMENTS:	
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	P-VV-10 open
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~15"	NO	NONE	—	-----	
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	10"	NO	NONE	—	-----	
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

**LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:**

DATE: October 27, 2021

INSPECTOR(S): ML

LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	P-VV-10 open
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~5'	NO	NONE	—	-----	Vault level appears higher. Need to investigate for potential blockage or other problem
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	10"	NO	NONE	—	-----	
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	

COMMENTS:

LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:

DATE: November 29, 2021		INSPECTOR(S): TA					COMMENTS:
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	P-VV-10 open
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (Inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~5'	NO	NONE	—	-----	Vault level appears higher. Need to investigate for potential blockage or other problem
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	?'	NO	NONE	—	-----	Above half of Valve on bottom pipe.
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							

**LEACHATE PRETREATMENT FACILITY
CLARIFIER LEVEL
MONTHLY INSPECTION:**

DATE: December 29, 2021		INSPECTOR(S): ML					
LOCATION:	CONFINED SPACE (TYPE)	FLUID DEPTH (INCHES)	CONDITION:		SUMP PUMP?	SUMP PUMP WORKING?	COMMENTS:
			ODORS	DEFECTS			
FD-1	Flow Distribution	Full	No	NONE	—	—	P-VV-10 open
P-BV-1	BLOWER VAULT	0"	NO	NONE	—	-----	
P-FV-2	FLOW METER VAULT	0"	NO	NONE	YES	YES	
P-MH-3	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-4	MAN HOLE	0"	NO	NONE	YES	YES	
P-MH-5	MAN HOLE	—	—	—	—	—	Sludge Storage - Leak Detection
P-MH-6	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-7	MAN HOLE	—	—	—	—	—	Clarifier - Leak Detection
P-MH-8	MAN HOLE	0-1 Sediment	NO	NONE	—	—	Overflow to SP 7- (inspect twice a year March & Aug)
P-MH-9	MAN HOLE	~5'	NO	NONE	—	-----	Vault level appears higher. Need to investigate for potential blockage or other problem
P-VV-10	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-11	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-12	VALVE VAULT	0"	NO	NONE	—	-----	
P-VV-9	VALVE VAULT	3'	NO	NONE	—	-----	Needs to be vactored
SP-7	SUMP PUMP	~12"	NO	NONE	YES	YES	
SP-8	SUMP PUMP	~12"	NO	NONE	YES	YES	
COMMENTS:							