

February 10, 1998


Mr. Hal Cowman
C&C Paint Company
5121 Ballard Ave NW
Seattle, WA 98107

DEPARTMENT OF ECOLOGY NWRO/TCP TANK UNIT	
INTERIM CLEANUP REPORT	<input type="checkbox"/>
SITE CHARACTERIZATION	<input checked="" type="checkbox"/>
FINAL CLEANUP REPORT	<input type="checkbox"/>
OTHER _____	<input type="checkbox"/>
AFFECTED MEDIA: SOIL	<input checked="" type="checkbox"/>
OTHER _____ GW	<input checked="" type="checkbox"/>
INSPECTOR (INIT.) <i>AD</i>	DATE <i>3/29/00</i>

UST# 1716
UST# 4806
**NOWICKI
&
ASSOCIATES**
ENERGY & ENVIRONMENTAL MANAGEMENT

from site files

RE: UST Closure In Place-Site Assessment Report
C&C Paints - Ecology Site ID 004806
5121 Ballard Ave NW
Seattle, Washington



Nowicki & Associates, Inc. (NAI) has conducted the site assessment for the underground storage tank (UST) closure at the C&C Paints store. This report documents the results of the site assessment. Included with the report are Ecology's Site Assessment Checklist and UST Closure & Site Assessment Notice.

Summary:

One 7,000-gallon alkyd resin underground storage tank(UST) was closed in-place on January 30, 1998. NAI was on-site to witness the tank closures and oversee the soil sampling procedures. Tank closure services were provided by Global Diving & Salvage, Inc.-Environmental Division. The results of the site assessment indicated no petroleum release above Washington State Model Control Act (MTCA) Method A clean-up levels from the closed UST. TPH-Gas and BTEX were detected below MTCA A levels. The tank was filled with concrete slurry, supplied by Salmon Bay Sand & Gravel.

Discussion:

The site is located in the Downtown Ballard, within the City limits of Seattle, King County. The UST was used to stored alkyd resin, which consists of petroleum solvents of xylenes and ethylbenzene and an alkyd resin of soybean polymer, for paint manufacturing. The tank had not been used for a number of years. Due to the closed proximity of the tank to the on-site building, closure in-place was selected. The site is also listed in the National Register of Historic Places. In 1992, one 6,000-gallon and one 8,000-gallon mineral spirits USTs were also closed in-place, east of the resin UST. Product release with mineral spirits was documented by Bison Environmental.

The 7,000-gallon tank manhole was large enough to provide tank cleaning access, no tank cutting was required. Upon tank opening, the tank appeared empty and the tank product residual had dried. The tank was cleaned and rinsed by Certified Cleaning Services, Inc.. A Marine Chemist from Sound Testing was on-site to verify safe tank entry conditions. An Inspector from the City of Seattle Fire Department was also on-site to observe the tank closure.

The top of the tank was buried at approximately 18" below ground surface. Tank dimensions were approximately 93" in diameter and 19' in length. The tank was cored at three locations in order to obtain closure soil samples. One soil sample was obtained at tank bottom and one from each tank ends (See Figure 2 for sample locations). Soil around the tank was of 1/2" to 3/4" pebbles and rocks, corresponding closest with the Unified Soil Classification of GW.

RECEIVED

MAR 24 2000

DEPT. OF ECOLOGY

33516 9th Avenue South
Building #6
Federal Way, Washington 98003
Phone: (253) 927-5233
FAX: (253) 924-0323

Soil samples were collected into laboratory provided 4-oz glass jars with teflon lids. No groundwater was encountered during soil sampling. Collected soil samples were lab-analyzed for Gas/BTEX range hydrocarbons by OnSite Environmental located in Redmond, Washington. OnSite's quality control parameters were within control limits. Laboratory results are summarized in Table 1. After soil sampling was completed, the tank was filled with a concrete slurry mixture supplied by Salmon Bay Sand & Gravel.

Table 1. Summary of Laboratory Data.

ID	Description	TPH-Gas ppm	Benzene ppm	Toluene ppm	Ethylben. ppm	Xylenes ppm
Bottom	Bottom of tank, middle, 9.5' bgs	29	ND	0.32	ND	1.32
East	East tank end, 8.5' bgs	24	ND	ND	ND	ND
West	West tank end, 8.5' bgs	12	ND	ND	ND	0.286
-	Method detection*	8.1-24	.08-.19	.08-.19	.08-.19	.08-.19
-	MTCA A level	100	0.5	40	20	20

Note:

ND = non-detect at the method detection level

bgs = below ground surface

*=variation in method detection levels was due to variation in soil matrix grain size.

Conclusion:

The 7,000-gallon resin UST was closed in-place in accordance with applicable regulations. There was no contamination above MTCA A levels associated with the closed tank based on field observations and the analytical results of collected soil samples.

Limitations:

This report has been prepared for the use of the original client, C & C Paint Company. The work was performed in accordance with the general accepted practices in environmental sciences and consulting under similar conditions and conforms to the accepted proposal dated November 18, 1997. No other warranty is expressed or implied.

NAI appreciates the opportunity to provide our service. If you have any questions or if we may be of additional service, please give us a call.

Respectfully Submitted,
Nowicki & Associates, Inc.



Michael Q. Lam
Project Engineer
Registered Site Assessor

Attachments:

- Figures 1 & 2
- OnSite Laboratory Report
- Ecology 30-Day Intent to Close Notice
- Ecology Site Assessment Checklist
- Ecology UST Closure & Site Assessment Notice
- Certified Cleaning Services Certificate
- Sound Testing Marine Chemist Certificate
- City of Seattle Fire Dept. Permit
- Salmon Bay Sand & Gravel Receipts

cc paints, 5221 NW Ballard Av, Seattle, 98107, 534 E4
 5221 NW Ballard Av, Seattle, 98107, 534 E4


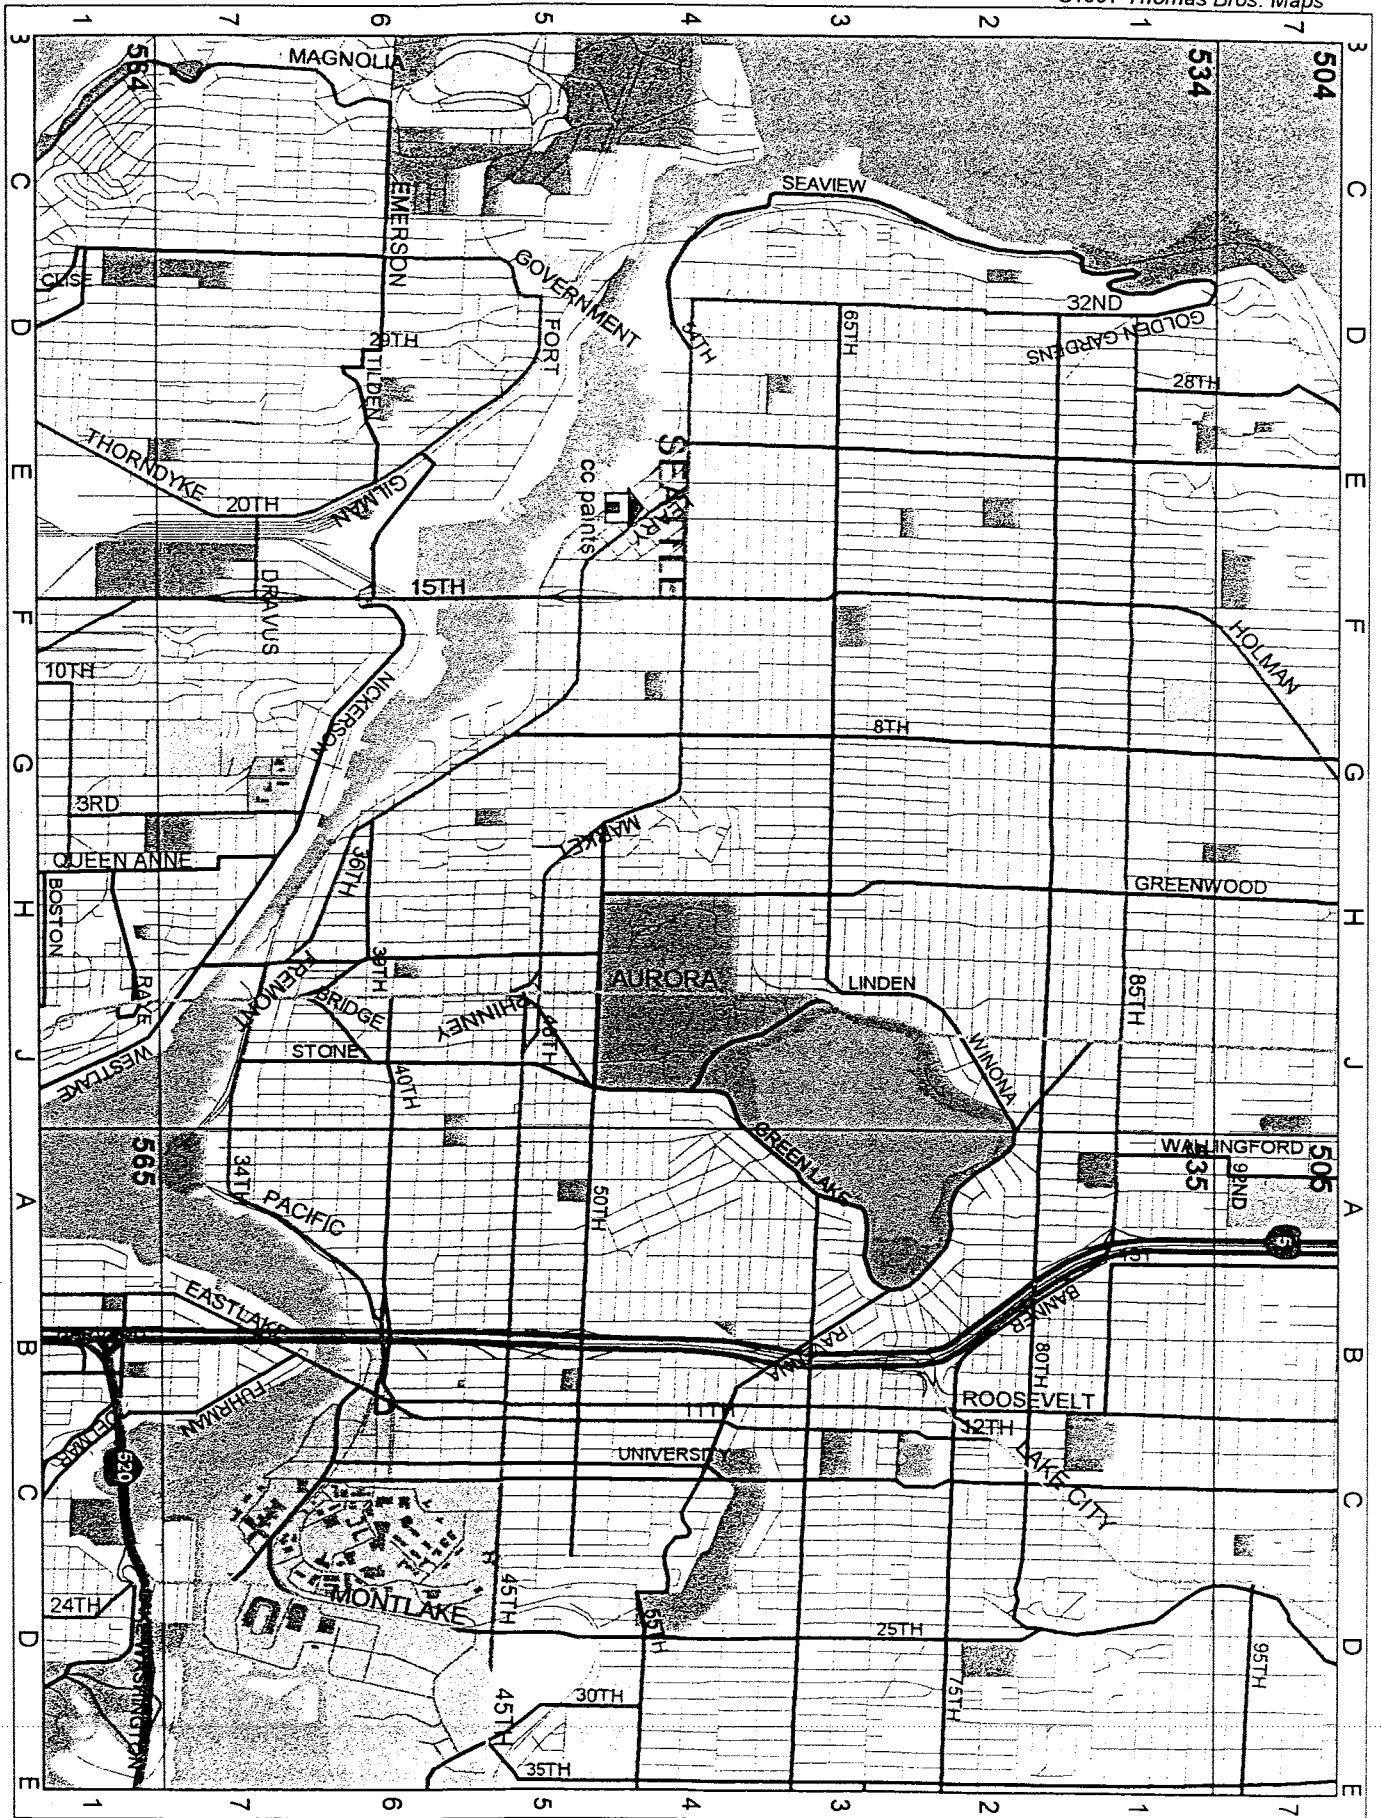


Figure 1. Site Map



X ... DENOTES SOIL SAMPLE LOCATION(S) WITH DEPTH IN FEET BEGOW GROUND SURFACE (BGS)

PROJECT: C&C PAINTS-UST CLSODURE	
FIGURE 2. UST & SAMPLES LOCATIONS	
2-3-98	1"=10'
NOWICKI & ASSOCIATES, INC.	

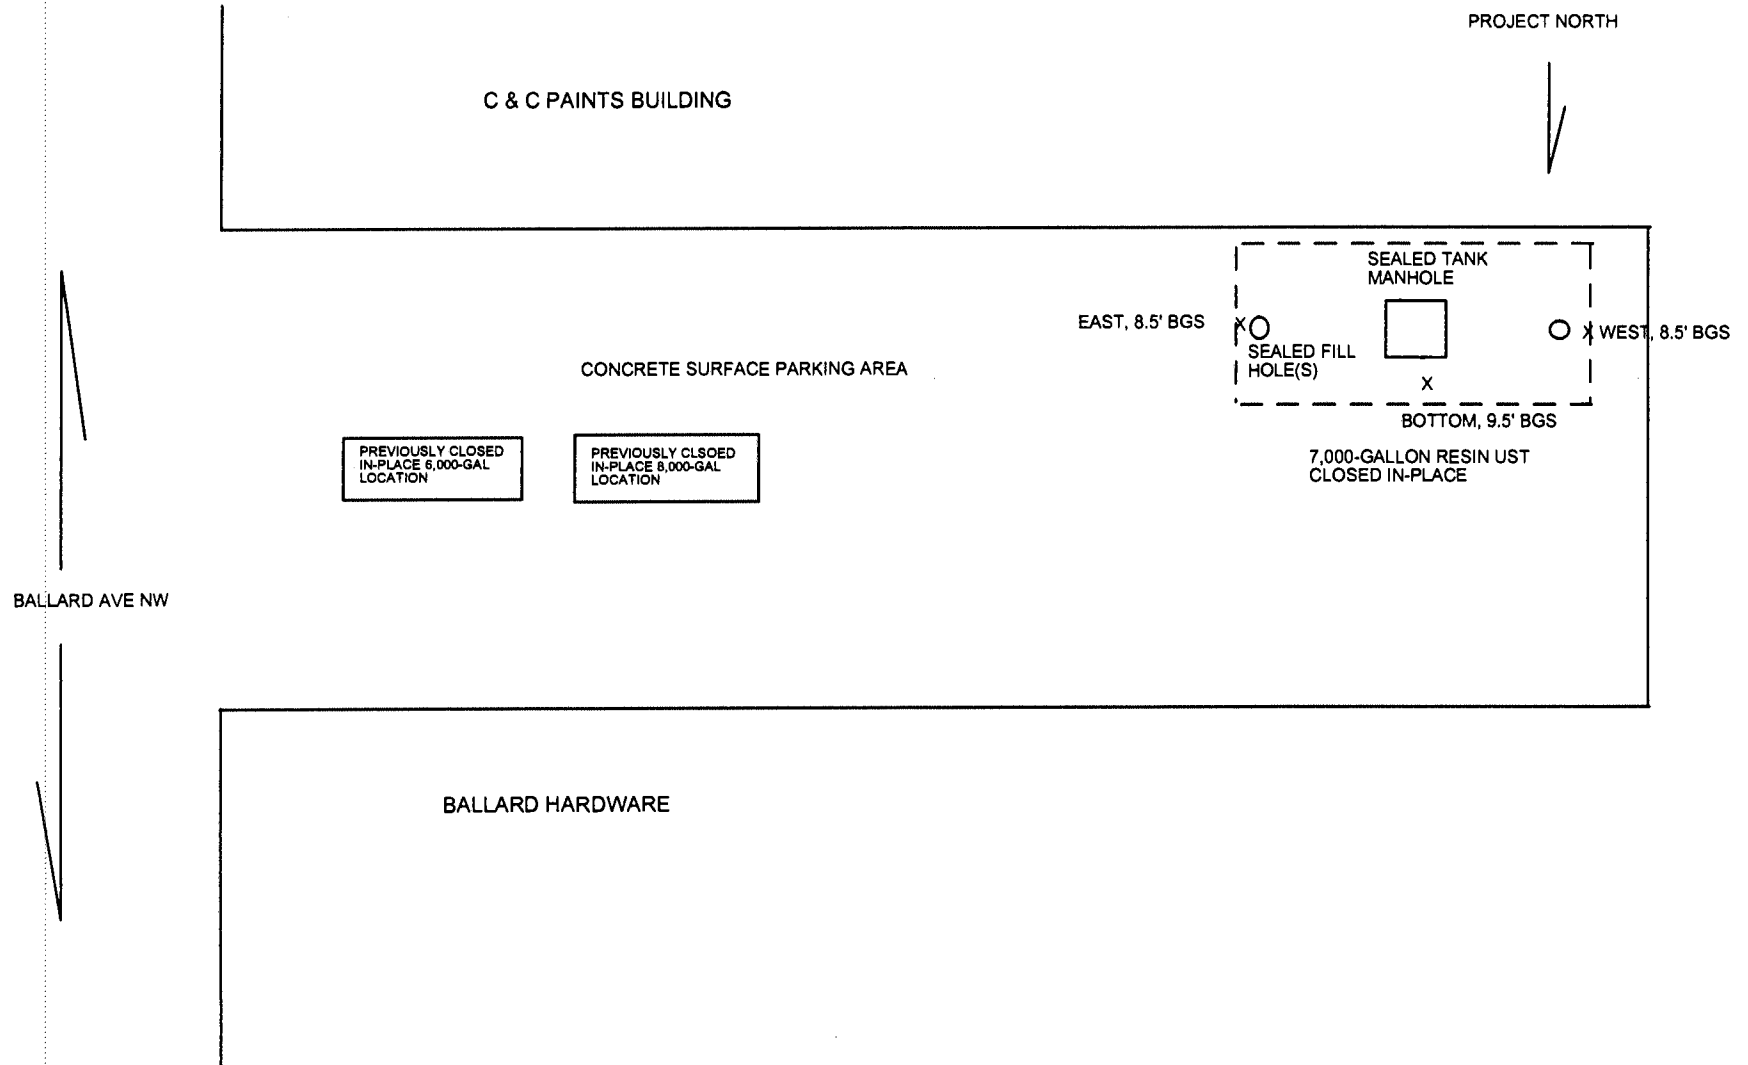

**OnSite
Environmental Inc.**
Analytical Testing and Mobile Laboratory Services

February 6, 1998

Michael Lam
Nowicki & Associates
33516 9th Avenue S., Building #6
Federal Way, WA 98003

Re: Analytical Data for Project C & C Paints
Laboratory Reference No. 9801-100

Dear Michael:

Enclosed are the analytical results and associated quality control data for samples submitted on January 30, 1998.

The standard policy of OnSite Environmental Inc., is to store your samples for 30 days from the date of receipt. If you require longer storage, please contact the laboratory.

We appreciate the opportunity to be of service to you on this project. If you have any questions concerning the data, or need additional information, please feel free to call me.

Sincerely,

Robert Wallace for:

Andy Bay
Project Chemist

Enclosures

Date of Report: February 6, 1998
Samples Submitted: January 30, 1998
Lab Traveler: 01-100
Project: C & C Paints

NWTPH-G/BTEX

Date Extracted: 02-02-98
Date Analyzed: 02-02-98

Matrix: Soil
Units: mg/Kg (ppm)

Lab ID: 01-100-1 01-100-2
Client ID: BOTTOM EAST

	Result	Flags	PQL	Result	Flags	PQL
Benzene	ND		0.19	ND		0.24
Toluene	0.32		0.19	ND		0.24
Ethyl Benzene	ND		0.19	ND		0.24
m,p-Xylene	0.91		0.19	ND		0.24
o-Xylene	0.41		0.19	ND		0.24
TPH-Gas	29		19	ND		24
Surrogate Recovery: Fluorobenzene	79%			81%		

Date of Report: February 6, 1998
Samples Submitted: January 30, 1998
Lab Traveler: 01-100
Project: C & C Paints

**NWTPH-G/BTEX
DUPLICATE QUALITY CONTROL**

Date Extracted: 01-29-98
Date Analyzed: 01-29-98

Matrix: Soil
Units: mg/Kg (ppm)

Lab ID	01-088-2 Original	01-088-2 Duplicate	RPD	Flags
Benzene	ND	ND	NA	
Toluene	ND	ND	NA	
Ethyl Benzene	ND	ND	NA	
m,p-Xylene	ND	ND	NA	
o-Xylene	ND	ND	NA	
TPH-Gas	ND	ND	NA	
Surrogate Recovery:				
Fluorobenzene	96%	101%		

Date of Report: February 6, 1998
Samples Submitted: January 30, 1998
Lab Traveler: 01-100
Project: C & C Paints

Date Analyzed: 02-02-98

% MOISTURE

Client ID	Lab ID	% Moisture
Bottom	01-100-01	3.0
East	01-100-02	2.0
West	01-100-03	0



DATA QUALIFIERS AND ABBREVIATIONS

- A - Due to high sample concentration, amount spiked insufficient for meaningful MS/MSD data recovery.
- B - The analyte indicated was also found in the blank sample.
- C - The duplicate RPD outside control limits due to analyte concentration within five times the quantitation limit.
- D - Data from 1:_____ dilution.
- E - Value reported exceeds the quantitation range. Value is an estimate.
- F - Surrogate recovery data not available due to the high concentration in the sample.
- G - Insufficient sample quantity for duplicate analysis.
- J - The value reported was below the practical quantitation limit. The value is an estimate.
- K - Sample duplicate RPD outside control limits due to sample inhomogeneity. Sample re-extracted and re-analyzed with similar results.
- L - Quantitated from C7-C34 as diesel fuel #2.
- M - Predominantly _____ range hydrocarbons present in the sample.
- N - Hydrocarbons in the gasoline range (C7-toluene) present in the sample.
- N1 - Hydrocarbons in the gasoline range (C7-toluene) present in the sample which are elevating the diesel result.
- O - Hydrocarbons in the heavy oil range (>C24) present in the sample.
- O1 - Hydrocarbons in the heavy oil range (>C24) present in the sample which are elevating the diesel result.
- P1 - Hydrocarbons in the diesel range (C12-C24) present in the sample which are elevating the oil result.
- R - Hydrocarbons outside defined gasoline range present in the sample.
- S - Surrogate recovery data not available due to the necessary dilution of the sample.
- T - The sample chromatogram is not similar to a typical _____.
- U - Matrix Spike/Matrix Spike Duplicate RPD outside control limits due to matrix effects.
- V - Matrix Spike/Matrix Spike Duplicate recoveries outside control limits due to matrix effects.
- Z - Interferences were present which prevented the quantitation of the analyte below the detection limit reported.
- ND - Not Detected
- MRL - Method Reporting Limit
- PQL - Practical Quantitation



Chain of Custody

Company:	Nowki & Assoc
Project No.:	
Project Name:	C & C Paints
Project Manager:	Michael Lam

[illegible][illegible]

RELINQUISHED BY <i>Thakker</i>	DATE <i>1/30/98</i>	RECEIVED BY <i>Kristen Koch</i>	DATE <i>1/30/98</i>	COMMENTS:
FIRM <i>AS</i>	TIME <i>4:40 PM</i>	FIRM <i>OnSite Env.</i>	TIME <i>4:40</i>	
RELINQUISHED BY	DATE	RECEIVED BY	DATE	
FIRM	TIME	FIRM	TIME	
REVIEWED BY	DATE REVIEWED			



UNDERGROUND STORAGE TANK 30 DAY NOTICE

See back of form for instructions

Please ✓ the appropriate box: ☐ Intent to Install ☒ Intent to Close ☐ Both

FOR OFFICE USE ONLY	
Site ID #:	
Owner ID #:	
Once validated by Ecology, this form serves as your temporary permit for the tanks listed below.	

Site Information

Site ID Number 004806
(Available from Ecology if the tanks are registered)
Site/Business Name C & C PAINTS
Site Address 5121 BALLARD AVE NW
City/State SEATTLE WA
Zip Code 98107 Telephone (206) 783-8835


Owner Information

(This information will be returned to this address)

UST Owner/Operator NOWICKI & ASSOC. - CONSULTANT
Mailing Address 33516 9TH AVE S, #6
City/State FEDERAL WAY WA
Zip Code 98003 Telephone (206) 927-5233

Tank Installation Company (if known). Fill out this section ONLY if tanks are being installed.

Service Company _____ Contact Name _____
Address _____
City _____ State _____ Zip Code _____ Telephone () _____

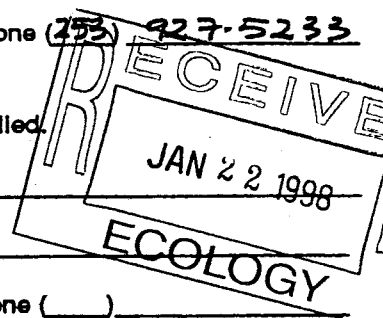

Tank Permanent Closure Company (if known). Fill out this section ONLY if tanks are being closed.

Service Company UNKNOWN AT PRESENT Contact Name _____
Address _____
City _____ State _____ Zip Code _____ Telephone () _____

Tank Closure Information

Fill out this section ONLY if tanks are being closed.

Tank Installation Information

Fill out this section ONLY if tanks are being installed.

Tank ID	Projected Closure Date	Tank Capacity	Substance Stored	Date Tank Last Used	Is There Product in the Tank (Yes/No)	If No, Date Tank Was Pumped	Tank ID	Approx. Install Date
7-P	1-30-98	7000-GAL	ALKYD RESIN	UNKNOWN	YES			



UNDERGROUND STORAGE TANK Site Check/Site Assessment Checklist

For Office Use Only

Owner # _____

Site # _____

INSTRUCTIONS:

When a release has **not** been confirmed and reported, this Site Check/Site Assessment Checklist must be completed and signed by a person registered with Ecology. **The results of the site check or site assessment must be included with this checklist.** This form must be submitted to Ecology at the address shown below within 30 days after completion of the site check/site assessment.

SITE INFORMATION: Include the Ecology site ID number if the tanks are registered with Ecology. This number may be found on the tank owner's invoice or tank permit.

TANK INFORMATION: Please list all tanks for which the site check or site assessment is being conducted. Use the owner's tank ID numbers if available, and indicate tank capacity and substance stored.

REASON FOR CONDUCTING SITE CHECK/SITE ASSESSMENT: Please check the appropriate item.

CHECKLIST: Please initial each item in the appropriate box.

SITE ASSESSOR INFORMATION: This form must be signed by the registered site assessor who is responsible for conducting the site check/site assessment.

Underground Storage Tank Section
Department of Ecology
P. O. Box 47655
Olympia, WA 98504-7655

SITE INFORMATION

Site ID Number (on invoice or available from Ecology if the tanks are registered): 004806

Site/Business Name: C & C PAINT COMPANY

Site Address: 5121 BALLARD AVE NW Telephone: (206) 783-8835

Street

SEATTLE

City

WA

State

98107

ZIP-Code

TANK INFORMATION

Tank ID No.

Tank Capacity

Substance Stored

7-P

7,000 - GAL

AUKYD RESIN

REASON FOR CONDUCTING SITE CHECK/SITE ASSESSMENT

Check one:

- ☐ Investigate suspected release due to on-site environmental contamination
- ☐ Investigate suspected release due to off-site environmental contamination.
- ☐ Extend temporary closure of UST system for more than 12 months.
- ☐ UST system undergoing change-in-service.
- ☒ UST system permanently closed-in-place.
- ☐ UST system permanently closed with tank removed.
- ☐ Abandoned tank containing product.
- ☐ Required by Ecology or delegated agency for UST system closed before 12/22/88.
- ☐ Other (describe): _____

CHECKLIST

Each item of the following checklist shall be initialed by the person registered with the Department of Ecology whose signature appears below.

		YES	NO
1.	The location of the UST site is shown on a vicinity map.	<u>M</u>	
2.	A brief summary of information obtained during the site inspection is provided. (see Section 3.2 in site assessment guidance)	<u>M</u>	
3.	A summary of UST system data is provided. (see Section 3.1)	<u>M</u>	
4.	The soils characteristics at the UST site are described. (see Section 5.2)	<u>M</u>	
5.	Is there any apparent groundwater in the tank excavation? <u>N.A.</u>		<u>M</u>
6.	A brief description of the surrounding land use is provided. (see Section 3.1)	<u>M</u>	
7.	Information has been provided indicating the number and types of samples collected, methods used to collect and analyze the samples, and the name and address of the laboratory used to perform the analyses.	<u>M</u>	
8.	A sketch or sketches showing the following items is provided:		
	- location and ID number for all field samples collected	<u>M</u>	
	- groundwater samples distinguished from soil samples (if applicable)	<u>M</u>	
	- samples collected from stockpiled excavated soil <u>NA</u>	<u>M</u>	
	- tank and piping locations and limits of excavation pit <u>NA</u>	<u>M</u>	
	- adjacent structures and streets	<u>M</u>	
	- approximate locations of any on-site and nearby utilities	<u>M</u>	
9.	If sampling procedures different from those specified in the guidance were used, has justification for using these alternative sampling procedures been provided? (see Section 3.4)	<u>NA</u>	<u>M</u>
10.	A table is provided showing laboratory results for each sample collected including; sample ID number, constituents analyzed for and corresponding concentration, analytical method and detection limit for that method.	<u>M</u>	
11.	Any factors that may have compromised the quality of the data or validity of the results are described.	<u>M</u>	
12.	The results of this site check / site assessment indicate that a confirmed release of a regulated substance has occurred.		<u>M</u>

SITE ASSESSOR INFORMATION

<u>MICHAEL LAM</u>	<u>NOWICKI & ASSOC, INC</u>
Person registered with Ecology	Firm Affiliated with
Business Address: <u>33516 9TH AVE S, BLDG 6</u>	Telephone: <u>(253) 927-5233</u>
<u>FEDERAL WAY</u>	<u>WA</u>
City	State
<u>98003</u>	ZIP+Code
I hereby certify that I have been in responsible charge of performing the site check / site assessment described above. Persons submitting false information are subject to penalties under Chapter 173.360 WAC.	
<u>2-10-98</u>	<u>Michael Lam</u>
Date	Signature of Person Registered with Ecology

02/05/98 14:05 FAX 206 340 8984

GLOBAL DIVING

002



UNDERGROUND STORAGE TANK Closure and Site Assessment Notice

See back of form for instructions

FOR OFFICE USE ONLY	
Site ID #	
Owner ID #	

Please ☒ the appropriate box(es)
☐ Temporary Tank Closure ☐ Change-In-Service ☒ Permanent Tank Closure ☐ Site Check/Site Assessment
Site Information**Owner Information**

(This form will be returned to this address)

Site ID Number 004806

(Available from Ecology if the tanks are registered)

UST Owner/Operator HAL COWMAN - C & C PAINTSSite/Business Name C & C PAINTSMailing Address 5121 BALLARD AVE NWSite Address 5121 BALLARD AVE NWCity/State SEATTLE WACity/State SEATTLE WAZip Code 98107 Telephone (206) 783-8835Zip Code 98107 Telephone (206) 783-8835Owner's Signature [Signature]**Tank Closure/Change-In-Service Company**Service Company GLOBAL DIVING & SALVAGE, INC. - ENVIRONMENTALCertified Supervisor CHRIS STOKES Decommissioning Certification No. 1044858-20Supervisor's Signature [Signature]Address 3840 WEST MARGINAL WAY, S.W.

Street	City	State	Zip Code	Telephone
<u>SEATTLE</u>	<u>WA</u>	<u>98106</u>	<u>(206) 623-0621</u>	

Site Check/Site AssessorCertified Site Assessor MICHAEL LAM - HOWICKI & ASSOC, INC.Address 33516 9TH AVE S, #6City FEDERAL WAY State WA Zip Code 98003 Telephone (253) 927-5233**Tank Information**

Tank ID	Closure Date	Closure Method	Tank Capacity	Substance Stored
<u>7-P</u>	<u>1-30-98</u>	<u>CLOSED</u>	<u>7,000 GAL</u>	<u>ALKYD</u>
		<u>IN-PLACE</u>		<u>RESIN</u>

Contamination Present at the Time of Closure

☐ Yes ☐ No ☐ Unknown
 Check unknown if no obvious contamination was observed and sample results have not yet been received from analytical lab.

☐ Yes ☐ No
 If contamination is present, has the release been reported to the appropriate regional office?

PO# 5405

1118 EAST D STREET
TACOMA, WA 98421
(206) 593-5300

CLEANING CERTIFICATE

THIS IS AN ON-SITE CLEANING CERTIFICATE. CERTIFICATE INDICATES THAT THE FOLLOWING TANK(S) HAS(HAVE) BEEN CLEANED AND TRIPLE RINSED IN COMPLIANCE WITH ALL LOCAL, STATE AND FEDERAL REGULATIONS:

QTY.	GALLONAGE	DESCRIPTION
1 7000	7,000	underground Tank
		Pump & Rinse

JOB # 98-029

TRUCK # 401

DRIVER SIGNATURE

Chris Stols

DATE 1-30-98

SITE INFORMATION

COMPANY: CTC Paints

ADDRESS: 5221 Ballard Ave NW
Ballard WA

CUSTOMER SIGNATURE

Chris Stols

DATE 1-30-98

LUND TESTING, INC.

1 BOX 16204 SEATTLE, WA 98116

932-0206

MARINE CHEMIST CERTIFICATE

SERIAL No 43517

LOGAN ENVIRO

Requested by

C & C PAINTS

Vessel Owner or Agent

30 JAN 98

Date

UST

UST

Type of Vessel

5221 BALLARD AVE

Specific Location of Vessel

ONE ETHYL BENZENE

Three (3) Cargoes

CG-02 / PID / VISUAL

Test Method

0930

Time Survey Completed

TANK MAY BE ENTERED WITH RESTRICTIONS.

① WORKERS IN TANK MUST WEAR FULL FACE, SUPPLIED AIR RESPIRATOR.

② SAFE TO DRILL HOLES WITH ELECTRIC DRILL.

NO OTHER HOT WORK AUTHORIZED.

TANK CONTAINS 20.5% O₂, 0 LEL, AND 600 ppm VOC.

P.O.# 5405

In the event of any physical or atmospheric changes adversely affecting the gas-free condition of the above spaces, or if in any doubt, immediately stop all work and contact the undersigned Marine Chemist.

QUALIFICATIONS: Transfer of ballast or manipulation of valves or closure equipment tending to alter conditions in pipe lines, tanks or compartments subject to gas accumulation, unless specifically approved in this Certificate, requires inspection and endorsement or reissue of Certificate for the spaces so affected. All lines, vents, heating coils, valves, and similarly enclosed appurtenances shall be considered "not safe" unless otherwise specifically designated.

STANDARD SAFETY DESIGNATIONS

SAFE FOR WORKERS: Means that in the compartment or space so designated: (a) the oxygen content of the atmosphere is at least 19.5 percent by volume, and that, (b) toxic materials in the atmosphere are within permissible concentrations; and that, (c) the residues are not capable of producing toxic materials under existing atmospheric conditions while maintained as directed on the Marine Chemist's Certificate.

NOT SAFE FOR WORKERS: Means that in the compartment or space so designated, the requirements of Safe for Workers has not been met.

SAFE FOR HOT WORK: Means that in the compartment so designated: (a) oxygen content of the atmosphere is at least 19.5 percent by volume, with the exception of inerted spaces or where external hot work is to be performed; and that, (b) the concentration of flammable materials in the atmosphere is below 10 percent of the lower flammable limit; and that, (c) the residues are not capable of producing a higher concentration than permitted by (b) above under existing atmospheric conditions in the presence of fire, and while maintained as directed on the Marine Chemist's Certificate; and further, that, (d) all adjacent spaces have been cleaned sufficiently to prevent the spread of fire, or are satisfactorily inerted, or, in the case of fuel tanks, or lube oil tanks, or engine room or fire room bilges, have been treated in accordance with the Marine Chemist's requirements.

NOT SAFE FOR HOT WORK: Means that in the compartment so designated, the requirements of Safe for Hot Work have not been met.

SAFE FOR REPAIR YARD ENTRY: Means that the compartments and spaces of the flammable cryogenic liquid carrier so designated: (a) have been tested by sampling at remote sampling stations, and results indicate the atmosphere tested to be above 19.5 percent oxygen, and less than 10 percent of the lower flammable limit, or (b) are inerted.

CHEMIST'S ENDORSEMENT: This is to certify that I have personally determined that all spaces in the foregoing list are in accordance with NFPA 306-1980 Control of Gas Hazards on Vessels and have found the condition of each to be in accordance with its assigned designation.

The undersigned acknowledges receipt of this Certificate under Section 2-3 of NFPA 306-1980 and understands conditions and limitations under which it was issued.

This Certificate is based on conditions existing at the time the inspection herein set forth was completed and is issued subject to compliance with all qualifications and instructions.

Signed

Name

Company

Date

Signed


Marine Chemist

Certificate No.

672

FAX: (206) 781-0984

SINCE 1907

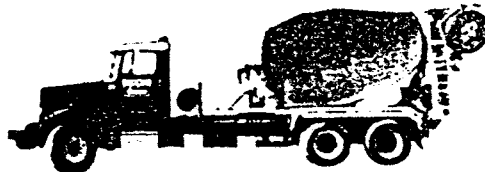

Y349986

LEFT
PLANT

ARRIVE
JOB

START
POUR


**FINISH
POUR**

ARRIVE
PLANT

IS AN ANNUAL
PERCENTAGE
RATE OF 18%.

TRUCK NUMBER 1.5	YARDS DELIVERED 36	GALLONS OF WATER ADDED AT CUSTOMER'S REQUEST 30			
RECEIVED IN GOOD CONDITION AND AS SHOWN ABOVE X [Signature]			NOTICE: Our drivers will make every effort to place material where customer designates, but company assumes no responsibility for damages inside of curb or property line.	WARNING CEMENT IS DANGEROUS TO YOUR HEALTH -SEE REVERSE-	Y34998
			SUB-TOTAL	SALES TAX	INVOICE TOTAL

SINCE 1907

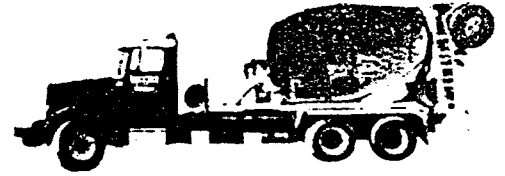

7228 SHILSHOLE AVE. N.W. • P.O. BOX 70497 • SEATTLE, WA 98107

DELIVERY
ADDRESS

5221 BALLARD AVE (C & C)

SOLD TO

GLOBAL DIVING & SALVAGE

ADDRESS

SEATTLE, WASHINGTON 981

CUSTOMER NUMBER
0605

INVOICE NUMBER	
----------------	--

Y349855

DATE 1/30/98

19

LEFT
PLANT

11 15 Jan

CUSTOMER'S P.O. NO./JOB NAME

5405

ARRIVE
JOB

11:25

CREDIT APPROVAL/NOTES

START
POUR

711:28

CUSTOMER'S PHONE NO.

INTEREST OF 1 1/2%
PER MONTH WILL
BE CHARGED ON
ALL PAST DUE
AMOUNTS. WHICH
IS AN ANNUAL
PERCENTAGE
RATE OF 18%

FINISH
POUR

7/1:45

TAX

1

NO
TA

• X

XX

IS AN ANNUAL
PERCENTAGE
RATE OF 18%

ARRIVE
PLANT

>

QUAN.	UNIT	DESCRIPTION	PRODUCT CODE	TX	SHIPPED	PRICE	AMOUNT
9	CUBIC YARDS MIX CONCR.	MIX 1 sx SIZE AGG. B-SAND SLUMP 4 PERM <input type="checkbox"/> HYURLY <input type="checkbox"/>					
		27+					
		ENVIRONMENTAL COMPLIANCE FEE					
8 MINUTES PER YARD FREE UNLOADING TIME. HOURLY MIXER RENTAL CHARGES THEREAFTER.			150-10				
TOTAL TIME ON JOB	MIN	ALLOWABLE FREE TIME	MIN	CHARGEABLE TIME	MIN		

TRUCK NUMBER

YARDS DELIVERED

GALLONS OF WATER ADDED AT CUSTOMER'S REQUEST	
--	--

60

SUB-TOTAL

SALES TAX**INVOICE TOTAL**

RECEIVED IN GOOD CONDITION AND AS SHOWN ABOVE

X

NOTICE: Our drivers will make every effort to place material where customer designates, but company assumes no responsibility for damages in or to curb or property line.

WARNING
CEMENT IS DANGEROUS
TO YOUR HEALTH
-SEE REVERSE-

Y349855