

COLLEGE AVENUE STEAM PLANT ADAPTIVE REUSE

Integrated Cleanup and Implementation Plan



Port of
Whitman
County

PORT OF WHITMAN COUNTY
March 30, 2020

ACKNOWLEDGMENTS

Client Name

Kara Riebold, Executive Director

Funder

Washington State Department of Ecology

Consulting Team

Maul Foster & Alongi, Inc.
Graham Baba Architects
DCI Engineering
DCW Cost Management



*Prepared by
Maul Foster & Alongi, Inc.
2815 2nd Avenue, Suite 540, Seattle, WA 98121*

CONTENTS

ABOUT THE PORT	I
PREFACE	II
EXECUTIVE SUMMARY	III
1 INTRODUCTION	1-1
PROJECT OVERVIEW	1-1
PROCESS	1-5
2 EXISTING CONDITIONS	2-1
PROPERTY HISTORY	2-1
OWNERSHIP	2-1
ONGOING OPERATIONS	2-2
INFRASTRUCTURE ASSESSMENT	2-2
STRUCTURAL ASSESSMENT	2-4
REGULATORY ANALYSIS	2-6
NATURAL RESOURCES	2-6
CULTURAL RESOURCES	2-8
HAZARDOUS MATERIALS SURVEY	2-8
ENVIRONMENTAL CONSIDERATIONS	2-9
3 REUSE PLANNING	3-1
CONCEPTUAL SITE PLAN	3-2
EXISTING USE INTEGRATION	3-5
COST PLAN	3-6
4 RECOMMENDATIONS	4-1
ACTION STEPS	4-2
ADDRESS ENVIRONMENTAL CONCERNS	4-3
LIMITATIONS	
APPENDIX A	
PROPERTY MAP	
APPENDIX B	
STEAM PLANT AND PROPERTY PHOTOGRAPHS	
APPENDIX C	
FOCUSED SITE ASSESSMENT REPORT	
APPENDIX D	
HAZARDOUS MATERIALS SURVEY REPORT	
APPENDIX E	
ADAPTIVE REUSE CONCEPTUAL PLAN	
APPENDIX F	
FEASIBILITY STUDY COST PLAN	

ABOUT THE PORT

The Port of Whitman County (the Port) is a port authority located in the Palouse region of southeastern Washington. Driven by the development of the Columbia-Snake River System, the Port was formed in 1958 to provide access to slack water navigation, promote industrial development, and create recreational opportunities on the Snake River. Today, the Port strives to make the Palouse a great place to live and a better place to work through the operation of three lines of business: industrial real estate, telecommunications infrastructure development, and recreation.¹

The Port operates three properties on the Snake River: Port of Wilma, near the Idaho state line; Port of Central Ferry, midway between Walla Walla and Colfax; and Port of Almoda, four miles downriver of Lower Granite Lock and Dam. The Port's off-water properties include Pullman Industrial Park in north Pullman and the Port of Whitman Business Air Center, which is a small general aviation airport and industrial park. The Port also supports tourism and transportation needs county-wide and manages Boyer Park and Marina to enhance recreational opportunities on the Snake River.

The Port, through a partnership with five other ports in Washington State, manages Petrichor Broadband, LLC, a limited liability company that seeks to meet the broadband needs of previously unserved or underserved communities across Washington State.

Facilitating economic development for all citizens of Whitman County is an important part of the Port's mission. Direct jobs associated with the Port increased 334 percent in the 20 years between 1996 (774 jobs) and 2019 (3,232 jobs). As of 2019, Port activities support more than 5,369 direct and indirect jobs for the surrounding community.²

The Port's 2021–2025 Strategic Plan provides its vision, mission, and core values as:

PORT VISION

We are valued for our ability to operate sustainably; move strategically, decisively and effectively; and make the Palouse a great place to live and a better place to work.

PORT MISSION

The Port of Whitman County is dedicated to improving the quality of life for all citizens of Whitman County through industrial real estate development, preservation of multimodal transportation, facilitation of economic development, and provision of on-water recreational opportunities.

PORT CORE VALUES



¹ 2021–2025 Strategic Plan. Port of Whitman County, Colfax, Washington, 2021.

² Peterson, Steven. Associate Clinical Professor of Economics, University of Idaho. Economic contributions of the Port of Whitman County, September 2020.

PREFACE

This planning effort was funded by an Integrated Planning Grant administered by the Washington State Department of Ecology (Agreement No. TCPIPG-1921-WhCoPo-00011). Integrated Planning Grants provide funding for local governments to conduct the necessary studies and to plan for acquiring and redeveloping underperforming, contaminated properties. The grants support planning for adaptive reuse of a property, integrating economic development, environmental cleanup and restoration, and community benefit. The Integrated Planning Grant Program is funded through the Model Toxics Control Account, which uses revenues from a fee on the first possession of imported hazardous substances in the state to support environmental cleanup, pollution prevention, and waste management efforts. The Model Toxics Control Act was approved by a voter referendum in 1988.

EXECUTIVE SUMMARY

The adaptive reuse of an unused portion of the Washington State University (WSU) College Avenue Steam Plant (Steam Plant) has the potential for catalytic impact on economic development in the city of Pullman and in Whitman County. The Port of Whitman County (Port) and WSU have collaborated to explore the potential for redevelopment of the Steam Plant for use as a commercialization hub, where WSU research and intellectual property can be further developed into businesses operating and growing in the county. This plan document articulates the vision for the future of the Steam Plant and identifies key steps to realize this vision.

VISION

The adaptive reuse of the Steam Plant will create a visually appealing gateway to campus from the surrounding neighborhoods and will blend coworking, office, and lab spaces with indoor and outdoor community gathering spaces. The main floor will be anchored by a destination brewery and restaurant incubator that may leverage WSU's research and leadership in the study of food and beverage science. Adapting the unused, mothballed portion of the historic Steam Plant for reuse will activate a signature building for greater use while supporting job creation and innovation in the county.

GOALS

The Port has identified the following goals to guide the planning process and to ensure that the Steam Plant Adaptive Reuse Integrated Cleanup and Implementation Plan reflects the future vision, as well as the needs of the community and its visitors:

- Ensure continuous steam and electrical power generation and access to power infrastructure for operations and maintenance.
- Collaborate with WSU to support the reuse of the building for the commercialization of research and intellectual property.
- Recognize the history and prior use of the site and building while also cleaning up contamination resulting from such use.
- Establish a financial platform to support redevelopment, operations, and maintenance of the Steam Plant building.
- Create a high-quality gateway from campus to the neighboring area to support a strong and mutually advantageous relationship between WSU and surrounding property owners.

FINDINGS

Environmental. Five areas of concern associated with former operations at the Steam Plant were found on site. Petroleum storage, coal storage, and equipment contain polychlorinated biphenyls (PCBs) were found on site. The analytical results from the fieldwork found potential contamination above cleanup levels in one groundwater sample and sub-slab soil vapor exceedances in two of the three sample locations in the basement. No soil samples were found to have contamination above cleanup levels; however, based on historical investigations, the remaining coal layer in the former bulk coal storage area is a potential source of polycyclic aromatic hydrocarbon impacts to soil. Three cleanup approaches were evaluated, and the preferred cleanup approach uses asphalt capping and

EXECUTIVE SUMMARY

institutional controls to address soil conditions in the coal storage area, vapor sealing and passive venting to address sub-slab vapor intrusion, and monitored natural attenuation to address the on-site groundwater contamination. The estimated cost for this cleanup approach is \$587,000.

Hazardous building materials. The hazardous building material survey found asbestos-containing materials, lead-based paint, and potentially PCB-containing fixtures and other hazardous materials, including coal dust, throughout the Steam Plant. The Port may provide the report to contractors during bidding on abatement, construction, or demolition work.

Structural conditions. An assessment of the Steam Plant building's structural systems, including the roof framing, exterior walls, interior walls, floor framing, foundations, and lateral systems, was conducted. Should the building undergo significant alterations and upgrades, a new lateral force-resisting system will have to be implemented to satisfy the International Building Code. As new frames are installed to support the existing structure, new foundations will also be required. Drilled micropiles have been used successfully to counteract downward and uplift forces in retrofits such as the Steam Plant project.

Interface with operations. The northern portion of the Steam Plant building currently houses natural-gas-powered boilers that are used to heat campus buildings. Additionally, the southern portion of the Steam Plant building, in an area where the Port would operate a commercialization center, houses a rack of electrical switchgear used to help power the campus. However, the reuse concept in the adaptive reuse section of the Steam Plant will not affect the operations of critical campus infrastructure. Special considerations—including fire walls, exclusive access to steam and electrical power infrastructure to ensure operations and maintenance, and realignment of steam piping to eliminate direct infrastructure interface with the adaptive reuse of the Steam Plant—have been factored into the conceptual plan.

Reuse conceptual plan. The conceptual plan for the unused portion of the Steam Plant blends coworking, office, and lab spaces with indoor and outdoor community gathering spaces. This concept provides space for fledgling entrepreneurs to grow their ideas into businesses that will help make the county's economy more resilient. The main floor of the renovated Steam Plant will be anchored by a destination brewery and restaurant incubator that may leverage WSU's research and leadership in the study of food and beverage science.

The conceptual plan specifies up to 9,100 square feet of commercialization center space; 6,400 square feet of brewery and brewpub space; and 3,900 square feet of food and drink and mixing space. An additional 10,600 square feet of the Port's portion of the building would be used for circulation and mixing, restrooms, and back of house operations. The conceptual plan also considers the need for WSU to maintain uninterrupted operations and maintenance of the steam and electrical utility. Approximately 1,800 square feet of the 12,100-square-foot first level, 4,600 square feet of the 12,400-square-foot basement, and the entire 1,200-square-foot subbasement would be reserved solely for WSU access to ensure its operations and maintenance needs.

Costs. The total estimated cost in 2023 dollars to redevelop the unused portion of the Steam Plant is approximately \$29,665,000. Areas of the Steam Plant building needed to ensure steam and power generation are set aside for WSU's use. The cost plan accounts for design measures taken to ensure access and continued operations as well as related fire safety measures. The redevelopment phases and the cost estimates associated with each phase are listed in the table on the following page.

EXECUTIVE SUMMARY

Phase	Estimate ¹
Phase 1: Hazardous Building Material Abatement	\$874,000
Phase 2: Demolition	\$2,294,000
Phase 3: Warm Shell	\$8,284,000
Phase 4: Tenant Improvement	\$7,180,000
Sitework	\$3,342,000
Soft Costs at 35%	\$7,691,000
Total Construction Estimate	\$29,665,000

¹Costs escalated to first quarter 2023 dollars. Costs exclude the estimated \$587,000 needed for environmental contamination cleanup.

ACTION STEPS

The redevelopment of the Steam Plant will take place over several years given the costs and related need for grant funding and use of other financing tools. Critical actions for the Port are best divided into the following near-term, mid-term, and long-term actions.

NEAR-TERM
(0-1 year activities)

- Regain support from the property owner.
- Explore lease negotiations for the portion of the Steam Plant and surrounding property the Port may utilize. A lease will be needed for the Port to pursue funding opportunities.
- Pursue site area cleanup funding associated with environmental cleanup in collaboration with the Washington State Department of Ecology.
- Complete CERB Planning Grant activities
 - Assess market demand, institutional needs, and direct and indirect potential economic impacts.
 - Establish a community-based coalition to help advance the project and pursue funding sources.
 - Develop a plan of finance. This could be supported by a Washington Department of Commerce CERB planning grant.
 - Explore the feasibility of leveraging historical and new market tax credits and identify the necessary steps to pursue this source of project financing.

EXECUTIVE SUMMARY

MID-TERM (1-2 year activities)

- Complete hazardous building material abatement leveraging a U.S. Environmental Protection Agency Site-Specific Cleanup Grant or Washington Department of Commerce Brownfield Revolving Loan Funds.
- Remove the decommissioned boilers and supporting equipment in coordination with WSU.
- Refine project design, engineering drawings, and cost estimates leveraging a U.S. Economic Development Administration Economic Adjustment Assistance grant for non-construction activities.
- Conduct environmental cleanup actions on the Property.
- Pursue historic tax credits and/or new market tax credits to support construction.
- Pursue construction grants from the U.S. Economic Development Administration and/or the Washington Department of Commerce.
- Market the project to seed users including a brewer and restaurateurs.

LONG-TERM (2 years+)

- Secure funding sources such as U.S. Economic Development Administration Economic Adjustment Assistance grants for construction activities and financing sources such as historical tax credits and/or new market tax credits to support construction. Act on other financing mechanisms identified in the plan of finance.
- Redevelop the site.
- Sustain operations and ensure available space for commercialization efforts.

1 INTRODUCTION



Project Overview

PROJECT PURPOSE

The Port of Whitman County (Port), in collaboration with Washington State University (WSU), is exploring the possibility of an adaptive reuse of WSU’s College Avenue Steam Plant (Steam Plant) building. The intent of the effort is to understand the possible adaptive reuse of the unused portion of the Steam Plant while maintaining the ongoing operations of the plant and, in doing so, address any legacy environmental concerns.

This project is funded by a Washington Department of Ecology (Ecology) Integrated Planning Grant (IPG) and intends to recommend a redevelopment plan for the underutilized portion of the Steam Plant building and the property around it (Property) through the evaluation of environmental, cultural, and physical conditions. Table 1 provides a summary of the Steam Plant and Property, and Figure 1 outlines the IPG-funded activities detailed in this plan.

Remediation and adaptive reuse of the underutilized portion of the building will align with the Port’s core mission of economic development by creating a coworking and collaboration space to support the innovations and commercialization efforts emerging from WSU. Located at the edge of campus and near downtown Pullman, the vision for the redevelopment is for the Steam Plant to be a focal point in further connecting the “town to gown.” The first floor will be a community gathering space that is activated with business ventures and entrepreneurs. When complete, the Steam Plant will be a power plant of ideas and energy at the edge of campus.

Table 1: Property Information

Address:	800 NE College Avenue Pullman, Washington
Owner:	Washington State University
Developer:	Port of Whitman County
Land Area:	Approximately 1.9 acres
Building:	Up to four stories totaling approximately 37,000 square feet
Current Condition:	Six decommissioned boilers reside in the vacant central structure.

Figure 1: IPG-Funded Activities

Planning-Related

- Existing conditions assessment
- Structural assessment
- Reuse visioning
- Building renderings
- Redevelopment cost estimates
- Implementation plan

Environmental Assessment

- Hazardous building assessment
- Focused site assessment
 - Environmental site characterization
 - Cleanup alternatives and cost estimates

This project could not have been advanced to this stage without the support and involvement from WSU leadership and staff. WSU is the property owner and is responsible for providing access for the Port or their contractors to complete site work and planning activities. It is understood that WSU may lease the adaptive reuse portion of the building and a portion of the Property to the Port. The Port, in collaboration with WSU, would lease the space inside the renovated Steam Plant.

PROPERTY CHARACTERISTICS

Property

The Steam Plant is located on the western edge of the WSU campus and is less than a quarter-mile walk to downtown Pullman, making it a gateway site to WSU's campus. Figure 2 illustrates the location of the Steam Plant relative to WSU and downtown Pullman.

Figure 2: Locator Map



The Property consists of eight separate tax parcels, totaling approximately 1.9 acres. A map showing the parcel lines relative to the outline of the Property can be found in Appendix A.

The western edge of the Property is bordered by railroad tracks owned by the Washington Department of Transportation and operated by Washington Idaho Railway Incorporated. North of the Property is a set of one-story, WSU-owned buildings, and east, up the hill from the Steam Plant, is the Voiland College of Engineering and Architecture. South of the Property on the other side of College Avenue is vacant land that used to be a Chevron bulk storage facility.

Property Parcels

- 1-1230-00-01-01-0001 #369
- 1-1230-00-01-01-0001 #401
- 1-1230-00-08-04-0001 #379 (partial)
- 1-1230-00-08-04-0001 #380 (partial)
- 1-1230-00-08-04-0001 #17 (partial)
- 1-1230-00-08-04-0001 #401
- 1-1230-00-08-04-0002 #309 (partial)
- 8-1460-00-00-00-0067 #22 (partial)

INTRODUCTION

Other improvements near the Steam Plant include two aboveground storage tanks (ASTs) formerly containing diesel (i.e., bunker C fuel), located on the north end of the Property; and an Avista Corporation (Avista) electrical substation located north and west of the Steam Plant. The ASTs are on the Property, and the Avista substation is off the Property. A backup generator and AST are also located in front of the boiler control room section. Other features on or adjacent the Property include supply well pump houses (only one is active) and phone and internet communications buildings located just beyond the Property. The gravel lot that occupies the southeast portion of the Property was used for bulk coal storage during steam plant operations. Photographs of these features located outside of the building are shown in Figure 3.

Figure 3: Property Photographs



ASTs and electrical substation




Backup generator and AST

Building

The entire footprint of the Steam Plant building is approximately 19,500 square feet. The building is comprised of three sections described from north to south as: the campus heating system section (natural-gas-powered boilers), the boiler control room and shop area, and the former Steam Plant operations area. Figures 4 and 5 depict these three sections of the building and identify the portion of the Steam Plant that the Port may adaptively reuse.

Figure 4: Exterior Depiction of Steam Plant Sections

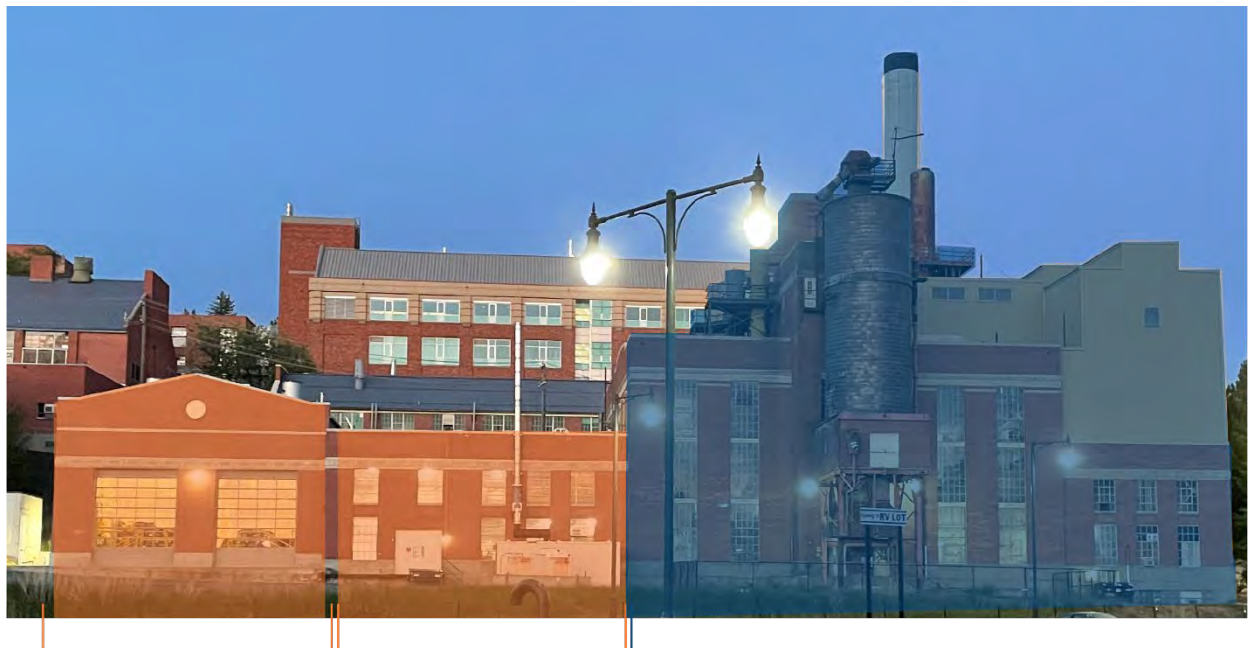


Campus heating system section

Boiler control room and shop area

Section* of the Steam Plant eligible for adaptive reuse by the port

Figure 5: Plan View of Steam Plant Sections

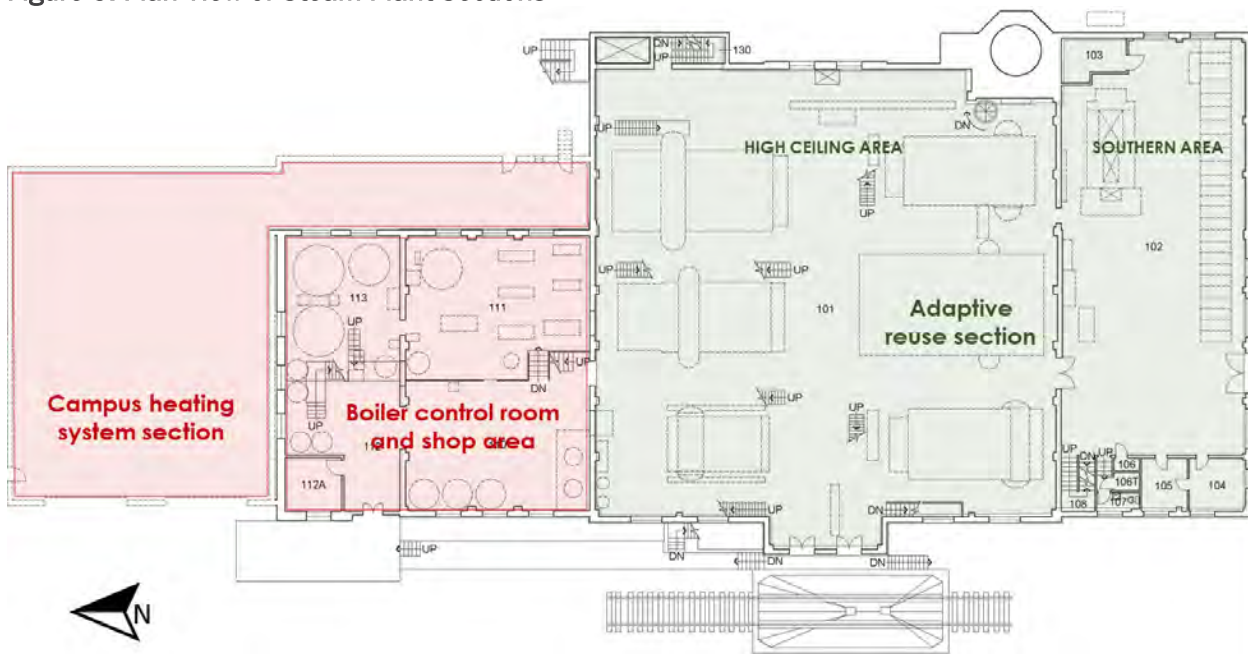

The adaptive reuse section of the building that may be reused by the Port has a building footprint of approximately 12,100 square feet. The high-ceilinged area of this section is approximately 55 feet tall at its highest point and houses six decommissioned steam boilers and supporting equipment. The two-story southern area section is mostly open from floor to roof. There is a second story on the western portion of the southern area that was used for offices and a break room. A bank of active electrical switchgear, also in this southern section, must remain accessible to WSU for operations and maintenance.

Beneath the entire section of the reusable portion of the building is a basement. Portions of the basement could be reused; however, careful coordination with WSU is required to ensure that steam and electrical operations may be safely maintained. Along the basement ceiling in the adaptive reuse section run active steam lines that connect the newer boilers in the northernmost section of the building (the campus heating systems section) to the tunnels that supply steam to WSU's campus. The main steam lines are located primarily in the western third of the basement, although there are other active, and smaller, lines throughout the basement. In addition to steam lines in the basement, cable routing from the switchgear on the first floor of the southern areas is accessed from the basement. These cables enter the tunnels along the southern end of the basement. Access to the underside of the electrical switchgear is needed. Finally, there are several condensate receivers in service in the basement; these receivers would have to be preserved or costs allocated for their relocation.


Below the basement is a subbasement. This area is assumed to be needed for ongoing operations and maintenance. The subbasement contains effluent lift pumps and footing drain pumps that must stay in service.

Selected images of the interior of the Steam Plant can be found in Appendix B.

Process

The integrated planning process typically takes between nine and 24 months to complete. Planning and environmental activities typically move on parallel tracks and converge with the development of an integrated plan to advance the project. Figure 6 illustrates the process taken for this project over a nine-month period between July 2021 and March 2022.


Figure 6: Steam Plant IPG Project Process

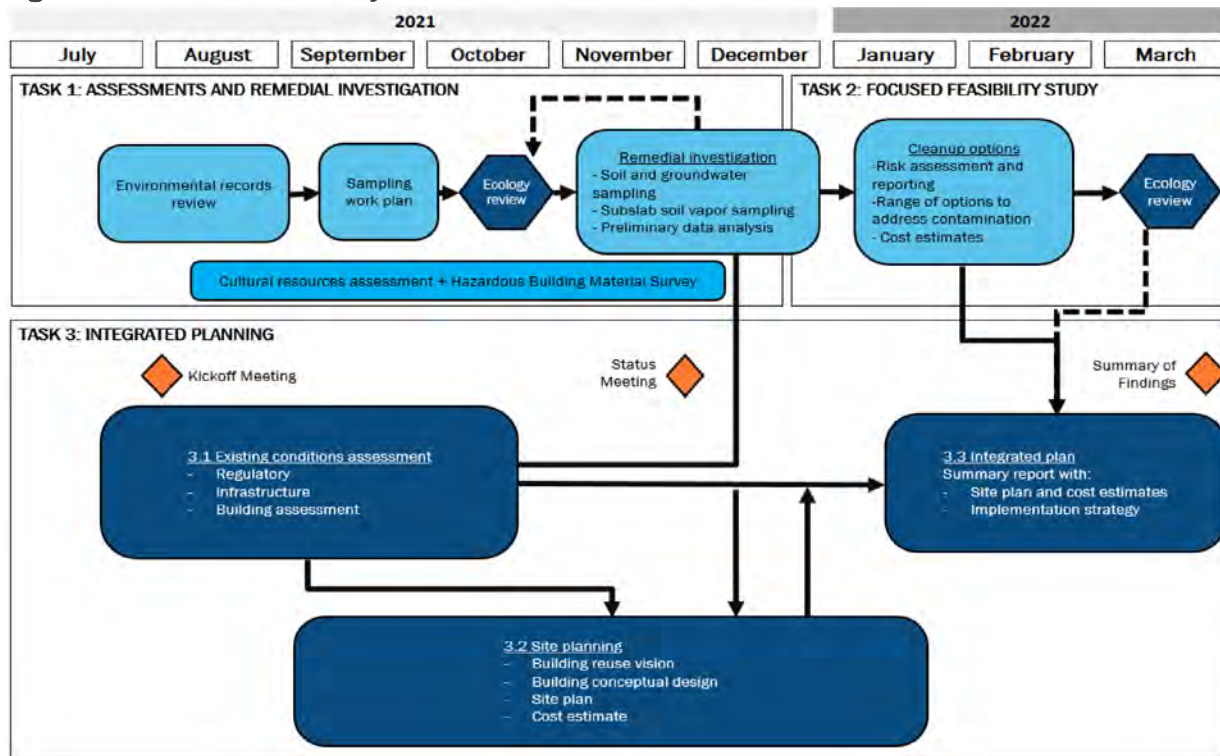

The project was split up between three tasks in two distinct focus areas—planning for a remedial action, and integrated planning for the future use of the Steam Plant. The site assessment and remedial investigation resulted in a study of cleanup action alternatives that are summarized in the Focused Site Assessment (FSA) report found in Appendix C. To inform this assessment, a site investigation work plan was drafted and approved by Ecology, and soil, groundwater, and vapor samples were collected and analyzed.

In parallel to the environmental investigation work, the project team completed planning activities to inform the Steam Plant reuse plan. This entailed an existing conditions study. The development of the Steam Plant reuse vision was informed by interviews with Port staff, meetings with WSU staff, and a site visit. A structural condition assessment was also conducted on the Steam Plant to understand what improvements would be required to support the reuse vision. This resulted in the preparation of a conceptual design and site plan for which cost estimates for the adaptive reuse of the building were completed.

2 EXISTING CONDITIONS

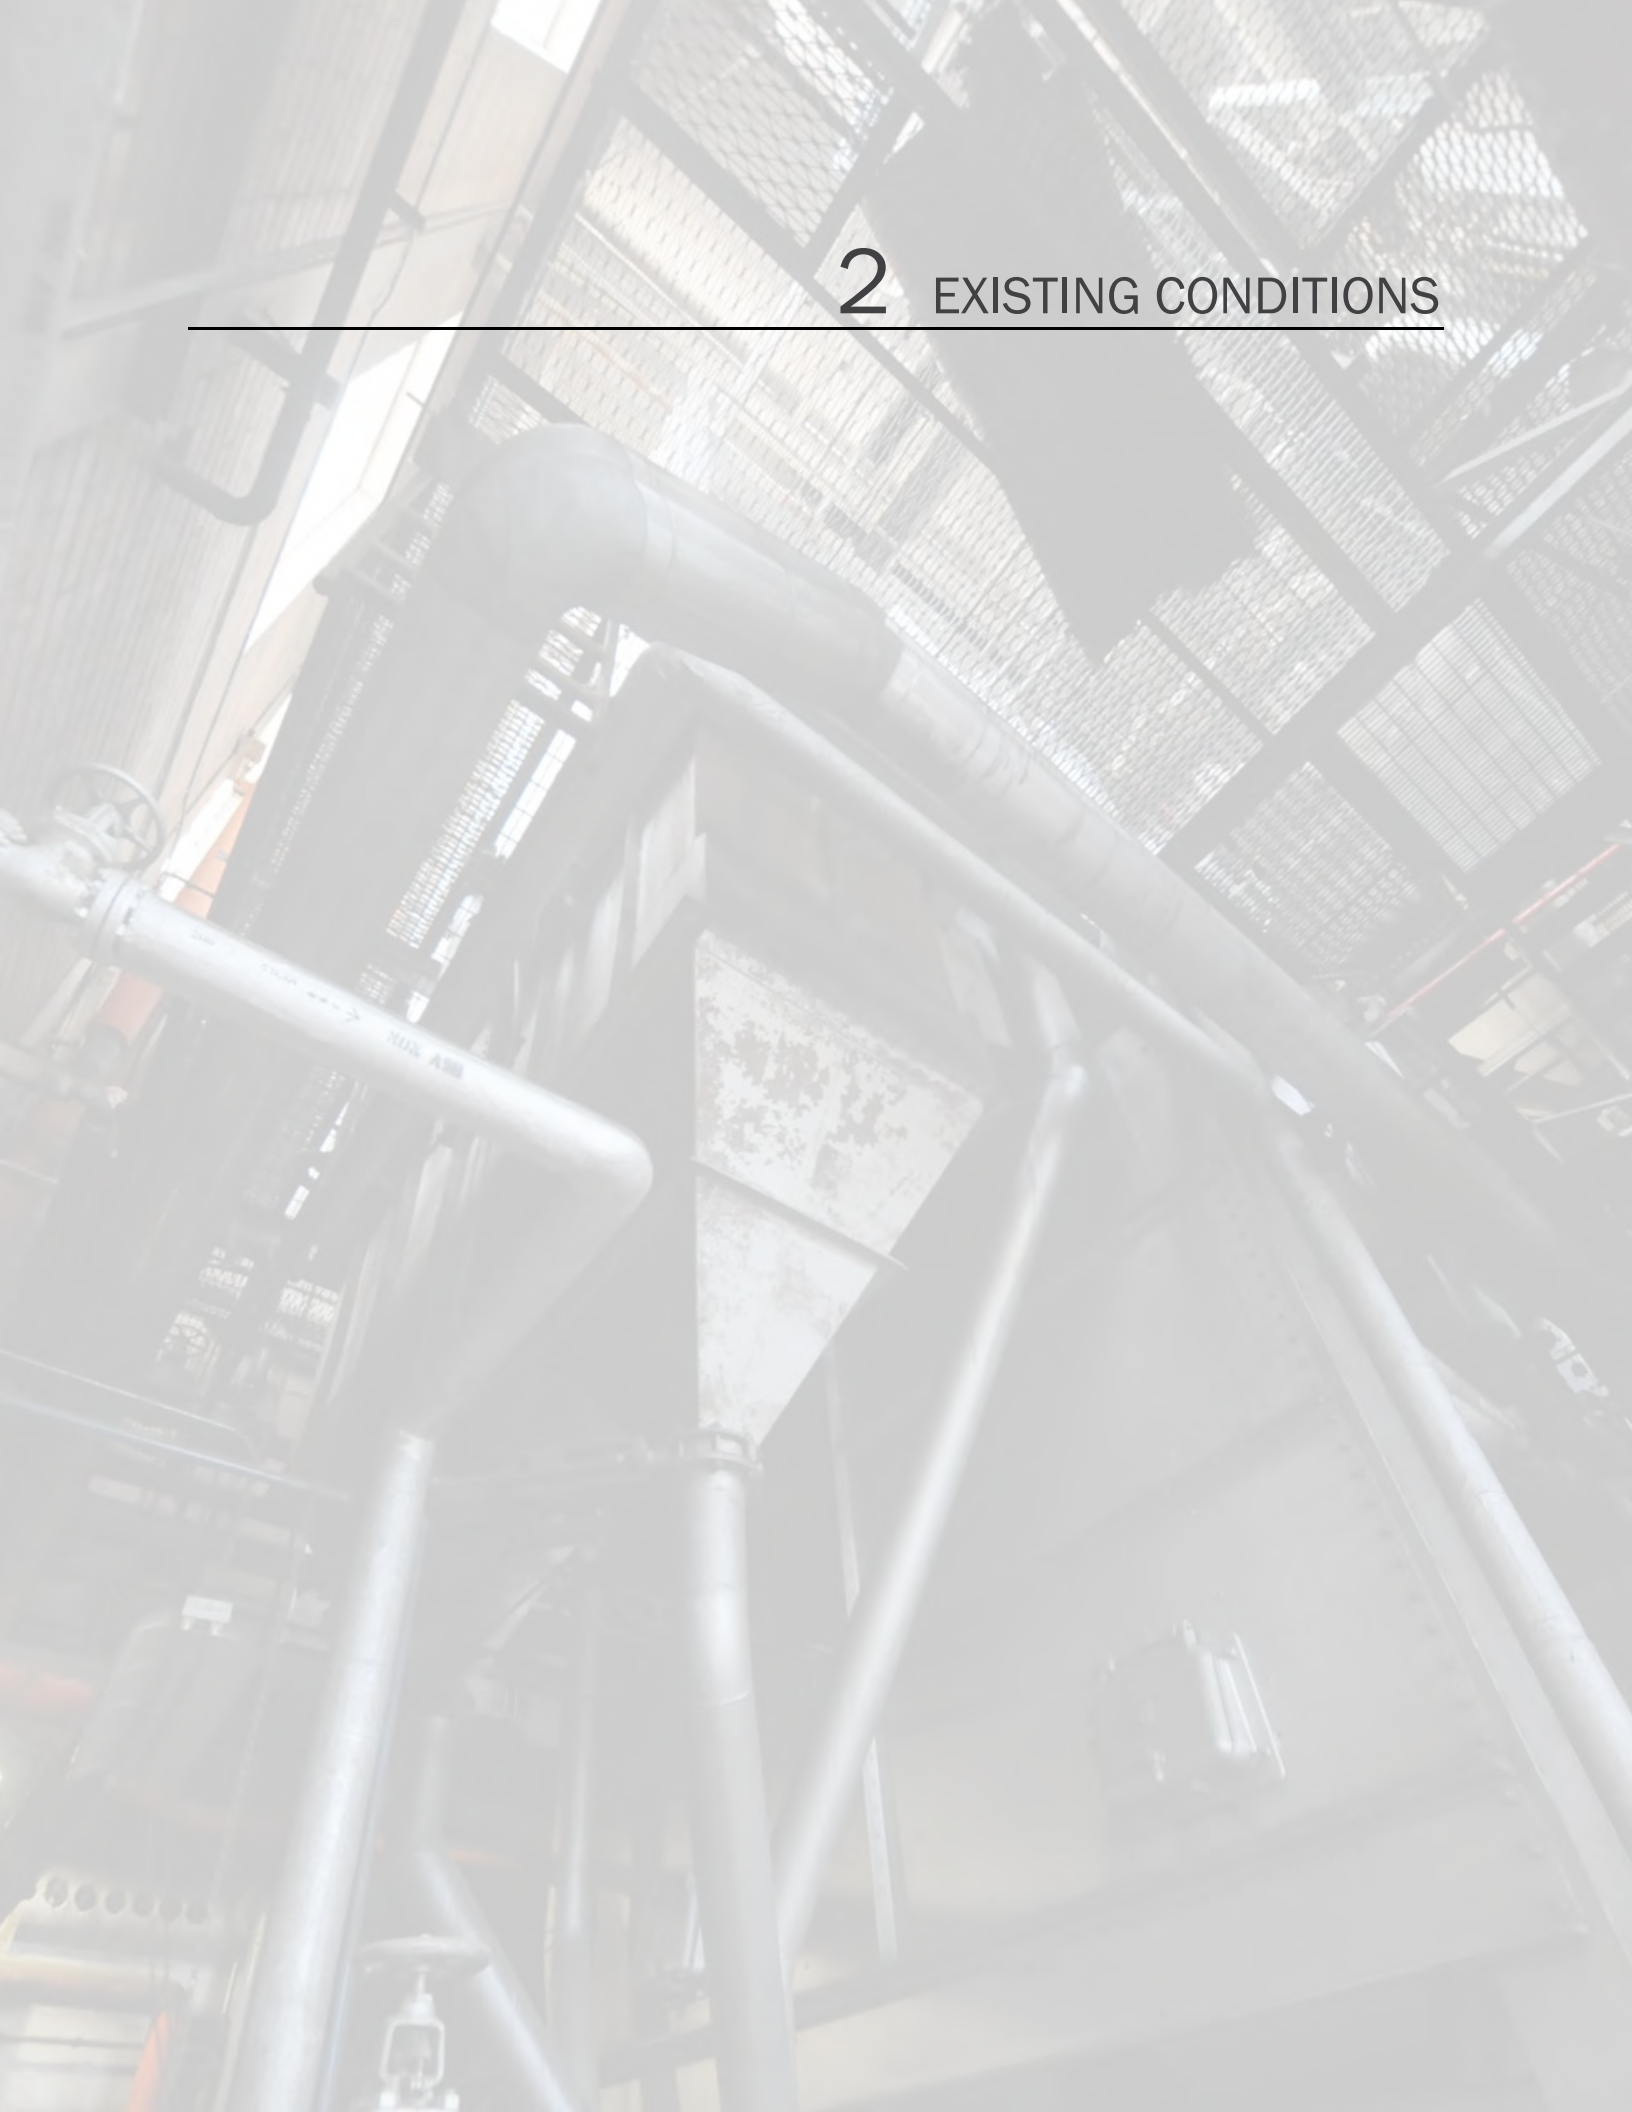

EXISTING CONDITIONS

This existing conditions section provides an overview of the conditions surrounding the redevelopment of the Steam Plant building and Property.

Property History

The Steam Plant is located on WSU's Pullman campus. Established in 1892, WSU was the state's first public land grant college. As WSU grew, so did its need for facilities to support campus operations. In 1927, the Steam Plant was commissioned. The facility provided heat, power, and light to campus buildings. Historical photographs of the Steam Plant are shown in Figure 7. Over the 76 years in which the Steam Plant was in operation, several additions and major modifications were completed on the Steam Plant building. Most recently, two natural gas boilers were installed in the Steam Plant's northern addition; these remain in operation today along with the electrical switchgear in the southern wing of the building. To the north of the main Steam Plant building is an Avista electrical substation.

In 2004, the Grimes Way Steam Plant was brought online; today, this provides most of the heat for campus buildings via the use of natural gas and diesel boilers. With the new steam plant in operation, the remaining coal-fired boilers in the Steam Plant were soon decommissioned. The portion of the building with the decommissioned boilers has since remained largely underutilized.

Ownership

The Steam Plant and the Property are owned by WSU and will be retained by WSU after the adaptive reuse. The Port intends to negotiate a long-term lease with WSU for most of the adaptive reuse section of the Steam Plant building and for the Property. Portions of the adaptive reuse section where WSU must secure access for operations and maintenance of the ongoing steam and power generation may be excluded from the lease; however, these details will be defined during negotiations.

Figure 7: Historical Photographs



Circa 1959



Circa 1956

Source: Washington State University Libraries Digital Collections

EXISTING CONDITIONS

Ongoing Operations

The northern addition to the Steam Plant building houses two natural-gas-fired boilers that remain in operation, providing additional heating capacity to nearby campus buildings. Also located in the Steam Plant is a room with electrical switchgear and transformers that remain in operation. On the Property in front of the Steam Plant is a buried electrical duct running from the Avista substation south through the lot into the south end of the building. During the demolition, construction, and operational phase of an adaptively reused Steam Plant, these essential infrastructure assets will remain under WSU's control and will not be included in the space leased to the Port.

Infrastructure Assessment

Infrastructure serving the Steam Plant is generally sufficient to support the redevelopment of the adaptive reuse section. An assessment of the condition of these utilities would be required before construction, and it is highly likely that system updates will be needed. Figure 8 and the following text describe the utilities serving the Steam Plant.


MUNICIPAL WATER

Water service is provided to the Steam Plant by two 8-inch-diameter feed lines. Chilled water is also available from the WSU campus infrastructure. The main line is approximately 400 feet up College Avenue, according to WSU Facilities Services. Connection to the campus's existing system is sufficient for the proposed use of the building.

WASTEWATER

According to correspondence from WSU Facilities Services, at least three sewer connections service the Steam Plant. A 12-inch-diameter main is located under the former coal pile, and a 24-inch-diameter city sewer main is located across the railroad tracks to the west of the Property. If a brewery operates out of the renovated Steam Plant, then the high-strength solids in the wastewater will have to be managed. This can either be done on site with pretreatment equipment or by the City of Pullman (City). A brewer will need to underwrite the equipment costs compared to the city wastewater surcharges to determine if the investment in the pretreatment equipment is needed.

Figure 8: Steam Plant Area Utilities

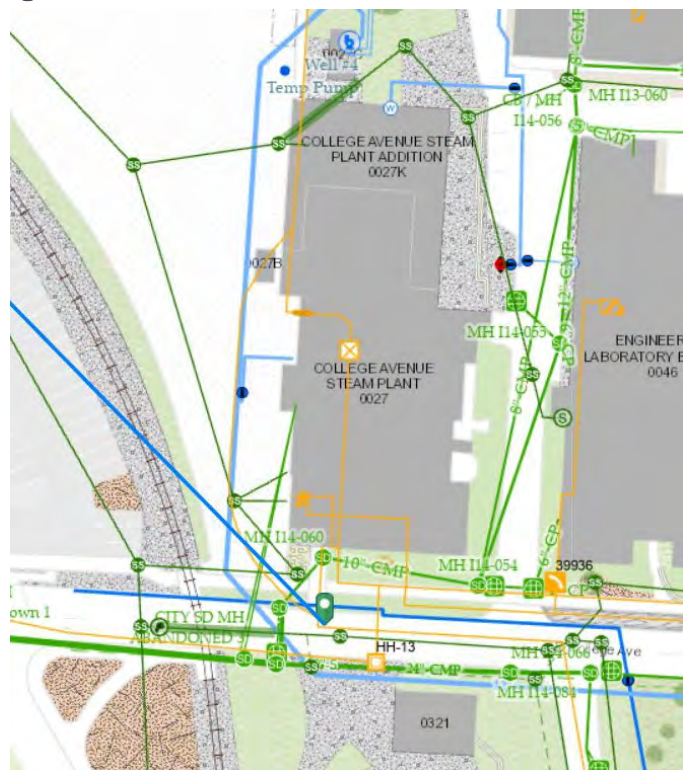

Source: WSU Facilities Services

STORMWATER

A 24-inch-diameter storm sewer main trunk runs past the Property along College Avenue. It is not known if the Steam Plant has an existing storm sewer connection to this main trunk. If a connection is

EXISTING CONDITIONS

found not to exist, a connection can be made to the main storm sewer line running under College Avenue.

Projects in the city that disturb 5,000 square feet or more require permitting to ensure compliance with the City's National Pollutant Discharge Elimination System Phase II Municipal permit, issued by Ecology. As far as the WSU campus is concerned, WSU is responsible for ensuring compliance with the City's permit per Section 10.32.050(2) Pullman City Code (PCC). WSU and the City are parties to a Memorandum of Understanding in which WSU is relieved of the requirement to obtain local stormwater permits for on-campus development but shall adopt the requirements in Ch. 10.32 PCC.

TRANSPORTATION

The Steam Plant is located near campus and downtown and is walkable from either location. Pullman Transit operates four routes from two bus stops within a 15-minute walk from the Steam Plant. The WSU Visitor Center stop is located 0.2 miles west of the Steam Plant and is served by the Loop Route, which provides service every 35 minutes between 6:30 a.m. and 6:45 p.m. Monday through Friday, excluding holidays. Another bus stop, east of the Steam Plant, at the corner of NE College Avenue and SE Spokane Street, is served by the Blue Route every 35 minutes between 6:30 a.m. and 6:45 p.m. and the Campus Route every 10 to 12 minutes between 6:50 a.m. and 6:30 p.m. On reduced-service days, the College and Spokane stop is serviced by the Community Service Express, running one bus between 6:45 a.m. and 6:40 p.m. The Blue Route and Loop Route are depicted in Figure 9.

The City is currently working toward updating its Bicycle and Pedestrian Plan. In the City's 1994 Bicycle and Pedestrian Plan, College Avenue is not designated as a formalized bike route. The site is located near a proposed loop route following Main Street and near multiple proposed cross routes in the College Hill neighborhood.


POWER

Avista provides electricity to the Property. An Avista substation is located north of the Steam Plant, just beyond the Property. It is assumed that this substation is sufficient to serve the electricity needs for the building post-redevelopment.

TELECOMMUNICATIONS

According to correspondence from WSU Facilities Services, it is likely that existing data infrastructure in the Steam Plant is limited. For private users, a new fiber connection to the Port's hub north of the Steam Plant would be necessary. For WSU users, a new fiber connection from Sloan Hall would be facilitated.

Figure 9: Pullman Transit Bus Routes

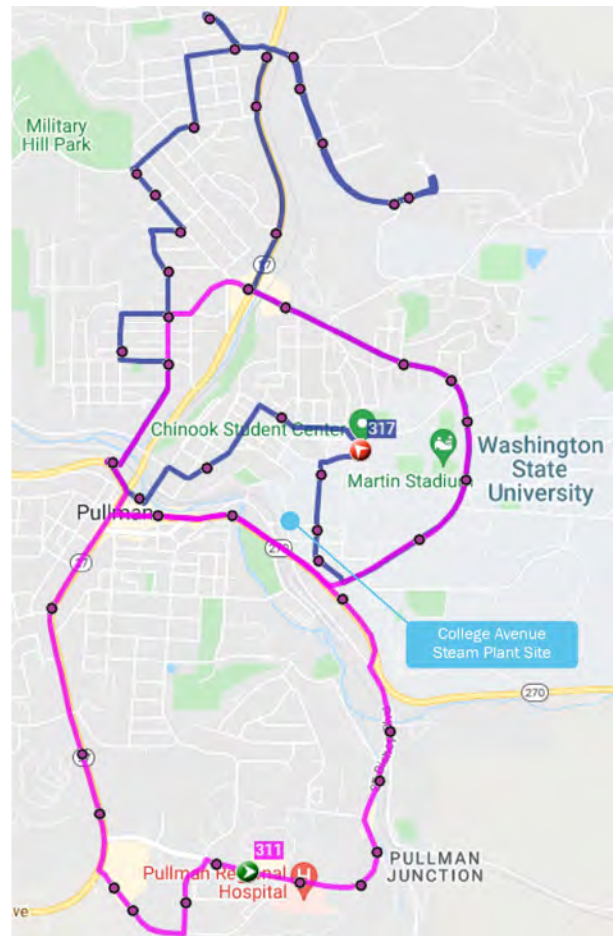

Source: Pullman Transit

Structural Assessment

The Steam Plant consists of a large steel industrial-type building with a main floor, basement, and partial subbasement. The building currently houses large boilers that have been decommissioned, as well as functioning electrical equipment along the south exterior wall. The building appears to have been constructed in the mid-1940s, but access to structural drawings is very limited to nonexistent. The building has been modified from the original configuration by the addition of large mechanical equipment on the southwestern portion of the roof and more exterior enclosure to protect that equipment. As the existing framing or lateral system was not analyzed or quantified, vertical load ratings for the existing structure were not determined.

OBSERVATIONS

Roof framing. The roofs are comprised of structural steel supporting cast-in-place concrete roof decks. The roofs are vertically separated by the high narrow center portion that houses the large coal hoppers. The center high roof is supported by large steel east-west trusses. The two adjacent roofs are set approximately 18 feet lower and are supported by the large east-west trusses. All roofs have north-south structural steel and are supported by steel columns in the demising walls.

Exterior Walls. The exterior walls appear to be comprised of unreinforced brick masonry that spans from the main floor to the roof and creates parapets around the roof. The structural steel columns are also embedded in the masonry space.

Interior Walls. The interior walls, like the exterior walls, appear to be made of unreinforced brick masonry; they are located on the structural steel column lines that support the roofs. The interior walls also run past the roof framing and create parapets in the east-west direction.

Floor Framing. The main floor framing is a cast-in-place concrete slab supported by cast-in-place concrete columns in the basement.

Foundations. There is no documentation on the existing foundations, but construction drawings indicate that the foundations resemble conventional concrete footings.

Lateral System. The main lateral system appears to be unreinforced brick masonry between the structural columns in the perimeter walls. The center high portion of the structure has structural steel angles bracing the tall, slender walls on the east and west ends.

Figure 10: Interior Bracing Photograph



Credit: Graham Baba Architecture

EXISTING CONDITIONS


Alteration Implications

It is understood that the adaptive reuse section of the Steam Plant may undergo alterations to accommodate a new use and a change of occupancy. As far as structure is concerned, if there are any alterations to the structural elements that cause an increase in gravity load or a decrease in capacity of gravity-resisting elements by more than 5 percent, the affected elements will have to be strengthened. This also applies to lateral-resisting elements with a decrease in capacity of more than 10 percent.

The new alterations may incorporate new floors to provide additional space in the existing building. These new floors likely will need their own independent gravity and lateral resisting elements and will act independently of the existing structure.

A seismic evaluation or ASCE 41 Tier 1 analysis has not been performed on the existing structure. However, if the building undergoes significant alterations and upgrades, a new lateral force-resisting system will have to be implemented to satisfy the International Building Code. Figure 10 illustrates the locations of new lateral elements to support the existing structure. As new frames are installed[built?] to support the existing structure, new foundations will also be required. Drilled micropiles have been used successfully to counteract downward and uplift forces in retrofits such as this. They also are very cost-effective to install in confined spaces such as the basement and subbasement.

Figure 11: Potential Lateral Element Needs

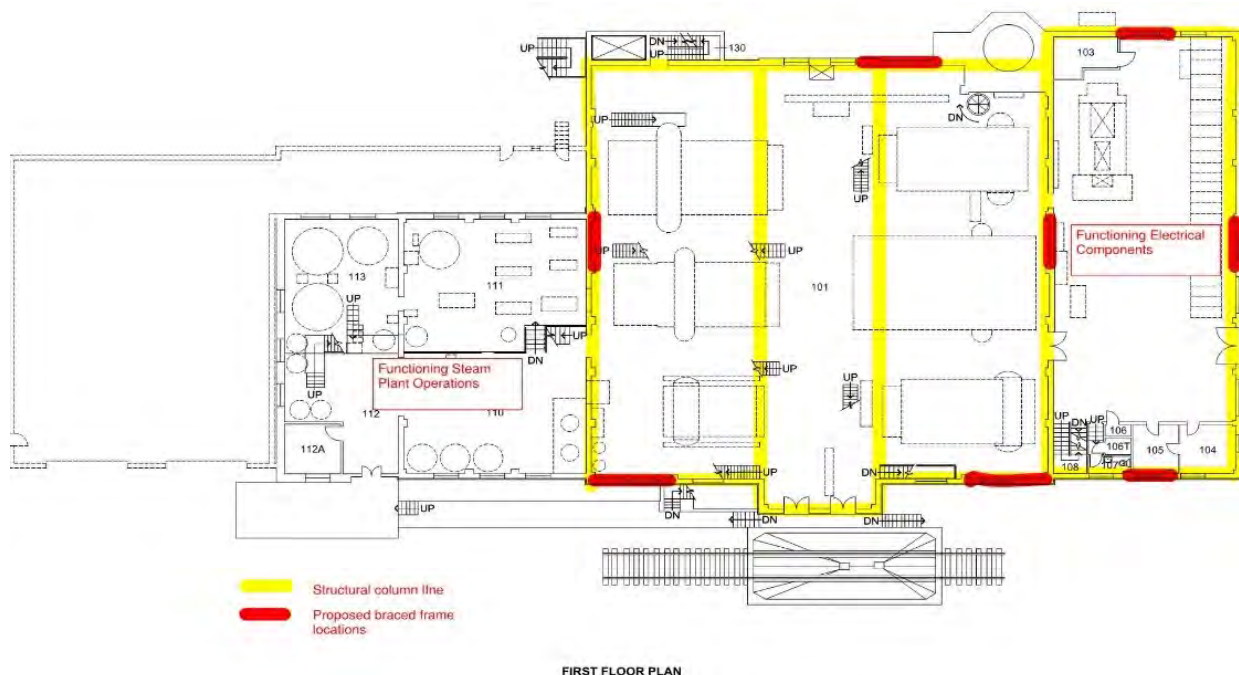

Credit: DCI Engineers

Since the building has been functioning as a university steam plant for its entire life, there is no documentation of the International Building Code Risk Category. The portion of the building that will be repurposed into office or restaurant space likely will be classified as a Risk Category II structure. It is unclear whether the adjacent space to the north and the electrical equipment in the space to the south would be classified as a Risk Category IV occupancy. If the spaces to the north and south support essential facilities such as the fire station, the police station, or WSU's communications that handle

EXISTING CONDITIONS

life safety functions, they should be classified as Risk Category IV. That classification would also extend to the repurposed space of the building or a portion of the building housing any utilities that supply any services that can lead to require its classification as an essential facility.

Regulatory Analysis

The Steam Plant is within the city limits and is subject to the development regulations imposed therein. The following is a summary of the regulations imposed on development and their implications for the proposed development activity.

Comprehensive Plan. The Property is under the WSU comprehensive plan designation, which is placed on all WSU-owned property within the Pullman city limits. The goals in the City's comprehensive plan support allowing WSU to have ultimate control over its land use activities, with some limited exceptions. Additionally, the City is tasked with cooperating with WSU to ensure that development in either jurisdiction is compatible with the other jurisdiction's interests and is well-coordinated with respect to public facilities and services.

Zoning Code. Per City zoning maps, the Property is zoned "WSU." Per Section 17.90.030 of the PCC, no specific development standards apply to the WSU zone district, as WSU maintains a capital planning and development operation to administer its own university development standards. Additionally, City standards for off-street parking (Ch. 17.40 PCC) and site plan review (Ch. 17.135 PCC) do not apply to the WSU zone district.

Building Code. The City will oversee the building permit approval process. Since the building has been functioning as a steam plant for its entire life, there is no documentation of the International Building Code Risk Category. Discussions with the City to determine the risk category have not been initiated. Additional discussion involving the building code and the change of use implications is provided in the Structural Assessment section (see pages 2-9 and 2-10).

Shoreline Master Program. The Shoreline Management Act (Chapter 90.58 Revised Code of Washington) defines shoreline jurisdiction as the shorelands extending 200 feet landward from the ordinary high-water mark of a shoreline water body. The South Fork of the Palouse River runs west of the Steam Plant. As the Property is more than 200 feet landward of the Palouse River, it is not in the shoreline jurisdiction and the regulations in the City's Shoreline Master Program would not apply to this project.

Critical Areas/Greenways/Environmental Overlays. As the Property is located outside any identified critical areas, Ch. 16.50 of the PCC does not apply to development activities proposed for the Steam Plant.

Natural Resources

This section discusses natural resources present on the Property in the context of the proposed redevelopment. Given the existing development on the Property, the implications for the proposal associated with natural resources and critical areas are limited.

TOPOGRAPHY AND SOILS

Based on the U.S. Department of Agriculture Natural Resources Conservation Service Web Soil Survey Maps, the following soil types underlie the Property:

EXISTING CONDITIONS

- Caldwell silt loam, 0 to 3 percent grade
- Gwin-Linville Complex, 30 to 65 percent slope

Both soil units are considered not to be hydric. The Gwin-Linville Complex consists of cobbly silt loam, transitioning to unweathered bedrock. Caldwell silt loam is considered to be prime farmland soil, while soils in the Gwin-Linville Complex are not.


FISH AND WILDLIFE HABITAT

The Property is approximately 500 feet east of the South Fork Palouse River, a Type S (Shoreline) stream. As the Property is more than 200 feet landward of the river, shoreline permitting will not be required for the proposal. Additionally, the Washington State Department of Fish and Wildlife Priority Habitat Species maps did not indicate the presence of threatened or endangered species or critical habitat on the Property.

FLOODPLAINS

Flooding from the South Fork Palouse River represents a low risk to the Property. Approximately 780 square feet of the northwest portion of the Property is designated Zone B, an area of low to moderate risk. It is between the limits of the 100-year and 500-year floodplain, with a 0.2 percent (or 1 in 500) annual chance of flooding. Figure 12 depicts the limited flood risk influencing the Property.

Figure 12: FEMA Flood Insurance Rate Map

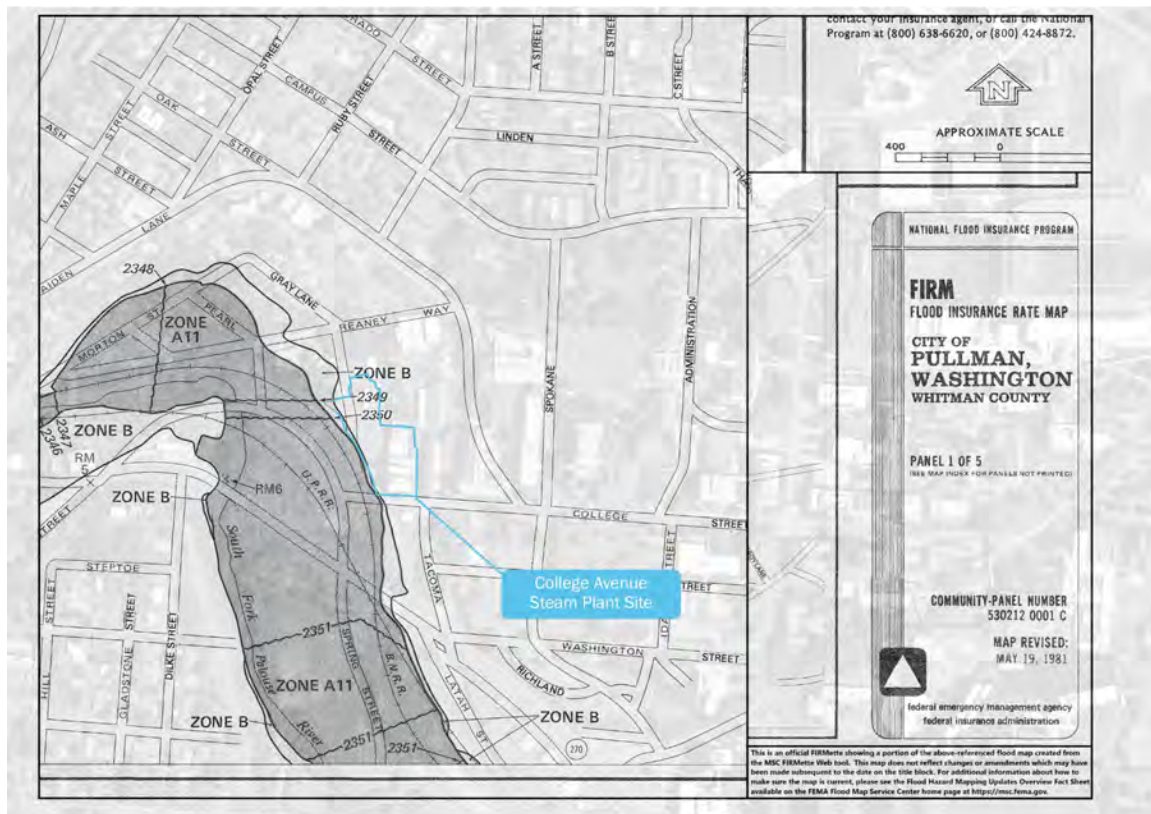

Credit: Federal Emergency Management Agency Flood Map Service Center

Cultural Resources

As required before issuance of IPG funds, Ecology completed a review of the proposed activity under Governor's Executive Order 21-02. The following is a summary of findings from the State Historic Preservation Officer and the Washington State Department of Archaeology and Historic Preservation (DAHP), as well as staff research, regarding the proposed adaptive reuse of the Steam Plant building.

ARCHAEOLOGICAL SIGNIFICANCE

The DAHP Washington Information System for Architectural and Archaeological Records Data maps indicate a "very high risk" of encountering archaeological or cultural resources during ground-disturbing activities. Ground-disturbing activities associated with the proposal were limited to the areas of concern (AOCs) that were necessary to inform potential cleanup actions. No resources were uncovered during the environmental investigation.

HISTORIC STRUCTURES

In their Executive Order 21-02 review letter, DAHP concluded that the Steam Plant building is eligible for listing in the National Register of Historic Places as a contributing resource to a potential historic district that may be located on the WSU Pullman campus. Additionally, DAHP concluded that the project as proposed will not adversely impact the historic property. Therefore, the proposed project will not have an adverse effect on the historic building.

HAZARDOUS MATERIALS SURVEY

A hazardous materials survey at the Steam Plant building in October 2021. The objective of the survey was to identify building materials and components that may require abatement, special handling, or disposal during future demolition or construction activities. The survey included the use of a portable X-ray fluorescence (XRF) device to screen materials for the presence of lead-based paint (LBP); sampling and analysis of suspected asbestos-containing materials (ACM); and visual inspection and tracking of suspected polychlorinated biphenyl (PCB)-containing fixtures, mercury-containing fixtures, and other potentially hazardous materials

The scope of work included the following:

- Collecting bulk samples of suspected ACM.
- Using a portable XRF device to field-screen painted surfaces for the presence of lead in surface paint.
- Collecting quality control paint chip samples for laboratory analysis.
- Submitting suspected ACM bulk samples and paint chip samples to a laboratory accredited by the National Voluntary Laboratory Accreditation Program. Suspected ACM samples were analyzed by polarized light microscopy.
- Recording the location, quantity, and quality of homogeneous areas identified in the Steam Plant building.

Based on observations and the results of the material testing, MFA found the following:

EXISTING CONDITIONS

- Other than pipes specifically marked as non-ACM, most of the thermal system insulation associated with piping throughout the basement, first floor, mezzanine, and upper mezzanine areas is ACM.
- Window glazing throughout the first floor, mezzanine, and upper mezzanine is ACM.
- The various types of vinyl tile flooring in rooms 103, 104, 200S, 202, and 203 are ACM.
- There are LBP coatings and paint throughout the interior and exterior of the structure.
- Fixtures potentially containing hazardous materials are present throughout most of the Property.
- Coal dust residue is present in rooms 201, 204, 301, and 302.
- Room 301 is labeled as an asbestos-containing-dust hazard.

The detailed findings of this work were shared with the cost estimators to inform demolition costs. Prior to any disturbance activities at the Property, identified hazardous materials should be abated by a licensed abatement contractor or safely managed in place consistent with a written operations and maintenance plan. The complete Hazardous Materials Survey Report can be found in Appendix D.


Environmental Considerations

This section discusses known and suspected areas of contamination on the Property, based on identified features of interest associated with historical operations, areas of contamination identified during previous sampling activities, and the nature and extent of contaminants of concern. Various locations on the Property have either known or suspected petroleum, coal, and PCB contamination and will require cleanup to accommodate the proposed reuse.

CLEANUP PROCESS

Cleanup of contaminated sites in Washington State is regulated under the Model Toxics Control Act (MTCA) through Ecology's Toxics Cleanup Program. The administrative rules for implementing MTCA (Washington Administrative Code 173-240) establish the procedural and technical requirements for remediation. Before a contaminated property can be redeveloped, it is necessary to understand the character and extent of contamination and the potential impacts of that contamination and to establish agreement with Ecology as to how the impacts will be addressed. Figure 13 frames the cleanup process in Washington. The assessment work and study conducted under this grant has been completed through the cleanup action plan step.

Figure 13: Cleanup Process



AREAS OF CONCERN

AOCs have been identified based on activities, conveyances, and physical features (e.g., equipment, tanks, and vaults) associated with current features and former Steam Plant operations that may have resulted in a release of hazardous substances to the air, soil, or groundwater on site. The following is a summary of the five AOCs identified for the Property.

EXISTING CONDITIONS

AOC 1: Steam Plant Building

The Steam Plant building is an AOC, based on the use of coal in the plant. Additionally, soil vapors associated with coal and diesel in the subsurface may be present. Historical reports also indicate that ACM and LBP are present inside the Steam Plant building. The presence of hazardous building materials was confirmed, according to the Hazardous Materials Survey Report completed for the building (Appendix D).

AOC 2: Coal Bulk Storage and Transport Area

During Steam Plant operations, coal was transported via railcar to the western part of the Property, where it was offloaded and stored. Heavy equipment was then used to transport coal from the railcar for storage and use on site. Polycyclic aromatic hydrocarbons (PAHs) were identified in historical borings in the storage area. PAHs, volatile organic compounds (VOCs), and diesel-range organics (DRO) may be present in soil and groundwater at the Property due to storage and transport of coal.

AOC 3: Former Diesel Tank Farm

Two diesel ASTs are located on site. These ASTs have been decommissioned and are not in use. Historical use and potential leaks or surface spills may have occurred on site, leading to the likely presence of diesel- and heavy-oil-range hydrocarbons and their associated constituents in subsurface soil and groundwater.

AOC 4: Avista Electrical Substation

An Avista electrical substation is located on site. Historically, transformers used at the substation held PCB-containing oil. Therefore, PCBs may be present in the subsurface as a result of leaking or spillage during operations.

AOC 5: Historical Oil Storage Area

This area is identified in an independent remedial action report¹ as an area of historical petroleum and PCB contamination. Confirmation samples taken throughout the extent of the excavation showed that impacted soil remained in two areas: beneath a concrete pad and beneath the eastern retaining wall. Excavation beneath these structures was not feasible and the remaining impacted soil was left in place.

In 2001, WSU constructed an addition to the Steam Plant building to house natural-gas-fired boilers for campus heating. The footprint of the addition occupies the location of the historical contamination and the former concrete pad. It is unknown if any remaining contamination was removed during construction activities. Therefore, it is possible that petroleum and PCBs may still be present in soils in this area.


¹ Independent Remedial Action Report, WSU Power Plant Oil Storage Area. Prepared for Washington State University, Facilities Development—McCluskey Offices. Parametrix, Inc., Pullman, Washington, February 1997.

EXISTING CONDITIONS

ASSESSMENT FINDINGS

Based on the 2021 investigation results, it appears that historical operations adversely may have impacted groundwater at the Property. Specific impacted areas and contaminants of concern are summarized in Figure 14 and are described below:

Figure 14: Summary of Analytical Results

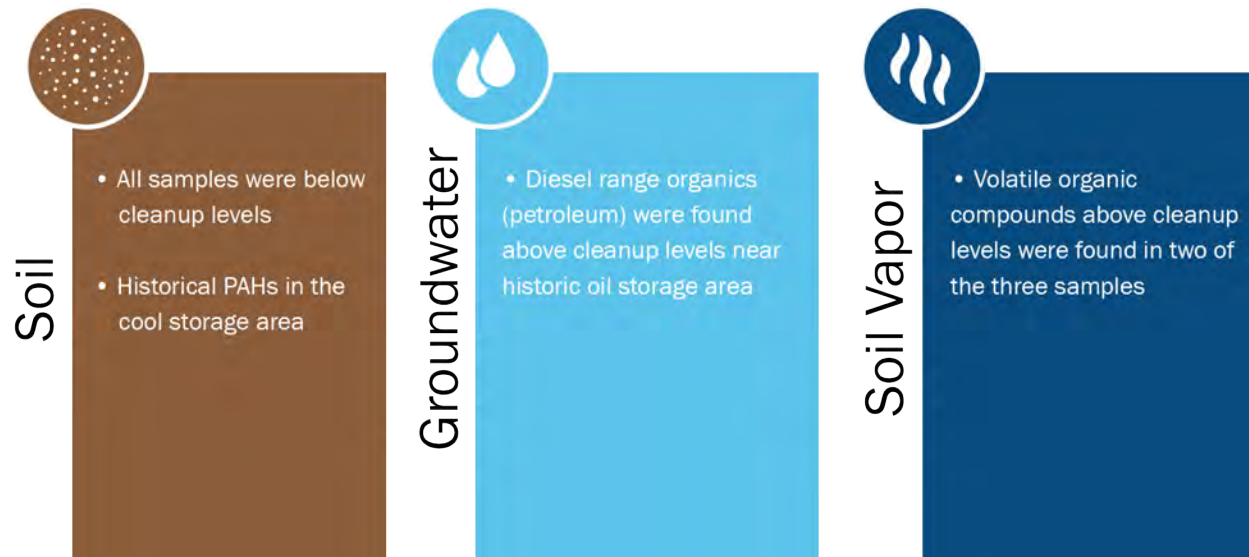

Credit: MFA

Soil: Soil beneath the 2001 boiler room potentially remains impacted, per the findings of the 1997 Parametrix investigation. Additionally, the remaining coal layer in the former bulk coal storage area is a potential source of PAH impacts to soil.

Groundwater: Groundwater on the northwest side of the Steam Plant building may have impacts from DRO and arsenic, likely related to a historical diesel spill in the area beneath the current boiler room, prior to the addition of this portion of the building. Additionally, the remaining coal layer in the former bulk coal storage area is a potential source of PAH impacts to groundwater. However, the samples were from reconnaissance borings and need to be confirmed with monitoring wells. Matrix interference in reconnaissance borings can bias results high.

Soil: Soil vapor beneath the original Steam Plant building is impacted with VOCs likely associated with historical operations.

The following may be current exposure pathways:

- Incidental ingestion of, and skin contact with, chemicals in surface and/or subsurface soil and groundwater
- Inhalation of fugitive dust generated from surface and/or subsurface soil
- Inhalation of outdoor air vapors that have emanated from soil or groundwater
- Inhalation of groundwater or subsurface soil vapors that have intruded into buildings
- Ingestion, skin contact, and inhalation of chemicals in groundwater used as drinking water
- Inhalation of indoor air vapors that have emanated from soil or groundwater

EXISTING CONDITIONS

The following are potentially complete human health exposure pathways:

Commercial/construction workers—there are petroleum impacts to shallow groundwater at the Property. When construction activities are conducted as part of Property redevelopment, construction workers could contact the substances, which are identified as indicator hazardous substances (IHSs) because of their elevated detections above MTCA Method A cleanup levels (CULs). An IHS is defined as a chemical exceeding a CUL at one or more locations. Because future construction workers may be exposed to the impacted shallow groundwater through ingestion, dermal contact, and inhalation of chemicals volatilizing from groundwater, appropriate protection of construction workers will be required.


Building occupants—there are VOC impacts to soil vapor beneath the building. Building occupants could be exposed to IHSs via vapor intrusion pathways. Because future occupants may be exposed to the impacted vapor through inhalation of chemicals volatilizing from soil or groundwater, appropriate protection of building occupants will be required.

CLEANUP OPTION DEVELOPMENT

One of the objectives of the environmental assessment effort is to identify and evaluate cleanup options that reduce contaminant exposure to levels that are protective of human health and the environment and that are appropriate for meeting the CULs at the Property. The following identifies feasible cleanup technologies to address contamination exceedances of MTCA Method A CULs in soil, groundwater, and sub-slab vapor and assembles those technologies into potential options.

Applicable remedial technologies to address contaminants in each medium are independent of each other. For this reason, cleanup options were developed for individual media and then combined into larger combined cleanup alternatives. The graphic in Figure 15 summarizes each cleanup technology by media.

Figure 15: Cleanup Technologies Considered

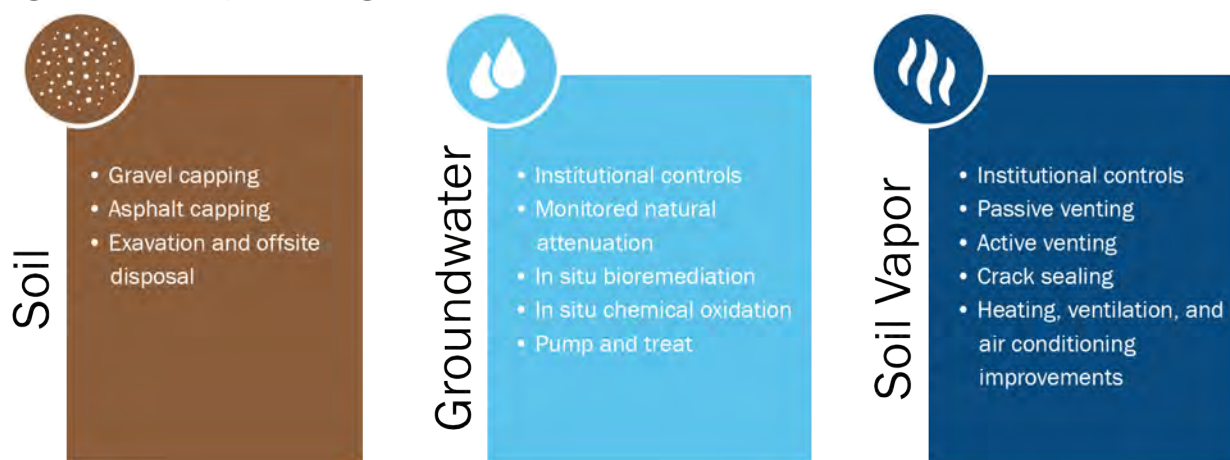

Credit: MFA

Cleanup options for the separate environmental media were combined into three cleanup alternatives. The following is an overview of the three cleanup approaches considered and the technologies that were considered for each. A detailed breakdown of cleanup cost estimates and assumptions is provided in the FSA report in Appendix C.

EXISTING CONDITIONS

Alternative 1: Gravel Capping, Vapor Sealing, and Monitored Natural Attenuation

Alternative 1 addresses soil cleanup using a gravel cap. This includes rough grading, capping with a nonwoven geotextile demarcation fabric, an annual inspection and maintenance plan, and an environmental covenant. The groundwater option for this alternative is monitored natural attenuation. This would involve installing three groundwater monitoring wells to a depth of 15 feet below grade. Groundwater would be monitored quarterly for each of five years after installation. To address vapor issues, this alternative would seal cracks in the building slab, install a gastight door from the basement to the subbasement, and construct a sub-slab passive vent pipe in the subbasement to reduce vapor-contact exposure risks to current and future occupants of the Steam Plant.

The probable cost of Alternative 1 is \$512,000. This estimate includes a 30 percent contingency and is considered to have a confidence of -30 percent/+50 percent.

Alternative 2: Asphalt Capping, Vapor Sealing, and Monitored Natural Attenuation

Alternative 2 addresses soil cleanup using an asphalt cap. This includes rough grading, capping with demarcation fabric over the former coal stockpile footprint, placement of an 8-inch-thick aggregate base layer, and capping with a 4-inch-thick layer of asphalt. An annual inspection and maintenance plan and an environmental covenant would also be put in place. The groundwater and vapor cleanup approaches of Alternative 2 are the same as those described in Alternative 1.

The probable cost of Alternative 2 is \$587,000. This estimate includes a 30 percent contingency and is considered to have a confidence of -30 percent/+50 percent.

Alternative 3: Excavation and Disposal, Vapor Sealing, and Monitored Natural Attenuation

Alternative 3 addresses soil cleanup by conducting soil excavation with off-site disposal. This includes a predesign investigation where additional sampling in the proposed excavation area would identify the extent of coal impacts and inform excavation design. This would be followed by excavation, disposal, backfilling, and institutional controls. The groundwater and vapor cleanup approaches in [of] Alternative 3 are the same as those described in Alternative 1.

The probable cost of Alternative 3 is \$845,000. This estimate includes a 30 percent contingency and is considered to have a confidence of -30 percent/+50 percent.

Preferred Cleanup Alternative

Alternative 2 is the preferred remedial alternative for the Property. This alternative protects human health by capping impacted soil and finds cost saving by aligning with the redevelopment plan. The estimated cleanup cost is \$587,000 (-30 percent/+50 percent). Recommendations provided in the FSA for the remediation and redevelopment are as follows:

- Delineate groundwater impacts near soil boring seven and the boiler room addition, and monitor groundwater for natural attenuation.
- Install an asphalt cap over the bulk storage area and inspect annually to prevent direct contact with coal material that may be a chemical and visual concern.
- Seal cracks and seams in the concrete building slab to prevent vapor intrusion.
- Install a passive venting system to direct potential vapors to outdoor vents.
- Seal the door that leads from the subbasement to the basement to prevent potential vapor migration into occupied spaces of the building.

EXISTING CONDITIONS

Groundwater data used in remedy development were from reconnaissance samples collected from temporary wells. These data are assumed to be representative of subsurface conditions; if groundwater data from monitoring wells indicate that the plume has not been well characterized, the proposed groundwater remedy should be reevaluated. A predesign basement inspection is recommended to identify areas of potential vapor intrusion to inform design of the passive venting system and crack-sealing effort. Design of an asphalt cap that effectively prevents contact with coal material can be incorporated into site development plans.

3 REUSE PLANNING



REUSE PLANNING

Reuse planning efforts for the proposed renovation of the adaptive reuse section of the Steam Plant are focused on providing a place that helps entrepreneurs commercialize their ideas, facilitates technology transfer from the region’s universities to the open market, and strengthens the town-gown connection associated with the city and the WSU campus.

“Town and Gown” refers to the relationship between the communities in which they are located (town) and local college campuses (gown). Universities, public and private, can provide many benefits to their outer communities, including jobs, economic development, and public/private investment. WSU and the City recognize the importance of a mutually advantageous town-gown relationship. As part of Pullman 2040, a community visioning initiative led by the Pullman Chamber of Commerce, the City, the Chamber of Commerce, and WSU entered into a memorandum of understanding, positioning the three organizations to work collaboratively to enhance the economic vitality of downtown Pullman, as well as to continue to make the city a desirable community for residents, tourists, students, and families. This effort, known as the Town Gown Collaborative, focuses on five main objectives: communications, first impressions of Pullman, improving conditions in the College Hill neighborhood, multimodal connectivity, and improving downtown Pullman. The Port believes that the proposed adaptive reuse of the Steam Plant building aligns with the Town Gown Collaborative’s mission through improving one of the gateways between the city and the college campus. This community initiative drove the idea of activating the ground floor of the Steam Plant with uses that serve entrepreneurs, the regional community, and visitors with a place to gather, eat, drink, and share ideas in an inspiring, open, adaptively reused building.

Examples of adaptive reuse projects where gathering and innovation were guiding principles are the Steam Plant Square in Spokane, Washington, and the Innovation Den in Coeur d’Alene, Idaho. Both of these projects, depicted in Figure 16, are inspirations for the adaptive reuse of the Steam Plant.

Figure 16: Regional Examples of Successful Adaptive Reuse Projects

Steam Plant Square, Spokane, WA



Source: DCI Engineers. <http://www.dci-engineers.com/project/steam-plant-square>

The Innovation Den, Coeur d’Alene, ID




Source: DCI Engineers. <http://www.dci-engineers.com/project/innovation-den>

Creating a place to gather is one important theme, but the key driver of the project is the need for space that will be operated by the Port to house a commercialization and technology transfer program

REUSE PLANNING

for research and intellectual property. Commercialization refers to the preparation of ideas for implementation in the open market, and technology transfer is the dissemination of technology from one organization to another to transform inventions and scientific outcomes into new products and services that benefit society. It is understood that efforts to promote commercialization and technology transfer are integral to the mission of public universities. Many universities have created successful commercialization hubs, which have housed startups using technology originating from academic research that have ultimately led to many successful businesses. The graphic in Figure 17 depicts the commercialization process from the Nova Southeastern University Office of Technology Transfer. A centralized place where technology transfer support can be provided, ideas can cross-pollinate, and potential capital partners may meet is an important aspect of the Port's vision for the Steam Plant. With the Port's help, and especially with its focus on helping these companies locate in Whitman County as they become established, these startups will have the space and support to grow.

Figure 17: Process of Technology Transfer

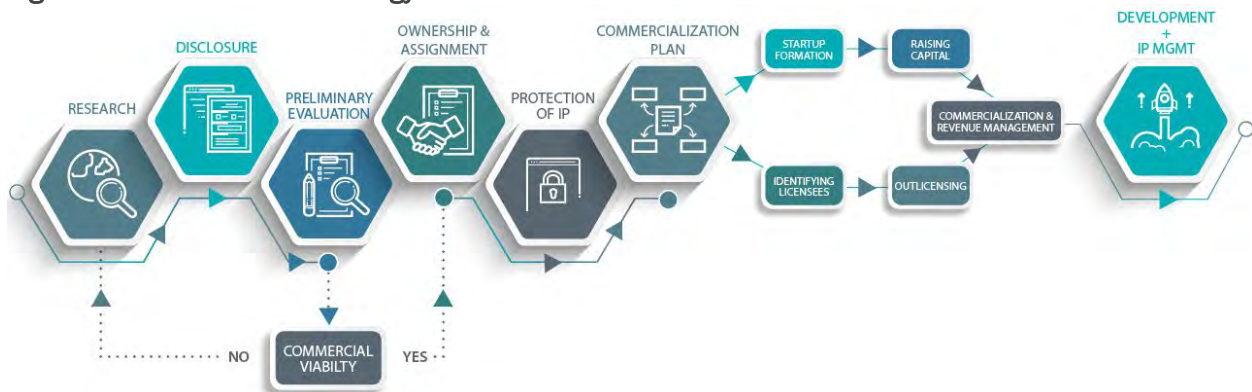


Source: NSU Florida. <https://www.nova.edu/ott/images/ott-flowchart.jpg>

Conceptual Site Plan

The conceptual site plan for the Steam Plant adaptive reuse was developed in collaboration with the Port and the project team, and in consultation with WSU staff. This vision provides gathering areas and space to facilitate commercialization efforts and business growth, and preserves areas to ensure that there are no disruptions to the operations and maintenance of the ongoing steam and electrical production. After the decommissioned boilers are removed and necessary structural improvements are completed, the adaptive reuse section of the Steam Plant could total nearly 37,500 square feet. The Port would operate 30,000 square feet of the space and the other 7,500 square feet would be accessible only to WSU for ongoing operations and maintenance. Figure 18 summarizes the conceptual site plan space program by space use. Figure 19 depicts the program in a section view, and Figure 20 illustrates the conceptual space program for each floor in plan view.


Figure 18: Space Program Summary

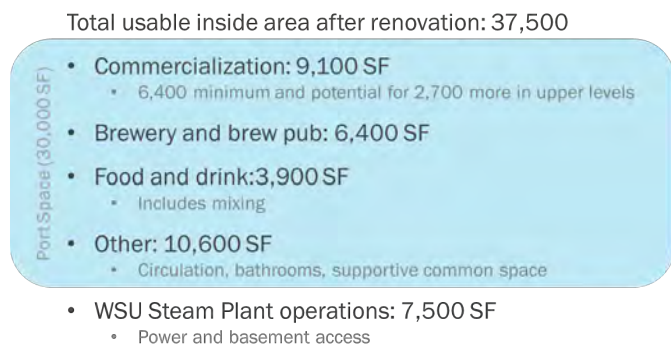

Credit: MFA

REUSE PLANNING

Figure 19: Conceptual Site Plan Section View

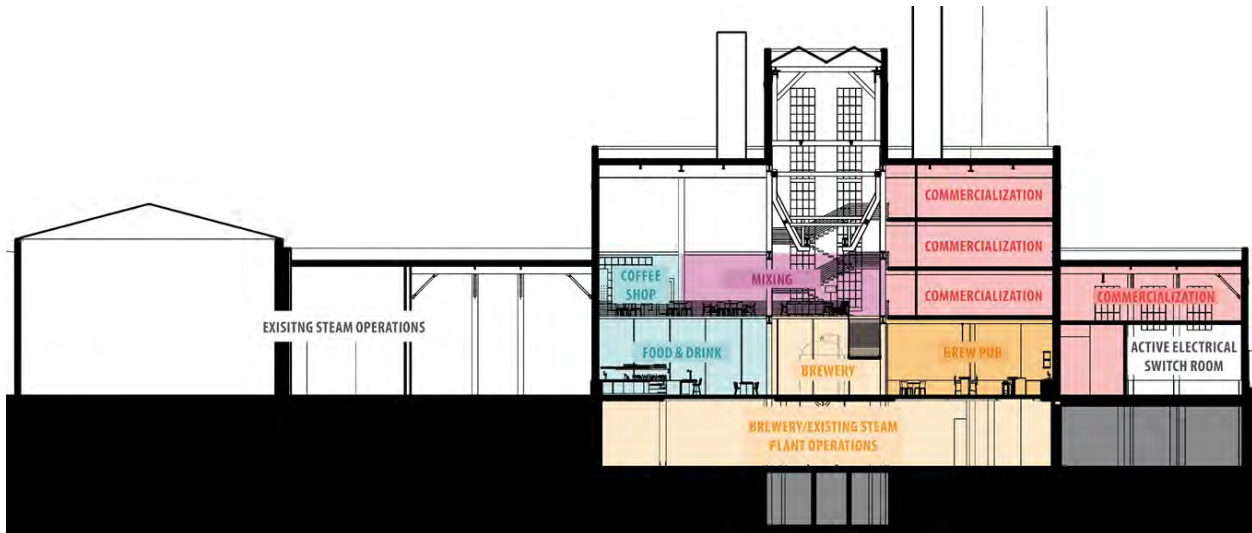

Source: Graham Baba Architects


Figure 20: Conceptual Site Plan Space Program Summary by Floor



Source: Graham Baba Architects

REUSE PLANNING

Figure 20, continued: Conceptual Site Plan Space Program Summary by Floor

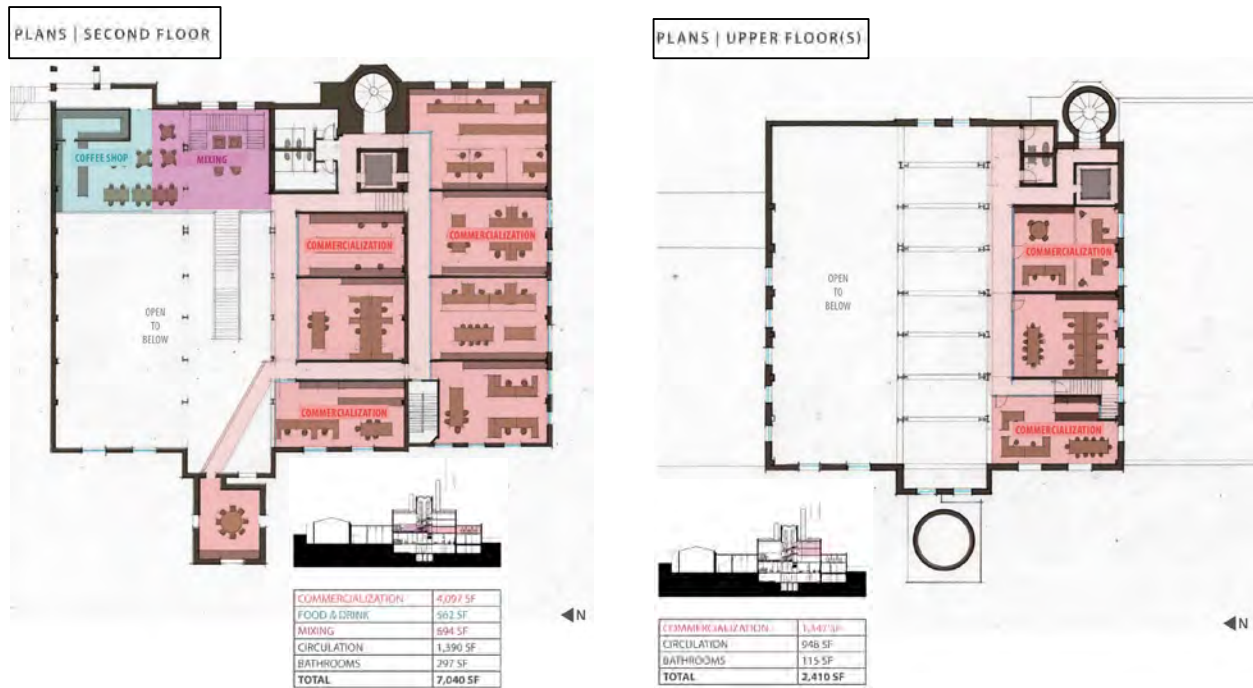

Source: Graham Baba Architects

The main floor of the high-ceilinged area of the adaptive reuse section of the Steam Plant will be used as a gathering space that could include a brewery with brewpub and a restaurant incubator that could host two to four aspiring restaurateurs. These gathering spaces could leverage and highlight WSU's leadership in food science with a brewpub and restaurant spaces serving food and beverages resulting from WSU food science research. A great stairway in the middle of the space will take visitors to the second level, where a mixing area and coffee shop would be located. Two outdoor patios would be constructed on either side of the Steam Plant's main, west-facing entrance. This would create an appealing new entry point for the public coming from campus or downtown Pullman. The portion of the basement that is not set aside for WSU's exclusive use could be used as a back-of-house space for the brewery and restaurants as well as some makers' space for the commercialization users.

The primary entrance for users of the commercialization space would be from the south-facing, College Avenue entrance. Most of the commercialization space on the first floor would be the entrance and circulation to bring entrepreneurs to the workspace on the upper levels. Much of the second story would be dedicated to the commercialization hub, with space for labs, offices, open workspaces, and meeting spaces. Floors three and four would contain additional office and open-air workspaces for the commercialization hub. Figure 21 illustrates the conceptual site plan. A complete package of the conceptual site plan is included as Appendix E.

Figure 21: Conceptual Site Plan Renderings




Source: Graham Baba Architects

Existing Use Integration

The proposed conceptual design takes several steps to preserve full functionality of the existing Steam Plant and to provide adequate separation between existing elements and proposed new occupancies. A new fire-rated wall will partition the western third of the basement for access to the existing steam pipes and associated equipment. The existing steam riser pipe, currently located in the northwest corner of the main volume of the boiler area, will be rerouted into the existing utility tunnel west of the building and then reconnect in the partitioned portion of the basement. This reroute will also clean up the current configuration, which takes the riser pipe up and over the roof of the building before it reenters the main volume of the building to get to the basement. The north wall of the main volume (existing boiler area) will be reinforced with shotcrete, both providing necessary seismic upgrades and creating a fire-rated condition between the proposed public portions of the building and the existing working steam plant. Finally, the existing electric switch gear in the south wing of the building will be enclosed with fire-rated walls and ceiling to provide separation from the proposed public portions of the building. Adequate space for ongoing maintenance of the equipment and multiple points of access for people and equipment are provided. Images of the switchgear area and basement steam pipes are shown in Figure 22.

Figure 22: Switchgear and Steam Pipes

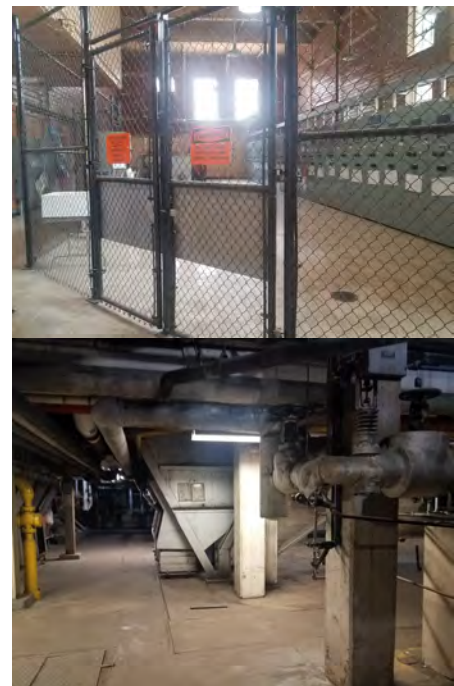

Source: Graham Baba Architects

Cost Plan

The cost plan is based on the conceptual plan detailed in the previous section. The cost plan anticipates a phased rehabilitation of the adaptive reuse section of the Steam Plant. It is explicitly acknowledged in the cost plan that portions of the adaptive reuse section of the Steam Plant will continue to generate steam to power the campus and electric utility equipment and that high-voltage power line conduits may interface with the future use conceived in the conceptual site plan. The cost plan factors in costs associated with maintaining continued power generation safely and accessibly.

The conceptual cost plan contains cost estimates for the conversion of a portion of the adaptive reuse section of the Steam Plant in the phases described below. Line-item details for each phase are included in the cost plan in Appendix F.

Phase 1: Hazardous Materials Abatement

This pre-demolition phase is focused on the abatement of asbestos, lead, PCBs, and other hazardous materials. As part of this project, the Port surveyed the entire adaptive reuse section of the Steam Plant, including the basement and subbasement areas that the Port will not use. These costs assume that the Port will conduct abatement activities in this entire area.

Phase 2: Demolition

The demolition phase would take place after the abatement is complete. This involves deconstructing and removing the decommissioned boilers and supporting equipment and structures in the basement and main floor up to the ceiling. This also includes the demolition of the metal addition above the southern section of the building and installation of new replacement roofing.

Phase 3: Warm Shell

The warm shell buildout would take place after the demolition is complete and prepare the adaptive reuse section of the building for use. In this phase the fire walls between Port use and WSU use would be created along with access to each area. The steam riser in the northwest corner of the adaptive reuse section would also be relocated to eliminate an incompatible interface with existing operations. The second floor in the adaptive reuse section would be created along with the third and fourth floors of the commercialization space. Bathrooms, stairs, elevators, and utilities including fire protection systems would also be brought into the building per the conceptual site plan.

Phase 4: Build Back

The final phase would complete the conceptual site plan. The commercialization space would be finished, the brewery and equipment built, kitchens and seating areas constructed, and mechanical and electrical systems finished.

Site Work

This phase, which likely would take place during Phase 3 or Phase 4, would include improving the west-facing façade and outdoor patios and would also ensure that utilities serving the Property were updated and management of stormwater in the paved parking lot was addressed.

The cost plan estimate assumes that prevailing wages apply for all labor costs and that development soft costs, permits and fees, and taxes are included in the budget. A list of the soft costs, fees, and taxes accounted for can be found in Appendix F. The cost estimate of \$29,665,000 is escalated to first-quarter 2023 dollars. Costs for cleanup of environmental contamination found below the building or on the grounds are excluded from the cost plan. Multiple sources were used in preparing the cost models. The source information includes a perspective on current codes, technology, energy

REUSE PLANNING

conservation, specific site elements, local general and sub-construction markets and labor agreements, material costs and availability, and labor efficiencies. The cost estimate for the project is summarized in Table 2.

Table 2: Cost Plan Summary

Phase	Estimate*
Phase 1: Hazardous Materials Abatement	\$874,000
Phase 2: Demolition	\$2,294,000
Phase 3: Warm Shell	\$8,284,000
Phase 4: Tenant Improvement	\$7,180,000
Sitework	\$3,342,000
Soft Costs at 35%	\$7,691,000
Total Construction Estimate	\$29,665,000
Environmental Cleanup (MFA)**	\$587,000
Total Project Cost Estimate	\$30,252,000


Source: DCW Cost Management

*In first-quarter 2023 dollars

** MFA estimate in 2022 dollars

The total cost per building area for this project is approximately \$990 per square foot (psf). The chart in Figure 23 shows the psf for each phase of the project. While these figures may appear high, given how construction materials and labor costs have escalated over the past two years and the fact that this estimate is projecting out an additional year, these costs are in line with complex demolition and adaptive reuse projects estimated by the project team cost estimator.

Figure 23: Cost Plan by Square Foot

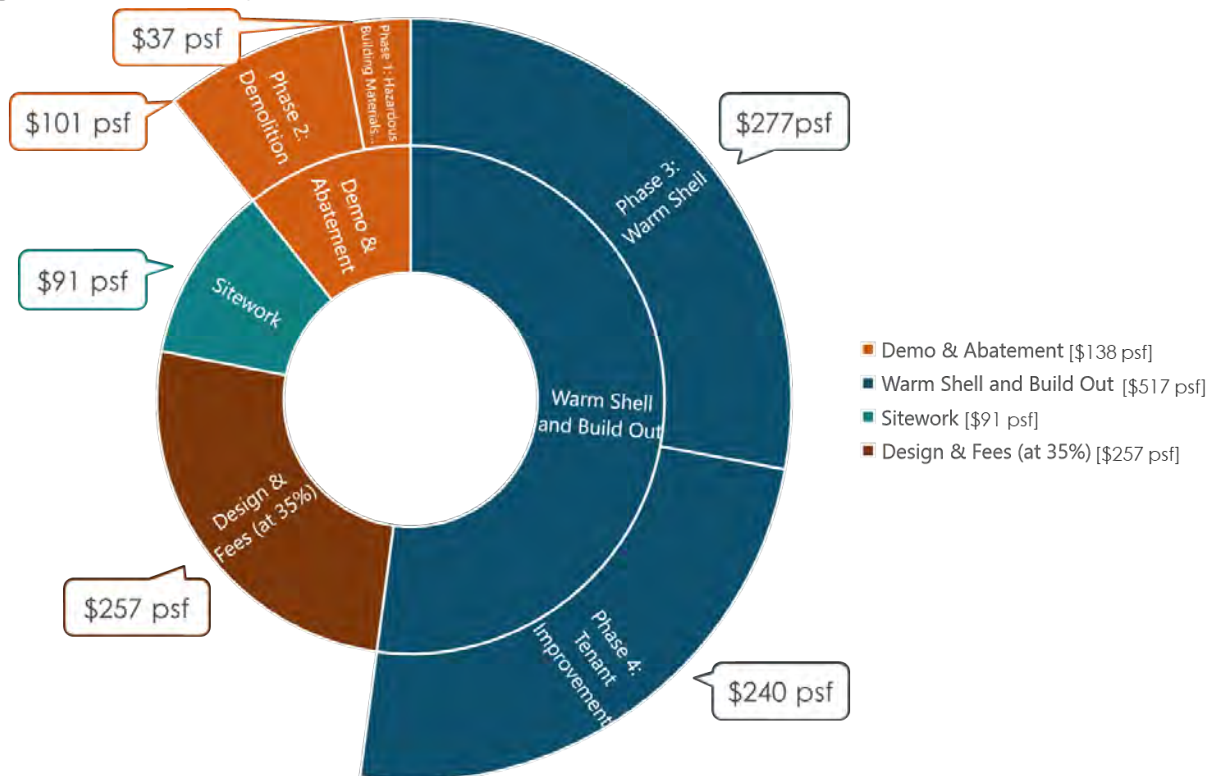

Source: DCW Cost Management

REUSE PLANNING

4 RECOMMENDATIONS

CAUTION !
HEAD BANGER

REUSE PLANNING

The Port’s renovation of the adaptive reuse section of the Steam Plant has the potential to be a transformational project in several respects. The conceptual plan envisions a main floor where the community can gather in a historic atrium that is filled with conversation, food, drink, and ideas. It will help connect the campus to downtown, furthering the Town Gown Collaborative’s mission. The commercialization center will foster economic growth that will extend into Whitman County’s business parks and office buildings as businesses mature. The Steam Plant project will result in positive, direct economic impacts, including construction jobs, food and beverage jobs, and jobs related to the operation of the commercialization center. There likely will also be indirect benefits that extend into the community. This is what is driving the Port to deliver on this project.

The recommendations in this section are provided to help the Port advance the adaptive reuse of the Steam Plant. Through this effort, several risks to feasibility have been identified and quantified, including environmental, structural, and development costs. The graphic in Figure 24 provides three important lenses through which to view project feasibility: physical, market, and financial.

- Physical:** The conceptual site plan meets the Port’s space objectives and the challenges with the physical feasibility are understood, which is why this consolidation is noted as green. These issues have been identified and quantified. With close coordination with WSU throughout the design and construction process the mitigation of operational interface with steam and power generation can be addressed.
- Market:** The Port will need people with an entrepreneurial spirit to leverage the services and connections offered by the Port-run commercialization center to bring their ideas to the market. This consideration is yellow because the depth of this user market has not been quantified under this grant; however, given the educational institutions in the area and the region’s entrepreneurial spirit, the Port believes that there will be demand. The same is true with a brewer to anchor the first floor and food and beverage startups. Near-term next steps will address market depth.
- Financial:** The costs are understood because of the work completed under the IPG grant. While sources of grant funds and financing tools have been identified, this consideration is yellow because a business plan that informs how each phase of construction will be paid for and models the revenue and operational costs is still needed.

Figure 24:
Feasibility Considerations



Action Steps

The redevelopment of the adaptive reuse section of the Steam Plant will take place over several years given the costs and related need for grant funding and use of other financing tools. The critical actions for the Port are outlined in Figure 25. These actions are divided into near-term, mid-term, and long-term actions. The near-term actions focus on three areas: reaffirming the Port’s relationship with WSU, pursuing cleanup funding, and advancing the business planning for the project using a Community Economic Revitalization Board (CERB) Planning Grant. Mid-term actions involve performing environmental cleanup actions on the Property and conducting hazardous material abatement, removing the decommissioned boilers, demolishing the interior, and advancing the funding strategy. All of the Port’s interior abatement and demolition activities will be conducted in close coordination with WSU. In the long term, the Port will complete the build out of the adaptive reuse section of the Steam Plant, sustain operations, and ensure available space for commercialization efforts.

Figure 25: Near-, Mid-, and Long-Term Action Steps

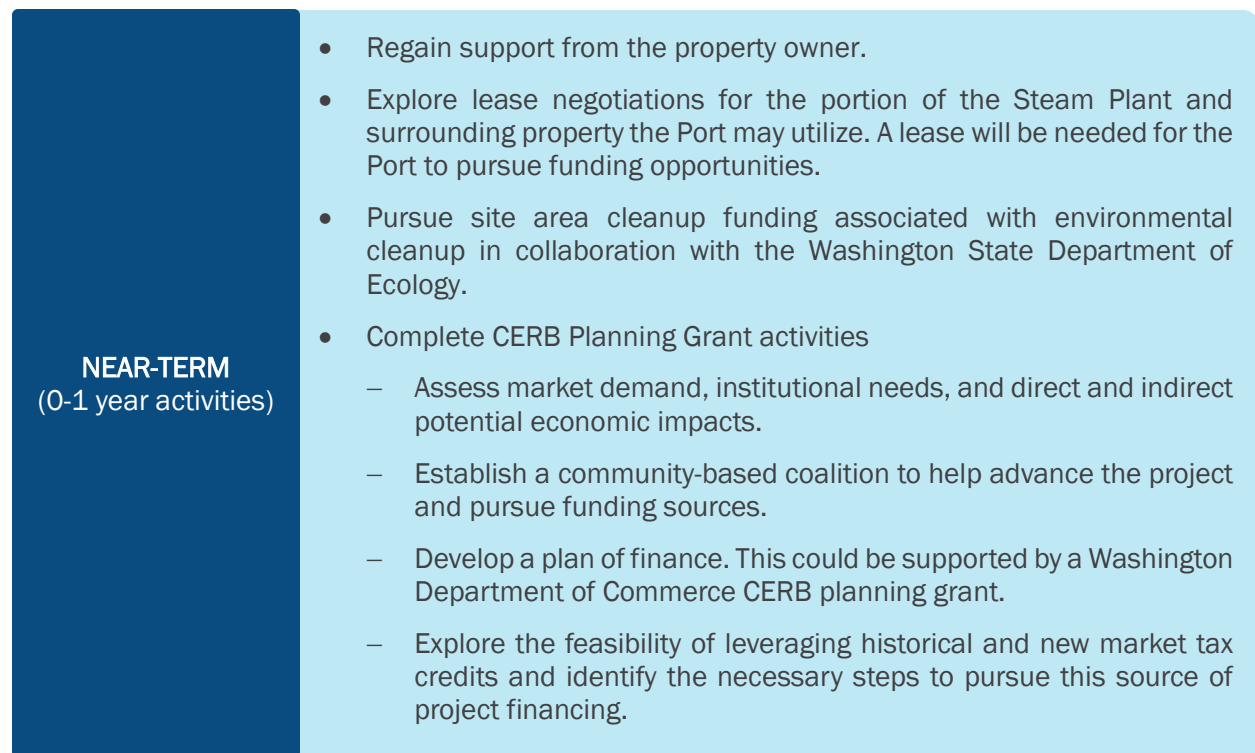


Figure 25, cont.: Near-, Mid-, and Long-Term Action Steps

<p>MID-TERM (1-2 year activities)</p>	<ul style="list-style-type: none"> • Complete hazardous building material abatement leveraging a U.S. Environmental Protection Agency Site-Specific Cleanup Grant or Washington Department of Commerce Brownfield Revolving Loan Funds. • Remove the decommissioned boilers and supporting equipment in coordination with WSU. • Refine project design, engineering drawings, and cost estimates leveraging a U.S. Economic Development Administration Economic Adjustment Assistance grant for non-construction activities. • Conduct environmental cleanup actions on the Property. • Pursue historic tax credits and/or new market tax credits to support construction. • Pursue construction grants from the U.S. Economic Development Administration and/or the Washington Department of Commerce. • Market the project to seed users including a brewer and restaurateurs.
<p>LONG-TERM (2 years+)</p>	<ul style="list-style-type: none"> • Secure funding sources such as U.S. Economic Development Administration Economic Adjustment Assistance grants for construction activities and financing sources such as historical tax credits and/or new market tax credits to support construction. Act on other financing mechanisms identified in the plan of finance. • Redevelop the site. • Sustain operations and ensure available space for commercialization efforts.

Address Environmental Concerns

The historical use at the Steam Plant and Property left residual environmental impacts that will have to be addressed to allow for redevelopment. The soil and vapor impacts can be remedied as part of the redevelopment, while the groundwater impacts will be monitored as the contamination is allowed to attenuate naturally. An effective environmental remediation approach should address three key issues: physical cleanup, administrative pathway, and funding.

CLEANUP ACTION

Based on the evaluation of cleanup options, the most appropriate option for the Steam Plant and Property appears to be Alternative 2, which involves asphalt capping of the parking lot, vapor sealing in the building, and monitored natural attenuation of the groundwater contamination. This option protects human health by capping impacted soil and finds costs savings by aligning with the

REUSE PLANNING

redevelopment plan. The estimated cost to implement this option is \$587,000. Approximately \$140,000 of this cost is for an asphalt cap, which may be used as a parking area.

To ensure construction worker health and safety, a contaminated media management work plan should be put in place prior to construction. This plan would identify appropriate personal protective equipment for construction workers, decontamination procedures, and erosion-control and dust-prevention procedures, as well as any other relevant health and safety practices.

ADMINISTRATIVE PATHWAY

MTCA establishes administrative pathways that provide a framework for processing cleanup projects through Ecology's Toxics Cleanup Program and determine the availability of liability protections. The pathways provide different degrees of Ecology involvement in cleanup and levels of liability protection. The pathway options are:

Voluntary Cleanup Program (VCP): Provides limited Ecology review at the work party's request and the potential for a No Further Action (NFA) letter from the state upon completion of a satisfactory cleanup. The VCP is the most used pathway for properties with relatively low levels of contamination. The NFA letter is typically acceptable assurance that allows financing institutions to lend money for development. However, Ecology opinions issued under the VCP are not binding and there is no formal settlement of liability.

Administrative Pathway Recommendation

Based on the type and extent of the contamination found in the Steam Plant and Property, it is recommended that the site be entered into the VCP so that it will be eligible for cleanup funding sources.

Agreed Order: Negotiated agreement between the lead work party and Ecology on the scope and schedule of the cleanup. If the work is being done in compliance with the order, Ecology cannot pursue additional enforcement actions against the work party. Agreed Orders are not settlements of liability and do not provide the party with either a "covenant not to sue" (meaning that Ecology will not pursue further legal action) or contribution protection (meaning that other potentially liable parties are prevented from seeking compensation from the liable party). An Agreed Order does provide some formal assurance that the cleanup actions meet state standards, and it can be the basis for a Consent Decree.

Consent Decree: Legal settlement of liability with the state. Judicial approval of the consent decree provides the work party with both a covenant not to sue from the state and contribution protection, which precludes claims by other parties. Consent decrees do include reopener clauses that allow Ecology to require additional or different remedial action if the party does not complete the cleanup, if the remedial action did not achieve cleanup standards, or if new information reveals a previously unknown threat to human health or the environment at the site. To date, Ecology has not reopened any consent decrees.

The greatest liability protection is provided through the consent decree, but this also requires the greatest level of state oversight and the highest transaction costs. The VCP is the most used administrative pathway because of its relative expediency. The choice of administrative pathway also has implications for funding.

FUNDING CLEANUP

There are three primary sources for funding environmental cleanup projects: state grants, federal grants, and historical insurance recovery.

REUSE PLANNING

State Grants. MTCA establishes a fee on imported hazardous materials, including petroleum, that funds a grant program to support local governments in cleanup of contaminated properties. This fund for local government grants is robust and has been budgeted at around \$65 million in recent biennia. These Remedial Action Grants typically cover 50 percent of cleanup costs and require local matching funds. There are two types of Remedial Action Grants: Oversight Grants and Independent Grants. Oversight Grants are provided to local governments conducting cleanup under an Agreed Order or Consent Decree. The match ratio for these grants can be adjusted, on a case-by-case basis, to as low as 10 percent funding. Independent Grants are available to local governments that conduct cleanups under the VCP. Independent Grants are limited to \$600,000 in total eligible project costs. Like the Oversight Grants, they typically require 50 percent match, but that can be adjusted to 10 percent. The Washington State Department of Commerce administers the state Brownfield Revolving Loan Fund (BRLF). The current pool of funds limits grants to \$200,000 for cleanup activities; however, the state is in the process of applying to the U.S. Environmental Protection Agency (EPA) for an additional allocation. If the application is successful, the grant maximum may be increased to \$500,000 per awardee. Whereas MTCA grants may be used only for the cleanup of contaminated soil, groundwater, sediment, and vapor, the BRLF funds may also be used for abatement of hazardous materials. If more than the grant limit is required, a low-interest loan with negotiable terms may be secured. There is no matching requirement, but there is a 1 percent origination fee of the funded amount.

Federal Grants. EPA provides grants of up to \$500,000 to local governments and nonprofit organizations for cleanup of contaminated properties. These grants are awarded on an annual basis through national competition. The applicant must provide a 20 percent match to the grant. There are several threshold eligibility requirements, including property ownership and having no liability for the contamination. Grant applications are evaluated on several criteria, including community benefit, the capacity and capability of the applicant to undertake cleanup, and the likelihood of success. Applications are due in the fall or winter of each year, with notification of awards issued in spring or summer of the following year. The upcoming round of grants (fiscal year 2023) that will be funded through the Bipartisan Infrastructure Law will have maximum awards of \$5 million and no cost share requirement.

Site-Specific Cleanup Grant

The Port applied for an EPA Site-Specific Cleanup Grant in December 2021. Award announcements will be made in late spring 2022. If awarded, these funds would be used to engage the community, fill in data gaps, and address hazardous materials in the Steam Plant.

Eligibility for the grant programs will be a key issue for this project. As a state entity, WSU is not eligible to apply for Remedial Action Grants. The Port could request a direct appropriation from the state legislature for cleanup funding. There is precedent from the University of Washington-Tacoma campus to obtain a direct appropriation of MTCA funds for a state university; however, it is understood that such a request may detract from higher-priority WSU projects. If the Property is transferred to a local public agency, such as the Port, that entity would be eligible for state Remedial Action Grants. This transfer likely would be done with a long-term lease agreement between the Port and WSU on the adaptive reuse section of the Steam Plant and the parking area. Since the Port did not cause the contamination, they would also be eligible for EPA brownfield grants and BRLF funding. A combination of these funding sources could provide 100 percent of the cleanup costs.

REUSE PLANNING

Table 3: Environmental Cleanup Grants

Program	Maximum Amount	Match Requirement	Eligibility	Notes
Independent Remedial Action Grant	\$600,000	Typically 50%, but can be reduced to as low as 10% local match.	Local government or special purpose district. Must be a liable party via ownership or have other responsibility for contamination.	Must be entered in VCP. Costs are reimbursed.
Oversight Remedial Action Grant	No maximum.	Typically 50%, but can be reduced to as low as 10% local match.	Local government or special purpose district. Must be a liable party via ownership or have other responsibility for contamination.	Must conduct cleanup under Agreed Order or Consent Decree.
BRLF	\$200,000 (possible increase to \$500,000). Average loan is currently \$500,000.	None. 1% origination fee.	Local government, special purpose district, nonprofit organization, or private party.	Grantee cannot have caused contamination of the property. Must be entered in VCP.
EPA Brownfield Cleanup Grant	\$500,000	20% local match. (FY23 grants have no match requirement.)	Local government, special purpose district, nonprofit organization.	Grantee cannot have caused contamination of the property.

Source: MFA Research

Historical Insurance Recovery. Property owners can pursue funds to support environmental investigation and cleanup through claims on liability insurance carriers that provided coverage to either a current property owner or previous property owners and site operators. Before the mid-1980s, commercial general liability policies did not contain exclusions for liabilities caused by environmental damage. Therefore, cost recovery may be pursued from historical insurance policies that were in place when pollution occurred and that covered a property owner, operators, or other potentially liable parties. Historical insurance recovery requires a commitment of time and resources but is a standard industry practice. It should be noted that actions seeking liability insurance claims for environmental damage to a property are not actions against the site owner or operator, nor do they impact current or future insurance premiums. These are claims for damages in the past and are covered by liability policies for which coverage premiums were paid.

LIMITATIONS

The services undertaken in completing this integrated plan were performed consistent with generally accepted professional consulting principles and practices. No other warranty, express or implied, is made. These services were performed consistent with our agreement with our client. This plan is solely for the use and information of our client unless otherwise noted. Any reliance on this plan by a third party is at such party's sole risk.


Opinions and recommendations contained in this plan apply to conditions existing when services were performed and are intended only for the client, purposes, locations, time frames, and project parameters indicated. We are not responsible for the impacts of any changes in environmental standards, practices, or regulations subsequent to performance of services. We do not warrant the accuracy of information supplied by others, or the use of segregated portions of this plan.

APPENDIX A

PROPERTY MAP




College Avenue Steam Plant Property Map

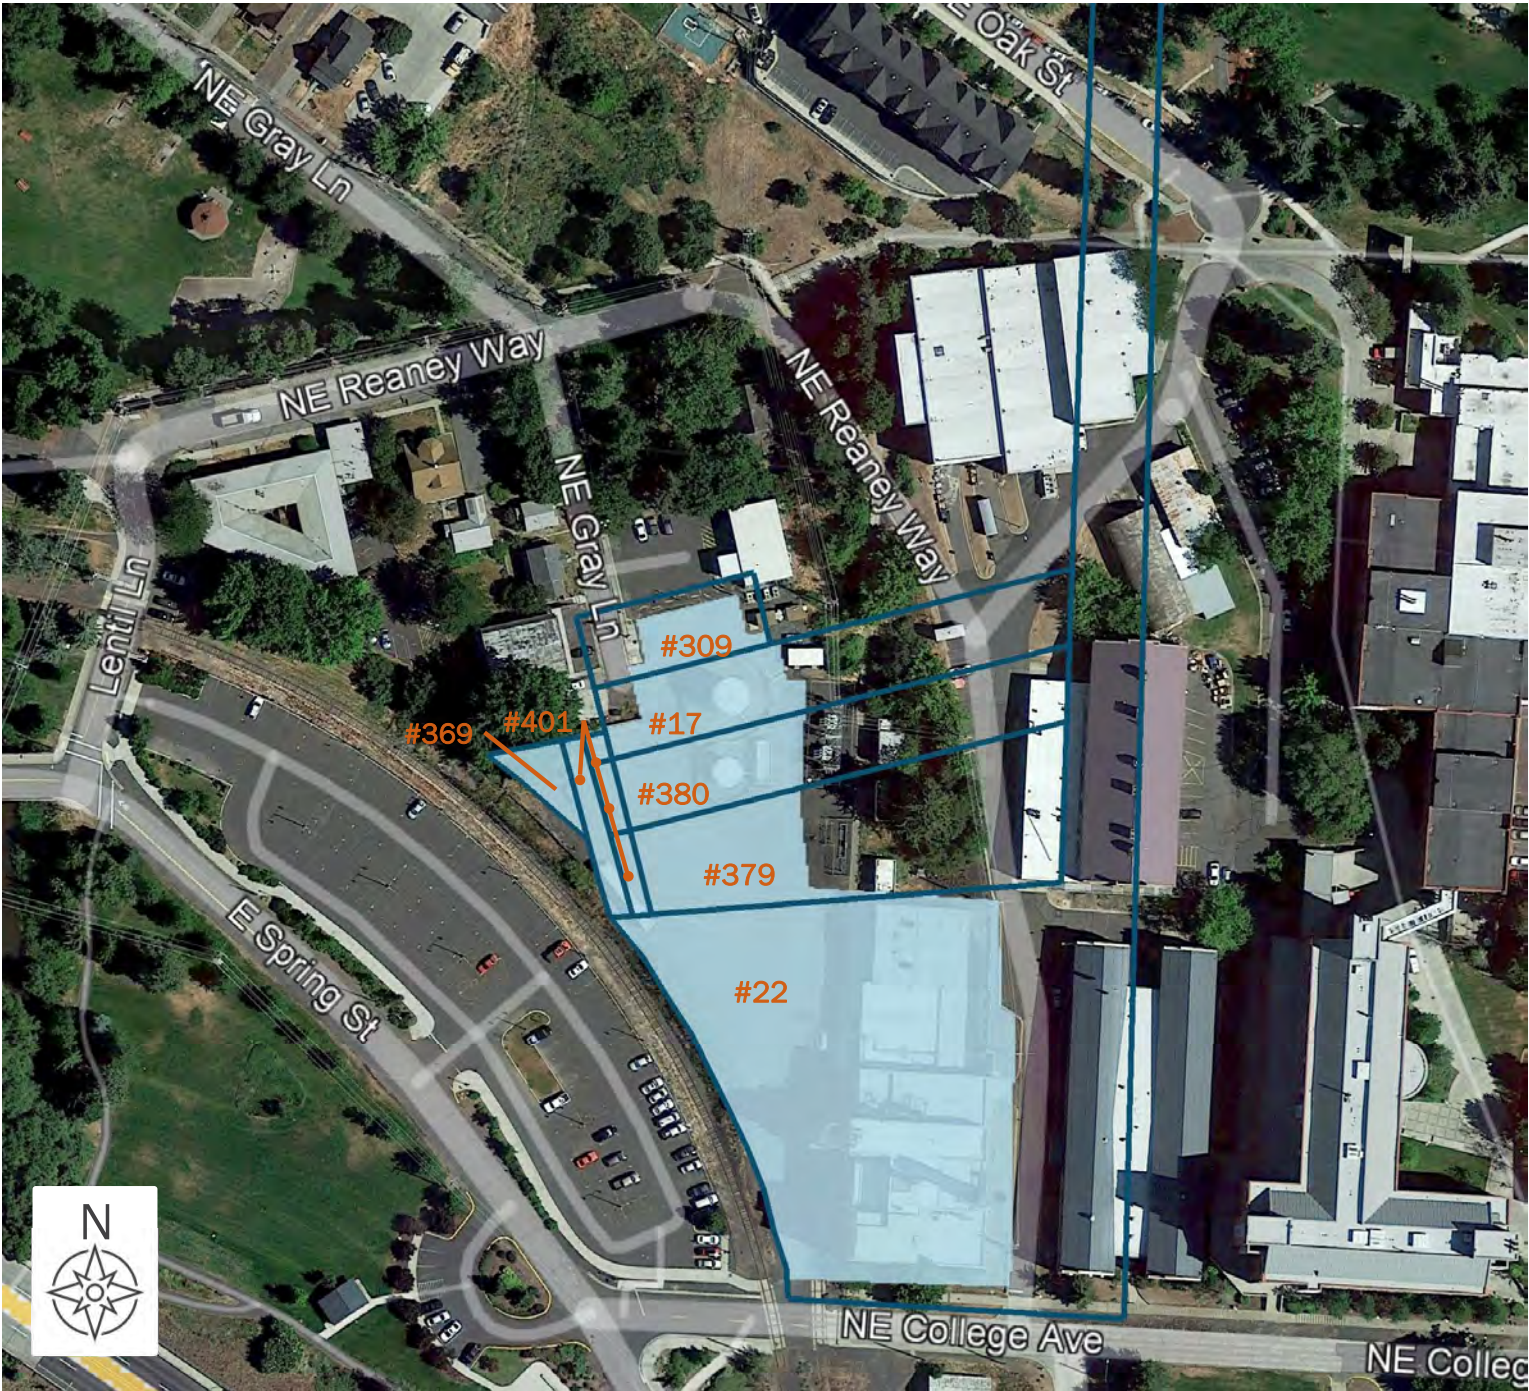

Legend

#369

Parcel Document Number



Steam Plant Property Area

Document Number	Parcel Number
#22	8-1460-00-00-00-0067
#379	1-1230-00-08-04-0001
#380	1-1230-00-08-04-0001
#17	1-1230-00-08-04-0001
#309	1-1230-00-08-04-0002
#401	1-1230-00-08-04-0001
#369	1-1230-00-01-01-0001

APPENDIX B

STEAM PLANT AND PROPERTY PHOTOGRAPHS





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 1.

Description

Exterior facing east



Photo No. 2.

Description

Exterior facing east





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 3.

Description

Exterior of sections
outside of scope



Photo No. 4.

Description

Exterior west facing
entrance





MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 5.

Description

Diesel storage tank in foreground and ash loader silo in background



Photo No. 6.

Description

Ash loader and west facing entrance





MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 7.

Description

College Avenue facing
entrance



Photo No. 8.

Description

Sign near College
Avenue entrance





MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 9.

Description

College Avenue
entrance



Photo No. 10.

Description

Southeast corner





MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 11.

Description


East facade



Photo No. 12.

Description

East facade

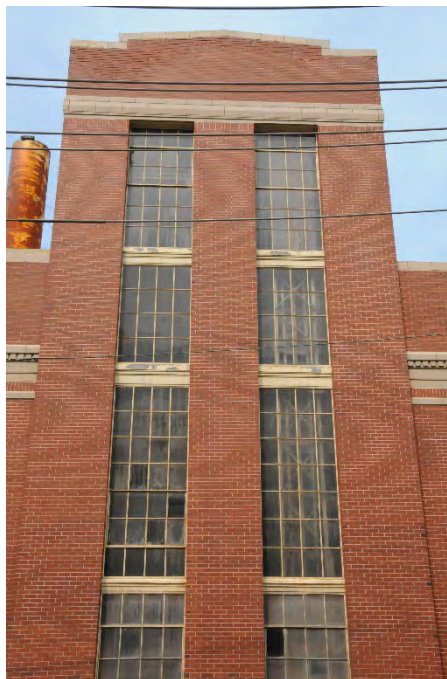



PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 13.

Description

Steam emitting from newer sector in foreground, north façade in background



Photo No. 14.

Description

Northeast corner





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 15.

Description

Parking lot and former coal storage area



Photo No. 16.

Description

Above ground bulk diesel storage tanks in north end of lot





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 17.

Description

Above ground bulk diesel storage tanks in north end of lot



Photo No. 18.

Description

Basement view





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 19.

Description
Basement view



Photo No. 20.

Description
Basement view





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 21.

Description
Basement view



Photo No. 22.

Description
WSU logo in basement





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 23.

Description

Steam pipes entering tunnel



Photo No. 24.

Description

Basement steam pipes





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 25.

Description

Basement steam pipes entering tunnel

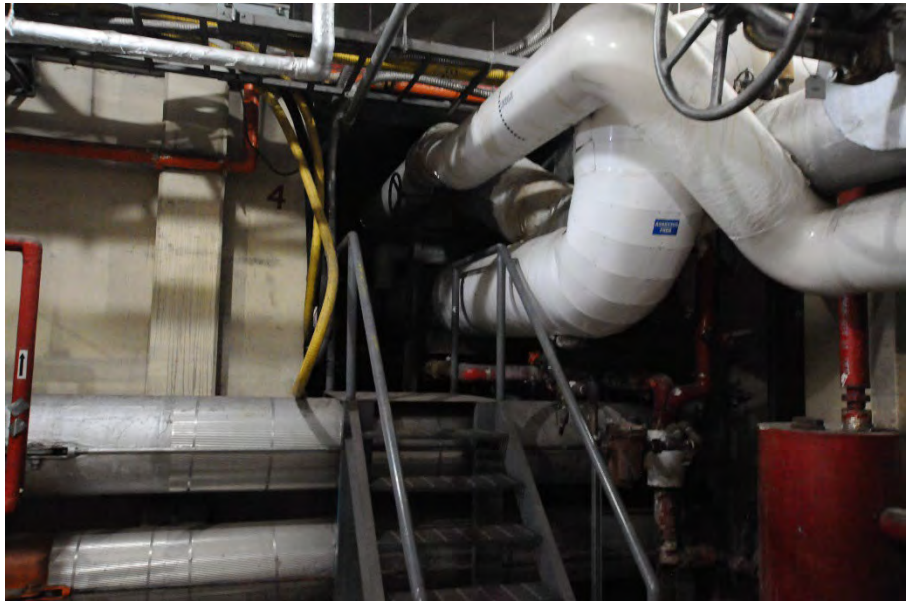


Photo No. 26.

Description

Basement view





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 27.

Description
Basement view



Photo No. 28.

Description
Basement view





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 29.

Description


Doorway into southern section from high ceiling section on main floor, looking south



Photo No. 30.

Description

High ceiling section boiler systems

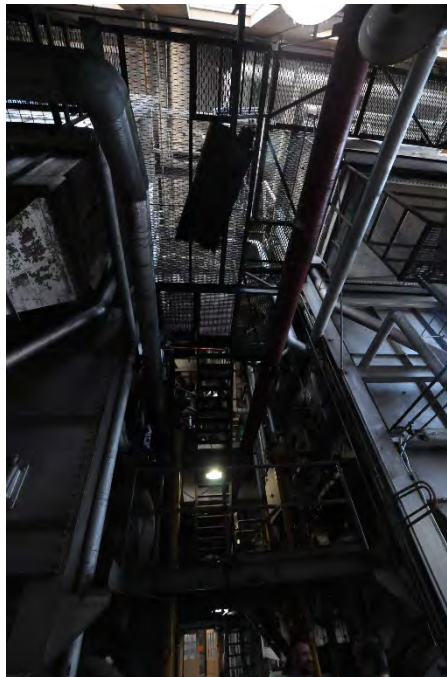



MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 31.

Description

High ceiling section
boiler systems



Photo No. 32.

Description

High ceiling section
boiler systems





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 33.

Description


High ceiling section
boiler systems



Photo No. 34.

Description

High ceiling section
boiler systems

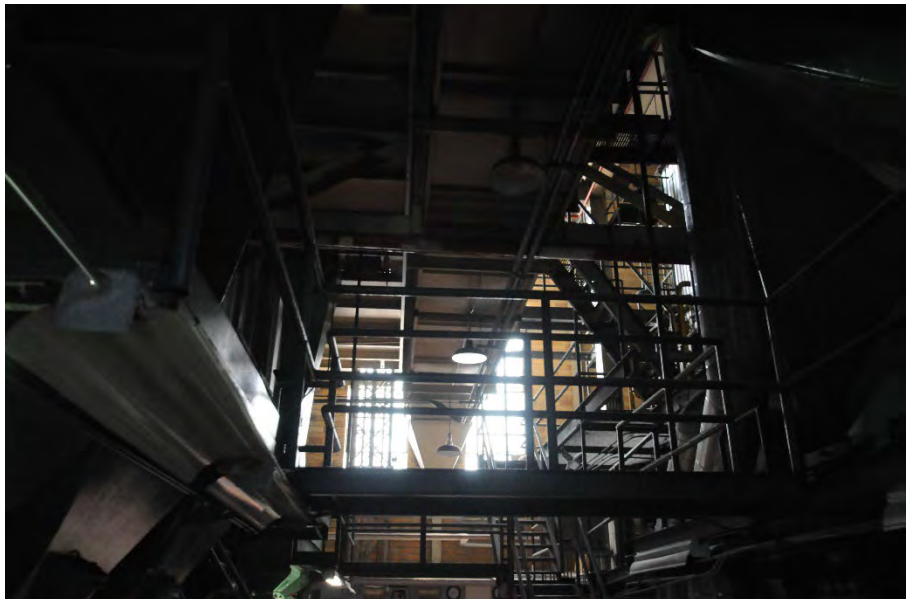



MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 35.

Description

High ceiling section
boiler systems

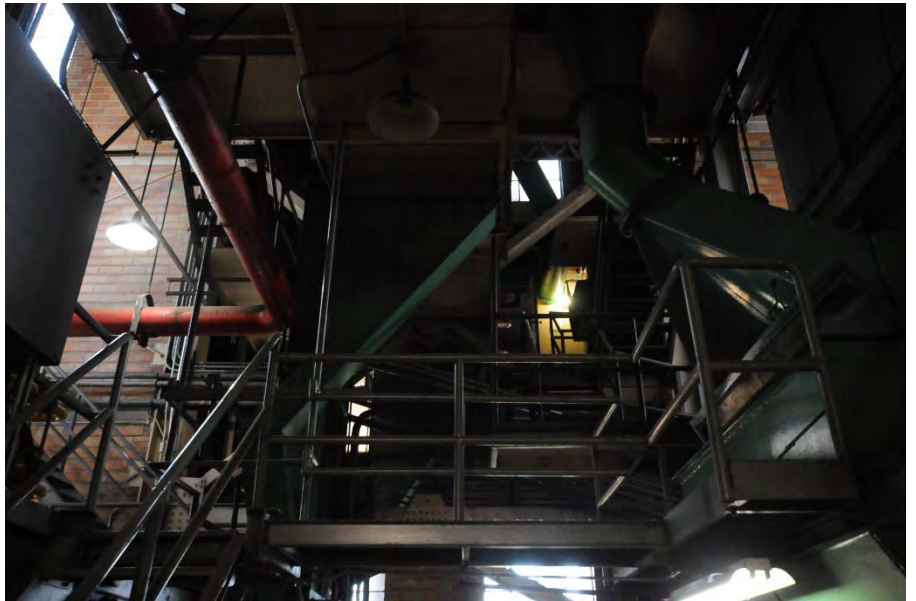


Photo No. 36.

Description

High ceiling section
boiler systems





MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 37.

Description

High ceiling section
boiler systems



Photo No. 38.

Description

High ceiling section
boiler systems





MAUL
FOSTER
ALONGI

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 39.

Description


High ceiling section
boiler systems



Photo No. 40.

Description

High ceiling section
boiler systems

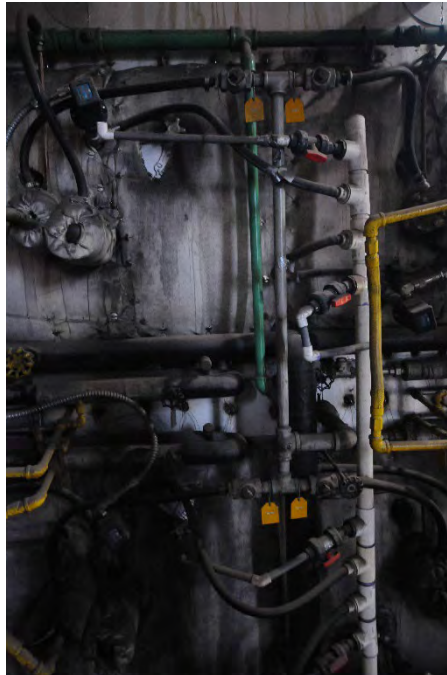



PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 41.

Description

High ceiling section
boiler systems

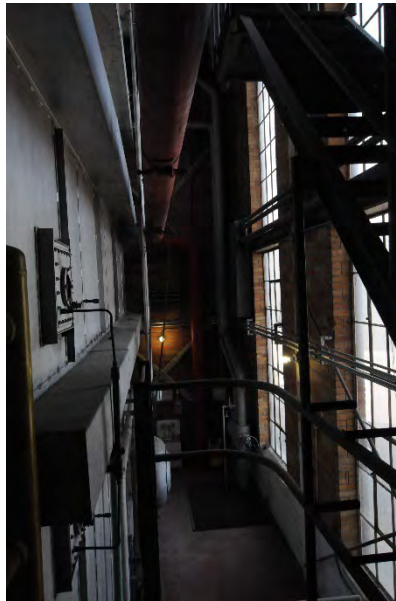


Photo No. 42.

Description

High ceiling section
boiler systems





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 43.

Description

High ceiling section
boiler systems



Photo No. 44.

Description

High ceiling section
boiler systems





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 45.

Description

High ceiling section
boiler systems



Photo No. 46.

Description

High ceiling section
boiler systems





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 47.

Description


Walkway on southern
roof under shed



Photo No. 48.

Description

Coal loader at top of
high ceiling section

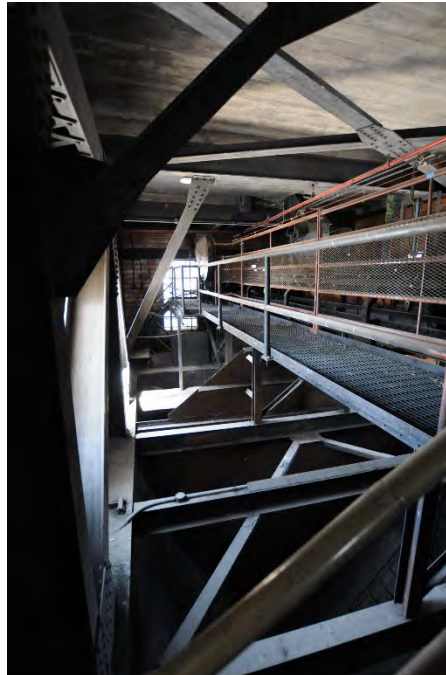



PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 49.

Description

Coal loader at top of high ceiling section


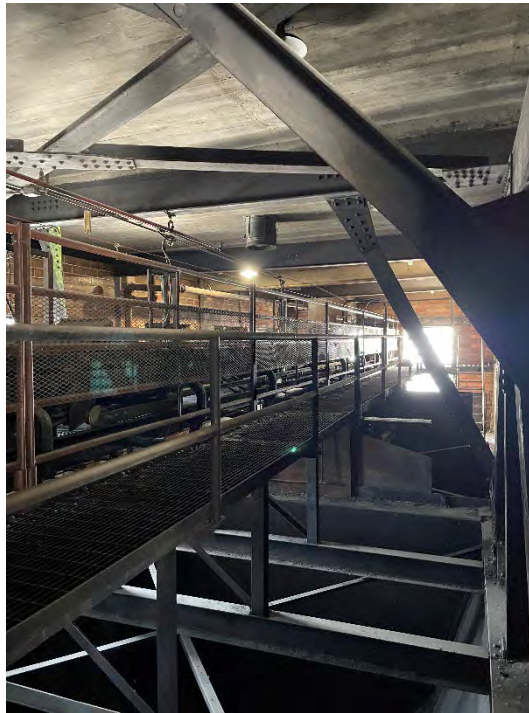


Photo No. 50.

Description

Coal loader at top of high ceiling section



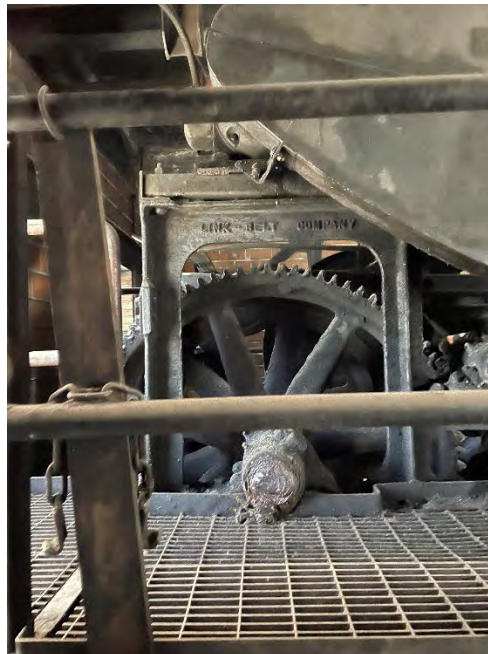

PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 51.

Description


High ceiling section
boiler systems



Photo No. 52.

Description

High ceiling section
boiler systems

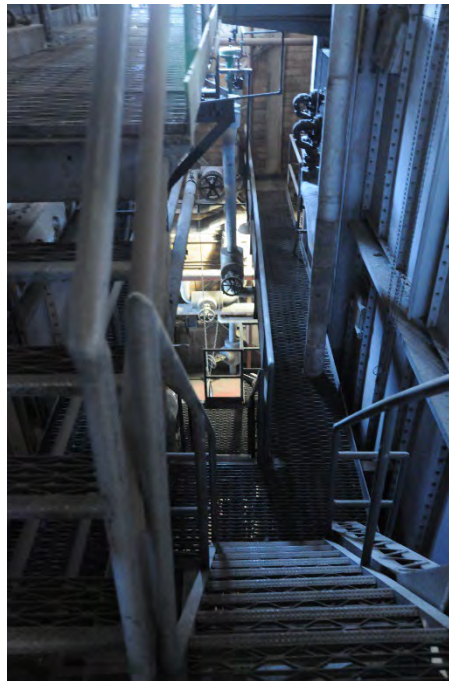



PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 53.

Description

High ceiling section
boiler systems

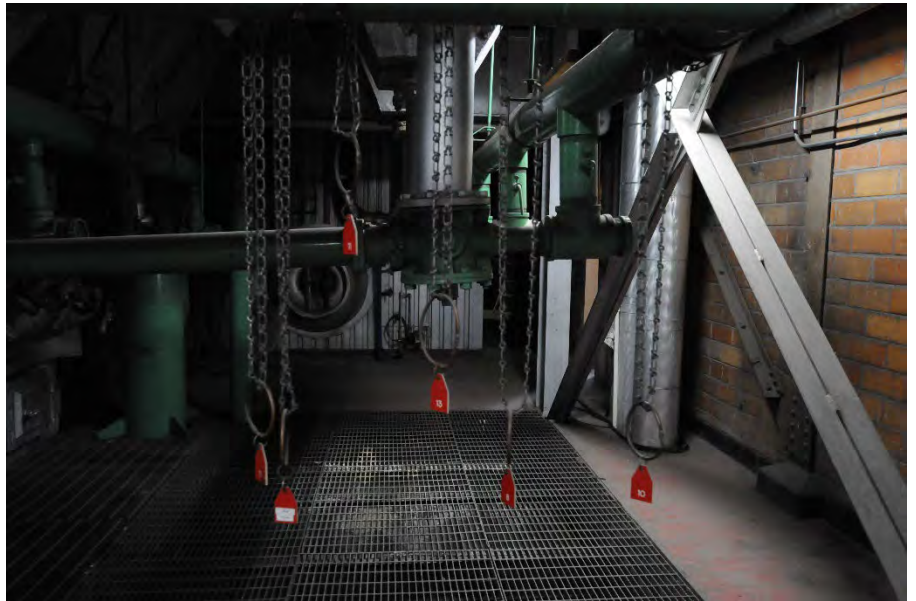


Photo No. 54.

Description

High ceiling section
boiler systems





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 55.

Description

Room under ash loader
above west facing
entrance



Photo No. 56.

Description

West facing entrance
from inside





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 57.

Description

High ceiling section
boiler systems



Photo No. 58.

Description

High ceiling section
boiler systems



PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 59.

Description

High ceiling section
boiler systems



Photo No. 60.

Description

Switch gear area in
southern section





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 61.

Description

Switch gear area in southern section



Photo No. 62.

Description

Switch gear area in southern section





PHOTOGRAPHS

Project Name: College Avenue Steam Plant IPG
Project Number: M0457.02.003
Location: Pullman, Washington

Photo No. 63.

Description

College Avenue Steam
Plant exterior



APPENDIX C

FOCUSED SITE ASSESSMENT REPORT



FOCUSED SITE ASSESSMENT REPORT

COLLEGE AVENUE STEAM PLANT
PULLMAN, WASHINGTON



Prepared for
PORT OF WHITMAN COUNTY
March 30, 2022
Project No. M0457.02.003

Prepared by
Maul Foster & Alongi, Inc.
601 East Front Ave., Suite 202, Coeur d'Alene, ID 83814

FOCUSED SITE ASSESSMENT REPORT
COLLEGE AVENUE STEAM PLANT
PULLMAN, WASHINGTON

*The material and data in this report were prepared
under the supervision and direction of the undersigned.*

MAUL FOSTER & ALONGI, INC.



03-30-2022

*Lisa M Pritzl, LG
Project Geologist*

A handwritten signature in cursive script that reads "Ted Wall".

*Ted Wall, PE
Principal Engineer*

CONTENTS

TABLES AND ILLUSTRATIONS	V
ACRONYMS AND ABBREVIATIONS	VI
1 INTRODUCTION	1
1.1 REGULATORY FRAMEWORK	1
1.2 PURPOSE AND OBJECTIVES	1
1.3 PROPERTY DESCRIPTION	1
1.4 GEOLOGY AND HYDROGEOLOGY	2
1.5 PROPERTY HISTORY	3
1.6 PREVIOUS INVESTIGATIONS	3
2 AREAS OF CONCERN	4
2.1 AOC 1: FORMER STEAM PLANT OPERATIONS BUILDING	4
2.2 AOC 2: COAL BULK STORAGE AND TRANSPORT AREA	5
2.3 AOC 3: FORMER DIESEL TANK FARM	5
2.4 AOC 4: AVISTA ELECTRICAL SUBSTATION	5
2.5 AOC 5: HISTORICAL OIL STORAGE AREA	5
3 FIELD AND ANALYTICAL METHODS	5
3.1 SOIL	6
3.2 GROUNDWATER	8
3.3 SUB-SLAB SOIL VAPOR	9
3.4 HAZARDOUS BUILDING MATERIALS SURVEY	10
4 ANALYTICAL RESULTS	10
4.1 SOIL BORINGS	10
4.2 GROUNDWATER	10
4.3 SOIL VAPOR	11
4.4 HAZARDOUS BUILDING MATERIALS SURVEY	11
5 CONCEPTUAL SITE MODEL	11
5.1 SUMMARY	11
5.2 SOURCE CHARACTERIZATION	12
5.3 FATE AND TRANSPORT PROCESSES	12
5.4 POTENTIAL EXPOSURE SCENARIOS	13
5.5 POTENTIAL RECEPTORS	14
6 RISK SCREENING	14
6.1 SOIL	14
6.2 GROUNDWATER	14
6.3 VAPOR	15
6.4 SUMMARY	15
7 CLEANUP OPTION DEVELOPMENT	15
7.1 CLEANUP TECHNOLOGIES	16
7.2 PRELIMINARY CLEANUP OPTIONS	17
8 EVALUATION OF CLEANUP ALTERNATIVES	20
8.1 MODEL TOXICS CONTROL ACT REQUIREMENTS	20
8.2 COMBINED CLEANUP OPTIONS AND COSTS	20

CONTENTS (CONTINUED)

8.3	COMPARISON OF ALTERNATIVES	21
9	CONCLUSIONS AND RECOMMENDATIONS	22
	LIMITATIONS	
	REFERENCES	
	TABLES	
	FIGURES	
	APPENDIX A	
	BORING LOGS	
	APPENDIX B	
	FIELD SAMPLING DATA SHEETS	
	APPENDIX C	
	HAZARDOUS MATERIALS SURVEY REPORT	
	APPENDIX D	
	ANALYTICAL LABORATORY REPORTS DATA	
	APPENDIX E	
	DATA VALIDATION MEMORANDUM	

TABLES AND ILLUSTRATIONS

FOLLOWING REPORT:

TABLES

- 4-1 SUMMARY OF SOIL ANALYTICAL RESULTS
- 4-2 SUMMARY OF GROUNDWATER ANALYTICAL RESULTS
- 4-3 SUMMARY OF SOIL VAPOR ANALYTICAL RESULTS
- 8-1 ALTERNATIVE 1 - GRAVEL CAPPING, VAPOR SEALING, AND MONITORED NATURAL ATTENUATION COST ESTIMATE SUMMARY
- 8-2 ALTERNATIVE 2 - ASPHALT CAPPING, VAPOR SEALING, AND MONITORED NATURAL ATTENUATION COST ESTIMATE SUMMARY
- 8-3 ALTERNATIVE 3 - EXCAVATION AND DISPOSAL, VAPOR SEALING, AND MONITORED NATURAL ATTENUATION COST ESTIMATE SUMMARY

FIGURES

- 1-1 PROPERTY LOCATION
- 1-2 PROPERTY FEATURES
- 1-3 SAMPLE LOCATIONS
- 5-1 CONCEPTUAL SITE MODEL OF POTENTIAL EXPOSURE PATHWAYS

ACRONYMS AND ABBREVIATIONS

ACM	asbestos-containing material
AOC	area of concern
AST	aboveground storage tank
CMMP	contaminated media management plan
COC	chemical of concern
CSM	conceptual site model
CUL	cleanup level
DRO	diesel-range organics
EPA	U.S. Environmental Protection Agency
FSA	focused site assessment
ft bgs	feet below ground surface
HBM	hazardous building materials
IHS	indicator hazardous substance
LBP	lead-based paint
MFA	Maul Foster & Alongi, Inc.
MTCA	Model Toxics Control Act
NWTPH	Northwest Total Petroleum Hydrocarbons
PAH	polycyclic aromatic hydrocarbon
Parametrix	Parametrix, Inc.
PCB	polychlorinated biphenyl
Port the Property	Port of Whitman County College Avenue Steam Plant
PVC	polyvinyl chloride
RRO	residual-range organics
TerraGraphics	TerraGraphics Environmental Engineering, Inc.
ug/L	micrograms per liter
ug/m ³	micrograms per cubic meter
UST	underground storage tank
VOC	volatile organic compound
WAC	Washington Administrative Code
WSU	Washington State University

1 INTRODUCTION

Maul Foster & Alongi, Inc. (MFA), has prepared this focused site assessment (FSA) report for the Port of Whitman County (the Port). The report describes the field activities and results of the FSA conducted at the College Avenue Steam Plant (the Property) (see Figure 1-1).

1.1 Regulatory Framework

The Port of Whitman County received an Integrated Planning Grant from the Washington State Department of Ecology for property assessment and development of a community-based plan for redevelopment of the Property in the City of Pullman, Washington. The FSA was conducted in general accordance with guidance put forth in the Model Toxics Control Act (MTCA) (Revised Code of Washington 70.105d) and its implementing regulations (Washington Administrative Code [WAC] 173-340).

1.2 Purpose and Objectives

The purpose of the FSA is to evaluate the presence of environmental impacts at selected areas of concern (AOCs) on the Property. The AOCs are discussed in detail in Section 2. Data generated by the FSA will support risk screening and evaluation of potential supplemental Property characterization (if necessary) and cleanup actions (as applicable). The results of the FSA are intended to support the following project objectives:

- Development of a preliminary conceptual site model (CSM)
- Characterization of the presence of potentially hazardous substances in environmental media near potential sources of contamination
- Evaluation of potential risk to current and likely future receptors on the Property
- Evaluation of potential cleanup options for impacted media at the Property

A hazardous building materials (HBM) survey was conducted as part of this scope, and the findings and documentation are included in this submittal. Note, however, remediation and disposal of HBM will be conducted under a program separate from the remedial action for soil, groundwater, and vapor. Therefore, any HBM identified during this FSA will not be evaluated as part of the cleanup action options.

1.3 Property Description

The Property is in section 5, township 14 north, range 45 east of the Willamette Meridian. The Property is located in Whitman County and comprises the following tax parcels (or partial tax parcels as indicated) (see Figures 1-1 and 1-2):

- 1-1230-00-01-01-0001 #369

- 1-1230-00-01-01-0001 #401
- 1-1230-00-08-04-0001 #379 (partial)
- 1-1230-00-08-04-0001 #380 (partial)
- 1-1230-00-08-04-0001 #401
- 8-1460-00-00-00-0067 #22 (partial)
- 1-1230-00-08-04-0001 #17 (partial)

The approximately entire 2.25-acre site is located within the Washington State University (WSU) comprehensive plan designation, which is placed upon all WSU-owned property within the Pullman city limits and is subject to the development regulations imposed therein. Only a portion of the site will be reused by the Port, which is outlined in yellow on Figure 1-2. The area selected for reuse is the area addressed by this FSA and will be referred to as “the Property” for the remainder of this report.

The approximately 20,000-square-foot building on the southeast corner of the Property comprises three sections described here from north to south: the campus heating system (natural gas-powered boilers), the boiler control room and shop area, and the former steam plant operations area. The former steam plant operations area is proposed for reuse by the Port, as shown in Figure 1-3, and has a building footprint that is approximately 12,365 square feet. Two aboveground storage tanks (ASTs) formerly containing diesel (i.e., bunker C fuel), and an Avista Corporation electrical substation (Avista electrical substation) are located north and west of the main building. The ASTs are on the Property and the substation is off the Property.

Other features include supply well pump houses (only one is active) and phone and internet communications buildings, located off the Property. The gravel lot that occupies the west portion of the Property was used for bulk coal storage during steam plant operations. The surrounding area, including the WSU campus, is a mix of commercial and residential properties.

1.4 Geology and Hydrogeology

The Property is located in an area of southeastern Washington referred to as “The Palouse,” is characterized by rolling hills and farmland. Palouse geology is characterized by thick (up to 250 feet) wind-deposited loess (silt and clay) underlain by Miocene basalt (USGS and AASG, 1980). Subsurface investigation results indicate that subsurface soil at the Property consists generally of silt and clay underlain by basalt.

The depth to groundwater at the Property is shallow, less than 15 feet below ground surface (ft bgs), perched upon thick layers of basalt, as described above. A groundwater supply well operated by WSU is located at the Property. According to WSU, the supply well intake is 165 feet bgs within fractured basalt. Given the depth and typical hydrogeologic conductivity of basalt, it is unlikely that there is a hydrogeologic connection between the shallow perched water table and the deeper water supply. Based on local topography and surface water location and flow direction, the groundwater gradient at the Property likely is west-southwest toward the South Fork of the Palouse River.

1.5 Property History

The original Steam Plant on the Property, located at 800 NE College Avenue, Pullman, Washington, was constructed by the WSU and operational in 1927. It underwent several additions and major modifications. The original six boilers were shut down in 2003 while two natural gas boilers in the newer, northern portion of the building continue to operate. While originally using coal for fuel, the facility was upgraded with newer technology that uses natural gas to generate steam. The building houses two gas-fired boilers and a small electrical substation, but there is substantial space for redevelopment in the building and associated grounds.

1.6 Previous Investigations

MFA was provided the following historical environmental reports for the Property:

- **Independent remedial action report, WSU power plant oil storage area** (Parametrix, Inc. [Parametrix], 1997)—In 1996, a remedial action was conducted in the area identified as previously storing diesel, oil, and other lubricants where petroleum and polychlorinated biphenyl (PCB) contamination was identified by WSU. Soil impacted with petroleum and PCBs was excavated to the extent possible during this remediation. Confirmation samples showed that impacted soil remained in two areas that could not be excavated, beneath a concrete pad and beneath the eastern retaining wall. Excavation beneath these structures was not feasible and the remaining impacted soil was left in place.
- **Former Steam Plant Coal Storage Site, Subsurface Boring Event** (TerraGraphics Environmental Engineering, Inc. [TerraGraphics], 2007)—In 2007, a subsurface investigation was conducted in the bulk coal storage area to assess potential impacts to soil. Sixteen soil borings were advanced up to 15 ft bgs in the coal stockpile area. Soil samples were analyzed for polycyclic aromatic hydrocarbons (PAHs), PCBs, and metals. The investigation showed that up to 1 foot of coal material remained on the surface of the coal bulk storage area. Beneath that, the subsurface consisted of native silt and clay. Only one soil sample showed exceedances of MTCA Method A cleanup levels (CULs) for unrestricted land use for PAHs.
- **Line and Tank Cleaning** (CCS, 2007)—A letter proposal describing asbestos abatement, cleaning, and flushing of ASTs, and product lines. A report containing results of this work was not provided. The facility manager confirmed that the work was completed.
- **Asbestos Inspection** (Strata Geotechnical, 2008)—In 2008, an asbestos inspection of the College Avenue steam tunnel was conducted as part of a campus lighting and wiring project. The inspection included sampling of wiring, conduit pipe, and insulation in the tunnel beneath College Avenue for asbestos-containing materials (ACM). Three of the analyzed samples, all associated with wire insulation in the junction box at the Fulmer Spur of the tunnel, contained ACM. The report did not include a figure showing the locations of the samples or the spur.
- **Lead and Asbestos Inspection** (TerraGraphics, 2008)—A lead and asbestos survey was conducted in 2008 as part of a restroom improvement project at the College Avenue Steam

Plant. Samples were collected from the restrooms (rooms 19 and 107), the boiler room basement, and the main floor north wall at the water fountain. ACM was identified in insulation, fittings, and hard pipe associated with the thermal insulation system located in the basement boiler room. Lead coatings were identified in five samples collected from the plaster wall in room 107, the wall and ceiling in room 19, and the boiler and orange piping in the boiler room.

- **Asbestos Management Program, shops good faith survey summary** (WSU, 2014)—Samples of roofing material were collected and analyzed in 2014. ACM was found in silver paint, black tar-like substances, and roofing felt over the southern portion of the steam plant building.

Stand-alone laboratory reports were also provided showing that ACM was identified in several locations in the steam plant.:

- First floor transite panel wall
- First floor bank and white rope
- First floor yellow/brown floor tile
- First floor west wall joint compound (room 102)
- First floor tile and mastic (room 102)
- First floor restroom brown tile mastic and grout
- Second floor ceiling (room 2L)
- Fourth floor black mastic (room 405L)
- Water heater gaskets (floor and room not specified)

2 AREAS OF CONCERN

This section discusses known and suspected areas of contamination at the Property, based on identified features of interest associated with historical operations, areas of contamination identified during previous sampling activities, and the nature and extent of contaminants of concern (COCs).

AOCs have been identified based on activities, conveyances, and physical features (e.g., equipment, tanks, and vaults), associated with current features and former steam plant operations, which may have resulted in a release of hazardous substances to environmental media at the Property (see Figure 1-3).

2.1 AOC 1: Former Steam Plant Operations Building

The former steam plant operations building is an AOC, based on the use of coal in the plant. Additionally, soil vapors associated with coal and diesel in the subsurface may be present. Historical reports also indicate that ACM and lead-based paint (LBP) are present inside the steam plant building.

2.2 AOC 2: Coal Bulk Storage and Transport Area

During steam plant operations, coal was transported via railcar to the Property where it was offloaded and stored in the area shown in Figure 1-3. Heavy equipment was used to transport the material from the railcar for storage and use at the Property. PAHs were identified in historical borings (TerraGraphics, 2007) in the bulk storage area. PAHs, volatile organic compounds (VOCs), and diesel-range organics (DRO) may be present in soil and groundwater at the Property due to storage and transport of coal at the Property.

2.3 AOC 3: Former Diesel Tank Farm

Two diesel ASTs are located at the Property. The ASTs have been decommissioned and are not in use. Historical use and potential leaks or surface spills may have occurred at the Property and diesel- and heavy-oil-range hydrocarbons and their associated constituents may be present in the subsurface soil and groundwater.

2.4 AOC 4: Avista Electrical Substation

An electrical substation is adjacent to the Property. Historically, transformers used at the substation held PCB-containing oil. PCBs may be present in the subsurface as a result of leaking or spillage during operations.

2.5 AOC 5: Historical Oil Storage Area

This area is identified in an independent remedial action report (Parametrix, 1997) as an area of historical petroleum and PCB contamination. Confirmation samples taken within the extent of the excavation showed that impacted soil remained in two areas: beneath a concrete pad and beneath the eastern retaining wall. Excavation beneath these structures was not feasible and the remaining impacted soil was left in place.

In 2001, WSU constructed an addition to the steam plant building to house boilers for campus heating. The footprint of the addition occupies the location of the historical contamination and the former concrete pad. It is unknown whether the remaining contamination was removed during construction activities and or whether petroleum and PCBs may still be present in this area.

3 FIELD AND ANALYTICAL METHODS

The FSA field investigation was conducted in general accordance with the methods and protocol described in the work plan (MFA, 2021). Standard field operating procedures for collecting soil samples, scheduling analyses, decontaminating equipment, and managing waste are described in the sampling and analysis plan, included as Appendix A of the work plan. As described in the work plan,

the FSA objectives as they relate to hazardous substances potentially present at the Property include the following:

- Characterization of potential source areas through the collection of environmental samples for observation, field screening, and chemical analyses
- Evaluation of the nature and distribution of COCs in media surrounding the selected AOCs
- Evaluation of the nature and distribution of COCs in building materials in the selected steam plant building areas
- Evaluation of risk to current and reasonably likely future human and ecological receptors
- Evaluation of potential cleanup options, if deemed necessary

To achieve these objectives, the FSA field investigation of the AOCs included the following elements:

- Soil sampling
- Groundwater sampling
- Sub-slab soil vapor sampling
- Hazardous building materials survey

The elements of the investigation are described in the following sections.

3.1 Soil

On October 19, 2021, MFA conducted the FSA subsurface investigation to identify the potential or residual impacts to soil at the AOCs, as described in Section 2. Six continuous soil cores (SB-1, SB-2, SB-3, SB-5, SB-6, and SB-7) were advanced from ground surface to the boring completion depth, using direct-push drilling methods.

Visual and olfactory observations were recorded on the soil boring log. Due to a malfunction of the photoionization detector, not all soil samples were screened during field work. The locations of the seven borings are shown in Figure 1-3. Some boring locations indicated in the work plan were moved or combined because of underground utilities identified by ground-penetrating radar. Location SB-4 was not completed due to the location of underground utilities. Boring logs for each location are included in Appendix A. Appendix B presents field sampling data sheets summarizing soil samples collected from each boring location.

Boring locations SB-1, SB-2, and SB-3 were advanced along the western boundary of the Property, within the bulk coal storage area, and inferred downgradient direction of the former diesel ASTs and storage areas. The borings were advanced to 16, 17, and 16 ft bgs, respectively. Subsurface soil consisted of grayish brown, silty sand and gravel with coal and trace woody or brick debris. Soil was field screened for the potential presence of VOCs commonly associated with petroleum fuel products. Two soil samples from each boring were collected from these locations and analyzed for the following:

- Total metals by U.S. Environmental Protection Agency (EPA) Method 6020B

- Total mercury by EPA Method 7470A/7471B
- VOCs by EPA Method 8260C
- PAHs by EPA 8270E-SIM (2.0 and 2.5 ft bgs sample depths only)
- DRO by the Northwest Total Petroleum Hydrocarbons (NWTPH)-Dx Method
- Residual oil-range organics (RRO) by the NWTPH-Dx Method

Boring location SB-5 was advanced downgradient of the location of the former diesel AST tank farm and the Avista electrical substation (see Figure 1-3). The boring was advanced to 20 ft bgs. Subsurface soil consisted of silty sand and sandy silt, with coal fragments from 3.0-3.8 ft bgs. Soil was field screen using a photoionization detector. Soil samples were collected from depths of 5 and 15 ft bgs. Soil samples collected from location SB-5 were analyzed for the following:

- Total metals by EPA Method 6020B
- Total mercury by EPA Method 7470A/7471B
- PCBs by EPA Method 8082A (for the sample collected at 15 ft bgs only)
- VOCs by EPA Method 8260C
- PAHs by EPA 8270E-SIM
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

Boring location SB-6 was completed adjacent to a former concrete underground storage tank (UST) on the east side of the steam plant building (see Figure 1-3). The boring initially advanced to 2.5 ft bgs where refusal was met. A second attempt was made, and refusal was met a 3.0 ft bgs. The boring was not advanced deep enough to collect soil from a similar depth as the UST therefore, soil from this boring was neither screened nor sampled.

Boring location SB-7 was completed downgradient of the historical oil storage area and Avista electrical substation (see Figure 1-3). The boring was advanced to 21 ft bgs. Soils were screened in approximately 3-foot intervals, when recovered. Dark brown gravelly sand with silt and trace coal fragments were observed from the surface to a depth of 5.4 ft bgs, when recovered. Below that, brown silt was observed, becoming sandy from 12.5 to 20 ft bgs. Samples were collected at 7.5 and 18.5 ft bgs. Samples were analyzed for the following:

- Total metals by EPA Method 6020B
- Total mercury by EPA Method 7471B
- PCBs by EPA Method 8082A
- VOCs by EPA Method 8260C
- PAHs by EPA 8270E-SIM
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

3.2 Groundwater

Reconnaissance groundwater samples were collected from borings SB-1, SB-2, SB-3, SB-5, and SB-7 to evaluate the potential for COCs. Groundwater sampling was conducted using the methods and protocol outlined in the FSA work plan (MFA, 2021). Appendix B includes field sampling data sheets detailing groundwater sampling activities.

At boring SB-1, groundwater was encountered at 14.1 ft bgs during drilling activities and stabilized at 12.95 ft bgs. A temporary well was installed in this boring, constructed of 2-inch-diameter schedule 40 polyvinyl chloride (PVC) casing and screened with a 0.01 slot, prepacked, schedule 40 PVC screen from 11 to 16 ft bgs. Groundwater was purged using a submersible pump, and a water quality meter was used to record water quality parameters. A groundwater sample was collected when the field parameters had stabilized and was submitted for the following laboratory analyses:

- Total metals by EPA Method 6020B
- Total mercury by EPA Method 7470A
- VOCs by EPA Method 8260D
- PAHs by EPA Method 8270E-SIM
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

At boring location SB-2, groundwater was first encountered at 15.1 ft bgs and stabilized at 12.95 ft bgs. The temporary well was screened from 12 to 17 ft bgs. Groundwater was purged using a submersible pump, and a water quality meter was used to record water parameters until stabilization was reached. A groundwater sample was collected for the following laboratory analyses:

- Total metals by EPA Method 6020B
- Total mercury by EPA Method 7470A
- VOCs by EPA Method 8260D
- PAHs by EPA Method 8270E-SIM
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

At boring location SB-3, groundwater was first encountered at 13.3 ft bgs and stabilized at 12.42 ft bgs. A temporary well was constructed with a screened interval from 11.0 to 16.0 ft bgs. Groundwater was purged using a peristaltic pump. Water quality parameters were recorded until stabilization was reached. A groundwater sample was collected for the following laboratory analyses:

- Total metals by EPA Method 6020B
- Total mercury by EPA Method 7470A
- VOCs by EPA Method 8260D
- PAHs by EPA Method 8270E-SIM
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

At boring location SB-5, groundwater was first encountered at 16.0 ft bgs and stabilized at 15.5 ft bgs. The temporary well was constructed and screened from 15.0 to 20.0 ft bgs. Groundwater was purged, using a peristaltic pump. Water quality parameters were recorded until stabilization was reached. A groundwater sample was collected for the following laboratory analyses:

- Total metals by EPA Method 6020B
- Total mercury by EPA Method 7470A
- VOCs by EPA Method 8260D
- PAHs by EPA Method 8270E-SIM
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

At boring location SB-7, groundwater was first encountered at 18.7 ft bgs and stabilized at 16.57 ft bgs. The temporary well was constructed and screened from 16.0 to 21.0 ft bgs. Groundwater was purged, using a peristaltic pump. Water quality parameters were recorded until stabilization was reached. A groundwater sample was collected for the following laboratory analyses:

- VOCs by EPA Method 8260D
- PAHs by EPA Method 8270E-SIM
- PCBs by EPA Method 8082A
- DRO by the NWTPH-Dx Method
- RRO by the NWTPH-Dx Method

Metals analysis was inadvertently omitted from the analysis request for the groundwater sample collected from boring SB-7.

3.3 Sub-Slab Soil Vapor

On November 12, 2021, MFA conducted sub-slab soil vapor sampling to identify the potential or residual impacts to soil vapor beneath the steam plant building, as described in Section 2. Three soil vapor sampling points (VP-1, VP-2, and VP-3) were installed in the concrete slab of the portion of the building intended for reuse (see Figure 1-3). Sub-slab samples were collected by installing temporary sampling ports through the concrete floor. The sampling ports were sealed, and vapor samples were collected in Summa canisters for analytical testing. A plastic shroud was placed over the sample train and filled with helium as a leak-check compound. The sample train was purged with a peristaltic pump before sample collection and the lines were monitored for leaks using a helium detection meter. Field sampling data sheets for sub-slab soil vapor sampling are included in Appendix B. Each of the soil vapor samples were submitted for the following laboratory analyses:

- VOCs by Method TO-15
- Helium by Method ASTM 1946

3.4 Hazardous Building Materials Survey

In October 2021, MFA conducted an HBM survey for the area of the steam plant building that is planned for reuse (see Figure 1-2). The survey was conducted by certified Asbestos Hazard Emergency Act building inspectors.

The survey included the use of a portable X-ray fluorescence device to screen materials for the presence of LBP; sampling and analysis of suspected ACM; and visual inspection and tracking of suspected PCB-containing fixtures, mercury-containing fixtures, and other potentially hazardous materials. Field and analytical methods are further described in the hazardous materials survey report included in Appendix C.

4 ANALYTICAL RESULTS

Soil and groundwater analytical results were compared to the MTCA Method A CULs. When chemicals were detected that are not included in the Method A list, then the MTCA Method B soil and/or groundwater CULs for unrestricted land use were used. Soil vapor analytical results were compared to MTCA Method B for indoor air. Analytical results are included in Tables 4-1 (soil), 4-2 (groundwater), and 4-3 (soil vapor). Detections below the reporting limits are recorded as the respective method reporting limit on the analytical tables and denoted with a “U” qualifier. Analytical reports are included in Appendix D. The data validation memorandum is included in Appendix E.

4.1 Soil Borings

The soil samples collected from SB-1, SB-2, and SB-3 were analyzed to determine whether metals, VOCs, PAHs, DRO, and RRO associated with bulk coal storage and former diesel use and storage at the Property were present. Concentrations for all analytes were below the reporting limit or less than the CULs in all samples collected from borings SB-1, SB-2, and SB-3.

At location SB-5, samples were analyzed to determine whether metals, VOCs, PCBs, PAHs, DRO, and RRO associated with the substation or former diesel use and storage at the Property were present. Concentrations for all analytes were below the reporting limit or less than the CULs in all samples collected from boring SB-5.

At location SB-7, samples were analyzed to determine whether metals, VOCs, PCBs, PAHs, DRO, and RRO associated with the substation or former diesel use and storage at the Property were present. Concentrations for all analytes were below the reporting limit or less than the CULs in all samples collected from boring SB-7.

4.2 Groundwater

A groundwater sample was collected from borings SB-1, SB-2, SB-3, SB-5, and SB-7 to determine whether the COCs associated with the former operations at each AOC were present. COCs were

below the reporting limit or less than the CULs (see Table 4-2), with exception of the sample collected from SB-7.

Groundwater collected from SB-7 had a concentration DRO of 512 micrograms per liter (ug/L), exceeding the MTCA Method A CUL of 500 ug/L. Reconnaissance groundwater samples are not relied upon for characterization purposes due to possible matrix interference; therefore, they may not represent groundwater quality. The diesel concentration may be biased high due to matrix interference in sample SB-7. Groundwater quality is unknown and is considered a data gap.

4.3 Soil Vapor

Soil vapor was collected at sample points VP-1, VP-2, and VP-3 (Figure 1-3). Each of the soil vapor samples were analyzed for VOCs and helium (Table 4-3). Helium analysis was completed to determine whether the sample train was sealed and confirm that only vapor from beneath the concrete slab was collected in each sample. All three samples were non-detect for helium.

Sample VP-1 was collected from beneath the concrete slab on the southwest corner of the area proposed for reuse. Analytical results showed that 1,4-dioxane and benzene were above MTCA Method B CULs, with concentrations of 0.84 and 7.12 micrograms per cubic meter (ug/m³), respectively.

Sample VP-2 was collected from beneath the concrete slab on the northwest corner of the area proposed for reuse. Analytical results did not show VOCs above CULs in sub-slab vapor collected from this location.

Sample VP-3 was collected from beneath the concrete slab on the northeast corner of the area proposed for reuse. Analytical results showed that benzene was above the MTCA Method B CUL with a concentration of 0.747 ug/m³.

4.4 Hazardous Building Materials Survey

ACM and LBP were identified within the building area proposed for reuse. Additionally, fixtures potentially containing PCBs, mercury, and other hazardous materials were identified at the Property. The hazardous building materials survey report, included in Appendix C, details these findings.

5 CONCEPTUAL SITE MODEL

5.1 Summary

The CSM describes potential chemical sources, release mechanisms, environmental transport processes, exposure pathways, and receptors. Development of a CSM is dynamic and iterative and may be refined as additional information becomes available. The primary purpose of the CSM is to describe pathways by which human and ecological receptors could be exposed to Property-related

chemicals. A complete exposure pathway consists of four necessary elements: (1) a source and mechanism of chemical release to the environment, (2) an environmental transport medium for a released chemical, (3) a point of potential contact with the impacted medium (referred to as the exposure point), and (4) an exposure route (e.g., soil ingestion) at the exposure point. The CSM describes potential exposure scenarios based on information collected during the Property assessment. All components and the relationships between them are fundamental in determining potential adverse effects that could be posed by COCs at the Property. Elements of potentially complete exposure scenarios relevant to human health and ecological receptors are discussed below and are presented in Figure 5-1.

5.2 Source Characterization

Historically, the Property operated as coal fired steam plant. COCs for the Property include metals, VOCs, PCBs, PAHs, DRO, and RRO. Based on current and previous investigations, sources of COCs at the Property include the historical use and storage of petroleum products, historical use and storage of bulk coal material, and operation of an electrical substation adjacent to the Property. The release mechanism from these sources is likely related to potential spills while transporting and unloading of process materials, petroleum fuel refueling for the USTs, petroleum fuel leakage from heavy equipment used to transport process materials, and potential leakage of PCB oil from transformers.

Based on the 2021 investigation results, it appears that historical operations have adversely impacted groundwater at the Property. Specific impacted areas and COCs are described below:

- Soil beneath the 2001 boiler room addition potentially remains impacted, per the findings of the 1997 Parametrix investigation.
- Groundwater on the northwest side of the steam plant building has impacts from DRO. This impact is likely related to a historical diesel spill in the area beneath the current boiler room, prior to the addition of this portion of the building.
- Soil vapor beneath the original steam plant building is impacted with VOCs likely associated historical operations. The source of these impacts has not been determined.

5.3 Fate and Transport Processes

Contaminant releases to the surface or subsurface have the potential to migrate vertically and laterally to the water table, resulting in impacts to subsurface soil and shallow groundwater beneath the Property. Contaminants in surface and subsurface soil may also partition to the vapor phase, which could impact indoor and/or outdoor air quality.

Dissolved-phase groundwater contamination in the underlying groundwater may volatilize into soil vapor in the overlying vadose zone after migration via groundwater transport. Contaminant vapors partitioned from contaminated groundwater could impact indoor and/or outdoor air quality.

The primary mechanisms likely to influence the fate and transport of chemicals at the Property include natural biodegradation of organic chemicals, sorption to soil, advection and dispersion in groundwater,

volatilization from soil or groundwater to air, and leaching of chemicals from soil to groundwater. The relative importance of these processes varies, depending on the chemical and physical properties of a released contaminant. The properties of soil and the dynamics of groundwater flow also shape contaminant fate and transport.

Chemicals with sufficiently high solubility could leach from soil to groundwater, and dissolved chemicals could be transported downward to local groundwater. In the dissolved phase, volatilization, dispersion, retardation, and biodegradation may further reduce concentrations of chemicals in groundwater downgradient of a source area.

Volatile chemicals in groundwater or in soil in the vadose zone have the potential to volatilize and migrate in the vapor phase.

5.4 Potential Exposure Scenarios

The following are potentially current exposure pathways:

- Incidental ingestion of, and dermal contact with, chemicals in surface and/or subsurface soil and groundwater
- Inhalation of fugitive dust generated from surface and/or subsurface soil
- Inhalation of outdoor air vapors that have emanated from soil or groundwater
- Inhalation of groundwater or subsurface soil vapors that have intruded into buildings
- Ingestion, dermal contact, and inhalation of chemicals in groundwater used as drinking water
- Inhalation of indoor air vapors that have emanated from soil or groundwater

The following are potentially complete human health exposure pathways:

- **Commercial/construction workers**—there are petroleum impacts to shallow groundwater at the Property. When construction activities are conducted as part of Property redevelopment, construction workers could contact the aforementioned substances, which are identified as indicator hazardous substances (IHSs) because of their elevated detections above MTCA Method A CULs. An IHS is defined as a chemical exceeding a CUL at one or more locations. Because future construction workers may be exposed to the impacted shallow groundwater through ingestion, dermal contact, and inhalation of chemicals volatilizing from groundwater, appropriate protection of construction workers is warranted.
- **Building occupants**—there are VOC impact to soil vapor beneath the building. Upon occupation of the building, occupants could potentially be exposed to IHS via vapor intrusion pathways. Because future occupants may be exposed to the impacted vapor through inhalation of chemicals volatilizing from soil or groundwater, appropriate protection of building occupants is warranted.

5.5 Potential Receptors

The following current and future human receptors may potentially be exposed to chemicals originating from the Property:

- Occupational workers/residents
- Construction workers

6 RISK SCREENING

The soil, groundwater, and soil vapor sample analytical results were compared to the MTCA Method A CULs for unrestricted land use, or MTCA Method B CULs when MTCA Method A CUL values were unavailable. IHSs are evaluated below by comparing the concentrations found in soil, groundwater, and soil vapor to their respective CULs.

6.1 Soil

Soil analytical data for this FSA are included in Table 4-1.

During the 2021 investigation, the soil sample collected from each of the borings did not exceed MTCA CULs.

In 1997, petroleum and PCB impacts to soil were encountered on the Property beneath a concrete pad and beneath the eastern retaining wall. (Parametrix, 1997). Excavation beneath these structures was not feasible and the remaining impacted soil was left in place.

In 2001, WSU constructed an addition to the steam plant building to house boilers for campus heating. The footprint of the addition occupies the location of the historical contamination and the former concrete pad. It is possible that contamination may still be present beneath the addition footprint.

In 2007, TerraGraphics, conducted a subsurface investigation in the bulk coal storage area to assess potential impacts to soil. The investigation showed that up to 1 foot of coal material remained on the surface of the coal bulk storage area. One soil sample showed exceedances of MTCA Method A CULS for PAHs.

Petroleum, PAHs, and PCBs are considered as IHSs for the investigation area where detections had exceeded their respective CULs. Additionally, the remaining coal layer in the former bulk coal storage area is a potential source of PAH impacts to soil.

6.2 Groundwater

Groundwater analytical data for this FSA are included in Table 4-2.

In the groundwater samples collected during this investigation, DRO was detected above the 500 ug/L MTCA Method A CUL in the samples collected from location SB-7 (512 milligrams per kilogram). Remaining COCs were below the MTCA Method A CULs or below reporting limits.

Petroleum is considered a potential groundwater IHS for the Property because of elevated detections in a reconnaissance sample. Additionally, the remaining coal layer in the former bulk coal storage area is a potential source of PAH impacts to groundwater. Groundwater samples will need to be collected from monitoring wells to assess chemical impacts, if any.

6.3 Vapor

Sub-slab soil vapor analytical data for this FSA are included in Table 4-3.

In the soil vapor samples collected during this investigation, VOCs were detected above their respective MTCA Method B CULs. In VP-1, 1,4-dioxane was above the MTCA Method B CUL of 0.5 ug/m³, with a concentration of 0.84 ug/m³. Benzene was also above the MTCA Method B CUL of 0.32 ug/m³ in samples collected from VP-1 and VP-3, with concentrations of 7.12 ug/m³ and 0.747 ug/m³, respectively.

VOCs, namely 1,4-dioxane and benzene, are considered soil vapor IHSs for the investigation area because of their elevated detections.

6.4 Summary

Petroleum and PCBs are the common IHSs identified in the soil media at the Property. Petroleum is the a potential IHS in the groundwater at the Property. VOCs (1,4-dioxane and benzene) are the common IHSs identified in soil vapor at the Property

The impacted soil identified in the 1997 investigation is associated with the former diesel and oil storage area. However, the impacts are beneath the footprint of the boiler room addition, and therefore the likelihood is low for the residual petroleum-contaminated soil to pose environmental concerns or risks to human health.

7 CLEANUP OPTION DEVELOPMENT

One of the objectives of this FSA is to identify and evaluate cleanup options that reduce contaminant exposure to levels that are protective of human health and the environment and are appropriate for meeting the CULs at the Property. As previously noted, this section identifies feasible cleanup technologies to address exceedances of MTCA Method A CULs in soil, groundwater, and sub-slab vapor and assembles those technologies into potential options.

Applicable remedial technologies to address contaminants in each medium are independent of each other. For this reason, cleanup options were developed for individual media and then combined into larger combined cleanup alternatives.

7.1 Cleanup Technologies

Prior to the development of cleanup options, various technologies were evaluated for applicability to address exceedances of established COCs. Technologies that were unlikely to be effective or significantly cost prohibitive were not considered further.

7.1.1 Groundwater Cleanup Technologies

The following technologies were initially considered for addressing groundwater on the Property with concentrations of DRO above CULS:

- Institutional controls
- In situ bioremediation
- In situ chemical oxidation
- Pump and treat
- Monitored natural attenuation

The density of silts observed during subsurface investigation on the Property prevents effective dispersion of chemical treatments in the subsurface and restricts the rate of groundwater flow. For this reason, in situ chemical oxidation, in situ bioremediation, and pump and treat were not considered further.

7.1.2 Soil Cleanup Technologies

The following technologies were initially considered for addressing coal and coal impacted soils on the Property:

- Capping
- Excavation and offsite disposal

Both technologies were retained for further analysis.

7.1.3 Vapor Cleanup Technologies

The following technologies were initially considered for addressing sub-slab vapor on the Property:

- Institutional controls
- Passive venting
- Active venting
- Crack sealing

- Heating, ventilation, and air conditioning improvements

The building slab is thick and assumed to have minimal points of potential vapor intrusion. With the intended building use, the basement will have limited occupation and the sub-basement will not be occupied. Active venting was determined to be not necessary based on the analytical data and building configuration and was not retained for further analysis.

7.2 Preliminary Cleanup Options

7.2.1 Groundwater

The following options were considered to address concentrations of DRO above CULs in groundwater in the Property assuming follow up monitoring well samples confirm elevated detections: institutional controls and monitored natural attenuation.

7.2.1.1 Groundwater Option 1: Institutional Controls

Groundwater Option 1 does not include any active remediation or monitoring and instead relies on institutional controls to remain protective.

Institutional Controls: Prepare an environmental covenant for the Property prohibiting the use of groundwater. Groundwater monitoring is not proposed for the Property under this option.

7.2.1.2 Groundwater Option 2: Monitored Natural Attenuation

Groundwater Option 2 consists of monitored natural attenuation using groundwater monitoring wells to reduce direct-contact exposure risks for current and future occupants of the Property.

Groundwater Monitoring: Install three groundwater monitoring wells to a depth of 15 ft bgs. Groundwater will be monitored quarterly for up to five years. The monitoring period may be increased or decreased depending on the attainment of CULs.

7.2.2 Soil

The following options were considered to address coal impacts in soil on the Property: gravel cap, asphalt cap, and excavation and offsite disposal.

7.2.2.1 Soil Option 1: Gravel Cap

Soil Option 1 consists of installing a gravel cap over the area outside of the building footprint to reduce direct-contact exposure risks for current and future occupants of the Property. Soil Option 1 includes the following elements:

Rough Grading: Grade site prior to cap installation to even out any potholes or low spots that could prevent proper drainage.

Capping: Place a non-woven geotextile demarcation fabric over the former coal stockpile footprint and cap with a one-foot-thick lift of imported gravel. Proposed cap is assumed to be 4,000 square yards.

Inspection and Maintenance: Inspect gravel cap annually for erosion and other damage. Observations from the inspection will be documented in a cap inspection report. Maintenance will consist of bringing additional material onto the site and regrading, as necessary. For comparative purposes, the lifetime of the remedy is considered to be 30 years and it is assumed that repairs are required every five years.

Institutional Controls: Prepare an environmental covenant for the Property requiring the development and application of a contaminated media management plan (CMMP), addressing the management and disposal of contaminated soils during excavation, repairs, or other subsurface work.

7.2.2.2 Soil Option 2: Asphalt Cap

Soil Option 2 consists of installing an asphalt cap to reduce direct-contact exposure risks for current and future occupants of the Property.

Rough Grading: Grade site prior to cap installation to even out any potholes or low spots that could prevent proper drainage.

Capping: Place demarcation fabric over former coal stockpile footprint, place 8-inch aggregate base layer, and cap with 4 inches of asphalt.

Inspection and Maintenance: Inspect asphalt cap annually for erosion and other damage. Observations from the inspection will be documented in a cap inspection report. Maintenance will consist of patching wear areas and applying a slurry, as necessary. For comparative purposes, the lifetime of the remedy is considered to be 30 years and it is assumed that repairs are required every ten years.

Institutional Controls: Prepare an environmental covenant for the Property requiring the development and application of a CMMP as described in Section 7.2.2.1.

7.2.2.3 Soil Option 3: Excavation and Offsite Disposal

Soil Option 3 consists of excavating and disposing of coal and soil with visual coal impacts to reduce direct-contact exposure for current and future occupants of the Property.

Pre-design Investigation: Conduct additional sampling in proposed excavation area to identify the extent of coal impacts and inform excavation design.

Excavation: Coal and soil with visual coal impacts will be selectively excavated, characterized, and disposed of offsite at a licensed Subtitle D landfill. Excavation volumes will depend on the extent of impacted material identified during the pre-design investigation and onsite observations.

Backfill: Backfill site with clean import material and grade to restore site to initial grade.

Institutional Controls: Prepare an environmental covenant for the Property requiring the development and application of a CMMP, as described in Section 7.2.2.1, for use in the event contaminated soil remains after removal is complete and is later discovered during subsurface work.

7.2.3 Vapor

The following options were considered to address sub-slab vapor exceedances underneath the building: institutional controls and crack sealing, passive venting, and door improvements.

7.2.3.1 Vapor Option 1: Institutional Controls

Vapor Option 1 relies on building upgrades and an environmental covenant to reduce vapor-contact exposure risks to current and future occupants of the Property.

Heating, Ventilation, and Air Conditioning: Under Vapor Option 1 it is assumed that building upgrades will include modifications and improvements to the existing heating, ventilation, and air conditioning system that will keep the building properly pressurized and prevent vapor intrusion.

Institutional Controls: Prepare an environmental covenant for the Property documenting vapor impacts.

7.2.3.2 Vapor Option 2: Crack Sealing, Passive Venting, and Door Improvements

It is our understanding that the sub-basement does not currently have occupancy, nor is expected to have in occupants in the future. Consequently, this option involves sealing the door and providing some air transfer outdoors in the event minor emissions from the vadose zone occur within the sub-basement. Vapor Option 2 consists of sealing cracks in the building slab, installation of a gas-tight door from the basement to the sub-basement, and construction of a sub-slab passive vent pipe in the sub-basement to reduce vapor-contact exposure risks to current and future occupants of the Property.

Pre-design Inspection: Conduct inspection of basement and sub-slab basement to assess cracks and areas of potential vapor intrusion.

Crack Sealing: Seal cracks and seams in the concrete building slab with a chemically compatible sealant.

Passive Venting: Install a sub-slab passive vent pipe from below the sub-basement floor to near the roofline.

Sub-Basement Door: Install a new gas-tight door or retrofit the existing door that leads to the sub-basement to limit potential vapor intrusion into the basement from the sub-basement.

Inspections: Inspect basement annually for sealant damage, new cracks, or other changes that could lead to vapor intrusions. Observations from the inspection will be documented in a basement inspection report. Maintenance may consist of reapplying sealant or repairing damage to the door

seal. For comparative purposes, the lifetime of the remedy is considered to be 30 years and it is assumed that repairs are required every ten years.

Institutional Controls: Prepare an environmental covenant for the Property prohibiting occupancy in the sub-basement and requiring annual inspection and maintenance of the vapor remedies.

8 EVALUATION OF CLEANUP ALTERNATIVES

8.1 Model Toxics Control Act Requirements

The criteria used to evaluate cleanup alternatives are defined in the MTCA regulation (WAC 173-340-360). These criteria are as follows:

- **Threshold requirements:**
 - Protect human health and the environment
 - Comply with cleanup standards (WAC 173-340-700 through 173-340-760)
 - Comply with applicable state and federal laws (WAC 173-340-710)
 - Provide for compliance monitoring (WAC 173-340-410 and 173-340-720 through 173-340-760)
- **Other requirements:**
 - Use permanent solutions to the maximum extent practicable
 - Provide for a reasonable restoration time frame
 - Consider public concerns (WAC 173-340-600)

Regarding the threshold requirements, all cleanup options except for Groundwater Option 1 and Vapor Option 1:

- Protect human health and the environment
- Are expected to comply with the CULs
- Include appropriate compliance monitoring
- Would be designed to comply with applicable state and federal laws

8.2 Combined Cleanup Options and Costs

Cleanup options for the separate environmental media were combined into three cleanup alternatives. Groundwater Option 1 and Vapor Option 1 were not incorporated into final cleanup alternatives because it was determined that they would not meet the minimum threshold requirements.

8.2.1 Alternative 1: Gravel Capping, Vapor Sealing, and Monitored Natural Attenuation

Alternative 1 includes all elements from Soil Option 1, Vapor Option 2 and Groundwater Option 2. The probable cost of Alternative 1 is \$512,000. This estimate includes a 30 percent contingency for all primary capital costs and a 10 percent contingency for long-term monitoring and maintenance. The estimate is considered to have a confidence level of -30%/+50%. A detailed breakdown of costs and assumptions are provided in Table 8-1.

8.2.2 Alternative 2: Asphalt Capping, Vapor Sealing, and Monitored Natural Attenuation

Alternative 2 includes all elements from Soil Option 2, Vapor Option 2, Groundwater Option 2. The probable cost of Alternative 2 is \$587,000. This estimate includes a 30 percent contingency for all primary capital costs and a 10 percent contingency for long-term monitoring and maintenance. The estimate is considered to have a confidence level of -30%/+50%. A detailed breakdown of costs and assumptions are provided in Table 8-2.

8.2.3 Alternative 3: Excavation and Disposal, Vapor Sealing, and Monitored Natural Attenuation

Alternative 3 includes all elements from Soil Option 3, Vapor Option 2, Groundwater Option 2. The probable cost of Alternative 3 is \$845,000. This estimate includes a 30 percent contingency for all primary capital costs and a 10 percent contingency for long-term monitoring and maintenance. The estimate is considered to have a confidence level of -30%/+50%. A detailed breakdown of costs and assumptions are provided in Table 8-3.

8.3 Comparison of Alternatives

All three alternatives meet the minimum threshold requirements as defined in MTCA and were retained for further evaluation. Under all alternatives, groundwater CULs will be achieved through monitored natural attenuation. Groundwater concentrations are not significantly higher than the CULs and it is believed that natural degradation will bring concentrations below CULs within a reasonable time frame. The vapor remedy included with the cleanup alternatives effectively prevents exposure by sealing off intrusion pathways and passively venting sub-slab vapors from the sub-basement. Annual inspections of the slab will maintain the integrity of the proposed remedy.

Alternative 3 involves source removal to eliminate exposure risk with coal impacted soils on the Property. While Alternative 3 is the most permanent alternative, it has the highest short-term risks associated with implementation and is more expensive than Alternatives 1 and 2. Current data for the Property around the extent and depths of coal is limited and the scope of excavation required to effectively remove the impacted material may increase significantly. Alternatives 1 and 2 both use capping to prevent direct-contact exposure with coal impacted soils on the Property. While Alternative 2 costs slightly more than Alternative 1, the asphalt cap requires less frequent repairs and prevents

stormwater infiltration through contaminated material. Additionally, Alternative 2 aligns with proposed future use of the Property and could be incorporated into redevelopment costs. While Alternative 3 is more permanent than Alternative 2, the uncertainty associated with the extent of excavation and the increased costs makes Alternative 2 the preferred remedy.

9 CONCLUSIONS AND RECOMMENDATIONS

Alternative 2 is the preferred remedy for the Property. Recommendations for the remediation and redevelopment in the FSA are as follows:

- Install monitoring wells near SB-7 and the boiler room addition and monitor groundwater for natural attenuation.
- Install asphalt cap over the bulk storage area and inspect annually to prevent direct contact with coal material, which may be a chemical and visual concern.
- Seal cracks and seams in the concrete building slab to prevent vapor intrusion.
- Install a passive venting system to capture sub-slab vapors near the sub-basement and direct them to an outdoor vent.
- Seal door that leads from the sub-basement to the basement to prevent potential vapor migration into occupied spaces of the building.

Groundwater data used in remedy development were from reconnaissance samples collected from temporary wells. This data is assumed to be representative of subsurface conditions. However, if groundwater data from monitoring wells indicates the plume has not been adequately characterized, the proposed groundwater remedy may warrant adjustment. The asphalt cap design can be incorporated into site development plans but should be designed to effectively prevent contact with coal material.

LIMITATIONS

The services undertaken in completing this report were performed consistent with generally accepted professional consulting principles and practices. No other warranty, express or implied, is made. These services were performed consistent with our agreement with our client. This report is solely for the use and information of our client unless otherwise noted. Any reliance on this report by a third party is at such party's sole risk.

Opinions and recommendations contained in this report apply to conditions existing when services were performed and are intended only for the client, purposes, locations, time frames, and project parameters indicated. We are not responsible for the impacts of any changes in environmental standards, practices, or regulations subsequent to performance of services. We do not warrant the accuracy of information supplied by others, or the use of segregated portions of this report.

REFERENCES

CCS. 2007. Letter (re: line and tank cleaning project). Prepared for Steve Potratz, WSU, Pullman, Washington. May 21.

MFA. 2021. Focused site assessment work plan, College Avenue steam plant, Pullman, Washington. Prepared for Port of Whitman County, Pullman, Washington. October 18.

Parametrix, Inc. 1997. Independent remedial action report, WSU power plant oil storage area. Prepared for Washington State University, Facilities Development – McCluskey Offices. Pullman, Washington. February.

Strata Geotechnical. 2008. Letter (re: good faith asbestos inspection, College Avenue steam tunnel street lighting and wiring project, Washington State University, Pullman, Washington). August 13.

TerraGraphics. 2007. Washington State University former steam plant coal storage site subsurface boring event, Pullman, WA 99164. Prepared for A. Donnelly, facility project officer, Washington State University Facilities Operations. TerraGraphics Environmental Engineering, Inc. November.

TerraGraphics. 2008. Letter (re: limited “good faith” asbestos inspection and lead based paint survey results for the College Avenue Steam Plant restrooms, WSU Project # 3409-2007). TerraGraphics Environmental Engineering, Inc. February 29.

USGS and AASG. 1980. National geologic map database. U.S. Geological Survey and Association of American State Geologists. Digital reconnaissance geologic map of the Columbia River Basalt Group, Pullman and Walla Walla quadrangles, southeast Washington and adjacent Idaho (accessed August 16, 2021). Page updated February 22, 2021.

WSU. 2014. Asbestos management program, shops good faith survey summary. Washington State University. May 2.

TABLES



Table 4-1
Summary of Soil Analytical Results
WSU Steam Plant
Port of Whitman County

Location:	MTCA A, Soil, Unrestricted Land Use ⁽¹⁾	SB-1	SB-1	SB-2	SB-2	SB-3	SB-3	SB-5	SB-5	SB-7	SB-7
Sample Name:		SB-1-2.5	SB-1-15	SB-2-2.0	SB-2-15.0	SB-3-5.0	SB-3-13.0	SB-5-5.0	SB-5-15.0	SB-7-5.5	SB-7-18.5
Collection Date:		10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021
Collection Depth (ft bgs):		2.5	15.0	2.0	15.0	5.0	13.0	5.0	15.0	5.5	18.5
Total Metals (mg/kg)											
Arsenic	20	4.82	2.97	3.86	3	2.98	4.13	3.42	4.01	3.41	3.3
Barium	NV	190	115	94	114	145	603	237	127	140	100
Cadmium	2	0.224 J	0.102 U	0.288 J	0.103 U	0.284 J	0.382 J	0.473 J	0.153 J	0.117 U	0.11 U
Chromium	2,000 ^(a)	20.3	18.7	20.2	13.9	18.3	11	19	14.9	16.8	21.9
Lead	250	11.7	8.13	13.3	6.01	71.2	7.26	33.5	9.42	6.83	5.86
Mercury	2	0.0206 U	0.0216 U	0.0207 U	0.0217 U	0.0295 J	0.0212 U	0.0511 J	0.0214 U	0.0247 U	0.0231 U
Selenium	NV	0.331 J	0.216 U	0.372 J	0.266 J	0.3 J	0.212 U	0.315 J	0.224 J	0.247 U	0.271 J
Silver	NV	0.0988 U	0.104 U	0.0996 U	0.104 U	0.233 J	0.102 U	0.115 J	0.103 U	0.119 U	0.111 U
PCBs (mg/kg)											
Aroclor 1016	NV	--	--	--	--	--	--	--	0.014 U	0.0162 U	0.0151 U
Aroclor 1221	NV	--	--	--	--	--	--	--	0.014 U	0.0162 U	0.0151 U
Aroclor 1232	NV	--	--	--	--	--	--	--	0.014 U	0.0162 U	0.0151 U
Aroclor 1242	NV	--	--	--	--	--	--	--	0.014 U	0.0162 U	0.0151 U
Aroclor 1248	NV	--	--	--	--	--	--	--	0.00876 U	0.0101 U	0.00947 U
Aroclor 1254	NV	--	--	--	--	--	--	--	0.00876 U	0.0101 U	0.00947 U
Aroclor 1260	NV	--	--	--	--	--	--	--	0.00876 U	0.0101 U	0.00947 U
Total PCBs ^(b)	1	--	--	--	--	--	--	--	0.014 U	0.0162 U	0.0151 U
VOCs (mg/kg)											
1,1,1,2-Tetrachloroethane	NV	0.00123 U	0.00135 U	0.00138 U	0.00138 U	0.0014 U	0.00129 U	0.00179 U	0.00136 U	0.00168 U	0.00152 U
1,1,1-Trichloroethane	2	0.0012 U	0.00131 U	0.00134 U	0.00134 U	0.00136 U	0.00126 U	0.00174 U	0.00132 U	0.00164 U	0.00148 U
1,1,2,2-Tetrachloroethane	NV	0.000901 U	0.000987 U	0.00101 U	0.00101 U	0.00102 U	0.000948 U	0.00131 U	0.000994 U	0.00123 U	0.00112 U
1,1,2-Trichloroethane	NV	0.000774 U	0.000848 U	0.000868 U	0.000868 U	0.00088 U	0.000814 U	0.00112 U	0.000854 U	0.00106 U	0.000958 U
1,1-Dichloroethane	NV	0.000636 U	0.000697 U	0.000713 U	0.000714 U	0.000723 U	0.00067 U	0.000924 U	0.000702 U	0.000871 U	0.000788 U
1,1-Dichloroethene	NV	0.000785 UJ	0.00086 UJ	0.00088 UJ	0.000881 UJ	0.000893 UJ	0.000827 UJ	0.00114 UJ	0.000866 UJ	0.00108 UJ	0.000972 UJ
1,1-Dichloropropene	NV	0.00105 U	0.00115 U	0.00117 U	0.00118 U	0.00119 U	0.0011 U	0.00152 U	0.00116 U	0.00144 U	0.0013 U
1,2,3-Trichlorobenzene	NV	0.0095 U	0.0104 U	0.0106 U	0.0107 U	0.0108 U	0.01 U	0.0138 U	0.0105 U	0.013 U	0.0118 U
1,2,3-Trichloropropane	NV	0.0021 U	0.0023 U	0.00235 U	0.00235 U	0.00239 U	0.00221 U	0.00304 U	0.00232 U	0.00287 U	0.0026 U
1,2,3-Trimethylbenzene	NV	0.0426	0.00224 U	0.0023 U	0.0023 U	0.0317	0.04	0.0321	0.00226 U	0.0028 U	0.00254 U
1,2,4-Trichlorobenzene	NV	0.0057 U	0.00625 U	0.00639 U	0.00639 U	0.00648 U	0.006 U	0.00828 U	0.00629 U	0.00781 U	0.00706 U
1,2,4-Trimethylbenzene	NV	0.0485 J	0.00224 U	0.0023 U	0.0023 U	0.0318	0.0449	0.034	0.00226 U	0.0028 U	0.00254 U
1,2-Dibromo-3-chloropropane	NV	0.00505 U	0.00554 U	0.00567 U	0.00567 U	0.00575 U	0.00532 U	0.00734 U	0.00558 U	0.00692 U	0.00626 U
1,2-Dibromoethane	0.005	0.00084 U	0.00092 U	0.000941 U	0.000942 U	0.000955 U	0.000884 U	0.00122 U	0.000927 U	0.00115 U	0.00104 U
1,2-Dichlorobenzene	NV	0.000551 U	0.000603 U	0.000617 U	0.000618 U	0.000626 U	0.00058 U	0.0008 U	0.000608 U	0.000754 U	0.000682 U
1,2-Dichloroethane	NV	0.000841 U	0.000922 U	0.000942 U	0.000943 U	0.000956 U	0.000885 U	0.00122 U	0.000928 U	0.00115 U	0.00104 U
1,2-Dichloropropane	NV	0.00184 U	0.00202 U	0.00206 U	0.00206 U	0.00209 U	0.00194 U	0.00268 U	0.00203 U	0.00252 U	0.00228 U
1,3,5-Trimethylbenzene	NV	0.0122 J	0.00284 U	0.0029 U	0.00291 U	0.00907	0.0106	0.0161	0.00286 U	0.00355 U	0.00321 U
1,3-Dichlorobenzene	NV	0.000778 U	0.000852 U	0.000871 U	0.000872 U	0.000884 U	0.000818 U	0.00113 U	0.000858 U	0.00106 U	0.000963 U
1,3-Dichloropropane	NV	0.000649 U	0.000711 U	0.000728 U	0.000728 U	0.000738 U	0.000683 U	0.000943 U	0.000716 U	0.000889 U	0.000804 U
1,4-Dichlorobenzene	NV	0.000907 U	0.000994 U	0.00102 U	0.00102 U	0.00103 U	0.000955 U	0.00132 U	0.001 U	0.00124 U	0.00112 U
2,2-Dichloropropane	NV	0.00179 UJ	0.00196 UJ	0.00201 UJ	0.00201 UJ	0.00203 UJ	0.00188 UJ	0.0026 UJ	0.00197 UJ	0.00245 UJ	0.00221 UJ
2-Butanone	NV	0.0823 U	0.0902 U	0.0923 U	0.0923 U	0.0935 U	0.0866 U	0.12 U	0.0908 U	0.113 U	0.102 U
2-Chlorotoluene	NV	0.00112 U	0.00123 U	0.00126 U	0.00126 U	0.00127 U	0.00118 U	0.00162 U	0.00124 U	0.00154 U	0.00139 U
4-Chlorotoluene	NV	0.000583 U	0.000639 U	0.000654 U	0.000654 U	0.000663 U	0.000614 U	0.000848 U	0.000643 U	0.000799 U	0.000722 U
4-Isopropyltoluene	NV	0.0152 J	0.00362 U	0.0037 U	0.00371 U	0.00891	0.0164	0.0137	0.00365 U	0.00453 U	0.00409 U
4-Methyl-2-pentanone	NV	0.0174 J	0.00324 U	0.00332 U	0.00331 U	0.00336 U	0.0103 J	0.00428 U	0.00326 U	0.00405 U	0.00366 U
Acetone	NV	0.0473 U	0.0518 U	0.053 U	0.053 U	0.0538 U	0.0498 U	0.0941 U	0.0522 U	0.0648 U	0.0586 U
Acrylonitrile	NV	0.00468 U	0.00513 U	0.00524 U	0.00525 U	0.00532 U	0.00492 U	0.00679 U	0.00516 U	0.00641 U	0.00579 U

Table 4-1
Summary of Soil Analytical Results
WSU Steam Plant
Port of Whitman County

Location:	MTCA A, Soil, Unrestricted Land Use ⁽¹⁾	SB-1	SB-1	SB-2	SB-2	SB-3	SB-3	SB-5	SB-5	SB-7	SB-7	
Sample Name:		SB-1-2.5	SB-1-15	SB-2-2.0	SB-2-15.0	SB-3-5.0	SB-3-13.0	SB-5-5.0	SB-5-15.0	SB-7-5.5	SB-7-18.5	
Collection Date:		10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021
Collection Depth (ft bgs):		2.5	15.0	2.0	15.0	5.0	13.0	5.0	15.0	5.5	18.5	
Benzene	0.03	0.00527 J	0.000663 U	0.000679 U	0.000679 U	0.0058	0.0341	0.0113	0.000744 J	0.000829 U	0.000749 U	
Bromobenzene	NV	0.00117 U	0.00128 U	0.00131 U	0.00131 U	0.00133 U	0.00123 U	0.0017 U	0.00129 U	0.0016 U	0.00144 U	
Bromodichloromethane	NV	0.00094 U	0.00103 U	0.00105 U	0.00105 U	0.00107 U	0.000989 U	0.00136 U	0.00104 U	0.00129 U	0.00116 U	
Bromoform	NV	0.00152 U	0.00166 U	0.0017 U	0.0017 U	0.00172 U	0.0016 U	0.0022 U	0.00167 U	0.00208 U	0.00188 U	
Bromomethane	NV	0.00255 U	0.0028 U	0.00287 U	0.00286 U	0.0029 U	0.00269 U	0.0037 U	0.00282 U	0.0035 U	0.00316 U	
Carbon tetrachloride	NV	0.00116 U	0.00128 U	0.0013 U	0.00131 U	0.00132 U	0.00122 U	0.00168 U	0.00128 U	0.00159 U	0.00144 U	
Chlorobenzene	NV	0.000272 U	0.000298 U	0.000305 U	0.000305 U	0.000309 U	0.000286 U	0.000395 U	0.0003 U	0.000373 U	0.000337 U	
Chloroethane	NV	0.0022 U	0.00241 U	0.00247 U	0.00247 U	0.0025 U	0.00232 U	0.0032 U	0.00243 U	0.00302 U	0.00273 U	
Chloroform	NV	0.00133 U	0.00146 U	0.00149 U	0.0015 U	0.00152 U	0.0014 U	0.00194 U	0.00147 U	0.00183 U	0.00165 U	
Chloromethane	NV	0.00564 UJ	0.00618 UJ	0.00632 UJ	0.00632 UJ	0.00641 UJ	0.00593 UJ	0.00819 UJ	0.00622 UJ	0.00772 UJ	0.00698 UJ	
cis-1,2-Dichloroethene	NV	0.000951 U	0.00104 U	0.00107 U	0.00107 U	0.00108 U	0.001 U	0.00138 U	0.00105 U	0.0013 U	0.00118 U	
cis-1,3-Dichloropropene	NV	0.000981 U	0.00107 U	0.0011 U	0.0011 U	0.00112 U	0.00103 U	0.00142 U	0.00108 U	0.00134 U	0.00121 U	
Dibromochloromethane	NV	0.000793 U	0.000869 U	0.000889 U	0.000889 U	0.000902 U	0.000835 U	0.00115 U	0.000875 U	0.00109 U	0.000982 U	
Dibromomethane	NV	0.000972 U	0.00106 U	0.00109 U	0.00109 U	0.0011 U	0.00102 U	0.00141 U	0.00107 U	0.00133 U	0.0012 U	
Dichlorodifluoromethane (Freon 12)	NV	0.00209 U	0.00229 U	0.00234 U	0.00234 U	0.00237 U	0.0022 U	0.00303 U	0.0023 U	0.00286 U	0.00258 U	
Diisopropyl Ether	NV	0.000531 U	0.000582 U	0.000595 U	0.000596 U	0.000604 U	0.000559 U	0.000771 U	0.000586 U	0.000728 U	0.000658 U	
Ethylbenzene	6	0.0172 J	0.00105 U	0.00107 U	0.00107 U	0.0122	0.0185	0.00139 U	0.00105 U	0.00131 U	0.00118 U	
Freon 113	NV	0.000977 UJ	0.00107 UJ	0.0011 UJ	0.0011 UJ	0.00111 UJ	0.00103 UJ	0.00142 UJ	0.00108 UJ	0.00134 UJ	0.00121 UJ	
Hexachlorobutadiene	NV	0.00778 U	0.00852 U	0.00871 U	0.00872 U	0.00884 U	0.00818 U	0.0113 U	0.00858 U	0.0106 U	0.00963 U	
Isopropylbenzene	NV	0.00503 J	0.000603 U	0.000617 U	0.000618 U	0.00324 J	0.00374	0.00301 J	0.000608 U	0.000754 U	0.000682 U	
Methyl tert-butyl ether	0.1	0.000454 U	0.000497 U	0.000509 U	0.000509 U	0.000516 U	0.000477 U	0.000659 U	0.0005 U	0.000621 U	0.000562 U	
Methylene chloride	0.02	0.0086 U	0.00943 U	0.00964 U	0.00965 U	0.00978 U	0.00906 U	0.0125 U	0.00949 U	0.0118 U	0.0107 U	
Naphthalene	5	0.0577	0.00693 U	0.00708 U	0.00709 U	0.0436	0.0536	0.043	0.00698 U	0.00866 U	0.00783 U	
n-Butylbenzene	NV	0.00877 J	0.00745 U	0.00762 U	0.00763 U	0.00773 U	0.00716 U	0.00988 U	0.00751 U	0.00932 U	0.00842 U	
n-Propylbenzene	NV	0.00566 J	0.00135 U	0.00138 U	0.00138 U	0.00414 J	0.00367 J	0.00395 J	0.00136 U	0.00169 U	0.00152 U	
sec-Butylbenzene	NV	0.00373 U	0.00409 U	0.00418 U	0.00419 U	0.00424 U	0.00393 U	0.00542 U	0.00412 U	0.00511 U	0.00462 U	
Styrene	NV	0.000297 U	0.000325 U	0.000333 U	0.000333 U	0.000337 U	0.000312 U	0.000431 U	0.000327 U	0.000406 U	0.000367 U	
tert-Butylbenzene	NV	0.00253 U	0.00277 U	0.00283 U	0.00283 U	0.00287 U	0.00266 U	0.00367 U	0.00279 U	0.00346 U	0.00313 U	
Tetrachloroethene	0.05	0.00116 U	0.00127 U	0.0013 U	0.0013 U	0.00132 U	0.00122 U	0.00168 U	0.00128 U	0.00159 U	0.00144 U	
Toluene	7	0.061	0.00192 J	0.00338 J	0.00189 U	0.0687	0.143	0.0762	0.003 J	0.00231 U	0.00209 U	
trans-1,2-Dichloroethene	NV	0.00135 U	0.00148 U	0.00152 U	0.00151 U	0.00153 U	0.00142 U	0.00196 U	0.00149 U	0.00185 U	0.00167 U	
trans-1,3-Dichloropropene	NV	0.00148 U	0.00162 U	0.00166 U	0.00166 U	0.00168 U	0.00155 U	0.00214 U	0.00163 U	0.00202 U	0.00183 U	
Trichloroethene	0.03	0.000757 U	0.000829 U	0.000848 U	0.000849 U	0.00086 U	0.000797 U	0.0011 U	0.000835 U	0.00104 U	0.000937 U	
Trichlorofluoromethane (Freon 11)	NV	0.00107 UJ	0.00117 UJ	0.0012 UJ	0.0012 UJ	0.00122 UJ	0.00113 UJ	0.00156 UJ	0.00118 UJ	0.00147 UJ	0.00133 UJ	
Vinyl chloride	NV	0.0015 UJ	0.00165 UJ	0.00168 UJ	0.00169 UJ	0.00171 UJ	0.00158 UJ	0.00219 UJ	0.00166 UJ	0.00206 UJ	0.00186 UJ	
Xylenes (total) ^(c)	9	0.112 J	0.00125 U	0.00585 J	0.00128 U	0.0959	0.149	0.105	0.00182 J	0.00156 U	0.00141 U	
PAHs (mg/kg)												
1-Methylnaphthalene	NV	0.129	--	0.0268	--	0.217	--	0.138 J	--	0.00616 U	--	
2-Chloronaphthalene	NV	0.00532 U	--	0.00536 U	--	0.00569 U	--	0.00602 U	--	0.00639 U	--	
2-Methylnaphthalene	NV	0.183	--	0.0284	--	0.276	--	0.195 J	--	0.00586 U	--	
Acenaphthene	NV	0.00516 J	--	0.00241 U	--	0.00409 J	--	0.00547 J	--	0.00287 U	--	
Acenaphthylene	NV	0.00247 U	--	0.00249 U	--	0.00264 U	--	0.00279 U	--	0.00296 U	--	
Anthracene	NV	0.00481 J	--	0.00439 J	--	0.011	--	0.00634 J	--	0.00316 U	--	
Benzo(a)anthracene	NV	0.00895	--	0.006 J	--	0.00997	--	0.0131	--	0.00237 U	--	
Benzo(a)pyrene	NV	0.00489 J	--	0.00403 J	--	0.00491 J	--	0.00779	--	0.00246 U	--	
Benzo(b)fluoranthene	NV	0.00993	--	0.00583 J	--	0.00525 J	--	0.0136	--	0.0021 U	--	
Benzo(ghi)perylene	NV	0.00656 J	--	0.00368 J	--	0.00238 J	--	0.00681 J	--	0.00243 U	--	
Benzo(k)fluoranthene	NV	0.00246 U	--	0.00248 U	--	0.00262 U	--	0.00293 J	--	0.00295 U	--	

Table 4-1
Summary of Soil Analytical Results
WSU Steam Plant
Port of Whitman County

Location:	MTCA A, Soil, Unrestricted Land Use ⁽¹⁾	SB-1	SB-1	SB-2	SB-2	SB-3	SB-3	SB-5	SB-5	SB-7	SB-7
Sample Name:		SB-1-2.5	SB-1-15	SB-2-2.0	SB-2-15.0	SB-3-5.0	SB-3-13.0	SB-5-5.0	SB-5-15.0	SB-7-5.5	SB-7-18.5
Collection Date:		10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021
Collection Depth (ft bgs):		2.5	15.0	2.0	15.0	5.0	13.0	5.0	15.0	5.5	18.5
Chrysene	NV	0.0117	--	0.00634 J	--	0.0102	--	0.0176	--	0.00318 U	--
Dibenzo(a,h)anthracene	NV	0.00197 U	--	0.00198 U	--	0.0021 U	--	0.00222 U	--	0.00236 U	--
Fluoranthene	NV	0.00979	--	0.011	--	0.00748	--	0.0194	--	0.00311 U	--
Fluorene	NV	0.00932	--	0.00311 J	--	0.00587 J	--	0.0083	--	0.00281 U	--
Indeno(1,2,3-cd)pyrene	NV	0.00296 J	--	0.00374 J	--	0.00221 U	--	0.00655 J	--	0.00248 U	--
Naphthalene	5	0.0772	--	0.0125 J	--	0.144	--	0.105 J	--	0.0056 U	--
Phenanthrene	NV	0.0652	--	0.0195	--	0.063	--	0.0817	--	0.00317 U	--
Pyrene	NV	0.0126	--	0.0107	--	0.0115	--	0.0203	--	0.00274 U	--
Total naphthalenes ^(d)	5	0.389	--	0.0677 J	--	0.637	--	0.438 J	--	0.00616 U	--
cPAH TEQ ^{(e)(2)}	0.1	0.00641 J	--	0.0304 J	--	0.03726 J	--	0.06379 J	--	0.00318 U	--
TPH (mg/kg)											
Diesel Range Hydrocarbons	2,000	25.4	1.59 U	7.56	1.6 U	16.1	19.2	24	1.58 U	1.82 U	1.71 U
Residual Range Hydrocarbons	2,000	46	3.99 U	19.1	4.01 U	22.1	45.1	55.2	3.95 U	4.57 U	4.27 U

NOTES:

Analytical results compared to screening criteria. There were no exceedances. Non-detects ("U" or "UJ") were not compared with screening criteria.

-- = not analyzed.

cPAH TEQ = carcinogenic PAH toxicity equivalence.

Ecology = Washington State Department of Ecology.

ft bgs = feet below ground surface.

J = result is estimated.

mg/kg = milligrams per kilogram.

MTCA = Model Toxics Control Act.

NV = no value.

PAH = polycyclic aromatic hydrocarbon.

PCB = polychlorinated biphenyl.

TEQ = toxicity equivalence.

TPH = total petroleum hydrocarbons.

U = result is non-detect to method detection limit or method reporting limit.

UJ = result is non-detect with an estimated method detection limit or method reporting limit.

VOC = volatile organic compound.

WSU = Washington State University.

^(a)Cleanup level is for trivalent chromium, as a value for total chromium is not available.

^(b)Total PCBs is the sum of all Aroclors. When all results are non-detect, the highest value is shown.

^(c)Total xylenes are reported by the laboratory.

^(d)Total naphthalenes is the sum of 1-methylnaphthalene, 2-methylnaphthalene, and naphthalene. When all results are non-detect, the highest value is shown.

^(e)cPAH TEQ calculated with non-detect results multiplied by one-half. When all cPAHs are non-detect, the highest product of toxicity equivalence factor and detection limit is provided.

REFERENCES:

⁽¹⁾Ecology. 2021. Cleanup Levels and Risk Calculation (CLARC) Table. Washington State Department of Ecology. February.

⁽²⁾Ecology. 2015. Washington State Department of Ecology Implementation Memorandum #10 (Evaluating the Human Health Toxicity of Carcinogenic PAHs [cPAHs] Using Toxicity Equivalency Factors [TEFs]). Washington State Department of Ecology. April 20, 2015.

Table 4-2
Summary of Groundwater Analytical Results
WSU Steam Plant
Port of Whitman County

Location:	MTCA A, Groundwater ⁽¹⁾	SB-1	SB-2	SB-3	SB-5	SB-7
Sample Name:		SB-1-GW	SB-2-GW	SB-3-GW	SB-5-GW	SB-7-GW
Collection Date:		10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021
Collection Depth (ft bgs):		16	17	16	16	21
Total Metals (ug/L)						
Arsenic	5	1.15 J	0.756 J	1.15 J	1.19 J	--
Barium	NV	169	171	92.7	97.1	--
Cadmium	5	0.222 J	0.359 J	0.15 U	0.15 U	--
Chromium	50	3.32 J+	4.32 J+	2.45 J+	7.09 J+	--
Lead	15	11.4	7.66	0.849 U	4.45	--
Mercury	2	0.1 U	0.1 U	0.1 U	0.1 U	--
Selenium	NV	0.3 U	0.3 U	0.792 J	0.583 J	--
Silver	NV	0.115 J	0.07 U	0.07 U	0.0736 J	--
PCB Aroclors (ug/L)						
Aroclor 1016	NV	--	--	--	0.27 U	0.27 U
Aroclor 1221	NV	--	--	--	0.27 U	0.27 U
Aroclor 1232	NV	--	--	--	0.27 U	0.27 U
Aroclor 1242	NV	--	--	--	0.27 U	0.27 U
Aroclor 1248	NV	--	--	--	0.173 U	0.173 U
Aroclor 1254	NV	--	--	--	0.173 U	0.173 U
Aroclor 1260	NV	--	--	--	0.173 U	0.173 U
Total PCBs ^(a)	0.10	--	--	--	0.27 U	0.27 U
VOCs (ug/L)						
1,1,1,2-Tetrachloroethane	NV	0.02 U	0.02 U	0.02 U	0.02 U	0.02 U
1,1,1-Trichloroethane	200	0.011 U	0.011 U	0.011 U	0.011 U	0.011 U
1,1,2,2-Tetrachloroethane	NV	0.0156 U	0.0156 U	0.0156 U	0.0156 U	0.0156 U
1,1,2-Trichloroethane	NV	0.0353 U	0.0353 U	0.0353 U	0.0353 U	0.0353 U
1,1-Dichloroethane	NV	0.023 U	0.023 U	0.023 U	0.023 U	0.023 U
1,1-Dichloroethene	NV	0.02 U	0.02 U	0.02 U	0.02 U	0.02 U
1,1-Dichloropropene	NV	0.028 U	0.028 U	0.028 U	0.028 U	0.028 U
1,2,3-Trichlorobenzene	NV	0.025 U	0.025 U	0.025 U	0.025 U	0.025 U
1,2,3-Trichloropropane	NV	0.204 U	0.204 U	0.204 U	0.204 U	0.204 U
1,2,3-Trimethylbenzene	NV	0.046 U	0.046 U	0.046 U	0.046 U	0.046 U
1,2,4-Trichlorobenzene	NV	0.193 U	0.193 U	0.193 U	0.193 U	0.193 U
1,2,4-Trimethylbenzene	NV	0.0464 U	0.0464 U	0.0464 U	0.0464 U	0.0464 U
1,2-Dibromo-3-chloropropane	NV	0.204 UJ	0.204 UJ	0.204 UJ	0.204 UJ	0.204 UJ
1,2-Dibromoethane	0.01	0.021 U	0.021 U	0.021 U	0.021 U	0.021 U
1,2-Dichlorobenzene	NV	0.058 U	0.058 U	0.058 U	0.058 U	0.058 U
1,2-Dichloroethane	5	0.019 U	0.019 U	0.019 U	0.019 U	0.019 U
1,2-Dichloropropane	NV	0.0508 U	0.0508 U	0.0508 U	0.0508 U	0.0508 U
1,3,5-Trimethylbenzene	NV	0.0432 U	0.0432 U	0.0432 U	0.0432 U	0.0432 U
1,3-Dichlorobenzene	NV	0.068 U	0.068 U	0.068 U	0.068 U	0.068 U
1,3-Dichloropropane	NV	0.07 U	0.07 U	0.07 U	0.07 U	0.07 U
1,4-Dichlorobenzene	NV	0.0788 U	0.0788 U	0.0788 U	0.0788 U	0.0788 U
2,2-Dichloropropane	NV	0.0317 U	0.0317 U	0.0317 U	0.0317 U	0.0317 U
2-Butanone	NV	0.5 U	0.5 U	0.5 U	0.5 U	1.19
2-Chlorotoluene	NV	0.0368 U	0.0368 U	0.0368 U	0.0368 U	0.0368 U
2-Hexanone	NV	0.4 U	0.4 U	0.4 U	0.4 U	0.4 U
4-Chlorotoluene	NV	0.0452 U	0.0452 U	0.0452 U	0.0452 U	0.0452 U
4-Isopropyltoluene	NV	0.0932 U	0.0932 U	0.0932 U	0.0932 U	1.35
4-Methyl-2-pentanone	NV	0.4 U	0.4 U	0.4 U	0.4 U	0.4 U
Acetone	NV	3.07 J	2.65 J	1.41 J	2.52 J	20.4 J

Table 4-2
Summary of Groundwater Analytical Results
WSU Steam Plant
Port of Whitman County

Location:	MTCA A, Groundwater ⁽¹⁾	SB-1	SB-2	SB-3	SB-5	SB-7
Sample Name:		SB-1-GW	SB-2-GW	SB-3-GW	SB-5-GW	SB-7-GW
Collection Date:		10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021
Collection Depth (ft bgs):		16	17	16	16	21
Acrylonitrile	NV	0.076 U	0.076 U	0.076 U	0.076 U	0.076 U
Benzene	5	0.016 U	0.098	0.049	0.024 J	0.134
Bromobenzene	NV	0.042 U	0.042 U	0.042 U	0.042 U	0.042 U
Bromodichloromethane	NV	0.0315 U	0.0315 U	0.0315 U	0.0315 U	0.062 J
Bromoform	NV	0.239 U	0.239 U	0.239 U	0.239 U	0.239 U
Bromomethane	NV	0.148 U	0.148 U	0.148 U	0.148 U	0.148 U
Carbon disulfide	NV	0.162 U	0.162 U	0.162 U	0.162 U	0.162 U
Carbon tetrachloride	NV	0.0432 U	0.0432 U	0.0432 U	0.0432 U	0.0432 U
Chlorobenzene	NV	0.0229 U	0.0229 U	0.0229 U	0.0229 U	0.0229 U
Chlorobromomethane	NV	0.0452 U	0.0452 U	0.0452 U	0.0452 U	0.0452 U
Chloroethane	NV	0.0432 U	0.0432 U	0.0432 U	0.0432 U	0.0432 U
Chloroform	NV	0.0166 U	0.0166 U	0.0166 U	0.0166 U	0.205 J
Chloromethane	NV	0.0556 U	0.0556 U	0.0556 U	0.0556 U	0.0556 U
cis-1,2-Dichloroethene	NV	0.0276 U	0.0276 U	0.0276 U	0.0276 U	0.0276 U
cis-1,3-Dichloropropene	NV	0.0271 U	0.0271 U	0.0271 U	0.0271 U	0.0271 U
Dibromochloromethane	NV	0.018 U	0.018 U	0.018 U	0.018 U	0.018 U
Dibromomethane	NV	0.04 U	0.04 U	0.04 U	0.04 U	0.04 U
Dichlorodifluoromethane (Freon 12)	NV	0.0327 U	0.0327 U	0.0327 U	0.0327 U	0.0327 U
Diisopropyl Ether	NV	0.014 U	0.014 U	0.014 U	0.014 U	0.014 U
Ethylbenzene	700	0.0212 U	0.0212 U	0.0212 U	0.0212 U	0.339
Freon 113	NV	0.027 U	0.027 U	0.027 U	0.027 U	0.027 U
Hexachlorobutadiene	NV	0.508 U	0.508 U	0.508 U	0.508 U	0.508 U
Isopropylbenzene	NV	0.0345 U	0.0345 U	0.0345 U	0.0345 U	0.0345 U
Methyl iodide	NV	0.242 U	0.242 U	0.242 U	0.242 U	0.242 U
Methyl tert-butyl ether	20	0.0118 U	0.0118 U	0.0118 U	0.0118 U	0.0118 U
Methylene chloride	5	0.265 U	0.265 U	0.265 U	0.265 U	0.265 U
Naphthalene	160	0.124 UJ	0.124 UJ	0.124 UJ	0.124 UJ	0.124 UJ
n-Butylbenzene	NV	0.153 U	0.153 U	0.153 U	0.153 U	0.153 U
n-Hexane	NV	0.0424 U	0.0424 U	0.0424 U	0.0424 U	0.0424 U
n-Propylbenzene	NV	0.0472 U	0.0472 U	0.0472 U	0.0472 U	0.0472 U
sec-Butylbenzene	NV	0.101 U	0.101 U	0.101 U	0.101 U	0.101 U
Styrene	NV	0.109 U	0.109 U	0.109 U	0.109 U	0.109 U
tert-Butylbenzene	NV	0.062 UJ	0.062 UJ	0.062 UJ	0.062 UJ	0.062 UJ
Tetrachloroethene	5	0.028 U	0.028 U	0.028 U	0.028 U	0.028 U
Toluene	1,000	0.055 J	0.105 J	0.081 J	0.116 J	0.483
trans-1,2-Dichloroethene	NV	0.0572 U	0.0572 U	0.0572 U	0.0572 U	0.0572 U
trans-1,3-Dichloropropene	NV	0.0612 U	0.0612 U	0.0612 U	0.0612 U	0.0612 U
trans-1,4-Dichloro-2-butene	NV	0.056 U	0.056 U	0.056 U	0.056 U	0.056 U
Trichloroethene	5	0.016 U	0.016 U	0.016 U	0.016 U	0.016 U
Trichlorofluoromethane (Freon 11)	NV	0.02 U	0.02 U	0.02 U	0.02 U	0.02 U
Vinyl Acetate	NV	0.141 U	0.141 U	0.141 U	0.141 U	0.141 U
Vinyl chloride	0.2	0.0273 U	0.0273 U	0.0273 U	0.0273 U	0.0273 U
Xylenes (total) ^(b)	1,000	0.191 U	0.191 U	0.191 U	0.191 U	2
PAHs (ug/L)						
1-Methylnaphthalene	NV	0.0687 U	0.0687 U	0.0687 U	0.0687 U	0.0687 U
2-Chloronaphthalene	NV	0.0682 U	0.0682 U	0.0682 U	0.0682 U	0.0682 U
2-Methylnaphthalene	NV	0.0674 U	0.0674 U	0.0674 U	0.0674 U	0.0674 U
Acenaphthene	NV	0.019 U	0.019 U	0.019 U	0.019 U	0.019 U

Table 4-2
Summary of Groundwater Analytical Results
WSU Steam Plant
Port of Whitman County

Location:	MTCA A, Groundwater ⁽¹⁾	SB-1	SB-2	SB-3	SB-5	SB-7
Sample Name:		SB-1-GW	SB-2-GW	SB-3-GW	SB-5-GW	SB-7-GW
Collection Date:		10/19/2021	10/19/2021	10/19/2021	10/19/2021	10/19/2021
Collection Depth (ft bgs):		16	17	16	16	21
Acenaphthylene	NV	0.0171 U	0.0171 U	0.0171 U	0.0171 U	0.0171 U
Anthracene	NV	0.019 U	0.019 U	0.019 U	0.019 U	0.019 U
Benzo(a)anthracene	NV	0.0203 U	0.0203 U	0.0203 U	0.0203 U	0.0203 U
Benzo(a)pyrene	NV	0.0184 U	0.0184 U	0.0184 U	0.0184 U	0.0184 U
Benzo(b)fluoranthene	NV	0.0168 U	0.0168 U	0.0168 U	0.0168 U	0.0168 U
Benzo(ghi)perylene	NV	0.0184 U	0.0184 U	0.0184 U	0.0184 U	0.0184 U
Benzo(k)fluoranthene	NV	0.0202 U	0.0202 U	0.0202 U	0.0202 U	0.0202 U
Chrysene	NV	0.0179 U	0.0179 U	0.0179 U	0.0179 U	0.0179 U
Dibenzo(a,h)anthracene	NV	0.016 U	0.016 U	0.016 U	0.016 U	0.016 U
Fluoranthene	NV	0.027 U	0.027 U	0.027 U	0.027 U	0.027 U
Fluorene	NV	0.0169 U	0.0169 U	0.0169 U	0.0169 U	0.0169 U
Indeno(1,2,3-cd)pyrene	NV	0.0158 U	0.0158 U	0.0158 U	0.0158 U	0.0158 U
Naphthalene	160	0.0917 U	0.0917 U	0.0917 U	0.0917 U	0.0917 U
Phenanthrene	NV	0.018 U	0.018 U	0.018 U	0.018 U	0.018 U
Pyrene	NV	0.0169 U	0.0169 U	0.0169 U	0.0169 U	0.0169 U
Total naphthalenes ^(c)	160	0.0917 U	0.0917 U	0.0917 U	0.0917 U	0.0917 U
cPAH TEQ ^{(d)(2)}	0.1	0.00318 U	0.00318 U	0.00318 U	0.00318 U	0.00318 U
TPH (ug/L)						
Diesel Range Hydrocarbons	500	66.7 UJ	66.7 U	66.7 U	155 J	512
Residual Range Hydrocarbons	500	83.3 UJ	83.3 U	83.3 U	287	164 J

<p>NOTES:</p> <p>Shading (color key below) indicates values that exceed screening criteria; non-detects ("U" or "UJ") were not compared with screening criteria.</p> <p>MTCA A, Groundwater</p> <p>-- = not analyzed.</p> <p>cPAH TEQ = carcinogenic PAH toxicity equivalence.</p> <p>Ecology = Washington State Department of Ecology.</p> <p>ft bgs = feet below ground surface.</p> <p>J = result is estimated.</p> <p>J+ = result is estimated with a potential high bias.</p> <p>MTCA = Model Toxics Control Act.</p> <p>NV = no value.</p> <p>PAH = polycyclic aromatic hydrocarbon.</p> <p>PCB = polychlorinated biphenyl.</p> <p>TEQ = toxicity equivalence.</p> <p>TPH = total petroleum hydrocarbons.</p> <p>U = result is non-detect to method detection limit or method reporting limit.</p> <p>ug/L = micrograms per liter.</p> <p>UJ = result is non-detect with an estimated method detection limit or method reporting limit.</p> <p>VOC = volatile organic compound.</p> <p>WSU = Washington State University.</p> <p>^(a)Total PCBs is the sum of all Aroclors. When all results are non-detect, the highest value is shown.</p> <p>^(b)Total xylenes are reported by the laboratory.</p> <p>^(c)Total naphthalenes is the sum of 1-methylnaphthalene, 2-methylnaphthalene, and naphthalene. When all results are non-detect the highest value is shown.</p> <p>^(d)cPAH TEQ calculated with non-detect results multiplied by one-half. When all cPAHs are non-detect, the highest product of toxicity equivalence factor and detection limit is provided.</p> <p>REFERENCES:</p> <p>⁽¹⁾Ecology. 2021. Cleanup Levels and Risk Calculation (CLARC) Table. Washington State Department of Ecology. February.</p> <p>⁽²⁾Ecology. 2015. Washington State Department of Ecology Implementation Memorandum #10 (Evaluating the Human Health Toxicity of Carcinogenic PAHs [cPAHs] Using Toxicity Equivalency Factors [TEFs]). Washington State Department of Ecology. April 20, 2015.</p>
--

Table 4-3
Summary of Soil Vapor Analytical Results
WSU Steam Plant
Port of Whitman County



Location:	MTCA Method	VP-1	VP-2	VP-3
Sample Name:	B, Indoor Air	VP-1	VP-2	VP-3
Collection Date:	CUL ^{(a)(1)}	11/12/2021	11/12/2021	11/12/2021
VOCs (ug/m³)				
1,1,1-Trichloroethane	2,300	1.09 U	1.09 U	1.09 U
1,1,2,2-Tetrachloroethane	0.043	1.37 U	1.37 U	1.37 U
1,1,2-Trichloroethane	0.091	1.09 U	1.09 U	1.09 U
1,1-Dichloroethane	1.6	0.802 U	0.802 U	0.802 U
1,1-Dichloroethene	91	0.793 U	0.793 U	0.793 U
1,2,4-Trichlorobenzene	0.91	4.66 U	4.66 U	4.66 U
1,2,4-Trimethylbenzene	27	0.982 U	1.23	1.75
1,2-Dibromoethane	0.0042	1.54 U	1.54 U	1.54 U
1,2-Dichlorobenzene	91	1.2 U	1.2 U	1.2 U
1,2-Dichloroethane	0.096	0.81 U	0.81 U	0.81 U
1,2-Dichloropropane	0.68	0.924 U	0.924 U	0.924 U
1,3,5-Trimethylbenzene	27	0.982 U	0.982 U	0.982 U
1,3-Butadiene	0.083	4.43 U	4.43 U	4.43 U
1,3-Dichlorobenzene	NV	1.2 U	1.2 U	1.2 U
1,4-Dichlorobenzene	0.23	1.2 U	1.2 U	1.2 U
1,4-Dioxane	0.5	0.84	0.721 U	0.721 U
2,2,4-Trimethylpentane	NV	0.934 U	0.934 U	0.934 U
2-Butanone	2,300	4.04	3.69 U	5.75
2-Chlorotoluene	NV	1.03 U	1.03 U	1.03 U
2-Hexanone	14	5.11 U	5.11 U	5.11 U
2-Propanol	91	5.31	3.07 U	7.03
4-Ethyltoluene	NV	0.982 U	0.982 U	1.24
4-Methyl-2-pentanone	1,400	5.12 U	5.12 U	5.12 U
Acetone	14,000	30.2	16.1	28.8
Allyl Chloride	0.42	0.626 U	0.626 U	0.626 U
Benzene	0.32	7.12	0.639 U	0.747
Benzyl Chloride	0.051	1.04 U	1.04 U	1.04 U
Bromodichloromethane	0.068	1.34 U	1.34 U	1.34 U
Bromoform	2.3	6.21 U	6.21 U	6.21 U
Bromomethane	2.3	0.776 U	0.776 U	0.776 U
Carbon disulfide	320	0.622 U	0.622 U	2.98
Carbon tetrachloride	0.42	1.26 U	1.26 U	1.26 U
Chlorobenzene	23	0.924 U	0.924 U	0.924 U
Chloroethane	4,600	0.528 U	0.528 U	0.528 U
Chloroform	0.11	0.973 U	0.973 U	0.973 U
Chloromethane	41	0.456	0.413 U	0.413 U

Table 4-3
Summary of Soil Vapor Analytical Results
WSU Steam Plant
Port of Whitman County



Location:	MTCA Method	VP-1	VP-2	VP-3
Sample Name:	B, Indoor Air	VP-1	VP-2	VP-3
Collection Date:	CUL ^{(a)(1)}	11/12/2021	11/12/2021	11/12/2021
cis-1,2-Dichloroethene	NV	0.793 U	0.793 U	0.793 U
cis-1,3-Dichloropropene	NV	0.908 U	0.908 U	0.908 U
Cyclohexane	2,700	0.73	0.689 U	0.689 U
Dibromochloromethane	NV	1.7 U	1.7 U	1.7 U
Dichlorodifluoromethane (Freon 12)	46	2.3	2.4	2.44
Ethanol	NV	107	71.6	58.8
Ethylbenzene	460	1.75	1.55	2.24
Freon 113	2,300	1.53 U	1.53 U	1.53 U
Freon 114	NV	1.4 U	4.23	1.4 U
Heptane	180	0.818 U	34.2	1.61
Hexachlorobutadiene	0.11	6.73 U	6.73 U	6.73 U
Isopropylbenzene	180	0.983 U	0.983 U	0.983 U
m,p-Xylene	NV	8.8	5.51	8.11
Methyl methacrylate	320	0.819 U	0.819 U	0.819 U
Methyl tert-butyl ether	9.6	0.721 U	0.721 U	0.721 U
Methylene chloride	66	6.46	0.694 U	0.694 U
Naphthalene	0.074	3.3 U	3.3 U	3.3 U
n-Hexane	320	3.17	52.5	2.96
o-Xylene	46	3.13	1.76	2.81
Propylene	NV	2.15 U	2.15 U	2.15 U
Styrene	460	0.851 U	1.48	2.08
Tetrachloroethene	9.6	1.36 U	1.36 U	1.36 U
Tetrahydrofuran	910	0.59 U	0.59 U	0.59 U
Toluene	2,300	15.2	15.2	14.3
trans-1,2-Dichloroethene	18	0.793 U	0.793 U	0.793 U
trans-1,3-Dichloropropene	NV	0.908 U	0.908 U	0.908 U
Trichloroethene	0.33	1.07 U	1.07 U	1.59
Trichlorofluoromethane (Freon 11)	320	1.16	13.4	1.12 U
Vinyl acetate	91	0.704 U	0.704 U	0.704 U
Vinyl bromide	0.17	0.875 U	0.875 U	0.875 U
Vinyl chloride	0.28	0.511 U	0.511 U	0.511 U
Xylenes, total ^(b)	46	11.9	7.27	10.9

Table 4-3
Summary of Soil Vapor Analytical Results
WSU Steam Plant
Port of Whitman County



NOTES:

Shading (color key below) indicates values that exceed screening criteria; non-detects ("U") were not compared with screening criteria.

MTCA Method B, Indoor Air CUL

CUL = cleanup level.

Ecology = Washington State Department of Ecology.

MTCA = Model Toxics Control Act.

NV = no value.

U = result is non-detect to method reporting limit.

ug/m³ = micrograms per cubic meter.

VOC = volatile organic compound.

WSU = Washington State University.

^(a)Cleanup level is the lower of available cancer or non-cancer values.

^(b)Total xylenes is the sum of m,p-xylene and o-xylene.

REFERENCE:

⁽¹⁾Ecology. 2021. Cleanup Levels and Risk Calculation (CLARC) Table. Washington State Department of Ecology. February.

Table 8-1
Alternative 1 - Gravel Capping, Vapor Sealing, and Monitored Natural Attenuation
Cost Estimate Summary
Port of Whitman County
Pullman, Washington

Project:	WSU Steam Plant Focused Site Assessment		MAUL FOSTER & ALONGI, INC. 601 East Front Ave., Suite 202 Coeur d'Alene, ID 83814 208.664.7880 (p) www.maulfooster.com
Client:	Port of Whitman County		
Project #/Task:	M0457.02.003	Initial	
Prepared By:	E. Lundeen	EL	
Checked By:	T. Wall	TW	
Date:	1/27/2022		
Revision #:	0		
Cost Estimate Summary—Feasibility Level			
Schedule A—Site Preparation	\$	13,300	
Schedule B—Monitoring Well Installation	\$	6,300	
Schedule C—Basement Sealing	\$	15,375	
Schedule D—Gravel Cap Installation	\$	66,000	
Schedule E—Permitting and Technical Services	\$	60,000	
Schedule F—Design and Project Management	\$	56,300	
Schedule G—Monitoring and Periodic Costs	\$	222,500	
Schedule H—Contingency	\$	72,000	
Total:		\$	512,000
Assumptions:			
<ol style="list-style-type: none"> 1. Three monitoring wells will be installed on the Property. 2. Groundwater will naturally attenuate to below cleanup levels after five years. Groundwater will be monitored on a quarterly basis for five years, or until groundwater meets cleanup levels. A final year of quarterly monitoring is assumed to demonstrate achievement of cleanup levels. 3. All samples used for remedy design are reconnaissance groundwater and not permanent wells. Data may not be representative of subsurface conditions. 4. Cap will consist of a one-foot-thick layer of gravel over approximately 3,900 square yards outside of the building. Additional materials will be required for repairs every five years. 5. A contaminated media management plan and environmental covenant will be prepared for the Property. 6. Cracks in the basement will be sealed with a vapor resistant sealant and a passive vent will be installed to vent vapors from the sub-basement. 7. Net present value of monitoring and periodic costs was calculated using the ten-year nominal interest rate published by the U.S. Federal Reserve on January 6, 2022. 8. There will be 30 years of post-closure monitoring and maintenance. 9. A 30 percent contingency is included for short-term costs and a 10 percent contingency is included for long-term monitoring and maintenance. Contingency accounts for site and design uncertainty. 10. Probable cost is a decision tool and should be considered to represent a range reflecting -30%/+50%. 			

Table 8-1
Alternative 1 - Gravel Capping, Vapor Sealing, and Monitored Natural Attenuation Probable Costs
Port of Whitman County
Pullman, Washington

Schedule 'A' - Site Preparation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
A.1	Pre-design basement inspection	1	LS	\$ 1,800.00	\$ 1,800.00
A.2	Mobilization/demobilization	10%	LS	\$ -	\$ 8,500.00
A.3	Erosion and sediment control	1	LS	\$ 1,000.00	\$ 1,000.00
A.4	Preliminary site grading	1	LS	\$ 2,000.00	\$ 2,000.00
Subtotal Schedule 'A':					\$ 13,300

Schedule 'B' - Monitoring Well Installation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
B.1	Mobilization/drilling rig	1	LS	\$ 1,800.00	\$ 1,800.00
B.2	Install monitoring well	3	EA	\$ 1,500.00	\$ 4,500.00
Subtotal Schedule 'B':					\$ 6,300

Schedule 'C' - Vapor Sealing					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
C.1	Sealant product	25	EA	\$ 25.00	\$ 625.00
C.2	Application of sealant	1	LS	\$ 2,500.00	\$ 2,500.00
C.3	Install gas-tight door	1	LS	\$ 1,000.00	\$ 1,000.00
C.4	Gas-tight door to sub-basement	1	EA	\$ 5,000.00	\$ 5,000.00
C.5	Install passive vent from sub-basement	1	LS	\$ 4,500.00	\$ 4,500.00
C.6	4" PVC solid pipe (vertical)	50	LF	\$ 15.00	\$ 750.00
C.7	Pipe penetration boot	2	EA	\$ 500.00	\$ 1,000.00
Subtotal Schedule 'C':					\$ 15,375

Schedule 'D' - Gravel Cap Installation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
D.1	Demarcation fabric and placement	4,000	SY	\$ 2.50	\$ 10,000.00
D.2	12 inch gravel cap material, import, and placement	4,000	SY	\$ 14.00	\$ 56,000.00
Subtotal Schedule 'D':					\$ 66,000

Schedule 'E' - Permitting and Technical Services					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
E.1	Pre-design material, process, and systems confirmation	1	LS	\$ 15,000.00	\$ 15,000.00
E.2	Preparation of sampling plan	1	LS	\$ 15,000.00	\$ 15,000.00
E.3	Preparation of contaminated media management plan and environmental covenant	1	LS	\$ 20,000.00	\$ 20,000.00
E.4	Completion reporting	1	LS	\$ 5,000.00	\$ 5,000.00
E.5	Planning documents	1	LS	\$ 5,000.00	\$ 5,000.00
Subtotal Schedule 'E':					\$ 60,000

Schedule 'F' - Design and Project Management					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
F.1	Project management	10%	LS	-	\$ 16,100.00
F.2	Remedial design	15%	LS	-	\$ 24,100.00
F.3	Construction management	10%	LS	-	\$ 16,100.00
Subtotal Schedule 'F':					\$ 56,300

Table 8-1
Alternative 1 - Gravel Capping, Vapor Sealing, and Monitored Natural Attenuation Probable Costs
Port of Whitman County
Pullman, Washington

Schedule 'G' - Monitoring and Periodic Costs					
	10 Year Discount Rate	1.73%			
	Total Years	10			
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
G.1	Annual cap and basement slab inspection (years 1-30)	1	LS	\$ 69,800.00	\$ 69,800.00
G.2	Cap repairs (years 5, 10, 15, 20, 25 and 30)	1	LS	\$ 89,000.00	\$ 89,000.00
G.3	Sealant repairs (years 10, 20 and 30)	1	LS	\$ 2,100.00	\$ 2,100.00
G.4	Semiannual groundwater monitoring (years 1-4)	1	LS	\$ 41,600.00	\$ 41,600.00
G.5	Quarterly groundwater monitoring (year 5)	1	LS	\$ 20,000.00	\$ 20,000.00
Subtotal Schedule 'G':					\$ 222,500

Schedule 'H' - Contingency					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
H.1	Contingency (30% for Schedules A-F, 10% for Schedule G)	30%	LS	-	\$ 72,000
Subtotal Schedule 'H':					\$ 72,000

Table 8-2
Alternative 2 - Asphalt Capping, Vapor Sealing, and Monitored Natural Attenuation
Cost Estimate Summary
Port of Whitman County
Pullman, Washington

Project:	WSU Steam Plant Focused Site Assessment		MAUL FOSTER & ALONGI, INC. 601 East Front Ave., Suite 202 Coeur d'Alene, ID 83814 208.664.7880 (p) www.maulfooster.com
Client:	Port of Whitman County		
Project #/Task:	M0457.02.003	Initial	
Prepared By:	E. Lundeen	EL	
Checked By:	T. Wall	TW	
Date:	1/27/2022		
Revision #:	0		

Cost Estimate Summary—Feasibility Level

Schedule A—Site Preparation	\$	19,100
Schedule B— Monitoring Well Installation	\$	6,300
Schedule C—Vapor Sealing	\$	15,375
Schedule D—Asphalt Cap Installation	\$	139,800
Schedule E—Permitting and Technical Services	\$	60,000
Schedule F—Design and Project Management	\$	76,000
Schedule G—Monitoring and Periodic Costs	\$	163,600
Schedule H—Contingency	\$	107,000
Total:	\$	587,000

Assumptions:

1. Three monitoring wells will be installed on the Property.
2. Groundwater will naturally attenuate to below cleanup levels after five years. Groundwater will be monitored on a quarterly basis for five years, or until groundwater meets cleanup levels. A final year of quarterly monitoring is assumed to demonstrate achievement of cleanup levels.
3. All samples used for remedy design are reconnaissance groundwater and not permanent wells. Data may not be representative of subsurface conditions.
4. Cap will consist of an eight-inch-thick layer of aggregate subbase and a four-inch-thick layer of asphalt over approximately 3,900 square yards outside of the building. Cap repairs will be required every ten years.
5. A contaminated media management plan and environmental covenant will be prepared for the Property.
6. Cracks in the basement will be sealed with a vapor resistant sealant and a passive vent will be installed to vent vapors from the sub-basement.
7. Net present value of monitoring and periodic costs was calculated using the ten-year nominal interest rate published by the U.S. Federal Reserve on January 6, 2022.
8. There will be 30 years of post-closure monitoring and maintenance.
9. A 30 percent contingency is included for short-term costs and a 10 percent contingency is included for long-term monitoring and maintenance. Contingency accounts for site and design uncertainty.
10. Probable cost is a decision tool and should be considered to represent a range reflecting -30%/+50%.

Table 8-2
Alternative 2 - Asphalt Capping, Vapor Sealing, and Monitored Natural Attenuation Probable
Costs
Port of Whitman County
Pullman, Washington

Schedule 'A' - Site Preparation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
A.1	Predesign basement inspection	1	LS	\$ 1,800.00	\$ 1,800.00
A.2	Mobilization/demobilization	10%	LS	\$ -	\$ 14,300.00
A.3	Erosion and sediment control	1	LS	\$ 1,000.00	\$ 1,000.00
A.4	Preliminary site grading	1	LS	\$ 2,000.00	\$ 2,000.00
Subtotal Schedule 'A':					\$ 19,100

Schedule 'B' - Monitoring Well Installation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
B.1	Mobilization/drilling rig	1	LS	\$ 1,800.00	\$ 1,800.00
B.2	Install monitoring well	3	EA	\$ 1,500.00	\$ 4,500.00
Subtotal Schedule 'B':					\$ 6,300

Schedule 'C' - Vapor Sealing					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
C.1	Sealant product	25	EA	\$ 25.00	\$ 625.00
C.2	Application of sealant	1	LS	\$ 2,500.00	\$ 2,500.00
C.3	Install gas-tight door	1	LS	\$ 1,000.00	\$ 1,000.00
C.4	Gas-tight door to sub-basement	1	EA	\$ 5,000.00	\$ 5,000.00
C.5	Install passive vent from sub-basement	1	LS	\$ 4,500.00	\$ 4,500.00
C.6	4" PVC solid pipe (vertical)	50	LF	\$ 15.00	\$ 750.00
C.7	Pipe penetration boot	2	EA	\$ 500.00	\$ 1,000.00
Subtotal Schedule 'C':					\$ 15,375

Schedule 'D' - Asphalt Cap Installation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
D.1	Demarcation fabric and placement	4,000	SY	\$ 1.09	\$ 4,360.00
D.2	8 inch aggregate base	4,000	SY	\$ 15.10	\$ 60,400.00
D.3	4 inch asphalt cap material and labor	4,000	SY	\$ 18.76	\$ 75,040.00
Subtotal Schedule 'D':					\$ 139,800

Schedule 'E' - Permitting and Technical Services					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
E.1	Pre-design material, process, and systems confirmation	1	LS	\$ 15,000.00	\$ 15,000.00
E.2	Preparation of sampling plan	1	LS	\$ 15,000.00	\$ 15,000.00
E.3	Preparation of contaminated media management plan and environmental covenant	1	LS	\$ 20,000.00	\$ 20,000.00
E.4	Completion reporting	1	LS	\$ 5,000.00	\$ 5,000.00
E.5	Planning documents	1	LS	\$ 5,000.00	\$ 5,000.00
Subtotal Schedule 'E':					\$ 60,000

Table 8-2
Alternative 2 - Asphalt Capping, Vapor Sealing, and Monitored Natural Attenuation Probable
Costs
Port of Whitman County
Pullman, Washington

Schedule 'F' - Design and Project Management					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
F.1	Project management	8%	LS	-	\$ 19,000.00
F.2	Remedial design	15%	LS	-	\$ 34,000.00
F.3	Construction management	10%	LS	-	\$ 23,000.00
Subtotal Schedule 'F':					\$ 76,000

Schedule 'G' - Monitoring and Periodic Costs					
	10 Year Discount Rate	1.73%			
	Total Years	10			
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
G.1	Annual cap and basement slab inspection (years 1-30)	1	LS	\$ 69,800.00	\$ 69,800.00
G.2	Cap repairs (years 10, 20, and 30)	1	LS	\$ 30,100.00	\$ 30,100.00
G.3	Sealant repairs (years 10, 20 and 30)	1	LS	\$ 2,100.00	\$ 2,100.00
G.4	Semiannual groundwater monitoring (years 1-4)	1	LS	\$ 41,600.00	\$ 41,600.00
G.5	Quarterly groundwater monitoring (year 5)	1	LS	\$ 20,000.00	\$ 20,000.00
Subtotal Schedule 'G':					\$ 163,600

Schedule 'H' - Contingency					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
H.1	Contingency (30% for Schedules A-F, 10% for Schedule G)	30%	LS	-	\$ 107,000.00
Subtotal Schedule 'H':					\$ 107,000

Table 8-3
Alternative 3 - Excavation and Disposal, Vapor Sealing, and Monitored Natural Attenuation
Cost Estimate Summary
Port of Whitman County
Pullman, Washington

Project:	WSU Steam Plant Focused Site Assessment		MAUL FOSTER & ALONGI, INC. 601 East Front Ave., Suite 202 Coeur d'Alene, ID 83814 208.664.7880 (p) www.maulfoster.com
Client:	Port of Whitman County		
Project #/Task:	M0457.02.003	Initial	
Prepared By:	E. Lundeen	EL	
Checked By:	T. Wall	TW	
Date:	1/27/2022		
Revision #:	0		

Cost Estimate Summary—Feasibility Level		
Schedule A—Site Preparation	\$	45,000
Schedule B—Monitoring Well Installation	\$	6,300
Schedule C—Vapor Sealing	\$	15,375
Schedule D—Excavation and Disposal	\$	310,050
Schedule E—Permitting and Technical Services	\$	60,000
Schedule F—Design and Project Management	\$	129,500
Schedule G—Monitoring and Periodic Costs	\$	98,600
Schedule H—Contingency	\$	180,000
Total:	\$	845,000

<p>Assumptions:</p> <ol style="list-style-type: none"> 1. Three monitoring wells will be installed on the Property. 2. Groundwater will naturally attenuate to below cleanup levels after five years. Groundwater will be monitored on a quarterly basis for five years, or until groundwater meets cleanup levels. A final year of quarterly monitoring is assumed to demonstrate achievement of cleanup levels. 3. All samples used for remedy design are reconnaissance groundwater and not permanent wells. Data may not be representative of subsurface conditions. 4. Coal material will be excavated from the Property. An additional pre-design investigation is required to delineate the extents of coal impacts. 5. A contaminated media management plan and environmental covenant will be prepared for the Property. 6. Cracks in the basement will be sealed with a vapor resistant sealant and a passive vent will be installed to vent vapors from the sub-basement. 7. Net present value of monitoring and periodic costs was calculated using the ten-year nominal interest rate published by the U.S. Federal Reserve on January 6, 2022. 8. There will be 30 years of post-closure monitoring and maintenance. 9. A 30 percent contingency is included for short-term costs and a 10 percent contingency is included for long-term monitoring and maintenance. Contingency accounts for site and design uncertainty. 10. Probable cost is a decision tool and should be considered to represent a range reflecting -30%/+50%.
--

Table 8-3
Alternative 3 - Excavation and Disposal, Vapor Sealing, and Monitored Natural Attenuation
Probable Costs
Port of Whitman County
Pullman, Washington

Schedule 'A' - Site Preparation					
<i>Description</i>		<i>Whitman C</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
A.1	Predesign basement inspection	1	LS	\$ 1,800.00	\$ 1,800.00
A.2	Predesign subsurface investigation	1	LS	\$ 25,000.00	\$ 25,000.00
A.3	Mobilization/demobilization	10%	LS	\$ -	\$ 17,200.00
A.4	Erosion and sediment control	1	LS	\$ 1,000.00	\$ 1,000.00
Subtotal Schedule 'A':					\$ 45,000

Schedule 'B' - Monitoring Well Installation					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
B.1	Mobilization/drilling rig	1	LS	\$ 1,800.00	\$ 1,800.00
B.2	Install monitoring well	3	LS	\$ 1,500.00	\$ 4,500.00
Subtotal Schedule 'B':					\$ 6,300

Schedule 'C' - Vapor Sealing					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
C.1	Sealant product	25	EA	\$ 25.00	\$ 625.00
C.2	Application of sealant	1	LS	\$ 2,500.00	\$ 2,500.00
C.3	Install gas-tight door	1	LS	\$ 1,000.00	\$ 1,000.00
C.4	Gas-tight door to sub-basement	1	EA	\$ 5,000.00	\$ 5,000.00
C.5	Install passive vent from sub-basement	1	LS	\$ 4,500.00	\$ 4,500.00
C.6	4" PVC solid pipe (vertical)	50	LF	\$ 15.00	\$ 750.00
C.7	Pipe penetration boot	2	EA	\$ 500.00	\$ 1,000.00
Subtotal Schedule 'C':					\$ 15,375

Schedule 'D' - Excavation and Disposal					
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>	<i>Total Cost</i>
D.1	Excavation and contaminated material management	1,500	BCY	\$ 30.00	\$ 45,000.00
D.2	Waste characterization	1	LS	\$ 1,250.00	\$ 1,250.00
D.3	Offsite waste transportation and disposal	2,250	TON	\$ 75.00	\$ 168,800.00
D.4	Backfill material	1,725	LCY	\$ 25.00	\$ 43,200.00
D.5	Backfill and compaction labor	1,725	LCY	\$ 30.00	\$ 51,800.00
Subtotal Schedule 'D':					\$ 310,050

Table 8-3
Alternative 3 - Excavation and Disposal, Vapor Sealing, and Monitored Natural Attenuation
Probable Costs
Port of Whitman County
Pullman, Washington

Schedule 'E' - Permitting and Technical Services						
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>		<i>Total Cost</i>
E.1	Pre-design material, process, and systems confirmation	1	LS	\$	15,000.00	\$ 15,000.00
E.2	Preparation of sampling plan	1	LS	\$	15,000.00	\$ 15,000.00
E.3	Preparation of contaminated media management plan and environmental covenant	1	LS	\$	20,000.00	\$ 20,000.00
E.4	Completion reporting	1	LS	\$	5,000.00	\$ 5,000.00
E.5	Planning documents	1	LS	\$	5,000.00	\$ 5,000.00
Subtotal Schedule 'E':						\$ 60,000


Schedule 'F' - Design and Project Management						
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>		<i>Total Cost</i>
F.1	Project management	10%	LS	-		\$ 37,000.00
F.2	Remedial design	15%	LS	-		\$ 55,500.00
F.3	Construction management	10%	LS	-		\$ 37,000.00
Subtotal Schedule 'F':						\$ 129,500

Schedule 'G' - Monitoring and Periodic Costs						
	10 Year Discount Rate	1.73%				
	Total Years	10				
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>		<i>Total Cost</i>
G.1	Annual basement slab inspection (years 1-30)	1	LS	\$	34,900.00	\$ 34,900.00
G.2	Sealant repairs (years 10, 20 and 30)	1	LS	\$	2,100.00	\$ 2,100.00
G.3	Semiannual groundwater monitoring (years 1-4)	1	LS	\$	41,600.00	\$ 41,600.00
G.4	Quarterly groundwater monitoring (year 5)	1	LS	\$	20,000.00	\$ 20,000.00
Subtotal Schedule 'G':						\$ 98,600


Schedule 'H' - Contingency						
<i>Description</i>		<i>Quantity</i>	<i>Unit</i>	<i>Unit Cost</i>		<i>Total Cost</i>
H.1	Contingency (30% for Schedules A-F, 10% for Schedule G)	30%	LS	-		\$ 180,000.00
Subtotal Schedule 'H':						\$ 180,000

FIGURES



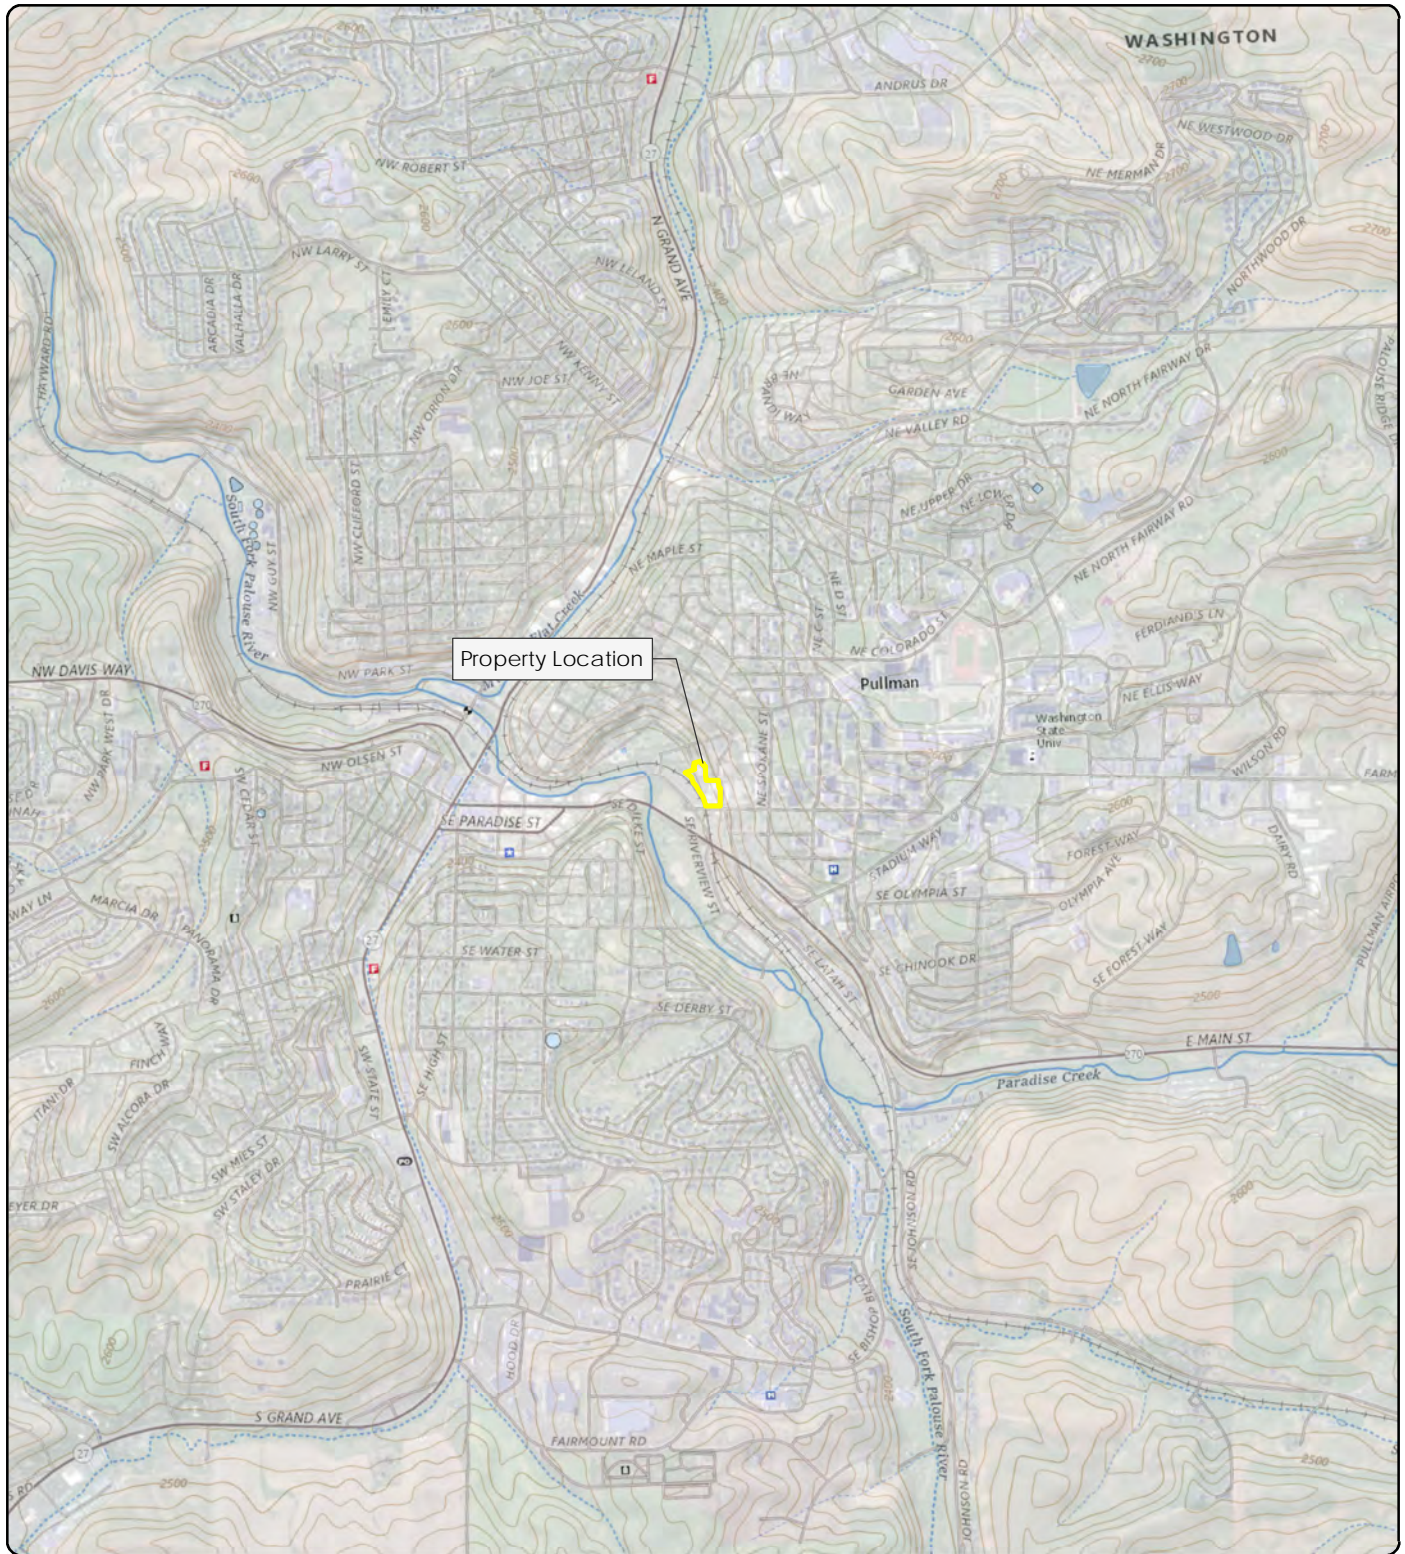


Source:
 U.S. Geological Survey (2021) 7.5-minute
 topographic quadrangle: Pullman.
 Township 14 North, Range 45 East, Section 5.

Legend
 Property Boundary


 MAUL FOSTER ALONGI
 p. 971 544 2139 | www.maulfooster.com

This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.







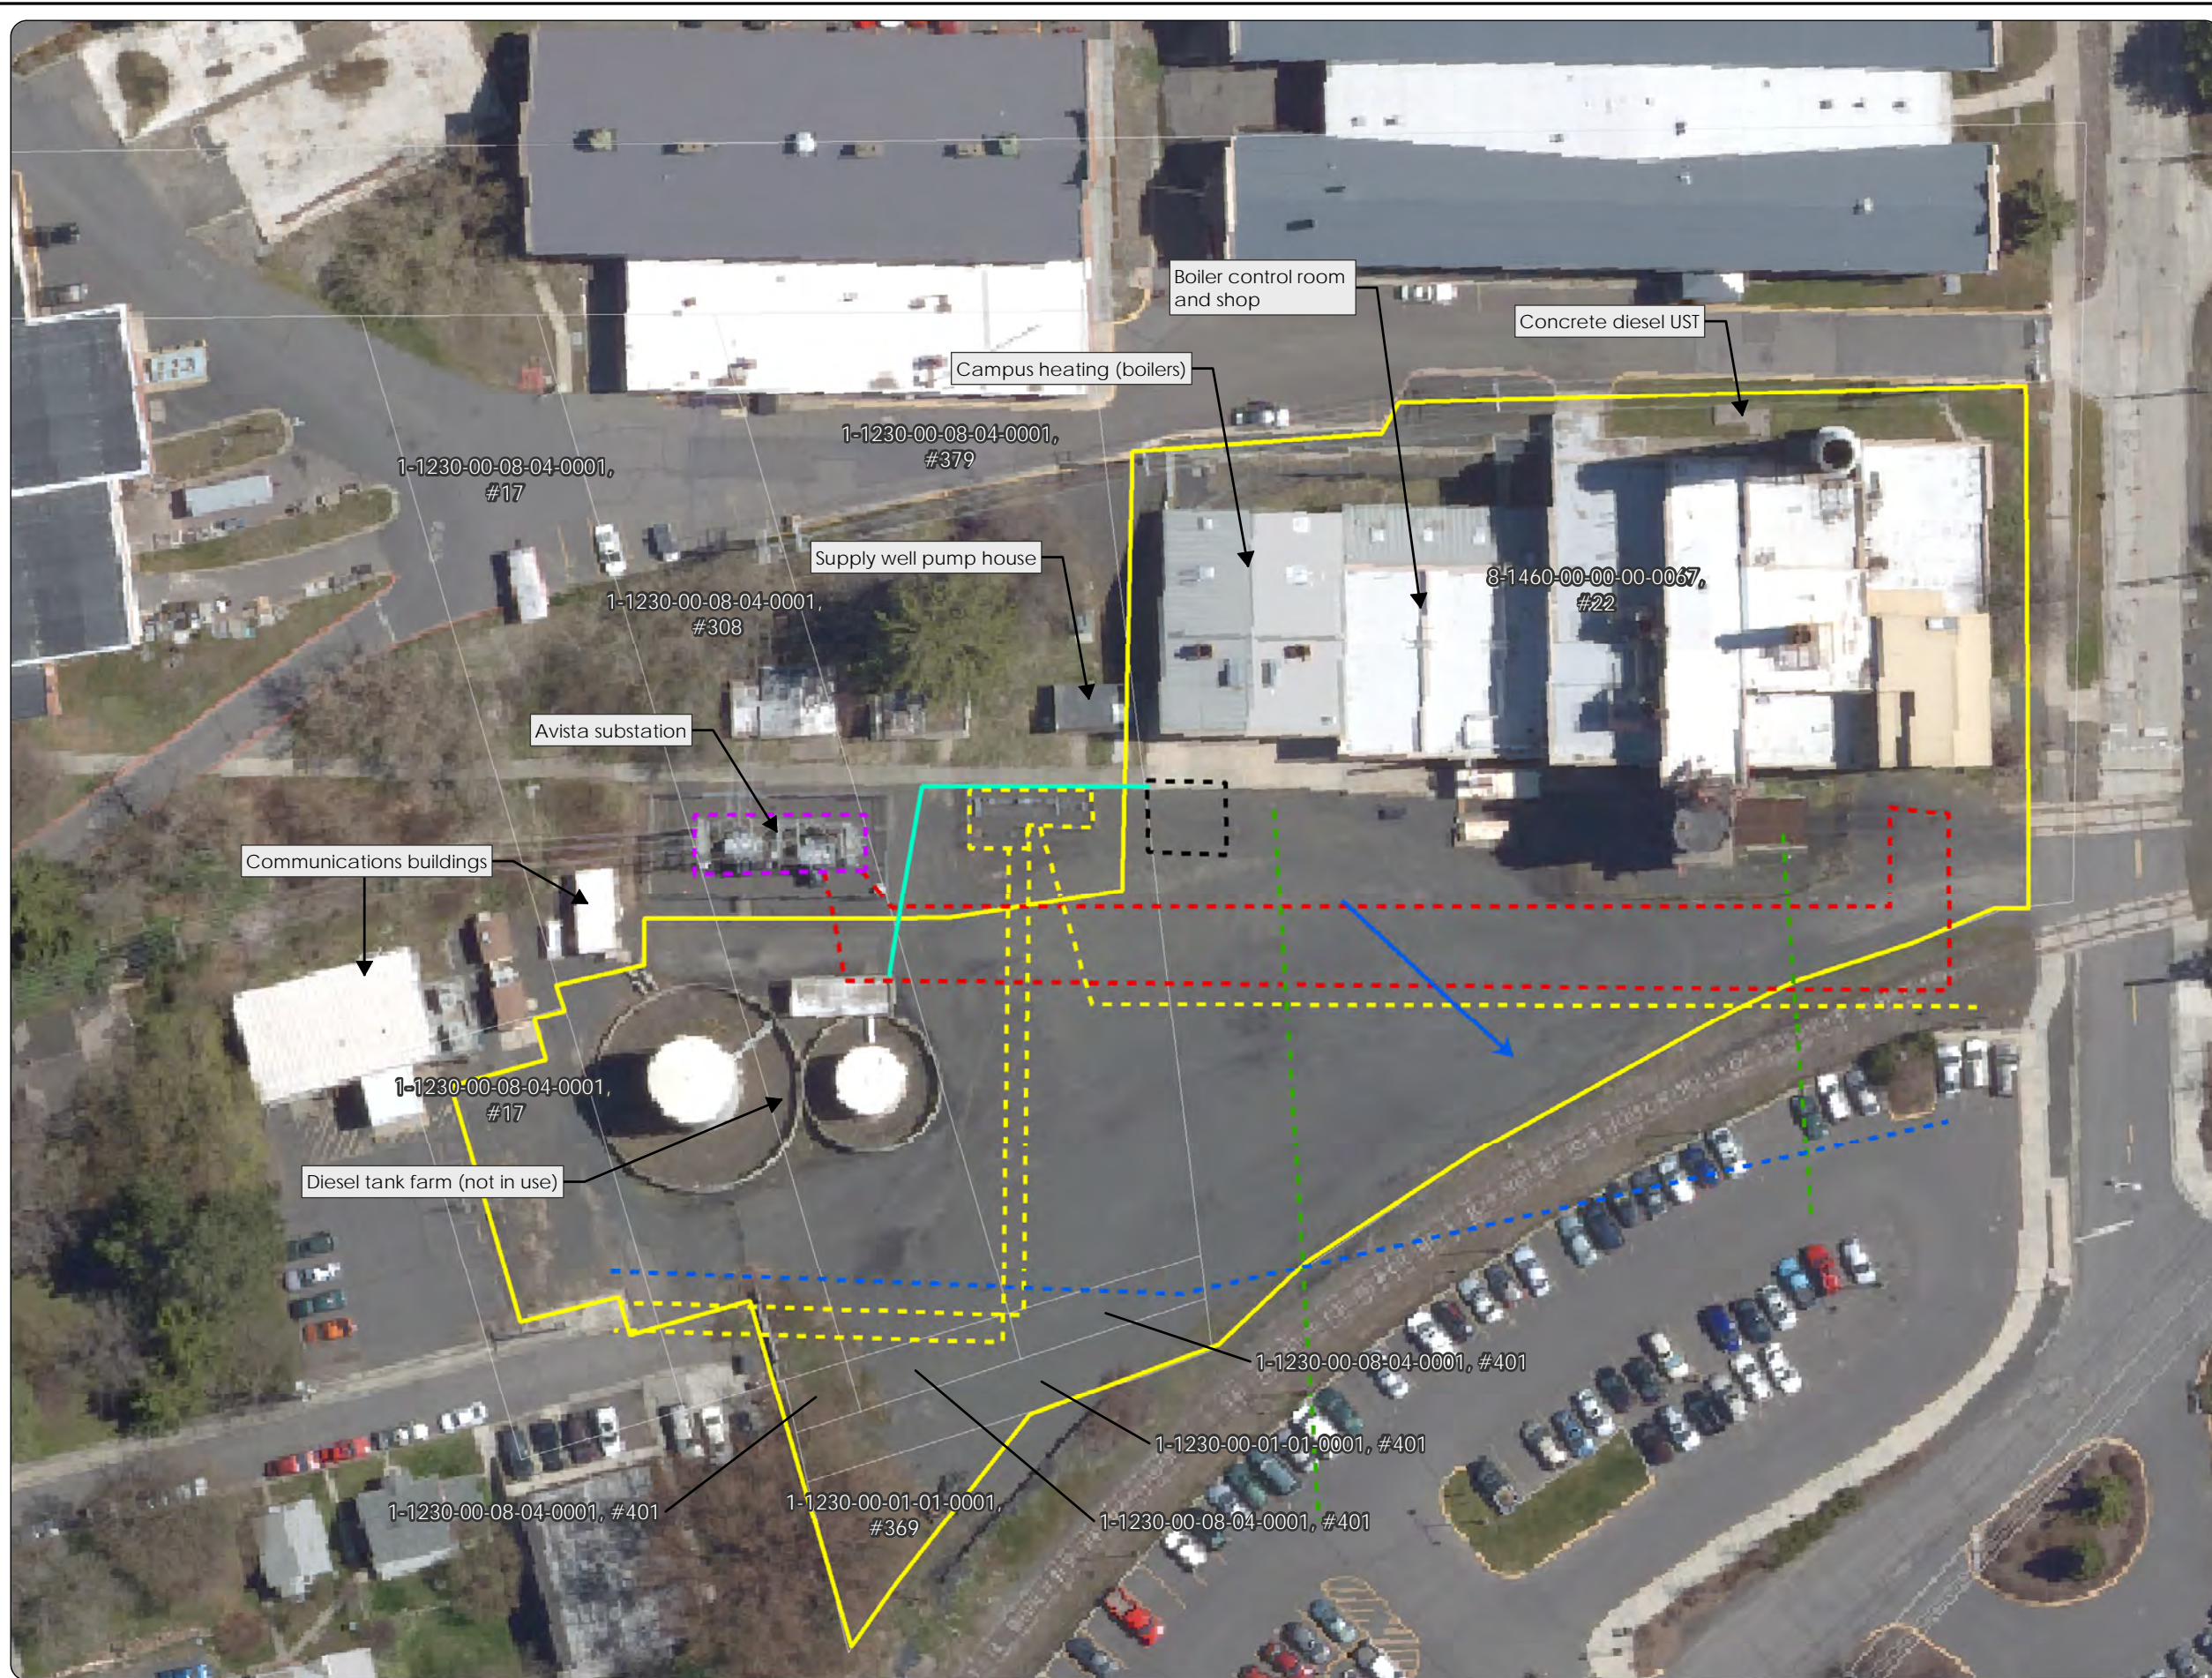



Figure 1-1
 Property Location
 College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington



**Figure 1-2
Property Features**
College Avenue Steam Plant
Port of Whitman County
Pullman, Washington



Legend

-  Inferred Grounwater Flow Direction
- Utility lines (approximate)
 -  Diesel tank
 -  Electrical duct
 -  Gas line
 -  Sewer line
 -  Transformer
 -  Water line
 -  Subsurface diesel piping (approximate)
 -  Property boundary
 -  Parcels

NOTES:
UST = Underground storage tank.



Source:
Aerial photograph obtained from City of Pullman.

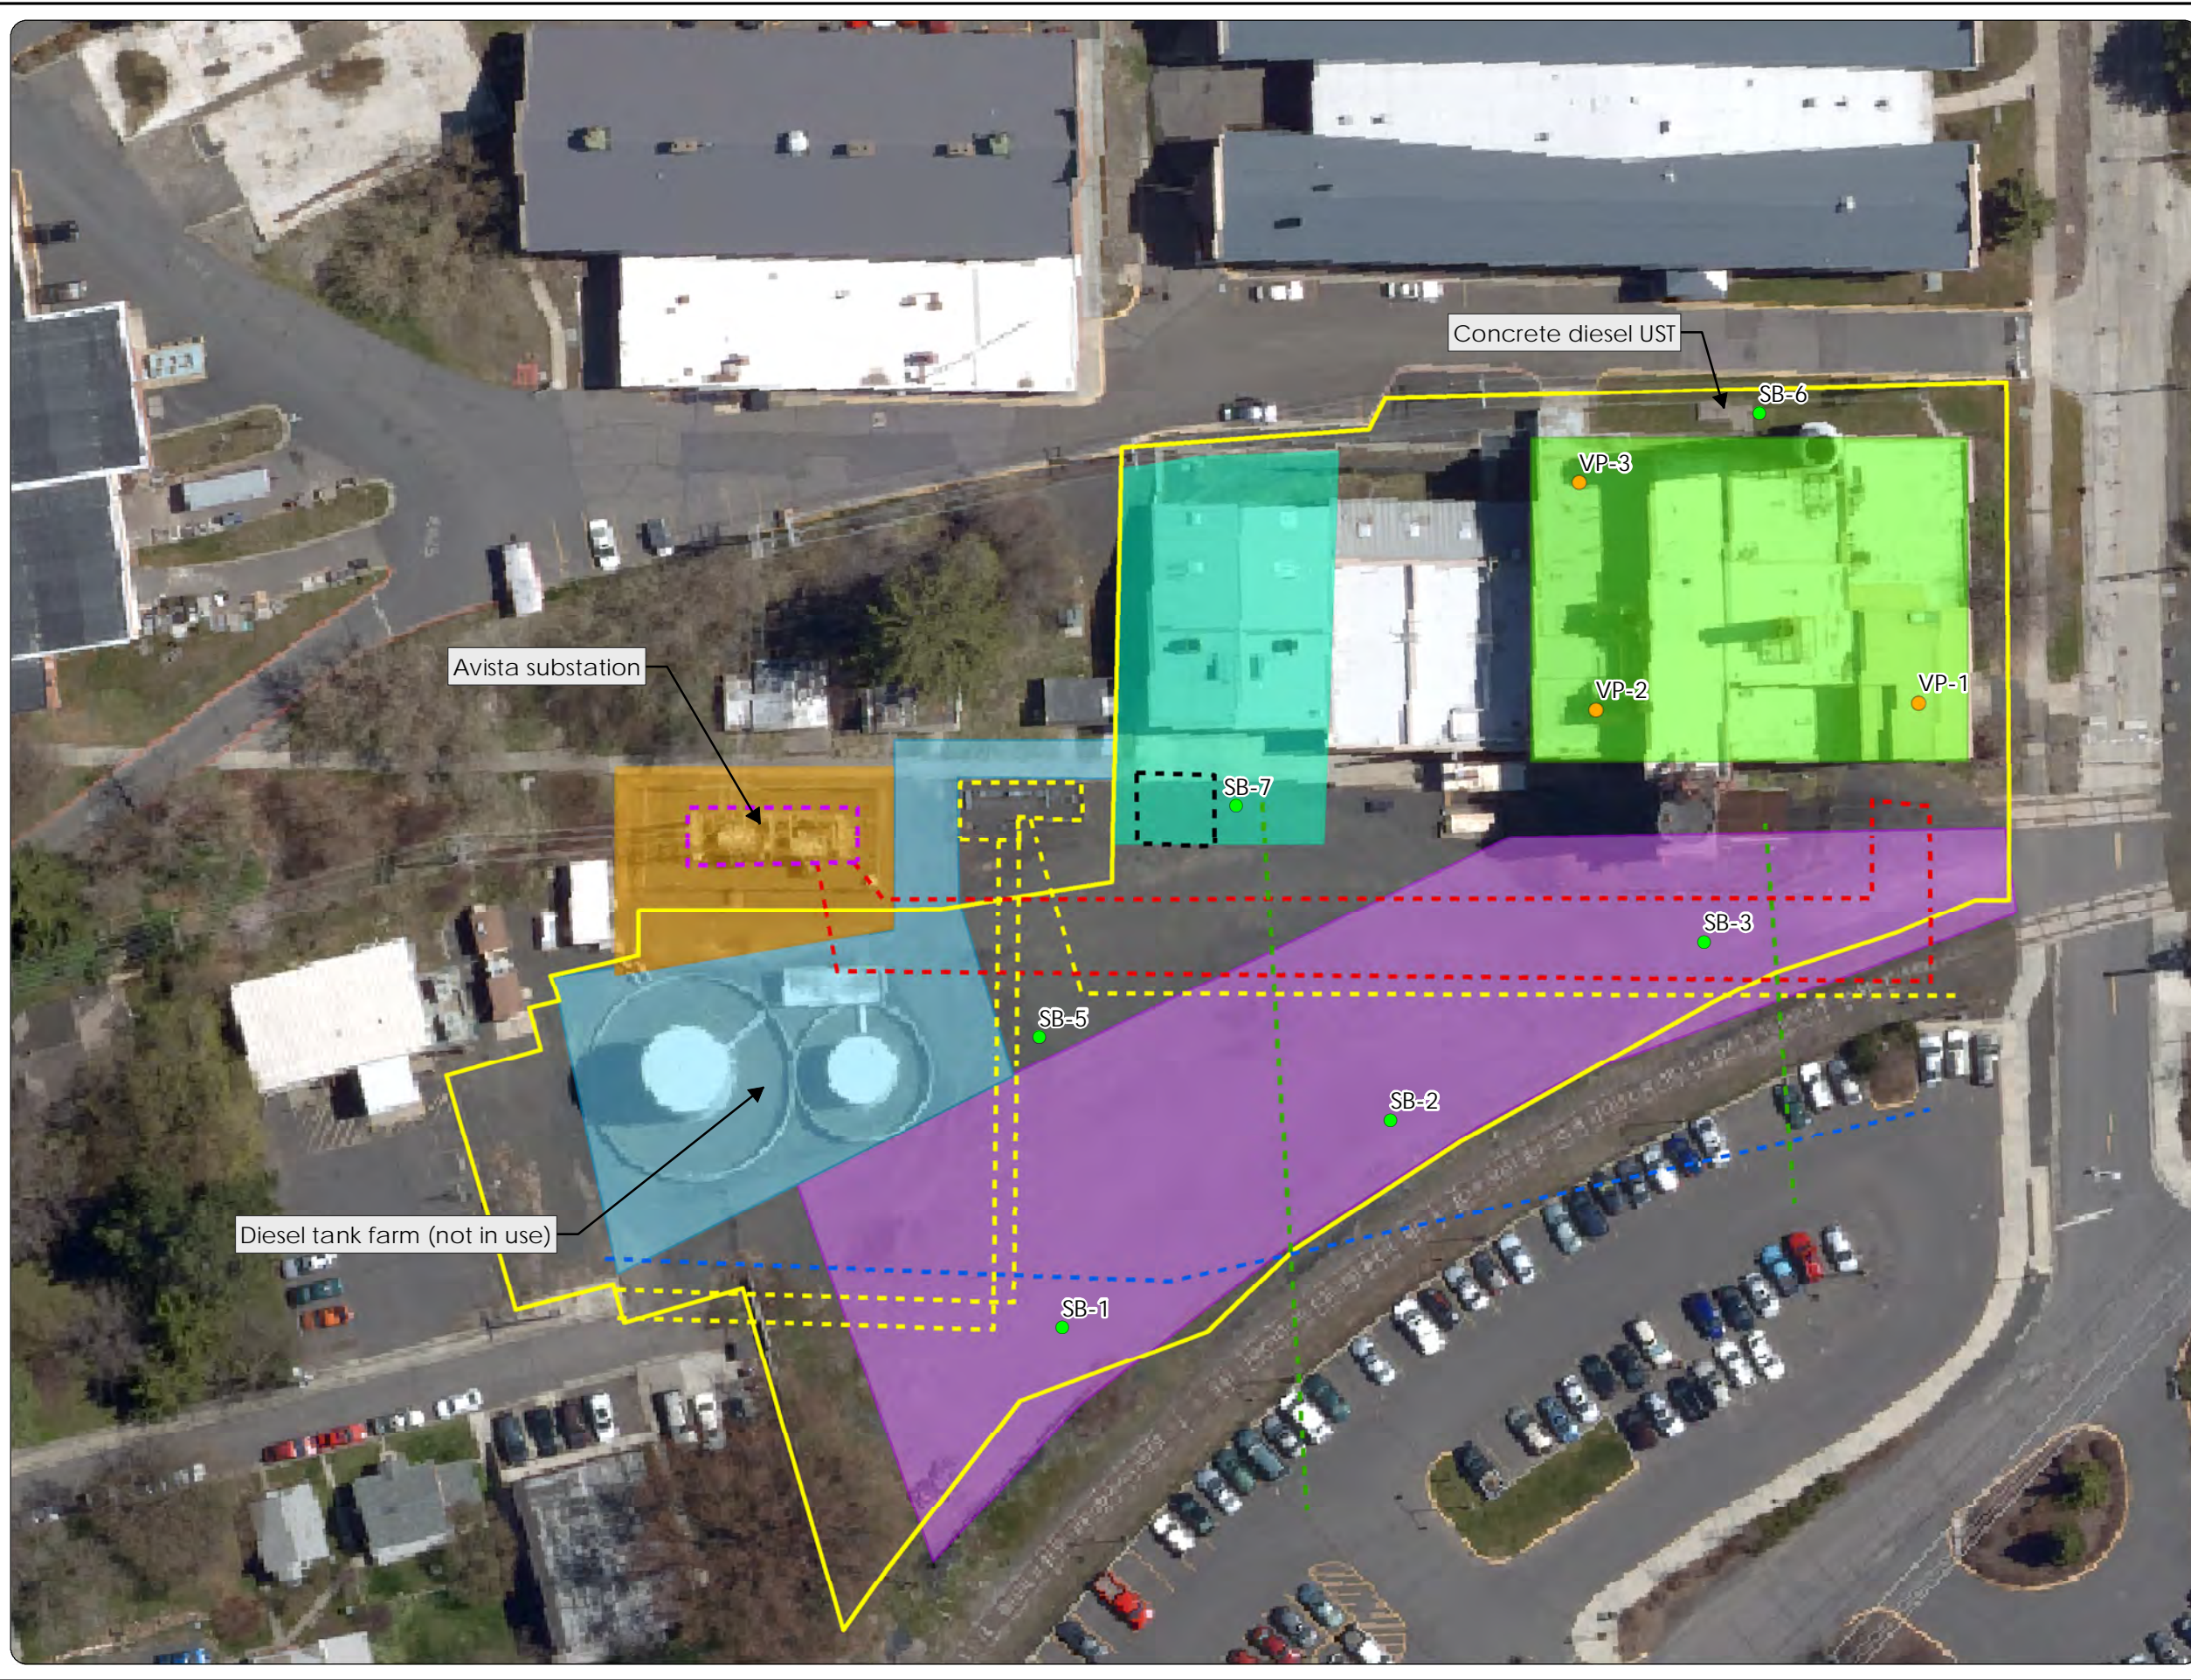


Figure 1-3
Sample Locations
 College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington

Legend

- Boring locations
- Sub-slab soil vapor sample locations

Utility Lines (Approximate)

- Diesel tank
- Electrical duct
- Gas line
- Sewer line
- Transformer
- Water line

AOC 1: Steam plant operations area/area proposed for reuse

AOC 2: Coal storage and transport area


AOC 3: Former diesel tank farm and associated piping

AOC 4: Avista substation

AOC 5: Historical oil storage area

Property boundary

NOTES:
 Boring location SB-4 was not completed due to the presence of subsurface utilities.
 AOC = Area of concern.
 UST = Underground storage tank.



Source:
 Aerial photograph obtained from City of Pullman.

Table 5-1
Conceptual Site Model of Potential Exposure Pathways
College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Primary Sources	Primary Release Mechanism	Secondary Sources	Secondary Release Mechanism	Tertiary Source	Point of Potential Contact	Exposure Route	Current and Potential Future Receptors				
							Construction Workers	Occupational Workers/Residents	Ecological Receptors	Recreational Fishers	
<div style="display: flex; flex-direction: column; align-items: center;"> <div style="border: 1px solid black; padding: 5px; margin-bottom: 10px;">Historical Releases to On-Site Shallow Soil</div> <div style="display: flex; justify-content: space-around; width: 100%;"> <div style="border: 1px solid black; padding: 5px;">Overland Flow</div> <div style="border: 1px solid black; padding: 5px;">Leaching</div> </div> <div style="display: flex; justify-content: space-around; width: 100%; margin-top: 10px;"> <div style="border: 1px solid black; padding: 5px;">Groundwater</div> <div style="border: 1px solid black; padding: 5px;">Volatilization</div> </div> <div style="display: flex; justify-content: space-around; width: 100%; margin-top: 10px;"> <div style="border: 1px solid black; padding: 5px;">South Fork of the Palouse River</div> </div> </div>					Soil	Ingestion Dermal Contact Inhalation	I	I	I	I	
						Indoor air	Inhalation	✓	✓	∅	∅
						Outdoor air	Inhalation	I	I	I	I
						Groundwater	Ingestion Dermal Contact Inhalation	✓ ✓ ✓	I	∅ ∅ ∅	∅ ∅ ∅
					South Fork of the Palouse River	Surface Water and Sediment	Ingestion Dermal Contact	I	I	I	I
						Fish Tissue (via Bioaccumulation)	Ingestion	∅	∅	∅	∅

Notes:

- Primary pathway
- - - Potential pathway
- ✓ Potentially complete exposure route
- ∅ Incomplete exposure route
- I Insignificant exposure route

APPENDIX A

BORING LOGS





MAUL FOSTER ALONG

Geologic Borehole Log

Project Number
0457.02.03

Boring Number
SB-1

Sheet
1 of 1

Project Name **College Avenue Steam Plant**
 Project Location **Pullman, Washington**
 Start/End Date **10/19/2021 to 10/19/2021**
 Driller/Equipment **Northern Lights Drilling/Truck-mounted Geoprobe 5410**
 Geologist/Engineer **C. Busch**
 Sample Method **Direct Push**

Surface Elevation (feet)
 Northing
 Easting
 Total Depth of Borehole **16.0-feet**
 Outer Hole Diam **2.25-inch**

Depth (feet, BGS)	Water Levels	Percent Recovery	Screen Int.	Sample Data		Lithologic Column	Soil Description
				Sample ID	PID (ppm)		
1							0.0 to 1.0 feet: COAL; black; 95% coal fragments; 5% gravel, fine to medium; angular; medium dense; dry to moist.
2		100		SB-1-2.5			1.0 to 9.9 feet: SILT (ML); olive gray; 90% fines, low plasticity; 10% sand, fine; trace coal fragments to a depth of 2.2 feet bgs; stiff; moist.
3							@ 3.0 feet: Becomes mottled brown.
4							
5							
6		100					
7							
8							
9							
10		100					9.9 to 14.1 feet: SILT (ML); dark gray; 100% fines; medium plasticity; trace fine sand; stiff; moist.
11							@ 10.3 feet: 0.5-foot-thick layer of black organic soil with abundant woody debris and moderate organic odor.
12							
13	▼						
14	▽	100					
15				SB-1-15.0			14.1 to 16.0 feet: SAND (SP); brown; 5% fines; 95% sand, fine to medium, angular to subangular; medium dense; wet.
16							

Total Depth = 16.0 feet bgs

NOTES:

1) bgs = below ground surface. 2) PID = photoionization detector. 3) ppm = parts per million. 4) PID meter malfunctioned during drilling.

Borehole Completion Details

0 to 16.0 feet: 2.25-inch borehole.

Reconnaissance Well Completion Details

Temporary polyvinyl chloride screen set from 11.0 to 16.0 feet bgs.

Borehole Abandonment Details

0.0 to 16.0 feet bgs: Bentonite chips hydrated with potable water.

▽ Soil becomes wet at 14.1 feet bgs as observed in the core sample. ▼ Water level measurement is 12.95 feet bgs, observed after temporary well installation.

MFA BOREHOLE WIRECON SCREEN WA\GINT\GINT\PROJECTS\0457.02\WSU STEAM PLANT LOGS.GPJ 12/23/21



MAUL FOSTER ALONG

Geologic Borehole Log

Project Number
M0457.02.003

Boring Number
SB-2

Sheet
1 of 1

Project Name **College Avenue Steam Plant**
 Project Location **Pullman, Washington**
 Start/End Date **10/19/2021 to 10/19/2021**
 Driller/Equipment **Northern Lights Drilling/Truck-mounted Geoprobe 5410**
 Geologist/Engineer **C. Busch**
 Sample Method **Direct Push**

Surface Elevation (feet)
 Northing
 Easting
 Total Depth of Borehole **17.0 feet**
 Outer Hole Diam **2.25 inches**

Depth (feet, bgs)	Water Levels	Percent Recovery	Screen Int.	Sample Data		Lithologic Column	Soil Description
				Sample ID	PID (ppm)		
1							0.0 to 1.4 feet: COAL; black; 100% coal fragments; medium dense; dry.
2		100		SB-2-2.0			1.4 to 3.6 feet: SILTY SAND (SM); grayish brown; 40% fines, nonplastic; 40% sand, fine; 20% gravel, fine, angular; trace coal fragments; trace brown mottling; medium dense; moist.
3							
4							3.6 to 8.3 feet: SILT WITH SAND (ML); brown; 85% fines, low plasticity; 15% sand, fine; stiff; moist.
5		100					
6							
7							
8							
9							8.3 to 11.6 feet: SILT (ML); very dark brown to dark grayish brown; 95% fines, medium plasticity; 5% sand, fine; trace organics; slight organic odor; soft to stiff; moist.
10		90					@ 9.5 to 10.3 feet: Natural woody debris present.
11							
12	▼						11.6 to 12.0 feet: No recovery. 12.0 to 13.7: Same as above.
13							
14		95					13.7 to 15.3 feet: SANDY SILT (ML); brown; 55% fines, nonplastic; 45% sand, fine; mottled with reddish orange; stiff; moist to wet.
15	▽			SB-2-15.0			@ 15.1 feet: Becomes wet.
16							15.3 to 15.8 feet: SAND (SP); brown; 5% fines; 95% sand, fine to medium, angular to subangular; medium dense; wet.
17		100					15.8 to 16.0 feet: No recovery. 16.0 to 17.0 feet: BEDROCK; black; basalt; fractured; very weathered to gravel size particles; becomes harder and less weathered with depth. Push probe met refusal at 17.0 feet bgs.

Total Depth = 17.0 feet bgs

NOTES:

1) bgs = below ground surface. 2) PID = photoionization detector. 3) ppm = parts per million. 4) PID meter malfunctioned during drilling.

Borehole Completion Details

0 to 17.0 feet: 2.25-inch borehole.

Reconnaissance Well Completion Details

Temporary polyvinyl chloride screen set from 12.0 to 17.0 feet bgs.

Borehole Abandonment Details

0.0 to 17.0 feet bgs: Bentonite chips hydrated with potable water.

▽ Soil becomes wet at 15.1 feet bgs as observed in the core sample. ▼ Water level measurement is 12.95 feet bgs, observed after temporary well installation.

MFA BOREHOLE WIRECON SCREEN W:\GINT\GINTWP\PROJECTS\0457.02\WSU STEAM PLANT LOGS.GPJ 12/23/21



MAUL FOSTER ALONG

Geologic Borehole Log

Project Number
M0457.02.003

Boring Number
SB-3

Sheet
1 of 1

Project Name	College Avenue Steam Plant	Surface Elevation (feet)	
Project Location	Pullman, Washington	Northing	
Start/End Date	10/19/2021 to 10/19/2021	Easting	
Driller/Equipment	Northern Lights Drilling/Truck-mounted Geoprobe 5410	Total Depth of Borehole	16.0 feet
Geologist/Engineer	C. Busch	Outer Hole Diam	2.25 Inches
Sample Method	Direct Push		

Depth (feet, bgs)	Water Levels	Percent Recovery	Screen Int.	Sample Data		Lithologic Column	Soil Description
				Sample ID	PID (ppm)		
1							0.0 to 0.5 feet: GRAVELLY SAND (SW); 5% fines; 75% sand, fine to coarse, angular; 20% gravel, fine to medium, angular; medium dense; dry.
2		88					0.5 to 0.9 feet: COAL; black; 100% coal fragments; medium dense; moist.
3							0.9 to 3.5 feet: SILT (ML); brown; 90% fines, low plasticity; 10% sand, fine; trace coal and brick fragments; stiff; moist.
4							3.5 to 4.0 feet: No recovery.
5							4.0 to 7.3 feet: Same as above. Trace coal and brick fragments 4.0 to 5.0 feet bgs.
6		83		SB-3-5.0			
7							
8							7.3 to 8.0 feet: No recovery.
9							8.0 to 13.3 feet: Same as above.
10		100					
11							
12	▼						
13	▽			SB-3-13.0			
14		83					13.3 to 15.3 feet: GRAVELLY SAND WITH SILT (SW-SM); brown; 10% fines; 60% sand, fine to coarse, angular to subangular; 30% gravel, fine to medium, angular; medium dense; wet.
15							
16							15.3 to 16.0 feet: No recovery.

Total Depth = 16.0 feet bgs

NOTES:

1) bgs = below ground surface. 2) PID = photoionization detector. 3) ppm = parts per million. 4) PID meter malfunctioned during drilling.

Borehole Completion Details

0 to 16.0 feet: 2.25-inch borehole.

Reconnaissance Well Completion Details

Temporary polyvinyl chloride screen set from 11.0 to 16.0 feet bgs.

Borehole Abandonment Details

0.0 to 16.0 feet bgs: Bentonite chips hydrated with potable water.

▽ Soil becomes wet at 13.3 feet bgs as observed in the core sample. ▼ Water level measurement is 12.42 feet bgs, observed after temporary well installation.

MFA BOREHOLE WIRECON SCREEN WA\GINTGINTWPROJECTS\0457.02\WSU STEAM PLANT LOGS.GPJ 12/23/21



MAUL FOSTER ALONG

Geologic Borehole Log

Project Number
M0457.02.003

Boring Number
SB-5

Sheet
1 of 1

Project Name **College Avenue Steam Plant**
 Project Location **Pullman, Washington**
 Start/End Date **10/19/2021 to 10/19/2021**
 Driller/Equipment **Northern Lights Drilling/Truck-mounted Geoprobe 5410**
 Geologist/Engineer **C. Busch**
 Sample Method **Direct Push**

Surface Elevation (feet)
 Northing
 Easting
 Total Depth of Borehole **20.0 Feet**
 Outer Hole Diam **2.25 Inches**

Depth (feet, bgs)	Water Levels	Percent Recovery	Screen Int.	Sample Data		Lithologic Column	Soil Description
				Sample ID	PID (ppm)		
1							0.0 to 3.0 feet: SILTY SAND (SM); dark gray and olive brown; 30% fines, nonplastic; 50% sand, fine to coarse, angular; 20% gravel, fine to coarse, angular; trace coal fragments; medium dense; moist. Coal fragments increase with depth.
2		100					
3							
4							3.0 to 3.8 feet: COAL; black; 100% coal fragments; medium dense; moist.
5							3.8 to 7.0 feet: SILT (ML); dark gray; 90% fines, nonplastic; 10% sand, fine, trace wood fragments at 3.9 feet bgs; stiff; moist.
6		75		SB-5-5.0	0.0		
7							7.0 to 8.0 feet: No recovery.
8							8.0 to 11.1 Same as above.
9							
10		100			0.0		
11							
12							11.1 to 15.3 feet: SILT (ML); brown; 90% fines, low plasticity; 10% sand, fine; mottled to 11.7 feet bgs; stiff; moist. Sand content increases with depth.
13							
14		90					
15				SB-5-15.0	0.0		
16	▼						15.3 to 15.6 feet: SILTY SAND (SM); light brown; 50% fines; low plasticity; 50% sand, fine; medium dense; moist.
17							15.6 to 16.0 feet: No recovery.
18							16.0 to 17.0 feet: Same as above, becomes wet.
19		100					17.0 to 20.0 feet: SAND (SP); light brown; 10% fines; 90% sand, fine to medium, angular to subangular; medium dense; wet.
20							

Total Depth = 20.0 feet bgs

NOTES:

1) bgs = below ground surface. 2) PID = photoionization detector. 3) ppm = parts per million.

Borehole Completion Details

0 to 20.0 feet: 2.25-inch borehole.

Reconnaissance Well Completion Details

Temporary polyvinyl chloride screen set from 15.0 to 20.0 feet bgs.

Borehole Abandonment Details

0.0 to 20.0 feet bgs: Bentonite chips hydrated with potable water.

▼ Soil becomes wet at 16.0 feet bgs as observed in the core sample. ▼ Water level measurement is 15.5 feet bgs, observed after temporary well installation.

MFA BOREHOLE WIRECON SCREEN WA\GINT\GINTW\PROJECTS\0457.02\WSU STEAM PLANT LOGS.GPJ 12/23/21



Geologic Borehole Log

Project Number
M0457.02.003

Boring Number
SB-6

Sheet
1 of 1

Project Name	College Avenue Steam Plant	Surface Elevation (feet)	
Project Location	Pullman, Washington	Northing	
Start/End Date	10/19/2021 to 10/19/2021	Easting	
Driller/Equipment	Northern Lights Drilling/Truck-mounted Geoprobe 5410	Total Depth of Borehole	3.0 feet
Geologist/Engineer	C. Busch	Outer Hole Diam	2.25 inches
Sample Method	Direct Push		

Depth (feet, bgs)	Water Levels	Percent Recovery	Screen Int.	Sample Data		Lithologic Column	Soil Description
				Sample ID	PID (ppm)		
1							0.0 to 1.0 feet: SILT WITH SAND (ML); brown; 80% fines, nonplastic; 20% sand, fine; trace rootlets to 0.4 feet bgs; medium dense; dry.
2		67					1.0 to 2.0 feet: SANDY GRAVEL (GP); gray to dark gray; 20% sand, fine to coarse, angular; 80% gravel, fine to coarse, angular (comprised of basalt); very dense; dry.
3							2.0 to 3.0 feet: No recovery. Push probe refusal at 3.0 feet bgs (likely basalt bedrock).

Total Depth = 3.0 feet bgs

NOTES:

- 1) bgs = below ground surface. 2) PID = photoionization detector. 3) ppm = parts per million. 4) PID meter malfunctioned during drilling.
- 5) Two attempts were made at this drilling location. A temporary screen was not installed at this location due to the shallow depth of bedrock.

Borehole Completion Details
 0 to 3.0 feet: 2.25-inch borehole.

Borehole Abandonment Details
 0.0 to 3.0 feet bgs: Bentonite chips hydrated with potable water.



Geologic Borehole Log

Project Number
M0457.02.003

Boring Number
SB-7

Sheet
1 of 1

Project Name **College Avenue Steam Plant**
 Project Location **Pullman, Washington**
 Start/End Date **10/19/2021 to 10/19/2021**
 Driller/Equipment **Northern Lights Drilling/Truck-mounted Geoprobe 5410**
 Geologist/Engineer **C. Busch**
 Sample Method **Direct Push**

Surface Elevation (feet)
 Northing
 Easting
 Total Depth of Borehole **21.0 feet**
 Outer Hole Diam **2.25 inches**

Depth (feet, bgs)	Water Levels	Percent Recovery	Screen Int.	Sample Data		Lithologic Column	Soil Description
				Sample ID	PID (ppm)		
1					0.0		0.0 to 2.4 feet: GRAVELLY SAND WITH SILT (SP-SM); dark brown; 10% fines; 40% sand, fine to coarse, angular; 50% gravel, fine to medium, angular; medium dense; moist.
2		60					1.4 to 2.4 feet: Black trace coal fragments; appear burnt.
3					0.0		2.4 to 4.0 feet: No recovery.
4							4.0 to 5.4 feet: Same as above; trace coal fragments from 5.0 to 5.4 feet bgs.
5					0.0		5.4 to 7.2 feet: SILT (ML); brown; 100% fines; low plasticity; firm to stiff; moist.
6		80					7.2 to 8.0 feet: No recovery.
7							8.0 to 12.5 feet: Same as above.
8				SB-7-7.5			
9							
10		100			0.0		
11							
12							
13		100			0.0		12.5 to 20.0 feet: SANDY SILT (ML); light brown; 60% fines, low plasticity; 40% sand, fine; slight mottling; stiff; moist to wet. Increase in sand content with depth.
14							
15							
16	▼						
17		100					
18							
19	▽			SB-7-18.5	0.0		@ 18.7 feet: Becomes wet.
20							
21		100					20.0 to 21.0 feet: SILTY GRAVEL (GM); olive gray; 30% fines, medium plasticity; 20% sand, fine to coarse, angular; 50% gravel, fine to coarse, angular (comprised of basalt); dense; wet. Push probe refusal at 21.0 feet bgs (likely basalt bedrock).

Total Depth = 21.0 feet bgs

NOTES:

1) bgs = below ground surface. 2) PID = photoionization detector. 3) ppm = parts per million.

Borehole Completion Details

0 to 20.0 feet: 2.25-inch borehole.

Reconnaissance Well Completion Details

Temporary polyvinyl chloride screen set from 16.0 to 21.0 feet bgs.

Borehole Abandonment Details

0.0 to 21.0 feet bgs: Bentonite chips hydrated with potable water.

▽ Soil becomes wet at 18.7 feet bgs as observed in the core sample. ▼ Water level measurement is 16.57 feet bgs, observed after temporary well installation.

MFA BOREHOLE WIRECON SCREEN W:\GINT\GINTWP\PROJECTS\0457.02\WSU STEAM PLANT LOGS.GPJ 12/23/21

APPENDIX B

FIELD SAMPLING DATA SHEETS



Maul Foster & Alongi, Inc.

601 East Front Avenue, Suite 202, Coeur d'Alene, Idaho (208) 664-7880

Water Field Sampling Data Sheet

Client Name	Port of Whitman County	Sample Location	SB-1		
Project #	M0457.02.003	Sampler	L. Pritzl		
Project Name	College Avenue Steam Plant	Sampling Date	10/19/2021		
Sampling Event		Sample Name	SB-1-GW		
Sub Area		Sample Depth	15		
FSDS QA:	CWB 1/11/2021	Easting		Northing	
		TOC			

Hydrology/Level Measurements

Date	Time	DT-Bottom	DT-Product	DT-Water	(Product Thickness)	(Water Column)	(Gallons/ft x Water Column)
					DTP-DTW	DTB-DTW	Pore Volume
10/19/2021	14:45	15.85		12.95			

(0.75" = 0.023 gal/ft) (1" = 0.041 gal/ft) (1.5" = 0.092 gal/ft) (2" = 0.163 gal/ft) (3" = 0.367 gal/ft) (4" = 0.653 gal/ft) (6" = 1.469 gal/ft) (8" = 2.611 gal/ft)

Water Quality Data

Purge Method	Time	Purge Vol (gal)	Flowrate l/min	pH	Temp (C)	E Cond (uS/cm)	DO (mg/L)	ORP	Turbidity
(2) Peristaltic Pump	2:50:00 PM		0.15						1000
	2:59:00 PM	1	0.15						897
	3:20:00 PM	1.25	0.15	6.96	17.6	690.1			48
	3:25:00 PM		0.15	6.98	17.6	690.9			50.3
	3:30:00 PM		0.15	6.97	17.6	690.8			46.6
Final Field Parameters	3:35:00 PM		0.15	6.98	17.6	690.8			43.9

Methods: (1) Submersible Pump (2) Peristaltic Pump (3) Disposable Bailer (4) Vacuum Pump (5) Dedicated Bailer (6) Inertia Pump (7) Other (specify)

Water Quality Observations:

Sample Information

Sampling Method	Sample Type	Sampling Time	Container Code/Preservative	#	Filtered
(2) Peristaltic Pump	Groundwater	3:35:00 PM	VOA-Glass	7	No
			Amber Glass	2	
			White Poly	1	
			Yellow Poly		
			Green Poly		
			Red Total Poly		
			Red Dissolved Poly		
			Total Bottles	10	

General Sampling Comments

Began purge at 14:50.

Signature _____

Maul Foster & Alongi, Inc.

601 East Front Avenue, Suite 202, Coeur d'Alene, Idaho (208) 664-7880

Water Field Sampling Data Sheet

Client Name	Port of Whitman County	Sample Location	SB-2		
Project #	M0457.02.003	Sampler	L. Pritzl		
Project Name	College Avenue Steam Plant	Sampling Date	10/19/2021		
Sampling Event		Sample Name	SB-2-GW		
Sub Area		Sample Depth	16		
FSDS QA:	CWB 1/11/2021	Easting		Northing	
				TOC	

Hydrology/Level Measurements

Date	Time	DT-Bottom	DT-Product	DT-Water	(Product Thickness)	(Water Column)	(Gallons/ft x Water Column)
					DTP-DTW	DTB-DTW	Pore Volume
10/19/2021	15:48	16.62		12.07			

(0.75" = 0.023 gal/ft) (1" = 0.041 gal/ft) (1.5" = 0.092 gal/ft) (2" = 0.163 gal/ft) (3" = 0.367 gal/ft) (4" = 0.653 gal/ft) (6" = 1.469 gal/ft) (8" = 2.611 gal/ft)

Water Quality Data

Purge Method	Time	Purge Vol (gal)	Flowrate l/min	pH	Temp (C)	E Cond (uS/cm)	DO (mg/L)	ORP	Turbidity
(2) Peristaltic Pump	3:55:00 PM		0.2						
	4:05:00 PM	1	0.2						693
	4:16:00 PM	2	0.2	7.18	16.5	927.7			43.1
	4:21:00 PM		0.2	7.19	16.5	927.5			54.7
	4:26:00 PM		0.2	7.19	16.5	925.6			48.8
Final Field Parameters	4:30:00 PM	3	0.2	7.2	16.5	925.3			51.6

Methods: (1) Submersible Pump (2) Peristaltic Pump (3) Disposable Bailer (4) Vacuum Pump (5) Dedicated Bailer (6) Inertia Pump (7) Other (specify)

Water Quality Observations:

Sample Information

Sampling Method	Sample Type	Sampling Time	Container Code/Preservative	#	Filtered
(2) Peristaltic Pump	Groundwater	4:30:00 PM	VOA-Glass	7	No
			Amber Glass	2	
			White Poly	1	
			Yellow Poly		
			Green Poly		
			Red Total Poly		
			Red Dissolved Poly		
			Total Bottles	10	

General Sampling Comments

Began purge at 15:55.

Signature _____

Maul Foster & Alongi, Inc.

601 East Front Avenue, Suite 202, Coeur d'Alene, Idaho (208) 664-7880

Water Field Sampling Data Sheet

Client Name	Port of Whitman County	Sample Location	SB-3		
Project #	M0457.02.003	Sampler	L. Pritzl		
Project Name	College Avenue Steam Plant	Sampling Date	10/19/2021		
Sampling Event		Sample Name	SB-3-GW		
Sub Area		Sample Depth	15		
FSDS QA:	CWB 1/11/2021	Easting		Northing	
				TOC	

Hydrology/Level Measurements

Date	Time	DT-Bottom	DT-Product	DT-Water	(Product Thickness)	(Water Column)	(Gallons/ft x Water Column)
					DTP-DTW	DTB-DTW	Pore Volume
10/19/2021	16:09	15.77		12.42			

(0.75" = 0.023 gal/ft) (1" = 0.041 gal/ft) (1.5" = 0.092 gal/ft) (2" = 0.163 gal/ft) (3" = 0.367 gal/ft) (4" = 0.653 gal/ft) (6" = 1.469 gal/ft) (8" = 2.611 gal/ft)

Water Quality Data

Purge Method	Time	Purge Vol (gal)	Flowrate l/min	pH	Temp (C)	E Cond (uS/cm)	DO (mg/L)	ORP	Turbidity
(2) Peristaltic Pump	4:13:00 PM		0.25						
	4:53:00 PM	2.5	0.25						662
	4:58:00 PM		0.15						
	5:08:00 PM		0.15	6.84	16.2	528.8			58.8
	5:13:00 PM		0.15	6.89	16.1	525			42.7
	5:18:00 PM		0.15	6.84	16.1	522.6			56.6
Final Field Parameters	5:20:00 PM		0.15	6.79	16.1	523.1			52.2

Methods: (1) Submersible Pump (2) Peristaltic Pump (3) Disposable Bailer (4) Vacuum Pump (5) Dedicated Bailer (6) Inertia Pump (7) Other (specify)

Water Quality Observations:

Sample Information

Sampling Method	Sample Type	Sampling Time	Container Code/Preservative	#	Filtered
(2) Peristaltic Pump	Groundwater	5:20:00 PM	VOA-Glass	7	No
			Amber Glass	2	
			White Poly	1	
			Yellow Poly		
			Green Poly		
			Red Total Poly		
			Red Dissolved Poly		
			Total Bottles	10	

General Sampling Comments

Began purge at 16:13.

Signature _____

Maul Foster & Alongi, Inc.

601 East Front Avenue, Suite 202, Coeur d'Alene, Idaho (208) 664-7880

Water Field Sampling Data Sheet

Client Name	Port of Whitman County	Sample Location	SB-5		
Project #	M0457.02.003	Sampler	L. Pritzl		
Project Name	College Avenue Steam Plant	Sampling Date	10/19/2021		
Sampling Event		Sample Name	SB-5-GW		
Sub Area		Sample Depth	19		
FSDS QA:	CWB 1/11/2021	Easting		Northing	
				TOC	

Hydrology/Level Measurements

Date	Time	DT-Bottom	DT-Product	DT-Water	(Product Thickness)	(Water Column)	(Gallons/ft x Water Column)
					DTP-DTW	DTB-DTW	Pore Volume
10/19/2021	12:00	19.9		15.5			

(0.75" = 0.023 gal/ft) (1" = 0.041 gal/ft) (1.5" = 0.092 gal/ft) (2" = 0.163 gal/ft) (3" = 0.367 gal/ft) (4" = 0.653 gal/ft) (6" = 1.469 gal/ft) (8" = 2.611 gal/ft)

Water Quality Data

Purge Method	Time	Purge Vol (gal)	Flowrate l/min	pH	Temp (C)	E Cond (uS/cm)	DO (mg/L)	ORP	Turbidity
(2) Peristaltic Pump	12:18:00 PM	0	0.15						1000
	12:42:00 PM	1	0.1						1524
	12:49:00 PM	1.25	0.1						927
	1:17:00 PM	2	0.1	7	17.6	584.8			58.4
	1:23:00 PM			0.1	6.92	17.6	578.8		47.2
	1:28:00 PM			0.1	6.96	17.5	577.9		47.9
Final Field Parameters	1:30:00 PM	2.5	0.1	6.96	17.5	577.8			43.9

Methods: (1) Submersible Pump (2) Peristaltic Pump (3) Disposable Bailer (4) Vacuum Pump (5) Dedicated Bailer (6) Inertia Pump (7) Other (specify)

Water Quality Observations:

Sample Information

Sampling Method	Sample Type	Sampling Time	Container Code/Preservative	#	Filtered
(2) Peristaltic Pump	Groundwater	1:30:00 PM	VOA-Glass	7	No
			Amber Glass	2	
			White Poly	1	
			Yellow Poly		
			Green Poly		
			Red Total Poly		
			Red Dissolved Poly		
			Total Bottles	10	

General Sampling Comments

Began purge at 12:18.

Signature _____

Maul Foster & Alongi, Inc.

601 East Front Avenue, Suite 202, Coeur d'Alene, Idaho (208) 664-7880

Water Field Sampling Data Sheet

Client Name	Port of Whitman County	Sample Location	SB-7		
Project #	M0457.02.003	Sampler	L. Pritzl		
Project Name	College Avenue Steam Plant	Sampling Date	10/19/2021		
Sampling Event		Sample Name	SB-7-GW		
Sub Area		Sample Depth	20		
FSDS QA:	CWB 1/11/2021	Easting		Northing	
				TOC	

Hydrology/Level Measurements

Date	Time	DT-Bottom	DT-Product	DT-Water	(Product Thickness)	(Water Column)	(Gallons/ft x Water Column)
					DTP-DTW	DTB-DTW	Pore Volume
10/19/2021	13:55	20.75		16.57			

(0.75" = 0.023 gal/ft) (1" = 0.041 gal/ft) (1.5" = 0.092 gal/ft) (2" = 0.163 gal/ft) (3" = 0.367 gal/ft) (4" = 0.653 gal/ft) (6" = 1.469 gal/ft) (8" = 2.611 gal/ft)

Water Quality Data

Purge Method	Time	Purge Vol (gal)	Flowrate l/min	pH	Temp (C)	E Cond (uS/cm)	DO (mg/L)	ORP	Turbidity
(2) Peristaltic Pump	2:13:00 PM	0.25	0.1						2112
Final Field Parameters	4:50:00 PM		0.1						

Methods: (1) Submersible Pump (2) Peristaltic Pump (3) Disposable Bailer (4) Vacuum Pump (5) Dedicated Bailer (6) Inertia Pump (7) Other (specify)

Water Quality Observations:

Sample Information

Sampling Method	Sample Type	Sampling Time	Container Code/Preservative	#	Filtered
(2) Peristaltic Pump	Groundwater	4:50:00 PM	VOA-Glass	7	No
			Amber Glass	2	
			White Poly	1	
			Yellow Poly		
			Green Poly		
			Red Total Poly		
			Red Dissolved Poly		
			Total Bottles	10	

General Sampling Comments

Well ran dry after collecting 0.25 gallons, allowed well to recharge and grabbed sample at 16:50 without parameters.

Signature _____

APPENDIX C

HAZARDOUS MATERIALS SURVEY REPORT



HAZARDOUS MATERIALS SURVEY REPORT

COLLEGE AVENUE STEAM PLANT
PULLMAN, WASHINGTON



Prepared for
PORT OF WHITMAN COUNTY
December 2, 2021
Project No. 0457.02.03

Prepared by
Maul Foster & Alongi, Inc.
601 East Front Ave., Suite 202, Coeur d'Alene, ID 83814

HAZARDOUS MATERIALS SURVEY REPORT
COLLEGE AVENUE STEAM PLANT
PULLMAN, WASHINGTON


*The material and data in this report were prepared
under the supervision and direction of the undersigned.*

MAUL FOSTER & ALONGI, INC.



Emily Curtis

*Project Health, Safety, and Environmental Specialist
AHERA Building Inspector Number IR-21-6100B*



Sean Maloney

*Staff Geologist
AHERA Building Inspector Number IN-20-8991B*

CONTENTS

TABLES AND ILLUSTRATIONS	IV
ACRONYMS AND ABBREVIATIONS	V
EXECUTIVE SUMMARY	VI
1 INTRODUCTION	1
1.1 MATERIAL SURVEY OBJECTIVE	1
1.2 REGULATORY FRAMEWORK	1
2 BACKGROUND	1
3 FIELD AND ANALYTICAL METHODS	2
3.1 ASBESTOS-CONTAINING MATERIAL	2
3.2 LEAD-BASED PAINT	2
3.3 MERCURY, POLYCHLORINATED BIPHENYLS, AND OTHER MATERIALS	3
4 ASSESSMENT RESULTS	3
4.1 ASBESTOS-CONTAINING MATERIAL	3
4.2 LEAD-BASED PAINT	4
4.3 MERCURY, POLYCHLORINATED BIPHENYLS, AND OTHER MATERIALS	5
5 SUMMARY AND RECOMMENDATIONS	5
5.1 RECOMMENDATIONS	6
LIMITATIONS	
REFERENCES	
TABLES	
FIGURES	
APPENDIX A	
AHERA CERTIFICATES	
APPENDIX B	
FIELD SAMPLING DATA SHEETS	
APPENDIX C	
LABORATORY ANALYTICAL REPORTS	

TABLES AND ILLUSTRATIONS

FOLLOWING REPORT:

TABLES

- 3-1 HAZARDOUS BUILDING MATERIALS SURVEY SUMMARY
- 4-1 SUMMARY OF ASBESTOS SAMPLE RESULTS
- 4-2 SUMMARY OF LEAD-BASED PAINT SAMPLE RESULTS

FIGURES

- 1-1 SITE FEATURES
- 3-1 FIRST FLOOR AND EXTERIOR—ASBESTOS
- 3-2 MEZZANINE—ASBESTOS
- 3-3 UPPER MEZZANINE—ASBESTOS
- 3-4 BASEMENT—ASBESTOS
- 3-5 FIRST FLOOR—LEAD
- 3-6 MEZZANINE—LEAD
- 3-7 UPPER MEZZANINE—LEAD
- 3-8 BASEMENT—LEAD
- 3-9 SUBBASEMENT—LEAD

ACRONYMS AND ABBREVIATIONS

ACM	asbestos-containing material
AHERA	Asbestos Hazard Emergency Act
EPA	U.S. Environmental Protection Agency
FSDS	field sampling data sheet
LBP	lead-based paint
MFA	Maul Foster & Alongi, Inc.
PCB	polychlorinated biphenyl
the Port the Site	Port of Whitman County College Avenue Steam Plant, 800 NE College Ave, Pullman, WA
WSU	Washington State University
XRF	X-ray fluorescence

EXECUTIVE SUMMARY

This summary is not intended as a stand-alone document and must be evaluated in context with the entire document.

On behalf of the Port of Whitman County (the Port), Maul Foster & Alongi, Inc., conducted a hazardous materials survey at the College Avenue Steam Plant site at 800 NE College Ave, Pullman, Washington, 99163. The purpose of the survey was to identify building materials that may require special handling and/or disposal during demolition or construction activities.

The survey included assessment of painted surfaces for the presence of lead-based paint, collection of samples to assess the presence of asbestos-containing materials, and identification of other potentially hazardous materials that may require abatement and/or management in the future. The following regulated building materials were identified during the survey:

Regulated Material	General Description ^(a)	Estimated Quantity ^(b)
Asbestos	Window glazing	4,030 linear feet
	Red paint-coated pipe wrap with compacted white insulation	20 linear feet
	White/gray compacted insulation with white-, silver-, orange-, or tan-painted wrap	3,000 linear feet
	White patch on gray pipe	5 linear feet
	Fire hose	1 hose in room 101. Assumed to be asbestos-containing material.
	Tan 12 x 12-inch vinyl floor tile with black mastic	3,000 square feet
	Fire-resistant board	1 board in room 105. Assumed to be asbestos-containing material.
	Tan 9 x 9-inch vinyl floor tile with black mastic	16 square feet
	Light tan patterned 9 x 9-inch vinyl floor tile with black mastic	76 square feet
	Brown vinyl floor tile	66 square feet
	Brown vinyl floor tile with black mastic	175 square feet
	Brown stipple-patterned 9 x 9-inch vinyl floor tile with black mastic	20 square feet
	White insulation with tan/white-painted woven fibrous mesh	35 linear feet

Regulated Material	General Description ^(a)	Estimated Quantity ^(b)	
Asbestos	White insulation with silver-painted woven fibrous cover	200 square feet	
	Asbestos dust	Door to room 301 has warning of asbestos-containing dust hazard in room.	
	White crumbly insulation with yellow woven fibrous mesh and silver paint	600 linear feet	
	White crumbly insulation with white fibrous felt and brown paint	1,200 linear feet	
	White crumbly insulation with white woven fibrous wrap and red paint	40 linear feet	
	Silver woven heat-resistant furnace door lining	80 linear feet	
	White insulation with gray painted wrap and fabric patch on elongated tank	20 linear feet	
	Orange-painted wrap and gray crumbly insulation	20 linear feet	
	Tan 1 x 1-inch and 2 x 2-inch flooring tile with brown adhesive	180 square feet	
	Tan cove base with green adhesive	60 linear feet	
	Lead-based paint	Brown paint	70 linear feet
		Brownish red paint	272 linear feet
Red paint		1,660 square feet	
Orange paint		3,950 square feet	
Yellow paint		740 linear feet	
Green paint		164 square feet	
White paint		3,386 square feet	
Bright white paint		280 linear feet	
Silver paint		3,025 square feet	
Gray paint		729 square feet	
Light tan paint		24 square feet	

Regulated Material	General Description ^(a)	Estimated Quantity ^(b)
Potentially PCB-containing fixtures and other hazardous materials ^(c)	Electrical boxes/panels	39 boxes/panels, including electrical boxes, control boxes, motor control centers, and a safety switch. Potentially PCB-containing.
	Motors	1 motor associated with elevator; 1 motor in room 302; potentially numerous motors associated with boilers. Potentially PCB-containing. May also contain residual mechanical fluids, such as oil.
Potentially PCB-containing fixtures and other hazardous materials ^(c)	Miscellaneous containers	4 or more containers in room 15, 3 unmarked black cans in room 201, 1 unmarked jug and 1 container of turbine oil in room 302. May contain residual mechanical fluids, such as oil.
	Coal dust	Rooms 204 and 301. Potential breathing hazard due to abundant presence of coal and coal dust.
	Thermostats	2 thermostats. Potentially mercury-containing.
	Boiler control panels	Boiler equipment control panels marked as mercury-containing.
	Steam equipment	Numerous pipes and pieces of equipment. Potentially contains residual mechanical fluids, such as oil.
	Boilers	6 boilers. Potentially containing residual mechanical fluids and coal dust.
	Fluorescent light tubes	89 tubes. Potentially mercury-containing.
<p>NOTES: PCB = polychlorinated biphenyl. ^(a)Detailed descriptions are provided in the main report. ^(b)Detailed quantities and locations are provided in the main report. Asbestos and lead paint associated with pipes and other linear surfaces are reported in linear feet in the main report. ^(c)Detailed information is provided in the main report.</p>		

1 INTRODUCTION

On behalf of the Port of Whitman County (the Port), Maul Foster & Alongi, Inc. (MFA), conducted a hazardous materials survey at the College Avenue Steam Plant site at 800 NE College Avenue in Pullman Washington (the Site). MFA conducted the survey in October 2021. The Site location is provided in Figure 1-1. Areas that were inaccessible due to locked access points or hazardous conditions were not included in the survey. These areas include the roof, subbasement room B2, and basement tunnels in rooms 21 and 23.

The survey included the use of a portable X-ray fluorescence (XRF) device to screen materials for the presence of lead-based paint (LBP); sampling and analysis of suspected asbestos-containing materials (ACM); and visual inspection and tracking of suspected polychlorinated biphenyl (PCB)-containing fixtures, mercury-containing fixtures, and other potentially hazardous materials.

The survey was conducted by certified Asbestos Hazard Emergency Act (AHERA) building inspectors Sean Maloney, Emily Curtis, and Connor Anderson of MFA. AHERA building inspector certificates are provided in Appendix A.

1.1 Material Survey Objective

The objective of this survey was to identify building materials and components that may require abatement, special handling, or disposal during future demolition or construction activities.

1.2 Regulatory Framework

This survey was conducted consistent with regulatory requirements of AHERA in 40 Code of Federal Regulations 763; Washington Administrative Code 296-65; and the Washington Department of Ecology Eastern Regional Office, which administers clean air regulations for Whitman County.

2 BACKGROUND

The Site is located on the Washington State University (WSU) campus in Pullman, Washington. The Site is bound by Northeast College Avenue to the south, the WSU campus to the east, and a railroad line to the west. The surrounding area is largely residential, with a commercial area to the south. The former steam plant facility operated on the Site from 1927 to 2003.

3 FIELD AND ANALYTICAL METHODS

Between October 10 and 14, 2021, MFA conducted the field sampling and survey. The building-material survey was conducted to satisfy federal, state, and local air quality regulations regarding communicating the location, amount, and quality of known ACM and LBP at the Site, as well as to catalogue other potentially hazardous fixtures to be managed before renovation, construction, or demolition. The scope of work included the following:

- Collecting bulk samples of suspected ACMs.
- Using a portable XRF device to field-screen painted surfaces for the presence of lead in surface paint.
- Collecting quality control paint chip samples for laboratory analysis.
- Submitting suspected ACM bulk samples and paint chip samples to a laboratory accredited by the National Voluntary Laboratory Accreditation Program. Suspected ACM samples were analyzed by polarized light microscopy.
- Recording the location, quantity, and quality of hazardous building materials in homogeneous areas identified in the steam plant building.
- Identifying other potentially hazardous materials that may require abatement and/or management.

The survey involved the visual inspection of the interior and exterior of the designated structure.

3.1 Asbestos-Containing Material

MFA's survey of suspected ACM at the Site in the designated structure included collecting bulk samples of thermal system insulation, surfacing materials, and miscellaneous materials from homogeneous areas, consistent with AHERA sampling protocol.

Sampling locations were chosen by the inspectors based on identification of suspected ACM. See Figures 3-1 through 3-4 for ACM sampling locations.

Samples were extracted using hand tools and placed into labeled sample bags. For layered building materials, the layers were penetrated and incorporated into each sample. Samples were sent to NVL Laboratories, Inc., a National Voluntary Laboratory Accreditation Program-accredited laboratory, for analysis by U.S. Environmental Protection Agency (EPA) Polarized Light Microscopy Method 600/R-93-116.

3.2 Lead-Based Paint

MFA conducted a survey for interior and exterior paint coatings of the designated structures, which included XRF readings of each color and/or layer identified. The portable XRF unit used was an

R:\0457.02 Port of Whitman County\Documents\03_2021.12.02 Hazardous Materials Survey Report\Rf_HBM Survey.docx

Olympus Vanta C-Series with a reported accuracy range of 0.01 to 5 milligrams of lead per square centimeter. Paint with a concentration of lead detectable by this method is considered “lead-containing.” LBP is defined by the EPA and the Washington State Department of Health as paint containing lead concentrations of more than 5,000 parts per million (greater than 0.5 percent).

For quality assurance, MFA collected paint chip samples from approximately 5 percent of the representative XRF sampling locations. The identification of LBP summarized in this report is based on XRF results and confirmation paint chip samples collected from the structures.

See Figures 3-5 through 3-9 for sampling locations.

XRF readings were recorded on the field sampling data sheets (FSDSs) provided in Appendix B. Paint chip samples were placed into labeled sample bags and sent to NVL Laboratories, Inc., for analysis by EPA Method 3051/7000B.

3.3 Mercury, Polychlorinated Biphenyls, and Other Materials

MFA conducted a visual survey to identify fixtures that may contain mercury or PCBs. MFA also noted the presence of other potentially hazardous materials, such as residual hazardous chemicals in containers. Items were tracked on the FSDSs and are summarized in Table 3-1.

4 ASSESSMENT RESULTS

4.1 Asbestos-Containing Material

Sampling locations are provided in Figures 3-1 through 3-4, and sample results are summarized in Table 4-1. Laboratory reports are provided in Appendix C.

45 of the 156 samples analyzed contained more than 1 percent asbestos. ACM include the following:

- Window glazing on windows throughout the first floor, mezzanine, and upper mezzanine areas.
- Red paint-coated woven pipe wrap with fibrous insulation in room 101 near the double doors on the west side of the room.
- White and gray compacted/crumblly fibrous insulation with white-, silver-, orange-, and/or tan-painted mesh wrapping in the following areas:
 - Rooms 11, 21, 22, 23, 101, 200, and 204.
 - Intermediate catwalks extending from rooms 101 and 200, surrounding the boiler equipment.
 - On boiler components.

- Tan 12 x 12-inch vinyl floor tile with black mastic in room 102.
- Tan 9 x 9-inch vinyl flooring tiles in room 106T.
- Light tan patterned 9 x 9-inch vinyl flooring tiles with black mastic in rooms 106T, 200S, and 204, and in the stairwell from room 102 to the mezzanine.
- White stipple-patterned 12 x 12-inch flooring tiles and underlying brown vinyl tile in room 203.
- Layered light brown patterned 9 x 9-inch vinyl flooring tiles in room 203.
- Layered dark brown stipple-patterned 9 x 9-inch vinyl flooring tiles and associated black mastic in room 202.
- Tan, white, and silver-painted white compacted fibrous insulation on boiler components in room 101, 200, and in the unlabeled mezzanine area above.
- White insulation with silver-painted woven fibrous cover on boiler equipment by the entrance to the northeastern staircase above room 101.
- White crumbly insulation with yellow woven fibrous mesh and silver paint in rooms 21, 22, and 11.
- White crumbly insulation with white fibrous felt and brown paint in rooms 21, 22, and 11.
- White crumbly insulation with white woven fibrous wrap and red paint on steam equipment in room 11 by the spiral staircase.
- Silver woven heat-resistant furnace door lining in room 11 by the control wheels and conveying systems, and by the entrance to the subbasement.
- White insulation with gray-painted wrap and fabric patch on elongated tank in the northeast portion of room 11.
- Orange-painted wrap and gray crumbly insulation on vertical tank in center of room 11.
- Tan 1 x 1-inch and 2 x 2-inch flooring tile with brown adhesive in room 17.
- Tan cove base with green adhesive in west side of room 17.

4.2 Lead-Based Paint

XRF measurement locations and paint chip sampling locations are provided in Figures 3-5 through 3-9. XRF measurements and paint chip sample results are summarized in Table 4-2 and laboratory reports are provided in Appendix C.

Areas and features of the Site with lead content above the EPA-regulated definition of LBP include the following:

- Brown-, red-, orange-, yellow-, and green-painted pipes throughout the basement, room 101, and mezzanine.

- The brownish-red I-beams supporting room 204 surrounding the railroad tracks on the western exterior of the building.
- Red paint near the fire extinguisher in room 101.
- The red-painted box in the northwest corner of the basement.
- Red-, orange-, and white- painted pipe wrap throughout the basement.
- The orange-painted vertical tank in the basement.
- The orange and yellow pipes in the subbasement.
- Yellow paint on the concrete bench west of the north door in room 101.
- The green cabinets on the east side of room 101.
- Green-painted boiler equipment in the basement.
- White paint in room 107.
- Bright white- and tan-painted I-beams in the vicinity of the northwest boiler in the basement, room 101, mezzanine, and upper mezzanine.
- Silver pipes on the western exterior of the building near the railroad tracks.
- Silver- and red-painted steam equipment throughout the basement.
- Gray-painted I-beams in room 301.
- The gray-painted tank in room 18.
- The gray- and tan-painted door to room 15.
- Tan-painted pipes in the basement, room 101, mezzanine, and upper mezzanine.

4.3 Mercury, Polychlorinated Biphenyls, and Other Materials

Observations related to mercury-containing fixtures, PCB-containing fixtures, and other hazardous materials were tracked and recorded on the FSDSs provided in Appendix B. Results are summarized in Table 3-1.

Fixtures potentially containing PCBs, mercury, and other hazardous materials were identified at the Site.

5 SUMMARY AND RECOMMENDATIONS

Based on observations and the results of the material testing, MFA concludes the following:

- Other than pipes specifically marked as non-ACM, the majority of thermal system insulation associated with piping throughout the basement, first floor, mezzanine, and upper mezzanine areas is ACM.
- Window glazing throughout the first floor, mezzanine, and upper mezzanine is ACM.
- The various types of vinyl tile flooring in rooms 103, 104, 200S, 202, and 203 are ACM.
- There are LBP coatings and lead-containing paint throughout the interior and exteriors of the structure.
- Potentially hazardous-materials-containing fixtures are present throughout most of the Site.
- Coal dust residue is present in rooms 201, 204, 301, and 302.
- Room 301 is labeled as an asbestos-containing dust hazard.

5.1 Recommendations

This report should be made available to contractors during bidding on abatement, construction, or demolition work to be conducted on these structures. Prior to any disturbance activities at the site, identified hazardous materials should be abated by a licensed abatement contractor or safely managed in place consistent with a written operations and maintenance plan.

The Port should inform contractors that other hazardous materials or conditions may be discovered during the renovation and demolition activities, which may warrant additional remediation and/or corrective actions.

LIMITATIONS

The services undertaken in completing this report were performed consistent with generally accepted professional consulting principles and practices. No other warranty, express or implied, is made. These services were performed consistent with our agreement with our client. This report is solely for the use and information of our client unless otherwise noted. Any reliance on this report by a third party is at such party's sole risk.

Opinions and recommendations contained in this report apply to conditions existing when services were performed and are intended only for the client, purposes, locations, time frames, and project parameters indicated. We are not responsible for the impacts of any changes in environmental standards, practices, or regulations subsequent to performance of services. We do not warrant the accuracy of information supplied by others, or the use of segregated portions of this report.

TABLES



**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
Asbestos	Window glazing	On windows throughout room 101, mezzanine, and upper mezzanine	4,030 ln. ft.	Difficult to estimate quantity.
	Red paint-coated pipe wrap with compacted white insulation	Near double doors on west side of room 101	20 ln. ft	
	White / gray compacted insulation with white-, silver-, orange-, or red-painted wrap	Rooms 11, 21, 22, 23, 101, 200, 204, on boiler equipment, and by intermediate catwalks	3,000 ln. ft	Difficult to estimate quantity.
	White patch on gray pipe	North wall of room 101	5 ln. ft	
	Fire hose	Room 101 by west double doors	1 hose	Assumed asbestos containing material.
	Tan 12 x 12-inch vinyl floor tile with black mastic	North wall west of single doorway in room 102	3,000 sq. ft	
	Fire-resistant board	Room 105	1 board	Assumed asbestos-containing material in board.
	Tan 9 x 9-inch vinyl floor tile with black mastic	Room 106T	16 sq. ft	
	Light tan patterned 9 x 9-inch vinyl floor tile with black mastic	Room 106T and staircase to room 200S	76 sq. ft	
	Brown vinyl floor tile	Room 203	66 sq. ft	Layered under white stipple-patterned 12 x 12-inch vinyl floor tile with black mastic.
	Brown vinyl floor tile with black mastic	Room 202	175 sq. ft	Layered under light brown patterned 9 x 9-inch vinyl floor tile with black mastic.
Brown stipple-patterned 9 x 9-inch vinyl floor tile with black mastic	East side of room 202	20 sq. ft.	2-tile-wide line of darker tiles running east-west through the room.	

**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
Asbestos	White insulation with tan / white-painted woven fibrous mesh	Covering T-coupling and pipe in northeast corner of mezzanine	35 ln. ft	Accessed by catwalk near staircase entrance on northeast side of room.
	White insulation with silver-painted woven fibrous cover	Flat sheet on boiler equipment / duct by northeastern boiler	200 sq. ft	Difficult to quantify. Accessed by catwalk near staircase entrance on northeast side of room.
	Asbestos dust	Room 301	1 room	Door to room 301 contains warning of asbestos-containing dust hazard within room.
	White crumbly insulation with yellow woven fibrous mesh and silver paint	Room 21, 22, and 11	600 ln. ft	
	White crumbly insulation with white fibrous felt and brown paint	Room 21, 22, and 11	1,200 ln. ft	
	White crumbly insulation with white woven fibrous wrap and red paint	On steam equipment in room 11 by the spiral staircase	40 ln. ft	
	Silver woven heat-resistant furnace door lining	Room 11 by the control wheels, surveying system, and doorway to sub-basement	80 ln. ft	
	White insulation with gray-painted wrap and fabric patch on elongated tank	Northeast portion of room 11	20 ln. ft	

**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
Asbestos	Orange-painted wrap and gray crumbly insulation	Vertical tank in center of room 11	20 ln. ft	
	Tan 1 x 1-inch and 2 x 2-inch flooring tile with brown adhesive	Room 17	180 sq. ft	
	Tan cove base with green adhesive	Room 17	60 ln. ft	
Lead-Based Paint	Brown paint	Room 101; on pipes	70 ln. ft	
	Brownish red paint	Exterior; support beam of ash pit	272 ln. ft	
	Red paint	Throughout basement, room 101, and mezzanine	1,660 sq. ft	
	Orange paint	Throughout basement, room 101, and sub-basement; on pipes and TSI pipe wrap	645 ln. ft	
	Yellow paint	Basement, room 101, and mezzanine; on pipes and concrete bench	3950 sq. ft	
	Green paint	Basement and room 101; on pipes and cabinets	164 sq. ft	
	White paint	Room 101, room 107, and basement	3,386 sq. ft	
	Bright white paint	Basement; support in center of room between north boilers	280 ln. ft	
	Silver paint	Room 101 and mezzanine; on I-beams	3,025 ln. ft	
	Gray paint	Throughout basement and room 301	729 sq. ft	
	Light tan paint	Basement; door to room 15	24 sq. ft	

**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
PCB-Containing and Other Hazardous Materials	Electrical boxes/panels	Room 11, 101	39 boxes/panels	Potentially PCB-containing. Includes electrical boxes, control boxes, motor control centers, and a safety switch.
	Motors	Elevator in room 101 and room 11; room 302	1 motor associated with elevator; 1 motor in room 302; potentially numerous motors associated with boilers	Potentially PCB-containing. May also contain residual mechanical fluids, such as oil.
	Miscellaneous containers	Room 15	4 or more containers	May contain residual mechanical fluids, such as oil.
		Room 201	3 unmarked black cans	
		Room 302	1 unmarked jug and 1 turbine oil container	
	Coal dust	Rooms 204 and 301	2 rooms	Potential breathing hazard due to abundant presence of coal and coal dust.
	Mercury-containing thermostats	Rooms 104 and 105	2 thermostats	Potentially mercury-containing.
	Mercury-containing fixture	Room 101; east side of room behind controls	1 fixture	Boiler and equipment control panels containing mercury. Panels behind controls are marked as mercury-containing.
	Steam equipment	Throughout basement and room 101	Numerous pipes and pieces of equipment	Potentially contains residual mechanical fluids.
	Boilers	Basement and room 101	6 boilers	Potentially containing residual mechanical fluids and coal dust.
Fluorescent light tubes	Throughout structure	89 tubes	Potentially mercury-containing.	

NOTES:
 Quantities of asbestos and lead paint associated with piping and other linear surfaces are reported in linear feet.
 ln. ft = linear feet.
 PCB = polychlorinated biphenyl.
 sq. ft. = square feet.

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
First Floor							
1-1-TSI-1	10/11/2021	Condensate pipe	Northwest corner of room 101	Off-white paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND		
1-1-TSI-2	10/11/2021	Condensate pipe	Northwest corner of room 101	Off-white paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND		
1-2-TSI-3	10/11/2021	Elbow on condensate pipe	Northwest corner of room 101	White flexible sheet vinyl	ND	--	--
				Yellow loose-fill fibrous material	ND		
1-3-MISC-4	10/11/2021	Window glazing	Northwest corner of room 101	Pale gray brittle material	4	Fair	4,030 ln. ft.
1-3-MISC-5	10/11/2021	Window glazing	Window at west wall in room 101	Gray brittle crumbly material with paint	ND	--	--
1-4-MISC-6	10/11/2021	Tan cementitious material	Above red brick on northwest corner of northwest boiler in room 101	Beige soft crumbly material	ND	--	--
1-5-MISC-7	10/11/2021	Red brick	Northwest corner of northwest boiler in room 101	Red paint coated hard brittle material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-6-TSI-8	10/11/2021	White insulation with red pipe wrap	By double doors on west side of room 101	Red paint coated woven fibrous material	ND	--	--
				White compacted fine powdery material	30	Damaged	20 ln. ft.
1-7-TSI-9	10/11/2021	Yellow insulation with silver pipe wrap	Silver pipe by double doors on west side of room 101	White paper with woven fibers and metal foil	ND	--	--
				Yellow and pink loose-fill fibrous material	ND	--	--
1-8-TSI-10	10/11/2021	White insulation with silver pipe wrap	Silver pipe on boiler by staircase to lower floor on west side of room 101	White woven fibrous mesh with paint	ND	--	--
				Pale gray crumbly powdery material	ND	--	--
				White compacted fine powdery material	ND	--	--
1-8-TSI-11	10/11/2021	White insulation with silver pipe wrap	Silver pipe on boiler by staircase to lower floor on west side of room 101	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	35	Damaged	3,000 ln. ft.

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-8-TSI-12	10/11/2021	White insulation with silver wrap	Silver insulation on boiler on southwest side of room 101	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	5	Damaged	3,000 ln. ft.
First Floor							
1-9-MISC-13	10/11/2021	Insulation on sink	Sink on southwest side of room 101	White encapsulated woven fibrous material	ND	--	--
				Tan paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
1-8-TSI-14	10/11/2021	White insulation with orange pipe wrap	Orange pipe in southeast corner of room 101	Orange paint coated woven fibrous mesh	ND	--	--
				White compacted fine powdery material	38	Damaged	3,000 ln. ft.
1-10-TSI-15	10/11/2021	White boiler insulation	Southeast corner of room 101 on corrugated boiler	White woven fibrous mesh with paint	ND	--	--
				Off-white crumbly material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-11-MISC-16	10/11/2021	Tan soundproofing material	Southeast corner of room 101 on corrugated boiler wall	Yellow loose-fill fibrous material	ND	--	--
1-12-MISC-17	10/11/2021	Gray fibrous material	Green cabinet in southeast corner of room 101	Pale gray loose-fill fibrous material	ND	--	--
1-8-TSI-18	10/11/2021	White insulation	East side of room 101	Tan woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	40	Damaged	3,000 ln. ft.
1-13-MISC-19	10/11/2021	Gray and tan soundproofing material wrap	Boiler in northeast corner of room 101	White woven fibrous cloth	ND	--	--
				White loose-fill fibrous material	ND	--	--
1-14-TSI-20	10/11/2021	White patch on gray pipe	North wall of room 101	White and tan woven fibrous mesh with paint	ND	--	--
				White compacted powdery material	40	Damaged	3,000 ln. ft.
1-8-TSI-21	10/11/2021	White insulation with dark gray pipe wrap	Dark gray pipe between boilers 4 and 5 in room 101	Dark gray paint coated woven mesh	ND	--	--
				Off-white fine compacted powdery material	37	Damaged	3,000 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-13-MISC-22	10/11/2021	Gray fabric material	Southeast boiler by double doors on south end of room 101	White woven fibrous cloth with paint	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
1-15-MISC-23	10/11/2021	Tan 12 x 12 in. vinyl floor tile with black mastic	Northeast corner of room 104	Tan patterned vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
First Floor							
1-15-MISC-24	10/11/2021	Tan 12 x 12 in. vinyl floor tile with black mastic	Northeast corner of room 105	Tan patterned vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
1-16-MISC-25	10/11/2021	Brown base cove with brown mastic	East wall of room 104	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
1-16-MISC-26	10/11/2021	Brown base cove with brown mastic	East wall of room 104	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
1-17-MISC-27	10/11/2021	Light gray wallboard	North wall of room 105	Pale gray brittle sandy material with paint	ND	--	--
				White chalky material with paper	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-18-MISC-28	10/11/2021	Light gray cementitious wallboard	North wall of room 104 in light switch casing	Pale gray brittle sandy material with paint	ND	--	--
1-19-MISC-29	10/11/2021	White 18 x 36 in. ceiling tile with randomized stipple pattern	Northwest corner of room 104 above light switch	Pale gray compressed fibrous material with paint	ND	--	--
1-20-MISC-30	10/11/2021	White 18 x 36 in. ceiling tile with uniform stipple pattern	Southeast corner above cabinet in room 104	Pale gray compressed fibrous material with paint	ND	--	--
1-19-MISC-31	10/11/2021	White 18 x 36 in. ceiling tile with randomized stipple pattern	Northwest corner of room 105	Beige fibrous material with white paint	ND	--	--
1-8-TSI-32	10/11/2021	Pipe insulation with white pipe wrap	Southeast corner of room 104 on white pipe	White fibrous material with painted cloth wrap	50	Damaged	3,000 ln. ft.
1-21-MISC-33	10/11/2021	Gray blue laminate countertop with black and green mastic	Gray blue counter top on east side of room 104	Blue laminate with clear adhesive	ND	--	--
1-22-MISC-34	10/11/2021	Dark brown base cove with brown mastic	Northwest corner of room 102 by stairs	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
1-22-MISC-35	10/11/2021	Dark brown base cove with brown mastic	North wall east of double door in room 102	Brown rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-23-MISC-36	10/11/2021	Gray cementitious patching material	North wall, west of transformer box and east of the double doors in room 102	Gray cementitious material	ND	--	--
First Floor							
1-24-MISC-37	10/11/2021	Light gray 12 x 12 in. vinyl floor tile with gray mastic	North wall west of single doorway in room 102	Beige/light gray vinyl tile	ND	--	--
				Tan brittle mastic	ND	--	--
				Light gray sandy material	ND	--	--
1-15-MISC-38	10/11/2021	Tan 12 x 12 in. vinyl floor tile with black mastic	North wall west of single doorway in room 102	Beige vinyl tile	ND	--	--
				Black asphaltic mastic	6	Fair	3,000 sq. ft
1-25-MISC-39	10/11/2021	Black transition strip with brown mastic	Double doorway between room 102 and 101	Black rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--
1-26-MISC-40	10/11/2021	Rubber stair tread with clear mastic	South side of stairway to Room 106T and 107	Light brown rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--
1-27-MISC-41	10/11/2021	Dark brown patterned 9 x 9 in. vinyl floor tiles with black mastic	Center floor of room 106T	Brown vinyl tile	3	Fair	16 sq. ft.
				Black asphaltic mastic	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-28-MISC-42	10/11/2021	Light tan patterned 9 x 9 in. vinyl floor tile with black mastic	Center floor of room 106T	Brown vinyl tile	3	Fair	76 sq. ft.
				Black asphaltic mastic	ND	--	--
1-18-MISC-43	10/11/2021	White drywall with cementitious wallboard	West wall by door in room 106T	White chalky material with paper	ND	--	--
				Light gray cementitious material	ND	--	--
1-29-MISC-44	10/11/2021	White plastic waterproofing material with pale yellow adhesive	West wall next to window in room 107	White hard plastic like material	ND	--	--
				Yellow soft mastic	ND	--	--
1-3-MISC-45	10/11/2021	Window glazing	West wall window frame in room 107	White crumbly material with green paint	ND	--	--
1-1-TSI-46	10/11/2021	Condensate pipe	Pipe in northwest corner of room 107	Yellow fibrous material with metal foil	ND	--	--
1-25-MISC-47	10/11/2021	Black transition strip with brown mastic	West stairway moving down in room 102	Black rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--
1-28-MISC-48	10/11/2021	Light tan patterned 9 x 9 in. vinyl floor tile with black mastic	West stairway moving up in room 102	Light brown vinyl tile	4	Fair	76 sq. ft.
				Black asphaltic fibrous backing with brown mastic	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-30-MISC-49	10/11/2021	Black base cove with tan mastic	Top of stairway from room 102 to 107; North wall at the top of stairs	Black rubbery material	ND	--	--
				Beige soft mastic with tan color paint	ND	--	--
Mezzanine							
2-1-MISC-1	10/12/2021	White stipple pattern 12 x 12 in. vinyl floor tile with black mastic	Northwest corner floor in room 202	Beige vinyl tile	ND	--	--
				Black/gray asphaltic mastic	ND	--	--
2-1-MISC-2	10/12/2021	White stipple pattern 12" x 12" vinyl floor tile with black mastic	Southeast corner floor in room 203	Beige vinyl tile	ND	--	--
				Light gray sandy material with yellow mastic	ND	--	--
				Black asphaltic mastic	ND	--	--
				Brown vinyl tile	8	Fair	66 sq. ft.
				Black asphaltic fibrous felt with mastic	ND	--	--
2-2-MISC-3	10/12/2021	Tan laminate countertop with clear mastic	Southeast corner of counter in room 203	Laminate beige color with clear adhesive	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-3-MISC-4	10/12/2021	Layered light brown patterned 9 x 9 in. vinyl floor tile with black mastic	West side of floor in room 202	Light brown vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
				Brown vinyl tile	8	Fair	175 sq. ft.
				Black asphaltic mastic	ND	--	--
2-3-MISC-5	10/12/2021	Layered light brown patterned 9 x 9 in. vinyl floor tile with black mastic	Southwest corner of floor in room 203	Light brown vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
2-4-MISC-6	10/12/2021	Brown stipple-patterned 9 x 9 in. vinyl floor tile with black mastic	East side of floor north of door in room 202	Light brown vinyl tile	3	Fair	20 sq. ft.
				Black asphaltic fibrous felt with mastic	6	Fair	20 sq. ft.
2-5-MISC-7	10/12/2021	Black base cove with tan mastic	Northeast corner of room 202	Black rubbery material	ND	--	--
				Tan soft mastic	ND	--	--
2-6-TSI-8	10/12/2021	Yellow insulation with white pipe wrap	Pipe on west wall in room 202	Yellow fibrous material with metal foil wrap	ND	--	--
2-7-MISC-9	10/12/2021	Window glazing	Northwest window in room 202	Light gray soft rubbery material with paint	ND	--	--
2-7-MISC-10	10/12/2021	Window glazing	Southeast window in room 203	Light gray soft rubbery material with paint	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-8-MISC-11	10/12/2021	White drywall with cementitious wallboard	East wall above sink in room 203	White chalky material with paper	ND	--	--
				Tan chalky material	ND	--	--
2-8-MISC-12	10/12/2021	White drywall with cementitious wallboard	Northwest corner wall under window in room 202	Pale gray brittle sandy material with paint	ND	--	--
				Thin layer of black asphaltic material	ND	--	--
Mezzanine							
2-9-MISC-13	10/12/2021	Brown base cove with brown mastic	West wall in room 200S, north of door to room 202	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
2-10-TSI-14	10/12/2021	White insulation with orange pipe wrap	Pipe on east wall south of single door in room 204	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	34	Damaged	14 ln. ft.
2-11-MISC-15	10/12/2021	Red 12 x 12 in. brick	West wall south of double door in room 204	Red hard brittle crumbly material	ND	--	--
2-12-MISC-16	10/12/2021	Gray brick mortar	West wall south of double door in room 204	Pale gray hard brittle sandy material	ND	--	--
2-11-MISC-17	10/12/2021	Red 12 x 12 in. brick	North wall below window in room 204	Red hard brittle crumbly material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-12-MISC-18	10/12/2021	Gray brick mortar	North wall below window in room 204	Pale gray hard brittle sandy material	ND	--	--
2-13-TSI-19	10/12/2021	White insulation with pipe wrap	Second catwalk on southwest side of Boiler 6 in room 200	White compacted fine powdery material	ND	--	--
2-13-TSI-20	10/12/2021	White insulation with pipe wrap	Second catwalk on southwest side of Boiler 6 in room 200	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	ND	--	--
2-14-TSI-21	10/12/2021	Fabric material with white insulation	Second catwalk on southwest side of Boiler 6 in room 200	White woven fibrous cloth with paint	ND	--	--
				White loose-fill fibrous material	ND	--	--
2-13-TSI-22	10/12/2021	White insulation with pipe wrap	Second catwalk on southwest side of Boiler 6 in room 200	White woven fibrous mesh with paint	ND	--	--
				White and pale gray compacted fine powdery material	ND	--	--
2-13-TSI-23	10/12/2021	White insulation with pipe wrap	Second catwalk on southeast side of Boiler 6 in room 200	Tan woven fibrous mesh with paint	ND	--	--
				Pale gray compacted fine powdery material	38	Damaged	3,000 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-14-TSI-24	10/12/2021	Fabric material with white insulation	Second catwalk on southeast side of Boiler 6 in room 200	White woven fibrous cloth	ND	--	--
				White loose-fill fibrous material	ND	--	--
2-13-TSI-25	10/12/2021	White insulation with pipe wrap	Second catwalk on south side of Boiler 6 in room 200	Off-white compacted fine powdery material	30	Damaged	3,000 ln. ft.
Mezzanine							
2-15-TSI-26	10/12/2021	White insulation with white pipe wrap	Southeast corner of room 200	Tan woven fibrous mesh with paint	ND	--	--
				White woven fibrous mesh	ND	--	--
				Off-white compacted fine powdery material	35	Damaged	35 ln. ft.
2-15-TSI-27	10/12/2021	White insulation with white pipe wrap	East side of room 200 by staircase entrance	Tan and white woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	43	Damaged	35 ln. ft.
2-16-TSI-28	10/12/2021	White insulation with silver paint	Located throughout northeast side of room 200 on and around northeastern boiler by staircase entrance	Tan woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	38	Damaged	Difficult to quantify (>200 sq. ft.)

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-16-TSI-29	10/12/2021	White insulation with silver paint	Located throughout northeast side of room 200 on and around northeastern boiler by staircase entrance	Tan and white woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	46	Damaged	Difficult to quantify (>200 sq. ft.)
2-13-TSI-30	10/12/2021	White insulation with pipe wrap	Located throughout northeast side of room 200 on and around Boiler 2 by staircase entrance	Tan woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	43	Damaged	3,000 ln. ft.
2-17-TSI-31	10/12/2021	Yellow insulation with white pipe wrap	North side of room 200, highest catwalk by Boiler 4	Off-white paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
2-17-TSI-32	10/12/2021	Yellow insulation with white pipe wrap	Northwest corner of room 200, highest catwalk by Boiler 3	Off-white paper with woven fibers and metal foil	ND	--	--
				White flexible sheet vinyl	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
2-7-MISC-33	10/12/2021	Window glazing	Northwest corner of room 200, highest catwalk	Off-white brittle material with paint	3	Fair	4,030 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
Upper Mezzanine (Above Room 200)							
3-1-TSI-1	10/13/2021	White insulation with silver wrap	Highest catwalk in room 200 (below Room 302)	Beige woven fibrous material with paint	ND	--	--
				Pale gray compacted brittle material	ND	--	--
3-1-TSI-2	10/13/2021	White insulation with silver wrap	Highest catwalk in room 200 (below room 302)	Beige woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	ND	--	--
3-2-TSI-3	10/13/2021	Fabric material with white insulation	Highest catwalk in room 200 (below room 302)	White woven fibrous mesh	ND	--	--
				White loose-fill fibrous material	ND	--	--
3-3-TSI-4	10/13/2021	Off-white insulation with pipe wrap	Motor part near west roof access in room 302	Tan woven fibrous mesh with paint	ND	--	--
				Off-white brittle crumbly material	ND	--	--
3-1-TSI-5	10/13/2021	White insulation with pipe wrap	Pipe near west roof access in room 302	White woven fibrous mesh with paint	ND	--	--
				Tan woven fibrous material with paint	ND	--	--
				White compacted crumbly powdery material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
3-2-TSI-6	10/13/2021	White insulation with pipe wrap	Pipe near west roof access in room 302	White woven fibrous mesh with paint	ND	--	--
				White loose-fill fibrous material	ND	--	--
Upper Mezzanine (Above Room 200)							
3-1-TSI-7	10/13/2021	White insulation with silver wrap	Vent near staircase to lower level in room 302	Tan woven fibrous mesh with paint	ND	--	--
				Off-white compacted crumbly powdery material	ND	--	--
				Blue and white flexible sheet vinyl	ND	--	--
3-4-TSI-8	10/13/2021	Tan fibrous insulation with pipe wrap	Pipe near motor in room 302	Off-white paper with woven fibers and metal foil	ND	--	--
				Tan loose-fill fibrous material	ND	--	--
3-1-TSI-9	10/13/2021	White insulation with silver wrap	Vent near staircase to lower level in room 302	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				White powdery material	ND	--	--
				White crumbly material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
3-3-TSI-10	10/13/2021	Off-white insulation with pipe wrap	Motor part near west roof access in room 302	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				White powdery material	ND	--	--
				Gray crumbly material	ND	--	--
3-8-MISC-11	10/14/2021	Window glazing	Window on west side of room 303	Off-white brittle putty material with debris	4	Fair	4,030 ln. ft.
3-8-MISC-12	10/14/2021	Window glazing	Window on west side of room 303	Off-white brittle putty material with debris	5	Fair	4,030 ln. ft.
Basement							
4-1-TSI-1	10/13/2021	White insulation with woven fibrous pipe wrap	By entrance to room 22 from room 21	Flaky silver paint	ND	--	--
				Yellow woven fibrous material	ND	--	--
				White crumbly material	45	Damaged	600 ln. ft.
4-2-TSI-2	10/13/2021	White insulation with pipe wrap	By entrance to room 22 from room 21	White fibrous felt with brown paint	ND	--	--
				White crumbly material	40	Damaged	1,200 ln. ft.
4-3-MISC-3	10/13/2021	Brown soundproofing wall pad	East wall in room 22	Yellow fibrous material	ND	--	--
4-3-MISC-4	10/13/2021	Brown soundproofing wall pad	North wall in room 22	Yellow fibrous material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-4-MISC-5	10/13/2021	Off-white laminate tabletop with clear adhesive	Northwest corner tabletop in room 22	Beige laminate	ND	--	--
				Brown fibrous material	ND	--	--
4-1-TSI-6	10/13/2021	White insulation with woven fibrous pipe wrap	Northeast corner of room 23	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				Brown woven fibrous material	ND	--	--
				White crumbly material	50	Damaged	600 In. ft.
4-2-TSI-7	10/13/2021	White insulation with pipe wrap	Northeast corner of room 23	White woven fibrous material with paint	ND	--	--
				White crumbly material	47	Damaged	1,200 In. ft.
4-5-TSI-8	10/13/2021	White insulation with wrap	Southeast corner of room 23	White woven fibrous material	ND	--	--
				White fibrous material	ND	--	--
4-5-TSI-9	10/13/2021	White insulation with wrap	Southeast corner of room 11 by entrance to Room 23	White woven fibrous material	ND	--	--
				White fibrous material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-1-TSI-10	10/13/2021	White insulation with woven fibrous pipe wrap	Southeast portion of room 11 by entrance to Room 23	White woven fibrous material with paint	ND	--	--
				Yellow woven fibrous material	ND	--	--
				White crumbly material	45	Damaged	600 ln. ft.
4-5-TSI-11	10/13/2021	White insulation with wrap	East portion of room 11 by spiral staircase	Brown crumbly material	ND	--	--
				White woven fibrous material	ND	--	--
				Yellow fibrous material	ND	--	--
4-6-TSI-12	10/13/2021	White insulation with silver painted wrap	East portion of room 11 north of spiral staircase	Brittle red/silver paint	ND	--	--
				White woven fibrous material with paint	ND	--	--
				White crumbly material	50	Damaged	40 ln. ft.
Basement							
4-5-TSI-13	10/13/2021	White insulation with wrap	East portion of room 11 north of spiral staircase	White woven fibrous material	ND	--	--
				Yellow fibrous material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-7-TSI-14	10/13/2021	Yellow insulation with painted pipe wrap	East portion of room 11 north of spiral staircase	White/silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				Off-white woven fibrous material	ND	--	--
				Silver paint	ND	--	--
				Brown crumbly material with metal foil	ND	--	--
				Yellow foamy fibrous material	ND	--	--
4-7-TSI-15	10/13/2021	Yellow insulation with painted pipe wrap	East portion of room 11 north of spiral staircase	White mastic with red paint and metal foil	ND	--	--
				Brown fibrous material	ND	--	--
				Yellow fibrous material	ND	--	--
4-8-MISC-16	10/13/2021	Silver woven heat-resistant seal material on hatch interior	By control wheels and conveying systems in room 11	Charcoal gray fibrous material	90	Fair	80 ln. ft.
4-1-TSI-17	10/13/2021	White insulation with woven fibrous pipe wrap	Northeast portion of room 11 between northeast staircase and elevator	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				White crumbly material	50	Damaged	600 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-7-TSI-18	10/13/2021	Yellow insulation with painted pipe wrap	Northeast portion of room 11 between northeast staircase and elevator	Brown fibrous material with red paint and metal foil	ND	--	--
				Yellow foamy fibrous material	ND	--	--
4-7-TSI-19	10/13/2021	Yellow insulation with painted pipe wrap	Northeast portion of room 11 between northeast staircase and elevator	Soft white thin vinyl sheet with silver paint	ND	--	--
				Yellow fibrous material	ND	--	--
Basement							
4-2-TSI-20	10/13/2021	White insulation with pipe wrap	Northeast portion of room 11 near northeast staircase	White woven fibrous material with paint	ND	--	--
				White crumbly material	50	Damaged	1,200 ln. ft.
4-5-TSI-21	10/13/2021	White insulation with wrap	Northeast portion of room 11 near northeast staircase	White woven fibrous material with black fibrous banding	ND	--	--
				Yellow fibrous material	ND	--	--
4-2-TSI-22	10/13/2021	White insulation with pipe wrap	Northeast portion of room 11	White woven fibrous material with paint	ND	--	--
				White crumbly material	48	Damaged	1,200 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-9-TSI-23	10/13/2021	White insulation with white woven pipe wrap	Northeast portion of room 11	White woven fibrous material with paint	ND	--	--
				White crumbly material	50	Damaged	20 ln. ft.
4-8-MISC-24	10/13/2021	Silver woven heat-resistant seal material on hatch interior	By control wheels and conveying systems in room 11	Flaky silver paint	6	Fair	80 ln. ft.
				Gray/white fibrous felt	85	Fair	80 ln. ft.
4-2-TSI-25	10/13/2021	White insulation with pipe wrap	On west side of room 11 by staircase down	White woven fibrous material with paint	ND	--	--
				White crumbly material	48	Damaged	1,200 ln. ft.
4-5-TSI-26	10/13/2021	White insulation with wrap	On west side of room 11 by staircase down	White woven fibrous felt	ND	--	--
4-7-TSI-27	10/13/2021	Yellow insulation with painted pipe wrap	West portion of room 11 by staircase to Room 101	White fibrous material with paper and metal foil	ND	--	--
				Yellow fibrous material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
Basement							
4-7-TSI-28	10/13/2021	Yellow insulation with painted pipe wrap	West portion of room 11 by staircase to Room 101	White synthetic material	ND	--	--
				Yellow foamy fibrous material	ND	--	--
4-2-TSI-29	10/13/2021	White insulation with pipe wrap	Center of room 11	Thin silver paint over fibrous mesh	ND	--	--
				White powdery fibrous material with paint	40	Damaged	1,200 ln. ft.
4-8-MISC-30	10/13/2021	Silver woven heat-resistant seal material on hatch interior	By control wheels and conveying systems in room 11	White interwoven fibrous material with paint	80	Fair	80 ln. ft.
				Gray fibrous mesh	ND	--	--
4-2-TSI-31	10/13/2021	White insulation with pipe wrap	Center of room 11	Silver paint	ND	--	--
				White interwoven fibrous mesh	ND	--	--
				Light brown crumbly powdery fibrous material	ND	--	--
4-9-TSI-32	10/13/2021	White insulation with white woven pipe wrap	Northeast portion of room 11	Light gray crumbly powdery fibrous material with paint	ND	--	--
				Gray crumbly fibrous material	40	Damaged	20 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-7-TSI-33	10/13/2021	Yellow insulation with painted pipe wrap	Center of room 11	Silver foil with fibrous mesh, paint and paper	ND	--	--
				Orange fibrous material	ND	--	--
4-10-MISC-34	10/13/2021	Gray brick mortar	East wall of room 18	Light gray brittle sandy material	ND	--	--
4-11-MISC-35	10/13/2021	Red brick	North wall of room 18	Red brick	ND	--	--
				Light gray cementitious material	ND	--	--
4-12-MISC-36	10/13/2021	White plastic waterproofing material with pale yellow adhesive	Under paper towel holder in room 19	White brittle fibrous material	ND	--	--
				White soft adhesive with paint and debris	ND	--	--
Basement							
4-13-MISC-37	10/13/2021	Window glazing	Window in room 19	White compacted powdery material	ND	--	--
				Gray crumbly material with paint	ND	--	--
4-14-MISC-38	10/13/2021	Black 12 x 12 in. linoleum floor tile with yellow adhesive	Bathroom floor in room 19	Black crumbly vinyl	ND	--	--
				Clear soft adhesive	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-15-MISC-39	10/13/2021	White 12 x 12 in. linoleum floor tile with yellow adhesive	Bathroom floor in room 19	White crumbly vinyl	ND	--	--
				Yellow brittle adhesive with debris and paint	ND	--	--
				Gray crumbly sandy material	ND	--	--
4-16-MISC-40	10/13/2021	Black base cove with tan adhesive	Bathroom floor in room 19	Black rubbery material	ND	--	--
				Tan soft mastic	ND	--	--
4-17-MISC-41	10/14/2021	Tan 1 x 2 in. square tile with brown adhesive	Northeast floor in front of door in room 17	Tan and white ceramic with debris	ND	--	--
				Off-white brittle material	ND	--	--
4-17-MISC-42	10/14/2021	Tan 1 x 2 in. square tile with brown adhesive	South center room 17 next to center dividing wall	Tan and white ceramic with debris	ND	--	--
				Off-white brittle material	ND	--	--
				Light brown brittle material with paint	6	Damaged	180 sq. ft.
4-18-MISC-43	10/14/2021	White drywall with gray cementitious wallboard	South wall of room 17	White brittle powdery material	ND	--	--
				Off-white brittle sandy material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-19-MISC-44	10/14/2021	Tan base cove with green adhesive	West wall in northwest corner of room 17	Off-white ceramic with white glaze and sandy debris	ND	--	--
				Brown crumbly material with paint	15	Fair	60 ln. ft.
4-18-MISC-45	10/14/2021	White drywall with gray cementitious wallboard	West wall in northwest corner of room 17	Light gray brittle powdery material	ND	--	--
				White chalky material with paper	ND	--	--
Subbasement							
No potential ACM present in sub basement.							
Exterior							
EXT-1-MISC-1	10/14/2021	Red brick	West exterior side of Room 101 north of double doors next to ash pit tower	Red brick	ND	--	--
EXT-2-MISC-2	10/14/2021	Gray brick mortar	West exterior side of Room 101 north of double doors next to ash pit tower	Gray cementitious sandy material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
EXT-3-MISC-3	10/14/2021	Window glazing	West exterior side of Room 105 on the southwest corner of exterior	Clear soft/elastic material with debris	ND	--	--
EXT-1-MISC-4	10/14/2021	Red brick	East exterior side of Room 101 south of stairwell exit door and north of windows	Red brick	ND	--	--
EXT-2-MISC-5	10/14/2021	Gray brick mortar	East exterior side of Room 101 south of stairwell exit door and north of windows	Loose gray cementitious material	ND	--	--
EXT-3-MISC-6	10/14/2021	Window glazing	South window on exterior east wall of Room 101	Light gray soft/elastic material with debris	ND	--	--
EXT-4-MISC-7	10/14/2021	White brick caulking	North corner of east exterior wall of room 101 south of stairwell exit	Light gray soft/elastic material with debris	ND	--	--

NOTES:

Samples were analyzed consistent with polarized light microscopy, U.S. Environmental Protection Agency Method 600/R-93-116.
 -- = not applicable.
 % = percent.
 in. = inch.
 ln. ft. = linear feet.
 ND = not detected.
 sq. ft. = square feet.

**Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
First Floor						
1-1-PB-1	10/11/2021	Tan paint	West wall between room 106 doorway and stairway of room 102	0.108	--	--
1-1-PB-2	10/11/2021	Tan paint	West wall north of room 105 doorway	0.071	--	--
1-1-PB-3	10/11/2021	Tan paint	North double doors between room 102 and 101	0.177	--	--
1-1-PB-4	10/11/2021	Tan paint	North double doors between room 102 and 101	0.224	--	--
1-2-PB-5	10/11/2021	White paint	West wall next to window in room 107	1.830	--	120 sq. ft.
1-2-PB-6	10/11/2021	White paint	North wall of room 107	1.630	--	120 sq. ft.
1-3-PB-7	10/11/2021	Off-white paint	East wall of room 106T	ND	--	--
1-4-PB-8	10/11/2021	White paint	South wall east of window in room 104	0.181	0.27	--
1-4-PB-9	10/11/2021	White paint	West wall south of window in room 104	0.175	--	--
1-4-PB-10	10/11/2021	White paint	East side of north wall in room 105	0.211	--	--
1-5-PB-11	10/11/2021	Silver	South side of east wall on south boiler in room 101	ND	--	--
1-6-PB-12	10/11/2021	Green paint	Hydraulic drive on northwest side of south middle boiler in room 101	0.326	--	--
1-7-PB-13	10/11/2021	Red paint	Floor on south side of room in front of double door between room in room 101	0.188	0.24	--

**Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
1-8-PB-14	10/11/2021	Red paint	West metal support beam next to fire extinguisher in room 101	5.000	--	15 sq. ft.
First Floor						
1-9-PB-15	10/11/2021	White paint	West metal support beam above fire extinguisher in room 101	5.000	--	3,000 sq. ft.
1-10-PB-16	10/11/2021	Red paint	Steam pipe in southwest corner of room 101	0.616	--	--
1-11-PB-17	10/11/2021	Green paint	Mirror above sink in southwest corner of room 101	0.472	--	--
1-12-PB-18	10/11/2021	White paint	Southwest corner of room 101	0.013	--	--
1-13-PB-19	10/11/2021	Red paint	Pipe on west side of southwest boiler in room 101	0.092	--	--
1-14-PB-20	10/11/2021	Yellow paint	Northwest corner of southwest boiler in room 101	5.000	--	600 ln. ft.
1-15-PB-21	10/11/2021	Orange paint	West wall north of double door in room 101	2.360	--	30 ln. ft.
1-16-PB-22	10/11/2021	Brown paint	West wall north of double door in room 101	0.015	--	--
1-9-PB-23	10/11/2021	White paint	Metal support beam on west wall north of double door in room 101	5.000	--	3,000 sq. ft.
1-17-PB-24	10/11/2021	Bright orange paint	Steam pipe on west side of northwest boiler in room 101	0.121	--	--
1-18-PB-25	10/11/2021	Red paint	Brick on southwest corner of northwest boiler in room 101	ND	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
1-19-PB-26	10/11/2021	Gray paint	Support pole in northwest corner of room 101	0.111	--	--
1-20-PB-27	10/11/2021	Silver paint	Northwest support beam of northwest boiler in room 101	2.470	--	3,000 ln. ft.
1-20-PB-28	10/11/2021	Silver paint	Northeast support beam of northwest boiler in room 101	1.660	2.00	3,000 ln. ft.
1-14-PB-29	10/11/2021	Yellow paint	North pipe on the northwest corner of north middle boiler in room 101	5.000	--	600 ln. ft.
First Floor						
1-14-PB-30	10/11/2021	Yellow paint	North concrete bench west of north door in room 101	2.830	--	600 ln. ft.
1-21-PB-31	10/11/2021	Brown paint	Pipe on north wall between northeast and north middle boiler in room 101	3.520	--	70 ln. ft.
1-21-PB-32	10/11/2021	Brown paint	Pipe north of north middle boiler in room 101	1.208	--	70 ln. ft.
1-20-PB-33	10/11/2021	Silver paint	Support beam on northwest corner of northeast boiler in room 101	0.040	--	3,000 ln. ft.
1-5-PB-34	10/11/2021	Silver paint	North side of northeast boiler in room 101	ND	--	--
1-12-PB-35	10/11/2021	White paint	Northeast corner of room 101	ND	--	--
1-6-PB-36	10/11/2021	Green paint	East side of northeast boiler in room 101	0.503	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
1-14-PB-37	10/11/2021	Yellow paint	Pipe between southeast and south middle boiler in room 101	5.000	--	600 ln. ft.
1-6-PB-38	10/11/2021	Green paint	Green pipe on south end of south middle boiler in room 101	0.375	--	--
1-12-PB-39	10/11/2021	White paint	Southeast corner of room 101	0.068	--	--
1-22-PB-40	10/11/2021	Dark green paint	Green cabinet in the southeast corner of room 101	1.068	--	64 sq. ft.
1-23-PB-41	10/11/2021	Light gray paint	Light gray cabinet in southeast corner of room 101	0.048	--	--
Mezzanine						
2-1-PB-1	10/12/2021	White paint	Southeast corner of room in room 203	0.180	--	--
2-1-PB-2	10/12/2021	White paint	Northeast corner of room in room 204	0.043	--	--
2-2-PB-3	10/12/2021	Tan paint	Catwalk in room 200S outside of room 202	0.085	--	--
2-2-PB-4	10/12/2021	Tan paint	Catwalk in room 200S outside of room 201	0.219	--	--
2-3-PB-5	10/12/2021	Dark tan paint	Cabinet inside doorway in room 201	0.330	--	--
2-3-PB-6	10/12/2021	Dark tan paint	Cabinet on north wall in room 201	0.268	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
2-4-PB-7	10/12/2021	Yellow paint	Yellow pipe on first catwalk, west side of room 101	3.220	--	600 ln. ft.
2-4-PB-8	10/12/2021	Yellow paint	Yellow pipe on first catwalk, west side of room 101	4.940	--	600 ln. ft.
2-5-PB-9	10/12/2021	Light green paint	Light green pipe on first catwalk in center of room 101	0.242	--	--
2-5-PB-10	10/12/2021	Light green paint	Light green pipe on first catwalk in center of room 101	0.108	--	--
2-6-PB-11	10/12/2021	Silver paint	Silver pipe on first catwalk in center of room 101	ND	--	--
2-4-PB-12	10/12/2021	Yellow paint	Yellow pipe on first catwalk, east side of room 101	3.280	--	600 ln. ft.
Mezzanine						
2-7-PB-13	10/12/2021	Red paint	Red pipe on first catwalk, east side of room 101	1.980	--	750 ln. ft.
2-8-PB-14	10/12/2021	Reddish brown paint	Red pipe on first catwalk, east side of room 101	0.075	--	100 ln. ft.
2-9-PB-15	10/12/2021	Gray paint	Gray corrugated boiler siding on second catwalk, east side of room 101	ND	--	--
2-5-PB-16	10/12/2021	Light green paint	Light green pipe on second catwalk on east side of room 101	0.036	--	--

**Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington**

Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
2-10-PB-17	10/12/2021	Gray paint	Gray railing on second catwalk on east side of room 200	0.007	--	--
2-11-PB-18	10/12/2021	Tan paint	Tan boiler part on second catwalk on east side of room 200	0.101	--	--
2-9-PB-19	10/12/2021	Gray paint	Gray boiler siding on second catwalk, east side of room 200	0.035	--	--
2-12-PB-20	10/12/2021	Gray paint	Gray door frame on second catwalk, east side of room 200	0.517	--	--
2-13-PB-21	10/12/2021	Red paint	Red pipe on west side of Boiler 4 in room 200	ND	--	--
2-11-PB-22	10/12/2021	Tan paint	Tan mechanical part in room 204	ND	--	--
2-14-PB-23	10/12/2021	Blue paint	Blue mechanical part in room 204	ND	--	--
2-7-PB-24	10/12/2021	Red paint	Red pipe	1.164	15.0	750 ln. ft.
2-8-PB-25	10/12/2021	Red paint	Red pipe on first catwalk, east side of room 101	ND	--	100 ln. ft.
Upper Mezzanine						
3-1-PB-1	10/13/2021	Red paint	Catwalk above coal hopper by staircase in room 301	0.136	--	--
3-1-PB-2	10/13/2021	Red paint	Catwalk above coal hopper by staircase in room 301	0.160	--	--
3-2-PB-3	10/13/2021	Gray paint	Catwalk above coal hopper by staircase in room 301	5.000	--	700 ln. ft.

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
3-2-PB-4	10/13/2021	Gray paint	Catwalk above coal hopper by staircase in room 301	5.000	--	700 ln. ft.
3-3-PB-5	10/13/2021	Brown paint	Catwalk above coal hopper by staircase in room 301	ND	--	--
3-3-PB-6	10/13/2021	Brown paint	Catwalk above coal hopper by staircase in room 301	ND	--	--
3-4-PB-7	10/13/2021	Silver paint	On equipment by east side door in room 302	ND	--	--
3-4-PB-8	10/13/2021	Silver paint	On equipment by east side door in room 302	ND	--	--
3-5-PB-9	10/13/2021	Red paint	By west side door in room 302	0.528	--	--
3-6-PB-10	10/13/2021	Tan paint	By west side door in room 302	0.531	--	--
3-6-PB-11	10/13/2021	Tan paint	By west side door in room 302	0.922	--	--
3-6-PB-12	10/13/2021	Tan paint	By staircase in room 302	0.920	0.063	--
3-7-PB-13	10/13/2021	Tan paint	East door in room 302	ND	--	--
3-7-PB-14	10/13/2021	Tan paint	West door in room 302	ND	--	--
3-8-PB-15	10/13/2021	Brown paint	Southeast corner of room 302	ND	--	--
3-9-PB-16	10/13/2021	Dark gray paint	Highest catwalk, southeast side of room 303M	ND	--	--
3-9-PB-17	10/13/2021	Dark gray paint	Highest catwalk, southeast side of room 303M	ND	--	--
3-10-PB-18	10/13/2021	Red paint	Downstairs below room 303M catwalk	0.095	--	--
3-11-PB-19	10/13/2021	Silver paint	Highest catwalk in room 200	ND	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
Basement						
4-1-PB-1	10/13/2021	Light green paint	East wall south of door between room 17 and 21	0.336	--	--
4-1-PB-2	10/13/2021	Light green paint	Paint chip on floor next to bathroom stall in room 17	0.237	--	--
4-2-PB-3	10/13/2021	Red paint	Pipe in southwest corner of room 21	ND	--	--
4-3-PB-4	10/13/2021	Red paint	Tank on north wall of room 21 east of entrance to room 11	1.346	2.30	145 ln. ft.
4-4-PB-5	10/13/2021	Silver paint	Silver pipe support on north ceiling of room 21	0.024	--	--
4-5-PB-6	10/13/2021	Gray paint	Cabinet in center of room 21 north of room 22	0.063	--	--
4-2-PB-7	10/13/2021	Red paint	Pipe in southwest corner of room 21	ND	--	--
4-6-PB-8	10/13/2021	Blue gray paint	Door frame to room 18	0.086	--	--
4-7-PB-9	10/13/2021	Silver paint	Tank in southeast corner of room 18	5.000	--	5 ln. ft.
4-8-PB-10	10/13/2021	Orange paint	Pipe underneath tank in southeast corner of room 18	5.000	--	10 ln. ft.
4-9-PB-11	10/13/2021	White paint	South side of stairway in room 18A	0.300	--	--
4-10-PB-12	10/13/2021	Gray paint	Pipe in west side of room 18A	0.085	--	--
4-11-PB-13	10/13/2021	Red paint	Red fire extinguisher marking paint on northwest corner of room 21	ND	--	--
4-12-PB-14	10/13/2021	Gray paint	Door to room 15	4.110	--	24 sq. ft.

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-13-PB-15	10/13/2021	Light tan paint	Paint under new paint on door to room 15	3.400	--	24 sq. ft.
4-14-PB-16	10/13/2021	Orange paint	Orange pipe on south wall of room 21 west of room 22	5.000	--	600 ln. ft.
Basement						
4-15-PB-17	10/13/2021	White paint	White paint on orange pipe on south wall of room 21 west of room 22	5.000	--	2 ln. ft.
4-16-PB-18	10/13/2021	Tan paint	East wall of room 22	ND	--	--
4-17-PB-19	10/13/2021	Yellow paint	Yellow caution paint above doorway to room 11	ND	--	--
4-3-PB-20	10/13/2021	Red paint	Red pipe in southwest corner of room 23	ND	--	145 ln. ft.
4-14-PB-21	10/13/2021	Orange paint	Orange pipe on east wall of room 23	3.700	--	600 ln. ft.
4-18-PB-22	10/13/2021	Yellow paint	Yellow pipe in northeast corner of room 23	0.305	--	--
4-19-PB-23	10/13/2021	Blue paint	Blue pipe in northeast corner of room 23	0.306	--	--
4-16-PB-24	10/13/2021	Tan paint	Tan paint on northwest corner of wall in room 23	ND	--	--
4-2-PB-25	10/13/2021	Red paint	Red pipe wrap on the south side of room 23	0.919	--	--
4-20-PB-26	10/13/2021	Green paint	Green equipment on south side of room 23	0.908	--	--
4-14-PB-27	10/13/2021	Orange paint	Orange pipe in southwest corner of room 11	3.320	--	600 ln. ft.
4-16-PB-28	10/13/2021	Tan paint	Support beam in southwest center of room 11	ND	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-21-PB-29	10/13/2021	White paint	White pipe wrap on west side of room 11 east of sun basement entrance	ND	--	--
Basement						
4-4-PB-30	10/13/2021	Silver paint	Silver support on west side of room 11 east of sun basement entrance	ND	--	--
4-22-PB-31	10/13/2021	Yellow paint	Yellow pipe on east side of room 11 east of door to sub basement	5.000	--	140 ln. ft.
4-23-PB-32	10/13/2021	Bright white paint	Support in northwest corner of room 11	5.000	0.22	280 ln. ft.
4-4-PB-33	10/13/2021	Silver paint	Silver painted equipment on west side of room 11 north of sub basement door	ND	--	--
4-23-PB-34	10/13/2021	White paint	Support on north side of room 11 east of active tank	0.146	--	264 ln. ft.
4-23-PB-35	10/13/2021	White paint	North side of room 11 south of active tank	5.000	--	280 ln. ft.
4-24-PB-36	10/13/2021	Green paint	North side of room 11 north of northwest boiler	0.241	0.80	100 ln. ft.
4-22-PB-37	10/13/2021	Yellow paint	North side of room 11 north of northwest boiler	3.670	--	140 ln. ft.
4-3-PB-38	10/13/2021	Red paint	Northwest corner of room 11	2.010	--	145 ln. ft.
4-19-PB-39	10/13/2021	Blue paint	Northwest corner of room 11 south of window	0.084	--	--
4-24-PB-40	10/13/2021	Green paint	Northwest corner of room 11	ND	--	100 ln. ft.

**Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington**

Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-25-PB-41	10/13/2021	Reddish brown paint	Drain pipe in northwest corner of room 11 west of active tank	ND	--	--
4-14-PB-42	10/13/2021	Orange paint	Orange pipe in northwest corner of room 11 west of active tank	5.000	--	600 ln. ft.
Basement						
4-3-PB-43	10/13/2021	Red paint	Red pipe on the north side of room 11 south of active tank	5.000	--	145 ln. ft.
4-14-PB-44	10/13/2021	Orange paint	Northeast corner of room 11 west of exit doorway	2.430	--	600 ln. ft.
4-17-PB-45	10/13/2021	Yellow paint	Yellow concrete block in northeast corner of room 11 south of exit doorway	ND	--	--
4-24-PB-46	10/13/2021	Green paint	East side of room 11 east of northeast boiler	1.178	--	100 ln. ft.
4-4-PB-47	10/13/2021	Silver paint	Underside of lid on southwest face of northeast boiler in room 11	0.071	--	--
4-22-PB-48	10/13/2021	Yellow paint	Center of room 11 east of southwest boiler	4.380	--	140 ln. ft.
4-23-PB-49	10/13/2021	Bright white paint	Support in center of room 11 between the two north boilers	5.000	--	280 ln. ft.
4-14-PB-50	10/13/2021	Orange paint	Orange tank in center of room 11 between the two north boilers	1.223	15.0	600 ln. ft.

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-16-PB-51	10/13/2021	White paint	Support beam on south side of room 11 east of green air equipment	0.005	--	--
4-2-PB-52	10/13/2021	Red paint	Red wrapped pipe on south wall of room 11	ND	--	--
4-24-PB-53	10/13/2021	Green paint	Green pipe and equipment on south side of room 11 east of entrance to room 21	0.220	--	100 ln. ft.
Basement						
4-11-PB-54	10/13/2021	Red paint	Red fire extinguisher marking in southeast corner of room 11 north of spiral staircase	ND	--	--
4-14-PB-55	10/13/2021	Orange paint	Orange pipe wrap in southeast corner of room 11 north of spiral staircase	1.275	--	600 ln. ft.
4-26-PB-56	10/13/2021	Silver paint	Silver pipe wrap southeast corner of room 11	ND	--	--
4-14-PB-57	10/13/2021	Orange paint	Southeast corner of room 11 east of doorway	4.490	--	600 ln. ft.
4-24-PB-58	10/13/2021	Green paint	Southwest corner of room 11	0.084	--	100 ln. ft.
4-25-PB-59	10/13/2021	Reddish brown paint	Southeast corner of room 11 west of southeast boiler	0.069	--	--
4-1-PB-60	10/13/2021	Light green paint	Paint on south wall of room 17	0.014	--	--
4-1-PB-61	10/13/2021	Light green paint	Southwest corner of room 17	0.135	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-27-PB-62	10/13/2021	Tan paint	East side of center wall of room 17 next to mirror	0.008	--	--
Subbasement						
5-1-PB-1	10/14/2021	Yellow paint	West hall entrance of room B1	0.023	--	110 ln. ft.
5-1-PB-2	10/14/2021	Yellow paint	Center of hallway of room B1	ND	4.3	110 ln. ft.
5-1-PB-3	10/14/2021	Yellow paint	East end of hallway of room B1	2.080	--	110 ln. ft.
5-2-PB-4	10/14/2021	Orange paint	Center of room B3	1.012	--	5 ln. ft
5-3-PB-5	10/14/2021	Brown paint	East wall at end of hall of room B1	0.080	--	--
5-3-PB-6	10/14/2021	Brown paint	East end in the center of hall of room B1	ND	--	--
5-4-PB-7	10/14/2021	Reddish brown paint	Center of hallway of room B1	ND	--	--
Exterior						
EXT-1-PB-1	10/14/2021	Brownish red paint	Southwest support beam of ash pit outside of room 101	1.470	1.60	272 ln. ft.
EXT-1-PB-2	10/14/2021	Brownish red paint	Northeast support beam of ash pit outside of room 101	1.150	--	272 ln. ft.
EXT-2-PB-3	10/14/2021	Dark brown red paint	Vent on west exterior side of room 101 in between double doors	0.120	--	--
EXT-3-PB-4	10/14/2021	Tan paint	Double doors on west exterior side of room 101	0.058	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
EXT-4-PB-5	10/14/2021	Green paint	Railing on west exterior side of room 101 in front of double doors	0.173	--	--
EXT-5-PB-6	10/14/2021	Silver paint	Silver pipe on west exterior side of room 101 and south of double doors	1.213	--	25 In. ft.
EXT-6-PB-7	10/14/2021	Blue gray paint	Blue gray pipe in corner of exterior side of room 101 and south of double doors	0.071	--	25 In. ft.

NOTES:
 Samples were analyzed consistent with U.S. Environmental Protection Agency Method 3051/7000B.
 -- = not applicable.
 % = percent (milligrams per kilogram/10000)
 'In. ft. = linear feet.
 mg/cm² = milligrams per square centimeter.
 ND = none detected.
 XRF = X-ray fluorescence.

FIGURES





Figure 3-1 First Floor and Exterior Sampling Locations - Asbestos

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Legend

● Asbestos

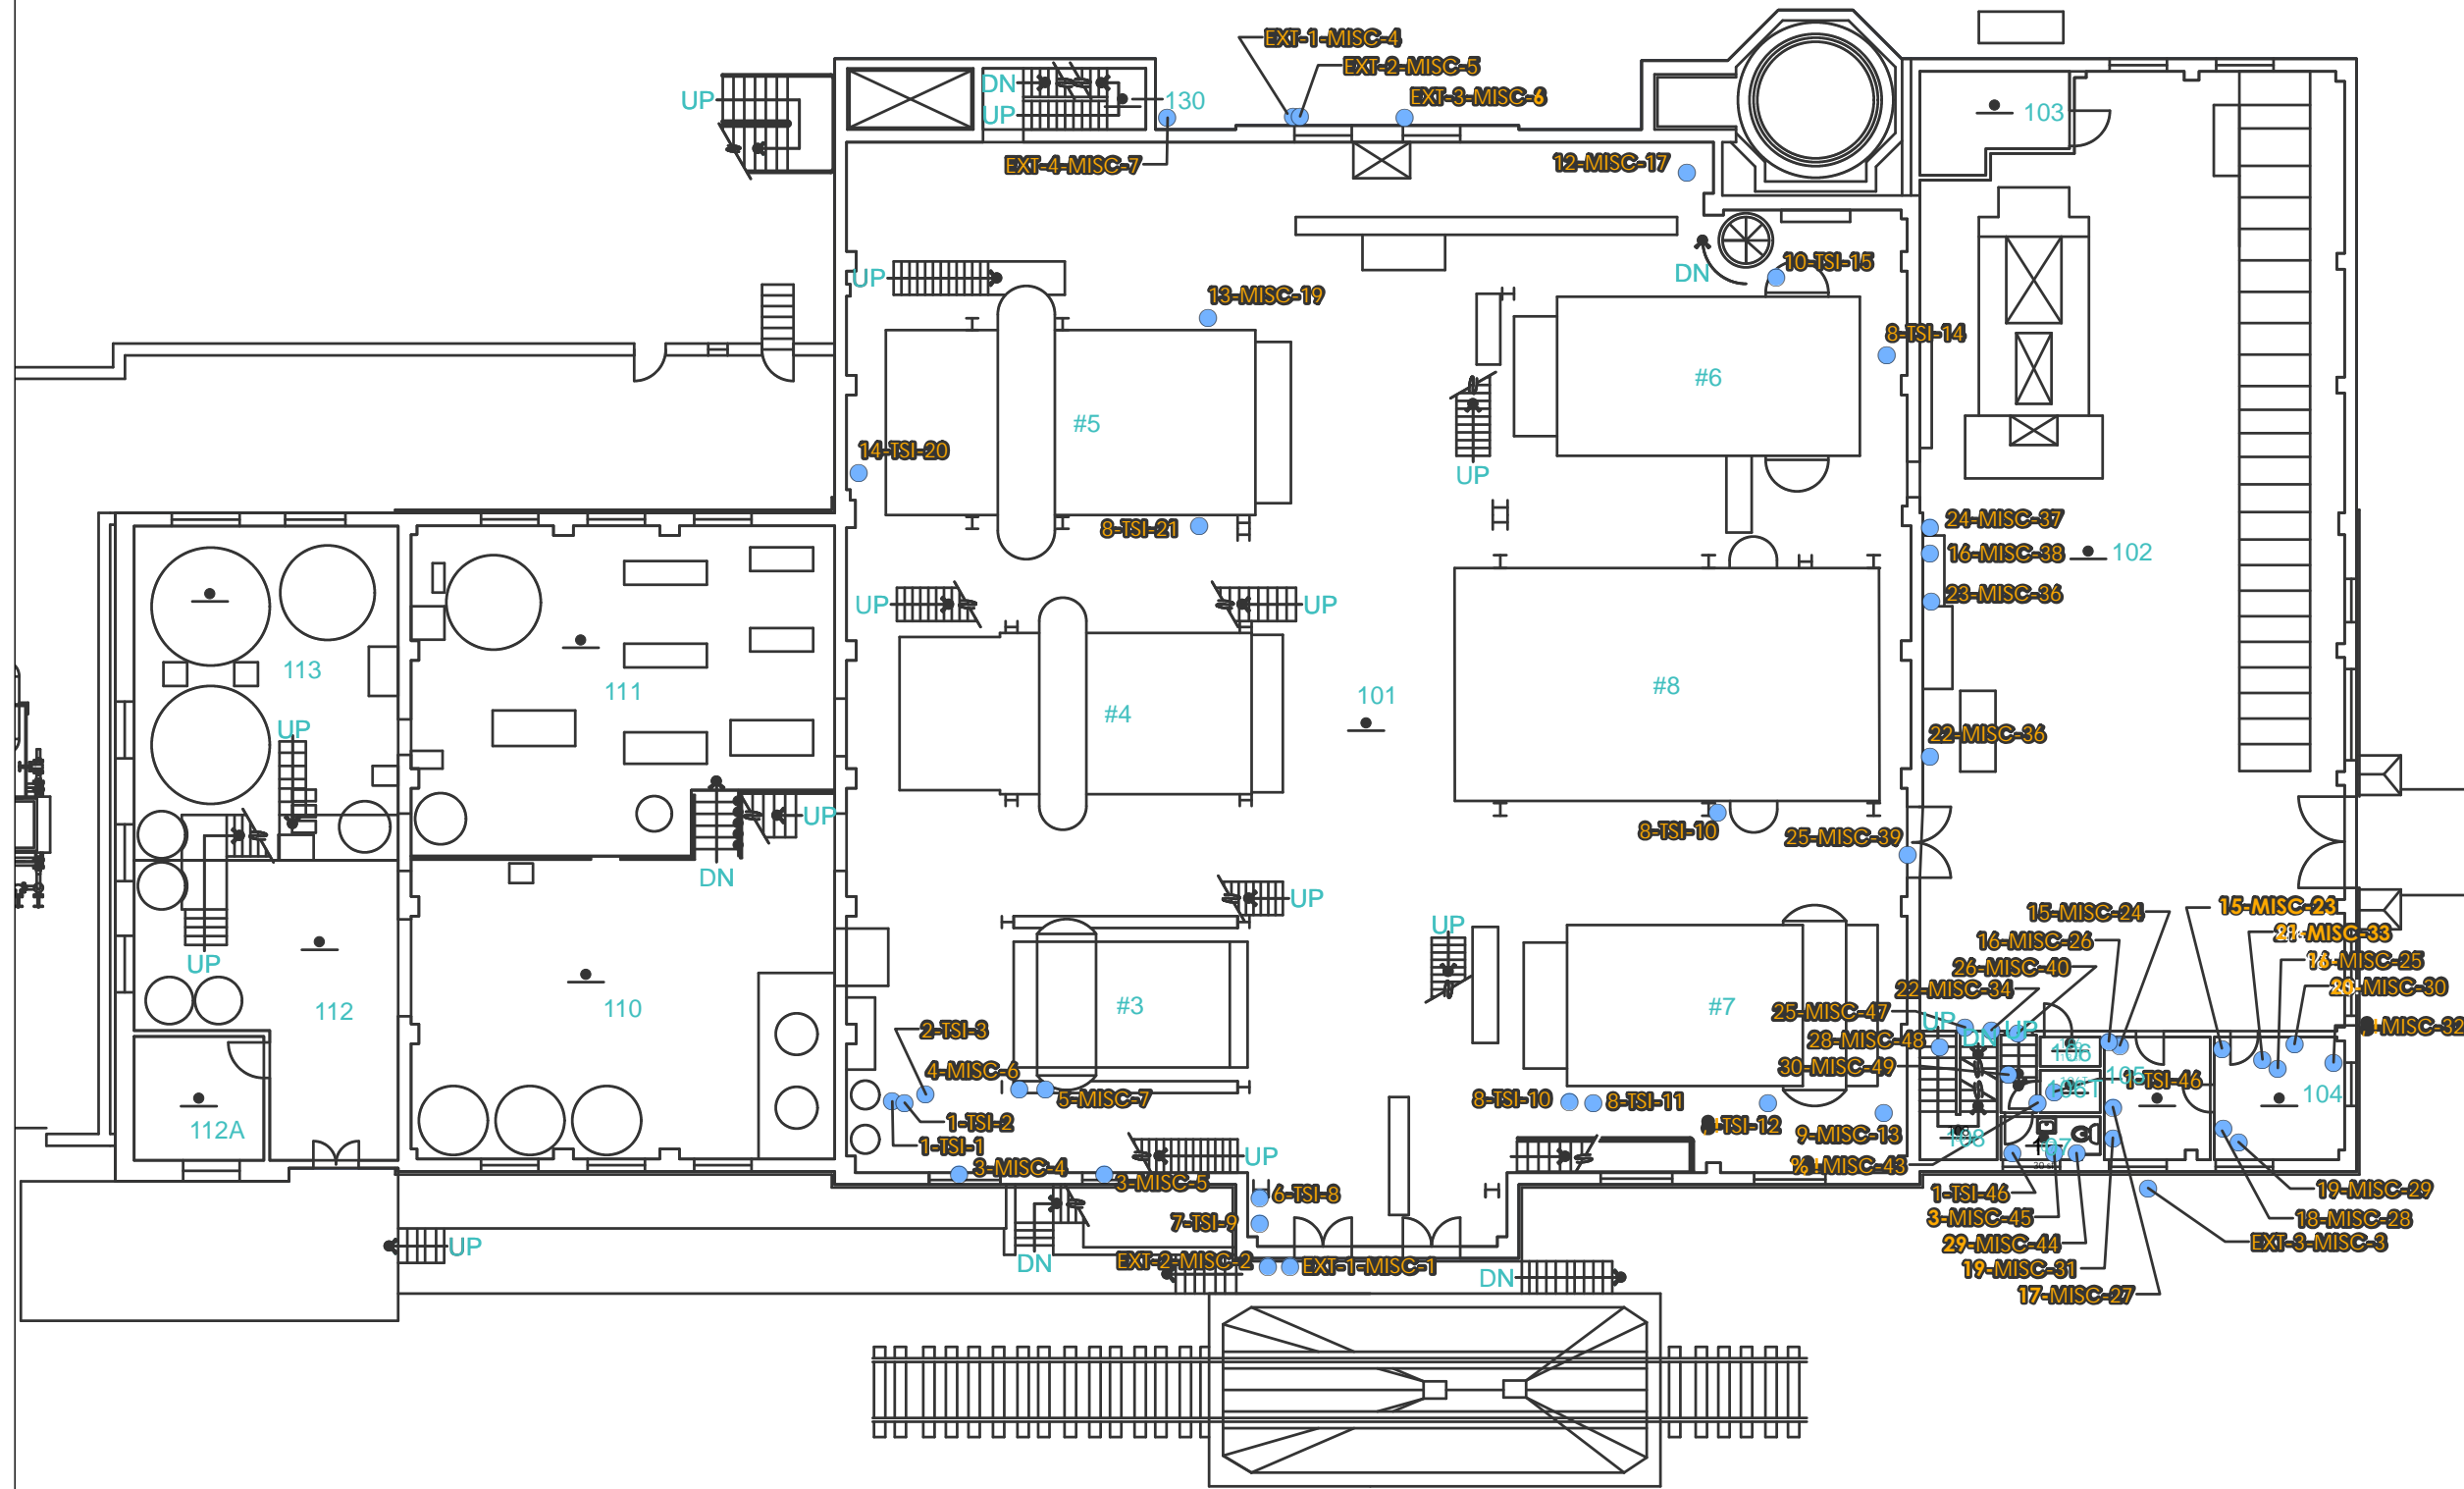

Source:
CAD data obtained from Washington State University.

 MAUL FOSTER LONGI
p. 971 544 2139 | www.maulfooster.com



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

Figure 3-3 Upper Mezzanine Sampling Locations - Asbestos

College Avenue Steam Plant Port
of Whitman County Pullman,
Washington

Legend

● Asbestos

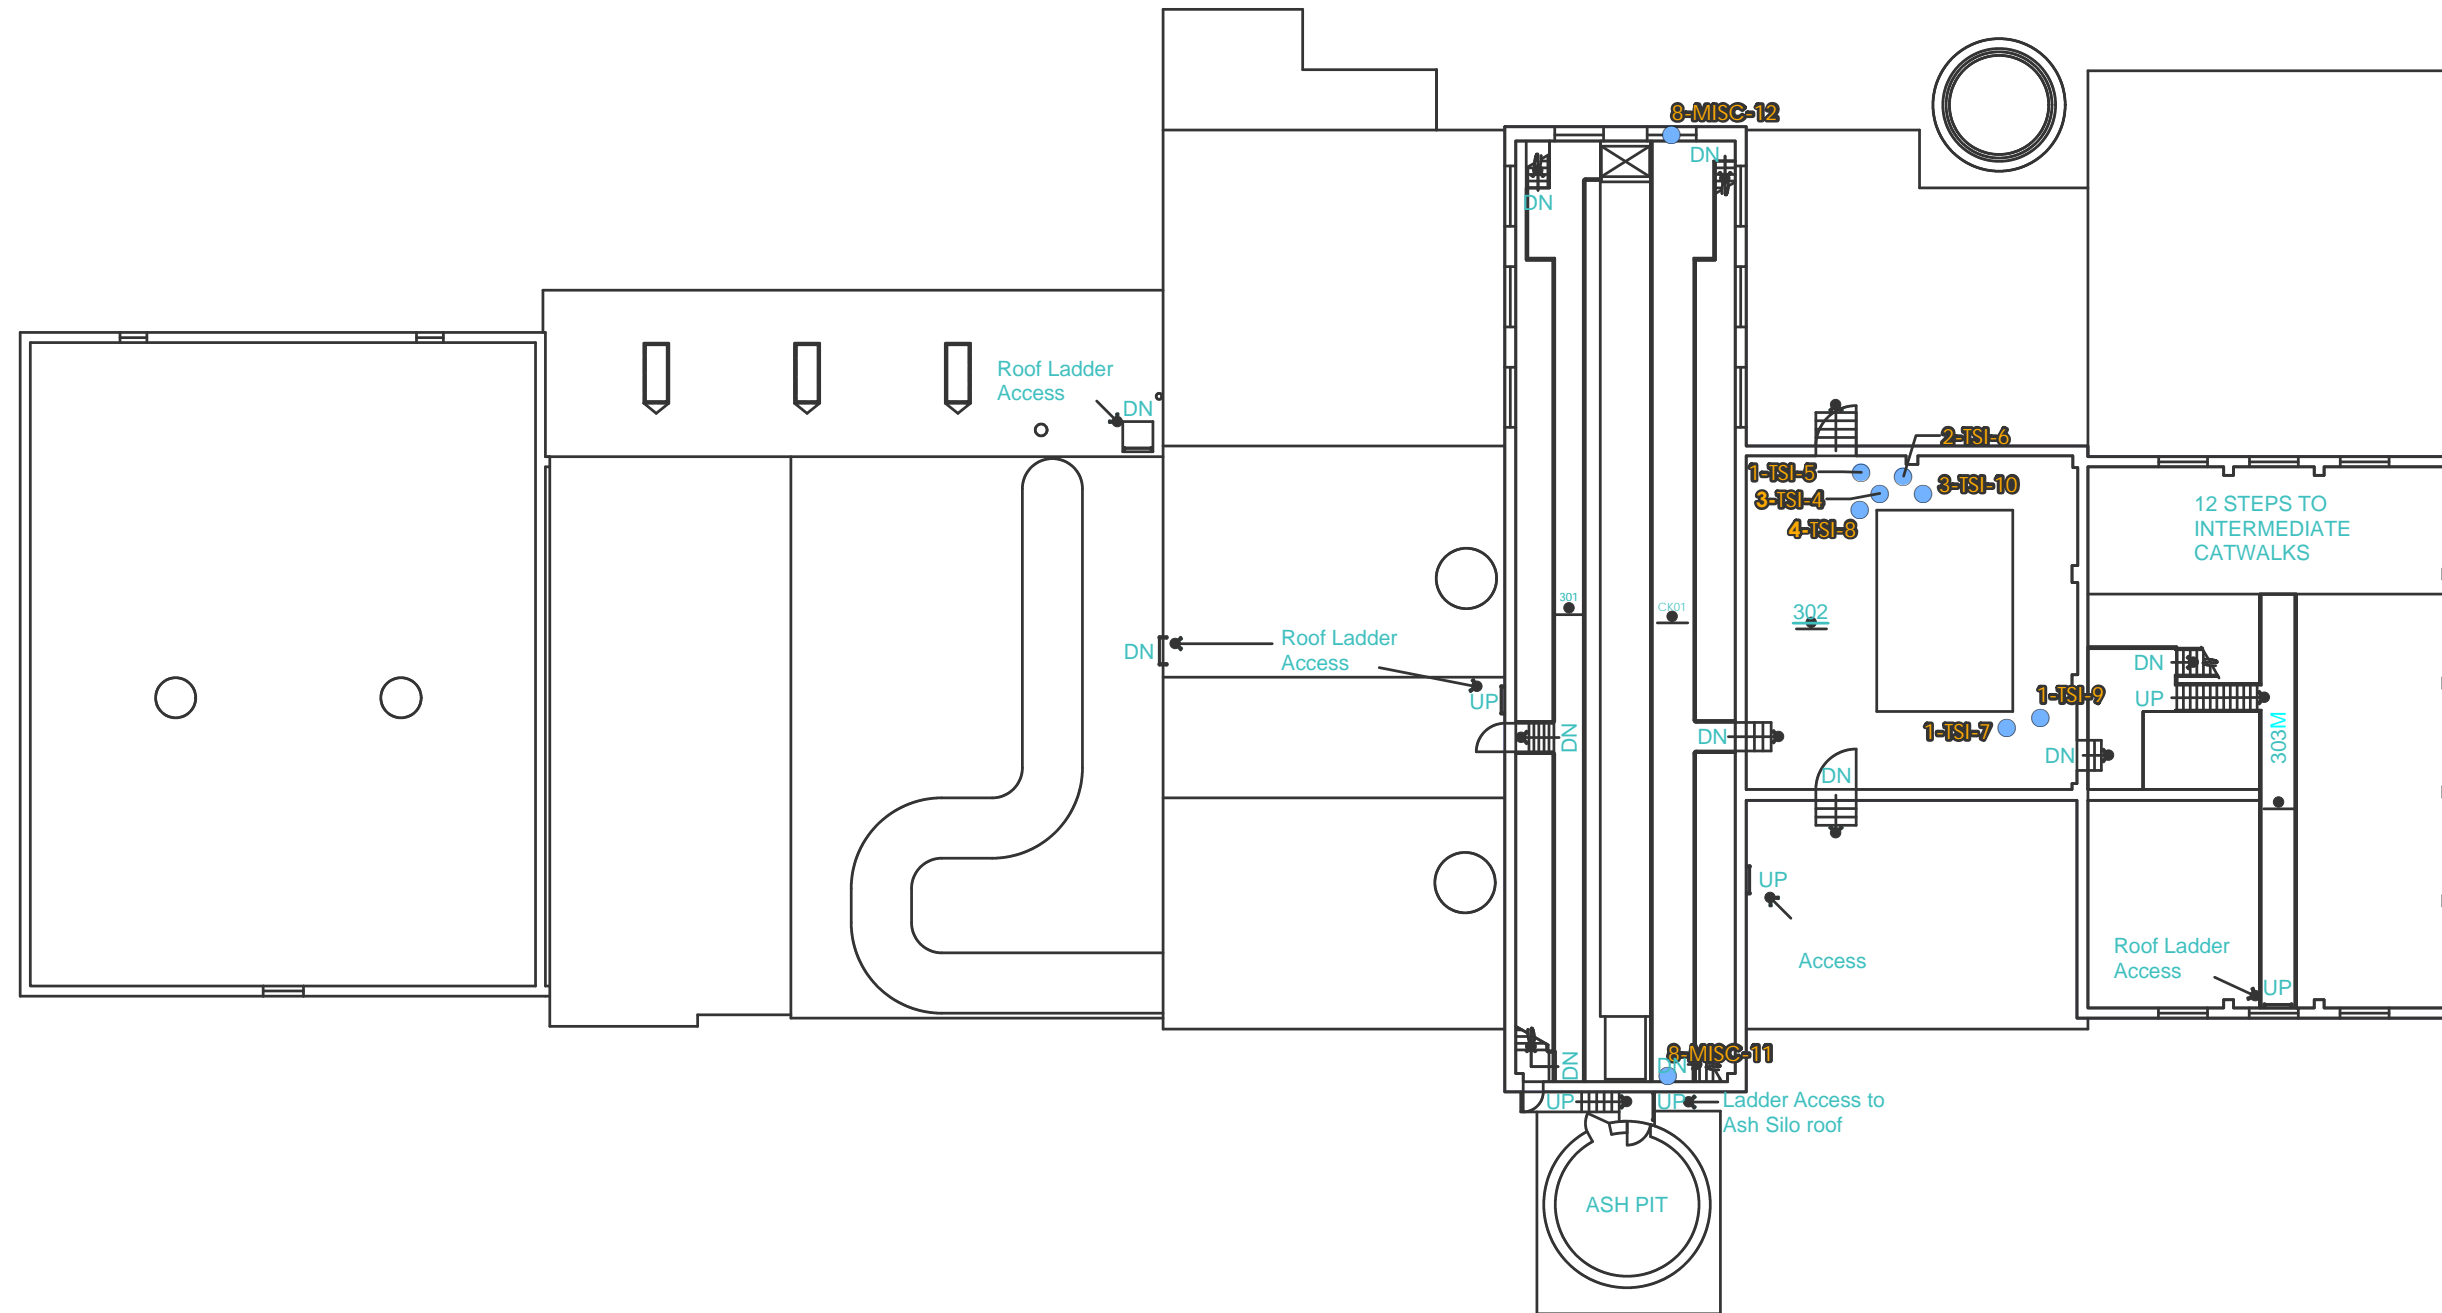

Source:
CAD data obtained from Washington State University.



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

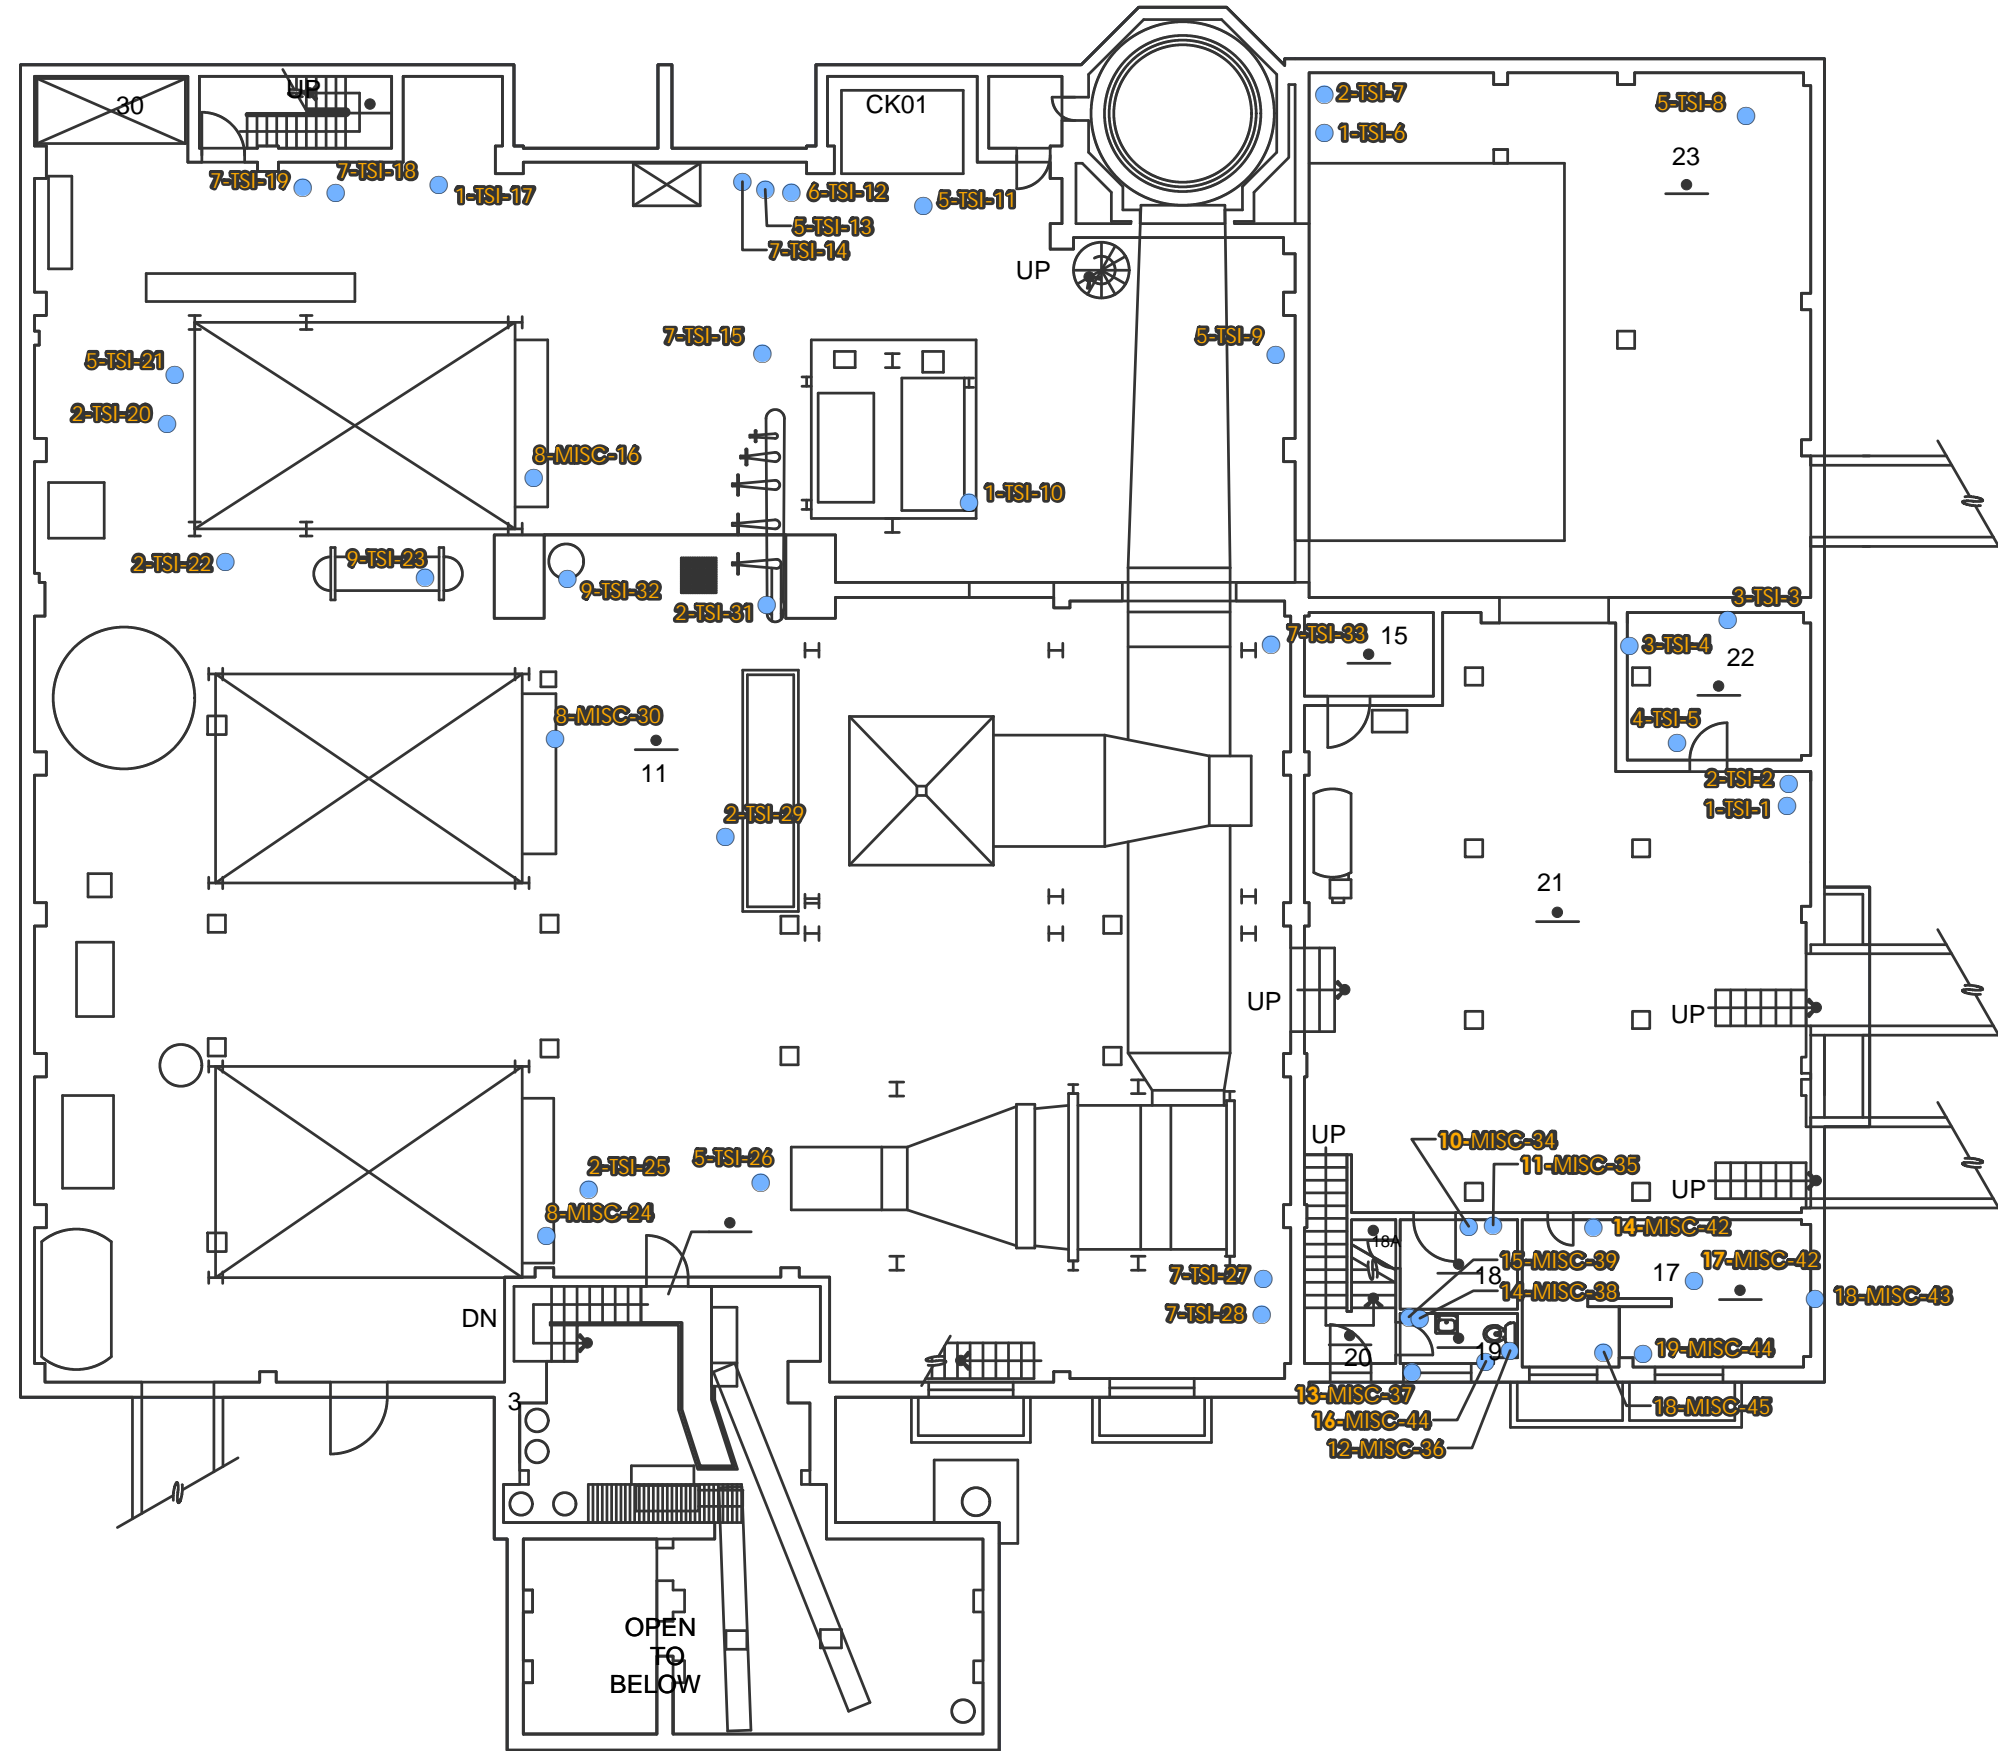


Figure 3-4
Basement Sampling
Locations - Asbestos

College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington

Legend
 ● Asbestos



Source:
 CAD data obtained from Washington State University.

MAULFOSTER ALONGI
 p. 971 544 2139 | www.maulfooster.com



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

Figure 3-5 First Floor and Exterior Sampling Locations - Lead

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Legend

● Lead

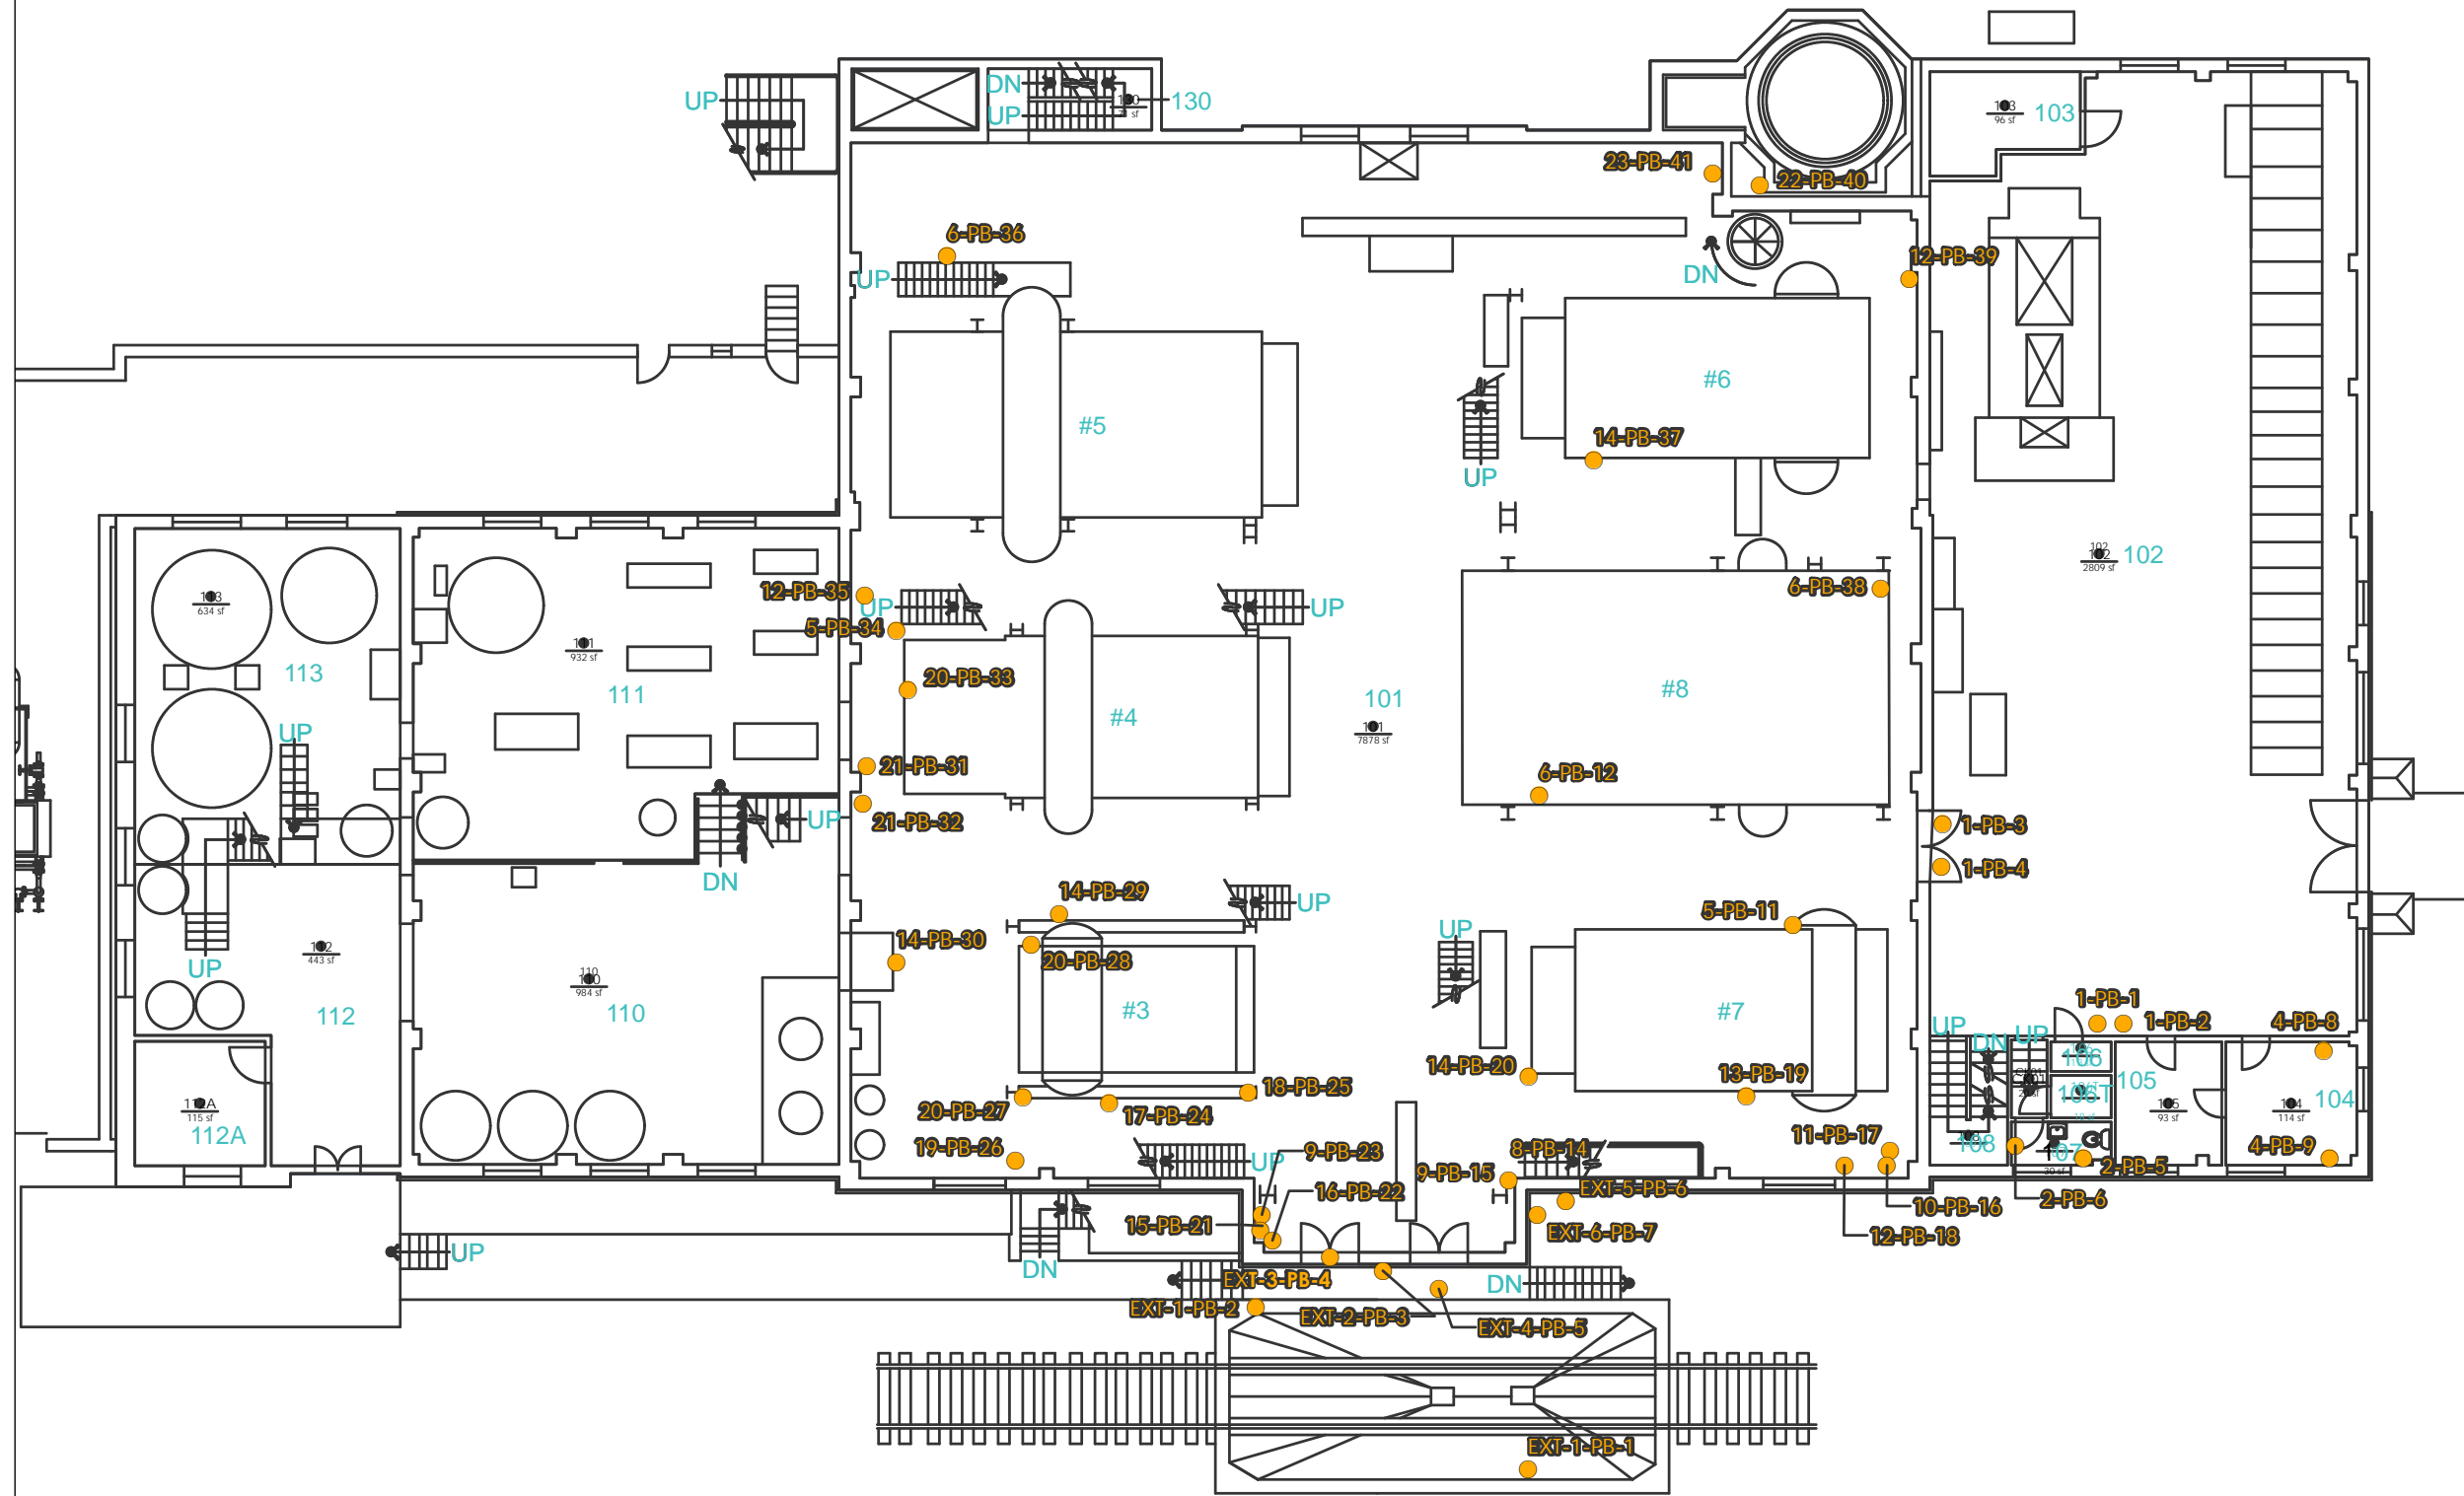

Source:
CAD data obtained from Washington State University.

 MAUL FOSTER LONGI
p. 971 544 2139 | www.maulfooster.com



This product is for informational purposes and may not have been prepared for, or be suitable for, legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

Figure 3-7 Upper Mezzanine Sampling Locations- Lead

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Legend

● Lead

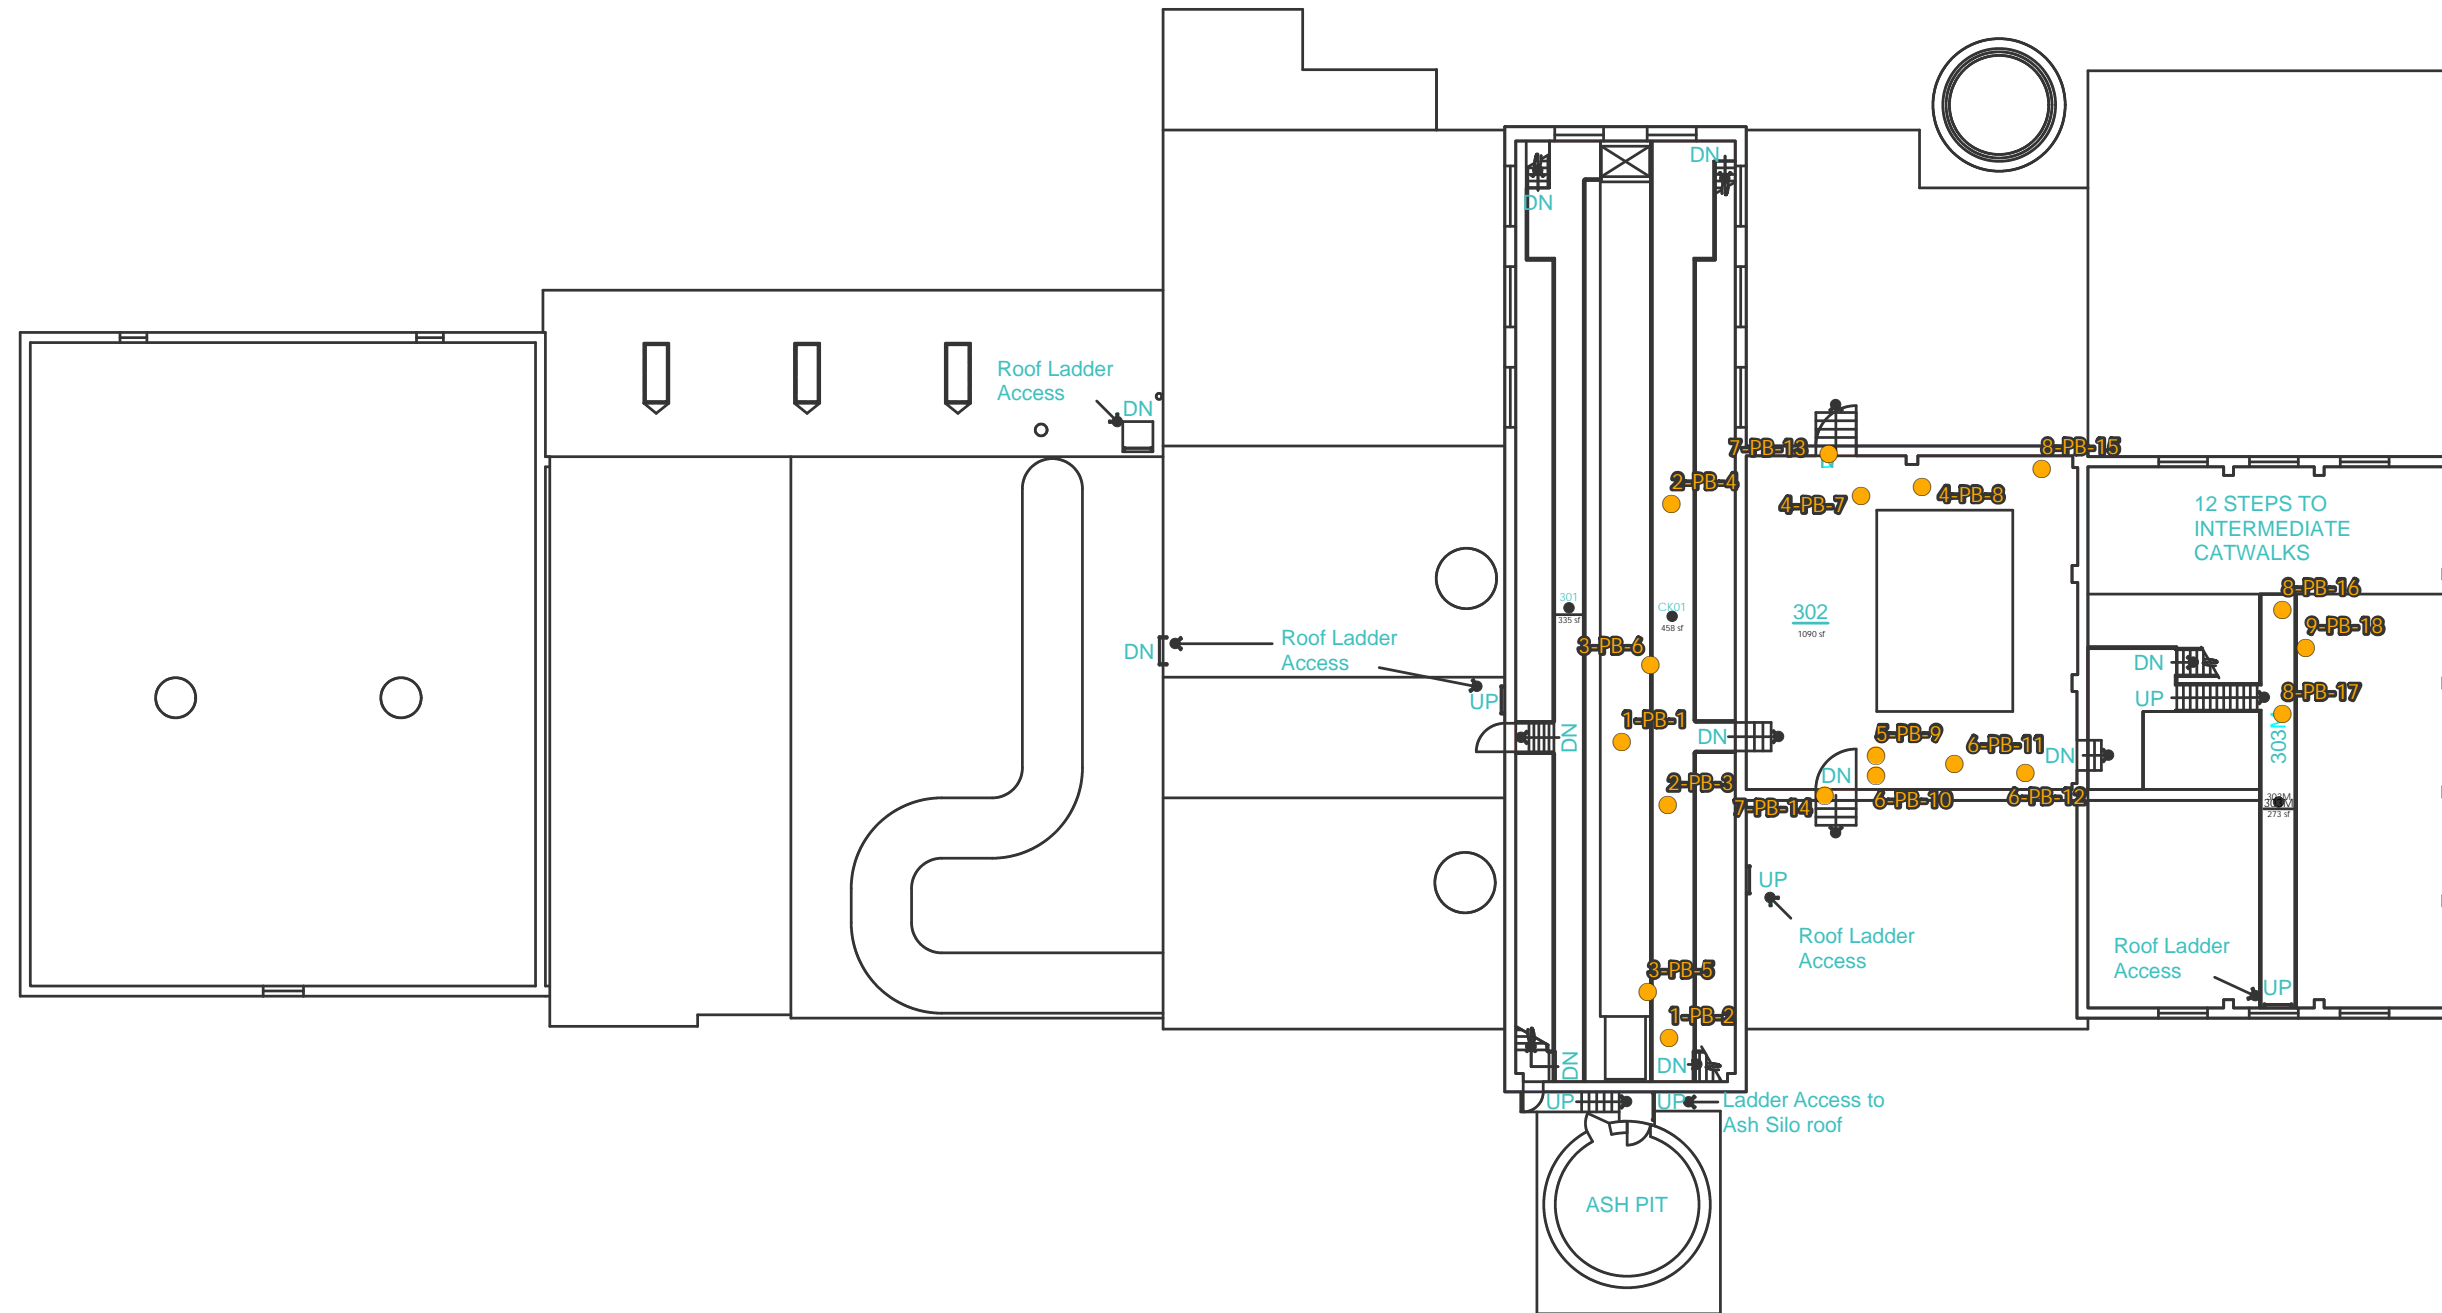

Source:
CAD data obtained from Washington State University.



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

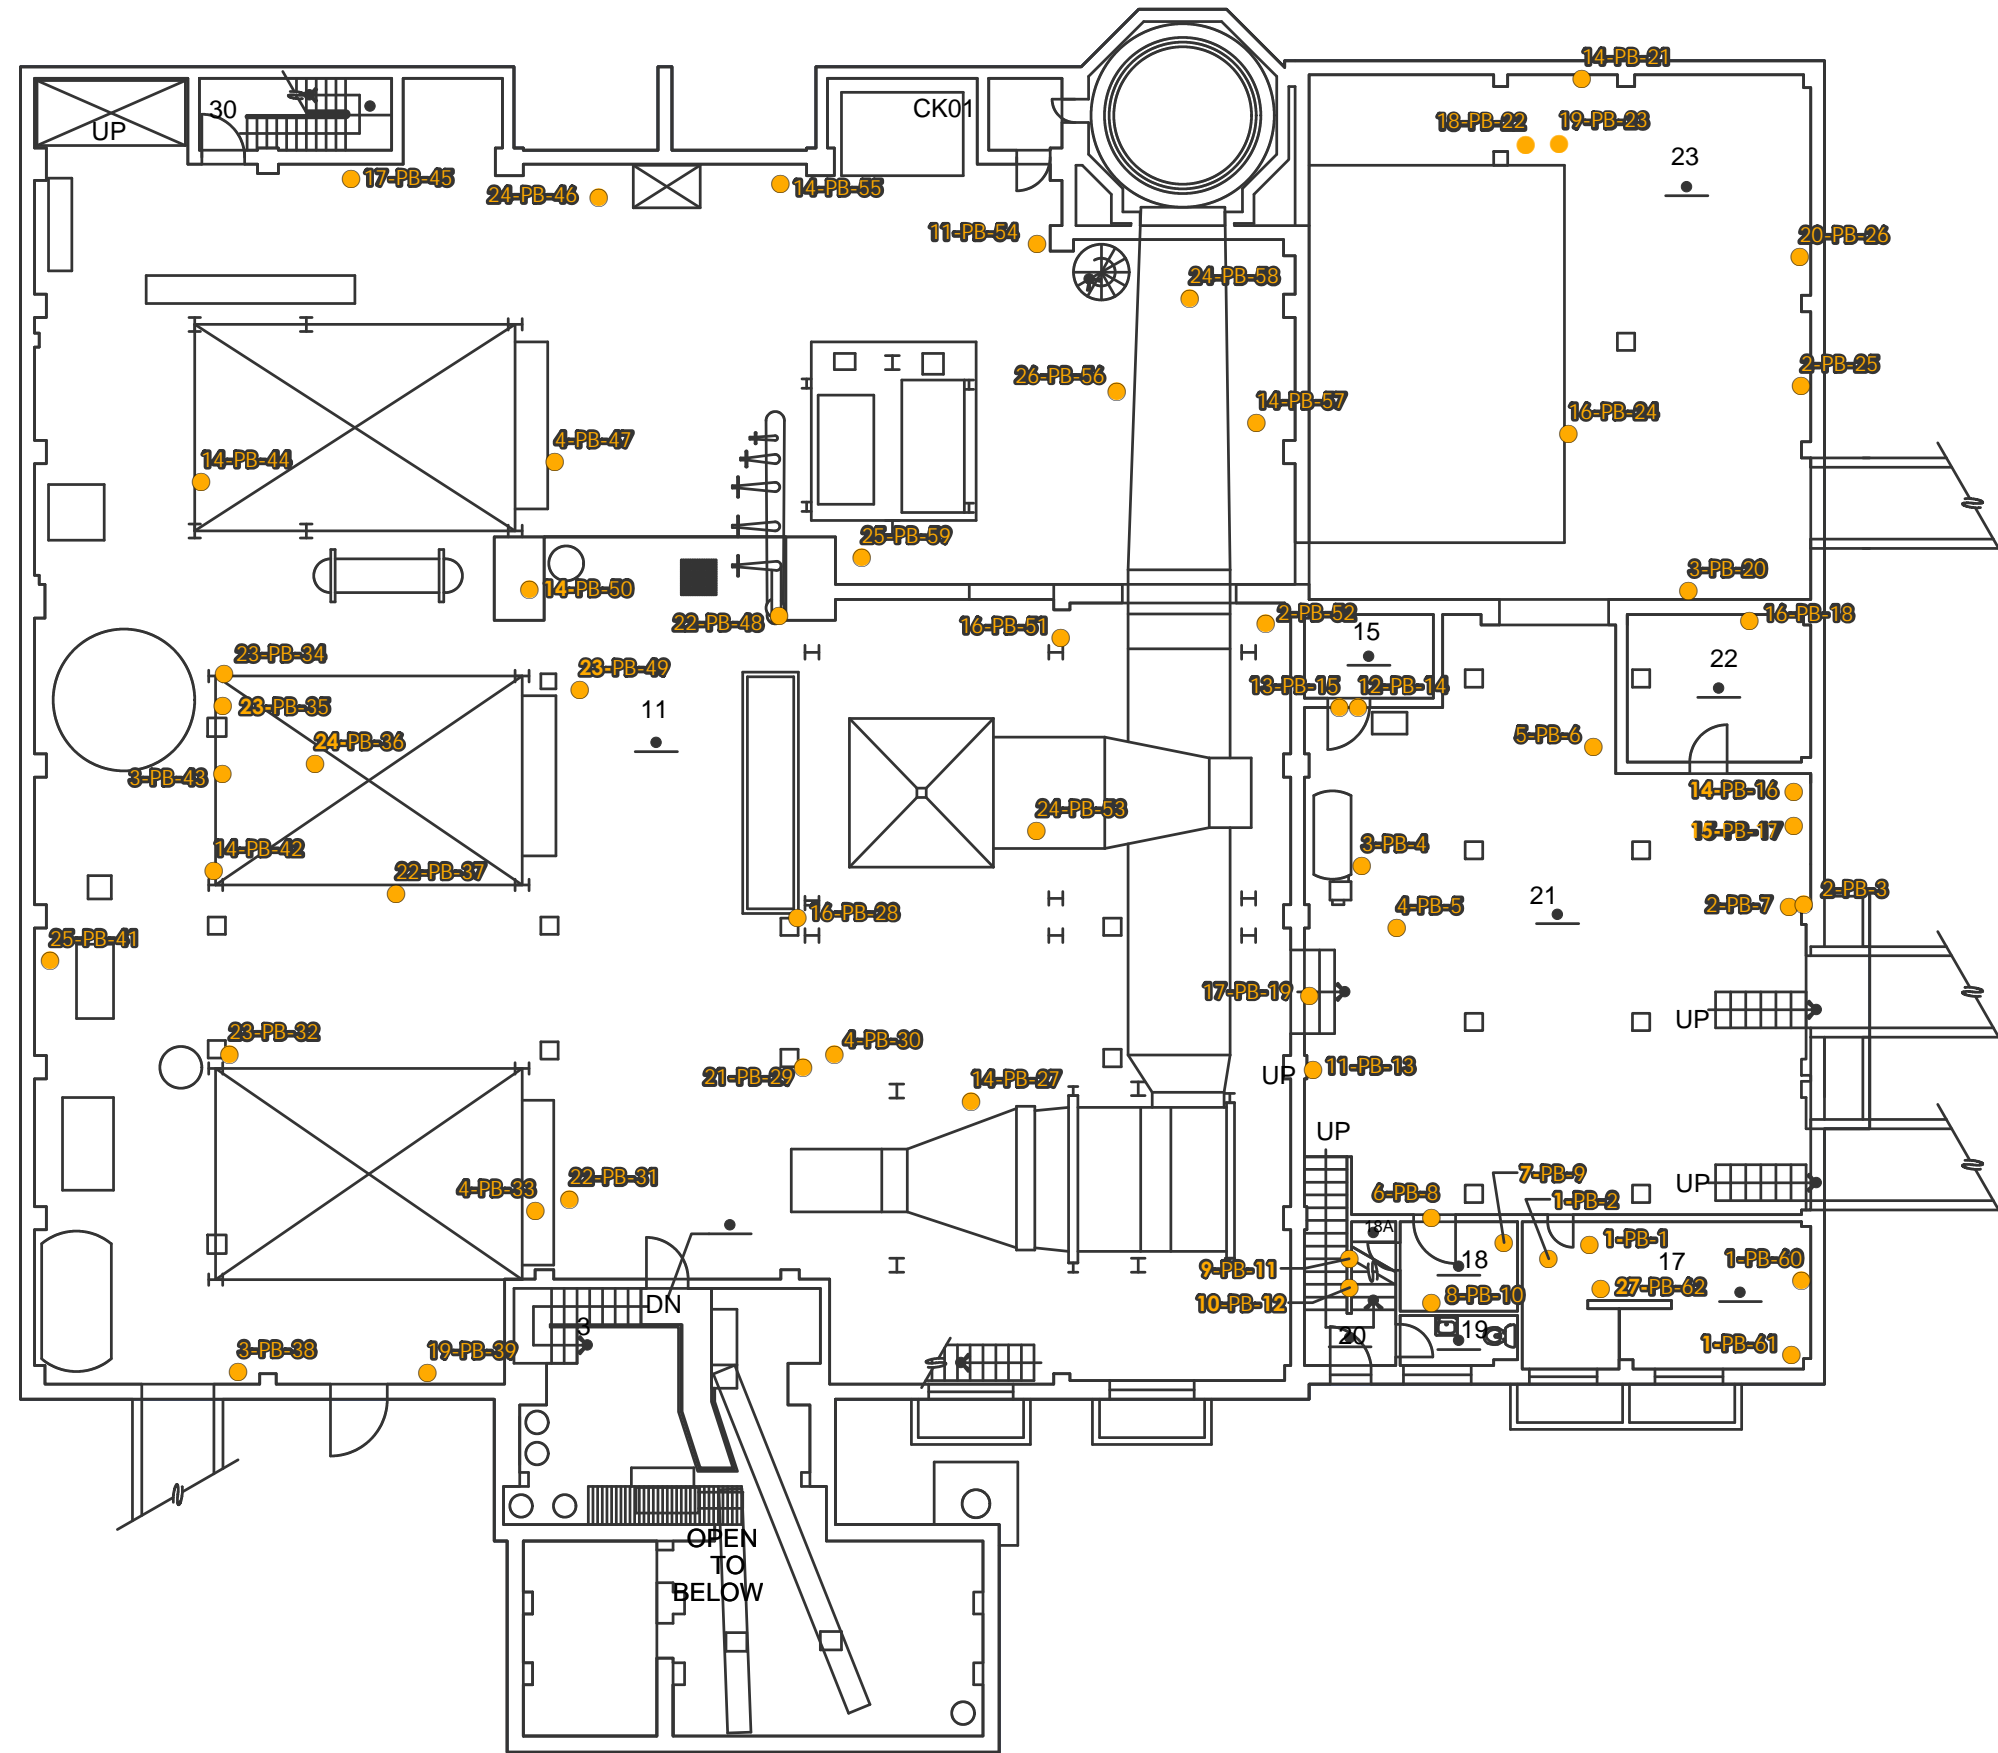


Figure 3-8
Basement Sampling
Locations - Lead

College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington

Legend
 ● Lead



Source:
 CAD data obtained from Washington State University.



This product is for informational purposes and may not have been prepared for, or be suitable for, legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.


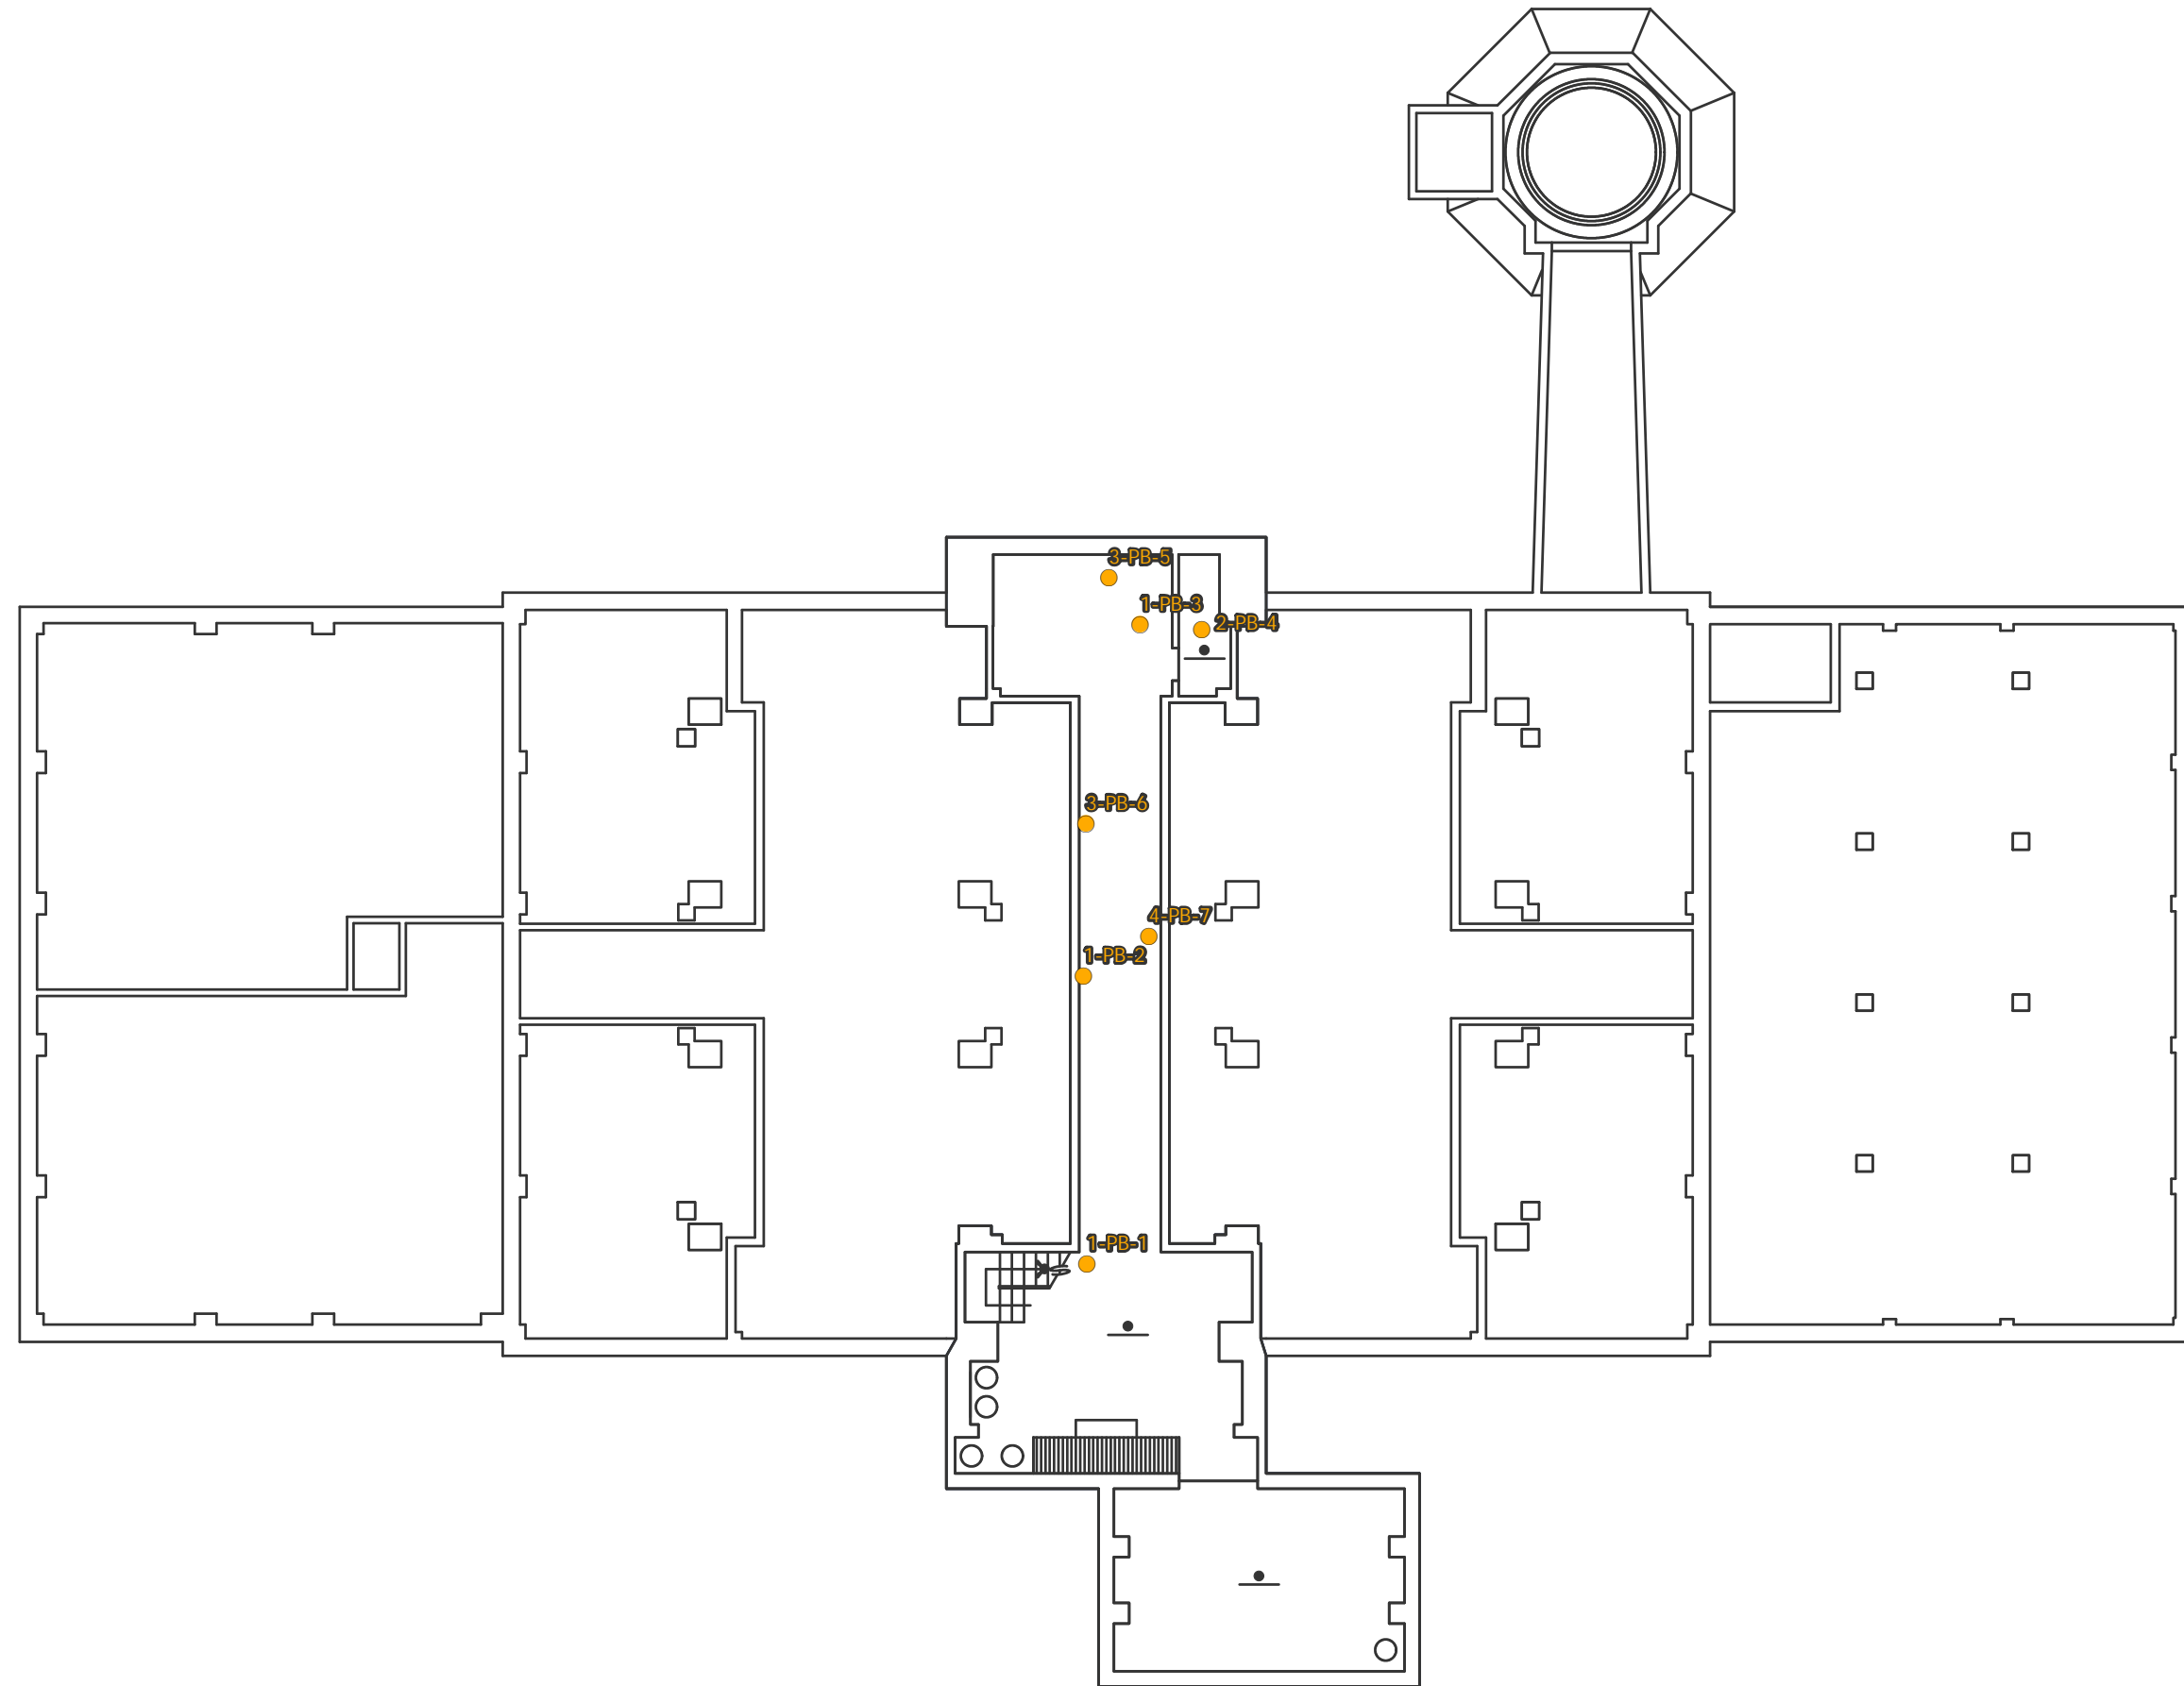


Figure 3-9
Subbasement Sampling
Locations - Lead

College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington

Legend

● Lead



Source:
 CAD data obtained from Washington State University.

 MAUL FOSTER ALONGI
 p. 971 544 2139 | www.maulfoster.com

This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

APPENDIX A

AHERA CERTIFICATES



THIS IS TO CERTIFY THAT
CONNOR ANDERSON
HAS SUCCESSFULLY COMPLETED THE TRAINING COURSE
for
ASBESTOS INSPECTOR INITIAL COURSE

In accordance with TSCA Title II, Part 763, Subpart E, Appendix C of 40 CFR

Course Date: 8/16/2021 - 8/18/2021
Course Location: Portland, OR
Certificate: IN-21-9554B



CCB #SRA0614 24-Hr Training

24-Hour AHERA Inspector Training; AHERA is the Asbestos Hazard Emergency Response Act enacting Title II of Toxic Substance Control Act (TSCA)

Expiration Date: 08/18/2022

For verification of the authenticity of this certificate contact:
PBS Engineering and Environmental Inc.
4412 S Corbett Avenue
Portland, Oregon 97239
503.248.1939

A handwritten signature in black ink that reads "Andy Fridley".

Andy Fridley, Instructor

THIS IS TO CERTIFY THAT

EMILY CURTIS

HAS SUCCESSFULLY COMPLETED THE TRAINING COURSE

for

ASBESTOS INSPECTOR REFRESHER

In accordance with TSCA Title II, Part 763, Subpart E, Appendix C of 40 CFR

Course Date: 01/21/2021

Course Location: Portland, OR

Certificate: IR-21-6100B



CCB #SRA0615 4-Hr Training

4-Hour AHERA Inspector Refresher Training; AHERA is the Asbestos Hazard Emergency Response Act enacting Title II of Toxic Substance Control Act (TSCA)

Expiration Date: 01/21/2022

For verification of the authenticity of this certificate contact:

PBS Engineering and Environmental Inc.
4412 S Corbett Avenue
Portland, Oregon 97239
503.248.1939

A handwritten signature in black ink that reads "Andy Fridley".

Andy Fridley, Instructor

THIS IS TO CERTIFY THAT
SEAN MALONEY
HAS SUCCESSFULLY COMPLETED THE TRAINING COURSE
for
ASBESTOS INSPECTOR INITIAL COURSE

In accordance with TSCA Title II, Part 763, Subpart E, Appendix C of 40 CFR

Course Date: 12/16/2020 - 12/18/2020

Course Location: Portland, OR

Certificate: IN-20-8991B



CCB #SRA0614 24-Hr Training

24-Hour AHERA Inspector Training; AHERA is the Asbestos Hazard Emergency Response Act enacting Title II of Toxic Substance Control Act (TSCA)

Expiration Date: 12/18/2021

For verification of the authenticity of this certificate contact:
PBS Engineering and Environmental Inc.
4412 S Corbett Avenue
Portland, Oregon 97239
503.248.1939

A handwritten signature in black ink, reading "Andy Fridley", is written over a horizontal line.

Andy Fridley, Instructor

APPENDIX B

FIELD SAMPLING DATA SHEETS




HBM Survey

Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/11/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	First Floor

Samples

Sample ID:	Sample Type:	
1-1-TSI-1	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Condensate pipe in northwest corner of room.	
Sample Quantity:	38 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

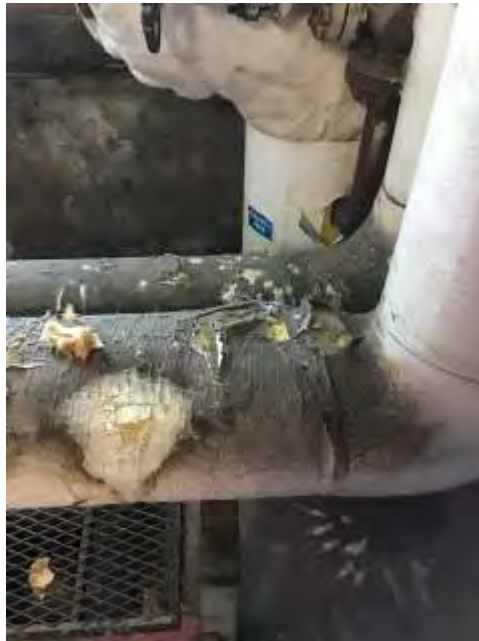

1-1-TSI-1



Additional Sample Notes:		White pipe wrapping with yellow insulation.
Sample ID:	Sample Type:	
1-1-TSI-2	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Condensate pipe in northwest corner of room.	
Sample Quantity:	38 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

1-1-TSI-2



Additional Sample Notes:

White pipe wrapping with yellow insulation.

Sample ID:

1-1-PB-1

Sample Type:

PB

Sample Location:

Room 102

Detailed Sample Location:

West wall between room 106 doorway and stairway.

Sample Quantity:

N/A

Sample Color:

XRF:

Tan

0.108

Sample Photo:




1-1-PB-1

Additional Sample Notes:

Sample ID:	Sample Type:
1-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room 102	West wall north of room 105 doorway.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.071

Sample Photo:

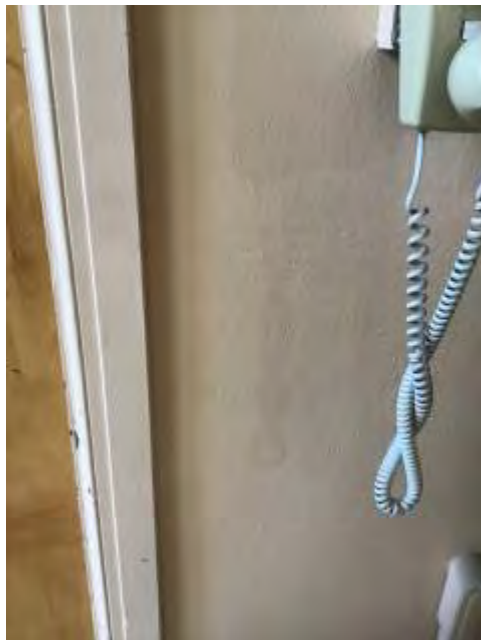

1-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
1-1-PB-3	PB
Sample Location:	Detailed Sample Location:
Room 102	North double doors between room 102 and 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.177

Sample Photo:



1-1-PB-3

Additional Sample Notes:

Sample ID:	Sample Type:
1-1-PB-4	PB
Sample Location:	Detailed Sample Location:
Room 102	North double door between room 102 and 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.224


Sample Photo:




1-1-PB-4

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-1-TSI-46	TSI	
Sample Location:	Detailed Sample Location:	
Room 107	Pipe in northwest corner of room 107.	
Sample Quantity:	38 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged; Potential ACBM with potential for significant damage	Yes

Sample Photo:



1-1-TSI-46

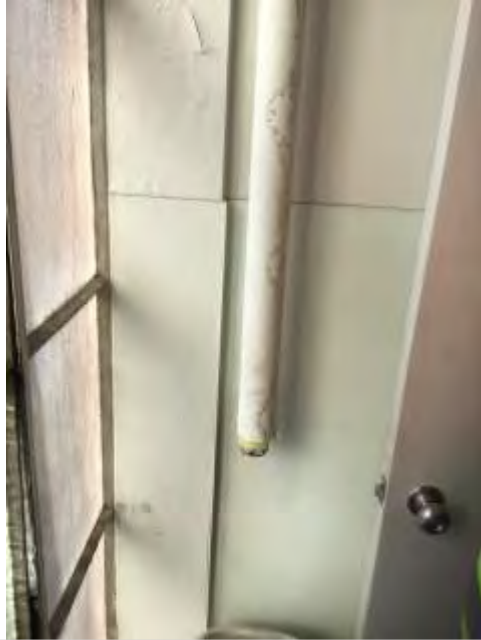

Additional Sample Notes:

Sample ID:

1-2-PB-5

Sample Location:

Room 107

Sample Quantity:

Sample Color:

White

Sample Type:

PB

Detailed Sample Location:


West wall next to window in room 107.

120 square feet.

XRF:

1.83

Sample Photo:

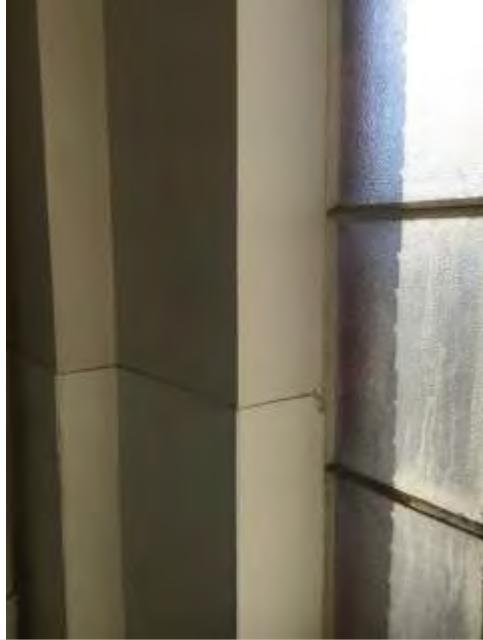

1-2-PB-5

Additional Sample Notes:

Sample ID:	Sample Type:
1-2-PB-6	PB
Sample Location:	Detailed Sample Location:
Room 107	North wall of room 107.
Sample Quantity:	120 square feet.
Sample Color:	XRF:
White	1.63

Sample Photo:



1-2-PB-6

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-2-TSI-3	TSI
-----------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Elbow on condensate pipe in northwest corner of room.
----------	---

Sample Quantity:	5 linear feet.
-------------------------	----------------

Sample Color:	XRF:
----------------------	-------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:



1-2-TSI-3



Additional Sample Notes:		White pipe covering with yellow insulation.
Sample ID:	Sample Type:	
1-3-MISC-4	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Window at northwest corner of room.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-3-MISC-4



Additional Sample Notes:

Sample ID:	Sample Type:	
1-3-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Window at west wall.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	Yes

Sample Photo:




1-3-MISC-5



Additional Sample Notes:

Sample ID:	Sample Type:
1-3-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 106T	East wall in room 106T.
Sample Quantity:	N/A
Sample Color:	XRF:
Off-white	ND

Sample Photo:

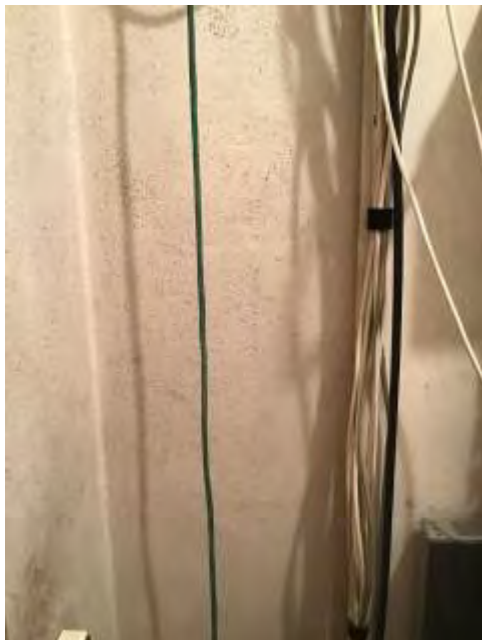

1-3-PB-7

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-3-MISC-45	MISC	
Sample Location:	Detailed Sample Location:	
Room 107	West wall window frame in room 107.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	No

Sample Photo:




1-3-MISC-45



Additional Sample Notes:

Sample ID:	Sample Type:
1-4-PB-8	PB
Sample Location:	Detailed Sample Location:
Room 104	South wall east of window in room 104.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.181

Sample Photo:

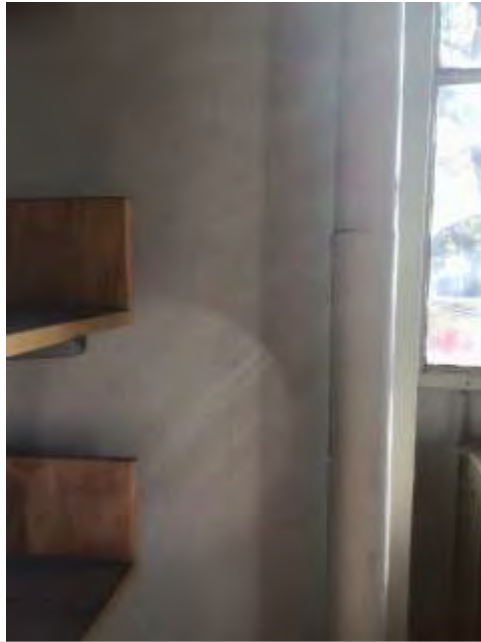


1-4-PB-8



Additional Sample Notes:	Submitted paint chip sample to laboratory for analysis.
---------------------------------	---

Sample ID:	Sample Type:
1-4-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 104	West wall south of window.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.175

Sample Photo:

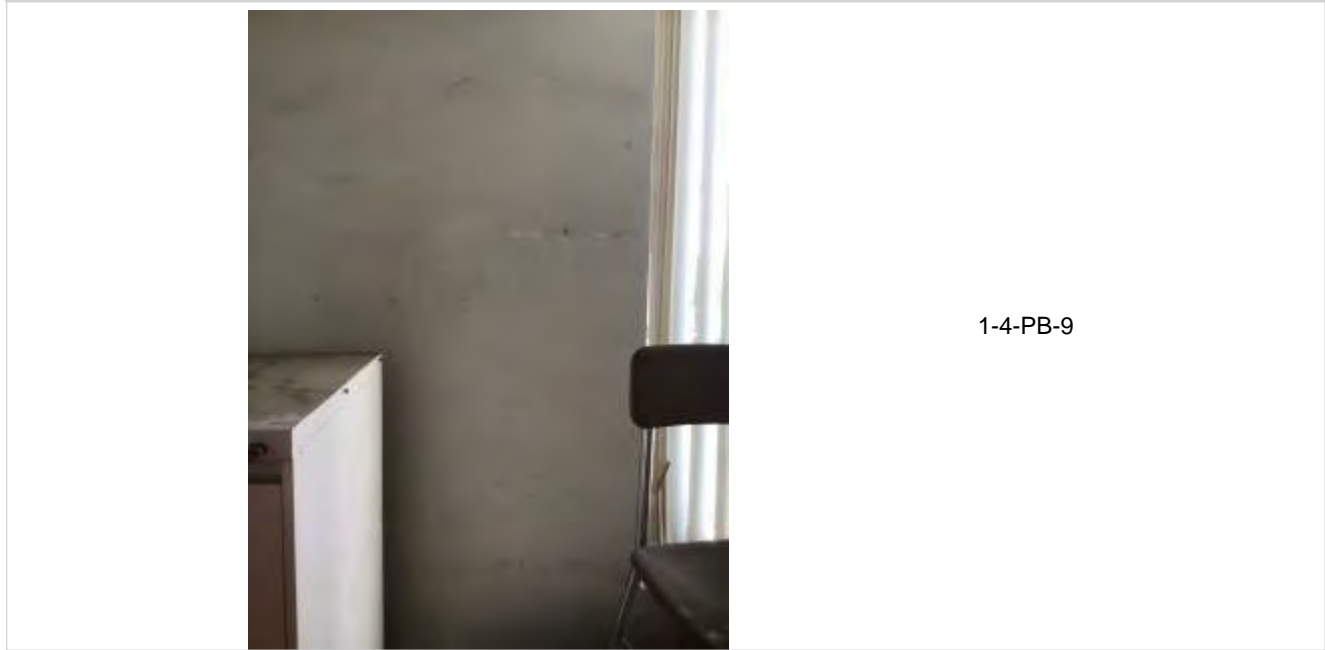

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-4-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 105	East side of north wall.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.211

Sample Photo:





1-4-PB-10

Additional Sample Notes:

Sample ID:	Sample Type:	
1-4-MISC-6	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Above red brick on northwest corner of northwest boiler.	
Sample Quantity:	3.5 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-4-MISC-6



Additional Sample Notes:

Sample ID:	Sample Type:	
1-5-MISC-7	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Red brick on northwest corner of northwest boiler.	
Sample Quantity:	8 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red brick.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-5-MISC-7



Additional Sample Notes:

Sample ID:

1-5-PB-11

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

South side of east wall on south boiler.

Sample Quantity:

N/A


Sample Color:

Silver

XRF:

ND

Sample Photo:

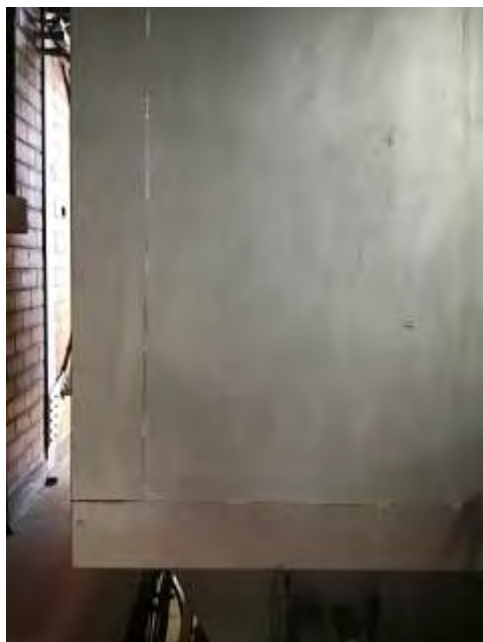

1-5-PB-11

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-5-PB-34	PB
Sample Location:	Detailed Sample Location:
Room 101	North side of northeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



1-5-PB-34

Additional Sample Notes:	Silver paint on various steam equipment in room 101.
---------------------------------	--

Sample ID:	Sample Type:
1-6-PB-12	PB
Sample Location:	Detailed Sample Location:
Room 101	Hydraulic Drive on northwest side of south middle boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.326

Sample Photo:




1-6-PB-12

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-6-TSI-8	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Red pipe by double doors on west side of room.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:

1-6-TSI-8

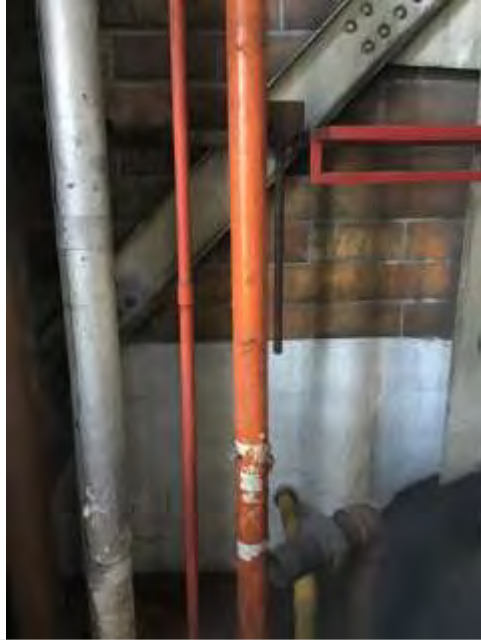

Additional Sample Notes:	Red pipe wrap with fibrous white insulation.
Sample ID:	Sample Type:
1-6-PB-38	PB
Sample Location:	Detailed Sample Location:
Room 101	Green pipe on south end of south middle boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.375

Sample Photo:



1-6-PB-38

Additional Sample Notes:

Sample ID:	Sample Type:
1-6-PB-36	PB
Sample Location:	Detailed Sample Location:
Room 101	East side of northeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.503


Sample Photo:



1-6-PB-36

Additional Sample Notes:	Green paint on various steam equipment in 101.	
Sample ID:	Sample Type:	
1-7-TSI-9	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Silver pipe by double doors on west side of room.	
Sample Quantity:	30 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:

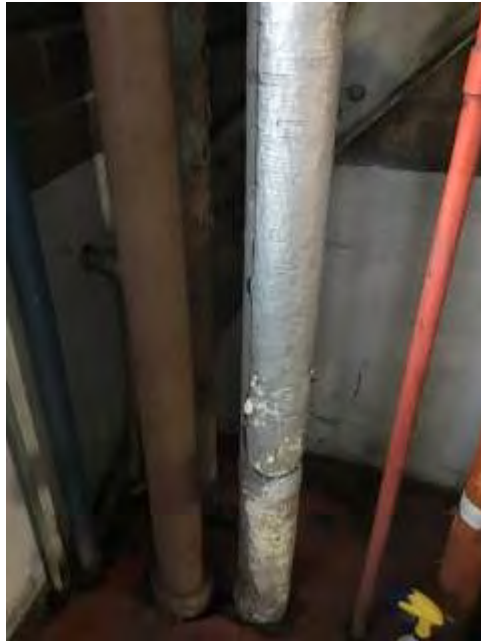

1-7-TSI-9



Additional Sample Notes:	Silver pipe wrap with yellow fibrous insulation
Sample ID:	Sample Type:
1-7-PB-13	PB
Sample Location:	Detailed Sample Location:
Room 101	Floor on south side of room in front of double door between room 102 and 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.188

Sample Photo:



1-7-PB-13



Additional Sample Notes: Submitted paint chip sample to laboratory for analysis.

Sample ID: 1-8-PB-14

Sample Type: PB

Sample Location: Room 101

Detailed Sample Location: West metal support beam next to fire extinguisher.

Sample Quantity: 15 square feet

Sample Color: Red

XRF: 5.00

Sample Photo:



1-8-PB-14

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-8-TSI-10	TSI
------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Silver pipe on boiler by staircase to lower floor on west side of room.
----------	---

Sample Quantity:	3,000 linear feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Tan cementitious material	Damaged or significantly damaged	Yes
---------------------------	----------------------------------	-----

Sample Photo:		
----------------------	--	--



1-8-TSI-10




Additional Sample Notes:

White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.

Sample ID:	Sample Type:	
1-8-TSI-11	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Silver pipe on boiler by staircase to lower floor on west side of room.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:





1-8-TSI-11



Additional Sample Notes:

White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.

Sample ID:

1-8-TSI-12

Sample Type:

TSI

Sample Location:

Room 101

Detailed Sample Location:

Silver insulation on boiler on southwest side of room.

Sample Quantity:

3,000 linear feet.

Sample Color:

XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-8-TSI-12



Additional Sample Notes:	White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.
---------------------------------	--

Sample ID:	Sample Type:
1-8-TSI-21	TSI
Sample Location:	Detailed Sample Location:

Room 101	Dark gray pipe between boilers 4 and 5.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-8-TSI-21



Additional Sample Notes:	Dark gray pipe wrap with white fibrous insulation. Insulation appears to be consistent with Homogenous Area 8. Difficult to quantify due to distribution and various wrap colors.
---------------------------------	---

Sample ID:	Sample Type:	
1-8-TSI-14	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Orange pipe in southeast corner of room.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-8-TSI-14



Additional Sample Notes:	White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.
---------------------------------	--

Sample ID:	Sample Type:	
1-8-TSI-32	TSI	
Sample Location:	Detailed Sample Location:	
Room 104	Southeast corner of room on white pipe.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:




1-8-TSI-32

Additional Sample Notes:	White pipe wrap with yellow insulation.
---------------------------------	---

Sample ID:	Sample Type:	
1-8-TSI-18	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	East side of room.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:

1-8-TSI-18

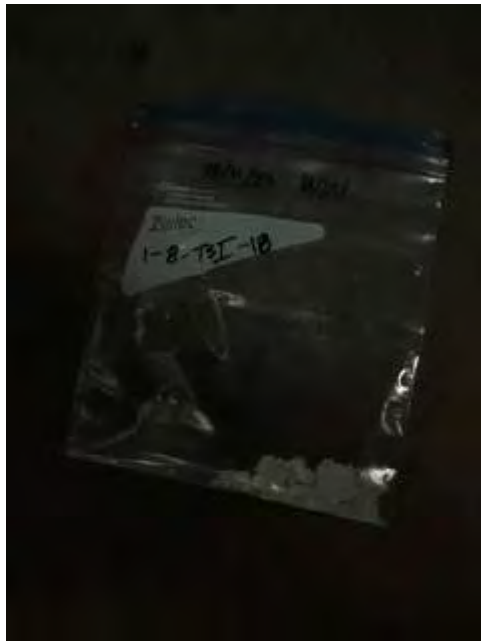

Additional Sample Notes:

Gray duct cover with white fibrous insulation. Insulation appears to be consistent with Homogenous Area 8. Difficult to quantify due to distribution and various wrap colors.

Sample ID:

1-9-MISC-13

Sample Type:

MISC

Sample Location:

Room 101

Detailed Sample Location:

Sink on southwest side of room.

Sample Quantity:

6 square feet.

Misc Sample Material:

Insulation on sink.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

Yes

Sample Photo:



1-9-MISC-13



Additional Sample Notes:	Yellow fibrous insulation.
---------------------------------	----------------------------

Sample ID:	Sample Type:
1-9-PB-15	PB
Sample Location:	Detailed Sample Location:
Room 101	West metal support beam above fire extinguisher.
Sample Quantity:	3,000 square feet.
Sample Color:	XRF:
White	5.00

Sample Photo:



1-9-PB-15

Additional Sample Notes:	Difficult to quantify.
---------------------------------	------------------------

Sample ID:	Sample Type:
-------------------	---------------------

1-9-PB-23	PB
-----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Metal support beam on west wall north of double door.
----------	---

Sample Quantity:	3,000 square feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

White	5.00
-------	------

Sample Photo:

1-9-PB-23



Additional Sample Notes:	Difficult to quantify.
Sample ID:	Sample Type:
1-10-PB-16	PB
Sample Location:	Detailed Sample Location:
Room 101	Steam pipe in southwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.616

Sample Photo:




1-10-PB-16

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-10-TSI-15	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Southeast corner of room on corrugated boiler.	
Sample Quantity:	2 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:




1-10-TSI-15

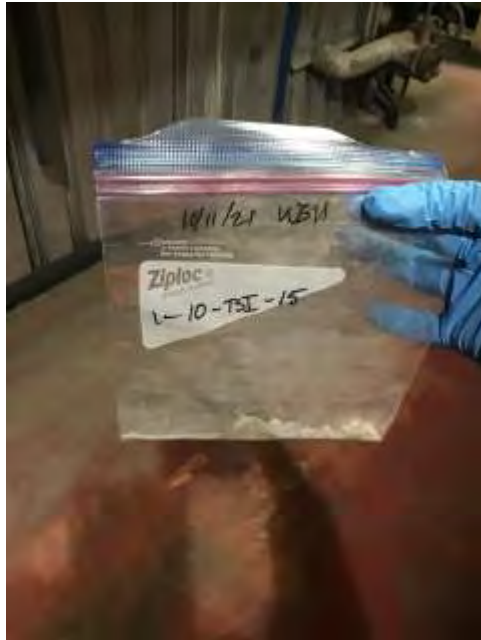

Additional Sample Notes:	Gray insulation and fabric.	
Sample ID:	Sample Type:	
1-11-MISC-16	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Southeast corner of room on corrugated boiler wall.	
Sample Quantity:	2 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan soundproofing material.	Potential ACBM with potential for damage	Yes

Sample Photo:

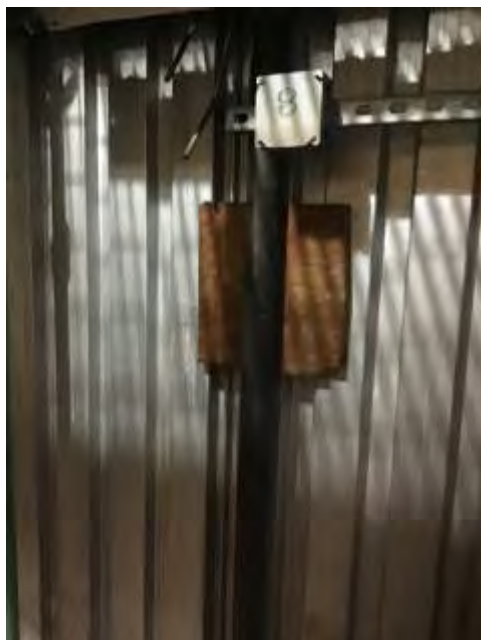

1-11-MISC-16



Additional Sample Notes:	Soundproofing material.
Sample ID:	Sample Type:
1-11-PB-17	PB
Sample Location:	Detailed Sample Location:
Room 101	Mirror above sink in southwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.472

Sample Photo:



1-11-PB-17

Additional Sample Notes:

Sample ID:	Sample Type:
1-12-PB-18	PB
Sample Location:	Detailed Sample Location:
Room 101	Southwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.013

Sample Photo:



1-12-PB-18

Additional Sample Notes:

Sample ID:	Sample Type:
1-12-PB-35	PB
Sample Location:	Detailed Sample Location:
Room 101	Northeast corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
White	ND

Sample Photo:





1-12-PB-35

Additional Sample Notes:

Sample ID:	Sample Type:	
1-12-MISC-17	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Green cabinet in southeast corner of room.	
Sample Quantity:	Less than 5 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray fibrous material.	Damaged or significantly damaged friable miscellaneous ACM	Yes

Sample Photo:




1-12-MISC-17



Additional Sample Notes:	Gray fibrous material.
Sample ID:	Sample Type:
1-12-PB-39	PB
Sample Location:	Detailed Sample Location:
Room 101	Southeast corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.068

Sample Photo:

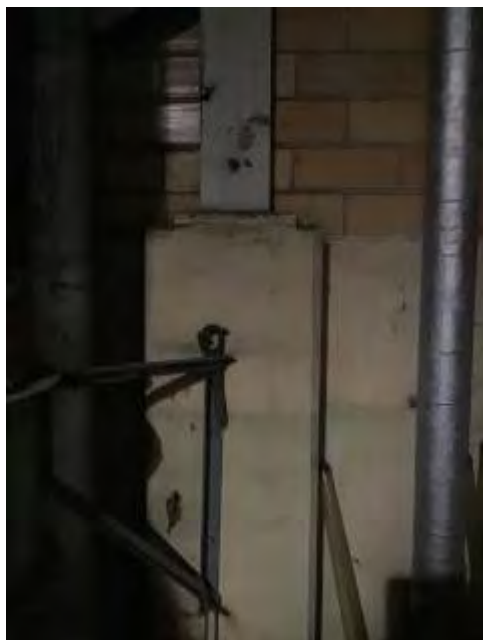

1-12-PB-39

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-13-MISC-19	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Soundproofing material on boiler in northeast corner of room.	
Sample Quantity:	15 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray and tan soundproofing material wrap.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-13-MISC-19



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-13-MISC-22	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Fabric material on southeast boiler by double doors on south end of room.	
Sample Quantity:	15 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray fabric material.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-13-MISC-22



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-13-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 101	Pipe on west side of southwest boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.092

Sample Photo:



1-13-PB-19

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-14-PB-20	PB
Sample Location:	Detailed Sample Location:
Room 101	Northwest corner of southwest boiler.
Sample Quantity:	600 linear feet
Sample Color:	XRF:
Yellow	5.00

Sample Photo:





1-14-PB-20

Additional Sample Notes:

Sample ID:	Sample Type:
1-14-PB-29	PB
Sample Location:	Detailed Sample Location:
Room 101	North pipe on the northwest corner of north middle boiler.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	5.00

Sample Photo:




1-14-PB-29

Additional Sample Notes:

Sample ID:	Sample Type:
1-14-PB-30	PB
Sample Location:	Detailed Sample Location:
Room 101	North concrete bench west of north door.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	2.83

Sample Photo:

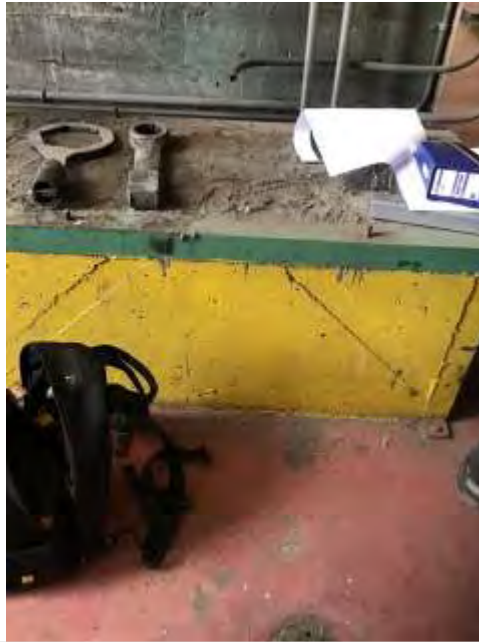


1-14-PB-30

Additional Sample Notes:

Sample ID:	Sample Type:	
1-14-TSI-20	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	White patch on pipe in north portion of room.	
Sample Quantity:	5 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

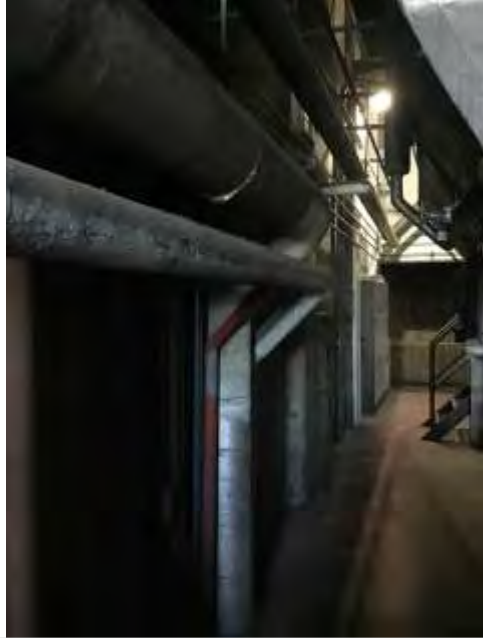

1-14-TSI-20



Additional Sample Notes:	White patch on silver pipe with white fibrous insulation.
---------------------------------	---

Sample ID:	Sample Type:
-------------------	---------------------

1-14-PB-37	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Pipe between southeast and south middle boiler.
----------	---

Sample Quantity:	600 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

Yellow	5.00
--------	------

Sample Photo:




1-14-PB-37

Additional Sample Notes:

Sample ID:	Sample Type:	
1-15-MISC-38	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall west of single doorway in room 102.	
Sample Quantity:	3,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:

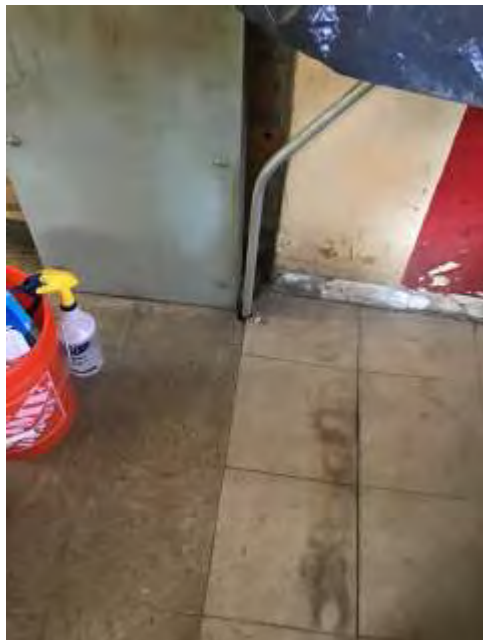

1-15-MISC-38



Additional Sample Notes:

Sample ID:	Sample Type:	
1-15-MISC-23	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	Northeast corner of room.	
Sample Quantity:	3,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-15-MISC-23



Additional Sample Notes:

Sample ID:	Sample Type:	
1-15-MISC-24	MISC	
Sample Location:	Detailed Sample Location:	
Room 105	Northeast corner of room.	
Sample Quantity:	3,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-15-MISC-24



Additional Sample Notes:

Sample ID:

1-15-PB-21

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

West wall north of double door.

Sample Quantity:

30 linear feet

Sample Color:

Orange

XRF:

2.36

Sample Photo:



1-15-PB-21

Additional Sample Notes:

Sample ID:	Sample Type:
1-16-PB-22	PB
Sample Location:	Detailed Sample Location:
Room 101	West wall north of double door.
Sample Quantity:	N/A
Sample Color:	XRF:
Brown	0.015

Sample Photo:




1-16-PB-22

Additional Sample Notes:

Sample ID:	Sample Type:	
1-16-MISC-25	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	East wall of room.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:

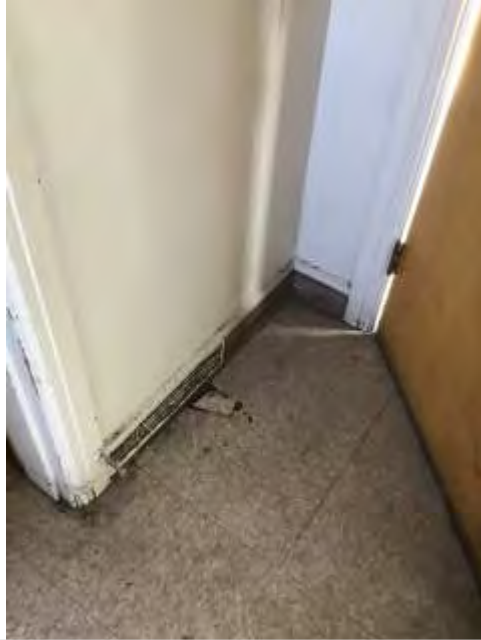

1-16-MISC-25



Additional Sample Notes:

Sample ID:

1-16-MISC-26

Sample Type:

MISC

Sample Location:

Room 104

Detailed Sample Location:

East wall of room.

Sample Quantity:

80 linear feet.

Misc Sample Material:

Brown cove base with brown mastic.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:



1-16-MISC-26



Additional Sample Notes:

Sample ID:

1-17-MISC-27

Sample Type:

MISC

Sample Location:

Room 105

Detailed Sample Location:

North wall of room.

Sample Quantity:

650 square feet.

Misc Sample Material:

Light gray wallboard.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

Yes

Sample Photo:



1-17-MISC-27



Additional Sample Notes:

Sample ID:

1-17-PB-24

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Steam pipe on west side or northwest boiler.

Sample Quantity:

N/A

Sample Color:

Bright orange

XRF:

0.121

Sample Photo:



1-17-PB-24

Additional Sample Notes:

Sample ID:	Sample Type:
1-18-PB-25	PB
Sample Location:	Detailed Sample Location:
Room 101	Brick on southwest corner of northwest boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:



1-18-PB-25

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-18-MISC-28	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	North wall of room in light switch casing.	
Sample Quantity:	785 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light gray cementitious wallboard.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-18-MISC-28



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-18-MISC-43	MISC	
Sample Location:	Detailed Sample Location:	
Room 106T	West wall by door in room 106T.	
Sample Quantity:	785 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with cementitious wallboard.	Damaged or significantly damaged friable miscellaneous ACM	Yes

Sample Photo:




1-18-MISC-43



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-19-MISC-29	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	Northwest corner of room above light switch.	
Sample Quantity:	180 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White 18" x 36" ceiling tile with randomized stipple pattern.	Potential ACBM with potential for damage	Yes

Sample Photo:

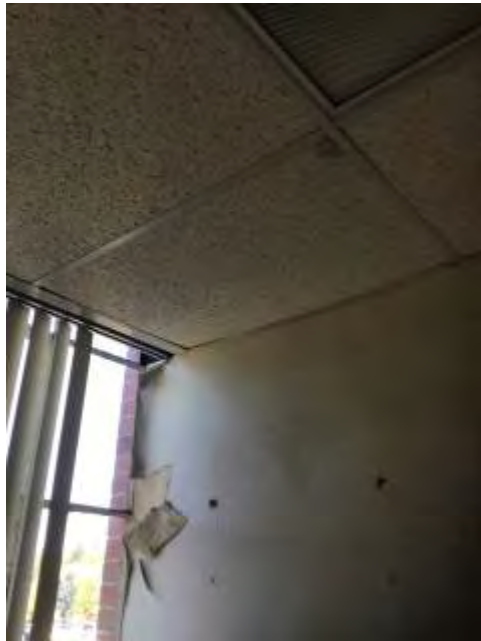

1-19-MISC-29



Additional Sample Notes:

Sample ID:	Sample Type:
1-19-PB-26	PB
Sample Location:	Detailed Sample Location:
Room 101	Support pole in northwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Gray	0.111

Sample Photo:



1-19-PB-26

Additional Sample Notes:

Sample ID:	Sample Type:	
1-19-MISC-31	MISC	
Sample Location:	Detailed Sample Location:	
Room 105	Northwest corner of room.	
Sample Quantity:	180 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White 18" x 36" ceiling tile with randomized stipple pattern.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-19-MISC-31



Additional Sample Notes:

Sample ID:	Sample Type:
1-20-PB-27	PB
Sample Location:	Detailed Sample Location:
Room 101	Northwest support beam of northwest boiler.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:
Silver	2.47

Sample Photo:



1-20-PB-27

Additional Sample Notes:	Quantity difficult to estimate.
Sample ID:	Sample Type:
1-20-PB-28	PB
Sample Location:	Detailed Sample Location:
Room 101	Northeast support beam of northwest boiler.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:
Silver	1.66

Sample Photo:



1-20-PB-28



Additional Sample Notes:

Quantity difficult to estimate. Submitted paint chip sample to laboratory for analysis.

Sample ID:

1-20-MISC-30

Sample Type:

MISC

Sample Location:

Room 104

Detailed Sample Location:

Southeast corner above cabinet.

Sample Quantity:

20 square feet.

Misc Sample Material:

White 18" x 36" ceiling tile with uniform stipple pattern.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

Yes

Sample Photo:

1-20-MISC-30



Additional Sample Notes:

Sample ID:	Sample Type:
1-20-PB-33	PB
Sample Location:	Detailed Sample Location:
Room 101	Support beam on northwest corner of northeast boiler.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:
Silver	0.040

Sample Photo:



1-20-PB-33

Additional Sample Notes:

Sample ID:	Sample Type:	
1-21-MISC-33	MISC	
Sample Location:	Detailed Sample Location:	
104	Gray blue counter top on east side of room.	
Sample Quantity:	12 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray blue laminate countertop with black and green mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-21-MISC-33



Additional Sample Notes:


Sample ID: 1-21-PB-31 **Sample Type:** PB

Sample Location: Room 101 **Detailed Sample Location:** Pipe on north wall between northeast and north middle boiler.

Sample Quantity: 70 linear feet.

Sample Color: Brown **XRF:** 3.52

Sample Photo:

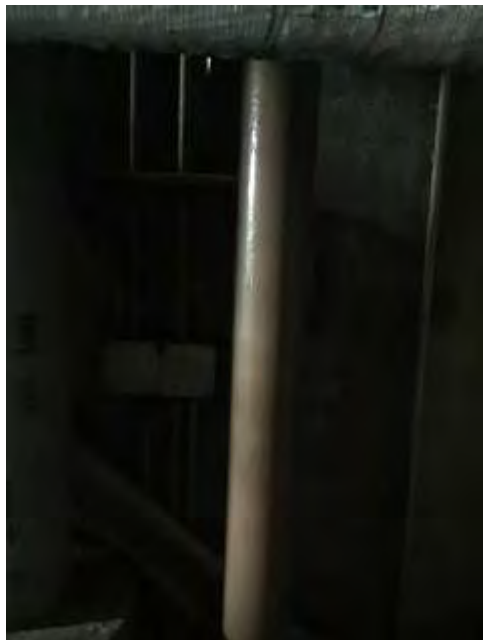

1-21-PB-31

Additional Sample Notes:

Sample ID:	Sample Type:
1-21-PB-32	PB
Sample Location:	Detailed Sample Location:
Room 101	Pipe north of north middle boiler.
Sample Quantity:	70 linear feet.
Sample Color:	XRF:
Brown	1.208

Sample Photo:



1-21-PB-32

Additional Sample Notes:

Sample ID:	Sample Type:	
1-22-MISC-34	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	Northwest corner of room by stairs.	
Sample Quantity:	240 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Dark brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-22-MISC-34



Additional Sample Notes:

Sample ID:	Sample Type:	
1-22-MISC-35	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall east of double door.	
Sample Quantity:	240 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Dark brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-22-MISC-35



Additional Sample Notes:

Sample ID:

1-22-PB-40

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Green cabinet in the southeast corner.

Sample Quantity:

64 square feet.

Sample Color:

Dark green

XRF:

1.068

Sample Photo:



1-22-PB-40

Additional Sample Notes:

Sample ID:	Sample Type:
1-23-PB-41	PB
Sample Location:	Detailed Sample Location:
Room 101	Light gray cabinet in southeast corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Light gray	0.048

Sample Photo:



1-23-PB-41

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-23-MISC-36	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall, west of transformer box and east of the double doors.	
Sample Quantity:	Less than 5 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray cementitious patching material.	Potential ACBM with potential for damage	No

Sample Photo:



1-23-MISC-36



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-24-MISC-37	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall west of single doorway.	
Sample Quantity:	77.5 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light gray 12" x 12" vinyl floor tile with gray mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-24-MISC-37



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-25-MISC-39	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Rooms 102 and 101.	Double doorway between room 102 and 101.
--------------------	--

Sample Quantity:	11 linear feet.
-------------------------	-----------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Black transition strip with brown mastic.	Potential ACBM with potential for damage	No
---	--	----

Sample Photo:



1-25-MISC-39



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-25-MISC-47	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	West stairway moving down in room 102.	
Sample Quantity:	11 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Black transition strip with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-25-MISC-47



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-26-MISC-40	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------


Stairway to Room 106T and 107	South side of stairway to Room 106T and 107.
-------------------------------	--

Sample Quantity:	28 square feet.
-------------------------	-----------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Rubber stair tread with clear mastic.	Potential ACBM with potential for damage	No
---------------------------------------	--	----

Sample Photo:

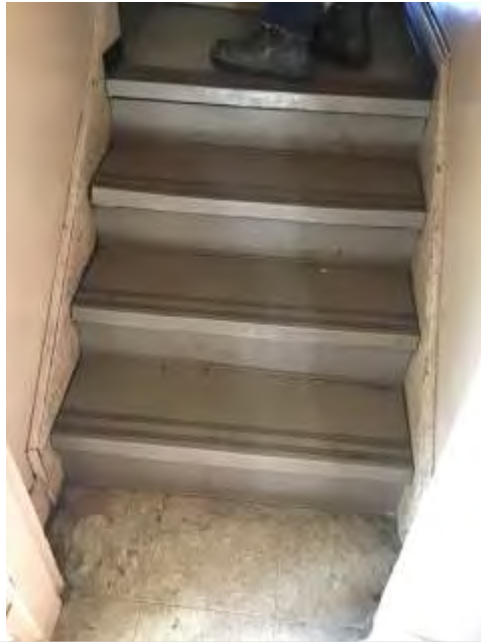

1-26-MISC-40



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-27-MISC-41	MISC	
Sample Location:	Detailed Sample Location:	
Room 106T	Center floor of room 106T.	
Sample Quantity:	16 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Dark brown patterned 9 x 9 vinyl floor tiles with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-27-MISC-41



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-28-MISC-42	MISC	
Sample Location:	Detailed Sample Location:	
Room 106T	Center floor of room 106T.	
Sample Quantity:	76 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light tan patterned 9" x 9" vinyl floor tile with black mastic.	Damaged or significantly damaged; Potential ACBM with potential for damage	No

Sample Photo:



1-28-MISC-42



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-28-MISC-48	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	West stairway moving up in room 102.	
Sample Quantity:	76 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light tan patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-28-MISC-48



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-29-MISC-44	MISC	
Sample Location:	Detailed Sample Location:	
Room 107	West wall next to window in room 107.	
Sample Quantity:	60 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White plastic waterproofing material with pale yellow adhesive.	Potential ACBM with potential for damage	No

Sample Photo:




1-29-MISC-44



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-30-MISC-49	MISC	
Sample Location:	Detailed Sample Location:	
Top of stairway from room 102 to 107.	North wall at the top of stairs.	
Sample Quantity:	20 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Black cove base with tan mastic	Potential ACBM with potential for damage	No

Sample Photo:

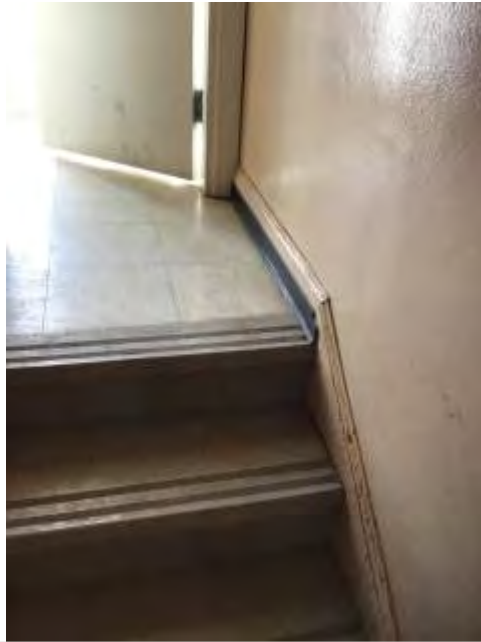

1-30-MISC-49



Additional Sample Notes:

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Throughout the room.
Type of Fixture:	Quantity:
Boilers and steam equipment.	6
Condition:	Additional Fixture Notes:
Good	Associated motors, residual mechanical fluids and coal dust.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Southeast corner of room 101.
Type of Fixture:	Quantity:
Fluorescent light bulbs.	13
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	East wall behind control panels.
Type of Fixture:	Quantity:
	1
Condition:	Additional Fixture Notes:
Good	Boiler and equipment control panels containing mercury.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	West wall south of double doors.
Type of Fixture:	Quantity:
Fire hose.	1
Condition:	Additional Fixture Notes:
Good	Assumed asbestos containing material in fire hose.


Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 105	West of south door.
Type of Fixture:	Quantity:
Fire-resistant board.	1
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 105 and 104	West of door between room 105 and 104.
Type of Fixture:	Quantity:
	2
Condition:	Additional Fixture Notes:
Good	Assumed mercury containing thermostats.

Other Material Photo:



Room 105



Room 104

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Throughout first floor.	
Type of Fixture:	Quantity:
Electrical equip	Several.
Condition:	Additional Fixture Notes:
Good	Electrical equipment: 13 breaker/electrical panels, 2 motor control center.

Other Material Photo:









Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Northwest corner of room 101.
Type of Fixture:	Quantity:
Equipment lift system.	1
Condition:	Additional Fixture Notes:
Good	Mechanical hazard with motor.

Other Material Photo:



Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/12/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Mezzanine

Samples

Sample ID:	Sample Type:	
2-1-MISC-1	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northwest corner floor.	
Sample Quantity:	66 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White stipple pattern 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-1-MISC-1



Additional Sample Notes:

Sample ID:	Sample Type:	
2-1-MISC-2	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southeast corner floor.	
Sample Quantity:	66 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White stipple pattern 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-1-MISC-2



Additional Sample Notes:

Sample ID:

2-1-PB-1

Sample Type:

PB

Sample Location:

Room 203

Detailed Sample Location:

Southeast corner of room.

Sample Quantity:

NA

Sample Color:

White

XRF:

0.180

Sample Photo:




2-1-PB-1

Additional Sample Notes:

Sample ID:	Sample Type:
2-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room 204	Northeast corner of room.
Sample Quantity:	NA
Sample Color:	XRF:
White	0.043

Sample Photo:

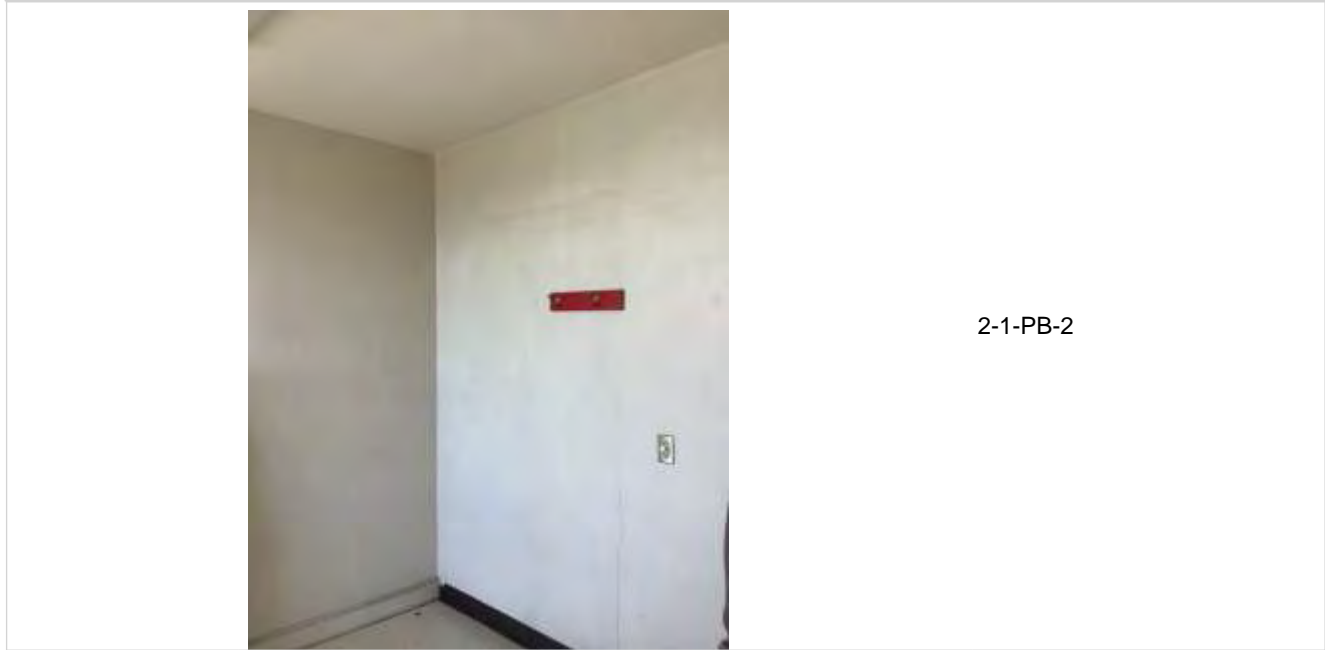

Additional Sample Notes:

Sample ID:	Sample Type:
2-2-PB-3	PB
Sample Location:	Detailed Sample Location:
Room 200S	Catwalk outside of room 204.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.085

Sample Photo:






2-2-PB-3

Additional Sample Notes:

Sample ID:	Sample Type:
2-2-PB-4	PB
Sample Location:	Detailed Sample Location:
Room 200S	Catwalk outside of room 201.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.219

Sample Photo:

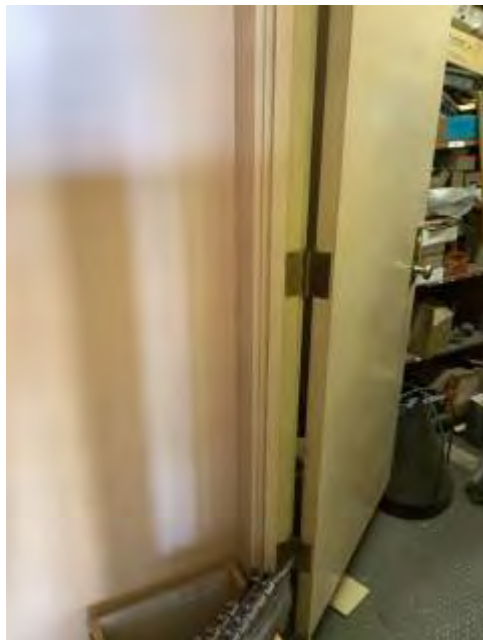

2-2-PB-4

Additional Sample Notes:		
Sample ID:	Sample Type:	
2-2-MISC-3	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southeast corner of counter.	
Sample Quantity:	22 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan laminate countertop with clear mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-2-MISC-3



Additional Sample Notes:		
Sample ID:	Sample Type:	
2-3-MISC-4	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	West side of floor.	
Sample Quantity:	175 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light brown patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:




2-3-MISC-4



Additional Sample Notes:		
Sample ID:	Sample Type:	
2-3-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southwest corner of floor.	
Sample Quantity:	175 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light brown patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:

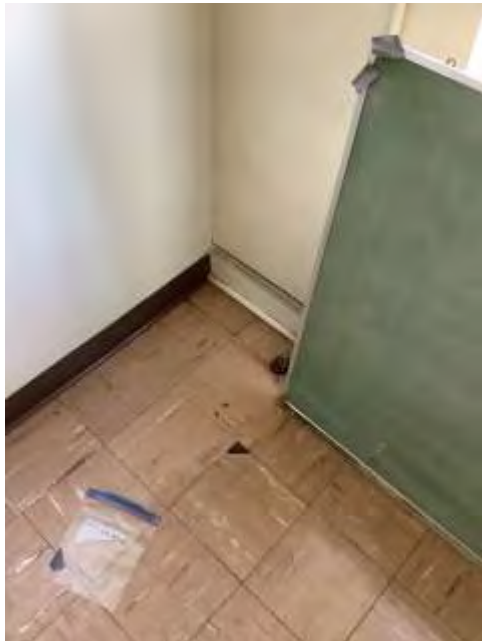

2-3-MISC-5



Additional Sample Notes:

Sample ID:	Sample Type:
2-3-PB-5	PB
Sample Location:	Detailed Sample Location:
Room 201	Cabinet inside doorway.
Sample Quantity:	NA
Sample Color:	XRF:
Dark tan	0.330

Sample Photo:



2-3-PB-5

Additional Sample Notes:

Sample ID:	Sample Type:
2-3-PB-6	PB
Sample Location:	Detailed Sample Location:
Room 201	Cabinet on north wall.
Sample Quantity:	NA
Sample Color:	XRF:
Dark tan	0.268

Sample Photo:



2-3-PB-6

Additional Sample Notes:

Sample ID:	Sample Type:
2-4-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 101	Yellow pipe on first catwalk, west side of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	3.22

Sample Photo:



2-4-PB-7

Additional Sample Notes:

Sample ID:	Sample Type:
2-4-PB-8	PB
Sample Location:	Detailed Sample Location:
Room 101	Yellow pipe on first catwalk, west side of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	4.94

Sample Photo:




2-4-PB-8

Additional Sample Notes:

Sample ID:	Sample Type:
2-4-PB-12	PB
Sample Location:	Detailed Sample Location:
Room 101	Yellow pipe on first catwalk, east side of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	3.28

Sample Photo:

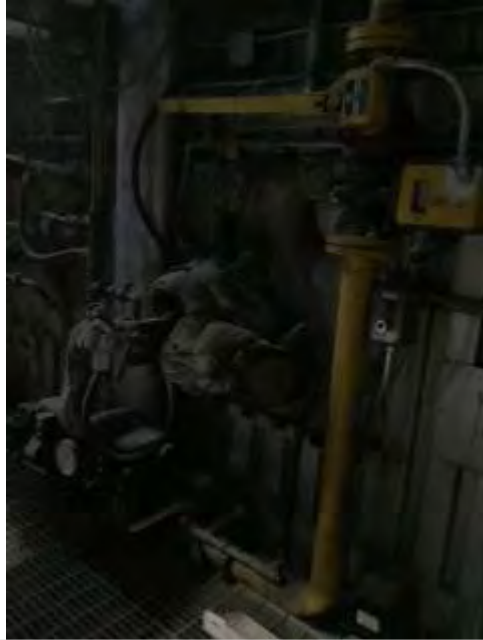

2-4-PB-12

Additional Sample Notes:

Sample ID:	Sample Type:	
2-4-MISC-6	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	East side of floor north of door.	
Sample Quantity:	20 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown stripped patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-4-MISC-6



Additional Sample Notes:

Sample ID:	Sample Type:	
2-5-MISC-7	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northeast corner of room.	
Sample Quantity:	30 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Black cove base with tan mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-5-MISC-7



Additional Sample Notes:

Sample ID:

2-5-PB-16

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Light green pipe on second catwalk on east side of room.

Sample Quantity:

NA


Sample Color:

Light green

XRF:

0.036

Sample Photo:

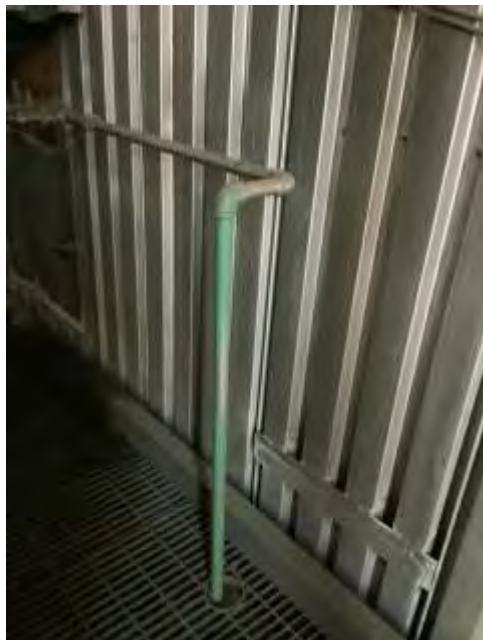


2-5-PB-16

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
2-5-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 101	Light green pipe on first catwalk in center of room.
Sample Quantity:	NA
Sample Color:	XRF:
Light green	0.242

Sample Photo:

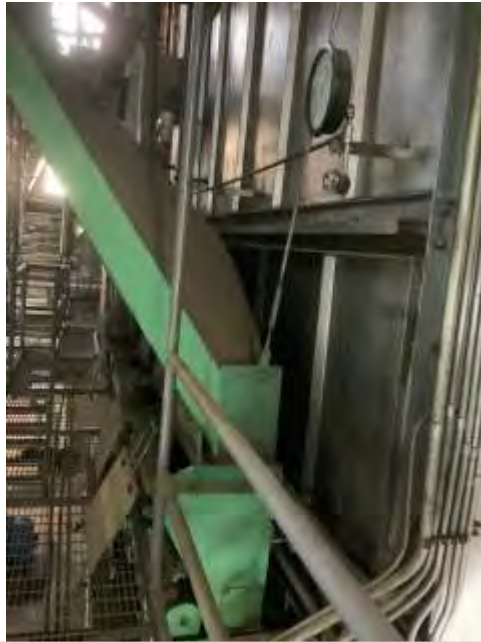

2-5-PB-9

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
2-5-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 101	Light green pipe on first catwalk in center of room.
Sample Quantity:	NA
Sample Color:	XRF:
Light green	0.108

Sample Photo:



2-5-PB-10

Additional Sample Notes:

Sample ID:	Sample Type:
2-6-PB-11	PB
Sample Location:	Detailed Sample Location:
Room 101	Silver pipe on first catwalk in center of room.
Sample Quantity:	NA
Sample Color:	XRF:
Silver	ND

Sample Photo:



2-6-PB-11

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

2-6-TSI-8	TSI
-----------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 202	Pipe on west wall.
----------	--------------------

Sample Quantity:	4 linear feet.
-------------------------	----------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Potential ACBM with potential for damage	No
--	--	----

Sample Photo:



2-6-TSI-8



Additional Sample Notes:

Sample ID:	Sample Type:	
2-7-MISC-9	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northwest window.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	No

Sample Photo:




2-7-MISC-9



Additional Sample Notes:

Sample ID:	Sample Type:	
2-7-MISC-10	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southeast window.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	No

Sample Photo:

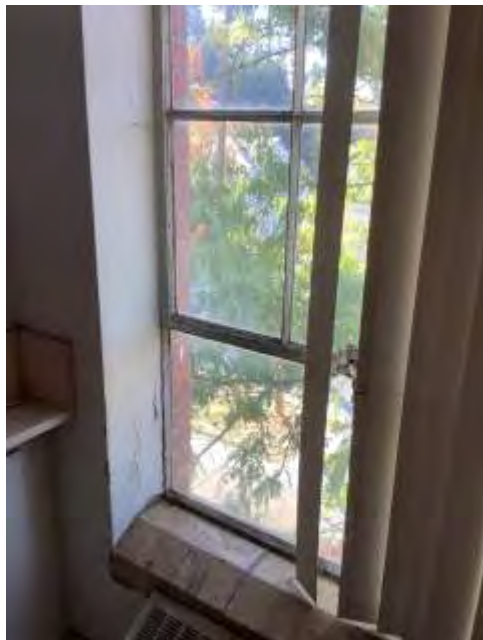

2-7-MISC-10



Additional Sample Notes:

Sample ID:	Sample Type:	
2-7-MISC-33	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Northwest corner; highest catwalk.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Damaged or significantly damaged friable miscellaneous ACM	Yes

Sample Photo:



2-7-MISC-33



Additional Sample Notes:

Sample ID: 2-7-PB-13 **Sample Type:** PB

Sample Location: Room 101 **Detailed Sample Location:** Red pipe on first catwalk, east side of room.

Sample Quantity: 750 linear feet.

Sample Color: Red **XRF:** 1.98

Red

Sample Photo:



2-7-PB-13

Additional Sample Notes:	
Sample ID:	Sample Type:
2-7-PB-24	PB
Sample Location:	Detailed Sample Location:
Room 204	Red pipe
Sample Quantity:	750 linear feet.
Sample Color:	XRF:
Red	1.164

Sample Photo:



2-7-PB-24



Additional Sample Notes:	Submitted sample to laboratory for analysis.
---------------------------------	--

Sample ID:	Sample Type:
2-8-PB-25	PB
Sample Location:	Detailed Sample Location:
Room 101	Red pipe on first catwalk, east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Red	ND

Sample Photo:



2-8-PB-25

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
2-8-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 101	Red pipe on first catwalk, east side of room.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Reddish brown	0.075

Sample Photo:





2-8-PB-14

Additional Sample Notes:

Sample ID:	Sample Type:	
2-8-MISC-11	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	East wall above sink.	
Sample Quantity:	1,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with cementitious wallboard.	Potential ACBM with potential for damage	No;Yes

Sample Photo:



2-8-MISC-11



Additional Sample Notes:

Sample ID: 2-8-MISC-12 **Sample Type:** MISC

Sample Location: Room 202 **Detailed Sample Location:** Northwest corner wall under window.

Sample Quantity: 1,000 square feet.

Misc Sample Material: White drywall with cementitious wallboard. **Sample Condition:** Potential ACBM with potential for damage **Sample Friable?:** No

Sample Photo:



2-8-MISC-12



Additional Sample Notes:

Sample ID:	Sample Type:	
2-9-MISC-13	MISC	
Sample Location:	Detailed Sample Location:	
Room 200S	West wall north of door to room 202.	
Sample Quantity:	14 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-9-MISC-13



Additional Sample Notes:

Sample ID:

2-9-PB-15

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Gray corrugated boiler siding on second catwalk, east side of room.

Sample Quantity:

NA

Sample Color:

Gray

XRF:

ND

Sample Photo:



2-9-PB-15

Additional Sample Notes:

Sample ID:	Sample Type:
2-9-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 101	Gray boiler siding on second catwalk, east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Gray	0.035

Sample Photo:



2-9-PB-19

Additional Sample Notes:

Sample ID:	Sample Type:
2-10-PB-17	PB
Sample Location:	Detailed Sample Location:
Room 101	Gray railing on second catwalk on east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Gray	0.007

Sample Photo:



2-10-PB-17

Additional Sample Notes:		
Sample ID:	Sample Type:	
2-10-TSI-14	TSI	
Sample Location:	Detailed Sample Location:	
Room 204	Pipe on east wall south of single door.	
Sample Quantity:	14 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:





Additional Sample Notes:

Sample ID:	Sample Type:	
2-11-MISC-15	MISC	
Sample Location:	Detailed Sample Location:	
Room 204	West wall south of double door.	
Sample Quantity:	615 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red 12" x 12" brick.	Potential ACBM with potential for damage	No

Sample Photo:



2-11-MISC-15



Additional Sample Notes:

Sample ID:

2-11-MISC-17

Sample Type:

MISC

Sample Location:

Room 204

Detailed Sample Location:

North wall below window.

Sample Quantity:

615 square feet.

Misc Sample Material:

Red 12" x 12" brick.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:



2-11-MISC-17



Additional Sample Notes:

Sample ID:	Sample Type:
2-11-PB-18	PB
Sample Location:	Detailed Sample Location:
Room 101	Tan boiler part on second catwalk on east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.101

Sample Photo:



2-11-PB-18

Additional Sample Notes:

Sample ID:	Sample Type:
2-11-PB-22	PB
Sample Location:	Detailed Sample Location:
Room 101	Tan mechanical part in room 204.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	ND

Sample Photo:




2-11-PB-22

Additional Sample Notes:

Sample ID:	Sample Type:
2-12-PB-20	PB
Sample Location:	Detailed Sample Location:
Room 101	Gray door frame on second catwalk, east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Gray	0.517

Sample Photo:

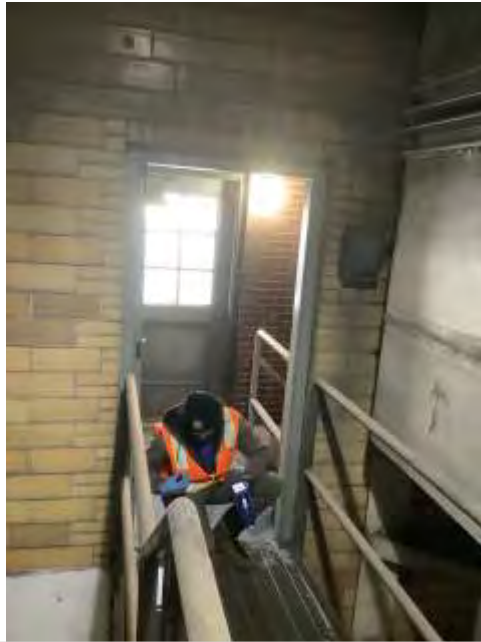

2-12-PB-20

Additional Sample Notes:

Sample ID:	Sample Type:	
2-12-MISC-18	MISC	
Sample Location:	Detailed Sample Location:	
Room 204	North wall below window.	
Sample Quantity:	550 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar.	Potential ACBM with potential for damage	No

Sample Photo:



2-12-MISC-18



Additional Sample Notes:

Sample ID:

2-12-MISC-16

Sample Type:

MISC

Sample Location:

Room 204

Detailed Sample Location:

West wall south of double door.

Sample Quantity:

550 linear feet.

Misc Sample Material:

Gray brick mortar.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:




2-12-MISC-16



Additional Sample Notes:		
Sample ID:	Sample Type:	
2-13-TSI-19	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Second catwalk on southwest side of Boiler 6.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

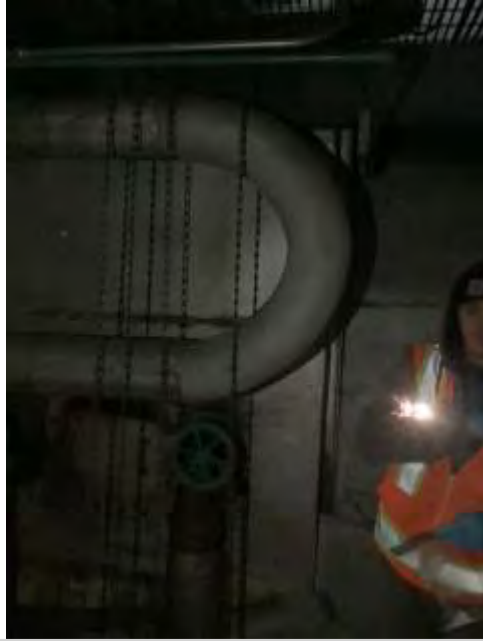


2-13-TSI-19



Additional Sample Notes:	Silver pipe with white insulation.
Sample ID:	Sample Type:
2-13-TSI-20	TSI
Sample Location:	Detailed Sample Location:
Room 101	Second catwalk on southwest side of Boiler 6.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

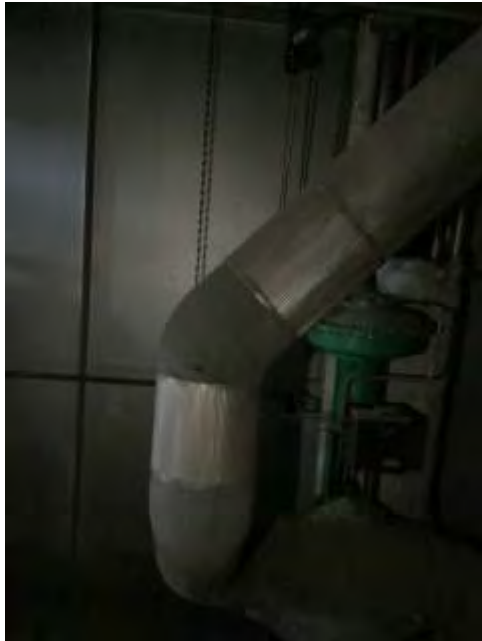

2-13-TSI-20



Additional Sample Notes:	Silver pipe with white insulation.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
2-13-TSI-22	TSI
Sample Location:	Detailed Sample Location:
Room 101	Second catwalk on southwest side of Boiler 6.
Sample Quantity:	3,000 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-13-TSI-22



Additional Sample Notes:	Elbow on silver pipe.
---------------------------------	-----------------------


Sample ID:	Sample Type:
-------------------	---------------------

2-13-TSI-23	TSI
-------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Second catwalk on southeast side of Boiler 6.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

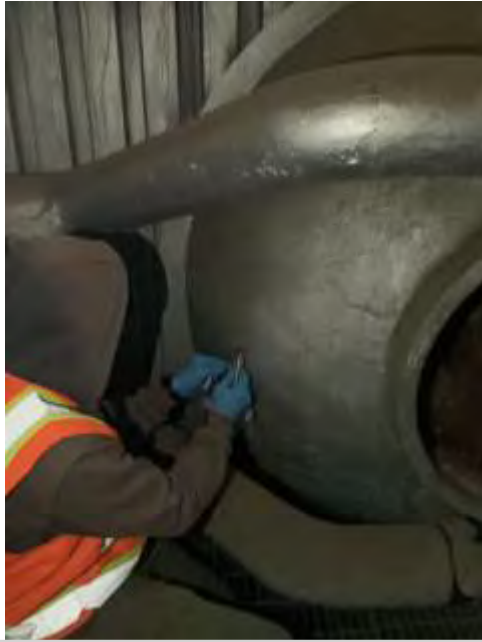

2-13-TSI-23




Additional Sample Notes:	Silver pipe with white insulation.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

2-13-TSI-30	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Located throughout northeast side of room on and around Boiler 2 by staircase entrance.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:

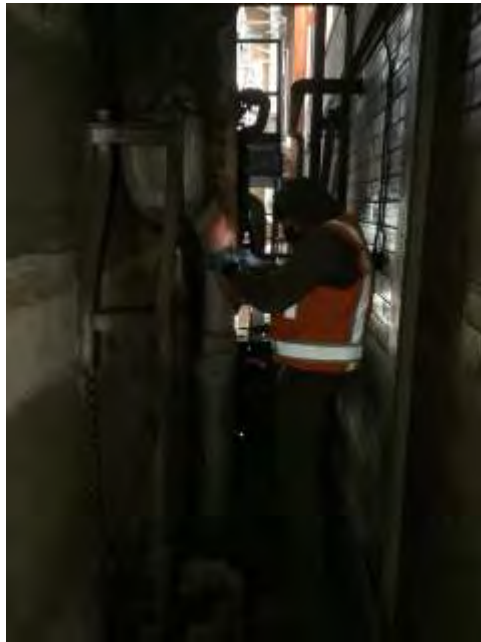

2-13-TSI-30



Additional Sample Notes:	Orange pipe wrap with white insulation.	
Sample ID:	Sample Type:	
2-13-TSI-25	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Second catwalk on south side of Boiler 6.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-13-TSI-25



Additional Sample Notes:	Orange pipe with white insulation.
Sample ID:	Sample Type:
2-13-PB-21	PB
Sample Location:	Detailed Sample Location:
Room 101	Red pipe on west side of Boiler 4.
Sample Quantity:	NA
Sample Color:	XRF:
Red	ND

Sample Photo:



2-13-PB-21

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

2-14-TSI-24	TSI
-------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Second catwalk on southeast side of Boiler 6.
----------	---

Sample Quantity:	500 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:		
----------------------	--	--



2-14-TSI-24



Additional Sample Notes:		Silver pipe with white insulation.	
Sample ID:		Sample Type:	
2-14-TSI-21		TSI	
Sample Location:		Detailed Sample Location:	
Room 101		Second catwalk on southwest side of Boiler 6.	
Sample Quantity:		500 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



2-14-TSI-21



Additional Sample Notes:	Silver pipe with white insulation.
Sample ID:	Sample Type:
2-14-PB-23	PB
Sample Location:	Detailed Sample Location:
Room 101	Blue mechanical part in room 204.
Sample Quantity:	NA
Sample Color:	XRF:
Blue	ND

Sample Photo:



2-14-PB-23

Additional Sample Notes:		
Sample ID:	Sample Type:	
2-15-TSI-26	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Southeast corner of room.	
Sample Quantity:	35 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:





Additional Sample Notes:		Tan / white pipe wrap with white insulation.	
Sample ID:		Sample Type:	
2-15-TSI-27		TSI	
Sample Location:		Detailed Sample Location:	
Room 101		East side of room by staircase entrance.	
Sample Quantity:		35 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	No

Sample Photo:



2-15-TSI-27



Additional Sample Notes:	White pipe wrap with white insulation.
Sample ID:	Sample Type:
2-16-TSI-28	TSI
Sample Location:	Detailed Sample Location:
Room 101	Located throughout northeast side of room on and around Boiler 2 by staircase entrance.
Sample Quantity:	Difficult to quantify.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:



2-16-TSI-28



Additional Sample Notes:	White tape wrap with white insulation.
---------------------------------	--

Sample ID:	Sample Type:
2-16-TSI-29	TSI
Sample Location:	Detailed Sample Location:
Room 101	Located throughout northeast side of room on and around Boiler 2 by staircase entrance.
Sample Quantity:	Difficult to quantify.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:



2-16-TSI-29



Additional Sample Notes:	White tape wrap with white insulation.
---------------------------------	--

Sample ID:	Sample Type:
2-17-TSI-31	TSI
Sample Location:	Detailed Sample Location:

Room 101	North side of room, highest catwalk by Boiler 4.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-17-TSI-31



Additional Sample Notes:	Silver paper wrapping and white insulation.
---------------------------------	---


Sample ID:	Sample Type:
-------------------	---------------------

2-17-TSI-32	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Northwest corner of room, highest catwalk by Boiler 3.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-17-TSI-32

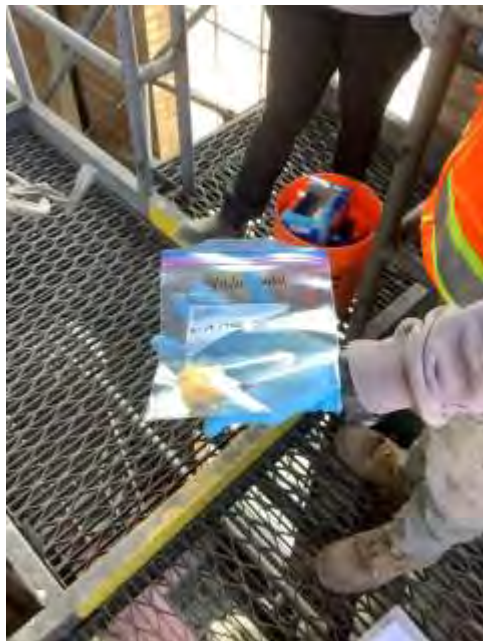


Additional Sample Notes:	Silver paper wrapping and white insulation.
---------------------------------	---

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 201	Ceiling of room 201, 203, and 204
Type of Fixture:	Quantity:
	28
Condition:	Additional Fixture Notes:
Good	Fluorescent lightbulbs

Other Material Photo:

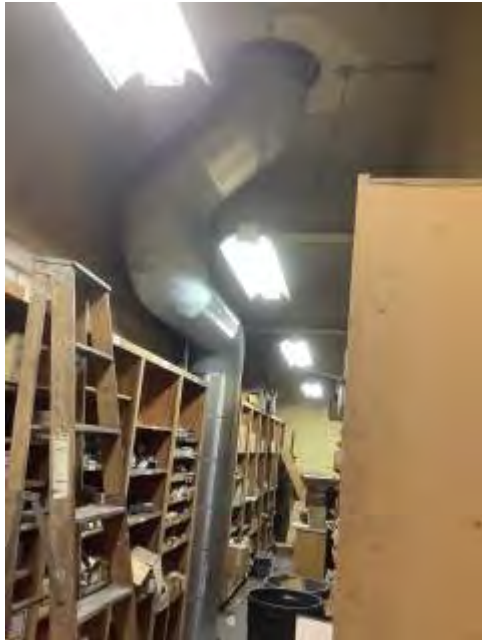

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 201	Northwest corner of room 201 behind door
Type of Fixture:	Quantity:
3 unmarked black cans	8
Condition:	Additional Fixture Notes:
Good	3 unmarked black cans.


Other Material Photo:




Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Interior walls of rooms 202 and 203	
Type of Fixture:	Quantity:
	2
Condition:	Additional Fixture Notes:
Poor	

Other Material Photo:



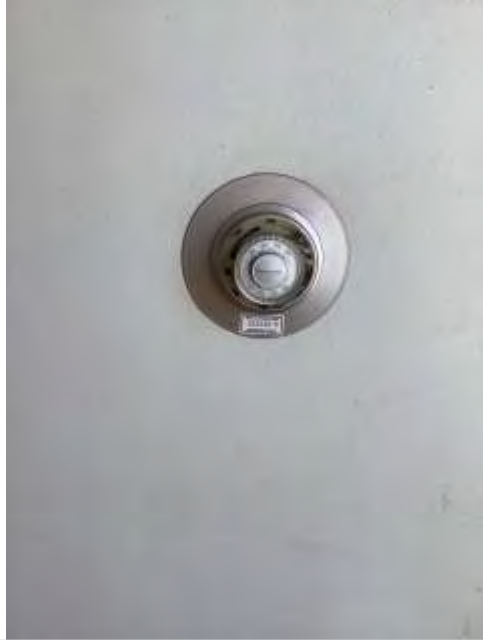

Room 202



Room 203

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Throughout room 101
Type of Fixture:	Quantity:
Electrical panels	7
Condition:	Additional Fixture Notes:
Good	4 electrical panels, 3 control panels.

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 204	Throughout room 204
Type of Fixture:	Quantity:
Coal dust	Throughout room
Condition:	Additional Fixture Notes:
Other	Coal dust exposure.

Other Material Photo:





Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/13/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Upper Mezzanine

Samples

Sample ID:	Sample Type:
3-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Red	0.136

Sample Photo:



Additional Sample Notes:	Red water line.
---------------------------------	-----------------

Sample ID:	Sample Type:
3-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Red	0.160

Sample Photo:



Additional Sample Notes:	Red water line.
---------------------------------	-----------------

Sample ID:	Sample Type:
-------------------	---------------------

3-1-TSI-5	TSI
-----------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 302	Pipe near west roof access.
----------	-----------------------------

Sample Quantity:	3,000 linear feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:




3-1-TSI-5



Additional Sample Notes:		White pipe insulation with white wrapping.
Sample ID:	Sample Type:	
3-1-TSI-1	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Highest catwalk.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

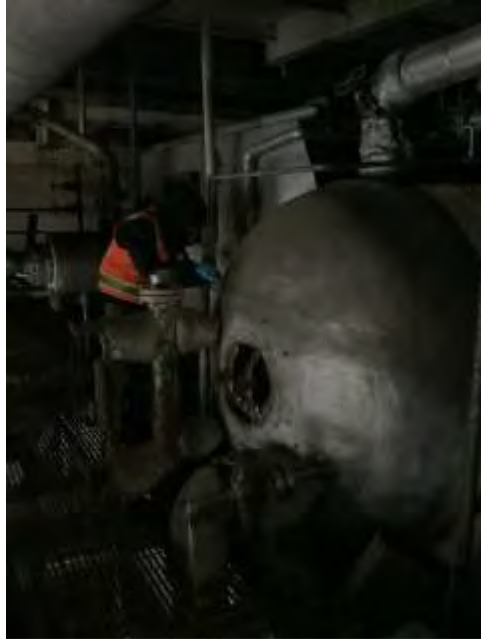

3-1-TSI-1



Additional Sample Notes:

White insulation with silver wrapping on boiler. Area of sampling not included on schematic of upper mezzanine.

Sample ID:

3-1-TSI-2

Sample Type:

TSI

Sample Location:

Room 101

Detailed Sample Location:

Highest catwalk.

Sample Quantity:

3,000 linear feet.

Sample Color:

XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-1-TSI-2



Additional Sample Notes:	White pipe insulation with white wrapping. Area of sampling not included on schematic of upper mezzanine.
---------------------------------	---

Sample ID:	Sample Type:
3-1-TSI-7	TSI
Sample Location:	Detailed Sample Location:
Room 302	Vent near staircase to lower level.
Sample Quantity:	3,000 linear feet

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-1-TSI-7



Additional Sample Notes:	White vent insulation with white wrapping.
---------------------------------	--

Sample ID:	Sample Type:
3-1-TSI-9	TSI

Sample Location:	Detailed Sample Location:

Room 302	Vent near staircase to lower level.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-1-TSI-9



Additional Sample Notes:	White vent insulation with white wrapping.
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

3-2-TSI-3	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Highest catwalk.	
Sample Quantity:	700 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-2-TSI-3



Additional Sample Notes:	Fabric insulation on pipe coming off of boiler. Area of sampling not included on schematic of upper mezzanine.
---------------------------------	--

Sample ID:	Sample Type:	
3-2-TSI-6	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Pipe near west roof access.	
Sample Quantity:	700 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-2-TSI-6



Additional Sample Notes:	White pipe insulation with silver wrapping.
Sample ID:	Sample Type:
3-2-PB-3	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	700 linear feet.
Sample Color:	XRF:
Gray	5.00

Sample Photo:



Additional Sample Notes:	Gray I-beam.
---------------------------------	--------------

Sample ID:	Sample Type:
-------------------	---------------------

3-2-PB-4	PB
----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Catwalk above coal hopper.	By staircase.
----------------------------	---------------

Sample Quantity:	700 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

Gray	5.00
------	------

Sample Photo:	
----------------------	--



Additional Sample Notes:	Gray I-beam.
---------------------------------	--------------

Sample ID:	Sample Type:
-------------------	---------------------

3-3-PB-5	PB
----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------


Catwalk above coal hopper.	By staircase.
----------------------------	---------------

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Brown	ND
-------	----


Sample Photo:	
----------------------	--

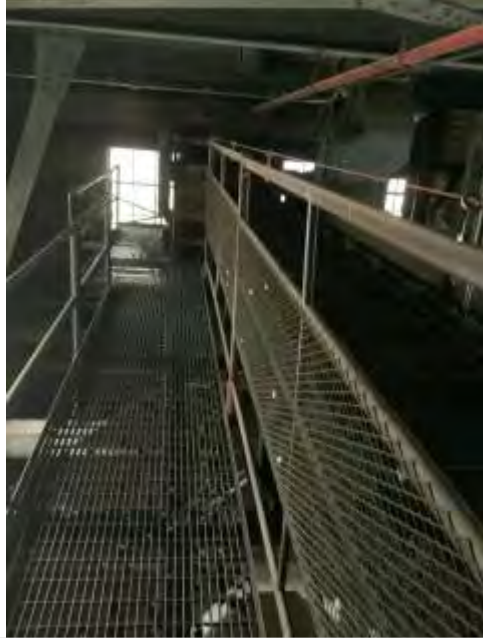

3-3-PB-5

Additional Sample Notes:	Brown catwalk railing.
Sample ID:	Sample Type:
3-3-PB-6	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Brown	ND

Sample Photo:

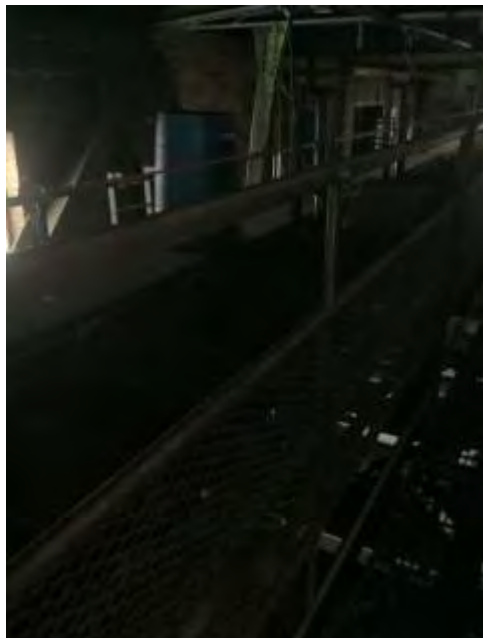


3-3-PB-6

Additional Sample Notes:	Brown catwalk railing.	
Sample ID:	Sample Type:	
3-3-TSI-4	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Motor part near west roof access.	
Sample Quantity:	40 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-3-TSI-4

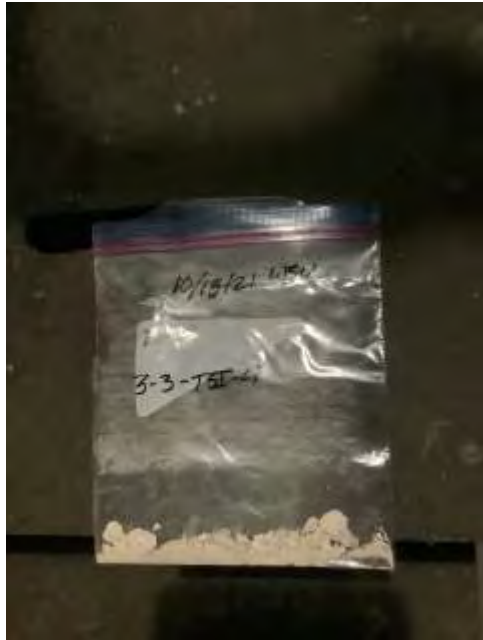

Additional Sample Notes:		White insulation on mechanical part.	
Sample ID:		Sample Type:	
3-3-TSI-10		TSI	
Sample Location:		Detailed Sample Location:	
Room 302		Motor part near west roof access.	
Sample Quantity:		40 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



3-3-TSI-10



Additional Sample Notes:	White insulation on mechanical part.	
Sample ID:	Sample Type:	
3-4-TSI-8	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Pipe near motor.	
Sample Quantity:	6 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-4-TSI-8



Additional Sample Notes:	Yellow insulation with white wrapping.
Sample ID:	Sample Type:
3-4-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 302	On equipment by east side door.
Sample Quantity:	NA
Sample Color:	XRF:
Silver	ND

Sample Photo:



Additional Sample Notes:

Silver piping.

Sample ID:

3-4-PB-8

Sample Type:

PB

Sample Location:

Room 302

Detailed Sample Location:

On equipment by east side door.

Sample Quantity:

NA


Sample Color:

Silver

XRF:


ND

Sample Photo:

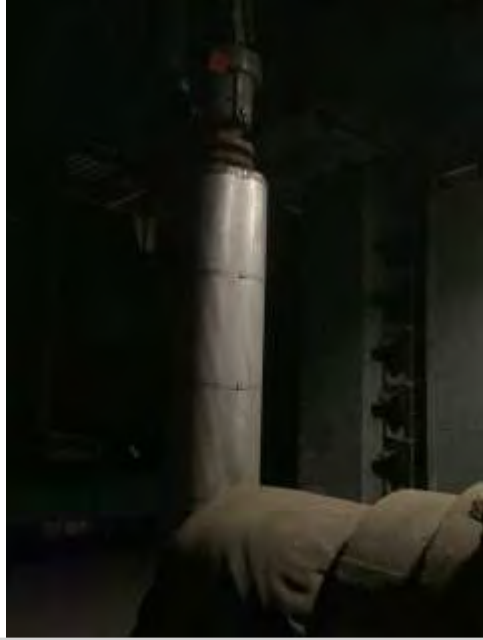

Additional Sample Notes:	Silver piping.
Sample ID:	Sample Type:
3-5-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 302	By west side door.
Sample Quantity:	NA
Sample Color:	XRF:
Red	0.528

Sample Photo:

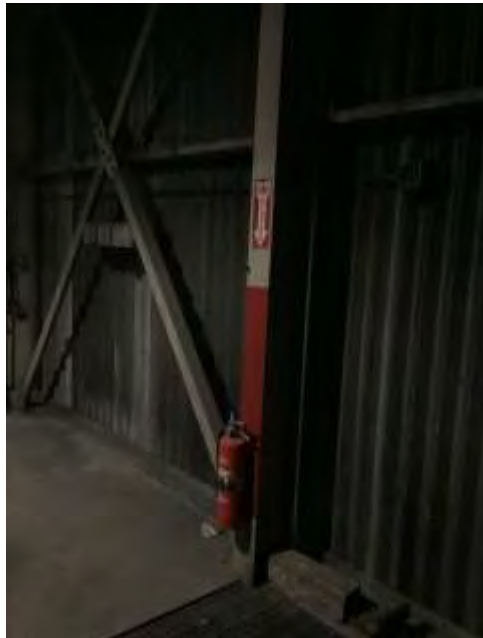


3-5-PB-9

Additional Sample Notes:	Red fire extinguisher marking paint.
---------------------------------	--------------------------------------

Sample ID:	Sample Type:
3-6-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 302	By west side door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.531

Sample Photo:

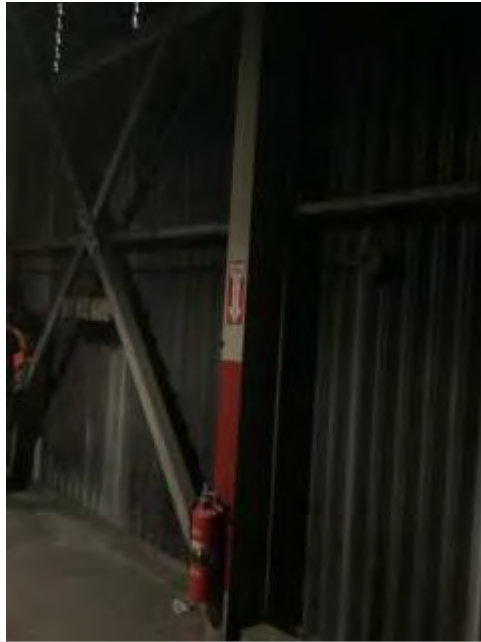

3-6-PB-10

Additional Sample Notes:	Tan paint above fire extinguisher.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
3-6-PB-11	PB
Sample Location:	Detailed Sample Location:
Room 302	By west side door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.922

Sample Photo:




3-6-PB-11

Additional Sample Notes:	Tan paint on I-beam next to safety switch box.
---------------------------------	--

Sample ID:	Sample Type:
3-6-PB-12	PB
Sample Location:	Detailed Sample Location:
Room 302	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.920

Sample Photo:

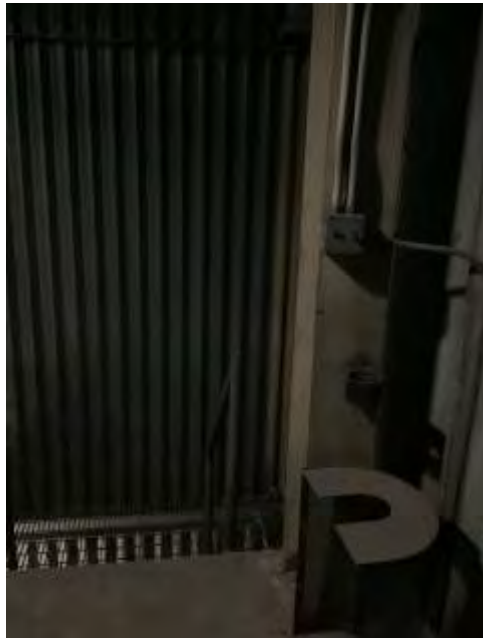

3-6-PB-12



Additional Sample Notes:	Tan paint on I-beam. Sample collected for laboratory analysis.
Sample ID:	Sample Type:
3-7-PB-13	PB
Sample Location:	Detailed Sample Location:
Room 302	East door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	ND

Sample Photo:




3-7-PB-13

Additional Sample Notes:	Tan paint on door.
---------------------------------	--------------------

Sample ID:	Sample Type:
3-7-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 302	West door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	ND

Sample Photo:

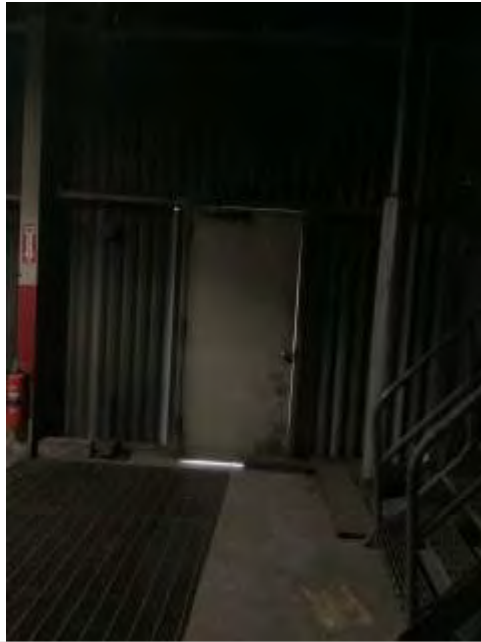


3-7-PB-14

Additional Sample Notes:	Tan paint on door.
---------------------------------	--------------------

Sample ID:	Sample Type:
3-8-PB-15	PB
Sample Location:	Detailed Sample Location:
Room 302	Southeast corner of room 302.
Sample Quantity:	NA
Sample Color:	XRF:
Brown	ND


Sample Photo:

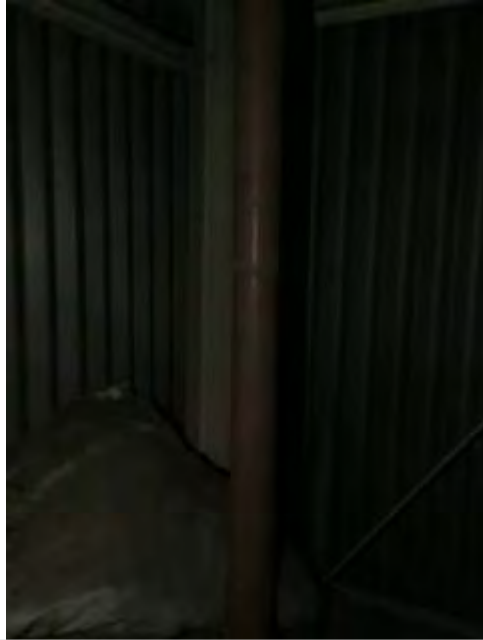

3-8-PB-15

Additional Sample Notes:		Brown paint on pipe to ceiling.
Sample ID:	Sample Type:	
3-8-MISC-11	MISC	
Sample Location:	Detailed Sample Location:	
Room 303	Window on west side of room.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:

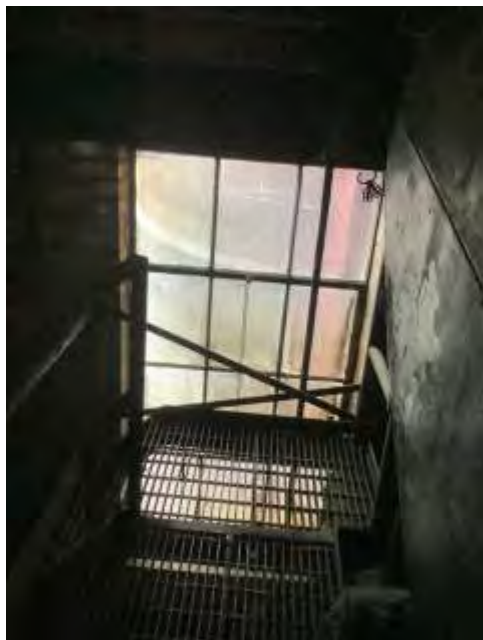


3-8-MISC-11



Additional Sample Notes:

Sample ID:	Sample Type:	
3-8-MISC-12	MISC	
Sample Location:	Detailed Sample Location:	
Room 303	Window on west side of room.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:

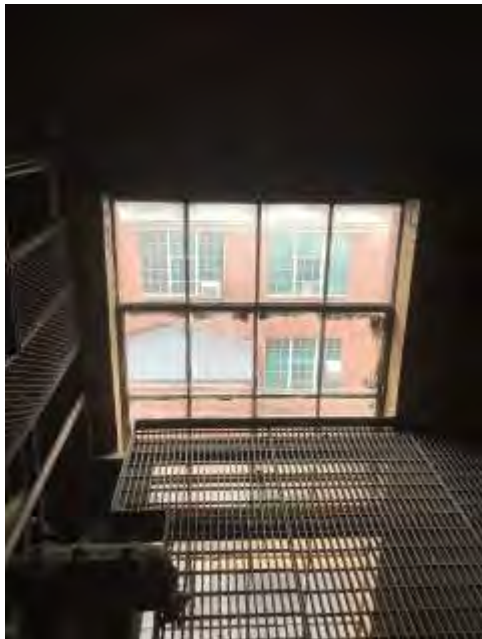

3-8-MISC-12



Additional Sample Notes:

Sample ID: 3-9-PB-16 **Sample Type:** PB

Sample Location: Room 303M **Detailed Sample Location:** Highest catwalk, southeast side.

Sample Quantity: NA

Sample Color: Dark gray **XRF:** ND

Sample Photo:



3-9-PB-16

Additional Sample Notes:	Door.
---------------------------------	-------

Sample ID:	Sample Type:
-------------------	---------------------

3-9-PB-17	PB
-----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 303M	Highest catwalk, southeast side.
-----------	----------------------------------

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Dark gray	ND
-----------	----

Sample Photo:



3-9-PB-17

Additional Sample Notes:	Door.
---------------------------------	-------

Sample ID:	Sample Type:
-------------------	---------------------

3-10-PB-18	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------


Room 303M	
-----------	--

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Red	0.095
-----	-------

Sample Photo:

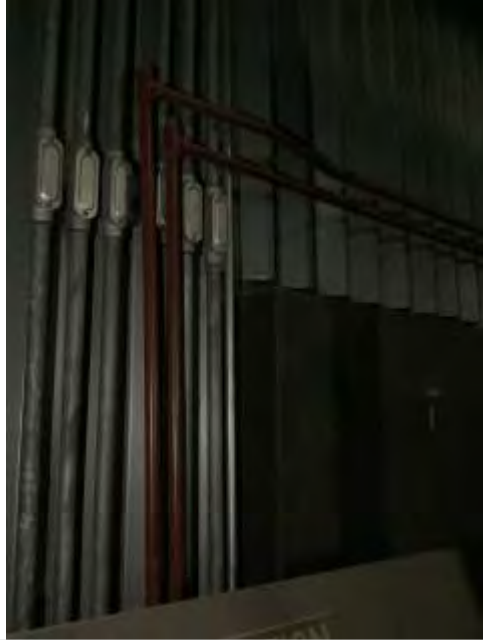

3-10-PB-18

Additional Sample Notes:	Door.
Sample ID:	Sample Type:
3-11-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 101	Highest catwalk.
Sample Quantity:	NA
Sample Color:	XRF:
Silver	ND

Sample Photo:



3-11-PB-19

Additional Sample Notes:	Silver paint on boiler.
---------------------------------	-------------------------

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 301	
Type of Fixture:	Quantity:
Asbestos dust breathing hazard signage.	
Condition:	Additional Fixture Notes:
Good	No material to sample in room.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 302	East wall.
Type of Fixture:	Quantity:
Unmarked jug and turbine oil container.	2
Condition:	Additional Fixture Notes:
Poor	

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 302	
Type of Fixture:	Quantity:
Potential mechanical fluid-containing fixture.	Throughout room
Condition:	Additional Fixture Notes:
Poor	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 302	West side of room.
Type of Fixture:	Quantity:
Potential electrical hazard.	2
Condition:	Additional Fixture Notes:
Good	1 control panel, 1 safety switch.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 303M	
Type of Fixture:	Quantity:
Potentially pressurized confined spaces.	17
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Highest catwalk.
Type of Fixture:	Quantity:
	2
Condition:	Additional Fixture Notes:
Good	Fluorescent lightbulbs.

Other Material Photo:



Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/13/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Basement

Samples

Sample ID:	Sample Type:	
4-1-TSI-1	TSI	
Sample Location:	Detailed Sample Location:	
Room 21	By entrance to room 22.	
Sample Quantity:	600 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:




4-1-TSI-1



Additional Sample Notes:		White insulation with silver fabric patch.	
Sample ID:		Sample Type:	
4-1-TSI-6		TSI	
Sample Location:		Detailed Sample Location:	
Room 23		Northeast corner of room.	
Sample Quantity:		600 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-6



Additional Sample Notes:	White insulation with silver fabric patch.	
Sample ID:	Sample Type:	
4-1-TSI-10	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Southeast portion of room by entrance to room 23.	
Sample Quantity:	600 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-10



Additional Sample Notes:	White insulation with silver fabric patch on boiler.
Sample ID:	Sample Type:
4-1-TSI-17	TSI
Sample Location:	Detailed Sample Location:
Room 11	Northeast portion of room between northeast staircase and elevator.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-17




Additional Sample Notes:	White insulation with silver fabric patch on machinery.
---------------------------------	---

Sample ID:	Sample Type:
4-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Room 17	East wall south of door.
Sample Quantity:	N/A

Sample Color:	XRF:
Light green	0.336

Sample Photo:

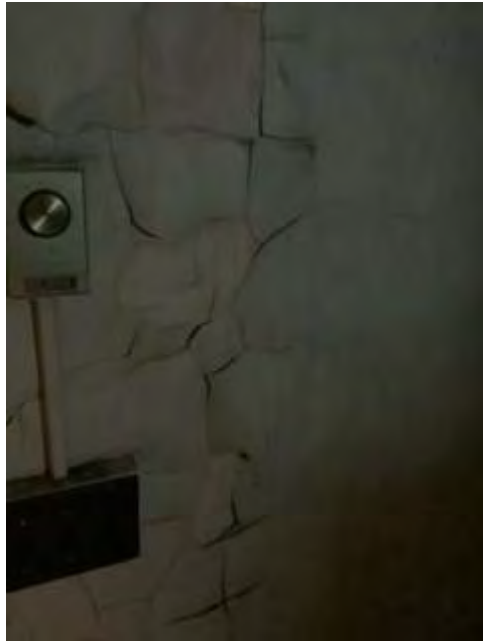

4-1-PB-1

Additional Sample Notes:

Sample ID:	Sample Type:
4-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room 17	Paint chip on floor nest to bathroom stall.
Sample Quantity:	N/A
Sample Color:	XRF:
Light green	0.237

Sample Photo:



4-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
4-1-PB-60	PB
Sample Location:	Detailed Sample Location:
Room 15	Paint on south wall of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Light green	0.014

Sample Photo:



4-1-PB-60

Additional Sample Notes:

Sample ID:	Sample Type:
4-1-PB-61	PB
Sample Location:	Detailed Sample Location:
Room 15	Southwest corner of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Light green	0.135

Sample Photo:



4-1-PB-61

Additional Sample Notes:

Sample ID:	Sample Type:
4-2-PB-52	PB
Sample Location:	Detailed Sample Location:
Room 11	Red wrapped pipe on south wall of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:




4-2-PB-52

Additional Sample Notes:

Sample ID:	Sample Type:
4-2-PB-3	PB
Sample Location:	Detailed Sample Location:
Room 21	Pipe in southwest corner of room 21.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:

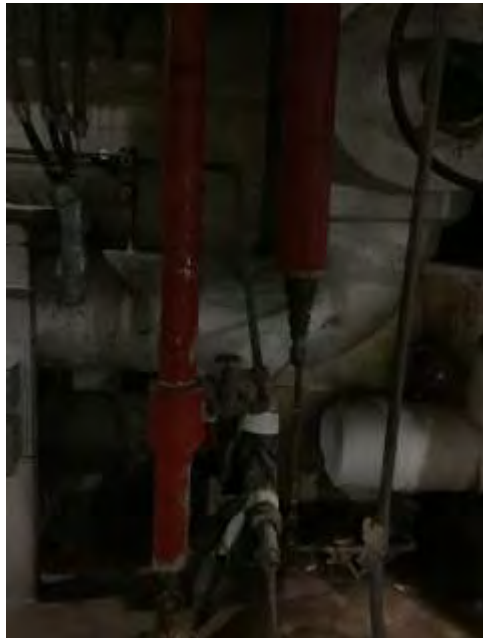

4-2-PB-3

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

4-2-TSI-29	TSI
------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 11	Center of room.
---------	-----------------

Sample Quantity:	1,200 linear feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:		
----------------------	--	--




4-2-TSI-29



Additional Sample Notes:		White insulation with silver painted wrap.	
Sample ID:		Sample Type:	
4-2-TSI-31		TSI	
Sample Location:		Detailed Sample Location:	
Room 11		Center of room.	
Sample Quantity:		1,200 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:




4-2-TSI-31



Additional Sample Notes:	White insulation with silver painted wrap.
Sample ID:	Sample Type:
4-2-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 21	Pipe in southwest corner of room 21.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:

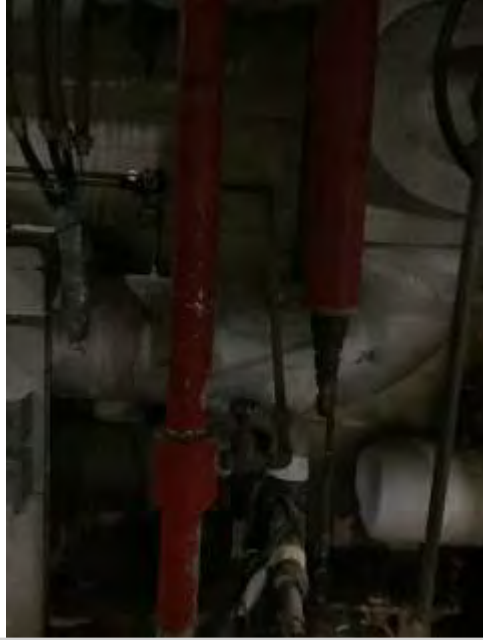

Additional Sample Notes:	
Sample ID:	Sample Type:
4-2-PB-25	PB
Sample Location:	Detailed Sample Location:
Room 23	Red pipe wrap on the south side of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.919

Sample Photo:



4-2-PB-25

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-2-TSI-20	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room near northeast staircase.	
Sample Quantity:	1,200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:




4-2-TSI-20





Additional Sample Notes:		White insulation with orange painted wrap.	
Sample ID:		Sample Type:	
4-2-TSI-22		TSI	
Sample Location:		Detailed Sample Location:	
Room 11		Northeast portion of room.	
Sample Quantity:		1,200 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-22

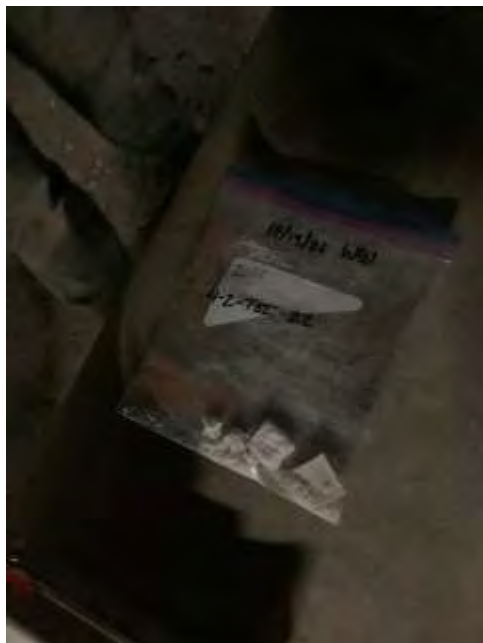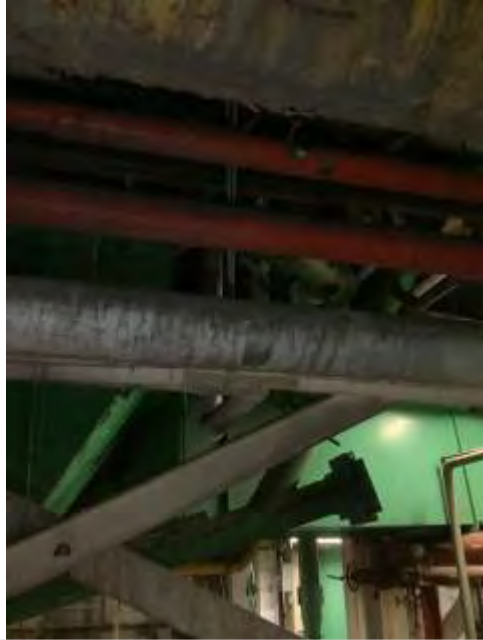

Additional Sample Notes:	White insulation with white painted wrap.	
Sample ID:	Sample Type:	
4-2-TSI-25	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	On west side of room by staircase down.	
Sample Quantity:	1,200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-25



Additional Sample Notes:	White insulation with orange painted wrap.
Sample ID:	Sample Type:
4-2-TSI-7	TSI
Sample Location:	Detailed Sample Location:
Room 23	Northeast corner of room.
Sample Quantity:	1,200 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-7



Additional Sample Notes:	White insulation with orange painted wrap.
---------------------------------	--

Sample ID:	Sample Type:
4-2-TSI-2	TSI
Sample Location:	Detailed Sample Location:
Room 21	By entrance to room 22.
Sample Quantity:	1,200 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-2




Additional Sample Notes:	White insulation with orange painted wrap.
---------------------------------	--

Sample ID:	Sample Type:
4-3-MISC-3	MISC
Sample Location:	Detailed Sample Location:

Room 22	East wall.	
Sample Quantity:	110 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown soundproofing wall pad.	Potential ACBM with potential for damage	Yes

Sample Photo:

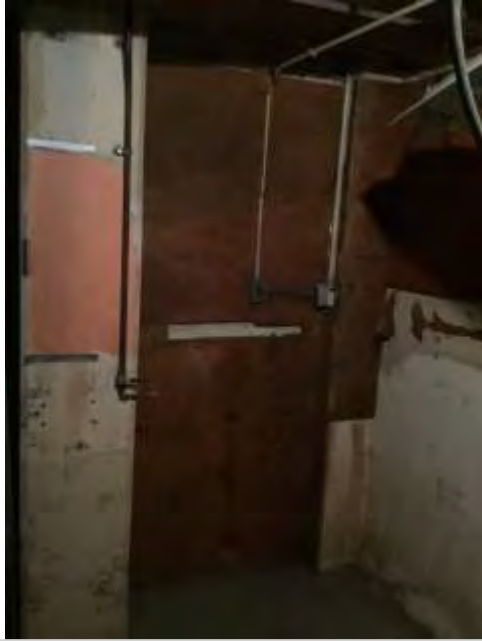

4-3-MISC-3




Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-3-MISC-4	MISC
Sample Location:	Detailed Sample Location:

Room 22	North wall.	
Sample Quantity:	110 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown soundproofing wall pad.	Potential ACBM with potential for damage	Yes

Sample Photo:

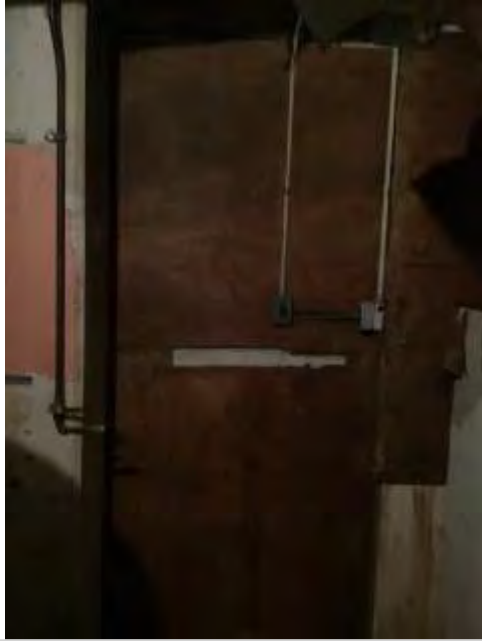

4-3-MISC-4



Additional Sample Notes:

Sample ID:	Sample Type:
4-3-PB-20	PB
Sample Location:	Detailed Sample Location:

Room 23	Red pipe in southwest corner.
Sample Quantity:	145 linear feet.
Sample Color:	XRF:
Red	ND

Sample Photo:



4-3-PB-20

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-3-PB-4	PB
Sample Location:	Detailed Sample Location:
Room 21	Tank on north wall east of entrance.
Sample Quantity:	145 linear feet.
Sample Color:	XRF:
Red	1.346

Sample Photo:





4-3-PB-4



Additional Sample Notes:

Did not XRF tank due to high heat. Submitted sample to laboratory for analysis.

Sample ID:

4-3-PB-38

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Northwest corner of room.

Sample Quantity:

145 linear feet.

Sample Color:

Red

XRF:

2.01

Sample Photo:



4-3-PB-38

Additional Sample Notes:

Sample ID:	Sample Type:
4-3-PB-43	PB
Sample Location:	Detailed Sample Location:
Room 11	Red pipe on the north side of room south of active tank.
Sample Quantity:	145 linear feet.
Sample Color:	XRF:
Red	5.0

Sample Photo:



4-3-PB-43

Additional Sample Notes:

Sample ID:	Sample Type:
4-4-PB-30	PB
Sample Location:	Detailed Sample Location:
Room 11	Silver support on west side of room east of sun basement entrance.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



4-4-PB-30

Additional Sample Notes:

Sample ID:	Sample Type:
4-4-PB-33	PB
Sample Location:	Detailed Sample Location:
Room 11	Silver painted equipment on west side of room north of sub basement door.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



4-4-PB-33

Additional Sample Notes:	
Sample ID:	Sample Type:
4-4-PB-47	PB
Sample Location:	Detailed Sample Location:
Room 11	Underside of lid on southwest face of northeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	0.071

Sample Photo:



4-4-PB-47

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-4-PB-5	PB
Sample Location:	Detailed Sample Location:
Room 21	Silver pipe support on north ceiling.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	0.024

Sample Photo:



4-4-PB-5

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:	
4-4-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
Room 22	Northwest corner tabletop.	
Sample Quantity:	15 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Off-white laminate tabletop with clear adhesive.	Potential ACBM with potential for damage	Yes

Sample Photo:



4-4-MISC-5



Additional Sample Notes:

Sample ID:	Sample Type:
4-5-PB-6	PB
Sample Location:	Detailed Sample Location:
Room 21	Cabinet in center of room north of room 22.
Sample Quantity:	N/A
Sample Color:	XRF:
Gray	0.063


Sample Photo:




4-5-PB-6

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-5-TSI-8	TSI	
Sample Location:	Detailed Sample Location:	
Room 23	Southeast corner of room.	
Sample Quantity:	200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-8

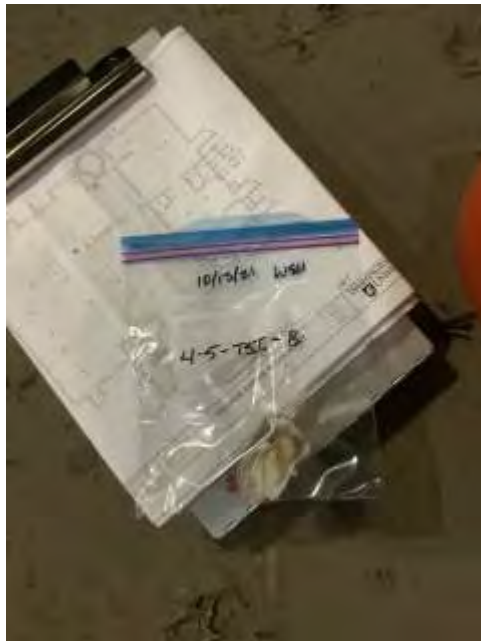

Additional Sample Notes:		Silver steam pipe fabric wrap.	
Sample ID:		Sample Type:	
4-5-TSI-9		TSI	
Sample Location:		Detailed Sample Location:	
Room 11		Southeast corner of room by entrance to room 23.	
Sample Quantity:		200 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-9



Additional Sample Notes:	Silver steam pipe fabric wrap.
Sample ID:	Sample Type:
4-5-TSI-26	TSI
Sample Location:	Detailed Sample Location:
Room 11	On west side of room by staircase down.
Sample Quantity:	200 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-26



Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:
4-5-TSI-21	TSI
Sample Location:	Detailed Sample Location:
Room 11	Northeast portion of room near northeast staircase.
Sample Quantity:	200 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-21



Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:
4-5-TSI-11	TSI

Sample Location:	Detailed Sample Location:

Room 11	East portion of room by spiral staircase.	
Sample Quantity:	200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-11



Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

4-5-TSI-13	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	East portion of room north of spiral staircase.	
Sample Quantity:	200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-13




Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:	
4-6-TSI-12	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	East portion of room north of spiral staircase.	
Sample Quantity:	40 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-6-TSI-12

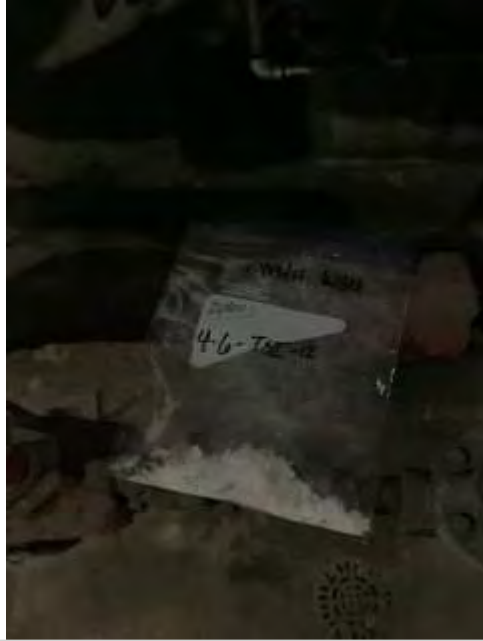

Additional Sample Notes:	Red steam pipe fabric wrap.
Sample ID:	Sample Type:
4-6-PB-8	PB
Sample Location:	Detailed Sample Location:
Room 21	Door frame to room 18.
Sample Quantity:	N/A
Sample Color:	XRF:
Blue gray	0.086

Sample Photo:



4-6-PB-8

Additional Sample Notes:

Sample ID:	Sample Type:
4-7-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 18	Tank in southeast corner of room.
Sample Quantity:	5 linear feet.
Sample Color:	XRF:
Silver	5.00

Sample Photo:



4-7-PB-9

Additional Sample Notes:

Sample ID:	Sample Type:	
4-7-TSI-33	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Center of room.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-33



Additional Sample Notes:		Yellow insulation with red painted silver wrap.
Sample ID:	Sample Type:	
4-7-TSI-18	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room between northeast staircase and elevator.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-18



Additional Sample Notes:	Orange steam pipe fabric wrap with yellow insulation.
Sample ID:	Sample Type:
4-7-TSI-19	TSI
Sample Location:	Detailed Sample Location:
Room 11	Northeast portion of room between northeast staircase and elevator.
Sample Quantity:	500 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-19



Additional Sample Notes:	Orange steam pipe fabric wrap with yellow insulation.
---------------------------------	---

Sample ID:	Sample Type:
4-7-TSI-14	TSI
Sample Location:	Detailed Sample Location:
Room 11	East portion of room north of spiral staircase.
Sample Quantity:	500 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-14



Additional Sample Notes:	Silver steam pipe fabric wrap with yellow insulation.
---------------------------------	---

Sample ID:	Sample Type:
-------------------	---------------------

4-7-TSI-15	TSI
------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 11	East portion of room north of spiral staircase.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-15



Additional Sample Notes:	Red steam pipe fabric wrap with yellow insulation.
---------------------------------	--


Sample ID:	Sample Type:
-------------------	---------------------

4-7-TSI-27	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	West portion of room by staircase to room 101.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-27

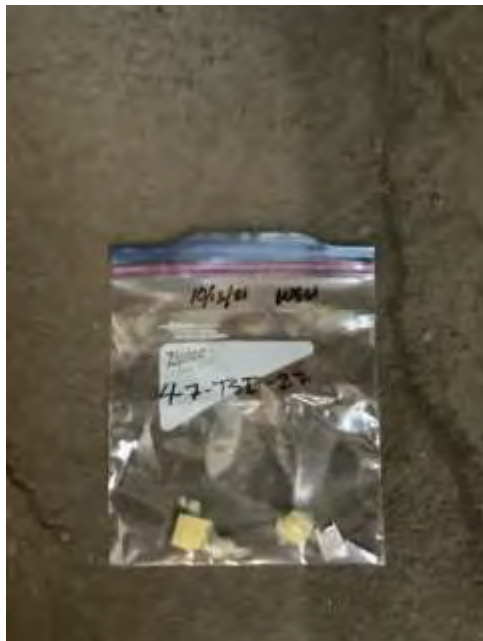


Additional Sample Notes: White condensate pipe with yellow insulation.

Sample ID:	Sample Type:	
4-7-TSI-28	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	West portion of room by staircase to room 101.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-28

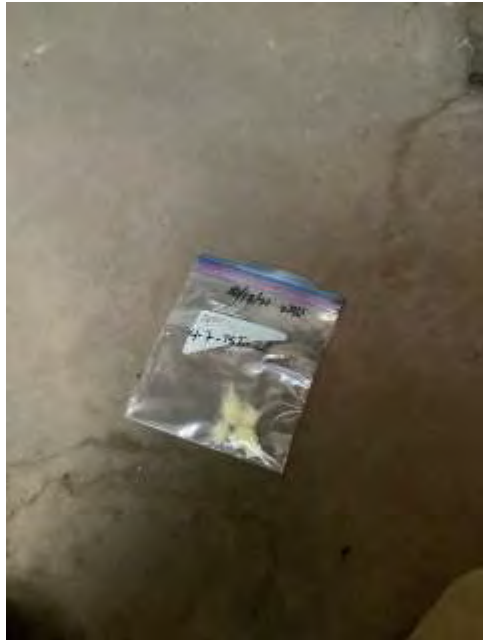

Additional Sample Notes:		White condensate line elbow with yellow insulation.
Sample ID:	Sample Type:	
4-8-MISC-16	MISC	
Sample Location:	Detailed Sample Location:	
Room 11	By control wheels and conveying systems.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Silver woven heat-resistant seal material on hatch interior.	Potential ACBM with potential for damage	No

Sample Photo:



4-8-MISC-16



Additional Sample Notes:

Sample ID:	Sample Type:	
4-8-MISC-30	MISC	
Sample Location:	Detailed Sample Location:	
Room 11	By control wheels and conveying systems.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Silver woven heat-resistant seal material on hatch interior.	Potential ACBM with potential for damage	No

Sample Photo:



4-8-MISC-30



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-8-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 18	Pipe underneath tank in southeast corner.
Sample Quantity:	10 linear feet.
Sample Color:	XRF:
Orange	5.00

Sample Photo:

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:	
4-8-MISC-24	MISC	
Sample Location:	Detailed Sample Location:	
Room 11	By control wheels and conveying systems.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Silver woven heat-resistant seal material on hatch interior.	Potential ACBM with potential for damage	No

Sample Photo:



4-8-MISC-24



Additional Sample Notes:

Sample ID:

4-9-PB-11

Sample Type:

PB

Sample Location:

Room 18A

Detailed Sample Location:

South side of stairway in 18A.

Sample Quantity:

N/A

Sample Color:

White

XRF:

0.300

Sample Photo:



4-9-PB-11

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-9-TSI-32	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-9-TSI-32




Additional Sample Notes:	White tank insulation with orange wrap.	
Sample ID:	Sample Type:	
4-9-TSI-23	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-9-TSI-23

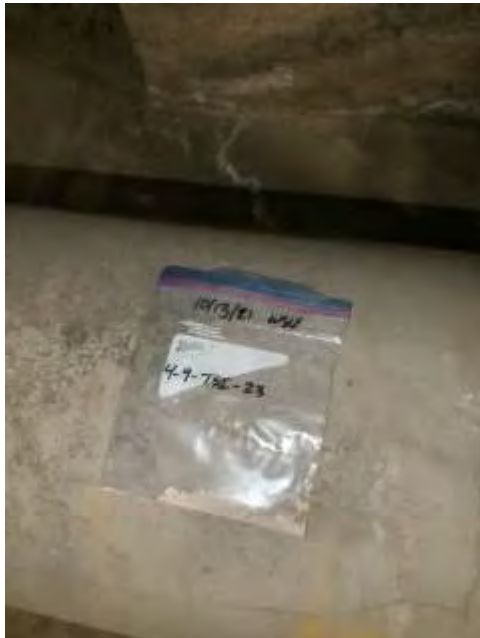


Additional Sample Notes:	White tank insulation with gray painted wrap and fabric patch.	
Sample ID:	Sample Type:	
4-10-MISC-34	MISC	
Sample Location:	Detailed Sample Location:	
Room 18	East wall of room.	
Sample Quantity:	350 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar.	Potential ACBM with potential for damage	No

Sample Photo:



4-10-MISC-34

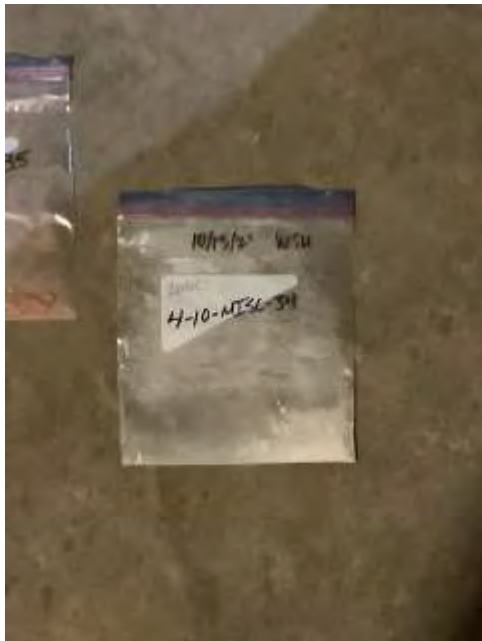

Additional Sample Notes:

Sample ID:

4-10-PB-12

Sample Type:

PB

Sample Location:

Room 18 A

Detailed Sample Location:

Pipe in west side of room.

Sample Quantity:

N/A

Sample Color:

Gray

XRF:

0.085

Sample Photo:



4-10-PB-12

Additional Sample Notes:

Sample ID:

4-11-PB-13

Sample Type:

PB

Sample Location:

Room 21

Detailed Sample Location:

Red fire extinguisher marking paint on northwest corner

Sample Quantity:

N/A

Sample Color:

Red

XRF:

ND

Sample Photo:

4-11-PB-13



Additional Sample Notes:

Sample ID:

4-11-MISC-35

Sample Type:

MISC

Sample Location:

Room 18

Detailed Sample Location:

North wall of room.

Sample Quantity:

180 square feet.

Misc Sample Material:

Red brick

Sample Condition:

Potential ACBM with potential for damage


Sample Friable?:

No

Sample Photo:



4-11-MISC-35

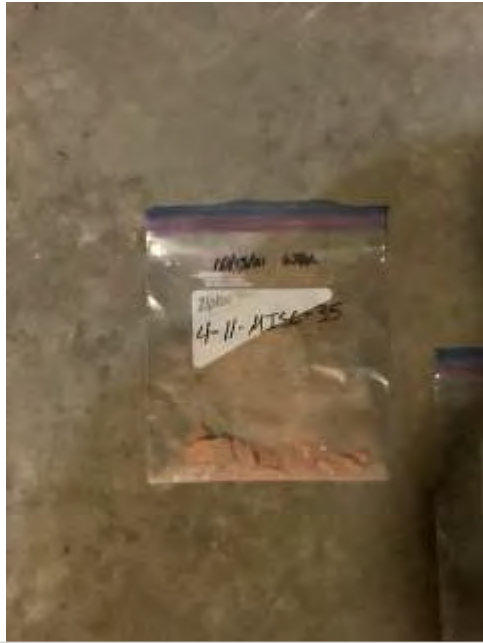

Additional Sample Notes:

Sample ID:

4-11-PB-54

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Red fire extinguisher marking in southeast corner of room north of spiral staircase.

Sample Quantity:

N/A

Sample Color:

Red

XRF:

ND

Sample Photo:




4-11-PB-54

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-12-MISC-36	MISC	
Sample Location:	Detailed Sample Location:	
Bathroom by west exit in stairwell.		
Sample Quantity:	60 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White textured waterproofing tile.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:



4-12-MISC-36

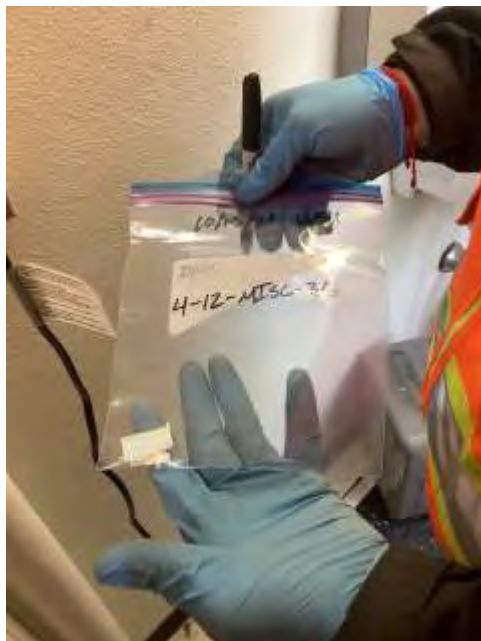

Additional Sample Notes:

Sample ID:	Sample Type:
4-12-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 21	Door to room 15.
Sample Quantity:	24 square feet.
Sample Color:	XRF:
Gray	4.11

Sample Photo:




4-12-PB-14

Additional Sample Notes:

Sample ID:	Sample Type:
4-13-PB-15	PB
Sample Location:	Detailed Sample Location:
Room 21	Paint under new paint on door to room 15.
Sample Quantity:	24 square feet.
Sample Color:	XRF:
Light tan	3.40

Sample Photo:

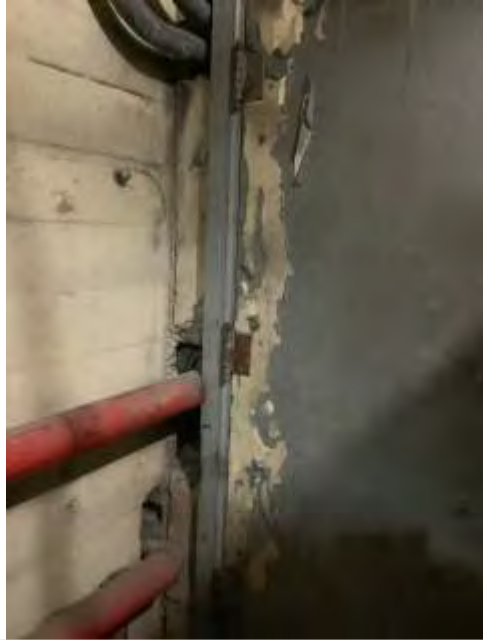

4-13-PB-15

Additional Sample Notes:

Sample ID:	Sample Type:	
4-13-MISC-37	MISC	
Sample Location:	Detailed Sample Location:	
Bathroom by exit		
Sample Quantity:	30 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:



4-13-MISC-37



Additional Sample Notes:

Sample ID:

4-14-MISC-38

Sample Type:

MISC

Sample Location:

Bathroom by exit

Detailed Sample Location:

Sample Quantity:

20 square feet.

Misc Sample Material:

Black 12" x 12" linoleum floor tile with yellow adhesive

Sample Condition:

Damaged or significantly damaged friable miscellaneous ACM

Sample Friable?:

No

Sample Photo:



4-14-MISC-38



Additional Sample Notes:

Sample ID:	Sample Type:
4-14-PB-16	PB
Sample Location:	Detailed Sample Location:
Room 21	Orange pipe on south wall west of room 22.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	5.00

Sample Photo:



4-14-PB-16

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-21	PB
Sample Location:	Detailed Sample Location:
Room 23	Orange pipe on east wall.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	3.70

Sample Photo:



4-14-PB-21

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-55	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange pipe wrap in southeast corner of room north of spiral staircase.
Sample Quantity:	600 linear feet
Sample Color:	XRF:
Orange	1.275

Sample Photo:



4-14-PB-55

Additional Sample Notes:

Sample ID:	Sample Type:
4-14-PB-57	PB
Sample Location:	Detailed Sample Location:
Room 11	Southeast corner of room east of doorway.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	4.49

Sample Photo:




4-14-PB-57

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-42	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange pipe in northwest corner of room west of active tank.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	5.0

Sample Photo:

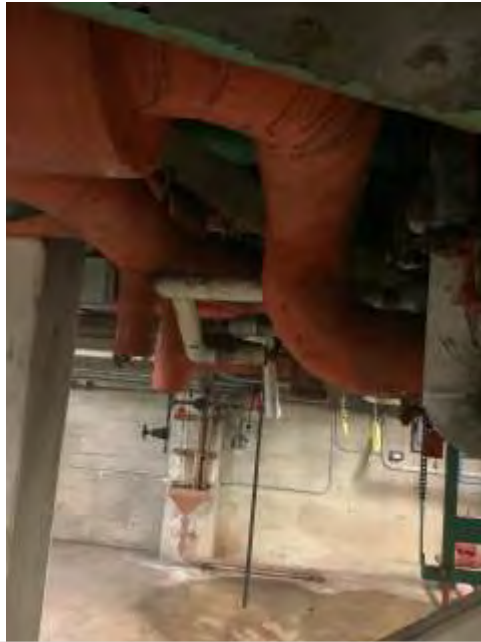

4-14-PB-42

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-50	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange tank in center of room between the two north boilers.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	1.223

Sample Photo:



4-14-PB-50



Additional Sample Notes:	Submitted sample to laboratory for analysis.
Sample ID:	Sample Type:
4-14-PB-27	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange pipe in southwest corner of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	3.32

Sample Photo:



4-14-PB-27

Additional Sample Notes:

Sample ID:	Sample Type:
4-14-PB-44	PB
Sample Location:	Detailed Sample Location:
Room 11	Northeast corner of room west of exit doorway.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	2.43

Sample Photo:



4-14-PB-44

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-15-PB-17	PB
Sample Location:	Detailed Sample Location:
Room 21	White paint on orange pipe on south wall west of room 22.
Sample Quantity:	2 linear feet.
Sample Color:	XRF:
White	5.00

Sample Photo:



4-15-PB-17

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:	
4-15-MISC-39	MISC	
Sample Location:	Detailed Sample Location:	
Bathroom by exit		
Sample Quantity:	20 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White 12" x 12" linoleum floor tile with yellow adhesive.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:



4-15-MISC-39



Additional Sample Notes:

Sample ID:

4-16-MISC-40

Sample Type:

MISC

Sample Location:

Bathroom by exit

Detailed Sample Location:

Sample Quantity:

21 linear feet.

Misc Sample Material:

Black cove base with tan adhesive.


Sample Condition:

Damaged or significantly damaged friable miscellaneous ACM


Sample Friable?:

No

Sample Photo:

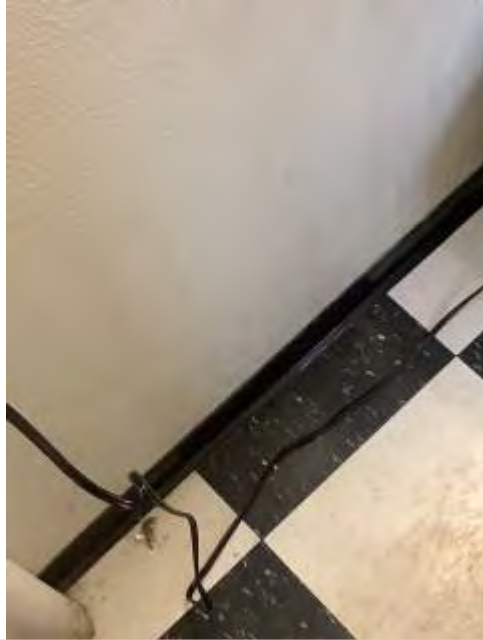

4-16-MISC-40

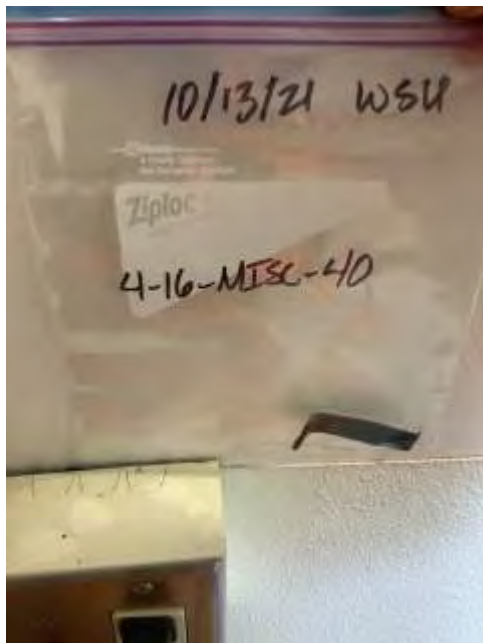

Additional Sample Notes:

Sample ID:

4-16-PB-18

Sample Type:

PB

Sample Location:

Room 22

Detailed Sample Location:

East wall of room.

Sample Quantity:

N/A

Sample Color:

Tan

XRF:

ND

Sample Photo:



4-16-PB-18

Additional Sample Notes:

Sample ID:	Sample Type:
4-16-PB-24	PB
Sample Location:	Detailed Sample Location:
Room 23	Tan paint on northwest corner of wall.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	ND

Sample Photo:



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-16-PB-28	PB
Sample Location:	Detailed Sample Location:
Room 11	Support beam in southwest center of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	ND

Sample Photo:



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-16-PB-51	PB
Sample Location:	Detailed Sample Location:
Room 11	Support beam on south side of room east of green air equipment.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.005

Sample Photo:





4-16-PB-51

Additional Sample Notes:

Sample ID:	Sample Type:	
4-17-MISC-41	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	Northeast floor in front of door.	
Sample Quantity:	180 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 1"-2" square tile with brown adhesive.	Potential ACBM with potential for damage	No

Sample Photo:



4-17-MISC-41



Additional Sample Notes:

Sample ID:

4-17-MISC-42

Sample Type:

MISC

Sample Location:

Room 17

Detailed Sample Location:

South center room next to center dividing wall.

Sample Quantity:

180 square feet.

Misc Sample Material:

Tan 1"-2" square tile with brown adhesive.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:




4-17-MISC-42



Additional Sample Notes:	
Sample ID:	Sample Type:
4-17-PB-45	PB
Sample Location:	Detailed Sample Location:
Room 11	Yellow concrete block In northeast corner of room south of exit doorway.
Sample Quantity:	N/A
Sample Color:	XRF:
Yellow	ND

Sample Photo:

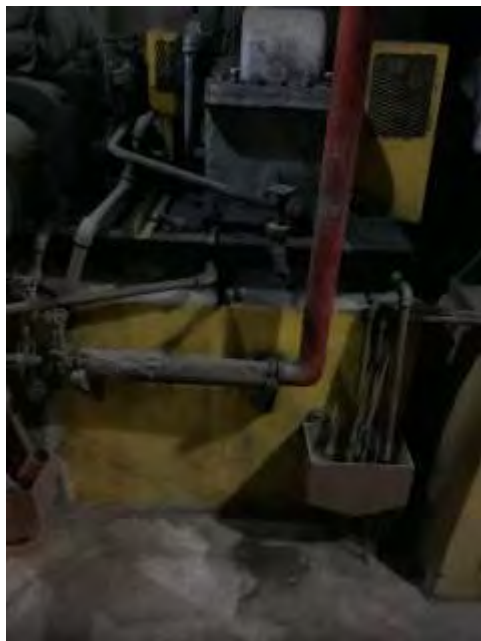

4-17-PB-45

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-17-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 21	Yellow caution paint above doorway to room 11.
Sample Quantity:	N/A
Sample Color:	XRF:
Yellow	ND

Sample Photo:



4-17-PB-19

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-18-PB-22	PB
Sample Location:	Detailed Sample Location:
Room 23	Yellow pipe in northeast corner.
Sample Quantity:	N/A
Sample Color:	XRF:
Yellow	0.305

Sample Photo:






4-18-PB-22

Additional Sample Notes:

Sample ID:	Sample Type:	
4-18-MISC-43	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	South wall of room.	
Sample Quantity:	920 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with gray cementitious wallboard.	Potential ACBM with potential for damage	No

Sample Photo:

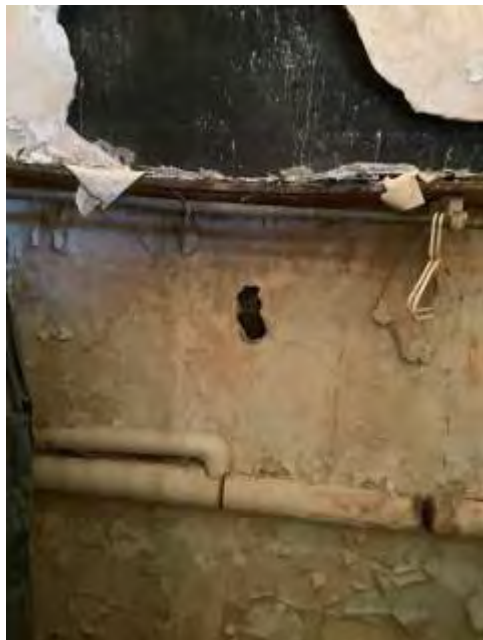


4-18-MISC-43



Additional Sample Notes:

Sample ID:	Sample Type:	
4-18-MISC-45	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	West wall in northwest corner.	
Sample Quantity:	920 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with gray cementitious wallboard.	Potential ACBM with potential for damage	No

Sample Photo:

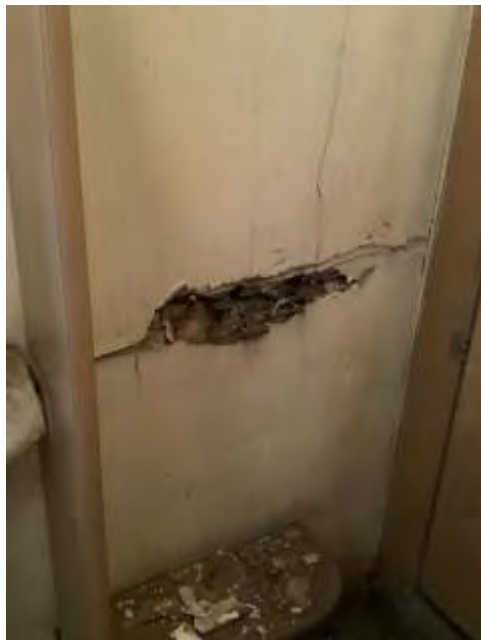

4-18-MISC-45



Additional Sample Notes:

Sample ID:	Sample Type:	
4-19-MISC-44	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	West wall in northwest corner.	
Sample Quantity:	60 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cove base with green adhesive.	Potential ACBM with potential for damage	No

Sample Photo:



4-19-MISC-44



Additional Sample Notes:

Sample ID:

4-19-PB-39

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Northwest corner of room south of window.

Sample Quantity:

N/A

Sample Color:

Blue

XRF:

0.084

Sample Photo:



4-19-PB-39

Additional Sample Notes:

Sample ID:	Sample Type:
4-19-PB-23	PB
Sample Location:	Detailed Sample Location:
Room 23	Blue pipe in northeast corner.
Sample Quantity:	N/A
Sample Color:	XRF:
Blue	0.306

Sample Photo:



4-19-PB-23

Additional Sample Notes:

Sample ID:	Sample Type:
4-20-PB-26	PB
Sample Location:	Detailed Sample Location:
Room 23	Green equipment on south side of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.908

Sample Photo:



4-20-PB-26

Additional Sample Notes:

Sample ID:	Sample Type:
4-21-PB-29	PB
Sample Location:	Detailed Sample Location:
Room 11	White pipe wrap on west side of room east of sun basement entrance.
Sample Quantity:	N/A
Sample Color:	XRF:
White	ND

Sample Photo:



4-21-PB-29

Additional Sample Notes:

Sample ID:	Sample Type:
4-22-PB-31	PB
Sample Location:	Detailed Sample Location:
Room 11	Yellow pipe on east side of room east of door to sub basement.
Sample Quantity:	140 linear feet.
Sample Color:	XRF:
Yellow	5.00

Sample Photo:



4-22-PB-31

Additional Sample Notes:

Sample ID:	Sample Type:
4-22-PB-37	PB
Sample Location:	Detailed Sample Location:
Room 11	North side of room north of northwest boiler.
Sample Quantity:	140 linear feet.
Sample Color:	XRF:
Yellow	3.67

Sample Photo:



4-22-PB-37

Additional Sample Notes:

Sample ID:	Sample Type:
4-22-PB-48	PB
Sample Location:	Detailed Sample Location:
Room 11	Center of room east of southwest boiler.
Sample Quantity:	140 linear feet.
Sample Color:	XRF:
Yellow	4.38

Sample Photo:



4-22-PB-48

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-23-PB-49	PB
Sample Location:	Detailed Sample Location:
Room 11	Support in center of room between the two north boilers.
Sample Quantity:	280 linear feet.
Sample Color:	XRF:
Bright white	5.00

Sample Photo:



4-23-PB-49

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-23-PB-32	PB
Sample Location:	Detailed Sample Location:
Room 11	Support in northwest corner.
Sample Quantity:	264 linear feet.
Sample Color:	XRF:
Bright white	5.00

Sample Photo:



4-23-PB-32



Additional Sample Notes:	Submitted sample to laboratory for analysis.
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

4-23-PB-34	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 11	Support on north side of room east of active tank.
---------	--

Sample Quantity:	264 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

White	0.146
-------	-------

Sample Photo:



4-23-PB-34

Additional Sample Notes:

Sample ID:	Sample Type:
4-23-PB-35	PB
Sample Location:	Detailed Sample Location:
Room 11	North side of room south of active tank.
Sample Quantity:	280 linear feet.
Sample Color:	XRF:
White	5.00

Sample Photo:



4-23-PB-35

Additional Sample Notes:	
Sample ID:	Sample Type:
4-24-PB-36	PB
Sample Location:	Detailed Sample Location:
Room 11	North side of room north of northwest boiler.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	0.241

Sample Photo:



4-24-PB-36



Additional Sample Notes:	Submitted sample to laboratory for analysis.
---------------------------------	--

Sample ID:	Sample Type:
4-24-PB-40	PB
Sample Location:	Detailed Sample Location:
Room 11	Northwest corner of room.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	ND

Sample Photo:




4-24-PB-36

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-24-PB-46	PB
Sample Location:	Detailed Sample Location:
Room 11	East side of room east of northeast boiler.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	1.178

Sample Photo:

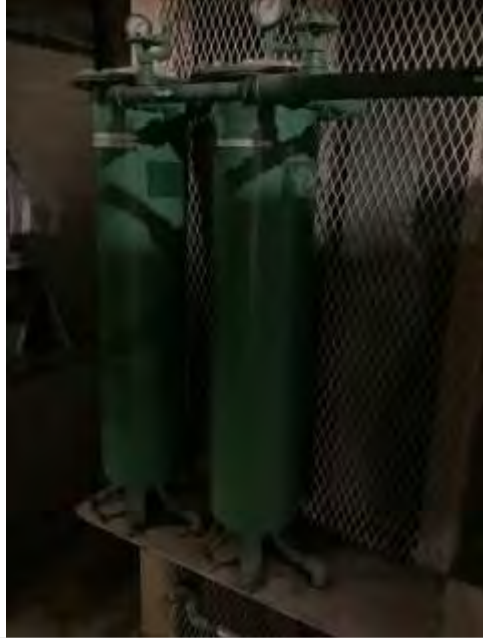

4-24-PB-36

Additional Sample Notes:	Difficult to quantify.
Sample ID:	Sample Type:
4-24-PB-53	PB
Sample Location:	Detailed Sample Location:
Room 11	Green pipe and equipment on south side of room east of entrance to room 21.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	0.220

Sample Photo:



4-24-PB-53

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-24-PB-58	PB
Sample Location:	Detailed Sample Location:
Room 11	Southwest corner of room.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	0.084

Sample Photo:



4-24-PB-58

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-25-PB-59	PB
Sample Location:	Detailed Sample Location:
Room 11	Southeast corner of room west of southeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Reddish brown	0.069

Sample Photo:






4-25-PB-59

Additional Sample Notes:

Sample ID:	Sample Type:
4-25-PB-41	PB
Sample Location:	Detailed Sample Location:
Room 11	Drain pipe in northwest corner of room west of active tank.
Sample Quantity:	N/A
Sample Color:	XRF:
Reddish brown	ND

Sample Photo:

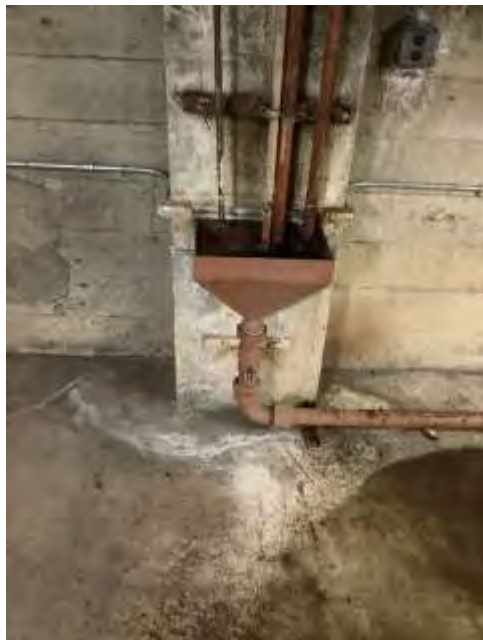

4-25-PB-41

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-26-PB-56	PB
Sample Location:	Detailed Sample Location:
Room 11	Silver pipe wrap southeast corner of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



4-26-PB-56

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-27-PB-62	PB
Sample Location:	Detailed Sample Location:
Room 15	East side of center wall of room next to mirror.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.008

Sample Photo:



4-27-PB-62

Additional Sample Notes:

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 15	Throughout room.
Type of Fixture:	Quantity:
Mechanical fluid hazard.	Throughout room.
Condition:	Additional Fixture Notes:
Good	Mechanical fluid containers throughout room.

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 17	Throughout room.
Type of Fixture:	Quantity:
Potential lead paint hazard.	Throughout room.
Condition:	Additional Fixture Notes:
Severely damaged	Paint peeling off walls and ceiling.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 21 and room 23	Throughout rooms.
Type of Fixture:	Quantity:
Hot pipes and tanks.	Several
Condition:	Additional Fixture Notes:
Good	Burn hazard from hot pipes and tanks.

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 21	North wall.
Type of Fixture:	Quantity:
Low clearance.	1
Condition:	Additional Fixture Notes:
Good	Low ceiling hazard.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 21	Throughout room.
Type of Fixture:	Quantity:
Electrical hazard.	3
Condition:	Additional Fixture Notes:
Good	1 electric source control unit, 1 electrical control panel, 1 electrical switch box.

Other Material Photo:






Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	Throughout room.
Type of Fixture:	Quantity:
Electrical fixtures.	25
Condition:	Additional Fixture Notes:
Good	1 control box, 20 control switch, 3 electrical boxes, 1 motor control center.

Other Material Photo:





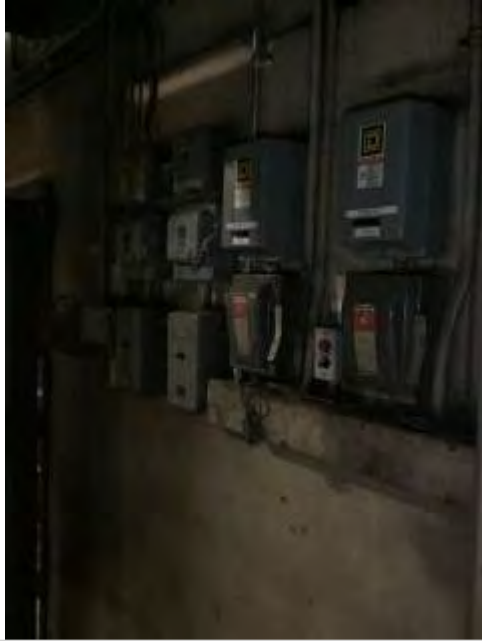

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	North side of room.
Type of Fixture:	Quantity:
Active steam equipment.	Several
Condition:	Additional Fixture Notes:
Good	Active tanks, pumps, and lines.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	Throughout room.
Type of Fixture:	Quantity:
Low clearance.	Several
Condition:	Additional Fixture Notes:
Good	Low pipes and supports.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	East side of room.
Type of Fixture:	Quantity:
Elevator shaft.	1
Condition:	Additional Fixture Notes:
Good	Potential hazard related to mechanical operation.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11, 21, 23	Throughout rooms.
Type of Fixture:	Quantity:
Fluorescent light fixtures.	43
Condition:	Additional Fixture Notes:
Good	34 lights in place and active, 9 in box in room 21.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	Throughout room.
Type of Fixture:	Quantity:
Steam equipment.	Several
Condition:	Additional Fixture Notes:
Good	Mechanical fluid hazard related to inactive and active equipment.

Other Material Photo:




Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/14/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Sub Basement

Samples

Sample ID:	Sample Type:
5-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Room B1	West hall entrance.
Sample Quantity:	110 linear feet.
Sample Color:	XRF:
Yellow	0.023

Sample Photo:

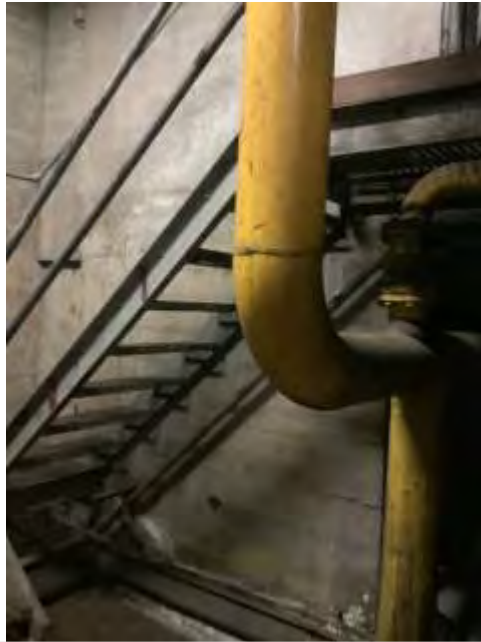

5-1-PB-1

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
5-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room B1	Center of hallway.
Sample Quantity:	110 linear feet.
Sample Color:	XRF:
Yellow	ND

Sample Photo:



5-1-PB-2



Additional Sample Notes:

Submitted sample to laboratory for analysis

Sample ID:

5-1-PB-3

Sample Type:

PB

Sample Location:

Room B1

Detailed Sample Location:

East end of hallway.

Sample Quantity:

110 linear feet.

Sample Color:

Yellow

XRF:

2.08

Sample Photo:



5-1-PB-3

Additional Sample Notes:

Sample ID:

5-2-PB-4

Sample Type:

PB

Sample Location:

Room B3

Detailed Sample Location:

Center of room.

Sample Quantity:

5 linear feet.

Sample Color:

Orange

XRF:

1.012

Sample Photo:

5-2-PB-4



Additional Sample Notes:

Sample ID:

5-3-PB-5

Sample Type:

PB

Sample Location:

Room B1

Detailed Sample Location:

East wall at end of hall.

Sample Quantity:

N/A

Sample Color:

Brown

XRF:

0.08

Sample Photo:



5-3-PB-5

Additional Sample Notes:

Sample ID:	Sample Type:
5-3-PB-6	PB
Sample Location:	Detailed Sample Location:
Room B1	East end in the center of hall.
Sample Quantity:	N/A
Sample Color:	XRF:
Brown	ND

Sample Photo:



5-3-PB-6

Additional Sample Notes:

Sample ID:	Sample Type:
5-4-PB-7	PB
Sample Location:	Detailed Sample Location:
Room B1	Center of hallway.
Sample Quantity:	N/A
Sample Color:	XRF:
Reddish brown	ND

Sample Photo:



5-4-PB-7

Additional Sample Notes:

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room B1	Southeast corner of room.
Type of Fixture:	Quantity:
Fluorescent bulbs.	3
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room B2	Whole room.
Type of Fixture:	Quantity:
Confined space.	1
Condition:	Additional Fixture Notes:
Good	Confined space hazard in room B2.

Other Material Photo:



Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/14/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Exterior

Samples

Sample ID:	Sample Type:	
EXT-1-MISC-1	MISC	
Sample Location:	Detailed Sample Location:	
West exterior side of structure.	West exterior side of room 101 north of double doors next to ash pit tower.	
Sample Quantity:	15,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red brick	Potential ACBM with potential for damage; Remaining friable ACBM or friable suspected ACBM	No

Sample Photo:



EXT-1-MISC-1



Additional Sample Notes:	Difficult to quantify material.
---------------------------------	---------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

EXT-1-MISC-4	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

East exterior side of structure.	East exterior side of room 101 south of stairwell exit door and north of windows.
----------------------------------	---

Sample Quantity:	15,000 square feet.
-------------------------	---------------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Red brick	Potential ACBM with potential for damage	No
-----------	--	----

Sample Photo:



EXT-1-MISC-4





Additional Sample Notes:	Difficult to quantify material.
---------------------------------	---------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

EXT-1-PB-1	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

West exterior support beams.	Southwest support beam of ash pit outside of room 101.
------------------------------	--

Sample Quantity:	272 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

Brownish red	1.47
--------------	------

Sample Photo:



EXT-1-PB-1



Additional Sample Notes:	Submitted sample to laboratory for analysis.
Sample ID:	Sample Type:
EXT-1-PB-2	PB
Sample Location:	Detailed Sample Location:
West exterior support beams.	Northeast support beam of ash pit outside of room 101.
Sample Quantity:	272 linear feet.
Sample Color:	XRF:
Brownish red	1.15

Sample Photo:



EXT-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
EXT-2-PB-3	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Vent on west exterior side of room 101 in between double doors.
Sample Quantity:	N/A
Sample Color:	XRF:
Dark brown red	0.120

Sample Photo:



EXT-2-PB-3

Additional Sample Notes:

Sample ID:	Sample Type:	
EXT-2-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
East exterior side of structure.	East exterior side of room 101 south of stairwell exit door and north of windows.	
Sample Quantity:	75,000 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar	Potential ACBM with potential for damage	No

Sample Photo:



EXT-2-MISC-5





Additional Sample Notes:		Difficult to quantify material.
Sample ID:		Sample Type:
EXT-2-MISC-2		MISC
Sample Location:		Detailed Sample Location:
West exterior side of structure.		West exterior side of room 101 north of double doors next to ash pit tower.
Sample Quantity:		75,000 linear feet.
Misc Sample Material:		Sample Condition:
Gray brick mortar		Potential ACBM with potential for damage
		Sample Friable?:
		No

Sample Photo:



EXT-2-MISC-2



Additional Sample Notes:	Difficult to quantify material.
---------------------------------	---------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

EXT-3-MISC-3	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

West exterior side of southwest corner.	West exterior side of room 105 on the southwest cornered exterior.
---	--

Sample Quantity:	4,030 linear feet.
-------------------------	--------------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Window glazing.	Potential ACBM with potential for damage	No
-----------------	--	----

Sample Photo:



EXT-3-MISC-3





Additional Sample Notes:

Sample ID:	Sample Type:	
EXT-3-MISC-6	MISC	
Sample Location:	Detailed Sample Location:	
East exterior side of structure.	South window on exterior east wall of room 101.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing	Potential ACBM with potential for damage	No

Sample Photo:



EXT-3-MISC-6



Additional Sample Notes:

Sample ID:

EXT-3-PB-4

Sample Type:

PB

Sample Location:

West exterior side of room 101.

Detailed Sample Location:

Double doors on west exterior side of room 101.

Sample Quantity:

N/A

Sample Color:

Tan

XRF:

0.058

Sample Photo:



EXT-3-PB-4

Additional Sample Notes:	
Sample ID:	Sample Type:
EXT-4-PB-5	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Railing on west exterior side of room 101 in front of double doors.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.173

Sample Photo:



EXT-4-PB-5

Additional Sample Notes:		
Sample ID:	Sample Type:	
EXT-4-MISC-7	MISC	
Sample Location:	Detailed Sample Location:	
East exterior side of structure.	North corner of east exterior wall of room 101 south of stairwell exit.	
Sample Quantity:	37 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White brick caulking.	Potential ACBM with potential for damage	No

Sample Photo:



EXT-4-MISC-7






Additional Sample Notes:	
Sample ID:	Sample Type:
EXT-5-PB-6	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Silver pipe on west exterior side of room 101 and south of double doors.
Sample Quantity:	25 linear feet.
Sample Color:	XRF:
Silver	1.213

Sample Photo:



Additional Sample Notes:	
Sample ID:	Sample Type:
EXT-6-PB-7	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Blue gray pipe in corner of exterior side of room 101 and south of double doors.
Sample Quantity:	25 linear feet.
Sample Color:	XRF:
Blue gray	0.071

Sample Photo:

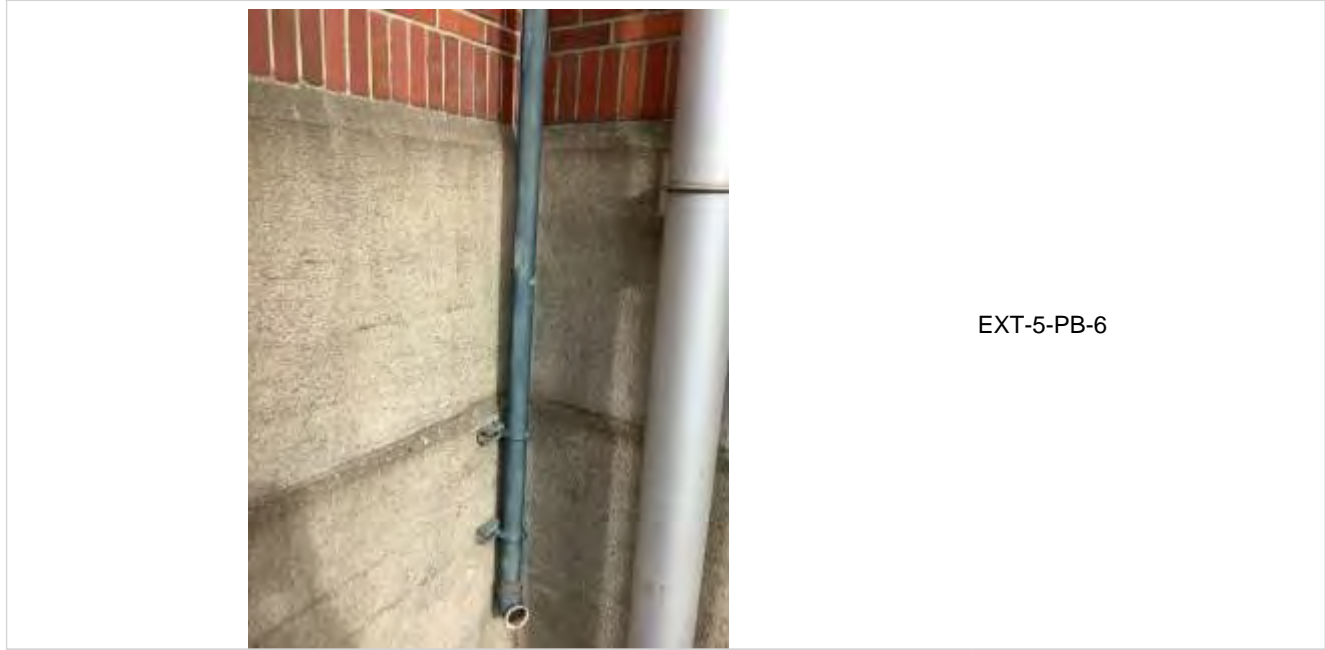

Additional Sample Notes:	
---------------------------------	--

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Type of Fixture:	Quantity:
Condition:	Additional Fixture Notes:

Other Material Photo:

APPENDIX C

LABORATORY ANALYTICAL REPORTS



October 26, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118225.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Munaf Khan, Laboratory Director



Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116000 Client Sample #: 1-1-TSI-1

Location: N-A

Layer 1 of 2 Description: Off-white paper with woven fibers and metal foil

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Metal foil	Cellulose 85%	
	Glass fibers 7%	

Layer 2 of 2 Description: Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass resin	Glass fibers 99%	

Lab ID: 21116001 Client Sample #: 1-1-TSI-2

Location: N-A

Layer 1 of 2 Description: Off-white paper with woven fibers and metal foil

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Metal foil	Cellulose 83%	
	Glass fibers 10%	

Layer 2 of 2 Description: Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass resin	Glass fibers 98%	

Lab ID: 21116002 Client Sample #: 1-2-TSI-3


Location: N-A

Layer 1 of 2 Description: White flexible sheet vinyl

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Vinyl/Binder, Fine particles	None Detected ND	

Sampled by: Client
Analyzed by: Nick Ly
Reviewed by: Munaf Khan

Date: 10/22/2021
Date: 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2 **Description:** Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Glass resin, Fine particles	Glass fibers 96%	

Lab ID: 21116003 **Client Sample #: 1-3-MISC-4**

Location: N-A

Layer 1 of 1 **Description:** Pale gray brittle material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % Chrysotile 4%
Binder/Filler	Cellulose 1%	

Lab ID: 21116004 **Client Sample #: 1-3-MISC-5**

Location: N-A

Layer 1 of 1 **Description:** Gray brittle crumbly material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Paint	Cellulose <1%	

Lab ID: 21116005 **Client Sample #: 1-4-MISC-6**

Location: N-A

Layer 1 of 1 **Description:** Beige soft crumbly material


Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Fine particles	Glass fibers 32%	
	Cellulose 8%	

Lab ID: 21116006 **Client Sample #: 1-5-MISC-7**

Location: N-A

Layer 1 of 1 **Description:** Red paint coated hard brittle material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Granules, Paint	None Detected ND	

Sampled by: Client	 Munaf Khan, Laboratory Director
Analyzed by: Nick Ly	
Reviewed by: Munaf Khan	
Date: 10/22/2021	
Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116007 Client Sample #: 1-6-TSI-8

Location: N-A

Layer 1 of 2	Description: Red paint coated woven fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Paint	Cellulose 88%		None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	None Detected ND		Amosite 30%

Lab ID: 21116008 Client Sample #: 1-7-TSI-9


Location: N-A

Layer 1 of 2	Description: White paper with woven fibers and metal foil			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Metal foil	Cellulose 75%		None Detected ND
		Glass fibers 7%		
Layer 2 of 2	Description: Yellow and pink loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Glass resin	Glass fibers 98%		None Detected ND

Lab ID: 21116009 Client Sample #: 1-8-TSI-10

Location: N-A

Layer 1 of 3	Description: White woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Paint	Cotton yarn 90%		None Detected ND
Layer 2 of 3	Description: Pale gray crumbly powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Fine particles, Glass shots & debris	Cellulose 25%		None Detected ND

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/22/2021	 Munaf Khan, Laboratory Director
Reviewed by: Munaf Khan	Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 3 of 3	Description: White compacted fine powdery material	Glass fibers 8%	
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles	Synthetic fibers 22%	None Detected ND

Lab ID: 21116010 **Client Sample #: 1-8-TSI-11**
 Location: N-A


Layer 1 of 2	Description: White woven fibrous mesh with paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles, Paint	Cotton yarn 85%	None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles	None Detected ND	Chrysotile 35%

Lab ID: 21116011 **Client Sample #: 1-8-TSI-12**
 Location: N-A

Layer 1 of 2	Description: White woven fibrous cloth with paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles, Paint	Cotton yarn 92%	None Detected ND
Layer 2 of 2	Description: Off-white fine powdery material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles, Glass shots & debris	Glass fibers 35%	Chrysotile 5%

Lab ID: 21116012 **Client Sample #: 1-9-MISC-13**
 Location: N-A

Layer 1 of 3	Description: White encapsulated woven fibrous material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Fine particles	Glass fibers 72%	None Detected ND

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/22/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021 
 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 3 **Description:** Tan paper with woven fibers and metal foil

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Metal foil	Cellulose 72%	
	Glass fibers 8%	

Layer 3 of 3 **Description:** Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass resin, Fine particles	Glass fibers 98%	

Lab ID: 21116013 **Client Sample #: 1-8-TSI-14**
 Location: N-A

Layer 1 of 2 **Description:** Orange paint coated woven fibrous mesh

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Paint	Cotton yarn 85%	

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % Amosite 38%
Fine particles	None Detected ND	

Lab ID: 21116014 **Client Sample #: 1-10-TSI-15**
 Location: N-A


Layer 1 of 2 **Description:** White woven fibrous mesh with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Paint	Glass fibers 95%	

Layer 2 of 2 **Description:** Off-white crumbly material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Glass shots & debris	Glass fibers 8%	

Lab ID: 21116015 **Client Sample #: 1-11-MISC-16**
 Location: N-A

Sampled by: Client	 Munaf Khan, Laboratory Director
Analyzed by: Nick Ly	
Reviewed by: Munaf Khan	
Date: 10/22/2021	
Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 1	Description: Yellow loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Glass Resin	Glass fibers 98%		None Detected ND

Lab ID: 2116016 **Client Sample #: 1-12-MISC-17**

Location: N-A

Layer 1 of 1	Description: Pale gray loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	Glass fibers 98%		None Detected ND

Lab ID: 2116017 **Client Sample #: 1-8-TSI-18**

Location: N-A

Layer 1 of 2	Description: Tan woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Paint	Cotton yarn 90%		None Detected ND


Layer 2 of 2	Description: White compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Mineral grains	Cellulose 2%		Chrysotile 27%
				Amosite 13%

Lab ID: 2116018 **Client Sample #: 1-13-MISC-19**

Location: N-A

Layer 1 of 2	Description: White woven fibrous cloth			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	Glass fibers 96%		None Detected ND

Layer 2 of 2	Description: White loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Glass resin, Fine particles	Glass fibers 98%		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Nick Ly</p> <p>Reviewed by: Munaf Khan</p>	<p>Date: 10/22/2021</p> <p>Date: 10/26/2021</p>	 <p>Munaf Khan, Laboratory Director</p>
---	---	---

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116019 Client Sample #: 1-14-TSI-20

Location: N-A

Layer 1 of 2 Description: White and tan woven fibrous mesh with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Paint, Fine particles	Cellulose 45%	None Detected ND
	Glass fibers 42%	

Layer 2 of 2 Description: White compacted powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Fine particles	None Detected ND	Chrysotile 28%
		Amosite 12%

Lab ID: 21116020 Client Sample #: 1-8-TSI-21

Location: N-A

Layer 1 of 2 Description: Dark gray paint coated woven mesh

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Fine particles, Paint	Cotton yarn 92%	None Detected ND

Layer 2 of 2 Description: Off-white fine compacted powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Fine particles	None Detected ND	Amosite 37%


Lab ID: 21116021 Client Sample #: 1-13-MISC-22

Location: N-A

Layer 1 of 2 Description: White woven fibrous cloth with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Fine particles, Paint	Glass fibers 95%	None Detected ND

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/22/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021


 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Yellow loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Glass resin	Glass fibers 99%		None Detected ND

Lab ID: 21116022 **Client Sample #: 1-15-MISC-23**

Location: N-A

Layer 1 of 2	Description: Tan patterned vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder, Mineral grains	None Detected ND		None Detected ND

Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	Cellulose 2%		None Detected ND

Lab ID: 21116023 **Client Sample #: 1-15-MISC-24**

Location: N-A


Layer 1 of 2	Description: Tan patterned vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder, Mineral grains	None Detected ND		None Detected ND

Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	None Detected ND		None Detected ND

Lab ID: 21116024 **Client Sample #: 1-16-MISC-25**

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Binder	None Detected ND		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Nick Ly</p> <p>Reviewed by: Munaf Khan</p>	<p>Date: 10/22/2021</p> <p>Date: 10/26/2021</p>	 <p>Munaf Khan, Laboratory Director</p>
---	---	---

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Brown brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder	Wollastonite 4%		None Detected ND

Lab ID: 21116025 **Client Sample #: 1-16-MISC-26**

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Binder	None Detected ND		None Detected ND

Layer 2 of 2	Description: Brown brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder	Wollastonite 3%		None Detected ND

Lab ID: 21116026 **Client Sample #: 1-17-MISC-27**

Location: N-A


Layer 1 of 2	Description: Pale gray brittle sandy material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Sand, Mica, Paint	Cellulose 3%		None Detected ND

Layer 2 of 2	Description: White chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder	Cellulose 38%		None Detected ND

Lab ID: 21116027 **Client Sample #: 1-18-MISC-28**

Location: N-A

Layer 1 of 1	Description: Pale gray brittle sandy material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Sand, Mica, Paint	Cellulose 2%		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Nick Ly</p> <p>Reviewed by: Munaf Khan</p>	<p>Date: 10/22/2021</p> <p>Date: 10/26/2021</p>	 <hr/> <p>Munaf Khan, Laboratory Director</p>
---	---	---

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116028 Client Sample #: 1-19-MISC-29

Location: N-A

Layer 1 of 1 Description: Pale gray compressed fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Glass shots & debris, Perlite, Paint	Cellulose 25%	None Detected ND
	Glass fibers 20%	


Lab ID: 21116029 Client Sample #: 1-20-MISC-30

Location: N-A

Layer 1 of 1 Description: Pale gray compressed fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Glass shots & debris, Perlite, Paint	Cellulose 22%	None Detected ND
	Glass fibers 18%	

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/22/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118225.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT _____
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax _____

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116000	1-1-TSI-1	A
2	21116001	1-1-TSI-2	A
3	21116002	1-2-TSI-3	A
4	21116003	1-3-MISC-4	A
5	21116004	1-3-MISC-5	A
6	21116005	1-4-MISC-6	A
7	21116006	1-5-MISC-7	A
8	21116007	1-6-TSI-8	A
9	21116008	1-7-TSI-9	A
10	21116009	1-8-TSI-10	A
11	21116010	1-8-TSI-11	A
12	21116011	1-8-TSI-12	A
13	21116012	1-9-MISC-13	A
14	21116013	1-8-TSI-14	A
15	21116014	1-10-TSI-15	A
16	21116015	1-11-MISC-16	A
17	21116016	1-12-MISC-17	A
18	21116017	1-8-TSI-18	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/22/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 10:49 AM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118225.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples**

Lab ID	Sample ID	Description	A/R
19	21116018	1-13-MISC-19	A
20	21116019	1-14-TSI-20	A
21	21116020	1-8-TSI-21	A
22	21116021	1-13-MISC-22	A
23	21116022	1-15-MISC-23	A
24	21116023	1-15-MISC-24	A
25	21116024	1-16-MISC-25	A
26	21116025	1-16-MISC-26	A
27	21116026	1-17-MISC-27	A
28	21116027	1-18-MISC-28	A
29	21116028	1-19-MISC-29	A
30	21116029	1-20-MISC-30	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/22/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 10:49 AM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi, Inc. Project Manager Matt Hoffman
 Address 2815 2nd Ave #540, Cell ()
Seattle, WA 98121 Email _____
 Phone 503-410-1524 Fax ()

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () Fax () Email ecurtts@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	<u>1-1-TSI-1</u>	<u>Condensate pipe in northwest corner of room</u>
2	<u>1-1-TSI-2</u>	<u>" "</u>
3	<u>1-2-TSI-3</u>	<u>Condensate pipe elbow</u>
4	<u>1-3-MISC-4</u>	<u>Window glazing</u>
5	<u>1-3-MISC-5</u>	<u>" "</u>
6	<u>1-4-MISC-6</u>	<u>Tan cementitious material</u>
7	<u>1-5-MISC-7</u>	<u>Red brick</u>
8	<u>1-6-TSI-8</u>	<u>Red pipe</u>
9	<u>1-7-TSI-9</u>	<u>Silver pipe</u>
10	<u>1-8-TSI-10</u>	<u>Silver pipe on ^{st. m} boiler insulation on boiler</u>
11	<u>1-8-TSI-11</u>	<u>" "</u>
12	<u>1-8-TSI-12</u>	<u>" "</u>
13	<u>1-9-MISC-13</u>	<u>Insulation on sink</u>
14	<u>1-8-TSI-14</u>	<u>Orange pipe in SE corner of room</u>
15	<u>1-10-TSI-15</u>	<u>Gray insulation and fabric</u>

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Name]</u>	<u>[Signature]</u>	<u>Nellabs</u>	<u>10/19/21</u>	<u>10:10</u>
Analyzed by					
Called by					
Faxed/Email by					<u>Falco</u>



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi, Inc.
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	<u>1-11-MISC-16</u>	<u>Tan soundproofing material</u>
2	<u>1-12-MISC-17</u>	<u>Gray fibrous material</u>
3	<u>1-8-TSI-18</u>	<u>Gray duct insulation</u>
4	<u>1-13-MISC-19</u>	<u>Tan soundproofing material</u>
5	<u>1-14-TSI-20</u>	<u>White patch on pipe</u>
6	<u>1-8-TSI-21</u>	<u>Dark gray pipe insulation</u>
7	<u>1-13-MISC-22</u>	<u>Gray fabric material</u>
8	<u>1-15-MISC-23</u>	<u>Tan 12"x12" vinyl floor tile w/ black mastic</u>
9	<u>1-15-MISC-24</u>	<u>" "</u>
10	<u>1-16-MISC-25</u>	<u>Brown base coat w/ brown mastic</u>
11	<u>1-16-MISC-26</u>	<u>" "</u>
12	<u>1-17-MISC-27</u>	<u>Light gray wallboard</u>
13	<u>1-18-MISC-28</u>	<u>Light gray cementitious wallboard</u>
14	<u>1-19-MISC-29</u>	<u>White 18"x36" inch ceiling tile w/randomized stippled pattern</u>
15	<u>1-20-MISC-30</u>	<u>White 18"x36" inch ceiling tile w/ uniform stippled pattern</u>

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Signature]</u>	<u>[Signature]</u>	<u>Nucleus</u>	<u>10/19/21</u>	<u>10:00</u>
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 25, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118227.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Evelyn Ahulu, EM Lab Manager

The logo for NVL LABS, featuring the letters "NVL" in a large, outlined, sans-serif font, followed by "LABS" in a smaller, outlined, sans-serif font.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116036 Client Sample #: 1-19-MISC-31

Location: N-A

Layer 1 of 1 Description: Beige fibrous material with white paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Paint, Glass debris, Binder/Filler	Glass fibers 45%	None Detected ND
	Cellulose 20%	

Lab ID: 21116037 Client Sample #: 1-8-TSI-32

Location: N-A35

Layer 1 of 1 Description: White fibrous material with painted cloth wrap

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Paint, Calcareous binder	Cellulose 30%	Chrysotile 50%

Lab ID: 21116038 Client Sample #: 1-21-MISC-33

Location: N-A

Layer 1 of 1 Description: Blue laminate with clear adhesive

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Laminate/binder, Fine grains, Adhesive/Binder	Cellulose 56%	None Detected ND

Lab ID: 21116039 Client Sample #: 1-22-MISC-34

Location: N-A

Layer 1 of 2 Description: Brown rubbery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Rubber/Synthetic Binder	None Detected ND	None Detected ND

Layer 2 of 2 Description: Brown brittle mastic

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Fine particles, Mastic/Binder	Cellulose 2%	None Detected ND

Sampled by: Client

Analyzed by: Munaf Khan

Reviewed by: Evelyn Ahulu

Date: 10/25/2021

Date: 10/25/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116040 Client Sample #: 1-22-MISC-35

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials: Adhesive/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected

Lab ID: 21116041 Client Sample #: 1-23-MISC-36


Location: N-A

Layer 1 of 1	Description: Gray cementitious material			
	Non-Fibrous Materials: Mineral grains, Calcareous binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected

Lab ID: 21116042 Client Sample #: 1-24-MISC-37

Location: N-A

Layer 1 of 3	Description: Beige/light gray vinyl tile			
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 3	Description: Tan brittle mastic			
	Non-Fibrous Materials: Fine particles, Mastic/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected
Layer 3 of 3	Description: Light gray sandy material			
	Non-Fibrous Materials: Calcareous particles, Binder/Filler	Other Fibrous Materials:% Cellulose	6%	Asbestos Type: % None Detected

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116043 Client Sample #: 1-15-MISC-38

Location: N-A

Layer 1 of 2	Description: Beige vinyl tile			
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % Chrysotile 6%

Lab ID: 21116044 Client Sample #: 1-25-MISC-39


Location: N-A

Layer 1 of 2	Description: Black rubbery material			
	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials: Adhesive/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected

Lab ID: 21116045 Client Sample #: 1-26-MISC-40

Location: N-A

Layer 1 of 2	Description: Light brown rubbery material			
	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials: Adhesive/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116046 Client Sample #: 1-27-MISC-41

Location: N-A

Layer 1 of 2	Description: Brown vinyl tile			Asbestos Type: % Chrysotile 3%
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	
Layer 2 of 2	Description: Black asphaltic mastic			Asbestos Type: % None Detected ND
	Non-Fibrous Materials: Fine particles, Asphalt/Binder	Other Fibrous Materials:% Cellulose	<1%	

Lab ID: 21116047 Client Sample #: 1-28-MISC-42


Location: N-A

Layer 1 of 2	Description: Brown vinyl tile			Asbestos Type: % Chrysotile 3%
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	
Layer 2 of 2	Description: Black asphaltic mastic			Asbestos Type: % None Detected ND
	Non-Fibrous Materials: Fine particles, Asphalt/Binder	Other Fibrous Materials:% Cellulose	3%	

Lab ID: 21116048 Client Sample #: 1-18-MISC-43

Location: N-A

Layer 1 of 2	Description: White chalky material with paper			Asbestos Type: % None Detected ND
	Non-Fibrous Materials: Gypsum/Binder	Other Fibrous Materials:% Cellulose	24%	
Layer 2 of 2	Description: Light gray cementitious material			Asbestos Type: % None Detected ND
	Non-Fibrous Materials: Calcareous particles, Binder/Filler	Other Fibrous Materials:% Cellulose	3%	

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116049 Client Sample #: 1-29-MISC-44

Location: N-A

Layer 1 of 2	Description: White hard plastic like material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Plastic, Binder/Filler	Glass fibers 12%	
Layer 2 of 2	Description: Yellow soft mastic	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Fine particles, Mastic/Binder	Cellulose <1%	

Lab ID: 21116050 Client Sample #: 1-3-MISC-45

Location: N-A

Layer 1 of 1	Description: White crumbly material with green paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Paint, Binder/Filler	Cellulose <1%	

Lab ID: 21116051 Client Sample #: 1-1-TSI-46


Location: N-A

Layer 1 of 1	Description: Yellow fibrous material with metal foil	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %	
		Metal foil, Glass debris	Glass fibers 66%		None Detected ND
			Cellulose 20%		

Lab ID: 21116052 Client Sample #: 1-25-MISC-47

Location: N-A

Layer 1 of 2	Description: Black rubbery material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Rubber/Synthetic Binder	None Detected ND	

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Adhesive/Binder	Cellulose 3%		None Detected ND

Lab ID: 21116053 **Client Sample #: 1-28-MISC-48**

Location: N-A

Layer 1 of 2	Description: Light brown vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		Chrysotile 4%

Layer 2 of 2	Description: Black asphaltic fibrous backing with brown mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Asphalt/Binder	Cellulose 65%		None Detected ND

Lab ID: 21116054 **Client Sample #: 1-30-MISC-49**

Location: N-A


Layer 1 of 2	Description: Black rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Synthetic Binder	None Detected ND		None Detected ND

Layer 2 of 2	Description: Beige soft mastic with tan color paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Paint, Fine particles, Mastic/Binder	Cellulose <1%		None Detected ND

Lab ID: 21116055 **Client Sample #: 2-1-MISC-1**

Location: N-A

Layer 1 of 2	Description: Beige vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Munaf Khan</p> <p>Reviewed by: Evelyn Ahulu</p>	<p>Date: 10/25/2021</p> <p>Date: 10/25/2021</p>	 <p>Evelyn Ahulu, EM Lab Manager</p>
--	---	--

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Black/gray asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Asphalt/Binder	Cellulose 12%		None Detected ND

Lab ID: 21116056 **Client Sample #: 2-1-MISC-2**

Location: N-A

Layer 1 of 5	Description: Beige vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		None Detected ND

Layer 2 of 5	Description: Light gray sandy material with yellow mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous particles, Mastic/Binder	Cellulose 4%		None Detected ND

Layer 3 of 5	Description: Black asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	Cellulose <1%		None Detected ND


Layer 4 of 5	Description: Brown vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		Chrysotile 8%

Layer 5 of 5	Description: Black asphaltic fibrous felt with mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder, Fine particles	Cellulose 65%		None Detected ND

Lab ID: 21116057 **Client Sample #: 2-2-MISC-3**

Location: N-A

Layer 1 of 1	Description: Laminate beige color with clear adhesive			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Laminate/binder, Adhesive/Binder, Fine particles	Cellulose 60%		None Detected ND

Sampled by: Client	
Analyzed by: Munaf Khan	Date: 10/25/2021
Reviewed by: Evelyn Ahulu	Date: 10/25/2021
	 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116058 Client Sample #: 2-3-MISC-4

Location: N-A

Layer 1 of 4	Description: Light brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND
Layer 2 of 4	Description: Black asphaltic mastic	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: Brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % Chrysotile 8%
Layer 4 of 4	Description: Black asphaltic mastic	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND


Lab ID: 21116059 Client Sample #: 2-3-MISC-5

Location: N-A

Layer 1 of 2	Description: Light brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Black asphaltic mastic	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND

Lab ID: 21116060 Client Sample #: 2-4-MISC-6

Location: N-A

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: Light brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % Chrysotile 3%
Layer 2 of 2	Description: Black asphaltic fibrous felt with mastic	Non-Fibrous Materials: Fine particles, Asphalt/Binder	Other Fibrous Materials:% Cellulose 56%	Asbestos Type: % Chrysotile 6%

Lab ID: 21116061 **Client Sample #: 2-5-MISC-7**
 Location: N-A


Layer 1 of 2	Description: Black rubbery material	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Tan soft mastic	Non-Fibrous Materials: Fine particles, Mastic/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND

Lab ID: 21116062 **Client Sample #: 2-6-TSI-8**
 Location: N-A

Layer 1 of 1	Description: Yellow fibrous material with metal foil wrap	Non-Fibrous Materials: Metal foil, Gypsum/Binder	Other Fibrous Materials:% Glass fibers 64% Cellulose 20%	Asbestos Type: % None Detected ND
---------------------	--	---	--	--

Lab ID: 21116063 **Client Sample #: 2-7-MISC-9**
 Location: N-A

Layer 1 of 1	Description: Light gray soft rubbery material with paint	Non-Fibrous Materials: Paint, Caulking compound, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
---------------------	---	--	---	--

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116064 Client Sample #: 2-7-MISC-10

Location: N-A

Layer 1 of 1 Description: Light gray soft rubbery material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Paint, Caulking compound, Fine particles	None Detected ND	None Detected ND

Lab ID: 21116065 Client Sample #: 2-8-MISC-11

Location: N-A

Layer 1 of 2 Description: White chalky material with paper

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Gypsum/Binder	Cellulose 22%	None Detected ND

Layer 2 of 2 Description: Tan chalky material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Mica, Gypsum/Binder	Cellulose 3%	None Detected ND

Sampled by: Client

Analyzed by: Munaf Khan

Date: 10/25/2021

Reviewed by: Evelyn Ahulu

Date: 10/25/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc. **NVL Batch Number** **2118227.00**
Address 109 E 13th St. **TAT** 5 Days **AH** No
 Vancouver, WA 98660 **Rush TAT**
Project Manager Mrs. Emily Curtis **Due Date** 10/26/2021 **Time** 10:10 AM
Phone (971) 544-2139 **Email** ecurtis@maulfoster.com
Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116036	1-19-MISC-31	A
2	21116037	1-8-TSI-32	A
3	21116038	1-21-MISC-33	A
4	21116039	1-22-MISC-34	A
5	21116040	1-22-MISC-35	A
6	21116041	1-23-MISC-36	A
7	21116042	1-24-MISC-37	A
8	21116043	1-15-MISC-38	A
9	21116044	1-25-MISC-39	A
10	21116045	1-26-MISC-40	A
11	21116046	1-27-MISC-41	A
12	21116047	1-28-MISC-42	A
13	21116048	1-18-MISC-43	A
14	21116049	1-29-MISC-44	A
15	21116050	1-3-MISC-45	A
16	21116051	1-1-TSI-46	A
17	21116052	1-25-MISC-47	A
18	21116053	1-28-MISC-48	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Munaf Khan		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 10:56 AM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118227.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
19	21116054	1-30-MISC-49	A
20	21116055	2-1-MISC-1	A
21	21116056	2-1-MISC-2	A
22	21116057	2-2-MISC-3	A
23	21116058	2-3-MISC-4	A
24	21116059	2-3-MISC-5	A
25	21116060	2-4-MISC-6	A
26	21116061	2-5-MISC-7	A
27	21116062	2-6-TSI-8	A
28	21116063	2-7-MISC-9	A
29	21116064	2-7-MISC-10	A
30	21116065	2-8-MISC-11	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Munaf Khan		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 10:56 AM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alouji
 Address 2815 2nd Ave #540,
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions _____

Call () - - Fax () - - Email _____

Total Number of Samples _____

Sample ID	Description	A/R
1	1-19-MISC-31	White 18" x 36" ceiling tile w/ randomized stipple pattern
2	1-8-TSI-32	White pipe insulation
3	1-21-MISC-33	Gray blue laminate counter top w/ black and green mastic
4	1-22-MISC-34	Dark Brown base core w/ brown mastic
5	1-22-MISC-35	Dark Brown base core w/ brown mastic
6	1-23-MISC-36	Gray cementitious patching material
7	1-24-MISC-37	Light Gray 12" x 12" vinyl flooring tile w/ gray mastic
8	1-15-MISC-38	Tan 12" x 12" vinyl floor tile w/ black mastic
9	1-25-MISC-39	Black Transition strip w/ Brown mastic
10	1-26-MISC-40	Rubber stair tread w/ clear mastic
11	1-27-MISC-41	Dark brown patterned 9" x 9" vinyl floor tile w/ black mastic
12	1-28-MISC-42	Light tan patterned 9" x 9" vinyl floor tile w/ black mastic
13	1-18-MISC-43	White drywall w/ cementitious wall board
14	1-29-MISC-44	White plastic waterproofing material w/ pale yellow adhesive
15	1-3-MISC-45	Window glazing

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Schmalzer	<i>[Signature]</i>	Nullebs	10/19/21	10:10
Analyzed by					
Called by					
Faxed/Email by					



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #540,
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell ()
 Email _____
 Fax ()

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () Fax () Email ecurtis@maulfoster.com

Total Number of Samples

Sample ID	Description	A/R
1	<u>1-1-TSI-46</u>	<u>White pipe insulation</u>
2	<u>1-25-MISC-47</u>	<u>Black transition strip w/ brown mastic</u>
3	<u>1-28-MISC-48</u>	<u>Light tan patterned 9"x9" vinyl floor tile w/ black mastic</u>
4	<u>1-30-MISC-49</u>	<u>Black base cove w/ tan mastic</u>
5	<u>2-1-MISC-1</u>	<u>White stipple pattern 12"x12" vinyl floor tile w/ black mastic</u>
6	<u>2-1-MISC-2</u>	<u>White stipple pattern 12"x12" vinyl floor tile w/ black mastic</u>
7	<u>2-2-MISC-3</u>	<u>Tan laminate counter top w/ clear mastic</u>
8	<u>2-3-MISC-4</u>	<u>Light brown patterned 9"x9" vinyl floor tile w/ black mastic</u>
9	<u>2-3-MISC-5</u>	<u>Light brown patterned 9"x9" vinyl floor tile w/ black mastic</u>
10	<u>2-4-MISC-6</u>	<u>Brown striped pattern 9"x9" vinyl floor tile w/ black mastic</u>
11	<u>2-5-MISC-7</u>	<u>Black base cove w/ tan mastic</u>
12	<u>2-6-TSI-8</u>	<u>Yellow pipe insulation w/ white papery cover</u>
13	<u>2-7-MISC-9</u>	<u>Window glazing</u>
14	<u>2-7-MISC-10</u>	<u>Window glazing</u>
15	<u>2-8-MISC-11</u>	<u>White drywall w/ cementitious wallboard</u>

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Cannon Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Cannon Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Signature]</u>	<u>[Signature]</u>	<u>Nullebs</u>	<u>10/19/21</u>	<u>10:10am</u>
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 26, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118233.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Munaf Khan, Laboratory Director



Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116110 Client Sample #: 2-8-MISC-12

Location: N-A

Layer 1 of 2	Description: Pale gray brittle sandy material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous binder, Sand, Mineral grains, Paint	Cellulose <1%		None Detected ND
Layer 2 of 2	Description: Thin layer of Black asphaltic material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	None Detected ND		None Detected ND

Lab ID: 21116111 Client Sample #: 2-9-MISC-13


Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Binder, Fine grains	None Detected ND		None Detected ND
Layer 2 of 2	Description: Brown brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder	Talc fibers 3%		None Detected ND
		Cellulose <1%		

Lab ID: 21116112 Client Sample #: 2-10-TSI-14

Location: N-A

Layer 1 of 2	Description: White woven fibrous meshl with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cotton yarn 90%		None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles	None Detected ND		Chrysotile 25%

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	 <hr style="width: 100%;"/> Munaf Khan, Laboratory Director
Reviewed by: Munaf Khan	Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 1 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles	Cellulose 28%	
	Synthetic fibers 7%	

Lab ID: 21116118 **Client Sample #: 2-13-TSI-20**

Location: N-A

Layer 1 of 2 **Description:** White woven fibrous mesh with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Binder/Filler, Paint, Fine particles	Cotton yarn 92%	

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Glass debris	Cellulose 32%	
	Synthetic fibers 5%	

Lab ID: 21116119 **Client Sample #: 2-14-TSI-21**

Location: N-A

Layer 1 of 2 **Description:** White woven fibrous cloth with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Binder/Filler, Paint	Glass fibers 90%	

Layer 2 of 2 **Description:** White loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass Resin	Glass fibers 99%	

Lab ID: 21116120 **Client Sample #: 2-13-TSI-22**

Location: N-A

Sampled by: Client	Date: 10/20/2021	 <hr style="width: 100%; border: 0; border-top: 1px solid black;"/> Munaf Khan, Laboratory Director
Analyzed by: Nick Ly	Date: 10/26/2021	
Reviewed by: Munaf Khan		

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint	Cotton yarn 93%		None Detected ND
Layer 2 of 2	Description: White and pale gray compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Glass debris	Synthetic fibers 25%		None Detected ND
		Cellulose 5%		
		Glass fibers 3%		

Lab ID: 21116121 **Client Sample #: 2-13-TSI-23**


Location: N-A

Layer 1 of 2	Description: Tan woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint	Cellulose 85%		None Detected ND
Layer 2 of 2	Description: Pale gray compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Glass shots & debris	Glass fibers 18%		Amosite 23%
				Chrysotile 15%

Lab ID: 21116122 **Client Sample #: 2-14-TSI-24**

Location: N-A

Layer 1 of 2	Description: White woven fibrous cloth			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler	Glass fibers 95%		None Detected ND

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	
Reviewed by: Munaf Khan	Date: 10/26/2021	Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: White loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Glass resin	Glass fibers 98%		None Detected ND

Lab ID: 21116123 **Client Sample #: 2-13-TSI-25**

Location: N-A

Layer 1 of 1	Description: Off-white compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	Glass fibers 5%		Amosite 30%

Lab ID: 21116124 **Client Sample #: 2-15-TSI-26**

Location: N-A

Layer 1 of 3	Description: Tan woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Paint	Cellulose 88%		None Detected ND


Layer 2 of 3	Description: White woven fibrous mesh			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Fine particles	Glass fibers 90%		None Detected ND

Layer 3 of 3	Description: Off-white compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	None Detected ND		Amosite 23%
				Chrysotile 12%

Lab ID: 21116125 **Client Sample #: 2-15-TSI-27**

Location: N-A

Layer 1 of 2	Description: Tan and white woven fibrous material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cellulose 45%		None Detected ND

Sampled by: Client	
Analyzed by: Nick Ly	Date: 10/20/2021
Reviewed by: Munaf Khan	Date: 10/26/2021
	 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Glass fibers 40%

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Fine particles	None Detected ND	Chrysotile 22%
		Amosite 18%
		Crocidolite 3%

Lab ID: 21116126 **Client Sample #: 2-16-TSI-28**
 Location: N-A

Layer 1 of 2 **Description:** Tan woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Paint, Fine particles	Cellulose 85%	None Detected ND

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Fine particles, Mineral grains	None Detected ND	Chrysotile 25%
		Amosite 13%

Lab ID: 21116127 **Client Sample #: 2-16-TSI-29**
 Location: N-A

Layer 1 of 2 **Description:** Tan and white woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Paint, Fine particles	Cellulose 48%	None Detected ND
	Glass fibers 45%	

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Fine particles, Mineral grains	None Detected ND	Chrysotile 28%

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/20/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021

Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Amosite 18%

Lab ID: 21116128 Client Sample #: 2-13-TSI-30

Location: N-A

Layer 1 of 2	Description: Tan woven fibrous material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cellulose 80%		None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles	None Detected ND		Chrysotile 28%
				Amosite 15%

Lab ID: 21116129 Client Sample #: 2-17-TSI-31


Location: N-A

Layer 1 of 2	Description: Off-white paper with woven fibers and metal foil			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Metal foil	Cellulose 82%		None Detected ND
		Glass fibers 8%		
Layer 2 of 2	Description: Yellow loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Glass debris, Fine particles	Glass fibers 95%		None Detected ND

Lab ID: 21116130 Client Sample #: 2-17-TSI-32

Location: N-A

Layer 1 of 3	Description: Off-white paper with woven fibers and metal foil			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Metal foil	Cellulose 78%		None Detected ND

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	
Reviewed by: Munaf Khan	Date: 10/26/2021	Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

		Glass fibers	10%	
Layer 2 of 3	Description: White flexible sheet vinyl	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Vinyl/Binder	None Detected ND	None Detected ND
Layer 3 of 3	Description: Yellow loose-fill fibrous material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Glass resin	Glass fibers 98%	None Detected ND


Lab ID: 21116131 **Client Sample #: 2-7-MISC-33**
 Location: N-A

Layer 1 of 1	Description: Off-white brittle material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Paint	Cellulose <1%	Chrysotile 3%

Lab ID: 21116132 **Client Sample #: 3-1-TSI-1**
 Location: N-A

Layer 1 of 2	Description: Beige woven fibrous material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Paint, Fine particles	Cellulose 42%	None Detected ND
			Glass fibers 38%	
Layer 2 of 2	Description: Pale gray compacted brittle material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Fine particles, Glass shots & debris	Glass fibers 15%	None Detected ND
			Cellulose 2%	

Lab ID: 21116133 **Client Sample #: 3-1-TSI-2**
 Location: N-A

<p>Sampled by: Client Analyzed by: Nick Ly Reviewed by: Munaf Khan</p>	<p>Date: 10/20/2021 Date: 10/26/2021</p>	 <hr/> <p>Munaf Khan, Laboratory Director</p>
---	---	---

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: Beige woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Fine particles	Other Fibrous Materials:% Cotton yarn 90%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material	Non-Fibrous Materials: Fine particles	Other Fibrous Materials:% Cellulose 22% Synthetic fibers 8%	Asbestos Type: % None Detected ND


Lab ID: 21116134 **Client Sample #: 3-2-TSI-3**
 Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh	Non-Fibrous Materials: Fine particles	Other Fibrous Materials:% Glass fibers 98%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White loose-fill fibrous material	Non-Fibrous Materials: Glass resin, Fine particles	Other Fibrous Materials:% Glass fibers 99%	Asbestos Type: % None Detected ND

Lab ID: 21116135 **Client Sample #: 3-3-TSI-4**
 Location: N-A

Layer 1 of 2	Description: Tan woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Cellulose 88%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Off-white brittle crumbly material	Non-Fibrous Materials: Binder/Filler, Glass shots & debris	Other Fibrous Materials:% Glass fibers 7% Cellulose 3%	Asbestos Type: % None Detected ND

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/20/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116136 Client Sample #: 3-1-TSI-5

Location: N-A

Layer 1 of 3	Description: White woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Tan woven fibrous material with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White compacted crumbly powdery material	Non-Fibrous Materials: Binder/Filler, Fine particles	Other Fibrous Materials:% Hair 7% Cellulose 5%	Asbestos Type: % None Detected ND

Lab ID: 21116137 Client Sample #: 3-2-TSI-6


Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White loose-fill fibrous material	Non-Fibrous Materials: Glass resin, Fine particles	Other Fibrous Materials:% Glass fibers 99%	Asbestos Type: % None Detected ND

Lab ID: 21116138 Client Sample #: 3-1-TSI-7

Location: N-A

Layer 1 of 3	Description: Tan woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Cellulose 92%	Asbestos Type: % None Detected ND
---------------------	---	---	--	--

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/20/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021 
 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 3	Description: Off-white compacted crumbly powdery material	Non-Fibrous Materials: Other Fibrous Materials:%	Fine particles, Glass shots & debris Glass fibers 25% Cellulose 5%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Blue and white flexible sheet vinyl	Non-Fibrous Materials: Other Fibrous Materials:%	Vinyl/Binder None Detected ND	Asbestos Type: % None Detected ND

Lab ID: 21116139 **Client Sample #: 3-4-TSI-8**

Location: N-A

Layer 1 of 2	Description: Off-white paper with woven fibers and metal foil	Non-Fibrous Materials: Other Fibrous Materials:%	Binder/Filler, Metal foil Cellulose 65% Glass fibers 12%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Tan loose-fill fibrous material	Non-Fibrous Materials: Other Fibrous Materials:%	Glass resin Glass fibers 99%	Asbestos Type: % None Detected ND

Sampled by: Client

Analyzed by: Nick Ly

Reviewed by: Munaf Khan

Date: 10/20/2021

Date: 10/26/2021

Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118233.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples**

Lab ID	Sample ID	Description	A/R
1	21116110	2-8-MISC-12	A
2	21116111	2-9-MISC-13	A
3	21116112	2-10-TSI-14	A
4	21116113	2-11-MISC-15	A
5	21116114	2-12-MISC-16	A
6	21116115	2-11-MISC-17	A
7	21116116	2-12-MISC-18	A
8	21116117	2-13-TSI-19	A
9	21116118	2-13-TSI-20	A
10	21116119	2-14-TSI-21	A
11	21116120	2-13-TSI-22	A
12	21116121	2-13-TSI-23	A
13	21116122	2-14-TSI-24	A
14	21116123	2-13-TSI-25	A
15	21116124	2-15-TSI-26	A
16	21116125	2-15-TSI-27	A
17	21116126	2-16-TSI-28	A
18	21116127	2-16-TSI-29	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/20/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 11:24 AM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118233.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
19	21116128	2-13-TSI-30	A
20	21116129	2-17-TSI-31	A
21	21116130	2-17-TSI-32	A
22	21116131	2-7-MISC-33	A
23	21116132	3-1-TSI-1	A
24	21116133	3-1-TSI-2	A
25	21116134	3-2-TSI-3	A
26	21116135	3-3-TSI-4	A
27	21116136	3-1-TSI-5	A
28	21116137	3-2-TSI-6	A
29	21116138	3-1-TSI-7	A
30	21116139	3-4-TSI-8	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/20/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 11:24 AM
 Entered By: Fatima Khan

2118233



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #310
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () -
 Email
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	White drywall w/ cementitious wallboard	
2	Brown base cove w/ brown mastic	
3	White pipe insulation w/ orange covering	
4	Red 12"x12" brick	
5	Curay brick mortar	
6	Red 12"x12" brick	
7	Curay brick mortar	
8	White pipe insulation w/ silver fabric covering	
9	White pipe insulation w/ silver fabric covering	
10	White fabric pipe insulation	
11	White pipe insulation w/ fabric covering	
12	White pipe insulation w/ fabric covering	
13	White fabric pipe insulation	
14	White pipe insulation w/ red painted fabric covering	
15	White pipe insulation w/ white fabric wrapping	

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<i>[Signature]</i>	<i>[Signature]</i>	<i>[Signature]</i>	10/19/21	10:10am Alex
Analyzed by					
Called by					
Faxed/Email by					

2118233



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #510
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman Hoffman
 Cell () -
 Email
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	2-15-TSI-27	White pipe insulation w/ white fabric wrapping
2	2-16-TSI-28	White boiler insulation w/ silver painted covering
3	2-16-TSI-29	White boiler insulation w/ white patch covering
4	2-13-TSI-30	White pipe insulation w/ fabric covering
5	2-17-TSI-31	Yellow pipe insulation w/ white covering
6	2-17-TSI-32	Yellow pipe insulation w/ white covering
7	2-7-MISC-33	Window glazing
8	3-1-TSI-1	White insulation with silver wrapping on boiler
9	3-1-TSI-2	White pipe insulation with white wrapping
10	3-2-TSI-3	Fabric insulation on pipe coming off of boiler
11	3-3-TSI-4	White insulation on mechanical part
12	3-1-TSI-5	White pipe insulation with white wrapping
13	3-2-TSI-6	White pipe insulation with silver wrapping
14	3-1-TSI-7	White vent insulation with white wrapping
15	3-4-TSI-8	Yellow insulation w/ white wrapping

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Khmalta	<i>[Signature]</i>	Neubels	10/19/21	10:00 AM
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 25, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118237.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Evelyn Ahulu, EM Lab Manager

The logo for NVL LABS, featuring the letters "NVL" in a large, outlined, sans-serif font, and "LABS" in a smaller, outlined, sans-serif font to the right.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116162 Client Sample #: 3-1-TSI-9


Location: N-A

Layer 1 of 4	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 5% Glass fibers 3%	Asbestos Type: % None Detected ND
Layer 2 of 4	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 80% Glass fibers 7%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: White powdery material	Non-Fibrous Materials: Calcareous binder, Calcareous particles, Fine grains	Other Fibrous Materials:% Cellulose 8% Glass fibers 6%	Asbestos Type: % None Detected ND
Layer 4 of 4	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Fine particles, Glass debris	Other Fibrous Materials:% Cellulose 45% Glass fibers 20%	Asbestos Type: % None Detected ND

Lab ID: 21116163 Client Sample #: 3-3-TSI-10

Location: N-A

Layer 1 of 4	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Glass debris	Other Fibrous Materials:% Cellulose 3% Glass fibers <1%	Asbestos Type: % None Detected ND
---------------------	--	--	---	--

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 4	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Fine particles, Glass debris	Other Fibrous Materials:% Cellulose 5% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: White powdery material	Non-Fibrous Materials: Calcareous particles, Calcareous binder, Fine grains	Other Fibrous Materials:% Cellulose 4% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 4 of 4	Description: Gray crumbly material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Cellulose 6% Glass fibers 82%	Asbestos Type: % None Detected ND

Lab ID: 21116164 **Client Sample #: 4-1-TSI-1**

Location: N-A

Layer 1 of 3	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 4% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Yellow woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 85%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % Chrysotile 15%

Sampled by: Client

Analyzed by: Hieu Ta

Reviewed by: Evelyn Ahulu

Date: 10/21/2021

Date: 10/25/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A


Amosite 30%

Lab ID: 21116165	Client Sample #: 4-2-TSI-2		
Location: N-A			
Layer 1 of 2	Description: White fibrous felt with brown paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Paint, Binder/Filler	Cellulose 75%	None Detected ND
Layer 2 of 2	Description: White crumbly material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Debris, Fine particles	Cellulose 7%	Amosite 30% Chrysotile 10%

Lab ID: 21116166	Client Sample #: 4-3-MISC-3		
Location: N-A			
Layer 1 of 1	Description: Yellow fibrous material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Glass debris	Glass fibers 85%	None Detected ND

Lab ID: 21116167	Client Sample #: 4-3-MISC-4		
Location: N-A			
Layer 1 of 1	Description: Yellow fibrous material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Glass debris	Glass fibers 82%	None Detected ND

Lab ID: 21116168	Client Sample #: 4-4-MISC-5		
Location: N-A			

Sampled by: Client	
Analyzed by: Hieu Ta	Date: 10/21/2021
Reviewed by: Evelyn Ahulu	Date: 10/25/2021
	 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: Beige laminate	Non-Fibrous Materials: Fine particles, Synthetic/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Brown fibrous material	Non-Fibrous Materials: Binder/Filler, Wood flakes, Debris	Other Fibrous Materials:% Cellulose 88%	Asbestos Type: % None Detected ND


Lab ID: 21116169 **Client Sample #: 4-1-TSI-6**

Location: N-A

Layer 1 of 4	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 6% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 2 of 4	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: Brown woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 87%	Asbestos Type: % None Detected ND
Layer 4 of 4	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % Chrysotile 20% Amosite 30%

Lab ID: 21116170 **Client Sample #: 4-2-TSI-7**

Location: N-A

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: White woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Debris	Other Fibrous Materials:% Cellulose 90%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 8%	Asbestos Type: % Chrysotile 22% Amosite 25%


Lab ID: 21116171 Client Sample #: 4-5-TSI-8
 Location: N-A

Layer 1 of 2	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 88%	Asbestos Type: % None Detected ND

Lab ID: 21116172 Client Sample #: 4-5-TSI-9
 Location: N-A

Layer 1 of 2	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND

Lab ID: 21116173 Client Sample #: 4-1-TSI-10
 Location: N-A

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 3	Description: White woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Glass debris, Paint	Other Fibrous Materials:% Cellulose 3% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Yellow woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 80%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % Chrysotile 20% Amosite 25%


Lab ID: 21116174 **Client Sample #: 4-5-TSI-11**

Location: N-A

Layer 1 of 3	Description: Brown crumbly material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 4%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Yellow fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 86%	Asbestos Type: % None Detected ND

Lab ID: 21116175 **Client Sample #: 4-6-TSI-12**

Location: N-A

Sampled by: Client	
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	Evelyn Ahulu, EM Lab Manager
Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A


Layer 1 of 3	Description: Brittle red/silver paint Non-Fibrous Materials: Paint/Binder, Debris, Fine particles	Other Fibrous Materials:% Cellulose 9%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: White woven fibrous material with paint Non-Fibrous Materials: Binder/Filler, Debris, Paint	Other Fibrous Materials:% Cellulose 85%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % Chrysotile 28% Amosite 22%

Lab ID: 21116176 **Client Sample #: 4-5-TSI-13**
 Location: N-A

Layer 1 of 2	Description: White woven fibrous material Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Yellow fibrous material Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND

Lab ID: 21116177 **Client Sample #: 4-7-TSI-14**
 Location: N-A

Layer 1 of 6	Description: White/silver paint Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 5% Glass fibers <1%	Asbestos Type: % None Detected ND
---------------------	--	---	--

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116


Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 6	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 82%	Asbestos Type: % None Detected ND
Layer 3 of 6	Description: Off-white woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 85%	Asbestos Type: % None Detected ND
Layer 4 of 6	Description: Silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 3% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 5 of 6	Description: Brown crumbly material with metal foil	Non-Fibrous Materials: Binder/Filler, Debris, Metal foil	Other Fibrous Materials:% Cellulose 5% Glass fibers 2%	Asbestos Type: % None Detected ND
Layer 6 of 6	Description: Yellow foamy fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 88%	Asbestos Type: % None Detected ND

Lab ID: 21116178 **Client Sample #: 4-7-TSI-15**

Location: N-A

Layer 1 of 3	Description: White mastic with red paint and metal foil	Non-Fibrous Materials: Binder/Filler, Metal foil, Paint	Other Fibrous Materials:% Cellulose 8% Glass fibers <1%	Asbestos Type: % None Detected ND
---------------------	--	--	---	--

Sampled by: Client	 Evelyn Ahulu, EM Lab Manager
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	
Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A


Layer 2 of 3	Description: Brown fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 25% Glass fibers 2%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Yellow fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 89%	Asbestos Type: % None Detected ND

Lab ID: 21116179 **Client Sample #: 4-8-MISC-16**
 Location: N-A

Layer 1 of 1	Description: Charcoal gray fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 2%	Asbestos Type: % Chrysotile 90%
---------------------	--	---	---	--

Lab ID: 21116180 **Client Sample #: 4-1-TSI-17**
 Location: N-A

Layer 1 of 3	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 88%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Calcareous particles, Debris	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % Chrysotile 30% Amosite 20%

Sampled by: Client	 Evelyn Ahulu, EM Lab Manager
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	Date: 10/25/2021

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116181 Client Sample #: 4-7-TSI-18

Location: N-A

Layer 1 of 2 Description: Brown fibrous material with red paint and metal foil

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Paint, Metal foil, Glass debris	Glass fibers 90%	
	Cellulose 3%	

Layer 2 of 2 Description: Yellow foamy fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Glass debris, Fine particles	Glass fibers 86%	

Lab ID: 21116182 Client Sample #: 4-7-TSI-19

Location: N-A

Layer 1 of 2 Description: Soft white thin vinyl sheet with silver paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Paint, Vinyl/Binder	Cellulose 3%	

Layer 2 of 2 Description: Yellow fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Glass debris, Fine particles	Glass fibers 85%	

Lab ID: 21116183 Client Sample #: 4-2-TSI-20

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Debris	Cellulose 90%	

Layer 2 of 2 Description: White crumbly material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % Amosite 50%
Binder/Filler, Debris, Fine particles	Cellulose 2%	

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116184 Client Sample #: 4-5-TSI-21

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with black fibrous banding

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 84%	None Detected ND
	Synthetic fibers 10%	

Layer 2 of 2 Description: Yellow fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 88%	None Detected ND

Lab ID: 21116185 Client Sample #: 4-2-TSI-22

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Paint, Debris	Cellulose 90%	None Detected ND

Layer 2 of 2 Description: White crumbly material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Debris, Fine particles	Cellulose 3%	Amosite 48%

Lab ID: 21116186 Client Sample #: 4-9-TSI-23

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 88%	None Detected ND

Layer 2 of 2 Description: White crumbly material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Debris, Fine particles	Cellulose 3%	Chrysotile 22%

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Amosite 28%

Lab ID: 21116187 Client Sample #: 4-8-MISC-24

Location: N-A

Layer 1 of 2	Description: Flaky silver paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Paint/Binder, Debris, Fine particles	Cellulose 3%	
Layer 2 of 2	Description: Gray/white fibrous felt	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Debris, Fine particles	Cellulose 5%	

Lab ID: 21116188 Client Sample #: 4-2-TSI-25


Location: N-A

Layer 1 of 2	Description: White woven fibrous material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Debris, Paint	Cellulose 88%	
Layer 2 of 2	Description: White crumbly material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Debris, Fine particles	Cellulose 5%	

Lab ID: 21116189 Client Sample #: 4-5-TSI-26

Location: N-A

Layer 1 of 1	Description: White woven fibrous felt	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Paint, Fine particles	Glass fibers 80%	

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116190 Client Sample #: 4-7-TSI-27

Location: N-A

Layer 1 of 2	Description: White fibrous material with paper and metal foil	Non-Fibrous Materials: Binder/Filler, Glass debris, Metal foil	Other Fibrous Materials:% Cellulose 30% Glass fibers 65%	Asbestos Type: % None Detected ND
---------------------	--	---	--	--


Layer 2 of 2	Description: Yellow fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND
---------------------	---	---	---	--

Lab ID: 21116191 Client Sample #: 4-7-TSI-28

Location: N-A

Layer 1 of 2	Description: White synthetic material	Non-Fibrous Materials: Binder/Filler, Synthetic/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
---------------------	--	---	---	--

Layer 2 of 2	Description: Yellow foamy fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 94%	Asbestos Type: % None Detected ND
---------------------	---	---	---	--

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118237.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT _____
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax _____

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116162	3-1-TSI-9	A
2	21116163	3-3-TSI-10	A
3	21116164	4-1-TSI-1	A
4	21116165	4-2-TSI-2	A
5	21116166	4-3-MISC-3	A
6	21116167	4-3-MISC-4	A
7	21116168	4-4-MISC-5	A
8	21116169	4-1-TSI-6	A
9	21116170	4-2-TSI-7	A
10	21116171	4-5-TSI-8	A
11	21116172	4-5-TSI-9	A
12	21116173	4-1-TSI-10	A
13	21116174	4-5-TSI-11	A
14	21116175	4-6-TSI-12	A
15	21116176	4-5-TSI-13	A
16	21116177	4-7-TSI-14	A
17	21116178	4-7-TSI-15	A
18	21116179	4-8-MISC-16	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Hieu Ta		NVL	10/21/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:00 PM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc. **NVL Batch Number** **2118237.00**
Address 109 E 13th St. **TAT** 5 Days **AH** No
 Vancouver, WA 98660 **Rush TAT**
Project Manager Mrs. Emily Curtis **Due Date** 10/26/2021 **Time** 10:10 AM
Phone (971) 544-2139 **Email** ecurtis@maulfoster.com
Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
19	21116180	4-1-TSI-17	A
20	21116181	4-7-TSI-18	A
21	21116182	4-7-TSI-19	A
22	21116183	4-2-TSI-20	A
23	21116184	4-5-TSI-21	A
24	21116185	4-2-TSI-22	A
25	21116186	4-9-TSI-23	A
26	21116187	4-8-MISC-24	A
27	21116188	4-2-TSI-25	A
28	21116189	4-5-TSI-26	A
29	21116190	4-7-TSI-27	A
30	21116191	4-7-TSI-28	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Hieu Ta		NVL	10/21/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:00 PM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	3-1-TSI-9	White vent insulation w/white wrapping
2	3-3-TSI-10	White insulation on mechanical part
3	3-10-PB-1 4-1-TSI-1	White insulation with silver fabric patch
4	4-2-TSI-2	White insulation with orange-painted wrap
5	4-3-MISC-3	Brown soundproofing wall pad
6	4-3-MISC-4	Brown soundproofing wall pad
7	4-4-MISC-5	Off-white laminate tabletop with clear adhesive
8	4-1-TSI-6	White insulation with orange-painted wrap
9	4-2-TSI-7	White insulation with silver fabric patch
10	4-5-TSI-8	Silver steam pipe fabric wrap
11	4-5-TSI-9	Silver steam pipe fabric wrap
12	4-1-TSI-10	White insulation with silver fabric patch
13	4-6-TSI-11	Silver steam pipe fabric wrap
14	4-6-TSI-12	Red steam pipe fabric wrap
15	4-5-TSI-13	Silver steam pipe fabric wrap

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Edmattan	<i>[Signature]</i>	Nucleus	10/19/21	10:00am
Analyzed by					
Called by					
Faxed/Email by					

2118237



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

1 Hour 24 Hours 4 Days

2 Hours 2 Days 5 Days

4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi

Address 2815 2nd Ave #540
Seattle, WA 98121

Phone 503-410-1524

Project Manager _____

Cell () _____

Email _____

Fax () _____

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400)
- PLM (EPA 600/R-93-116)
- PLM Gravimetry (600/R-93-116)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116)
- TEM (NIOSH 7402)
- EPA 400 Points (600/R-93-116)
- Asbestos in Vermiculite (EPA 600/R-04/004)
- Other _____
- TEM (AHERA)
- EPA 1000Points (600/R-93-116)
- Asbestos in Sediment (EPA 1900 Points)

Reporting Instructions Report to Emily Curtis

Call () _____

Fax () _____

Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	Silver steam pipe fabric wrap w/ yellow insulation	
2	Red steam pipe fabric wrap w/ yellow insulation	
3	Silver woven heat-resistant seal material on hatch interior	
4	White insulation w/ silver fabric patch on machinery	
5	Orange steam pipe fabric wrap w/ yellow insulation	
6	Orange steam pipe fabric wrap w/ yellow insulation	
7	White insulation w/ orange-painted wrap	
8	Silver steam pipe fabric wrap	
9	White insulation w/ white-painted wrap	
10	White tank insulation w/ grey painted wrap & plastic patch	
11	Silver woven heat-resistant seal material on hatch interior	
12	White insulation w/ orange-painted wrap	
13	Silver steam pipe fabric wrap	
14	White condensate pipe w/ yellow insulation	
15	White condensate line elbow w/ yellow insulation	

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Schmitt	<i>[Signature]</i>	Mulleys	10/19/21	10:00 AM
Analyzed by					
Called by					
Faxed/Email by					

8

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 26, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118240.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 26 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Nick Ly".

Nick Ly, Technical Director

The logo for NVL LABS, featuring the letters "NVL" in a large, outlined, sans-serif font, followed by "LABS" in a smaller, outlined, sans-serif font.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660


Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116209	Client Sample #: 4-2-TSI-29		
Location: N-A			
Layer 1 of 2	Description: Thin silver paint over fibrous mesh		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Metallic paint, Fine particles, Binder/Filler	Cellulose 70%	None Detected ND
Layer 2 of 2	Description: White powdery fibrous material with paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Paint, Fine particles	None Detected ND	Amosite 40%

Lab ID: 21116210	Client Sample #: 4-8-MISC-30		
Location: N-A			
Layer 1 of 2	Description: White interwoven fibrous material with paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Paint, Binder/Filler, Fine particles	Cellulose 10%	Chrysotile 80%
	Debris		
Layer 2 of 2	Description: Gray fibrous mesh		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Fine particles	Cellulose 98%	None Detected ND

Lab ID: 21116211	Client Sample #: 4-2-TSI-31		
Location: N-A			
Layer 1 of 3	Description: Silver paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Metallic paint, Fine particles	None Detected ND	None Detected ND
Layer 2 of 3	Description: White interwoven fibrous mesh		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Fine particles	Glass fibers 98%	None Detected ND

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
Address: 109 E 13th St.
Vancouver, WA 98660

Batch #: 2118240.00
Client Project #: 0457.02.03-01
Date Received: 10/19/2021
Samples Received: 26
Samples Analyzed: 26
Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
Project Location: N-A

Layer 3 of 3	Description: Light brown crumbly powdery fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Glass debris, Fine particles	Glass fibers 60%		None Detected ND
		Cellulose 10%		

Lab ID: 21116212 **Client Sample #: 4-9-TSI-32**
Location: N-A
Comments: Unsure of correct layer sequence.


Layer 1 of 2	Description: Light gray crumbly powdery fibrous material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint, Glass debris	Glass fibers 65%		None Detected ND
	Fine particles			

Layer 2 of 2	Description: Gray crumbly fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Fine grains, Fine particles	Cellulose 12%		Chrysotile 40%

Lab ID: 21116213 **Client Sample #: 4-7-TSI-33**
Location: N-A

Layer 1 of 2	Description: Silver foil with fibrous mesh, paint and paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint, Metal foil	Cellulose 30%		None Detected ND
	Fine particles	Glass fibers 20%		

Layer 2 of 2	Description: Orange fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Fine particles, Glass debris	Glass fibers 98%		None Detected ND

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116214 Client Sample #: 4-10-MISC-34

Location: N-A

Layer 1 of 1	Description: Light gray brittle sandy material			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials: %		None Detected ND
	Binder/Filler, Sand, Fine grains	Cellulose 5%		
	Fine particles			

Lab ID: 21116215 Client Sample #: 4-11-MISC-35


Location: N-A

Layer 1 of 2	Description: Red brick			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials: %		None Detected ND
	Brick, Fine grains, Fine particles	None Detected ND		
Layer 2 of 2	Description: Light gray cementitious material			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials: %		None Detected ND
	Cement/Binder, Fine grains, Fine particles	None Detected ND		

Lab ID: 21116216 Client Sample #: 4-12-MISC-36

Location: N-A

Layer 1 of 2	Description: White brittle fibrous material			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials: %		None Detected ND
	Binder/Filler, Fine particles, Debris	Glass fibers 50%		
Layer 2 of 2	Description: White soft adhesive with paint and debris			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials: %		None Detected ND
	Adhesive/Binder, Paint, Debris	None Detected ND		
	Fine grains, Fine particles			

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	_____ Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116217 Client Sample #: 4-13-MISC-37

Location: N-A

Layer 1 of 2	Description: White compacted powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Calcareous binder, Calcareous particles	Cellulose 2%		None Detected ND
Layer 2 of 2	Description: Gray crumbly material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Fine grains, Fine particles	None Detected ND		None Detected ND

Lab ID: 21116218 Client Sample #: 4-14-MISC-38

Location: N-A


Layer 1 of 2	Description: Black crumbly vinyl			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Vinyl/Binder, Fine grains, Fine particles	None Detected ND		None Detected ND
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Adhesive/Binder, Debris, Fine particles	Cellulose 4%		None Detected ND

Lab ID: 21116219 Client Sample #: 4-15-MISC-39

Location: N-A

Layer 1 of 3	Description: White crumbly vinyl			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Vinyl/Binder, Fine grains, Fine particles	None Detected ND		None Detected ND
Layer 2 of 3	Description: Yellow brittle adhesive with debris and paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Adhesive/Binder, Debris, Fine particles	Cellulose 3%		None Detected ND
	Paint			

Sampled by: Client
Analyzed by: Michael Jenkins **Date:** 10/25/2021
Reviewed by: Nick Ly **Date:** 10/26/2021



 Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116223 Client Sample #: EXT-3-MISC-3

Location: N-A

Layer 1 of 1 Description: Clear soft/elastic material with debris

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Debris, Fine particles	None Detected ND	None Detected ND
Sand		

Lab ID: 21116224 Client Sample #: EXT-1-MISC-4

Location: N-A

Layer 1 of 1 Description: Red brick

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Brick, Fine grains, Fine particles	None Detected ND	None Detected ND

Lab ID: 21116225 Client Sample #: EXT-2-MISC-5

Location: N-A

Layer 1 of 1 Description: Loose gray cementitious material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Cement/Binder, Sand, Debris	None Detected ND	None Detected ND
Fine grains, Fine particles, Mica		

Lab ID: 21116226 Client Sample #: EXT-3-MISC-6


Location: N-A

Layer 1 of 1 Description: Light gray soft/elastic material with debris

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Debris, Fine particles	None Detected ND	None Detected ND

Lab ID: 21116227 Client Sample #: EXT-4-MISC-7

Location: N-A

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 3	Description: Tan and white ceramic with debris Non-Fibrous Materials: Ceramic/Binder, Debris, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Off-white brittle material Non-Fibrous Materials: Binder/Filler, Fine grains, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Light brown brittle material with paint Non-Fibrous Materials: Binder/Filler, Paint, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % Chrysotile 6%

Lab ID: 21116232 Client Sample #: 4-18-MISC-43


Location: N-A

Layer 1 of 2	Description: White brittle powdery material Non-Fibrous Materials: Binder/Filler, Fine grains, Fine particles Gypsum particles	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Off-white brittle sandy material Non-Fibrous Materials: Binder/Filler, Sand, Fine grains Fine particles, Gypsum particles	Other Fibrous Materials:% Cellulose 10%	Asbestos Type: % None Detected ND

Lab ID: 21116233 Client Sample #: 4-19-MISC-44

Location: N-A

Layer 1 of 2	Description: Off-white ceramic with white glaze and sandy debris Non-Fibrous Materials: Ceramic/Binder, Sand, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
---------------------	--	---	--

Sampled by: Client	 _____ Nick Ly, Technical Director
Analyzed by: Michael Jenkins	
Reviewed by: Nick Ly	
Date: 10/25/2021	Date: 10/26/2021

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Fine grains

Layer 2 of 2	Description: Brown crumbly material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Fine particles	Other Fibrous Materials:% Cellulose 6%	Asbestos Type: % Chrysotile 15%
---------------------	---	--	---	--

Lab ID: 21116234 **Client Sample #: 4-18-MISC-45**

Location: N-A

Layer 1 of 2	Description: Light gray brittle powdery material	Non-Fibrous Materials: Binder/Filler, Mica, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
---------------------	---	---	---	--

Layer 2 of 2	Description: White chalky material with paper	Non-Fibrous Materials: Gypsum/Binder, Fine particles	Other Fibrous Materials:% Cellulose 35% Glass fibers 8%	Asbestos Type: % None Detected ND
---------------------	--	---	---	--

Sampled by: Client

Analyzed by: Michael Jenkins

Reviewed by: Nick Ly

Date: 10/25/2021

Date: 10/26/2021

Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118240.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT _____
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax _____

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 26 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116209	4-2-TSI-29	A
2	21116210	4-8-MISC-30	A
3	21116211	4-2-TSI-31	A
4	21116212	4-9-TSI-32	A
5	21116213	4-7-TSI-33	A
6	21116214	4-10-MISC-34	A
7	21116215	4-11-MISC-35	A
8	21116216	4-12-MISC-36	A
9	21116217	4-13-MISC-37	A
10	21116218	4-14-MISC-38	A
11	21116219	4-15-MISC-39	A
12	21116220	4-16-MISC-40	A
13	21116221	EXT-1-MISC-1	A
14	21116222	EXT-2-MISC-2	A
15	21116223	EXT-3-MISC-3	A
16	21116224	EXT-1-MISC-4	A
17	21116225	EXT-2-MISC-5	A
18	21116226	EXT-3-MISC-6	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Michael Jenkins		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:25 PM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc. **NVL Batch Number** **2118240.00**
Address 109 E 13th St. **TAT** 5 Days **AH** No
 Vancouver, WA 98660 **Rush TAT**
Project Manager Mrs. Emily Curtis **Due Date** 10/26/2021 **Time** 10:10 AM
Phone (971) 544-2139 **Email** ecurtis@maulfoster.com
Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 26 **Rush Samples**

Lab ID	Sample ID	Description	A/R
19	21116227	EXT-4-MISC-7	A
20	21116228	3-8-MISC-11	A
21	21116229	3-8-MISC-12	A
22	21116230	4-17-MISC-41	A
23	21116231	4-17-MISC-42	A
24	21116232	4-18-MISC-43	A
25	21116233	4-19-MISC-44	A
26	21116234	4-18-MISC-45	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Michael Jenkins		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 12:25 PM
 Entered By: Fatima Khan



2118240

ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 509-440-1524

Project Manager Matt Hoffman
 Cell () -
 Email _____
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R	
1	4-2-TSI-29	White insulation with silver-painted wrap	
2	4-8-MISC-30	Silver woven heat-resistant seal material on hatch interior	
3	4-2-TSI-31	White insulation w/ silver painted wrap	
4	4-9-TSI-32	White tank insulation w/ orange wrap	
5	4-7-TSI-33	Yellow insulation with red-painted silver wrap	
6	4-10-MISC-34	Gray brick mortar	
7	4-11-MISC-35	Red brick	
8	4-12-MISC-36	White textured waterproofing tile	
9	4-13-MISC-37	Window glazing	
10	4-14-MISC-38	Black 12x12 linoleum floor tile w/ yellow adhesive	
11	4-15-MISC-39	White 12x12 linoleum floor tile w/ yellow adhesive	
12	4-16-MISC-40	Black base core w/ yellow adhesive	
13	5-16 EXT-1-MISC-1	Red Brick	
14	EXT-2-MISC-2	Caray brick mortar	
15	EXT-3-MISC-3	Window glazing	

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Fitmaida	<i>[Signature]</i>	Muller	10/19/21	10:10am
Analyzed by					
Called by					
Faxed/Email by					



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alougi
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis

Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	<u>EXT-1-MISC-4</u>	<u>Red Brick</u>
2	<u>EXT-2-MISC-5</u>	<u>Curry brick mortar</u>
3	<u>EXT-3-MISC-6</u>	<u>Window glazing</u>
4	<u>EXT-4-MISC-7</u>	<u>White brick caulking</u>
5	<u>3-8-MISC-11</u>	<u>Window Glazing</u>
6	<u>3-8-MISC-12</u>	<u>Window Glazing</u>
7	<u>4-17-MISC-41</u>	<u>Tan 1"-2" square tile w/ brown adhesive</u>
8	<u>4-17-MISC-42</u>	<u>Tan 1"-2" square tile w/ brown adhesive</u>
9	<u>4-18-MISC-43</u>	<u>White drywall w/ gray cementitious wallboard</u>
10	<u>4-19-MISC-44</u>	<u>Tan base coat w/ green adhesive</u>
11	<u>4-18-MISC-45</u>	<u>White drywall w/ gray cementitious wallboard</u>
12		
13		
14		
15		

Print Name	Signature	Company	Date	Time
Sampled by <u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by <u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

Print Name	Signature	Company	Date	Time
Received by <u>[Signature]</u>	<u>[Signature]</u>	<u>neulabs</u>	<u>10/16/21</u>	<u>10:00am</u>
Analyzed by				
Called by				
Faxed/Email by				

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 22, 2021

Emily Curtis

Maul Foster & Alongi, Inc.

109 E 13th St.

Vancouver, WA 98660



NVL Batch # 2118241.00

RE: Total Metal Analysis
Method: EPA 7000B Lead by FAA <paint>
Item Code: FAA-02

Client Project: 0457.02.03-01

Location: N-A

Dear Mrs. Curtis,

NVL Labs received 11 sample(s) for the said project on 10/19/2021. Preparation of these samples was conducted following protocol outlined in EPA 3051/7000B, unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with EPA 7000B Lead by FAA <paint>. The results are usually expressed in mg/Kg and percentage (%). Test results are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more detail.

At NVL Labs all analyses are performed under strict guidelines of the Quality Assurance Program. This report is considered highly confidential and will not be released without your approval. Samples are archived after two weeks from the analysis date. Please feel free to contact us at 206-547-0100, in case you have any questions or concerns.

Sincerely,

A handwritten signature in black ink, appearing to read "Shalini Patel".

Shalini Patel, Lab Supervisor

Enc.: Sample results



Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516

Analysis Report

Total Lead (Pb)



Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118241.00

Matrix: Paint
 Method: EPA 3051/7000B
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 11
 Samples Analyzed: 11

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
21116235	1-4-PB-8	0.1854	54	2700	0.27
21116236	1-7-PB-13	0.1939	52	2400	0.24
21116237	1-20-PB-28	0.1774	56	20000	2.0
21116238	2-7-PB-24	0.1861	54	150000	15
21116239	3-6-PB-12	0.2025	49	630	0.063
21116240	4-3-PB-4	0.1904	53	23000	2.3
21116241	4-23-PB-32	0.1931	52	2200	0.22
21116242	4-24-PB-36	0.1919	52	8000	0.80
21116243	4-14-PB-50	0.1927	52	150000	15
21116244	5-1-PB-2	0.1938	52	43000	4.3
21116245	EXT-1-PB-1	0.1839	54	16000	1.6


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/22/2021

Date Issued: 10/22/2021


 Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Bench Run No: 2021-1021-04

FAA-02

LEAD LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118241.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory Flame AA (FAA)
Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 11 **Rush Samples**

Lab ID	Sample ID	Description	A/R
1	21116235	1-4-PB-8	A
2	21116236	1-7-PB-13	A
3	21116237	1-20-PB-28	A
4	21116238	2-7-PB-24	A
5	21116239	3-6-PB-12	A
6	21116240	4-3-PB-4	A
7	21116241	4-23-PB-32	A
8	21116242	4-24-PB-36	A
9	21116243	4-14-PB-50	A
10	21116244	5-1-PB-2	A
11	21116245	EXT-1-PB-1	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Yasuyuki Hida		NVL	10/22/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 12:32 PM
 Entered By: Fatima Khan



METALS CHAIN OF CUSTODY

Turn Around Time

- 2 Hour 4 Hours 24 Hours
 2 Days 3 Days 4 Days
 5 Days 6-10 Days
 Please call for TAT less than 24 Hours

Company Maul Foster & Alougi
 Address 2815 2nd Ave #540,
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () -
 Email _____
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- | | | | | | | |
|--|-------------------------------------|--|--|-------------------------------|-----------------------------------|--|
| <input checked="" type="checkbox"/> Total Metals | <input type="checkbox"/> FAA (ppm) | <input type="checkbox"/> Air Filter | <input type="checkbox"/> Paint Chips (%) | <input type="checkbox"/> Soil | RCRA 8 | RCRA 11 |
| <input type="checkbox"/> TCLP | <input type="checkbox"/> ICP (PPM) | <input checked="" type="checkbox"/> Paint Chips (cm) | <input type="checkbox"/> Dust Wipes | | <input type="checkbox"/> Barium | <input type="checkbox"/> Chromium |
| | <input type="checkbox"/> GFAA (ppb) | <input type="checkbox"/> Drinking Water | <input type="checkbox"/> Waste Water | | <input type="checkbox"/> Arsenic | <input type="checkbox"/> Mercury |
| | <input type="checkbox"/> CVAA (ppb) | <input type="checkbox"/> Other | | | <input type="checkbox"/> Selenium | <input type="checkbox"/> Cadmium |
| | | | | | | <input checked="" type="checkbox"/> Silver |
| | | | | | | <input checked="" type="checkbox"/> Lead |
| | | | | | | <input type="checkbox"/> Copper |
| | | | | | | <input type="checkbox"/> Zinc |
| | | | | | | <input type="checkbox"/> Other |

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

	Sample ID	Description	A/R
1	1-4-PB-8	White Paint Chips	
2	1-7-PB-13	Red Paint Chips	
3	1-20-PB-28	Silver Paint chips	
4	2-7-PB-24	Red Paint Chips	
5	3-6-PB-12	Tan paint chips	
6	4-3-PB-4	Red Paint Chips	
7	4-23-PB-32	Bright White Paint Chips	
8	4-24-PB-36	Green Paint Chips	
9	4-14-PB-50	Orange Paint Chips	
10	5-1-PB-2	Yellow Paint Chips	
11	EXT-1-PB-1	Brownish Red Paint Chips	
12			
13			
14			
15			

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>Connor Anderson</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>Connor Anderson</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<i>Emilia</i>	<i>Emilia</i>	Nuclabs	10/16/21	10:00am
Analyzed by					
Called by					
Faxed/Email by					

Emilia

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

APPENDIX D

ANALYTICAL LABORATORY REPORTS DATA






Maul Foster & Alongi- Coeur d Alene, ID

Sample Delivery Group: L1421071
Samples Received: 10/21/2021
Project Number: 0457.02.03
Description: WSU Steam Plant, Pullman, Washington


Report To: Lisa Pritzl
601 East Front Avenue, Suite 202
Coeur d'Alene, ID 83814

Entire Report Reviewed By:



Brian Ford
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

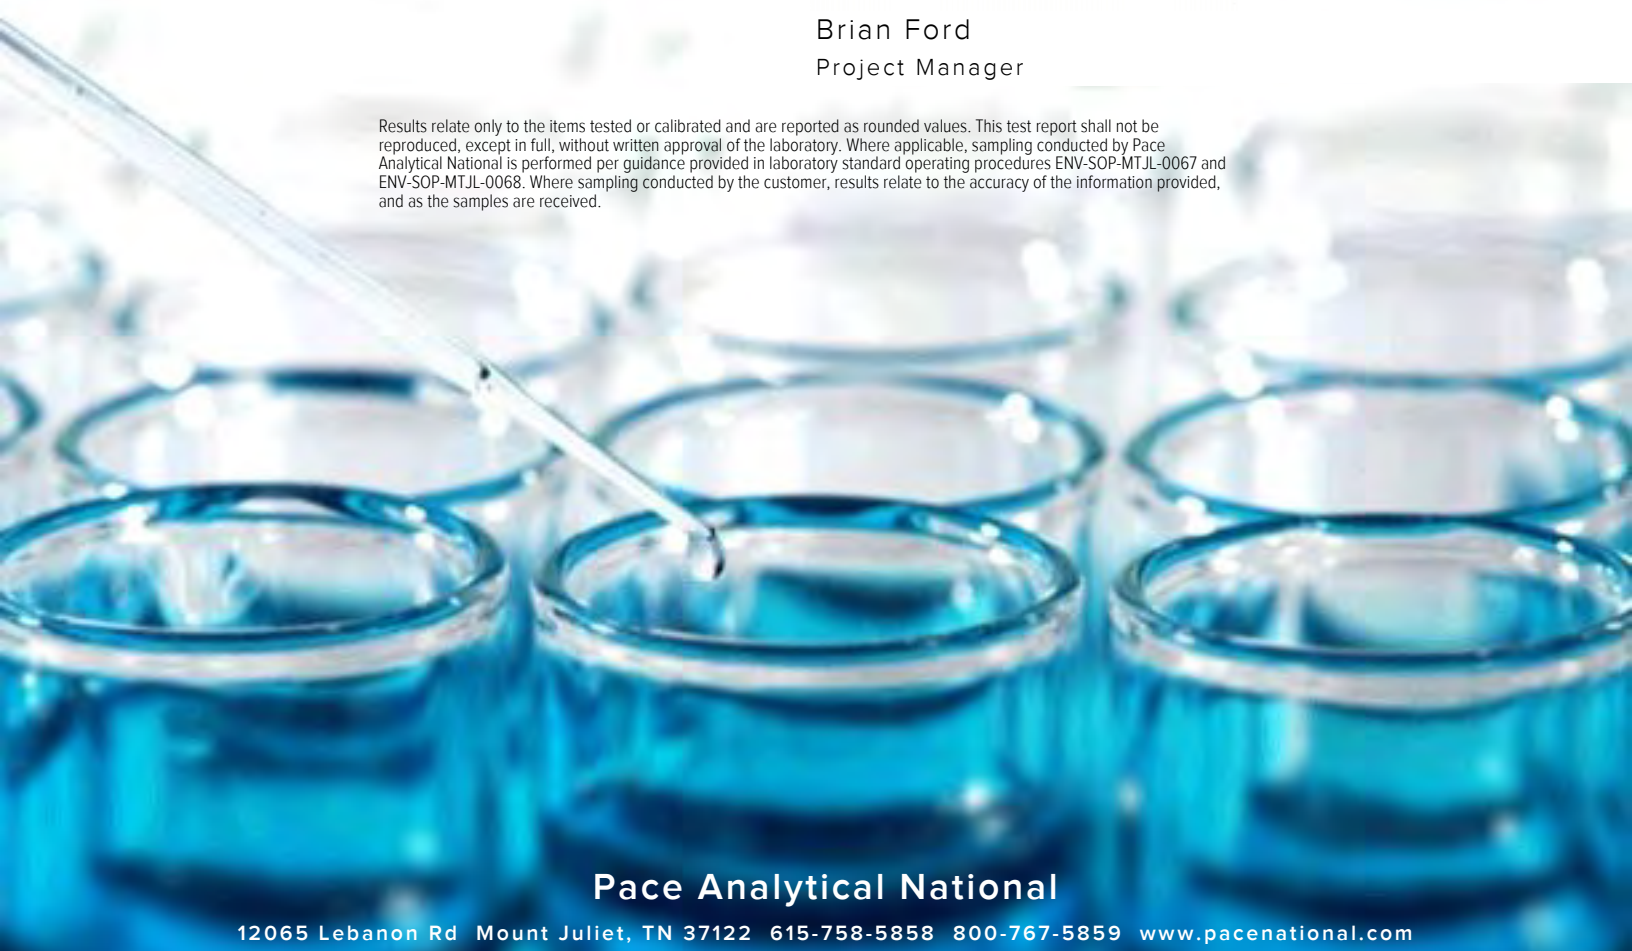

Pace Analytical National

12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 www.pacenational.com

TABLE OF CONTENTS

Cp: Cover Page	1	¹Cp
Tc: Table of Contents	2	²Tc
Ss: Sample Summary	4	³Ss
Cn: Case Narrative	8	⁴Cn
Sr: Sample Results	9	⁵Sr
SB-1-2.5 L1421071-01	9	
SB-1-15 L1421071-02	12	
SB-2-2.0 L1421071-03	14	
SB-2-15.0 L1421071-04	17	
SB-3-5.0 L1421071-05	19	⁶Qc
SB-3-13.0 L1421071-06	22	⁷Is
SB-5-5.0 L1421071-07	24	
SB-5-15.0 L1421071-08	27	⁸Gl
SB-7-5.5 L1421071-09	29	
SB-7-18.5 L1421071-10	32	⁹Al
TRIP BLANK-SOIL COOLER L1421071-11	34	
SB-1-GW L1421071-12	36	¹⁰Sc
SB-2-GW L1421071-13	39	
SB-5-GW L1421071-14	42	
SB-3-GW L1421071-15	45	
SB-7-GW L1421071-16	48	
TRIP BLANK-WATER COOLER L1421071-17	51	
Qc: Quality Control Summary	53	
Total Solids by Method 2540 G-2011	53	
Mercury by Method 7470A	55	
Mercury by Method 7471B	56	
Metals (ICPMS) by Method 6020B	57	
Volatile Organic Compounds (GC/MS) by Method 8260D	60	
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	74	
Polychlorinated Biphenyls (GC) by Method 8082 A	77	
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	79	
Is: Internal Standard Summary	83	
Volatile Organic Compounds (GC/MS) by Method 8260D	83	
Volatile Organic Compounds (GC/MS) by Method 8260D	84	
Polychlorinated Biphenyls (GC) by Method 8082 A	85	
Polychlorinated Biphenyls (GC) by Method 8082 A	86	
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	87	
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	88	
Gl: Glossary of Terms	89	
Al: Accreditations & Locations	91	

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

SAMPLE SUMMARY

SB-1-2.5 L1421071-01 Solid

Collected by L. Pritzl Collected date/time 10/19/21 12:55 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762222	1	10/25/21 08:42	10/25/21 08:48	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 10:39	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:30	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 13:18	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 14:29	JAS	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1764422	1	10/28/21 08:27	10/28/21 13:23	LEA	Mt. Juliet, TN



SB-1-15 L1421071-02 Solid

Collected by L. Pritzl Collected date/time 10/19/21 13:06 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762222	1	10/25/21 08:42	10/25/21 08:48	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 10:42	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:34	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 13:38	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 11:05	JAS	Mt. Juliet, TN

SB-2-2.0 L1421071-03 Solid

Collected by L. Pritzl Collected date/time 10/19/21 15:00 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762222	1	10/25/21 08:42	10/25/21 08:48	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 10:44	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:37	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1.13	10/23/21 22:46	10/26/21 13:57	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 13:48	JAS	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1764422	1	10/28/21 08:27	10/28/21 13:41	LEA	Mt. Juliet, TN

SB-2-15.0 L1421071-04 Solid

Collected by L. Pritzl Collected date/time 10/19/21 15:05 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762222	1	10/25/21 08:42	10/25/21 08:48	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 10:47	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:40	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 14:17	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 11:18	JAS	Mt. Juliet, TN

SB-3-5.0 L1421071-05 Solid

Collected by L. Pritzl Collected date/time 10/19/21 13:40 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762222	1	10/25/21 08:42	10/25/21 08:48	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 10:50	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:44	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 14:36	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 13:34	JAS	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1764422	1	10/28/21 08:27	10/28/21 13:58	ADF	Mt. Juliet, TN

SAMPLE SUMMARY

SB-3-13.0 L1421071-06 Solid

Collected by L. Pritzl Collected date/time 10/19/21 13:50 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762223	1	10/25/21 08:35	10/25/21 08:41	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 10:57	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:47	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 14:55	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 14:15	JAS	Mt. Juliet, TN



SB-5-5.0 L1421071-07 Solid

Collected by L. Pritzl Collected date/time 10/19/21 11:50 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762223	1	10/25/21 08:35	10/25/21 08:41	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 11:00	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:50	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1.23	10/23/21 22:46	10/26/21 15:14	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 14:02	JAS	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1764422	1	10/28/21 08:27	10/28/21 14:16	LEA	Mt. Juliet, TN

SB-5-15.0 L1421071-08 Solid

Collected by L. Pritzl Collected date/time 10/19/21 12:00 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762223	1	10/25/21 08:35	10/25/21 08:41	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 11:02	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:53	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 15:34	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 12:26	JAS	Mt. Juliet, TN
Polychlorinated Biphenyls (GC) by Method 8082 A	WG1764102	1	10/27/21 16:28	10/27/21 22:07	MTJ	Mt. Juliet, TN

SB-7-5.5 L1421071-09 Solid

Collected by L. Pritzl Collected date/time 10/19/21 11:00 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762223	1	10/25/21 08:35	10/25/21 08:41	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 11:05	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 19:57	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 15:53	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 11:32	JAS	Mt. Juliet, TN
Polychlorinated Biphenyls (GC) by Method 8082 A	WG1764102	1	10/27/21 16:28	10/27/21 22:16	MTJ	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1764422	1	10/28/21 08:27	10/28/21 15:09	LEA	Mt. Juliet, TN

SB-7-18.5 L1421071-10 Solid

Collected by L. Pritzl Collected date/time 10/19/21 11:05 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Total Solids by Method 2540 G-2011	WG1762223	1	10/25/21 08:35	10/25/21 08:41	KDW	Mt. Juliet, TN
Mercury by Method 7471B	WG1762773	1	10/25/21 12:30	10/26/21 11:07	MRW	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763566	5	10/26/21 17:34	10/27/21 18:24	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763431	1	10/23/21 22:46	10/26/21 16:12	DWR	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1764428	1	10/28/21 08:29	10/28/21 11:46	JAS	Mt. Juliet, TN
Polychlorinated Biphenyls (GC) by Method 8082 A	WG1764102	1	10/27/21 16:28	10/27/21 22:25	MTJ	Mt. Juliet, TN

SAMPLE SUMMARY

TRIP BLANK-SOIL COOLER L1421071-11 GW

Collected by L. Pritzl
 Collected date/time 10/19/21 08:00
 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1761975	1	10/23/21 00:08	10/23/21 00:08	BMB	Mt. Juliet, TN



SB-1-GW L1421071-12 GW

Collected by L. Pritzl
 Collected date/time 10/19/21 15:35
 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Mercury by Method 7470A	WG1762928	1	10/26/21 14:31	10/27/21 07:32	ABL	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 20:57	LD	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 22:44	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1761975	1	10/23/21 04:39	10/23/21 04:39	BMB	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1765164	1	10/28/21 22:54	10/29/21 09:04	CAG	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1762605	1	10/25/21 23:00	10/26/21 17:14	LEA	Mt. Juliet, TN

SB-2-GW L1421071-13 GW

Collected by L. Pritzl
 Collected date/time 10/19/21 16:30
 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Mercury by Method 7470A	WG1762928	1	10/26/21 14:31	10/27/21 07:34	ABL	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 21:00	LD	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 22:48	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1761975	1	10/23/21 04:59	10/23/21 04:59	GLN	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1765164	1	10/28/21 22:54	10/29/21 09:25	CAG	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1762605	1	10/25/21 23:00	10/26/21 17:32	LEA	Mt. Juliet, TN

SB-5-GW L1421071-14 GW

Collected by L. Pritzl
 Collected date/time 10/19/21 13:30
 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Mercury by Method 7470A	WG1762928	1	10/26/21 14:31	10/27/21 07:36	ABL	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 20:07	LD	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 22:29	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1761975	1	10/23/21 05:18	10/23/21 05:18	GLN	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1765162	1	10/29/21 16:49	10/30/21 01:02	DMG	Mt. Juliet, TN
Polychlorinated Biphenyls (GC) by Method 8082 A	WG1761898	1	10/23/21 06:08	10/24/21 06:30	AMM	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1762605	1	10/25/21 23:00	10/26/21 17:50	LEA	Mt. Juliet, TN

SB-3-GW L1421071-15 GW

Collected by L. Pritzl
 Collected date/time 10/19/21 17:20
 Received date/time 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Mercury by Method 7470A	WG1762928	1	10/26/21 14:31	10/27/21 07:42	ABL	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 21:04	LD	Mt. Juliet, TN
Metals (ICPMS) by Method 6020B	WG1763394	1	10/27/21 11:51	10/27/21 22:51	LD	Mt. Juliet, TN
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1761975	1	10/23/21 05:37	10/23/21 05:37	GLN	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1765164	1	10/28/21 22:54	10/29/21 10:08	CAG	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1762605	1	10/25/21 23:00	10/26/21 18:08	LEA	Mt. Juliet, TN

SAMPLE SUMMARY

SB-7-GW L1421071-16 GW

Collected by: L. Pritzl
 Collected date/time: 10/19/21 16:50
 Received date/time: 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1761975	1	10/23/21 05:57	10/23/21 05:57	GLN	Mt. Juliet, TN
Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT	WG1765164	1	10/28/21 22:54	10/29/21 10:29	CAG	Mt. Juliet, TN
Polychlorinated Biphenyls (GC) by Method 8082 A	WG1761898	1	10/23/21 06:08	10/24/21 07:40	AMM	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM	WG1762605	1	10/25/21 23:00	10/26/21 14:39	LEA	Mt. Juliet, TN

TRIP BLANK-WATER COOLER L1421071-17 GW


Collected by: L. Pritzl
 Collected date/time: 10/19/21 08:00
 Received date/time: 10/21/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Volatile Organic Compounds (GC/MS) by Method 8260D	WG1763302	1	10/26/21 03:39	10/26/21 03:39	ADM	Mt. Juliet, TN

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Brian Ford
Project Manager

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	87.5		1	10/25/2021 08:48	WG1762222

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	U		0.0206	0.0457	1	10/26/2021 10:39	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	4.82		0.114	1.14	5	10/27/2021 19:30	WG1763566
Barium	190		0.174	2.86	5	10/27/2021 19:30	WG1763566
Cadmium	0.224	J	0.0977	1.14	5	10/27/2021 19:30	WG1763566
Chromium	20.3		0.338	5.71	5	10/27/2021 19:30	WG1763566
Lead	11.7		0.113	2.29	5	10/27/2021 19:30	WG1763566
Selenium	0.331	J	0.206	2.86	5	10/27/2021 19:30	WG1763566
Silver	U		0.0988	0.571	5	10/27/2021 19:30	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	U		0.0473	0.0648	1	10/26/2021 13:18	WG1763431
Acrylonitrile	U		0.00468	0.0162	1	10/26/2021 13:18	WG1763431
Benzene	0.00527	J3	0.000605	0.00130	1	10/26/2021 13:18	WG1763431
Bromobenzene	U		0.00117	0.0162	1	10/26/2021 13:18	WG1763431
Bromodichloromethane	U		0.000940	0.00324	1	10/26/2021 13:18	WG1763431
Bromoform	U		0.00152	0.0324	1	10/26/2021 13:18	WG1763431
Bromomethane	U	J3	0.00255	0.0162	1	10/26/2021 13:18	WG1763431
n-Butylbenzene	0.00877	J J3	0.00680	0.0162	1	10/26/2021 13:18	WG1763431
sec-Butylbenzene	U	J3	0.00373	0.0162	1	10/26/2021 13:18	WG1763431
tert-Butylbenzene	U	J3	0.00253	0.00648	1	10/26/2021 13:18	WG1763431
Carbon tetrachloride	U	J3	0.00116	0.00648	1	10/26/2021 13:18	WG1763431
Chlorobenzene	U	J3	0.000272	0.00324	1	10/26/2021 13:18	WG1763431
Chlorodibromomethane	U		0.000793	0.00324	1	10/26/2021 13:18	WG1763431
Chloroethane	U	J3	0.00220	0.00648	1	10/26/2021 13:18	WG1763431
Chloroform	U	J3	0.00133	0.00324	1	10/26/2021 13:18	WG1763431
Chloromethane	U	C3 J3	0.00564	0.0162	1	10/26/2021 13:18	WG1763431
2-Chlorotoluene	U	J3	0.00112	0.00324	1	10/26/2021 13:18	WG1763431
4-Chlorotoluene	U		0.000583	0.00648	1	10/26/2021 13:18	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00505	0.0324	1	10/26/2021 13:18	WG1763431
1,2-Dibromoethane	U		0.000840	0.00324	1	10/26/2021 13:18	WG1763431
Dibromomethane	U		0.000972	0.00648	1	10/26/2021 13:18	WG1763431
1,2-Dichlorobenzene	U		0.000551	0.00648	1	10/26/2021 13:18	WG1763431
1,3-Dichlorobenzene	U	J3	0.000778	0.00648	1	10/26/2021 13:18	WG1763431
1,4-Dichlorobenzene	U		0.000907	0.00648	1	10/26/2021 13:18	WG1763431
Dichlorodifluoromethane	U	J3	0.00209	0.00324	1	10/26/2021 13:18	WG1763431
1,1-Dichloroethane	U	J3	0.000636	0.00324	1	10/26/2021 13:18	WG1763431
1,2-Dichloroethane	U		0.000841	0.00324	1	10/26/2021 13:18	WG1763431
1,1-Dichloroethene	U	C3 J3	0.000785	0.00324	1	10/26/2021 13:18	WG1763431
cis-1,2-Dichloroethene	U	J3	0.000951	0.00324	1	10/26/2021 13:18	WG1763431
trans-1,2-Dichloroethene	U	J3	0.00135	0.00648	1	10/26/2021 13:18	WG1763431
1,2-Dichloropropane	U	J3	0.00184	0.00648	1	10/26/2021 13:18	WG1763431
1,1-Dichloropropene	U	J3	0.00105	0.00324	1	10/26/2021 13:18	WG1763431
1,3-Dichloropropane	U		0.000649	0.00648	1	10/26/2021 13:18	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.000981	0.00324	1	10/26/2021 13:18	WG1763431
trans-1,3-Dichloropropene	U		0.00148	0.00648	1	10/26/2021 13:18	WG1763431
2,2-Dichloropropane	U	C3 J3	0.00179	0.00324	1	10/26/2021 13:18	WG1763431
Di-isopropyl ether	U	J3	0.000531	0.00130	1	10/26/2021 13:18	WG1763431
Ethylbenzene	0.0172	J3	0.000955	0.00324	1	10/26/2021 13:18	WG1763431
Hexachloro-1,3-butadiene	U	J3	0.00778	0.0324	1	10/26/2021 13:18	WG1763431
Isopropylbenzene	0.00503	J3	0.000551	0.00324	1	10/26/2021 13:18	WG1763431
p-Isopropyltoluene	0.0152	J3	0.00330	0.00648	1	10/26/2021 13:18	WG1763431
2-Butanone (MEK)	U		0.0823	0.130	1	10/26/2021 13:18	WG1763431
Methylene Chloride	U	J3	0.00860	0.0324	1	10/26/2021 13:18	WG1763431
4-Methyl-2-pentanone (MIBK)	0.0174	J	0.00295	0.0324	1	10/26/2021 13:18	WG1763431
Methyl tert-butyl ether	U		0.000454	0.00130	1	10/26/2021 13:18	WG1763431
Naphthalene	0.0577		0.00632	0.0162	1	10/26/2021 13:18	WG1763431
n-Propylbenzene	0.00566	J J3	0.00123	0.00648	1	10/26/2021 13:18	WG1763431
Styrene	U	J3	0.000297	0.0162	1	10/26/2021 13:18	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00123	0.00324	1	10/26/2021 13:18	WG1763431
1,1,2,2-Tetrachloroethane	U		0.000901	0.00324	1	10/26/2021 13:18	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3 J3	0.000977	0.00324	1	10/26/2021 13:18	WG1763431
Tetrachloroethene	U	J3	0.00116	0.00324	1	10/26/2021 13:18	WG1763431
Toluene	0.0610		0.00168	0.00648	1	10/26/2021 13:18	WG1763431
1,2,3-Trichlorobenzene	U		0.00950	0.0162	1	10/26/2021 13:18	WG1763431
1,2,4-Trichlorobenzene	U		0.00570	0.0162	1	10/26/2021 13:18	WG1763431
1,1,1-Trichloroethane	U	J3	0.00120	0.00324	1	10/26/2021 13:18	WG1763431
1,1,2-Trichloroethane	U		0.000774	0.00324	1	10/26/2021 13:18	WG1763431
Trichloroethene	U	J3	0.000757	0.00130	1	10/26/2021 13:18	WG1763431
Trichlorofluoromethane	U	C3 J3	0.00107	0.00324	1	10/26/2021 13:18	WG1763431
1,2,3-Trichloropropane	U		0.00210	0.0162	1	10/26/2021 13:18	WG1763431
1,2,4-Trimethylbenzene	0.0485	J3	0.00205	0.00648	1	10/26/2021 13:18	WG1763431
1,2,3-Trimethylbenzene	0.0426		0.00205	0.00648	1	10/26/2021 13:18	WG1763431
Vinyl chloride	U	C3 J3	0.00150	0.00324	1	10/26/2021 13:18	WG1763431
1,3,5-Trimethylbenzene	0.0122	J3	0.00259	0.00648	1	10/26/2021 13:18	WG1763431
Xylenes, Total	0.112	J3	0.00114	0.00842	1	10/26/2021 13:18	WG1763431
(S) Toluene-d8	122			75.0-131		10/26/2021 13:18	WG1763431
(S) 4-Bromofluorobenzene	91.1			67.0-138		10/26/2021 13:18	WG1763431
(S) 1,2-Dichloroethane-d4	99.7			70.0-130		10/26/2021 13:18	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	25.4		1.52	4.57	1	10/28/2021 14:29	WG1764428
Residual Range Organics (RRO)	46.0		3.81	11.4	1	10/28/2021 14:29	WG1764428
(S) o-Terphenyl	34.6			18.0-148		10/28/2021 14:29	WG1764428

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Anthracene	0.00481	J	0.00263	0.00686	1	10/28/2021 13:23	WG1764422
Acenaphthene	0.00516	J	0.00239	0.00686	1	10/28/2021 13:23	WG1764422
Acenaphthylene	U		0.00247	0.00686	1	10/28/2021 13:23	WG1764422
Benzo(a)anthracene	0.00895		0.00198	0.00686	1	10/28/2021 13:23	WG1764422
Benzo(a)pyrene	0.00489	J	0.00205	0.00686	1	10/28/2021 13:23	WG1764422
Benzo(b)fluoranthene	0.00993		0.00175	0.00686	1	10/28/2021 13:23	WG1764422
Benzo(g,h,i)perylene	0.00656	J	0.00202	0.00686	1	10/28/2021 13:23	WG1764422
Benzo(k)fluoranthene	U		0.00246	0.00686	1	10/28/2021 13:23	WG1764422
Chrysene	0.0117		0.00265	0.00686	1	10/28/2021 13:23	WG1764422

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Dibenz(a,h)anthracene	U		0.00197	0.00686	1	10/28/2021 13:23	WG1764422
Fluoranthene	0.00979		0.00259	0.00686	1	10/28/2021 13:23	WG1764422
Fluorene	0.00932		0.00234	0.00686	1	10/28/2021 13:23	WG1764422
Indeno(1,2,3-cd)pyrene	0.00296	J	0.00207	0.00686	1	10/28/2021 13:23	WG1764422
Naphthalene	0.0772		0.00466	0.0229	1	10/28/2021 13:23	WG1764422
Phenanthrene	0.0652		0.00264	0.00686	1	10/28/2021 13:23	WG1764422
Pyrene	0.0126		0.00229	0.00686	1	10/28/2021 13:23	WG1764422
1-Methylnaphthalene	0.129		0.00513	0.0229	1	10/28/2021 13:23	WG1764422
2-Methylnaphthalene	0.183		0.00488	0.0229	1	10/28/2021 13:23	WG1764422
2-Chloronaphthalene	U		0.00532	0.0229	1	10/28/2021 13:23	WG1764422
(S) Nitrobenzene-d5	82.8			14.0-149		10/28/2021 13:23	WG1764422
(S) 2-Fluorobiphenyl	78.1			34.0-125		10/28/2021 13:23	WG1764422
(S) p-Terphenyl-d14	90.2			23.0-120		10/28/2021 13:23	WG1764422

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	83.4		1	10/25/2021 08:48	WG1762222

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	U		0.0216	0.0479	1	10/26/2021 10:42	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	2.97		0.120	1.20	5	10/27/2021 19:34	WG1763566
Barium	115		0.182	3.00	5	10/27/2021 19:34	WG1763566
Cadmium	U		0.102	1.20	5	10/27/2021 19:34	WG1763566
Chromium	18.7		0.355	5.99	5	10/27/2021 19:34	WG1763566
Lead	8.13		0.119	2.40	5	10/27/2021 19:34	WG1763566
Selenium	U		0.216	3.00	5	10/27/2021 19:34	WG1763566
Silver	U		0.104	0.599	5	10/27/2021 19:34	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	U		0.0518	0.0710	1	10/26/2021 13:38	WG1763431
Acrylonitrile	U		0.00513	0.0177	1	10/26/2021 13:38	WG1763431
Benzene	U		0.000663	0.00142	1	10/26/2021 13:38	WG1763431
Bromobenzene	U		0.00128	0.0177	1	10/26/2021 13:38	WG1763431
Bromodichloromethane	U		0.00103	0.00355	1	10/26/2021 13:38	WG1763431
Bromoform	U		0.00166	0.0355	1	10/26/2021 13:38	WG1763431
Bromomethane	U		0.00280	0.0177	1	10/26/2021 13:38	WG1763431
n-Butylbenzene	U		0.00745	0.0177	1	10/26/2021 13:38	WG1763431
sec-Butylbenzene	U		0.00409	0.0177	1	10/26/2021 13:38	WG1763431
tert-Butylbenzene	U		0.00277	0.00710	1	10/26/2021 13:38	WG1763431
Carbon tetrachloride	U		0.00128	0.00710	1	10/26/2021 13:38	WG1763431
Chlorobenzene	U		0.000298	0.00355	1	10/26/2021 13:38	WG1763431
Chlorodibromomethane	U		0.000869	0.00355	1	10/26/2021 13:38	WG1763431
Chloroethane	U		0.00241	0.00710	1	10/26/2021 13:38	WG1763431
Chloroform	U		0.00146	0.00355	1	10/26/2021 13:38	WG1763431
Chloromethane	U	C3	0.00618	0.0177	1	10/26/2021 13:38	WG1763431
2-Chlorotoluene	U		0.00123	0.00355	1	10/26/2021 13:38	WG1763431
4-Chlorotoluene	U		0.000639	0.00710	1	10/26/2021 13:38	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00554	0.0355	1	10/26/2021 13:38	WG1763431
1,2-Dibromoethane	U		0.000920	0.00355	1	10/26/2021 13:38	WG1763431
Dibromomethane	U		0.00106	0.00710	1	10/26/2021 13:38	WG1763431
1,2-Dichlorobenzene	U		0.000603	0.00710	1	10/26/2021 13:38	WG1763431
1,3-Dichlorobenzene	U		0.000852	0.00710	1	10/26/2021 13:38	WG1763431
1,4-Dichlorobenzene	U		0.000994	0.00710	1	10/26/2021 13:38	WG1763431
Dichlorodifluoromethane	U		0.00229	0.00355	1	10/26/2021 13:38	WG1763431
1,1-Dichloroethane	U		0.000697	0.00355	1	10/26/2021 13:38	WG1763431
1,2-Dichloroethane	U		0.000922	0.00355	1	10/26/2021 13:38	WG1763431
1,1-Dichloroethene	U	C3	0.000860	0.00355	1	10/26/2021 13:38	WG1763431
cis-1,2-Dichloroethene	U		0.00104	0.00355	1	10/26/2021 13:38	WG1763431
trans-1,2-Dichloroethene	U		0.00148	0.00710	1	10/26/2021 13:38	WG1763431
1,2-Dichloropropane	U		0.00202	0.00710	1	10/26/2021 13:38	WG1763431
1,1-Dichloropropene	U		0.00115	0.00355	1	10/26/2021 13:38	WG1763431
1,3-Dichloropropane	U		0.000711	0.00710	1	10/26/2021 13:38	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00107	0.00355	1	10/26/2021 13:38	WG1763431
trans-1,3-Dichloropropene	U		0.00162	0.00710	1	10/26/2021 13:38	WG1763431
2,2-Dichloropropane	U	<u>C3</u>	0.00196	0.00355	1	10/26/2021 13:38	WG1763431
Di-isopropyl ether	U		0.000582	0.00142	1	10/26/2021 13:38	WG1763431
Ethylbenzene	U		0.00105	0.00355	1	10/26/2021 13:38	WG1763431
Hexachloro-1,3-butadiene	U		0.00852	0.0355	1	10/26/2021 13:38	WG1763431
Isopropylbenzene	U		0.000603	0.00355	1	10/26/2021 13:38	WG1763431
p-Isopropyltoluene	U		0.00362	0.00710	1	10/26/2021 13:38	WG1763431
2-Butanone (MEK)	U		0.0902	0.142	1	10/26/2021 13:38	WG1763431
Methylene Chloride	U		0.00943	0.0355	1	10/26/2021 13:38	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00324	0.0355	1	10/26/2021 13:38	WG1763431
Methyl tert-butyl ether	U		0.000497	0.00142	1	10/26/2021 13:38	WG1763431
Naphthalene	U		0.00693	0.0177	1	10/26/2021 13:38	WG1763431
n-Propylbenzene	U		0.00135	0.00710	1	10/26/2021 13:38	WG1763431
Styrene	U		0.000325	0.0177	1	10/26/2021 13:38	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00135	0.00355	1	10/26/2021 13:38	WG1763431
1,1,2,2-Tetrachloroethane	U		0.000987	0.00355	1	10/26/2021 13:38	WG1763431
1,1,2-Trichlorotrifluoroethane	U	<u>C3</u>	0.00107	0.00355	1	10/26/2021 13:38	WG1763431
Tetrachloroethene	U		0.00127	0.00355	1	10/26/2021 13:38	WG1763431
Toluene	0.00192	<u>J</u>	0.00185	0.00710	1	10/26/2021 13:38	WG1763431
1,2,3-Trichlorobenzene	U		0.0104	0.0177	1	10/26/2021 13:38	WG1763431
1,2,4-Trichlorobenzene	U		0.00625	0.0177	1	10/26/2021 13:38	WG1763431
1,1,1-Trichloroethane	U		0.00131	0.00355	1	10/26/2021 13:38	WG1763431
1,1,2-Trichloroethane	U		0.000848	0.00355	1	10/26/2021 13:38	WG1763431
Trichloroethene	U		0.000829	0.00142	1	10/26/2021 13:38	WG1763431
Trichlorofluoromethane	U	<u>C3</u>	0.00117	0.00355	1	10/26/2021 13:38	WG1763431
1,2,3-Trichloropropane	U		0.00230	0.0177	1	10/26/2021 13:38	WG1763431
1,2,4-Trimethylbenzene	U		0.00224	0.00710	1	10/26/2021 13:38	WG1763431
1,2,3-Trimethylbenzene	U		0.00224	0.00710	1	10/26/2021 13:38	WG1763431
Vinyl chloride	U	<u>C3</u>	0.00165	0.00355	1	10/26/2021 13:38	WG1763431
1,3,5-Trimethylbenzene	U		0.00284	0.00710	1	10/26/2021 13:38	WG1763431
Xylenes, Total	U		0.00125	0.00923	1	10/26/2021 13:38	WG1763431
(S) Toluene-d8	123			75.0-131		10/26/2021 13:38	WG1763431
(S) 4-Bromofluorobenzene	89.4			67.0-138		10/26/2021 13:38	WG1763431
(S) 1,2-Dichloroethane-d4	105			70.0-130		10/26/2021 13:38	WG1763431



Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		1.59	4.79	1	10/28/2021 11:05	WG1764428
Residual Range Organics (RRO)	U		3.99	12.0	1	10/28/2021 11:05	WG1764428
(S) o-Terphenyl	38.5			18.0-148		10/28/2021 11:05	WG1764428

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	86.9		1	10/25/2021 08:48	WG1762222

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	U		0.0207	0.0460	1	10/26/2021 10:44	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	3.86		0.115	1.15	5	10/27/2021 19:37	WG1763566
Barium	94.0		0.175	2.88	5	10/27/2021 19:37	WG1763566
Cadmium	0.288	J	0.0984	1.15	5	10/27/2021 19:37	WG1763566
Chromium	20.2		0.341	5.76	5	10/27/2021 19:37	WG1763566
Lead	13.3		0.114	2.30	5	10/27/2021 19:37	WG1763566
Selenium	0.372	J	0.207	2.88	5	10/27/2021 19:37	WG1763566
Silver	U		0.0996	0.576	5	10/27/2021 19:37	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	U		0.0530	0.0726	1.13	10/26/2021 13:57	WG1763431
Acrylonitrile	U		0.00524	0.0181	1.13	10/26/2021 13:57	WG1763431
Benzene	U		0.000679	0.00145	1.13	10/26/2021 13:57	WG1763431
Bromobenzene	U		0.00131	0.0181	1.13	10/26/2021 13:57	WG1763431
Bromodichloromethane	U		0.00105	0.00364	1.13	10/26/2021 13:57	WG1763431
Bromoform	U		0.00170	0.0364	1.13	10/26/2021 13:57	WG1763431
Bromomethane	U		0.00287	0.0181	1.13	10/26/2021 13:57	WG1763431
n-Butylbenzene	U		0.00762	0.0181	1.13	10/26/2021 13:57	WG1763431
sec-Butylbenzene	U		0.00418	0.0181	1.13	10/26/2021 13:57	WG1763431
tert-Butylbenzene	U		0.00283	0.00726	1.13	10/26/2021 13:57	WG1763431
Carbon tetrachloride	U		0.00130	0.00726	1.13	10/26/2021 13:57	WG1763431
Chlorobenzene	U		0.000305	0.00364	1.13	10/26/2021 13:57	WG1763431
Chlorodibromomethane	U		0.000889	0.00364	1.13	10/26/2021 13:57	WG1763431
Chloroethane	U		0.00247	0.00726	1.13	10/26/2021 13:57	WG1763431
Chloroform	U		0.00149	0.00364	1.13	10/26/2021 13:57	WG1763431
Chloromethane	U	C3	0.00632	0.0181	1.13	10/26/2021 13:57	WG1763431
2-Chlorotoluene	U		0.00126	0.00364	1.13	10/26/2021 13:57	WG1763431
4-Chlorotoluene	U		0.000654	0.00726	1.13	10/26/2021 13:57	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00567	0.0364	1.13	10/26/2021 13:57	WG1763431
1,2-Dibromoethane	U		0.000941	0.00364	1.13	10/26/2021 13:57	WG1763431
Dibromomethane	U		0.00109	0.00726	1.13	10/26/2021 13:57	WG1763431
1,2-Dichlorobenzene	U		0.000617	0.00726	1.13	10/26/2021 13:57	WG1763431
1,3-Dichlorobenzene	U		0.000871	0.00726	1.13	10/26/2021 13:57	WG1763431
1,4-Dichlorobenzene	U		0.00102	0.00726	1.13	10/26/2021 13:57	WG1763431
Dichlorodifluoromethane	U		0.00234	0.00364	1.13	10/26/2021 13:57	WG1763431
1,1-Dichloroethane	U		0.000713	0.00364	1.13	10/26/2021 13:57	WG1763431
1,2-Dichloroethane	U		0.000942	0.00364	1.13	10/26/2021 13:57	WG1763431
1,1-Dichloroethene	U	C3	0.000880	0.00364	1.13	10/26/2021 13:57	WG1763431
cis-1,2-Dichloroethene	U		0.00107	0.00364	1.13	10/26/2021 13:57	WG1763431
trans-1,2-Dichloroethene	U		0.00152	0.00726	1.13	10/26/2021 13:57	WG1763431
1,2-Dichloropropane	U		0.00206	0.00726	1.13	10/26/2021 13:57	WG1763431
1,1-Dichloropropene	U		0.00117	0.00364	1.13	10/26/2021 13:57	WG1763431
1,3-Dichloropropane	U		0.000728	0.00726	1.13	10/26/2021 13:57	WG1763431

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00110	0.00364	1.13	10/26/2021 13:57	WG1763431
trans-1,3-Dichloropropene	U		0.00166	0.00726	1.13	10/26/2021 13:57	WG1763431
2,2-Dichloropropane	U	C3	0.00201	0.00364	1.13	10/26/2021 13:57	WG1763431
Di-isopropyl ether	U		0.000595	0.00145	1.13	10/26/2021 13:57	WG1763431
Ethylbenzene	U		0.00107	0.00364	1.13	10/26/2021 13:57	WG1763431
Hexachloro-1,3-butadiene	U		0.00871	0.0364	1.13	10/26/2021 13:57	WG1763431
Isopropylbenzene	U		0.000617	0.00364	1.13	10/26/2021 13:57	WG1763431
p-Isopropyltoluene	U		0.00370	0.00726	1.13	10/26/2021 13:57	WG1763431
2-Butanone (MEK)	U		0.0923	0.145	1.13	10/26/2021 13:57	WG1763431
Methylene Chloride	U		0.00964	0.0364	1.13	10/26/2021 13:57	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00332	0.0364	1.13	10/26/2021 13:57	WG1763431
Methyl tert-butyl ether	U		0.000509	0.00145	1.13	10/26/2021 13:57	WG1763431
Naphthalene	U		0.00708	0.0181	1.13	10/26/2021 13:57	WG1763431
n-Propylbenzene	U		0.00138	0.00726	1.13	10/26/2021 13:57	WG1763431
Styrene	U		0.000333	0.0181	1.13	10/26/2021 13:57	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00138	0.00364	1.13	10/26/2021 13:57	WG1763431
1,1,2,2-Tetrachloroethane	U		0.00101	0.00364	1.13	10/26/2021 13:57	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00110	0.00364	1.13	10/26/2021 13:57	WG1763431
Tetrachloroethene	U		0.00130	0.00364	1.13	10/26/2021 13:57	WG1763431
Toluene	0.00338	U	0.00189	0.00726	1.13	10/26/2021 13:57	WG1763431
1,2,3-Trichlorobenzene	U		0.0106	0.0181	1.13	10/26/2021 13:57	WG1763431
1,2,4-Trichlorobenzene	U		0.00639	0.0181	1.13	10/26/2021 13:57	WG1763431
1,1,1-Trichloroethane	U		0.00134	0.00364	1.13	10/26/2021 13:57	WG1763431
1,1,2-Trichloroethane	U		0.000868	0.00364	1.13	10/26/2021 13:57	WG1763431
Trichloroethene	U		0.000848	0.00145	1.13	10/26/2021 13:57	WG1763431
Trichlorofluoromethane	U	C3	0.00120	0.00364	1.13	10/26/2021 13:57	WG1763431
1,2,3-Trichloropropane	U		0.00235	0.0181	1.13	10/26/2021 13:57	WG1763431
1,2,4-Trimethylbenzene	U		0.00230	0.00726	1.13	10/26/2021 13:57	WG1763431
1,2,3-Trimethylbenzene	U		0.00230	0.00726	1.13	10/26/2021 13:57	WG1763431
Vinyl chloride	U	C3	0.00168	0.00364	1.13	10/26/2021 13:57	WG1763431
1,3,5-Trimethylbenzene	U		0.00290	0.00726	1.13	10/26/2021 13:57	WG1763431
Xylenes, Total	0.00585	U	0.00128	0.00945	1.13	10/26/2021 13:57	WG1763431
(S) Toluene-d8	125			75.0-131		10/26/2021 13:57	WG1763431
(S) 4-Bromofluorobenzene	90.4			67.0-138		10/26/2021 13:57	WG1763431
(S) 1,2-Dichloroethane-d4	104			70.0-130		10/26/2021 13:57	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	7.56		1.53	4.60	1	10/28/2021 13:48	WG1764428
Residual Range Organics (RRO)	19.1		3.83	11.5	1	10/28/2021 13:48	WG1764428
(S) o-Terphenyl	58.7			18.0-148		10/28/2021 13:48	WG1764428

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Anthracene	0.00439	U	0.00265	0.00691	1	10/28/2021 13:41	WG1764422
Acenaphthene	U		0.00241	0.00691	1	10/28/2021 13:41	WG1764422
Acenaphthylene	U		0.00249	0.00691	1	10/28/2021 13:41	WG1764422
Benzo(a)anthracene	0.00600	U	0.00199	0.00691	1	10/28/2021 13:41	WG1764422
Benzo(a)pyrene	0.00403	U	0.00206	0.00691	1	10/28/2021 13:41	WG1764422
Benzo(b)fluoranthene	0.00583	U	0.00176	0.00691	1	10/28/2021 13:41	WG1764422
Benzo(g,h,i)perylene	0.00368	U	0.00204	0.00691	1	10/28/2021 13:41	WG1764422
Benzo(k)fluoranthene	U		0.00248	0.00691	1	10/28/2021 13:41	WG1764422
Chrysene	0.00634	U	0.00267	0.00691	1	10/28/2021 13:41	WG1764422

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Dibenz(a,h)anthracene	U		0.00198	0.00691	1	10/28/2021 13:41	WG1764422
Fluoranthene	0.0110		0.00261	0.00691	1	10/28/2021 13:41	WG1764422
Fluorene	0.00311	U	0.00236	0.00691	1	10/28/2021 13:41	WG1764422
Indeno(1,2,3-cd)pyrene	0.00374	U	0.00208	0.00691	1	10/28/2021 13:41	WG1764422
Naphthalene	0.0125	U	0.00470	0.0230	1	10/28/2021 13:41	WG1764422
Phenanthrene	0.0195		0.00266	0.00691	1	10/28/2021 13:41	WG1764422
Pyrene	0.0107		0.00230	0.00691	1	10/28/2021 13:41	WG1764422
1-Methylnaphthalene	0.0268		0.00517	0.0230	1	10/28/2021 13:41	WG1764422
2-Methylnaphthalene	0.0284		0.00492	0.0230	1	10/28/2021 13:41	WG1764422
2-Chloronaphthalene	U		0.00536	0.0230	1	10/28/2021 13:41	WG1764422
(S) Nitrobenzene-d5	85.0			14.0-149		10/28/2021 13:41	WG1764422
(S) 2-Fluorobiphenyl	84.4			34.0-125		10/28/2021 13:41	WG1764422
(S) p-Terphenyl-d14	94.1			23.0-120		10/28/2021 13:41	WG1764422

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
	%			date / time	
Total Solids	83.0		1	10/25/2021 08:48	WG1762222

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Mercury	U		0.0217	0.0482	1	10/26/2021 10:47	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Arsenic	3.00		0.120	1.20	5	10/27/2021 19:40	WG1763566
Barium	114		0.183	3.01	5	10/27/2021 19:40	WG1763566
Cadmium	U		0.103	1.20	5	10/27/2021 19:40	WG1763566
Chromium	13.9		0.357	6.02	5	10/27/2021 19:40	WG1763566
Lead	6.01		0.119	2.41	5	10/27/2021 19:40	WG1763566
Selenium	0.266	J	0.217	3.01	5	10/27/2021 19:40	WG1763566
Silver	U		0.104	0.602	5	10/27/2021 19:40	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Acetone	U		0.0530	0.0727	1	10/26/2021 14:17	WG1763431
Acrylonitrile	U		0.00525	0.0182	1	10/26/2021 14:17	WG1763431
Benzene	U		0.000679	0.00145	1	10/26/2021 14:17	WG1763431
Bromobenzene	U		0.00131	0.0182	1	10/26/2021 14:17	WG1763431
Bromodichloromethane	U		0.00105	0.00363	1	10/26/2021 14:17	WG1763431
Bromoform	U		0.00170	0.0363	1	10/26/2021 14:17	WG1763431
Bromomethane	U		0.00286	0.0182	1	10/26/2021 14:17	WG1763431
n-Butylbenzene	U		0.00763	0.0182	1	10/26/2021 14:17	WG1763431
sec-Butylbenzene	U		0.00419	0.0182	1	10/26/2021 14:17	WG1763431
tert-Butylbenzene	U		0.00283	0.00727	1	10/26/2021 14:17	WG1763431
Carbon tetrachloride	U		0.00131	0.00727	1	10/26/2021 14:17	WG1763431
Chlorobenzene	U		0.000305	0.00363	1	10/26/2021 14:17	WG1763431
Chlorodibromomethane	U		0.000889	0.00363	1	10/26/2021 14:17	WG1763431
Chloroethane	U		0.00247	0.00727	1	10/26/2021 14:17	WG1763431
Chloroform	U		0.00150	0.00363	1	10/26/2021 14:17	WG1763431
Chloromethane	U	C3	0.00632	0.0182	1	10/26/2021 14:17	WG1763431
2-Chlorotoluene	U		0.00126	0.00363	1	10/26/2021 14:17	WG1763431
4-Chlorotoluene	U		0.000654	0.00727	1	10/26/2021 14:17	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00567	0.0363	1	10/26/2021 14:17	WG1763431
1,2-Dibromoethane	U		0.000942	0.00363	1	10/26/2021 14:17	WG1763431
Dibromomethane	U		0.00109	0.00727	1	10/26/2021 14:17	WG1763431
1,2-Dichlorobenzene	U		0.000618	0.00727	1	10/26/2021 14:17	WG1763431
1,3-Dichlorobenzene	U		0.000872	0.00727	1	10/26/2021 14:17	WG1763431
1,4-Dichlorobenzene	U		0.00102	0.00727	1	10/26/2021 14:17	WG1763431
Dichlorodifluoromethane	U		0.00234	0.00363	1	10/26/2021 14:17	WG1763431
1,1-Dichloroethane	U		0.000714	0.00363	1	10/26/2021 14:17	WG1763431
1,2-Dichloroethane	U		0.000943	0.00363	1	10/26/2021 14:17	WG1763431
1,1-Dichloroethene	U	C3	0.000881	0.00363	1	10/26/2021 14:17	WG1763431
cis-1,2-Dichloroethene	U		0.00107	0.00363	1	10/26/2021 14:17	WG1763431
trans-1,2-Dichloroethene	U		0.00151	0.00727	1	10/26/2021 14:17	WG1763431
1,2-Dichloropropane	U		0.00206	0.00727	1	10/26/2021 14:17	WG1763431
1,1-Dichloropropene	U		0.00118	0.00363	1	10/26/2021 14:17	WG1763431
1,3-Dichloropropane	U		0.000728	0.00727	1	10/26/2021 14:17	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00110	0.00363	1	10/26/2021 14:17	WG1763431
trans-1,3-Dichloropropene	U		0.00166	0.00727	1	10/26/2021 14:17	WG1763431
2,2-Dichloropropane	U	<u>C3</u>	0.00201	0.00363	1	10/26/2021 14:17	WG1763431
Di-isopropyl ether	U		0.000596	0.00145	1	10/26/2021 14:17	WG1763431
Ethylbenzene	U		0.00107	0.00363	1	10/26/2021 14:17	WG1763431
Hexachloro-1,3-butadiene	U		0.00872	0.0363	1	10/26/2021 14:17	WG1763431
Isopropylbenzene	U		0.000618	0.00363	1	10/26/2021 14:17	WG1763431
p-Isopropyltoluene	U		0.00371	0.00727	1	10/26/2021 14:17	WG1763431
2-Butanone (MEK)	U		0.0923	0.145	1	10/26/2021 14:17	WG1763431
Methylene Chloride	U		0.00965	0.0363	1	10/26/2021 14:17	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00331	0.0363	1	10/26/2021 14:17	WG1763431
Methyl tert-butyl ether	U		0.000509	0.00145	1	10/26/2021 14:17	WG1763431
Naphthalene	U		0.00709	0.0182	1	10/26/2021 14:17	WG1763431
n-Propylbenzene	U		0.00138	0.00727	1	10/26/2021 14:17	WG1763431
Styrene	U		0.000333	0.0182	1	10/26/2021 14:17	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00138	0.00363	1	10/26/2021 14:17	WG1763431
1,1,2,2-Tetrachloroethane	U		0.00101	0.00363	1	10/26/2021 14:17	WG1763431
1,1,2-Trichlorotrifluoroethane	U	<u>C3</u>	0.00110	0.00363	1	10/26/2021 14:17	WG1763431
Tetrachloroethene	U		0.00130	0.00363	1	10/26/2021 14:17	WG1763431
Toluene	U		0.00189	0.00727	1	10/26/2021 14:17	WG1763431
1,2,3-Trichlorobenzene	U		0.0107	0.0182	1	10/26/2021 14:17	WG1763431
1,2,4-Trichlorobenzene	U		0.00639	0.0182	1	10/26/2021 14:17	WG1763431
1,1,1-Trichloroethane	U		0.00134	0.00363	1	10/26/2021 14:17	WG1763431
1,1,2-Trichloroethane	U		0.000868	0.00363	1	10/26/2021 14:17	WG1763431
Trichloroethene	U		0.000849	0.00145	1	10/26/2021 14:17	WG1763431
Trichlorofluoromethane	U	<u>C3</u>	0.00120	0.00363	1	10/26/2021 14:17	WG1763431
1,2,3-Trichloropropane	U		0.00235	0.0182	1	10/26/2021 14:17	WG1763431
1,2,4-Trimethylbenzene	U		0.00230	0.00727	1	10/26/2021 14:17	WG1763431
1,2,3-Trimethylbenzene	U		0.00230	0.00727	1	10/26/2021 14:17	WG1763431
Vinyl chloride	U	<u>C3</u>	0.00169	0.00363	1	10/26/2021 14:17	WG1763431
1,3,5-Trimethylbenzene	U		0.00291	0.00727	1	10/26/2021 14:17	WG1763431
Xylenes, Total	U		0.00128	0.00945	1	10/26/2021 14:17	WG1763431
(S) Toluene-d8	123			75.0-131		10/26/2021 14:17	WG1763431
(S) 4-Bromofluorobenzene	88.9			67.0-138		10/26/2021 14:17	WG1763431
(S) 1,2-Dichloroethane-d4	104			70.0-130		10/26/2021 14:17	WG1763431

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		1.60	4.82	1	10/28/2021 11:18	WG1764428
Residual Range Organics (RRO)	U		4.01	12.0	1	10/28/2021 11:18	WG1764428
(S) o-Terphenyl	54.6			18.0-148		10/28/2021 11:18	WG1764428

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
	%			date / time	
Total Solids	81.9		1	10/25/2021 08:48	WG1762222

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Mercury	0.0295	J	0.0220	0.0488	1	10/26/2021 10:50	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Arsenic	2.98		0.122	1.22	5	10/27/2021 19:44	WG1763566
Barium	145		0.186	3.05	5	10/27/2021 19:44	WG1763566
Cadmium	0.284	J	0.104	1.22	5	10/27/2021 19:44	WG1763566
Chromium	18.3		0.361	6.10	5	10/27/2021 19:44	WG1763566
Lead	71.2		0.121	2.44	5	10/27/2021 19:44	WG1763566
Selenium	0.300	J	0.220	3.05	5	10/27/2021 19:44	WG1763566
Silver	0.233	J	0.106	0.610	5	10/27/2021 19:44	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Acetone	U		0.0538	0.0737	1	10/26/2021 14:36	WG1763431
Acrylonitrile	U		0.00532	0.0184	1	10/26/2021 14:36	WG1763431
Benzene	0.00580		0.000688	0.00147	1	10/26/2021 14:36	WG1763431
Bromobenzene	U		0.00133	0.0184	1	10/26/2021 14:36	WG1763431
Bromodichloromethane	U		0.00107	0.00368	1	10/26/2021 14:36	WG1763431
Bromoform	U		0.00172	0.0368	1	10/26/2021 14:36	WG1763431
Bromomethane	U		0.00290	0.0184	1	10/26/2021 14:36	WG1763431
n-Butylbenzene	U		0.00773	0.0184	1	10/26/2021 14:36	WG1763431
sec-Butylbenzene	U		0.00424	0.0184	1	10/26/2021 14:36	WG1763431
tert-Butylbenzene	U		0.00287	0.00737	1	10/26/2021 14:36	WG1763431
Carbon tetrachloride	U		0.00132	0.00737	1	10/26/2021 14:36	WG1763431
Chlorobenzene	U		0.000309	0.00368	1	10/26/2021 14:36	WG1763431
Chlorodibromomethane	U		0.000902	0.00368	1	10/26/2021 14:36	WG1763431
Chloroethane	U		0.00250	0.00737	1	10/26/2021 14:36	WG1763431
Chloroform	U		0.00152	0.00368	1	10/26/2021 14:36	WG1763431
Chloromethane	U	C3	0.00641	0.0184	1	10/26/2021 14:36	WG1763431
2-Chlorotoluene	U		0.00127	0.00368	1	10/26/2021 14:36	WG1763431
4-Chlorotoluene	U		0.000663	0.00737	1	10/26/2021 14:36	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00575	0.0368	1	10/26/2021 14:36	WG1763431
1,2-Dibromoethane	U		0.000955	0.00368	1	10/26/2021 14:36	WG1763431
Dibromomethane	U		0.00110	0.00737	1	10/26/2021 14:36	WG1763431
1,2-Dichlorobenzene	U		0.000626	0.00737	1	10/26/2021 14:36	WG1763431
1,3-Dichlorobenzene	U		0.000884	0.00737	1	10/26/2021 14:36	WG1763431
1,4-Dichlorobenzene	U		0.00103	0.00737	1	10/26/2021 14:36	WG1763431
Dichlorodifluoromethane	U		0.00237	0.00368	1	10/26/2021 14:36	WG1763431
1,1-Dichloroethane	U		0.000723	0.00368	1	10/26/2021 14:36	WG1763431
1,2-Dichloroethane	U		0.000956	0.00368	1	10/26/2021 14:36	WG1763431
1,1-Dichloroethene	U	C3	0.000893	0.00368	1	10/26/2021 14:36	WG1763431
cis-1,2-Dichloroethene	U		0.00108	0.00368	1	10/26/2021 14:36	WG1763431
trans-1,2-Dichloroethene	U		0.00153	0.00737	1	10/26/2021 14:36	WG1763431
1,2-Dichloropropane	U		0.00209	0.00737	1	10/26/2021 14:36	WG1763431
1,1-Dichloropropene	U		0.00119	0.00368	1	10/26/2021 14:36	WG1763431
1,3-Dichloropropane	U		0.000738	0.00737	1	10/26/2021 14:36	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00112	0.00368	1	10/26/2021 14:36	WG1763431
trans-1,3-Dichloropropene	U		0.00168	0.00737	1	10/26/2021 14:36	WG1763431
2,2-Dichloropropane	U	C3	0.00203	0.00368	1	10/26/2021 14:36	WG1763431
Di-isopropyl ether	U		0.000604	0.00147	1	10/26/2021 14:36	WG1763431
Ethylbenzene	0.0122		0.00109	0.00368	1	10/26/2021 14:36	WG1763431
Hexachloro-1,3-butadiene	U		0.00884	0.0368	1	10/26/2021 14:36	WG1763431
Isopropylbenzene	0.00324	U	0.000626	0.00368	1	10/26/2021 14:36	WG1763431
p-Isopropyltoluene	0.00891		0.00376	0.00737	1	10/26/2021 14:36	WG1763431
2-Butanone (MEK)	U		0.0935	0.147	1	10/26/2021 14:36	WG1763431
Methylene Chloride	U		0.00978	0.0368	1	10/26/2021 14:36	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00336	0.0368	1	10/26/2021 14:36	WG1763431
Methyl tert-butyl ether	U		0.000516	0.00147	1	10/26/2021 14:36	WG1763431
Naphthalene	0.0436		0.00719	0.0184	1	10/26/2021 14:36	WG1763431
n-Propylbenzene	0.00414	U	0.00140	0.00737	1	10/26/2021 14:36	WG1763431
Styrene	U		0.000337	0.0184	1	10/26/2021 14:36	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00140	0.00368	1	10/26/2021 14:36	WG1763431
1,1,2,2-Tetrachloroethane	U		0.00102	0.00368	1	10/26/2021 14:36	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00111	0.00368	1	10/26/2021 14:36	WG1763431
Tetrachloroethene	U		0.00132	0.00368	1	10/26/2021 14:36	WG1763431
Toluene	0.0687		0.00192	0.00737	1	10/26/2021 14:36	WG1763431
1,2,3-Trichlorobenzene	U		0.0108	0.0184	1	10/26/2021 14:36	WG1763431
1,2,4-Trichlorobenzene	U		0.00648	0.0184	1	10/26/2021 14:36	WG1763431
1,1,1-Trichloroethane	U		0.00136	0.00368	1	10/26/2021 14:36	WG1763431
1,1,2-Trichloroethane	U		0.000880	0.00368	1	10/26/2021 14:36	WG1763431
Trichloroethene	U		0.000860	0.00147	1	10/26/2021 14:36	WG1763431
Trichlorofluoromethane	U	C3	0.00122	0.00368	1	10/26/2021 14:36	WG1763431
1,2,3-Trichloropropane	U		0.00239	0.0184	1	10/26/2021 14:36	WG1763431
1,2,4-Trimethylbenzene	0.0318		0.00233	0.00737	1	10/26/2021 14:36	WG1763431
1,2,3-Trimethylbenzene	0.0317		0.00233	0.00737	1	10/26/2021 14:36	WG1763431
Vinyl chloride	U	C3	0.00171	0.00368	1	10/26/2021 14:36	WG1763431
1,3,5-Trimethylbenzene	0.00907		0.00295	0.00737	1	10/26/2021 14:36	WG1763431
Xylenes, Total	0.0959		0.00130	0.00958	1	10/26/2021 14:36	WG1763431
(S) Toluene-d8	120			75.0-131		10/26/2021 14:36	WG1763431
(S) 4-Bromofluorobenzene	89.0			67.0-138		10/26/2021 14:36	WG1763431
(S) 1,2-Dichloroethane-d4	102			70.0-130		10/26/2021 14:36	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	16.1		1.62	4.88	1	10/28/2021 13:34	WG1764428
Residual Range Organics (RRO)	22.1		4.06	12.2	1	10/28/2021 13:34	WG1764428
(S) o-Terphenyl	40.8			18.0-148		10/28/2021 13:34	WG1764428

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Anthracene	0.0110		0.00281	0.00732	1	10/28/2021 13:58	WG1764422
Acenaphthene	0.00409	U	0.00255	0.00732	1	10/28/2021 13:58	WG1764422
Acenaphthylene	U		0.00264	0.00732	1	10/28/2021 13:58	WG1764422
Benzo(a)anthracene	0.00997		0.00211	0.00732	1	10/28/2021 13:58	WG1764422
Benzo(a)pyrene	0.00491	U	0.00219	0.00732	1	10/28/2021 13:58	WG1764422
Benzo(b)fluoranthene	0.00525	U	0.00187	0.00732	1	10/28/2021 13:58	WG1764422
Benzo(g,h,i)perylene	0.00238	U	0.00216	0.00732	1	10/28/2021 13:58	WG1764422
Benzo(k)fluoranthene	U		0.00262	0.00732	1	10/28/2021 13:58	WG1764422
Chrysene	0.0102		0.00283	0.00732	1	10/28/2021 13:58	WG1764422

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Dibenz(a,h)anthracene	U		0.00210	0.00732	1	10/28/2021 13:58	WG1764422
Fluoranthene	0.00748		0.00277	0.00732	1	10/28/2021 13:58	WG1764422
Fluorene	0.00587	J	0.00250	0.00732	1	10/28/2021 13:58	WG1764422
Indeno(1,2,3-cd)pyrene	U		0.00221	0.00732	1	10/28/2021 13:58	WG1764422
Naphthalene	0.144		0.00498	0.0244	1	10/28/2021 13:58	WG1764422
Phenanthrene	0.0630		0.00282	0.00732	1	10/28/2021 13:58	WG1764422
Pyrene	0.0115		0.00244	0.00732	1	10/28/2021 13:58	WG1764422
1-Methylnaphthalene	0.217		0.00548	0.0244	1	10/28/2021 13:58	WG1764422
2-Methylnaphthalene	0.276		0.00521	0.0244	1	10/28/2021 13:58	WG1764422
2-Chloronaphthalene	U		0.00569	0.0244	1	10/28/2021 13:58	WG1764422
(S) Nitrobenzene-d5	73.6			14.0-149		10/28/2021 13:58	WG1764422
(S) 2-Fluorobiphenyl	66.4			34.0-125		10/28/2021 13:58	WG1764422
(S) p-Terphenyl-d14	74.6			23.0-120		10/28/2021 13:58	WG1764422

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	84.8		1	10/25/2021 08:41	WG1762223

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	U		0.0212	0.0472	1	10/26/2021 10:57	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	4.13		0.118	1.18	5	10/27/2021 19:47	WG1763566
Barium	603		0.179	2.95	5	10/27/2021 19:47	WG1763566
Cadmium	0.382	J	0.101	1.18	5	10/27/2021 19:47	WG1763566
Chromium	11.0		0.349	5.90	5	10/27/2021 19:47	WG1763566
Lead	7.26		0.117	2.36	5	10/27/2021 19:47	WG1763566
Selenium	U		0.212	2.95	5	10/27/2021 19:47	WG1763566
Silver	U		0.102	0.590	5	10/27/2021 19:47	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	U		0.0498	0.0682	1	10/26/2021 14:55	WG1763431
Acrylonitrile	U		0.00492	0.0170	1	10/26/2021 14:55	WG1763431
Benzene	0.0341		0.000637	0.00136	1	10/26/2021 14:55	WG1763431
Bromobenzene	U		0.00123	0.0170	1	10/26/2021 14:55	WG1763431
Bromodichloromethane	U		0.000989	0.00341	1	10/26/2021 14:55	WG1763431
Bromoform	U		0.00160	0.0341	1	10/26/2021 14:55	WG1763431
Bromomethane	U		0.00269	0.0170	1	10/26/2021 14:55	WG1763431
n-Butylbenzene	U		0.00716	0.0170	1	10/26/2021 14:55	WG1763431
sec-Butylbenzene	U		0.00393	0.0170	1	10/26/2021 14:55	WG1763431
tert-Butylbenzene	U		0.00266	0.00682	1	10/26/2021 14:55	WG1763431
Carbon tetrachloride	U		0.00122	0.00682	1	10/26/2021 14:55	WG1763431
Chlorobenzene	U		0.000286	0.00341	1	10/26/2021 14:55	WG1763431
Chlorodibromomethane	U		0.000835	0.00341	1	10/26/2021 14:55	WG1763431
Chloroethane	U		0.00232	0.00682	1	10/26/2021 14:55	WG1763431
Chloroform	U		0.00140	0.00341	1	10/26/2021 14:55	WG1763431
Chloromethane	U	C3	0.00593	0.0170	1	10/26/2021 14:55	WG1763431
2-Chlorotoluene	U		0.00118	0.00341	1	10/26/2021 14:55	WG1763431
4-Chlorotoluene	U		0.000614	0.00682	1	10/26/2021 14:55	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00532	0.0341	1	10/26/2021 14:55	WG1763431
1,2-Dibromoethane	U		0.000884	0.00341	1	10/26/2021 14:55	WG1763431
Dibromomethane	U		0.00102	0.00682	1	10/26/2021 14:55	WG1763431
1,2-Dichlorobenzene	U		0.000580	0.00682	1	10/26/2021 14:55	WG1763431
1,3-Dichlorobenzene	U		0.000818	0.00682	1	10/26/2021 14:55	WG1763431
1,4-Dichlorobenzene	U		0.000955	0.00682	1	10/26/2021 14:55	WG1763431
Dichlorodifluoromethane	U		0.00220	0.00341	1	10/26/2021 14:55	WG1763431
1,1-Dichloroethane	U		0.000670	0.00341	1	10/26/2021 14:55	WG1763431
1,2-Dichloroethane	U		0.000885	0.00341	1	10/26/2021 14:55	WG1763431
1,1-Dichloroethene	U	C3	0.000827	0.00341	1	10/26/2021 14:55	WG1763431
cis-1,2-Dichloroethene	U		0.00100	0.00341	1	10/26/2021 14:55	WG1763431
trans-1,2-Dichloroethene	U		0.00142	0.00682	1	10/26/2021 14:55	WG1763431
1,2-Dichloropropane	U		0.00194	0.00682	1	10/26/2021 14:55	WG1763431
1,1-Dichloropropene	U		0.00110	0.00341	1	10/26/2021 14:55	WG1763431
1,3-Dichloropropane	U		0.000683	0.00682	1	10/26/2021 14:55	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00103	0.00341	1	10/26/2021 14:55	WG1763431
trans-1,3-Dichloropropene	U		0.00155	0.00682	1	10/26/2021 14:55	WG1763431
2,2-Dichloropropane	U	C3	0.00188	0.00341	1	10/26/2021 14:55	WG1763431
Di-isopropyl ether	U		0.000559	0.00136	1	10/26/2021 14:55	WG1763431
Ethylbenzene	0.0185		0.00101	0.00341	1	10/26/2021 14:55	WG1763431
Hexachloro-1,3-butadiene	U		0.00818	0.0341	1	10/26/2021 14:55	WG1763431
Isopropylbenzene	0.00374		0.000580	0.00341	1	10/26/2021 14:55	WG1763431
p-Isopropyltoluene	0.0164		0.00348	0.00682	1	10/26/2021 14:55	WG1763431
2-Butanone (MEK)	U		0.0866	0.136	1	10/26/2021 14:55	WG1763431
Methylene Chloride	U		0.00906	0.0341	1	10/26/2021 14:55	WG1763431
4-Methyl-2-pentanone (MIBK)	0.0103	U	0.00311	0.0341	1	10/26/2021 14:55	WG1763431
Methyl tert-butyl ether	U		0.000477	0.00136	1	10/26/2021 14:55	WG1763431
Naphthalene	0.0536		0.00666	0.0170	1	10/26/2021 14:55	WG1763431
n-Propylbenzene	0.00367	U	0.00130	0.00682	1	10/26/2021 14:55	WG1763431
Styrene	U		0.000312	0.0170	1	10/26/2021 14:55	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00129	0.00341	1	10/26/2021 14:55	WG1763431
1,1,2,2-Tetrachloroethane	U		0.000948	0.00341	1	10/26/2021 14:55	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00103	0.00341	1	10/26/2021 14:55	WG1763431
Tetrachloroethene	U		0.00122	0.00341	1	10/26/2021 14:55	WG1763431
Toluene	0.143		0.00177	0.00682	1	10/26/2021 14:55	WG1763431
1,2,3-Trichlorobenzene	U		0.0100	0.0170	1	10/26/2021 14:55	WG1763431
1,2,4-Trichlorobenzene	U		0.00600	0.0170	1	10/26/2021 14:55	WG1763431
1,1,1-Trichloroethane	U		0.00126	0.00341	1	10/26/2021 14:55	WG1763431
1,1,2-Trichloroethane	U		0.000814	0.00341	1	10/26/2021 14:55	WG1763431
Trichloroethene	U		0.000797	0.00136	1	10/26/2021 14:55	WG1763431
Trichlorofluoromethane	U	C3	0.00113	0.00341	1	10/26/2021 14:55	WG1763431
1,2,3-Trichloropropane	U		0.00221	0.0170	1	10/26/2021 14:55	WG1763431
1,2,4-Trimethylbenzene	0.0449		0.00215	0.00682	1	10/26/2021 14:55	WG1763431
1,2,3-Trimethylbenzene	0.0400		0.00215	0.00682	1	10/26/2021 14:55	WG1763431
Vinyl chloride	U	C3	0.00158	0.00341	1	10/26/2021 14:55	WG1763431
1,3,5-Trimethylbenzene	0.0106		0.00273	0.00682	1	10/26/2021 14:55	WG1763431
Xylenes, Total	0.149		0.00120	0.00887	1	10/26/2021 14:55	WG1763431
(S) Toluene-d8	120			75.0-131		10/26/2021 14:55	WG1763431
(S) 4-Bromofluorobenzene	91.3			67.0-138		10/26/2021 14:55	WG1763431
(S) 1,2-Dichloroethane-d4	103			70.0-130		10/26/2021 14:55	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	19.2		1.57	4.72	1	10/28/2021 14:15	WG1764428
Residual Range Organics (RRO)	45.1		3.93	11.8	1	10/28/2021 14:15	WG1764428
(S) o-Terphenyl	35.7			18.0-148		10/28/2021 14:15	WG1764428

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	77.4		1	10/25/2021 08:41	WG1762223

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	0.0511	J	0.0233	0.0517	1	10/26/2021 11:00	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	3.42		0.129	1.29	5	10/27/2021 19:50	WG1763566
Barium	237		0.196	3.23	5	10/27/2021 19:50	WG1763566
Cadmium	0.473	J	0.110	1.29	5	10/27/2021 19:50	WG1763566
Chromium	19.0		0.383	6.46	5	10/27/2021 19:50	WG1763566
Lead	33.5		0.128	2.58	5	10/27/2021 19:50	WG1763566
Selenium	0.315	J	0.233	3.23	5	10/27/2021 19:50	WG1763566
Silver	0.115	J	0.112	0.646	5	10/27/2021 19:50	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	0.0733	J	0.0687	0.0941	1.23	10/26/2021 15:14	WG1763431
Acrylonitrile	U		0.00679	0.0236	1.23	10/26/2021 15:14	WG1763431
Benzene	0.0113		0.000878	0.00188	1.23	10/26/2021 15:14	WG1763431
Bromobenzene	U		0.00170	0.0236	1.23	10/26/2021 15:14	WG1763431
Bromodichloromethane	U		0.00136	0.00471	1.23	10/26/2021 15:14	WG1763431
Bromoform	U		0.00220	0.0471	1.23	10/26/2021 15:14	WG1763431
Bromomethane	U		0.00370	0.0236	1.23	10/26/2021 15:14	WG1763431
n-Butylbenzene	U		0.00988	0.0236	1.23	10/26/2021 15:14	WG1763431
sec-Butylbenzene	U		0.00542	0.0236	1.23	10/26/2021 15:14	WG1763431
tert-Butylbenzene	U		0.00367	0.00941	1.23	10/26/2021 15:14	WG1763431
Carbon tetrachloride	U		0.00168	0.00941	1.23	10/26/2021 15:14	WG1763431
Chlorobenzene	U		0.000395	0.00471	1.23	10/26/2021 15:14	WG1763431
Chlorodibromomethane	U		0.00115	0.00471	1.23	10/26/2021 15:14	WG1763431
Chloroethane	U		0.00320	0.00941	1.23	10/26/2021 15:14	WG1763431
Chloroform	U		0.00194	0.00471	1.23	10/26/2021 15:14	WG1763431
Chloromethane	U	C3	0.00819	0.0236	1.23	10/26/2021 15:14	WG1763431
2-Chlorotoluene	U		0.00162	0.00471	1.23	10/26/2021 15:14	WG1763431
4-Chlorotoluene	U		0.000848	0.00941	1.23	10/26/2021 15:14	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00734	0.0471	1.23	10/26/2021 15:14	WG1763431
1,2-Dibromoethane	U		0.00122	0.00471	1.23	10/26/2021 15:14	WG1763431
Dibromomethane	U		0.00141	0.00941	1.23	10/26/2021 15:14	WG1763431
1,2-Dichlorobenzene	U		0.000800	0.00941	1.23	10/26/2021 15:14	WG1763431
1,3-Dichlorobenzene	U		0.00113	0.00941	1.23	10/26/2021 15:14	WG1763431
1,4-Dichlorobenzene	U		0.00132	0.00941	1.23	10/26/2021 15:14	WG1763431
Dichlorodifluoromethane	U		0.00303	0.00471	1.23	10/26/2021 15:14	WG1763431
1,1-Dichloroethane	U		0.000924	0.00471	1.23	10/26/2021 15:14	WG1763431
1,2-Dichloroethane	U		0.00122	0.00471	1.23	10/26/2021 15:14	WG1763431
1,1-Dichloroethene	U	C3	0.00114	0.00471	1.23	10/26/2021 15:14	WG1763431
cis-1,2-Dichloroethene	U		0.00138	0.00471	1.23	10/26/2021 15:14	WG1763431
trans-1,2-Dichloroethene	U		0.00196	0.00941	1.23	10/26/2021 15:14	WG1763431
1,2-Dichloropropane	U		0.00268	0.00941	1.23	10/26/2021 15:14	WG1763431
1,1-Dichloropropene	U		0.00152	0.00471	1.23	10/26/2021 15:14	WG1763431
1,3-Dichloropropane	U		0.000943	0.00941	1.23	10/26/2021 15:14	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00142	0.00471	1.23	10/26/2021 15:14	WG1763431
trans-1,3-Dichloropropene	U		0.00214	0.00941	1.23	10/26/2021 15:14	WG1763431
2,2-Dichloropropane	U	C3	0.00260	0.00471	1.23	10/26/2021 15:14	WG1763431
Di-isopropyl ether	U		0.000771	0.00188	1.23	10/26/2021 15:14	WG1763431
Ethylbenzene	U		0.00139	0.00471	1.23	10/26/2021 15:14	WG1763431
Hexachloro-1,3-butadiene	U		0.0113	0.0471	1.23	10/26/2021 15:14	WG1763431
Isopropylbenzene	0.00301	U	0.000800	0.00471	1.23	10/26/2021 15:14	WG1763431
p-Isopropyltoluene	0.0137		0.00480	0.00941	1.23	10/26/2021 15:14	WG1763431
2-Butanone (MEK)	U		0.120	0.188	1.23	10/26/2021 15:14	WG1763431
Methylene Chloride	U		0.0125	0.0471	1.23	10/26/2021 15:14	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00428	0.0471	1.23	10/26/2021 15:14	WG1763431
Methyl tert-butyl ether	U		0.000659	0.00188	1.23	10/26/2021 15:14	WG1763431
Naphthalene	0.0430		0.00918	0.0236	1.23	10/26/2021 15:14	WG1763431
n-Propylbenzene	0.00395	U	0.00179	0.00941	1.23	10/26/2021 15:14	WG1763431
Styrene	U		0.000431	0.0236	1.23	10/26/2021 15:14	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00179	0.00471	1.23	10/26/2021 15:14	WG1763431
1,1,2,2-Tetrachloroethane	U		0.00131	0.00471	1.23	10/26/2021 15:14	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00142	0.00471	1.23	10/26/2021 15:14	WG1763431
Tetrachloroethene	U		0.00168	0.00471	1.23	10/26/2021 15:14	WG1763431
Toluene	0.0762		0.00245	0.00941	1.23	10/26/2021 15:14	WG1763431
1,2,3-Trichlorobenzene	U		0.0138	0.0236	1.23	10/26/2021 15:14	WG1763431
1,2,4-Trichlorobenzene	U		0.00828	0.0236	1.23	10/26/2021 15:14	WG1763431
1,1,1-Trichloroethane	U		0.00174	0.00471	1.23	10/26/2021 15:14	WG1763431
1,1,2-Trichloroethane	U		0.00112	0.00471	1.23	10/26/2021 15:14	WG1763431
Trichloroethene	U		0.00110	0.00188	1.23	10/26/2021 15:14	WG1763431
Trichlorofluoromethane	U	C3	0.00156	0.00471	1.23	10/26/2021 15:14	WG1763431
1,2,3-Trichloropropane	U		0.00304	0.0236	1.23	10/26/2021 15:14	WG1763431
1,2,4-Trimethylbenzene	0.0340		0.00297	0.00941	1.23	10/26/2021 15:14	WG1763431
1,2,3-Trimethylbenzene	0.0321		0.00297	0.00941	1.23	10/26/2021 15:14	WG1763431
Vinyl chloride	U	C3	0.00219	0.00471	1.23	10/26/2021 15:14	WG1763431
1,3,5-Trimethylbenzene	0.0161		0.00376	0.00941	1.23	10/26/2021 15:14	WG1763431
Xylenes, Total	0.105		0.00165	0.0122	1.23	10/26/2021 15:14	WG1763431
(S) Toluene-d8	124			75.0-131		10/26/2021 15:14	WG1763431
(S) 4-Bromofluorobenzene	87.5			67.0-138		10/26/2021 15:14	WG1763431
(S) 1,2-Dichloroethane-d4	105			70.0-130		10/26/2021 15:14	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	24.0		1.72	5.17	1	10/28/2021 14:02	WG1764428
Residual Range Organics (RRO)	55.2		4.30	12.9	1	10/28/2021 14:02	WG1764428
(S) o-Terphenyl	39.0			18.0-148		10/28/2021 14:02	WG1764428

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Anthracene	0.00634	U	0.00297	0.00775	1	10/28/2021 14:16	WG1764422
Acenaphthene	0.00547	U	0.00270	0.00775	1	10/28/2021 14:16	WG1764422
Acenaphthylene	U		0.00279	0.00775	1	10/28/2021 14:16	WG1764422
Benzo(a)anthracene	0.0131		0.00224	0.00775	1	10/28/2021 14:16	WG1764422
Benzo(a)pyrene	0.00779		0.00231	0.00775	1	10/28/2021 14:16	WG1764422
Benzo(b)fluoranthene	0.0136		0.00198	0.00775	1	10/28/2021 14:16	WG1764422
Benzo(g,h,i)perylene	0.00681	U	0.00229	0.00775	1	10/28/2021 14:16	WG1764422
Benzo(k)fluoranthene	0.00293	U	0.00278	0.00775	1	10/28/2021 14:16	WG1764422
Chrysene	0.0176		0.00300	0.00775	1	10/28/2021 14:16	WG1764422

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Dibenz(a,h)anthracene	U		0.00222	0.00775	1	10/28/2021 14:16	WG1764422
Fluoranthene	0.0194		0.00293	0.00775	1	10/28/2021 14:16	WG1764422
Fluorene	0.00830		0.00265	0.00775	1	10/28/2021 14:16	WG1764422
Indeno(1,2,3-cd)pyrene	0.00655	<u>J</u>	0.00234	0.00775	1	10/28/2021 14:16	WG1764422
Naphthalene	0.105	<u>J6</u>	0.00527	0.0258	1	10/28/2021 14:16	WG1764422
Phenanthrene	0.0817		0.00299	0.00775	1	10/28/2021 14:16	WG1764422
Pyrene	0.0203		0.00258	0.00775	1	10/28/2021 14:16	WG1764422
1-Methylnaphthalene	0.138	<u>J6</u>	0.00580	0.0258	1	10/28/2021 14:16	WG1764422
2-Methylnaphthalene	0.195	<u>J6</u>	0.00552	0.0258	1	10/28/2021 14:16	WG1764422
2-Chloronaphthalene	U		0.00602	0.0258	1	10/28/2021 14:16	WG1764422
<i>(S)</i> Nitrobenzene-d5	83.6			14.0-149		10/28/2021 14:16	WG1764422
<i>(S)</i> 2-Fluorobiphenyl	78.6			34.0-125		10/28/2021 14:16	WG1764422
<i>(S)</i> p-Terphenyl-d14	91.4			23.0-120		10/28/2021 14:16	WG1764422

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
	%			date / time	
Total Solids	84.3		1	10/25/2021 08:41	WG1762223

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Mercury	U		0.0214	0.0475	1	10/26/2021 11:02	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Arsenic	4.01		0.119	1.19	5	10/27/2021 19:53	WG1763566
Barium	127		0.180	2.97	5	10/27/2021 19:53	WG1763566
Cadmium	0.153	J	0.101	1.19	5	10/27/2021 19:53	WG1763566
Chromium	14.9		0.351	5.93	5	10/27/2021 19:53	WG1763566
Lead	9.42		0.117	2.37	5	10/27/2021 19:53	WG1763566
Selenium	0.224	J	0.214	2.97	5	10/27/2021 19:53	WG1763566
Silver	U		0.103	0.593	5	10/27/2021 19:53	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
	mg/kg		mg/kg	mg/kg		date / time	
Acetone	U		0.0522	0.0715	1	10/26/2021 15:34	WG1763431
Acrylonitrile	U		0.00516	0.0179	1	10/26/2021 15:34	WG1763431
Benzene	0.000744	J	0.000668	0.00143	1	10/26/2021 15:34	WG1763431
Bromobenzene	U		0.00129	0.0179	1	10/26/2021 15:34	WG1763431
Bromodichloromethane	U		0.00104	0.00357	1	10/26/2021 15:34	WG1763431
Bromoform	U		0.00167	0.0357	1	10/26/2021 15:34	WG1763431
Bromomethane	U		0.00282	0.0179	1	10/26/2021 15:34	WG1763431
n-Butylbenzene	U		0.00751	0.0179	1	10/26/2021 15:34	WG1763431
sec-Butylbenzene	U		0.00412	0.0179	1	10/26/2021 15:34	WG1763431
tert-Butylbenzene	U		0.00279	0.00715	1	10/26/2021 15:34	WG1763431
Carbon tetrachloride	U		0.00128	0.00715	1	10/26/2021 15:34	WG1763431
Chlorobenzene	U		0.000300	0.00357	1	10/26/2021 15:34	WG1763431
Chlorodibromomethane	U		0.000875	0.00357	1	10/26/2021 15:34	WG1763431
Chloroethane	U		0.00243	0.00715	1	10/26/2021 15:34	WG1763431
Chloroform	U		0.00147	0.00357	1	10/26/2021 15:34	WG1763431
Chloromethane	U	C3	0.00622	0.0179	1	10/26/2021 15:34	WG1763431
2-Chlorotoluene	U		0.00124	0.00357	1	10/26/2021 15:34	WG1763431
4-Chlorotoluene	U		0.000643	0.00715	1	10/26/2021 15:34	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00558	0.0357	1	10/26/2021 15:34	WG1763431
1,2-Dibromoethane	U		0.000927	0.00357	1	10/26/2021 15:34	WG1763431
Dibromomethane	U		0.00107	0.00715	1	10/26/2021 15:34	WG1763431
1,2-Dichlorobenzene	U		0.000608	0.00715	1	10/26/2021 15:34	WG1763431
1,3-Dichlorobenzene	U		0.000858	0.00715	1	10/26/2021 15:34	WG1763431
1,4-Dichlorobenzene	U		0.00100	0.00715	1	10/26/2021 15:34	WG1763431
Dichlorodifluoromethane	U		0.00230	0.00357	1	10/26/2021 15:34	WG1763431
1,1-Dichloroethane	U		0.000702	0.00357	1	10/26/2021 15:34	WG1763431
1,2-Dichloroethane	U		0.000928	0.00357	1	10/26/2021 15:34	WG1763431
1,1-Dichloroethene	U	C3	0.000866	0.00357	1	10/26/2021 15:34	WG1763431
cis-1,2-Dichloroethene	U		0.00105	0.00357	1	10/26/2021 15:34	WG1763431
trans-1,2-Dichloroethene	U		0.00149	0.00715	1	10/26/2021 15:34	WG1763431
1,2-Dichloropropane	U		0.00203	0.00715	1	10/26/2021 15:34	WG1763431
1,1-Dichloropropene	U		0.00116	0.00357	1	10/26/2021 15:34	WG1763431
1,3-Dichloropropane	U		0.000716	0.00715	1	10/26/2021 15:34	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00108	0.00357	1	10/26/2021 15:34	WG1763431
trans-1,3-Dichloropropene	U		0.00163	0.00715	1	10/26/2021 15:34	WG1763431
2,2-Dichloropropane	U	C3	0.00197	0.00357	1	10/26/2021 15:34	WG1763431
Di-isopropyl ether	U		0.000586	0.00143	1	10/26/2021 15:34	WG1763431
Ethylbenzene	U		0.00105	0.00357	1	10/26/2021 15:34	WG1763431
Hexachloro-1,3-butadiene	U		0.00858	0.0357	1	10/26/2021 15:34	WG1763431
Isopropylbenzene	U		0.000608	0.00357	1	10/26/2021 15:34	WG1763431
p-Isopropyltoluene	U		0.00365	0.00715	1	10/26/2021 15:34	WG1763431
2-Butanone (MEK)	U		0.0908	0.143	1	10/26/2021 15:34	WG1763431
Methylene Chloride	U		0.00949	0.0357	1	10/26/2021 15:34	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00326	0.0357	1	10/26/2021 15:34	WG1763431
Methyl tert-butyl ether	U		0.000500	0.00143	1	10/26/2021 15:34	WG1763431
Naphthalene	U		0.00698	0.0179	1	10/26/2021 15:34	WG1763431
n-Propylbenzene	U		0.00136	0.00715	1	10/26/2021 15:34	WG1763431
Styrene	U		0.000327	0.0179	1	10/26/2021 15:34	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00136	0.00357	1	10/26/2021 15:34	WG1763431
1,1,2,2-Tetrachloroethane	U		0.000994	0.00357	1	10/26/2021 15:34	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00108	0.00357	1	10/26/2021 15:34	WG1763431
Tetrachloroethene	U		0.00128	0.00357	1	10/26/2021 15:34	WG1763431
Toluene	0.00300	J	0.00186	0.00715	1	10/26/2021 15:34	WG1763431
1,2,3-Trichlorobenzene	U		0.0105	0.0179	1	10/26/2021 15:34	WG1763431
1,2,4-Trichlorobenzene	U		0.00629	0.0179	1	10/26/2021 15:34	WG1763431
1,1,1-Trichloroethane	U		0.00132	0.00357	1	10/26/2021 15:34	WG1763431
1,1,2-Trichloroethane	U		0.000854	0.00357	1	10/26/2021 15:34	WG1763431
Trichloroethene	U		0.000835	0.00143	1	10/26/2021 15:34	WG1763431
Trichlorofluoromethane	U	C3	0.00118	0.00357	1	10/26/2021 15:34	WG1763431
1,2,3-Trichloropropane	U		0.00232	0.0179	1	10/26/2021 15:34	WG1763431
1,2,4-Trimethylbenzene	U		0.00226	0.00715	1	10/26/2021 15:34	WG1763431
1,2,3-Trimethylbenzene	U		0.00226	0.00715	1	10/26/2021 15:34	WG1763431
Vinyl chloride	U	C3	0.00166	0.00357	1	10/26/2021 15:34	WG1763431
1,3,5-Trimethylbenzene	U		0.00286	0.00715	1	10/26/2021 15:34	WG1763431
Xylenes, Total	0.00182	J	0.00126	0.00929	1	10/26/2021 15:34	WG1763431
(S) Toluene-d8	119			75.0-131		10/26/2021 15:34	WG1763431
(S) 4-Bromofluorobenzene	90.0			67.0-138		10/26/2021 15:34	WG1763431
(S) 1,2-Dichloroethane-d4	103			70.0-130		10/26/2021 15:34	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		1.58	4.75	1	10/28/2021 12:26	WG1764428
Residual Range Organics (RRO)	U		3.95	11.9	1	10/28/2021 12:26	WG1764428
(S) o-Terphenyl	43.6			18.0-148		10/28/2021 12:26	WG1764428

Polychlorinated Biphenyls (GC) by Method 8082 A

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
PCB 1016	U		0.0140	0.0403	1	10/27/2021 22:07	WG1764102
PCB 1221	U		0.0140	0.0403	1	10/27/2021 22:07	WG1764102
PCB 1232	U		0.0140	0.0403	1	10/27/2021 22:07	WG1764102
PCB 1242	U		0.0140	0.0403	1	10/27/2021 22:07	WG1764102
PCB 1248	U		0.00876	0.0202	1	10/27/2021 22:07	WG1764102
PCB 1254	U		0.00876	0.0202	1	10/27/2021 22:07	WG1764102
PCB 1260	U		0.00876	0.0202	1	10/27/2021 22:07	WG1764102
(S) Decachlorobiphenyl	62.4			10.0-135		10/27/2021 22:07	WG1764102
(S) Tetrachloro-m-xylene	79.8			10.0-139		10/27/2021 22:07	WG1764102

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	72.9		1	10/25/2021 08:41	WG1762223

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	U		0.0247	0.0549	1	10/26/2021 11:05	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	3.41		0.137	1.37	5	10/27/2021 19:57	WG1763566
Barium	140		0.209	3.43	5	10/27/2021 19:57	WG1763566
Cadmium	U		0.117	1.37	5	10/27/2021 19:57	WG1763566
Chromium	16.8		0.406	6.86	5	10/27/2021 19:57	WG1763566
Lead	6.83		0.136	2.74	5	10/27/2021 19:57	WG1763566
Selenium	U		0.247	3.43	5	10/27/2021 19:57	WG1763566
Silver	U		0.119	0.686	5	10/27/2021 19:57	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	U		0.0648	0.0887	1	10/26/2021 15:53	WG1763431
Acrylonitrile	U		0.00641	0.0222	1	10/26/2021 15:53	WG1763431
Benzene	U		0.000829	0.00177	1	10/26/2021 15:53	WG1763431
Bromobenzene	U		0.00160	0.0222	1	10/26/2021 15:53	WG1763431
Bromodichloromethane	U		0.00129	0.00444	1	10/26/2021 15:53	WG1763431
Bromoform	U		0.00208	0.0444	1	10/26/2021 15:53	WG1763431
Bromomethane	U		0.00350	0.0222	1	10/26/2021 15:53	WG1763431
n-Butylbenzene	U		0.00932	0.0222	1	10/26/2021 15:53	WG1763431
sec-Butylbenzene	U		0.00511	0.0222	1	10/26/2021 15:53	WG1763431
tert-Butylbenzene	U		0.00346	0.00887	1	10/26/2021 15:53	WG1763431
Carbon tetrachloride	U		0.00159	0.00887	1	10/26/2021 15:53	WG1763431
Chlorobenzene	U		0.000373	0.00444	1	10/26/2021 15:53	WG1763431
Chlorodibromomethane	U		0.00109	0.00444	1	10/26/2021 15:53	WG1763431
Chloroethane	U		0.00302	0.00887	1	10/26/2021 15:53	WG1763431
Chloroform	U		0.00183	0.00444	1	10/26/2021 15:53	WG1763431
Chloromethane	U	C3	0.00772	0.0222	1	10/26/2021 15:53	WG1763431
2-Chlorotoluene	U		0.00154	0.00444	1	10/26/2021 15:53	WG1763431
4-Chlorotoluene	U		0.000799	0.00887	1	10/26/2021 15:53	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00692	0.0444	1	10/26/2021 15:53	WG1763431
1,2-Dibromoethane	U		0.00115	0.00444	1	10/26/2021 15:53	WG1763431
Dibromomethane	U		0.00133	0.00887	1	10/26/2021 15:53	WG1763431
1,2-Dichlorobenzene	U		0.000754	0.00887	1	10/26/2021 15:53	WG1763431
1,3-Dichlorobenzene	U		0.00106	0.00887	1	10/26/2021 15:53	WG1763431
1,4-Dichlorobenzene	U		0.00124	0.00887	1	10/26/2021 15:53	WG1763431
Dichlorodifluoromethane	U		0.00286	0.00444	1	10/26/2021 15:53	WG1763431
1,1-Dichloroethane	U		0.000871	0.00444	1	10/26/2021 15:53	WG1763431
1,2-Dichloroethane	U		0.00115	0.00444	1	10/26/2021 15:53	WG1763431
1,1-Dichloroethene	U	C3	0.00108	0.00444	1	10/26/2021 15:53	WG1763431
cis-1,2-Dichloroethene	U		0.00130	0.00444	1	10/26/2021 15:53	WG1763431
trans-1,2-Dichloroethene	U		0.00185	0.00887	1	10/26/2021 15:53	WG1763431
1,2-Dichloropropane	U		0.00252	0.00887	1	10/26/2021 15:53	WG1763431
1,1-Dichloropropene	U		0.00144	0.00444	1	10/26/2021 15:53	WG1763431
1,3-Dichloropropane	U		0.000889	0.00887	1	10/26/2021 15:53	WG1763431



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00134	0.00444	1	10/26/2021 15:53	WG1763431
trans-1,3-Dichloropropene	U		0.00202	0.00887	1	10/26/2021 15:53	WG1763431
2,2-Dichloropropane	U	C3	0.00245	0.00444	1	10/26/2021 15:53	WG1763431
Di-isopropyl ether	U		0.000728	0.00177	1	10/26/2021 15:53	WG1763431
Ethylbenzene	U		0.00131	0.00444	1	10/26/2021 15:53	WG1763431
Hexachloro-1,3-butadiene	U		0.0106	0.0444	1	10/26/2021 15:53	WG1763431
Isopropylbenzene	U		0.000754	0.00444	1	10/26/2021 15:53	WG1763431
p-Isopropyltoluene	U		0.00453	0.00887	1	10/26/2021 15:53	WG1763431
2-Butanone (MEK)	U		0.113	0.177	1	10/26/2021 15:53	WG1763431
Methylene Chloride	U		0.0118	0.0444	1	10/26/2021 15:53	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00405	0.0444	1	10/26/2021 15:53	WG1763431
Methyl tert-butyl ether	U		0.000621	0.00177	1	10/26/2021 15:53	WG1763431
Naphthalene	U		0.00866	0.0222	1	10/26/2021 15:53	WG1763431
n-Propylbenzene	U		0.00169	0.00887	1	10/26/2021 15:53	WG1763431
Styrene	U		0.000406	0.0222	1	10/26/2021 15:53	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00168	0.00444	1	10/26/2021 15:53	WG1763431
1,1,2,2-Tetrachloroethane	U		0.00123	0.00444	1	10/26/2021 15:53	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00134	0.00444	1	10/26/2021 15:53	WG1763431
Tetrachloroethene	U		0.00159	0.00444	1	10/26/2021 15:53	WG1763431
Toluene	U		0.00231	0.00887	1	10/26/2021 15:53	WG1763431
1,2,3-Trichlorobenzene	U		0.0130	0.0222	1	10/26/2021 15:53	WG1763431
1,2,4-Trichlorobenzene	U		0.00781	0.0222	1	10/26/2021 15:53	WG1763431
1,1,1-Trichloroethane	U		0.00164	0.00444	1	10/26/2021 15:53	WG1763431
1,1,2-Trichloroethane	U		0.00106	0.00444	1	10/26/2021 15:53	WG1763431
Trichloroethene	U		0.00104	0.00177	1	10/26/2021 15:53	WG1763431
Trichlorofluoromethane	U	C3	0.00147	0.00444	1	10/26/2021 15:53	WG1763431
1,2,3-Trichloropropane	U		0.00287	0.0222	1	10/26/2021 15:53	WG1763431
1,2,4-Trimethylbenzene	U		0.00280	0.00887	1	10/26/2021 15:53	WG1763431
1,2,3-Trimethylbenzene	U		0.00280	0.00887	1	10/26/2021 15:53	WG1763431
Vinyl chloride	U	C3	0.00206	0.00444	1	10/26/2021 15:53	WG1763431
1,3,5-Trimethylbenzene	U		0.00355	0.00887	1	10/26/2021 15:53	WG1763431
Xylenes, Total	U		0.00156	0.0115	1	10/26/2021 15:53	WG1763431
(S) Toluene-d8	122			75.0-131		10/26/2021 15:53	WG1763431
(S) 4-Bromofluorobenzene	86.1			67.0-138		10/26/2021 15:53	WG1763431
(S) 1,2-Dichloroethane-d4	104			70.0-130		10/26/2021 15:53	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		1.82	5.49	1	10/28/2021 11:32	WG1764428
Residual Range Organics (RRO)	U		4.57	13.7	1	10/28/2021 11:32	WG1764428
(S) o-Terphenyl	34.8			18.0-148		10/28/2021 11:32	WG1764428

Polychlorinated Biphenyls (GC) by Method 8082 A

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
PCB 1016	U		0.0162	0.0466	1	10/27/2021 22:16	WG1764102
PCB 1221	U		0.0162	0.0466	1	10/27/2021 22:16	WG1764102
PCB 1232	U		0.0162	0.0466	1	10/27/2021 22:16	WG1764102
PCB 1242	U		0.0162	0.0466	1	10/27/2021 22:16	WG1764102
PCB 1248	U		0.0101	0.0233	1	10/27/2021 22:16	WG1764102
PCB 1254	U		0.0101	0.0233	1	10/27/2021 22:16	WG1764102
PCB 1260	U		0.0101	0.0233	1	10/27/2021 22:16	WG1764102
(S) Decachlorobiphenyl	55.5			10.0-135		10/27/2021 22:16	WG1764102
(S) Tetrachloro-m-xylene	72.5			10.0-139		10/27/2021 22:16	WG1764102

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Anthracene	U		0.00316	0.00823	1	10/28/2021 15:09	WG1764422
Acenaphthene	U		0.00287	0.00823	1	10/28/2021 15:09	WG1764422
Acenaphthylene	U		0.00296	0.00823	1	10/28/2021 15:09	WG1764422
Benzo(a)anthracene	U		0.00237	0.00823	1	10/28/2021 15:09	WG1764422
Benzo(a)pyrene	U		0.00246	0.00823	1	10/28/2021 15:09	WG1764422
Benzo(b)fluoranthene	U		0.00210	0.00823	1	10/28/2021 15:09	WG1764422
Benzo(g,h,i)perylene	U		0.00243	0.00823	1	10/28/2021 15:09	WG1764422
Benzo(k)fluoranthene	U		0.00295	0.00823	1	10/28/2021 15:09	WG1764422
Chrysene	U		0.00318	0.00823	1	10/28/2021 15:09	WG1764422
Dibenz(a,h)anthracene	U		0.00236	0.00823	1	10/28/2021 15:09	WG1764422
Fluoranthene	U		0.00311	0.00823	1	10/28/2021 15:09	WG1764422
Fluorene	U		0.00281	0.00823	1	10/28/2021 15:09	WG1764422
Indeno(1,2,3-cd)pyrene	U		0.00248	0.00823	1	10/28/2021 15:09	WG1764422
Naphthalene	U		0.00560	0.0274	1	10/28/2021 15:09	WG1764422
Phenanthrene	U		0.00317	0.00823	1	10/28/2021 15:09	WG1764422
Pyrene	U		0.00274	0.00823	1	10/28/2021 15:09	WG1764422
1-Methylnaphthalene	U		0.00616	0.0274	1	10/28/2021 15:09	WG1764422
2-Methylnaphthalene	U		0.00586	0.0274	1	10/28/2021 15:09	WG1764422
2-Chloronaphthalene	U		0.00639	0.0274	1	10/28/2021 15:09	WG1764422
(S) Nitrobenzene-d5	59.2			14.0-149		10/28/2021 15:09	WG1764422
(S) 2-Fluorobiphenyl	64.9			34.0-125		10/28/2021 15:09	WG1764422
(S) p-Terphenyl-d14	69.3			23.0-120		10/28/2021 15:09	WG1764422

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Total Solids by Method 2540 G-2011

Analyte	Result	Qualifier	Dilution	Analysis	Batch
Total Solids	78.0		1	10/25/2021 08:41	WG1762223

Mercury by Method 7471B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Mercury	U		0.0231	0.0513	1	10/26/2021 11:07	WG1762773

Metals (ICPMS) by Method 6020B

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Arsenic	3.30		0.128	1.28	5	10/27/2021 18:24	WG1763566
Barium	100		0.195	3.21	5	10/27/2021 18:24	WG1763566
Cadmium	U		0.110	1.28	5	10/27/2021 18:24	WG1763566
Chromium	21.9		0.380	6.41	5	10/27/2021 18:24	WG1763566
Lead	5.86		0.127	2.57	5	10/27/2021 18:24	WG1763566
Selenium	0.271	J	0.231	3.21	5	10/27/2021 18:24	WG1763566
Silver	U		0.111	0.641	5	10/27/2021 18:24	WG1763566

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry)	Qualifier	MDL (dry)	RDL (dry)	Dilution	Analysis	Batch
Acetone	U		0.0586	0.0802	1	10/26/2021 16:12	WG1763431
Acrylonitrile	U		0.00579	0.0201	1	10/26/2021 16:12	WG1763431
Benzene	U		0.000749	0.00160	1	10/26/2021 16:12	WG1763431
Bromobenzene	U		0.00144	0.0201	1	10/26/2021 16:12	WG1763431
Bromodichloromethane	U		0.00116	0.00401	1	10/26/2021 16:12	WG1763431
Bromoform	U		0.00188	0.0401	1	10/26/2021 16:12	WG1763431
Bromomethane	U		0.00316	0.0201	1	10/26/2021 16:12	WG1763431
n-Butylbenzene	U		0.00842	0.0201	1	10/26/2021 16:12	WG1763431
sec-Butylbenzene	U		0.00462	0.0201	1	10/26/2021 16:12	WG1763431
tert-Butylbenzene	U		0.00313	0.00802	1	10/26/2021 16:12	WG1763431
Carbon tetrachloride	U		0.00144	0.00802	1	10/26/2021 16:12	WG1763431
Chlorobenzene	U		0.000337	0.00401	1	10/26/2021 16:12	WG1763431
Chlorodibromomethane	U		0.000982	0.00401	1	10/26/2021 16:12	WG1763431
Chloroethane	U		0.00273	0.00802	1	10/26/2021 16:12	WG1763431
Chloroform	U		0.00165	0.00401	1	10/26/2021 16:12	WG1763431
Chloromethane	U	C3	0.00698	0.0201	1	10/26/2021 16:12	WG1763431
2-Chlorotoluene	U		0.00139	0.00401	1	10/26/2021 16:12	WG1763431
4-Chlorotoluene	U		0.000722	0.00802	1	10/26/2021 16:12	WG1763431
1,2-Dibromo-3-Chloropropane	U		0.00626	0.0401	1	10/26/2021 16:12	WG1763431
1,2-Dibromoethane	U		0.00104	0.00401	1	10/26/2021 16:12	WG1763431
Dibromomethane	U		0.00120	0.00802	1	10/26/2021 16:12	WG1763431
1,2-Dichlorobenzene	U		0.000682	0.00802	1	10/26/2021 16:12	WG1763431
1,3-Dichlorobenzene	U		0.000963	0.00802	1	10/26/2021 16:12	WG1763431
1,4-Dichlorobenzene	U		0.00112	0.00802	1	10/26/2021 16:12	WG1763431
Dichlorodifluoromethane	U		0.00258	0.00401	1	10/26/2021 16:12	WG1763431
1,1-Dichloroethane	U		0.000788	0.00401	1	10/26/2021 16:12	WG1763431
1,2-Dichloroethane	U		0.00104	0.00401	1	10/26/2021 16:12	WG1763431
1,1-Dichloroethene	U	C3	0.000972	0.00401	1	10/26/2021 16:12	WG1763431
cis-1,2-Dichloroethene	U		0.00118	0.00401	1	10/26/2021 16:12	WG1763431
trans-1,2-Dichloroethene	U		0.00167	0.00802	1	10/26/2021 16:12	WG1763431
1,2-Dichloropropane	U		0.00228	0.00802	1	10/26/2021 16:12	WG1763431
1,1-Dichloropropene	U		0.00130	0.00401	1	10/26/2021 16:12	WG1763431
1,3-Dichloropropane	U		0.000804	0.00802	1	10/26/2021 16:12	WG1763431

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
cis-1,3-Dichloropropene	U		0.00121	0.00401	1	10/26/2021 16:12	WG1763431
trans-1,3-Dichloropropene	U		0.00183	0.00802	1	10/26/2021 16:12	WG1763431
2,2-Dichloropropane	U	C3	0.00221	0.00401	1	10/26/2021 16:12	WG1763431
Di-isopropyl ether	U		0.000658	0.00160	1	10/26/2021 16:12	WG1763431
Ethylbenzene	U		0.00118	0.00401	1	10/26/2021 16:12	WG1763431
Hexachloro-1,3-butadiene	U		0.00963	0.0401	1	10/26/2021 16:12	WG1763431
Isopropylbenzene	U		0.000682	0.00401	1	10/26/2021 16:12	WG1763431
p-Isopropyltoluene	U		0.00409	0.00802	1	10/26/2021 16:12	WG1763431
2-Butanone (MEK)	U		0.102	0.160	1	10/26/2021 16:12	WG1763431
Methylene Chloride	U		0.0107	0.0401	1	10/26/2021 16:12	WG1763431
4-Methyl-2-pentanone (MIBK)	U		0.00366	0.0401	1	10/26/2021 16:12	WG1763431
Methyl tert-butyl ether	U		0.000562	0.00160	1	10/26/2021 16:12	WG1763431
Naphthalene	U		0.00783	0.0201	1	10/26/2021 16:12	WG1763431
n-Propylbenzene	U		0.00152	0.00802	1	10/26/2021 16:12	WG1763431
Styrene	U		0.000367	0.0201	1	10/26/2021 16:12	WG1763431
1,1,1,2-Tetrachloroethane	U		0.00152	0.00401	1	10/26/2021 16:12	WG1763431
1,1,2,2-Tetrachloroethane	U		0.00112	0.00401	1	10/26/2021 16:12	WG1763431
1,1,2-Trichlorotrifluoroethane	U	C3	0.00121	0.00401	1	10/26/2021 16:12	WG1763431
Tetrachloroethene	U		0.00144	0.00401	1	10/26/2021 16:12	WG1763431
Toluene	U		0.00209	0.00802	1	10/26/2021 16:12	WG1763431
1,2,3-Trichlorobenzene	U		0.0118	0.0201	1	10/26/2021 16:12	WG1763431
1,2,4-Trichlorobenzene	U		0.00706	0.0201	1	10/26/2021 16:12	WG1763431
1,1,1-Trichloroethane	U		0.00148	0.00401	1	10/26/2021 16:12	WG1763431
1,1,2-Trichloroethane	U		0.000958	0.00401	1	10/26/2021 16:12	WG1763431
Trichloroethene	U		0.000937	0.00160	1	10/26/2021 16:12	WG1763431
Trichlorofluoromethane	U	C3	0.00133	0.00401	1	10/26/2021 16:12	WG1763431
1,2,3-Trichloropropane	U		0.00260	0.0201	1	10/26/2021 16:12	WG1763431
1,2,4-Trimethylbenzene	U		0.00254	0.00802	1	10/26/2021 16:12	WG1763431
1,2,3-Trimethylbenzene	U		0.00254	0.00802	1	10/26/2021 16:12	WG1763431
Vinyl chloride	U	C3	0.00186	0.00401	1	10/26/2021 16:12	WG1763431
1,3,5-Trimethylbenzene	U		0.00321	0.00802	1	10/26/2021 16:12	WG1763431
Xylenes, Total	U		0.00141	0.0104	1	10/26/2021 16:12	WG1763431
(S) Toluene-d8	120			75.0-131		10/26/2021 16:12	WG1763431
(S) 4-Bromofluorobenzene	91.4			67.0-138		10/26/2021 16:12	WG1763431
(S) 1,2-Dichloroethane-d4	106			70.0-130		10/26/2021 16:12	WG1763431

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		1.71	5.13	1	10/28/2021 11:46	WG1764428
Residual Range Organics (RRO)	U		4.27	12.8	1	10/28/2021 11:46	WG1764428
(S) o-Terphenyl	34.7			18.0-148		10/28/2021 11:46	WG1764428

Polychlorinated Biphenyls (GC) by Method 8082 A

Analyte	Result (dry) mg/kg	Qualifier	MDL (dry) mg/kg	RDL (dry) mg/kg	Dilution	Analysis date / time	Batch
PCB 1016	U		0.0151	0.0436	1	10/27/2021 22:25	WG1764102
PCB 1221	U		0.0151	0.0436	1	10/27/2021 22:25	WG1764102
PCB 1232	U		0.0151	0.0436	1	10/27/2021 22:25	WG1764102
PCB 1242	U		0.0151	0.0436	1	10/27/2021 22:25	WG1764102
PCB 1248	U		0.00947	0.0218	1	10/27/2021 22:25	WG1764102
PCB 1254	U		0.00947	0.0218	1	10/27/2021 22:25	WG1764102
PCB 1260	U		0.00947	0.0218	1	10/27/2021 22:25	WG1764102
(S) Decachlorobiphenyl	53.4			10.0-135		10/27/2021 22:25	WG1764102
(S) Tetrachloro-m-xylene	75.5			10.0-139		10/27/2021 22:25	WG1764102

TRIP BLANK-SOIL COOLER

SAMPLE RESULTS - 11

Collected date/time: 10/19/21 08:00

L1421071

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Acetone	1.51	C5	0.548	1.00	1	10/23/2021 00:08	WG1761975
Acrylonitrile	U		0.0760	0.500	1	10/23/2021 00:08	WG1761975
Benzene	U		0.0160	0.0400	1	10/23/2021 00:08	WG1761975
Bromobenzene	U		0.0420	0.500	1	10/23/2021 00:08	WG1761975
Bromochloromethane	U		0.0452	0.200	1	10/23/2021 00:08	WG1761975
Bromodichloromethane	U	J4	0.0315	0.100	1	10/23/2021 00:08	WG1761975
Bromoform	U		0.239	1.00	1	10/23/2021 00:08	WG1761975
Bromomethane	U		0.148	0.500	1	10/23/2021 00:08	WG1761975
n-Butylbenzene	U		0.153	0.500	1	10/23/2021 00:08	WG1761975
sec-Butylbenzene	U		0.101	0.500	1	10/23/2021 00:08	WG1761975
tert-Butylbenzene	U	C3	0.0620	0.200	1	10/23/2021 00:08	WG1761975
Carbon disulfide	U		0.162	0.500	1	10/23/2021 00:08	WG1761975
Carbon tetrachloride	U		0.0432	0.200	1	10/23/2021 00:08	WG1761975
Chlorobenzene	U		0.0229	0.100	1	10/23/2021 00:08	WG1761975
Chlorodibromomethane	U		0.0180	0.100	1	10/23/2021 00:08	WG1761975
Chloroethane	U		0.0432	0.200	1	10/23/2021 00:08	WG1761975
Chloroform	U		0.0166	0.100	1	10/23/2021 00:08	WG1761975
Chloromethane	U		0.0556	0.500	1	10/23/2021 00:08	WG1761975
2-Chlorotoluene	U		0.0368	0.100	1	10/23/2021 00:08	WG1761975
4-Chlorotoluene	U		0.0452	0.200	1	10/23/2021 00:08	WG1761975
1,2-Dibromo-3-Chloropropane	U	C3	0.204	1.00	1	10/23/2021 00:08	WG1761975
1,2-Dibromoethane	U		0.0210	0.100	1	10/23/2021 00:08	WG1761975
Dibromomethane	U	J4	0.0400	0.200	1	10/23/2021 00:08	WG1761975
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/23/2021 00:08	WG1761975
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/23/2021 00:08	WG1761975
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/23/2021 00:08	WG1761975
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/23/2021 00:08	WG1761975
Dichlorodifluoromethane	U		0.0327	0.100	1	10/23/2021 00:08	WG1761975
1,1-Dichloroethane	U		0.0230	0.100	1	10/23/2021 00:08	WG1761975
1,2-Dichloroethane	U		0.0190	0.100	1	10/23/2021 00:08	WG1761975
1,1-Dichloroethene	U		0.0200	0.100	1	10/23/2021 00:08	WG1761975
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/23/2021 00:08	WG1761975
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/23/2021 00:08	WG1761975
1,2-Dichloropropane	U		0.0508	0.200	1	10/23/2021 00:08	WG1761975
1,1-Dichloropropene	U		0.0280	0.100	1	10/23/2021 00:08	WG1761975
1,3-Dichloropropane	U		0.0700	0.200	1	10/23/2021 00:08	WG1761975
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/23/2021 00:08	WG1761975
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/23/2021 00:08	WG1761975
2,2-Dichloropropane	U		0.0317	0.100	1	10/23/2021 00:08	WG1761975
Di-isopropyl ether	U		0.0140	0.0400	1	10/23/2021 00:08	WG1761975
Ethylbenzene	U		0.0212	0.100	1	10/23/2021 00:08	WG1761975
Hexachloro-1,3-butadiene	U		0.508	1.00	1	10/23/2021 00:08	WG1761975
2-Hexanone	U		0.400	1.00	1	10/23/2021 00:08	WG1761975
n-Hexane	U		0.0424	0.200	1	10/23/2021 00:08	WG1761975
Iodomethane	U		0.242	0.500	1	10/23/2021 00:08	WG1761975
Isopropylbenzene	U		0.0345	0.100	1	10/23/2021 00:08	WG1761975
p-Isopropyltoluene	U		0.0932	0.200	1	10/23/2021 00:08	WG1761975
2-Butanone (MEK)	U		0.500	1.00	1	10/23/2021 00:08	WG1761975
Methylene Chloride	U		0.265	1.00	1	10/23/2021 00:08	WG1761975
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/23/2021 00:08	WG1761975
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/23/2021 00:08	WG1761975
Naphthalene	U	C3	0.124	0.500	1	10/23/2021 00:08	WG1761975
n-Propylbenzene	U		0.0472	0.200	1	10/23/2021 00:08	WG1761975
Styrene	U		0.109	0.500	1	10/23/2021 00:08	WG1761975
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/23/2021 00:08	WG1761975
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/23/2021 00:08	WG1761975

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

TRIP BLANK-SOIL COOLER

SAMPLE RESULTS - 11

Collected date/time: 10/19/21 08:00

L1421071

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/23/2021 00:08	WG1761975
Tetrachloroethene	U		0.0280	0.100	1	10/23/2021 00:08	WG1761975
Toluene	U		0.0500	0.200	1	10/23/2021 00:08	WG1761975
1,2,3-Trichlorobenzene	U		0.0250	0.500	1	10/23/2021 00:08	WG1761975
1,2,4-Trichlorobenzene	U		0.193	0.500	1	10/23/2021 00:08	WG1761975
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/23/2021 00:08	WG1761975
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/23/2021 00:08	WG1761975
Trichloroethene	U		0.0160	0.0400	1	10/23/2021 00:08	WG1761975
Trichlorofluoromethane	U		0.0200	0.100	1	10/23/2021 00:08	WG1761975
1,2,3-Trichloropropane	U		0.204	0.500	1	10/23/2021 00:08	WG1761975
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/23/2021 00:08	WG1761975
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/23/2021 00:08	WG1761975
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/23/2021 00:08	WG1761975
Vinyl acetate	U		0.141	0.500	1	10/23/2021 00:08	WG1761975
Vinyl chloride	U		0.0273	0.100	1	10/23/2021 00:08	WG1761975
Xylenes, Total	U		0.191	0.260	1	10/23/2021 00:08	WG1761975
(S) Toluene-d8	94.9			75.0-131		10/23/2021 00:08	WG1761975
(S) 4-Bromofluorobenzene	102			67.0-138		10/23/2021 00:08	WG1761975
(S) 1,2-Dichloroethane-d4	97.6			70.0-130		10/23/2021 00:08	WG1761975

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Mercury by Method 7470A

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Mercury	U		0.100	0.200	1	10/27/2021 07:32	WG1762928

Metals (ICPMS) by Method 6020B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Arsenic	1.15	J	0.180	2.00	1	10/27/2021 20:57	WG1763394
Barium	169		0.381	2.00	1	10/27/2021 20:57	WG1763394
Cadmium	0.222	J	0.150	1.00	1	10/27/2021 20:57	WG1763394
Chromium	3.32	B	1.24	2.00	1	10/27/2021 20:57	WG1763394
Lead	11.4		0.849	2.00	1	10/27/2021 20:57	WG1763394
Selenium	U		0.300	2.00	1	10/27/2021 22:44	WG1763394
Silver	0.115	J	0.0700	2.00	1	10/27/2021 20:57	WG1763394

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Acetone	3.07	C5	0.548	1.00	1	10/23/2021 04:39	WG1761975
Acrylonitrile	U		0.0760	0.500	1	10/23/2021 04:39	WG1761975
Benzene	U		0.0160	0.0400	1	10/23/2021 04:39	WG1761975
Bromobenzene	U		0.0420	0.500	1	10/23/2021 04:39	WG1761975
Bromochloromethane	U		0.0452	0.200	1	10/23/2021 04:39	WG1761975
Bromodichloromethane	U	J4	0.0315	0.100	1	10/23/2021 04:39	WG1761975
Bromoform	U		0.239	1.00	1	10/23/2021 04:39	WG1761975
Bromomethane	U		0.148	0.500	1	10/23/2021 04:39	WG1761975
n-Butylbenzene	U		0.153	0.500	1	10/23/2021 04:39	WG1761975
sec-Butylbenzene	U		0.101	0.500	1	10/23/2021 04:39	WG1761975
tert-Butylbenzene	U	C3	0.0620	0.200	1	10/23/2021 04:39	WG1761975
Carbon disulfide	U		0.162	0.500	1	10/23/2021 04:39	WG1761975
Carbon tetrachloride	U		0.0432	0.200	1	10/23/2021 04:39	WG1761975
Chlorobenzene	U		0.0229	0.100	1	10/23/2021 04:39	WG1761975
Chlorodibromomethane	U		0.0180	0.100	1	10/23/2021 04:39	WG1761975
Chloroethane	U		0.0432	0.200	1	10/23/2021 04:39	WG1761975
Chloroform	U		0.0166	0.100	1	10/23/2021 04:39	WG1761975
Chloromethane	U		0.0556	0.500	1	10/23/2021 04:39	WG1761975
2-Chlorotoluene	U		0.0368	0.100	1	10/23/2021 04:39	WG1761975
4-Chlorotoluene	U		0.0452	0.200	1	10/23/2021 04:39	WG1761975
1,2-Dibromo-3-Chloropropane	U	C3	0.204	1.00	1	10/23/2021 04:39	WG1761975
1,2-Dibromoethane	U		0.0210	0.100	1	10/23/2021 04:39	WG1761975
Dibromomethane	U	J4	0.0400	0.200	1	10/23/2021 04:39	WG1761975
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/23/2021 04:39	WG1761975
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/23/2021 04:39	WG1761975
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/23/2021 04:39	WG1761975
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/23/2021 04:39	WG1761975
Dichlorodifluoromethane	U		0.0327	0.100	1	10/23/2021 04:39	WG1761975
1,1-Dichloroethane	U		0.0230	0.100	1	10/23/2021 04:39	WG1761975
1,2-Dichloroethane	U		0.0190	0.100	1	10/23/2021 04:39	WG1761975
1,1-Dichloroethene	U		0.0200	0.100	1	10/23/2021 04:39	WG1761975
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/23/2021 04:39	WG1761975
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/23/2021 04:39	WG1761975
1,2-Dichloropropane	U		0.0508	0.200	1	10/23/2021 04:39	WG1761975
1,1-Dichloropropene	U		0.0280	0.100	1	10/23/2021 04:39	WG1761975
1,3-Dichloropropane	U		0.0700	0.200	1	10/23/2021 04:39	WG1761975
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/23/2021 04:39	WG1761975
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/23/2021 04:39	WG1761975
2,2-Dichloropropane	U		0.0317	0.100	1	10/23/2021 04:39	WG1761975



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Di-isopropyl ether	U		0.0140	0.0400	1	10/23/2021 04:39	WG1761975
Ethylbenzene	U		0.0212	0.100	1	10/23/2021 04:39	WG1761975
Hexachloro-1,3-butadiene	U		0.508	1.00	1	10/23/2021 04:39	WG1761975
2-Hexanone	U		0.400	1.00	1	10/23/2021 04:39	WG1761975
n-Hexane	U		0.0424	0.200	1	10/23/2021 04:39	WG1761975
Iodomethane	U		0.242	0.500	1	10/23/2021 04:39	WG1761975
Isopropylbenzene	U		0.0345	0.100	1	10/23/2021 04:39	WG1761975
p-Isopropyltoluene	U		0.0932	0.200	1	10/23/2021 04:39	WG1761975
2-Butanone (MEK)	U		0.500	1.00	1	10/23/2021 04:39	WG1761975
Methylene Chloride	U		0.265	1.00	1	10/23/2021 04:39	WG1761975
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/23/2021 04:39	WG1761975
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/23/2021 04:39	WG1761975
Naphthalene	U	C3	0.124	0.500	1	10/23/2021 04:39	WG1761975
n-Propylbenzene	U		0.0472	0.200	1	10/23/2021 04:39	WG1761975
Styrene	U		0.109	0.500	1	10/23/2021 04:39	WG1761975
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/23/2021 04:39	WG1761975
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/23/2021 04:39	WG1761975
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/23/2021 04:39	WG1761975
Tetrachloroethene	U		0.0280	0.100	1	10/23/2021 04:39	WG1761975
Toluene	0.0550	U	0.0500	0.200	1	10/23/2021 04:39	WG1761975
1,2,3-Trichlorobenzene	U		0.0250	0.500	1	10/23/2021 04:39	WG1761975
1,2,4-Trichlorobenzene	U		0.193	0.500	1	10/23/2021 04:39	WG1761975
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/23/2021 04:39	WG1761975
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/23/2021 04:39	WG1761975
Trichloroethene	U		0.0160	0.0400	1	10/23/2021 04:39	WG1761975
Trichlorofluoromethane	U		0.0200	0.100	1	10/23/2021 04:39	WG1761975
1,2,3-Trichloropropane	U		0.204	0.500	1	10/23/2021 04:39	WG1761975
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/23/2021 04:39	WG1761975
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/23/2021 04:39	WG1761975
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/23/2021 04:39	WG1761975
Vinyl acetate	U		0.141	0.500	1	10/23/2021 04:39	WG1761975
Vinyl chloride	U		0.0273	0.100	1	10/23/2021 04:39	WG1761975
Xylenes, Total	U		0.191	0.260	1	10/23/2021 04:39	WG1761975
(S) Toluene-d8	92.2			75.0-131		10/23/2021 04:39	WG1761975
(S) 4-Bromofluorobenzene	109			67.0-138		10/23/2021 04:39	WG1761975
(S) 1,2-Dichloroethane-d4	112			70.0-130		10/23/2021 04:39	WG1761975

1 Cp
2 Tc
3 Ss
4 Cn
5 Sr
6 Qc
7 Is
8 Gl
9 Al
10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		66.7	200	1	10/29/2021 09:04	WG1765164
Residual Range Organics (RRO)	U		83.3	250	1	10/29/2021 09:04	WG1765164
(S) o-Terphenyl	50.5	J2		52.0-156		10/29/2021 09:04	WG1765164

Sample Narrative:

L1421071-12 WG1765164: Sample produced emulsion during Extraction process, low surr/spike recoveries due to matrix.

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Anthracene	U		0.0190	0.0500	1	10/26/2021 17:14	WG1762605
Acenaphthene	U		0.0190	0.0500	1	10/26/2021 17:14	WG1762605
Acenaphthylene	U		0.0171	0.0500	1	10/26/2021 17:14	WG1762605
Benzo(a)anthracene	U		0.0203	0.0500	1	10/26/2021 17:14	WG1762605
Benzo(a)pyrene	U		0.0184	0.0500	1	10/26/2021 17:14	WG1762605

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Benzo(b)fluoranthene	U		0.0168	0.0500	1	10/26/2021 17:14	WG1762605
Benzo(g,h,i)perylene	U	<u>J3</u>	0.0184	0.0500	1	10/26/2021 17:14	WG1762605
Benzo(k)fluoranthene	U	<u>J3</u>	0.0202	0.0500	1	10/26/2021 17:14	WG1762605
Chrysene	U		0.0179	0.0500	1	10/26/2021 17:14	WG1762605
Dibenz(a,h)anthracene	U	<u>J3</u>	0.0160	0.0500	1	10/26/2021 17:14	WG1762605
Fluoranthene	U		0.0270	0.100	1	10/26/2021 17:14	WG1762605
Fluorene	U		0.0169	0.0500	1	10/26/2021 17:14	WG1762605
Indeno(1,2,3-cd)pyrene	U	<u>J3</u>	0.0158	0.0500	1	10/26/2021 17:14	WG1762605
Naphthalene	U		0.0917	0.250	1	10/26/2021 17:14	WG1762605
Phenanthrene	U		0.0180	0.0500	1	10/26/2021 17:14	WG1762605
Pyrene	U		0.0169	0.0500	1	10/26/2021 17:14	WG1762605
1-Methylnaphthalene	U		0.0687	0.250	1	10/26/2021 17:14	WG1762605
2-Methylnaphthalene	U		0.0674	0.250	1	10/26/2021 17:14	WG1762605
2-Chloronaphthalene	U		0.0682	0.250	1	10/26/2021 17:14	WG1762605
(S) Nitrobenzene-d5	67.0			31.0-160		10/26/2021 17:14	WG1762605
(S) 2-Fluorobiphenyl	92.0			48.0-148		10/26/2021 17:14	WG1762605
(S) p-Terphenyl-d14	105			37.0-146		10/26/2021 17:14	WG1762605

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Mercury by Method 7470A

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Mercury	U		0.100	0.200	1	10/27/2021 07:34	WG1762928

Metals (ICPMS) by Method 6020B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Arsenic	0.756	<u>J</u>	0.180	2.00	1	10/27/2021 21:00	WG1763394
Barium	171		0.381	2.00	1	10/27/2021 21:00	WG1763394
Cadmium	0.359	<u>J</u>	0.150	1.00	1	10/27/2021 21:00	WG1763394
Chromium	4.32	<u>B</u>	1.24	2.00	1	10/27/2021 21:00	WG1763394
Lead	7.66		0.849	2.00	1	10/27/2021 21:00	WG1763394
Selenium	U		0.300	2.00	1	10/27/2021 22:48	WG1763394
Silver	U		0.0700	2.00	1	10/27/2021 21:00	WG1763394

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Acetone	2.65	<u>C5</u>	0.548	1.00	1	10/23/2021 04:59	WG1761975
Acrylonitrile	U		0.0760	0.500	1	10/23/2021 04:59	WG1761975
Benzene	0.0980		0.0160	0.0400	1	10/23/2021 04:59	WG1761975
Bromobenzene	U		0.0420	0.500	1	10/23/2021 04:59	WG1761975
Bromochloromethane	U		0.0452	0.200	1	10/23/2021 04:59	WG1761975
Bromodichloromethane	U	<u>J4</u>	0.0315	0.100	1	10/23/2021 04:59	WG1761975
Bromoform	U		0.239	1.00	1	10/23/2021 04:59	WG1761975
Bromomethane	U		0.148	0.500	1	10/23/2021 04:59	WG1761975
n-Butylbenzene	U		0.153	0.500	1	10/23/2021 04:59	WG1761975
sec-Butylbenzene	U		0.101	0.500	1	10/23/2021 04:59	WG1761975
tert-Butylbenzene	U	<u>C3</u>	0.0620	0.200	1	10/23/2021 04:59	WG1761975
Carbon disulfide	U		0.162	0.500	1	10/23/2021 04:59	WG1761975
Carbon tetrachloride	U		0.0432	0.200	1	10/23/2021 04:59	WG1761975
Chlorobenzene	U		0.0229	0.100	1	10/23/2021 04:59	WG1761975
Chlorodibromomethane	U		0.0180	0.100	1	10/23/2021 04:59	WG1761975
Chloroethane	U		0.0432	0.200	1	10/23/2021 04:59	WG1761975
Chloroform	U		0.0166	0.100	1	10/23/2021 04:59	WG1761975
Chloromethane	U		0.0556	0.500	1	10/23/2021 04:59	WG1761975
2-Chlorotoluene	U		0.0368	0.100	1	10/23/2021 04:59	WG1761975
4-Chlorotoluene	U		0.0452	0.200	1	10/23/2021 04:59	WG1761975
1,2-Dibromo-3-Chloropropane	U	<u>C3</u>	0.204	1.00	1	10/23/2021 04:59	WG1761975
1,2-Dibromoethane	U		0.0210	0.100	1	10/23/2021 04:59	WG1761975
Dibromomethane	U	<u>J4</u>	0.0400	0.200	1	10/23/2021 04:59	WG1761975
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/23/2021 04:59	WG1761975
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/23/2021 04:59	WG1761975
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/23/2021 04:59	WG1761975
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/23/2021 04:59	WG1761975
Dichlorodifluoromethane	U		0.0327	0.100	1	10/23/2021 04:59	WG1761975
1,1-Dichloroethane	U		0.0230	0.100	1	10/23/2021 04:59	WG1761975
1,2-Dichloroethane	U		0.0190	0.100	1	10/23/2021 04:59	WG1761975
1,1-Dichloroethene	U		0.0200	0.100	1	10/23/2021 04:59	WG1761975
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/23/2021 04:59	WG1761975
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/23/2021 04:59	WG1761975
1,2-Dichloropropane	U		0.0508	0.200	1	10/23/2021 04:59	WG1761975
1,1-Dichloropropene	U		0.0280	0.100	1	10/23/2021 04:59	WG1761975
1,3-Dichloropropane	U		0.0700	0.200	1	10/23/2021 04:59	WG1761975
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/23/2021 04:59	WG1761975
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/23/2021 04:59	WG1761975
2,2-Dichloropropane	U		0.0317	0.100	1	10/23/2021 04:59	WG1761975



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Di-isopropyl ether	U		0.0140	0.0400	1	10/23/2021 04:59	WG1761975
Ethylbenzene	U		0.0212	0.100	1	10/23/2021 04:59	WG1761975
Hexachloro-1,3-butadiene	U		0.508	1.00	1	10/23/2021 04:59	WG1761975
2-Hexanone	U		0.400	1.00	1	10/23/2021 04:59	WG1761975
n-Hexane	U		0.0424	0.200	1	10/23/2021 04:59	WG1761975
Iodomethane	U		0.242	0.500	1	10/23/2021 04:59	WG1761975
Isopropylbenzene	U		0.0345	0.100	1	10/23/2021 04:59	WG1761975
p-Isopropyltoluene	U		0.0932	0.200	1	10/23/2021 04:59	WG1761975
2-Butanone (MEK)	U		0.500	1.00	1	10/23/2021 04:59	WG1761975
Methylene Chloride	U		0.265	1.00	1	10/23/2021 04:59	WG1761975
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/23/2021 04:59	WG1761975
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/23/2021 04:59	WG1761975
Naphthalene	U	C3	0.124	0.500	1	10/23/2021 04:59	WG1761975
n-Propylbenzene	U		0.0472	0.200	1	10/23/2021 04:59	WG1761975
Styrene	U		0.109	0.500	1	10/23/2021 04:59	WG1761975
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/23/2021 04:59	WG1761975
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/23/2021 04:59	WG1761975
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/23/2021 04:59	WG1761975
Tetrachloroethene	U		0.0280	0.100	1	10/23/2021 04:59	WG1761975
Toluene	0.105	U	0.0500	0.200	1	10/23/2021 04:59	WG1761975
1,2,3-Trichlorobenzene	U		0.0250	0.500	1	10/23/2021 04:59	WG1761975
1,2,4-Trichlorobenzene	U		0.193	0.500	1	10/23/2021 04:59	WG1761975
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/23/2021 04:59	WG1761975
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/23/2021 04:59	WG1761975
Trichloroethene	U		0.0160	0.0400	1	10/23/2021 04:59	WG1761975
Trichlorofluoromethane	U		0.0200	0.100	1	10/23/2021 04:59	WG1761975
1,2,3-Trichloropropane	U		0.204	0.500	1	10/23/2021 04:59	WG1761975
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/23/2021 04:59	WG1761975
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/23/2021 04:59	WG1761975
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/23/2021 04:59	WG1761975
Vinyl acetate	U		0.141	0.500	1	10/23/2021 04:59	WG1761975
Vinyl chloride	U		0.0273	0.100	1	10/23/2021 04:59	WG1761975
Xylenes, Total	U		0.191	0.260	1	10/23/2021 04:59	WG1761975
(S) Toluene-d8	93.9			75.0-131		10/23/2021 04:59	WG1761975
(S) 4-Bromofluorobenzene	92.8			67.0-138		10/23/2021 04:59	WG1761975
(S) 1,2-Dichloroethane-d4	115			70.0-130		10/23/2021 04:59	WG1761975



Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		66.7	200	1	10/29/2021 09:25	WG1765164
Residual Range Organics (RRO)	U		83.3	250	1	10/29/2021 09:25	WG1765164
(S) o-Terphenyl	53.0			52.0-156		10/29/2021 09:25	WG1765164

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Anthracene	U		0.0190	0.0500	1	10/26/2021 17:32	WG1762605
Acenaphthene	U		0.0190	0.0500	1	10/26/2021 17:32	WG1762605
Acenaphthylene	U		0.0171	0.0500	1	10/26/2021 17:32	WG1762605
Benzo(a)anthracene	U		0.0203	0.0500	1	10/26/2021 17:32	WG1762605
Benzo(a)pyrene	U		0.0184	0.0500	1	10/26/2021 17:32	WG1762605
Benzo(b)fluoranthene	U		0.0168	0.0500	1	10/26/2021 17:32	WG1762605
Benzo(g,h,i)perylene	U	J3	0.0184	0.0500	1	10/26/2021 17:32	WG1762605
Benzo(k)fluoranthene	U	J3	0.0202	0.0500	1	10/26/2021 17:32	WG1762605

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Chrysene	U		0.0179	0.0500	1	10/26/2021 17:32	WG1762605
Dibenz(a,h)anthracene	U	<u>J3</u>	0.0160	0.0500	1	10/26/2021 17:32	WG1762605
Fluoranthene	U		0.0270	0.100	1	10/26/2021 17:32	WG1762605
Fluorene	U		0.0169	0.0500	1	10/26/2021 17:32	WG1762605
Indeno(1,2,3-cd)pyrene	U	<u>J3</u>	0.0158	0.0500	1	10/26/2021 17:32	WG1762605
Naphthalene	U		0.0917	0.250	1	10/26/2021 17:32	WG1762605
Phenanthrene	U		0.0180	0.0500	1	10/26/2021 17:32	WG1762605
Pyrene	U		0.0169	0.0500	1	10/26/2021 17:32	WG1762605
1-Methylnaphthalene	U		0.0687	0.250	1	10/26/2021 17:32	WG1762605
2-Methylnaphthalene	U		0.0674	0.250	1	10/26/2021 17:32	WG1762605
2-Chloronaphthalene	U		0.0682	0.250	1	10/26/2021 17:32	WG1762605
(S) Nitrobenzene-d5	70.5			31.0-160		10/26/2021 17:32	WG1762605
(S) 2-Fluorobiphenyl	98.0			48.0-148		10/26/2021 17:32	WG1762605
(S) p-Terphenyl-d14	112			37.0-146		10/26/2021 17:32	WG1762605

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Mercury by Method 7470A

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Mercury	U		0.100	0.200	1	10/27/2021 07:36	WG1762928

Metals (ICPMS) by Method 6020B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Arsenic	1.19	J	0.180	2.00	1	10/27/2021 20:07	WG1763394
Barium	97.1		0.381	2.00	1	10/27/2021 20:07	WG1763394
Cadmium	U		0.150	1.00	1	10/27/2021 20:07	WG1763394
Chromium	7.09	B	1.24	2.00	1	10/27/2021 20:07	WG1763394
Lead	4.45		0.849	2.00	1	10/27/2021 20:07	WG1763394
Selenium	0.583	J	0.300	2.00	1	10/27/2021 22:29	WG1763394
Silver	0.0736	J	0.0700	2.00	1	10/27/2021 20:07	WG1763394

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Acetone	2.52	C5	0.548	1.00	1	10/23/2021 05:18	WG1761975
Acrylonitrile	U		0.0760	0.500	1	10/23/2021 05:18	WG1761975
Benzene	0.0240	J	0.0160	0.0400	1	10/23/2021 05:18	WG1761975
Bromobenzene	U		0.0420	0.500	1	10/23/2021 05:18	WG1761975
Bromochloromethane	U		0.0452	0.200	1	10/23/2021 05:18	WG1761975
Bromodichloromethane	U	J4	0.0315	0.100	1	10/23/2021 05:18	WG1761975
Bromoform	U		0.239	1.00	1	10/23/2021 05:18	WG1761975
Bromomethane	U		0.148	0.500	1	10/23/2021 05:18	WG1761975
n-Butylbenzene	U		0.153	0.500	1	10/23/2021 05:18	WG1761975
sec-Butylbenzene	U		0.101	0.500	1	10/23/2021 05:18	WG1761975
tert-Butylbenzene	U	C3	0.0620	0.200	1	10/23/2021 05:18	WG1761975
Carbon disulfide	U		0.162	0.500	1	10/23/2021 05:18	WG1761975
Carbon tetrachloride	U		0.0432	0.200	1	10/23/2021 05:18	WG1761975
Chlorobenzene	U		0.0229	0.100	1	10/23/2021 05:18	WG1761975
Chlorodibromomethane	U		0.0180	0.100	1	10/23/2021 05:18	WG1761975
Chloroethane	U		0.0432	0.200	1	10/23/2021 05:18	WG1761975
Chloroform	U		0.0166	0.100	1	10/23/2021 05:18	WG1761975
Chloromethane	U		0.0556	0.500	1	10/23/2021 05:18	WG1761975
2-Chlorotoluene	U		0.0368	0.100	1	10/23/2021 05:18	WG1761975
4-Chlorotoluene	U		0.0452	0.200	1	10/23/2021 05:18	WG1761975
1,2-Dibromo-3-Chloropropane	U	C3	0.204	1.00	1	10/23/2021 05:18	WG1761975
1,2-Dibromoethane	U		0.0210	0.100	1	10/23/2021 05:18	WG1761975
Dibromomethane	U	J4	0.0400	0.200	1	10/23/2021 05:18	WG1761975
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/23/2021 05:18	WG1761975
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/23/2021 05:18	WG1761975
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/23/2021 05:18	WG1761975
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/23/2021 05:18	WG1761975
Dichlorodifluoromethane	U		0.0327	0.100	1	10/23/2021 05:18	WG1761975
1,1-Dichloroethane	U		0.0230	0.100	1	10/23/2021 05:18	WG1761975
1,2-Dichloroethane	U		0.0190	0.100	1	10/23/2021 05:18	WG1761975
1,1-Dichloroethene	U		0.0200	0.100	1	10/23/2021 05:18	WG1761975
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/23/2021 05:18	WG1761975
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/23/2021 05:18	WG1761975
1,2-Dichloropropane	U		0.0508	0.200	1	10/23/2021 05:18	WG1761975
1,1-Dichloropropene	U		0.0280	0.100	1	10/23/2021 05:18	WG1761975
1,3-Dichloropropane	U		0.0700	0.200	1	10/23/2021 05:18	WG1761975
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/23/2021 05:18	WG1761975
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/23/2021 05:18	WG1761975
2,2-Dichloropropane	U		0.0317	0.100	1	10/23/2021 05:18	WG1761975



Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Di-isopropyl ether	U		0.0140	0.0400	1	10/23/2021 05:18	WG1761975
Ethylbenzene	U		0.0212	0.100	1	10/23/2021 05:18	WG1761975
Hexachloro-1,3-butadiene	U		0.508	1.00	1	10/23/2021 05:18	WG1761975
2-Hexanone	U		0.400	1.00	1	10/23/2021 05:18	WG1761975
n-Hexane	U		0.0424	0.200	1	10/23/2021 05:18	WG1761975
Iodomethane	U		0.242	0.500	1	10/23/2021 05:18	WG1761975
Isopropylbenzene	U		0.0345	0.100	1	10/23/2021 05:18	WG1761975
p-Isopropyltoluene	U		0.0932	0.200	1	10/23/2021 05:18	WG1761975
2-Butanone (MEK)	U		0.500	1.00	1	10/23/2021 05:18	WG1761975
Methylene Chloride	U		0.265	1.00	1	10/23/2021 05:18	WG1761975
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/23/2021 05:18	WG1761975
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/23/2021 05:18	WG1761975
Naphthalene	U	C3	0.124	0.500	1	10/23/2021 05:18	WG1761975
n-Propylbenzene	U		0.0472	0.200	1	10/23/2021 05:18	WG1761975
Styrene	U		0.109	0.500	1	10/23/2021 05:18	WG1761975
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/23/2021 05:18	WG1761975
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/23/2021 05:18	WG1761975
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/23/2021 05:18	WG1761975
Tetrachloroethene	U		0.0280	0.100	1	10/23/2021 05:18	WG1761975
Toluene	0.116	U	0.0500	0.200	1	10/23/2021 05:18	WG1761975
1,2,3-Trichlorobenzene	U		0.0250	0.500	1	10/23/2021 05:18	WG1761975
1,2,4-Trichlorobenzene	U		0.193	0.500	1	10/23/2021 05:18	WG1761975
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/23/2021 05:18	WG1761975
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/23/2021 05:18	WG1761975
Trichloroethene	U		0.0160	0.0400	1	10/23/2021 05:18	WG1761975
Trichlorofluoromethane	U		0.0200	0.100	1	10/23/2021 05:18	WG1761975
1,2,3-Trichloropropane	U		0.204	0.500	1	10/23/2021 05:18	WG1761975
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/23/2021 05:18	WG1761975
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/23/2021 05:18	WG1761975
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/23/2021 05:18	WG1761975
Vinyl acetate	U		0.141	0.500	1	10/23/2021 05:18	WG1761975
Vinyl chloride	U		0.0273	0.100	1	10/23/2021 05:18	WG1761975
Xylenes, Total	U		0.191	0.260	1	10/23/2021 05:18	WG1761975
(S) Toluene-d8	94.4			75.0-131		10/23/2021 05:18	WG1761975
(S) 4-Bromofluorobenzene	89.9			67.0-138		10/23/2021 05:18	WG1761975
(S) 1,2-Dichloroethane-d4	113			70.0-130		10/23/2021 05:18	WG1761975



Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	155	U	66.7	200	1	10/30/2021 01:02	WG1765162
Residual Range Organics (RRO)	287		83.3	250	1	10/30/2021 01:02	WG1765162
(S) o-Terphenyl	103			52.0-156		10/30/2021 01:02	WG1765162

Polychlorinated Biphenyls (GC) by Method 8082 A

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.270	0.500	1	10/24/2021 06:30	WG1761898
PCB 1221	U		0.270	0.500	1	10/24/2021 06:30	WG1761898
PCB 1232	U		0.270	0.500	1	10/24/2021 06:30	WG1761898
PCB 1242	U		0.270	0.500	1	10/24/2021 06:30	WG1761898
PCB 1248	U		0.173	0.500	1	10/24/2021 06:30	WG1761898
PCB 1254	U		0.173	0.500	1	10/24/2021 06:30	WG1761898
PCB 1260	U		0.173	0.500	1	10/24/2021 06:30	WG1761898
(S) Decachlorobiphenyl	22.2			10.0-128		10/24/2021 06:30	WG1761898

Polychlorinated Biphenyls (GC) by Method 8082 A

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
(S) Tetrachloro-m-xylene	52.8			10.0-127		10/24/2021 06:30	WG1761898

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Anthracene	U		0.0190	0.0500	1	10/26/2021 17:50	WG1762605
Acenaphthene	U		0.0190	0.0500	1	10/26/2021 17:50	WG1762605
Acenaphthylene	U		0.0171	0.0500	1	10/26/2021 17:50	WG1762605
Benzo(a)anthracene	U		0.0203	0.0500	1	10/26/2021 17:50	WG1762605
Benzo(a)pyrene	U		0.0184	0.0500	1	10/26/2021 17:50	WG1762605
Benzo(b)fluoranthene	U		0.0168	0.0500	1	10/26/2021 17:50	WG1762605
Benzo(g,h,i)perylene	U	<u>J3</u>	0.0184	0.0500	1	10/26/2021 17:50	WG1762605
Benzo(k)fluoranthene	U	<u>J3</u>	0.0202	0.0500	1	10/26/2021 17:50	WG1762605
Chrysene	U		0.0179	0.0500	1	10/26/2021 17:50	WG1762605
Dibenz(a,h)anthracene	U	<u>J3</u>	0.0160	0.0500	1	10/26/2021 17:50	WG1762605
Fluoranthene	U		0.0270	0.100	1	10/26/2021 17:50	WG1762605
Fluorene	U		0.0169	0.0500	1	10/26/2021 17:50	WG1762605
Indeno(1,2,3-cd)pyrene	U	<u>J3</u>	0.0158	0.0500	1	10/26/2021 17:50	WG1762605
Naphthalene	U		0.0917	0.250	1	10/26/2021 17:50	WG1762605
Phenanthrene	U		0.0180	0.0500	1	10/26/2021 17:50	WG1762605
Pyrene	U		0.0169	0.0500	1	10/26/2021 17:50	WG1762605
1-Methylnaphthalene	U		0.0687	0.250	1	10/26/2021 17:50	WG1762605
2-Methylnaphthalene	U		0.0674	0.250	1	10/26/2021 17:50	WG1762605
2-Chloronaphthalene	U		0.0682	0.250	1	10/26/2021 17:50	WG1762605
(S) Nitrobenzene-d5	69.5			31.0-160		10/26/2021 17:50	WG1762605
(S) 2-Fluorobiphenyl	98.0			48.0-148		10/26/2021 17:50	WG1762605
(S) p-Terphenyl-d14	109			37.0-146		10/26/2021 17:50	WG1762605

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Mercury by Method 7470A

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Mercury	U		0.100	0.200	1	10/27/2021 07:42	WG1762928

Metals (ICPMS) by Method 6020B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Arsenic	1.15	J	0.180	2.00	1	10/27/2021 21:04	WG1763394
Barium	92.7		0.381	2.00	1	10/27/2021 21:04	WG1763394
Cadmium	U		0.150	1.00	1	10/27/2021 21:04	WG1763394
Chromium	2.45	B	1.24	2.00	1	10/27/2021 21:04	WG1763394
Lead	U		0.849	2.00	1	10/27/2021 21:04	WG1763394
Selenium	0.792	J	0.300	2.00	1	10/27/2021 22:51	WG1763394
Silver	U		0.0700	2.00	1	10/27/2021 21:04	WG1763394

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Acetone	1.41	C5	0.548	1.00	1	10/23/2021 05:37	WG1761975
Acrylonitrile	U		0.0760	0.500	1	10/23/2021 05:37	WG1761975
Benzene	0.0490		0.0160	0.0400	1	10/23/2021 05:37	WG1761975
Bromobenzene	U		0.0420	0.500	1	10/23/2021 05:37	WG1761975
Bromochloromethane	U		0.0452	0.200	1	10/23/2021 05:37	WG1761975
Bromodichloromethane	U	J4	0.0315	0.100	1	10/23/2021 05:37	WG1761975
Bromoform	U		0.239	1.00	1	10/23/2021 05:37	WG1761975
Bromomethane	U		0.148	0.500	1	10/23/2021 05:37	WG1761975
n-Butylbenzene	U		0.153	0.500	1	10/23/2021 05:37	WG1761975
sec-Butylbenzene	U		0.101	0.500	1	10/23/2021 05:37	WG1761975
tert-Butylbenzene	U	C3	0.0620	0.200	1	10/23/2021 05:37	WG1761975
Carbon disulfide	U		0.162	0.500	1	10/23/2021 05:37	WG1761975
Carbon tetrachloride	U		0.0432	0.200	1	10/23/2021 05:37	WG1761975
Chlorobenzene	U		0.0229	0.100	1	10/23/2021 05:37	WG1761975
Chlorodibromomethane	U		0.0180	0.100	1	10/23/2021 05:37	WG1761975
Chloroethane	U		0.0432	0.200	1	10/23/2021 05:37	WG1761975
Chloroform	U		0.0166	0.100	1	10/23/2021 05:37	WG1761975
Chloromethane	U		0.0556	0.500	1	10/23/2021 05:37	WG1761975
2-Chlorotoluene	U		0.0368	0.100	1	10/23/2021 05:37	WG1761975
4-Chlorotoluene	U		0.0452	0.200	1	10/23/2021 05:37	WG1761975
1,2-Dibromo-3-Chloropropane	U	C3	0.204	1.00	1	10/23/2021 05:37	WG1761975
1,2-Dibromoethane	U		0.0210	0.100	1	10/23/2021 05:37	WG1761975
Dibromomethane	U	J4	0.0400	0.200	1	10/23/2021 05:37	WG1761975
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/23/2021 05:37	WG1761975
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/23/2021 05:37	WG1761975
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/23/2021 05:37	WG1761975
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/23/2021 05:37	WG1761975
Dichlorodifluoromethane	U		0.0327	0.100	1	10/23/2021 05:37	WG1761975
1,1-Dichloroethane	U		0.0230	0.100	1	10/23/2021 05:37	WG1761975
1,2-Dichloroethane	U		0.0190	0.100	1	10/23/2021 05:37	WG1761975
1,1-Dichloroethene	U		0.0200	0.100	1	10/23/2021 05:37	WG1761975
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/23/2021 05:37	WG1761975
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/23/2021 05:37	WG1761975
1,2-Dichloropropane	U		0.0508	0.200	1	10/23/2021 05:37	WG1761975
1,1-Dichloropropene	U		0.0280	0.100	1	10/23/2021 05:37	WG1761975
1,3-Dichloropropane	U		0.0700	0.200	1	10/23/2021 05:37	WG1761975
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/23/2021 05:37	WG1761975
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/23/2021 05:37	WG1761975
2,2-Dichloropropane	U		0.0317	0.100	1	10/23/2021 05:37	WG1761975

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Di-isopropyl ether	U		0.0140	0.0400	1	10/23/2021 05:37	WG1761975
Ethylbenzene	U		0.0212	0.100	1	10/23/2021 05:37	WG1761975
Hexachloro-1,3-butadiene	U		0.508	1.00	1	10/23/2021 05:37	WG1761975
2-Hexanone	U		0.400	1.00	1	10/23/2021 05:37	WG1761975
n-Hexane	U		0.0424	0.200	1	10/23/2021 05:37	WG1761975
Iodomethane	U		0.242	0.500	1	10/23/2021 05:37	WG1761975
Isopropylbenzene	U		0.0345	0.100	1	10/23/2021 05:37	WG1761975
p-Isopropyltoluene	U		0.0932	0.200	1	10/23/2021 05:37	WG1761975
2-Butanone (MEK)	U		0.500	1.00	1	10/23/2021 05:37	WG1761975
Methylene Chloride	U		0.265	1.00	1	10/23/2021 05:37	WG1761975
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/23/2021 05:37	WG1761975
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/23/2021 05:37	WG1761975
Naphthalene	U	C3	0.124	0.500	1	10/23/2021 05:37	WG1761975
n-Propylbenzene	U		0.0472	0.200	1	10/23/2021 05:37	WG1761975
Styrene	U		0.109	0.500	1	10/23/2021 05:37	WG1761975
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/23/2021 05:37	WG1761975
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/23/2021 05:37	WG1761975
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/23/2021 05:37	WG1761975
Tetrachloroethene	U		0.0280	0.100	1	10/23/2021 05:37	WG1761975
Toluene	0.0810	U	0.0500	0.200	1	10/23/2021 05:37	WG1761975
1,2,3-Trichlorobenzene	U		0.0250	0.500	1	10/23/2021 05:37	WG1761975
1,2,4-Trichlorobenzene	U		0.193	0.500	1	10/23/2021 05:37	WG1761975
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/23/2021 05:37	WG1761975
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/23/2021 05:37	WG1761975
Trichloroethene	U		0.0160	0.0400	1	10/23/2021 05:37	WG1761975
Trichlorofluoromethane	U		0.0200	0.100	1	10/23/2021 05:37	WG1761975
1,2,3-Trichloropropane	U		0.204	0.500	1	10/23/2021 05:37	WG1761975
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/23/2021 05:37	WG1761975
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/23/2021 05:37	WG1761975
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/23/2021 05:37	WG1761975
Vinyl acetate	U		0.141	0.500	1	10/23/2021 05:37	WG1761975
Vinyl chloride	U		0.0273	0.100	1	10/23/2021 05:37	WG1761975
Xylenes, Total	U		0.191	0.260	1	10/23/2021 05:37	WG1761975
(S) Toluene-d8	96.1			75.0-131		10/23/2021 05:37	WG1761975
(S) 4-Bromofluorobenzene	109			67.0-138		10/23/2021 05:37	WG1761975
(S) 1,2-Dichloroethane-d4	101			70.0-130		10/23/2021 05:37	WG1761975

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	U		66.7	200	1	10/29/2021 10:08	WG1765164
Residual Range Organics (RRO)	U		83.3	250	1	10/29/2021 10:08	WG1765164
(S) o-Terphenyl	103			52.0-156		10/29/2021 10:08	WG1765164

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Anthracene	U		0.0190	0.0500	1	10/26/2021 18:08	WG1762605
Acenaphthene	U		0.0190	0.0500	1	10/26/2021 18:08	WG1762605
Acenaphthylene	U		0.0171	0.0500	1	10/26/2021 18:08	WG1762605
Benzo(a)anthracene	U		0.0203	0.0500	1	10/26/2021 18:08	WG1762605
Benzo(a)pyrene	U		0.0184	0.0500	1	10/26/2021 18:08	WG1762605
Benzo(b)fluoranthene	U		0.0168	0.0500	1	10/26/2021 18:08	WG1762605
Benzo(g,h,i)perylene	U	J3	0.0184	0.0500	1	10/26/2021 18:08	WG1762605
Benzo(k)fluoranthene	U	J3	0.0202	0.0500	1	10/26/2021 18:08	WG1762605

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Chrysene	U		0.0179	0.0500	1	10/26/2021 18:08	WG1762605
Dibenz(a,h)anthracene	U	J3	0.0160	0.0500	1	10/26/2021 18:08	WG1762605
Fluoranthene	U		0.0270	0.100	1	10/26/2021 18:08	WG1762605
Fluorene	U		0.0169	0.0500	1	10/26/2021 18:08	WG1762605
Indeno(1,2,3-cd)pyrene	U	J3	0.0158	0.0500	1	10/26/2021 18:08	WG1762605
Naphthalene	U		0.0917	0.250	1	10/26/2021 18:08	WG1762605
Phenanthrene	U		0.0180	0.0500	1	10/26/2021 18:08	WG1762605
Pyrene	U		0.0169	0.0500	1	10/26/2021 18:08	WG1762605
1-Methylnaphthalene	U		0.0687	0.250	1	10/26/2021 18:08	WG1762605
2-Methylnaphthalene	U		0.0674	0.250	1	10/26/2021 18:08	WG1762605
2-Chloronaphthalene	U		0.0682	0.250	1	10/26/2021 18:08	WG1762605
(S) Nitrobenzene-d5	45.4			31.0-160		10/26/2021 18:08	WG1762605
(S) 2-Fluorobiphenyl	101			48.0-148		10/26/2021 18:08	WG1762605
(S) p-Terphenyl-d14	116			37.0-146		10/26/2021 18:08	WG1762605

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Acetone	20.4	<u>C5</u>	0.548	1.00	1	10/23/2021 05:57	WG1761975
Acrylonitrile	U		0.0760	0.500	1	10/23/2021 05:57	WG1761975
Benzene	0.134		0.0160	0.0400	1	10/23/2021 05:57	WG1761975
Bromobenzene	U		0.0420	0.500	1	10/23/2021 05:57	WG1761975
Bromochloromethane	U		0.0452	0.200	1	10/23/2021 05:57	WG1761975
Bromodichloromethane	0.0620	<u>J J4</u>	0.0315	0.100	1	10/23/2021 05:57	WG1761975
Bromoform	U		0.239	1.00	1	10/23/2021 05:57	WG1761975
Bromomethane	U		0.148	0.500	1	10/23/2021 05:57	WG1761975
n-Butylbenzene	U		0.153	0.500	1	10/23/2021 05:57	WG1761975
sec-Butylbenzene	U		0.101	0.500	1	10/23/2021 05:57	WG1761975
tert-Butylbenzene	U	<u>C3</u>	0.0620	0.200	1	10/23/2021 05:57	WG1761975
Carbon disulfide	U		0.162	0.500	1	10/23/2021 05:57	WG1761975
Carbon tetrachloride	U		0.0432	0.200	1	10/23/2021 05:57	WG1761975
Chlorobenzene	U		0.0229	0.100	1	10/23/2021 05:57	WG1761975
Chlorodibromomethane	U		0.0180	0.100	1	10/23/2021 05:57	WG1761975
Chloroethane	U		0.0432	0.200	1	10/23/2021 05:57	WG1761975
Chloroform	0.205	<u>C5</u>	0.0166	0.100	1	10/23/2021 05:57	WG1761975
Chloromethane	U		0.0556	0.500	1	10/23/2021 05:57	WG1761975
2-Chlorotoluene	U		0.0368	0.100	1	10/23/2021 05:57	WG1761975
4-Chlorotoluene	U		0.0452	0.200	1	10/23/2021 05:57	WG1761975
1,2-Dibromo-3-Chloropropane	U	<u>C3</u>	0.204	1.00	1	10/23/2021 05:57	WG1761975
1,2-Dibromoethane	U		0.0210	0.100	1	10/23/2021 05:57	WG1761975
Dibromomethane	U	<u>J4</u>	0.0400	0.200	1	10/23/2021 05:57	WG1761975
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/23/2021 05:57	WG1761975
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/23/2021 05:57	WG1761975
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/23/2021 05:57	WG1761975
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/23/2021 05:57	WG1761975
Dichlorodifluoromethane	U		0.0327	0.100	1	10/23/2021 05:57	WG1761975
1,1-Dichloroethane	U		0.0230	0.100	1	10/23/2021 05:57	WG1761975
1,2-Dichloroethane	U		0.0190	0.100	1	10/23/2021 05:57	WG1761975
1,1-Dichloroethene	U		0.0200	0.100	1	10/23/2021 05:57	WG1761975
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/23/2021 05:57	WG1761975
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/23/2021 05:57	WG1761975
1,2-Dichloropropane	U		0.0508	0.200	1	10/23/2021 05:57	WG1761975
1,1-Dichloropropene	U		0.0280	0.100	1	10/23/2021 05:57	WG1761975
1,3-Dichloropropane	U		0.0700	0.200	1	10/23/2021 05:57	WG1761975
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/23/2021 05:57	WG1761975
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/23/2021 05:57	WG1761975
2,2-Dichloropropane	U		0.0317	0.100	1	10/23/2021 05:57	WG1761975
Di-isopropyl ether	U		0.0140	0.0400	1	10/23/2021 05:57	WG1761975
Ethylbenzene	0.339		0.0212	0.100	1	10/23/2021 05:57	WG1761975
Hexachloro-1,3-butadiene	U		0.508	1.00	1	10/23/2021 05:57	WG1761975
2-Hexanone	U		0.400	1.00	1	10/23/2021 05:57	WG1761975
n-Hexane	U		0.0424	0.200	1	10/23/2021 05:57	WG1761975
Iodomethane	U		0.242	0.500	1	10/23/2021 05:57	WG1761975
Isopropylbenzene	U		0.0345	0.100	1	10/23/2021 05:57	WG1761975
p-Isopropyltoluene	1.35		0.0932	0.200	1	10/23/2021 05:57	WG1761975
2-Butanone (MEK)	1.19		0.500	1.00	1	10/23/2021 05:57	WG1761975
Methylene Chloride	U		0.265	1.00	1	10/23/2021 05:57	WG1761975
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/23/2021 05:57	WG1761975
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/23/2021 05:57	WG1761975
Naphthalene	U	<u>C3</u>	0.124	0.500	1	10/23/2021 05:57	WG1761975
n-Propylbenzene	U		0.0472	0.200	1	10/23/2021 05:57	WG1761975
Styrene	U		0.109	0.500	1	10/23/2021 05:57	WG1761975
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/23/2021 05:57	WG1761975
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/23/2021 05:57	WG1761975

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/23/2021 05:57	WG1761975
Tetrachloroethene	U		0.0280	0.100	1	10/23/2021 05:57	WG1761975
Toluene	0.483		0.0500	0.200	1	10/23/2021 05:57	WG1761975
1,2,3-Trichlorobenzene	U		0.0250	0.500	1	10/23/2021 05:57	WG1761975
1,2,4-Trichlorobenzene	U		0.193	0.500	1	10/23/2021 05:57	WG1761975
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/23/2021 05:57	WG1761975
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/23/2021 05:57	WG1761975
Trichloroethene	U		0.0160	0.0400	1	10/23/2021 05:57	WG1761975
Trichlorofluoromethane	U		0.0200	0.100	1	10/23/2021 05:57	WG1761975
1,2,3-Trichloropropane	U		0.204	0.500	1	10/23/2021 05:57	WG1761975
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/23/2021 05:57	WG1761975
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/23/2021 05:57	WG1761975
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/23/2021 05:57	WG1761975
Vinyl acetate	U		0.141	0.500	1	10/23/2021 05:57	WG1761975
Vinyl chloride	U		0.0273	0.100	1	10/23/2021 05:57	WG1761975
Xylenes, Total	2.00		0.191	0.260	1	10/23/2021 05:57	WG1761975
(S) Toluene-d8	90.6			75.0-131		10/23/2021 05:57	WG1761975
(S) 4-Bromofluorobenzene	96.6			67.0-138		10/23/2021 05:57	WG1761975
(S) 1,2-Dichloroethane-d4	114			70.0-130		10/23/2021 05:57	WG1761975



Semi-Volatile Organic Compounds (GC) by Method NWTPHDX-NO SGT

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Diesel Range Organics (DRO)	512		66.7	200	1	10/29/2021 10:29	WG1765164
Residual Range Organics (RRO)	164	J	83.3	250	1	10/29/2021 10:29	WG1765164
(S) o-Terphenyl	63.5			52.0-156		10/29/2021 10:29	WG1765164

Polychlorinated Biphenyls (GC) by Method 8082 A

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.270	0.500	1	10/24/2021 07:40	WG1761898
PCB 1221	U		0.270	0.500	1	10/24/2021 07:40	WG1761898
PCB 1232	U		0.270	0.500	1	10/24/2021 07:40	WG1761898
PCB 1242	U		0.270	0.500	1	10/24/2021 07:40	WG1761898
PCB 1248	U		0.173	0.500	1	10/24/2021 07:40	WG1761898
PCB 1254	U		0.173	0.500	1	10/24/2021 07:40	WG1761898
PCB 1260	U		0.173	0.500	1	10/24/2021 07:40	WG1761898
(S) Decachlorobiphenyl	26.3			10.0-128		10/24/2021 07:40	WG1761898
(S) Tetrachloro-m-xylene	62.4			10.0-127		10/24/2021 07:40	WG1761898

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Anthracene	U		0.0190	0.0500	1	10/26/2021 14:39	WG1762605
Acenaphthene	U		0.0190	0.0500	1	10/26/2021 14:39	WG1762605
Acenaphthylene	U		0.0171	0.0500	1	10/26/2021 14:39	WG1762605
Benzo(a)anthracene	U		0.0203	0.0500	1	10/26/2021 14:39	WG1762605
Benzo(a)pyrene	U		0.0184	0.0500	1	10/26/2021 14:39	WG1762605
Benzo(b)fluoranthene	U		0.0168	0.0500	1	10/26/2021 14:39	WG1762605
Benzo(g,h,i)perylene	U	J3	0.0184	0.0500	1	10/26/2021 14:39	WG1762605
Benzo(k)fluoranthene	U	J3	0.0202	0.0500	1	10/26/2021 14:39	WG1762605
Chrysene	U		0.0179	0.0500	1	10/26/2021 14:39	WG1762605
Dibenz(a,h)anthracene	U	J3	0.0160	0.0500	1	10/26/2021 14:39	WG1762605
Fluoranthene	U		0.0270	0.100	1	10/26/2021 14:39	WG1762605
Fluorene	U		0.0169	0.0500	1	10/26/2021 14:39	WG1762605

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
Indeno(1,2,3-cd)pyrene	U	<u>J3</u>	0.0158	0.0500	1	10/26/2021 14:39	WG1762605
Naphthalene	U		0.0917	0.250	1	10/26/2021 14:39	WG1762605
Phenanthrene	U		0.0180	0.0500	1	10/26/2021 14:39	WG1762605
Pyrene	U		0.0169	0.0500	1	10/26/2021 14:39	WG1762605
1-Methylnaphthalene	U		0.0687	0.250	1	10/26/2021 14:39	WG1762605
2-Methylnaphthalene	U		0.0674	0.250	1	10/26/2021 14:39	WG1762605
2-Chloronaphthalene	U		0.0682	0.250	1	10/26/2021 14:39	WG1762605
<i>(S)</i> Nitrobenzene-d5	84.5			31.0-160		10/26/2021 14:39	WG1762605
<i>(S)</i> 2-Fluorobiphenyl	61.5			48.0-148		10/26/2021 14:39	WG1762605
<i>(S)</i> p-Terphenyl-d14	44.2			37.0-146		10/26/2021 14:39	WG1762605

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

TRIP BLANK-WATER COOLER

SAMPLE RESULTS - 17

Collected date/time: 10/19/21 08:00

L1421071

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis	Batch
	ug/l		ug/l	ug/l		date / time	
Acetone	U		0.548	1.00	1	10/26/2021 03:39	WG1763302
Acrylonitrile	U		0.0760	0.500	1	10/26/2021 03:39	WG1763302
Benzene	U		0.0160	0.0400	1	10/26/2021 03:39	WG1763302
Bromobenzene	U		0.0420	0.500	1	10/26/2021 03:39	WG1763302
Bromochloromethane	U		0.0452	0.200	1	10/26/2021 03:39	WG1763302
Bromodichloromethane	U		0.0315	0.100	1	10/26/2021 03:39	WG1763302
Bromoform	U		0.239	1.00	1	10/26/2021 03:39	WG1763302
Bromomethane	U	C3	0.148	0.500	1	10/26/2021 03:39	WG1763302
n-Butylbenzene	U		0.153	0.500	1	10/26/2021 03:39	WG1763302
sec-Butylbenzene	U		0.101	0.500	1	10/26/2021 03:39	WG1763302
tert-Butylbenzene	U		0.0620	0.200	1	10/26/2021 03:39	WG1763302
Carbon disulfide	U		0.162	0.500	1	10/26/2021 03:39	WG1763302
Carbon tetrachloride	U		0.0432	0.200	1	10/26/2021 03:39	WG1763302
Chlorobenzene	U		0.0229	0.100	1	10/26/2021 03:39	WG1763302
Chlorodibromomethane	U		0.0180	0.100	1	10/26/2021 03:39	WG1763302
Chloroethane	U		0.0432	0.200	1	10/26/2021 03:39	WG1763302
Chloroform	U		0.0166	0.100	1	10/26/2021 03:39	WG1763302
Chloromethane	U		0.0556	0.500	1	10/26/2021 03:39	WG1763302
2-Chlorotoluene	U		0.0368	0.100	1	10/26/2021 03:39	WG1763302
4-Chlorotoluene	U		0.0452	0.200	1	10/26/2021 03:39	WG1763302
1,2-Dibromo-3-Chloropropane	U		0.204	1.00	1	10/26/2021 03:39	WG1763302
1,2-Dibromoethane	U		0.0210	0.100	1	10/26/2021 03:39	WG1763302
Dibromomethane	U		0.0400	0.200	1	10/26/2021 03:39	WG1763302
1,2-Dichlorobenzene	U		0.0580	0.200	1	10/26/2021 03:39	WG1763302
1,3-Dichlorobenzene	U		0.0680	0.200	1	10/26/2021 03:39	WG1763302
1,4-Dichlorobenzene	U		0.0788	0.200	1	10/26/2021 03:39	WG1763302
trans-1,4-Dichloro-2-butene	U		0.0560	0.200	1	10/26/2021 03:39	WG1763302
Dichlorodifluoromethane	U		0.0327	0.100	1	10/26/2021 03:39	WG1763302
1,1-Dichloroethane	U		0.0230	0.100	1	10/26/2021 03:39	WG1763302
1,2-Dichloroethane	U		0.0190	0.100	1	10/26/2021 03:39	WG1763302
1,1-Dichloroethene	U		0.0200	0.100	1	10/26/2021 03:39	WG1763302
cis-1,2-Dichloroethene	U		0.0276	0.100	1	10/26/2021 03:39	WG1763302
trans-1,2-Dichloroethene	U		0.0572	0.200	1	10/26/2021 03:39	WG1763302
1,2-Dichloropropane	U		0.0508	0.200	1	10/26/2021 03:39	WG1763302
1,1-Dichloropropene	U		0.0280	0.100	1	10/26/2021 03:39	WG1763302
1,3-Dichloropropane	U		0.0700	0.200	1	10/26/2021 03:39	WG1763302
cis-1,3-Dichloropropene	U		0.0271	0.100	1	10/26/2021 03:39	WG1763302
trans-1,3-Dichloropropene	U		0.0612	0.200	1	10/26/2021 03:39	WG1763302
2,2-Dichloropropane	U		0.0317	0.100	1	10/26/2021 03:39	WG1763302
Di-isopropyl ether	U		0.0140	0.0400	1	10/26/2021 03:39	WG1763302
Ethylbenzene	U		0.0212	0.100	1	10/26/2021 03:39	WG1763302
Hexachloro-1,3-butadiene	U	C3	0.508	1.00	1	10/26/2021 03:39	WG1763302
2-Hexanone	U		0.400	1.00	1	10/26/2021 03:39	WG1763302
n-Hexane	U		0.0424	0.200	1	10/26/2021 03:39	WG1763302
Iodomethane	U		0.242	0.500	1	10/26/2021 03:39	WG1763302
Isopropylbenzene	U		0.0345	0.100	1	10/26/2021 03:39	WG1763302
p-Isopropyltoluene	U		0.0932	0.200	1	10/26/2021 03:39	WG1763302
2-Butanone (MEK)	U		0.500	1.00	1	10/26/2021 03:39	WG1763302
Methylene Chloride	U		0.265	1.00	1	10/26/2021 03:39	WG1763302
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00	1	10/26/2021 03:39	WG1763302
Methyl tert-butyl ether	U		0.0118	0.0400	1	10/26/2021 03:39	WG1763302
Naphthalene	U	C3	0.124	0.500	1	10/26/2021 03:39	WG1763302
n-Propylbenzene	U		0.0472	0.200	1	10/26/2021 03:39	WG1763302
Styrene	U		0.109	0.500	1	10/26/2021 03:39	WG1763302
1,1,1,2-Tetrachloroethane	U		0.0200	0.100	1	10/26/2021 03:39	WG1763302
1,1,2,2-Tetrachloroethane	U		0.0156	0.100	1	10/26/2021 03:39	WG1763302

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

TRIP BLANK-WATER COOLER

SAMPLE RESULTS - 17

Collected date/time: 10/19/21 08:00

L1421071

Volatile Organic Compounds (GC/MS) by Method 8260D

Analyte	Result ug/l	Qualifier	MDL ug/l	RDL ug/l	Dilution	Analysis date / time	Batch
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100	1	10/26/2021 03:39	WG1763302
Tetrachloroethene	U		0.0280	0.100	1	10/26/2021 03:39	WG1763302
Toluene	U		0.0500	0.200	1	10/26/2021 03:39	WG1763302
1,2,3-Trichlorobenzene	U	<u>C4</u>	0.0250	0.500	1	10/26/2021 03:39	WG1763302
1,2,4-Trichlorobenzene	U	<u>C4</u>	0.193	0.500	1	10/26/2021 03:39	WG1763302
1,1,1-Trichloroethane	U		0.0110	0.100	1	10/26/2021 03:39	WG1763302
1,1,2-Trichloroethane	U		0.0353	0.100	1	10/26/2021 03:39	WG1763302
Trichloroethene	U		0.0160	0.0400	1	10/26/2021 03:39	WG1763302
Trichlorofluoromethane	U		0.0200	0.100	1	10/26/2021 03:39	WG1763302
1,2,3-Trichloropropane	U		0.204	0.500	1	10/26/2021 03:39	WG1763302
1,2,4-Trimethylbenzene	U		0.0464	0.200	1	10/26/2021 03:39	WG1763302
1,2,3-Trimethylbenzene	U		0.0460	0.200	1	10/26/2021 03:39	WG1763302
1,3,5-Trimethylbenzene	U		0.0432	0.200	1	10/26/2021 03:39	WG1763302
Vinyl acetate	U	<u>J3</u>	0.141	0.500	1	10/26/2021 03:39	WG1763302
Vinyl chloride	U		0.0273	0.100	1	10/26/2021 03:39	WG1763302
Xylenes, Total	U		0.191	0.260	1	10/26/2021 03:39	WG1763302
(S) Toluene-d8	103			75.0-131		10/26/2021 03:39	WG1763302
(S) 4-Bromofluorobenzene	96.8			67.0-138		10/26/2021 03:39	WG1763302
(S) 1,2-Dichloroethane-d4	111			70.0-130		10/26/2021 03:39	WG1763302

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Method Blank (MB)

(MB) R3721210-1 10/25/21 08:48

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	%		%	%
Total Solids	0.00100			

¹Cp

²Tc

³Ss

L1421071-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1421071-02 10/25/21 08:48 • (DUP) R3721210-3 10/25/21 08:48

Analyte	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
	%	%		%		%
Total Solids	83.4	82.7	1	0.874		10

⁴Cn

⁵Sr

Laboratory Control Sample (LCS)

(LCS) R3721210-2 10/25/21 08:48

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
	%	%	%	%	
Total Solids	50.0	50.0	100	85.0-115	

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3721208-1 10/25/21 08:41

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	%		%	%
Total Solids	0.00100			

¹Cp

²Tc

³Ss

L1421083-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1421083-02 10/25/21 08:41 • (DUP) R3721208-3 10/25/21 08:41

Analyte	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
	%	%		%		%
Total Solids	89.9	91.2	1	1.44		10

⁴Cn

⁵Sr

Laboratory Control Sample (LCS)

(LCS) R3721208-2 10/25/21 08:41

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
	%	%	%	%	
Total Solids	50.0	50.0	100	85.0-115	

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3721935-1 10/27/21 07:19

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
Mercury	U		0.100	0.200

¹Cp

²Tc

³Ss

Laboratory Control Sample (LCS)

(LCS) R3721935-2 10/27/21 07:20

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Mercury	3.00	3.16	105	80.0-120	

⁴Cn

⁵Sr

L1421800-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421800-01 10/27/21 07:22 • (MS) R3721935-3 10/27/21 07:24 • (MSD) R3721935-4 10/27/21 07:26

Analyte	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Mercury	3.00	U	3.42	3.19	114	106	1	75.0-125			6.99	20

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3721394-1 10/26/21 10:27

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
Mercury	U		0.0180	0.0400

¹Cp

²Tc

³Ss

Laboratory Control Sample (LCS)

(LCS) R3721394-2 10/26/21 10:29

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Mercury	0.500	0.543	109	80.0-120	

⁴Cn

⁵Sr

L1421083-13 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421083-13 10/26/21 10:32 • (MS) R3721394-3 10/26/21 10:34 • (MSD) R3721394-4 10/26/21 10:37

Analyte	Spike Amount (dry)	Original Result (dry)	MS Result (dry)	MSD Result (dry)	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Mercury	0.525	U	0.631	0.610	120	116	1	75.0-125			3.47	20

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3722247-6 10/27/21 20:46

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	ug/l		ug/l	ug/l
Arsenic	U		0.180	2.00
Barium	U		0.381	2.00
Cadmium	U		0.150	1.00
Chromium	1.77	J	1.24	2.00
Lead	U		0.849	2.00
Silver	U		0.0700	2.00

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

Method Blank (MB)

(MB) R3722269-1 10/27/21 22:22

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	ug/l		ug/l	ug/l
Selenium	U		0.300	2.00

⁶Qc

⁷Is

⁸Gl

Laboratory Control Sample (LCS)

(LCS) R3722247-2 10/27/21 20:03

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
	ug/l	ug/l	%	%	
Arsenic	50.0	50.6	101	80.0-120	
Barium	50.0	48.6	97.2	80.0-120	
Cadmium	50.0	52.0	104	80.0-120	
Chromium	50.0	53.1	106	80.0-120	
Lead	50.0	50.0	100	80.0-120	
Silver	50.0	49.4	98.8	80.0-120	

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS)

(LCS) R3722269-2 10/27/21 22:26

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
	ug/l	ug/l	%	%	
Selenium	50.0	50.1	100	80.0-120	

L1421071-14 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-14 10/27/21 20:07 • (MS) R3722247-4 10/27/21 20:14 • (MSD) R3722247-5 10/27/21 20:18

Analyte	Spike Amount ug/l	Original Result ug/l	MS Result ug/l	MSD Result ug/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Arsenic	50.0	1.19	53.2	51.2	104	100	1	75.0-125			3.85	20
Barium	50.0	97.1	152	155	109	116	1	75.0-125			2.44	20
Cadmium	50.0	U	53.1	54.1	106	108	1	75.0-125			1.90	20
Chromium	50.0	7.09	61.5	65.0	109	116	1	75.0-125			5.53	20
Lead	50.0	4.45	54.3	59.1	99.7	109	1	75.0-125			8.52	20
Silver	50.0	0.0736	50.1	50.4	100	101	1	75.0-125			0.602	20

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

L1421071-14 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-14 10/27/21 22:29 • (MS) R3722269-4 10/27/21 22:36 • (MSD) R3722269-5 10/27/21 22:40

Analyte	Spike Amount ug/l	Original Result ug/l	MS Result ug/l	MSD Result ug/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Selenium	50.0	0.583	51.0	52.0	101	103	1	75.0-125			1.95	20

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3722219-1 10/27/21 18:18

Analyte	MB Result mg/kg	MB Qualifier	MB MDL mg/kg	MB RDL mg/kg
Arsenic	U		0.100	1.00
Barium	U		0.152	2.50
Cadmium	U		0.0855	1.00
Chromium	U		0.297	5.00
Lead	U		0.0990	2.00
Selenium	U		0.180	2.50
Silver	U		0.0865	0.500

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS)

(LCS) R3722219-2 10/27/21 18:21

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	LCS Qualifier
Arsenic	100	94.6	94.6	80.0-120	
Barium	100	100	100	80.0-120	
Cadmium	100	98.9	98.9	80.0-120	
Chromium	100	95.6	95.6	80.0-120	
Lead	100	99.0	99.0	80.0-120	
Selenium	100	95.7	95.7	80.0-120	
Silver	20.0	20.0	99.8	80.0-120	

L1421071-10 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-10 10/27/21 18:24 • (MS) R3722219-5 10/27/21 18:34 • (MSD) R3722219-6 10/27/21 18:37

Analyte	Spike Amount (dry) mg/kg	Original Result (dry) mg/kg	MS Result (dry) mg/kg	MSD Result (dry) mg/kg	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Arsenic	128	3.30	117	116	89.0	88.0	5	75.0-125			1.12	20
Barium	128	100	243	235	112	105	5	75.0-125			3.57	20
Cadmium	128	U	128	126	99.6	98.0	5	75.0-125			1.68	20
Chromium	128	21.9	139	140	91.2	92.0	5	75.0-125			0.757	20
Lead	128	5.86	133	125	99.0	92.9	5	75.0-125			6.07	20
Selenium	128	0.271	122	121	95.3	94.3	5	75.0-125			1.06	20
Silver	25.7	U	25.1	24.9	97.9	97.1	5	75.0-125			0.829	20

Method Blank (MB)

(MB) R3725266-3 10/22/21 23:29

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Acetone	U		0.548	1.00
Acrylonitrile	U		0.0760	0.500
Benzene	U		0.0160	0.0400
Bromobenzene	U		0.0420	0.500
Bromodichloromethane	U		0.0315	0.100
Bromochloromethane	U		0.0452	0.200
Bromoform	U		0.239	1.00
Bromomethane	U		0.148	0.500
n-Butylbenzene	U		0.153	0.500
sec-Butylbenzene	U		0.101	0.500
tert-Butylbenzene	U		0.0620	0.200
Carbon disulfide	U		0.162	0.500
Carbon tetrachloride	U		0.0432	0.200
Chlorobenzene	U		0.0229	0.100
Chlorodibromomethane	U		0.0180	0.100
Chloroethane	U		0.0432	0.200
Chloroform	U		0.0166	0.100
Chloromethane	U		0.0556	0.500
2-Chlorotoluene	U		0.0368	0.100
4-Chlorotoluene	U		0.0452	0.200
1,2-Dibromo-3-Chloropropane	U		0.204	1.00
1,2-Dibromoethane	U		0.0210	0.100
Dibromomethane	U		0.0400	0.200
1,2-Dichlorobenzene	U		0.0580	0.200
1,3-Dichlorobenzene	U		0.0680	0.200
1,4-Dichlorobenzene	U		0.0788	0.200
trans-1,4-Dichloro-2-butene	U		0.0560	0.200
Dichlorodifluoromethane	U		0.0327	0.100
1,1-Dichloroethane	U		0.0230	0.100
1,2-Dichloroethane	U		0.0190	0.100
1,1-Dichloroethene	U		0.0200	0.100
cis-1,2-Dichloroethene	U		0.0276	0.100
trans-1,2-Dichloroethene	U		0.0572	0.200
1,2-Dichloropropane	U		0.0508	0.200
1,1-Dichloropropene	U		0.0280	0.100
1,3-Dichloropropane	U		0.0700	0.200
cis-1,3-Dichloropropene	U		0.0271	0.100
trans-1,3-Dichloropropene	U		0.0612	0.200
2,2-Dichloropropane	U		0.0317	0.100
Di-isopropyl ether	U		0.0140	0.0400

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3725266-3 10/22/21 23:29

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Ethylbenzene	U		0.0212	0.100
Hexachloro-1,3-butadiene	U		0.508	1.00
n-Hexane	U		0.0424	0.200
2-Hexanone	U		0.400	1.00
Iodomethane	U		0.242	0.500
Isopropylbenzene	U		0.0345	0.100
p-Isopropyltoluene	U		0.0932	0.200
2-Butanone (MEK)	U		0.500	1.00
Methylene Chloride	U		0.265	1.00
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00
Methyl tert-butyl ether	U		0.0118	0.0400
Naphthalene	U		0.124	0.500
n-Propylbenzene	U		0.0472	0.200
Styrene	U		0.109	0.500
1,1,1,2-Tetrachloroethane	U		0.0200	0.100
1,1,2,2-Tetrachloroethane	U		0.0156	0.100
Tetrachloroethene	U		0.0280	0.100
Toluene	U		0.0500	0.200
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100
1,2,3-Trichlorobenzene	U		0.0250	0.500
1,2,4-Trichlorobenzene	U		0.193	0.500
1,1,1-Trichloroethane	U		0.0110	0.100
1,1,2-Trichloroethane	U		0.0353	0.100
Trichloroethene	U		0.0160	0.0400
Trichlorofluoromethane	U		0.0200	0.100
1,2,3-Trichloropropane	U		0.204	0.500
1,2,3-Trimethylbenzene	U		0.0460	0.200
1,2,4-Trimethylbenzene	U		0.0464	0.200
1,3,5-Trimethylbenzene	U		0.0432	0.200
Vinyl acetate	U		0.141	0.500
Vinyl chloride	U		0.0273	0.100
Xylenes, Total	U		0.191	0.260
(S) Toluene-d8	93.6			75.0-131
(S) 4-Bromofluorobenzene	104			67.0-138
(S) 1,2-Dichloroethane-d4	116			70.0-130

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3725266-1 10/22/21 22:11 • (LCSD) R3725266-2 10/22/21 22:31

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	<u>LCS Qualifier</u>	<u>LCSD Qualifier</u>	RPD %	RPD Limits %
Acetone	25.0	32.6	34.8	130	139	10.0-160			6.53	31
Acrylonitrile	25.0	27.0	27.7	108	111	45.0-153			2.56	22
Benzene	5.00	5.98	6.07	120	121	70.0-123			1.49	20
Bromobenzene	5.00	4.70	4.38	94.0	87.6	73.0-121			7.05	20
Bromodichloromethane	5.00	6.35	6.43	127	129	73.0-121	J4	J4	1.25	20
Bromochloromethane	5.00	5.29	5.12	106	102	77.0-128			3.27	20
Bromoform	5.00	4.55	4.52	91.0	90.4	64.0-132			0.662	20
Bromomethane	5.00	6.26	6.16	125	123	56.0-147			1.61	20
n-Butylbenzene	5.00	4.96	4.44	99.2	88.8	68.0-135			11.1	20
sec-Butylbenzene	5.00	4.30	4.44	86.0	88.8	74.0-130			3.20	20
tert-Butylbenzene	5.00	3.95	4.22	79.0	84.4	75.0-127			6.61	20
Carbon disulfide	5.00	4.82	5.00	96.4	100	56.0-133			3.67	20
Carbon tetrachloride	5.00	5.64	5.43	113	109	66.0-128			3.79	20
Chlorobenzene	5.00	5.09	4.87	102	97.4	76.0-128			4.42	20
Chlorodibromomethane	5.00	5.32	4.79	106	95.8	74.0-127			10.5	20
Chloroethane	5.00	5.29	5.10	106	102	61.0-134			3.66	20
Chloroform	5.00	6.11	6.08	122	122	72.0-123			0.492	20
Chloromethane	5.00	4.95	4.57	99.0	91.4	51.0-138			7.98	20
2-Chlorotoluene	5.00	4.46	4.24	89.2	84.8	75.0-124			5.06	20
4-Chlorotoluene	5.00	4.56	4.56	91.2	91.2	75.0-124			0.000	20
1,2-Dibromo-3-Chloropropane	5.00	3.92	3.42	78.4	68.4	59.0-130			13.6	20
1,2-Dibromoethane	5.00	4.72	4.57	94.4	91.4	74.0-128			3.23	20
Dibromomethane	5.00	6.46	6.46	129	129	75.0-122	J4	J4	0.000	20
1,2-Dichlorobenzene	5.00	5.25	4.81	105	96.2	76.0-124			8.75	20
1,3-Dichlorobenzene	5.00	4.58	4.67	91.6	93.4	76.0-125			1.95	20
1,4-Dichlorobenzene	5.00	4.42	4.66	88.4	93.2	77.0-121			5.29	20
trans-1,4-Dichloro-2-butene	5.00	4.41	4.21	88.2	84.2	45.0-143			4.64	20
Dichlorodifluoromethane	5.00	4.77	4.30	95.4	86.0	43.0-156			10.4	20
1,1-Dichloroethane	5.00	5.24	5.27	105	105	70.0-127			0.571	20
1,2-Dichloroethane	5.00	5.60	5.96	112	119	65.0-131			6.23	20
1,1-Dichloroethene	5.00	4.90	5.35	98.0	107	65.0-131			8.78	20
cis-1,2-Dichloroethene	5.00	5.82	5.31	116	106	73.0-125			9.16	20
trans-1,2-Dichloroethene	5.00	5.87	5.50	117	110	71.0-125			6.51	20
1,2-Dichloropropane	5.00	5.75	6.15	115	123	74.0-125			6.72	20
1,1-Dichloropropene	5.00	5.03	5.37	101	107	73.0-125			6.54	20
1,3-Dichloropropane	5.00	4.85	4.90	97.0	98.0	80.0-125			1.03	20
cis-1,3-Dichloropropene	5.00	6.13	5.99	123	120	76.0-127			2.31	20
trans-1,3-Dichloropropene	5.00	4.87	4.72	97.4	94.4	73.0-127			3.13	20
2,2-Dichloropropane	5.00	6.40	6.18	128	124	59.0-135			3.50	20
Di-isopropyl ether	5.00	5.19	5.78	104	116	60.0-136			10.8	20

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3725266-1 10/22/21 22:11 • (LCSD) R3725266-2 10/22/21 22:31

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Ethylbenzene	5.00	5.03	4.90	101	98.0	74.0-126			2.62	20
Hexachloro-1,3-butadiene	5.00	4.64	3.98	92.8	79.6	57.0-150			15.3	20
n-Hexane	5.00	5.33	4.51	107	90.2	55.0-137			16.7	20
2-Hexanone	25.0	22.8	24.5	91.2	98.0	54.0-147			7.19	20
Iodomethane	25.0	27.7	28.2	111	113	74.0-134			1.79	20
Isopropylbenzene	5.00	4.84	4.81	96.8	96.2	72.0-127			0.622	20
p-Isopropyltoluene	5.00	4.39	4.28	87.8	85.6	72.0-133			2.54	20
2-Butanone (MEK)	25.0	26.6	25.2	106	101	30.0-160			5.41	24
Methylene Chloride	5.00	5.19	5.35	104	107	68.0-123			3.04	20
4-Methyl-2-pentanone (MIBK)	25.0	22.2	24.0	88.8	96.0	56.0-143			7.79	20
Methyl tert-butyl ether	5.00	5.78	5.20	116	104	66.0-132			10.6	20
Naphthalene	5.00	3.76	3.56	75.2	71.2	59.0-130			5.46	20
n-Propylbenzene	5.00	4.59	4.39	91.8	87.8	74.0-126			4.45	20
Styrene	5.00	4.93	4.68	98.6	93.6	72.0-127			5.20	20
1,1,1,2-Tetrachloroethane	5.00	5.73	5.48	115	110	74.0-129			4.46	20
1,1,2,2-Tetrachloroethane	5.00	4.68	4.46	93.6	89.2	68.0-128			4.81	20
Tetrachloroethene	5.00	5.10	4.66	102	93.2	70.0-136			9.02	20
Toluene	5.00	5.02	5.00	100	100	75.0-121			0.399	20
1,1,2-Trichlorotrifluoroethane	5.00	5.25	5.17	105	103	61.0-139			1.54	20
1,2,3-Trichlorobenzene	5.00	4.57	4.37	91.4	87.4	59.0-139			4.47	20
1,2,4-Trichlorobenzene	5.00	5.84	5.29	117	106	62.0-137			9.88	20
1,1,1-Trichloroethane	5.00	6.28	6.19	126	124	69.0-126			1.44	20
1,1,2-Trichloroethane	5.00	5.72	5.10	114	102	78.0-123			11.5	20
Trichloroethene	5.00	5.75	5.61	115	112	76.0-126			2.46	20
Trichlorofluoromethane	5.00	5.50	5.31	110	106	61.0-142			3.52	20
1,2,3-Trichloropropane	5.00	4.50	4.48	90.0	89.6	67.0-129			0.445	20
1,2,3-Trimethylbenzene	5.00	4.21	4.47	84.2	89.4	74.0-124			5.99	20
1,2,4-Trimethylbenzene	5.00	4.75	4.56	95.0	91.2	70.0-126			4.08	20
1,3,5-Trimethylbenzene	5.00	4.64	4.43	92.8	88.6	73.0-127			4.63	20
Vinyl acetate	25.0	27.7	25.9	111	104	43.0-159			6.72	20
Vinyl chloride	5.00	5.23	5.06	105	101	63.0-134			3.30	20
Xylenes, Total	15.0	14.9	14.7	99.3	98.0	72.0-127			1.35	20
(S) Toluene-d8				95.4	93.8	75.0-131				
(S) 4-Bromofluorobenzene				106	98.4	67.0-138				
(S) 1,2-Dichloroethane-d4				113	117	70.0-130				

¹ Cp

² Tc

³ Ss

⁴ Cn

⁵ Sr

⁶ Qc

⁷ Is

⁸ Gl

⁹ Al

¹⁰ Sc

Method Blank (MB)

(MB) R3724543-3 10/26/21 03:20

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Acetone	U		0.548	1.00
Acrylonitrile	U		0.0760	0.500
Benzene	U		0.0160	0.0400
Bromobenzene	U		0.0420	0.500
Bromodichloromethane	U		0.0315	0.100
Bromochloromethane	U		0.0452	0.200
Bromoform	U		0.239	1.00
Bromomethane	U		0.148	0.500
n-Butylbenzene	U		0.153	0.500
sec-Butylbenzene	U		0.101	0.500
tert-Butylbenzene	U		0.0620	0.200
Carbon disulfide	U		0.162	0.500
Carbon tetrachloride	U		0.0432	0.200
Chlorobenzene	U		0.0229	0.100
Chlorodibromomethane	U		0.0180	0.100
Chloroethane	U		0.0432	0.200
Chloroform	U		0.0166	0.100
Chloromethane	U		0.0556	0.500
2-Chlorotoluene	U		0.0368	0.100
4-Chlorotoluene	U		0.0452	0.200
1,2-Dibromo-3-Chloropropane	U		0.204	1.00
1,2-Dibromoethane	U		0.0210	0.100
Dibromomethane	U		0.0400	0.200
1,2-Dichlorobenzene	U		0.0580	0.200
1,3-Dichlorobenzene	U		0.0680	0.200
1,4-Dichlorobenzene	U		0.0788	0.200
trans-1,4-Dichloro-2-butene	U		0.0560	0.200
Dichlorodifluoromethane	U		0.0327	0.100
1,1-Dichloroethane	U		0.0230	0.100
1,2-Dichloroethane	U		0.0190	0.100
1,1-Dichloroethene	U		0.0200	0.100
cis-1,2-Dichloroethene	U		0.0276	0.100
trans-1,2-Dichloroethene	U		0.0572	0.200
1,2-Dichloropropane	U		0.0508	0.200
1,1-Dichloropropene	U		0.0280	0.100
1,3-Dichloropropane	U		0.0700	0.200
cis-1,3-Dichloropropene	U		0.0271	0.100
trans-1,3-Dichloropropene	U		0.0612	0.200
2,2-Dichloropropane	U		0.0317	0.100
Di-isopropyl ether	U		0.0140	0.0400

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3724543-3 10/26/21 03:20

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Ethylbenzene	U		0.0212	0.100
Hexachloro-1,3-butadiene	U		0.508	1.00
n-Hexane	U		0.0424	0.200
2-Hexanone	U		0.400	1.00
Iodomethane	U		0.242	0.500
Isopropylbenzene	U		0.0345	0.100
p-Isopropyltoluene	U		0.0932	0.200
2-Butanone (MEK)	U		0.500	1.00
Methylene Chloride	U		0.265	1.00
4-Methyl-2-pentanone (MIBK)	U		0.400	1.00
Methyl tert-butyl ether	U		0.0118	0.0400
Naphthalene	U		0.124	0.500
n-Propylbenzene	U		0.0472	0.200
Styrene	U		0.109	0.500
1,1,1,2-Tetrachloroethane	U		0.0200	0.100
1,1,2,2-Tetrachloroethane	U		0.0156	0.100
Tetrachloroethene	U		0.0280	0.100
Toluene	U		0.0500	0.200
1,1,2-Trichlorotrifluoroethane	U		0.0270	0.100
1,2,3-Trichlorobenzene	U		0.0250	0.500
1,2,4-Trichlorobenzene	U		0.193	0.500
1,1,1-Trichloroethane	U		0.0110	0.100
1,1,2-Trichloroethane	U		0.0353	0.100
Trichloroethene	U		0.0160	0.0400
Trichlorofluoromethane	U		0.0200	0.100
1,2,3-Trichloropropane	U		0.204	0.500
1,2,3-Trimethylbenzene	U		0.0460	0.200
1,2,4-Trimethylbenzene	U		0.0464	0.200
1,3,5-Trimethylbenzene	U		0.0432	0.200
Vinyl acetate	U		0.141	0.500
Vinyl chloride	U		0.0273	0.100
Xylenes, Total	U		0.191	0.260
(S) Toluene-d8	103			75.0-131
(S) 4-Bromofluorobenzene	102			67.0-138
(S) 1,2-Dichloroethane-d4	111			70.0-130

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3724543-1 10/26/21 02:04 • (LCSD) R3724543-2 10/26/21 02:23

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	<u>LCS Qualifier</u>	<u>LCSD Qualifier</u>	RPD %	RPD Limits %
Acetone	25.0	39.9	39.5	160	158	10.0-160			1.01	31
Acrylonitrile	25.0	36.0	36.6	144	146	45.0-153			1.65	22
Benzene	5.00	4.98	5.03	99.6	101	70.0-123			0.999	20
Bromobenzene	5.00	5.08	5.30	102	106	73.0-121			4.24	20
Bromodichloromethane	5.00	5.20	5.38	104	108	73.0-121			3.40	20
Bromochloromethane	5.00	5.32	5.25	106	105	77.0-128			1.32	20
Bromoform	5.00	4.55	4.79	91.0	95.8	64.0-132			5.14	20
Bromomethane	5.00	3.78	3.84	75.6	76.8	56.0-147			1.57	20
n-Butylbenzene	5.00	4.31	4.31	86.2	86.2	68.0-135			0.000	20
sec-Butylbenzene	5.00	4.53	4.63	90.6	92.6	74.0-130			2.18	20
tert-Butylbenzene	5.00	4.70	4.97	94.0	99.4	75.0-127			5.58	20
Carbon disulfide	5.00	4.76	4.83	95.2	96.6	56.0-133			1.46	20
Carbon tetrachloride	5.00	5.19	5.07	104	101	66.0-128			2.34	20
Chlorobenzene	5.00	4.77	4.85	95.4	97.0	76.0-128			1.66	20
Chlorodibromomethane	5.00	4.75	4.76	95.0	95.2	74.0-127			0.210	20
Chloroethane	5.00	4.40	4.73	88.0	94.6	61.0-134			7.23	20
Chloroform	5.00	5.61	5.66	112	113	72.0-123			0.887	20
Chloromethane	5.00	4.77	4.87	95.4	97.4	51.0-138			2.07	20
2-Chlorotoluene	5.00	4.79	5.01	95.8	100	75.0-124			4.49	20
4-Chlorotoluene	5.00	5.11	5.41	102	108	75.0-124			5.70	20
1,2-Dibromo-3-Chloropropane	5.00	4.81	4.92	96.2	98.4	59.0-130			2.26	20
1,2-Dibromoethane	5.00	4.74	4.61	94.8	92.2	74.0-128			2.78	20
Dibromomethane	5.00	4.89	4.96	97.8	99.2	75.0-122			1.42	20
1,2-Dichlorobenzene	5.00	4.93	5.16	98.6	103	76.0-124			4.56	20
1,3-Dichlorobenzene	5.00	4.90	4.93	98.0	98.6	76.0-125			0.610	20
1,4-Dichlorobenzene	5.00	4.60	4.81	92.0	96.2	77.0-121			4.46	20
trans-1,4-Dichloro-2-butene	5.00	5.76	5.94	115	119	45.0-143			3.08	20
Dichlorodifluoromethane	5.00	5.01	5.11	100	102	43.0-156			1.98	20
1,1-Dichloroethane	5.00	5.07	5.28	101	106	70.0-127			4.06	20
1,2-Dichloroethane	5.00	5.60	5.46	112	109	65.0-131			2.53	20
1,1-Dichloroethene	5.00	5.18	5.24	104	105	65.0-131			1.15	20
cis-1,2-Dichloroethene	5.00	4.94	4.88	98.8	97.6	73.0-125			1.22	20
trans-1,2-Dichloroethene	5.00	4.89	4.99	97.8	99.8	71.0-125			2.02	20
1,2-Dichloropropane	5.00	5.37	5.42	107	108	74.0-125			0.927	20
1,1-Dichloropropene	5.00	5.22	5.32	104	106	73.0-125			1.90	20
1,3-Dichloropropane	5.00	4.92	5.07	98.4	101	80.0-125			3.00	20
cis-1,3-Dichloropropene	5.00	5.17	5.28	103	106	76.0-127			2.11	20
trans-1,3-Dichloropropene	5.00	4.81	5.02	96.2	100	73.0-127			4.27	20
2,2-Dichloropropane	5.00	5.04	5.04	101	101	59.0-135			0.000	20
Di-isopropyl ether	5.00	4.96	4.94	99.2	98.8	60.0-136			0.404	20

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3724543-1 10/26/21 02:04 • (LCSD) R3724543-2 10/26/21 02:23

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Ethylbenzene	5.00	4.59	4.66	91.8	93.2	74.0-126			1.51	20
Hexachloro-1,3-butadiene	5.00	3.20	3.46	64.0	69.2	57.0-150			7.81	20
n-Hexane	5.00	4.55	4.67	91.0	93.4	55.0-137			2.60	20
2-Hexanone	25.0	23.4	24.0	93.6	96.0	54.0-147			2.53	20
Iodomethane	25.0	24.9	24.7	99.6	98.8	74.0-134			0.806	20
Isopropylbenzene	5.00	4.53	4.41	90.6	88.2	72.0-127			2.68	20
p-Isopropyltoluene	5.00	4.17	4.39	83.4	87.8	72.0-133			5.14	20
2-Butanone (MEK)	25.0	30.5	30.7	122	123	30.0-160			0.654	24
Methylene Chloride	5.00	5.29	5.35	106	107	68.0-123			1.13	20
4-Methyl-2-pentanone (MIBK)	25.0	26.0	26.6	104	106	56.0-143			2.28	20
Methyl tert-butyl ether	5.00	5.37	5.42	107	108	66.0-132			0.927	20
Naphthalene	5.00	3.24	3.38	64.8	67.6	59.0-130			4.23	20
n-Propylbenzene	5.00	5.11	5.33	102	107	74.0-126			4.21	20
Styrene	5.00	4.47	4.42	89.4	88.4	72.0-127			1.12	20
1,1,1,2-Tetrachloroethane	5.00	4.52	4.51	90.4	90.2	74.0-129			0.221	20
1,1,2,2-Tetrachloroethane	5.00	4.81	5.35	96.2	107	68.0-128			10.6	20
Tetrachloroethene	5.00	5.00	5.06	100	101	70.0-136			1.19	20
Toluene	5.00	4.78	5.06	95.6	101	75.0-121			5.69	20
1,1,2-Trichlorotrifluoroethane	5.00	4.86	4.35	97.2	87.0	61.0-139			11.1	20
1,2,3-Trichlorobenzene	5.00	3.10	3.24	62.0	64.8	59.0-139			4.42	20
1,2,4-Trichlorobenzene	5.00	3.26	3.49	65.2	69.8	62.0-137			6.81	20
1,1,1-Trichloroethane	5.00	5.27	5.59	105	112	69.0-126			5.89	20
1,1,2-Trichloroethane	5.00	4.72	4.89	94.4	97.8	78.0-123			3.54	20
Trichloroethene	5.00	5.43	5.28	109	106	76.0-126			2.80	20
Trichlorofluoromethane	5.00	4.31	4.47	86.2	89.4	61.0-142			3.64	20
1,2,3-Trichloropropane	5.00	5.12	5.45	102	109	67.0-129			6.24	20
1,2,3-Trimethylbenzene	5.00	4.52	4.73	90.4	94.6	74.0-124			4.54	20
1,2,4-Trimethylbenzene	5.00	4.86	4.95	97.2	99.0	70.0-126			1.83	20
1,3,5-Trimethylbenzene	5.00	4.67	4.83	93.4	96.6	73.0-127			3.37	20
Vinyl acetate	25.0	21.0	31.8	84.0	127	43.0-159		J3	40.9	20
Vinyl chloride	5.00	4.68	4.54	93.6	90.8	63.0-134			3.04	20
Xylenes, Total	15.0	14.2	14.2	94.7	94.7	72.0-127			0.000	20
(S) Toluene-d8				101	103	75.0-131				
(S) 4-Bromofluorobenzene				101	95.4	67.0-138				
(S) 1,2-Dichloroethane-d4				110	109	70.0-130				

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Method Blank (MB)

(MB) R3723968-2 10/26/21 05:37

Analyte	MB Result mg/kg	MB Qualifier	MB MDL mg/kg	MB RDL mg/kg
Acetone	U		0.0365	0.0500
Acrylonitrile	U		0.00361	0.0125
Benzene	U		0.000467	0.00100
Bromobenzene	U		0.000900	0.0125
Bromodichloromethane	U		0.000725	0.00250
Bromoform	U		0.00117	0.0250
Bromomethane	U		0.00197	0.0125
n-Butylbenzene	U		0.00525	0.0125
sec-Butylbenzene	U		0.00288	0.0125
tert-Butylbenzene	U		0.00195	0.00500
Carbon tetrachloride	U		0.000898	0.00500
Chlorobenzene	U		0.000210	0.00250
Chlorodibromomethane	U		0.000612	0.00250
Chloroethane	U		0.00170	0.00500
Chloroform	U		0.00103	0.00250
Chloromethane	U		0.00435	0.0125
2-Chlorotoluene	U		0.000865	0.00250
4-Chlorotoluene	U		0.000450	0.00500
1,2-Dibromo-3-Chloropropane	U		0.00390	0.0250
1,2-Dibromoethane	U		0.000648	0.00250
Dibromomethane	U		0.000750	0.00500
1,2-Dichlorobenzene	U		0.000425	0.00500
1,3-Dichlorobenzene	U		0.000600	0.00500
1,4-Dichlorobenzene	U		0.000700	0.00500
Dichlorodifluoromethane	U		0.00161	0.00250
1,1-Dichloroethane	U		0.000491	0.00250
1,2-Dichloroethane	U		0.000649	0.00250
1,1-Dichloroethene	U		0.000606	0.00250
cis-1,2-Dichloroethene	U		0.000734	0.00250
trans-1,2-Dichloroethene	U		0.00104	0.00500
1,2-Dichloropropane	U		0.00142	0.00500
1,1-Dichloropropene	U		0.000809	0.00250
1,3-Dichloropropane	U		0.000501	0.00500
cis-1,3-Dichloropropene	U		0.000757	0.00250
trans-1,3-Dichloropropene	U		0.00114	0.00500
2,2-Dichloropropane	U		0.00138	0.00250
Di-isopropyl ether	U		0.000410	0.00100
Ethylbenzene	U		0.000737	0.00250
Hexachloro-1,3-butadiene	U		0.00600	0.0250
Isopropylbenzene	U		0.000425	0.00250

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3723968-2 10/26/21 05:37

Analyte	MB Result mg/kg	MB Qualifier	MB MDL mg/kg	MB RDL mg/kg
p-Isopropyltoluene	U		0.00255	0.00500
2-Butanone (MEK)	0.0696	U	0.0635	0.100
Methylene Chloride	U		0.00664	0.0250
4-Methyl-2-pentanone (MIBK)	U		0.00228	0.0250
Methyl tert-butyl ether	U		0.000350	0.00100
Naphthalene	U		0.00488	0.0125
n-Propylbenzene	U		0.000950	0.00500
Styrene	U		0.000229	0.0125
1,1,1,2-Tetrachloroethane	U		0.000948	0.00250
1,1,2,2-Tetrachloroethane	U		0.000695	0.00250
Tetrachloroethene	U		0.000896	0.00250
Toluene	U		0.00130	0.00500
1,1,2-Trichlorotrifluoroethane	U		0.000754	0.00250
1,2,3-Trichlorobenzene	U		0.00733	0.0125
1,2,4-Trichlorobenzene	U		0.00440	0.0125
1,1,1-Trichloroethane	U		0.000923	0.00250
1,1,2-Trichloroethane	U		0.000597	0.00250
Trichloroethene	U		0.000584	0.00100
Trichlorofluoromethane	U		0.000827	0.00250
1,2,3-Trichloropropane	U		0.00162	0.0125
1,2,3-Trimethylbenzene	U		0.00158	0.00500
1,2,4-Trimethylbenzene	U		0.00158	0.00500
1,3,5-Trimethylbenzene	U		0.00200	0.00500
Vinyl chloride	U		0.00116	0.00250
Xylenes, Total	U		0.000880	0.00650
(S) Toluene-d8	124			75.0-131
(S) 4-Bromofluorobenzene	92.8			67.0-138
(S) 1,2-Dichloroethane-d4	99.7			70.0-130

¹ Cp

² Tc

³ Ss

⁴ Cn

⁵ Sr

⁶ Qc

⁷ Is

⁸ Gl

⁹ Al

¹⁰ Sc

Laboratory Control Sample (LCS)

(LCS) R3723968-1 10/26/21 04:38

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	LCS Qualifier
Acetone	0.625	0.526	84.2	10.0-160	
Acrylonitrile	0.625	0.563	90.1	45.0-153	
Benzene	0.125	0.105	84.0	70.0-123	
Bromobenzene	0.125	0.123	98.4	73.0-121	
Bromodichloromethane	0.125	0.109	87.2	73.0-121	

Laboratory Control Sample (LCS)

(LCS) R3723968-1 10/26/21 04:38

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Bromoform	0.125	0.123	98.4	64.0-132	
Bromomethane	0.125	0.102	81.6	56.0-147	
n-Butylbenzene	0.125	0.121	96.8	68.0-135	
sec-Butylbenzene	0.125	0.126	101	74.0-130	
tert-Butylbenzene	0.125	0.129	103	75.0-127	
Carbon tetrachloride	0.125	0.101	80.8	66.0-128	
Chlorobenzene	0.125	0.118	94.4	76.0-128	
Chlorodibromomethane	0.125	0.125	100	74.0-127	
Chloroethane	0.125	0.106	84.8	61.0-134	
Chloroform	0.125	0.106	84.8	72.0-123	
Chloromethane	0.125	0.0886	70.9	51.0-138	
2-Chlorotoluene	0.125	0.132	106	75.0-124	
4-Chlorotoluene	0.125	0.132	106	75.0-124	
1,2-Dibromo-3-Chloropropane	0.125	0.132	106	59.0-130	
1,2-Dibromoethane	0.125	0.125	100	74.0-128	
Dibromomethane	0.125	0.108	86.4	75.0-122	
1,2-Dichlorobenzene	0.125	0.130	104	76.0-124	
1,3-Dichlorobenzene	0.125	0.126	101	76.0-125	
1,4-Dichlorobenzene	0.125	0.128	102	77.0-121	
Dichlorodifluoromethane	0.125	0.116	92.8	43.0-156	
1,1-Dichloroethane	0.125	0.104	83.2	70.0-127	
1,2-Dichloroethane	0.125	0.113	90.4	65.0-131	
1,1-Dichloroethene	0.125	0.0938	75.0	65.0-131	
cis-1,2-Dichloroethene	0.125	0.106	84.8	73.0-125	
trans-1,2-Dichloroethene	0.125	0.104	83.2	71.0-125	
1,2-Dichloropropane	0.125	0.110	88.0	74.0-125	
1,1-Dichloropropene	0.125	0.105	84.0	73.0-125	
1,3-Dichloropropane	0.125	0.120	96.0	80.0-125	
cis-1,3-Dichloropropene	0.125	0.114	91.2	76.0-127	
trans-1,3-Dichloropropene	0.125	0.128	102	73.0-127	
2,2-Dichloropropane	0.125	0.0853	68.2	59.0-135	
Di-isopropyl ether	0.125	0.101	80.8	60.0-136	
Ethylbenzene	0.125	0.118	94.4	74.0-126	
Hexachloro-1,3-butadiene	0.125	0.139	111	57.0-150	
Isopropylbenzene	0.125	0.121	96.8	72.0-127	
p-Isopropyltoluene	0.125	0.130	104	72.0-133	
2-Butanone (MEK)	0.625	0.605	96.8	30.0-160	
Methylene Chloride	0.125	0.102	81.6	68.0-123	
4-Methyl-2-pentanone (MIBK)	0.625	0.645	103	56.0-143	
Methyl tert-butyl ether	0.125	0.105	84.0	66.0-132	

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS)

(LCS) R3723968-1 10/26/21 04:38

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Naphthalene	0.125	0.119	95.2	59.0-130	
n-Propylbenzene	0.125	0.124	99.2	74.0-126	
Styrene	0.125	0.130	104	72.0-127	
1,1,1,2-Tetrachloroethane	0.125	0.118	94.4	74.0-129	
1,1,2,2-Tetrachloroethane	0.125	0.109	87.2	68.0-128	
Tetrachloroethene	0.125	0.117	93.6	70.0-136	
Toluene	0.125	0.118	94.4	75.0-121	
1,1,2-Trichlorotrifluoroethane	0.125	0.0900	72.0	61.0-139	
1,2,3-Trichlorobenzene	0.125	0.138	110	59.0-139	
1,2,4-Trichlorobenzene	0.125	0.133	106	62.0-137	
1,1,1-Trichloroethane	0.125	0.103	82.4	69.0-126	
1,1,2-Trichloroethane	0.125	0.121	96.8	78.0-123	
Trichloroethene	0.125	0.110	88.0	76.0-126	
Trichlorofluoromethane	0.125	0.0860	68.8	61.0-142	
1,2,3-Trichloropropane	0.125	0.123	98.4	67.0-129	
1,2,3-Trimethylbenzene	0.125	0.126	101	74.0-124	
1,2,4-Trimethylbenzene	0.125	0.129	103	70.0-126	
1,3,5-Trimethylbenzene	0.125	0.129	103	73.0-127	
Vinyl chloride	0.125	0.0956	76.5	63.0-134	
Xylenes, Total	0.375	0.369	98.4	72.0-127	
(S) Toluene-d8			112	75.0-131	
(S) 4-Bromofluorobenzene			98.0	67.0-138	
(S) 1,2-Dichloroethane-d4			106	70.0-130	

1 Cp
2 Tc
3 Ss
4 Cn
5 Sr
6 Qc
7 Is
8 Gl
9 Al
10 Sc

L1421071-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-01 10/26/21 13:18 • (MS) R3723968-3 10/26/21 16:32 • (MSD) R3723968-4 10/26/21 16:51

Analyte	Spike Amount (dry) mg/kg	Original Result (dry) mg/kg	MS Result (dry) mg/kg	MSD Result (dry) mg/kg	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Acetone	0.755	U	0.165	0.144	21.8	19.0	1	10.0-160			13.4	40
Acrylonitrile	0.755	U	0.525	0.473	69.5	62.6	1	10.0-160			10.4	40
Benzene	0.152	0.00527	0.129	0.0680	81.7	41.4	1	10.0-149		U3	62.0	37
Bromobenzene	0.152	U	0.176	0.126	116	82.9	1	10.0-156			33.5	38
Bromodichloromethane	0.152	U	0.125	0.0864	82.7	57.0	1	10.0-143			36.8	37
Bromoform	0.152	U	0.139	0.123	91.5	81.0	1	10.0-146			12.1	36
Bromomethane	0.152	U	0.0890	0.0429	58.7	28.3	1	10.0-149		U3	69.9	38
n-Butylbenzene	0.152	0.00877	0.161	0.0793	100	46.5	1	10.0-160		U3	67.8	40
sec-Butylbenzene	0.152	U	0.163	0.0680	108	44.9	1	10.0-159		U3	82.4	39
tert-Butylbenzene	0.152	U	0.168	0.0736	111	48.5	1	10.0-156		U3	78.4	39

L1421071-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-01 10/26/21 13:18 • (MS) R3723968-3 10/26/21 16:32 • (MSD) R3723968-4 10/26/21 16:51

Analyte	Spike Amount (dry) mg/kg	Original Result (dry) mg/kg	MS Result (dry) mg/kg	MSD Result (dry) mg/kg	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Carbon tetrachloride	0.152	U	0.111	0.0350	73.4	23.1	1	10.0-145		J3	104	37
Chlorobenzene	0.152	U	0.140	0.0857	92.3	56.5	1	10.0-152		J3	48.1	39
Chlorodibromomethane	0.152	U	0.152	0.121	100	79.6	1	10.0-146			22.8	37
Chloroethane	0.152	U	0.0745	0.0349	49.1	23.0	1	10.0-146		J3	72.5	40
Chloroform	0.152	U	0.120	0.0683	79.1	45.0	1	10.0-146		J3	54.8	37
Chloromethane	0.152	U	0.105	0.0439	69.5	29.0	1	10.0-159		J3	82.3	37
2-Chlorotoluene	0.152	U	0.172	0.0952	114	62.8	1	10.0-159		J3	57.6	38
4-Chlorotoluene	0.152	U	0.156	0.109	103	72.1	1	10.0-155			34.8	39
1,2-Dibromo-3-Chloropropane	0.152	U	0.154	0.143	102	94.0	1	10.0-151			7.86	39
1,2-Dibromoethane	0.152	U	0.163	0.141	108	93.2	1	10.0-148			14.5	34
Dibromomethane	0.152	U	0.130	0.102	85.5	67.1	1	10.0-147			24.1	35
1,2-Dichlorobenzene	0.152	U	0.159	0.115	105	75.8	1	10.0-155			32.4	37
1,3-Dichlorobenzene	0.152	U	0.156	0.102	103	67.3	1	10.0-153		J3	41.6	38
1,4-Dichlorobenzene	0.152	U	0.158	0.108	104	70.9	1	10.0-151			38.0	38
Dichlorodifluoromethane	0.152	U	0.132	0.0271	87.2	17.9	1	10.0-160		J3	132	35
1,1-Dichloroethane	0.152	U	0.118	0.0609	77.9	40.2	1	10.0-147		J3	64.0	37
1,2-Dichloroethane	0.152	U	0.135	0.102	88.9	67.3	1	10.0-148			27.7	35
1,1-Dichloroethene	0.152	U	0.0982	0.0333	64.8	22.0	1	10.0-155		J3	98.7	37
cis-1,2-Dichloroethene	0.152	U	0.121	0.0666	79.8	43.9	1	10.0-149		J3	58.0	37
trans-1,2-Dichloroethene	0.152	U	0.113	0.0508	74.3	33.5	1	10.0-150		J3	75.7	37
1,2-Dichloropropane	0.152	U	0.131	0.0828	86.3	54.6	1	10.0-148		J3	45.0	37
1,1-Dichloropropene	0.152	U	0.116	0.0409	76.6	27.0	1	10.0-153		J3	95.7	35
1,3-Dichloropropane	0.152	U	0.167	0.137	110	90.6	1	10.0-154			19.6	35
cis-1,3-Dichloropropene	0.152	U	0.140	0.0990	92.3	65.3	1	10.0-151			34.3	37
trans-1,3-Dichloropropene	0.152	U	0.172	0.140	114	92.3	1	10.0-148			20.7	37
2,2-Dichloropropane	0.152	U	0.0908	0.0319	59.9	21.0	1	10.0-138		J3	96.1	36
Di-isopropyl ether	0.152	U	0.126	0.0835	82.8	55.0	1	10.0-147		J3	40.3	36
Ethylbenzene	0.152	0.0172	0.165	0.0963	97.2	52.1	1	10.0-160		J3	52.4	38
Hexachloro-1,3-butadiene	0.152	U	0.189	0.0746	125	49.2	1	10.0-160		J3	86.8	40
Isopropylbenzene	0.152	0.00503	0.136	0.0641	86.4	39.0	1	10.0-155		J3	71.8	38
p-Isopropyltoluene	0.152	0.0152	0.190	0.0978	116	54.5	1	10.0-160		J3	64.3	40
2-Butanone (MEK)	0.755	U	0.695	0.584	91.9	77.4	1	10.0-160			17.2	40
Methylene Chloride	0.152	U	0.116	0.0310	76.8	20.4	1	10.0-141		J3	116	37
4-Methyl-2-pentanone (MIBK)	0.755	0.0174	0.864	0.851	112	110	1	10.0-160			1.51	35
Methyl tert-butyl ether	0.152	U	0.123	0.0965	80.9	63.7	1	11.0-147			23.8	35
Naphthalene	0.152	0.0577	0.272	0.246	141	124	1	10.0-160			10.0	36
n-Propylbenzene	0.152	0.00566	0.174	0.0832	111	51.1	1	10.0-158		J3	70.4	38
Styrene	0.152	U	0.146	0.0897	96.6	59.1	1	10.0-160		J3	48.1	40
1,1,1,2-Tetrachloroethane	0.152	U	0.141	0.0951	93.2	62.7	1	10.0-149			39.0	39

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

L1421071-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-01 10/26/21 13:18 • (MS) R3723968-3 10/26/21 16:32 • (MSD) R3723968-4 10/26/21 16:51

Analyte	Spike Amount (dry) mg/kg	Original Result (dry) mg/kg	MS Result (dry) mg/kg	MSD Result (dry) mg/kg	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,2,2-Tetrachloroethane	0.152	U	0.176	0.159	116	105	1	10.0-160			10.0	35
Tetrachloroethene	0.152	U	0.137	0.0559	90.6	36.8	1	10.0-156		J3	84.4	39
Toluene	0.152	0.0610	0.223	0.153	107	60.6	1	10.0-156			37.2	38
1,1,2-Trichlorotrifluoroethane	0.152	U	0.107	0.0245	70.5	16.2	1	10.0-160		J3	125	36
1,2,3-Trichlorobenzene	0.152	U	0.215	0.159	142	105	1	10.0-160			29.8	40
1,2,4-Trichlorobenzene	0.152	U	0.172	0.120	114	79.1	1	10.0-160			35.8	40
1,1,1-Trichloroethane	0.152	U	0.113	0.0362	74.5	23.8	1	10.0-144		J3	103	35
1,1,2-Trichloroethane	0.152	U	0.170	0.144	112	94.9	1	10.0-160			16.5	35
Trichloroethene	0.152	U	0.117	0.0534	77.1	35.2	1	10.0-156		J3	74.6	38
Trichlorofluoromethane	0.152	U	0.0536	0.0175	35.4	11.5	1	10.0-160		J3	102	40
1,2,3-Trichloropropane	0.152	U	0.188	0.179	124	118	1	10.0-156			4.95	35
1,2,3-Trimethylbenzene	0.152	0.0426	0.224	0.165	120	80.4	1	10.0-160			30.7	36
1,2,4-Trimethylbenzene	0.152	0.0485	0.241	0.167	127	78.3	1	10.0-160		J3	36.2	36
1,3,5-Trimethylbenzene	0.152	0.0122	0.185	0.103	114	59.8	1	10.0-160		J3	57.2	38
Vinyl chloride	0.152	U	0.116	0.0376	76.7	24.8	1	10.0-160		J3	102	37
Xylenes, Total	0.452	0.112	0.591	0.386	106	60.7	1	10.0-160		J3	41.9	38
(S) Toluene-d8					123	124		75.0-131				
(S) 4-Bromofluorobenzene					89.4	87.8		67.0-138				
(S) 1,2-Dichloroethane-d4					106	101		70.0-130				

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Method Blank (MB)

(MB) R3722694-1 10/28/21 10:38

Analyte	MB Result mg/kg	MB Qualifier	MB MDL mg/kg	MB RDL mg/kg
Diesel Range Organics (DRO)	U		1.33	4.00
Residual Range Organics (RRO)	U		3.33	10.0
<i>(S) o-Terphenyl</i>	52.9			18.0-148

Laboratory Control Sample (LCS)

(LCS) R3722694-2 10/28/21 10:51

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	LCS Qualifier
Diesel Range Organics (DRO)	50.0	34.4	68.8	50.0-150	
<i>(S) o-Terphenyl</i>			51.8	18.0-148	

L1421083-23 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421083-23 10/28/21 12:40 • (MS) R3722694-3 10/28/21 12:54 • (MSD) R3722694-4 10/28/21 13:07

Analyte	Spike Amount (dry) mg/kg	Original Result (dry) mg/kg	MS Result (dry) mg/kg	MSD Result (dry) mg/kg	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Diesel Range Organics (DRO)	54.9	358	276	534	0.000	320	1	50.0-150	V	E J3 V	63.9	20
<i>(S) o-Terphenyl</i>					77.8	69.4		18.0-148				

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Method Blank (MB)

(MB) R3723840-1 10/30/21 00:02

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Diesel Range Organics (DRO)	U		66.7	200
Residual Range Organics (RRO)	U		83.3	250
<i>(S) o-Terphenyl</i>	102			52.0-156

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3723840-2 10/30/21 00:22 • (LCSD) R3723840-3 10/30/21 00:42

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Diesel Range Organics (DRO)	1500	1620	1520	108	101	50.0-150			6.37	20
<i>(S) o-Terphenyl</i>				69.0	85.0	52.0-156				

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3723124-1 10/29/21 08:00

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Diesel Range Organics (DRO)	U		66.7	200
Residual Range Organics (RRO)	U		83.3	250
<i>(S) o-Terphenyl</i>	108			52.0-156

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3723124-2 10/29/21 08:21 • (LCSD) R3723124-3 10/29/21 08:42

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Diesel Range Organics (DRO)	1500	1710	1720	114	115	50.0-150			0.583	20
<i>(S) o-Terphenyl</i>				135	138	52.0-156				

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3720580-1 10/24/21 04:44

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	ug/l		ug/l	ug/l
PCB 1260	U		0.173	0.500
PCB 1016	U		0.270	0.500
PCB 1221	U		0.270	0.500
PCB 1232	U		0.270	0.500
PCB 1242	U		0.270	0.500
PCB 1248	U		0.173	0.500
PCB 1254	U		0.173	0.500
(S) Decachlorobiphenyl	62.4			10.0-128
(S) Tetrachloro-m-xylene	80.3			10.0-127

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3720580-2 10/24/21 04:53 • (LCSD) R3720580-3 10/24/21 05:02

Analyte	Spike Amount	LCS Result	LCSD Result	LCS Rec.	LCSD Rec.	Rec. Limits	LCS Qualifier	LCSD Qualifier	RPD	RPD Limits
	ug/l	ug/l	ug/l	%	%	%			%	%
PCB 1260	2.50	2.17	2.07	86.8	82.8	42.0-131			4.72	25
PCB 1016	2.50	3.22	2.92	129	117	36.0-135	P		9.77	29
(S) Decachlorobiphenyl				63.8	59.3	10.0-128				
(S) Tetrachloro-m-xylene				82.1	80.4	10.0-127				

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3722529-1 10/27/21 21:24

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	mg/kg		mg/kg	mg/kg
PCB 1016	U		0.0118	0.0340
PCB 1221	U		0.0118	0.0340
PCB 1232	U		0.0118	0.0340
PCB 1242	U		0.0118	0.0340
PCB 1248	U		0.00738	0.0170
PCB 1254	U		0.00738	0.0170
PCB 1260	U		0.00738	0.0170
(S) Decachlorobiphenyl	66.4			10.0-135
(S) Tetrachloro-m-xylene	80.9			10.0-139

Laboratory Control Sample (LCS)

(LCS) R3722529-2 10/27/21 21:32

Analyte	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
	mg/kg	mg/kg	%	%	
PCB 1260	0.167	0.164	98.2	37.0-145	
PCB 1016	0.167	0.163	97.6	36.0-141	
(S) Decachlorobiphenyl			78.2	10.0-135	
(S) Tetrachloro-m-xylene			93.5	10.0-139	

L1421240-07 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421240-07 10/28/21 00:01 • (MS) R3722529-3 10/28/21 00:10 • (MSD) R3722529-4 10/28/21 00:18

Analyte	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
	mg/kg	mg/kg	mg/kg	mg/kg	%	%		%			%	%
PCB 1260	0.167	U	0.261	0.316	156	189	1	10.0-160	P	J5	19.1	38
PCB 1016	0.167	U	5.50	2.80	3290	1680	1	10.0-160	J5 P	J3 J5 P	65.1	37
(S) Decachlorobiphenyl					68.5	73.7		10.0-135				
(S) Tetrachloro-m-xylene					81.1	87.8		10.0-139				



Method Blank (MB)

(MB) R3721626-3 10/26/21 08:20

Analyte	MB Result ug/l	MB Qualifier	MB MDL ug/l	MB RDL ug/l
Anthracene	U		0.0190	0.0500
Acenaphthene	U		0.0190	0.0500
Acenaphthylene	U		0.0171	0.0500
Benzo(a)anthracene	U		0.0203	0.0500
Benzo(a)pyrene	U		0.0184	0.0500
Benzo(b)fluoranthene	U		0.0168	0.0500
Benzo(g,h,i)perylene	U		0.0184	0.0500
Benzo(k)fluoranthene	U		0.0202	0.0500
Chrysene	U		0.0179	0.0500
Dibenz(a,h)anthracene	U		0.0160	0.0500
Fluoranthene	U		0.0270	0.100
Fluorene	U		0.0169	0.0500
Indeno(1,2,3-cd)pyrene	U		0.0158	0.0500
Naphthalene	U		0.0917	0.250
Phenanthrene	U		0.0180	0.0500
Pyrene	U		0.0169	0.0500
1-Methylnaphthalene	U		0.0687	0.250
2-Methylnaphthalene	U		0.0674	0.250
2-Chloronaphthalene	U		0.0682	0.250
(S) Nitrobenzene-d5	73.0			31.0-160
(S) 2-Fluorobiphenyl	108			48.0-148
(S) p-Terphenyl-d14	109			37.0-146



Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3721626-1 10/26/21 07:44 • (LCSD) R3721626-2 10/26/21 08:02

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Anthracene	2.00	2.09	2.11	104	105	67.0-150			0.952	20
Acenaphthene	2.00	1.98	2.07	99.0	104	65.0-138			4.44	20
Acenaphthylene	2.00	2.14	2.23	107	111	66.0-140			4.12	20
Benzo(a)anthracene	2.00	1.92	1.76	96.0	88.0	61.0-140			8.70	20
Benzo(a)pyrene	2.00	1.80	1.51	90.0	75.5	60.0-143			17.5	20
Benzo(b)fluoranthene	2.00	1.76	1.55	88.0	77.5	58.0-141			12.7	20
Benzo(g,h,i)perylene	2.00	1.65	1.31	82.5	65.5	52.0-153		J3	23.0	20
Benzo(k)fluoranthene	2.00	1.76	1.43	88.0	71.5	58.0-148		J3	20.7	20
Chrysene	2.00	1.91	1.70	95.5	85.0	64.0-144			11.6	20
Dibenz(a,h)anthracene	2.00	1.68	1.33	84.0	66.5	52.0-155		J3	23.3	20
Fluoranthene	2.00	2.20	2.17	110	108	69.0-153			1.37	20

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3721626-1 10/26/21 07:44 • (LCSD) R3721626-2 10/26/21 08:02

Analyte	Spike Amount ug/l	LCS Result ug/l	LCSD Result ug/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Fluorene	2.00	2.12	2.26	106	113	64.0-136			6.39	20
Indeno(1,2,3-cd)pyrene	2.00	1.69	1.36	84.5	68.0	54.0-153		J3	21.6	20
Naphthalene	2.00	1.95	2.07	97.5	104	61.0-137			5.97	20
Phenanthrene	2.00	2.06	2.08	103	104	62.0-137			0.966	20
Pyrene	2.00	1.88	1.86	94.0	93.0	60.0-142			1.07	20
1-Methylnaphthalene	2.00	2.18	2.27	109	114	66.0-142			4.04	20
2-Methylnaphthalene	2.00	2.00	2.18	100	109	62.0-136			8.61	20
2-Chloronaphthalene	2.00	1.93	2.07	96.5	104	64.0-140			7.00	20
(S) Nitrobenzene-d5				45.5	72.0	31.0-160				
(S) 2-Fluorobiphenyl				102	106	48.0-148				
(S) p-Terphenyl-d14				107	93.0	37.0-146				

L1420670-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1420670-01 10/26/21 15:27 • (MS) R3721626-4 10/26/21 15:45 • (MSD) R3721626-5 10/26/21 16:03

Analyte	Spike Amount ug/l	Original Result ug/l	MS Result ug/l	MSD Result ug/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Anthracene	2.00	U	2.09	2.08	104	104	1	56.0-156			0.480	20
Acenaphthene	2.00	U	2.03	1.95	102	97.5	1	44.0-153			4.02	20
Acenaphthylene	2.00	U	2.19	2.11	109	105	1	53.0-150			3.72	20
Benzo(a)anthracene	2.00	U	1.91	1.99	95.5	99.5	1	47.0-151			4.10	20
Benzo(a)pyrene	2.00	U	1.73	1.84	86.5	92.0	1	45.0-146			6.16	20
Benzo(b)fluoranthene	2.00	U	1.69	1.76	84.5	88.0	1	43.0-142			4.06	20
Benzo(g,h,i)perylene	2.00	U	1.60	1.76	80.0	88.0	1	40.0-147			9.52	20
Benzo(k)fluoranthene	2.00	U	1.73	1.83	86.5	91.5	1	43.0-148			5.62	21
Chrysene	2.00	U	1.89	1.98	94.5	99.0	1	50.0-148			4.65	20
Dibenz(a,h)anthracene	2.00	U	1.60	1.74	80.0	87.0	1	37.0-151			8.38	20
Fluoranthene	2.00	U	2.20	2.22	110	111	1	56.0-157			0.905	20
Fluorene	2.00	U	2.14	2.12	107	106	1	48.0-148			0.939	20
Indeno(1,2,3-cd)pyrene	2.00	U	1.61	1.71	80.5	85.5	1	41.0-148			6.02	20
Naphthalene	2.00	U	1.99	1.94	99.5	97.0	1	10.0-160			2.54	20
Phenanthrene	2.00	U	2.02	1.97	101	98.5	1	47.0-147			2.51	20
Pyrene	2.00	U	1.86	1.89	93.0	94.5	1	51.0-148			1.60	20
1-Methylnaphthalene	2.00	U	2.19	2.17	109	108	1	21.0-160			0.917	20
2-Methylnaphthalene	2.00	U	2.09	2.06	104	103	1	31.0-160			1.45	20
2-Chloronaphthalene	2.00	U	1.97	1.93	98.5	96.5	1	52.0-148			2.05	20
(S) Nitrobenzene-d5					69.0	69.5		31.0-160				
(S) 2-Fluorobiphenyl					103	99.0		48.0-148				
(S) p-Terphenyl-d14					103	110		37.0-146				

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Method Blank (MB)

(MB) R3722772-2 10/28/21 13:05

Analyte	MB Result mg/kg	MB Qualifier	MB MDL mg/kg	MB RDL mg/kg
Anthracene	U		0.00230	0.00600
Acenaphthene	U		0.00209	0.00600
Acenaphthylene	U		0.00216	0.00600
Benzo(a)anthracene	U		0.00173	0.00600
Benzo(a)pyrene	U		0.00179	0.00600
Benzo(b)fluoranthene	U		0.00153	0.00600
Benzo(g,h,i)perylene	U		0.00177	0.00600
Benzo(k)fluoranthene	U		0.00215	0.00600
Chrysene	U		0.00232	0.00600
Dibenz(a,h)anthracene	U		0.00172	0.00600
Fluoranthene	U		0.00227	0.00600
Fluorene	U		0.00205	0.00600
Indeno(1,2,3-cd)pyrene	U		0.00181	0.00600
Naphthalene	U		0.00408	0.0200
Phenanthrene	U		0.00231	0.00600
Pyrene	U		0.00200	0.00600
1-Methylnaphthalene	U		0.00449	0.0200
2-Methylnaphthalene	U		0.00427	0.0200
2-Chloronaphthalene	U		0.00466	0.0200
(S) Nitrobenzene-d5	91.6			14.0-149
(S) 2-Fluorobiphenyl	92.1			34.0-125
(S) p-Terphenyl-d14	106			23.0-120

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Laboratory Control Sample (LCS)

(LCS) R3722772-1 10/28/21 12:48

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	LCS Qualifier
Anthracene	0.0800	0.0628	78.5	50.0-126	
Acenaphthene	0.0800	0.0619	77.4	50.0-120	
Acenaphthylene	0.0800	0.0662	82.8	50.0-120	
Benzo(a)anthracene	0.0800	0.0627	78.4	45.0-120	
Benzo(a)pyrene	0.0800	0.0549	68.6	42.0-120	
Benzo(b)fluoranthene	0.0800	0.0581	72.6	42.0-121	
Benzo(g,h,i)perylene	0.0800	0.0562	70.3	45.0-125	
Benzo(k)fluoranthene	0.0800	0.0584	73.0	49.0-125	
Chrysene	0.0800	0.0593	74.1	49.0-122	
Dibenz(a,h)anthracene	0.0800	0.0604	75.5	47.0-125	
Fluoranthene	0.0800	0.0622	77.8	49.0-129	

Laboratory Control Sample (LCS)

(LCS) R3722772-1 10/28/21 12:48

Analyte	Spike Amount mg/kg	LCS Result mg/kg	LCS Rec. %	Rec. Limits %	LCS Qualifier
Fluorene	0.0800	0.0623	77.9	49.0-120	
Indeno(1,2,3-cd)pyrene	0.0800	0.0621	77.6	46.0-125	
Naphthalene	0.0800	0.0562	70.3	50.0-120	
Phenanthrene	0.0800	0.0588	73.5	47.0-120	
Pyrene	0.0800	0.0565	70.6	43.0-123	
1-Methylnaphthalene	0.0800	0.0616	77.0	51.0-121	
2-Methylnaphthalene	0.0800	0.0605	75.6	50.0-120	
2-Chloronaphthalene	0.0800	0.0619	77.4	50.0-120	
(S) Nitrobenzene-d5			91.7	14.0-149	
(S) 2-Fluorobiphenyl			90.0	34.0-125	
(S) p-Terphenyl-d14			98.3	23.0-120	

L1421071-07 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1421071-07 10/28/21 14:16 • (MS) R3722772-3 10/28/21 14:34 • (MSD) R3722772-4 10/28/21 14:52

Analyte	Spike Amount (dry) mg/kg	Original Result (dry) mg/kg	MS Result (dry) mg/kg	MSD Result (dry) mg/kg	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Anthracene	0.101	0.00634	0.0634	0.0704	56.4	63.3	1	10.0-145			10.4	30
Acenaphthene	0.101	0.00547	0.0653	0.0687	59.0	62.5	1	14.0-127			5.21	27
Acenaphthylene	0.101	U	0.0658	0.0712	64.9	70.3	1	21.0-124			7.92	25
Benzo(a)anthracene	0.101	0.0131	0.0691	0.0761	55.4	62.2	1	10.0-139			9.61	30
Benzo(a)pyrene	0.101	0.00779	0.0605	0.0686	52.0	60.0	1	10.0-141			12.6	31
Benzo(b)fluoranthene	0.101	0.0136	0.0651	0.0726	50.9	58.3	1	10.0-140			10.9	36
Benzo(g,h,i)perylene	0.101	0.00681	0.0569	0.0660	49.4	58.5	1	10.0-140			14.9	33
Benzo(k)fluoranthene	0.101	0.00293	0.0584	0.0662	54.8	62.4	1	10.0-137			12.4	31
Chrysene	0.101	0.0176	0.0757	0.0775	57.4	59.2	1	10.0-145			2.36	30
Dibenz(a,h)anthracene	0.101	U	0.0602	0.0690	59.4	68.1	1	10.0-132			13.6	31
Fluoranthene	0.101	0.0194	0.0709	0.0773	50.9	57.1	1	10.0-153			8.54	33
Fluorene	0.101	0.00830	0.0702	0.0743	61.1	65.2	1	11.0-130			5.72	29
Indeno(1,2,3-cd)pyrene	0.101	0.00655	0.0605	0.0704	53.2	63.0	1	10.0-137			15.2	32
Naphthalene	0.101	0.105	0.117	0.109	12.0	3.83	1	10.0-135		J6	7.31	27
Phenanthrene	0.101	0.0817	0.123	0.115	41.2	32.8	1	10.0-144			7.16	31
Pyrene	0.101	0.0203	0.0663	0.0721	45.4	51.1	1	10.0-148			8.40	35
1-Methylnaphthalene	0.101	0.138	0.169	0.143	30.6	5.10	1	10.0-142		J6	16.5	28
2-Methylnaphthalene	0.101	0.195	0.207	0.169	11.5	0.000	1	10.0-137		J6	19.9	28
2-Chloronaphthalene	0.101	U	0.0632	0.0673	62.4	66.5	1	29.0-120			6.34	24
(S) Nitrobenzene-d5					76.9	83.6		14.0-149				
(S) 2-Fluorobiphenyl					74.2	82.3		34.0-125				
(S) p-Terphenyl-d14					84.6	93.4		23.0-120				

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

INTERNAL STANDARD SUMMARY

Instrument: VOCMS58 • File ID: 1025_36-1

10/26/21 02:04

Sample ID	File ID	8260-FLUOROBENZENE Response	8260-CHLOROBENZENE-D5 Response	8260-1,4-DICHLOROBENZENE-D4 Response
Standard	1025_36-1	562626.50	266611.20	215894.90
Upper Limit		1125253	533222	431790
Lower Limit		281313	133306	107947
LCS R3724543-1 WG1763302 1x	1025_36LCS	562626.50	266611.20	215894.90
LCSD R3724543-2 WG1763302 1x	1025_37	555496	259893.60	194077.80
BLANK R3724543-3 WG1763302 1x	1025_40	501722.20	233107.60	192179.70
L1421071-17 WG1763302 1x	1025_41	491301.90	226919.70	175617

Instrument: VOCMS59 • File ID: 1022a_28-2

10/22/21 22:11

Sample ID	File ID	8260-FLUOROBENZENE Response	8260-CHLOROBENZENE-D5 Response	8260-1,4-DICHLOROBENZENE-D4 Response
Standard	1022a_28-2	621224.50	260979.50	256938.70
Upper Limit		1242449	521959	513877
Lower Limit		310612	130490	128469
LCS R3725266-1 WG1761975 1x	1022a_28LCS	621224.50	260979.50	256938.70
LCSD R3725266-2 WG1761975 1x	1022a_29	643400.80	293567.10	269930.60
BLANK R3725266-3 WG1761975 1x	1022a_32	591368	262465.70	258706.30
L1421071-11 WG1761975 1x	1022a_34	603030	260145	243021.20
L1421071-12 WG1761975 1x	1022a_48	469663	210950.80	207607.70
L1421071-13 WG1761975 1x	1022a_49	492868.20	230309.10	210181.70
L1421071-14 WG1761975 1x	1022a_50	528796.50	230604	201763.60
L1421071-15 WG1761975 1x	1022a_51	518008.20	215986.60	221914.60
L1421071-16 WG1761975 1x	1022a_52	507486.90	235047.50	227533.90

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

INTERNAL STANDARD SUMMARY

Instrument: VOCMS37 • File ID: 1026_03-1

10/26/21 04:38

Sample ID	File ID	8260-FLUOROBENZENE Response	8260-CHLOROBENZENE-D5 Response	8260-1,4-DICHLOROBENZENE-D4 Response
Standard	1026_03-1	860495.10	382052.90	309904.10
Upper Limit		1720990	764106	619808
Lower Limit		430248	191026	154952
LCS R3723968-1 WG1763431 1x	1026_03LCS	860495.10	382052.90	309904.10
BLANK R3723968-2 WG1763431 1x	1026_06	812733.30	312459.20	206230.20
L1421071-01 WG1763431 1x	1026_19	860818.50	337677.10	210887.70
L1421071-02 WG1763431 1x	1026_20	832543.60	329451.50	215750.70
L1421071-03 WG1763431 1.13x	1026_21	797457.40	309525.10	193666.80
L1421071-04 WG1763431 1x	1026_22	775602.50	310760.70	194935.10
L1421071-05 WG1763431 1x	1026_23	763778.50	302851.60	181612
L1421071-06 WG1763431 1x	1026_24	815103.20	325035	216296.70
L1421071-07 WG1763431 1.23x	1026_25	773452.80	300917.20	185085.10
L1421071-08 WG1763431 1x	1026_26	811834.80	317776	207038.30
L1421071-09 WG1763431 1x	1026_27	788402	311029.60	185621
L1421071-10 WG1763431 1x	1026_28	804028	318298	207684.70
MS R3723968-3 WG1763431 1x	1026_29	776145.10	310128.60	195823.40
MSD R3723968-4 WG1763431 1x	1026_30	804858.30	313181.30	191558.70

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

INTERNAL STANDARD SUMMARY

Instrument: SVGC30 • File ID: AVG

Sample ID	File ID	1-BROMO-2-DINITROBENZENE Response
Standard	AVG	1802134286
Upper Limit		2703201000
Lower Limit		901067000
BLANK R3720580-1 WG1761898 1x	1023_48	2088156000
LCS R3720580-2 WG1761898 1x	1023_49	2214956000
LCSD R3720580-3 WG1761898 1x	1023_50	2281437000
L1421071-14 WG1761898 1x	1023_60	2185046000
L1421071-16 WG1761898 1x	1023_68	2261502000

- ¹Cp
- ²Tc
- ³Ss
- ⁴Cn
- ⁵Sr
- ⁶Qc
- ⁷Is
- ⁸Gl
- ⁹Al
- ¹⁰Sc

INTERNAL STANDARD SUMMARY

Instrument: SVGC29 • File ID: AVG

Sample ID	File ID	1-BROMO-2-DINITROBENZENE Response
Standard	AVG	914368714
Upper Limit		1371553000
Lower Limit		457184400
BLANK R3722529-1 WG1764102 1x	1027A_09	817581800
LCS R3722529-2 WG1764102 1x	1027A_10	817003500
L1421071-08 WG1764102 1x	1027A_14	855029500
L1421071-09 WG1764102 1x	1027A_15	886713300
L1421071-10 WG1764102 1x	1027A_16	849686700
MS R3722529-3 WG1764102 1x	1027A_28	856192300
MSD R3722529-4 WG1764102 1x	1027A_29	874249300

- ¹Cp
- ²Tc
- ³Ss
- ⁴Cn
- ⁵Sr
- ⁶Qc
- ⁷Is
- ⁸Gl
- ⁹Al
- ¹⁰Sc

INTERNAL STANDARD SUMMARY

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Instrument: BNAMS25 • File ID: 1028_03

10/28/21 11:35

Sample ID	File ID	NAPHTHALENE-D8 Response	ACENAPHTHENE-D10 Response	PHENANTHRENE-D10 Response	CHRYSENE-D12 Response	PERYLENE-D12 Response
Standard	1028_03	114785	67203	124893	108646	107206
Upper Limit		229570	134406	249786	217292	214412
Lower Limit		57393	33602	62447	54323	53603
LCS R3722772-1 WG1764422 1x	1028_04	125170	71555	132127	116419	113271
BLANK R3722772-2 WG1764422 1x	1028_05	117354	69228	126651	109335	102486
L1421071-01 WG1764422 1x	1028_06	126827	75621	140387	122877	120091
L1421071-03 WG1764422 1x	1028_07	123867	72429	135177	119936	118022
L1421071-05 WG1764422 1x	1028_08	121350	72597	138301	120063	116959
L1421071-07 WG1764422 1x	1028_09	123423	74229	138401	120307	119457
MS R3722772-3 WG1764422 1x	1028_10	123596	72898	135149	118760	115543
MSD R3722772-4 WG1764422 1x	1028_11	120410	70287	132506	115561	110791
L1421071-09 WG1764422 1x	1028_12	125909	73501	135543	116029	103738

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

ACCOUNT:

Maul Foster & Alongi- Coeur d Alene, ID

PROJECT:

0457.02.03

SDG:

L1421071

DATE/TIME:

11/08/21 10:22

PAGE:

87 of 93

INTERNAL STANDARD SUMMARY

Semi Volatile Organic Compounds (GC/MS) by Method 8270E-SIM

Instrument: BNAMS13 • File ID: 1026_03

10/26/21 06:39

Sample ID	File ID	NAPHTHALENE-D8 Response	ACENAPHTHENE-D10 Response	PHENANTHRENE-D10 Response	CHRYSENE-D12 Response	PERYLENE-D12 Response
Standard	1026_03	49642	25766	43972	35702	28073
Upper Limit		99284	51532	87944	71404	56146
Lower Limit		24821	12883	21986	17851	14037
L1421071-16 WG1762605 1x	1026_27	45599	23076	38636	29288	22002

Instrument: BNAMS28 • File ID: 1026_03

10/26/21 06:33

Sample ID	File ID	NAPHTHALENE-D8 Response	ACENAPHTHENE-D10 Response	PHENANTHRENE-D10 Response	CHRYSENE-D12 Response	PERYLENE-D12 Response
Standard	1026_03	8008	5602	12673	13854	14709
Upper Limit		16016	11204	25346	27708	29418
Lower Limit		4004	2801	6337	6927	7355
LCS R3721626-1 WG1762605 1x	1026_07	6772	4771	10664	11652	12002
LCSD R3721626-2 WG1762605 1x	1026_08	6388	4522	10377	11251	11607
BLANK R3721626-3 WG1762605 1x	1026_09	6257	4430	9786	10762	10976
MS R3721626-4 WG1762605 1x	1026_34	6545	4598	10393	11518	11988
MSD R3721626-5 WG1762605 1x	1026_35	6560	4684	10469	11478	12146
L1421071-12 WG1762605 1x	1026_39	6342	4448	9968	10564	10991
L1421071-13 WG1762605 1x	1026_40	6254	4409	9778	10395	10770
L1421071-14 WG1762605 1x	1026_41	6232	4443	9769	10438	10788
L1421071-15 WG1762605 1x	1026_42	6192	4315	9572	10138	10468

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

GLOSSARY OF TERMS

Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

Abbreviations and Definitions

(dry)	Results are reported based on the dry weight of the sample. [this will only be present on a dry report basis for soils].
MDL	Method Detection Limit.
MDL (dry)	Method Detection Limit.
RDL	Reported Detection Limit.
RDL (dry)	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier	Description
B	The same analyte is found in the associated blank.
C3	The reported concentration is an estimate. The continuing calibration standard associated with this data responded low. Method sensitivity check is acceptable.
C4	The reported concentration is an estimate. The continuing calibration standard associated with this data responded low. Data is likely to show a low bias concerning the result.
C5	The reported concentration is an estimate. The continuing calibration standard associated with this data responded high. Data is likely to show a high bias concerning the result.
E	The analyte concentration exceeds the upper limit of the calibration range of the instrument established by the initial calibration (ICAL).
J	The identification of the analyte is acceptable; the reported value is an estimate.
J2	Surrogate recovery limits have been exceeded; values are outside lower control limits.



GLOSSARY OF TERMS

Qualifier	Description	
J3	The associated batch QC was outside the established quality control range for precision.	¹ Cp
J4	The associated batch QC was outside the established quality control range for accuracy.	
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.	² Tc
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.	
P	RPD between the primary and confirmatory analysis exceeded 40%.	³ Ss
V	The sample concentration is too high to evaluate accurate spike recoveries.	⁴ Cn
		⁵ Sr
		⁶ Qc
		⁷ Is
		⁸ Gl
		⁹ Al
		¹⁰ Sc

ACCREDITATIONS & LOCATIONS

Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey–NELAP	TN002
California	2932	New Mexico ¹	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina ¹	DW21704
Georgia	NELAP	North Carolina ³	41
Georgia ¹	923	North Dakota	R-140
Idaho	TN00003	Ohio–VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky ^{1,6}	KY90010	South Carolina	84004002
Kentucky ²	16	South Dakota	n/a
Louisiana	AI30792	Tennessee ^{1,4}	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas ⁵	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP,LLC EMLAP	100789
A2LA – ISO 17025 ⁵	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA–Crypto	TN00003		

¹ Drinking Water ² Underground Storage Tanks ³ Aquatic Toxicity ⁴ Chemical/Microbiological ⁵ Mold ⁶ Wastewater n/a Accreditation not applicable

* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

¹ Cp

² Tc

³ Ss

⁴ Cn

⁵ Sr

⁶ Qc

⁷ Is

⁸ Gl

⁹ Al

¹⁰ Sc

Address:
Maul Foster & Alongi- Coeur d Alene, ID
 601 East Front Avenue, Suite 202

Billing Information:
 Accounts Payable - Stephanie Ashmore
 400 E Mill Plain Blvd., Ste. 400
 Vancouver, WA 98660

Analysis / Container / Preservative Chain of Custody Page 1 of 2

Report to:
Lisa Pritzl

Email To: lpritzl@maulfoster.com

Project Description:
WSU Steam Plant, Pullman, Washington

City/State Collected: Please Circle:
 PT MT CT ET

Phone: **208-664-7883**

Client Project #
0457.02.03

Lab Project #
MAUFOSCID-04570203

Collected by (print):
Lisa Pritzl

Site/Facility ID #

P.O. #

Collected by (signature):
Lisa M. Pritzl


Rush? (Lab MUST Be Notified)
 ___ Same Day ___ Five Day
 ___ Next Day ___ 5 Day (Rad Only)
 ___ Two Day ___ 10 Day (Rad Only)
 ___ Three Day

Quote #

Immediately Packed on Ice N ___ Y

Date Results Needed No. of Cntrs

Sample ID	Comp/Grab	Matrix *	Depth	Date	Time	soil NWTPHDX NOSGT 8ozClr-NoPres	soil PAHs 8270ESIM 8ozClr-NoPres	soil PCBs 8082 8ozClr-NoPres	soil RCRA8 6020 4ozClr-NoPres	soil VOCs 8260D 40mlAmb/MeOH10ml/Syr	water NWTPHDX NOSGT 40mlAmb-HCl-BT	water PAHs 8270ESIM 40mlAmb-NoPres-WT	water PCBs 8082 100ml Amb-NoPres	water RCRA8 6020 250mlHDPE-HNO3	water VOCs 8260D ULL 40mlAmb-HCl	
SB-1-2.5	G	SS	2.5	10-19-21	1255	3	X	X	Hold	X	X					-01
SB-1-15		SS	15		1300	3	X	X	Hold	X	X					-02
SB-2-2.0		SS	2.0		1500	3	X	X	Hold	X	X					-03
SB-2-15.0		SS	15.0		1505	3	X	X	Hold	X	X					-04
SB-3-5.0		SS	5.0		1340	3	X	X	Hold	X	X					-05
SB-3-13.0		SS	13.0		1350	3	X	X	Hold	X	X					-06
SB-5-5.0		SS	5.0		1150	2	X	X		X	X					-07
SB-5-15.0		SS	15.0		1200	3	X	X	Hold	X	X					-08
SB-7-5.5		SS	5.5		1100	3	X	X	X	X	X					-09
SB-7-13.5		SS	13.5		1105	3	X	X	Hold	X	X					-10

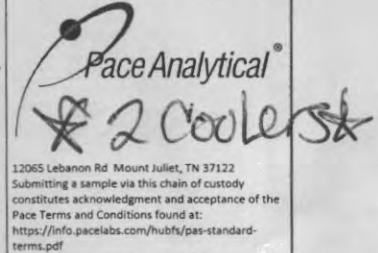

12065 Lebanon Rd Mount Juliet, TN 37122
 Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at:
<https://info.pacelabs.com/hubfs/pas-standard-terms.pdf>

SLUG # **1921071**
G121

Acctnum: MAUFOSCID
 Template: T197433
 Prelogin: P880566
 PM: 110 - Brian Ford
 PB:

Shipped Via:
 Remarks Sample # (lab only)

* Matrix:
 SS - Soil AIR - Air F - Filter
 GW - Groundwater B - Bioassay
 WW - WasteWater
 DW - Drinking Water
 OT - Other

Remarks:
2 Coolers -> 1 Soil 1 GW
 Samples returned via: UPS FedEx Courier
 Tracking # **5217 3314 1543**

Sample Receipt Checklist
 COC Seal Present/Intact: Y N
 COC Signed/Accurate: Y N
 Bottles arrive intact: Y N
 Correct bottles used: Y N
 Sufficient volume sent: Y N
 If Applicable
 VOA Zero Headspace: Y N
 Preservation Correct/Checked: Y N
 RAD Screen <0.5 mR/hr: Y N

Relinquished by: (Signature)
Lisa M. Pritzl

Date: **10-20-21** Time: **1600**

Received by: (Signature)

Trip Blank Received: Yes / No
4 HCl/MeOH TBR

Relinquished by: (Signature)

Date: Time:

Received by: (Signature)

Temp **2.10 to 2.6** °C Bottles Received: **82**

If preservation required by Login: Date/Time

Relinquished by: (Signature)

Date: Time:

Received for lab by: (Signature)
Madeline Cho

Date: **10/21/21** Time: **0900**

Hold: Condition: **NCF / OK**

Company Address:

Maul Foster & Alongi- Coeur d Alene, ID

601 East Front Avenue, Suite 202

Report to:
Lisa Pritzl

Project Description:
WSU Steam Plant, Pullman, Washington

Phone: **208-664-7883**

Client Project #
0457.02.03

Lab Project #
MAUFOSCID-04570203

Collected by (print):
L Pritzl

Site/Facility ID #

P.O. #

Collected by (signature):
Lisa M. Pritzl

Rush? (Lab MUST Be Notified)

Quote #

Immediately Packed on Ice N Y

Same Day Five Day
 Next Day 5 Day (Rad Only)
 Two Day 10 Day (Rad Only)
 Three Day

Date Results Needed

No. of Cntrs

Sample ID	Comp/Grab	Matrix *	Depth	Date	Time	No. of Cntrs	soil NWTPHDX NOSGT 8ozClr-NoPres	soil PAHs 8270ESIM 8ozClr-NoPres	soil PCBs 8082 8ozClr-NoPres	soil RCRA8 6020 4ozClr-NoPres	soil VOCs 8260D 40mlAmb/MeOH10ml/Syr	water NWTPHDX NOSGT 40mlAmb-HCl-BT	water PAHs 8270ESIM 40mlAmb-NoPres-WT	water PCBs 8082 100ml Amb-NoPres	water RCRA8 6020 250mlHDPE-HNO3	water VOCs 8260D ULL 40mlAmb-HCl	
Trip Blank - Soil Cooler	Other	Other		10-19-21	0800	2											
SB-1-GW	G	GW		10-19-21	1535	10						X	X		X	X	X
SB-2-GW	G	GW		10-19-21	1630	10						X	X		X	X	" "
SB-5-GW	G	GW		10-19-21	1330	10						X	X	X	X	X	" "
SB-3-GW	G	GW		10-19-21	1720	10						X	X		X	X	" "
SB-7-GW	G	GW		10-19-21	1650	10						X	X	X		X	" "
TRIP Blank - Water Cooler	Other	Other		10-19-21	0800	2											
		GW															
		GW															
		GW															

* Matrix:
SS - Soil AIR - Air F - Filter
GW - Groundwater B - Bioassay
WW - WasteWater
DW - Drinking Water
OT - Other

Remarks:
HCL Removed + Rinsed from 100 ml AMBERS Prior to Sample Collection (P)

pH _____ Temp _____
Flow _____ Other _____

Sample Receipt Checklist

COC Seal Present/Intact: Y N

COC Signed/Accurate: Y N

Bottles arrive intact: Y N

Correct bottles used: Y N

Sufficient volume sent: Y N

IF Applicable

VOA Zero Headspace: Y N

Preservation Correct/Checked: Y N

RAD Screen <0.5 mR/hr: Y N

Samples returned via: UPS FedEx Courier

Tracking # **5217 3314 1532**

Relinquished by: (Signature)
Lisa M. Pritzl

Date: **10/20/21** Time: **1600**

Received by: (Signature)

Trip Blank Received: Yes No
4 HCL MeOH TBR

Relinquished by: (Signature)

Date: _____ Time: _____

Received by: (Signature)

Temp: **Attemp** Bottles Received: **2.610 = 2.6 82**

If preservation required by Login: Date/Time

Relinquished by: (Signature)

Date: _____ Time: _____

Received for lab by: (Signature)
W. Wells

Date: **10/21/21** Time: **0900**

Hold: _____ Condition: **NCF / OK**

Analysis / Container / Preservative

Chain of Custody Page 2 of 2

Pace Analytical

*** 2 coolers ***

12065 Lebanon Rd Mount Juliet, TN 37122
Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: <https://info.pacelabs.com/hubfs/pas-standard-terms.pdf>

SDG # **142107**

Table #

Acctnum: **MAUFOSCID**

Template: **T197433**

Prelogin: **P880566**

PM: **110 - Brian Ford**

PB:

Shipped Via:


Remarks | Sample # (lab only)



Maul Foster & Alongi- Coeur d Alene, ID


Sample Delivery Group: L1431168
Samples Received: 11/13/2021
Project Number: 0457.02.03
Description: WSU Steam Plant, Pullman, Washington
Site: WSU STEAMPLANT
Report To: Lisa Pritzl
601 East Front Avenue, Suite 202
Coeur d'Alene, ID 83814

Entire Report Reviewed By:



Brian Ford
Project Manager



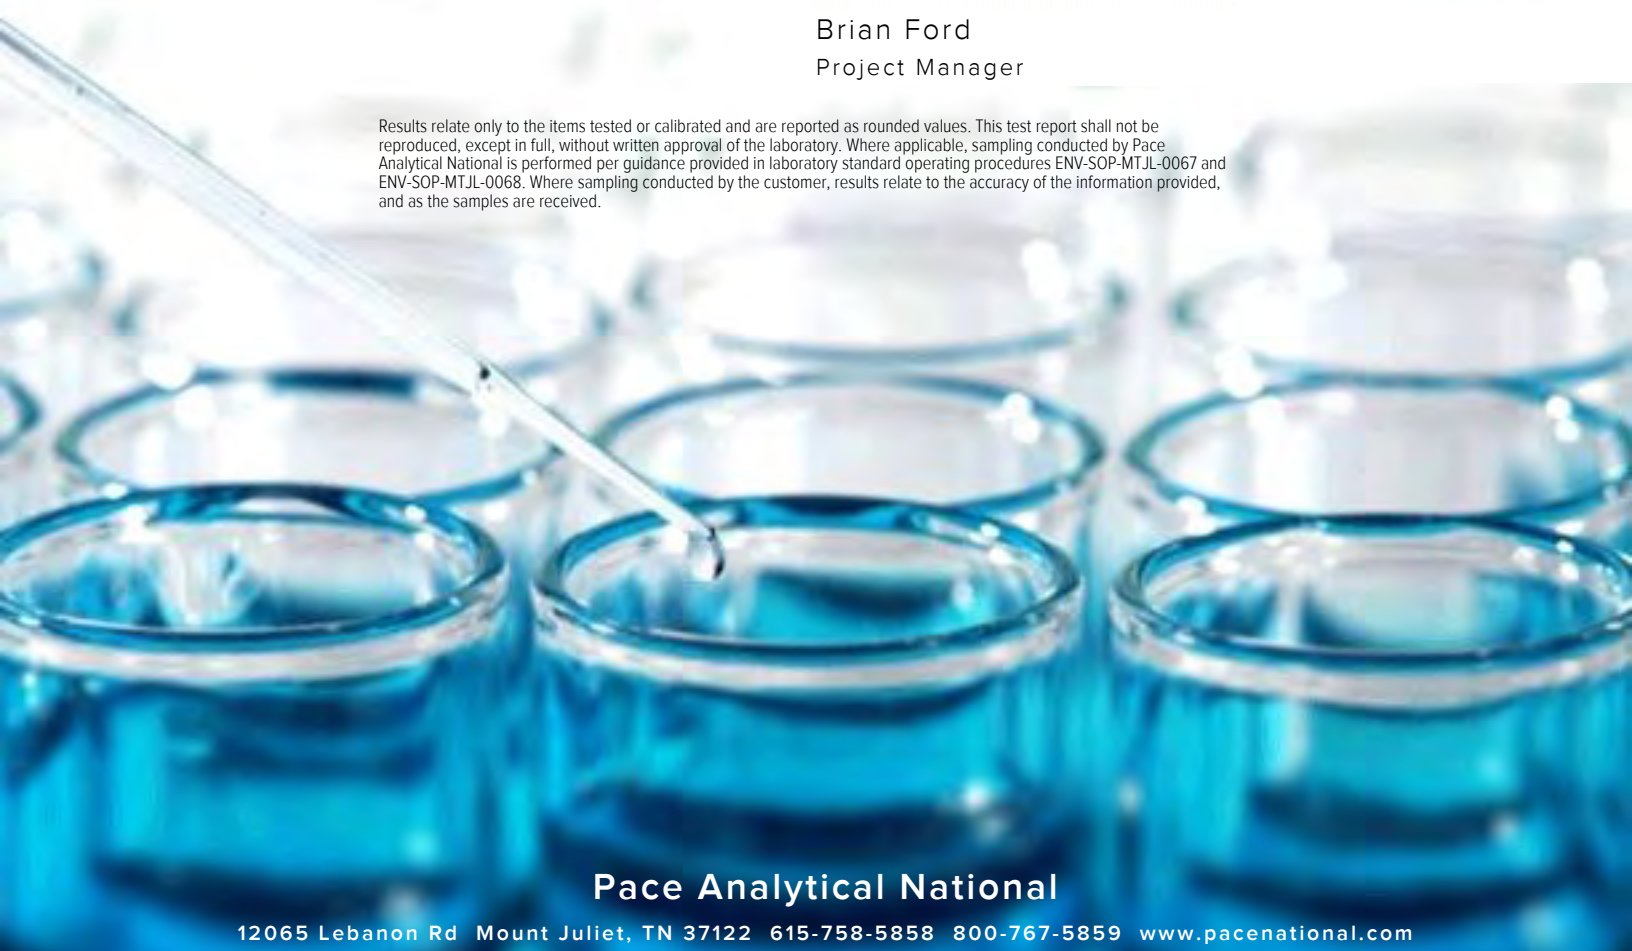







Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.



Pace Analytical National

12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 www.pacenational.com

TABLE OF CONTENTS

Cp: Cover Page	1	
Tc: Table of Contents	2	
Ss: Sample Summary	3	
Cn: Case Narrative	4	
Sr: Sample Results	5	
VP-1 L1431168-01	5	
VP-2 L1431168-02	7	
VP-3 L1431168-03	9	
Qc: Quality Control Summary	11	
Volatile Organic Compounds (MS) by Method TO-15	11	
Organic Compounds (GC) by Method ASTM 1946	15	
Is: Internal Standard Summary	16	
Volatile Organic Compounds (MS) by Method TO-15	16	
Gl: Glossary of Terms	17	
Al: Accreditations & Locations	18	
Sc: Sample Chain of Custody	19	

SAMPLE SUMMARY

VP-1 L1431168-01 Air

Collected by: L. Pritzl
 Collected date/time: 11/12/21 11:21
 Received date/time: 11/13/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Volatile Organic Compounds (MS) by Method TO-15	WG1774462	1	11/15/21 15:22	11/15/21 15:22	CEP	Mt. Juliet, TN
Organic Compounds (GC) by Method ASTM 1946	WG1775095	1	11/16/21 13:47	11/16/21 13:47	CMS	Mt. Juliet, TN

¹Cp

²Tc

³Ss

VP-2 L1431168-02 Air

Collected by: L. Pritzl
 Collected date/time: 11/12/21 12:19
 Received date/time: 11/13/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Volatile Organic Compounds (MS) by Method TO-15	WG1774462	1	11/15/21 16:02	11/15/21 16:02	CEP	Mt. Juliet, TN
Organic Compounds (GC) by Method ASTM 1946	WG1775095	1	11/16/21 13:50	11/16/21 13:50	CMS	Mt. Juliet, TN

⁴Cn

⁵Sr

⁶Qc

VP-3 L1431168-03 Air

Collected by: L. Pritzl
 Collected date/time: 11/12/21 12:48
 Received date/time: 11/13/21 09:00

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Volatile Organic Compounds (MS) by Method TO-15	WG1774462	1	11/15/21 16:42	11/15/21 16:42	CEP	Mt. Juliet, TN
Organic Compounds (GC) by Method ASTM 1946	WG1775095	1	11/16/21 13:57	11/16/21 13:57	CMS	Mt. Juliet, TN

⁷Is

⁸Gl

⁹Al

¹⁰Sc

CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Brian Ford
Project Manager

- 1 Cp
- 2 Tc
- 3 Ss
- 4 Cn
- 5 Sr
- 6 Qc
- 7 Is
- 8 Gl
- 9 Al
- 10 Sc

Volatile Organic Compounds (MS) by Method TO-15

Analyte	CAS #	Mol. Wt.	RDL1 ppbv	RDL2 ug/m3	Result ppbv	Result ug/m3	Qualifier	Dilution	Batch
Acetone	67-64-1	58.10	1.25	2.97	12.7	30.2		1	WG1774462
Allyl chloride	107-05-1	76.53	0.200	0.626	ND	ND		1	WG1774462
Benzene	71-43-2	78.10	0.200	0.639	2.23	7.12		1	WG1774462
Benzyl Chloride	100-44-7	127	0.200	1.04	ND	ND		1	WG1774462
Bromodichloromethane	75-27-4	164	0.200	1.34	ND	ND		1	WG1774462
Bromoform	75-25-2	253	0.600	6.21	ND	ND		1	WG1774462
Bromomethane	74-83-9	94.90	0.200	0.776	ND	ND		1	WG1774462
1,3-Butadiene	106-99-0	54.10	2.00	4.43	ND	ND		1	WG1774462
Carbon disulfide	75-15-0	76.10	0.200	0.622	ND	ND		1	WG1774462
Carbon tetrachloride	56-23-5	154	0.200	1.26	ND	ND		1	WG1774462
Chlorobenzene	108-90-7	113	0.200	0.924	ND	ND		1	WG1774462
Chloroethane	75-00-3	64.50	0.200	0.528	ND	ND		1	WG1774462
Chloroform	67-66-3	119	0.200	0.973	ND	ND		1	WG1774462
Chloromethane	74-87-3	50.50	0.200	0.413	0.221	0.456		1	WG1774462
2-Chlorotoluene	95-49-8	126	0.200	1.03	ND	ND		1	WG1774462
Cyclohexane	110-82-7	84.20	0.200	0.689	0.212	0.730		1	WG1774462
Dibromochloromethane	124-48-1	208	0.200	1.70	ND	ND		1	WG1774462
1,2-Dibromoethane	106-93-4	188	0.200	1.54	ND	ND		1	WG1774462
1,2-Dichlorobenzene	95-50-1	147	0.200	1.20	ND	ND		1	WG1774462
1,3-Dichlorobenzene	541-73-1	147	0.200	1.20	ND	ND		1	WG1774462
1,4-Dichlorobenzene	106-46-7	147	0.200	1.20	ND	ND		1	WG1774462
1,2-Dichloroethane	107-06-2	99	0.200	0.810	ND	ND		1	WG1774462
1,1-Dichloroethane	75-34-3	98	0.200	0.802	ND	ND		1	WG1774462
1,1-Dichloroethene	75-35-4	96.90	0.200	0.793	ND	ND		1	WG1774462
cis-1,2-Dichloroethene	156-59-2	96.90	0.200	0.793	ND	ND		1	WG1774462
trans-1,2-Dichloroethene	156-60-5	96.90	0.200	0.793	ND	ND		1	WG1774462
1,2-Dichloropropane	78-87-5	113	0.200	0.924	ND	ND		1	WG1774462
cis-1,3-Dichloropropene	10061-01-5	111	0.200	0.908	ND	ND		1	WG1774462
trans-1,3-Dichloropropene	10061-02-6	111	0.200	0.908	ND	ND		1	WG1774462
1,4-Dioxane	123-91-1	88.10	0.200	0.721	0.233	0.840		1	WG1774462
Ethanol	64-17-5	46.10	1.25	2.36	56.5	107		1	WG1774462
Ethylbenzene	100-41-4	106	0.200	0.867	0.403	1.75		1	WG1774462
4-Ethyltoluene	622-96-8	120	0.200	0.982	ND	ND		1	WG1774462
Trichlorofluoromethane	75-69-4	137.40	0.200	1.12	0.207	1.16		1	WG1774462
Dichlorodifluoromethane	75-71-8	120.92	0.200	0.989	0.466	2.30		1	WG1774462
1,1,2-Trichlorotrifluoroethane	76-13-1	187.40	0.200	1.53	ND	ND		1	WG1774462
1,2-Dichlorotetrafluoroethane	76-14-2	171	0.200	1.40	ND	ND		1	WG1774462
Heptane	142-82-5	100	0.200	0.818	ND	ND		1	WG1774462
Hexachloro-1,3-butadiene	87-68-3	261	0.630	6.73	ND	ND		1	WG1774462
n-Hexane	110-54-3	86.20	0.630	2.22	0.899	3.17		1	WG1774462
Isopropylbenzene	98-82-8	120.20	0.200	0.983	ND	ND		1	WG1774462
Methylene Chloride	75-09-2	84.90	0.200	0.694	1.86	6.46		1	WG1774462
Methyl Butyl Ketone	591-78-6	100	1.25	5.11	ND	ND		1	WG1774462
2-Butanone (MEK)	78-93-3	72.10	1.25	3.69	1.37	4.04		1	WG1774462
4-Methyl-2-pentanone (MIBK)	108-10-1	100.10	1.25	5.12	ND	ND		1	WG1774462
Methyl methacrylate	80-62-6	100.12	0.200	0.819	ND	ND		1	WG1774462
MTBE	1634-04-4	88.10	0.200	0.721	ND	ND		1	WG1774462
Naphthalene	91-20-3	128	0.630	3.30	ND	ND		1	WG1774462
2-Propanol	67-63-0	60.10	1.25	3.07	2.16	5.31		1	WG1774462
Propene	115-07-1	42.10	1.25	2.15	ND	ND		1	WG1774462
Styrene	100-42-5	104	0.200	0.851	ND	ND		1	WG1774462
1,1,2,2-Tetrachloroethane	79-34-5	168	0.200	1.37	ND	ND		1	WG1774462
Tetrachloroethylene	127-18-4	166	0.200	1.36	ND	ND		1	WG1774462
Tetrahydrofuran	109-99-9	72.10	0.200	0.590	ND	ND		1	WG1774462
Toluene	108-88-3	92.10	0.500	1.88	4.04	15.2		1	WG1774462
1,2,4-Trichlorobenzene	120-82-1	181	0.630	4.66	ND	ND		1	WG1774462

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (MS) by Method TO-15

Analyte	CAS #	Mol. Wt.	RDL1 ppbv	RDL2 ug/m3	Result ppbv	Result ug/m3	Qualifier	Dilution	Batch
1,1,1-Trichloroethane	71-55-6	133	0.200	1.09	ND	ND		1	WG1774462
1,1,2-Trichloroethane	79-00-5	133	0.200	1.09	ND	ND		1	WG1774462
Trichloroethylene	79-01-6	131	0.200	1.07	ND	ND		1	WG1774462
1,2,4-Trimethylbenzene	95-63-6	120	0.200	0.982	ND	ND		1	WG1774462
1,3,5-Trimethylbenzene	108-67-8	120	0.200	0.982	ND	ND		1	WG1774462
2,2,4-Trimethylpentane	540-84-1	114.22	0.200	0.934	ND	ND		1	WG1774462
Vinyl chloride	75-01-4	62.50	0.200	0.511	ND	ND		1	WG1774462
Vinyl Bromide	593-60-2	106.95	0.200	0.875	ND	ND		1	WG1774462
Vinyl acetate	108-05-4	86.10	0.200	0.704	ND	ND		1	WG1774462
m&p-Xylene	1330-20-7	106	0.400	1.73	2.03	8.80		1	WG1774462
o-Xylene	95-47-6	106	0.200	0.867	0.722	3.13		1	WG1774462
(S) 1,4-Bromofluorobenzene	460-00-4	175	60.0-140		104				WG1774462

Organic Compounds (GC) by Method ASTM 1946

Analyte	CAS #	Mol. Wt.	RDL %	Result %	Qualifier	Dilution	Batch
Helium	7440-59-7		0.100	ND		1	WG1775095

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (MS) by Method TO-15

Analyte	CAS #	Mol. Wt.	RDL1 ppbv	RDL2 ug/m3	Result ppbv	Result ug/m3	Qualifier	Dilution	Batch
Acetone	67-64-1	58.10	1.25	2.97	6.78	16.1		1	WG1774462
Allyl chloride	107-05-1	76.53	0.200	0.626	ND	ND		1	WG1774462
Benzene	71-43-2	78.10	0.200	0.639	ND	ND		1	WG1774462
Benzyl Chloride	100-44-7	127	0.200	1.04	ND	ND		1	WG1774462
Bromodichloromethane	75-27-4	164	0.200	1.34	ND	ND		1	WG1774462
Bromoform	75-25-2	253	0.600	6.21	ND	ND		1	WG1774462
Bromomethane	74-83-9	94.90	0.200	0.776	ND	ND		1	WG1774462
1,3-Butadiene	106-99-0	54.10	2.00	4.43	ND	ND		1	WG1774462
Carbon disulfide	75-15-0	76.10	0.200	0.622	ND	ND		1	WG1774462
Carbon tetrachloride	56-23-5	154	0.200	1.26	ND	ND		1	WG1774462
Chlorobenzene	108-90-7	113	0.200	0.924	ND	ND		1	WG1774462
Chloroethane	75-00-3	64.50	0.200	0.528	ND	ND		1	WG1774462
Chloroform	67-66-3	119	0.200	0.973	ND	ND		1	WG1774462
Chloromethane	74-87-3	50.50	0.200	0.413	ND	ND		1	WG1774462
2-Chlorotoluene	95-49-8	126	0.200	1.03	ND	ND		1	WG1774462
Cyclohexane	110-82-7	84.20	0.200	0.689	ND	ND		1	WG1774462
Dibromochloromethane	124-48-1	208	0.200	1.70	ND	ND		1	WG1774462
1,2-Dibromoethane	106-93-4	188	0.200	1.54	ND	ND		1	WG1774462
1,2-Dichlorobenzene	95-50-1	147	0.200	1.20	ND	ND		1	WG1774462
1,3-Dichlorobenzene	541-73-1	147	0.200	1.20	ND	ND		1	WG1774462
1,4-Dichlorobenzene	106-46-7	147	0.200	1.20	ND	ND		1	WG1774462
1,2-Dichloroethane	107-06-2	99	0.200	0.810	ND	ND		1	WG1774462
1,1-Dichloroethane	75-34-3	98	0.200	0.802	ND	ND		1	WG1774462
1,1-Dichloroethene	75-35-4	96.90	0.200	0.793	ND	ND		1	WG1774462
cis-1,2-Dichloroethene	156-59-2	96.90	0.200	0.793	ND	ND		1	WG1774462
trans-1,2-Dichloroethene	156-60-5	96.90	0.200	0.793	ND	ND		1	WG1774462
1,2-Dichloropropane	78-87-5	113	0.200	0.924	ND	ND		1	WG1774462
cis-1,3-Dichloropropene	10061-01-5	111	0.200	0.908	ND	ND		1	WG1774462
trans-1,3-Dichloropropene	10061-02-6	111	0.200	0.908	ND	ND		1	WG1774462
1,4-Dioxane	123-91-1	88.10	0.200	0.721	ND	ND		1	WG1774462
Ethanol	64-17-5	46.10	1.25	2.36	38.0	71.6		1	WG1774462
Ethylbenzene	100-41-4	106	0.200	0.867	0.358	1.55		1	WG1774462
4-Ethyltoluene	622-96-8	120	0.200	0.982	ND	ND		1	WG1774462
Trichlorofluoromethane	75-69-4	137.40	0.200	1.12	2.39	13.4		1	WG1774462
Dichlorodifluoromethane	75-71-8	120.92	0.200	0.989	0.485	2.40		1	WG1774462
1,1,2-Trichlorotrifluoroethane	76-13-1	187.40	0.200	1.53	ND	ND		1	WG1774462
1,2-Dichlorotetrafluoroethane	76-14-2	171	0.200	1.40	0.605	4.23		1	WG1774462
Heptane	142-82-5	100	0.200	0.818	8.35	34.2		1	WG1774462
Hexachloro-1,3-butadiene	87-68-3	261	0.630	6.73	ND	ND		1	WG1774462
n-Hexane	110-54-3	86.20	0.630	2.22	14.9	52.5		1	WG1774462
Isopropylbenzene	98-82-8	120.20	0.200	0.983	ND	ND		1	WG1774462
Methylene Chloride	75-09-2	84.90	0.200	0.694	ND	ND		1	WG1774462
Methyl Butyl Ketone	591-78-6	100	1.25	5.11	ND	ND		1	WG1774462
2-Butanone (MEK)	78-93-3	72.10	1.25	3.69	ND	ND		1	WG1774462
4-Methyl-2-pentanone (MIBK)	108-10-1	100.10	1.25	5.12	ND	ND		1	WG1774462
Methyl methacrylate	80-62-6	100.12	0.200	0.819	ND	ND		1	WG1774462
MTBE	1634-04-4	88.10	0.200	0.721	ND	ND		1	WG1774462
Naphthalene	91-20-3	128	0.630	3.30	ND	ND		1	WG1774462
2-Propanol	67-63-0	60.10	1.25	3.07	ND	ND		1	WG1774462
Propene	115-07-1	42.10	1.25	2.15	ND	ND		1	WG1774462
Styrene	100-42-5	104	0.200	0.851	0.348	1.48		1	WG1774462
1,1,2,2-Tetrachloroethane	79-34-5	168	0.200	1.37	ND	ND		1	WG1774462
Tetrachloroethylene	127-18-4	166	0.200	1.36	ND	ND		1	WG1774462
Tetrahydrofuran	109-99-9	72.10	0.200	0.590	ND	ND		1	WG1774462
Toluene	108-88-3	92.10	0.500	1.88	4.03	15.2		1	WG1774462
1,2,4-Trichlorobenzene	120-82-1	181	0.630	4.66	ND	ND		1	WG1774462

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (MS) by Method TO-15

Analyte	CAS #	Mol. Wt.	RDL1 ppbv	RDL2 ug/m3	Result ppbv	Result ug/m3	Qualifier	Dilution	Batch
1,1,1-Trichloroethane	71-55-6	133	0.200	1.09	ND	ND		1	WG1774462
1,1,2-Trichloroethane	79-00-5	133	0.200	1.09	ND	ND		1	WG1774462
Trichloroethylene	79-01-6	131	0.200	1.07	ND	ND		1	WG1774462
1,2,4-Trimethylbenzene	95-63-6	120	0.200	0.982	0.251	1.23		1	WG1774462
1,3,5-Trimethylbenzene	108-67-8	120	0.200	0.982	ND	ND		1	WG1774462
2,2,4-Trimethylpentane	540-84-1	114.22	0.200	0.934	ND	ND		1	WG1774462
Vinyl chloride	75-01-4	62.50	0.200	0.511	ND	ND		1	WG1774462
Vinyl Bromide	593-60-2	106.95	0.200	0.875	ND	ND		1	WG1774462
Vinyl acetate	108-05-4	86.10	0.200	0.704	ND	ND		1	WG1774462
m&p-Xylene	1330-20-7	106	0.400	1.73	1.27	5.51		1	WG1774462
o-Xylene	95-47-6	106	0.200	0.867	0.405	1.76		1	WG1774462
(S) 1,4-Bromofluorobenzene	460-00-4	175	60.0-140		103				WG1774462

Organic Compounds (GC) by Method ASTM 1946

Analyte	CAS #	Mol. Wt.	RDL %	Result %	Qualifier	Dilution	Batch
Helium	7440-59-7		0.100	ND		1	WG1775095

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Volatile Organic Compounds (MS) by Method TO-15

Analyte	CAS #	Mol. Wt.	RDL1 ppbv	RDL2 ug/m3	Result ppbv	Result ug/m3	Qualifier	Dilution	Batch
Acetone	67-64-1	58.10	1.25	2.97	12.1	28.8		1	WG1774462
Allyl chloride	107-05-1	76.53	0.200	0.626	ND	ND		1	WG1774462
Benzene	71-43-2	78.10	0.200	0.639	0.234	0.747		1	WG1774462
Benzyl Chloride	100-44-7	127	0.200	1.04	ND	ND		1	WG1774462
Bromodichloromethane	75-27-4	164	0.200	1.34	ND	ND		1	WG1774462
Bromoform	75-25-2	253	0.600	6.21	ND	ND		1	WG1774462
Bromomethane	74-83-9	94.90	0.200	0.776	ND	ND		1	WG1774462
1,3-Butadiene	106-99-0	54.10	2.00	4.43	ND	ND		1	WG1774462
Carbon disulfide	75-15-0	76.10	0.200	0.622	0.958	2.98		1	WG1774462
Carbon tetrachloride	56-23-5	154	0.200	1.26	ND	ND		1	WG1774462
Chlorobenzene	108-90-7	113	0.200	0.924	ND	ND		1	WG1774462
Chloroethane	75-00-3	64.50	0.200	0.528	ND	ND		1	WG1774462
Chloroform	67-66-3	119	0.200	0.973	ND	ND		1	WG1774462
Chloromethane	74-87-3	50.50	0.200	0.413	ND	ND		1	WG1774462
2-Chlorotoluene	95-49-8	126	0.200	1.03	ND	ND		1	WG1774462
Cyclohexane	110-82-7	84.20	0.200	0.689	ND	ND		1	WG1774462
Dibromochloromethane	124-48-1	208	0.200	1.70	ND	ND		1	WG1774462
1,2-Dibromoethane	106-93-4	188	0.200	1.54	ND	ND		1	WG1774462
1,2-Dichlorobenzene	95-50-1	147	0.200	1.20	ND	ND		1	WG1774462
1,3-Dichlorobenzene	541-73-1	147	0.200	1.20	ND	ND		1	WG1774462
1,4-Dichlorobenzene	106-46-7	147	0.200	1.20	ND	ND		1	WG1774462
1,2-Dichloroethane	107-06-2	99	0.200	0.810	ND	ND		1	WG1774462
1,1-Dichloroethane	75-34-3	98	0.200	0.802	ND	ND		1	WG1774462
1,1-Dichloroethene	75-35-4	96.90	0.200	0.793	ND	ND		1	WG1774462
cis-1,2-Dichloroethene	156-59-2	96.90	0.200	0.793	ND	ND		1	WG1774462
trans-1,2-Dichloroethene	156-60-5	96.90	0.200	0.793	ND	ND		1	WG1774462
1,2-Dichloropropane	78-87-5	113	0.200	0.924	ND	ND		1	WG1774462
cis-1,3-Dichloropropene	10061-01-5	111	0.200	0.908	ND	ND		1	WG1774462
trans-1,3-Dichloropropene	10061-02-6	111	0.200	0.908	ND	ND		1	WG1774462
1,4-Dioxane	123-91-1	88.10	0.200	0.721	ND	ND		1	WG1774462
Ethanol	64-17-5	46.10	1.25	2.36	31.2	58.8		1	WG1774462
Ethylbenzene	100-41-4	106	0.200	0.867	0.517	2.24		1	WG1774462
4-Ethyltoluene	622-96-8	120	0.200	0.982	0.252	1.24		1	WG1774462
Trichlorofluoromethane	75-69-4	137.40	0.200	1.12	ND	ND		1	WG1774462
Dichlorodifluoromethane	75-71-8	120.92	0.200	0.989	0.494	2.44		1	WG1774462
1,1,2-Trichlorotrifluoroethane	76-13-1	187.40	0.200	1.53	ND	ND		1	WG1774462
1,2-Dichlorotetrafluoroethane	76-14-2	171	0.200	1.40	ND	ND		1	WG1774462
Heptane	142-82-5	100	0.200	0.818	0.393	1.61		1	WG1774462
Hexachloro-1,3-butadiene	87-68-3	261	0.630	6.73	ND	ND		1	WG1774462
n-Hexane	110-54-3	86.20	0.630	2.22	0.841	2.96		1	WG1774462
Isopropylbenzene	98-82-8	120.20	0.200	0.983	ND	ND		1	WG1774462
Methylene Chloride	75-09-2	84.90	0.200	0.694	ND	ND		1	WG1774462
Methyl Butyl Ketone	591-78-6	100	1.25	5.11	ND	ND		1	WG1774462
2-Butanone (MEK)	78-93-3	72.10	1.25	3.69	1.95	5.75		1	WG1774462
4-Methyl-2-pentanone (MIBK)	108-10-1	100.10	1.25	5.12	ND	ND		1	WG1774462
Methyl methacrylate	80-62-6	100.12	0.200	0.819	ND	ND		1	WG1774462
MTBE	1634-04-4	88.10	0.200	0.721	ND	ND		1	WG1774462
Naphthalene	91-20-3	128	0.630	3.30	ND	ND		1	WG1774462
2-Propanol	67-63-0	60.10	1.25	3.07	2.86	7.03		1	WG1774462
Propene	115-07-1	42.10	1.25	2.15	ND	ND		1	WG1774462
Styrene	100-42-5	104	0.200	0.851	0.489	2.08		1	WG1774462
1,1,2,2-Tetrachloroethane	79-34-5	168	0.200	1.37	ND	ND		1	WG1774462
Tetrachloroethylene	127-18-4	166	0.200	1.36	ND	ND		1	WG1774462
Tetrahydrofuran	109-99-9	72.10	0.200	0.590	ND	ND		1	WG1774462
Toluene	108-88-3	92.10	0.500	1.88	3.79	14.3		1	WG1774462
1,2,4-Trichlorobenzene	120-82-1	181	0.630	4.66	ND	ND		1	WG1774462



Volatile Organic Compounds (MS) by Method TO-15

Analyte	CAS #	Mol. Wt.	RDL1 ppbv	RDL2 ug/m3	Result ppbv	Result ug/m3	Qualifier	Dilution	Batch
1,1,1-Trichloroethane	71-55-6	133	0.200	1.09	ND	ND		1	WG1774462
1,1,2-Trichloroethane	79-00-5	133	0.200	1.09	ND	ND		1	WG1774462
Trichloroethylene	79-01-6	131	0.200	1.07	0.297	1.59		1	WG1774462
1,2,4-Trimethylbenzene	95-63-6	120	0.200	0.982	0.356	1.75		1	WG1774462
1,3,5-Trimethylbenzene	108-67-8	120	0.200	0.982	ND	ND		1	WG1774462
2,2,4-Trimethylpentane	540-84-1	114.22	0.200	0.934	ND	ND		1	WG1774462
Vinyl chloride	75-01-4	62.50	0.200	0.511	ND	ND		1	WG1774462
Vinyl Bromide	593-60-2	106.95	0.200	0.875	ND	ND		1	WG1774462
Vinyl acetate	108-05-4	86.10	0.200	0.704	ND	ND		1	WG1774462
m&p-Xylene	1330-20-7	106	0.400	1.73	1.87	8.11		1	WG1774462
o-Xylene	95-47-6	106	0.200	0.867	0.649	2.81		1	WG1774462
(S) 1,4-Bromofluorobenzene	460-00-4	175	60.0-140		102				WG1774462

Organic Compounds (GC) by Method ASTM 1946

Analyte	CAS #	Mol. Wt.	RDL %	Result %	Qualifier	Dilution	Batch
Helium	7440-59-7		0.100	ND		1	WG1775095

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Method Blank (MB)

(MB) R3729541-2 11/15/21 10:07

Analyte	MB Result ppbv	MB Qualifier	MB MDL ppbv	MB RDL ppbv
1,1,1-Trichloroethane	U		0.0736	0.200
1,1,2,2-Tetrachloroethane	U		0.0743	0.200
1,1,2-Trichloroethane	U		0.0775	0.200
1,1,2-Trichlorotrifluoroethane	U		0.0793	0.200
1,1-Dichloroethane	U		0.0723	0.200
1,1-Dichloroethene	U		0.0762	0.200
1,2,4-Trichlorobenzene	U		0.148	0.630
1,2,4-Trimethylbenzene	U		0.0764	0.200
1,2-Dibromoethane	U		0.0721	0.200
1,2-Dichlorobenzene	U		0.128	0.200
1,2-Dichloroethane	U		0.0700	0.200
1,2-Dichloropropane	U		0.0760	0.200
1,2-Dichlorotetrafluoroethane	U		0.0890	0.200
1,3,5-Trimethylbenzene	U		0.0779	0.200
1,3-Butadiene	U		0.104	2.00
1,3-Dichlorobenzene	U		0.182	0.200
1,4-Dichlorobenzene	U		0.0557	0.200
1,4-Dioxane	U		0.0833	0.200
2,2,4-Trimethylpentane	U		0.133	0.200
2-Butanone (MEK)	U		0.0814	1.25
2-Chlorotoluene	U		0.0828	0.200
2-Propanol	U		0.264	1.25
4-Ethyltoluene	U		0.0783	0.200
4-Methyl-2-pentanone (MIBK)	U		0.0765	1.25
Acetone	U		0.584	1.25
Allyl Chloride	U		0.114	0.200
Benzene	U		0.0715	0.200
Benzyl Chloride	U		0.0598	0.200
Bromodichloromethane	U		0.0702	0.200
Bromoform	U		0.0732	0.600
Bromomethane	U		0.0982	0.200
Carbon disulfide	U		0.102	0.200
Carbon tetrachloride	U		0.0732	0.200
Chlorobenzene	U		0.0832	0.200
Dibromochloromethane	U		0.0727	0.200
Chloroethane	U		0.0996	0.200
Chloroform	U		0.0717	0.200
Chloromethane	U		0.103	0.200
cis-1,2-Dichloroethene	U		0.0784	0.200
cis-1,3-Dichloropropene	U		0.0689	0.200

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

Method Blank (MB)

(MB) R3729541-2 11/15/21 10:07

Analyte	MB Result	MB Qualifier	MB MDL	MB RDL
	ppbv		ppbv	ppbv
Cyclohexane	U		0.0753	0.200
Dichlorodifluoromethane	U		0.137	0.200
Ethanol	U		0.265	1.25
Ethylbenzene	U		0.0835	0.200
Heptane	U		0.104	0.200
Hexachloro-1,3-butadiene	U		0.105	0.630
Isopropylbenzene	U		0.0777	0.200
m&p-Xylene	U		0.135	0.400
Methyl Butyl Ketone	U		0.133	1.25
Methyl Methacrylate	U		0.0876	0.200
MTBE	U		0.0647	0.200
Methylene Chloride	U		0.0979	0.200
n-Hexane	U		0.206	0.630
Naphthalene	U		0.350	0.630
o-Xylene	U		0.0828	0.200
Propene	0.0978	U	0.0932	1.25
Styrene	U		0.0788	0.200
Tetrachloroethylene	U		0.0814	0.200
Tetrahydrofuran	U		0.0734	0.200
Toluene	U		0.0870	0.500
trans-1,2-Dichloroethene	U		0.0673	0.200
trans-1,3-Dichloropropene	U		0.0728	0.200
Trichloroethylene	U		0.0680	0.200
Trichlorofluoromethane	U		0.0819	0.200
Vinyl acetate	U		0.116	0.200
Vinyl Bromide	U		0.0852	0.200
Vinyl chloride	U		0.0949	0.200
(S) 1,4-Bromofluorobenzene	102			60.0-140

1
Cp

2
Tc

3
Ss

4
Cn

5
Sr

6
Qc

7
Is

8
Gl

9
Al

10
Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3729541-1 11/15/21 09:29 • (LCSD) R3729541-3 11/15/21 10:47

Analyte	Spike Amount	LCS Result	LCSD Result	LCS Rec.	LCSD Rec.	Rec. Limits	LCS Qualifier	LCSD Qualifier	RPD	RPD Limits
	ppbv	ppbv	ppbv	%	%	%			%	%
1,1,1-Trichloroethane	3.75	4.15	4.15	111	111	70.0-130			0.000	25
1,1,2,2-Tetrachloroethane	3.75	4.01	4.06	107	108	70.0-130			1.24	25
1,1,2-Trichloroethane	3.75	4.01	4.03	107	107	70.0-130			0.498	25
1,1,2-Trichlorotrifluoroethane	3.75	4.19	4.19	112	112	70.0-130			0.000	25
1,1-Dichloroethane	3.75	4.18	4.23	111	113	70.0-130			1.19	25

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3729541-1 11/15/21 09:29 • (LCSD) R3729541-3 11/15/21 10:47

Analyte	Spike Amount ppbv	LCS Result ppbv	LCSD Result ppbv	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
1,1-Dichloroethene	3.75	4.23	4.33	113	115	70.0-130			2.34	25
1,2,4-Trichlorobenzene	3.75	3.58	3.67	95.5	97.9	70.0-160			2.48	25
1,2,4-Trimethylbenzene	3.75	4.26	4.33	114	115	70.0-130			1.63	25
1,2-Dibromoethane	3.75	4.06	4.09	108	109	70.0-130			0.736	25
1,2-Dichlorobenzene	3.75	4.01	4.05	107	108	70.0-130			0.993	25
1,2-Dichloroethane	3.75	4.24	4.16	113	111	70.0-130			1.90	25
1,2-Dichloropropane	3.75	4.05	4.09	108	109	70.0-130			0.983	25
1,2-Dichlorotetrafluoroethane	3.75	4.04	4.06	108	108	70.0-130			0.494	25
1,3,5-Trimethylbenzene	3.75	4.30	4.35	115	116	70.0-130			1.16	25
1,3-Butadiene	3.75	3.64	3.67	97.1	97.9	70.0-130			0.821	25
1,3-Dichlorobenzene	3.75	4.02	4.01	107	107	70.0-130			0.249	25
1,4-Dichlorobenzene	3.75	3.93	3.97	105	106	70.0-130			1.01	25
1,4-Dioxane	3.75	4.37	4.34	117	116	70.0-140			0.689	25
2,2,4-Trimethylpentane	3.75	4.22	4.31	113	115	70.0-130			2.11	25
2-Butanone (MEK)	3.75	4.14	4.22	110	113	70.0-130			1.91	25
2-Chlorotoluene	3.75	4.13	4.16	110	111	70.0-130			0.724	25
2-Propanol	3.75	4.51	4.48	120	119	70.0-139			0.667	25
4-Ethyltoluene	3.75	4.18	4.22	111	113	70.0-130			0.952	25
4-Methyl-2-pentanone (MIBK)	3.75	4.37	4.48	117	119	70.0-139			2.49	25
Acetone	3.75	4.12	4.16	110	111	70.0-130			0.966	25
Allyl Chloride	3.75	4.17	4.53	111	121	70.0-130			8.28	25
Benzene	3.75	3.99	3.99	106	106	70.0-130			0.000	25
Benzyl Chloride	3.75	3.88	3.99	103	106	70.0-152			2.80	25
Bromodichloromethane	3.75	4.08	4.02	109	107	70.0-130			1.48	25
Bromoform	3.75	4.09	4.09	109	109	70.0-130			0.000	25
Bromomethane	3.75	3.87	3.68	103	98.1	70.0-130			5.03	25
Carbon disulfide	3.75	4.19	4.21	112	112	70.0-130			0.476	25
Carbon tetrachloride	3.75	4.19	4.15	112	111	70.0-130			0.959	25
Chlorobenzene	3.75	4.02	4.05	107	108	70.0-130			0.743	25
Dibromochloromethane	3.75	4.06	4.04	108	108	70.0-130			0.494	25
Chloroethane	3.75	3.64	3.34	97.1	89.1	70.0-130			8.60	25
Chloroform	3.75	4.10	4.14	109	110	70.0-130			0.971	25
Chloromethane	3.75	4.14	4.25	110	113	70.0-130			2.62	25
cis-1,2-Dichloroethene	3.75	4.23	4.32	113	115	70.0-130			2.11	25
cis-1,3-Dichloropropene	3.75	4.19	4.18	112	111	70.0-130			0.239	25
Cyclohexane	3.75	4.27	4.31	114	115	70.0-130			0.932	25
Dichlorodifluoromethane	3.75	4.06	4.11	108	110	64.0-139			1.22	25
Ethanol	3.75	4.59	4.60	122	123	55.0-148			0.218	25
Ethylbenzene	3.75	4.18	4.20	111	112	70.0-130			0.477	25
Heptane	3.75	4.11	4.33	110	115	70.0-130			5.21	25

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3729541-1 11/15/21 09:29 • (LCSD) R3729541-3 11/15/21 10:47

Analyte	Spike Amount ppbv	LCS Result ppbv	LCSD Result ppbv	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Hexachloro-1,3-butadiene	3.75	4.07	4.13	109	110	70.0-151			1.46	25
Isopropylbenzene	3.75	4.33	4.35	115	116	70.0-130			0.461	25
m&p-Xylene	7.50	8.48	8.54	113	114	70.0-130			0.705	25
Methyl Butyl Ketone	3.75	4.44	4.46	118	119	70.0-149			0.449	25
Methyl Methacrylate	3.75	4.13	4.16	110	111	70.0-130			0.724	25
MTBE	3.75	4.37	4.40	117	117	70.0-130			0.684	25
Methylene Chloride	3.75	4.07	4.18	109	111	70.0-130			2.67	25
n-Hexane	3.75	4.29	4.37	114	117	70.0-130			1.85	25
Naphthalene	3.75	3.85	3.88	103	103	70.0-159			0.776	25
o-Xylene	3.75	4.26	4.32	114	115	70.0-130			1.40	25
Propene	3.75	4.09	4.23	109	113	64.0-144			3.37	25
Styrene	3.75	4.20	4.24	112	113	70.0-130			0.948	25
Tetrachloroethylene	3.75	4.04	4.03	108	107	70.0-130			0.248	25
Tetrahydrofuran	3.75	4.21	4.33	112	115	70.0-137			2.81	25
Toluene	3.75	4.12	4.15	110	111	70.0-130			0.726	25
trans-1,2-Dichloroethene	3.75	4.28	4.31	114	115	70.0-130			0.698	25
trans-1,3-Dichloropropene	3.75	4.17	4.16	111	111	70.0-130			0.240	25
Trichloroethylene	3.75	4.09	4.14	109	110	70.0-130			1.22	25
Trichlorofluoromethane	3.75	3.99	3.79	106	101	70.0-130			5.14	25
Vinyl acetate	3.75	3.92	3.90	105	104	70.0-130			0.512	25
Vinyl Bromide	3.75	4.14	3.93	110	105	70.0-130			5.20	25
Vinyl chloride	3.75	3.98	3.97	106	106	70.0-130			0.252	25
<i>(S)</i> 1,4-Bromofluorobenzene				104	104	60.0-140				

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

Method Blank (MB)

(MB) R3730091-3 11/16/21 13:20

Analyte	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
	%		%	%
Helium	U		0.0259	0.100

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R3730091-1 11/16/21 13:08 • (LCSD) R3730091-2 11/16/21 13:12

Analyte	Spike Amount	LCS Result	LCSD Result	LCS Rec.	LCSD Rec.	Rec. Limits	<u>LCS Qualifier</u>	<u>LCSD Qualifier</u>	RPD	RPD Limits
	%	%	%	%	%	%			%	%
Helium	2.50	2.37	2.31	94.8	92.4	70.0-130			2.56	25

¹Cp

²Tc

³Ss

⁴Cn

⁵Sr

⁶Qc

⁷Is

⁸Gl

⁹Al

¹⁰Sc

INTERNAL STANDARD SUMMARY

Instrument: AIRMS1 • File ID: 1115_02

11/15/21 08:49

Sample ID	File ID	BROMOCHLOROMETHANE Response	1,4-DIFLUOROBENZENE Response	CHLOROBENZENE-D5 Response
Standard	1115_02	197767	752184	681264
Upper Limit		352142	1310719	1205928
Lower Limit		150918	561737	516826
LCS R3729541-1 WG1774462 1x	1115_03	206540	785525	711278
BLANK R3729541-2 WG1774462 1x	1115_04	201879	778625	695877
LCSD R3729541-3 WG1774462 1x	1115_05	205837	787835	709797
L1431168-01 WG1774462 1x	1115_11	227568	872021	785939
L1431168-02 WG1774462 1x	1115_12	216727	832355	750139
L1431168-03 WG1774462 1x	1115_13	215052	828657	742390

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Is

8 Gl

9 Al

10 Sc

GLOSSARY OF TERMS

Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

Abbreviations and Definitions

MDL	Method Detection Limit.
ND	Not detected at the Reporting Limit (or MDL where applicable).
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier Description

J	The identification of the analyte is acceptable; the reported value is an estimate.
---	---



ACCREDITATIONS & LOCATIONS

Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey-NELAP	TN002
California	2932	New Mexico ¹	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina ¹	DW21704
Georgia	NELAP	North Carolina ³	41
Georgia ¹	923	North Dakota	R-140
Idaho	TN00003	Ohio-VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky ^{1,6}	KY90010	South Carolina	84004002
Kentucky ²	16	South Dakota	n/a
Louisiana	AI30792	Tennessee ^{1,4}	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas ⁵	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP,LLC EMLAP	100789
A2LA – ISO 17025 ⁵	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		

¹ Drinking Water ² Underground Storage Tanks ³ Aquatic Toxicity ⁴ Chemical/Microbiological ⁵ Mold ⁶ Wastewater n/a Accreditation not applicable

* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

¹ Cp

² Tc

³ Ss

⁴ Cn

⁵ Sr

⁶ Qc

⁷ Is

⁸ Gl

⁹ Al

¹⁰ Sc

Company Name/Address: **Maul Foster & Alongi- Coeur d Alene, ID**
 601 East Front Avenue, Suite 202

Billing Information: **Accounts Payable - Stephanie Ashmore**
 400 E Mill Plain Blvd., Ste. 400
 Vancouver, WA 98660

Report to: **Lisa Pritzl**

Project Description: **WSU Steam Plant, Pullman, Washington**

City/State Collected: _____ Please Circle: **PT MT CT ET**

Phone: **208-664-7883** Client Project #: **0457.02.03** Lab Project #: **MAUFOSCID-04570203**


Collected by (print): **L Pritzl** Site/Facility ID #: **WSU Steam Plant** P.O. #: _____

Collected by (signature): *[Signature]* **Rush? (Lab MUST Be Notified)** Quote #: _____

Immediately Packed on Ice **N** *NA* **Same Day** **Five Day**
Next Day **5 Day (Rad Only)**
Two Day **10 Day (Rad Only)**
Three Day

Date Results Needed: _____ No. of Cntrs: _____

Chain of Custody Page ___ of ___



12065 Lebanon Rd Mount Juliet, TN 37122
 Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: <https://info.pacelabs.com/hubfs/pas-standard-terms.pdf>

SDG # **4431168**

Table # **L-081**

Acctnum: **MAUFOSCID**

Template: **T198741**

Prelogin: **P885393**

PM: **110 - Brian Ford**

PB: *[Signature]* **11/04/21**

Shipped Via: **FedEX Saver**

Remarks: _____ Sample # (lab only): _____

Sample ID	Comp/Grab	Matrix *	Depth	Date	Time	No. of Cntrs	VOCs TO-15 Summa	VOCs TO-15 Fedlar	Helium
VP-1	G	Air		11/12/21	1121	X	X	X	
VP-2	G	Air			1219	X	X	X	
VP-3	G	Air			1248	X	X	X	
		Air							
		Air							
		Air							

* Matrix: **SS - Soil AIR - Air F - Filter**
GW - Groundwater B - Bioassay
WW - WasteWater
DW - Drinking Water
OT - Other

Remarks: _____

Samples returned via: UPS FedEx Courier _____ Tracking # **5349 7813 0098**

Relinquished by: (Signature) *[Signature]* Date: **11/12/21** Time: **1600** Received by: (Signature) _____ Temp: **Amb** °C Bottles Received: **3**

Relinquished by: (Signature) _____ Date: _____ Time: _____ Received by: (Signature) _____ Date: **11-13-21** Time: **0900**

Relinquished by: (Signature) _____ Date: _____ Time: _____ Received for lab by: (Signature) **B. Baucus** Date: _____ Time: _____ Hold: _____ Condition: **NCF / OK**

Sample Receipt Checklist

COC Seal Present/Intact:	NP	Y	N
COC Signed/Accurate:		X	N
Bottles arrive intact:		X	N
Correct bottles used:		X	N
Sufficient volume sent:		X	N
If Applicable			
VOA Zero Headspace:		Y	N
Preservation Correct/Checked:		Y	N
RAD Screen <0.5 mR/hr:		F	N

APPENDIX E

DATA VALIDATION MEMORANDUM



DATA QUALITY ASSURANCE/QUALITY CONTROL REVIEW

PROJECT NO. M0457.02.003 | NOVEMBER 29, 2021 | PORT OF WHITMAN COUNTY

Maul Foster & Alongi, Inc., conducted an independent stage 2A review of the quality of analytical results for groundwater, soil, air, and associated quality control samples collected at the former Washington State University Steam Plant site on October 12 and 19, 2021.

Pace Analytical National Center for Testing and Innovation (Pace-N) performed the analyses. Pace-N report numbers L1421071 and L1431168 were reviewed. The analyses performed and samples analyzed are listed below.

Analysis	Reference
Diesel- and residual-range-organics	NWTPH-Dx
Helium	ASTM D1946-1990
Polychlorinated biphenyls as Aroclors	EPA 8082A
Polycyclic aromatic hydrocarbons	EPA 8270E-SIM
Total mercury	EPA 7470A/7471B
Total metals	EPA 6020B
Total solids	SM 2540G-2011
Volatile organic compounds–groundwater and soil	EPA 8260D
Volatile organic compounds–air	TO-15
NOTES: ASTM = ASTM International. EPA = U.S. Environmental Protection Agency. NWTPH = Northwest Total Petroleum Hydrocarbons. SIM = selected ion monitoring. SM = Standard Methods for the Examination of Water and Wastewater. TO = toxic organics.	

Samples Analyzed		
Report L1421071		Report L1431168
SB-1-2.5	SB-7-18.5	VP-1
SB-1-15	TRIP BLANK-SOIL COOLER	VP-2
SB-2-2.0	SB-1-GW	VP-3
SB-2-15.0	SB-2-GW	--
SB-3-5.0	SB-5-GW	--
SB-3-13.0	SB-3-GW	--
SB-5-5.0	SB-7-GW	--
SB-5-15.0	TRIP BLANK-WATER	--
SB-7-5.5	--	--

DATA QUALIFICATION

Analytical results were evaluated according to applicable sections of U.S. Environmental Protection Agency (EPA) guidelines for data review (EPA, 2020a,b) and appropriate laboratory- and method-specific guidelines (EPA, 1986; Pace-N, 2020).

Data validation procedures were modified, as appropriate, to accommodate quality control requirements for methods that EPA data review procedures do not specifically address (e.g., NWTPH-Dx).

Based on the results of the data quality review procedures described below, the data are considered acceptable for their intended use, with the appropriate final data qualifiers assigned. Final data qualifiers represent qualifiers originating from the laboratory and accepted by the reviewer, as well as data qualifiers assigned by the reviewer during validation.

- Final data qualifiers:
 - J = result is estimated.
 - J+ = result is estimated with a potential high bias.
 - U = result is non-detect at the method detection limit (MDL) or at the method reporting limit (MRL).
 - UJ = result is non-detect with an estimated MDL.

The reviewer confirmed that each air sample provided for report L1431168 was collected under a helium shroud to detect leaks in the collection system. The associated sample results were non-detect for helium to MRLs.

HOLDING TIMES, PRESERVATION, AND SAMPLE STORAGE

Holding Times

Extractions and analyses were performed within the recommended holding time criteria.

R:\0457.02 Port of Whitman County\Documents\003_2022.03.30 FSA Report\Appendix E_Data Validation Memorandum\DVM_SteamPlant-IPG_Oct2021.docx

Preservation and Sample Storage

According to the chain-of-custody form (COC) provided in report L1421071, the hydrochloric acid preservative was removed and rinsed from the 100-milliliter amber glass containers prior to sample collection. These containers were used for EPA Method 8082A analysis, which required unpreserved amber containers. The reviewer confirmed that, per Pace-N's instruction, the field sampler removed the preservative by rinsing the 100-milliliter amber containers with bottled water. All samples were non-detect for EPA Method 8082A polychlorinated biphenyls; thus, qualification was not required.

The remaining samples were preserved and stored appropriately.

BLANKS

Method Blanks

Laboratory method blanks are used to assess whether laboratory contamination was introduced during sample preparation and analysis. Laboratory method blank analyses were performed at the required frequencies. For purposes of data qualification, the laboratory method blanks were associated with all samples prepared in the analytical batch.

According to report L1421071, the SM 2540G-2011 batch WG1762222 and WG1762223 laboratory method blanks had low total solids results. The associated sample results were all greater than ten times the laboratory method blank results; thus, qualification was not required.

According to report L1421071, the EPA Method 6020B batch WG1763394 laboratory method blank had a detection of total chromium between the MDL and MRL, at 1.77 micrograms per liter (ug/L). All associated detected results were greater than the MRL but less than five times the laboratory method blank concentration; these results have been qualified by the reviewer with "J+," as estimated with a potential high bias.

Report	Sample	Component	Method Blank Result (ug/L)	Original Result (ug/L)	Qualified Result (ug/L)
L1421071	SB-1-GW	Total chromium	1.77 J	3.32	3.32 J+
	SB-2-GW			4.32	4.32 J+
	SB-5-GW			7.09	7.09 J+
	SB-3-GW			2.45	2.45 J+
NOTES: J = result is estimated. J+ = result is estimated with a potential high bias. ug/L = micrograms per liter.					

According to report L1421071, the EPA Method 8260D batch WG1763431 laboratory method blank had a detection of 2-butanone between the MDL and MRL at 0.0696 milligrams per kilogram (mg/kg). The associated sample results were non-detect; thus, qualification was not required.

According to report L1431168, the EPA Method TO-15 batch WG1774462 laboratory method blank had a detection of propene between the MDL and MRL at 0.0978 parts per billion by volume. The associated sample results were non-detect; thus, qualification was not required.

All remaining laboratory method blank results were non-detect to MDLs for all target analytes.

Equipment Rinsate Blanks

Equipment rinsate blanks are used to evaluate field equipment decontamination. Equipment rinsate blanks were not submitted for analysis.

Trip Blanks

Trip blanks are used to evaluate whether volatile organic compound contamination was introduced during sample storage and shipment between the sampling location and the laboratory.

Two trip blank samples (TRIP BLANK-SOIL COOLER and TRIP BLANK-WATER COOLER) were submitted with the sample delivery group L1421071 for EPA Method 8260D analysis.

Trip blank TRIP BLANK-SOIL COOLER had a detection of acetone above the MRL at 1.51 ug/L. Pace-N also indicated that the trip blank acetone result was estimated with a potential high bias due to association with a continuing calibration verification (CCV) sample with a high acetone percent recovery. Sample SB-5-5.0 had a detection of acetone below the MRL at 0.0733 mg/kg. Because the both the trip blank and sample concentrations were estimated, the reviewer determined that assessment against a wider range of potential impact from storage or shipment contamination was appropriate. The reviewer qualified the sample result with “U,” as non-detect at the MRL, as shown in the table below.

The remaining soil samples were non-detect for acetone; thus, additional qualification was not required.

Report	Sample	Component	Original Result (mg/kg)	Qualified Result (mg/kg)
L1421071	SB-5-5.0	Acetone	0.0733 J	0.0941 U
NOTES: J = result is estimated. mg/kg = milligrams per kilogram. U = result is non-detect at the method reporting limit.				

The trip blank TRIP BLANK-WATER COOLER was non-detect to MDLs for all target analytes.

LABORATORY CONTROL SAMPLE/LABORATORY CONTROL SAMPLE DUPLICATE RESULTS

A laboratory control sample (LCS) and a laboratory control sample duplicate (LCSD) are spiked with target analytes to provide information about laboratory precision and accuracy. The LCS/LCSD samples were extracted and analyzed at the required frequency. An LCSD was not reported with SM 2540G-2011; batch precision was evaluated with laboratory duplicate results. For remaining analytical batches, where LCSD results were not reported, batch precision was evaluated with matrix spike (MS) and matrix spike duplicate (MSD) results.

According to report L1421071, the EPA Method 8260D batch WG1761975 LCS and LCSD results for bromodichloromethane and dibromomethane were above upper percent recovery acceptance limits, ranging from 127 percent to 129 percent. The associated sample results were non-detect; thus, qualification was not required.

According to report L1421071, the EPA Method 8260D batch WG1763302 LCS and LCSD vinyl acetate results exceeded the relative percent difference (RPD) control limit of 20 percent, at 40.9 percent. The associated sample result was non-detect; thus, qualification was not required.

According to report L1421071, the EPA Method 8082A batch WG1761898 LCS result for Aroclor 1016 was flagged by Pace-N because the RPD for the confirmation analysis exceeded the control limit of 40 percent. The associated sample results were non-detect; thus, qualification was not required.

According to report L1421071, the EPA Method 8270E-SIM batch WG1762605 LCS and LCSD exceeded RPD control limits of 20 percent for benzo(g,h,i)perylene; benzo(k)fluoranthene; dibenz(a,h)anthracene; and indeno(1,2,3-cd)pyrene; ranging from 20.7 percent to 23.3 percent. The LCS and LCSD percent recoveries were acceptable, and the associated sample results were non-detect; thus, qualification was not required.

All remaining LCS/LCSD results were within acceptance limits for percent recovery and RPD.

LABORATORY DUPLICATE RESULTS

Laboratory duplicate results are used to evaluate laboratory precision. All laboratory duplicate samples were extracted and analyzed at the required frequencies. Laboratory duplicate results within five times the MRL were not evaluated for precision. Laboratory duplicate samples were reported only with SM 2540G-2011 quality control results. Batch precision was evaluated with LCS/LCSD or MS/MSD results

All laboratory duplicate results met RPD acceptance criteria.

MATRIX SPIKE/MATRIX SPIKE DUPLICATE RESULTS

MS/MSD results are used to evaluate laboratory precision and accuracy as well as the effect of the sample matrix on sample preparation and analysis. All MS/MSD samples were prepared and analyzed at the required frequencies. When MS/MSD percent recoveries and RPDs were outside acceptance limits because of high concentrations of analyte in the sample, no qualifications were made by the reviewer. MS/MSDs are not required for EPA Method TO-15 and so were not reported by Pace-N.

MS/MSD percent recovery and RPD control limit exceedances did not require qualification in cases where the MS/MSD had been prepared by the laboratory with samples from unrelated projects because MS/MSD with these sample matrices were not representative of project sample matrices.

According to report L1421071, the EPA Method 8260D batch WG1763431 MS and MSD exceeded RPD control limits for most volatile organic compounds. The reviewer confirmed that the MSD had lower percent recoveries for most analytes, which likely contributed to the RPD exceedances. Associated detected sample results were qualified by the reviewer with “J,” as estimated. Associated results detected below the MRL were already flagged by Pace-N as estimated; additional qualification was not required. Qualification of associated non-detect results was also not required.

Report	Sample	Component	Original Result (mg/kg)	Qualified Result (mg/kg)
L1421071	SB-1-2.5	Benzene	0.00527	0.00527 J
		n-Butylbenzene	0.00877 J	0.00877 J
		Ethylbenzene	0.0172	0.0172 J
		Isopropylbenzene	0.00503	0.00503 J
		p-Isopropyltoluene	0.0152	0.0152 J
		n-Propylbenzene	0.00566 J	0.00566 J ^(a)
		1,2,4-Trimethylbenzene	0.0485	0.0485 J
		1,3,5-Trimethylbenzene	0.0122	0.0122 J
		Total xylenes	0.112	0.112 J
NOTES: J = result is estimated. mg/kg = milligrams per kilogram. ^(a) Result detected below the MRL; additional qualification not required.				

According to report L1421071, the EPA Method 8270E-SIM batch WG1764422 MSD results for naphthalene, 1-methylnaphthalene, and 2-methylnaphthalene were below lower percent recovery acceptance limits with naphthalene at 3.83 percent, 1-methylnaphthalene at 5.10 percent, and 2-methylnaphthalene with no recovery. The associated MS results had low but acceptable percent recovery, at 12.0 percent, 30.6 percent, and 11.5 percent, respectively. Pace-N noted that the recoveries were impacted by the sample matrix. The reviewer confirmed that the associated sample concentrations were not high enough to impact percent recovery calculations. The associated sample results were qualified by the reviewer with “J,” as estimated.

Report	Sample	Component	Original Result (mg/kg)	Qualified Result (mg/kg)
L1421071	SB-5-5.0	Naphthalene	0.105	0.105 J
		1-Methylnaphthalene	0.138	0.138 J
		2-Methylnaphthalene	0.195	0.195 J
NOTES: J = result is estimated. mg/kg = milligrams per kilogram.				

All remaining MS/MSD results were within acceptance limits for percent recovery and RPD.

SURROGATE RECOVERY RESULTS

The samples were spiked with surrogate compounds to evaluate laboratory performance for individual samples. The laboratory appropriately documented and qualified surrogate outliers. The reviewer took no action based on surrogate percent recoveries that were outside acceptance limits because of dilutions necessary to quantify high concentrations of target analytes present in the samples. The reviewer confirmed that batch quality assurance/quality control results for samples with surrogate outliers were within acceptance limits.

According to report L1421071, the NWTPH-Dx surrogate o-terphenyl result for sample SB-1-GW was below the lower percent recovery acceptance limit of 52.0 percent, at 50.5 percent. The associated sample results were non-detect and have been qualified by the reviewer with “UJ,” as non-detect with an estimated detection limit.

Report	Sample	Component	Original Result (ug/L)	Qualified Result (ug/L)
L1421071	SB-1-GW	Diesel-range organics	66.7 U	66.7 UJ
		Residual-range organics	83.3 U	83.3 UJ
NOTES: U = result is non-detect at the method detection limit. ug/L = micrograms per liter. UJ = result is non-detect with an estimated detection limit.				

All remaining surrogate results were within percent recovery acceptance limits.

CONTINUING CALIBRATION VERIFICATION RESULTS

CCV results are used to demonstrate instrument precision and accuracy through the end of the sample batch. Pace-N did not report CCV results but flagged sample results associated with CCV control limit exceedances. When surrogate or batch quality control results were flagged by the laboratory based on CCV exceedances but met percent recovery and/or RPD acceptance criteria, no action was required by the reviewer.

According to report L1421071, the EPA Method 8260D chloromethane; 1,1-dichloroethene; 2,2-dichloropropane; 1,1,2-trichlorotrifluoromethane; and vinyl chloride results for all soil samples; and tert-butylbenzene; 1,2-dibromo-3-chloropropane; and naphthalene results for TRIP BLANK-SOIL COOLER were flagged by Pace-N as estimated due to associated CCV results with low percent recoveries. Pace-N indicated that MRL sensitivity was demonstrated. The associated sample results were non-detect and have been qualified by the reviewer with “UJ,” as non-detect with estimated detection limits.

Report	Sample	Component	Original Result (mg/kg)	Qualified Result (mg/kg)
L1421071	SB-1-2.5	Chloromethane	0.00564 U	0.00564 UJ
		1,1-Dichloroethene	0.000785 U	0.000785 UJ
		2,2-Dichloropropane	0.00179 U	0.00179 UJ
		1,1,2-Trichlorotrifluoroethane	0.000977 U	0.000977 UJ
		Trichlorofluoromethane	0.00107 U	0.00107 UJ
		Vinyl chloride	0.00150 U	0.00150 UJ
	SB-1-15	Chloromethane	0.00618 U	0.00618 UJ
		1,1-Dichloroethene	0.000860 U	0.000860 UJ
		2,2-Dichloropropane	0.00196 U	0.00196 UJ
		1,1,2-Trichlorotrifluoroethane	0.00107 U	0.00107 UJ
		Trichlorofluoromethane	0.00117 U	0.00117 UJ
		Vinyl chloride	0.00165 U	0.00165 UJ
	SB-2-2.0	Chloromethane	0.00632 U	0.00632 UJ
		1,1-Dichloroethene	0.000880 U	0.000880 UJ
		2,2-Dichloropropane	0.00201 U	0.00201 UJ
		1,1,2-Trichlorotrifluoroethane	0.00110 U	0.00110 UJ
		Trichlorofluoromethane	0.00120 U	0.00120 UJ
		Vinyl chloride	0.00160 U	0.00160 UJ
	SB-2-15.0	Chloromethane	0.00632 U	0.00632 UJ
		1,1-Dichloroethene	0.000881 U	0.000881 UJ
		2,2-Dichloropropane	0.00201 U	0.00201 UJ
		1,1,2-Trichlorotrifluoroethane	0.00110 U	0.00110 UJ
		Trichlorofluoromethane	0.00120 U	0.00120 UJ
		Vinyl chloride	0.00169 U	0.00169 UJ
	SB-3-5.0	Chloromethane	0.00641 U	0.00641 UJ
		1,1-Dichloroethene	0.000893 U	0.000893 UJ
		2,2-Dichloropropane	0.00203 U	0.00203 UJ
		1,1,2-Trichlorotrifluoroethane	0.00111 U	0.00111 UJ
		Trichlorofluoromethane	0.00122 U	0.00122 UJ
		Vinyl chloride	0.00171 U	0.00171 UJ
SB-3-13.0	Chloromethane	0.00593 U	0.00593 UJ	
	1,1-Dichloroethene	0.000827 U	0.000827 UJ	
	2,2-Dichloropropane	0.00188 U	0.00188 UJ	
	1,1,2-Trichlorotrifluoroethane	0.00103 U	0.00103 UJ	
	Trichlorofluoromethane	0.00113 U	0.00113 UJ	

Report	Sample	Component	Original Result (mg/kg)	Qualified Result (mg/kg)
		Vinyl chloride	0.00158 U	0.00158 UJ
	SB-5-5.0	Chloromethane	0.00819 U	0.00819 UJ
		1,1-Dichloroethene	0.00114 U	0.00114 UJ
		2,2-Dichloropropane	0.00260 U	0.00260 UJ
		1,1,2-Trichlorotrifluoroethane	0.00142 U	0.00142 UJ
		Trichlorofluoromethane	0.00156 U	0.00156 UJ
		Vinyl chloride	0.00219 U	0.00219 UJ
	SB-5-15.0	Chloromethane	0.00622 U	0.00622 UJ
		1,1-Dichloroethene	0.000866 U	0.000866 UJ
		2,2-Dichloropropane	0.00197 U	0.00197 UJ
		1,1,2-Trichlorotrifluoroethane	0.00108 U	0.00108 UJ
		Trichlorofluoromethane	0.00118 U	0.00118 UJ
		Vinyl chloride	0.00166 U	0.00166 UJ
	SB-7-5.5	Chloromethane	0.00772 U	0.00772 UJ
		1,1-Dichloroethene	0.00108 U	0.00108 UJ
		2,2-Dichloropropane	0.00245 U	0.00245 UJ
		1,1,2-Trichlorotrifluoroethane	0.00134 U	0.00134 UJ
		Trichlorofluoromethane	0.00147 U	0.00147 UJ
		Vinyl chloride	0.00206 U	0.00206 UJ
	SB-7-18.5	Chloromethane	0.00698 U	0.00698 UJ
		1,1-Dichloroethene	0.000972 U	0.000972 UJ
		2,2-Dichloropropane	0.00221 U	0.00221 UJ
		1,1,2-Trichlorotrifluoroethane	0.00121 U	0.00121 UJ
		Trichlorofluoromethane	0.00133 U	0.00133 UJ
Vinyl chloride		0.00186 U	0.00186 UJ	
NOTES: mg/kg = milligrams per kilogram. U = result is non-detect at the method detection limit. UJ = result is non-detect with an estimated detection limit.				

According to report L1421071, the EPA Method 8260D acetone results for all trip blank and groundwater samples and the chloroform result for sample SB-7-GW were flagged by Pace-N as estimated due to associated CCV results with high percent recoveries. The sample results have been qualified by the reviewer with “J,” as estimated. All EPA Method 8260D groundwater sample results for tert-butylbenzene, 1,2-dibromo-3-chloropropane, and naphthalene; and the trip blank sample TRIP BLANK-WATER COOLER results for bromomethane; hexachloro-1,3-butadiene; and naphthalene were flagged by Pace-N as estimated due to associated CCV results with low percent recoveries. Pace-N indicated that

MRL sensitivity was demonstrated for all of these CCV exceedances. The associated sample results were non-detect and have been qualified by the reviewer with “UJ,” as non-detect with estimated detection limits. Qualifications are shown in the table below.

The EPA Method 8260D 1,2,3-trichlorobenzene and 1,2,4-trichlorobeznene results for sample TRIP BLANK-WATER COOLER were flagged by Pace-N as estimated with potential low bias due to association with a CCV that had results below the lower percent recovery acceptance limit. The reviewer confirmed that reporting limit sensitivity was not demonstrated by the laboratory. Because the sample results were non-detect, potentially biased low, and reporting limit sensitivity was not demonstrated by Pace-N, the reviewer raised MDLs to MRLs by qualifying the results with “U,” as non-detect at the MRL in the table below.

Report	Sample	Component	Original Result (ug/L)	Qualified Result (ug/L)
L1421071	TRIP BLANK-SOIL COOLER	Acetone	1.51	1.51 J
		tert-Butylbenzene	0.0620 U	0.0620 UJ
		1,2-Dibromo-3-chloropropane	0.204 U	0.204 UJ
		Naphthalene	0.124 U	0.124 UJ
	SB-1-GW	Acetone	3.07	3.07 J
		tert-Butylbenzene	0.0620 U	0.0620 UJ
		1,2-Dibromo-3-chloropropane	0.204 U	0.204 UJ
		Naphthalene	0.124 U	0.124 UJ
	SB-2-GW	Acetone	2.65	2.65 J
		tert-Butylbenzene	0.0620 U	0.0620 UJ
		1,2-Dibromo-3-chloropropane	0.204 U	0.204 UJ
		Naphthalene	0.124 U	0.124 UJ
	SB-5-GW	Acetone	2.65	2.65 J
		tert-Butylbenzene	0.0620 U	0.0620 UJ
		1,2-Dibromo-3-chloropropane	0.204 U	0.204 UJ
		Naphthalene	0.124 U	0.124 UJ
	SB-3-GW	Acetone	1.41	1.41 J
		tert-Butylbenzene	0.0620 U	0.0620 UJ
		1,2-Dibromo-3-chloropropane	0.204 U	0.204 UJ
		Naphthalene	0.124 U	0.124 UJ
SB-7-GW	Acetone	20.4	20.4 J	
	tert-Butylbenzene	0.0620 U	0.0620 UJ	
	Chloroform	0.205	0.205 J	
	1,2-Dibromo-3-chloropropane	0.204 U	0.204 UJ	
	Naphthalene	0.124 U	0.124 UJ	

Report	Sample	Component	Original Result (ug/L)	Qualified Result (ug/L)
	TRIP BLANK-WATER COOLER	Bromomethane	0.148	0.148 J
		Hexachloro-1,3-butadiene	0.508 U	0.508 UJ
		Naphthalene	0.124 U	0.124 UJ
		1,2,3-Trichlorobenzene	0.0250 U	0.5400 U
		1,2,4-Trichlorobenzene	0.193 U	0.500 U
NOTES: J = result is estimated. U = result is non-detect at the method detection limit/method reporting limit. ug/L = micrograms per liter. UJ = result is non-detect with an estimated detection limit.				

FIELD DUPLICATE RESULTS

Field duplicate samples measure both field and laboratory precision. Field duplicate samples were not submitted for analysis.

REPORTING LIMITS

Pace-N reported non-detect soil and groundwater results to MDLs and non-detect air results to MRLs. Pace-N also reported MRLs, which were labeled as reporting detection limits in the laboratory report. Samples requiring dilutions because of high analyte concentrations and/or matrix interferences were reported with raised MDLs and/or MRLs. Results detected between MDLs and MRLs were flagged by Pace-N with “J,” as estimated.

DATA PACKAGE

The data package was reviewed for transcription errors, omissions, and anomalies.

According to report L1421071, the trip blank sample names were provided on the COC as “TripBlank-Soil Cooler” and “TRIP Blank-Water Cooler” but were reported by Pace-N as “TRIP BLANK-SOIL COOLER” and “TRIP BLANK-WATER COOLER” instead. The changes made to the sample names by Pace-N were limited to capitalization and so were considered minor by the reviewer. No action was required.

According to the COC included with report L1431168, the sample collection date was not recorded for samples VP-2 and VP-3. The reviewer confirmed that the sample collection date was November 12, 2021, for both samples. The correct sample collection date was reported by Pace-N. No additional action was required. No additional issues were found.

REFERENCES

EPA. 1986. Test methods for evaluating solid waste, physical/chemical methods. EPA publication SW-846. 3d ed. U.S. Environmental Protection Agency. Final updates I (1993), II (1995), IIA (1994), IIB (1995), III (1997), IIIA (1999), IIIB (2005), IV (2008), V (2015), VI phase I (2017), VI phase II (2018), VI phase III (2019).

EPA. 2020a. EPA contract laboratory program, national functional guidelines for inorganic Superfund methods data review. EPA 542-R-20-006. U.S. Environmental Protection Agency, Office of Superfund Remediation and Technology Innovation. November.

EPA. 2020b. EPA contract laboratory program, national functional guidelines for organic Superfund methods data review. EPA 540-R-20-005. U.S. Environmental Protection Agency, Office of Superfund Remediation and Technology Innovation. November.

Pace-N. 2020. Laboratory quality manual. Revision 05. Pace Analytical Services, LLC. Mt. Juliet, Tennessee. November 13.

APPENDIX D

HAZARDOUS MATERIALS SURVEY REPORT



HAZARDOUS MATERIALS SURVEY REPORT

COLLEGE AVENUE STEAM PLANT
PULLMAN, WASHINGTON



Prepared for
PORT OF WHITMAN COUNTY
December 2, 2021
Project No. 0457.02.03

Prepared by
Maul Foster & Alongi, Inc.
601 East Front Ave., Suite 202, Coeur d'Alene, ID 83814

HAZARDOUS MATERIALS SURVEY REPORT
COLLEGE AVENUE STEAM PLANT
PULLMAN, WASHINGTON


*The material and data in this report were prepared
under the supervision and direction of the undersigned.*

MAUL FOSTER & ALONGI, INC.



Emily Curtis

*Project Health, Safety, and Environmental Specialist
AHERA Building Inspector Number IR-21-6100B*



Sean Maloney

*Staff Geologist
AHERA Building Inspector Number IN-20-8991B*

CONTENTS

TABLES AND ILLUSTRATIONS	IV
ACRONYMS AND ABBREVIATIONS	V
EXECUTIVE SUMMARY	VI
1 INTRODUCTION	1
1.1 MATERIAL SURVEY OBJECTIVE	1
1.2 REGULATORY FRAMEWORK	1
2 BACKGROUND	1
3 FIELD AND ANALYTICAL METHODS	2
3.1 ASBESTOS-CONTAINING MATERIAL	2
3.2 LEAD-BASED PAINT	2
3.3 MERCURY, POLYCHLORINATED BIPHENYLS, AND OTHER MATERIALS	3
4 ASSESSMENT RESULTS	3
4.1 ASBESTOS-CONTAINING MATERIAL	3
4.2 LEAD-BASED PAINT	4
4.3 MERCURY, POLYCHLORINATED BIPHENYLS, AND OTHER MATERIALS	5
5 SUMMARY AND RECOMMENDATIONS	5
5.1 RECOMMENDATIONS	6
LIMITATIONS	
REFERENCES	
TABLES	
FIGURES	
APPENDIX A	
AHERA CERTIFICATES	
APPENDIX B	
FIELD SAMPLING DATA SHEETS	
APPENDIX C	
LABORATORY ANALYTICAL REPORTS	

TABLES AND ILLUSTRATIONS

FOLLOWING REPORT:

TABLES

- 3-1 HAZARDOUS BUILDING MATERIALS SURVEY SUMMARY
- 4-1 SUMMARY OF ASBESTOS SAMPLE RESULTS
- 4-2 SUMMARY OF LEAD-BASED PAINT SAMPLE RESULTS

FIGURES

- 1-1 SITE FEATURES
- 3-1 FIRST FLOOR AND EXTERIOR—ASBESTOS
- 3-2 MEZZANINE—ASBESTOS
- 3-3 UPPER MEZZANINE—ASBESTOS
- 3-4 BASEMENT—ASBESTOS
- 3-5 FIRST FLOOR—LEAD
- 3-6 MEZZANINE—LEAD
- 3-7 UPPER MEZZANINE—LEAD
- 3-8 BASEMENT—LEAD
- 3-9 SUBBASEMENT—LEAD

ACRONYMS AND ABBREVIATIONS

ACM	asbestos-containing material
AHERA	Asbestos Hazard Emergency Act
EPA	U.S. Environmental Protection Agency
FSDS	field sampling data sheet
LBP	lead-based paint
MFA	Maul Foster & Alongi, Inc.
PCB	polychlorinated biphenyl
the Port the Site	Port of Whitman County College Avenue Steam Plant, 800 NE College Ave, Pullman, WA
WSU	Washington State University
XRF	X-ray fluorescence

EXECUTIVE SUMMARY

This summary is not intended as a stand-alone document and must be evaluated in context with the entire document.

On behalf of the Port of Whitman County (the Port), Maul Foster & Alongi, Inc., conducted a hazardous materials survey at the College Avenue Steam Plant site at 800 NE College Ave, Pullman, Washington, 99163. The purpose of the survey was to identify building materials that may require special handling and/or disposal during demolition or construction activities.

The survey included assessment of painted surfaces for the presence of lead-based paint, collection of samples to assess the presence of asbestos-containing materials, and identification of other potentially hazardous materials that may require abatement and/or management in the future. The following regulated building materials were identified during the survey:

Regulated Material	General Description ^(a)	Estimated Quantity ^(b)
Asbestos	Window glazing	4,030 linear feet
	Red paint-coated pipe wrap with compacted white insulation	20 linear feet
	White/gray compacted insulation with white-, silver-, orange-, or tan-painted wrap	3,000 linear feet
	White patch on gray pipe	5 linear feet
	Fire hose	1 hose in room 101. Assumed to be asbestos-containing material.
	Tan 12 x 12-inch vinyl floor tile with black mastic	3,000 square feet
	Fire-resistant board	1 board in room 105. Assumed to be asbestos-containing material.
	Tan 9 x 9-inch vinyl floor tile with black mastic	16 square feet
	Light tan patterned 9 x 9-inch vinyl floor tile with black mastic	76 square feet
	Brown vinyl floor tile	66 square feet
	Brown vinyl floor tile with black mastic	175 square feet
	Brown stipple-patterned 9 x 9-inch vinyl floor tile with black mastic	20 square feet
	White insulation with tan/white-painted woven fibrous mesh	35 linear feet

Regulated Material	General Description ^(a)	Estimated Quantity ^(b)	
Asbestos	White insulation with silver-painted woven fibrous cover	200 square feet	
	Asbestos dust	Door to room 301 has warning of asbestos-containing dust hazard in room.	
	White crumbly insulation with yellow woven fibrous mesh and silver paint	600 linear feet	
	White crumbly insulation with white fibrous felt and brown paint	1,200 linear feet	
	White crumbly insulation with white woven fibrous wrap and red paint	40 linear feet	
	Silver woven heat-resistant furnace door lining	80 linear feet	
	White insulation with gray painted wrap and fabric patch on elongated tank	20 linear feet	
	Orange-painted wrap and gray crumbly insulation	20 linear feet	
	Tan 1 x 1-inch and 2 x 2-inch flooring tile with brown adhesive	180 square feet	
	Tan cove base with green adhesive	60 linear feet	
	Lead-based paint	Brown paint	70 linear feet
		Brownish red paint	272 linear feet
Red paint		1,660 square feet	
Orange paint		3,950 square feet	
Yellow paint		740 linear feet	
Green paint		164 square feet	
White paint		3,386 square feet	
Bright white paint		280 linear feet	
Silver paint		3,025 square feet	
Gray paint		729 square feet	
Light tan paint		24 square feet	

Regulated Material	General Description ^(a)	Estimated Quantity ^(b)
Potentially PCB-containing fixtures and other hazardous materials ^(c)	Electrical boxes/panels	39 boxes/panels, including electrical boxes, control boxes, motor control centers, and a safety switch. Potentially PCB-containing.
	Motors	1 motor associated with elevator; 1 motor in room 302; potentially numerous motors associated with boilers. Potentially PCB-containing. May also contain residual mechanical fluids, such as oil.
Potentially PCB-containing fixtures and other hazardous materials ^(c)	Miscellaneous containers	4 or more containers in room 15, 3 unmarked black cans in room 201, 1 unmarked jug and 1 container of turbine oil in room 302. May contain residual mechanical fluids, such as oil.
	Coal dust	Rooms 204 and 301. Potential breathing hazard due to abundant presence of coal and coal dust.
	Thermostats	2 thermostats. Potentially mercury-containing.
	Boiler control panels	Boiler equipment control panels marked as mercury-containing.
	Steam equipment	Numerous pipes and pieces of equipment. Potentially contains residual mechanical fluids, such as oil.
	Boilers	6 boilers. Potentially containing residual mechanical fluids and coal dust.
	Fluorescent light tubes	89 tubes. Potentially mercury-containing.
<p>NOTES: PCB = polychlorinated biphenyl. ^(a)Detailed descriptions are provided in the main report. ^(b)Detailed quantities and locations are provided in the main report. Asbestos and lead paint associated with pipes and other linear surfaces are reported in linear feet in the main report. ^(c)Detailed information is provided in the main report.</p>		

1 INTRODUCTION

On behalf of the Port of Whitman County (the Port), Maul Foster & Alongi, Inc. (MFA), conducted a hazardous materials survey at the College Avenue Steam Plant site at 800 NE College Avenue in Pullman Washington (the Site). MFA conducted the survey in October 2021. The Site location is provided in Figure 1-1. Areas that were inaccessible due to locked access points or hazardous conditions were not included in the survey. These areas include the roof, subbasement room B2, and basement tunnels in rooms 21 and 23.

The survey included the use of a portable X-ray fluorescence (XRF) device to screen materials for the presence of lead-based paint (LBP); sampling and analysis of suspected asbestos-containing materials (ACM); and visual inspection and tracking of suspected polychlorinated biphenyl (PCB)-containing fixtures, mercury-containing fixtures, and other potentially hazardous materials.

The survey was conducted by certified Asbestos Hazard Emergency Act (AHERA) building inspectors Sean Maloney, Emily Curtis, and Connor Anderson of MFA. AHERA building inspector certificates are provided in Appendix A.

1.1 Material Survey Objective

The objective of this survey was to identify building materials and components that may require abatement, special handling, or disposal during future demolition or construction activities.

1.2 Regulatory Framework

This survey was conducted consistent with regulatory requirements of AHERA in 40 Code of Federal Regulations 763; Washington Administrative Code 296-65; and the Washington Department of Ecology Eastern Regional Office, which administers clean air regulations for Whitman County.

2 BACKGROUND

The Site is located on the Washington State University (WSU) campus in Pullman, Washington. The Site is bound by Northeast College Avenue to the south, the WSU campus to the east, and a railroad line to the west. The surrounding area is largely residential, with a commercial area to the south. The former steam plant facility operated on the Site from 1927 to 2003.

3 FIELD AND ANALYTICAL METHODS

Between October 10 and 14, 2021, MFA conducted the field sampling and survey. The building-material survey was conducted to satisfy federal, state, and local air quality regulations regarding communicating the location, amount, and quality of known ACM and LBP at the Site, as well as to catalogue other potentially hazardous fixtures to be managed before renovation, construction, or demolition. The scope of work included the following:

- Collecting bulk samples of suspected ACMs.
- Using a portable XRF device to field-screen painted surfaces for the presence of lead in surface paint.
- Collecting quality control paint chip samples for laboratory analysis.
- Submitting suspected ACM bulk samples and paint chip samples to a laboratory accredited by the National Voluntary Laboratory Accreditation Program. Suspected ACM samples were analyzed by polarized light microscopy.
- Recording the location, quantity, and quality of hazardous building materials in homogeneous areas identified in the steam plant building.
- Identifying other potentially hazardous materials that may require abatement and/or management.

The survey involved the visual inspection of the interior and exterior of the designated structure.

3.1 Asbestos-Containing Material

MFA's survey of suspected ACM at the Site in the designated structure included collecting bulk samples of thermal system insulation, surfacing materials, and miscellaneous materials from homogeneous areas, consistent with AHERA sampling protocol.

Sampling locations were chosen by the inspectors based on identification of suspected ACM. See Figures 3-1 through 3-4 for ACM sampling locations.

Samples were extracted using hand tools and placed into labeled sample bags. For layered building materials, the layers were penetrated and incorporated into each sample. Samples were sent to NVL Laboratories, Inc., a National Voluntary Laboratory Accreditation Program-accredited laboratory, for analysis by U.S. Environmental Protection Agency (EPA) Polarized Light Microscopy Method 600/R-93-116.

3.2 Lead-Based Paint

MFA conducted a survey for interior and exterior paint coatings of the designated structures, which included XRF readings of each color and/or layer identified. The portable XRF unit used was an

Olympus Vanta C-Series with a reported accuracy range of 0.01 to 5 milligrams of lead per square centimeter. Paint with a concentration of lead detectable by this method is considered “lead-containing.” LBP is defined by the EPA and the Washington State Department of Health as paint containing lead concentrations of more than 5,000 parts per million (greater than 0.5 percent).

For quality assurance, MFA collected paint chip samples from approximately 5 percent of the representative XRF sampling locations. The identification of LBP summarized in this report is based on XRF results and confirmation paint chip samples collected from the structures.

See Figures 3-5 through 3-9 for sampling locations.

XRF readings were recorded on the field sampling data sheets (FSDSs) provided in Appendix B. Paint chip samples were placed into labeled sample bags and sent to NVL Laboratories, Inc., for analysis by EPA Method 3051/7000B.

3.3 Mercury, Polychlorinated Biphenyls, and Other Materials

MFA conducted a visual survey to identify fixtures that may contain mercury or PCBs. MFA also noted the presence of other potentially hazardous materials, such as residual hazardous chemicals in containers. Items were tracked on the FSDSs and are summarized in Table 3-1.

4 ASSESSMENT RESULTS

4.1 Asbestos-Containing Material

Sampling locations are provided in Figures 3-1 through 3-4, and sample results are summarized in Table 4-1. Laboratory reports are provided in Appendix C.

45 of the 156 samples analyzed contained more than 1 percent asbestos. ACM include the following:

- Window glazing on windows throughout the first floor, mezzanine, and upper mezzanine areas.
- Red paint-coated woven pipe wrap with fibrous insulation in room 101 near the double doors on the west side of the room.
- White and gray compacted/crumblly fibrous insulation with white-, silver-, orange-, and/or tan-painted mesh wrapping in the following areas:
 - Rooms 11, 21, 22, 23, 101, 200, and 204.
 - Intermediate catwalks extending from rooms 101 and 200, surrounding the boiler equipment.
 - On boiler components.

- Tan 12 x 12-inch vinyl floor tile with black mastic in room 102.
- Tan 9 x 9-inch vinyl flooring tiles in room 106T.
- Light tan patterned 9 x 9-inch vinyl flooring tiles with black mastic in rooms 106T, 200S, and 204, and in the stairwell from room 102 to the mezzanine.
- White stipple-patterned 12 x 12-inch flooring tiles and underlying brown vinyl tile in room 203.
- Layered light brown patterned 9 x 9-inch vinyl flooring tiles in room 203.
- Layered dark brown stipple-patterned 9 x 9-inch vinyl flooring tiles and associated black mastic in room 202.
- Tan, white, and silver-painted white compacted fibrous insulation on boiler components in room 101, 200, and in the unlabeled mezzanine area above.
- White insulation with silver-painted woven fibrous cover on boiler equipment by the entrance to the northeastern staircase above room 101.
- White crumbly insulation with yellow woven fibrous mesh and silver paint in rooms 21, 22, and 11.
- White crumbly insulation with white fibrous felt and brown paint in rooms 21, 22, and 11.
- White crumbly insulation with white woven fibrous wrap and red paint on steam equipment in room 11 by the spiral staircase.
- Silver woven heat-resistant furnace door lining in room 11 by the control wheels and conveying systems, and by the entrance to the subbasement.
- White insulation with gray-painted wrap and fabric patch on elongated tank in the northeast portion of room 11.
- Orange-painted wrap and gray crumbly insulation on vertical tank in center of room 11.
- Tan 1 x 1-inch and 2 x 2-inch flooring tile with brown adhesive in room 17.
- Tan cove base with green adhesive in west side of room 17.

4.2 Lead-Based Paint

XRF measurement locations and paint chip sampling locations are provided in Figures 3-5 through 3-9. XRF measurements and paint chip sample results are summarized in Table 4-2 and laboratory reports are provided in Appendix C.

Areas and features of the Site with lead content above the EPA-regulated definition of LBP include the following:

- Brown-, red-, orange-, yellow-, and green-painted pipes throughout the basement, room 101, and mezzanine.

- The brownish-red I-beams supporting room 204 surrounding the railroad tracks on the western exterior of the building.
- Red paint near the fire extinguisher in room 101.
- The red-painted box in the northwest corner of the basement.
- Red-, orange-, and white- painted pipe wrap throughout the basement.
- The orange-painted vertical tank in the basement.
- The orange and yellow pipes in the subbasement.
- Yellow paint on the concrete bench west of the north door in room 101.
- The green cabinets on the east side of room 101.
- Green-painted boiler equipment in the basement.
- White paint in room 107.
- Bright white- and tan-painted I-beams in the vicinity of the northwest boiler in the basement, room 101, mezzanine, and upper mezzanine.
- Silver pipes on the western exterior of the building near the railroad tracks.
- Silver- and red-painted steam equipment throughout the basement.
- Gray-painted I-beams in room 301.
- The gray-painted tank in room 18.
- The gray- and tan-painted door to room 15.
- Tan-painted pipes in the basement, room 101, mezzanine, and upper mezzanine.

4.3 Mercury, Polychlorinated Biphenyls, and Other Materials

Observations related to mercury-containing fixtures, PCB-containing fixtures, and other hazardous materials were tracked and recorded on the FSDSs provided in Appendix B. Results are summarized in Table 3-1.

Fixtures potentially containing PCBs, mercury, and other hazardous materials were identified at the Site.

5 SUMMARY AND RECOMMENDATIONS

Based on observations and the results of the material testing, MFA concludes the following:

- Other than pipes specifically marked as non-ACM, the majority of thermal system insulation associated with piping throughout the basement, first floor, mezzanine, and upper mezzanine areas is ACM.
- Window glazing throughout the first floor, mezzanine, and upper mezzanine is ACM.
- The various types of vinyl tile flooring in rooms 103, 104, 200S, 202, and 203 are ACM.
- There are LBP coatings and lead-containing paint throughout the interior and exteriors of the structure.
- Potentially hazardous-materials-containing fixtures are present throughout most of the Site.
- Coal dust residue is present in rooms 201, 204, 301, and 302.
- Room 301 is labeled as an asbestos-containing dust hazard.

5.1 Recommendations

This report should be made available to contractors during bidding on abatement, construction, or demolition work to be conducted on these structures. Prior to any disturbance activities at the site, identified hazardous materials should be abated by a licensed abatement contractor or safely managed in place consistent with a written operations and maintenance plan.

The Port should inform contractors that other hazardous materials or conditions may be discovered during the renovation and demolition activities, which may warrant additional remediation and/or corrective actions.

LIMITATIONS

The services undertaken in completing this report were performed consistent with generally accepted professional consulting principles and practices. No other warranty, express or implied, is made. These services were performed consistent with our agreement with our client. This report is solely for the use and information of our client unless otherwise noted. Any reliance on this report by a third party is at such party's sole risk.

Opinions and recommendations contained in this report apply to conditions existing when services were performed and are intended only for the client, purposes, locations, time frames, and project parameters indicated. We are not responsible for the impacts of any changes in environmental standards, practices, or regulations subsequent to performance of services. We do not warrant the accuracy of information supplied by others, or the use of segregated portions of this report.

TABLES



**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
Asbestos	Window glazing	On windows throughout room 101, mezzanine, and upper mezzanine	4,030 ln. ft.	Difficult to estimate quantity.
	Red paint-coated pipe wrap with compacted white insulation	Near double doors on west side of room 101	20 ln. ft	
	White / gray compacted insulation with white-, silver-, orange-, or red-painted wrap	Rooms 11, 21, 22, 23, 101, 200, 204, on boiler equipment, and by intermediate catwalks	3,000 ln. ft	Difficult to estimate quantity.
	White patch on gray pipe	North wall of room 101	5 ln. ft	
	Fire hose	Room 101 by west double doors	1 hose	Assumed asbestos containing material.
	Tan 12 x 12-inch vinyl floor tile with black mastic	North wall west of single doorway in room 102	3,000 sq. ft	
	Fire-resistant board	Room 105	1 board	Assumed asbestos-containing material in board.
	Tan 9 x 9-inch vinyl floor tile with black mastic	Room 106T	16 sq. ft	
	Light tan patterned 9 x 9-inch vinyl floor tile with black mastic	Room 106T and staircase to room 200S	76 sq. ft	
	Brown vinyl floor tile	Room 203	66 sq. ft	Layered under white stipple-patterned 12 x 12-inch vinyl floor tile with black mastic.
	Brown vinyl floor tile with black mastic	Room 202	175 sq. ft	Layered under light brown patterned 9 x 9-inch vinyl floor tile with black mastic.
Brown stipple-patterned 9 x 9-inch vinyl floor tile with black mastic	East side of room 202	20 sq. ft.	2-tile-wide line of darker tiles running east-west through the room.	

**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
Asbestos	White insulation with tan / white-painted woven fibrous mesh	Covering T-coupling and pipe in northeast corner of mezzanine	35 ln. ft	Accessed by catwalk near staircase entrance on northeast side of room.
	White insulation with silver-painted woven fibrous cover	Flat sheet on boiler equipment / duct by northeastern boiler	200 sq. ft	Difficult to quantify. Accessed by catwalk near staircase entrance on northeast side of room.
	Asbestos dust	Room 301	1 room	Door to room 301 contains warning of asbestos-containing dust hazard within room.
	White crumbly insulation with yellow woven fibrous mesh and silver paint	Room 21, 22, and 11	600 ln. ft	
	White crumbly insulation with white fibrous felt and brown paint	Room 21, 22, and 11	1,200 ln. ft	
	White crumbly insulation with white woven fibrous wrap and red paint	On steam equipment in room 11 by the spiral staircase	40 ln. ft	
	Silver woven heat-resistant furnace door lining	Room 11 by the control wheels, surveying system, and doorway to sub-basement	80 ln. ft	
	White insulation with gray-painted wrap and fabric patch on elongated tank	Northeast portion of room 11	20 ln. ft	

**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
Asbestos	Orange-painted wrap and gray crumbly insulation	Vertical tank in center of room 11	20 ln. ft	
	Tan 1 x 1-inch and 2 x 2-inch flooring tile with brown adhesive	Room 17	180 sq. ft	
	Tan cove base with green adhesive	Room 17	60 ln. ft	
Lead-Based Paint	Brown paint	Room 101; on pipes	70 ln. ft	
	Brownish red paint	Exterior; support beam of ash pit	272 ln. ft	
	Red paint	Throughout basement, room 101, and mezzanine	1,660 sq. ft	
	Orange paint	Throughout basement, room 101, and sub-basement; on pipes and TSI pipe wrap	645 ln. ft	
	Yellow paint	Basement, room 101, and mezzanine; on pipes and concrete bench	3950 sq. ft	
	Green paint	Basement and room 101; on pipes and cabinets	164 sq. ft	
	White paint	Room 101, room 107, and basement	3,386 sq. ft	
	Bright white paint	Basement; support in center of room between north boilers	280 ln. ft	
	Silver paint	Room 101 and mezzanine; on I-beams	3,025 ln. ft	
	Gray paint	Throughout basement and room 301	729 sq. ft	
	Light tan paint	Basement; door to room 15	24 sq. ft	

**Table 3-1
Hazardous Building Materials Survey Summary
College Avenue Steam Plant
Pullman, Washington**



Regulated Material	Material Description	Location Description	Estimated Quantity	Comments
PCB-Containing and Other Hazardous Materials	Electrical boxes/panels	Room 11, 101	39 boxes/panels	Potentially PCB-containing. Includes electrical boxes, control boxes, motor control centers, and a safety switch.
	Motors	Elevator in room 101 and room 11; room 302	1 motor associated with elevator; 1 motor in room 302; potentially numerous motors associated with boilers	Potentially PCB-containing. May also contain residual mechanical fluids, such as oil.
	Miscellaneous containers	Room 15	4 or more containers	May contain residual mechanical fluids, such as oil.
		Room 201	3 unmarked black cans	
		Room 302	1 unmarked jug and 1 turbine oil container	
	Coal dust	Rooms 204 and 301	2 rooms	Potential breathing hazard due to abundant presence of coal and coal dust.
	Mercury-containing thermostats	Rooms 104 and 105	2 thermostats	Potentially mercury-containing.
	Mercury-containing fixture	Room 101; east side of room behind controls	1 fixture	Boiler and equipment control panels containing mercury. Panels behind controls are marked as mercury-containing.
	Steam equipment	Throughout basement and room 101	Numerous pipes and pieces of equipment	Potentially contains residual mechanical fluids.
	Boilers	Basement and room 101	6 boilers	Potentially containing residual mechanical fluids and coal dust.
Fluorescent light tubes	Throughout structure	89 tubes	Potentially mercury-containing.	

NOTES:
 Quantities of asbestos and lead paint associated with piping and other linear surfaces are reported in linear feet.
 ln. ft = linear feet.
 PCB = polychlorinated biphenyl.
 sq. ft. = square feet.

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
First Floor							
1-1-TSI-1	10/11/2021	Condensate pipe	Northwest corner of room 101	Off-white paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND		
1-1-TSI-2	10/11/2021	Condensate pipe	Northwest corner of room 101	Off-white paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND		
1-2-TSI-3	10/11/2021	Elbow on condensate pipe	Northwest corner of room 101	White flexible sheet vinyl	ND	--	--
				Yellow loose-fill fibrous material	ND		
1-3-MISC-4	10/11/2021	Window glazing	Northwest corner of room 101	Pale gray brittle material	4	Fair	4,030 ln. ft.
1-3-MISC-5	10/11/2021	Window glazing	Window at west wall in room 101	Gray brittle crumbly material with paint	ND	--	--
1-4-MISC-6	10/11/2021	Tan cementitious material	Above red brick on northwest corner of northwest boiler in room 101	Beige soft crumbly material	ND	--	--
1-5-MISC-7	10/11/2021	Red brick	Northwest corner of northwest boiler in room 101	Red paint coated hard brittle material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-6-TSI-8	10/11/2021	White insulation with red pipe wrap	By double doors on west side of room 101	Red paint coated woven fibrous material	ND	--	--
				White compacted fine powdery material	30	Damaged	20 ln. ft.
1-7-TSI-9	10/11/2021	Yellow insulation with silver pipe wrap	Silver pipe by double doors on west side of room 101	White paper with woven fibers and metal foil	ND	--	--
				Yellow and pink loose-fill fibrous material	ND	--	--
1-8-TSI-10	10/11/2021	White insulation with silver pipe wrap	Silver pipe on boiler by staircase to lower floor on west side of room 101	White woven fibrous mesh with paint	ND	--	--
				Pale gray crumbly powdery material	ND	--	--
				White compacted fine powdery material	ND	--	--
1-8-TSI-11	10/11/2021	White insulation with silver pipe wrap	Silver pipe on boiler by staircase to lower floor on west side of room 101	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	35	Damaged	3,000 ln. ft.

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-8-TSI-12	10/11/2021	White insulation with silver wrap	Silver insulation on boiler on southwest side of room 101	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	5	Damaged	3,000 ln. ft.
First Floor							
1-9-MISC-13	10/11/2021	Insulation on sink	Sink on southwest side of room 101	White encapsulated woven fibrous material	ND	--	--
				Tan paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
1-8-TSI-14	10/11/2021	White insulation with orange pipe wrap	Orange pipe in southeast corner of room 101	Orange paint coated woven fibrous mesh	ND	--	--
				White compacted fine powdery material	38	Damaged	3,000 ln. ft.
1-10-TSI-15	10/11/2021	White boiler insulation	Southeast corner of room 101 on corrugated boiler	White woven fibrous mesh with paint	ND	--	--
				Off-white crumbly material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-11-MISC-16	10/11/2021	Tan soundproofing material	Southeast corner of room 101 on corrugated boiler wall	Yellow loose-fill fibrous material	ND	--	--
1-12-MISC-17	10/11/2021	Gray fibrous material	Green cabinet in southeast corner of room 101	Pale gray loose-fill fibrous material	ND	--	--
1-8-TSI-18	10/11/2021	White insulation	East side of room 101	Tan woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	40	Damaged	3,000 ln. ft.
1-13-MISC-19	10/11/2021	Gray and tan soundproofing material wrap	Boiler in northeast corner of room 101	White woven fibrous cloth	ND	--	--
				White loose-fill fibrous material	ND	--	--
1-14-TSI-20	10/11/2021	White patch on gray pipe	North wall of room 101	White and tan woven fibrous mesh with paint	ND	--	--
				White compacted powdery material	40	Damaged	3,000 ln. ft.
1-8-TSI-21	10/11/2021	White insulation with dark gray pipe wrap	Dark gray pipe between boilers 4 and 5 in room 101	Dark gray paint coated woven mesh	ND	--	--
				Off-white fine compacted powdery material	37	Damaged	3,000 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-13-MISC-22	10/11/2021	Gray fabric material	Southeast boiler by double doors on south end of room 101	White woven fibrous cloth with paint	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
1-15-MISC-23	10/11/2021	Tan 12 x 12 in. vinyl floor tile with black mastic	Northeast corner of room 104	Tan patterned vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
First Floor							
1-15-MISC-24	10/11/2021	Tan 12 x 12 in. vinyl floor tile with black mastic	Northeast corner of room 105	Tan patterned vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
1-16-MISC-25	10/11/2021	Brown base cove with brown mastic	East wall of room 104	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
1-16-MISC-26	10/11/2021	Brown base cove with brown mastic	East wall of room 104	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
1-17-MISC-27	10/11/2021	Light gray wallboard	North wall of room 105	Pale gray brittle sandy material with paint	ND	--	--
				White chalky material with paper	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-18-MISC-28	10/11/2021	Light gray cementitious wallboard	North wall of room 104 in light switch casing	Pale gray brittle sandy material with paint	ND	--	--
1-19-MISC-29	10/11/2021	White 18 x 36 in. ceiling tile with randomized stipple pattern	Northwest corner of room 104 above light switch	Pale gray compressed fibrous material with paint	ND	--	--
1-20-MISC-30	10/11/2021	White 18 x 36 in. ceiling tile with uniform stipple pattern	Southeast corner above cabinet in room 104	Pale gray compressed fibrous material with paint	ND	--	--
1-19-MISC-31	10/11/2021	White 18 x 36 in. ceiling tile with randomized stipple pattern	Northwest corner of room 105	Beige fibrous material with white paint	ND	--	--
1-8-TSI-32	10/11/2021	Pipe insulation with white pipe wrap	Southeast corner of room 104 on white pipe	White fibrous material with painted cloth wrap	50	Damaged	3,000 ln. ft.
1-21-MISC-33	10/11/2021	Gray blue laminate countertop with black and green mastic	Gray blue counter top on east side of room 104	Blue laminate with clear adhesive	ND	--	--
1-22-MISC-34	10/11/2021	Dark brown base cove with brown mastic	Northwest corner of room 102 by stairs	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
1-22-MISC-35	10/11/2021	Dark brown base cove with brown mastic	North wall east of double door in room 102	Brown rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-23-MISC-36	10/11/2021	Gray cementitious patching material	North wall, west of transformer box and east of the double doors in room 102	Gray cementitious material	ND	--	--
First Floor							
1-24-MISC-37	10/11/2021	Light gray 12 x 12 in. vinyl floor tile with gray mastic	North wall west of single doorway in room 102	Beige/light gray vinyl tile	ND	--	--
				Tan brittle mastic	ND	--	--
				Light gray sandy material	ND	--	--
1-15-MISC-38	10/11/2021	Tan 12 x 12 in. vinyl floor tile with black mastic	North wall west of single doorway in room 102	Beige vinyl tile	ND	--	--
				Black asphaltic mastic	6	Fair	3,000 sq. ft
1-25-MISC-39	10/11/2021	Black transition strip with brown mastic	Double doorway between room 102 and 101	Black rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--
1-26-MISC-40	10/11/2021	Rubber stair tread with clear mastic	South side of stairway to Room 106T and 107	Light brown rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--
1-27-MISC-41	10/11/2021	Dark brown patterned 9 x 9 in. vinyl floor tiles with black mastic	Center floor of room 106T	Brown vinyl tile	3	Fair	16 sq. ft.
				Black asphaltic mastic	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-28-MISC-42	10/11/2021	Light tan patterned 9 x 9 in. vinyl floor tile with black mastic	Center floor of room 106T	Brown vinyl tile	3	Fair	76 sq. ft.
				Black asphaltic mastic	ND	--	--
1-18-MISC-43	10/11/2021	White drywall with cementitious wallboard	West wall by door in room 106T	White chalky material with paper	ND	--	--
				Light gray cementitious material	ND	--	--
1-29-MISC-44	10/11/2021	White plastic waterproofing material with pale yellow adhesive	West wall next to window in room 107	White hard plastic like material	ND	--	--
				Yellow soft mastic	ND	--	--
1-3-MISC-45	10/11/2021	Window glazing	West wall window frame in room 107	White crumbly material with green paint	ND	--	--
1-1-TSI-46	10/11/2021	Condensate pipe	Pipe in northwest corner of room 107	Yellow fibrous material with metal foil	ND	--	--
1-25-MISC-47	10/11/2021	Black transition strip with brown mastic	West stairway moving down in room 102	Black rubbery material	ND	--	--
				Clear soft adhesive	ND	--	--
1-28-MISC-48	10/11/2021	Light tan patterned 9 x 9 in. vinyl floor tile with black mastic	West stairway moving up in room 102	Light brown vinyl tile	4	Fair	76 sq. ft.
				Black asphaltic fibrous backing with brown mastic	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
1-30-MISC-49	10/11/2021	Black base cove with tan mastic	Top of stairway from room 102 to 107; North wall at the top of stairs	Black rubbery material	ND	--	--
				Beige soft mastic with tan color paint	ND	--	--
Mezzanine							
2-1-MISC-1	10/12/2021	White stipple pattern 12 x 12 in. vinyl floor tile with black mastic	Northwest corner floor in room 202	Beige vinyl tile	ND	--	--
				Black/gray asphaltic mastic	ND	--	--
2-1-MISC-2	10/12/2021	White stipple pattern 12" x 12" vinyl floor tile with black mastic	Southeast corner floor in room 203	Beige vinyl tile	ND	--	--
				Light gray sandy material with yellow mastic	ND	--	--
				Black asphaltic mastic	ND	--	--
				Brown vinyl tile	8	Fair	66 sq. ft.
				Black asphaltic fibrous felt with mastic	ND	--	--
2-2-MISC-3	10/12/2021	Tan laminate countertop with clear mastic	Southeast corner of counter in room 203	Laminate beige color with clear adhesive	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-3-MISC-4	10/12/2021	Layered light brown patterned 9 x 9 in. vinyl floor tile with black mastic	West side of floor in room 202	Light brown vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
				Brown vinyl tile	8	Fair	175 sq. ft.
				Black asphaltic mastic	ND	--	--
2-3-MISC-5	10/12/2021	Layered light brown patterned 9 x 9 in. vinyl floor tile with black mastic	Southwest corner of floor in room 203	Light brown vinyl tile	ND	--	--
				Black asphaltic mastic	ND	--	--
2-4-MISC-6	10/12/2021	Brown stipple-patterned 9 x 9 in. vinyl floor tile with black mastic	East side of floor north of door in room 202	Light brown vinyl tile	3	Fair	20 sq. ft.
				Black asphaltic fibrous felt with mastic	6	Fair	20 sq. ft.
2-5-MISC-7	10/12/2021	Black base cove with tan mastic	Northeast corner of room 202	Black rubbery material	ND	--	--
				Tan soft mastic	ND	--	--
2-6-TSI-8	10/12/2021	Yellow insulation with white pipe wrap	Pipe on west wall in room 202	Yellow fibrous material with metal foil wrap	ND	--	--
2-7-MISC-9	10/12/2021	Window glazing	Northwest window in room 202	Light gray soft rubbery material with paint	ND	--	--
2-7-MISC-10	10/12/2021	Window glazing	Southeast window in room 203	Light gray soft rubbery material with paint	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-8-MISC-11	10/12/2021	White drywall with cementitious wallboard	East wall above sink in room 203	White chalky material with paper	ND	--	--
				Tan chalky material	ND	--	--
2-8-MISC-12	10/12/2021	White drywall with cementitious wallboard	Northwest corner wall under window in room 202	Pale gray brittle sandy material with paint	ND	--	--
				Thin layer of black asphaltic material	ND	--	--
Mezzanine							
2-9-MISC-13	10/12/2021	Brown base cove with brown mastic	West wall in room 200S, north of door to room 202	Brown rubbery material	ND	--	--
				Brown brittle mastic	ND	--	--
2-10-TSI-14	10/12/2021	White insulation with orange pipe wrap	Pipe on east wall south of single door in room 204	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	34	Damaged	14 ln. ft.
2-11-MISC-15	10/12/2021	Red 12 x 12 in. brick	West wall south of double door in room 204	Red hard brittle crumbly material	ND	--	--
2-12-MISC-16	10/12/2021	Gray brick mortar	West wall south of double door in room 204	Pale gray hard brittle sandy material	ND	--	--
2-11-MISC-17	10/12/2021	Red 12 x 12 in. brick	North wall below window in room 204	Red hard brittle crumbly material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-12-MISC-18	10/12/2021	Gray brick mortar	North wall below window in room 204	Pale gray hard brittle sandy material	ND	--	--
2-13-TSI-19	10/12/2021	White insulation with pipe wrap	Second catwalk on southwest side of Boiler 6 in room 200	White compacted fine powdery material	ND	--	--
2-13-TSI-20	10/12/2021	White insulation with pipe wrap	Second catwalk on southwest side of Boiler 6 in room 200	White woven fibrous mesh with paint	ND	--	--
				White compacted fine powdery material	ND	--	--
2-14-TSI-21	10/12/2021	Fabric material with white insulation	Second catwalk on southwest side of Boiler 6 in room 200	White woven fibrous cloth with paint	ND	--	--
				White loose-fill fibrous material	ND	--	--
2-13-TSI-22	10/12/2021	White insulation with pipe wrap	Second catwalk on southwest side of Boiler 6 in room 200	White woven fibrous mesh with paint	ND	--	--
				White and pale gray compacted fine powdery material	ND	--	--
2-13-TSI-23	10/12/2021	White insulation with pipe wrap	Second catwalk on southeast side of Boiler 6 in room 200	Tan woven fibrous mesh with paint	ND	--	--
				Pale gray compacted fine powdery material	38	Damaged	3,000 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-14-TSI-24	10/12/2021	Fabric material with white insulation	Second catwalk on southeast side of Boiler 6 in room 200	White woven fibrous cloth	ND	--	--
				White loose-fill fibrous material	ND	--	--
2-13-TSI-25	10/12/2021	White insulation with pipe wrap	Second catwalk on south side of Boiler 6 in room 200	Off-white compacted fine powdery material	30	Damaged	3,000 ln. ft.
Mezzanine							
2-15-TSI-26	10/12/2021	White insulation with white pipe wrap	Southeast corner of room 200	Tan woven fibrous mesh with paint	ND	--	--
				White woven fibrous mesh	ND	--	--
				Off-white compacted fine powdery material	35	Damaged	35 ln. ft.
2-15-TSI-27	10/12/2021	White insulation with white pipe wrap	East side of room 200 by staircase entrance	Tan and white woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	43	Damaged	35 ln. ft.
2-16-TSI-28	10/12/2021	White insulation with silver paint	Located throughout northeast side of room 200 on and around northeastern boiler by staircase entrance	Tan woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	38	Damaged	Difficult to quantify (>200 sq. ft.)

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
2-16-TSI-29	10/12/2021	White insulation with silver paint	Located throughout northeast side of room 200 on and around northeastern boiler by staircase entrance	Tan and white woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	46	Damaged	Difficult to quantify (>200 sq. ft.)
2-13-TSI-30	10/12/2021	White insulation with pipe wrap	Located throughout northeast side of room 200 on and around Boiler 2 by staircase entrance	Tan woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	43	Damaged	3,000 ln. ft.
2-17-TSI-31	10/12/2021	Yellow insulation with white pipe wrap	North side of room 200, highest catwalk by Boiler 4	Off-white paper with woven fibers and metal foil	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
2-17-TSI-32	10/12/2021	Yellow insulation with white pipe wrap	Northwest corner of room 200, highest catwalk by Boiler 3	Off-white paper with woven fibers and metal foil	ND	--	--
				White flexible sheet vinyl	ND	--	--
				Yellow loose-fill fibrous material	ND	--	--
2-7-MISC-33	10/12/2021	Window glazing	Northwest corner of room 200, highest catwalk	Off-white brittle material with paint	3	Fair	4,030 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
Upper Mezzanine (Above Room 200)							
3-1-TSI-1	10/13/2021	White insulation with silver wrap	Highest catwalk in room 200 (below Room 302)	Beige woven fibrous material with paint	ND	--	--
				Pale gray compacted brittle material	ND	--	--
3-1-TSI-2	10/13/2021	White insulation with silver wrap	Highest catwalk in room 200 (below room 302)	Beige woven fibrous material with paint	ND	--	--
				White compacted fine powdery material	ND	--	--
3-2-TSI-3	10/13/2021	Fabric material with white insulation	Highest catwalk in room 200 (below room 302)	White woven fibrous mesh	ND	--	--
				White loose-fill fibrous material	ND	--	--
3-3-TSI-4	10/13/2021	Off-white insulation with pipe wrap	Motor part near west roof access in room 302	Tan woven fibrous mesh with paint	ND	--	--
				Off-white brittle crumbly material	ND	--	--
3-1-TSI-5	10/13/2021	White insulation with pipe wrap	Pipe near west roof access in room 302	White woven fibrous mesh with paint	ND	--	--
				Tan woven fibrous material with paint	ND	--	--
				White compacted crumbly powdery material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
3-2-TSI-6	10/13/2021	White insulation with pipe wrap	Pipe near west roof access in room 302	White woven fibrous mesh with paint	ND	--	--
				White loose-fill fibrous material	ND	--	--
Upper Mezzanine (Above Room 200)							
3-1-TSI-7	10/13/2021	White insulation with silver wrap	Vent near staircase to lower level in room 302	Tan woven fibrous mesh with paint	ND	--	--
				Off-white compacted crumbly powdery material	ND	--	--
				Blue and white flexible sheet vinyl	ND	--	--
3-4-TSI-8	10/13/2021	Tan fibrous insulation with pipe wrap	Pipe near motor in room 302	Off-white paper with woven fibers and metal foil	ND	--	--
				Tan loose-fill fibrous material	ND	--	--
3-1-TSI-9	10/13/2021	White insulation with silver wrap	Vent near staircase to lower level in room 302	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				White powdery material	ND	--	--
				White crumbly material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
3-3-TSI-10	10/13/2021	Off-white insulation with pipe wrap	Motor part near west roof access in room 302	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				White powdery material	ND	--	--
				Gray crumbly material	ND	--	--
3-8-MISC-11	10/14/2021	Window glazing	Window on west side of room 303	Off-white brittle putty material with debris	4	Fair	4,030 ln. ft.
3-8-MISC-12	10/14/2021	Window glazing	Window on west side of room 303	Off-white brittle putty material with debris	5	Fair	4,030 ln. ft.
Basement							
4-1-TSI-1	10/13/2021	White insulation with woven fibrous pipe wrap	By entrance to room 22 from room 21	Flaky silver paint	ND	--	--
				Yellow woven fibrous material	ND	--	--
				White crumbly material	45	Damaged	600 ln. ft.
4-2-TSI-2	10/13/2021	White insulation with pipe wrap	By entrance to room 22 from room 21	White fibrous felt with brown paint	ND	--	--
				White crumbly material	40	Damaged	1,200 ln. ft.
4-3-MISC-3	10/13/2021	Brown soundproofing wall pad	East wall in room 22	Yellow fibrous material	ND	--	--
4-3-MISC-4	10/13/2021	Brown soundproofing wall pad	North wall in room 22	Yellow fibrous material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-4-MISC-5	10/13/2021	Off-white laminate tabletop with clear adhesive	Northwest corner tabletop in room 22	Beige laminate	ND	--	--
				Brown fibrous material	ND	--	--
4-1-TSI-6	10/13/2021	White insulation with woven fibrous pipe wrap	Northeast corner of room 23	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				Brown woven fibrous material	ND	--	--
				White crumbly material	50	Damaged	600 In. ft.
4-2-TSI-7	10/13/2021	White insulation with pipe wrap	Northeast corner of room 23	White woven fibrous material with paint	ND	--	--
				White crumbly material	47	Damaged	1,200 In. ft.
4-5-TSI-8	10/13/2021	White insulation with wrap	Southeast corner of room 23	White woven fibrous material	ND	--	--
				White fibrous material	ND	--	--
4-5-TSI-9	10/13/2021	White insulation with wrap	Southeast corner of room 11 by entrance to Room 23	White woven fibrous material	ND	--	--
				White fibrous material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-1-TSI-10	10/13/2021	White insulation with woven fibrous pipe wrap	Southeast portion of room 11 by entrance to Room 23	White woven fibrous material with paint	ND	--	--
				Yellow woven fibrous material	ND	--	--
				White crumbly material	45	Damaged	600 ln. ft.
4-5-TSI-11	10/13/2021	White insulation with wrap	East portion of room 11 by spiral staircase	Brown crumbly material	ND	--	--
				White woven fibrous material	ND	--	--
				Yellow fibrous material	ND	--	--
4-6-TSI-12	10/13/2021	White insulation with silver painted wrap	East portion of room 11 north of spiral staircase	Brittle red/silver paint	ND	--	--
				White woven fibrous material with paint	ND	--	--
				White crumbly material	50	Damaged	40 ln. ft.
Basement							
4-5-TSI-13	10/13/2021	White insulation with wrap	East portion of room 11 north of spiral staircase	White woven fibrous material	ND	--	--
				Yellow fibrous material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-7-TSI-14	10/13/2021	Yellow insulation with painted pipe wrap	East portion of room 11 north of spiral staircase	White/silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				Off-white woven fibrous material	ND	--	--
				Silver paint	ND	--	--
				Brown crumbly material with metal foil	ND	--	--
				Yellow foamy fibrous material	ND	--	--
4-7-TSI-15	10/13/2021	Yellow insulation with painted pipe wrap	East portion of room 11 north of spiral staircase	White mastic with red paint and metal foil	ND	--	--
				Brown fibrous material	ND	--	--
				Yellow fibrous material	ND	--	--
4-8-MISC-16	10/13/2021	Silver woven heat-resistant seal material on hatch interior	By control wheels and conveying systems in room 11	Charcoal gray fibrous material	90	Fair	80 ln. ft.
4-1-TSI-17	10/13/2021	White insulation with woven fibrous pipe wrap	Northeast portion of room 11 between northeast staircase and elevator	Flaky silver paint	ND	--	--
				White woven fibrous material	ND	--	--
				White crumbly material	50	Damaged	600 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-7-TSI-18	10/13/2021	Yellow insulation with painted pipe wrap	Northeast portion of room 11 between northeast staircase and elevator	Brown fibrous material with red paint and metal foil	ND	--	--
				Yellow foamy fibrous material	ND	--	--
4-7-TSI-19	10/13/2021	Yellow insulation with painted pipe wrap	Northeast portion of room 11 between northeast staircase and elevator	Soft white thin vinyl sheet with silver paint	ND	--	--
				Yellow fibrous material	ND	--	--
Basement							
4-2-TSI-20	10/13/2021	White insulation with pipe wrap	Northeast portion of room 11 near northeast staircase	White woven fibrous material with paint	ND	--	--
				White crumbly material	50	Damaged	1,200 ln. ft.
4-5-TSI-21	10/13/2021	White insulation with wrap	Northeast portion of room 11 near northeast staircase	White woven fibrous material with black fibrous banding	ND	--	--
				Yellow fibrous material	ND	--	--
4-2-TSI-22	10/13/2021	White insulation with pipe wrap	Northeast portion of room 11	White woven fibrous material with paint	ND	--	--
				White crumbly material	48	Damaged	1,200 ln. ft.

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-9-TSI-23	10/13/2021	White insulation with white woven pipe wrap	Northeast portion of room 11	White woven fibrous material with paint	ND	--	--
				White crumbly material	50	Damaged	20 ln. ft.
4-8-MISC-24	10/13/2021	Silver woven heat-resistant seal material on hatch interior	By control wheels and conveying systems in room 11	Flaky silver paint	6	Fair	80 ln. ft.
				Gray/white fibrous felt	85	Fair	80 ln. ft.
4-2-TSI-25	10/13/2021	White insulation with pipe wrap	On west side of room 11 by staircase down	White woven fibrous material with paint	ND	--	--
				White crumbly material	48	Damaged	1,200 ln. ft.
4-5-TSI-26	10/13/2021	White insulation with wrap	On west side of room 11 by staircase down	White woven fibrous felt	ND	--	--
4-7-TSI-27	10/13/2021	Yellow insulation with painted pipe wrap	West portion of room 11 by staircase to Room 101	White fibrous material with paper and metal foil	ND	--	--
				Yellow fibrous material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
Basement							
4-7-TSI-28	10/13/2021	Yellow insulation with painted pipe wrap	West portion of room 11 by staircase to Room 101	White synthetic material	ND	--	--
				Yellow foamy fibrous material	ND	--	--
4-2-TSI-29	10/13/2021	White insulation with pipe wrap	Center of room 11	Thin silver paint over fibrous mesh	ND	--	--
				White powdery fibrous material with paint	40	Damaged	1,200 ln. ft.
4-8-MISC-30	10/13/2021	Silver woven heat-resistant seal material on hatch interior	By control wheels and conveying systems in room 11	White interwoven fibrous material with paint	80	Fair	80 ln. ft.
				Gray fibrous mesh	ND	--	--
4-2-TSI-31	10/13/2021	White insulation with pipe wrap	Center of room 11	Silver paint	ND	--	--
				White interwoven fibrous mesh	ND	--	--
				Light brown crumbly powdery fibrous material	ND	--	--
4-9-TSI-32	10/13/2021	White insulation with white woven pipe wrap	Northeast portion of room 11	Light gray crumbly powdery fibrous material with paint	ND	--	--
				Gray crumbly fibrous material	40	Damaged	20 ln. ft.

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-7-TSI-33	10/13/2021	Yellow insulation with painted pipe wrap	Center of room 11	Silver foil with fibrous mesh, paint and paper	ND	--	--
				Orange fibrous material	ND	--	--
4-10-MISC-34	10/13/2021	Gray brick mortar	East wall of room 18	Light gray brittle sandy material	ND	--	--
4-11-MISC-35	10/13/2021	Red brick	North wall of room 18	Red brick	ND	--	--
				Light gray cementitious material	ND	--	--
4-12-MISC-36	10/13/2021	White plastic waterproofing material with pale yellow adhesive	Under paper towel holder in room 19	White brittle fibrous material	ND	--	--
				White soft adhesive with paint and debris	ND	--	--
Basement							
4-13-MISC-37	10/13/2021	Window glazing	Window in room 19	White compacted powdery material	ND	--	--
				Gray crumbly material with paint	ND	--	--
4-14-MISC-38	10/13/2021	Black 12 x 12 in. linoleum floor tile with yellow adhesive	Bathroom floor in room 19	Black crumbly vinyl	ND	--	--
				Clear soft adhesive	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-15-MISC-39	10/13/2021	White 12 x 12 in. linoleum floor tile with yellow adhesive	Bathroom floor in room 19	White crumbly vinyl	ND	--	--
				Yellow brittle adhesive with debris and paint	ND	--	--
				Gray crumbly sandy material	ND	--	--
4-16-MISC-40	10/13/2021	Black base cove with tan adhesive	Bathroom floor in room 19	Black rubbery material	ND	--	--
				Tan soft mastic	ND	--	--
4-17-MISC-41	10/14/2021	Tan 1 x 2 in. square tile with brown adhesive	Northeast floor in front of door in room 17	Tan and white ceramic with debris	ND	--	--
				Off-white brittle material	ND	--	--
4-17-MISC-42	10/14/2021	Tan 1 x 2 in. square tile with brown adhesive	South center room 17 next to center dividing wall	Tan and white ceramic with debris	ND	--	--
				Off-white brittle material	ND	--	--
				Light brown brittle material with paint	6	Damaged	180 sq. ft.
4-18-MISC-43	10/14/2021	White drywall with gray cementitious wallboard	South wall of room 17	White brittle powdery material	ND	--	--
				Off-white brittle sandy material	ND	--	--

Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
4-19-MISC-44	10/14/2021	Tan base cove with green adhesive	West wall in northwest corner of room 17	Off-white ceramic with white glaze and sandy debris	ND	--	--
				Brown crumbly material with paint	15	Fair	60 ln. ft.
4-18-MISC-45	10/14/2021	White drywall with gray cementitious wallboard	West wall in northwest corner of room 17	Light gray brittle powdery material	ND	--	--
				White chalky material with paper	ND	--	--
Subbasement							
No potential ACM present in sub basement.							
Exterior							
EXT-1-MISC-1	10/14/2021	Red brick	West exterior side of Room 101 north of double doors next to ash pit tower	Red brick	ND	--	--
EXT-2-MISC-2	10/14/2021	Gray brick mortar	West exterior side of Room 101 north of double doors next to ash pit tower	Gray cementitious sandy material	ND	--	--

**Table 4-1
Summary of Asbestos Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lab Description	Bulk Asbestos (%)	Condition if Detected	Estimated Quantity if Detected
EXT-3-MISC-3	10/14/2021	Window glazing	West exterior side of Room 105 on the southwest corner of exterior	Clear soft/elastic material with debris	ND	--	--
EXT-1-MISC-4	10/14/2021	Red brick	East exterior side of Room 101 south of stairwell exit door and north of windows	Red brick	ND	--	--
EXT-2-MISC-5	10/14/2021	Gray brick mortar	East exterior side of Room 101 south of stairwell exit door and north of windows	Loose gray cementitious material	ND	--	--
EXT-3-MISC-6	10/14/2021	Window glazing	South window on exterior east wall of Room 101	Light gray soft/elastic material with debris	ND	--	--
EXT-4-MISC-7	10/14/2021	White brick caulking	North corner of east exterior wall of room 101 south of stairwell exit	Light gray soft/elastic material with debris	ND	--	--

NOTES:

Samples were analyzed consistent with polarized light microscopy, U.S. Environmental Protection Agency Method 600/R-93-116.
 -- = not applicable.
 % = percent.
 in. = inch.
 ln. ft. = linear feet.
 ND = not detected.
 sq. ft. = square feet.

**Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington**



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
First Floor						
1-1-PB-1	10/11/2021	Tan paint	West wall between room 106 doorway and stairway of room 102	0.108	--	--
1-1-PB-2	10/11/2021	Tan paint	West wall north of room 105 doorway	0.071	--	--
1-1-PB-3	10/11/2021	Tan paint	North double doors between room 102 and 101	0.177	--	--
1-1-PB-4	10/11/2021	Tan paint	North double doors between room 102 and 101	0.224	--	--
1-2-PB-5	10/11/2021	White paint	West wall next to window in room 107	1.830	--	120 sq. ft.
1-2-PB-6	10/11/2021	White paint	North wall of room 107	1.630	--	120 sq. ft.
1-3-PB-7	10/11/2021	Off-white paint	East wall of room 106T	ND	--	--
1-4-PB-8	10/11/2021	White paint	South wall east of window in room 104	0.181	0.27	--
1-4-PB-9	10/11/2021	White paint	West wall south of window in room 104	0.175	--	--
1-4-PB-10	10/11/2021	White paint	East side of north wall in room 105	0.211	--	--
1-5-PB-11	10/11/2021	Silver	South side of east wall on south boiler in room 101	ND	--	--
1-6-PB-12	10/11/2021	Green paint	Hydraulic drive on northwest side of south middle boiler in room 101	0.326	--	--
1-7-PB-13	10/11/2021	Red paint	Floor on south side of room in front of double door between room in room 101	0.188	0.24	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
1-8-PB-14	10/11/2021	Red paint	West metal support beam next to fire extinguisher in room 101	5.000	--	15 sq. ft.
First Floor						
1-9-PB-15	10/11/2021	White paint	West metal support beam above fire extinguisher in room 101	5.000	--	3,000 sq. ft.
1-10-PB-16	10/11/2021	Red paint	Steam pipe in southwest corner of room 101	0.616	--	--
1-11-PB-17	10/11/2021	Green paint	Mirror above sink in southwest corner of room 101	0.472	--	--
1-12-PB-18	10/11/2021	White paint	Southwest corner of room 101	0.013	--	--
1-13-PB-19	10/11/2021	Red paint	Pipe on west side of southwest boiler in room 101	0.092	--	--
1-14-PB-20	10/11/2021	Yellow paint	Northwest corner of southwest boiler in room 101	5.000	--	600 ln. ft.
1-15-PB-21	10/11/2021	Orange paint	West wall north of double door in room 101	2.360	--	30 ln. ft.
1-16-PB-22	10/11/2021	Brown paint	West wall north of double door in room 101	0.015	--	--
1-9-PB-23	10/11/2021	White paint	Metal support beam on west wall north of double door in room 101	5.000	--	3,000 sq. ft.
1-17-PB-24	10/11/2021	Bright orange paint	Steam pipe on west side of northwest boiler in room 101	0.121	--	--
1-18-PB-25	10/11/2021	Red paint	Brick on southwest corner of northwest boiler in room 101	ND	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
1-19-PB-26	10/11/2021	Gray paint	Support pole in northwest corner of room 101	0.111	--	--
1-20-PB-27	10/11/2021	Silver paint	Northwest support beam of northwest boiler in room 101	2.470	--	3,000 ln. ft.
1-20-PB-28	10/11/2021	Silver paint	Northeast support beam of northwest boiler in room 101	1.660	2.00	3,000 ln. ft.
1-14-PB-29	10/11/2021	Yellow paint	North pipe on the northwest corner of north middle boiler in room 101	5.000	--	600 ln. ft.
First Floor						
1-14-PB-30	10/11/2021	Yellow paint	North concrete bench west of north door in room 101	2.830	--	600 ln. ft.
1-21-PB-31	10/11/2021	Brown paint	Pipe on north wall between northeast and north middle boiler in room 101	3.520	--	70 ln. ft.
1-21-PB-32	10/11/2021	Brown paint	Pipe north of north middle boiler in room 101	1.208	--	70 ln. ft.
1-20-PB-33	10/11/2021	Silver paint	Support beam on northwest corner of northeast boiler in room 101	0.040	--	3,000 ln. ft.
1-5-PB-34	10/11/2021	Silver paint	North side of northeast boiler in room 101	ND	--	--
1-12-PB-35	10/11/2021	White paint	Northeast corner of room 101	ND	--	--
1-6-PB-36	10/11/2021	Green paint	East side of northeast boiler in room 101	0.503	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
1-14-PB-37	10/11/2021	Yellow paint	Pipe between southeast and south middle boiler in room 101	5.000	--	600 ln. ft.
1-6-PB-38	10/11/2021	Green paint	Green pipe on south end of south middle boiler in room 101	0.375	--	--
1-12-PB-39	10/11/2021	White paint	Southeast corner of room 101	0.068	--	--
1-22-PB-40	10/11/2021	Dark green paint	Green cabinet in the southeast corner of room 101	1.068	--	64 sq. ft.
1-23-PB-41	10/11/2021	Light gray paint	Light gray cabinet in southeast corner of room 101	0.048	--	--
Mezzanine						
2-1-PB-1	10/12/2021	White paint	Southeast corner of room in room 203	0.180	--	--
2-1-PB-2	10/12/2021	White paint	Northeast corner of room in room 204	0.043	--	--
2-2-PB-3	10/12/2021	Tan paint	Catwalk in room 200S outside of room 202	0.085	--	--
2-2-PB-4	10/12/2021	Tan paint	Catwalk in room 200S outside of room 201	0.219	--	--
2-3-PB-5	10/12/2021	Dark tan paint	Cabinet inside doorway in room 201	0.330	--	--
2-3-PB-6	10/12/2021	Dark tan paint	Cabinet on north wall in room 201	0.268	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
2-4-PB-7	10/12/2021	Yellow paint	Yellow pipe on first catwalk, west side of room 101	3.220	--	600 ln. ft.
2-4-PB-8	10/12/2021	Yellow paint	Yellow pipe on first catwalk, west side of room 101	4.940	--	600 ln. ft.
2-5-PB-9	10/12/2021	Light green paint	Light green pipe on first catwalk in center of room 101	0.242	--	--
2-5-PB-10	10/12/2021	Light green paint	Light green pipe on first catwalk in center of room 101	0.108	--	--
2-6-PB-11	10/12/2021	Silver paint	Silver pipe on first catwalk in center of room 101	ND	--	--
2-4-PB-12	10/12/2021	Yellow paint	Yellow pipe on first catwalk, east side of room 101	3.280	--	600 ln. ft.
Mezzanine						
2-7-PB-13	10/12/2021	Red paint	Red pipe on first catwalk, east side of room 101	1.980	--	750 ln. ft.
2-8-PB-14	10/12/2021	Reddish brown paint	Red pipe on first catwalk, east side of room 101	0.075	--	100 ln. ft.
2-9-PB-15	10/12/2021	Gray paint	Gray corrugated boiler siding on second catwalk, east side of room 101	ND	--	--
2-5-PB-16	10/12/2021	Light green paint	Light green pipe on second catwalk on east side of room 101	0.036	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington

Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
2-10-PB-17	10/12/2021	Gray paint	Gray railing on second catwalk on east side of room 200	0.007	--	--
2-11-PB-18	10/12/2021	Tan paint	Tan boiler part on second catwalk on east side of room 200	0.101	--	--
2-9-PB-19	10/12/2021	Gray paint	Gray boiler siding on second catwalk, east side of room 200	0.035	--	--
2-12-PB-20	10/12/2021	Gray paint	Gray door frame on second catwalk, east side of room 200	0.517	--	--
2-13-PB-21	10/12/2021	Red paint	Red pipe on west side of Boiler 4 in room 200	ND	--	--
2-11-PB-22	10/12/2021	Tan paint	Tan mechanical part in room 204	ND	--	--
2-14-PB-23	10/12/2021	Blue paint	Blue mechanical part in room 204	ND	--	--
2-7-PB-24	10/12/2021	Red paint	Red pipe	1.164	15.0	750 ln. ft.
2-8-PB-25	10/12/2021	Red paint	Red pipe on first catwalk, east side of room 101	ND	--	100 ln. ft.
Upper Mezzanine						
3-1-PB-1	10/13/2021	Red paint	Catwalk above coal hopper by staircase in room 301	0.136	--	--
3-1-PB-2	10/13/2021	Red paint	Catwalk above coal hopper by staircase in room 301	0.160	--	--
3-2-PB-3	10/13/2021	Gray paint	Catwalk above coal hopper by staircase in room 301	5.000	--	700 ln. ft.

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
3-2-PB-4	10/13/2021	Gray paint	Catwalk above coal hopper by staircase in room 301	5.000	--	700 ln. ft.
3-3-PB-5	10/13/2021	Brown paint	Catwalk above coal hopper by staircase in room 301	ND	--	--
3-3-PB-6	10/13/2021	Brown paint	Catwalk above coal hopper by staircase in room 301	ND	--	--
3-4-PB-7	10/13/2021	Silver paint	On equipment by east side door in room 302	ND	--	--
3-4-PB-8	10/13/2021	Silver paint	On equipment by east side door in room 302	ND	--	--
3-5-PB-9	10/13/2021	Red paint	By west side door in room 302	0.528	--	--
3-6-PB-10	10/13/2021	Tan paint	By west side door in room 302	0.531	--	--
3-6-PB-11	10/13/2021	Tan paint	By west side door in room 302	0.922	--	--
3-6-PB-12	10/13/2021	Tan paint	By staircase in room 302	0.920	0.063	--
3-7-PB-13	10/13/2021	Tan paint	East door in room 302	ND	--	--
3-7-PB-14	10/13/2021	Tan paint	West door in room 302	ND	--	--
3-8-PB-15	10/13/2021	Brown paint	Southeast corner of room 302	ND	--	--
3-9-PB-16	10/13/2021	Dark gray paint	Highest catwalk, southeast side of room 303M	ND	--	--
3-9-PB-17	10/13/2021	Dark gray paint	Highest catwalk, southeast side of room 303M	ND	--	--
3-10-PB-18	10/13/2021	Red paint	Downstairs below room 303M catwalk	0.095	--	--
3-11-PB-19	10/13/2021	Silver paint	Highest catwalk in room 200	ND	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
Basement						
4-1-PB-1	10/13/2021	Light green paint	East wall south of door between room 17 and 21	0.336	--	--
4-1-PB-2	10/13/2021	Light green paint	Paint chip on floor next to bathroom stall in room 17	0.237	--	--
4-2-PB-3	10/13/2021	Red paint	Pipe in southwest corner of room 21	ND	--	--
4-3-PB-4	10/13/2021	Red paint	Tank on north wall of room 21 east of entrance to room 11	1.346	2.30	145 ln. ft.
4-4-PB-5	10/13/2021	Silver paint	Silver pipe support on north ceiling of room 21	0.024	--	--
4-5-PB-6	10/13/2021	Gray paint	Cabinet in center of room 21 north of room 22	0.063	--	--
4-2-PB-7	10/13/2021	Red paint	Pipe in southwest corner of room 21	ND	--	--
4-6-PB-8	10/13/2021	Blue gray paint	Door frame to room 18	0.086	--	--
4-7-PB-9	10/13/2021	Silver paint	Tank in southeast corner of room 18	5.000	--	5 ln. ft.
4-8-PB-10	10/13/2021	Orange paint	Pipe underneath tank in southeast corner of room 18	5.000	--	10 ln. ft.
4-9-PB-11	10/13/2021	White paint	South side of stairway in room 18A	0.300	--	--
4-10-PB-12	10/13/2021	Gray paint	Pipe in west side of room 18A	0.085	--	--
4-11-PB-13	10/13/2021	Red paint	Red fire extinguisher marking paint on northwest corner of room 21	ND	--	--
4-12-PB-14	10/13/2021	Gray paint	Door to room 15	4.110	--	24 sq. ft.

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-13-PB-15	10/13/2021	Light tan paint	Paint under new paint on door to room 15	3.400	--	24 sq. ft.
4-14-PB-16	10/13/2021	Orange paint	Orange pipe on south wall of room 21 west of room 22	5.000	--	600 ln. ft.
Basement						
4-15-PB-17	10/13/2021	White paint	White paint on orange pipe on south wall of room 21 west of room 22	5.000	--	2 ln. ft.
4-16-PB-18	10/13/2021	Tan paint	East wall of room 22	ND	--	--
4-17-PB-19	10/13/2021	Yellow paint	Yellow caution paint above doorway to room 11	ND	--	--
4-3-PB-20	10/13/2021	Red paint	Red pipe in southwest corner of room 23	ND	--	145 ln. ft.
4-14-PB-21	10/13/2021	Orange paint	Orange pipe on east wall of room 23	3.700	--	600 ln. ft.
4-18-PB-22	10/13/2021	Yellow paint	Yellow pipe in northeast corner of room 23	0.305	--	--
4-19-PB-23	10/13/2021	Blue paint	Blue pipe in northeast corner of room 23	0.306	--	--
4-16-PB-24	10/13/2021	Tan paint	Tan paint on northwest corner of wall in room 23	ND	--	--
4-2-PB-25	10/13/2021	Red paint	Red pipe wrap on the south side of room 23	0.919	--	--
4-20-PB-26	10/13/2021	Green paint	Green equipment on south side of room 23	0.908	--	--
4-14-PB-27	10/13/2021	Orange paint	Orange pipe in southwest corner of room 11	3.320	--	600 ln. ft.
4-16-PB-28	10/13/2021	Tan paint	Support beam in southwest center of room 11	ND	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-21-PB-29	10/13/2021	White paint	White pipe wrap on west side of room 11 east of sun basement entrance	ND	--	--
Basement						
4-4-PB-30	10/13/2021	Silver paint	Silver support on west side of room 11 east of sun basement entrance	ND	--	--
4-22-PB-31	10/13/2021	Yellow paint	Yellow pipe on east side of room 11 east of door to sub basement	5.000	--	140 ln. ft.
4-23-PB-32	10/13/2021	Bright white paint	Support in northwest corner of room 11	5.000	0.22	280 ln. ft.
4-4-PB-33	10/13/2021	Silver paint	Silver painted equipment on west side of room 11 north of sub basement door	ND	--	--
4-23-PB-34	10/13/2021	White paint	Support on north side of room 11 east of active tank	0.146	--	264 ln. ft.
4-23-PB-35	10/13/2021	White paint	North side of room 11 south of active tank	5.000	--	280 ln. ft.
4-24-PB-36	10/13/2021	Green paint	North side of room 11 north of northwest boiler	0.241	0.80	100 ln. ft.
4-22-PB-37	10/13/2021	Yellow paint	North side of room 11 north of northwest boiler	3.670	--	140 ln. ft.
4-3-PB-38	10/13/2021	Red paint	Northwest corner of room 11	2.010	--	145 ln. ft.
4-19-PB-39	10/13/2021	Blue paint	Northwest corner of room 11 south of window	0.084	--	--
4-24-PB-40	10/13/2021	Green paint	Northwest corner of room 11	ND	--	100 ln. ft.

**Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington**

Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-25-PB-41	10/13/2021	Reddish brown paint	Drain pipe in northwest corner of room 11 west of active tank	ND	--	--
4-14-PB-42	10/13/2021	Orange paint	Orange pipe in northwest corner of room 11 west of active tank	5.000	--	600 ln. ft.
Basement						
4-3-PB-43	10/13/2021	Red paint	Red pipe on the north side of room 11 south of active tank	5.000	--	145 ln. ft.
4-14-PB-44	10/13/2021	Orange paint	Northeast corner of room 11 west of exit doorway	2.430	--	600 ln. ft.
4-17-PB-45	10/13/2021	Yellow paint	Yellow concrete block in northeast corner of room 11 south of exit doorway	ND	--	--
4-24-PB-46	10/13/2021	Green paint	East side of room 11 east of northeast boiler	1.178	--	100 ln. ft.
4-4-PB-47	10/13/2021	Silver paint	Underside of lid on southwest face of northeast boiler in room 11	0.071	--	--
4-22-PB-48	10/13/2021	Yellow paint	Center of room 11 east of southwest boiler	4.380	--	140 ln. ft.
4-23-PB-49	10/13/2021	Bright white paint	Support in center of room 11 between the two north boilers	5.000	--	280 ln. ft.
4-14-PB-50	10/13/2021	Orange paint	Orange tank in center of room 11 between the two north boilers	1.223	15.0	600 ln. ft.

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-16-PB-51	10/13/2021	White paint	Support beam on south side of room 11 east of green air equipment	0.005	--	--
4-2-PB-52	10/13/2021	Red paint	Red wrapped pipe on south wall of room 11	ND	--	--
4-24-PB-53	10/13/2021	Green paint	Green pipe and equipment on south side of room 11 east of entrance to room 21	0.220	--	100 ln. ft.
Basement						
4-11-PB-54	10/13/2021	Red paint	Red fire extinguisher marking in southeast corner of room 11 north of spiral staircase	ND	--	--
4-14-PB-55	10/13/2021	Orange paint	Orange pipe wrap in southeast corner of room 11 north of spiral staircase	1.275	--	600 ln. ft.
4-26-PB-56	10/13/2021	Silver paint	Silver pipe wrap southeast corner of room 11	ND	--	--
4-14-PB-57	10/13/2021	Orange paint	Southeast corner of room 11 east of doorway	4.490	--	600 ln. ft.
4-24-PB-58	10/13/2021	Green paint	Southwest corner of room 11	0.084	--	100 ln. ft.
4-25-PB-59	10/13/2021	Reddish brown paint	Southeast corner of room 11 west of southeast boiler	0.069	--	--
4-1-PB-60	10/13/2021	Light green paint	Paint on south wall of room 17	0.014	--	--
4-1-PB-61	10/13/2021	Light green paint	Southwest corner of room 17	0.135	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington



Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
4-27-PB-62	10/13/2021	Tan paint	East side of center wall of room 17 next to mirror	0.008	--	--
Subbasement						
5-1-PB-1	10/14/2021	Yellow paint	West hall entrance of room B1	0.023	--	110 ln. ft.
5-1-PB-2	10/14/2021	Yellow paint	Center of hallway of room B1	ND	4.3	110 ln. ft.
5-1-PB-3	10/14/2021	Yellow paint	East end of hallway of room B1	2.080	--	110 ln. ft.
5-2-PB-4	10/14/2021	Orange paint	Center of room B3	1.012	--	5 ln. ft
5-3-PB-5	10/14/2021	Brown paint	East wall at end of hall of room B1	0.080	--	--
5-3-PB-6	10/14/2021	Brown paint	East end in the center of hall of room B1	ND	--	--
5-4-PB-7	10/14/2021	Reddish brown paint	Center of hallway of room B1	ND	--	--
Exterior						
EXT-1-PB-1	10/14/2021	Brownish red paint	Southwest support beam of ash pit outside of room 101	1.470	1.60	272 ln. ft.
EXT-1-PB-2	10/14/2021	Brownish red paint	Northeast support beam of ash pit outside of room 101	1.150	--	272 ln. ft.
EXT-2-PB-3	10/14/2021	Dark brown red paint	Vent on west exterior side of room 101 in between double doors	0.120	--	--
EXT-3-PB-4	10/14/2021	Tan paint	Double doors on west exterior side of room 101	0.058	--	--

Table 4-2
Summary of Lead-Based Paint Sample Results
College Avenue Steam Plant
Pullman, Washington




Sample Name	Sample Date	Material Description	Location Description	Lead Result— XRF (mg/cm ²)	Lead Result— Laboratory (%)	Estimated Quantity if Detected
EXT-4-PB-5	10/14/2021	Green paint	Railing on west exterior side of room 101 in front of double doors	0.173	--	--
EXT-5-PB-6	10/14/2021	Silver paint	Silver pipe on west exterior side of room 101 and south of double doors	1.213	--	25 In. ft.
EXT-6-PB-7	10/14/2021	Blue gray paint	Blue gray pipe in corner of exterior side of room 101 and south of double doors	0.071	--	25 In. ft.

NOTES:
 Samples were analyzed consistent with U.S. Environmental Protection Agency Method 3051/7000B.
 -- = not applicable.
 % = percent (milligrams per kilogram/10000)
 'In. ft. = linear feet.
 mg/cm² = milligrams per square centimeter.
 ND = none detected.
 XRF = X-ray fluorescence.

FIGURES



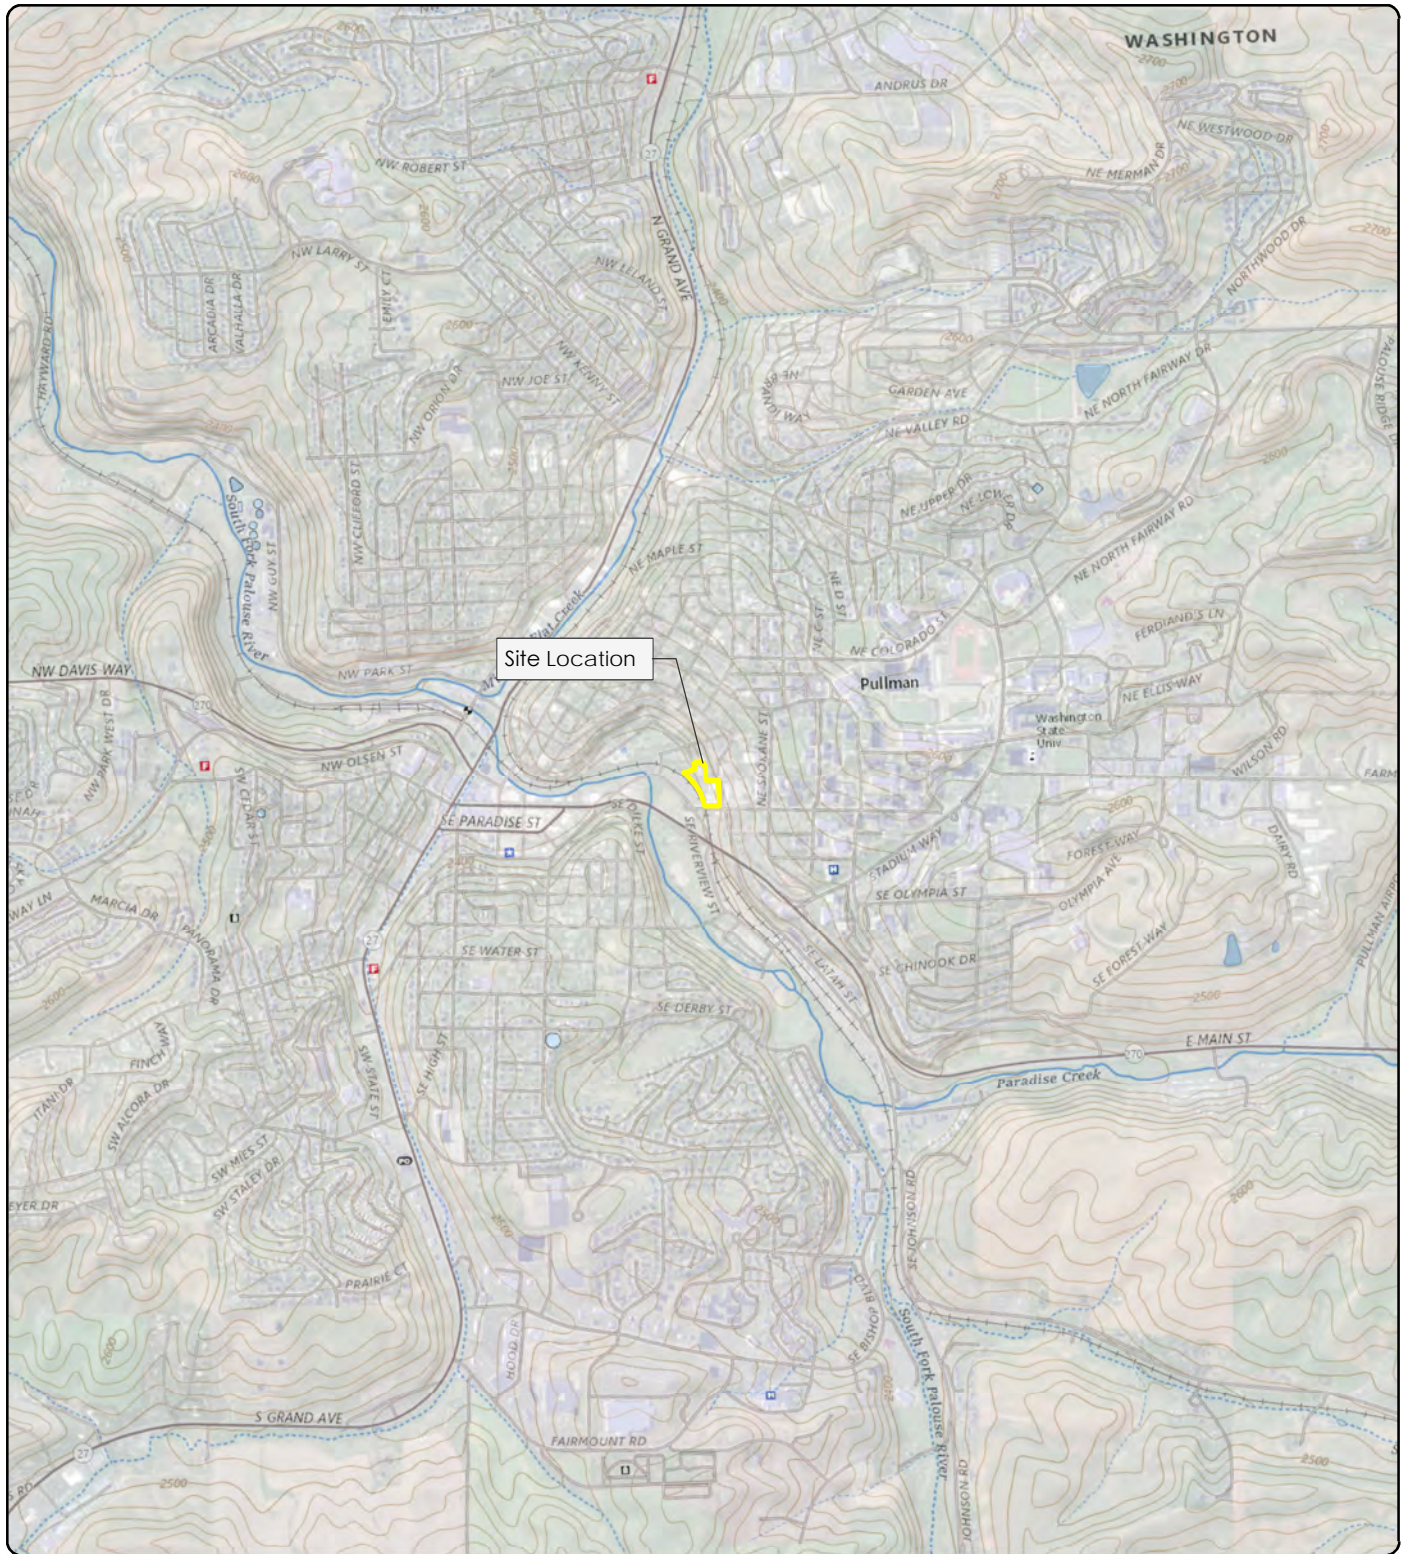

Site Location


Legend
 Site Boundary

Figure 1-1
Site Location

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Source:
U.S. Geological Survey (2021) 7.5-minute
topographic quadrangle: Pullman.
Township 14 North, Range 45 East, Section 5.



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.






Figure 3-1 First Floor and Exterior Sampling Locations - Asbestos

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Legend

● Asbestos

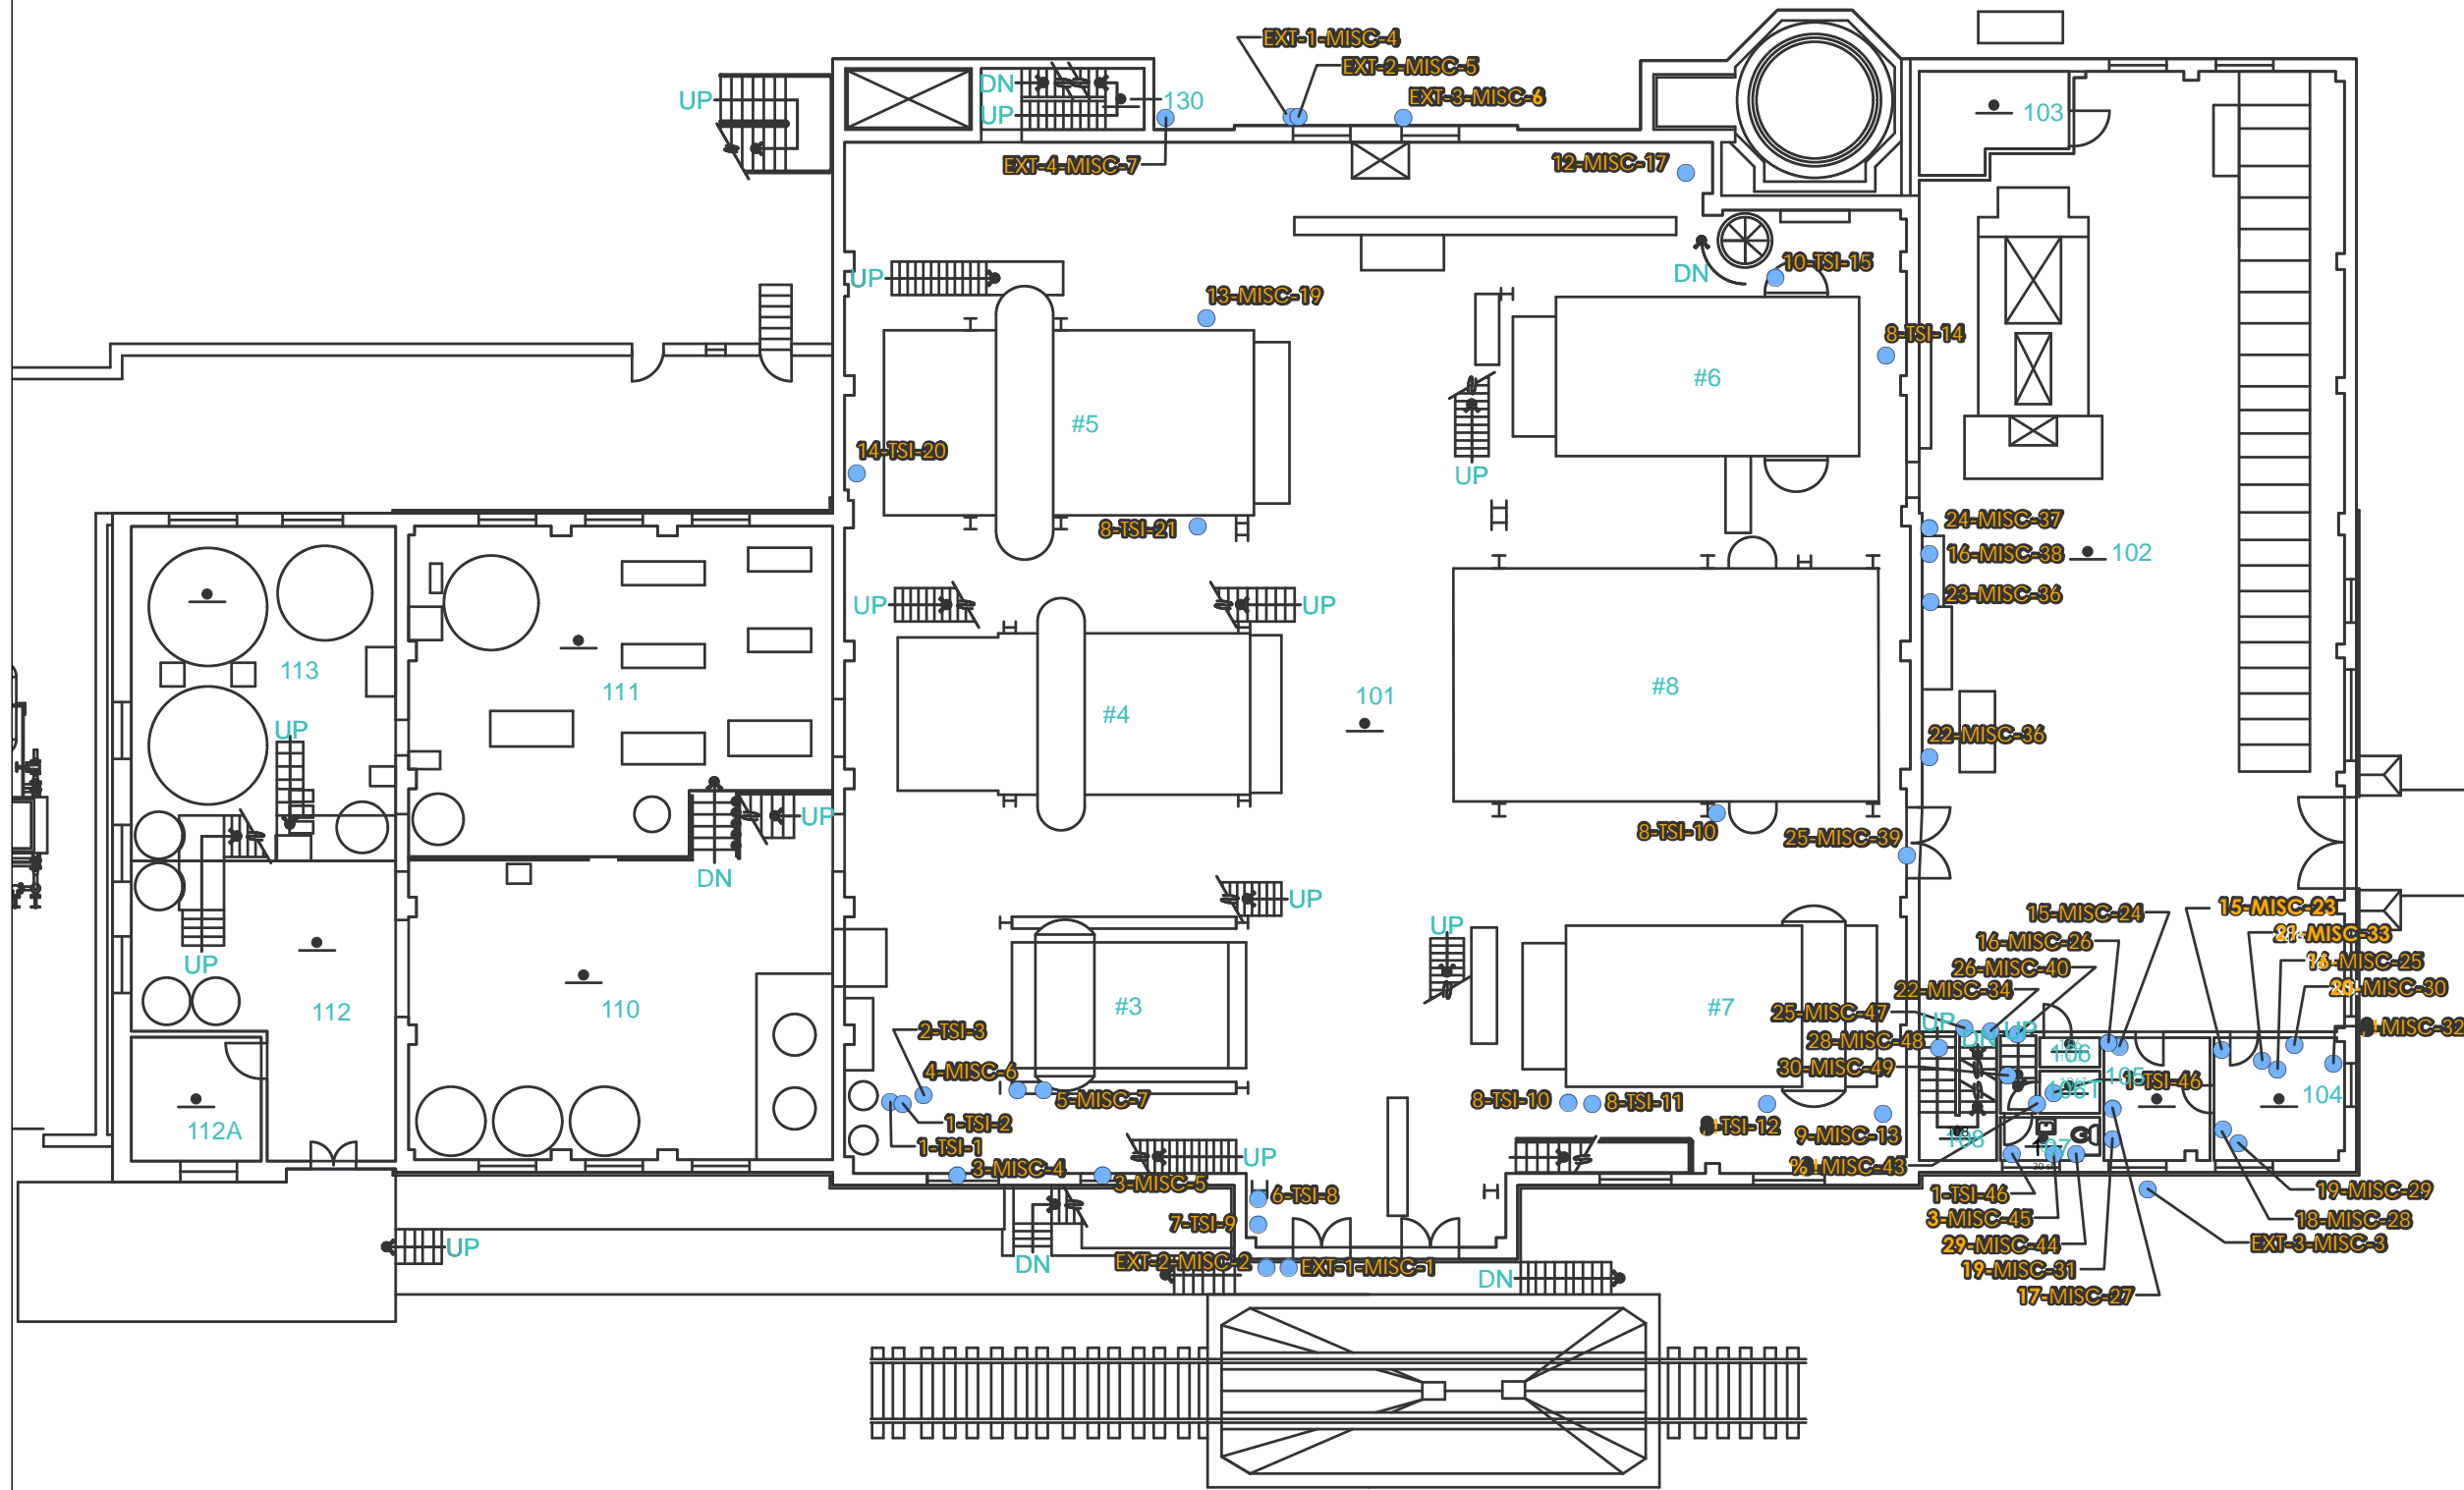

Source:
CAD data obtained from Washington State University.

 MAUL FOSTER LONGI
p. 971 544 2139 | www.maulfooster.com



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

Figure 3-3 Upper Mezzanine Sampling Locations - Asbestos

College Avenue Steam Plant Port
of Whitman County Pullman,
Washington

Legend

● Asbestos

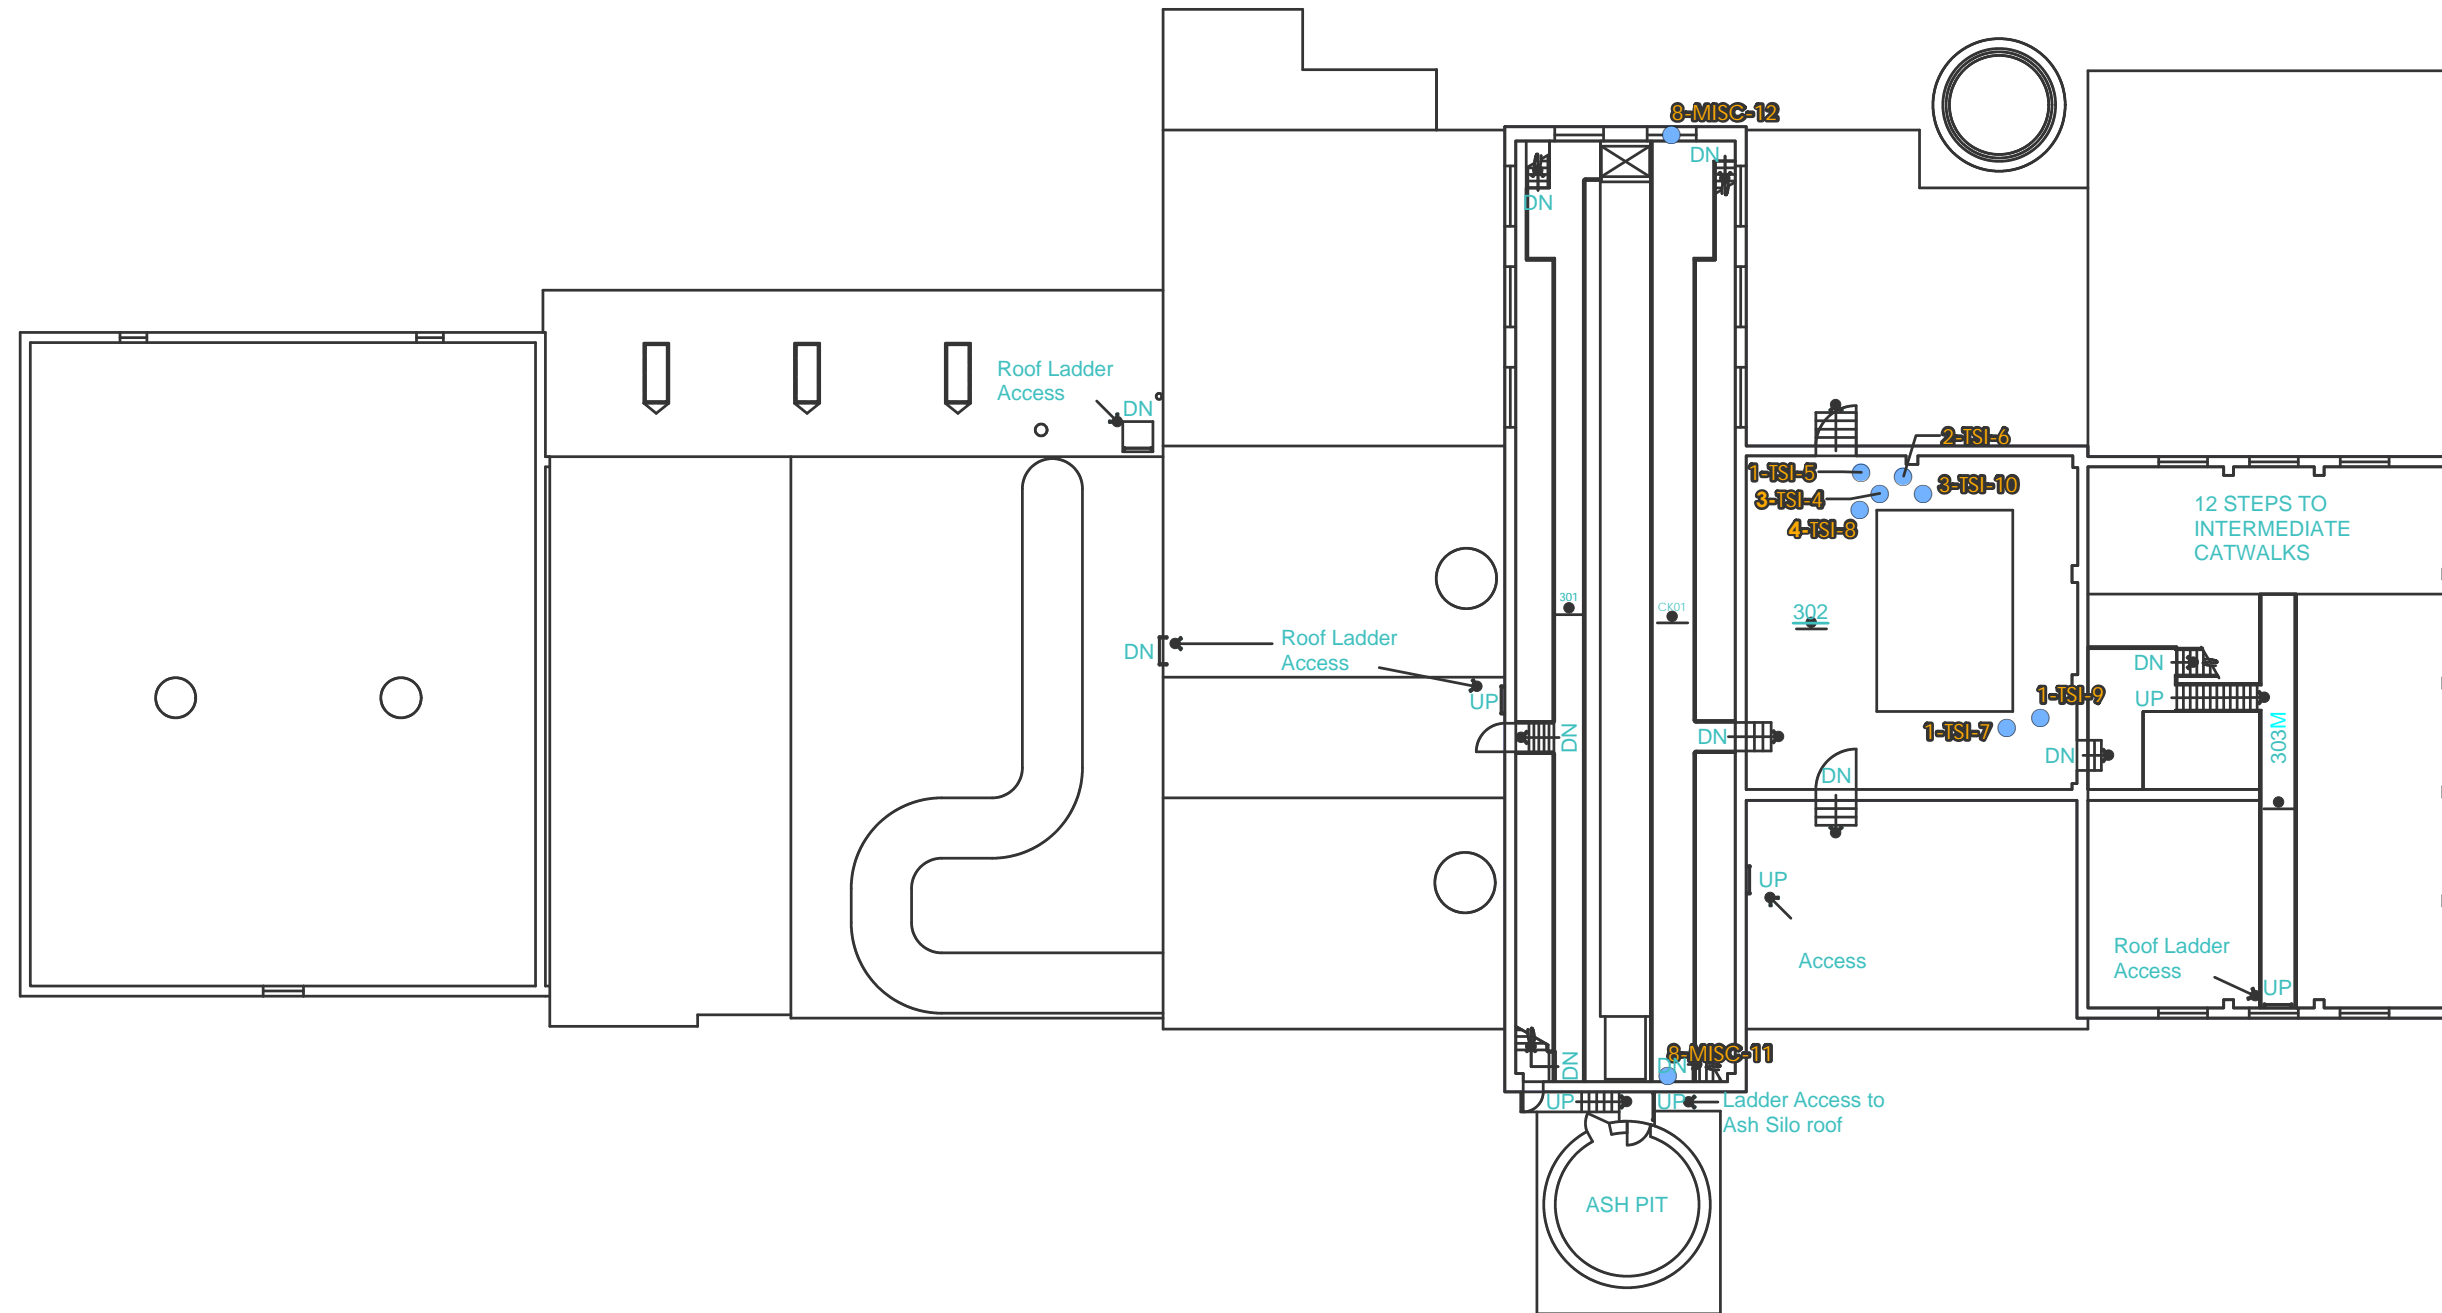

Source:
CAD data obtained from Washington State University.



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

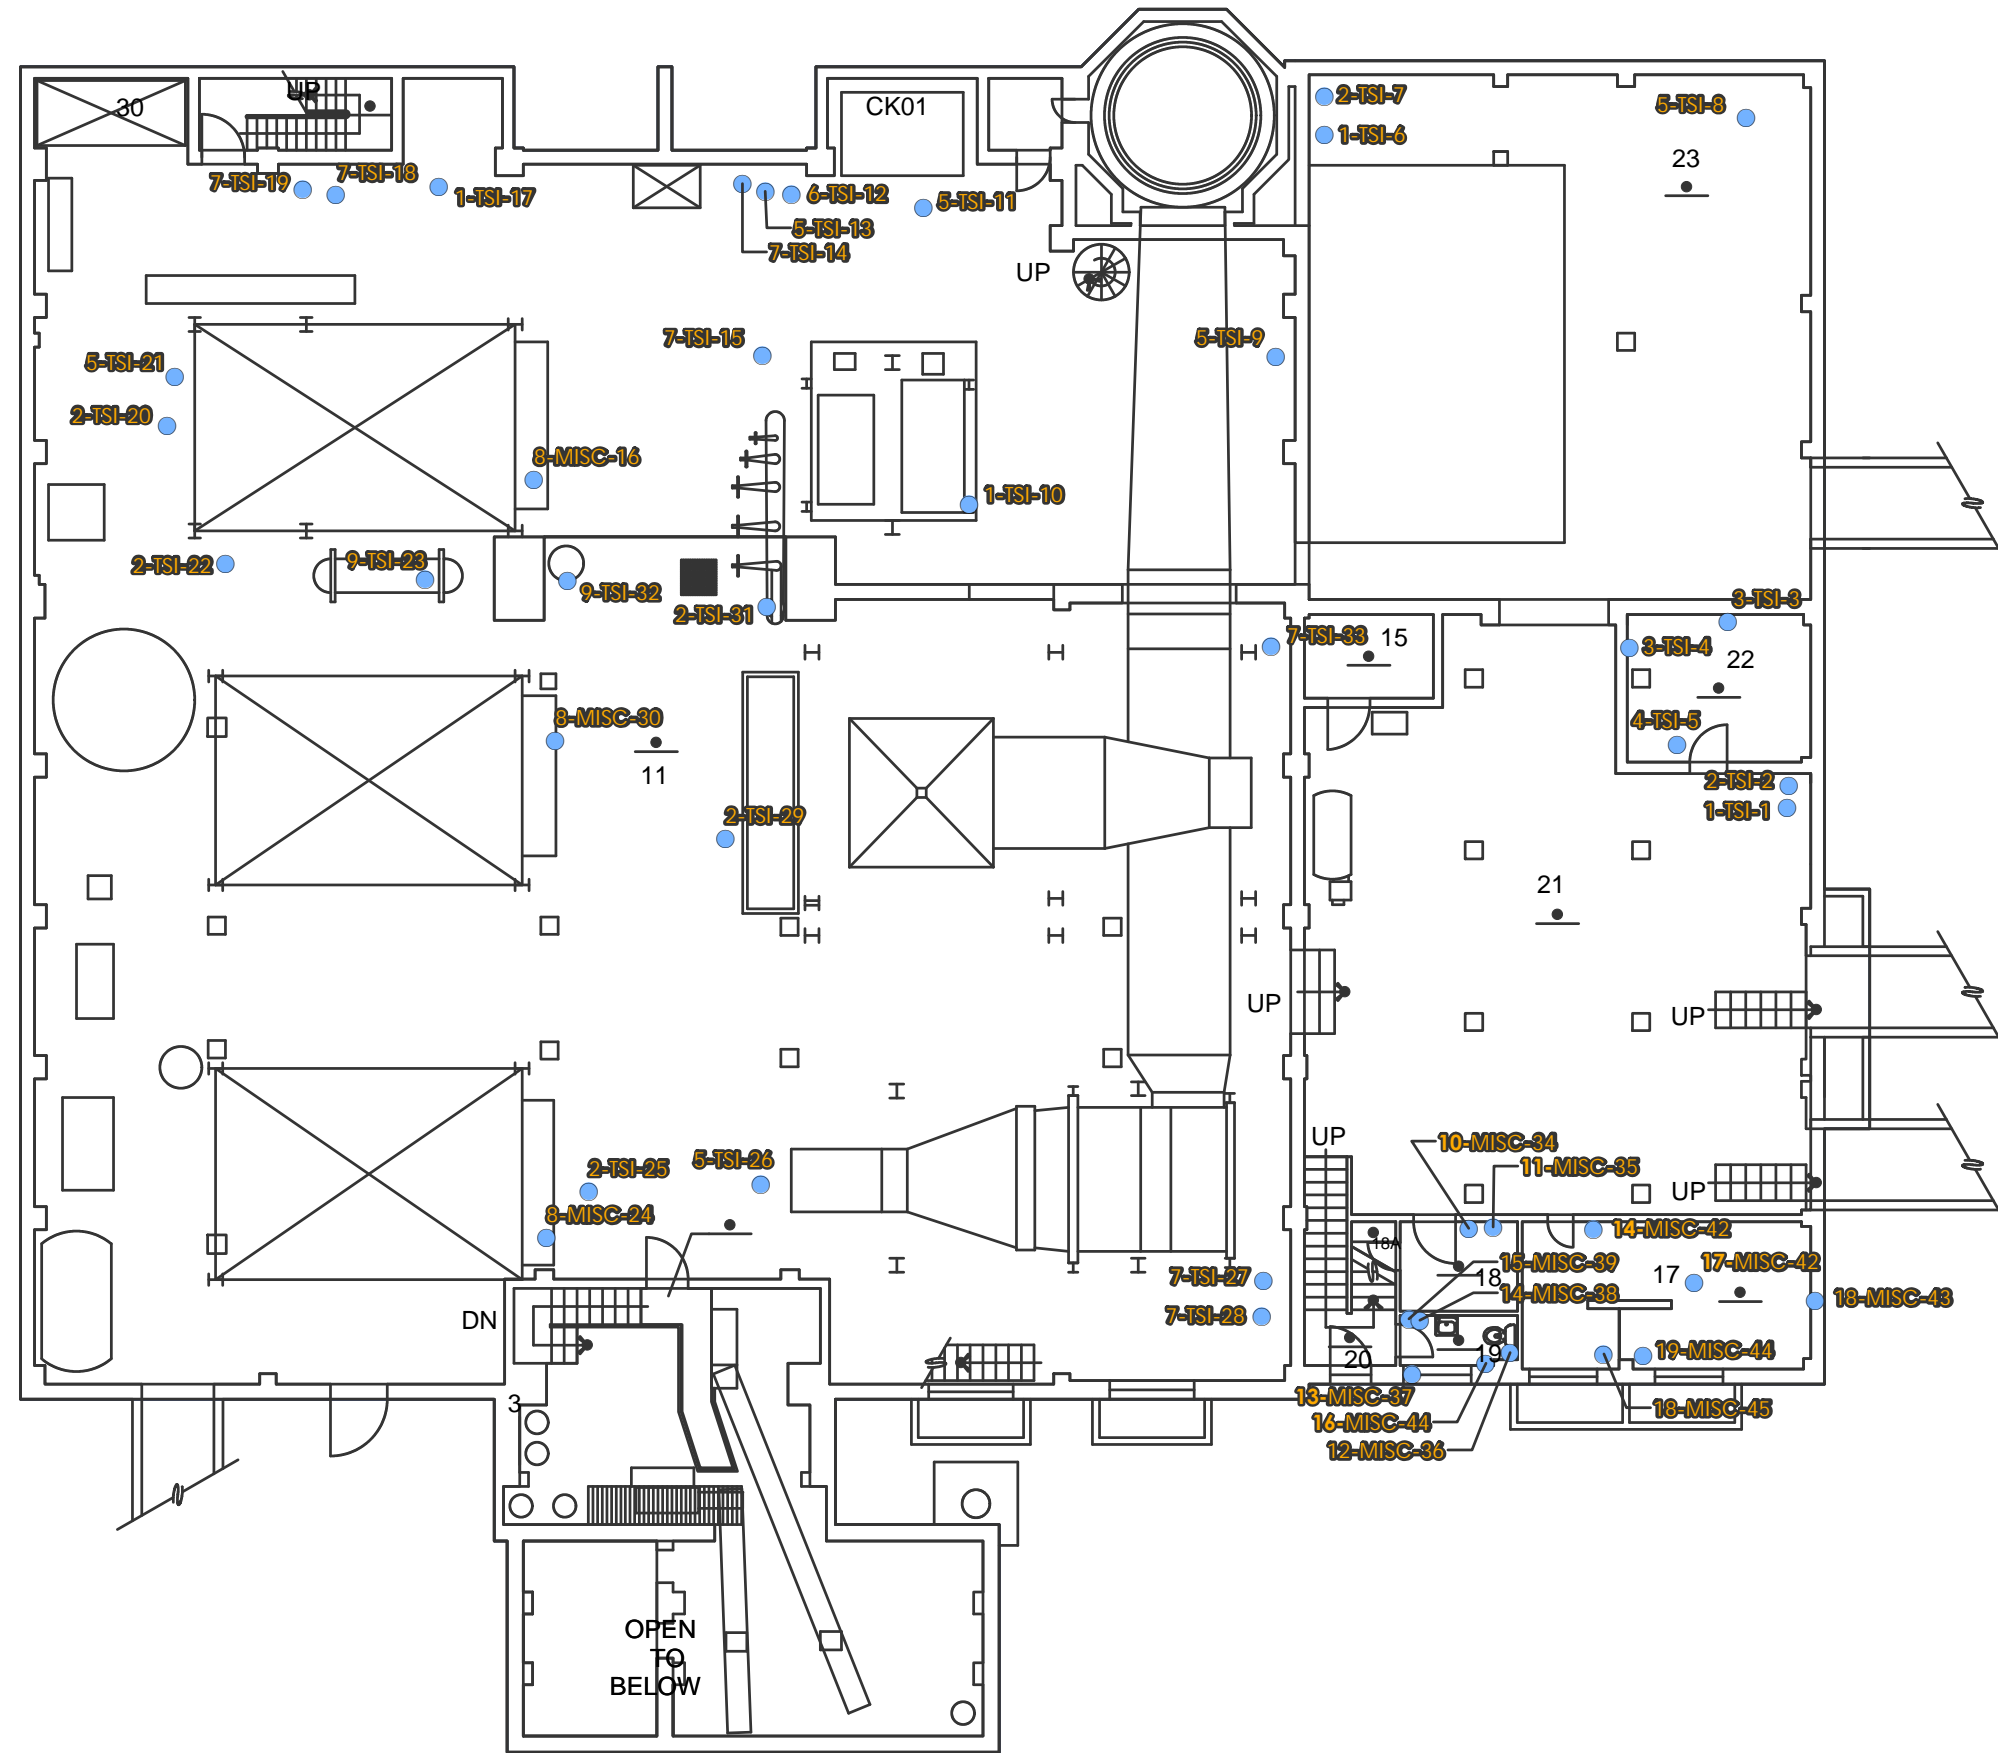


Figure 3-4
Basement Sampling
Locations - Asbestos

College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington

Legend
 ● Asbestos



Source:
 CAD data obtained from Washington State University.





This product is for informational purposes and may not have been prepared for, or be suitable for, legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

Figure 3-5 First Floor and Exterior Sampling Locations - Lead

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Legend

● Lead

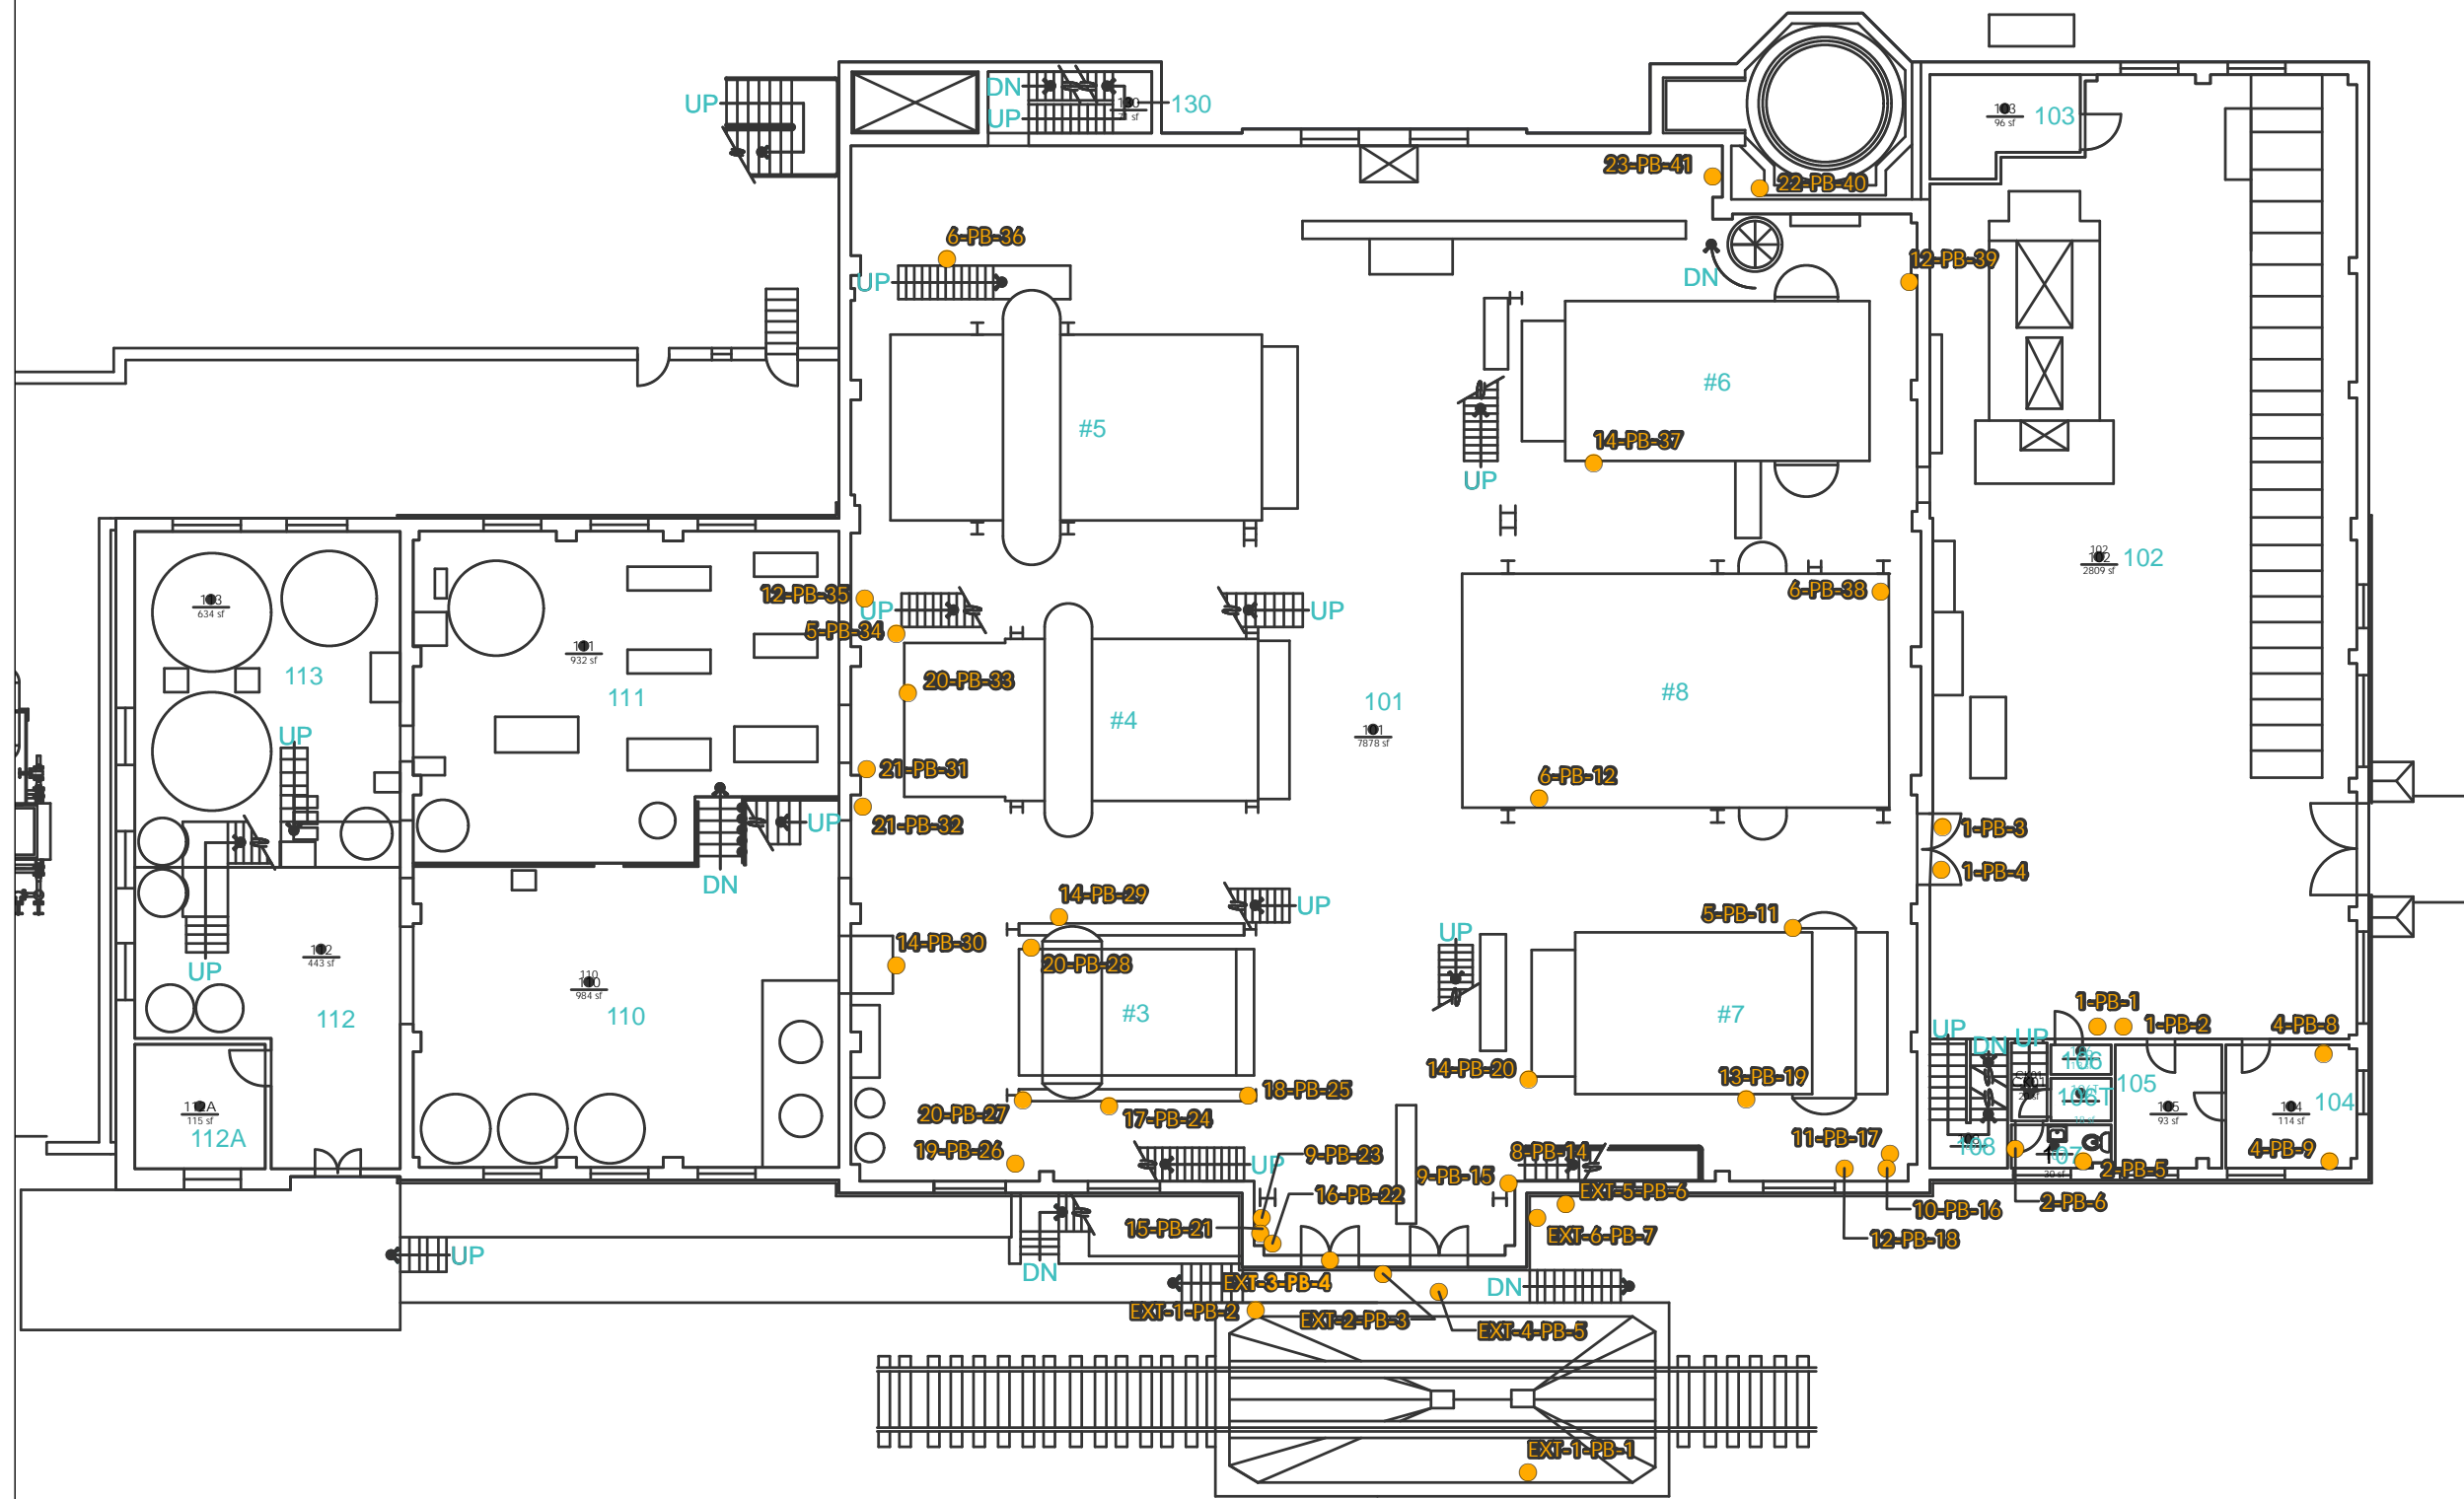

Source:
CAD data obtained from Washington State University.

 MAUL FOSTER LONGI
p. 971 544 2139 | www.maulfooster.com



This product is for informational purposes and may not have been prepared for, or be suitable for, legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

Figure 3-7 Upper Mezzanine Sampling Locations- Lead

College Avenue Steam Plant
Port of Whitman County
Pullman, Washington

Legend

● Lead

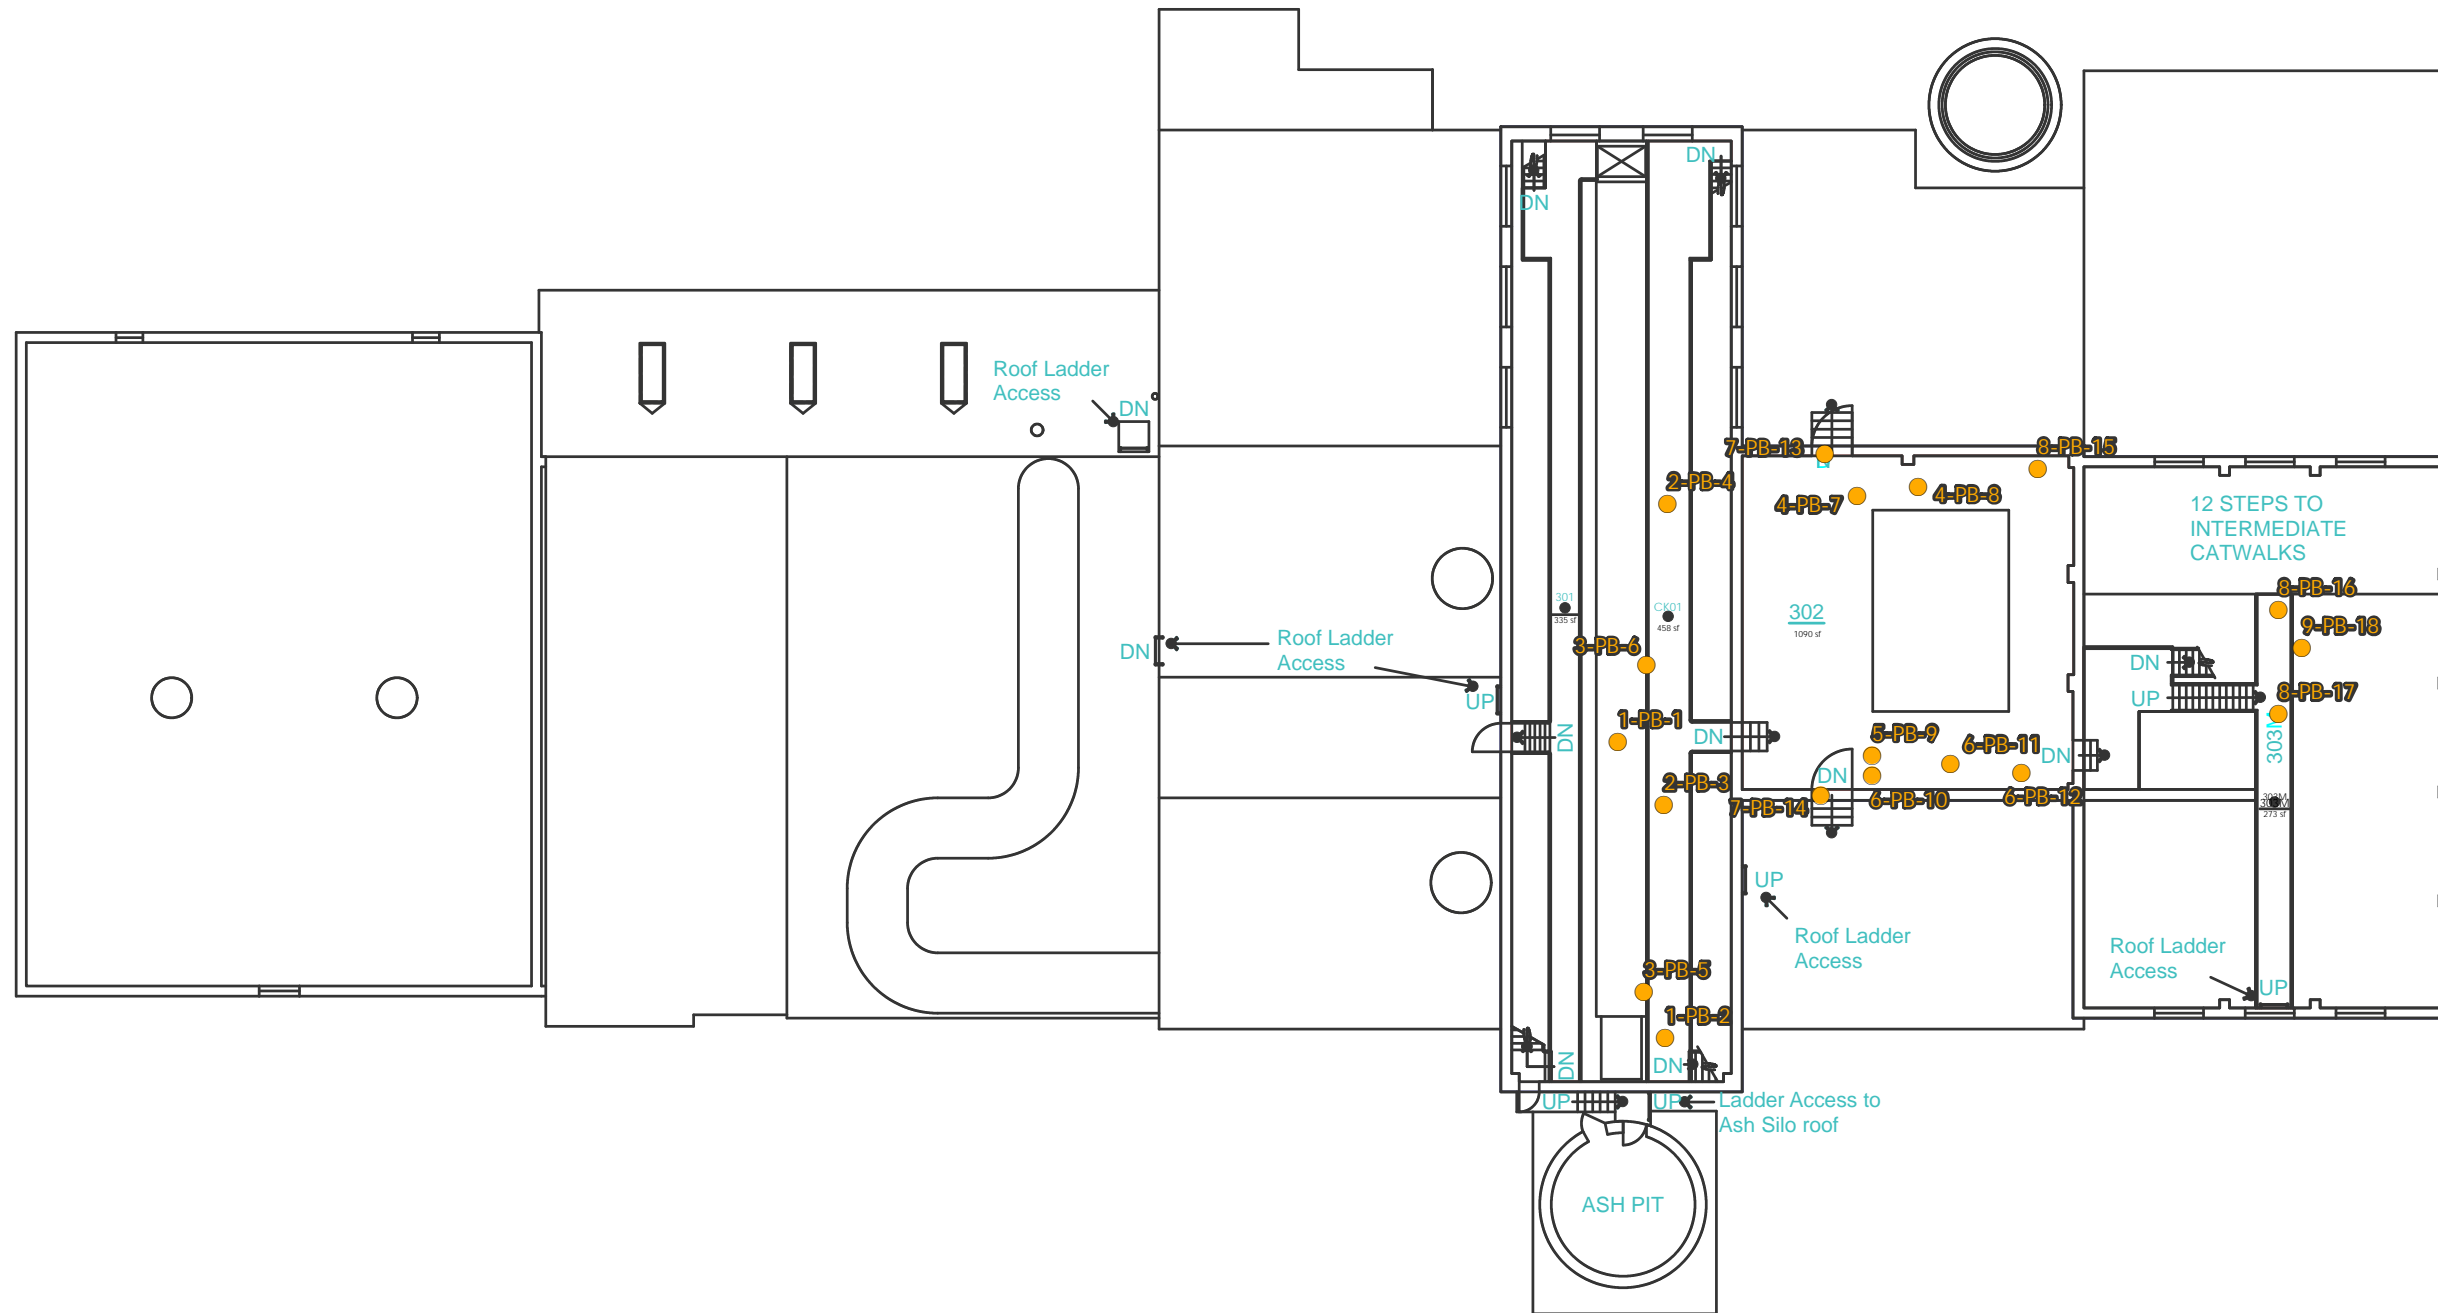

Source:
CAD data obtained from Washington State University.



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.


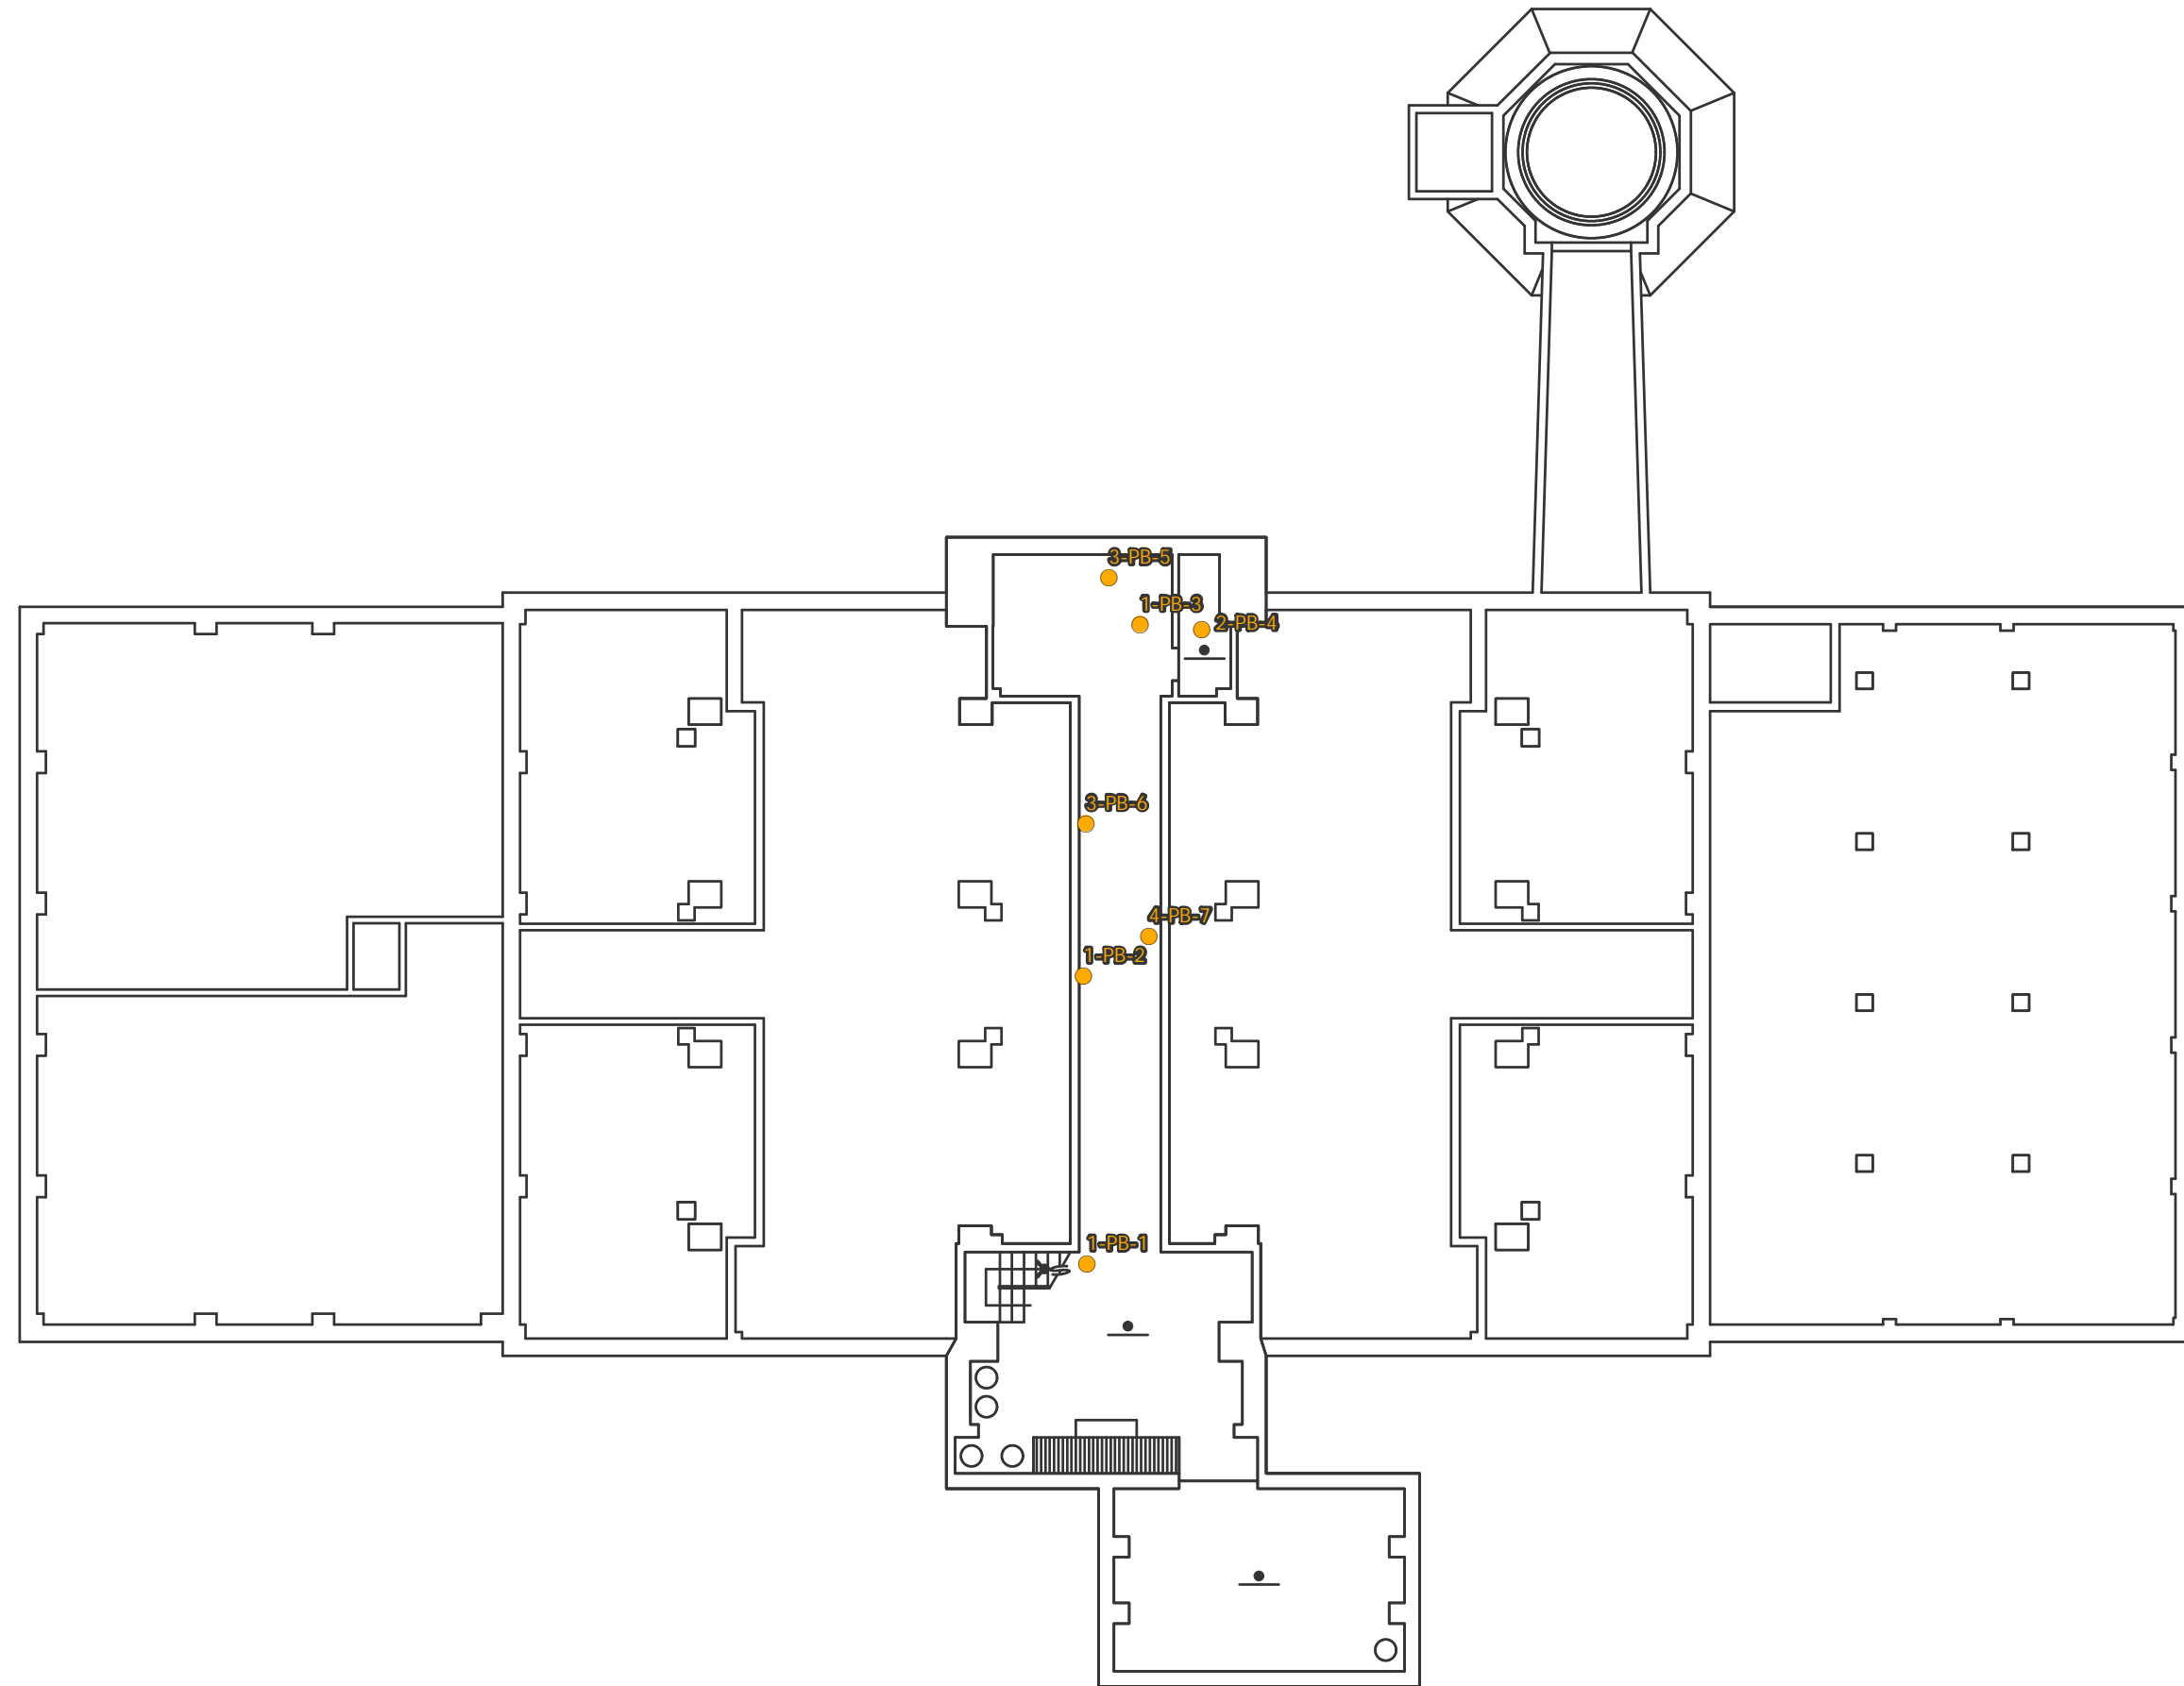


Figure 3-9
Subbasement Sampling
Locations - Lead

College Avenue Steam Plant
 Port of Whitman County
 Pullman, Washington

Legend

● Lead



Source:
 CAD data obtained from Washington State University.



This product is for informational purposes and may not have been prepared for, or be suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to ascertain the usability of the information.

APPENDIX A

AHERA CERTIFICATES



THIS IS TO CERTIFY THAT
CONNOR ANDERSON
HAS SUCCESSFULLY COMPLETED THE TRAINING COURSE
for
ASBESTOS INSPECTOR INITIAL COURSE

In accordance with TSCA Title II, Part 763, Subpart E, Appendix C of 40 CFR

Course Date: 8/16/2021 - 8/18/2021
Course Location: Portland, OR
Certificate: IN-21-9554B



CCB #SRA0614 24-Hr Training

24-Hour AHERA Inspector Training; AHERA is the Asbestos Hazard Emergency Response Act enacting Title II of Toxic Substance Control Act (TSCA)

Expiration Date: 08/18/2022

For verification of the authenticity of this certificate contact:
PBS Engineering and Environmental Inc.
4412 S Corbett Avenue
Portland, Oregon 97239
503.248.1939

A handwritten signature in black ink that reads "Andy Fridley".

Andy Fridley, Instructor

THIS IS TO CERTIFY THAT

EMILY CURTIS

HAS SUCCESSFULLY COMPLETED THE TRAINING COURSE

for

ASBESTOS INSPECTOR REFRESHER

In accordance with TSCA Title II, Part 763, Subpart E, Appendix C of 40 CFR

Course Date: 01/21/2021

Course Location: Portland, OR

Certificate: IR-21-6100B



CCB #SRA0615 4-Hr Training

4-Hour AHERA Inspector Refresher Training; AHERA is the Asbestos Hazard Emergency Response Act enacting Title II of Toxic Substance Control Act (TSCA)

Expiration Date: 01/21/2022

For verification of the authenticity of this certificate contact:

PBS Engineering and Environmental Inc.
4412 S Corbett Avenue
Portland, Oregon 97239
503.248.1939

A handwritten signature in black ink that reads "Andy Fridley".

Andy Fridley, Instructor

THIS IS TO CERTIFY THAT
SEAN MALONEY
HAS SUCCESSFULLY COMPLETED THE TRAINING COURSE
for
ASBESTOS INSPECTOR INITIAL COURSE

In accordance with TSCA Title II, Part 763, Subpart E, Appendix C of 40 CFR

Course Date: 12/16/2020 - 12/18/2020

Course Location: Portland, OR

Certificate: IN-20-8991B



CCB #SRA0614 24-Hr Training

24-Hour AHERA Inspector Training; AHERA is the Asbestos Hazard Emergency Response Act enacting Title II of Toxic Substance Control Act (TSCA)

Expiration Date: 12/18/2021

For verification of the authenticity of this certificate contact:
PBS Engineering and Environmental Inc.
4412 S Corbett Avenue
Portland, Oregon 97239
503.248.1939

A handwritten signature in black ink, which appears to read "Andy Fridley", is written over a horizontal line.

Andy Fridley, Instructor

APPENDIX B

FIELD SAMPLING DATA SHEETS




HBM Survey

Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/11/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	First Floor

Samples

Sample ID:	Sample Type:	
1-1-TSI-1	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Condensate pipe in northwest corner of room.	
Sample Quantity:	38 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

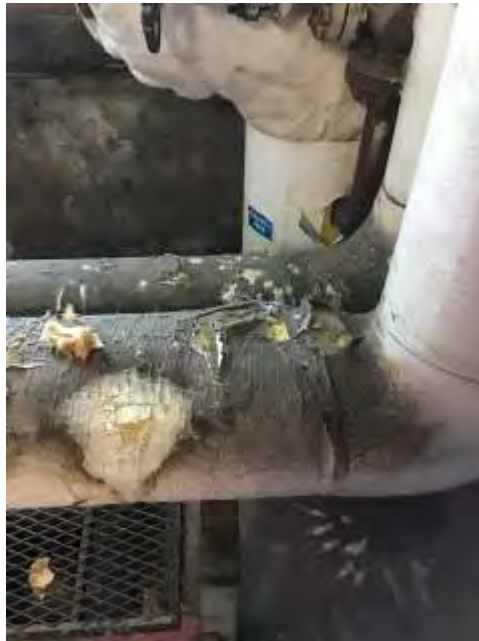

1-1-TSI-1



Additional Sample Notes:		White pipe wrapping with yellow insulation.
Sample ID:	Sample Type:	
1-1-TSI-2	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Condensate pipe in northwest corner of room.	
Sample Quantity:	38 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

1-1-TSI-2



Additional Sample Notes:

White pipe wrapping with yellow insulation.

Sample ID:

1-1-PB-1

Sample Type:

PB

Sample Location:

Room 102

Detailed Sample Location:

West wall between room 106 doorway and stairway.

Sample Quantity:

N/A

Sample Color:

XRF:

Tan

0.108

Sample Photo:




1-1-PB-1

Additional Sample Notes:

Sample ID:	Sample Type:
1-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room 102	West wall north of room 105 doorway.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.071

Sample Photo:

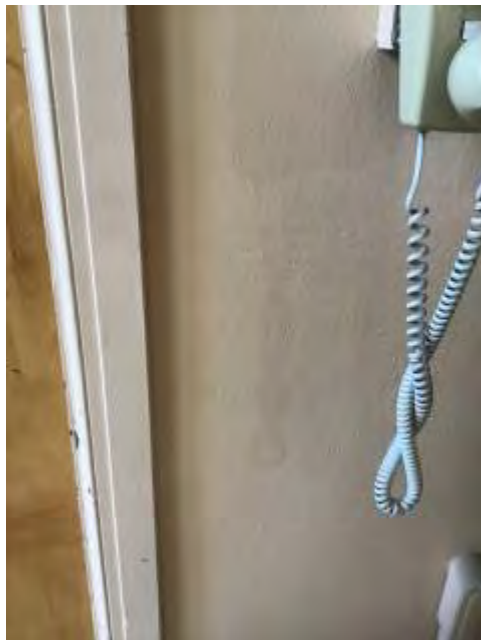

1-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
1-1-PB-3	PB
Sample Location:	Detailed Sample Location:
Room 102	North double doors between room 102 and 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.177

Sample Photo:



1-1-PB-3

Additional Sample Notes:

Sample ID:	Sample Type:
1-1-PB-4	PB
Sample Location:	Detailed Sample Location:
Room 102	North double door between room 102 and 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.224


Sample Photo:




1-1-PB-4

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-1-TSI-46	TSI	
Sample Location:	Detailed Sample Location:	
Room 107	Pipe in northwest corner of room 107.	
Sample Quantity:	38 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged; Potential ACBM with potential for significant damage	Yes

Sample Photo:



1-1-TSI-46

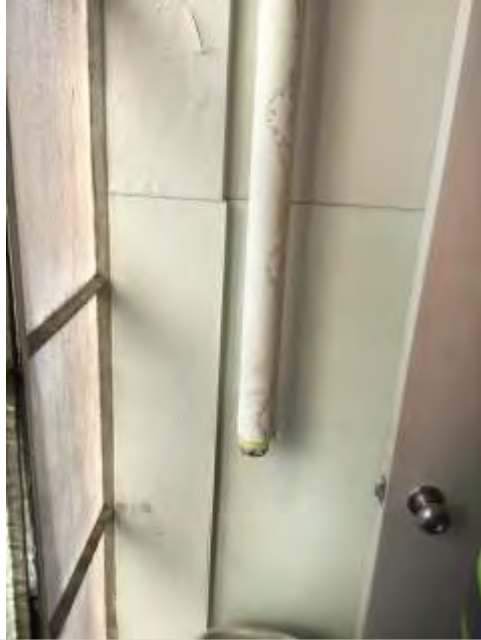

Additional Sample Notes:

Sample ID:

1-2-PB-5

Sample Type:

PB

Sample Location:

Room 107

Detailed Sample Location:

West wall next to window in room 107.

Sample Quantity:

120 square feet.


Sample Color:

White

XRF:

1.83

Sample Photo:

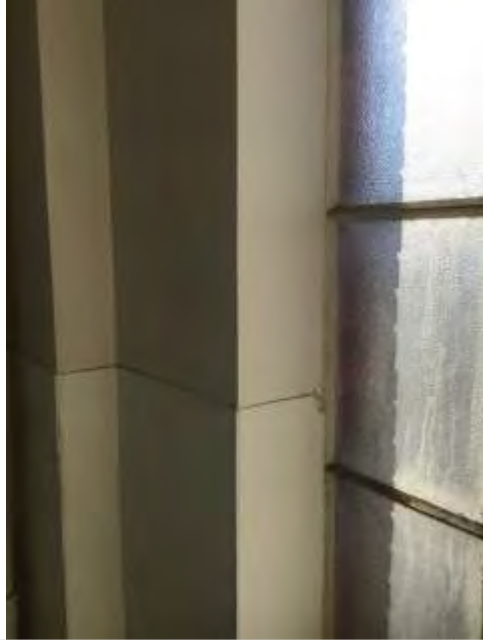

1-2-PB-5

Additional Sample Notes:

Sample ID:	Sample Type:
1-2-PB-6	PB
Sample Location:	Detailed Sample Location:
Room 107	North wall of room 107.
Sample Quantity:	120 square feet.
Sample Color:	XRF:
White	1.63

Sample Photo:



1-2-PB-6

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-2-TSI-3	TSI
-----------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Elbow on condensate pipe in northwest corner of room.
----------	---

Sample Quantity:	5 linear feet.
-------------------------	----------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:		
----------------------	--	--



1-2-TSI-3



Additional Sample Notes:		White pipe covering with yellow insulation.
Sample ID:	Sample Type:	
1-3-MISC-4	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Window at northwest corner of room.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-3-MISC-4



Additional Sample Notes:

Sample ID:	Sample Type:	
1-3-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Window at west wall.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	Yes

Sample Photo:




1-3-MISC-5



Additional Sample Notes:

Sample ID:	Sample Type:
1-3-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 106T	East wall in room 106T.
Sample Quantity:	N/A
Sample Color:	XRF:
Off-white	ND

Sample Photo:

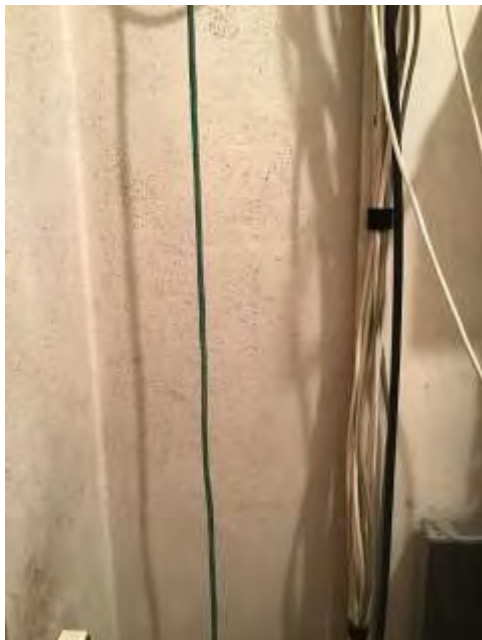

1-3-PB-7

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-3-MISC-45	MISC	
Sample Location:	Detailed Sample Location:	
Room 107	West wall window frame in room 107.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	No

Sample Photo:




1-3-MISC-45



Additional Sample Notes:	
Sample ID:	Sample Type:
1-4-PB-8	PB
Sample Location:	Detailed Sample Location:
Room 104	South wall east of window in room 104.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.181

Sample Photo:

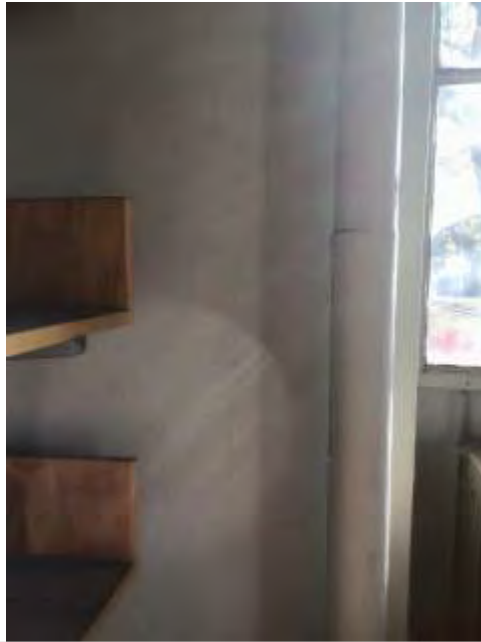


1-4-PB-8



Additional Sample Notes:	Submitted paint chip sample to laboratory for analysis.
---------------------------------	---

Sample ID:	Sample Type:
1-4-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 104	West wall south of window.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.175

Sample Photo:

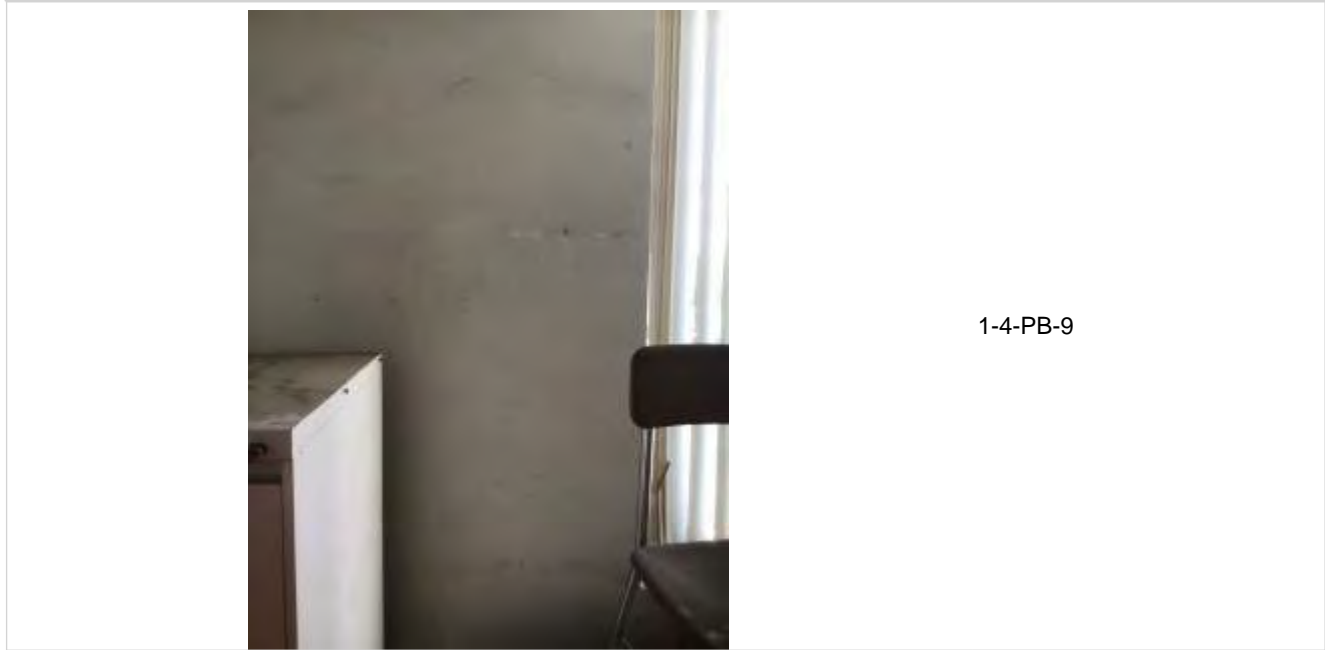


Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-4-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 105	East side of north wall.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.211

Sample Photo:



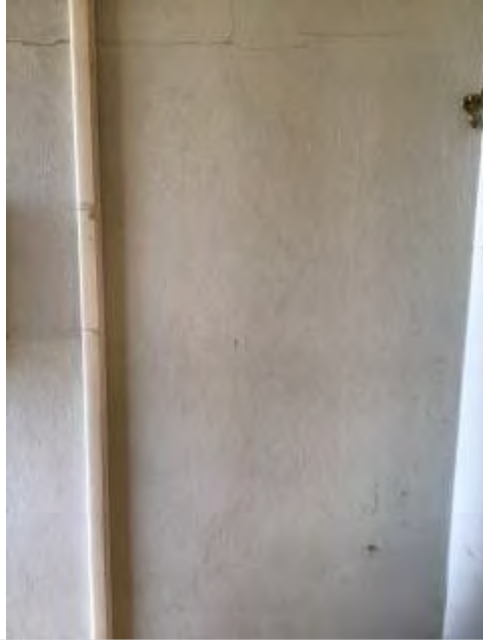

1-4-PB-10

Additional Sample Notes:

Sample ID:	Sample Type:	
1-4-MISC-6	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Above red brick on northwest corner of northwest boiler.	
Sample Quantity:	3.5 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-4-MISC-6



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-5-MISC-7	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Red brick on northwest corner of northwest boiler.	
Sample Quantity:	8 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red brick.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-5-MISC-7



Additional Sample Notes:


Sample ID: 1-5-PB-11 **Sample Type:** PB

Sample Location: Room 101 **Detailed Sample Location:** South side of east wall on south boiler.

Sample Quantity: N/A

Sample Color: Silver **XRF:** ND

Sample Photo:

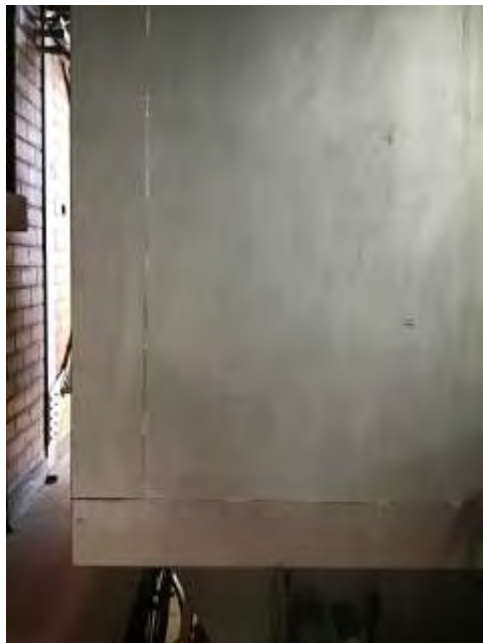

1-5-PB-11

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-5-PB-34	PB
Sample Location:	Detailed Sample Location:
Room 101	North side of northeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



1-5-PB-34

Additional Sample Notes:	Silver paint on various steam equipment in room 101.
---------------------------------	--

Sample ID:	Sample Type:
1-6-PB-12	PB
Sample Location:	Detailed Sample Location:
Room 101	Hydraulic Drive on northwest side of south middle boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.326

Sample Photo:




1-6-PB-12

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-6-TSI-8	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Red pipe by double doors on west side of room.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-6-TSI-8

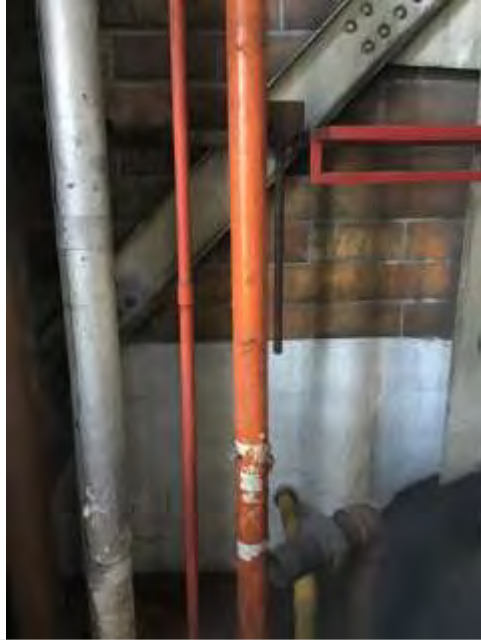

Additional Sample Notes:	Red pipe wrap with fibrous white insulation.
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-6-PB-38	PB
-----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Green pipe on south end of south middle boiler.
----------	---

Sample Quantity:	N/A
-------------------------	-----

Sample Color:	XRF:
----------------------	-------------

Green	0.375
-------	-------

Sample Photo:



1-6-PB-38

Additional Sample Notes:

Sample ID:	Sample Type:
1-6-PB-36	PB
Sample Location:	Detailed Sample Location:
Room 101	East side of northeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.503


Sample Photo:



1-6-PB-36

Additional Sample Notes:	Green paint on various steam equipment in 101.	
Sample ID:	Sample Type:	
1-7-TSI-9	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Silver pipe by double doors on west side of room.	
Sample Quantity:	30 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:

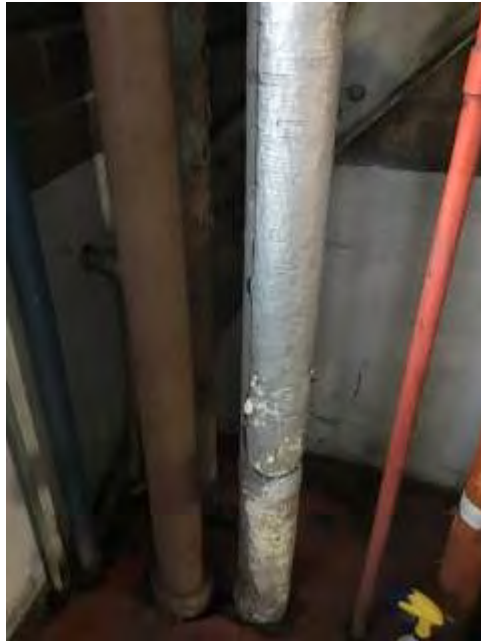

1-7-TSI-9



Additional Sample Notes:	Silver pipe wrap with yellow fibrous insulation
Sample ID:	Sample Type:
1-7-PB-13	PB
Sample Location:	Detailed Sample Location:
Room 101	Floor on south side of room in front of double door between room 102 and 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.188

Sample Photo:



1-7-PB-13



Additional Sample Notes:	Submitted paint chip sample to laboratory for analysis.
Sample ID:	Sample Type:
1-8-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 101	West metal support beam next to fire extinguisher.
Sample Quantity:	15 square feet
Sample Color:	XRF:
Red	5.00

Sample Photo:



1-8-PB-14

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-8-TSI-10	TSI
------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Silver pipe on boiler by staircase to lower floor on west side of room.
----------	---

Sample Quantity:	3,000 linear feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Tan cementitious material	Damaged or significantly damaged	Yes
---------------------------	----------------------------------	-----

Sample Photo:



1-8-TSI-10




Additional Sample Notes:

White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.

Sample ID:	Sample Type:	
1-8-TSI-11	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Silver pipe on boiler by staircase to lower floor on west side of room.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:





1-8-TSI-11



Additional Sample Notes:

White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.

Sample ID:	Sample Type:
1-8-TSI-12	TSI
Sample Location:	Detailed Sample Location:
Room 101	Silver insulation on boiler on southwest side of room.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-8-TSI-12



Additional Sample Notes:	White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.
---------------------------------	--

Sample ID:	Sample Type:
1-8-TSI-21	TSI
Sample Location:	Detailed Sample Location:

Room 101	Dark gray pipe between boilers 4 and 5.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-8-TSI-21



Additional Sample Notes:	Dark gray pipe wrap with white fibrous insulation. Insulation appears to be consistent with Homogenous Area 8. Difficult to quantify due to distribution and various wrap colors.
---------------------------------	---

Sample ID:	Sample Type:	
1-8-TSI-14	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Orange pipe in southeast corner of room.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:



1-8-TSI-14



Additional Sample Notes:	White fibrous insulation with various colors of pipe wrap covers (e.g., also includes red pipe in southwest corner of room that runs to north section of room). Difficult to quantify due to distribution and various wrap colors.
---------------------------------	--

Sample ID:	Sample Type:	
1-8-TSI-32	TSI	
Sample Location:	Detailed Sample Location:	
Room 104	Southeast corner of room on white pipe.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:




1-8-TSI-32

Additional Sample Notes:	White pipe wrap with yellow insulation.
---------------------------------	---

Sample ID:	Sample Type:	
1-8-TSI-18	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	East side of room.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:

1-8-TSI-18

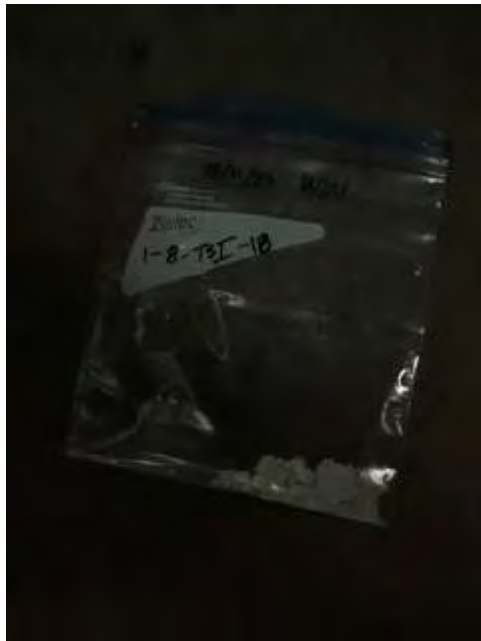

Additional Sample Notes:

Gray duct cover with white fibrous insulation. Insulation appears to be consistent with Homogenous Area 8. Difficult to quantify due to distribution and various wrap colors.

Sample ID:

1-9-MISC-13

Sample Type:

MISC

Sample Location:

Room 101

Detailed Sample Location:

Sink on southwest side of room.

Sample Quantity:

6 square feet.

Misc Sample Material:

Insulation on sink.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

Yes

Sample Photo:



1-9-MISC-13



Additional Sample Notes:	Yellow fibrous insulation.
---------------------------------	----------------------------

Sample ID:	Sample Type:
1-9-PB-15	PB
Sample Location:	Detailed Sample Location:
Room 101	West metal support beam above fire extinguisher.
Sample Quantity:	3,000 square feet.
Sample Color:	XRF:
White	5.00

Sample Photo:



1-9-PB-15

Additional Sample Notes:	Difficult to quantify.
---------------------------------	------------------------

Sample ID:	Sample Type:
-------------------	---------------------

1-9-PB-23	PB
-----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Metal support beam on west wall north of double door.
----------	---

Sample Quantity:	3,000 square feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

White	5.00
-------	------

Sample Photo:

1-9-PB-23



Additional Sample Notes:

Difficult to quantify.

Sample ID:

1-10-PB-16

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Steam pipe in southwest corner of room 101.

Sample Quantity:

N/A

Sample Color:

Red

XRF:

0.616

Sample Photo:




1-10-PB-16

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-10-TSI-15	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Southeast corner of room on corrugated boiler.	
Sample Quantity:	2 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cementitious material	Damaged or significantly damaged	Yes

Sample Photo:




1-10-TSI-15

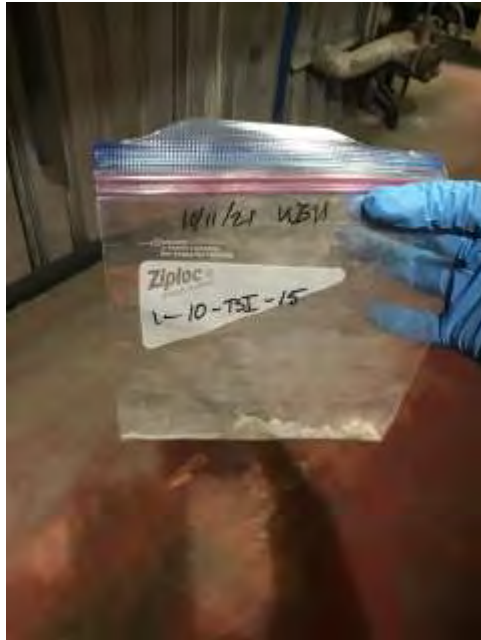

Additional Sample Notes:	Gray insulation and fabric.	
Sample ID:	Sample Type:	
1-11-MISC-16	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Southeast corner of room on corrugated boiler wall.	
Sample Quantity:	2 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan soundproofing material.	Potential ACBM with potential for damage	Yes

Sample Photo:

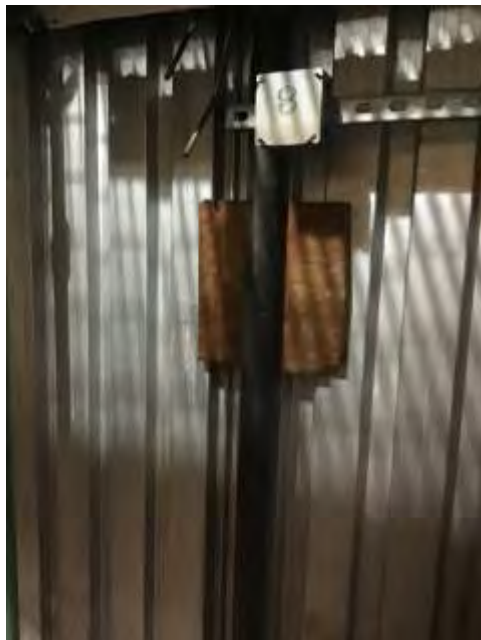

1-11-MISC-16



Additional Sample Notes:	Soundproofing material.
Sample ID:	Sample Type:
1-11-PB-17	PB
Sample Location:	Detailed Sample Location:
Room 101	Mirror above sink in southwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.472

Sample Photo:



1-11-PB-17

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-12-PB-18	PB
Sample Location:	Detailed Sample Location:
Room 101	Southwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.013

Sample Photo:



1-12-PB-18

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-12-PB-35	PB
Sample Location:	Detailed Sample Location:
Room 101	Northeast corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
White	ND

Sample Photo:





1-12-PB-35

Additional Sample Notes:

Sample ID:	Sample Type:	
1-12-MISC-17	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Green cabinet in southeast corner of room.	
Sample Quantity:	Less than 5 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray fibrous material.	Damaged or significantly damaged friable miscellaneous ACM	Yes

Sample Photo:




1-12-MISC-17



Additional Sample Notes:	Gray fibrous material.
Sample ID:	Sample Type:
1-12-PB-39	PB
Sample Location:	Detailed Sample Location:
Room 101	Southeast corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.068

Sample Photo:

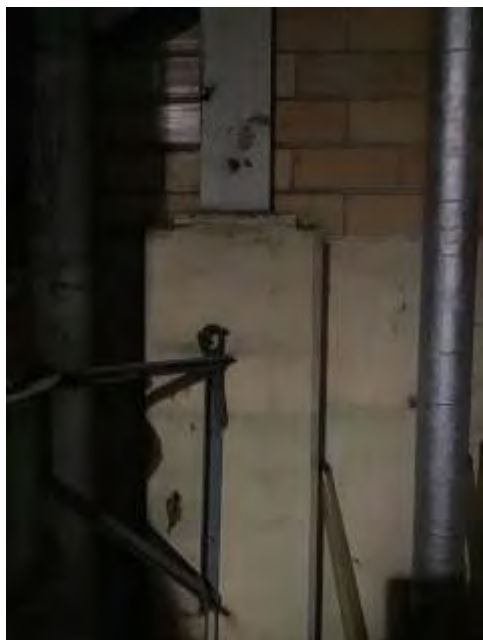

1-12-PB-39

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-13-MISC-19	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Soundproofing material on boiler in northeast corner of room.	
Sample Quantity:	15 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray and tan soundproofing material wrap.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-13-MISC-19



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-13-MISC-22	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Fabric material on southeast boiler by double doors on south end of room.	
Sample Quantity:	15 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray fabric material.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-13-MISC-22



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-13-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 101	Pipe on west side of southwest boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.092

Sample Photo:



1-13-PB-19

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-14-PB-20	PB
Sample Location:	Detailed Sample Location:
Room 101	Northwest corner of southwest boiler.
Sample Quantity:	600 linear feet
Sample Color:	XRF:
Yellow	5.00

Sample Photo:





1-14-PB-20

Additional Sample Notes:

Sample ID:	Sample Type:
1-14-PB-29	PB
Sample Location:	Detailed Sample Location:
Room 101	North pipe on the northwest corner of north middle boiler.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	5.00

Sample Photo:



1-14-PB-29

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-14-PB-30	PB
Sample Location:	Detailed Sample Location:
Room 101	North concrete bench west of north door.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	2.83

Sample Photo:




1-14-PB-30

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
1-14-TSI-20	TSI
Sample Location:	Detailed Sample Location:
Room 101	White patch on pipe in north portion of room.
Sample Quantity:	5 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

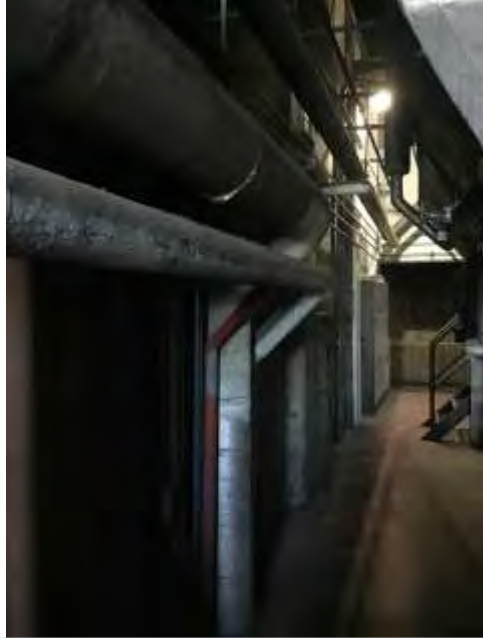

1-14-TSI-20



Additional Sample Notes:	White patch on silver pipe with white fibrous insulation.
---------------------------------	---

Sample ID:	Sample Type:
-------------------	---------------------

1-14-PB-37	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Pipe between southeast and south middle boiler.
----------	---

Sample Quantity:	600 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

Yellow	5.00
--------	------

Sample Photo:




1-14-PB-37

Additional Sample Notes:

Sample ID:	Sample Type:	
1-15-MISC-38	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall west of single doorway in room 102.	
Sample Quantity:	3,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:

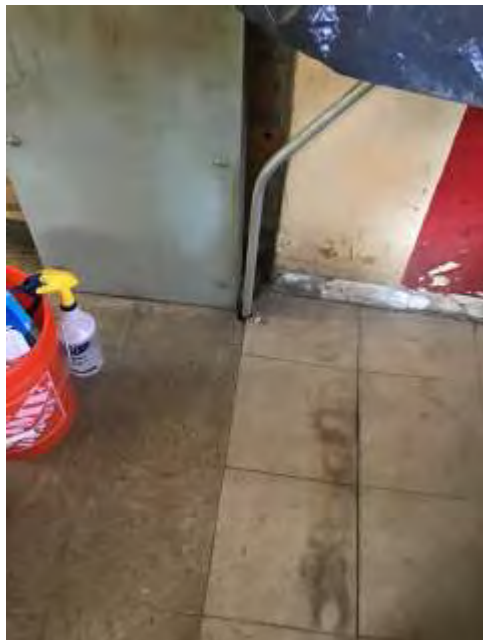

1-15-MISC-38



Additional Sample Notes:

Sample ID:	Sample Type:	
1-15-MISC-23	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	Northeast corner of room.	
Sample Quantity:	3,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-15-MISC-23



Additional Sample Notes:

Sample ID:	Sample Type:	
1-15-MISC-24	MISC	
Sample Location:	Detailed Sample Location:	
Room 105	Northeast corner of room.	
Sample Quantity:	3,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-15-MISC-24



Additional Sample Notes:

Sample ID:

1-15-PB-21

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

West wall north of double door.

Sample Quantity:

30 linear feet

Sample Color:

Orange

XRF:

2.36

Sample Photo:



1-15-PB-21

Additional Sample Notes:

Sample ID:	Sample Type:
1-16-PB-22	PB
Sample Location:	Detailed Sample Location:
Room 101	West wall north of double door.
Sample Quantity:	N/A
Sample Color:	XRF:
Brown	0.015

Sample Photo:




1-16-PB-22

Additional Sample Notes:

Sample ID:	Sample Type:	
1-16-MISC-25	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	East wall of room.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:

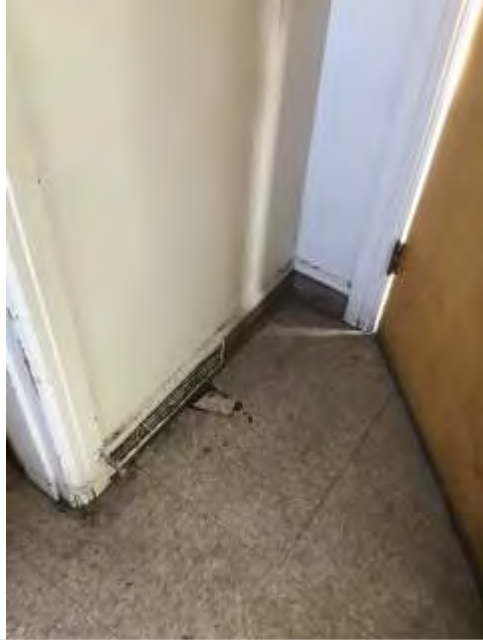


1-16-MISC-25



Additional Sample Notes:

Sample ID:	Sample Type:	
1-16-MISC-26	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	East wall of room.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:

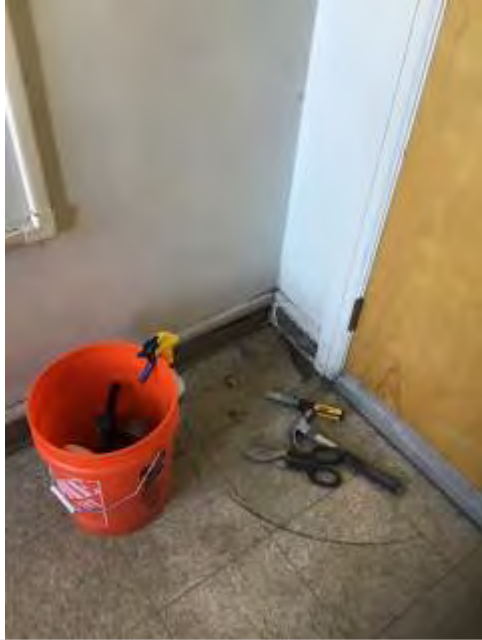

1-16-MISC-26



Additional Sample Notes:

Sample ID:

1-17-MISC-27

Sample Type:

MISC

Sample Location:

Room 105

Detailed Sample Location:

North wall of room.

Sample Quantity:

650 square feet.

Misc Sample Material:

Light gray wallboard.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

Yes

Sample Photo:



1-17-MISC-27



Additional Sample Notes:

Sample ID:

1-17-PB-24

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Steam pipe on west side or northwest boiler.

Sample Quantity:

N/A

Sample Color:

Bright orange

XRF:

0.121

Sample Photo:



1-17-PB-24

Additional Sample Notes:

Sample ID:	Sample Type:
1-18-PB-25	PB
Sample Location:	Detailed Sample Location:
Room 101	Brick on southwest corner of northwest boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:



1-18-PB-25

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-18-MISC-28	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	North wall of room in light switch casing.	
Sample Quantity:	785 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light gray cementitious wallboard.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-18-MISC-28



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-18-MISC-43	MISC	
Sample Location:	Detailed Sample Location:	
Room 106T	West wall by door in room 106T.	
Sample Quantity:	785 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with cementitious wallboard.	Damaged or significantly damaged friable miscellaneous ACM	Yes

Sample Photo:




1-18-MISC-43



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-19-MISC-29	MISC	
Sample Location:	Detailed Sample Location:	
Room 104	Northwest corner of room above light switch.	
Sample Quantity:	180 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White 18" x 36" ceiling tile with randomized stipple pattern.	Potential ACBM with potential for damage	Yes

Sample Photo:

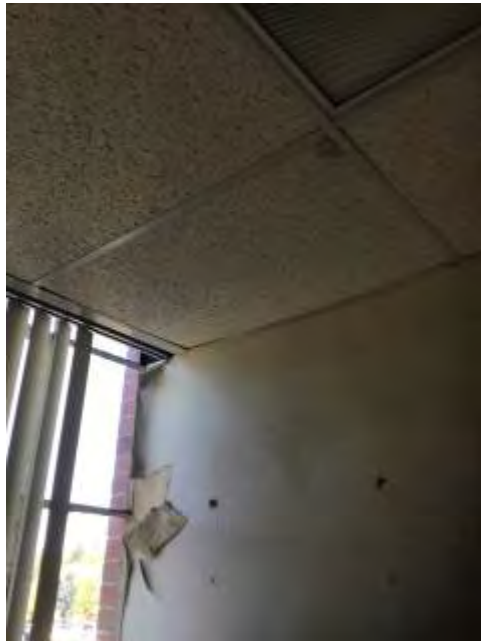

1-19-MISC-29



Additional Sample Notes:

Sample ID:	Sample Type:
1-19-PB-26	PB
Sample Location:	Detailed Sample Location:
Room 101	Support pole in northwest corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Gray	0.111

Sample Photo:



1-19-PB-26

Additional Sample Notes:

Sample ID:	Sample Type:	
1-19-MISC-31	MISC	
Sample Location:	Detailed Sample Location:	
Room 105	Northwest corner of room.	
Sample Quantity:	180 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White 18" x 36" ceiling tile with randomized stipple pattern.	Potential ACBM with potential for damage	Yes

Sample Photo:



1-19-MISC-31



Additional Sample Notes:

Sample ID:	Sample Type:
1-20-PB-27	PB
Sample Location:	Detailed Sample Location:
Room 101	Northwest support beam of northwest boiler.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:
Silver	2.47

Sample Photo:



1-20-PB-27

Additional Sample Notes:	Quantity difficult to estimate.
Sample ID:	Sample Type:
1-20-PB-28	PB
Sample Location:	Detailed Sample Location:
Room 101	Northeast support beam of northwest boiler.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:
Silver	1.66

Sample Photo:



1-20-PB-28



Additional Sample Notes:	Quantity difficult to estimate. Submitted paint chip sample to laboratory for analysis.
---------------------------------	---

Sample ID:	Sample Type:
-------------------	---------------------

1-20-MISC-30	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 104	Southeast corner above cabinet.
----------	---------------------------------

Sample Quantity:	20 square feet.
-------------------------	-----------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

White 18" x 36" ceiling tile with uniform stipple pattern.	Potential ACBM with potential for damage	Yes
--	--	-----

Sample Photo:

1-20-MISC-30



Additional Sample Notes:

Sample ID:	Sample Type:
1-20-PB-33	PB
Sample Location:	Detailed Sample Location:
Room 101	Support beam on northwest corner of northeast boiler.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:
Silver	0.040

Sample Photo:



1-20-PB-33

Additional Sample Notes:

Sample ID:	Sample Type:	
1-21-MISC-33	MISC	
Sample Location:	Detailed Sample Location:	
104	Gray blue counter top on east side of room.	
Sample Quantity:	12 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray blue laminate countertop with black and green mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-21-MISC-33



Additional Sample Notes:


Sample ID: 1-21-PB-31 **Sample Type:** PB

Sample Location: Room 101 **Detailed Sample Location:** Pipe on north wall between northeast and north middle boiler.

Sample Quantity: 70 linear feet.

Sample Color: Brown **XRF:** 3.52

Sample Photo:

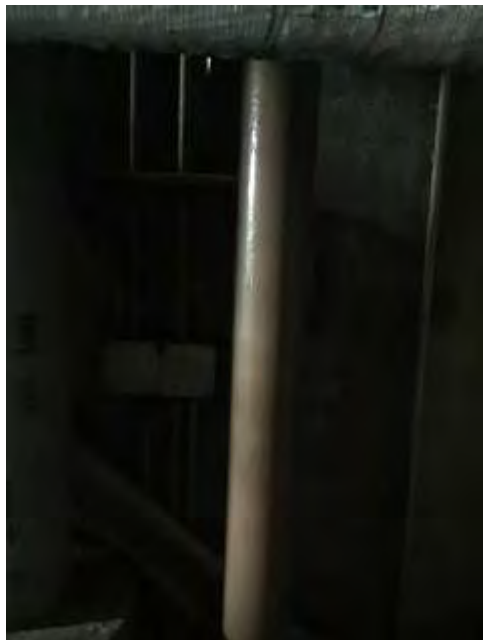

1-21-PB-31

Additional Sample Notes:

Sample ID:	Sample Type:
1-21-PB-32	PB
Sample Location:	Detailed Sample Location:
Room 101	Pipe north of north middle boiler.
Sample Quantity:	70 linear feet.
Sample Color:	XRF:
Brown	1.208

Sample Photo:



1-21-PB-32

Additional Sample Notes:

Sample ID:	Sample Type:	
1-22-MISC-34	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	Northwest corner of room by stairs.	
Sample Quantity:	240 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Dark brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-22-MISC-34



Additional Sample Notes:

Sample ID:	Sample Type:	
1-22-MISC-35	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall east of double door.	
Sample Quantity:	240 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Dark brown cove base with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-22-MISC-35



Additional Sample Notes:

Sample ID:

1-22-PB-40

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Green cabinet in the southeast corner.

Sample Quantity:

64 square feet.

Sample Color:

Dark green

XRF:

1.068

Sample Photo:



1-22-PB-40

Additional Sample Notes:

Sample ID:	Sample Type:
1-23-PB-41	PB
Sample Location:	Detailed Sample Location:
Room 101	Light gray cabinet in southeast corner of room 101.
Sample Quantity:	N/A
Sample Color:	XRF:
Light gray	0.048

Sample Photo:



1-23-PB-41

Additional Sample Notes:		
Sample ID:	Sample Type:	
1-23-MISC-36	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	North wall, west of transformer box and east of the double doors.	
Sample Quantity:	Less than 5 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray cementitious patching material.	Potential ACBM with potential for damage	No

Sample Photo:



1-23-MISC-36



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-24-MISC-37	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 102	North wall west of single doorway.
----------	------------------------------------

Sample Quantity:	77.5 square feet.
-------------------------	-------------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Light gray 12" x 12" vinyl floor tile with gray mastic.	Potential ACBM with potential for damage	No
---	--	----

Sample Photo:



1-24-MISC-37



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-25-MISC-39	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Rooms 102 and 101.	Double doorway between room 102 and 101.
--------------------	--

Sample Quantity:	11 linear feet.
-------------------------	-----------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Black transition strip with brown mastic.	Potential ACBM with potential for damage	No
---	--	----

Sample Photo:



1-25-MISC-39



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-25-MISC-47	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	West stairway moving down in room 102.	
Sample Quantity:	11 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Black transition strip with brown mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-25-MISC-47



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

1-26-MISC-40	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Stairway to Room 106T and 107	South side of stairway to Room 106T and 107.
-------------------------------	--

Sample Quantity:	28 square feet.
-------------------------	-----------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Rubber stair tread with clear mastic.	Potential ACBM with potential for damage	No
---------------------------------------	--	----

Sample Photo:



1-26-MISC-40



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-27-MISC-41	MISC	
Sample Location:	Detailed Sample Location:	
Room 106T	Center floor of room 106T.	
Sample Quantity:	16 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Dark brown patterned 9 x 9 vinyl floor tiles with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-27-MISC-41



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-28-MISC-42	MISC	
Sample Location:	Detailed Sample Location:	
Room 106T	Center floor of room 106T.	
Sample Quantity:	76 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light tan patterned 9" x 9" vinyl floor tile with black mastic.	Damaged or significantly damaged; Potential ACBM with potential for damage	No

Sample Photo:



1-28-MISC-42



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-28-MISC-48	MISC	
Sample Location:	Detailed Sample Location:	
Room 102	West stairway moving up in room 102.	
Sample Quantity:	76 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light tan patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



1-28-MISC-48



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-29-MISC-44	MISC	
Sample Location:	Detailed Sample Location:	
Room 107	West wall next to window in room 107.	
Sample Quantity:	60 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White plastic waterproofing material with pale yellow adhesive.	Potential ACBM with potential for damage	No

Sample Photo:



1-29-MISC-44



Additional Sample Notes:		
Sample ID:	Sample Type:	
1-30-MISC-49	MISC	
Sample Location:	Detailed Sample Location:	
Top of stairway from room 102 to 107.	North wall at the top of stairs.	
Sample Quantity:	20 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Black cove base with tan mastic	Potential ACBM with potential for damage	No

Sample Photo:



1-30-MISC-49



Additional Sample Notes:

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Throughout the room.
Type of Fixture:	Quantity:
Boilers and steam equipment.	6
Condition:	Additional Fixture Notes:
Good	Associated motors, residual mechanical fluids and coal dust.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Southeast corner of room 101.
Type of Fixture:	Quantity:
Fluorescent light bulbs.	13
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	East wall behind control panels.
Type of Fixture:	Quantity:
	1
Condition:	Additional Fixture Notes:
Good	Boiler and equipment control panels containing mercury.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	West wall south of double doors.
Type of Fixture:	Quantity:
Fire hose.	1
Condition:	Additional Fixture Notes:
Good	Assumed asbestos containing material in fire hose.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 105	West of south door.
Type of Fixture:	Quantity:
Fire-resistant board.	1
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 105 and 104	West of door between room 105 and 104.
Type of Fixture:	Quantity:
	2
Condition:	Additional Fixture Notes:
Good	Assumed mercury containing thermostats.

Other Material Photo:



Room 105



Room 104

Other Material Tracking


General Fixture Location:	Detailed Fixture Location:
Throughout first floor.	
Type of Fixture:	Quantity:
Electrical equip	Several.
Condition:	Additional Fixture Notes:
Good	Electrical equipment: 13 breaker/electrical panels, 2 motor control center.

Other Material Photo:







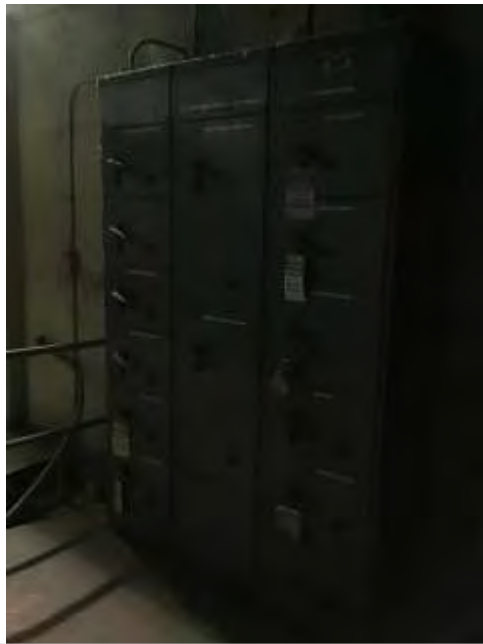

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Northwest corner of room 101.
Type of Fixture:	Quantity:
Equipment lift system.	1
Condition:	Additional Fixture Notes:
Good	Mechanical hazard with motor.

Other Material Photo:



Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/12/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Mezzanine

Samples

Sample ID:	Sample Type:	
2-1-MISC-1	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northwest corner floor.	
Sample Quantity:	66 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White stipple pattern 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-1-MISC-1



Additional Sample Notes:

Sample ID:	Sample Type:	
2-1-MISC-2	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southeast corner floor.	
Sample Quantity:	66 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White stipple pattern 12" x 12" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-1-MISC-2



Additional Sample Notes:

Sample ID:	Sample Type:
2-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Room 203	Southeast corner of room.
Sample Quantity:	NA
Sample Color:	XRF:
White	0.180

Sample Photo:




2-1-PB-1

Additional Sample Notes:

Sample ID:	Sample Type:
2-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room 204	Northeast corner of room.
Sample Quantity:	NA
Sample Color:	XRF:
White	0.043

Sample Photo:

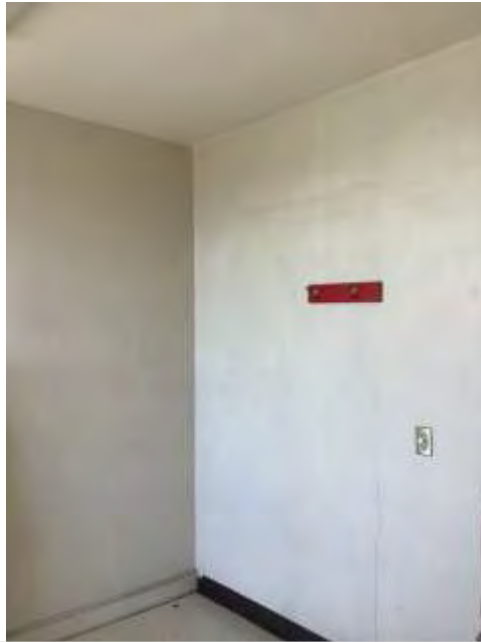

2-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
2-2-PB-3	PB
Sample Location:	Detailed Sample Location:
Room 200S	Catwalk outside of room 204.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.085

Sample Photo:




2-2-PB-3

Additional Sample Notes:

Sample ID:	Sample Type:
2-2-PB-4	PB
Sample Location:	Detailed Sample Location:
Room 200S	Catwalk outside of room 201.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.219

Sample Photo:

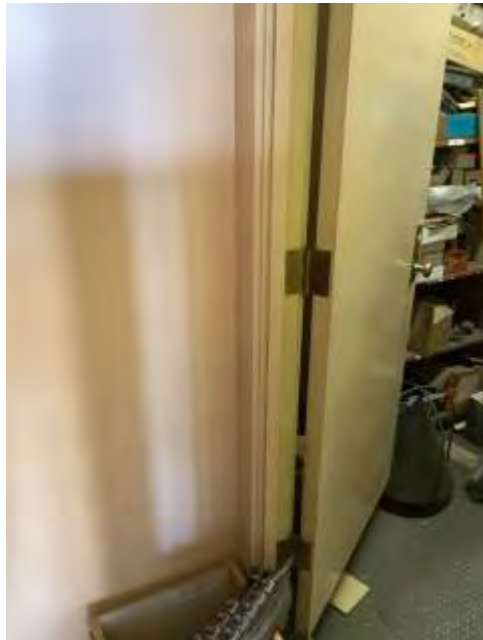

2-2-PB-4

Additional Sample Notes:		
Sample ID:	Sample Type:	
2-2-MISC-3	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southeast corner of counter.	
Sample Quantity:	22 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan laminate countertop with clear mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-2-MISC-3



Additional Sample Notes:		
Sample ID:	Sample Type:	
2-3-MISC-4	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	West side of floor.	
Sample Quantity:	175 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light brown patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:




2-3-MISC-4



Additional Sample Notes:		
Sample ID:	Sample Type:	
2-3-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southwest corner of floor.	
Sample Quantity:	175 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Light brown patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:

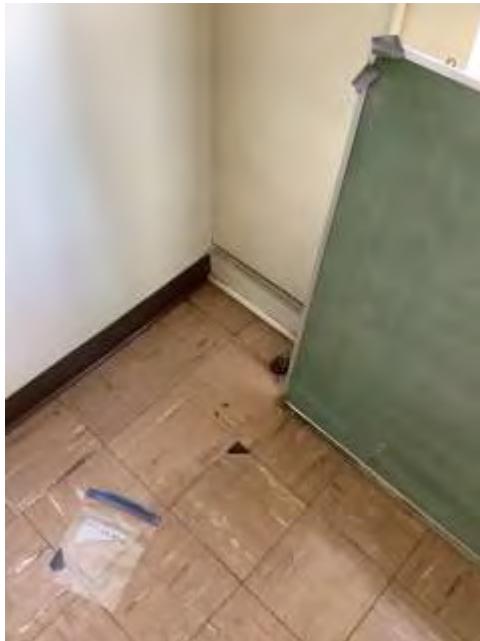

2-3-MISC-5



Additional Sample Notes:

Sample ID:	Sample Type:
2-3-PB-5	PB
Sample Location:	Detailed Sample Location:
Room 201	Cabinet inside doorway.
Sample Quantity:	NA
Sample Color:	XRF:
Dark tan	0.330

Sample Photo:



2-3-PB-5

Additional Sample Notes:

Sample ID:	Sample Type:
2-3-PB-6	PB
Sample Location:	Detailed Sample Location:
Room 201	Cabinet on north wall.
Sample Quantity:	NA
Sample Color:	XRF:
Dark tan	0.268

Sample Photo:



2-3-PB-6

Additional Sample Notes:

Sample ID:	Sample Type:
2-4-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 101	Yellow pipe on first catwalk, west side of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	3.22

Sample Photo:



2-4-PB-7

Additional Sample Notes:

Sample ID:	Sample Type:
2-4-PB-8	PB
Sample Location:	Detailed Sample Location:
Room 101	Yellow pipe on first catwalk, west side of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	4.94

Sample Photo:




Additional Sample Notes:

Sample ID:	Sample Type:
2-4-PB-12	PB
Sample Location:	Detailed Sample Location:
Room 101	Yellow pipe on first catwalk, east side of room.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Yellow	3.28

Sample Photo:



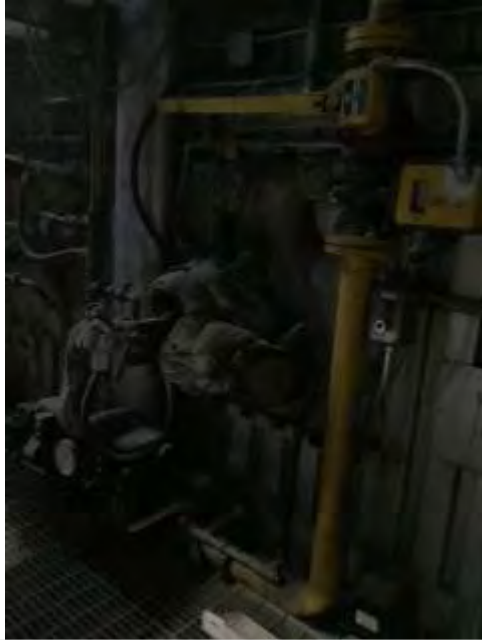

2-4-PB-12

Additional Sample Notes:

Sample ID:	Sample Type:	
2-4-MISC-6	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	East side of floor north of door.	
Sample Quantity:	20 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown stripped patterned 9" x 9" vinyl floor tile with black mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-4-MISC-6



Additional Sample Notes:

Sample ID:	Sample Type:	
2-5-MISC-7	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northeast corner of room.	
Sample Quantity:	30 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Black cove base with tan mastic.	Potential ACBM with potential for damage	No

Sample Photo:



2-5-MISC-7



Additional Sample Notes:

Sample ID:

2-5-PB-16

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Light green pipe on second catwalk on east side of room.

Sample Quantity:

NA


Sample Color:

Light green

XRF:

0.036

Sample Photo:

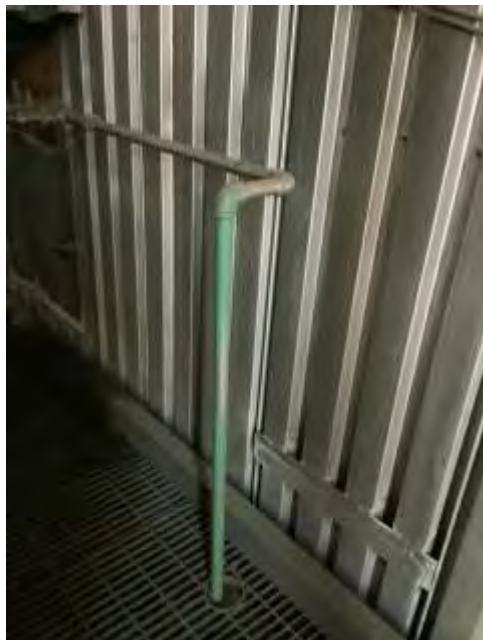


2-5-PB-16

Additional Sample Notes:

Sample ID:	Sample Type:
2-5-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 101	Light green pipe on first catwalk in center of room.
Sample Quantity:	NA
Sample Color:	XRF:
Light green	0.242

Sample Photo:

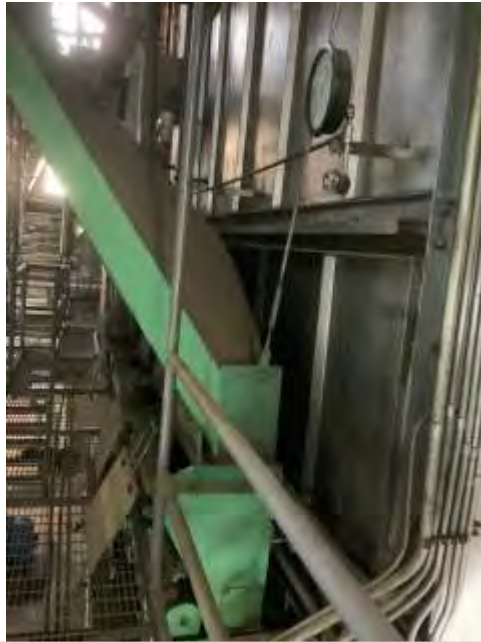

2-5-PB-9

Additional Sample Notes:

Sample ID:	Sample Type:
2-5-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 101	Light green pipe on first catwalk in center of room.
Sample Quantity:	NA
Sample Color:	XRF:
Light green	0.108

Sample Photo:



2-5-PB-10

Additional Sample Notes:

Sample ID:	Sample Type:
2-6-PB-11	PB
Sample Location:	Detailed Sample Location:
Room 101	Silver pipe on first catwalk in center of room.
Sample Quantity:	NA
Sample Color:	XRF:
Silver	ND

Sample Photo:



2-6-PB-11

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

2-6-TSI-8	TSI
-----------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 202	Pipe on west wall.
----------	--------------------

Sample Quantity:	4 linear feet.
-------------------------	----------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Potential ACBM with potential for damage	No
--	--	----

Sample Photo:		
----------------------	--	--



2-6-TSI-8



Additional Sample Notes:

Sample ID:	Sample Type:	
2-7-MISC-9	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northwest window.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	No

Sample Photo:




2-7-MISC-9



Additional Sample Notes:

Sample ID:	Sample Type:	
2-7-MISC-10	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	Southeast window.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Potential ACBM with potential for damage	No

Sample Photo:

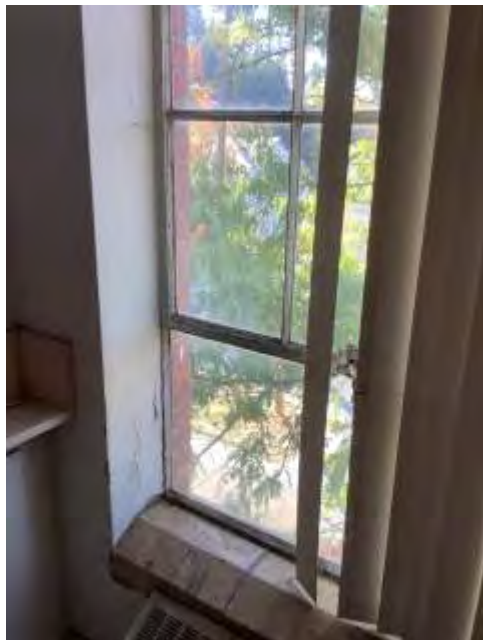

2-7-MISC-10



Additional Sample Notes:

Sample ID:	Sample Type:	
2-7-MISC-33	MISC	
Sample Location:	Detailed Sample Location:	
Room 101	Northwest corner; highest catwalk.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Damaged or significantly damaged friable miscellaneous ACM	Yes

Sample Photo:



2-7-MISC-33



Additional Sample Notes:

Sample ID: 2-7-PB-13 **Sample Type:** PB

Sample Location: Room 101 **Detailed Sample Location:** Red pipe on first catwalk, east side of room.

Sample Quantity: 750 linear feet.

Sample Color: Red **XRF:** 1.98

Red 1.98

Sample Photo:



2-7-PB-13

Additional Sample Notes:	
Sample ID:	Sample Type:
2-7-PB-24	PB
Sample Location:	Detailed Sample Location:
Room 204	Red pipe
Sample Quantity:	750 linear feet.
Sample Color:	XRF:
Red	1.164

Sample Photo:



2-7-PB-24



Additional Sample Notes:	Submitted sample to laboratory for analysis.
---------------------------------	--

Sample ID:	Sample Type:
2-8-PB-25	PB
Sample Location:	Detailed Sample Location:
Room 101	Red pipe on first catwalk, east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Red	ND

Sample Photo:



2-8-PB-25

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
2-8-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 101	Red pipe on first catwalk, east side of room.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Reddish brown	0.075

Sample Photo:





2-8-PB-14

Additional Sample Notes:

Sample ID:	Sample Type:	
2-8-MISC-11	MISC	
Sample Location:	Detailed Sample Location:	
Room 203	East wall above sink.	
Sample Quantity:	1,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with cementitious wallboard.	Potential ACBM with potential for damage	No;Yes

Sample Photo:



2-8-MISC-11



Additional Sample Notes:

Sample ID:	Sample Type:	
2-8-MISC-12	MISC	
Sample Location:	Detailed Sample Location:	
Room 202	Northwest corner wall under window.	
Sample Quantity:	1,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with cementitious wallboard.	Potential ACBM with potential for damage	No

Sample Photo:



2-8-MISC-12



Additional Sample Notes:

Sample ID:

2-9-MISC-13

Sample Type:

MISC

Sample Location:

Room 200S

Detailed Sample Location:

West wall north of door to room 202.

Sample Quantity:

14 linear feet.

Misc Sample Material:

Brown cove base with brown mastic.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:



2-9-MISC-13



Additional Sample Notes:

Sample ID:

2-9-PB-15

Sample Type:

PB

Sample Location:

Room 101

Detailed Sample Location:

Gray corrugated boiler siding on second catwalk, east side of room.

Sample Quantity:

NA

Sample Color:

Gray

XRF:

ND

Sample Photo:



2-9-PB-15

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
2-9-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 101	Gray boiler siding on second catwalk, east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Gray	0.035

Sample Photo:



2-9-PB-19

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
2-10-PB-17	PB
Sample Location:	Detailed Sample Location:
Room 101	Gray railing on second catwalk on east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Gray	0.007

Sample Photo:





2-10-PB-17

Additional Sample Notes:		
Sample ID:	Sample Type:	
2-10-TSI-14	TSI	
Sample Location:	Detailed Sample Location:	
Room 204	Pipe on east wall south of single door.	
Sample Quantity:	14 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:





Additional Sample Notes:

Sample ID:	Sample Type:	
2-11-MISC-15	MISC	
Sample Location:	Detailed Sample Location:	
Room 204	West wall south of double door.	
Sample Quantity:	615 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red 12" x 12" brick.	Potential ACBM with potential for damage	No

Sample Photo:



2-11-MISC-15



Additional Sample Notes:

Sample ID:

2-11-MISC-17

Sample Type:

MISC

Sample Location:

Room 204

Detailed Sample Location:

North wall below window.

Sample Quantity:

615 square feet.

Misc Sample Material:

Red 12" x 12" brick.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:



2-11-MISC-17



Additional Sample Notes:

Sample ID:	Sample Type:
2-11-PB-18	PB
Sample Location:	Detailed Sample Location:
Room 101	Tan boiler part on second catwalk on east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.101

Sample Photo:



2-11-PB-18

Additional Sample Notes:	
Sample ID:	Sample Type:
2-11-PB-22	PB
Sample Location:	Detailed Sample Location:
Room 101	Tan mechanical part in room 204.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	ND

Sample Photo:




2-11-PB-22

Additional Sample Notes:

Sample ID:	Sample Type:
2-12-PB-20	PB
Sample Location:	Detailed Sample Location:
Room 101	Gray door frame on second catwalk, east side of room.
Sample Quantity:	NA
Sample Color:	XRF:
Gray	0.517

Sample Photo:

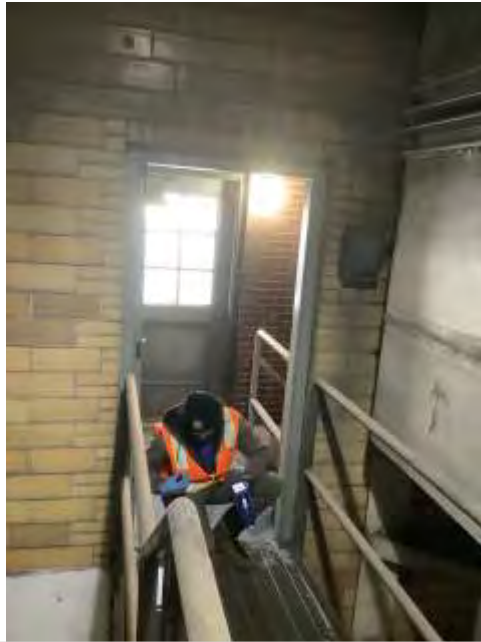

2-12-PB-20

Additional Sample Notes:

Sample ID:	Sample Type:	
2-12-MISC-18	MISC	
Sample Location:	Detailed Sample Location:	
Room 204	North wall below window.	
Sample Quantity:	550 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar.	Potential ACBM with potential for damage	No

Sample Photo:



2-12-MISC-18



Additional Sample Notes:

Sample ID:	Sample Type:	
2-12-MISC-16	MISC	
Sample Location:	Detailed Sample Location:	
Room 204	West wall south of double door.	
Sample Quantity:	550 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar.	Potential ACBM with potential for damage	No

Sample Photo:




2-12-MISC-16



Additional Sample Notes:		
Sample ID:	Sample Type:	
2-13-TSI-19	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Second catwalk on southwest side of Boiler 6.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

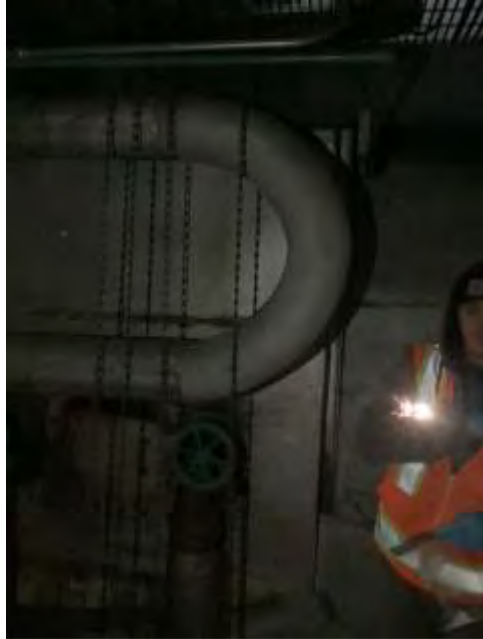

2-13-TSI-19



Additional Sample Notes:	Silver pipe with white insulation.
Sample ID:	Sample Type:
2-13-TSI-20	TSI
Sample Location:	Detailed Sample Location:
Room 101	Second catwalk on southwest side of Boiler 6.
Sample Quantity:	3,000 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-13-TSI-20



Additional Sample Notes:	Silver pipe with white insulation.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
2-13-TSI-22	TSI
Sample Location:	Detailed Sample Location:
Room 101	Second catwalk on southwest side of Boiler 6.
Sample Quantity:	3,000 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-13-TSI-22



Additional Sample Notes:	Elbow on silver pipe.
---------------------------------	-----------------------


Sample ID:	Sample Type:
-------------------	---------------------

2-13-TSI-23	TSI
-------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Second catwalk on southeast side of Boiler 6.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

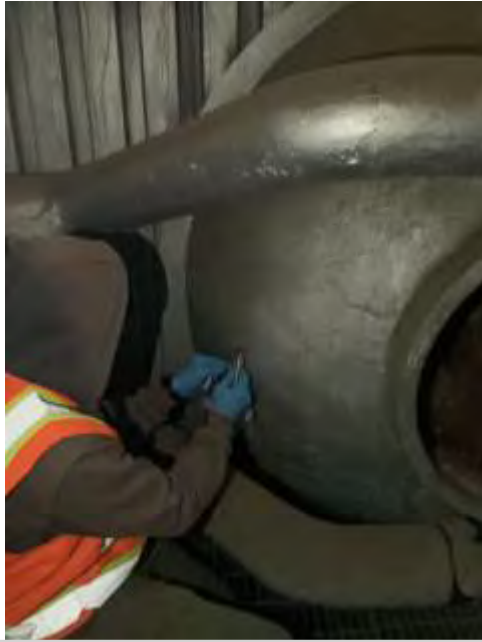

2-13-TSI-23




Additional Sample Notes:	Silver pipe with white insulation.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

2-13-TSI-30	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Located throughout northeast side of room on and around Boiler 2 by staircase entrance.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:

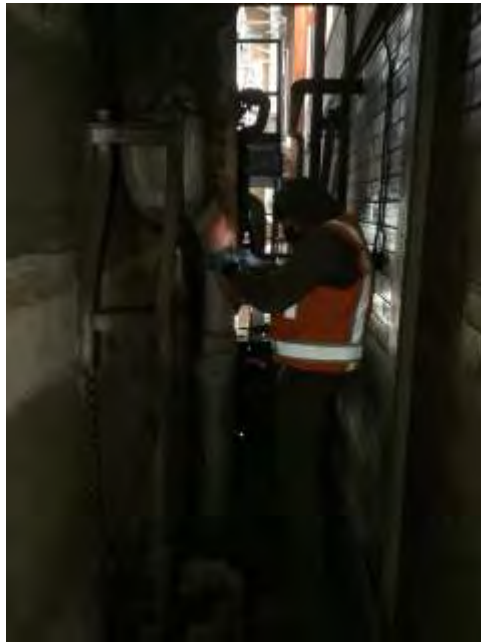

2-13-TSI-30



Additional Sample Notes:	Orange pipe wrap with white insulation.	
Sample ID:	Sample Type:	
2-13-TSI-25	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Second catwalk on south side of Boiler 6.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-13-TSI-25



Additional Sample Notes:	Orange pipe with white insulation.
Sample ID:	Sample Type:
2-13-PB-21	PB
Sample Location:	Detailed Sample Location:
Room 101	Red pipe on west side of Boiler 4.
Sample Quantity:	NA
Sample Color:	XRF:
Red	ND

Sample Photo:



2-13-PB-21

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

2-14-TSI-24	TSI
-------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Second catwalk on southeast side of Boiler 6.
----------	---

Sample Quantity:	500 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:		
----------------------	--	--



2-14-TSI-24




Additional Sample Notes:		Silver pipe with white insulation.	
Sample ID:		Sample Type:	
2-14-TSI-21		TSI	
Sample Location:		Detailed Sample Location:	
Room 101		Second catwalk on southwest side of Boiler 6.	
Sample Quantity:		500 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



2-14-TSI-21

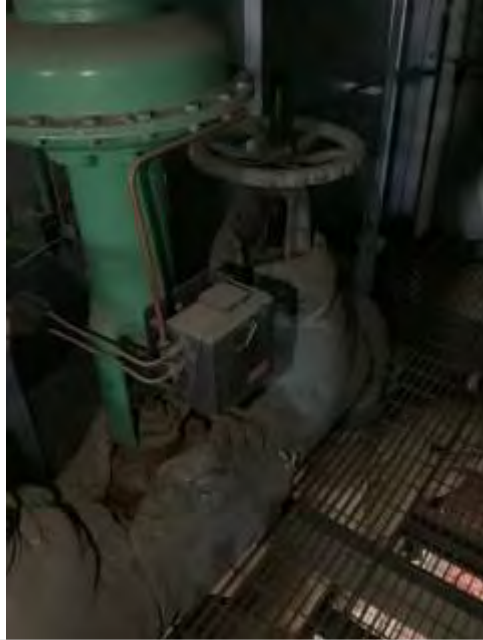

Additional Sample Notes:	Silver pipe with white insulation.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

2-14-PB-23	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 101	Blue mechanical part in room 204.
----------	-----------------------------------

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Blue	ND
------	----

Sample Photo:



2-14-PB-23

Additional Sample Notes:		
Sample ID:	Sample Type:	
2-15-TSI-26	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Southeast corner of room.	
Sample Quantity:	35 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:



2-15-TSI-26



Additional Sample Notes:	Tan / white pipe wrap with white insulation.	
Sample ID:	Sample Type:	
2-15-TSI-27	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	East side of room by staircase entrance.	
Sample Quantity:	35 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:



2-15-TSI-27



Additional Sample Notes:	White pipe wrap with white insulation.
Sample ID:	Sample Type:
2-16-TSI-28	TSI
Sample Location:	Detailed Sample Location:
Room 101	Located throughout northeast side of room on and around Boiler 2 by staircase entrance.
Sample Quantity:	Difficult to quantify.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:



2-16-TSI-28



Additional Sample Notes:	White tape wrap with white insulation.
---------------------------------	--

Sample ID:	Sample Type:
2-16-TSI-29	TSI
Sample Location:	Detailed Sample Location:
Room 101	Located throughout northeast side of room on and around Boiler 2 by staircase entrance.
Sample Quantity:	Difficult to quantify.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	No

Sample Photo:



2-16-TSI-29



Additional Sample Notes:	White tape wrap with white insulation.
---------------------------------	--

Sample ID:	Sample Type:
2-17-TSI-31	TSI
Sample Location:	Detailed Sample Location:

Room 101	North side of room, highest catwalk by Boiler 4.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-17-TSI-31



Additional Sample Notes:	Silver paper wrapping and white insulation.
---------------------------------	---

Sample ID:	Sample Type:
-------------------	---------------------

2-17-TSI-32	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Northwest corner of room, highest catwalk by Boiler 3.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



2-17-TSI-32




Additional Sample Notes: Silver paper wrapping and white insulation.

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 201	Ceiling of room 201, 203, and 204
Type of Fixture:	Quantity:
	28
Condition:	Additional Fixture Notes:
Good	Fluorescent lightbulbs

Other Material Photo:

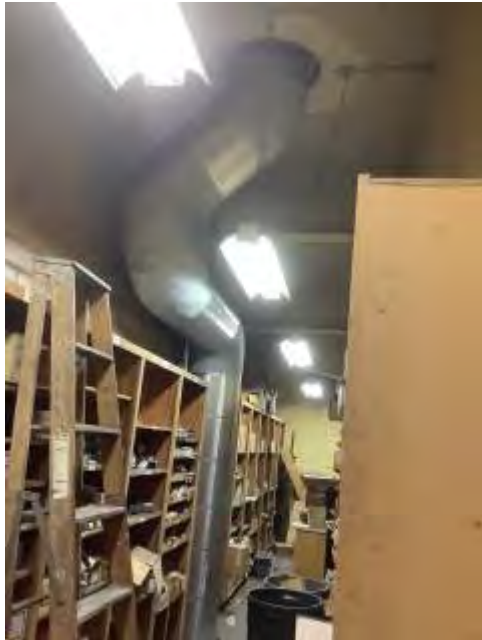

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 201	Northwest corner of room 201 behind door
Type of Fixture:	Quantity:
3 unmarked black cans	8
Condition:	Additional Fixture Notes:
Good	3 unmarked black cans.


Other Material Photo:




Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Interior walls of rooms 202 and 203	
Type of Fixture:	Quantity:
	2
Condition:	Additional Fixture Notes:
Poor	

Other Material Photo:



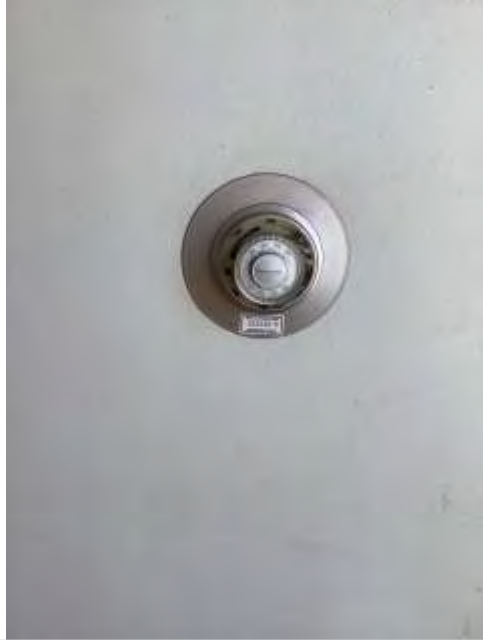

Room 202



Room 203

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Throughout room 101
Type of Fixture:	Quantity:
Electrical panels	7
Condition:	Additional Fixture Notes:
Good	4 electrical panels, 3 control panels.

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 204	Throughout room 204
Type of Fixture:	Quantity:
Coal dust	Throughout room
Condition:	Additional Fixture Notes:
Other	Coal dust exposure.

Other Material Photo:





Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/13/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Upper Mezzanine

Samples

Sample ID:	Sample Type:
3-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Red	0.136

Sample Photo:



Additional Sample Notes:	Red water line.
---------------------------------	-----------------

Sample ID:	Sample Type:
3-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Red	0.160

Sample Photo:



Additional Sample Notes:	Red water line.
---------------------------------	-----------------

Sample ID:	Sample Type:
-------------------	---------------------

3-1-TSI-5	TSI
-----------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 302	Pipe near west roof access.
----------	-----------------------------

Sample Quantity:	3,000 linear feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:




3-1-TSI-5



Additional Sample Notes:		White pipe insulation with white wrapping.
Sample ID:	Sample Type:	
3-1-TSI-1	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Highest catwalk.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:

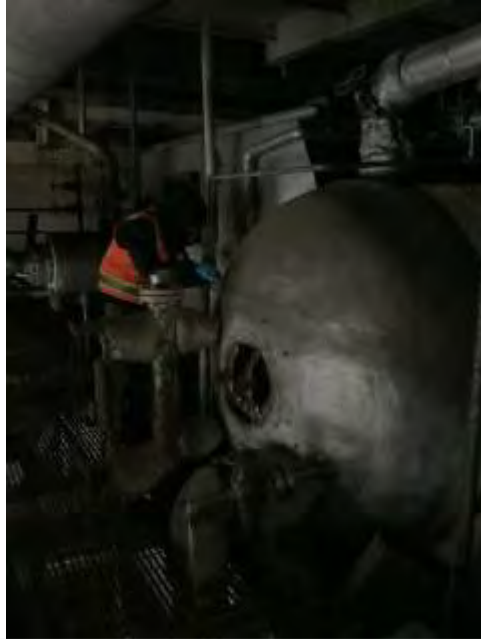

3-1-TSI-1



Additional Sample Notes:

White insulation with silver wrapping on boiler. Area of sampling not included on schematic of upper mezzanine.

Sample ID:

3-1-TSI-2

Sample Type:

TSI

Sample Location:

Room 101

Detailed Sample Location:

Highest catwalk.

Sample Quantity:

3,000 linear feet.

Sample Color:

XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-1-TSI-2



Additional Sample Notes:	White pipe insulation with white wrapping. Area of sampling not included on schematic of upper mezzanine.
---------------------------------	---

Sample ID:	Sample Type:
3-1-TSI-7	TSI
Sample Location:	Detailed Sample Location:
Room 302	Vent near staircase to lower level.
Sample Quantity:	3,000 linear feet

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-1-TSI-7



Additional Sample Notes:	White vent insulation with white wrapping.
---------------------------------	--

Sample ID:	Sample Type:
3-1-TSI-9	TSI

Sample Location:	Detailed Sample Location:

Room 302	Vent near staircase to lower level.	
Sample Quantity:	3,000 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-1-TSI-9



Additional Sample Notes:	White vent insulation with white wrapping.
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

3-2-TSI-3	TSI	
Sample Location:	Detailed Sample Location:	
Room 101	Highest catwalk.	
Sample Quantity:	700 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-2-TSI-3



Additional Sample Notes:	Fabric insulation on pipe coming off of boiler. Area of sampling not included on schematic of upper mezzanine.
---------------------------------	--

Sample ID:	Sample Type:	
3-2-TSI-6	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Pipe near west roof access.	
Sample Quantity:	700 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-2-TSI-6



Additional Sample Notes:	White pipe insulation with silver wrapping.
Sample ID:	Sample Type:
3-2-PB-3	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	700 linear feet.
Sample Color:	XRF:
Gray	5.00

Sample Photo:



Additional Sample Notes:	Gray I-beam.
---------------------------------	--------------

Sample ID:	Sample Type:
-------------------	---------------------

3-2-PB-4	PB
----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Catwalk above coal hopper.	By staircase.
----------------------------	---------------

Sample Quantity:	700 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

Gray	5.00
------	------

Sample Photo:	
----------------------	--



Additional Sample Notes:	Gray I-beam.
---------------------------------	--------------

Sample ID:	Sample Type:
-------------------	---------------------

3-3-PB-5	PB
----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------


Catwalk above coal hopper.	By staircase.
----------------------------	---------------

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Brown	ND
-------	----


Sample Photo:	
----------------------	--

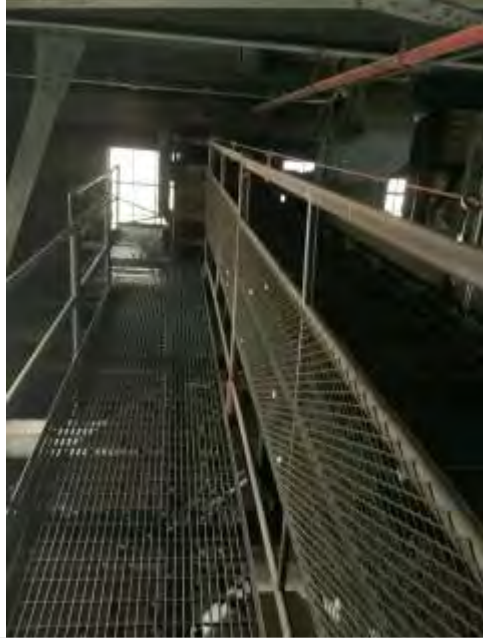

3-3-PB-5

Additional Sample Notes:	Brown catwalk railing.
Sample ID:	Sample Type:
3-3-PB-6	PB
Sample Location:	Detailed Sample Location:
Catwalk above coal hopper.	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Brown	ND

Sample Photo:

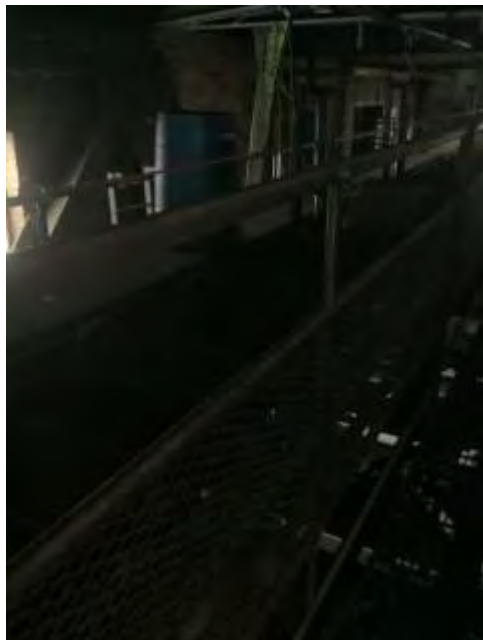


3-3-PB-6

Additional Sample Notes:	Brown catwalk railing.	
Sample ID:	Sample Type:	
3-3-TSI-4	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Motor part near west roof access.	
Sample Quantity:	40 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-3-TSI-4

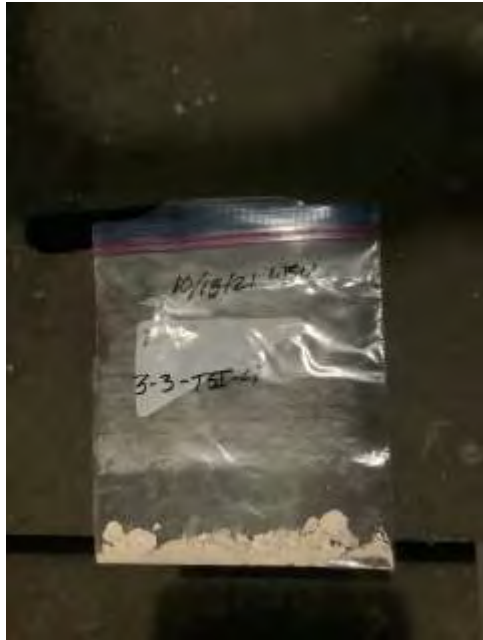


Additional Sample Notes:		White insulation on mechanical part.
Sample ID:	Sample Type:	
3-3-TSI-10	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Motor part near west roof access.	
Sample Quantity:	40 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-3-TSI-10

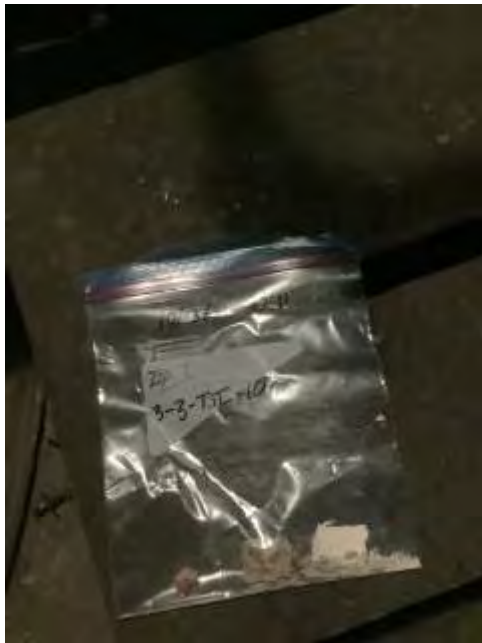

Additional Sample Notes:		White insulation on mechanical part.
Sample ID:	Sample Type:	
3-4-TSI-8	TSI	
Sample Location:	Detailed Sample Location:	
Room 302	Pipe near motor.	
Sample Quantity:	6 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



3-4-TSI-8



Additional Sample Notes:	Yellow insulation with white wrapping.
Sample ID:	Sample Type:
3-4-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 302	On equipment by east side door.
Sample Quantity:	NA
Sample Color:	XRF:
Silver	ND

Sample Photo:



Additional Sample Notes:

Silver piping.

Sample ID:

3-4-PB-8

Sample Type:

PB

Sample Location:

Room 302

Detailed Sample Location:

On equipment by east side door.

Sample Quantity:

NA


Sample Color:

Silver

XRF:


ND

Sample Photo:

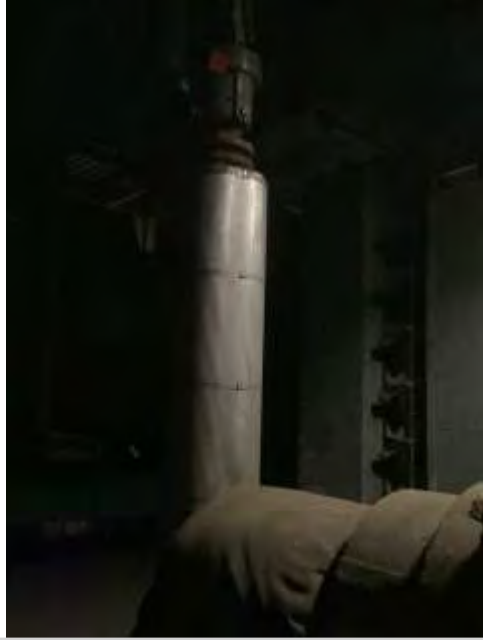

Additional Sample Notes:	Silver piping.
Sample ID:	Sample Type:
3-5-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 302	By west side door.
Sample Quantity:	NA
Sample Color:	XRF:
Red	0.528

Sample Photo:

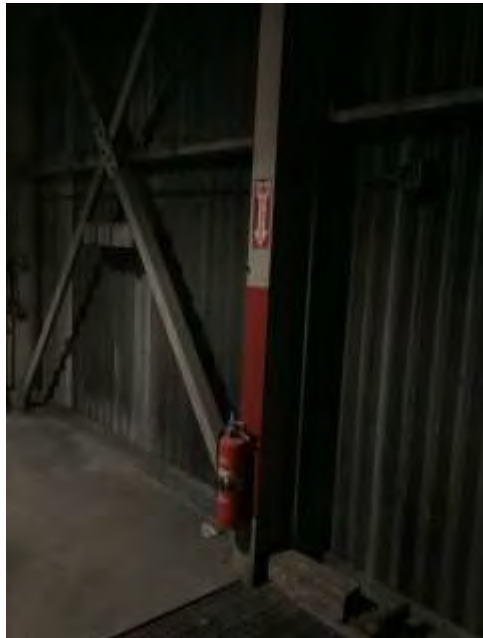


3-5-PB-9

Additional Sample Notes:	Red fire extinguisher marking paint.
---------------------------------	--------------------------------------

Sample ID:	Sample Type:
3-6-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 302	By west side door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.531

Sample Photo:

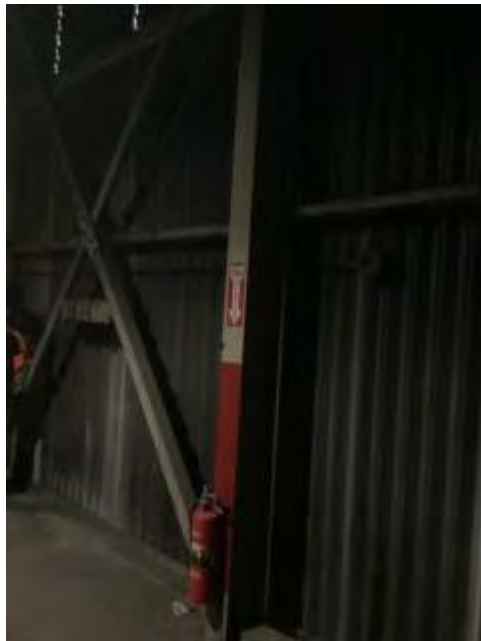

3-6-PB-10

Additional Sample Notes:	Tan paint above fire extinguisher.
---------------------------------	------------------------------------

Sample ID:	Sample Type:
3-6-PB-11	PB
Sample Location:	Detailed Sample Location:
Room 302	By west side door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.922

Sample Photo:



3-6-PB-11

Additional Sample Notes:	Tan paint on I-beam next to safety switch box.
---------------------------------	--

Sample ID:	Sample Type:
3-6-PB-12	PB
Sample Location:	Detailed Sample Location:
Room 302	By staircase.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	0.920

Sample Photo:



3-6-PB-12



Additional Sample Notes:	Tan paint on I-beam. Sample collected for laboratory analysis.
Sample ID:	Sample Type:
3-7-PB-13	PB
Sample Location:	Detailed Sample Location:
Room 302	East door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	ND

Sample Photo:




3-7-PB-13

Additional Sample Notes:	Tan paint on door.
---------------------------------	--------------------

Sample ID:	Sample Type:
3-7-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 302	West door.
Sample Quantity:	NA
Sample Color:	XRF:
Tan	ND

Sample Photo:

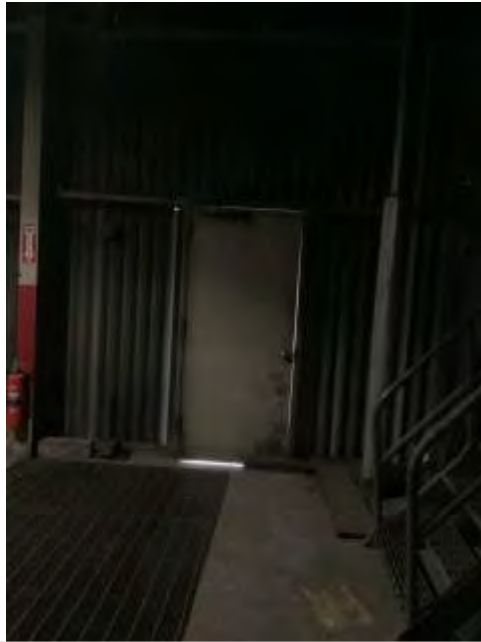


3-7-PB-14

Additional Sample Notes:	Tan paint on door.
---------------------------------	--------------------

Sample ID:	Sample Type:
3-8-PB-15	PB
Sample Location:	Detailed Sample Location:
Room 302	Southeast corner of room 302.
Sample Quantity:	NA
Sample Color:	XRF:
Brown	ND

Sample Photo:

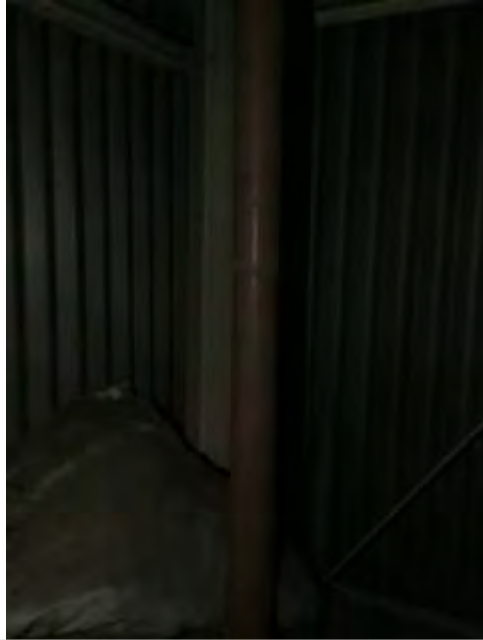


3-8-PB-15

Additional Sample Notes:	Brown paint on pipe to ceiling.
---------------------------------	---------------------------------

Sample ID:	Sample Type:	
3-8-MISC-11	MISC	
Sample Location:	Detailed Sample Location:	
Room 303	Window on west side of room.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:

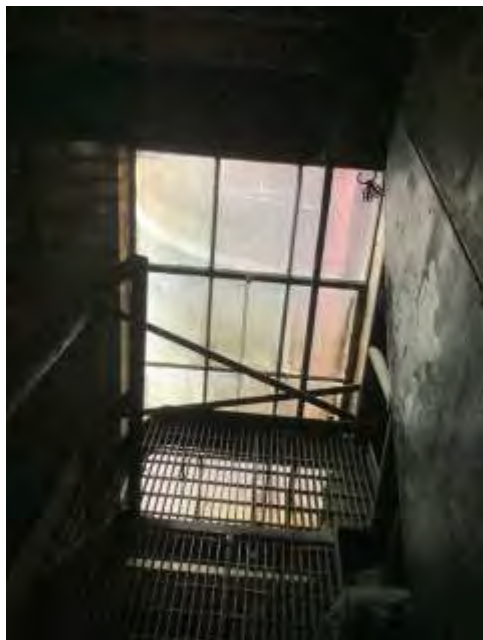


3-8-MISC-11



Additional Sample Notes:

Sample ID:	Sample Type:	
3-8-MISC-12	MISC	
Sample Location:	Detailed Sample Location:	
Room 303	Window on west side of room.	
Sample Quantity:	4,030 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:

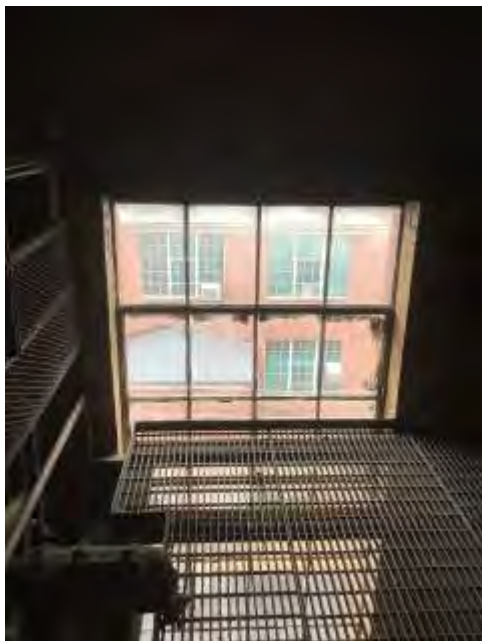

3-8-MISC-12



Additional Sample Notes:

Sample ID:

3-9-PB-16

Sample Type:

PB

Sample Location:

Room 303M

Detailed Sample Location:

Highest catwalk, southeast side.

Sample Quantity:

NA

Sample Color:

Dark gray

XRF:

ND

Sample Photo:



3-9-PB-16

Additional Sample Notes:	Door.
---------------------------------	-------

Sample ID:	Sample Type:
-------------------	---------------------

3-9-PB-17	PB
-----------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 303M	Highest catwalk, southeast side.
-----------	----------------------------------

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Dark gray	ND
-----------	----

Sample Photo:



3-9-PB-17

Additional Sample Notes:	Door.
---------------------------------	-------

Sample ID:	Sample Type:
-------------------	---------------------

3-10-PB-18	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------


Room 303M	
-----------	--

Sample Quantity:	NA
-------------------------	----

Sample Color:	XRF:
----------------------	-------------

Red	0.095
-----	-------

Sample Photo:

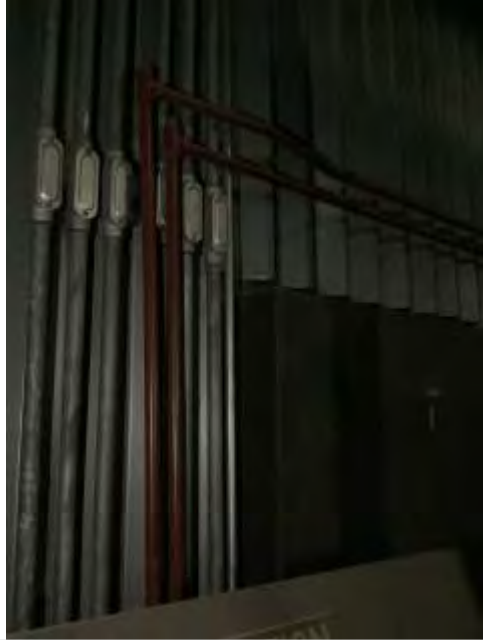

3-10-PB-18

Additional Sample Notes:	Door.
Sample ID:	Sample Type:
3-11-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 101	Highest catwalk.
Sample Quantity:	NA
Sample Color:	XRF:
Silver	ND

Sample Photo:



3-11-PB-19

Additional Sample Notes:	Silver paint on boiler.
---------------------------------	-------------------------

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 301	
Type of Fixture:	Quantity:
Asbestos dust breathing hazard signage.	
Condition:	Additional Fixture Notes:
Good	No material to sample in room.


Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 302	East wall.
Type of Fixture:	Quantity:
Unmarked jug and turbine oil container.	2
Condition:	Additional Fixture Notes:
Poor	

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 302	
Type of Fixture:	Quantity:
Potential mechanical fluid-containing fixture.	Throughout room
Condition:	Additional Fixture Notes:
Poor	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 302	West side of room.
Type of Fixture:	Quantity:
Potential electrical hazard.	2
Condition:	Additional Fixture Notes:
Good	1 control panel, 1 safety switch.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 303M	
Type of Fixture:	Quantity:
Potentially pressurized confined spaces.	17
Condition:	Additional Fixture Notes:
Good	

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 101	Highest catwalk.
Type of Fixture:	Quantity:
	2
Condition:	Additional Fixture Notes:
Good	Fluorescent lightbulbs.

Other Material Photo:



Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/13/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Basement

Samples

Sample ID:	Sample Type:	
4-1-TSI-1	TSI	
Sample Location:	Detailed Sample Location:	
Room 21	By entrance to room 22.	
Sample Quantity:	600 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-1



Additional Sample Notes:		White insulation with silver fabric patch.	
Sample ID:		Sample Type:	
4-1-TSI-6		TSI	
Sample Location:		Detailed Sample Location:	
Room 23		Northeast corner of room.	
Sample Quantity:		600 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-6



Additional Sample Notes:		White insulation with silver fabric patch.
Sample ID:	Sample Type:	
4-1-TSI-10	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Southeast portion of room by entrance to room 23.	
Sample Quantity:	600 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-10



Additional Sample Notes:	White insulation with silver fabric patch on boiler.
Sample ID:	Sample Type:
4-1-TSI-17	TSI
Sample Location:	Detailed Sample Location:
Room 11	Northeast portion of room between northeast staircase and elevator.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-1-TSI-17




Additional Sample Notes:	White insulation with silver fabric patch on machinery.
---------------------------------	---

Sample ID:	Sample Type:
4-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Room 17	East wall south of door.
Sample Quantity:	N/A

Sample Color:	XRF:
Light green	0.336

Sample Photo:

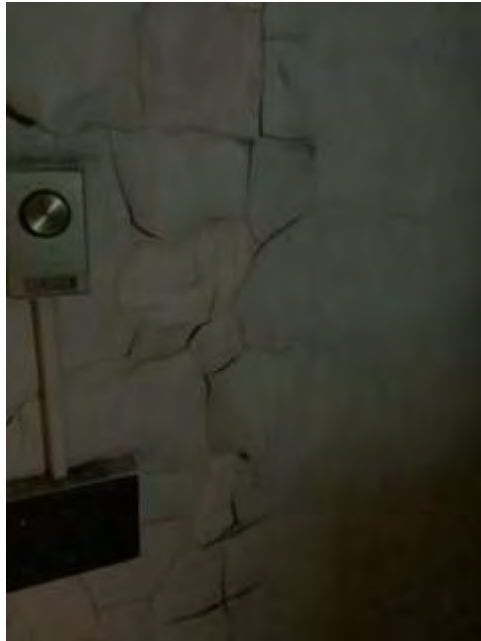

4-1-PB-1

Additional Sample Notes:

Sample ID:	Sample Type:
4-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room 17	Paint chip on floor next to bathroom stall.
Sample Quantity:	N/A
Sample Color:	XRF:
Light green	0.237

Sample Photo:



4-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
4-1-PB-60	PB
Sample Location:	Detailed Sample Location:
Room 15	Paint on south wall of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Light green	0.014

Sample Photo:



4-1-PB-60

Additional Sample Notes:

Sample ID:	Sample Type:
4-1-PB-61	PB
Sample Location:	Detailed Sample Location:
Room 15	Southwest corner of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Light green	0.135

Sample Photo:



4-1-PB-61

Additional Sample Notes:

Sample ID:	Sample Type:
4-2-PB-52	PB
Sample Location:	Detailed Sample Location:
Room 11	Red wrapped pipe on south wall of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:




4-2-PB-52

Additional Sample Notes:

Sample ID:	Sample Type:
4-2-PB-3	PB
Sample Location:	Detailed Sample Location:
Room 21	Pipe in southwest corner of room 21.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:

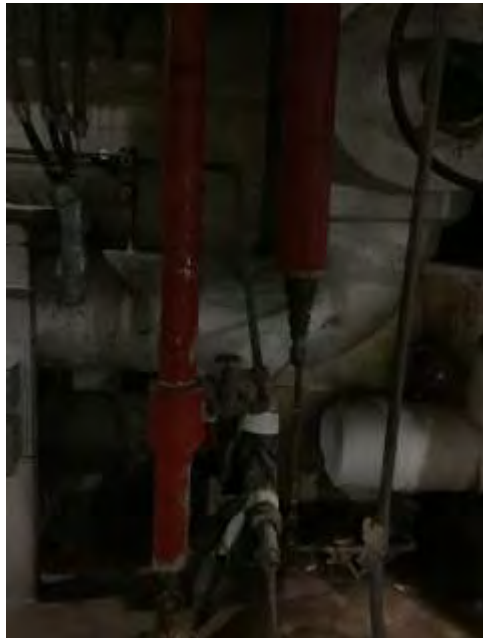

4-2-PB-3

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

4-2-TSI-29	TSI
------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 11	Center of room.
---------	-----------------

Sample Quantity:	1,200 linear feet.
-------------------------	--------------------

Sample Color:	XRF:
----------------------	-------------

--	--

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

	Damaged or significantly damaged	Yes
--	----------------------------------	-----

Sample Photo:		
----------------------	--	--




4-2-TSI-29



Additional Sample Notes:		White insulation with silver painted wrap.
Sample ID:	Sample Type:	
4-2-TSI-31	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Center of room.	
Sample Quantity:	1,200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:




4-2-TSI-31



Additional Sample Notes:	White insulation with silver painted wrap.
Sample ID:	Sample Type:
4-2-PB-7	PB
Sample Location:	Detailed Sample Location:
Room 21	Pipe in southwest corner of room 21.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:

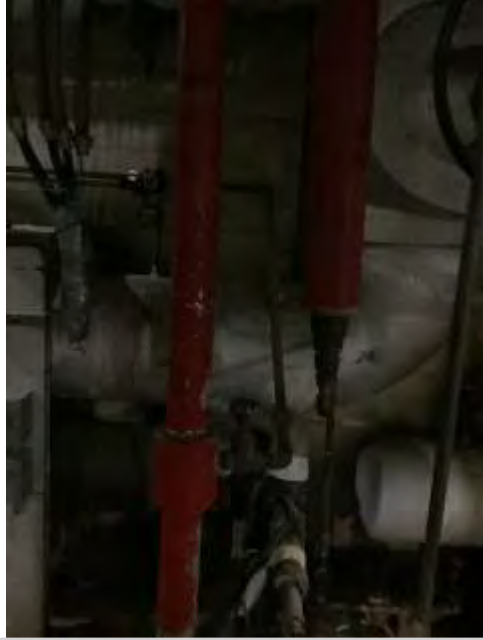

Additional Sample Notes:

Sample ID:	Sample Type:
4-2-PB-25	PB
Sample Location:	Detailed Sample Location:
Room 23	Red pipe wrap on the south side of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	0.919

Sample Photo:



4-2-PB-25

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-2-TSI-20	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room near northeast staircase.	
Sample Quantity:	1,200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:




4-2-TSI-20





Additional Sample Notes:		White insulation with orange painted wrap.	
Sample ID:		Sample Type:	
4-2-TSI-22		TSI	
Sample Location:		Detailed Sample Location:	
Room 11		Northeast portion of room.	
Sample Quantity:		1,200 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-22

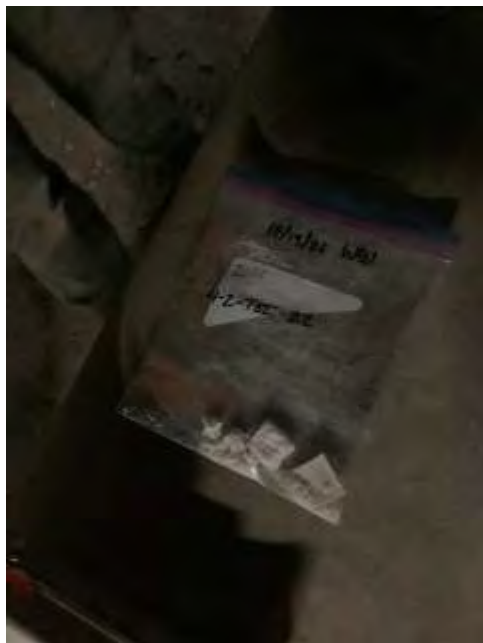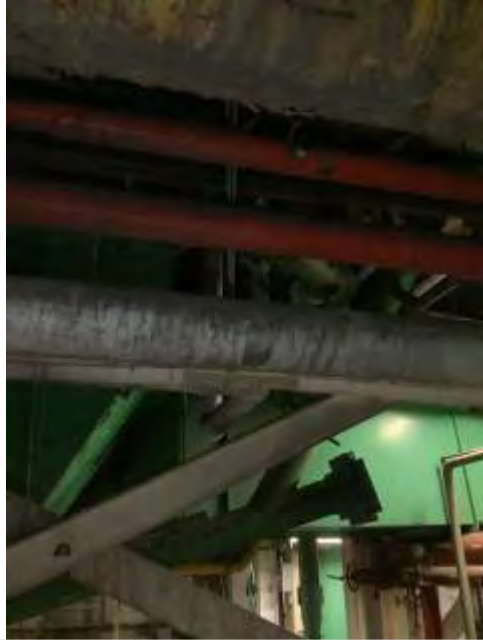

Additional Sample Notes:	White insulation with white painted wrap.	
Sample ID:	Sample Type:	
4-2-TSI-25	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	On west side of room by staircase down.	
Sample Quantity:	1,200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-25



Additional Sample Notes:	White insulation with orange painted wrap.
Sample ID:	Sample Type:
4-2-TSI-7	TSI
Sample Location:	Detailed Sample Location:
Room 23	Northeast corner of room.
Sample Quantity:	1,200 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-7



Additional Sample Notes:	White insulation with orange painted wrap.
---------------------------------	--

Sample ID:	Sample Type:
4-2-TSI-2	TSI
Sample Location:	Detailed Sample Location:
Room 21	By entrance to room 22.
Sample Quantity:	1,200 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-2-TSI-2



Additional Sample Notes:	White insulation with orange painted wrap.
---------------------------------	--


Sample ID:	Sample Type:
-------------------	---------------------

4-3-MISC-3	MISC
------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 22	East wall.	
Sample Quantity:	110 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown soundproofing wall pad.	Potential ACBM with potential for damage	Yes

Sample Photo:

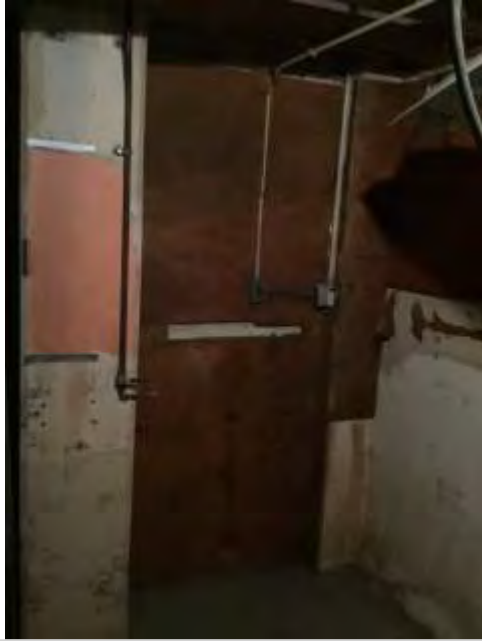

4-3-MISC-3




Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-3-MISC-4	MISC
Sample Location:	Detailed Sample Location:

Room 22	North wall.	
Sample Quantity:	110 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Brown soundproofing wall pad.	Potential ACBM with potential for damage	Yes

Sample Photo:

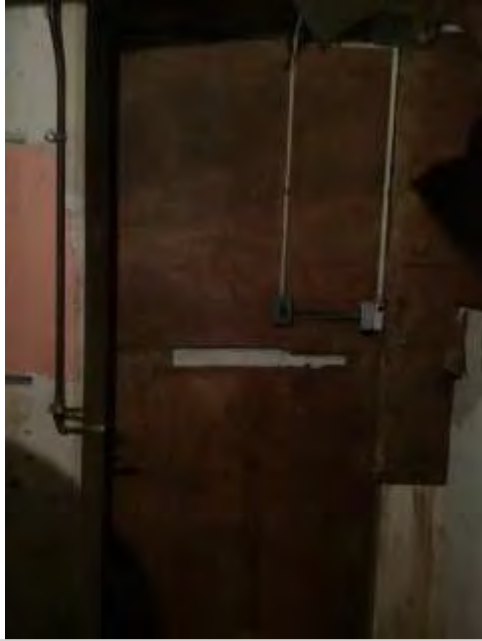

4-3-MISC-4



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-3-PB-20	PB
Sample Location:	Detailed Sample Location:

Room 23	Red pipe in southwest corner.
Sample Quantity:	145 linear feet.
Sample Color:	XRF:
Red	ND

Sample Photo:



4-3-PB-20

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-3-PB-4	PB
Sample Location:	Detailed Sample Location:
Room 21	Tank on north wall east of entrance.
Sample Quantity:	145 linear feet.
Sample Color:	XRF:
Red	1.346

Sample Photo:





4-3-PB-4



Additional Sample Notes:

Did not XRF tank due to high heat. Submitted sample to laboratory for analysis.

Sample ID:

4-3-PB-38

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Northwest corner of room.

Sample Quantity:

145 linear feet.

Sample Color:

Red

XRF:

2.01

Sample Photo:



4-3-PB-38

Additional Sample Notes:

Sample ID:	Sample Type:
4-3-PB-43	PB
Sample Location:	Detailed Sample Location:
Room 11	Red pipe on the north side of room south of active tank.
Sample Quantity:	145 linear feet.
Sample Color:	XRF:
Red	5.0

Sample Photo:



4-3-PB-43

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-4-PB-30	PB
Sample Location:	Detailed Sample Location:
Room 11	Silver support on west side of room east of sun basement entrance.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



4-4-PB-30

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-4-PB-33	PB
Sample Location:	Detailed Sample Location:
Room 11	Silver painted equipment on west side of room north of sub basement door.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



4-4-PB-33

Additional Sample Notes:	
Sample ID:	Sample Type:
4-4-PB-47	PB
Sample Location:	Detailed Sample Location:
Room 11	Underside of lid on southwest face of northeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	0.071

Sample Photo:



4-4-PB-47

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-4-PB-5	PB
Sample Location:	Detailed Sample Location:
Room 21	Silver pipe support on north ceiling.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	0.024

Sample Photo:



4-4-PB-5

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:	
4-4-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
Room 22	Northwest corner tabletop.	
Sample Quantity:	15 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Off-white laminate tabletop with clear adhesive.	Potential ACBM with potential for damage	Yes

Sample Photo:



4-4-MISC-5



Additional Sample Notes:

Sample ID:	Sample Type:
4-5-PB-6	PB
Sample Location:	Detailed Sample Location:
Room 21	Cabinet in center of room north of room 22.
Sample Quantity:	N/A
Sample Color:	XRF:
Gray	0.063

Sample Photo:



4-5-PB-6

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-5-TSI-8	TSI	
Sample Location:	Detailed Sample Location:	
Room 23	Southeast corner of room.	
Sample Quantity:	200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-8



Additional Sample Notes:		Silver steam pipe fabric wrap.	
Sample ID:		Sample Type:	
4-5-TSI-9		TSI	
Sample Location:		Detailed Sample Location:	
Room 11		Southeast corner of room by entrance to room 23.	
Sample Quantity:		200 linear feet.	
Sample Color:		XRF:	
Misc Sample Material:		Sample Condition:	Sample Friable?:
		Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-9




Additional Sample Notes:	Silver steam pipe fabric wrap.
Sample ID:	Sample Type:
4-5-TSI-26	TSI
Sample Location:	Detailed Sample Location:
Room 11	On west side of room by staircase down.
Sample Quantity:	200 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-26

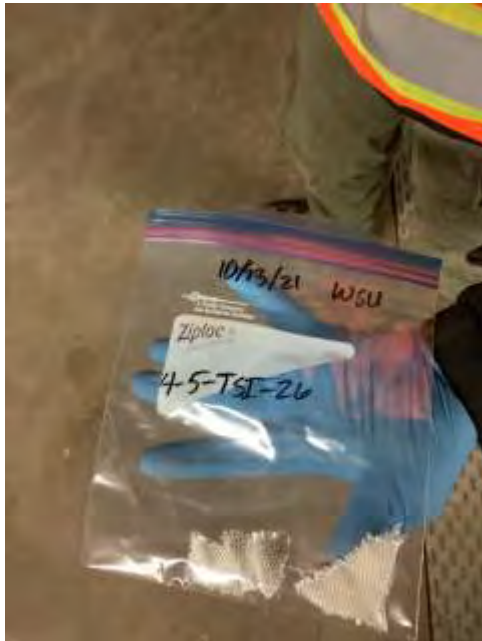

Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:
4-5-TSI-21	TSI
Sample Location:	Detailed Sample Location:
Room 11	Northeast portion of room near northeast staircase.
Sample Quantity:	200 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-21



Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:
4-5-TSI-11	TSI

Sample Location:	Detailed Sample Location:

Room 11	East portion of room by spiral staircase.	
Sample Quantity:	200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-11



Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

4-5-TSI-13	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	East portion of room north of spiral staircase.	
Sample Quantity:	200 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-5-TSI-13




Additional Sample Notes:	Silver steam pipe fabric wrap.
---------------------------------	--------------------------------

Sample ID:	Sample Type:	
4-6-TSI-12	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	East portion of room north of spiral staircase.	
Sample Quantity:	40 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-6-TSI-12

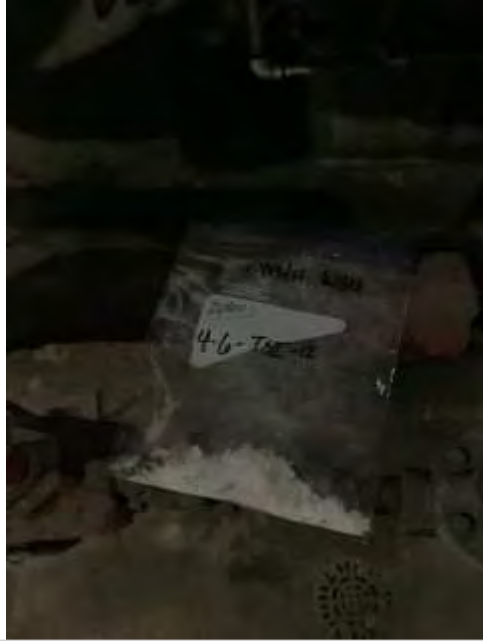

Additional Sample Notes:	Red steam pipe fabric wrap.
Sample ID:	Sample Type:
4-6-PB-8	PB
Sample Location:	Detailed Sample Location:
Room 21	Door frame to room 18.
Sample Quantity:	N/A
Sample Color:	XRF:
Blue gray	0.086

Sample Photo:



4-6-PB-8

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-7-PB-9	PB
Sample Location:	Detailed Sample Location:
Room 18	Tank in southeast corner of room.
Sample Quantity:	5 linear feet.
Sample Color:	XRF:
Silver	5.00

Sample Photo:



4-7-PB-9

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-7-TSI-33	TSI
Sample Location:	Detailed Sample Location:
Room 11	Center of room.
Sample Quantity:	500 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:





4-7-TSI-33



Additional Sample Notes:		Yellow insulation with red painted silver wrap.
Sample ID:	Sample Type:	
4-7-TSI-18	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room between northeast staircase and elevator.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-18



Additional Sample Notes:	Orange steam pipe fabric wrap with yellow insulation.
Sample ID:	Sample Type:
4-7-TSI-19	TSI
Sample Location:	Detailed Sample Location:
Room 11	Northeast portion of room between northeast staircase and elevator.
Sample Quantity:	500 linear feet.
Sample Color:	XRF:

Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-19



Additional Sample Notes:	Orange steam pipe fabric wrap with yellow insulation.
---------------------------------	---

Sample ID:	Sample Type:
4-7-TSI-14	TSI
Sample Location:	Detailed Sample Location:
Room 11	East portion of room north of spiral staircase.
Sample Quantity:	500 linear feet.

Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-14



Additional Sample Notes:	Silver steam pipe fabric wrap with yellow insulation.
---------------------------------	---

Sample ID:	Sample Type:
-------------------	---------------------

4-7-TSI-15	TSI
------------	-----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 11	East portion of room north of spiral staircase.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-15



Additional Sample Notes:	Red steam pipe fabric wrap with yellow insulation.
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

4-7-TSI-27	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	West portion of room by staircase to room 101.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-27




Additional Sample Notes: White condensate pipe with yellow insulation.

Sample ID:	Sample Type:	
4-7-TSI-28	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	West portion of room by staircase to room 101.	
Sample Quantity:	500 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-7-TSI-28

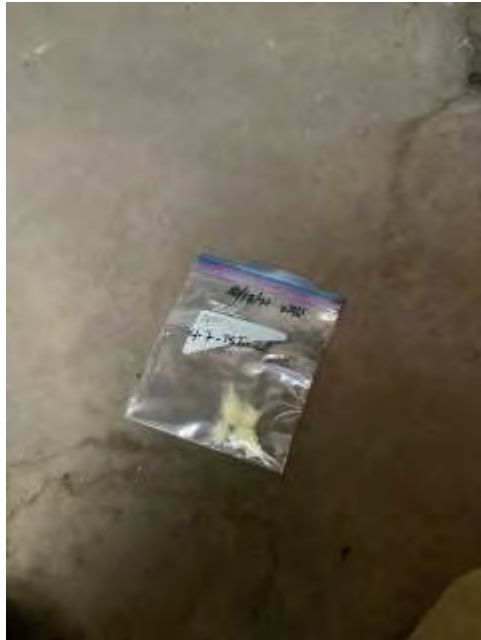

Additional Sample Notes:		White condensate line elbow with yellow insulation.
Sample ID:	Sample Type:	
4-8-MISC-16	MISC	
Sample Location:	Detailed Sample Location:	
Room 11	By control wheels and conveying systems.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Silver woven heat-resistant seal material on hatch interior.	Potential ACBM with potential for damage	No

Sample Photo:



4-8-MISC-16



Additional Sample Notes:

Sample ID:	Sample Type:	
4-8-MISC-30	MISC	
Sample Location:	Detailed Sample Location:	
Room 11	By control wheels and conveying systems.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Silver woven heat-resistant seal material on hatch interior.	Potential ACBM with potential for damage	No

Sample Photo:



4-8-MISC-30



Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-8-PB-10	PB
Sample Location:	Detailed Sample Location:
Room 18	Pipe underneath tank in southeast corner.
Sample Quantity:	10 linear feet.
Sample Color:	XRF:
Orange	5.00

Sample Photo:

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:	
4-8-MISC-24	MISC	
Sample Location:	Detailed Sample Location:	
Room 11	By control wheels and conveying systems.	
Sample Quantity:	80 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Silver woven heat-resistant seal material on hatch interior.	Potential ACBM with potential for damage	No

Sample Photo:



4-8-MISC-24



Additional Sample Notes:

Sample ID:

4-9-PB-11

Sample Type:

PB

Sample Location:

Room 18A

Detailed Sample Location:

South side of stairway in 18A.

Sample Quantity:

N/A

Sample Color:

White

XRF:

0.300

Sample Photo:



4-9-PB-11

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-9-TSI-32	TSI	
Sample Location:	Detailed Sample Location:	
Room 11	Northeast portion of room.	
Sample Quantity:	20 linear feet.	
Sample Color:	XRF:	
Misc Sample Material:	Sample Condition:	Sample Friable?:
	Damaged or significantly damaged	Yes

Sample Photo:



4-9-TSI-32




Additional Sample Notes:		White tank insulation with orange wrap.			
Sample ID:		Sample Type:			
4-9-TSI-23		TSI			
Sample Location:		Detailed Sample Location:			
Room 11		Northeast portion of room.			
Sample Quantity:		20 linear feet.			
Sample Color:		XRF:			
Misc Sample Material:		Sample Condition:		Sample Friable?:	
		Damaged or significantly damaged		Yes	

Sample Photo:



4-9-TSI-23

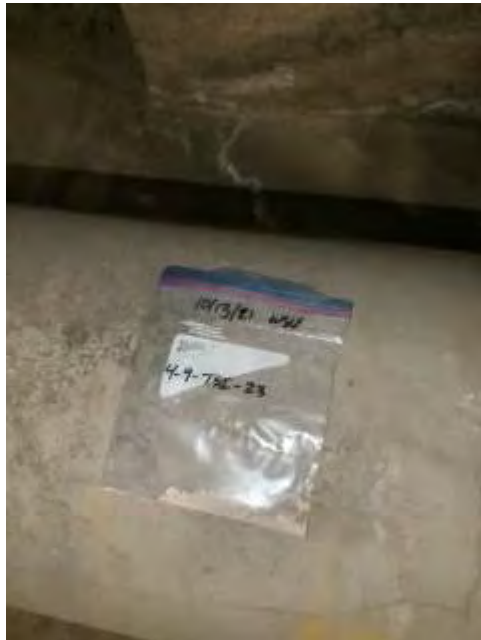


Additional Sample Notes:	White tank insulation with gray painted wrap and fabric patch.	
Sample ID:	Sample Type:	
4-10-MISC-34	MISC	
Sample Location:	Detailed Sample Location:	
Room 18	East wall of room.	
Sample Quantity:	350 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar.	Potential ACBM with potential for damage	No

Sample Photo:



4-10-MISC-34

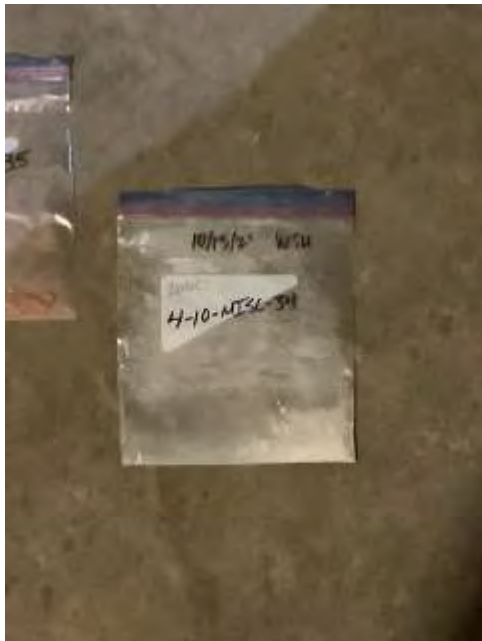

Additional Sample Notes:

Sample ID:

4-10-PB-12

Sample Type:

PB

Sample Location:

Room 18 A

Detailed Sample Location:

Pipe in west side of room.

Sample Quantity:

N/A

Sample Color:

Gray

XRF:

0.085

Sample Photo:



4-10-PB-12

Additional Sample Notes:

Sample ID:

4-11-PB-13

Sample Type:

PB

Sample Location:

Room 21

Detailed Sample Location:

Red fire extinguisher marking paint on northwest corner

Sample Quantity:

N/A

Sample Color:

Red

XRF:

ND

Sample Photo:

4-11-PB-13



Additional Sample Notes:

Sample ID:

4-11-MISC-35

Sample Type:

MISC

Sample Location:

Room 18

Detailed Sample Location:

North wall of room.

Sample Quantity:

180 square feet.

Misc Sample Material:

Red brick

Sample Condition:

Potential ACBM with potential for damage


Sample Friable?:

No

Sample Photo:



4-11-MISC-35

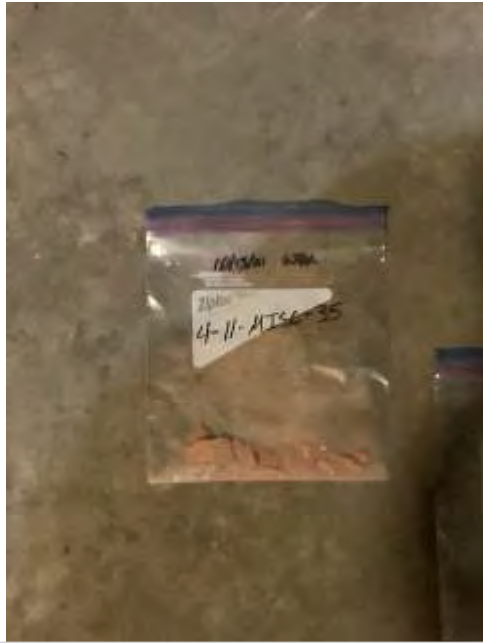

Additional Sample Notes:	
Sample ID:	Sample Type:
4-11-PB-54	PB
Sample Location:	Detailed Sample Location:
Room 11	Red fire extinguisher marking in southeast corner of room north of spiral staircase.
Sample Quantity:	N/A
Sample Color:	XRF:
Red	ND

Sample Photo:




4-11-PB-54

Additional Sample Notes:		
Sample ID:	Sample Type:	
4-12-MISC-36	MISC	
Sample Location:	Detailed Sample Location:	
Bathroom by west exit in stairwell.		
Sample Quantity:	60 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White textured waterproofing tile.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:




4-12-MISC-36

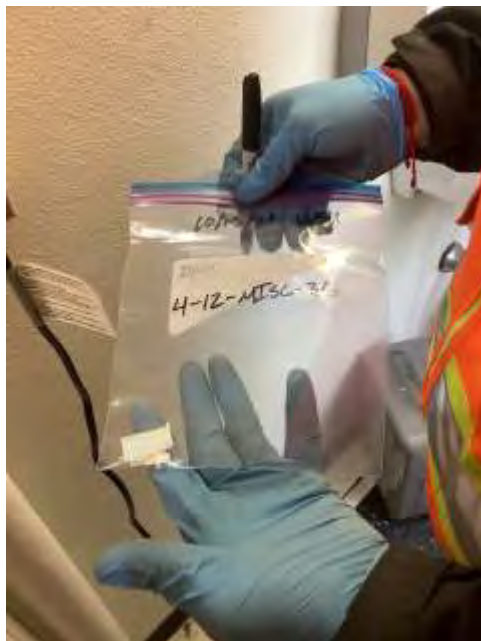

Additional Sample Notes:

Sample ID:	Sample Type:
4-12-PB-14	PB
Sample Location:	Detailed Sample Location:
Room 21	Door to room 15.
Sample Quantity:	24 square feet.
Sample Color:	XRF:
Gray	4.11

Sample Photo:

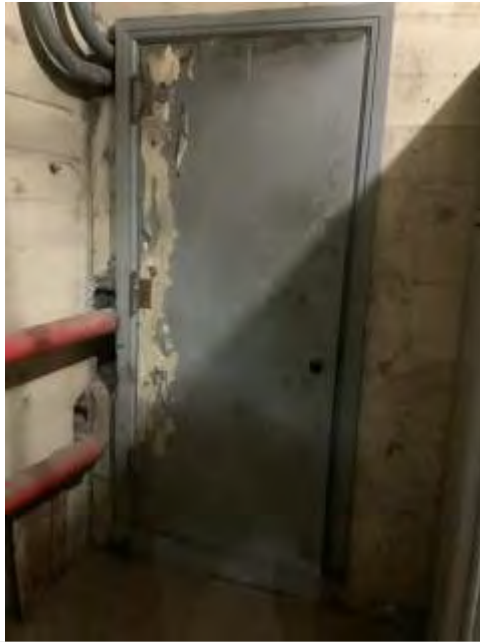


4-12-PB-14

Additional Sample Notes:

Sample ID:	Sample Type:
4-13-PB-15	PB
Sample Location:	Detailed Sample Location:
Room 21	Paint under new paint on door to room 15.
Sample Quantity:	24 square feet.
Sample Color:	XRF:
Light tan	3.40

Sample Photo:

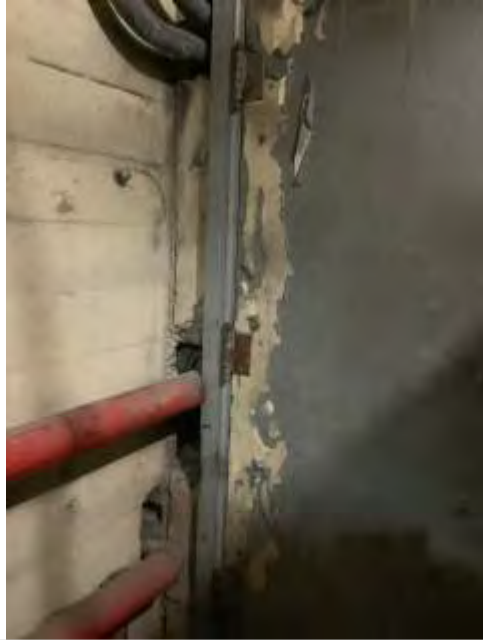

4-13-PB-15

Additional Sample Notes:

Sample ID:	Sample Type:	
4-13-MISC-37	MISC	
Sample Location:	Detailed Sample Location:	
Bathroom by exit		
Sample Quantity:	30 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Window glazing.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:



4-13-MISC-37



Additional Sample Notes:

Sample ID: 4-14-MISC-38 **Sample Type:** MISC

Sample Location: Bathroom by exit **Detailed Sample Location:**

Sample Quantity: 20 square feet.

Misc Sample Material: Black 12" x 12" linoleum floor tile with yellow adhesive

Sample Condition: Damaged or significantly damaged friable miscellaneous ACM

Sample Friable?: No

Sample Photo:



4-14-MISC-38



Additional Sample Notes:

Sample ID:	Sample Type:
4-14-PB-16	PB
Sample Location:	Detailed Sample Location:
Room 21	Orange pipe on south wall west of room 22.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	5.00

Sample Photo:



4-14-PB-16

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-21	PB
Sample Location:	Detailed Sample Location:
Room 23	Orange pipe on east wall.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	3.70

Sample Photo:



4-14-PB-21

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-55	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange pipe wrap in southeast corner of room north of spiral staircase.
Sample Quantity:	600 linear feet
Sample Color:	XRF:
Orange	1.275

Sample Photo:



4-14-PB-55

Additional Sample Notes:

Sample ID:	Sample Type:
4-14-PB-57	PB
Sample Location:	Detailed Sample Location:
Room 11	Southeast corner of room east of doorway.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	4.49

Sample Photo:




4-14-PB-57

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-42	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange pipe in northwest corner of room west of active tank.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	5.0

Sample Photo:

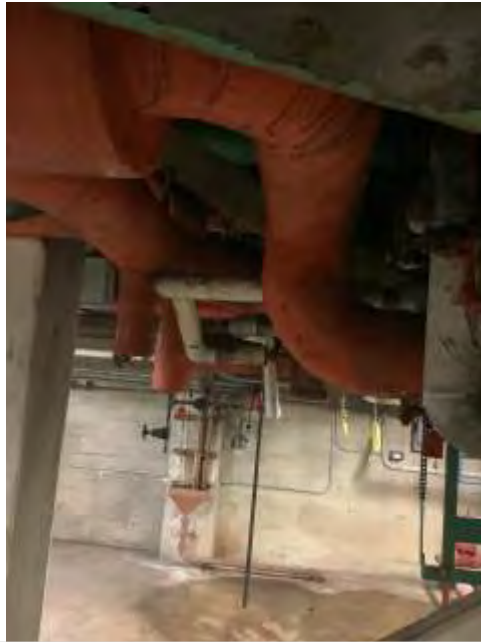

4-14-PB-42

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-14-PB-50	PB
Sample Location:	Detailed Sample Location:
Room 11	Orange tank in center of room between the two north boilers.
Sample Quantity:	600 linear feet.
Sample Color:	XRF:
Orange	1.223

Sample Photo:



4-14-PB-50



Additional Sample Notes:

Submitted sample to laboratory for analysis.

Sample ID:

4-14-PB-27

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Orange pipe in southwest corner of room.

Sample Quantity:

600 linear feet.

Sample Color:

Orange

XRF:

3.32

Sample Photo:



4-14-PB-27

Additional Sample Notes:

Sample ID:

4-14-PB-44

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Northeast corner of room west of exit doorway.

Sample Quantity:

600 linear feet.

Sample Color:

Orange

XRF:

2.43

Sample Photo:



4-14-PB-44

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-15-PB-17	PB
Sample Location:	Detailed Sample Location:
Room 21	White paint on orange pipe on south wall west of room 22.
Sample Quantity:	2 linear feet.
Sample Color:	XRF:
White	5.00

Sample Photo:



4-15-PB-17

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:	
4-15-MISC-39	MISC	
Sample Location:	Detailed Sample Location:	
Bathroom by exit		
Sample Quantity:	20 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White 12" x 12" linoleum floor tile with yellow adhesive.	Damaged or significantly damaged friable miscellaneous ACM	No

Sample Photo:



4-15-MISC-39



Additional Sample Notes:

Sample ID:

4-16-MISC-40

Sample Type:

MISC

Sample Location:

Bathroom by exit

Detailed Sample Location:

Sample Quantity:

21 linear feet.

Misc Sample Material:

Black cove base with tan adhesive.


Sample Condition:

Damaged or significantly damaged friable miscellaneous ACM


Sample Friable?:

No

Sample Photo:

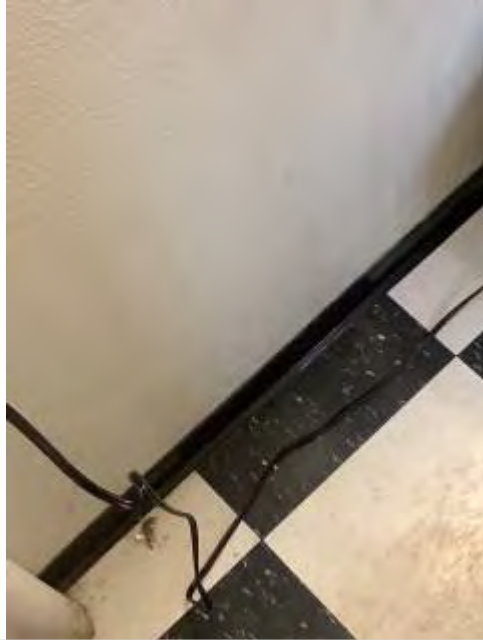

4-16-MISC-40

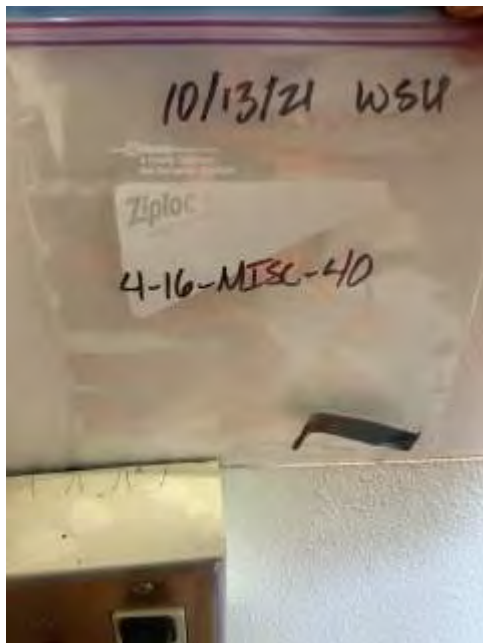

Additional Sample Notes:

Sample ID:

4-16-PB-18

Sample Type:

PB

Sample Location:

Room 22

Detailed Sample Location:

East wall of room.

Sample Quantity:

N/A

Sample Color:

Tan

XRF:

ND

Sample Photo:



4-16-PB-18

Additional Sample Notes:	
Sample ID:	Sample Type:
4-16-PB-24	PB
Sample Location:	Detailed Sample Location:
Room 23	Tan paint on northwest corner of wall.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	ND

Sample Photo:



Additional Sample Notes:

Sample ID:	Sample Type:
4-16-PB-28	PB
Sample Location:	Detailed Sample Location:
Room 11	Support beam in southwest center of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	ND

Sample Photo:



Additional Sample Notes:

Sample ID:	Sample Type:
4-16-PB-51	PB
Sample Location:	Detailed Sample Location:
Room 11	Support beam on south side of room east of green air equipment.
Sample Quantity:	N/A
Sample Color:	XRF:
White	0.005

Sample Photo:



4-16-PB-51

Additional Sample Notes:

Sample ID:	Sample Type:	
4-17-MISC-41	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	Northeast floor in front of door.	
Sample Quantity:	180 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan 1"-2" square tile with brown adhesive.	Potential ACBM with potential for damage	No

Sample Photo:



4-17-MISC-41



Additional Sample Notes:

Sample ID:

4-17-MISC-42

Sample Type:

MISC

Sample Location:

Room 17

Detailed Sample Location:

South center room next to center dividing wall.

Sample Quantity:

180 square feet.

Misc Sample Material:

Tan 1"-2" square tile with brown adhesive.

Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:



4-17-MISC-42



Additional Sample Notes:	
Sample ID:	Sample Type:
4-17-PB-45	PB
Sample Location:	Detailed Sample Location:
Room 11	Yellow concrete block In northeast corner of room south of exit doorway.
Sample Quantity:	N/A
Sample Color:	XRF:
Yellow	ND

Sample Photo:



4-17-PB-45

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-17-PB-19	PB
Sample Location:	Detailed Sample Location:
Room 21	Yellow caution paint above doorway to room 11.
Sample Quantity:	N/A
Sample Color:	XRF:
Yellow	ND

Sample Photo:



4-17-PB-19

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-18-PB-22	PB
Sample Location:	Detailed Sample Location:
Room 23	Yellow pipe in northeast corner.
Sample Quantity:	N/A
Sample Color:	XRF:
Yellow	0.305

Sample Photo:




4-18-PB-22

Additional Sample Notes:

Sample ID:	Sample Type:	
4-18-MISC-43	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	South wall of room.	
Sample Quantity:	920 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White drywall with gray cementitious wallboard.	Potential ACBM with potential for damage	No

Sample Photo:

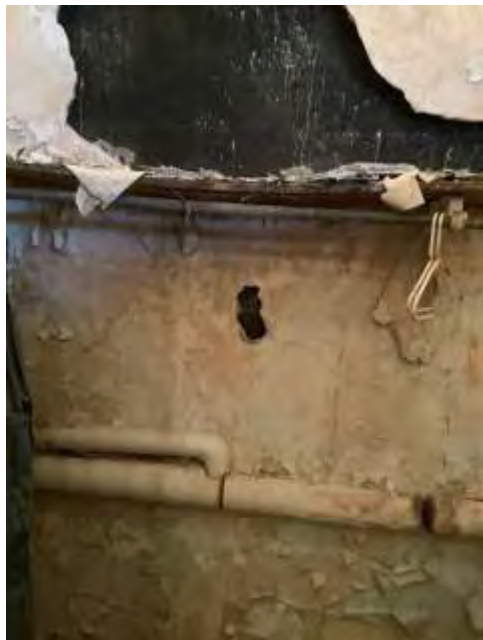

4-18-MISC-43



Additional Sample Notes:

Sample ID:

4-18-MISC-45

Sample Type:

MISC

Sample Location:

Room 17

Detailed Sample Location:

West wall in northwest corner.

Sample Quantity:

920 square feet.

Misc Sample Material:

White drywall with gray cementitious wallboard.


Sample Condition:

Potential ACBM with potential for damage

Sample Friable?:

No

Sample Photo:

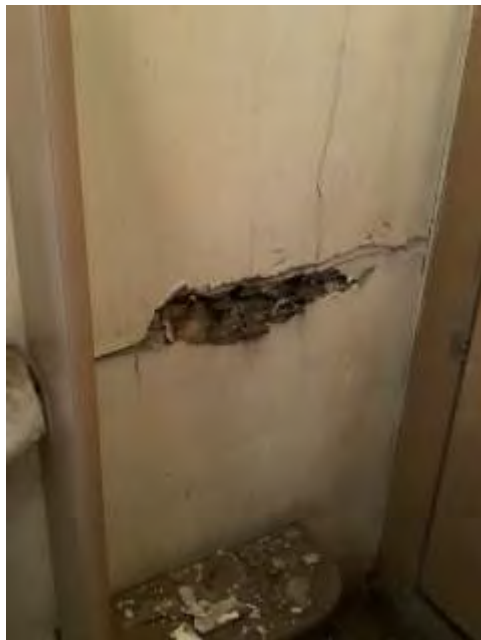

4-18-MISC-45



Additional Sample Notes:

Sample ID:	Sample Type:	
4-19-MISC-44	MISC	
Sample Location:	Detailed Sample Location:	
Room 17	West wall in northwest corner.	
Sample Quantity:	60 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Tan cove base with green adhesive.	Potential ACBM with potential for damage	No

Sample Photo:



4-19-MISC-44



Additional Sample Notes:

Sample ID:

4-19-PB-39

Sample Type:

PB

Sample Location:

Room 11

Detailed Sample Location:

Northwest corner of room south of window.

Sample Quantity:

N/A

Sample Color:

Blue

XRF:

0.084

Sample Photo:




4-19-PB-39

Additional Sample Notes:

Sample ID:	Sample Type:
4-19-PB-23	PB
Sample Location:	Detailed Sample Location:
Room 23	Blue pipe in northeast corner.
Sample Quantity:	N/A
Sample Color:	XRF:
Blue	0.306

Sample Photo:

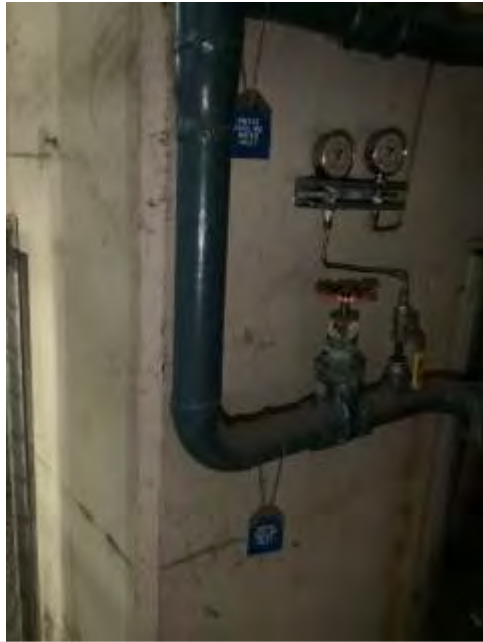

4-19-PB-23

Additional Sample Notes:

Sample ID:	Sample Type:
4-20-PB-26	PB
Sample Location:	Detailed Sample Location:
Room 23	Green equipment on south side of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.908

Sample Photo:



4-20-PB-26

Additional Sample Notes:

Sample ID:	Sample Type:
4-21-PB-29	PB
Sample Location:	Detailed Sample Location:
Room 11	White pipe wrap on west side of room east of sun basement entrance.
Sample Quantity:	N/A
Sample Color:	XRF:
White	ND

Sample Photo:



4-21-PB-29

Additional Sample Notes:

Sample ID:	Sample Type:
4-22-PB-31	PB
Sample Location:	Detailed Sample Location:
Room 11	Yellow pipe on east side of room east of door to sub basement.
Sample Quantity:	140 linear feet.
Sample Color:	XRF:
Yellow	5.00

Sample Photo:



4-22-PB-31

Additional Sample Notes:

Sample ID:	Sample Type:
4-22-PB-37	PB
Sample Location:	Detailed Sample Location:
Room 11	North side of room north of northwest boiler.
Sample Quantity:	140 linear feet.
Sample Color:	XRF:
Yellow	3.67

Sample Photo:



4-22-PB-37

Additional Sample Notes:

Sample ID:	Sample Type:
4-22-PB-48	PB
Sample Location:	Detailed Sample Location:
Room 11	Center of room east of southwest boiler.
Sample Quantity:	140 linear feet.
Sample Color:	XRF:
Yellow	4.38

Sample Photo:



4-22-PB-48

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-23-PB-49	PB
Sample Location:	Detailed Sample Location:
Room 11	Support in center of room between the two north boilers.
Sample Quantity:	280 linear feet.
Sample Color:	XRF:
Bright white	5.00

Sample Photo:



4-23-PB-49

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-23-PB-32	PB
Sample Location:	Detailed Sample Location:
Room 11	Support in northwest corner.
Sample Quantity:	264 linear feet.
Sample Color:	XRF:
Bright white	5.00

Sample Photo:



4-23-PB-32



Additional Sample Notes:	Submitted sample to laboratory for analysis.
---------------------------------	--

Sample ID:	Sample Type:
-------------------	---------------------

4-23-PB-34	PB
------------	----

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

Room 11	Support on north side of room east of active tank.
---------	--

Sample Quantity:	264 linear feet.
-------------------------	------------------

Sample Color:	XRF:
----------------------	-------------

White	0.146
-------	-------

Sample Photo:



4-23-PB-34

Additional Sample Notes:

Sample ID:	Sample Type:
4-23-PB-35	PB
Sample Location:	Detailed Sample Location:
Room 11	North side of room south of active tank.
Sample Quantity:	280 linear feet.
Sample Color:	XRF:
White	5.00

Sample Photo:



4-23-PB-35

Additional Sample Notes:	
Sample ID:	Sample Type:
4-24-PB-36	PB
Sample Location:	Detailed Sample Location:
Room 11	North side of room north of northwest boiler.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	0.241

Sample Photo:



4-24-PB-36



Additional Sample Notes:	Submitted sample to laboratory for analysis.
---------------------------------	--

Sample ID:	Sample Type:
4-24-PB-40	PB
Sample Location:	Detailed Sample Location:
Room 11	Northwest corner of room.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	ND

Sample Photo:




4-24-PB-36

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-24-PB-46	PB
Sample Location:	Detailed Sample Location:
Room 11	East side of room east of northeast boiler.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	1.178

Sample Photo:

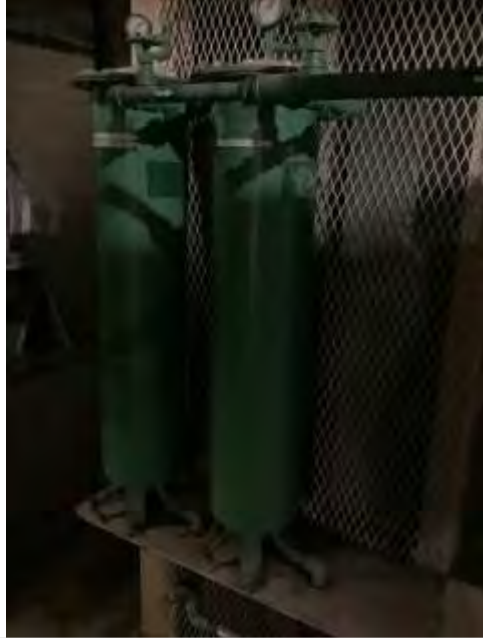

4-24-PB-36

Additional Sample Notes:	Difficult to quantify.
Sample ID:	Sample Type:
4-24-PB-53	PB
Sample Location:	Detailed Sample Location:
Room 11	Green pipe and equipment on south side of room east of entrance to room 21.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	0.220

Sample Photo:



4-24-PB-53

Additional Sample Notes:

Sample ID:	Sample Type:
4-24-PB-58	PB
Sample Location:	Detailed Sample Location:
Room 11	Southwest corner of room.
Sample Quantity:	100 linear feet.
Sample Color:	XRF:
Green	0.084

Sample Photo:



4-24-PB-58

Additional Sample Notes:

Sample ID:	Sample Type:
4-25-PB-59	PB
Sample Location:	Detailed Sample Location:
Room 11	Southeast corner of room west of southeast boiler.
Sample Quantity:	N/A
Sample Color:	XRF:
Reddish brown	0.069

Sample Photo:




4-25-PB-59

Additional Sample Notes:

Sample ID:	Sample Type:
4-25-PB-41	PB
Sample Location:	Detailed Sample Location:
Room 11	Drain pipe in northwest corner of room west of active tank.
Sample Quantity:	N/A
Sample Color:	XRF:
Reddish brown	ND

Sample Photo:

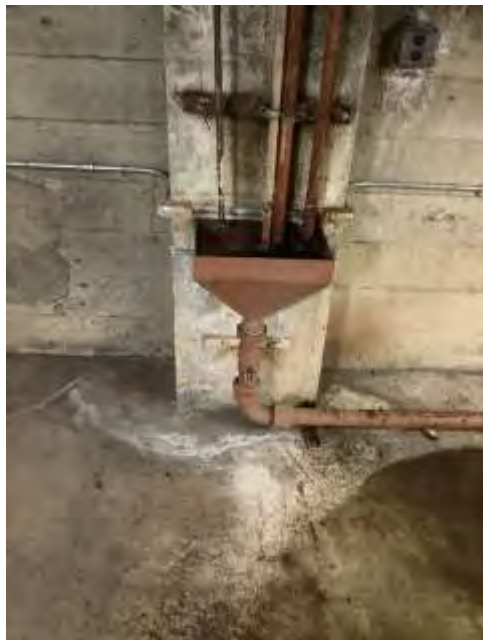

4-25-PB-41

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-26-PB-56	PB
Sample Location:	Detailed Sample Location:
Room 11	Silver pipe wrap southeast corner of room.
Sample Quantity:	N/A
Sample Color:	XRF:
Silver	ND

Sample Photo:



4-26-PB-56

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
4-27-PB-62	PB
Sample Location:	Detailed Sample Location:
Room 15	East side of center wall of room next to mirror.
Sample Quantity:	N/A
Sample Color:	XRF:
Tan	0.008

Sample Photo:



4-27-PB-62

Additional Sample Notes:

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 15	Throughout room.
Type of Fixture:	Quantity:
Mechanical fluid hazard.	Throughout room.
Condition:	Additional Fixture Notes:
Good	Mechanical fluid containers throughout room.

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 17	Throughout room.
Type of Fixture:	Quantity:
Potential lead paint hazard.	Throughout room.
Condition:	Additional Fixture Notes:
Severely damaged	Paint peeling off walls and ceiling.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 21 and room 23	Throughout rooms.
Type of Fixture:	Quantity:
Hot pipes and tanks.	Several
Condition:	Additional Fixture Notes:
Good	Burn hazard from hot pipes and tanks.

Other Material Photo:





Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 21	North wall.
Type of Fixture:	Quantity:
Low clearance.	1
Condition:	Additional Fixture Notes:
Good	Low ceiling hazard.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 21	Throughout room.
Type of Fixture:	Quantity:
Electrical hazard.	3
Condition:	Additional Fixture Notes:
Good	1 electric source control unit, 1 electrical control panel, 1 electrical switch box.

Other Material Photo:






Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	Throughout room.
Type of Fixture:	Quantity:
Electrical fixtures.	25
Condition:	Additional Fixture Notes:
Good	1 control box, 20 control switch, 3 electrical boxes, 1 motor control center.

Other Material Photo:



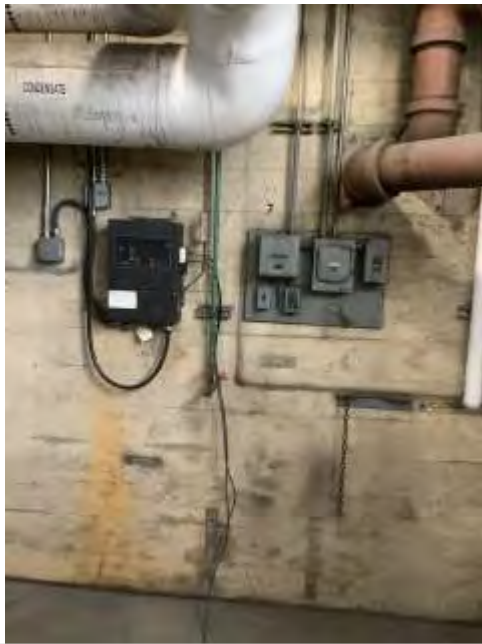



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	North side of room.
Type of Fixture:	Quantity:
Active steam equipment.	Several
Condition:	Additional Fixture Notes:
Good	Active tanks, pumps, and lines.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	Throughout room.
Type of Fixture:	Quantity:
Low clearance.	Several
Condition:	Additional Fixture Notes:
Good	Low pipes and supports.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	East side of room.
Type of Fixture:	Quantity:
Elevator shaft.	1
Condition:	Additional Fixture Notes:
Good	Potential hazard related to mechanical operation.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11, 21, 23	Throughout rooms.
Type of Fixture:	Quantity:
Fluorescent light fixtures.	43
Condition:	Additional Fixture Notes:
Good	34 lights in place and active, 9 in box in room 21.

Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room 11	Throughout room.
Type of Fixture:	Quantity:
Steam equipment.	Several
Condition:	Additional Fixture Notes:
Good	Mechanical fluid hazard related to inactive and active equipment.

Other Material Photo:




Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/14/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Sub Basement

Samples

Sample ID:	Sample Type:
5-1-PB-1	PB
Sample Location:	Detailed Sample Location:
Room B1	West hall entrance.
Sample Quantity:	110 linear feet.
Sample Color:	XRF:
Yellow	0.023

Sample Photo:

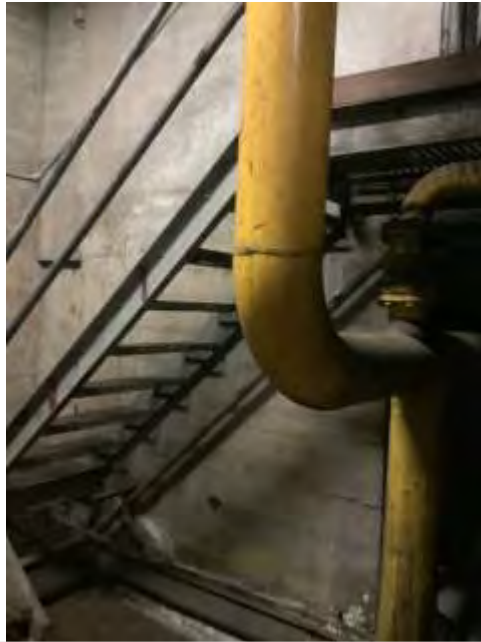

5-1-PB-1

Additional Sample Notes:	
---------------------------------	--

Sample ID:	Sample Type:
5-1-PB-2	PB
Sample Location:	Detailed Sample Location:
Room B1	Center of hallway.
Sample Quantity:	110 linear feet.
Sample Color:	XRF:
Yellow	ND

Sample Photo:



5-1-PB-2



Additional Sample Notes:

Submitted sample to laboratory for analysis

Sample ID:

5-1-PB-3

Sample Type:

PB

Sample Location:

Room B1

Detailed Sample Location:

East end of hallway.

Sample Quantity:

110 linear feet.

Sample Color:

Yellow

XRF:

2.08

Sample Photo:



5-1-PB-3

Additional Sample Notes:

Sample ID:

5-2-PB-4

Sample Type:

PB

Sample Location:

Room B3

Detailed Sample Location:

Center of room.

Sample Quantity:

5 linear feet.

Sample Color:

Orange

XRF:

1.012

Sample Photo:

5-2-PB-4



Additional Sample Notes:

Sample ID:

5-3-PB-5

Sample Type:

PB

Sample Location:

Room B1

Detailed Sample Location:

East wall at end of hall.

Sample Quantity:

N/A

Sample Color:

Brown

XRF:

0.08

Sample Photo:



5-3-PB-5

Additional Sample Notes:

Sample ID:	Sample Type:
5-3-PB-6	PB
Sample Location:	Detailed Sample Location:
Room B1	East end in the center of hall.
Sample Quantity:	N/A
Sample Color:	XRF:
Brown	ND

Sample Photo:



5-3-PB-6

Additional Sample Notes:

Sample ID:	Sample Type:
5-4-PB-7	PB
Sample Location:	Detailed Sample Location:
Room B1	Center of hallway.
Sample Quantity:	N/A
Sample Color:	XRF:
Reddish brown	ND

Sample Photo:



5-4-PB-7

Additional Sample Notes:

Other Material Tracking

General Fixture Location:

Room B1

Detailed Fixture Location:

Southeast corner of room.

Type of Fixture:

Fluorescent bulbs.

Quantity:

3

Condition:

Good

Additional Fixture Notes:


Other Material Photo:



Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Room B2	Whole room.
Type of Fixture:	Quantity:
Confined space.	1
Condition:	Additional Fixture Notes:
Good	Confined space hazard in room B2.

Other Material Photo:

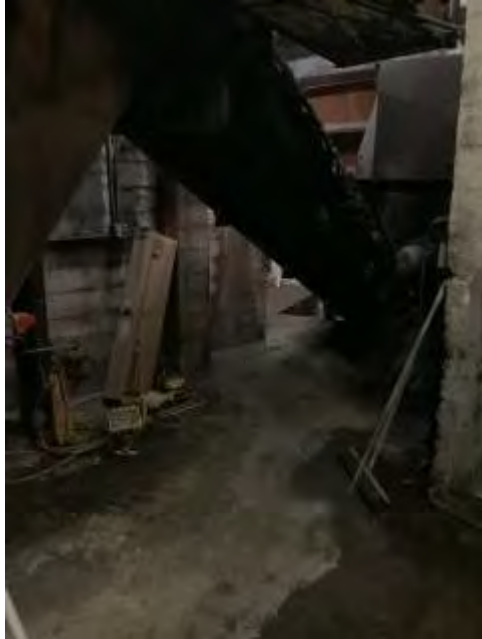

Project Name:	0457.02.03-01
Project Number:	Port of Whitman County
Date:	10/14/2021
Field Personnel:	Other
Sample Types:	Asbestos; Lead
Sample Areas:	Exterior

Samples

Sample ID:	Sample Type:	
EXT-1-MISC-1	MISC	
Sample Location:	Detailed Sample Location:	
West exterior side of structure.	West exterior side of room 101 north of double doors next to ash pit tower.	
Sample Quantity:	15,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red brick	Potential ACBM with potential for damage; Remaining friable ACBM or friable suspected ACBM	No

Sample Photo:



EXT-1-MISC-1



Additional Sample Notes:	Difficult to quantify material.	
Sample ID:	Sample Type:	
EXT-1-MISC-4	MISC	
Sample Location:	Detailed Sample Location:	
East exterior side of structure.	East exterior side of room 101 south of stairwell exit door and north of windows.	
Sample Quantity:	15,000 square feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Red brick	Potential ACBM with potential for damage	No
Sample Photo:		



EXT-1-MISC-4





Additional Sample Notes:	Difficult to quantify material.
Sample ID:	Sample Type:
EXT-1-PB-1	PB
Sample Location:	Detailed Sample Location:
West exterior support beams.	Southwest support beam of ash pit outside of room 101.
Sample Quantity:	272 linear feet.
Sample Color:	XRF:
Brownish red	1.47

Sample Photo:



EXT-1-PB-1



Additional Sample Notes:	Submitted sample to laboratory for analysis.
Sample ID:	Sample Type:
EXT-1-PB-2	PB
Sample Location:	Detailed Sample Location:
West exterior support beams.	Northeast support beam of ash pit outside of room 101.
Sample Quantity:	272 linear feet.
Sample Color:	XRF:
Brownish red	1.15

Sample Photo:



EXT-1-PB-2

Additional Sample Notes:

Sample ID:	Sample Type:
EXT-2-PB-3	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Vent on west exterior side of room 101 in between double doors.
Sample Quantity:	N/A
Sample Color:	XRF:
Dark brown red	0.120

Sample Photo:



EXT-2-PB-3

Additional Sample Notes:

Sample ID:	Sample Type:	
EXT-2-MISC-5	MISC	
Sample Location:	Detailed Sample Location:	
East exterior side of structure.	East exterior side of room 101 south of stairwell exit door and north of windows.	
Sample Quantity:	75,000 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
Gray brick mortar	Potential ACBM with potential for damage	No

Sample Photo:



EXT-2-MISC-5





Additional Sample Notes:		Difficult to quantify material.
Sample ID:		Sample Type:
EXT-2-MISC-2		MISC
Sample Location:		Detailed Sample Location:
West exterior side of structure.		West exterior side of room 101 north of double doors next to ash pit tower.
Sample Quantity:		75,000 linear feet.
Misc Sample Material:		Sample Condition:
Gray brick mortar		Potential ACBM with potential for damage
		Sample Friable?:
		No

Sample Photo:



EXT-2-MISC-2



Additional Sample Notes:	Difficult to quantify material.
---------------------------------	---------------------------------

Sample ID:	Sample Type:
-------------------	---------------------

EXT-3-MISC-3	MISC
--------------	------

Sample Location:	Detailed Sample Location:
-------------------------	----------------------------------

West exterior side of southwest corner.	West exterior side of room 105 on the southwest cornered exterior.
---	--

Sample Quantity:	4,030 linear feet.
-------------------------	--------------------

Misc Sample Material:	Sample Condition:	Sample Friable?:
------------------------------	--------------------------	-------------------------

Window glazing.	Potential ACBM with potential for damage	No
-----------------	--	----

Sample Photo:



EXT-3-MISC-3





Additional Sample Notes:

Sample ID: EXT-3-MISC-6 **Sample Type:** MISC

Sample Location: East exterior side of structure. **Detailed Sample Location:** South window on exterior east wall of room 101.

Sample Quantity: 4,030 linear feet.

Misc Sample Material: Window glazing **Sample Condition:** Potential ACBM with potential for damage **Sample Friable?:** No

Sample Photo:



EXT-3-MISC-6



Additional Sample Notes:

Sample ID:
EXT-3-PB-4

Sample Type:
PB

Sample Location:
West exterior side of room 101.

Detailed Sample Location:
Double doors on west exterior side of room 101.

Sample Quantity:

N/A

Sample Color:

XRF:

Tan

0.058

Sample Photo:



EXT-3-PB-4

Additional Sample Notes:	
Sample ID:	Sample Type:
EXT-4-PB-5	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Railing on west exterior side of room 101 in front of double doors.
Sample Quantity:	N/A
Sample Color:	XRF:
Green	0.173

Sample Photo:



EXT-4-PB-5

Additional Sample Notes:		
Sample ID:	Sample Type:	
EXT-4-MISC-7	MISC	
Sample Location:	Detailed Sample Location:	
East exterior side of structure.	North corner of east exterior wall of room 101 south of stairwell exit.	
Sample Quantity:	37 linear feet.	
Misc Sample Material:	Sample Condition:	Sample Friable?:
White brick caulking.	Potential ACBM with potential for damage	No

Sample Photo:



EXT-4-MISC-7





Additional Sample Notes:

Sample ID:

EXT-5-PB-6

Sample Type:

PB

Sample Location:

West exterior side of room 101.

Detailed Sample Location:

Silver pipe on west exterior side of room 101 and south of double doors.

Sample Quantity:

25 linear feet.

Sample Color:

Silver

XRF:


1.213

Sample Photo:



Additional Sample Notes:	
Sample ID:	Sample Type:
EXT-6-PB-7	PB
Sample Location:	Detailed Sample Location:
West exterior side of room 101.	Blue gray pipe in corner of exterior side of room 101 and south of double doors.
Sample Quantity:	25 linear feet.
Sample Color:	XRF:
Blue gray	0.071

Sample Photo:

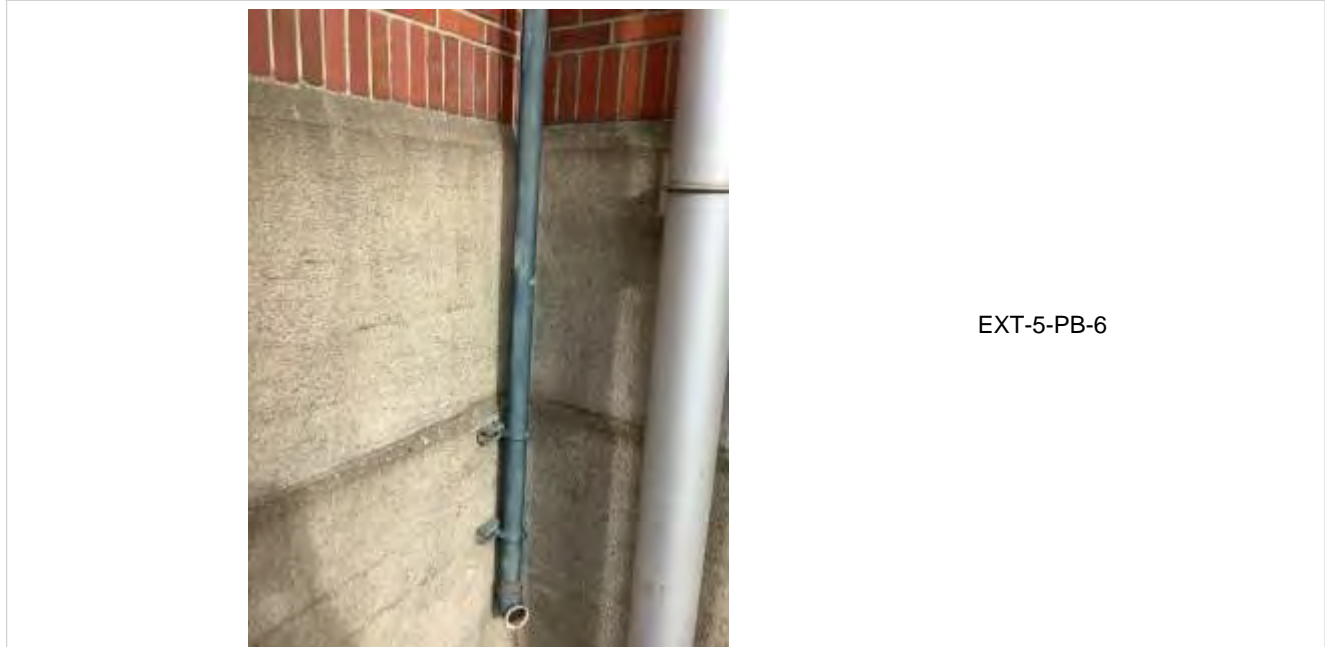

Additional Sample Notes:	
---------------------------------	--

Other Material Tracking

General Fixture Location:	Detailed Fixture Location:
Type of Fixture:	Quantity:
Condition:	Additional Fixture Notes:

Other Material Photo:

APPENDIX C

LABORATORY ANALYTICAL REPORTS



October 26, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118225.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Munaf Khan, Laboratory Director



Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116000 Client Sample #: 1-1-TSI-1

Location: N-A

Layer 1 of 2 Description: Off-white paper with woven fibers and metal foil

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Metal foil	Cellulose 85%	
	Glass fibers 7%	

Layer 2 of 2 Description: Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass resin	Glass fibers 99%	

Lab ID: 21116001 Client Sample #: 1-1-TSI-2

Location: N-A

Layer 1 of 2 Description: Off-white paper with woven fibers and metal foil

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Metal foil	Cellulose 83%	
	Glass fibers 10%	

Layer 2 of 2 Description: Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass resin	Glass fibers 98%	

Lab ID: 21116002 Client Sample #: 1-2-TSI-3


Location: N-A

Layer 1 of 2 Description: White flexible sheet vinyl

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Vinyl/Binder, Fine particles	None Detected ND	

Sampled by: Client
Analyzed by: Nick Ly
Reviewed by: Munaf Khan

Date: 10/22/2021
Date: 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2 **Description:** Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Glass resin, Fine particles	Glass fibers 96%	

Lab ID: 21116003 **Client Sample #: 1-3-MISC-4**

Location: N-A

Layer 1 of 1 **Description:** Pale gray brittle material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % Chrysotile 4%
Binder/Filler	Cellulose 1%	

Lab ID: 21116004 **Client Sample #: 1-3-MISC-5**

Location: N-A

Layer 1 of 1 **Description:** Gray brittle crumbly material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Paint	Cellulose <1%	

Lab ID: 21116005 **Client Sample #: 1-4-MISC-6**

Location: N-A

Layer 1 of 1 **Description:** Beige soft crumbly material


Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Fine particles	Glass fibers 32%	
	Cellulose 8%	

Lab ID: 21116006 **Client Sample #: 1-5-MISC-7**

Location: N-A

Layer 1 of 1 **Description:** Red paint coated hard brittle material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Granules, Paint	None Detected ND	

Sampled by: Client	 Munaf Khan, Laboratory Director
Analyzed by: Nick Ly	
Reviewed by: Munaf Khan	
Date: 10/22/2021	
Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116007 Client Sample #: 1-6-TSI-8

Location: N-A

Layer 1 of 2	Description: Red paint coated woven fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Paint	Cellulose 88%		None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	None Detected ND		Amosite 30%

Lab ID: 21116008 Client Sample #: 1-7-TSI-9

Location: N-A

Layer 1 of 2	Description: White paper with woven fibers and metal foil			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Metal foil	Cellulose 75%		None Detected ND
		Glass fibers 7%		
Layer 2 of 2	Description: Yellow and pink loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Glass resin	Glass fibers 98%		None Detected ND

Lab ID: 21116009 Client Sample #: 1-8-TSI-10

Location: N-A

Layer 1 of 3	Description: White woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles, Paint	Cotton yarn 90%		None Detected ND
Layer 2 of 3	Description: Pale gray crumbly powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Fine particles, Glass shots & debris	Cellulose 25%		None Detected ND

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/22/2021	 <hr style="width: 80%; margin: 0 auto;"/> Munaf Khan, Laboratory Director
Reviewed by: Munaf Khan	Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 3 of 3	Description: White compacted fine powdery material	Glass fibers 8%	
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles	Synthetic fibers 22%	None Detected ND

Lab ID: 21116010 Client Sample #: 1-8-TSI-11
 Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh with paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles, Paint	Cotton yarn 85%	None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles	None Detected ND	Chrysotile 35%


Lab ID: 21116011 Client Sample #: 1-8-TSI-12
 Location: N-A

Layer 1 of 2	Description: White woven fibrous cloth with paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles, Paint	Cotton yarn 92%	None Detected ND
Layer 2 of 2	Description: Off-white fine powdery material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Fine particles, Glass shots & debris	Glass fibers 35%	Chrysotile 5%

Lab ID: 21116012 Client Sample #: 1-9-MISC-13
 Location: N-A

Layer 1 of 3	Description: White encapsulated woven fibrous material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Fine particles	Glass fibers 72%	None Detected ND

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/22/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021


 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 3 **Description:** Tan paper with woven fibers and metal foil

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Metal foil	Cellulose 72%	
	Glass fibers 8%	

Layer 3 of 3 **Description:** Yellow loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass resin, Fine particles	Glass fibers 98%	

Lab ID: 21116013 **Client Sample #: 1-8-TSI-14**
 Location: N-A

Layer 1 of 2 **Description:** Orange paint coated woven fibrous mesh

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Paint	Cotton yarn 85%	

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % Amosite 38%
Fine particles	None Detected ND	

Lab ID: 21116014 **Client Sample #: 1-10-TSI-15**
 Location: N-A


Layer 1 of 2 **Description:** White woven fibrous mesh with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Paint	Glass fibers 95%	

Layer 2 of 2 **Description:** Off-white crumbly material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Glass shots & debris	Glass fibers 8%	

Lab ID: 21116015 **Client Sample #: 1-11-MISC-16**
 Location: N-A

Sampled by: Client	 Munaf Khan, Laboratory Director
Analyzed by: Nick Ly	
Reviewed by: Munaf Khan	
Date: 10/22/2021	
Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116019 Client Sample #: 1-14-TSI-20

Location: N-A

Layer 1 of 2 Description: White and tan woven fibrous mesh with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Paint, Fine particles	Cellulose 45%	
	Glass fibers 42%	

Layer 2 of 2 Description: White compacted powdery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % Chrysotile 28% Amosite 12%
Fine particles	None Detected ND	

Lab ID: 21116020 Client Sample #: 1-8-TSI-21

Location: N-A

Layer 1 of 2 Description: Dark gray paint coated woven mesh

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Fine particles, Paint	Cotton yarn 92%	

Layer 2 of 2 Description: Off-white fine compacted powdery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % Amosite 37%
Fine particles	None Detected ND	

Lab ID: 21116021 Client Sample #: 1-13-MISC-22


Location: N-A

Layer 1 of 2 Description: White woven fibrous cloth with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Fine particles, Paint	Glass fibers 95%	

Sampled by: Client
Analyzed by: Nick Ly
Reviewed by: Munaf Khan

Date: 10/22/2021
Date: 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Yellow loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Glass resin	Glass fibers 99%		None Detected ND

Lab ID: 21116022 **Client Sample #: 1-15-MISC-23**

Location: N-A

Layer 1 of 2	Description: Tan patterned vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder, Mineral grains	None Detected ND		None Detected ND

Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	Cellulose 2%		None Detected ND

Lab ID: 21116023 **Client Sample #: 1-15-MISC-24**

Location: N-A


Layer 1 of 2	Description: Tan patterned vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Vinyl/Binder, Mineral grains	None Detected ND		None Detected ND

Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	None Detected ND		None Detected ND

Lab ID: 21116024 **Client Sample #: 1-16-MISC-25**

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Binder	None Detected ND		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Nick Ly</p> <p>Reviewed by: Munaf Khan</p>	<p>Date: 10/22/2021</p> <p>Date: 10/26/2021</p>	 <hr/> <p>Munaf Khan, Laboratory Director</p>
---	---	---

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Brown brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder	Wollastonite 4%		None Detected ND

Lab ID: 21116025 **Client Sample #: 1-16-MISC-26**

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Binder	None Detected ND		None Detected ND

Layer 2 of 2	Description: Brown brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mastic/Binder	Wollastonite 3%		None Detected ND

Lab ID: 21116026 **Client Sample #: 1-17-MISC-27**

Location: N-A


Layer 1 of 2	Description: Pale gray brittle sandy material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Sand, Mica, Paint	Cellulose 3%		None Detected ND

Layer 2 of 2	Description: White chalky material with paper			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Gypsum/Binder	Cellulose 38%		None Detected ND

Lab ID: 21116027 **Client Sample #: 1-18-MISC-28**

Location: N-A

Layer 1 of 1	Description: Pale gray brittle sandy material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Sand, Mica, Paint	Cellulose 2%		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Nick Ly</p> <p>Reviewed by: Munaf Khan</p>	<p>Date: 10/22/2021</p> <p>Date: 10/26/2021</p>	 <p>Munaf Khan, Laboratory Director</p>
---	---	---

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118225.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116028 Client Sample #: 1-19-MISC-29

Location: N-A

Layer 1 of 1 Description: Pale gray compressed fibrous material with paint


Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Glass shots & debris, Perlite, Paint	Cellulose 25%	None Detected ND
	Glass fibers 20%	

Lab ID: 21116029 Client Sample #: 1-20-MISC-30

Location: N-A

Layer 1 of 1 Description: Pale gray compressed fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Glass shots & debris, Perlite, Paint	Cellulose 22%	None Detected ND
	Glass fibers 18%	

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/22/2021	 <hr style="width: 100%;"/> Munaf Khan, Laboratory Director
Reviewed by: Munaf Khan	Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118225.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT _____
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax _____

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116000	1-1-TSI-1	A
2	21116001	1-1-TSI-2	A
3	21116002	1-2-TSI-3	A
4	21116003	1-3-MISC-4	A
5	21116004	1-3-MISC-5	A
6	21116005	1-4-MISC-6	A
7	21116006	1-5-MISC-7	A
8	21116007	1-6-TSI-8	A
9	21116008	1-7-TSI-9	A
10	21116009	1-8-TSI-10	A
11	21116010	1-8-TSI-11	A
12	21116011	1-8-TSI-12	A
13	21116012	1-9-MISC-13	A
14	21116013	1-8-TSI-14	A
15	21116014	1-10-TSI-15	A
16	21116015	1-11-MISC-16	A
17	21116016	1-12-MISC-17	A
18	21116017	1-8-TSI-18	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/22/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 10:49 AM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc. **NVL Batch Number** **2118225.00**
Address 109 E 13th St. **TAT** 5 Days **AH** No
 Vancouver, WA 98660 **Rush TAT** _____
Project Manager Mrs. Emily Curtis **Due Date** 10/26/2021 **Time** 10:10 AM
Phone (971) 544-2139 **Email** ecurtis@maulfoster.com
Fax _____

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
19	21116018	1-13-MISC-19	A
20	21116019	1-14-TSI-20	A
21	21116020	1-8-TSI-21	A
22	21116021	1-13-MISC-22	A
23	21116022	1-15-MISC-23	A
24	21116023	1-15-MISC-24	A
25	21116024	1-16-MISC-25	A
26	21116025	1-16-MISC-26	A
27	21116026	1-17-MISC-27	A
28	21116027	1-18-MISC-28	A
29	21116028	1-19-MISC-29	A
30	21116029	1-20-MISC-30	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/22/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 10:49 AM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi, Inc. Project Manager Matt Hoffman
 Address 2815 2nd Ave #540, Cell () -
Seattle, WA 98121 Email _____
 Phone 503-410-1524 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtts@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	<u>1-1-TSI-1</u>	<u>Condensate pipe in northwest corner of room</u>
2	<u>1-1-TSI-2</u>	<u>" "</u>
3	<u>1-2-TSI-3</u>	<u>Condensate pipe elbow</u>
4	<u>1-3-MISC-4</u>	<u>Window glazing</u>
5	<u>1-3-MISC-5</u>	<u>" "</u>
6	<u>1-4-MISC-6</u>	<u>Tan cementitious material</u>
7	<u>1-5-MISC-7</u>	<u>Red brick</u>
8	<u>1-6-TSI-8</u>	<u>Red pipe</u>
9	<u>1-7-TSI-9</u>	<u>Silver pipe</u>
10	<u>1-8-TSI-10</u>	<u>Silver pipe on ^{st. m} bracket insulation on boiler</u>
11	<u>1-8-TSI-11</u>	<u>" "</u>
12	<u>1-8-TSI-12</u>	<u>" "</u>
13	<u>1-9-MISC-13</u>	<u>Insulation on sink</u>
14	<u>1-8-TSI-14</u>	<u>Orange pipe in SE corner of room</u>
15	<u>1-10-TSI-15</u>	<u>Gray insulation and fabric</u>

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Name]</u>	<u>[Signature]</u>	<u>Nellie's</u>	<u>10/19/21</u>	<u>10:10</u>
Analyzed by					
Called by					
Faxed/Email by					<u>Falco</u>



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi, Inc.
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	<u>1-11-MISC-16</u>	<u>Tan soundproofing material</u>
2	<u>1-12-MISC-17</u>	<u>Gray fibrous material</u>
3	<u>1-8-TSI-18</u>	<u>Gray duct insulation</u>
4	<u>1-13-MISC-19</u>	<u>Tan soundproofing material</u>
5	<u>1-14-TSI-20</u>	<u>White patch on pipe</u>
6	<u>1-8-TSI-21</u>	<u>Dark gray pipe insulation</u>
7	<u>1-13-MISC-22</u>	<u>Gray fabric material</u>
8	<u>1-15-MISC-23</u>	<u>Tan 12"x12" vinyl floor tile w/ black mastic</u>
9	<u>1-15-MISC-24</u>	<u>" "</u>
10	<u>1-16-MISC-25</u>	<u>Brown base coat w/ brown mastic</u>
11	<u>1-16-MISC-26</u>	<u>" "</u>
12	<u>1-17-MISC-27</u>	<u>Light gray wallboard</u>
13	<u>1-18-MISC-28</u>	<u>Light gray cementitious wallboard</u>
14	<u>1-19-MISC-29</u>	<u>White 18"x36" inch ceiling tile w/randomized stippled pattern</u>
15	<u>1-20-MISC-30</u>	<u>White 18"x36" inch ceiling tile w/ uniform stippled pattern</u>

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Signature]</u>	<u>[Signature]</u>	<u>Nucleus</u>	<u>10/19/21</u>	<u>10:00</u>
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 25, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118227.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Evelyn Ahulu, EM Lab Manager

The logo for NVL LABS, featuring the letters 'NVL' in a large, outlined, sans-serif font, followed by 'LABS' in a smaller, outlined, sans-serif font.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116036 Client Sample #: 1-19-MISC-31

Location: N-A

Layer 1 of 1 Description: Beige fibrous material with white paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Paint, Glass debris, Binder/Filler	Glass fibers 45%	None Detected ND
	Cellulose 20%	

Lab ID: 21116037 Client Sample #: 1-8-TSI-32

Location: N-A35

Layer 1 of 1 Description: White fibrous material with painted cloth wrap

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Paint, Calcareous binder	Cellulose 30%	Chrysotile 50%

Lab ID: 21116038 Client Sample #: 1-21-MISC-33

Location: N-A

Layer 1 of 1 Description: Blue laminate with clear adhesive

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Laminate/binder, Fine grains, Adhesive/Binder	Cellulose 56%	None Detected ND

Lab ID: 21116039 Client Sample #: 1-22-MISC-34

Location: N-A

Layer 1 of 2 Description: Brown rubbery material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Rubber/Synthetic Binder	None Detected ND	None Detected ND

Layer 2 of 2 Description: Brown brittle mastic

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Fine particles, Mastic/Binder	Cellulose 2%	None Detected ND

Sampled by: Client

Analyzed by: Munaf Khan

Reviewed by: Evelyn Ahulu

Date: 10/25/2021

Date: 10/25/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116040 Client Sample #: 1-22-MISC-35

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials: Adhesive/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected

Lab ID: 21116041 Client Sample #: 1-23-MISC-36


Location: N-A

Layer 1 of 1	Description: Gray cementitious material			
	Non-Fibrous Materials: Mineral grains, Calcareous binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected

Lab ID: 21116042 Client Sample #: 1-24-MISC-37

Location: N-A

Layer 1 of 3	Description: Beige/light gray vinyl tile			
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 3	Description: Tan brittle mastic			
	Non-Fibrous Materials: Fine particles, Mastic/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected
Layer 3 of 3	Description: Light gray sandy material			
	Non-Fibrous Materials: Calcareous particles, Binder/Filler	Other Fibrous Materials:% Cellulose	6%	Asbestos Type: % None Detected

Sampled by: Client		
Analyzed by: Munaf Khan	Date: 10/25/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116043 Client Sample #: 1-15-MISC-38

Location: N-A

Layer 1 of 2	Description: Beige vinyl tile			
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % Chrysotile 6%

Lab ID: 21116044 Client Sample #: 1-25-MISC-39


Location: N-A

Layer 1 of 2	Description: Black rubbery material			
	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials: Adhesive/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected

Lab ID: 21116045 Client Sample #: 1-26-MISC-40

Location: N-A

Layer 1 of 2	Description: Light brown rubbery material			
	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % None Detected
Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials: Adhesive/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116046 Client Sample #: 1-27-MISC-41

Location: N-A

Layer 1 of 2	Description: Brown vinyl tile			
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % Chrysotile 3%
Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials: Fine particles, Asphalt/Binder	Other Fibrous Materials:% Cellulose	<1%	Asbestos Type: % None Detected ND

Lab ID: 21116047 Client Sample #: 1-28-MISC-42


Location: N-A

Layer 1 of 2	Description: Brown vinyl tile			
	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected	ND	Asbestos Type: % Chrysotile 3%
Layer 2 of 2	Description: Black asphaltic mastic			
	Non-Fibrous Materials: Fine particles, Asphalt/Binder	Other Fibrous Materials:% Cellulose	3%	Asbestos Type: % None Detected ND

Lab ID: 21116048 Client Sample #: 1-18-MISC-43

Location: N-A

Layer 1 of 2	Description: White chalky material with paper			
	Non-Fibrous Materials: Gypsum/Binder	Other Fibrous Materials:% Cellulose	24%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Light gray cementitious material			
	Non-Fibrous Materials: Calcareous particles, Binder/Filler	Other Fibrous Materials:% Cellulose	3%	Asbestos Type: % None Detected ND

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116049 Client Sample #: 1-29-MISC-44

Location: N-A

Layer 1 of 2	Description: White hard plastic like material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Plastic, Binder/Filler	Glass fibers 12%	
Layer 2 of 2	Description: Yellow soft mastic	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Fine particles, Mastic/Binder	Cellulose <1%	

Lab ID: 21116050 Client Sample #: 1-3-MISC-45

Location: N-A

Layer 1 of 1	Description: White crumbly material with green paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Paint, Binder/Filler	Cellulose <1%	

Lab ID: 21116051 Client Sample #: 1-1-TSI-46

Location: N-A

Layer 1 of 1	Description: Yellow fibrous material with metal foil	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %	
		Metal foil, Glass debris	Glass fibers 66%		None Detected ND
			Cellulose 20%		

Lab ID: 21116052 Client Sample #: 1-25-MISC-47

Location: N-A

Layer 1 of 2	Description: Black rubbery material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Rubber/Synthetic Binder	None Detected ND	

Sampled by: Client

Analyzed by: Munaf Khan

Date: 10/25/2021

Reviewed by: Evelyn Ahulu

Date: 10/25/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Clear soft adhesive			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Adhesive/Binder	Cellulose 3%		None Detected ND

Lab ID: 21116053 **Client Sample #: 1-28-MISC-48**

Location: N-A

Layer 1 of 2	Description: Light brown vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		Chrysotile 4%

Layer 2 of 2	Description: Black asphaltic fibrous backing with brown mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Asphalt/Binder	Cellulose 65%		None Detected ND

Lab ID: 21116054 **Client Sample #: 1-30-MISC-49**

Location: N-A


Layer 1 of 2	Description: Black rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Rubber/Synthetic Binder	None Detected ND		None Detected ND

Layer 2 of 2	Description: Beige soft mastic with tan color paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Paint, Fine particles, Mastic/Binder	Cellulose <1%		None Detected ND

Lab ID: 21116055 **Client Sample #: 2-1-MISC-1**

Location: N-A

Layer 1 of 2	Description: Beige vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		None Detected ND

<p>Sampled by: Client</p> <p>Analyzed by: Munaf Khan</p> <p>Reviewed by: Evelyn Ahulu</p>	<p>Date: 10/25/2021</p> <p>Date: 10/25/2021</p>	 <hr/> <p>Evelyn Ahulu, EM Lab Manager</p>
--	---	--

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: Black/gray asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Asphalt/Binder	Cellulose 12%		None Detected ND

Lab ID: 21116056 **Client Sample #: 2-1-MISC-2**

Location: N-A

Layer 1 of 5	Description: Beige vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		None Detected ND

Layer 2 of 5	Description: Light gray sandy material with yellow mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Calcareous particles, Mastic/Binder	Cellulose 4%		None Detected ND

Layer 3 of 5	Description: Black asphaltic mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder	Cellulose <1%		None Detected ND


Layer 4 of 5	Description: Brown vinyl tile			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Mineral grains, Vinyl/Binder	None Detected ND		Chrysotile 8%

Layer 5 of 5	Description: Black asphaltic fibrous felt with mastic			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Asphalt/Binder, Fine particles	Cellulose 65%		None Detected ND

Lab ID: 21116057 **Client Sample #: 2-2-MISC-3**

Location: N-A

Layer 1 of 1	Description: Laminate beige color with clear adhesive			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Laminate/binder, Adhesive/Binder, Fine particles	Cellulose 60%		None Detected ND

Sampled by: Client	
Analyzed by: Munaf Khan	Date: 10/25/2021
Reviewed by: Evelyn Ahulu	Date: 10/25/2021
	 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116058 Client Sample #: 2-3-MISC-4

Location: N-A

Layer 1 of 4	Description: Light brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND
Layer 2 of 4	Description: Black asphaltic mastic	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: Brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % Chrysotile 8%
Layer 4 of 4	Description: Black asphaltic mastic	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND

Lab ID: 21116059 Client Sample #: 2-3-MISC-5


Location: N-A

Layer 1 of 2	Description: Light brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Black asphaltic mastic	Non-Fibrous Materials: Asphalt/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND

Lab ID: 21116060 Client Sample #: 2-4-MISC-6

Location: N-A

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021


 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: Light brown vinyl tile	Non-Fibrous Materials: Mineral grains, Vinyl/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % Chrysotile 3%
Layer 2 of 2	Description: Black asphaltic fibrous felt with mastic	Non-Fibrous Materials: Fine particles, Asphalt/Binder	Other Fibrous Materials:% Cellulose 56%	Asbestos Type: % Chrysotile 6%

Lab ID: 21116061 **Client Sample #: 2-5-MISC-7**
 Location: N-A


Layer 1 of 2	Description: Black rubbery material	Non-Fibrous Materials: Rubber/Synthetic Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Tan soft mastic	Non-Fibrous Materials: Fine particles, Mastic/Binder	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % None Detected ND

Lab ID: 21116062 **Client Sample #: 2-6-TSI-8**
 Location: N-A

Layer 1 of 1	Description: Yellow fibrous material with metal foil wrap	Non-Fibrous Materials: Metal foil, Gypsum/Binder	Other Fibrous Materials:% Glass fibers 64% Cellulose 20%	Asbestos Type: % None Detected ND
---------------------	--	---	--	--

Lab ID: 21116063 **Client Sample #: 2-7-MISC-9**
 Location: N-A

Layer 1 of 1	Description: Light gray soft rubbery material with paint	Non-Fibrous Materials: Paint, Caulking compound, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
---------------------	---	--	---	--

Sampled by: Client
Analyzed by: Munaf Khan **Date:** 10/25/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118227.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116064 Client Sample #: 2-7-MISC-10

Location: N-A

Layer 1 of 1 Description: Light gray soft rubbery material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Paint, Caulking compound, Fine particles	None Detected ND	None Detected ND

Lab ID: 21116065 Client Sample #: 2-8-MISC-11

Location: N-A

Layer 1 of 2 Description: White chalky material with paper

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Gypsum/Binder	Cellulose 22%	None Detected ND

Layer 2 of 2 Description: Tan chalky material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Mica, Gypsum/Binder	Cellulose 3%	None Detected ND

Sampled by: Client

Analyzed by: Munaf Khan

Date: 10/25/2021

Reviewed by: Evelyn Ahulu

Date: 10/25/2021

Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118227.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples**

Lab ID	Sample ID	Description	A/R
1	21116036	1-19-MISC-31	A
2	21116037	1-8-TSI-32	A
3	21116038	1-21-MISC-33	A
4	21116039	1-22-MISC-34	A
5	21116040	1-22-MISC-35	A
6	21116041	1-23-MISC-36	A
7	21116042	1-24-MISC-37	A
8	21116043	1-15-MISC-38	A
9	21116044	1-25-MISC-39	A
10	21116045	1-26-MISC-40	A
11	21116046	1-27-MISC-41	A
12	21116047	1-28-MISC-42	A
13	21116048	1-18-MISC-43	A
14	21116049	1-29-MISC-44	A
15	21116050	1-3-MISC-45	A
16	21116051	1-1-TSI-46	A
17	21116052	1-25-MISC-47	A
18	21116053	1-28-MISC-48	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Munaf Khan		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 10:56 AM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118227.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples**

Lab ID	Sample ID	Description	A/R
19	21116054	1-30-MISC-49	A
20	21116055	2-1-MISC-1	A
21	21116056	2-1-MISC-2	A
22	21116057	2-2-MISC-3	A
23	21116058	2-3-MISC-4	A
24	21116059	2-3-MISC-5	A
25	21116060	2-4-MISC-6	A
26	21116061	2-5-MISC-7	A
27	21116062	2-6-TSI-8	A
28	21116063	2-7-MISC-9	A
29	21116064	2-7-MISC-10	A
30	21116065	2-8-MISC-11	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Munaf Khan		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 10:56 AM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alouji
 Address 2815 2nd Ave #540,
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions _____

Call () - - Fax () - - Email _____

Total Number of Samples _____

Sample ID	Description	A/R
1	1-19-MISC-31	White 18" x 36" ceiling tile w/ randomized stipple pattern
2	1-8-TSI-32	White pipe insulation
3	1-21-MISC-33	Gray blue laminate counter top w/ black and green mastic
4	1-22-MISC-34	Dark Brown base core w/ brown mastic
5	1-22-MISC-35	Dark Brown base core w/ brown mastic
6	1-23-MISC-36	Gray cementitious patching material
7	1-24-MISC-37	Light Gray 12" x 12" vinyl flooring tile w/ gray mastic
8	1-15-MISC-38	Tan 12" x 12" vinyl floor tile w/ black mastic
9	1-25-MISC-39	Black Transition strip w/ Brown mastic
10	1-26-MISC-40	Rubber stair tread w/ clear mastic
11	1-27-MISC-41	Dark brown patterned 9" x 9" vinyl floor tile w/ black mastic
12	1-28-MISC-42	Light tan patterned 9" x 9" vinyl floor tile w/ black mastic
13	1-18-MISC-43	White drywall w/ cementitious wall board
14	1-29-MISC-44	White plastic waterproofing material w/ pale yellow adhesive
15	1-3-MISC-45	Window glazing

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Schmalzer	<i>[Signature]</i>	Nullebs	10/19/21	10:10
Analyzed by					
Called by					
Faxed/Email by					



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #540,
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell ()
 Email _____
 Fax ()

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () Fax () Email ecurtis@maulfoster.com

Total Number of Samples

Sample ID	Description	A/R
1	<u>1-1-TSI-46</u>	<u>White pipe insulation</u>
2	<u>1-25-MISC-47</u>	<u>Black transition strip w/ brown mastic</u>
3	<u>1-28-MISC-48</u>	<u>Light tan patterned 9"x9" vinyl floor tile w/ black mastic</u>
4	<u>1-30-MISC-49</u>	<u>Black base cove w/ tan mastic</u>
5	<u>2-1-MISC-1</u>	<u>White stipple pattern 12"x12" vinyl floor tile w/ black mastic</u>
6	<u>2-1-MISC-2</u>	<u>White stipple pattern 12"x12" vinyl floor tile w/ black mastic</u>
7	<u>2-2-MISC-3</u>	<u>Tan laminate counter top w/ clear mastic</u>
8	<u>2-3-MISC-4</u>	<u>Light brown patterned 9"x9" vinyl floor tile w/ black mastic</u>
9	<u>2-3-MISC-5</u>	<u>Light brown patterned 9"x9" vinyl floor tile w/ black mastic</u>
10	<u>2-4-MISC-6</u>	<u>Brown striped pattern 9"x9" vinyl floor tile w/ black mastic</u>
11	<u>2-5-MISC-7</u>	<u>Black base cove w/ tan mastic</u>
12	<u>2-6-TSI-8</u>	<u>Yellow pipe insulation w/ white papery cover</u>
13	<u>2-7-MISC-9</u>	<u>Window glazing</u>
14	<u>2-7-MISC-10</u>	<u>Window glazing</u>
15	<u>2-8-MISC-11</u>	<u>White drywall w/ cementitious wallboard</u>

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Cannon Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Cannon Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Signature]</u>	<u>[Signature]</u>	<u>Nullebs</u>	<u>10/19/21</u>	<u>10:10am</u>
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 26, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118233.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Munaf Khan, Laboratory Director



Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116110 Client Sample #: 2-8-MISC-12

Location: N-A

Layer 1 of 2	Description: Pale gray brittle sandy material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Calcareous binder, Sand, Mineral grains, Paint	Cellulose <1%		None Detected ND
Layer 2 of 2	Description: Thin layer of Black asphaltic material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Asphalt/Binder	None Detected ND		None Detected ND

Lab ID: 21116111 Client Sample #: 2-9-MISC-13

Location: N-A

Layer 1 of 2	Description: Brown rubbery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Rubber/Binder, Fine grains	None Detected ND		None Detected ND
Layer 2 of 2	Description: Brown brittle mastic			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Mastic/Binder	Talc fibers 3%		None Detected ND
		Cellulose <1%		

Lab ID: 21116112 Client Sample #: 2-10-TSI-14

Location: N-A

Layer 1 of 2	Description: White woven fibrous meshl with paint			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cotton yarn 90%		None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials: %		Asbestos Type: %
	Fine particles	None Detected ND		Chrysotile 25%

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	 <hr style="width: 80%; margin: 0 auto;"/> Munaf Khan, Laboratory Director
Reviewed by: Munaf Khan	Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 1 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles	Cellulose 28%	
	Synthetic fibers 7%	

Lab ID: 21116118 **Client Sample #: 2-13-TSI-20**
 Location: N-A

Layer 1 of 2 **Description:** White woven fibrous mesh with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Binder/Filler, Paint, Fine particles	Cotton yarn 92%	

Layer 2 of 2 **Description:** White compacted fine powdery material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Fine particles, Glass debris	Cellulose 32%	
	Synthetic fibers 5%	

Lab ID: 21116119 **Client Sample #: 2-14-TSI-21**
 Location: N-A


Layer 1 of 2 **Description:** White woven fibrous cloth with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Binder/Filler, Paint	Glass fibers 90%	

Layer 2 of 2 **Description:** White loose-fill fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: % None Detected ND
Glass Resin	Glass fibers 99%	

Lab ID: 21116120 **Client Sample #: 2-13-TSI-22**
 Location: N-A

Sampled by: Client	 Munaf Khan, Laboratory Director
Analyzed by: Nick Ly	
Reviewed by: Munaf Khan	
Date: 10/20/2021	
Date: 10/26/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint	Cotton yarn 93%		None Detected ND
Layer 2 of 2	Description: White and pale gray compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Glass debris	Synthetic fibers 25%		None Detected ND
		Cellulose 5%		
		Glass fibers 3%		

Lab ID: 21116121 **Client Sample #: 2-13-TSI-23**


Location: N-A

Layer 1 of 2	Description: Tan woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint	Cellulose 85%		None Detected ND
Layer 2 of 2	Description: Pale gray compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles, Glass shots & debris	Glass fibers 18%		Amosite 23%
				Chrysotile 15%

Lab ID: 21116122 **Client Sample #: 2-14-TSI-24**

Location: N-A

Layer 1 of 2	Description: White woven fibrous cloth			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler	Glass fibers 95%		None Detected ND

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	
Reviewed by: Munaf Khan	Date: 10/26/2021	Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: White loose-fill fibrous material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Glass resin	Glass fibers 98%		None Detected ND

Lab ID: 21116123 **Client Sample #: 2-13-TSI-25**

Location: N-A

Layer 1 of 1	Description: Off-white compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles	Glass fibers 5%		Amosite 30%

Lab ID: 21116124 **Client Sample #: 2-15-TSI-26**

Location: N-A

Layer 1 of 3	Description: Tan woven fibrous mesh with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint	Cellulose 88%		None Detected ND


Layer 2 of 3	Description: White woven fibrous mesh			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Fine particles	Glass fibers 90%		None Detected ND

Layer 3 of 3	Description: Off-white compacted fine powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Fine particles	None Detected ND		Amosite 23%
				Chrysotile 12%

Lab ID: 21116125 **Client Sample #: 2-15-TSI-27**

Location: N-A

Layer 1 of 2	Description: Tan and white woven fibrous material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cellulose 45%		None Detected ND

Sampled by: Client	
Analyzed by: Nick Ly	Date: 10/20/2021
Reviewed by: Munaf Khan	Date: 10/26/2021
	 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 2	Description: White compacted fine powdery material	Glass fibers 40%	
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Fine particles	None Detected ND	Chrysotile 22%
			Amosite 18%
			Crocidolite 3%

Lab ID: 21116126 Client Sample #: 2-16-TSI-28
 Location: N-A

Layer 1 of 2	Description: Tan woven fibrous material with paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cellulose 85%	None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Fine particles, Mineral grains	None Detected ND	Chrysotile 25%
			Amosite 13%

Lab ID: 21116127 Client Sample #: 2-16-TSI-29
 Location: N-A

Layer 1 of 2	Description: Tan and white woven fibrous material with paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Paint, Fine particles	Cellulose 48%	None Detected ND
		Glass fibers 45%	
Layer 2 of 2	Description: White compacted fine powdery material		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Fine particles, Mineral grains	None Detected ND	Chrysotile 28%

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	
Reviewed by: Munaf Khan	Date: 10/26/2021	Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Amosite 18%

Lab ID: 21116128 Client Sample #: 2-13-TSI-30

Location: N-A

Layer 1 of 2	Description: Tan woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Fine particles	Other Fibrous Materials:% Cellulose 80%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material	Non-Fibrous Materials: Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % Chrysotile 28% Amosite 15%

Lab ID: 21116129 Client Sample #: 2-17-TSI-31

Location: N-A

Layer 1 of 2	Description: Off-white paper with woven fibers and metal foil	Non-Fibrous Materials: Binder/Filler, Metal foil	Other Fibrous Materials:% Cellulose 82% Glass fibers 8%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Yellow loose-fill fibrous material	Non-Fibrous Materials: Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 95%	Asbestos Type: % None Detected ND

Lab ID: 21116130 Client Sample #: 2-17-TSI-32

Location: N-A

Layer 1 of 3	Description: Off-white paper with woven fibers and metal foil	Non-Fibrous Materials: Binder/Filler, Metal foil	Other Fibrous Materials:% Cellulose 78%	Asbestos Type: % None Detected ND
---------------------	--	---	--	--

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	
Reviewed by: Munaf Khan	Date: 10/26/2021	Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

		Glass fibers	10%	
Layer 2 of 3	Description: White flexible sheet vinyl	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Vinyl/Binder	None Detected ND	None Detected ND
Layer 3 of 3	Description: Yellow loose-fill fibrous material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Glass resin	Glass fibers 98%	None Detected ND


Lab ID: 21116131 **Client Sample #: 2-7-MISC-33**
 Location: N-A

Layer 1 of 1	Description: Off-white brittle material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Paint	Cellulose <1%	Chrysotile 3%

Lab ID: 21116132 **Client Sample #: 3-1-TSI-1**
 Location: N-A

Layer 1 of 2	Description: Beige woven fibrous material with paint	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Binder/Filler, Paint, Fine particles	Cellulose 42%	None Detected ND
			Glass fibers 38%	
Layer 2 of 2	Description: Pale gray compacted brittle material	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
		Fine particles, Glass shots & debris	Glass fibers 15%	None Detected ND
			Cellulose 2%	

Lab ID: 21116133 **Client Sample #: 3-1-TSI-2**
 Location: N-A

Sampled by: Client		
Analyzed by: Nick Ly	Date: 10/20/2021	
Reviewed by: Munaf Khan	Date: 10/26/2021	Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: Beige woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Fine particles	Other Fibrous Materials:% Cotton yarn 90%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White compacted fine powdery material	Non-Fibrous Materials: Fine particles	Other Fibrous Materials:% Cellulose 22% Synthetic fibers 8%	Asbestos Type: % None Detected ND


Lab ID: 21116134 **Client Sample #: 3-2-TSI-3**
 Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh	Non-Fibrous Materials: Fine particles	Other Fibrous Materials:% Glass fibers 98%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White loose-fill fibrous material	Non-Fibrous Materials: Glass resin, Fine particles	Other Fibrous Materials:% Glass fibers 99%	Asbestos Type: % None Detected ND

Lab ID: 21116135 **Client Sample #: 3-3-TSI-4**
 Location: N-A

Layer 1 of 2	Description: Tan woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Cellulose 88%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Off-white brittle crumbly material	Non-Fibrous Materials: Binder/Filler, Glass shots & debris	Other Fibrous Materials:% Glass fibers 7% Cellulose 3%	Asbestos Type: % None Detected ND

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/20/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116136 Client Sample #: 3-1-TSI-5

Location: N-A

Layer 1 of 3	Description: White woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Tan woven fibrous material with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White compacted crumbly powdery material	Non-Fibrous Materials: Binder/Filler, Fine particles	Other Fibrous Materials:% Hair 7% Cellulose 5%	Asbestos Type: % None Detected ND

Lab ID: 21116137 Client Sample #: 3-2-TSI-6


Location: N-A

Layer 1 of 2	Description: White woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White loose-fill fibrous material	Non-Fibrous Materials: Glass resin, Fine particles	Other Fibrous Materials:% Glass fibers 99%	Asbestos Type: % None Detected ND

Lab ID: 21116138 Client Sample #: 3-1-TSI-7

Location: N-A

Layer 1 of 3	Description: Tan woven fibrous mesh with paint	Non-Fibrous Materials: Paint, Fine particles	Other Fibrous Materials:% Cellulose 92%	Asbestos Type: % None Detected ND
---------------------	---	---	--	--

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/20/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021 
 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118233.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116


Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 3	Description: Off-white compacted crumbly powdery material	Non-Fibrous Materials: Fine particles, Glass shots & debris	Other Fibrous Materials:% Glass fibers 25% Cellulose 5%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Blue and white flexible sheet vinyl	Non-Fibrous Materials: Vinyl/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND

Lab ID: 21116139 **Client Sample #: 3-4-TSI-8**
 Location: N-A

Layer 1 of 2	Description: Off-white paper with woven fibers and metal foil	Non-Fibrous Materials: Binder/Filler, Metal foil	Other Fibrous Materials:% Cellulose 65% Glass fibers 12%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Tan loose-fill fibrous material	Non-Fibrous Materials: Glass resin	Other Fibrous Materials:% Glass fibers 99%	Asbestos Type: % None Detected ND

Sampled by: Client
Analyzed by: Nick Ly **Date:** 10/20/2021
Reviewed by: Munaf Khan **Date:** 10/26/2021



 Munaf Khan, Laboratory Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118233.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116110	2-8-MISC-12	A
2	21116111	2-9-MISC-13	A
3	21116112	2-10-TSI-14	A
4	21116113	2-11-MISC-15	A
5	21116114	2-12-MISC-16	A
6	21116115	2-11-MISC-17	A
7	21116116	2-12-MISC-18	A
8	21116117	2-13-TSI-19	A
9	21116118	2-13-TSI-20	A
10	21116119	2-14-TSI-21	A
11	21116120	2-13-TSI-22	A
12	21116121	2-13-TSI-23	A
13	21116122	2-14-TSI-24	A
14	21116123	2-13-TSI-25	A
15	21116124	2-15-TSI-26	A
16	21116125	2-15-TSI-27	A
17	21116126	2-16-TSI-28	A
18	21116127	2-16-TSI-29	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/20/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 11:24 AM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118233.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples**

Lab ID	Sample ID	Description	A/R
19	21116128	2-13-TSI-30	A
20	21116129	2-17-TSI-31	A
21	21116130	2-17-TSI-32	A
22	21116131	2-7-MISC-33	A
23	21116132	3-1-TSI-1	A
24	21116133	3-1-TSI-2	A
25	21116134	3-2-TSI-3	A
26	21116135	3-3-TSI-4	A
27	21116136	3-1-TSI-5	A
28	21116137	3-2-TSI-6	A
29	21116138	3-1-TSI-7	A
30	21116139	3-4-TSI-8	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Nick Ly		NVL	10/20/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 11:24 AM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #310
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	White drywall w/ cementitious wallboard	
2	Brown base cove w/ brown mastic	
3	White pipe insulation w/ orange covering	
4	Red 12"x12" brick	
5	Curay brick mortar	
6	Red 12"x12" brick	
7	Curay brick mortar	
8	White pipe insulation w/ silver fabric covering	
9	White pipe insulation w/ silver fabric covering	
10	White fabric pipe insulation	
11	White pipe insulation w/ fabric covering	
12	White pipe insulation w/ fabric covering	
13	White fabric pipe insulation	
14	White pipe insulation w/ red painted fabric covering	
15	White pipe insulation w/ white fabric wrapping	

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<i>[Signature]</i>	<i>[Signature]</i>	<i>[Signature]</i>	10/19/21	10:10am Alex
Analyzed by					
Called by					
Faxed/Email by					

2118233



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #510
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman Hoffman
 Cell () -
 Email
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	2-15-TSI-27	White pipe insulation w/ white fabric wrapping
2	2-16-TSI-28	White boiler insulation w/ silver painted covering
3	2-16-TSI-29	White boiler insulation w/ white patch covering
4	2-13-TSI-30	White pipe insulation w/ fabric covering
5	2-17-TSI-31	Yellow pipe insulation w/ white covering
6	2-17-TSI-32	Yellow pipe insulation w/ white covering
7	2-7-MISC-33	Window glazing
8	3-1-TSI-1	White insulation with silver wrapping on boiler
9	3-1-TSI-2	White pipe insulation with white wrapping
10	3-2-TSI-3	Fabric insulation on pipe coming off of boiler
11	3-3-TSI-4	White insulation on mechanical part
12	3-1-TSI-5	White pipe insulation with white wrapping
13	3-2-TSI-6	White pipe insulation with silver wrapping
14	3-1-TSI-7	White vent insulation with white wrapping
15	3-4-TSI-8	Yellow insulation w/ white wrapping

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Khmalta	<i>[Signature]</i>	Neubels	10/19/21	10:00 AM
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 25, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118237.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 30 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.


For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,


Evelyn Ahulu, EM Lab Manager



Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116162 Client Sample #: 3-1-TSI-9


Location: N-A

Layer 1 of 4	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 5% Glass fibers 3%	Asbestos Type: % None Detected ND
Layer 2 of 4	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 80% Glass fibers 7%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: White powdery material	Non-Fibrous Materials: Calcareous binder, Calcareous particles, Fine grains	Other Fibrous Materials:% Cellulose 8% Glass fibers 6%	Asbestos Type: % None Detected ND
Layer 4 of 4	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Fine particles, Glass debris	Other Fibrous Materials:% Cellulose 45% Glass fibers 20%	Asbestos Type: % None Detected ND

Lab ID: 21116163 Client Sample #: 3-3-TSI-10

Location: N-A

Layer 1 of 4	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Glass debris	Other Fibrous Materials:% Cellulose 3% Glass fibers <1%	Asbestos Type: % None Detected ND
---------------------	--	--	---	--

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116


Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 4	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Fine particles, Glass debris	Other Fibrous Materials:% Cellulose 5% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: White powdery material	Non-Fibrous Materials: Calcareous particles, Calcareous binder, Fine grains	Other Fibrous Materials:% Cellulose 4% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 4 of 4	Description: Gray crumbly material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Cellulose 6% Glass fibers 82%	Asbestos Type: % None Detected ND

Lab ID: 21116164 **Client Sample #: 4-1-TSI-1**

Location: N-A

Layer 1 of 3	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 4% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Yellow woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 85%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose <1%	Asbestos Type: % Chrysotile 15%

Sampled by: Client	
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	Evelyn Ahulu, EM Lab Manager
Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A


Amosite 30%

Lab ID: 21116165	Client Sample #: 4-2-TSI-2		
Location: N-A			
Layer 1 of 2	Description: White fibrous felt with brown paint		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Paint, Binder/Filler	Cellulose 75%	None Detected ND
Layer 2 of 2	Description: White crumbly material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Debris, Fine particles	Cellulose 7%	Amosite 30% Chrysotile 10%

Lab ID: 21116166	Client Sample #: 4-3-MISC-3		
Location: N-A			
Layer 1 of 1	Description: Yellow fibrous material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Glass debris	Glass fibers 85%	None Detected ND

Lab ID: 21116167	Client Sample #: 4-3-MISC-4		
Location: N-A			
Layer 1 of 1	Description: Yellow fibrous material		
	Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
	Binder/Filler, Glass debris	Glass fibers 82%	None Detected ND

Lab ID: 21116168	Client Sample #: 4-4-MISC-5		
Location: N-A			

Sampled by: Client	
Analyzed by: Hieu Ta	Date: 10/21/2021
Reviewed by: Evelyn Ahulu	Date: 10/25/2021
	 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: Beige laminate	Non-Fibrous Materials: Fine particles, Synthetic/Binder	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Brown fibrous material	Non-Fibrous Materials: Binder/Filler, Wood flakes, Debris	Other Fibrous Materials:% Cellulose 88%	Asbestos Type: % None Detected ND


Lab ID: 21116169 **Client Sample #: 4-1-TSI-6**

Location: N-A

Layer 1 of 4	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 6% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 2 of 4	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND
Layer 3 of 4	Description: Brown woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 87%	Asbestos Type: % None Detected ND
Layer 4 of 4	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % Chrysotile 20% Amosite 30%

Lab ID: 21116170 **Client Sample #: 4-2-TSI-7**

Location: N-A

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 2	Description: White woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Debris	Other Fibrous Materials:% Cellulose 90%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 8%	Asbestos Type: % Chrysotile 22% Amosite 25%

Lab ID: 21116171 Client Sample #: 4-5-TSI-8
 Location: N-A

Layer 1 of 2	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 88%	Asbestos Type: % None Detected ND

Lab ID: 21116172 Client Sample #: 4-5-TSI-9
 Location: N-A

Layer 1 of 2	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND

Lab ID: 21116173 Client Sample #: 4-1-TSI-10
 Location: N-A

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 3	Description: White woven fibrous material with paint	Non-Fibrous Materials: Binder/Filler, Glass debris, Paint	Other Fibrous Materials:% Cellulose 3% Glass fibers 85%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: Yellow woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 80%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % Chrysotile 20% Amosite 25%


Lab ID: 21116174 **Client Sample #: 4-5-TSI-11**

Location: N-A

Layer 1 of 3	Description: Brown crumbly material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 4%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Yellow fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 86%	Asbestos Type: % None Detected ND

Lab ID: 21116175 **Client Sample #: 4-6-TSI-12**

Location: N-A

Sampled by: Client	
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	Evelyn Ahulu, EM Lab Manager
Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A


Layer 1 of 3	Description: Brittle red/silver paint Non-Fibrous Materials: Paint/Binder, Debris, Fine particles	Other Fibrous Materials:% Cellulose 9%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: White woven fibrous material with paint Non-Fibrous Materials: Binder/Filler, Debris, Paint	Other Fibrous Materials:% Cellulose 85%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material Non-Fibrous Materials: Binder/Filler, Debris, Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % Chrysotile 28% Amosite 22%

Lab ID: 21116176 **Client Sample #: 4-5-TSI-13**
 Location: N-A

Layer 1 of 2	Description: White woven fibrous material Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 90%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Yellow fibrous material Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 87%	Asbestos Type: % None Detected ND

Lab ID: 21116177 **Client Sample #: 4-7-TSI-14**
 Location: N-A

Layer 1 of 6	Description: White/silver paint Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 5% Glass fibers <1%	Asbestos Type: % None Detected ND
---------------------	--	---	--

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021 
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116


Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 2 of 6	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 82%	Asbestos Type: % None Detected ND
Layer 3 of 6	Description: Off-white woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 85%	Asbestos Type: % None Detected ND
Layer 4 of 6	Description: Silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 3% Glass fibers <1%	Asbestos Type: % None Detected ND
Layer 5 of 6	Description: Brown crumbly material with metal foil	Non-Fibrous Materials: Binder/Filler, Debris, Metal foil	Other Fibrous Materials:% Cellulose 5% Glass fibers 2%	Asbestos Type: % None Detected ND
Layer 6 of 6	Description: Yellow foamy fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 88%	Asbestos Type: % None Detected ND

Lab ID: 21116178 **Client Sample #: 4-7-TSI-15**

Location: N-A

Layer 1 of 3	Description: White mastic with red paint and metal foil	Non-Fibrous Materials: Binder/Filler, Metal foil, Paint	Other Fibrous Materials:% Cellulose 8% Glass fibers <1%	Asbestos Type: % None Detected ND
---------------------	--	--	---	--

Sampled by: Client	
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	Evelyn Ahulu, EM Lab Manager
Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A


Layer 2 of 3	Description: Brown fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 25% Glass fibers 2%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: Yellow fibrous material	Non-Fibrous Materials: Binder/Filler, Glass debris, Fine particles	Other Fibrous Materials:% Glass fibers 89%	Asbestos Type: % None Detected ND

Lab ID: 21116179 **Client Sample #: 4-8-MISC-16**
 Location: N-A

Layer 1 of 1	Description: Charcoal gray fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 2%	Asbestos Type: % Chrysotile 90%
---------------------	--	---	---	--

Lab ID: 21116180 **Client Sample #: 4-1-TSI-17**
 Location: N-A

Layer 1 of 3	Description: Flaky silver paint	Non-Fibrous Materials: Paint/Binder, Debris	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % None Detected ND
Layer 2 of 3	Description: White woven fibrous material	Non-Fibrous Materials: Binder/Filler, Debris	Other Fibrous Materials:% Cellulose 88%	Asbestos Type: % None Detected ND
Layer 3 of 3	Description: White crumbly material	Non-Fibrous Materials: Binder/Filler, Calcareous particles, Debris	Other Fibrous Materials:% Cellulose 3%	Asbestos Type: % Chrysotile 30% Amosite 20%

Sampled by: Client	 Evelyn Ahulu, EM Lab Manager
Analyzed by: Hieu Ta	
Reviewed by: Evelyn Ahulu	
Date: 10/21/2021	Date: 10/25/2021

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116181 Client Sample #: 4-7-TSI-18

Location: N-A

Layer 1 of 2 Description: Brown fibrous material with red paint and metal foil

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Paint, Metal foil, Glass debris	Glass fibers 90%	
	Cellulose 3%	

None Detected ND

Layer 2 of 2 Description: Yellow foamy fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 86%	

None Detected ND

Lab ID: 21116182 Client Sample #: 4-7-TSI-19

Location: N-A

Layer 1 of 2 Description: Soft white thin vinyl sheet with silver paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Paint, Vinyl/Binder	Cellulose 3%	

None Detected ND

Layer 2 of 2 Description: Yellow fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 85%	

None Detected ND

Lab ID: 21116183 Client Sample #: 4-2-TSI-20

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Debris	Cellulose 90%	


None Detected ND

Layer 2 of 2 Description: White crumbly material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
Binder/Filler, Debris, Fine particles	Cellulose 2%	

Amosite 50%

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021


 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116184 Client Sample #: 4-5-TSI-21

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with black fibrous banding

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 84%	None Detected ND
	Synthetic fibers 10%	

Layer 2 of 2 Description: Yellow fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 88%	None Detected ND

Lab ID: 21116185 Client Sample #: 4-2-TSI-22

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Paint, Debris	Cellulose 90%	None Detected ND

Layer 2 of 2 Description: White crumbly material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Debris, Fine particles	Cellulose 3%	Amosite 48%

Lab ID: 21116186 Client Sample #: 4-9-TSI-23

Location: N-A

Layer 1 of 2 Description: White woven fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 88%	None Detected ND

Layer 2 of 2 Description: White crumbly material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Debris, Fine particles	Cellulose 3%	Chrysotile 22%

Sampled by: Client
Analyzed by: Hieu Ta **Date:** 10/21/2021
Reviewed by: Evelyn Ahulu **Date:** 10/25/2021
 Evelyn Ahulu, EM Lab Manager

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Amosite 28%

Lab ID: 21116187 Client Sample #: 4-8-MISC-24

Location: N-A

Layer 1 of 2	Description: Flaky silver paint			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Paint/Binder, Debris, Fine particles	Cellulose 3%		Chrysotile 6%
Layer 2 of 2	Description: Gray/white fibrous felt			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Binder/Filler, Debris, Fine particles	Cellulose 5%		Chrysotile 85%

Lab ID: 21116188 Client Sample #: 4-2-TSI-25

Location: N-A

Layer 1 of 2	Description: White woven fibrous material with paint			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Binder/Filler, Debris, Paint	Cellulose 88%		None Detected ND
Layer 2 of 2	Description: White crumbly material			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Binder/Filler, Debris, Fine particles	Cellulose 5%		Chrysotile 15% Amosite 33%

Lab ID: 21116189 Client Sample #: 4-5-TSI-26

Location: N-A

Layer 1 of 1	Description: White woven fibrous felt			Asbestos Type: %
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Binder/Filler, Paint, Fine particles	Glass fibers 80%		None Detected ND

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118237.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 30
 Samples Analyzed: 30
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116190 Client Sample #: 4-7-TSI-27

Location: N-A

Layer 1 of 2 Description: White fibrous material with paper and metal foil

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Glass debris, Metal foil	Cellulose 30%	
	Glass fibers 65%	

Layer 2 of 2 Description: Yellow fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Glass debris, Fine particles	Glass fibers 87%	

Lab ID: 21116191 Client Sample #: 4-7-TSI-28


Location: N-A

Layer 1 of 2 Description: White synthetic material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Synthetic/Binder	None Detected ND	

Layer 2 of 2 Description: Yellow foamy fibrous material

Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: % None Detected ND
Binder/Filler, Glass debris, Fine particles	Glass fibers 94%	

Sampled by: Client		
Analyzed by: Hieu Ta	Date: 10/21/2021	 Evelyn Ahulu, EM Lab Manager
Reviewed by: Evelyn Ahulu	Date: 10/25/2021	

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118237.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples**

Lab ID	Sample ID	Description	A/R
1	21116162	3-1-TSI-9	A
2	21116163	3-3-TSI-10	A
3	21116164	4-1-TSI-1	A
4	21116165	4-2-TSI-2	A
5	21116166	4-3-MISC-3	A
6	21116167	4-3-MISC-4	A
7	21116168	4-4-MISC-5	A
8	21116169	4-1-TSI-6	A
9	21116170	4-2-TSI-7	A
10	21116171	4-5-TSI-8	A
11	21116172	4-5-TSI-9	A
12	21116173	4-1-TSI-10	A
13	21116174	4-5-TSI-11	A
14	21116175	4-6-TSI-12	A
15	21116176	4-5-TSI-13	A
16	21116177	4-7-TSI-14	A
17	21116178	4-7-TSI-15	A
18	21116179	4-8-MISC-16	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Hieu Ta		NVL	10/21/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions:

Date: 10/19/2021
 Time: 12:00 PM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc. **NVL Batch Number** **2118237.00**
Address 109 E 13th St. **TAT** 5 Days **AH** No
 Vancouver, WA 98660 **Rush TAT**
Project Manager Mrs. Emily Curtis **Due Date** 10/26/2021 **Time** 10:10 AM
Phone (971) 544-2139 **Email** ecurtis@maulfoster.com
Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 30 **Rush Samples** _____

	Lab ID	Sample ID	Description	A/R
19	21116180	4-1-TSI-17		A
20	21116181	4-7-TSI-18		A
21	21116182	4-7-TSI-19		A
22	21116183	4-2-TSI-20		A
23	21116184	4-5-TSI-21		A
24	21116185	4-2-TSI-22		A
25	21116186	4-9-TSI-23		A
26	21116187	4-8-MISC-24		A
27	21116188	4-2-TSI-25		A
28	21116189	4-5-TSI-26		A
29	21116190	4-7-TSI-27		A
30	21116191	4-7-TSI-28		A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Hieu Ta		NVL	10/21/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:00 PM
 Entered By: Fatima Khan



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	3-1-TSI-9 White vent insulation w/white wrapping	
2	3-3-TSI-10 White insulation on mechanical part	
3	3-10-PB-1 4-1-TSI-1 White insulation with silver fabric patch	
4	4-2-TSI-2 White insulation with orange-painted wrap	
5	4-3-MISC-3 Brown soundproofing wall pad	
6	4-3-MISC-4 Brown soundproofing wall pad	
7	4-4-MISC-5 Off-white laminate tabletop with clear adhesive	
8	4-1-TSI-6 ^{SPM} White insulation with orange-painted wrap	
9	4-2-TSI-7 White insulation with silver fabric patch	
10	4-5-TSI-8 Silver steam pipe fabric wrap	
11	4-5-TSI-9 Silver steam pipe fabric wrap	
12	4-1-TSI-10 White insulation with silver fabric patch	
13	4-6-TSI-11 Silver steam pipe fabric wrap	
14	4-6-TSI-12 Red steam pipe fabric wrap	
15	4-5-TSI-13 Silver steam pipe fabric wrap	

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Edmattan	<i>[Signature]</i>	Nucleus	10/19/21	10:00am
Analyzed by					
Called by					
Faxed/Email by					

2118237



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

1 Hour 24 Hours 4 Days

2 Hours 2 Days 5 Days

4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi

Address 2815 2nd Ave #540
Seattle, WA 98121

Phone 503-410-1524

Project Manager _____

Cell () _____

Email _____

Fax () _____

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400)
- PLM (EPA 600/R-93-116)
- PLM Gravimetry (600/R-93-116)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116)
- TEM (NIOSH 7402)
- EPA 400 Points (600/R-93-116)
- Asbestos in Vermiculite (EPA 600/R-04/004)
- Other _____
- TEM (AHERA)
- EPA 1000Points (600/R-93-116)
- Asbestos in Sediment (EPA 1900 Points)

Reporting Instructions Report to Emily Curtis

Call () _____

Fax () _____

Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	Silver steam pipe fabric wrap w/ yellow insulation	
2	Red steam pipe fabric wrap w/ yellow insulation	
3	Silver woven heat-resistant seal material on hatch interior	
4	White insulation w/ silver fabric patch on machinery	
5	Orange steam pipe fabric wrap w/ yellow insulation	
6	Orange steam pipe fabric wrap w/ yellow insulation	
7	White insulation w/ orange-painted wrap	
8	Silver steam pipe fabric wrap	
9	White insulation w/ white-painted wrap	
10	White tank insulation w/ grey painted wrap & plastic patch	
11	Silver woven heat-resistant seal material on hatch interior	
12	White insulation w/ orange-painted wrap	
13	Silver steam pipe fabric wrap	
14	White condensate pipe w/ yellow insulation	
15	White condensate line elbow w/ yellow insulation	

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>[Signature]</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>[Signature]</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<i>[Signature]</i>	<i>[Signature]</i>	Mulleys	10/19/21	10:00 AM
Analyzed by					
Called by					
Faxed/Email by					

8

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 26, 2021



Emily Curtis
Maul Foster & Alongi, Inc.
109 E 13th St.
Vancouver, WA 98660

RE: Bulk Asbestos Fiber Analysis; NVL Batch # 2118240.00

Client Project: 0457.02.03-01
Location: N-A

Dear Mrs. Curtis,

Enclosed please find test results for the 26 sample(s) submitted to our laboratory for analysis on 10/19/2021.

Examination of these samples was conducted for the presence of identifiable asbestos fibers using polarized light microscopy (PLM) with dispersion staining in accordance with **U. S. EPA 40 CFR Appendix E to Subpart E of Part 763**, Interim Method for the Determination of Asbestos in Bulk Insulation Samples and **EPA 600/R-93/116**, Method for the Determination of Asbestos in Bulk Building Materials.

For samples containing more than one separable layer of materials, the report will include findings for each layer (labeled Layer 1 and Layer 2, etc. for each individual layer). The asbestos concentration in the sample is determined by calibrated visual estimation.

For those samples with asbestos concentrations between 1 and 10 percent based on visual estimation, the EPA recommends a procedure known as point counting (NESHAPS, 40 CFR Part 61). Point counting is a statistically more accurate means of quantification for samples with low concentrations of asbestos.

The detection limit for the calibrated visual estimation is <1%, 400 point counts is 0.25% and 1000 point counts is 0.1%

Samples are archived for two weeks following analysis. Samples that are not retrieved by the client are discarded after two weeks.

Thank you for using our laboratory services. Please do not hesitate to call if there is anything further we can assist you with.

Sincerely,

A handwritten signature in black ink, appearing to read "Nick Ly".

Nick Ly, Technical Director

The logo for NVL LABS, featuring the letters "NVL" in a large, outlined, sans-serif font, followed by "LABS" in a smaller, outlined, sans-serif font.

Lab Code: 102063-0

Enc.: Sample Results

Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660


Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116209	Client Sample #: 4-2-TSI-29		
Location: N-A			
Layer 1 of 2	Description: Thin silver paint over fibrous mesh		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Metallic paint, Fine particles, Binder/Filler	Cellulose 70%	None Detected ND
Layer 2 of 2	Description: White powdery fibrous material with paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Paint, Fine particles	None Detected ND	Amosite 40%

Lab ID: 21116210	Client Sample #: 4-8-MISC-30		
Location: N-A			
Layer 1 of 2	Description: White interwoven fibrous material with paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Paint, Binder/Filler, Fine particles	Cellulose 10%	Chrysotile 80%
	Debris		
Layer 2 of 2	Description: Gray fibrous mesh		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Fine particles	Cellulose 98%	None Detected ND

Lab ID: 21116211	Client Sample #: 4-2-TSI-31		
Location: N-A			
Layer 1 of 3	Description: Silver paint		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Metallic paint, Fine particles	None Detected ND	None Detected ND
Layer 2 of 3	Description: White interwoven fibrous mesh		
	Non-Fibrous Materials:	Other Fibrous Materials: %	Asbestos Type: %
	Binder/Filler, Fine particles	Glass fibers 98%	None Detected ND

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 3 of 3 **Description:** Light brown crumbly powdery fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Glass debris, Fine particles	Glass fibers 60%	None Detected ND
	Cellulose 10%	

Lab ID: 21116212 **Client Sample #: 4-9-TSI-32**

Location: N-A

Comments: Unsure of correct layer sequence.

Layer 1 of 2 **Description:** Light gray crumbly powdery fibrous material with paint

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Paint, Glass debris	Glass fibers 65%	None Detected ND
Fine particles		

Layer 2 of 2 **Description:** Gray crumbly fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Fine grains, Fine particles	Cellulose 12%	Chrysotile 40%

Lab ID: 21116213 **Client Sample #: 4-7-TSI-33**

Location: N-A

Layer 1 of 2 **Description:** Silver foil with fibrous mesh, paint and paper

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Paint, Metal foil	Cellulose 30%	None Detected ND
Fine particles	Glass fibers 20%	

Layer 2 of 2 **Description:** Orange fibrous material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Fine particles, Glass debris	Glass fibers 98%	None Detected ND

Sampled by: Client

Analyzed by: Michael Jenkins

Reviewed by: Nick Ly

Date: 10/25/2021

Date: 10/26/2021

Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116214 Client Sample #: 4-10-MISC-34

Location: N-A

Layer 1 of 1	Description: Light gray brittle sandy material	Non-Fibrous Materials: Binder/Filler, Sand, Fine grains Fine particles	Other Fibrous Materials:% Cellulose 5%	Asbestos Type: % None Detected ND
---------------------	---	--	---	--

Lab ID: 21116215 Client Sample #: 4-11-MISC-35


Location: N-A

Layer 1 of 2	Description: Red brick	Non-Fibrous Materials: Brick, Fine grains, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: Light gray cementitious material	Non-Fibrous Materials: Cement/Binder, Fine grains, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND

Lab ID: 21116216 Client Sample #: 4-12-MISC-36

Location: N-A

Layer 1 of 2	Description: White brittle fibrous material	Non-Fibrous Materials: Binder/Filler, Fine particles, Debris	Other Fibrous Materials:% Glass fibers 50%	Asbestos Type: % None Detected ND
Layer 2 of 2	Description: White soft adhesive with paint and debris	Non-Fibrous Materials: Adhesive/Binder, Paint, Debris Fine grains, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	_____ Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116217 Client Sample #: 4-13-MISC-37

Location: N-A

Layer 1 of 2	Description: White compacted powdery material			Asbestos Type: % None Detected ND
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Calcareous binder, Calcareous particles	Cellulose	2%	
Layer 2 of 2	Description: Gray crumbly material with paint			Asbestos Type: % None Detected ND
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Binder/Filler, Fine grains, Fine particles	None Detected	ND	

Lab ID: 21116218 Client Sample #: 4-14-MISC-38


Location: N-A

Layer 1 of 2	Description: Black crumbly vinyl			Asbestos Type: % None Detected ND
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Vinyl/Binder, Fine grains, Fine particles	None Detected	ND	
Layer 2 of 2	Description: Clear soft adhesive			Asbestos Type: % None Detected ND
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Adhesive/Binder, Debris, Fine particles	Cellulose	4%	

Lab ID: 21116219 Client Sample #: 4-15-MISC-39

Location: N-A

Layer 1 of 3	Description: White crumbly vinyl			Asbestos Type: % None Detected ND
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Vinyl/Binder, Fine grains, Fine particles	None Detected	ND	
Layer 2 of 3	Description: Yellow brittle adhesive with debris and paint			Asbestos Type: % None Detected ND
	Non-Fibrous Materials:	Other Fibrous Materials:%		
	Adhesive/Binder, Debris, Fine particles	Cellulose	3%	
	Paint			

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	_____ Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID: 21116223 Client Sample #: EXT-3-MISC-3

Location: N-A

Layer 1 of 1 Description: Clear soft/elastic material with debris

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Debris, Fine particles	None Detected ND	None Detected ND
Sand		

Lab ID: 21116224 Client Sample #: EXT-1-MISC-4

Location: N-A

Layer 1 of 1 Description: Red brick

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Brick, Fine grains, Fine particles	None Detected ND	None Detected ND

Lab ID: 21116225 Client Sample #: EXT-2-MISC-5

Location: N-A

Layer 1 of 1 Description: Loose gray cementitious material

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Cement/Binder, Sand, Debris	None Detected ND	None Detected ND
Fine grains, Fine particles, Mica		

Lab ID: 21116226 Client Sample #: EXT-3-MISC-6


Location: N-A

Layer 1 of 1 Description: Light gray soft/elastic material with debris

Non-Fibrous Materials:	Other Fibrous Materials:%	Asbestos Type: %
Binder/Filler, Debris, Fine particles	None Detected ND	None Detected ND

Lab ID: 21116227 Client Sample #: EXT-4-MISC-7

Location: N-A

Sampled by: Client		
Analyzed by: Michael Jenkins	Date: 10/25/2021	
Reviewed by: Nick Ly	Date: 10/26/2021	_____ Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Layer 1 of 3	Description: Tan and white ceramic with debris			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Ceramic/Binder, Debris, Fine particles	None Detected ND		None Detected ND
Layer 2 of 3	Description: Off-white brittle material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Fine grains, Fine particles	None Detected ND		None Detected ND
Layer 3 of 3	Description: Light brown brittle material with paint			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Paint, Fine particles	None Detected ND		Chrysotile 6%

Lab ID: 21116232 **Client Sample #: 4-18-MISC-43**

Location: N-A

Layer 1 of 2	Description: White brittle powdery material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Fine grains, Fine particles	Cellulose 3%		None Detected ND
	Gypsum particles			
Layer 2 of 2	Description: Off-white brittle sandy material			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Binder/Filler, Sand, Fine grains	Cellulose 10%		None Detected ND
	Fine particles, Gypsum particles			

Lab ID: 21116233 **Client Sample #: 4-19-MISC-44**

Location: N-A

Layer 1 of 2	Description: Off-white ceramic with white glaze and sandy debris			
	Non-Fibrous Materials:	Other Fibrous Materials:%		Asbestos Type: %
	Ceramic/Binder, Sand, Fine particles	None Detected ND		None Detected ND

Sampled by: Client

Analyzed by: Michael Jenkins

Reviewed by: Nick Ly

Date: 10/25/2021

Date: 10/26/2021

Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government



Bulk Asbestos Fibers Analysis

By Polarized Light Microscopy

Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118240.00
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 26
 Samples Analyzed: 26
 Method: EPA/600/R-93/116

Attention: Mrs. Emily Curtis
 Project Location: N-A

Fine grains

Layer 2 of 2	Description: Brown crumbly material with paint	Non-Fibrous Materials: Binder/Filler, Paint, Fine particles	Other Fibrous Materials:% Cellulose 6%	Asbestos Type: % Chrysotile 15%
---------------------	---	--	---	--

Lab ID: 21116234 **Client Sample #: 4-18-MISC-45**

Location: N-A

Layer 1 of 2	Description: Light gray brittle powdery material	Non-Fibrous Materials: Binder/Filler, Mica, Fine particles	Other Fibrous Materials:% None Detected ND	Asbestos Type: % None Detected ND
---------------------	---	---	---	--

Layer 2 of 2	Description: White chalky material with paper	Non-Fibrous Materials: Gypsum/Binder, Fine particles	Other Fibrous Materials:% Cellulose 35% Glass fibers 8%	Asbestos Type: % None Detected ND
---------------------	--	---	---	--

Sampled by: Client

Analyzed by: Michael Jenkins

Reviewed by: Nick Ly

Date: 10/25/2021

Date: 10/26/2021

Nick Ly, Technical Director

Note: If samples are not homogeneous, then subsamples of the components were analyzed separately. All bulk samples are analyzed using both EPA 600/R-93/116 and 600/M4-82-020 Methods with the following measurement uncertainties for the reported % Asbestos (1%=0-3%, 5%=1-9%, 10%=5-15%, 20%=10-30%, 50%=40-60%). This report relates only to the items tested. If sample was not collected by NVL personnel, then the accuracy of the results is limited by the methodology and acuity of the sample collector. This report shall not be reproduced except in full, without written approval of NVL Laboratories, Inc. It shall not be used to claim product endorsement by NVLAP or any other agency of the US Government

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118240.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01	Project Location: N-A
---	------------------------------

Subcategory PLM Bulk

Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 26 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116209	4-2-TSI-29	A
2	21116210	4-8-MISC-30	A
3	21116211	4-2-TSI-31	A
4	21116212	4-9-TSI-32	A
5	21116213	4-7-TSI-33	A
6	21116214	4-10-MISC-34	A
7	21116215	4-11-MISC-35	A
8	21116216	4-12-MISC-36	A
9	21116217	4-13-MISC-37	A
10	21116218	4-14-MISC-38	A
11	21116219	4-15-MISC-39	A
12	21116220	4-16-MISC-40	A
13	21116221	EXT-1-MISC-1	A
14	21116222	EXT-2-MISC-2	A
15	21116223	EXT-3-MISC-3	A
16	21116224	EXT-1-MISC-4	A
17	21116225	EXT-2-MISC-5	A
18	21116226	EXT-3-MISC-6	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Michael Jenkins		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:25 PM
 Entered By: Fatima Khan

ASBESTOS LABORATORY SERVICES



Company Maul Foster & Alongi, Inc. **NVL Batch Number** **2118240.00**
Address 109 E 13th St. **TAT** 5 Days **AH** No
 Vancouver, WA 98660 **Rush TAT** _____
Project Manager Mrs. Emily Curtis **Due Date** 10/26/2021 **Time** 10:10 AM
Phone (971) 544-2139 **Email** ecurtis@maulfoster.com
Fax _____

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory PLM Bulk
Item Code ASB-02 EPA 600/R-93-116 Asbestos by PLM <bulk>

Total Number of Samples 26 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
19	21116227	EXT-4-MISC-7	A
20	21116228	3-8-MISC-11	A
21	21116229	3-8-MISC-12	A
22	21116230	4-17-MISC-41	A
23	21116231	4-17-MISC-42	A
24	21116232	4-18-MISC-43	A
25	21116233	4-19-MISC-44	A
26	21116234	4-18-MISC-45	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Michael Jenkins		NVL	10/25/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:25 PM
 Entered By: Fatima Khan



2118240

ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alongi
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-440-1524

Project Manager Matt Hoffman
 Cell () -
 Email _____
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R	
1	<u>4-2-TSI-29</u>	<u>White insulation with silver-painted wrap</u>	
2	<u>4-8-MISC-30</u>	<u>Silver woven heat-resistant seal material on hatch interior</u>	
3	<u>4-2-TSI-31</u>	<u>White insulation w/ silver painted wrap</u>	
4	<u>4-9-TSI-32</u>	<u>White tank insulation w/ orange wrap</u>	
5	<u>4-7-TSI-33</u>	<u>Yellow insulation with red-painted silver wrap</u>	
6	<u>4-10-MISC-34</u>	<u>Gray brick mortar</u>	
7	<u>4-11-MISC-35</u>	<u>Red brick</u>	
8	<u>4-12-MISC-36</u>	<u>White textured waterproofing tile</u>	
9	<u>4-13-MISC-37</u>	<u>Window glazing</u>	
10	<u>4-14-MISC-38</u>	<u>Black 12x12 linoleum floor tile w/ yellow adhesive</u>	
11	<u>4-15-MISC-39</u>	<u>White 12x12 linoleum floor tile w/ yellow adhesive</u>	
12	<u>4-16-MISC-40</u>	<u>Black base core w/ yellow adhesive</u>	
13	<u>5-16 EXT-1-MISC-1</u>	<u>Red Brick</u>	
14	<u>EXT-2-MISC-2</u>	<u>Caray brick mortar</u>	
15	<u>EXT-3-MISC-3</u>	<u>Window glazing</u>	

	Print Name	Signature	Company	Date	Time
Sampled by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by	<u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	<u>[Signature]</u>	<u>[Signature]</u>	<u>Muller</u>	<u>10/19/21</u>	<u>10:10am</u>
Analyzed by					
Called by					
Faxed/Email by					



ASBESTOS CHAIN OF CUSTODY

Turn Around Time

- 1 Hour 24 Hours 4 Days
- 2 Hours 2 Days 5 Days
- 4 Hours 3 Days 10 Days

Please call for TAT less than 24 Hours

Company Maul Foster & Alougi
 Address 2815 2nd Ave #540
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () - -
 Email _____
 Fax () - -

Project Name/Number	Project Location
---------------------	------------------

- PCM Air (NIOSH 7400) TEM (NIOSH 7402) TEM (AHERA) TEM (EPA Level II Modified)
- PLM (EPA 600/R-93-116) EPA 400 Points (600/R-93-116) EPA 1000Points (600/R-93-116)
- PLM Gravimetry (600/R-93-116) Asbestos in Vermiculite (EPA 600/R-04/004) Asbestos in Sediment (EPA 1900 Points)
- Asbestos Friable/Non-Friable (EPA 600/R-93/116) Other _____

Reporting Instructions Report to Emily Curtis

Call () - - Fax () - - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	EXT-1-MISC-4 Red Brick	
2	EXT-2-MISC-5 Gray brick mortar	
3	EXT-3-MISC-6 Window glazing	
4	EXT-4-MISC-7 White brick caulking	
5	3-8-MISC-11 Window Glazing	
6	3-8-MISC-12 Window Glazing	
7	4-17-MISC-41 Tan 1"-2" square tile w/ brown adhesive	
8	4-17-MISC-42 Tan 1"-2" square tile w/ brown adhesive	
9	4-18-MISC-43 White drywall w/ gray cementitious wallboard	
10	4-19-MISC-44 Tan base coat w/ green adhesive	
11	4-18-MISC-45 White drywall w/ gray cementitious wallboard	
12		
13		
14		
15		

Print Name	Signature	Company	Date	Time
Sampled by <u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/15/21</u>	<u>0800</u>
Relinquish by <u>Connor Anderson</u>	<u>[Signature]</u>	<u>MFA</u>	<u>10/17/21</u>	<u>1350</u>

Office Use Only

Print Name	Signature	Company	Date	Time
Received by <u>[Signature]</u>	<u>[Signature]</u>	<u>neulabs</u>	<u>10/16/21</u>	<u>10:00am</u>
Analyzed by _____				
Called by _____				
Faxed/Email by _____				

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

October 22, 2021

Emily Curtis

Maul Foster & Alongi, Inc.

109 E 13th St.

Vancouver, WA 98660



NVL Batch # 2118241.00

RE: Total Metal Analysis
Method: EPA 7000B Lead by FAA <paint>
Item Code: FAA-02

Client Project: 0457.02.03-01

Location: N-A

Dear Mrs. Curtis,

NVL Labs received 11 sample(s) for the said project on 10/19/2021. Preparation of these samples was conducted following protocol outlined in EPA 3051/7000B , unless stated otherwise. Analysis of these samples was performed using analytical instruments in accordance with EPA 7000B Lead by FAA <paint>. The results are usually expressed in mg/Kg and percentage (%). Test results are not blank corrected.

For recent regulation updates pertaining to current regulatory levels or permissible exposure levels, please call your local regulatory agencies for more detail.

At NVL Labs all analyses are performed under strict guidelines of the Quality Assurance Program. This report is considered highly confidential and will not be released without your approval. Samples are archived after two weeks from the analysis date. Please feel free to contact us at 206-547-0100, in case you have any questions or concerns.

Sincerely,

A handwritten signature in black ink, appearing to read 'Shalini Patel'.

Shalini Patel, Lab Supervisor

Enc.: Sample results



Phone: 206 547.0100 | Fax: 206 634.1936 | Toll Free: 1.888.NVL.LABS (685.5227)
4708 Aurora Avenue North | Seattle, WA 98103-6516

Analysis Report

Total Lead (Pb)



Client: Maul Foster & Alongi, Inc.
 Address: 109 E 13th St.
 Vancouver, WA 98660

Batch #: 2118241.00

Matrix: Paint
 Method: EPA 3051/7000B
 Client Project #: 0457.02.03-01
 Date Received: 10/19/2021
 Samples Received: 11
 Samples Analyzed: 11

Attention: Mrs. Emily Curtis
 Project Location: N-A

Lab ID	Client Sample #	Sample Weight (g)	RL in mg/Kg	Results in mg/Kg	Results in percent
21116235	1-4-PB-8	0.1854	54	2700	0.27
21116236	1-7-PB-13	0.1939	52	2400	0.24
21116237	1-20-PB-28	0.1774	56	20000	2.0
21116238	2-7-PB-24	0.1861	54	150000	15
21116239	3-6-PB-12	0.2025	49	630	0.063
21116240	4-3-PB-4	0.1904	53	23000	2.3
21116241	4-23-PB-32	0.1931	52	2200	0.22
21116242	4-24-PB-36	0.1919	52	8000	0.80
21116243	4-14-PB-50	0.1927	52	150000	15
21116244	5-1-PB-2	0.1938	52	43000	4.3
21116245	EXT-1-PB-1	0.1839	54	16000	1.6


Sampled by: Client

Analyzed by: Yasuyuki Hida

Reviewed by: Shalini Patel

Date Analyzed: 10/22/2021

Date Issued: 10/22/2021


 Shalini Patel, Lab Supervisor

mg/ Kg =Milligrams per kilogram

Percent = Milligrams per kilogram / 10000

Note : Method QC results are acceptable unless stated otherwise.

Unless otherwise indicated, the condition of all samples was acceptable at time of receipt.

RL = Reporting Limit

'<' = Below the reporting Limit

Bench Run No: 2021-1021-04

FAA-02

LEAD LABORATORY SERVICES



Company Maul Foster & Alongi, Inc.	NVL Batch Number 2118241.00
Address 109 E 13th St. Vancouver, WA 98660	TAT 5 Days AH No
Project Manager Mrs. Emily Curtis	Rush TAT
Phone (971) 544-2139	Due Date 10/26/2021 Time 10:10 AM
	Email ecurtis@maulfoster.com
	Fax

Project Name/Number: 0457.02.03-01 **Project Location:** N-A

Subcategory Flame AA (FAA)
Item Code FAA-02 EPA 7000B Lead by FAA <paint>

Total Number of Samples 11 **Rush Samples** _____

Lab ID	Sample ID	Description	A/R
1	21116235	1-4-PB-8	A
2	21116236	1-7-PB-13	A
3	21116237	1-20-PB-28	A
4	21116238	2-7-PB-24	A
5	21116239	3-6-PB-12	A
6	21116240	4-3-PB-4	A
7	21116241	4-23-PB-32	A
8	21116242	4-24-PB-36	A
9	21116243	4-14-PB-50	A
10	21116244	5-1-PB-2	A
11	21116245	EXT-1-PB-1	A

	Print Name	Signature	Company	Date	Time
Sampled by	Client				
Relinquished by	Federal Express				

Office Use Only	Print Name	Signature	Company	Date	Time
Received by	Fatima Khan		NVL	10/19/21	1010
Analyzed by	Yasuyuki Hida		NVL	10/22/21	
Results Called by					
<input type="checkbox"/> Faxed <input type="checkbox"/> Emailed					

Special Instructions: _____

Date: 10/19/2021
 Time: 12:32 PM
 Entered By: Fatima Khan



METALS CHAIN OF CUSTODY

Turn Around Time

- 2 Hour 4 Hours 24 Hours
 2 Days 3 Days 4 Days
 5 Days 6-10 Days
 Please call for TAT less than 24 Hours

Company Maul Foster & Alougi
 Address 2815 2nd Ave #540,
Seattle, WA 98121
 Phone 503-410-1524

Project Manager Matt Hoffman
 Cell () -
 Email _____
 Fax () -

Project Name/Number	Project Location
---------------------	------------------

<input checked="" type="checkbox"/> Total Metals <input type="checkbox"/> TCLP	<input type="checkbox"/> FAA (ppm) <input type="checkbox"/> ICP (PPM) <input type="checkbox"/> GFAA (ppb) <input type="checkbox"/> CVAA (ppb)	<input type="checkbox"/> Air Filter <input checked="" type="checkbox"/> Paint Chips (cm) <input type="checkbox"/> Drinking Water <input type="checkbox"/> Other	<input type="checkbox"/> Paint Chips (%) <input type="checkbox"/> Dust Wipes <input type="checkbox"/> Waste Water	<input type="checkbox"/> Soil <input type="checkbox"/> Barium <input type="checkbox"/> Arsenic <input type="checkbox"/> Selenium	<input type="checkbox"/> RCRA 8 <input type="checkbox"/> Chromium <input type="checkbox"/> Mercury <input type="checkbox"/> Cadmium	<input type="checkbox"/> RCRA 11 <input type="checkbox"/> Silver <input checked="" type="checkbox"/> Lead <input type="checkbox"/> Copper <input type="checkbox"/> Zinc <input type="checkbox"/> Other
---	--	--	---	---	--	---

Reporting Instructions Report to Emily Curtis
 Call () - Fax () - Email ecurtis@maulfoster.com

Total Number of Samples _____

Sample ID	Description	A/R
1	1-4-PB-8	White Paint Chips
2	1-7-PB-13	Red Paint Chips
3	1-20-PB-28	Silver Paint chips
4	2-7-PB-24	Red Paint Chips
5	3-6-PB-12	Tan paint chips
6	4-3-PB-4	Red Paint Chips
7	4-23-PB-32	Bright White Paint Chips
8	4-24-PB-36	Green Paint Chips
9	4-14-PB-50	Orange Paint Chips
10	5-1-PB-2	Yellow Paint Chips
11	EXT-1-PB-1	Brownish Red Paint Chips
12		
13		
14		
15		

	Print Name	Signature	Company	Date	Time
Sampled by	Connor Anderson	<i>Connor Anderson</i>	MFA	10/15/21	0800
Relinquish by	Connor Anderson	<i>Connor Anderson</i>	MFA	10/17/21	1350

Office Use Only

	Print Name	Signature	Company	Date	Time
Received by	Emilia	<i>Emilia</i>	NVL Labs	10/16/21	10:00am
Analyzed by					
Called by					
Faxed/Email by					

Kelly Au Vu

From: Emily Curtis <ecurtis@maulfoster.com>
Sent: Tuesday, October 19, 2021 10:10 AM
To: Client Services
Subject: Project Information

Hello,

Please use project number 0457.02.03-01 and 5-day turn.

Thanks,

EMILY CURTIS | MAUL FOSTER & ALONGI, INC.
Project Health, Safety, and Environmental Specialist
pronouns: she/her
m. 503 410 1524 | d. 503 501 5233



3140 NE Broadway Street, Portland, OR 97232
www.maulfoster.com

APPENDIX E

ADAPTIVE REUSE CONCEPTUAL PLAN





COLLEGE AVENUE STEAM PLANT

ADAPTIVE REUSE CONCEPTUAL PLAN


GRAHAM BABA ARCHITECTS




INTRODUCTION

The conceptual plan and visualizations depicted in this package were developed using funds from an Integrated Planning Grant administered by the state of Washington Department of Ecology. Integrated Planning Grants provide funding for local governments to conduct the necessary studies and to plan for acquiring and redeveloping under performing, contaminated properties.

The conceptual plan was created based on a site visit, historical drawings, and a series of meetings with the Port, staff from Washington State University, and the project consulting team. This plans and images in this package are intended to inspire as well as provide a foundation for adaptive use cost estimating and identifying building structural deficiencies to support reuse in the portion of the College Avenue Steam Plant that are not being used for ongoing power generation. Measures were taken in collaboration with WSU to design a concept that would ensure existing Steam Plant operations could continue and be maintained uninterrupted.

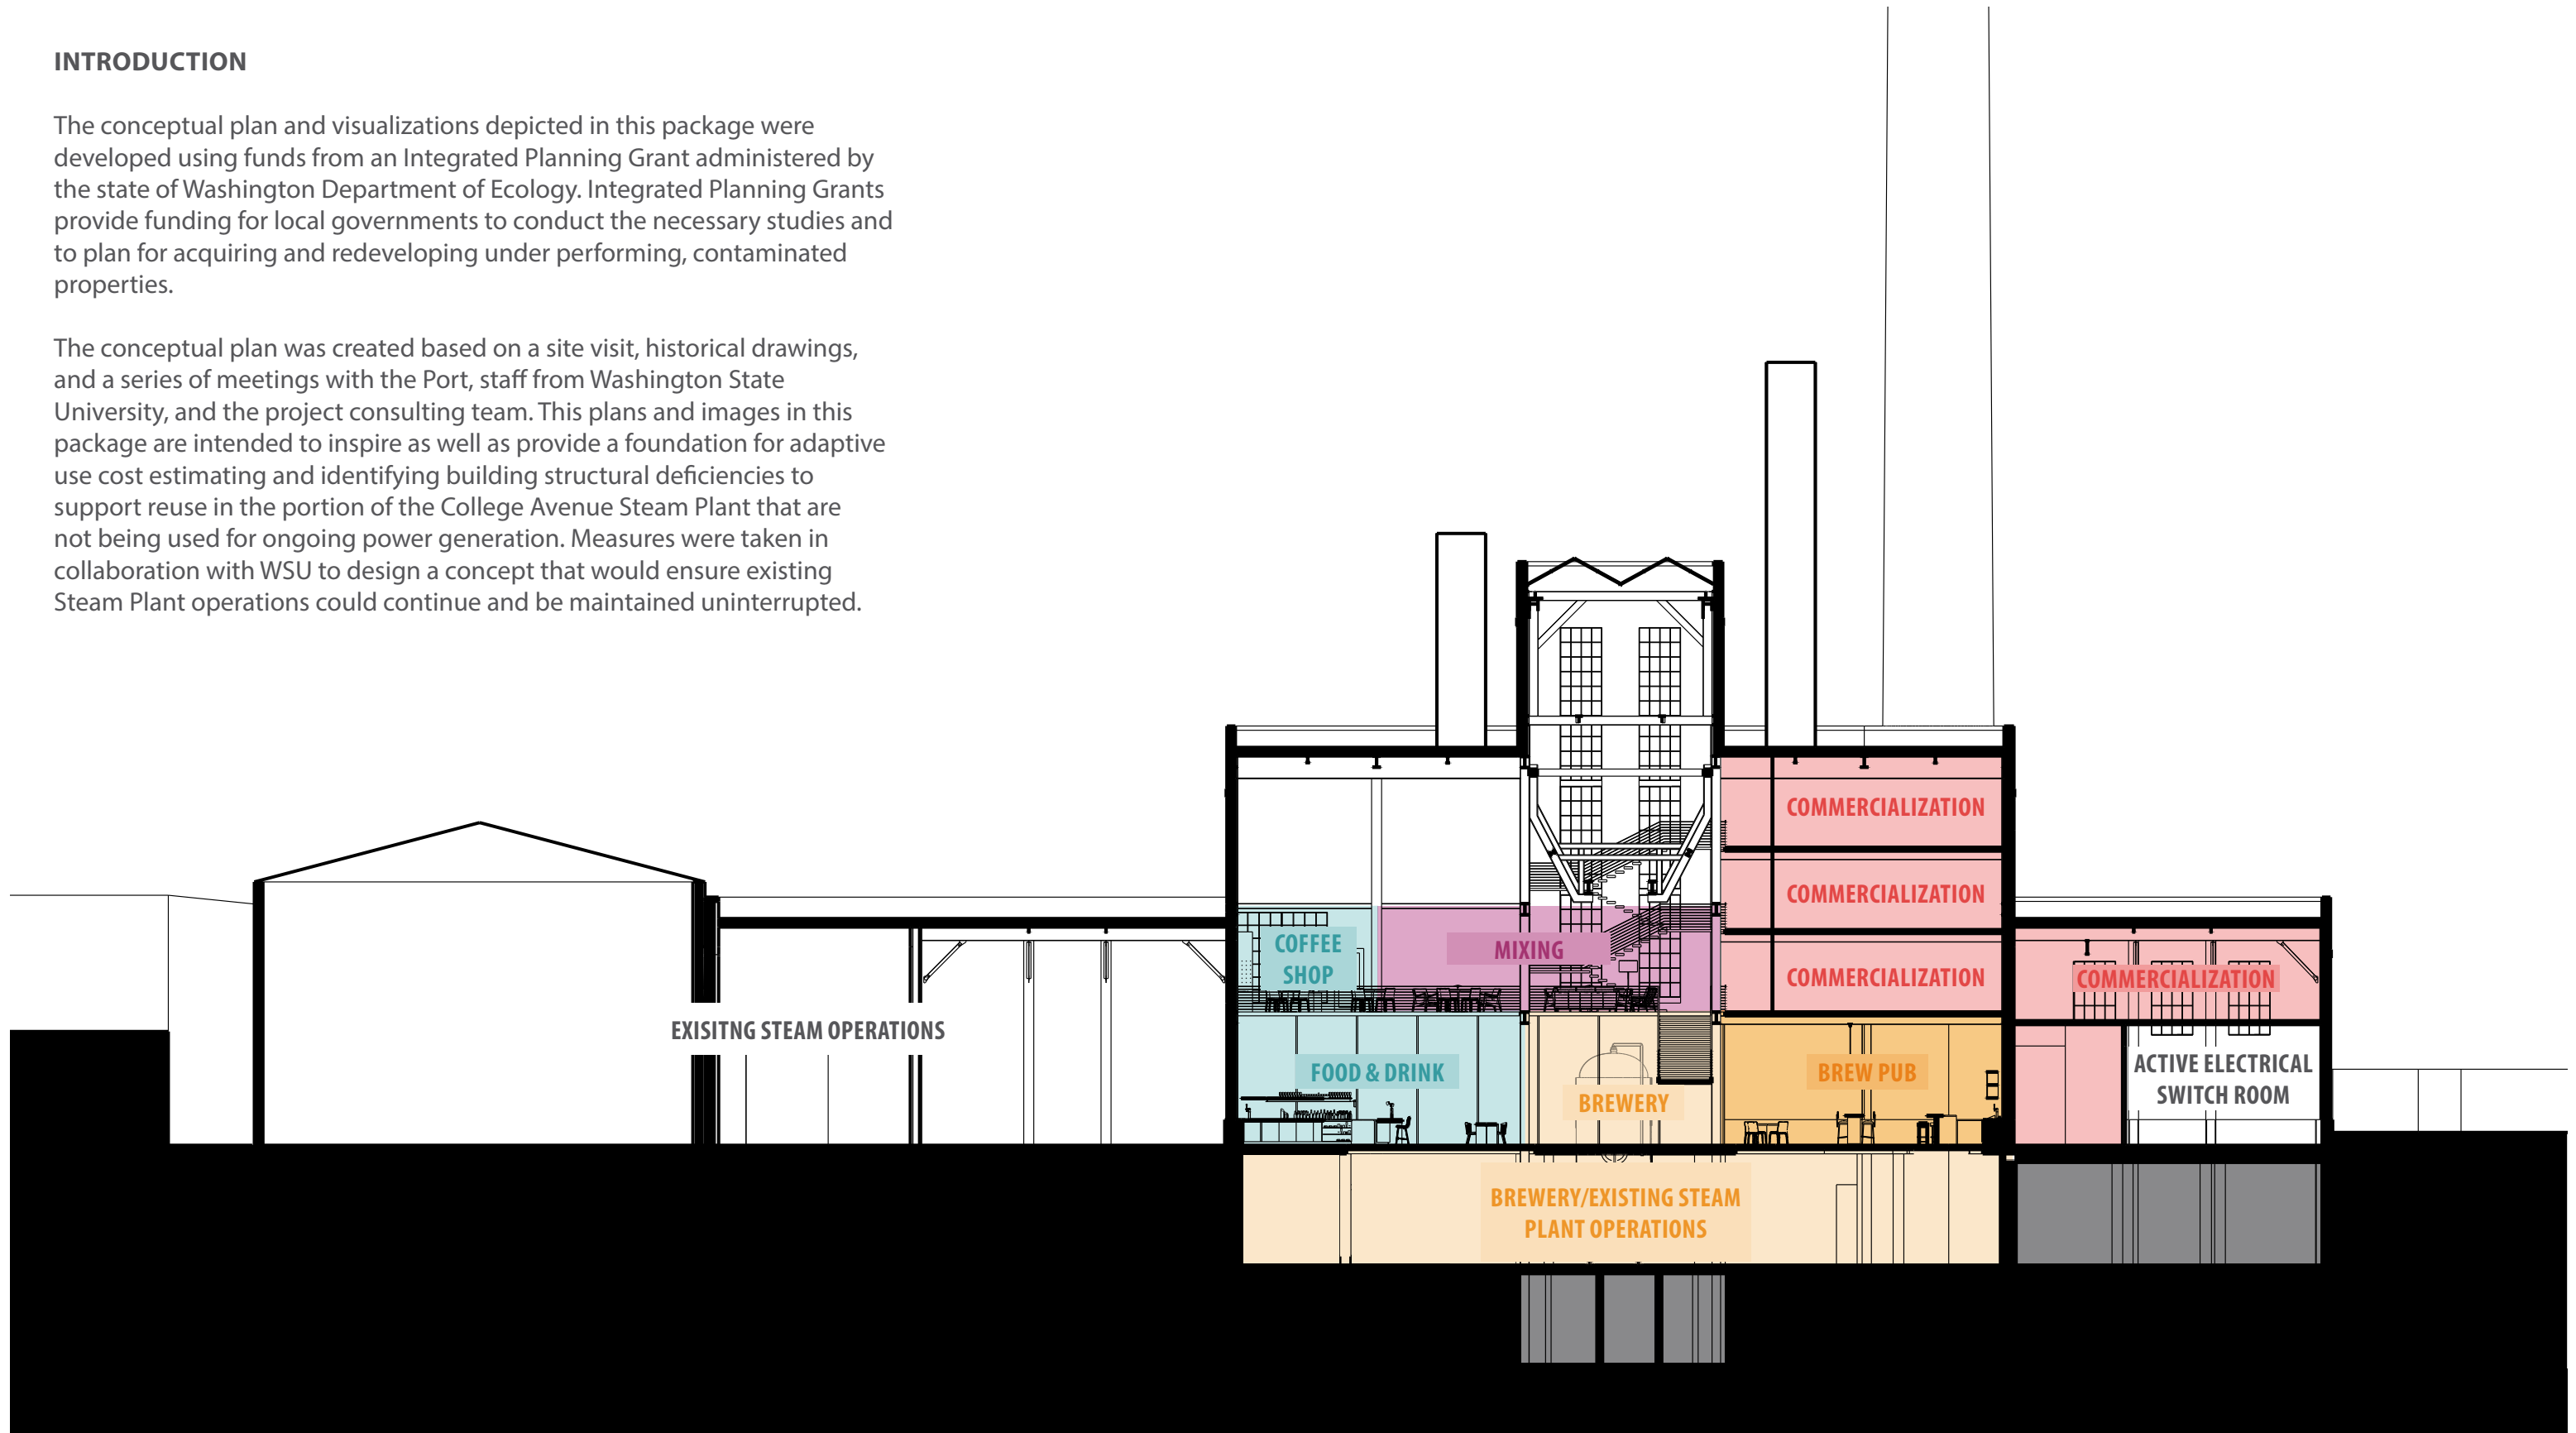


SECTION

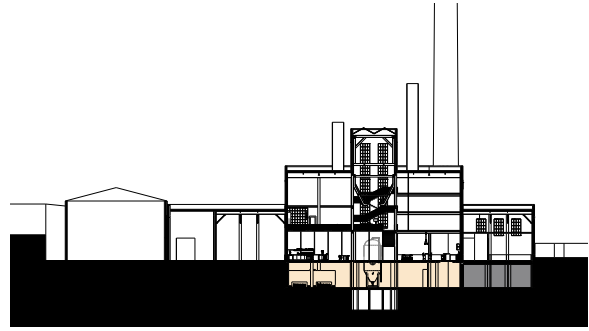


COMMERCIALIZATION	639 SF
BREWERY	2,418 SF
PORT BACK OF HOUSE	3,920 SF
EXISTING STEAM PLANT	4,564 SF
CIRCULATION	826 SF
TOTAL	12,367 SF




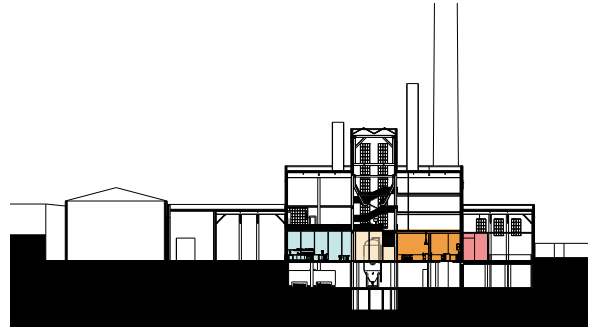

COMMERCIALIZATION	1,624 SF
BREWERY	1,459 SF
BREW PUB	2,543 SF
FOOD & DRINK	2,618 SF
CIRCULATION	1,509 SF
BATHROOMS	496 SF
EXISTING STEAM PLANT	1,806 SF
TOTAL INTERIOR	12,055 SF


PATIO: BREW PUB	1,291 SF
PATIO: FOOD & DRINK	1,274 SF
TOTAL EXTERIOR	2,565 SF

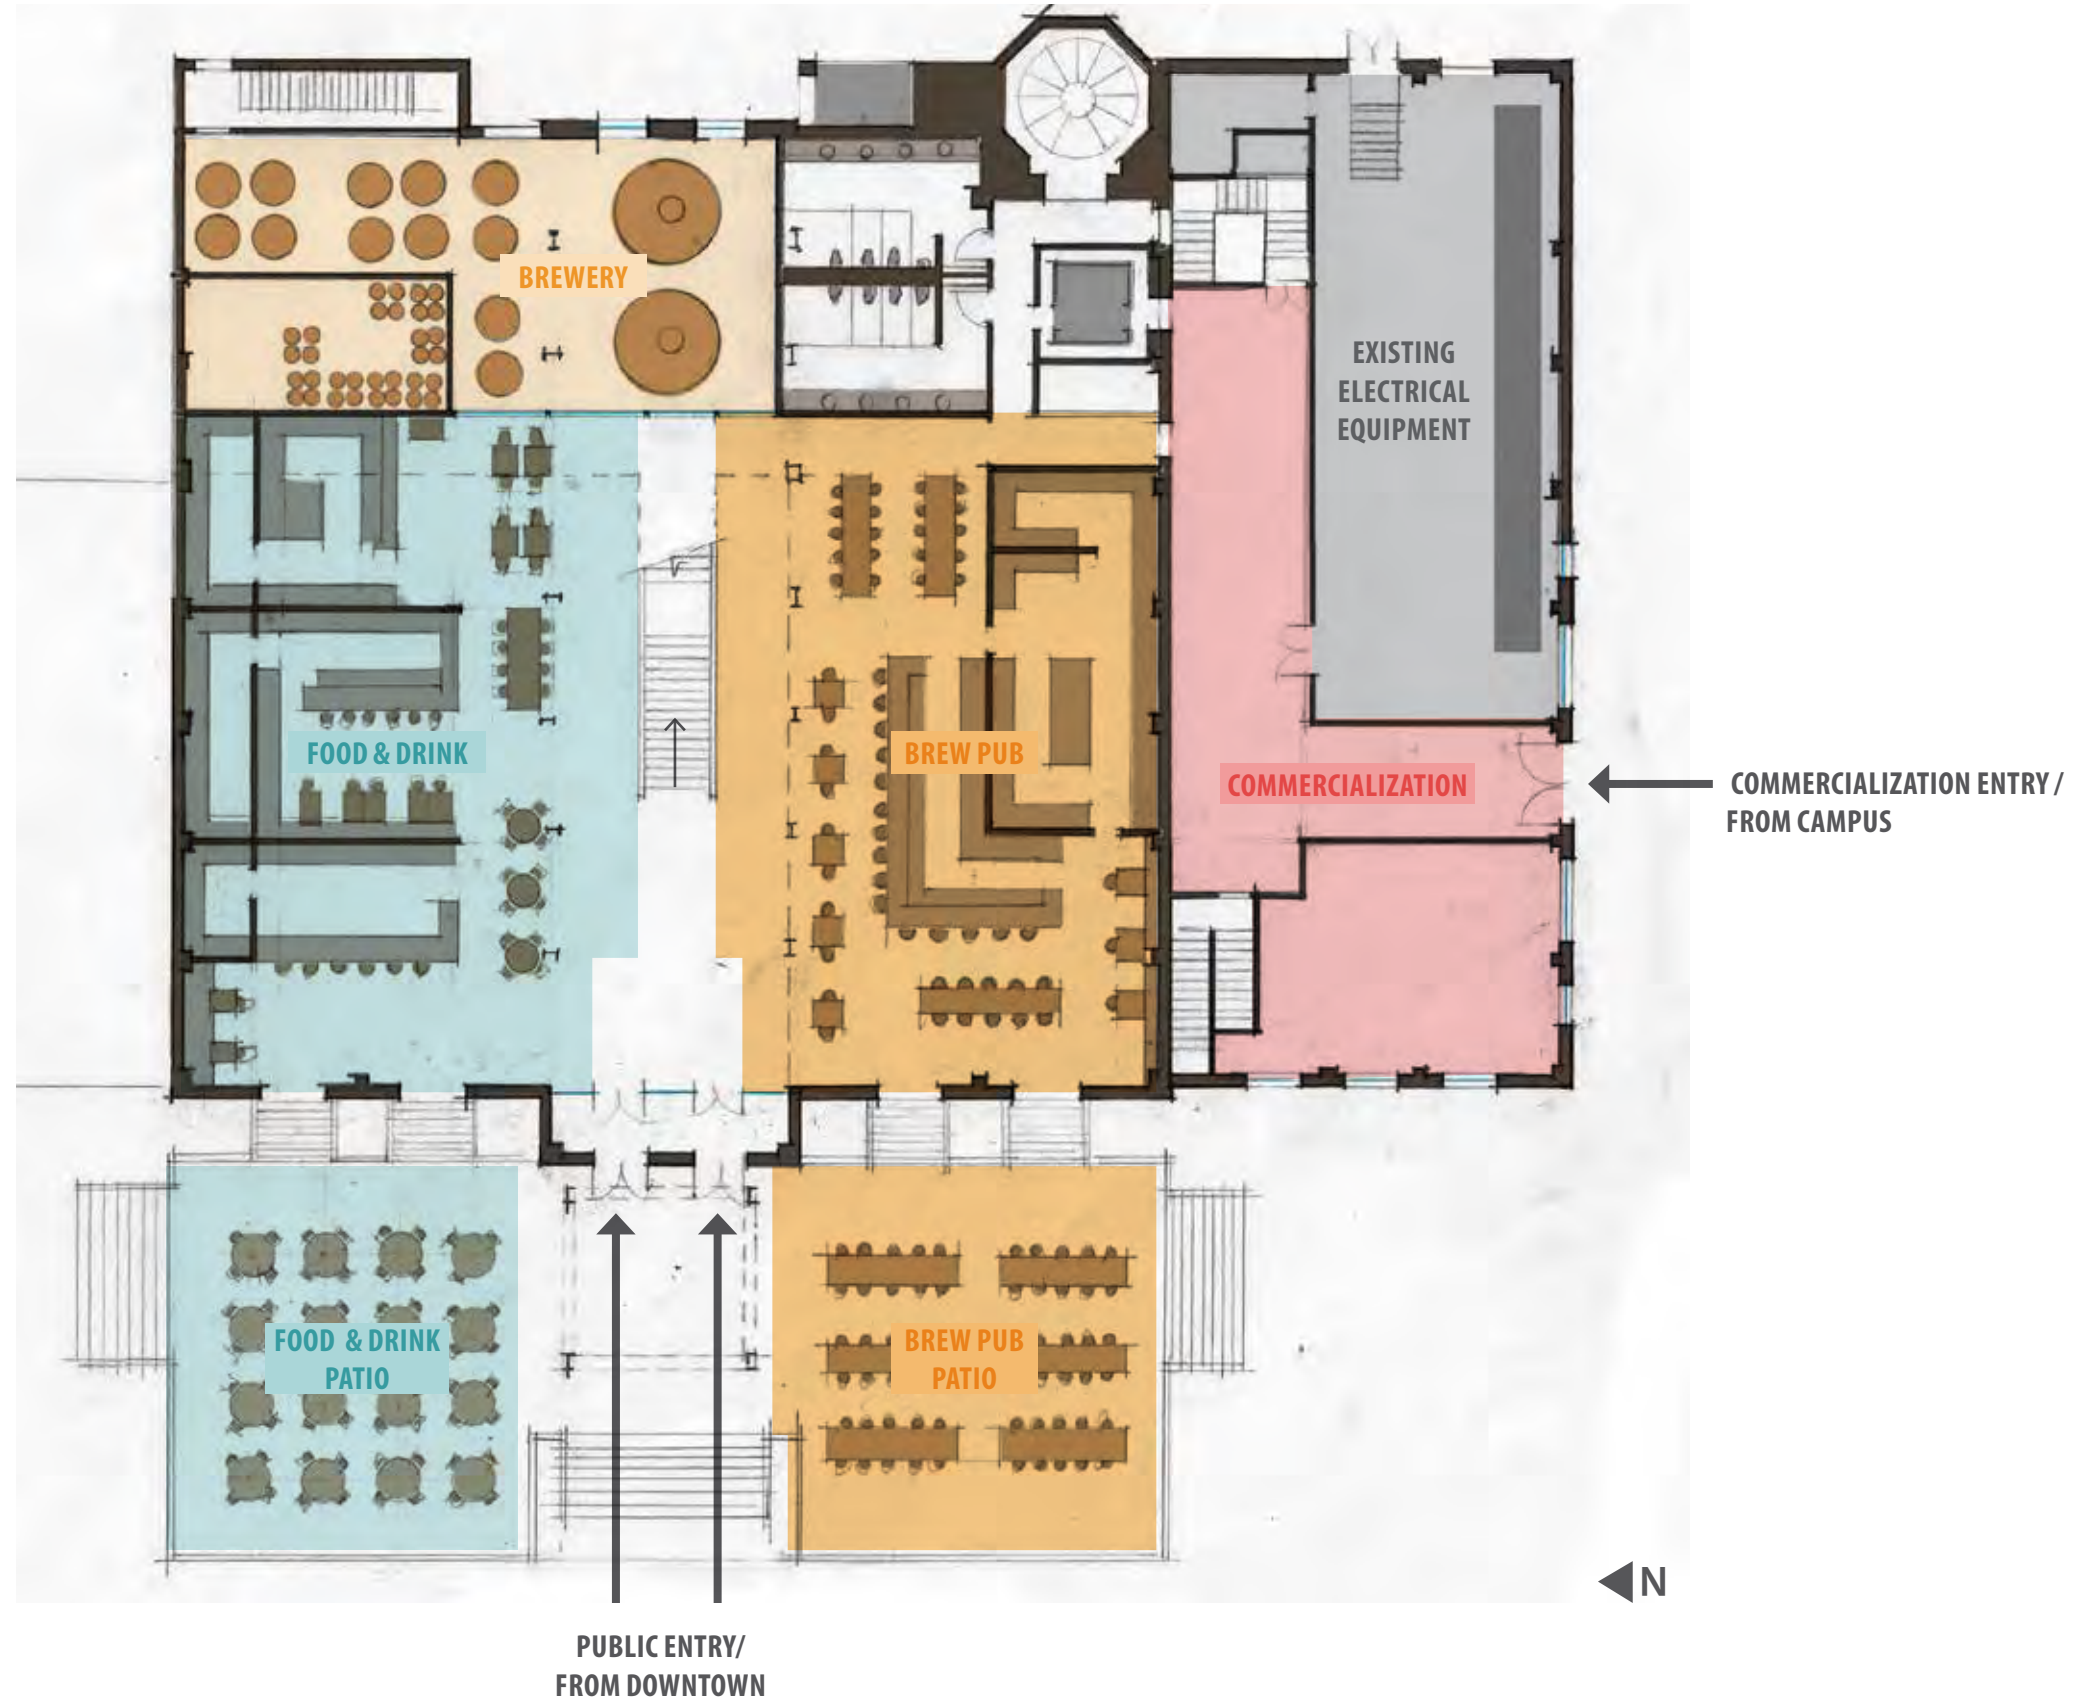

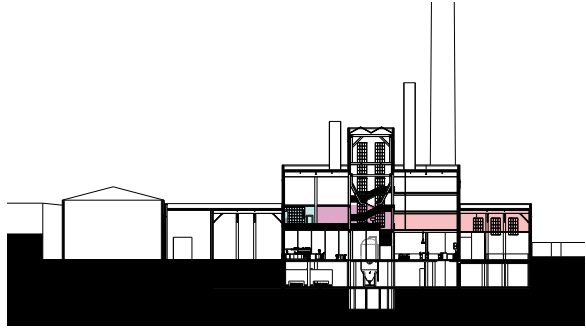


COMMERCIALIZATION	4,097 SF
FOOD & DRINK	562 SF
MIXING	694 SF
CIRCULATION	1,390 SF
BATHROOMS	297 SF
TOTAL	7,040 SF



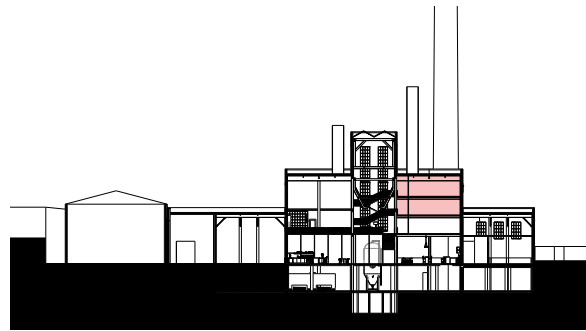

COMMERCIALIZATION	1,347 SF
CIRCULATION	948 SF
BATHROOMS	115 SF
TOTAL	2,410 SF

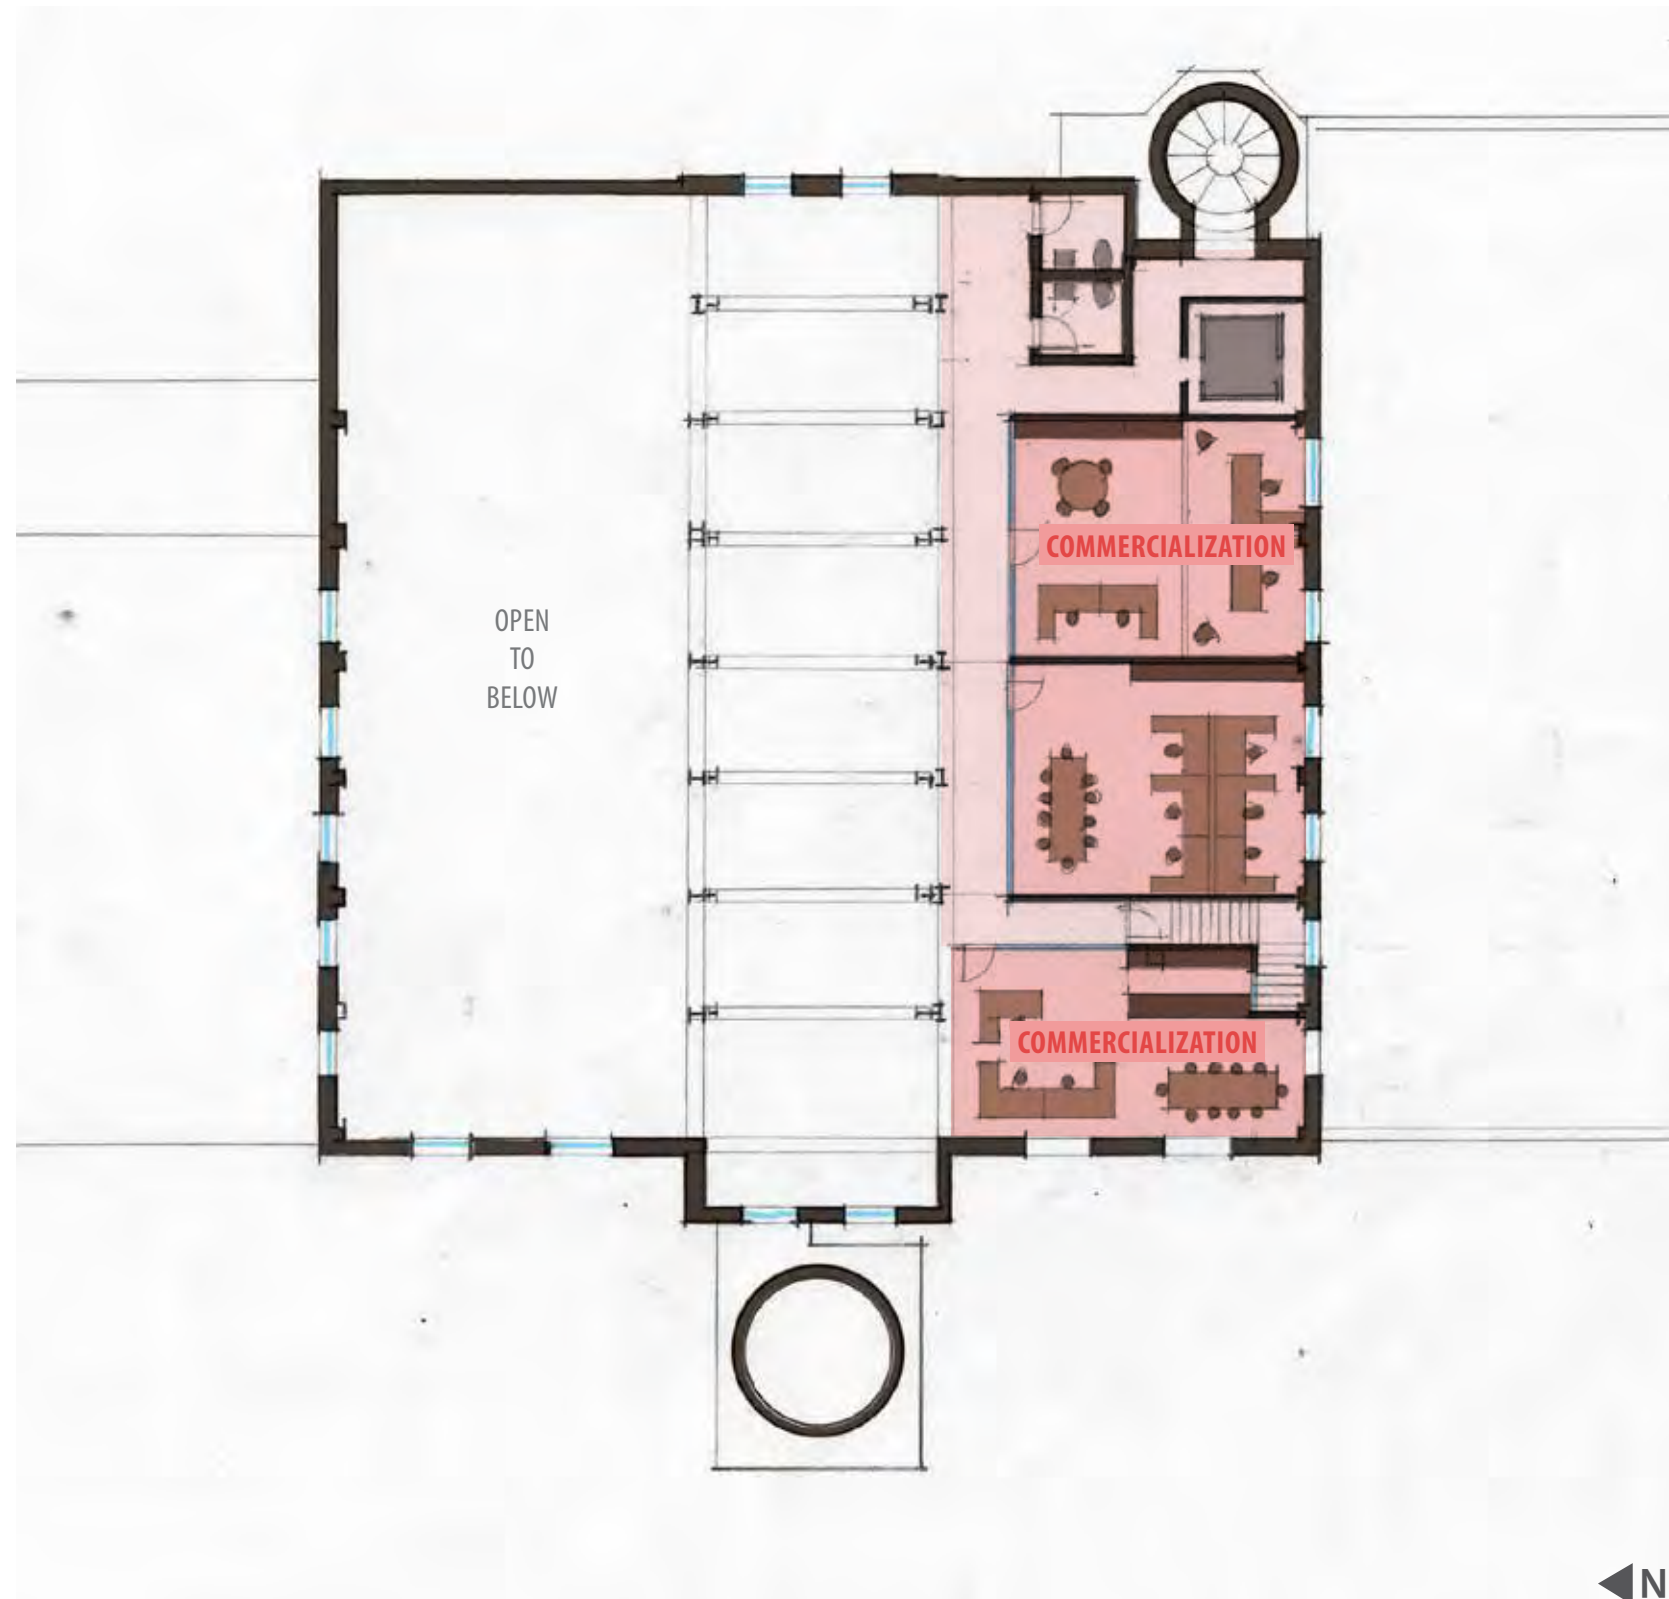

INTERIOR

SPACE TYPE	SUBBASEMENT	BASEMENT	LEVEL 1	LEVEL 2	LEVEL 3	LEVEL 4	SPACE TOTALS
COMMERCIALIZATION	0 SF	639 SF	1,624 SF	4,097 SF	1,347 SF	1,347 SF	9,054 SF
BREWERY	0 SF	2,418 SF	1,459 SF	0 SF	0 SF	0 SF	3,877 SF
BREW PUB	0 SF	0 SF	2,543 SF	0 SF	0 SF	0 SF	2,543 SF
FOOD & DRINK	0 SF	0 SF	2,618 SF	562 SF	0 SF	0 SF	3,180 SF
MIXING	0 SF	0 SF	0 SF	694 SF	0 SF	0 SF	694 SF
PORT BACK OF HOUSE	0 SF	3,920 SF	0 SF	0 SF	0 SF	0 SF	3,920 SF
EXISTING STEAM PLANT OPERATIONS	1,200 SF	4,564 SF	1,806 SF	0 SF	0 SF	0 SF	7,570 SF
CIRCULATION	0 SF	826 SF	1,509 SF	1,390 SF	948 SF	948 SF	5,621 SF
BATHROOMS	0 SF	0 SF	496 SF	297 SF	115 SF	115 SF	1,023 SF
TOTAL	1,200 SF	12,367 SF	12,055 SF	7,040 SF	2,410 SF	2,410 SF	37,482 SF

EXTERIOR

PATIO: BREW PUB	0 SF	0 SF	1,291 SF	0 SF	0 SF	0 SF	1,291 SF
PATIO: FOOD & DRINK	0 SF	0 SF	1,274 SF	0 SF	0 SF	0 SF	1,274 SF



COLLEGE AVENUE STEAM PLANT - PULLMAN, WA | GRAHAM BABA ARCHITECTS







APPENDIX F

FEASIBILITY STUDY COST PLAN



College Avenue Steam Plant Development



College Avenue Steam Plant Development

Prepared for:



Kara Riebold
Port of Whitman County
302 N Mill Street
Colfax, WA 99111

Prepared by:



Project Manager: Bryan Baldwin
Project Leader: Andrew Jonsson
DCW Cost Management
815 1st Ave
Suite 176
Seattle, WA 98109
(206) 259-2992

College Avenue Steam Plant Development

Contents

Overall Summary	4
Scope of Work	5
Basis of Estimate	6
Phase 1: Hazardous Building Materials Abatement	7
Phase 2: Demolition	9
Phase 3: Warm Shell	10
Phase 4: Tenant Improvement	14
Sitework	18

College Avenue Steam Plant Development

Overall Summary

	SF		Cost/SF		Cost
Phases	29,912	\$	991.75	\$	29,665,306
Phase 1: Hazardous Building Materials Abatement	23,816	\$	36.69	\$	873,750
Phase 2: Demolition	22,616	\$	101.44	\$	2,294,192
Phase 3: Warm Shell	29,912	\$	276.95	\$	8,284,177
Phase 4: Tenant Improvement	29,912	\$	240.04	\$	7,180,126
Sitework	36,580	\$	91.36	\$	3,342,055
TOTAL CONSTRUCTION COST	29,912	\$	734.63	\$	21,974,301
Soft Costs at 35%				\$	7,691,005
RECOMMENDED BUDGET INCL. SOFT COSTS	29,912	\$	991.75	\$	29,665,306

College Avenue Steam Plant Development

Scope of Work

Project Background

In coordination with Washington State University (WSU), the Port of Whitman County is exploring possibilities to redevelop a portion of the former Steam Plant located on the southwest edge of campus in Pullman, WA. The original building was constructed and began operations in 1927; it underwent seven additions and modifications including the closure of six boilers and the central portion of the building in 2003.

Redeveloping portions of the underutilized building will support the Port's core mission of economic development by creating a co-working and collaboration space to support the innovations and commercialization efforts emerging from WSU.

Project Scope Description

The project consists of phased renovation cost planning for the Steam Plant. Portions of the building continue to generate steam to power the campus and electric utility equipment and high voltage power lines interface with the portion that may be redeveloped. It is fully intended that the Steam Plant maintain full operation. The scope of work includes costing the feasibility study documents provided by the project team and factoring in costs associated with maintaining continued power generation in a safe and accessible manner.

The intended design package contains the conversion a portion of the existing steam plant standing at approximately 12,000 SF with 3 stories in the following phases.

- Phase 1: Hazardous Materials Abatement
- Phase 2: Demolition
- Phase 3: Cold Shell
- Phase 4: Build Back

Project Design

The cost report is based on the following plan sets including narrative documents, supplemental information, and imagery:

- Presentation_small, dated 10.25.21
- WSU Steamplant annotated rendering for DCW, dated 11.10.21
- Preliminary Braced Frames, dated 11.10.21
- Preliminary Braced Frame Locations, dated 11.10.21
- mfa_DCW Cost Plan - Department of Ecology Integrated Planning Grant - Feasibility Study - 122021 Rev 4
- 21-1220_Presentation Update
- WSU Steam Plant_Area Breakdown

Procurement

It is anticipated that the project will be delivered by traditional low bid with a minimum of 4 qualified contractors for competitive pricing. It is expected that the total project will be phased.

College Avenue Steam Plant Development

Basis of Estimate

Assumptions and Clarifications

This estimate is based on the following assumptions and clarifications:

- 1 The estimate is based on the drawings listed in the scope of work and conversations with the architects and engineers.
- 2 Standard working hours.
- 3 Prevailing wages apply.
- 4 Development soft costs are included in the Soft Cost Allowance - See Summary.
- 5 Escalation is included to Q1-2023.
- 6 Permits and fees are included in the Soft Cost Allowance - See Summary.
- 7 Sales tax not included in hard costs (See Soft Costs below).
- 8 Ancillary site structures and features are excluded from the cost report.
- 9 Environmental contamination cleanup costs found below the building or on the grounds is excluded.

General Conditions Include:

- Project management and supervision.
- Construction mobilization including trailers, temp power, lighting, and heating.
- Contractor vehicles, fuel, and maintenance.
- Small tools and consumables.
- Hoisting, forklifts, and tool storage.

Note: Trade equipment is included within the trade services unit rates.

Soft Cost include

- Jurisdictional costs, permits etc
- A&E fees
- Other Consultants
- Administrative costs
- Special inspections and commissioning
- Owner's contingency
- Sales tax 7.8% on hard costs
- FF&E will be provided by tenant

Further investigation of the structural components is necessary for complete cost accuracy and risk reduction. In the interim, we recommend that the Port (Project Owner) carries construction contingency for structural repairs if encountered during construction.

In preparing the cost models, multiple sources were used. The source information includes a perspective on current codes, technology, energy conservation, specific site elements, local general and sub construction markets and labor agreements, material costs and availability, and labor efficiencies.

College Avenue Steam Plant Development

Phase 1: Hazardous Building Materials Abatement

Item Description	Quantity	Unit	Rate	Total
------------------	----------	------	------	-------

PROJECT AREAS

Sub-Basement	1,200	SF		
<i>Floor ht.</i>	12	LF		
Basement	12,367	SF		
<i>Floor ht.</i>	16	LF		
Main floor (less sitework)	10,249	SF		
<i>Floor ht.</i>	42	LF		
Total Project Area	23,816	SF		

Phase 1: Hazardous Building Materials Abatement

23,816	SF		
--------	----	--	--

Asbestos	23,816	SF	8.30	197,673
<i>Widow glazing</i>	4,030	LF		<i>incl. above</i>
<i>Red paint coated pipe wrap with compacted white insulation</i>	20	LF		<i>incl. above</i>
<i>White / gray compacted insulation with white, silver, orange, or red painted wrap</i>	3,000	LF		<i>incl. above</i>
<i>White patch on gray pipe</i>	5	LF		<i>incl. above</i>
<i>Tan 12x12-inch vinyl floor tile with black mastic</i>	3,000	SF		<i>incl. above</i>
<i>Tan 9x9-inch vinyl floor tile with black mastic</i>	16	SF		<i>incl. above</i>
<i>Light tan patterned 9x9-inch vinyl floor tile with black mastic</i>	76	SF		<i>incl. above</i>
<i>Brown vinyl floor tile</i>	66	SF		<i>incl. above</i>
<i>Brown vinyl floor tile with black mastic</i>	175	SF		<i>incl. above</i>
<i>Brown stipple-patterned 9x9-inch vinyl floor tile with black mastic</i>	20	SF		<i>incl. above</i>
<i>White insulation with tan / white-painted woven fibrous mesh</i>	35	LF		<i>incl. above</i>
<i>White insulation with silver-painted woven fibrous cover</i>	200	SF		<i>incl. above</i>
<i>White crumbly insulation with yellow woven fibrous mesh and silver paint</i>	600	LF		<i>incl. above</i>
<i>White crumbly insulation with white fibrous felt and brown paint</i>	1,200	LF		<i>incl. above</i>
<i>White crumbly insulation with white woven fibrous wrap and red paint</i>	40	LF		<i>incl. above</i>
<i>Silver woven heat-resistant furnace door lining</i>	80	LF		<i>incl. above</i>
<i>White insulation with gray painted wrap and fabric patch on elongated tank</i>	20	LF		<i>incl. above</i>
<i>Orange-painted wrap and gray crumbly insulation</i>	20	LF		<i>incl. above</i>
<i>Tan 1x1-inch and 2x2-inch flooring tile with brown adhesive</i>	180	SF		<i>incl. above</i>
<i>Tan base cove with green adhesive</i>	60	LF		<i>incl. above</i>
Lead-based Paint - Encapsulate	23,816	SF	6.70	159,567
<i>Brown paint</i>	70	SF		<i>incl. above</i>
<i>Brownish red paint</i>	272	SF		<i>incl. above</i>
<i>Red paint</i>	1,660	SF		<i>incl. above</i>
<i>Orange paint</i>	645	SF		<i>incl. above</i>
<i>Yellow paint</i>	3,950	SF		<i>incl. above</i>
<i>Green paint</i>	165	SF		<i>incl. above</i>
<i>White paint</i>	3,385	SF		<i>incl. above</i>

College Avenue Steam Plant Development

Phase 1: Hazardous Building Materials Abatement

Item Description	Quantity	Unit	Rate	Total
<i>Bright white paint</i>	280	SF		<i>incl. above</i>
<i>Silver paint</i>	3,025	SF		<i>incl. above</i>
<i>Gray paint</i>	729	SF		<i>incl. above</i>
<i>Light tan paint</i>	24	SF		<i>incl. above</i>
PCB Containing and Other Hazardous Materials	23,816	SF	7.10	169,094
<i>Electrical boxes / panels</i>	39	EA		<i>incl. above</i>
<i>Motors</i>	1	LS		<i>incl. above</i>
<i>Miscellaneous containers</i>	1	LS		<i>incl. above</i>
<i>Coal dust</i>	2	RM		<i>incl. above</i>
<i>Asbestos dust</i>	1	RM		<i>incl. above</i>
<i>Fire hose</i>	1	EA		<i>incl. above</i>
<i>Fire-resistant board</i>	1	EA		<i>incl. above</i>
<i>Mercury-containing thermostats</i>	2	EA		<i>incl. above</i>
<i>Mercury-containing fixture</i>	1	EA		<i>incl. above</i>
<i>Steam equipment</i>	1	LS		<i>incl. above</i>
<i>Boilers</i>	6	EA		<i>incl. above</i>
<i>Fluorescent light tubes</i>	89	EA		<i>incl. above</i>
Direct Construction Cost	23,816	SF	22.10	526,334
Contingency - Construction and Design	30.0%			157,900
General Conditions	7.0%			47,896
General Requirements	7.5%			54,910
Contractor's Overhead and Profit or Fee	4.5%			35,417
Bonds and Insurance	1.5%			12,337
Construction Cost Before Escalation	23,816	SF	35.05	834,793
Escalation (Q1 2023)	4.67%			38,957
Construction Cost Including Escalation	23,816	SF	36.69	873,750

College Avenue Steam Plant Development

Phase 2: Demolition

Item Description	Quantity	Unit	Rate	Total
PROJECT AREAS				
Sub-Basement	-	SF		
<i>Floor ht.</i>	12	LF		
Basement	12,367	SF		
<i>Floor ht.</i>		LF		
Main floor (less sitework)	10,249	SF		
<i>Floor ht.</i>	18	LF		
Total Project Area	22,616	SF		
Phase 2: Demolition				
Site protection - elements to remain, incl. dust control	22,616	SF	3.25	73,502
Temp. shoring as required, allow	1	LS	75,000.00	75,000
Seismic bracing				
HSS8x8x1/2 (assume thk.)	4.07	TN	15,000.00	61,093
W12 beams and columns - existing to remain				NIC
Salvage industrial relics	1	LS	50,000.00	50,000
Boilers, complete	6	EA	65,000.00	390,000
Catwalks and railings, complete	1	LS	125,000.00	125,000
Coal hopper incl. conveyance, complete	1	LS	75,000.00	75,000
Misc. equipment and piping incl. bracing, allow	1	LS	250,000.00	250,000
Existing structure incl. metal siding & equipment, complete	9,555	SF	18.50	176,768
Exterior wall for new storefront	600	SF	25.00	15,000
Roofing for new green house roof	3,035	SF	8.50	25,798
Temp. roof	3,035	SF	4.50	13,658
Cut existing floor decking for elevator	330	SF	50.00	16,500
Architectural elements, as required	22,616	SF	1.25	28,270
Direct Construction Cost	22,616	SF	60.82	1,375,588
Contingency - Construction and Design	20.0%			275,118
General Conditions	7.0%			115,549
General Requirements	17.0%			300,263
Contractor's Overhead and Profit or Fee	4.5%			92,993
Bonds and Insurance	1.5%			32,393
Construction Cost Before Escalation	22,616	SF	96.92	2,191,904
Escalation (Q1 2023)	4.67%			102,289
Construction Cost Including Escalation	22,616	SF	101.44	2,294,192

College Avenue Steam Plant Development

Phase 3: Warm Shell

Item Description	Quantity	Unit	Rate	Total
------------------	----------	------	------	-------

PROJECT AREAS

Sub-Basement - not included	-	SF		
<i>Floor ht.</i>	12	LF		
Basement	7,803	SF		
<i>Floor ht.</i>	16	LF		
Main floor (less sitework)	10,249	SF		
<i>Floor ht.</i>	18	LF		
Level 2	7,040	SF		
<i>Floor ht.</i>	12	LF		
Level 3	2,410	SF		
<i>Floor ht.</i>	12	LF		
Level 4	2,410	SF		
<i>Floor ht.</i>	12	LF		
Total Project Area	29,912	SF		

Phase 3: Warm Shell	29,912	SF		
Site protection - elements to remain, incl. dust control	29,912	SF	1.50	44,868
Structural				
CLT deck incl. concrete topping slab, new	11,860	SF	28.90	342,754
CLT deck incl. concrete topping slab, infill (allow)	3,000	SF	28.90	86,700
Floor beams and columns	59.44	TN	10,500.00	624,120
Roof beams and columns	12.14	TN	10,500.00	127,470
Elevator shaft walls, CLT	3,500	SF	18.50	64,750
Excavate for elevator pit incl. haul, hand dig	31	CY	120.00	3,720
Elevator pit incl. sump pump	1	LS	15,500.00	15,500
Interior of exterior masonry - clean, prep and seal	27,065	SF	4.75	128,559
Shared wall shotcrete, firewall	2,400	SF	15.00	36,000
Exterior enclosure				
Exterior cladding - renovate as required	27,065	SF	5.20	140,738
Masonry tie backs	416	EA	84.50	35,185
Storefront	600	SF	105.00	63,000
Exterior				
Pivot up doors	4	EA	18,000.00	72,000
Vestibule, double	4	EA	4,200.00	16,800
Glazing				
New window system to existing	4,134	SF	52.50	217,035
Roof covering				
Green house roof glazing	3,035	SF	135.00	409,725
Existing room - maintenance as required	7,214	SF	10.50	75,747
Interior construction				

College Avenue Steam Plant Development

Phase 3: Warm Shell

Item Description	Quantity	Unit	Rate	Total
Partitions				
Wood stud - painted 2x6 (assume), typ. complete	8,463	SF	18.50	156,566
Interior storefront	1,411	SF	75.00	105,788
Floor leveling and prep for new construction	29,912	SF	3.00	89,736
Interior				
Single, flush	5	EA	2,850.00	14,250
Single, full glazed	10	EA	3,500.00	35,000
Stairs & rails				
Steel string stairs with wood tread, main floor	1	FLT	85,000.00	85,000
Steel string stairs with wood tread, basement	1	FLT	40,000.00	40,000
Steel string stairs with wood tread, mixing	1	FLT	45,000.00	45,000
Steel string stairs with wood tread, upper commercial	2	FLT	20,000.00	40,000
Guardrails - on deck	335	LF	250.00	83,750
Elevator				
Passenger - 3500# lbs.	5	STP	56,500.00	282,500
Plumbing				
Fixtures				<i>NIC</i>
Water closet	16	EA	1,550.00	24,800
Urinals	2	EA	1,050.00	2,100
Vanity	14	EA	1,500.00	21,000
Janitor sink	2	EA	1,825.00	3,650
Hose bibb	4	EA	450.00	1,800
Floor drains	16	EA	650.00	10,400
Piping, domestic HW/CW insulated	1,540	LF	60.00	92,400
Piping, sanitary	1,925	LF	65.00	125,125
Water heating	1	LS	30,000.00	30,000
Devices	1	LS	15,000.00	15,000
Stub for future use	29,912	SF	3.50	104,692
Steam pipe riser relocation	1	LS	16,650.00	16,650
Mechanical - Rough in				
Heating systems and equipment	29,912	SF	5.25	157,038
Cooling systems and equipment	29,912	SF	4.88	145,821
Distribution systems	29,912	SF	7.50	224,340
Terminal and package units	29,912	SF	4.00	119,648
Controls	29,912	SF	3.25	97,214
System test and balance	29,912	SF	0.75	22,434
Misc. HVAC system	29,912	SF	2.50	74,780
Fire protection				
No work required				<i>NIC</i>

College Avenue Steam Plant Development

Phase 3: Warm Shell

Item Description	Quantity	Unit	Rate	Total
Electrical				
Limited distribution and pathways	29,912	SF	1.85	55,337
Emergency lighting and controls	29,912	SF	6.00	179,472
Conduit and pull string for data	29,912	SF	2.60	77,771
Generator and diesel tank relocation	1	LS	32,160.00	32,160
Fire protection				
Wet system	29,912	SF	5.50	164,516
Standpipe	70	LF	225.00	15,750
Equipment				
Wayfinding	29,912	SF	0.50	14,956
Trash compactor	1	EA	50,000.00	50,000
Reinstall industrial relics	1	LS	45,000.00	45,000
Direct Construction Cost	29,912	SF	180.73	5,406,114
Contingency - Construction and Design	20.0%			1,081,223
General Conditions	7.0%			454,114
General Requirements	7.5%			520,609
Contractor's Overhead and Profit or Fee	4.5%			335,793
Bonds and Insurance	1.5%			116,968
Construction Cost Before Escalation	29,912	SF	264.60	7,914,819
Escalation (Q1 2023)	4.67%			369,358
Construction Cost Including Escalation	29,912	SF	276.95	8,284,177

College Avenue Steam Plant Development

Phase 4: Tenant Improvement

Item Description	Quantity	Unit	Rate	Total
------------------	----------	------	------	-------

PROJECT AREAS

Sub-Basement - Not included	-	SF		
<i>Floor ht.</i>	12	LF		
Basement	7,803	SF		
<i>Floor ht.</i>	16	LF		
Main floor (less sitework)	10,249	SF		
<i>Floor ht.</i>	18	LF		
Level 2	7,040	SF		
<i>Floor ht.</i>	12	LF		
Level 3	2,410	SF		
<i>Floor ht.</i>	12	LF		
Level 4	2,410	SF		
<i>Floor ht.</i>	12	LF		

Total Project Area	29,912	SF		
---------------------------	---------------	-----------	--	--

Program Areas - Building

Brew pub	2,199	SF		
Brewery	3,877	SF		
Circulation	6,170	SF		
Commercialization	9,054	SF		
Food & drink	2,203	SF		
Coffee shop	562	SF		
Mixing	694	SF		
Restrooms	1,023	SF		
Vestibule	185	SF		
Existing to remain - no work	1,565	SF		

Program Areas - Site (See Sitework)

<i>Brew pub patio</i>	1,291	SF		
<i>Food & drink patio</i>	1,274	SF		
<i>Stairs</i>	1,630	SF		
<i>Elevated paths</i>	315	SF		

Phase 4: Tenant Improvement	29,912	SF	229.34	6,859,993
------------------------------------	---------------	-----------	---------------	------------------

Structural

See "Phase 3: Cold Shell"				<i>incl</i>
---------------------------	--	--	--	-------------

Interior construction

Partitions

Wood stud - painted 2x6 (assume), typ. complete	8,463	SF	18.50	156,566
Interior storefront	4,231	SF	75.00	317,325

College Avenue Steam Plant Development

Phase 4: Tenant Improvement

Item Description	Quantity	Unit	Rate	Total
Doors, frame and hardware				
Interior				
Single, flush	6	EA	2,850.00	17,100
Single, full glazed	11	EA	3,500.00	38,500
Finishes and build outs				
Brew pub	2,199	SF		
Casework, shelving	145	LF	385.00	55,825
Bartop	50	LF	750.00	37,500
Finishes (allow)				
Floor	2,199	SF	6.50	14,294
Ceiling	2,199	SF	4.41	9,698
Wall - specialty finish, incl. graphics	1	LS	30,000.00	30,000
Furniture - by Owner				NIC
Brewery	3,877	SF		
Equipment - by tenant, allow	1	LS	585,000.00	585,000
Grain storage				<i>incl</i>
Grist				<i>incl</i>
Boiler				<i>incl</i>
Fermentation tanks				<i>incl</i>
Mash				<i>incl</i>
Still				<i>incl</i>
Apple press				<i>incl</i>
Hot liquor tanks				<i>incl</i>
Post fermentation				<i>incl</i>
Brew Kettle				<i>incl</i>
Lauter Tun				<i>incl</i>
Bright Beer				<i>incl</i>
Bottling equipment				<i>incl</i>
Storage and misc equipment				<i>incl</i>
Specialty plumbing including drainage	3,877	SF	36.00	139,572
Controls (see electrical)				<i>incl</i>
Finishes (allow)				
Floor	3,877	SF	3.75	14,539
Ceiling	3,877	SF	1.85	7,172
Wall - specialty finish, incl. graphics	1	LS	10,000.00	10,000
Coffee shop	562	SF		
Bartop	15	LF	750.00	11,250
Casework, shelving	55	LF	385.00	21,175
Finishes (allow)				
Floor	3,877	SF	14.50	56,217

College Avenue Steam Plant Development

Phase 4: Tenant Improvement

Item Description	Quantity	Unit	Rate	Total
Ceiling	3,877	SF	1.85	7,172
Wall - specialty finish, incl. graphics	1	LS	10,000.00	10,000
Furniture - by Owner				NIC
Commercialization	9,054	SF		
Tenant fit out	9,054	SF	45.00	407,430
Food & drink	2,203	SF		
Bartop	65	LF	750.00	48,750
Casework, shelving	150	LF	385.00	57,750
Casework, seating	65	LF	300.00	19,500
Finishes (allow)				
Floor	2,203	SF	14.50	31,944
Ceiling	2,203	SF	1.85	4,076
Wall - specialty finish, incl. graphics	1	LS	30,000.00	30,000
Furniture - by Owner				NIC
Mixing	694	SF		
Finishes (allow)				
Floor	694	SF	14.50	10,063
Ceiling	694	SF	1.85	1,284
Wall - specialty finish, incl. graphics	1	LS	5,000.00	5,000
Furniture - by Owner				NIC
Restrooms	1,023	SF		
Finishes (allow)				
Floor	1,023	SF	15.00	15,345
Ceiling	1,023	SF	10.50	10,742
Wall - specialty finish, incl. graphics	1	LS	50,000.00	50,000
Circulation & Vestibule	6,355	SF		
Finishes (allow)				
Floor	6,355	SF	6.50	41,308
Ceiling	6,355	SF	1.85	11,757
Wall - specialty finish, incl. graphics	1	LS	20,000.00	20,000
Plumbing				
Kitchen sink	6	EA	1,250.00	7,500
Distributions from stub ups	29,912	SF	3.30	98,710
Mechanical- Finish				
Heating systems and equipment	29,912	SF	5.25	157,038
Cooling systems and equipment	29,912	SF	4.88	145,821
Distribution systems	29,912	SF	7.50	224,340
Terminal and package units	29,912	SF	4.00	119,648
Controls	29,912	SF	3.25	97,214
System test and balance	29,912	SF	0.75	22,434

College Avenue Steam Plant Development

Phase 4: Tenant Improvement

Item Description	Quantity	Unit	Rate	Total
Misc. HVAC system	29,912	SF	2.50	74,780
Electrical				
Distribution	29,912	SF	12.00	358,944
Lighting fixtures	29,912	SF	9.30	278,182
Lighting controls	29,912	SF	2.80	83,754
Tele/data	29,912	SF	2.75	82,258
PA system	29,912	SF	2.00	59,824
AV systems	29,912	SF	6.00	179,472
WAP	8	EA	1,650.00	13,200
Security				
Access controls	4	EA	4,500.00	18,000
CCTV	29,912	SF	2.50	74,780
Equipment				
Kitchen equipment	1	LS	300,000.00	300,000
Furnishings				
See "Finishes and Build Outs"				<i>incl. above</i>
Direct Construction Cost	29,912	SF	157.12	4,699,748
Contingency - Construction and Design	20.0%			939,950
General Conditions	7.0%			394,779
General Requirements	7.5%			452,586
Contractor's Overhead and Profit or Fee	4.5%			271,551
Bonds and Insurance	1.5%			101,379
Construction Cost Before Escalation				6,859,993
Escalation (Q1 2023)	4.7%			320,133
Construction Cost Including Escalation	29,912	SF	240.04	7,180,126

College Avenue Steam Plant Development

Sitework

Item Description	Quantity	Unit	Rate	Total
Sitework	36,580	SF		
Site protection - elements to remain, incl. dust control	36,580	SF	1.50	54,870
Sitework				
Site prep	4,510	SF	4.50	20,295
Sitework general, allow	1	LS	30,000.00	30,000
Brew pub patio	1,291			
Elevated slab	1,291	SF	12.50	16,138
Curb wall - 4' ht.	175	LF	260.00	45,500
Continuous footing	26	CY	650.00	16,852
Aggregate fill	191	CY	40.00	7,650
Patio railing	135	LF	225.00	30,375
Furnishing - by other				NIC
Food & drink patio	1,274			
Elevated slab	1,274	SF	12.50	15,925
Curb wall - 4' ht.	175	LF	260.00	45,500
Continuous footing	26	CY	650.00	16,852
Aggregate fill	189	CY	40.00	7,550
Patio railing	135	LF	225.00	30,375
Furnishing - by other				NIC
Elevated walkway	315	SF	125.00	39,375
Stairs, CIP concrete	1,630	SF	55.00	89,650
Rails	228	LF	225.00	51,300
Site Utilities	1	LS	320,000.00	320,000
Site Electrical	1	LS	145,000.00	145,000
Prep and paint tanks and concrete walls	2	EA	12,000.00	24,000
Site - parking lot improvement	32,070	SF	36.60	1,173,762
Environmental hazardous material abatement - by others				<i>Separate Budget</i>
Direct Construction Cost	36,580	SF	59.62	2,180,968
Contingency - Construction and Design	20.0%			436,194
General Conditions	7.0%			183,201
General Requirements	7.5%			210,027
Contractor's Overhead and Profit or Fee	4.5%			135,468
Bonds and Insurance	1.5%			47,188
Construction Cost Before Escalation	36,580	SF	87.29	3,193,046
Escalation (Q1 2023)	4.67%			149,009
Construction Cost Including Escalation	36,580	SF	91.36	3,342,055