


PFAS Contamination in Groundwater U.S. Army Yakima Training Center (YTC)

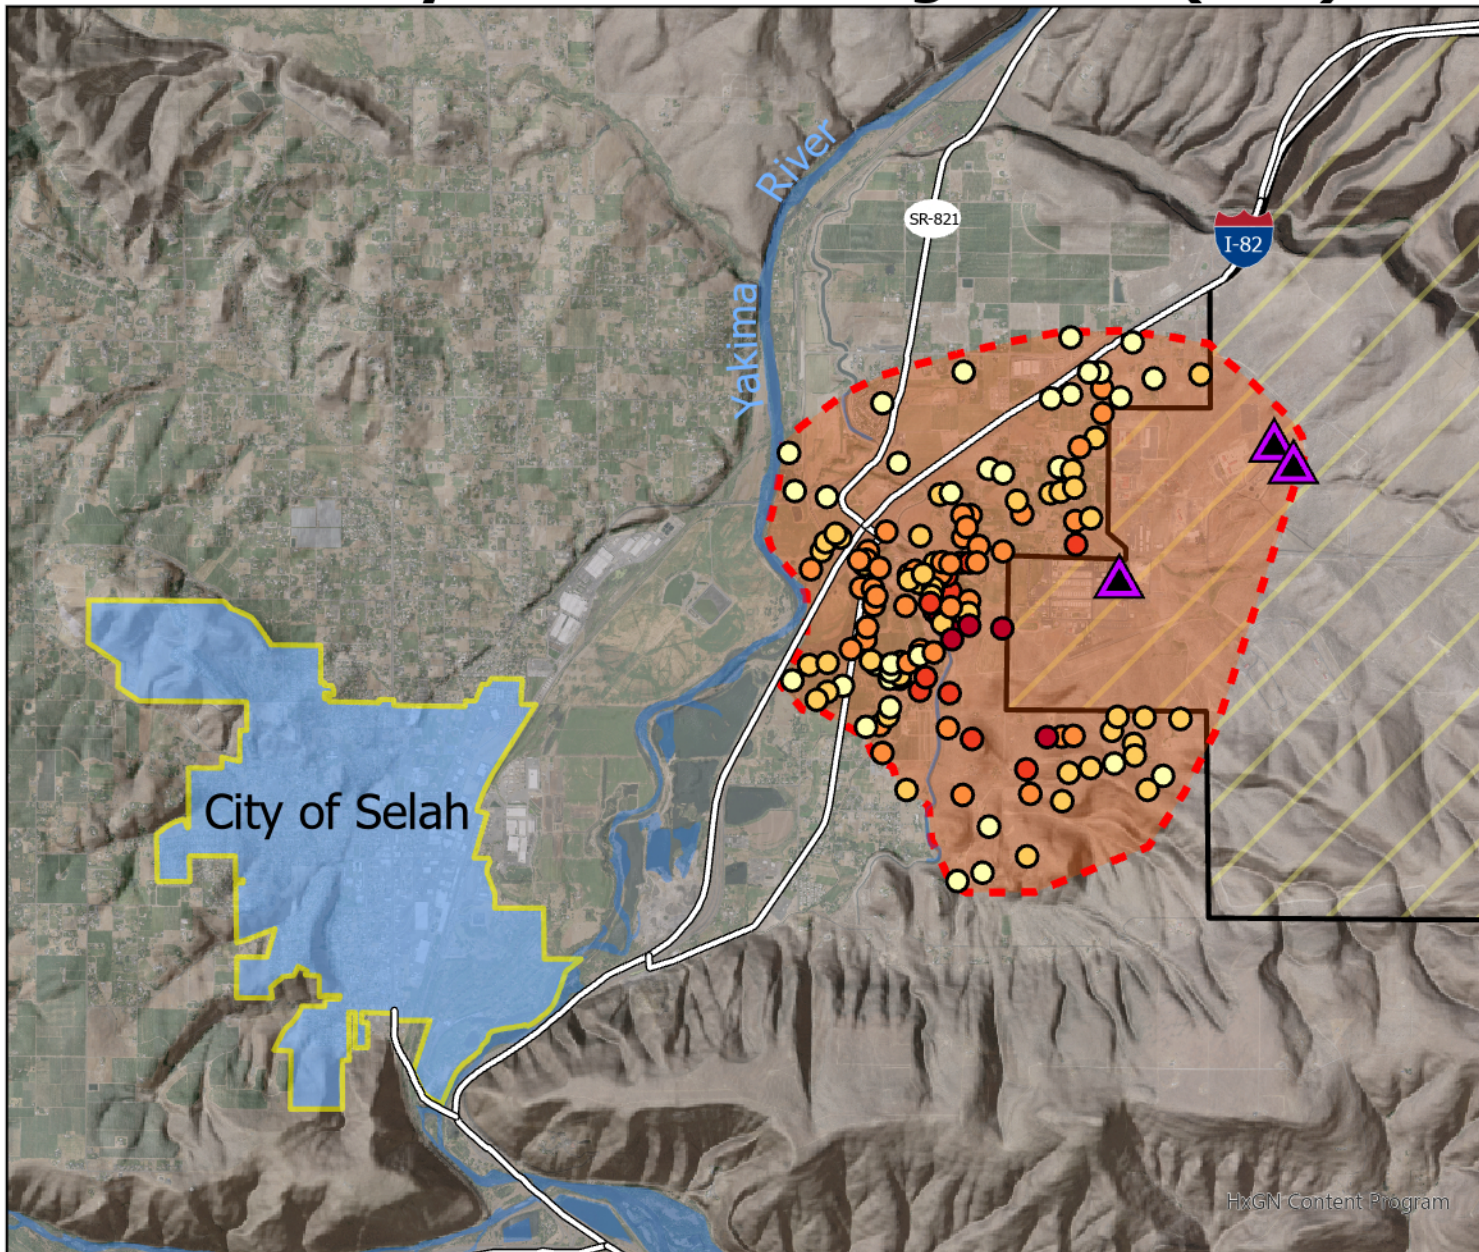

Confirmed PFAS Sources

Wells *PFOA + PFOS (ppt)

- 1.0 - 10.0 (34)
- 10.1 - 70.0 (50)
- 70.1 - 400.0 (46)
- 400.1 - 800.0 (13)
- 800.1 - 1650.0 (6)

PFAS Contamination


U.S. Army YTC

*Data source: 2021-2023 U.S. Army and U.S. Environmental Protection Agency (EPA) sampling.

On April 10, 2024, the U.S EPA announced a new regulation to establish legally enforceable levels called Maximum Contaminant Levels (MCLs) for 6 PFAS chemicals in drinking water including those found in groundwater at the Yakima Training Center.

MCL for PFOA: 4ppt, PFOS: 4ppt

HxGN Content Program



May 2024