

**GALVANIC CATHODIC PROTECTION
EVALUATION CHECKLIST
FOR UNDERGROUND STORAGE TANKS**

This checklist certifies that cathodic protection testing activities were performed and conducted in accordance with Chapter 173-360A WAC. Instructions are found on the back page.

| I. UST FACILITY | | II. CERTIFIED CATHODIC PROTECTION TESTER | | | |
|--|--|---|---|--|---|
| Facility Compliance Tag #: A0005 | | Service Provider Name: MARCUS ROUNDS | | | |
| UST ID #: 3997 | | Company Name: MTM SERVICES LLC | | | |
| Site Name: FOODMART #0605 | | Address: PO BOX 576 | | | |
| Site Address: 108 HWY 603 | | City: TWISP | State: WA Zip: 98856 | | |
| City: CHEHALIS | | Phone: 509-560-0421 | Email: MARCUS.ROUNDS94@GMAIL.COM | | |
| County: LEWIS | | Certification Type: AMPP | | | |
| Phone: 253-255-0487 | | Certification Number: 205036 | Exp. Date: 10-27 | | |
| III. RESULTS OF EVALUATION (which include results of both continuity and system surveys) | | | | | |
| <input checked="" type="checkbox"/> PASS | The criteria used to evaluate whether cathodic protection is adequate were in accordance with a code of practice developed by a nationally recognized association (e.g. NACE), as required by the Washington State Underground Storage Tank Regulations. | | | | |
| Date CP Evaluation Performed: 6/4/2025 | | | | | |
| IV. CRITERIA APPLICABLE TO EVALUATION | | | | | |
| Continuity Survey | | <input checked="" type="checkbox"/> PASS – continuity data is passing and no action is needed | | | |
| | | <input type="checkbox"/> FAIL – continuity data is failing and the system requires a repair or retrofit | | | |
| System Survey | | # TANKS WINS | # STP SFC¹ | # DISP. SFC² | |
| Neg. 850 mV ON | <input checked="" type="checkbox"/> PASS | | | 3 | A negative (cathodic) potential of at least -850 mV with the cathodic protection applied. This potential is with respect to a saturated copper-copper sulfate reference electrode containing electrolyte. |
| | <input type="checkbox"/> FAIL | | | | |
| Neg. 850 mV Instant Off | <input type="checkbox"/> PASS | | | | A negative polarized potential of at least 850 mV relative to a saturated copper-copper sulfate reference electrode (Instant Off Potential). |
| | <input type="checkbox"/> FAIL | | | | |
| 100 mV Polarization | <input type="checkbox"/> PASS | | | | A minimum of 100 mV of cathodic polarization between the structure surface and a stable reference electrode contacting the electrolyte. |
| | <input type="checkbox"/> FAIL | | | | |
| V. ACTION REQUIRED AS A RESULT OF THIS EVALUATION (check one box and explain further in comment box below) | | | | | |
| <input type="checkbox"/> NONE | | The cathodic protection system is adequately providing protection. No further action is necessary at this time. System must be tested in three years unless more immediate attention is required. | | | |
| <input type="checkbox"/> RETEST | | The cathodic protection system may not be adequately protecting steel from corroding. Retesting is necessary. | | | |
| <input type="checkbox"/> RETROFIT/REPAIR | | The cathodic protection system is not adequately providing protection. Retrofitting or repairing is necessary. | | | |
| <input checked="" type="checkbox"/> RETEST AFTER RETROFIT/REPAIR | | The cathodic protection system has been retrofitted or repaired and tested at time of the retrofit/repair. Testing is required again within one to six months after the retrofit or repair. | | | |
| Comments (include type of testing gear used, steel components tested, etc.): FLUKE 110 MULTIMETER, MCMILLER RE-5 REFERENCE CELL, COPPER ROD, WIRE SPOOL, REPAIRED CUT WIRE ON SUL TANK AND INSTALLED NEW DIELECTRIC UNION | | | | | |

1. If no submersible turbine pump (STP) is present, these steel flex connectors (SFC) are on the tank end of piping.
2. If no dispenser is installed, these SFCs are on the non-tank end of piping.

VI. CONTINUITY SURVEY

VII. SYSTEM SURVEY


XI. UST SITE PLAN

Diagram the UST System, including tanks, piping, and dispenser locations, approximate scale, and any other notable structures/physical features. Indicate north with arrow. On the map below, include the half cell locations used during testing. All test points must be easily identifiable, so that testing can be reproduced and your results verified.


N
4

HWY 6

Old Hwy 603

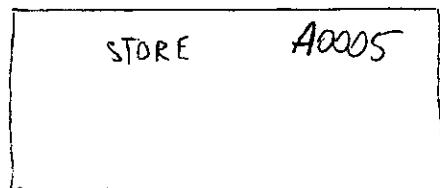

□ Fuel Island

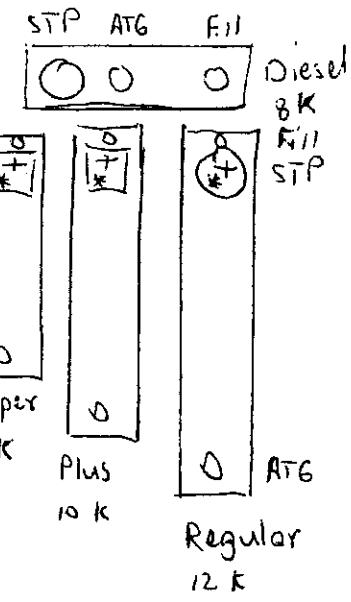



+ Structure contact

* Reference cell location

* Remote

IX. RETROFIT OR REPAIR DESIGN (if applicable)

All retrofitting or repairs to CP systems shall be designed by a Corrosion Expert. I certify that I am a Corrosion Expert qualified to engage in the practice of corrosion control on buried or submerged metal piping systems and metal tanks. I have attached copies of the retrofit/repair design and of the Underground Storage Tank Retrofit and Repair Checklist.

| | |
|--|---|
| Corrosion Expert's Name: | Company's Name: |
| Nationally Recognized Association: | Certification Number: |
| Corrosion Expert's Signature: | Date: |
| X. REQUIRED SIGNATURES | |
| <i>The certified supervisor certifies the criteria used to evaluate whether cathodic protection is adequate were in accordance with a code of practice developed by a nationally recognized association (e.g. NACE), as required by the Washington State Underground Storage Tank Regulations.</i> | |
| 6-4-25 |  |
| Date | Signature of Certified Supervisor |
| 6-4-25 |  |
| Date | Signature of Tank Owner or Authorized Representative |
| Print or Type Name | |
|  | |
| Print or Type Name | |
|  | |
| Print or Type Name | |