

VGB/32/5A/NW

UF

✓

SNE # 1940

11/31/91  
Entered closure  
info.  
KLB

BUD'S A-1 PUMP SERVICE  
P.O. BOX 45  
MOUNT VERNON, WA. 98273-0045

DEPARTMENT OF ECOLOGY  
UNDERGROUND STORAGE TANKS

OCT 31 1991

AUGUST 23, 1991

SITE ASSESSMENT: PORT OF EVERETT  
1001 14TH STREET  
BOAT HOUSE/ YACHT SALES  
EVERETT, WA. 98201

ON JANUARY 17, 1991, ONE 500 GALLON AND ONE 2000 GALLON TANKS WERE REMOVED FROM THIS SITE. LABORATORY SAMPLES COLLECTED BY KALDVEER ASSOCIATES (REFER TO THE REPORT FILED, DATED 03/19/91). IN AREA T-4 ON KALDVEER SITE PLAN, LEVELS OF CONTAMINATION WERE RECORDED AT 3300 PPM. THIS ENTIRE AREA WAS RE-EXCAVATED AND NEW SAMPLES WERE TAKEN, WATER WAS PUMPED OUT OF THE AREA AND PROPERLY DISPOSED OF. NEW SOIL SAMPLES AS WELL AS WATER SAMPLES INDICATE THAT THIS AREA IS NO LONGER CONTAMINATED. ALL REMOVED SOIL WAS PLACED IN A BERM YARD AND AERATED OVER A THIRTY DAY PERIOD, RECHECKED AND THEN PLACED ON THE NORTH SECTION OF PORT PROPERTY.


SINCERELY,

*M. Bud Ebeling*

BUD EBELING  
A-1 PUMP SERVICE

CC: D. O. E.  
CC: A-1 PUMP SERVICE


DEPARTMENT OF ECOLOGY	
NWRO/TCP TANK UNIT	
# 1940	
INTERIM CLEANUP REPORT	<input checked="" type="checkbox"/>
SITE CHARACTERIZATION	<input type="checkbox"/>
FINAL CLEANUP REPORT	<input type="checkbox"/>
OTHER _____	<input type="checkbox"/>
AFFECTED MEDIA: SOIL	<input checked="" type="checkbox"/>
OTHER _____ GW	<input type="checkbox"/>
INSPECTOR (INIT.) <i>WJ</i>	DATE: <i>U-30-92</i>

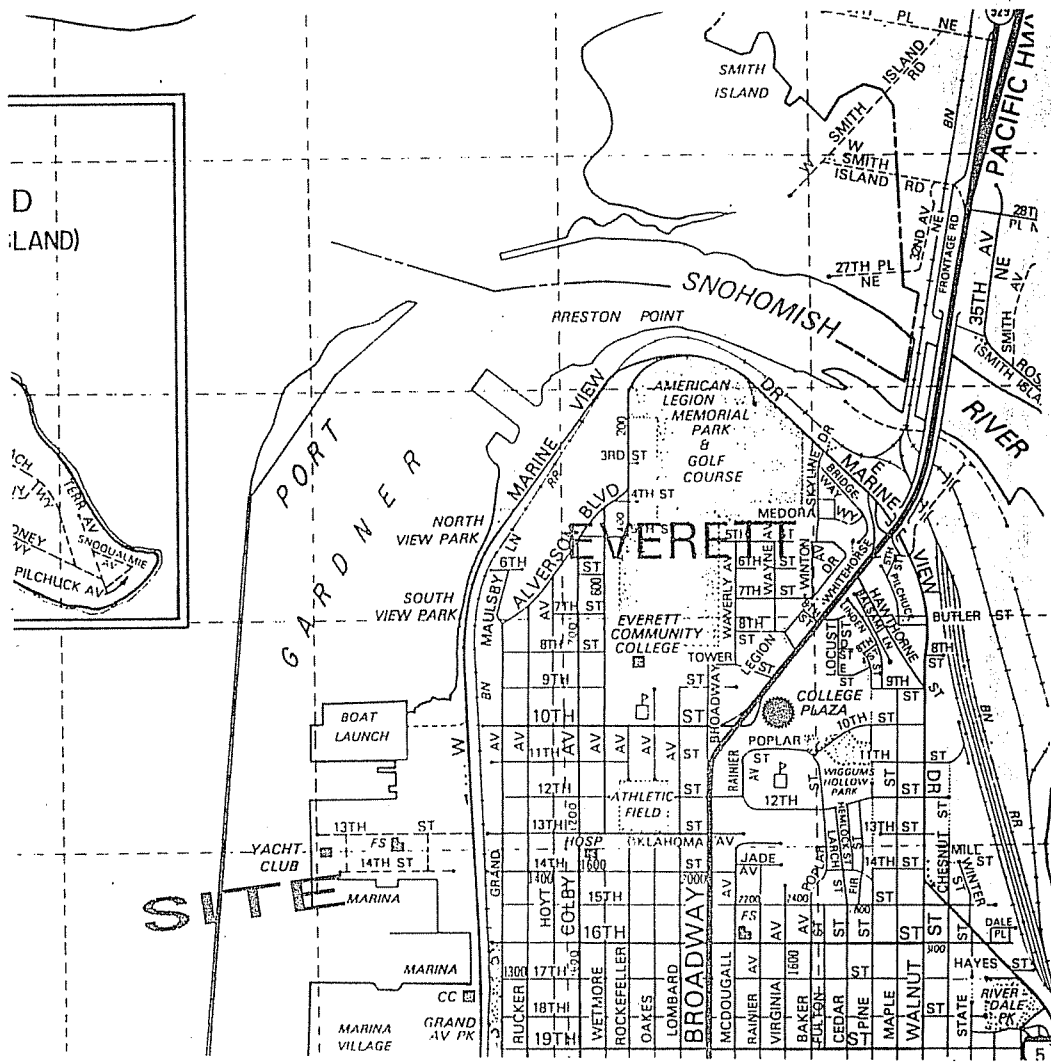

Reference:  
 Snohomish County / Map 34  
 The Thomas Guide, 1990 Edition  
 By Thomas Bros Maps

*Bud's*  
 PUMP SERVICE  
 P. O. BOX 45  
 MOUNT VERNON, WA 98273

VICINITY MAP		
EVERETT BOAT HOUSE TANKS EVERETT, WASHINGTON		
PROJECT NO.	DATE	FIGURE 1
WE-1034-01-042	2/15/91	

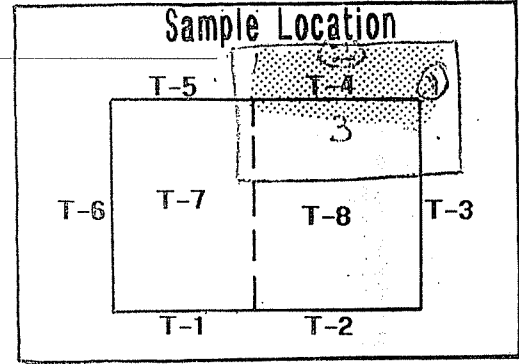

Marina

14th Street

Harbor Marine  
Maintenance & Supply

Boat lift

Tanks Location

Marina Dry  
Covered Moorage

SCHMATIC - NOT TO SCALE

SITE PLAN

EVERETT BOAT HOUSE TANKS  
EVERETT, WASHINGTON

*Bud's*  
PUMP SERVICE  
P. O. BOX 45  
MOUNT VERNON, WA 98273

PROJECT NO.

DATE

FIGURE 2

WE-1034-01-042

2/15/91

MTC

Analytical/Environmental Services

Materials Testing & Consulting, Inc.

P.O. Box 309

Mount Vernon, WA 98273

WSDOH Laboratory #46092090

(206)424-7560 - FAX (206)424-7550

Client: 12  
 A-1 Pump Inc.  
 335 N. Baker  
 Mount Vernon, WA 98273


Date: 8/2/91  
 Reference: 91-0431

Attn: Mr. Bud Ebeling

Project: P of E Boat Yard House  
 1001 14th St

Data Report

Lab Number	Sample Description	ug/gm	ng/gm			
		TPH	Benzene	Toluene	Ethlybenzene	Xylenes
19-91-01293.OS	West Wall Mid-Bank	<1	<5	<5	<5	<5
19-91-01297.OS	South Wall 2/3 Mid-Bank	<1	<5	<5	<5	<5
19-91-01298.OS	Water Sample	<0.01	<1	<1	<1	<1
Methods:						
BTEX/TPH SW846 8020/8015mod.						
G- Gasoline                      D-Diesel		Soil/Water	Soil/Water	Soil/Water	Soil/Water	Soil/Water
Method Reporting Limit (MRL)		0.05/0.01	5/1	5/1	5/1	5/1
Maximum Contamination Levels		100/1	500/5	20000/20	40000/40	20000/20

  
 Kurt W. Larsen  
 Sr. Enviromental Chemist