

APPENDIX B

REMEDIAL INVESTIGATION SOIL ANALYTICAL RESULTS TABLE

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)											
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC		
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050		
Perimeter Injection Wells																
PRB-A3/PRB-C3	A3C3-3	1/16/19	3	39.67	0.904 U	0.000427 U	0.00283 J	0.000565 U	0.00510 U	0.00790	0.000766 J	0.000736 U	0.00152 U	0.000728 U		
	A3C3-6	1/16/19	6	36.67	0.973 U	0.000459 U	0.00350 J	0.00140 J	0.00548 U	0.160	0.0214	0.00343	0.00164 U	0.000783 U		
	A3C3-8	1/16/19	8	34.67	12.9	0.00540	0.0380	0.00311 J	0.0142	0.149	0.0396	0.00948	0.00287 U	0.00137 U		
	A3C3-10	2/13/19	10	32.67	3.52	0.00236	0.00626 J	0.00132 J	0.00652 J	0.00298 J	0.000543 U	0.00175 J	0.00194 U	0.000928 U		
	A3C3-15	2/13/19	15	27.67	4.42	0.00298	0.0167	0.00379	0.0136	0.00281 J	0.000462 U	0.000798 U	0.00165 U	0.000789 U		
	A3C3-20	2/13/19	20	22.67	1.38 J	0.000913 J	0.00143 U	0.000606 U	0.00547 U	0.000801 U	0.000458 U	0.000789 U	0.00164 U	0.000781 U		
	A3C3-25	2/13/19	25	17.67	1.01 U	0.000638 J	0.00149 U	0.000632 U	0.00570 U	0.000835 U	0.000477 U	0.00390	0.00171 U	0.000815 U		
	A3C3-32	2/13/19	32	10.67	1.37 J	0.000776 J	0.00144 U	0.000611 U	0.00551 U	0.000807 U	0.000461 U	0.119	0.00169 J	0.00675		
	A3C3-35	2/13/19	35	7.67	1.21 J	0.000572 J	0.00158 J	0.000599 U	0.00540 U	0.00198 J	0.000452 U	0.0369	0.00162 U	0.000772 U		
	A3C3-40	2/13/19	40	2.67	2.31 J	0.000654 J	0.00156 J	0.000652 U	0.00588 U	0.265	0.0163	0.471	0.00227 J	0.000841 U		
	A3C3-45	2/13/19	45	-2.33	1.27 J	0.00108 J	0.00196 J	0.000602 U	0.00543 U	0.000794 U	0.000454 U	0.121	0.00300 J	0.000775 U		
A3C3-50	2/13/19	50	-7.33	1.40 J	0.000509 J	0.00167 J	0.000625 U	0.00564 U	0.0279	0.00163	0.108	0.00198 J	0.0203			
PRB-A9/PRB-C9	A9C9-3	1/21/19	3	40.12	–	0.141	0.0115	0.00160 J	0.00806 U	0.109	0.000675 U	0.00116 U	0.00242 U	0.00115 U		
	A9C9-6	1/21/19	6	37.12	–	0.0153	0.00773	0.00295 J	0.0170	0.00257 J	0.000490 U	0.000845 U	0.00175 U	0.000837 U		
	A9C9-10	1/21/19	10	33.12	–	0.0228	0.00384 J	0.000632 J	0.00552 U	0.00251 J	0.000462 U	0.00338	0.00165 U	0.00102 J		
	A9C9-15	2/7/2019	15	28.12	–	0.00166	0.00146 U	0.000618 U	0.00558 U	0.0477	0.0296	0.0243	0.00167 U	0.000797 U		
	A9C9-20	2/7/2019	20	23.12	–	0.000462 J	0.00144 U	0.000609 U	0.00549 U	0.0190	0.00885	0.00665	0.00164 U	0.000785 U		
	A9C9-25	2/7/2019	25	18.12	–	0.000430 U	0.00135 U	0.000570 U	0.00514 U	0.0381	0.00731	0.00881	0.00154 U	0.00576		
	A9C9-32	2/7/2019	32	11.12	–	0.000558 J	0.00160 J	0.000566 U	0.00511 U	4.44	1.32	1.04	0.00738	0.0872		
	A9C9-35	2/7/2019	35	8.12	–	0.000423 U	0.00132 U	0.000561 U	0.00506 U	0.187	0.248	0.167	0.00170 J	0.00747		
	A9C9-40	2/7/2019	40	3.12	–	0.000825 J	0.00217 J	0.000569 U	0.00513 U	0.0243	0.153	1.74	0.00383 J	0.0754		
	A9C9-45	2/7/2019	45	-1.88	–	0.000500 J	0.00140 J	0.000555 U	0.00500 U	0.00154 J	0.00275	0.0596	0.00150 U	0.0123		
	A9C9-50	2/7/2019	50	-6.88	–	0.000690 J	0.00174 J	0.000570 U	0.00514 U	0.415	0.0656	0.0743	0.00183 J	0.0124		
B-931-50 (duplicate)	2/7/2019	50	-6.88	–	0.000725 J	0.00181 J	0.000570 U	0.00514 U	0.387	0.0732	0.0869	0.00208 J	0.0181			
PRB-B1/PRB-D1	B1D1-11	1/17/19	11	30.75	2.42 J	0.00250	0.00261 J	0.00129 J	0.00558 U	0.00192 J	0.000467 U	0.000806 U	0.00167 U	0.000798 U		
	B1D1-15	1/17/19	15	26.75	1.67 J	0.000611 U	0.00191 U	0.000810 U	0.00731 U	0.00107 U	0.000611 U	0.00105 U	0.00219 U	0.00104 U		
	B1D1-20	1/17/19	20	21.75	1.67 J	0.000491 U	0.00153 U	0.000651 U	0.00587 U	0.00173 J	0.000491 U	0.0236	0.00176 U	0.000838 U		
	B1D1-25	1/17/19	25	16.75	1.89 J	0.000625 J	0.00174 U	0.000737 U	0.00665 U	0.00783	0.0922	0.148	0.00304 J	0.0596		
	B1D1-31	1/17/19	31	10.75	1.07 J	0.000435 U	0.00136 U	0.000577 U	0.00520 U	0.0185	0.0176	0.0147	0.00156 U	0.00468		
	B1D1-35	1/17/19	35	6.75	1.05 J	0.000490 U	0.00153 U	0.000649 U	0.00585 U	0.0505	0.0219	0.0194	0.00175 U	0.000837 U		
	B1D1-40	1/17/19	40	1.75	0.969 J	0.000447 U	0.00140 U	0.000592 U	0.00534 U	0.123	0.0284	0.0157	0.00160 U	0.000764 U		
	B1D1-45	1/17/19	45	-3.25	1.18 J	0.000458 U	0.00143 U	0.000607 U	0.00547 U	0.478	0.139	0.0852	0.00164 U	0.000989 J		
	B1D1-50	1/17/19	50	-8.25	1.69 J	0.000462 U	0.00144 U	0.000612 U	0.00552 U	1.71	0.274	0.199	0.00268 J	0.00154 J		
PRB-B2/PRB-D2	B2D2-3	1/16/19	3	38.75	0.924 U	0.000436 U	0.00144 J	0.000578 U	0.00521 U	0.0133	0.000436 U	0.000752 U	0.00156 U	0.000745 U		
	B2D2-6	1/16/19	6	35.75	4.28	0.0111	0.00424 J	0.00256 J	0.0127	0.180	0.000557 U	0.000961 U	0.00199 U	0.000951 U		
	B2D2-10	1/21/19	10	31.75	24.9	0.274	0.118	0.0240	0.0516	0.00154 J	0.00166 J	0.864	0.0366	0.141		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)											
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC		
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050		
PRB-B4/PRB-D4	B4D4-3	1/17/19	3	39.67	–	0.000453 U	0.00141 U	0.000600 U	0.00541 U	0.000792 U	0.000453 U	0.000781 U	0.001620 U	0.000773 U		
	B4D4-6	1/17/19	6	36.67	–	0.00961	0.00647 J	0.00168 J	0.00818 J	0.0605	0.00337	0.00697	0.002250 U	0.00371 J		
	B4D4-10	1/17/19	10	32.67	–	0.00245 J-	0.00632 J-	0.00140 J-	0.00611 J-	0.00665 J-	0.00675 J-	0.0467 J-	0.00429 J-	0.0160 J-		
PRB-B5/PRB-D5	B5D5-10	2/14/19	10	32.92	–	0.00147	0.00260 J	0.000621 U	0.00560 U	0.140	0.00203	0.0484	0.00325 J	0.000800 U		
	B5D5-15	2/14/19	15	27.92	–	0.000466 U	0.00146 U	0.000617 U	0.00557 U	0.00298	0.000466 U	0.0104	0.00166 U	0.000795 U		
	B5D5-20	2/14/19	20	22.92	–	0.000467 U	0.00146 U	0.000619 U	0.00558 U	0.00166 J	0.000467 U	0.0277	0.00167 U	0.000798 U		
	B5D5-25	2/14/19	25	17.92	–	0.000471 U	0.00147 U	0.000624 U	0.00563 U	0.0608	0.00455	0.156	0.00294 J	0.00858		
	B5D5-32	2/14/19	32	10.92	–	0.000600 J	0.00142 U	0.000602 U	0.00543 U	0.0382	0.00548	0.257	0.00280 J	0.0169		
	B5D5-35	2/14/19	35	7.92	–	0.000735 J	0.00155 J	0.000584 U	0.00527 U	0.200	0.000844 J	0.924	0.0482	0.136		
	B5D5-40	2/14/19	40	2.92	–	0.000878 J	0.00144 J	0.000585 U	0.00527 U	0.483	0.00165	1.80	0.0103	0.219		
	B5D5-45	2/14/19	45	-2.08	–	0.000824 J	0.00148 J	0.000570 U	0.00514 U	3.45	0.310	0.712	0.00663	0.0802		
	B5D5-50	2/14/19	50	-7.08	–	0.000797 J	0.00233 J	0.000553 U	0.00498 U	0.0112	0.00173	0.0246	0.00149 U	0.0158		
	B-932-50	2/14/19	50 (dup)	-7.08	–	0.000746 J	0.00200 J	0.000651 J	0.00595 J	0.0148	0.00198	0.0260	0.00152 U	0.0223		
PRB-B6/PRB-D6	B6D6-17	2/20/19	17	25.92	–	0.000460 U	0.00146 J	0.000609 U	0.00550 U	0.00641	0.00629	0.00388	0.00164 U	0.000785 U		
	B6D6-20	2/20/19	20	22.92	–	0.000465 U	0.00201 J	0.000615 U	0.00555 U	0.00154 J	0.00333	0.0233	0.00166 U	0.000793 U		
	B6D6-25	2/20/19	25	17.92	–	0.000476 U	0.00149 U	0.000631 U	0.00569 U	0.00806	0.00229	0.0372	0.00170 U	0.000813 U		
	B6D6-32	2/20/19	32	10.92	–	0.000482 U	0.00151 U	0.000638 U	0.00576 U	0.441	0.147	0.402	0.00889	0.000823 U		
	B6D6-35	2/20/19	35	7.92	–	0.000453 J	0.00140 J	0.000575 U	0.00519 U	0.575	0.577	0.420	0.0293	0.000741 U		
	B6D6-40	2/20/19	40	2.92	–	0.000692 J	0.00187 J	0.000626 U	0.00564 U	0.00500	0.0210	0.0713	0.00213 J	0.000807 U		
	B6D6-45	2/20/19	45	-2.08	–	0.000884 U	0.00282 J	0.00117 U	0.0106 U	0.193	0.316	1.82	0.00347 J	0.00759		
	B6D6-50	2/20/19	50	-7.08	–	0.000428 U	0.00156 J	0.000567 U	0.00512 U	0.00513	0.00153	0.00754	0.00153 U	0.000731 U		
	B-933-50	2/20/19	50 (dup)	-7.08	–	0.000440 U	0.00216 J	0.000583 U	0.00526 U	0.285	0.264	0.552	0.00224 J	0.000751 U		
PRB-B10/PRB-D10	B10D10-15	2/21/19	15	30.13	–	0.00843	0.00787	0.00170 J	0.00656 J	0.0321	0.000504 U	0.00105 J	0.00180 U	0.000861 U		
	B10D10-20	2/21/19	20	25.13	–	0.000483 U	0.00151 U	0.000640 U	0.00577 U	0.00726	0.00164	0.339	0.00334 J	0.000825 U		
	B10D10-25	2/21/19	25	20.13	–	0.000452 U	0.00185 J	0.000599 U	0.00540 U	1.89	0.419	0.196	0.00652	0.000772 U		
	B10D10-30	2/21/19	30	15.13	–	0.000449 U	0.00140 U	0.000595 U	0.00537 U	1.03	0.603	0.409	0.00837	0.000767 U		
	B10D10-35	2/21/19	35	10.13	–	0.000439 U	0.00154 J	0.000582 U	0.00525 U	0.0809	0.418	0.995	0.00238 J	0.000750 U		
	B10D10-40	2/21/19	40	5.13	–	0.000457 U	0.00166 J	0.000605 U	0.00546 U	0.0210	0.0552	0.694	0.00163 U	0.000780 U		
	B10D10-45	2/21/19	45	0.13	–	0.007010 U	0.0218 U	0.00929 U	0.0837 U	0.00757 U	0.0182	0.209	0.0251 U	0.0120 U		
	B10D10-50	2/21/19	50	-4.87	–	0.000443 U	0.00146 J	0.000587 U	0.00529 U	0.251	0.247	0.564	0.00208 J	0.000756 U		
PRB-B11/PRB-D11	B11D11-10	1/15/19	10	35.13	–	0.000539 U	0.0101	0.000783 J	0.00644 U	0.000944 U	0.000539 U	0.000921 U	0.00193 U	0.000921 U		
	B11D11-15	1/15/19	15	30.13	–	0.000436 U	0.00136 U	0.000577 U	0.00520 U	0.00295	0.00351	0.00436	0.00156 U	0.000744 UJ		
	B11D11-20	1/15/19	20	25.13	–	0.000459 U	0.00144 U	0.000608 U	0.00549 U	0.0526	0.0138	0.0158	0.00164 U	0.000784 UJ		
	B11D11-27	1/15/19	27	18.13	–	0.000439 U	0.00137 U	0.000581 U	0.00524 U	1.77	0.0723	0.0292	0.00157 U	0.000749 U		
	B11D11-30	1/15/19	30	15.13	–	0.000415 U	0.00130 U	0.000550 U	0.00496 U	4.42	0.226	0.0698	0.00410 J	0.000709 UJ		
	B11D11-35	1/15/19	35	10.13	–	0.000469 J	0.00160 J	0.000593 U	0.00535 U	2.6	0.441	0.574	0.00269 J	0.000764 UJ		
	B11D11-40	1/15/19	40	5.13	–	0.000437 U	0.00136 U	0.000578 U	0.00522 U	0.0198	0.0156	0.275	0.00156 U	0.000745 UJ		
	B11D11-46	1/15/19	46	-0.87	–	0.000451 U	0.00141 U	0.000597 U	0.00539 U	1.13	0.273	0.105	0.00185 J	0.000770 UJ		
	B-928-46	1/15/19	46 (dup)	-0.87	–	0.000450 U	0.00141 U	0.000596 U	0.00538 U	1.43	0.332	0.13	0.00216 J	0.000768 UJ		
	B11D11-50	1/15/19	50	-4.87	–	0.000533 U	0.00238 J	0.000707 U	0.00637 U	0.0119	0.00177	0.0512	0.00190 U	0.000910 UJ		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co–Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
PRB-B13/PRB-D13	B13D13-10	03/21/19	10	37.50	–	0.000456 U	0.00143 U	0.000604 U	0.00545 U	0.000798 U	0.000456 U	0.000787 U	0.00163 U	0.000779 U	
	B13D13-20	03/21/19	20	27.50	–	0.000474 U	0.00148 U	0.000628 U	0.00566 U	0.000829 U	0.000474 U	0.000817 U	0.00169 U	0.000809 U	
	B13D13-30	03/21/19	30	17.50	–	0.000460 U	0.00144 U	0.000609 U	0.00549 U	0.0498	0.0117	0.0169	0.00164 U	0.000785 U	
	B13D13-40	03/21/19	40	7.50	–	0.000427 U	0.00133 U	0.000566 U	0.00510 U	0.00300	0.000505 J	0.00174 J	0.00153 U	0.000729 U	
	B13D13-50	03/21/19	50	-2.50	–	0.000439 UJ	0.00137 UJ	0.000582 U	0.00525 UJ	0.00784	0.00166 UJ	0.000758 U	0.00157 U	0.00075 UJ	
PRB-B16/PRB-D16	B16D16-15	03/13/19	15	34.5	–	0.001880 U	0.00587 U	0.00249 U	0.0224 U	0.00329 U	0.00188 U	0.00324 U	0.00672 U	0.00321 U	
	B16D16-20	03/13/19	20	29.5	–	0.000438 U	0.00137 U	0.000580 U	0.00523 U	0.0142	0.000603 J	0.000755 U	0.00156 U	0.000747 U	
	B16D16-25	03/13/19	25	24.5	–	0.000428 U	0.00134 U	0.000665 J	0.00512 U	0.0242	0.00173	0.00264 J	0.00153 U	0.000732 U	
	B16D16-30	03/13/19	30	19.5	–	0.000440 U	0.00137 U	0.000582 U	0.00525 U	0.0590	0.00431	0.00446	0.00157 U	0.000751 U	
	B16D16-35	03/13/19	35	14.5	–	0.000599 J	0.00137 U	0.000583 U	0.00526 U	0.00319	0.0279	0.713	0.00157 U	0.00599	
	B16D16-40	03/13/19	40	9.5	–	0.000466 U	0.00146 U	0.000618 U	0.00557 U	0.321	0.0276	2.31	0.00788	0.789	
	B16D16-45	03/13/19	45	4.5	–	0.000428 U	0.00134 U	0.000567 U	0.00511 U	0.598	0.165	0.665	0.00153 U	0.0503	
	B16D16-50	03/13/19	50	-0.5	–	0.000448 J	0.00247 J	0.00109 J	0.00520 U	0.884	0.0610	1.23	0.00156 U	0.0421	
	B16D16-55	03/13/19	55	-5.5	–	0.00196 U	0.00614 U	0.00260 U	0.02350 U	0.00483 J	0.00196 U	0.00338 U	0.00702 U	0.00335 U	
	B16D16-60	03/13/19	60	-10.5	–	0.000426 U	0.00152 J	0.000564 U	0.00509 U	0.001120 J	0.000426 U	0.00094 J	0.00152 U	0.000727 U	
	B16D16-65	03/13/19	65	-15.5	–	0.000438 U	0.00137 U	0.000580 U	0.00523 U	0.000766 U	0.000438 U	0.000755 U	0.00156 U	0.000747 U	
	B16D16-70	03/13/19	70	-20.5	–	0.000766 J	0.00207 J	0.000594 U	0.00536 U	0.000785 U	0.000448 U	0.000773 U	0.0016 U	0.000766 U	
	B16D16-75	03/13/19	75	-25.5	–	0.000674 J	0.00359 J	0.000582 U	0.00525 U	0.000769 U	0.000439 U	0.000758 U	0.00157 U	0.00075 U	
	B16D16-80	03/13/19	80	-30.5	–	0.000446 U	0.00139 U	0.000591 U	0.00533 U	0.000781 U	0.000446 U	0.00077 U	0.00160 U	0.000762 U	
	B16D16-85	03/13/19	85	-35.5	–	0.000468 J	0.00139 U	0.000588 U	0.00530 U	0.000776 U	0.000444 U	0.000765 U	0.00159 U	0.000758 U	
	B16D16-90	03/13/19	90	-40.5	–	0.000452 U	0.00141 U	0.000599 U	0.00540 U	0.000791 U	0.000452 U	0.000779 U	0.00162 U	0.000771 U	
	B16D16-95	03/13/19	95	-45.5	–	0.000466 U	0.00146 U	0.000617 U	0.00557 U	0.000815 U	0.000466 U	0.000804 U	0.00167 U	0.000795 U	
	B16D16-100	03/13/19	100	-50.5	–	0.000463 U	0.00145 U	0.000614 U	0.00554 U	0.000811 U	0.000463 U	0.000799 U	0.00166 U	0.000791 U	
	B16D16-105	03/13/19	105	-55.5	–	0.000456 U	0.00142 U	0.000604 U	0.00545 U	0.000798 U	0.000456 U	0.000787 U	0.00163 U	0.000779 U	
	B-934-105	03/13/19	105 (dup)	-55.5	–	0.000456 U	0.00143 U	0.000605 U	0.00545 U	0.000799 U	0.000456 U	0.000787 U	0.00163 U	0.000779 U	
PRB-B18/PRB-D18	B18D18-10	03/22/19	10	41.00	–	0.000467 U	0.00146 U	0.000618 U	0.00558 U	0.00519	0.000467 UJ	0.000805 U	0.00167 U	0.000797 U	
	B18D18-20	03/22/19	20	31.00	–	0.000467 J	0.00139 U	0.000589 U	0.00532 U	0.00911	0.000445 UJ	0.0319	0.00159 U	0.000760 U	
	B18D18-30	03/22/19	30	21.00	–	0.000548 J	0.00233 J	0.000584 U	0.00526 U	0.253	0.00663 J	0.712	0.00168 J	0.000752 U	
	B18D18-40	03/22/19	40	11.00	–	0.000441 U	0.00138 U	0.000585 U	0.00527 U	0.0237	0.00331 J	0.0174	0.00158 U	0.000754 U	
	B18D18-50	03/22/19	50	1.00	–	0.000434 U	0.00135 U	0.000574 U	0.00518 U	0.00688	0.00244 J	0.0255	0.00155 U	0.000740 U	
PRB-B19/PRB-D19	B19D19-10	03/18/19	10	42.50	–	0.000441 U	0.00149 J	0.000584 U	0.00527 U	0.000772 U	0.000441 U	0.000760 U	0.00158 U	0.000753 U	
	B19D19-15	03/18/19	15	37.5	–	0.000493 U	0.00154 U	0.000654 U	0.0059 U	0.0182	0.000493 U	0.0310 J	0.00177 U	0.000843 U	
	B19D19-20	03/18/19	20	32.5	–	0.000467 U	0.00152 J	0.000619 U	0.00558 U	0.0251	0.000616 J	0.00927 J	0.00167 U	0.000797 U	
	B19D19-25	03/18/19	25	27.5	–	0.000496 U	0.00184 J	0.000657 U	0.00592 U	2.38	0.221	0.0500 J	0.00177 U	0.000847 U	
	B19D19-30	03/18/19	30	22.5	–	0.000460 U	0.00171 J	0.000609 U	0.00549 U	0.604	0.0272	0.0551 J	0.00164 U	0.000785 U	
	B19D19-35	03/18/19	35	17.5	–	0.000454 U	0.00142 U	0.000601 U	0.00542 U	0.189	0.0189	0.324 J	0.00162 U	0.0176	
	B19D19-40	03/18/19	40	12.5	–	0.000466 U	0.00188 J	0.000808 J	0.00557 U	0.212 J	0.00993 J	0.0658 J	0.00167 U	0.000796 U	
	B19D19-45	03/18/19	45	7.5	–	0.000463 U	0.00145 U	0.000614 U	0.00554 U	7.74	0.222	0.126 J	0.00166 U	0.000791 U	
	B19D19-50	03/18/19	50	2.5	–	0.000779 J	0.00247 J	0.000608 U	0.00548 U	0.00329	0.000459 U	0.000791 U	0.00164 U	0.000783 U	
	B19D19-55	03/18/19	55	-2.5	–	0.000769 J	0.00173 J	0.000611 UJ	0.00551 UJ	0.000807 U	0.000461 U	0.000795 U	0.00165 U	0.000787 U	
	B19D19-60	03/18/19	60	-7.5	–	0.000448 U	0.00253 J	0.000613 J	0.00536 U	0.000784 U	0.000448 U	0.000773 U	0.00160 U	0.000765 U	
	B19D19-65	03/18/19	65	-12.5	–	0.000508 U	0.00244 J	0.000672 UJ	0.00606 U	0.000888 U	0.000508 U	0.000875 U	0.00181 U	0.000867 U	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co-Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)											
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC		
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050		
PRB-B19/PRB-D19 (continued)	B19D19-70	03/18/19	70	-17.5	–	0.000488 U	0.00181 J	0.000647 U	0.00583 U	0.001790 J	0.000488 U	0.000842 U	0.00175 U	0.000834 U		
	B19D19-75	03/18/19	75	-22.5	–	0.000475 U	0.00148 U	0.000630 U	0.00568 U	0.000832 U	0.000475 U	0.000820 U	0.00169 U	0.000812 U		
	B19D19-80	03/18/19	80	-27.5	–	0.000453 U	0.00142 U	0.000600 U	0.00541 U	0.000793 U	0.000453 U	0.000782 U	0.00162 U	0.000774 U		
	B19D19-85	03/18/19	85	-32.5	–	0.000486 U	0.00152 U	0.000644 U	0.0058 U	0.000850 U	0.000486 U	0.000838 U	0.00174 U	0.000829 U		
	B19D19-90	03/18/19	90	-37.5	–	0.000504 U	0.00213 J	0.000667 U	0.00601 U	0.000881 U	0.000504 U	0.000868 U	0.00180 U	0.00086 U		
	B19D19-95	03/18/19	95	-42.5	–	0.000479 U	0.00150 U	0.000635 U	0.00573 U	0.000839 U	0.000479 U	0.000827 U	0.00171 U	0.000819 U		
	B19D19-100	03/18/19	100	-47.5	–	0.000487 U	0.00159 J	0.000645 U	0.00582 U	0.000852 U	0.000487 U	0.00084 U	0.00174 U	0.000832 U		
	B19D19-105	03/18/19	105	-52.5	–	0.000446 U	0.00139 U	0.000591 U	0.00533 U	0.000781 U	0.000446 U	0.000770 U	0.00160 U	0.000762 U		
	B19D19-110	03/18/19	110	-57.5	–	0.000504 U	0.00157 U	0.000667 U	0.00602 U	0.000881 U	0.000504 U	0.000869 U	0.00180 U	0.000860 U		
	B-935-40	03/18/19	110 (dup)	-57.5	–	0.000537 U	0.00167 U	0.000712 U	0.00641 U	0.000939 UJ	0.000537 UJ	0.000926 UJ	0.00192 U	0.000916 U		
PRB-B21/PRB-D21	B21D21-10	03/25/19	10	44.00	–	0.000459 U	0.00143 U	0.000608 U	0.00548 U	0.000803 U	0.000459 U	0.000791 U	0.00164 U	0.000783 U		
	B21D21-20	03/25/19	20	34.00	–	0.000473 U	0.00148 U	0.000627 U	0.00565 U	0.000828 U	0.000473 U	0.000816 U	0.00169 U	0.000808 U		
	B21D21-30	03/25/19	30	24.00	–	0.000431 U	0.00135 U	0.000571 U	0.00515 U	2.06	0.0810	0.0215	0.00154 U	0.000736 U		
	B21D21-40	03/25/19	40	14.00	–	0.000443 U	0.00139 U	0.000587 U	0.00530 U	0.00395	0.000443 U	0.000765 U	0.00158 U	0.000757 U		
	B21D21-50	03/25/19	50	4.00	–	0.000453 U	0.00229 J	0.000600 U	0.00541 U	0.600	0.00903	0.307	0.00162 U	0.0933		
	B21D21-60	03/26/19	60	-6.00	–	0.000437 U	0.00136 U	0.000578 U	0.00522 U	0.00192 J	0.000437 U	0.0961 J	0.00156 U	0.0162 J		
		B-936-60	03/26/19	60 (dup)	-6.00	–	0.000438 U	0.00180 J	0.000580 U	0.00523 U	0.000766 U	0.000438 U	0.180 J	0.00157 U	0.0601 J	
Off Property																
B-1A	B-1/S-2	12/1/89	10.5	–	800	–	–	–	–	–	–	–	–	–		
B-2A	B-2/S-1	12/1/89	10	–	12	–	–	–	–	–	–	–	–	–		
B-212	B-212-15	9/8/17	15	42.6	0.977 U	0.000311 U	0.000500 U	0.000342 U	0.000804 U	0.000318 U	0.000321 U	0.000271 UJ	0.000304 U	0.000335 U		
	B-212-21	9/8/17	21	36.6	63.0 q	0.000346 J	0.000649 J	0.00103 J	0.0131	0.000490 J	0.000290 U	0.000244 UJ	0.000274 U	0.000302 U		
	B-212-35	9/8/17	35	22.6	1.98 U	0.000294 U	0.000473 U	0.000324 U	0.000761 U	0.000955 J	0.000304 U	0.000256 UJ	0.000288 U	0.000317 U		
	B-212-45	9/8/17	45	12.6	2.81 J	0.000303 J	0.000454 U	0.000311 U	0.000730 U	0.000289 U	0.000292 U	0.000246 UJ	0.000276 U	0.000304 U		
	B-907-25	9/8/17	45 (dup)	12.6	1.16 U	0.00807 U	0.0129 U	0.00887 U	0.0208 U	0.00825 U	0.00834 U	0.00703 U	0.00789 U	0.00870 U		
	B-212-55	9/8/17	55	2.6	3.40 J	0.000305 U	0.000490 U	0.000335 U	0.000787 U	0.000311 U	0.000315 U	0.000265 UJ	0.000298 U	0.000328 U		
	B-212-65	9/8/17	65	-7.4	1.29 U	0.000313 U	0.000504 U	0.000345 U	0.000810 U	0.000320 U	0.000324 U	0.000273 U	0.000306 U	0.000338 U		
	B-212-75	9/8/17	75	-17.4	1.05 U	0.000314 U	0.000505 U	0.000345 U	0.000812 U	0.000321 U	0.000324 U	0.000273 U	0.000307 U	0.000338 U		
	B-212-85	9/11/17	85	-27.4	0.0385 U	0.000306 U	0.000492 U	0.000337 U	0.000792 U	0.000313 U	0.000317 U	0.000267 U	0.000300 U	0.000330 U		
	B-212-95	9/11/17	95	-37.4	0.0422 U	0.000354 U	0.000568 U	0.000389 U	0.000913 U	0.000361 U	0.000365 U	0.000308 U	0.000345 U	0.000381 U		
	B-212-100	9/11/17	100	-42.4	0.0409 U	0.000326 U	0.000524 U	0.000358 U	0.000842 U	0.000333 U	0.000337 U	0.000284 U	0.000319 U	0.000351 U		
B-213	B-213-15	9/5/17	15	42.4	–	0.000313 U	0.000503 U	0.000344 U	0.000809 U	0.00289	0.000323 U	0.000272 U	0.000306 U	0.000337 U		
	B-213-21.5	9/5/17	22	35.9	–	0.000385 J	0.000540 J	0.000991 J	0.0126 J	0.00263	0.000291 U	0.000245 U	0.000275 U	0.000303 U		
	B-213-35	9/5/17	35	22.4	–	0.000292 U	0.000470 U	0.000322 U	0.000756 U	0.000299 U	0.000302 U	0.000254 U	0.000286 U	0.000315 U		
	B-213-45	9/5/17	45	12.4	–	0.000299 U	0.000481 U	0.000329 U	0.000774 U	0.000306 U	0.000309 U	0.000260 U	0.000293 U	0.000323 U		
	B-213-55	9/5/17	55	2.4	–	0.000294 U	0.000472 U	0.000323 U	0.000760 U	0.000300 U	0.000304 U	0.000256 U	0.000287 U	0.000317 U		
	B-213-65	9/5/17	65	-7.6	–	0.000297 U	0.000478 U	0.000327 U	0.000768 U	0.000304 U	0.000307 U	0.000259 U	0.000290 U	0.000320 U		
	B-213-75	9/5/17	75	-17.6	–	0.000295 U	0.000474 U	0.000325 U	0.000763 U	0.000302 U	0.000305 U	0.000257 U	0.000289 U	0.000318 U		
	B-213-85	9/5/17	85	-27.6	–	0.000329 U	0.000529 U	0.000362 U	0.000851 U	0.000336 U	0.000340 U	0.000286 U	0.000322 U	0.000355 U		
	B-213-95	9/6/17	95	-37.6	–	0.000334 U	0.000536 U	0.000367 U	0.000862 U	0.000341 U	0.000345 U	0.000290 U	0.000326 U	0.000359 U		
	B-213-105	9/6/17	105	-47.6	–	0.000310 U	0.000499 U	0.000341 U	0.000802 U	0.000317 U	0.000321 U	0.000270 U	0.000303 U	0.000334 U		
		B-906-110	9/6/17	105 (dup)	-47.6	–	0.000310 U	0.000498 U	0.000341 U	0.000801 U	0.000317 U	0.000320 U	0.000270 U	0.000303 U	0.000334 U	
		B-213-115	9/6/17	115	-57.6	–	0.000331 U	0.000532 U	0.000364 U	0.000856 U	0.000338 U	0.000342 U	0.000288 U	0.000324 U	0.000357 U	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
B-213	B-213-125	9/6/17	125	-67.6	–	0.000400 U	0.000642 U	0.000440 U	0.00103 U	0.000408 U	0.000413 U	0.000348 U	0.000391 U	0.000431 U	
B-214	B-214-15	9/7/17	15	42.4	–	0.000290 U	0.000465 U	0.000318 U	0.000748 U	0.000296 U	0.000299 U	0.000252 U	0.000283 U	0.000312 U	
	B-214-25	9/7/17	25	32.4	–	0.000285 U	0.000459 U	0.000314 U	0.000738 U	0.000292 U	0.000295 U	0.000248 U	0.000279 U	0.000308 U	
	B-214-35	9/7/17	35	22.4	–	0.000293 U	0.000471 U	0.000322 U	0.000758 U	0.000300 U	0.000303 U	0.000255 U	0.000287 U	0.000316 U	
	B-214-45	9/7/17	45	12.4	–	0.000287 U	0.000462 U	0.000316 U	0.000743 U	0.000294 U	0.000297 U	0.000250 U	0.000281 U	0.000310 U	
	B-214-55	9/7/17	55	2.4	–	0.000343 J	0.000482 U	0.000330 U	0.000775 U	0.000306 U	0.000310 U	0.000261 U	0.000293 U	0.000323 U	
	B-214-65	9/7/17	65	-7.6	–	0.000347 U	0.000559 U	0.000382 U	0.000898 U	0.000355 U	0.000359 U	0.000302 U	0.000340 U	0.000375 U	
	B-214-75	9/7/17	75	-17.6	–	0.000300 U	0.000482 U	0.000330 U	0.000775 U	0.000307 U	0.000310 U	0.000261 U	0.000293 U	0.000323 U	
	B-214-85	9/7/17	85	-27.6	–	0.000325 U	0.000522 U	0.000357 U	0.000839 U	0.000332 U	0.000335 U	0.000282 U	0.000317 U	0.000350 U	
	B-908-100	9/7/17	85 (dup)	-27.6	–	0.000302 U	0.000485 U	0.000332 U	0.000780 U	0.000309 U	0.000312 U	0.000263 U	0.000295 U	0.000325 U	
	B-214-95	9/7/17	95	-37.6	–	0.000296 U	0.000476 U	0.000326 U	0.000766 U	0.000303 U	0.000306 U	0.000258 U	0.000290 U	0.000319 U	
	B-214-105	9/7/17	105	-47.6	–	0.000342 U	0.000549 U	0.000376 U	0.000883 U	0.000349 U	0.000353 U	0.000297 U	0.000334 U	0.000368 U	
	B-214-115	9/11/17	115	-57.6	–	0.000329 U	0.000529 U	0.000362 U	0.000851 U	0.000337 U	0.000340 U	0.000287 U	0.000322 U	0.000355 U	
B-214-120	9/11/17	120	-62.6	–	0.000319 U	0.000513 U	0.000351 U	0.000824 U	0.000326 U	0.000329 U	0.000278 U	0.000312 U	0.000344 U		
B-215	B-215-15	9/12/17	15	39.0	–	0.000293 U	0.000471 U	0.000322 U	0.000757 U	0.000299 U	0.000303 U	0.000255 U	0.000286 U	0.000316 U	
	B-215-25	9/12/17	25	29.0	–	0.000289 U	0.000464 U	0.000318 U	0.000747 U	0.00480	0.000299 U	0.000252 U	0.000283 U	0.000311 U	
	B-215-35	9/12/17	35	19.0	–	0.000318 U	0.000512 U	0.000350 U	0.000823 U	0.0277	0.00195	0.0620	0.000311 U	0.000343 U	
	B-215-45	9/12/17	45	9.0	–	0.000287 U	0.000462 U	0.000316 U	0.000743 U	0.000294 U	0.000297 U	0.000250 U	0.000281 U	0.000310 U	
	B-215-55	9/12/17	55	-1.1	–	0.000299 U	0.000481 U	0.000329 U	0.000773 U	0.000306 U	0.000309 U	0.000260 U	0.000292 U	0.000322 U	
	B-215-65	9/12/17	65	-11.1	–	0.00772 U	0.0124 U	0.00849 U	0.0199 U	11.1	1.02	1.55	0.00755 U	0.00833 U	
	B-215-75	9/12/17	75	-21.1	–	0.000298 U	0.000479 U	0.000328 U	0.000770 U	0.000304 U	0.000308 U	0.000259 U	0.000291 U	0.000321 U	
	B-215-85	9/13/17	85	-31.1	–	0.000325 U	0.000523 U	0.000358 U	0.000841 U	0.000333 U	0.000336 U	0.000283 U	0.000318 U	0.000351 U	
	B-909-115	9/13/17	85 (dup)	-31.1	–	0.000303 U	0.000486 U	0.000333 U	0.000782 U	0.000309 U	0.000313 U	0.000263 U	0.000296 U	0.000326 U	
B-215-95	9/13/17	95	-41.1	–	0.000323 U	0.000519 U	0.000355 U	0.000835 U	0.000330 U	0.000334 U	0.000281 U	0.000316 U	0.000348 U		
BB-5	S-6	3/9/97	15-17	34.0	22 U	ND	ND	ND	ND	–	–	–	–	–	
	S-10	3/9/97	25-27	24.0	22 U	–	–	–	–	–	–	–	–	–	
BB-7	S-4	4/6/97	10-12	17.0	26 U	–	–	–	–	–	–	–	–	–	
BB-8 (13.6 to 3.6)	S-8	6/6/97	20-22	23.6	20 U	ND	ND	ND	ND	ND	ND	ND	ND	ND	
BB-10	S-6	8/29/97	15-17	42.0	27 U	–	–	–	–	–	–	–	–	–	
BB-12	S-3	3/18/98	15-16.5	18.8	29 U	ND	ND	ND	ND	ND	ND	ND	ND	ND	
	S-14	3/18/98	45-46.5	-11.2	29 U	ND	ND	ND	ND	ND	ND	ND	ND	ND	
BB-13	S-10	3/19/98	25-27.5	1.9	34 U	ND	ND	ND	ND	ND	ND	ND	ND	ND	
	S-16	3/19/98	40-41.5	-13.1	30 U	ND	ND	ND	ND	ND	ND	ND	ND	ND	
BB-14	S-2	3/3/98	5-6.5	21.3	32 U	–	–	–	–	–	–	–	–	–	
	S-5	3/3/98	12.5-14	14.3	31 U	–	–	–	–	–	–	–	–	–	
	S-9	3/3/98	22.5-24	4.3	31 U	–	–	–	–	–	–	–	–	–	
	S-12	3/3/98	30-31.5	-4.3	27 U	–	–	–	–	–	–	–	–	–	
CHB-07	CHB-07-12.5-13.5	4/14/05	12.5-13.5	16.5	7.2 U	0.0015	0.0011 U	0.0011 U	0.0022 U	0.0011 U	0.0011 U	1.1	0.0083	0.027	
	CHB-07-5.0-7.0	4/14/08	5-7	23.5	5 U	–	–	–	–	–	–	–	–	–	
CHB-08	CHB-08-15.0-16.0	4/15/08	15-16	14.1	5.6 U	0.0008 U	0.0008 U	0.0008 U	0.0016 U	0.0008 U	0.0008 U	0.0008 U	0.0008 U	0.0008 U	
CHB-09	CHB-09-20.0-21.5	4/16/08	20-21.5	15.4	6.2 U	–	–	–	–	–	–	–	–	–	
	CHB-09-25.0-26.5	4/16/08	25-26.5	10.4	6.1 U	0.0012 U	0.0012 U	0.0012 U	0.0024 U	0.0012 U	0.0012 U	0.0012 U	0.0012 U	0.0012 U	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co-Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																			
					GRO		Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC	
Screening Levels					30		0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050		0.050	
GEI-MW-1 (-9.7 to -29.7)	MW-1-1-2.5	8/22/14	1	29.5	4.52	U	0.0181	U	0.0181	U	0.0271	U	18.1	U	0.0181	U	0.0181	U	0.0181	U	-	-	0.0181	U
GEI-MW-2 (4.0 to -6.0)	MW-2-2-5.0	8/23/14	5	26.6	9.29		0.0391	U	0.0391	U	0.0587	U	39.1	U	0.0391	U	0.0391	U	0.0391	U	-	-	0.0391	U
	MW-2-4-10.0	8/23/14	10	21.6	-		-		-		-		-		-		-		-		-	-	-	
	MW-2-8-20.0	8/23/14	20	11.6	-		-		-		-		-		-		-		-		-	-	-	
GEI-MW-3 (-18.7 to -28.7)	MW-3-4-10.0	8/23/14	10	20.8	14.7	U	0.0258	U	0.0258	U	0.0388	U	25.8	U	0.0258	U	0.0258	U	0.0258	U	-	-	0.0258	U
	MW-3-10-50.0	8/23/14	50	-19.3	-		0.0166	U	0.0166	U	0.0249	U	16.6	U	0.0166	U	0.0166	U	0.0166	U	-	-	0.0166	U
GEI-4	GEI-4-2-5.0	8/23/14	5	26.0	5.34	U	0.0214	U	0.0214	U	0.0321	U	21.4	U	0.0214	U	0.0214	U	0.0214	U	-	-	0.0214	U
	GEI-4-5-12.5	8/23/14	12.5	18.5	6.08	U	0.0243	U	0.0243	U	0.0365	U	24.3	U	0.0243	U	0.0243	U	0.0243	U	-	-	0.0243	U
MW-1 (SCLB-3)	RS3-2.5	3/15/93	2.5	37.5	20	U	-		-		-		-		-		-		-		-		-	
	RS3-7.5	3/15/93	7.5	32.5	20	U	-		-		-		-		-		-		-		-		-	
	RS3-17.5	3/15/93	17.5	22.5	210		10		7.3		3.7		15.8		-		-		-		-		-	
	RS3-22.5/RS3-27.5 (Comp)	3/15/93	22.5-27.5	-	42		3.9		0.8		0.76		2.49		-		-		-		-		-	
	RS3-32.5	3/15/93	32.5	7.5	5	U	0.15		0.050	U	0.050	U	1.00	U	-		-		-		-		-	
RS3-37.5	3/15/93	37.5	2.5	5	U	0.050	U	0.050	U	0.050	U	1.00	U	-		-		-		-		-		
MW-2 (SCLB-4)	RS4-2.5	3/15/93	2.5	37.5	20	U	-		-		-		-		-		-		-		-		-	
	RS4-7.5	3/15/93	7.5	32.5	20	U	-		-		-		-		-		-		-		-		-	
	RS4-12.5/RS4-17.5	3/15/93	12.5-17.5	-	5	U	0.05	U	0.05	U	0.05	U	0.05	U	-		-		-		-		-	
	RS4-22.5/RS4-27.5 (Comp)	3/15/93	22.5-27.5	-	5	U	0.05	U	0.05	U	0.05	U	0.096	J	-		-		-		-		-	
	RS4-37.5	3/15/93	37.5	2.5	6.6	J	0.05	U	0.05	U	0.05	U	0.05	U	-		-		-		-		-	
MW-3 (SCLB-5)	RS5-2.5/RS5-7.5 (Comp)	3/16/93	2.5-7.5	-	20	U	-		-		-		-		-		-		-		-		-	
	RS5-12.5/RS5-17.5 (Comp)	3/16/93	12.5-17.5	-	46		0.88		0.28		0.97		1.37		-		-		-		-		-	
	RS5-17.5	3/16/93	17.5	21.5	-		-		-		-		-		-		-		-		-		-	
	RS5-22.5	3/16/93	22.5	16.5	17	J	0.2		0.099	J	0.33		0.446		-		-		-		-		-	
	RS5-32.5	3/16/93	32.5	6.5	7.2	J	0.056	J	0.05	U	0.061		0.15		-		-		-		-		-	
RS5-37.5	3/16/93	37.5	1.5	5	U	0.050	U	0.050	U	0.050	U	1.00	U	-		-		-		-		-		
MW-4 (SCLB-6)	RS6-2.5	3/17/93	2.5	37.5	20	U	-		-		-		-		-		-		-		-		-	
	RS6-7.5	3/17/93	7.5	32.5	20	U	-		-		-		-		-		-		-		-		-	
	RS6-12.5	3/17/93	12.5	27.5	20	U	-		-		-		-		-		-		-		-		-	
	RS6-17.5/RS6-22.5 (Comp)	3/17/93	17.5-22.5	-	5.0	U	0.050	U	0.050	U	0.050	U	0.092	J	-		-		-		-		-	
	RS6-27.5	3/17/93	27.5	12.5	5.0	U	0.050	U	0.050	U	0.050	U	1.00	U	-		-		-		-		-	
MW-5 (SCLB-7)	RS7-2.5	3/17/93	2.5	37.5	20	U	-		-		-		-		-		-		-		-		-	
	RS7-7.5	3/17/93	7.5	32.5	20	U	-		-		-		-		-		-		-		-		-	
	RS7-12.5	3/17/93	12.5	27.5	20	U	-		-		-		-		-		-		-		-		-	
	RS7-17.5	3/17/93	17.5	22.5	20	U	-		-		-		-		-		-		-		-		-	
	RS7-22.5	3/17/93	22.5	17.5	20	U	-		-		-		-		-		-		-		-		-	
MW-6	MW6-25	10/11/93	25	13.2	19		3.5		0.23		0.44		0.93		-		-		-		-		-	
MW-7	MW7-16.5	10/11/93	16.5	18.6	4,100		7.1		160		54		300		-		-		-		-		-	
	MW7-18.5	10/11/93	18.5	16.6	840		2.2		30		12		62		-		-		-		-		-	
MW-8 (28.7 to 14.2)	MW8-20	10/18/93	20	13.2	5	U	0.059	U	0.059	U	0.059	U	0.12	U	-		-		-		-		-	
MW-9 (33.7 to 18.7)	MW9-17.5	10/18/93	17.5	23.6	5	U	0.068	U	0.068	U	0.068	U	0.14	U	-		-		-		-		-	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)													
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC				
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050				
MW-10	MW10-17.5	10/19/93	17.5	20.5	5 U	0.068 U	0.068 U	0.068 U	0.14 U	–	–	–	–	–				
MW102 (B102) (-65.8 to -75.8)	B102-20	7/17/12	20	29.2	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-30	7/17/12	30	19.2	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-38	7/17/12	38	11.2	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-40	7/17/12	40	9.2	–	–	–	–	–	–	–	–	–	–				
	B102-49	7/17/12	49	0.2	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-60	7/17/12	60	-10.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-70	7/18/12	70	-20.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-80	7/19/12	80	-30.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-90	7/19/12	90	-40.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B102-100	7/20/12	100	-50.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
B102-110	7/20/12	110	-60.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
B102-120	7/23/12	120	-70.8	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
MW103 (B103) (-67.6 to -77.6)	B103-10	7/25/12	10	25.9	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B103-18	7/25/12	18	17.9	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B103-30	7/25/12	30	5.9	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B103-40	7/25/12	40	-4.1	–	–	–	–	–	4.6	0.77	0.12	0.05 U	0.05 U				
	B103-45	7/25/12	45	-9.1	–	–	–	–	–	5.3	0.48	0.24	0.05 U	0.05 U				
	B103-55	7/25/12	55	-19.1	–	–	–	–	–	0.025 U	0.03 U	0.18	0.05 U	0.05 U				
	B103-62.5	7/26/12	62.5	-26.6	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B103-75	7/26/12	75	-39.1	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B103-83	7/26/12	83	-47.1	–	–	–	–	–	0.025 U	0.03 U	0.12	0.05 U	0.05 U				
	B103-95	7/26/12	95	-59.1	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
B103-105	7/27/12	105	-69.1	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
B103-113	7/27/12	113	-77.1	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
MW104 (B104) (-76.3 to -86.3)	B104-10	7/30/12	10	32.7	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B104-20	7/30/12	20	22.7	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B104-30	7/30/12	30	12.7	–	–	–	–	–	1.8	0.086	0.14	0.05 U	0.05 U				
	B104-35	7/30/12	35	7.7	–	–	–	–	–	7.1	0.23	0.099	0.05 U	0.05 U				
	B104-50	7/30/12	50	-7.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B104-60	7/31/12	60	-17.3	–	–	–	–	–	2.1	0.21	0.12	0.05 U	0.05 U				
	B104-69	7/31/12	69	-26.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B104-80	7/31/12	80	-37.3	–	–	–	–	–	0.12	0.03 U	0.05 U	0.05 U	0.05 U				
	B104-90	8/1/12	90	-47.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B104-100	8/1/12	100	-57.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
B104-110	8/1/12	110	-67.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
B104-120	8/1/12	120	-77.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
B104-130	8/1/12	130	-87.3	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U					
MW105 (B105) (-85.8 to -95.8)	B105-10	8/6/12	10	34.2	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B105-20	8/6/12	20	24.2	–	–	–	–	–	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U				
	B105-30	8/6/12	30	14.2	–	–	–	–	–	1.3	0.16	0.086	0.05 U	0.05 U				
	B105-40	8/8/12	40	4.2	–	–	–	–	–	0.025 U	0.03 U	0.22	0.05 U	0.05 U				
	B105-50	8/8/12	50	-5.8	–	–	–	–	–	0.18	0.040	0.05 U	0.05 U	0.05 U				

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co-Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																	
					Screening Levels					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC			
					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050								
MW105 (B105) (continued)	B105-60	8/9/12	60	-15.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U			
	B105-70	8/9/12	70	-25.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-80	8/9/12	80	-35.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-90	8/10/12	90	-45.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-100	8/10/12	100	-55.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-110	8/10/12	110	-65.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-120	8/10/12	120	-75.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-130	8/10/12	130	-85.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B105-138	8/10/12	138	-93.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
MW106 (B106) (-78.0 to -88.0)	B106-10	8/14/12	10	42.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-20	8/14/12	20	32.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-30	8/14/12	30	22.0	-	-	-	-	-	0.038		0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-40	8/14/12	40	12.0	-	-	-	-	-	3.1		0.15		0.05	U	0.05	U	0.05	U	0.05	U	
	B106-50	8/14/12	50	2.0	-	-	-	-	-	0.73		0.17		0.11		0.05	U	0.05	U	0.05	U	
	B106-60	8/14/12	60	-8.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-70	8/15/12	70	-18.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-80	8/15/12	80	-28.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-90	8/15/12	90	-38.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-100	8/15/12	100	-48.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-110	8/15/12	110	-58.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-120	8/15/12	120	-68.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-130	8/15/12	130	-78.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B106-140	8/15/12	140	-88.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
MW107 (B107) (8.8 to -1.2)	B107-05	3/12/12	5	38.8	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U
	B107-15	3/12/12	15	28.8	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U
	B107-25	3/12/12	25	18.8	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.60		0.063		0.060		0.05	U
	B107-35	3/12/12	35	8.8	2	U	0.03	U	0.05	U	0.05	U	0.15	U	19		0.59		0.37		0.05	U
	B107-45	3/12/12	45	-1.2	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.028		0.03	U	0.05	U	0.05	U
MW108 (B108) (-7.2 to -17.2)	B108-15	12/14/12	15	17.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B108-25	12/14/12	25	7.8	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B108-35	12/14/12	35	-2.2	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B108-45	12/14/12	45	-12.2	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B108-50	12/14/12	50	-17.2	-	-	-	-	-	0.037		0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
MW109 (B109) (0.0 to -10.0)	B109-05	4/12/12	5	30.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B109-15	4/12/12	15	20.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B109-25	4/12/12	25	10.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B109-35	4/12/12	35	0.0	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B109-45	4/12/12	45	-10.0	-	-	-	-	-	1.6		0.94		0.15		0.05	U	0.05	U	0.05	U	
MW110 (B110) (4.7 to -5.3)	B110-15	4/12/12	15	24.7	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B110-25	4/12/12	25	14.7	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	
	B110-35	4/12/12	35	4.7	-	-	-	-	-	3.4		0.21		0.31		0.05	U	0.05	U	0.05	U	
	B110-45	4/12/12	45	-5.3	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	0.05	U	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co-Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)												
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC			
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050			
MW111 (B111) (-33.5 to -43.5)	B111-10	5/12/12	10	26.5	-	-	-	-	-	0.05 U	0.06 U	0.1 U	0.1 U	0.1 U			
	B111-20	5/12/12	20	16.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B111-30	5/12/12	30	6.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B111-38	5/12/12	38	-1.5	-	-	-	-	-	0.078	0.40	0.28	0.05 U	0.05 U			
	B111-50	5/12/12	50	-13.5	-	-	-	-	-	1.4	0.56	0.11	0.05 U	0.05 U			
	B111-60	6/12/12	60	-23.5	-	-	-	-	-	0.085	0.03 U	0.05 U	0.05 U	0.05 U			
	B111-70	6/12/12	70	-33.5	-	-	-	-	-	0.033	0.03 U	0.05 U	0.05 U	0.05 U			
	B111-80	6/12/12	80	-43.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
MW112 (B112) (-17.5 to -27.5)	B112-10	11/12/12	10	47.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-20	11/12/12	20	37.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-30	11/12/12	30	27.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-40	11/12/12	40	17.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-50	11/12/12	50	7.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-60	11/12/12	60	-2.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-75	11/12/12	75	-17.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B112-85	12/12/12	85	-27.5	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
MW113 (B113) (-37.1 to -47.1)	B113-10	12/18/12	10	22.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B113-20	12/18/12	20	12.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B113-30	12/18/12	30	2.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B113-40	12/18/12	40	-7.1	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B113-50	12/18/12	50	-17.1	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
MW114 (B114) (10.8 to 0.8)	B114-15	10/12/12	15	30.8	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B114-25	10/12/12	25	20.8	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B114-35	10/12/12	35	10.8	-	-	-	-	-	8.8	0.45	0.11	0.05 U	0.05 U			
	B114-40	10/12/12	40	5.8	-	-	-	-	-	0.59	0.071	0.05 U	0.05 U	0.05 U			
	B114-45	10/12/12	45	0.8	-	-	-	-	-	0.25	0.03 U	0.05 U	0.05 U	0.05 U			
MW115 (B115) (-0.9 to -10.9)	B115-10	12/13/12	10	24.1	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B115-15	12/13/12	15	19.1	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B115-25	12/13/12	25	9.1	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B115-35	12/13/12	35	-0.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B115-45	12/13/12	45	-10.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
MW116 (B116) (-3.6 to -13.6)	B116-15	7/12/12	15	16.4	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B116-25	7/12/12	25	6.4	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B116-35	7/12/12	35	-3.6	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B116-45	7/12/12	45	-13.6	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
MW117 (B117) (16.9 to 1.9)	B117-10	2/4/13	10	46.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B117-20	2/4/13	20	36.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B117-30	2/4/13	30	26.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B117-40	2/4/13	40	16.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			
	B117-50	2/4/13	50	6.9	-	-	-	-	-	0.025 U	0.03 U	0.05 U	0.05 U	0.05 U			

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co-Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																			
					GRO		Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC	
Screening Levels					30		0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050		0.050	
MW118 (B118) (12.9 to 2.9)	B118-10	3/21/13	10	42.9	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B118-20	3/21/13	20	32.9	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B118-30	3/21/13	30	22.9	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B118-40	3/21/13	40	12.9	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B118-50	3/21/13	50	2.9	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
MW119 (B119) (2.4 to -7.7)	B119-10	3/21/13	10	27.4	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B119-20	3/21/13	20	17.4	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B119-30	3/21/13	30	7.4	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
	B119-40	3/21/13	40	-2.7	-	-	-	-	-	-	-	-	-	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U	
MW120 (B120) (0 to -10)	B120-20	12/16/13	20	20.0	2	U	0.3	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B120-30	12/16/13	30	10.0	2	U	0.3	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B120-45	12/16/13	45	-5.0	2	U	0.3	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW121 (B121) (26.7 to 16.7)	B121-15	12/16/13	15	26.7	2	U	0.3	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B121-25	12/16/13	25	16.7	2	U	0.3	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW122 (B122) (-75 to -89)	B122-15	12/17/13	15	15.0	-	-	0.053	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-25	12/17/13	25	5.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-40	12/17/13	40	-10.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-45	12/17/13	45	-15.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-50	12/17/13	50	-20.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-60	12/17/13	60	-30.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-70	12/17/13	70	-40.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-80	12/17/13	80	-50.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B122-100	12/17/13	100	-70.0	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW123 (B123) (-42.5 to -52.5)	B123-20	12/18/13	20	7.5	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW124 (B124) (-53.8 to -63.8)	B124-10	12/19/13	10	46.2	2	U	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
	B124-20	12/19/13	20	36.2	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-30	12/19/13	30	26.2	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-40	12/19/13	40	16.2	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-50	12/19/13	50	6.2	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-60	12/19/13	60	-3.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-70	12/19/13	70	-13.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-80	12/19/13	80	-23.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-90	12/19/13	90	-33.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-100	12/19/13	100	-43.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-110	12/19/13	110	-53.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B124-120	12/19/13	120	-63.8	-	-	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW125 (B125) (28.6 to 13.6)	B125-15	12/20/13	15	28.6	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B125-20	12/20/13	20	23.6	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B125-25	12/20/13	25	18.6	2	U	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B125-30	12/20/13	30	13.6	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																		
					GRO	Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC	
Screening Levels					30	0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050			
MW126 (B126) (-54.1 to -64.1)	B126-20	12/30/13	20	10.9	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B126-35	12/30/13	35	-4.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B126-45	12/30/13	45	-14.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B126-55	12/30/13	55	-24.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B126-60	12/31/13	60	-29.1	–	–		–		–		–		–		–		–		–		–	
	B126-65	1/1/14	65	-34.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B126-75	1/2/14	75	-44.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B126-80	1/3/14	80	-49.1	–	–		–		–		–		–		–		–		–		–	
	B126-85	1/4/14	85	-54.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
B126-95	1/5/14	95	-64.1	–	–		–		–		–		–		–		–		–		–		
MW127 (B127) (-1.0 to -11.0)	B127-15	12/31/13	15	24.0	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B127-25	12/31/13	25	14.0	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B127-40	12/31/13	40	-1.0	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B127-45	12/31/13	45	-6.0	–	–		–		–		–		–		–		–		–		–	
	B127-50	12/31/13	50	-11.0	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW128 (B128) (-30.8 to -40.8)	B128-25	1/9/14	25	2.9	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B128-45	1/9/14	45	-17.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
	B128-65	1/9/14	65	-37.1	–	0.03	U	0.05	U	0.05	U	0.15	U	0.025	U	0.03	U	0.05	U	0.05	U	0.05	U
MW-138 (-47.5 to -57.5)	MW-138-15	9/12/17	15	42.5	–	0.000321	U	0.000516	U	0.000353	U	0.000830	U	0.000328	U	0.000332	U	0.000279	U	0.000314	U	0.000346	U
	MW-138-25	9/12/17	25	32.5	–	0.000311	U	0.000500	U	0.000342	U	0.000804	U	0.000318	U	0.000321	U	0.000271	U	0.000304	U	0.000335	U
	MW-138-35	9/12/17	35	22.5	–	0.000288	U	0.000464	U	0.000317	U	0.000746	U	0.000295	U	0.000298	U	0.000251	U	0.000282	U	0.000311	U
	MW-138-45	9/12/17	45	12.5	–	0.000285	U	0.000459	U	0.000314	U	0.000738	U	0.000292	U	0.000295	U	0.000248	U	0.000279	U	0.000308	U
	MW-138-56	9/12/17	56	1.5	–	0.000304	U	0.000488	U	0.000334	U	0.000785	U	0.000310	U	0.000314	U	0.000264	U	0.000297	U	0.000327	U
	MW-138-65	9/13/17	65	-7.5	–	0.000292	U	0.000469	U	0.000321	U	0.000755	U	0.000299	U	0.000302	U	0.000254	U	0.000286	R	0.000315	R
	B-910-90	9/13/17	65 (dup)	-7.5	–	0.000313	U	0.000503	U	0.000344	U	0.000809	U	0.000320	U	0.000323	U	0.000272	U	0.000306	R	0.000337	R
	MW-138-75	9/13/17	75	-17.5	–	0.000297	U	0.000478	U	0.000327	U	0.000769	U	0.000304	U	0.000307	U	0.000259	U	0.000291	U	0.000320	U
	MW-138-85	9/13/17	85	-27.5	–	0.000325	U	0.000522	U	0.000357	U	0.000839	U	0.000332	U	0.000335	U	0.000283	U	0.000317	U	0.000350	U
	MW-138-95	9/13/17	95	-37.5	–	0.000295	U	0.000473	U	0.000324	U	0.000761	U	0.000301	U	0.000304	U	0.000256	U	0.000288	U	0.000317	U
	MW-138-105	9/13/17	105	-47.5	–	0.000336	U	0.000540	U	0.000369	U	0.000868	U	0.000343	U	0.000347	U	0.000292	U	0.000328	U	0.000362	U
MW-138-115	9/14/17	115	-57.5	–	0.000313	U	0.000503	U	0.000344	U	0.000809	U	0.000320	U	0.000323	U	0.000272	U	0.000306	U	0.000337	U	
MW-140 (-78.9 to -88.9)	MW-140-15	8/30/17	15	35.6	–	0.000308	U	0.000495	U	0.000339	U	0.000796	U	0.000315	U	0.000318	U	0.000268	U	0.000301	U	0.000332	U
	MW-140-25	8/30/17	25	25.6	–	0.000293	U	0.000471	U	0.000322	U	0.000757	U	0.147		0.0107		0.00199		0.000286	U	0.000316	U
	MW-140-35	8/30/17	35	15.6	–	0.00786	U	0.0126	U	0.00865	U	0.0203	U	15.1		0.629		0.387		0.00769	U	0.0107	J
	MW-140-45	8/30/17	45	5.6	–	0.000288	U	0.000463	U	0.000317	U	0.000745	U	4.27		0.0793		0.0431		0.000282	U	0.00160	
	MW-140-55	8/30/17	55	-4.4	–	0.000379	J	0.000498	J	0.000326	U	0.000766	U	1.56		0.0496		0.130		0.000500	J	0.0990	
	MW-140-65	8/30/17	65	-14.4	–	0.000289	U	0.000465	U	0.000318	U	0.000747	U	0.00746	U	0.000299	U	0.000252	U	0.000283	U	0.000312	U
	MW-140-75	8/30/17	75	-24.4	–	0.00728	U	0.0116	U	0.00800	U	0.0188	U	0.00744	U	0.00753	U	0.00634	U	0.00712	U	0.00785	U
	MW-140-90	8/30/17	90	-39.4	–	0.000318	U	0.000511	U	0.000349	U	0.000821	U	0.000325	U	0.000328	U	0.000276	U	0.000311	U	0.000342	U
	MW-140-110	8/31/17	110	-59.4	–	0.000313	U	0.000503	U	0.000344	U	0.000808	U	0.000320	U	0.000323	U	0.000272	U	0.000306	U	0.000337	U
	MW-140-130	8/31/17	130	-79.4	–	0.000305	U	0.000491	U	0.000336	U	0.000789	U	0.000312	U	0.000315	U	0.000266	U	0.000298	U	0.000329	U
MW-140-140	8/31/17	140	-89.4	–	0.00762	U	0.0122	U	0.00838	U	0.0197	U	0.00779	U	0.00788	U	0.00664	U	0.00745	U	0.00822	U	
MW-142 (2.4 to -7.6)	MW-142-5	4/12/18	5	37.1	–	0.000392	J	0.000522	U	0.000357	U	0.000840	U	0.000332	U	0.000336	U	0.000283	U	0.000318	U	0.000350	U

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-143 (-27.7 to -37.7)	MW-143-10	4/11/18	10	32.0	–	0.00459	0.000602 U	0.000412 U	0.000968 U	0.000499 J	0.000387 U	0.000326 U	0.000366 U	0.000403 U	
	MW-143-20	4/11/18	20	22.0	–	0.000314 U	0.000504 U	0.000345 U	0.000811 U	0.000321 U	0.000324 U	0.000273 U	0.000307 U	0.000338 U	
	MW-143-30	4/11/18	30	12.0	–	0.000307 U	0.000494 U	0.000338 U	0.000795 U	0.000314 U	0.000318 U	0.000547 J	0.000301 U	0.000928 J	
	MW-143-40	4/11/18	40	2.0	–	0.000322 U	0.000518 U	0.000354 U	0.000833 U	0.000329 U	0.000333 U	0.00203	0.000315 U	0.000521 J	
	MW-143-50	4/11/18	50	-8.0	–	0.000309 U	0.000497 U	0.000340 U	0.000799 U	0.00589	0.00729	0.207	0.00117	0.0227	
	MW-143-60	4/11/18	60	-18.0	–	0.000300 U	0.000482 U	0.000330 U	0.000776 U	0.00270	0.000443 J	0.00285	0.00136	0.656	
	MW-143-70	4/11/18	70	-28.0	–	0.000297 U	0.000477 U	0.000327 U	0.000768 U	0.00164	0.00106 J	0.0182	0.000290 U	0.0137	
	MW-143-80	4/11/18	80	-38.0	–	0.000307 U	0.000493 U	0.000337 U	0.000793 U	0.000314 U	0.000317 U	0.00361	0.000300 U	0.00320	
	MW-902-20	4/11/18	80 (dup)	-38.0	–	0.000302 U	0.000486 U	0.000332 U	0.000781 U	0.000309 U	0.000312 U	0.00256	0.000295 U	0.00587	
MW-145 (-26.1 to -36.1)	MW-145-10	4/17/18	10	33.5	–	0.000339 U	0.000545 U	0.000373 U	0.000877 U	0.000347 U	0.000351 U	0.000295 U	0.000332 U	0.000366 U	
	MW-145-20	4/17/18	20	23.5	–	0.000315 U	0.000507 U	0.000347 U	0.000815 U	0.000505 J	0.000332 J	0.00765	0.000308 U	0.000340 U	
	MW-145-30	4/17/18	30	13.5	–	0.000320 U	0.000515 U	0.000352 U	0.000828 U	0.790	0.0668	0.100	0.00118 J	0.000345 U	
	MW-145-40	4/17/18	40	3.5	–	0.000301 U	0.000484 U	0.000331 U	0.000778 U	0.00641	0.00474	0.0691	0.000294 U	0.0160	
	MW-145-50	4/17/18	50	-6.5	–	0.000296 U	0.000476 U	0.000325 U	0.00329	0.00390	0.00180	0.00555	0.000289 U	0.00329	
	MW-145-60	4/17/18	60	-16.5	–	0.000298 U	0.000478 U	0.000327 U	0.000769 U	0.000304 U	0.000308 U	0.000259 U	0.000291 U	0.00255	
	MW-145-70	4/17/18	70	-26.5	–	0.000327 U	0.000526 U	0.000360 U	0.000847 U	0.000335 U	0.000338 U	0.000290 J	0.000320 U	0.000544 J	
	MW-145-80	4/17/18	80	-36.5	–	0.000310 U	0.000498 U	0.000341 U	0.000802 U	0.000464 J	0.000320 U	0.000380 J	0.000303 U	0.000723 J	
	MW-903-40	4/17/18	80 (dup)	-36.5	–	0.000303 U	0.000487 U	0.000333 U	0.000783 U	0.000450 J	0.000313 U	0.000384 J	0.000296 U	0.00180	
MW-147 (-17.6 to -27.6)	MW-147-10	4/2/18	10	41.9	–	0.000566 J	0.000471 U	0.000323 U	0.000758 U	0.000697 J	0.000303 U	0.000255 U	0.000287 U	0.000316 U	
	MW-147-20	4/2/18	20	31.9	–	0.000292 U	0.000469 U	0.000321 U	0.000754 U	0.000759 J	0.000302 U	0.000254 U	0.000285 U	0.000314 U	
	MW-147-30	4/2/18	30	21.9	–	0.000301 U	0.000485 U	0.000332 U	0.000779 U	0.0238	0.00330	0.00239	0.000295 U	0.000325 U	
	MW-147-40	4/2/18	40	11.9	–	0.000298 U	0.000479 U	0.000328 U	0.000770 U	0.0146	0.00118	0.00488	0.000291 U	0.0615	
	MW-147-50	4/2/18	50	1.9	–	0.000299 U	0.000481 U	0.000329 U	0.000773 U	0.00175	0.00105 J	0.00432	0.000292 U	0.00322	
	MW-147-60	4/2/18	60	-8.2	–	0.000290 U	0.000467 U	0.000319 U	0.000751 U	0.000607 J	0.000300 U	0.000696 J	0.000284 U	0.000313 U	
	MW-901-10	4/2/18	60 (dup)	-8.2	–	0.000291 U	0.000467 U	0.000320 U	0.000752 U	0.000377 J	0.000300 U	0.000253 U	0.000284 U	0.000313 U	
	MW-147-70	4/2/18	70	-18.2	–	0.000302 U	0.000486 U	0.000332 U	0.000781 U	0.000309 U	0.000312 U	0.000263 U	0.000295 U	0.000502 J	
	MW-147-80	4/2/18	80	-28.2	–	0.000312 U	0.000502 U	0.000334 U	0.000808 U	0.000319 U	0.000323 U	0.000272 U	0.000305 U	0.000337 U	
MW-148 (-25.7 to -35.7)	MW-148-11	4/9/18	11	32.9	–	0.000728 J	0.000501 U	0.000343 U	0.000805 U	0.000318 U	0.000322 U	0.000271 U	0.000305 U	0.000336 U	
	MW-148-20	4/9/18	20	23.9	–	0.000293 U	0.000471 U	0.000322 U	0.000757 U	0.00188	0.000303 U	0.000255 U	0.000286 U	0.000316 U	
	MW-148-30	4/9/18	30	13.9	–	0.000303 U	0.000487 U	0.000334 U	0.000784 U	0.000310 U	0.000313 U	0.00364	0.000296 U	0.0144	
	MW-148-40	4/9/18	40	3.9	–	0.000293 U	0.000471 U	0.000323 U	0.000758 U	0.000801 J	0.000551 J	0.00113	0.000287 U	0.000316 U	
	MW-148-50	4/9/18	50	-6.1	–	0.000298 U	0.000479 U	0.000328 U	0.000770 U	0.000304 U	0.000308 U	0.000259 U	0.000291 U	0.000321 U	
	MW-148-60	4/9/18	60	-16.1	–	0.000341 U	0.000548 U	0.000375 U	0.000881 U	0.000348 U	0.000352 U	0.000297 U	0.000333 U	0.000367 U	
	MW-148-70	4/9/18	70	-26.1	–	0.000340 U	0.000547 U	0.000374 U	0.000880 U	0.000618 J	0.000352 U	0.000380 J	0.000333 U	0.000367 U	
	MW-148-80	4/9/18	80	-36.1	–	0.000317 U	0.000510 U	0.000349 U	0.000820 U	0.000585 J	0.000328 U	0.000314 J	0.000310 U	0.000342 U	
MW-153 (-65.3 to -75.3)	MW-153-10	3/27/18	10	44.4	–	0.000306 U	0.000492 U	0.000337 U	0.000792 U	0.000313 U	0.000316 U	0.000266 U	0.000299 U	0.000330 U	
	MW-153-20	3/27/18	20	34.4	–	0.000296 U	0.000475 U	0.000325 U	0.000764 U	0.000561 J	0.000305 U	0.000257 U	0.000289 U	0.000318 U	
	MW-153-30	3/27/18	30	24.4	–	0.000290 U	0.000466 U	0.000319 U	0.000749 U	0.000296 U	0.000299 U	0.000252 U	0.000283 U	0.000312 U	
	MW-153-40	3/27/18	40	14.4	–	0.000306 U	0.000492 U	0.000336 U	0.000791 U	0.000313 U	0.000486 J	0.00421	0.000299 U	0.000330 U	
	MW-153-50	3/27/18	50	4.4	–	0.000299 U	0.000481 U	0.000329 U	0.000774 U	0.000306 U	0.000309 U	0.000261 U	0.000293 U	0.00767	
	MW-153-61	3/27/18	61	-6.7	–	0.000307 U	0.000493 U	0.000338 U	0.000793 U	0.000314 U	0.000317 U	0.000267 U	0.000300 U	0.000344 J	
	MW-153-70	3/27/18	70	-15.7	–	0.000301 U	0.000483 U	0.000331 U	0.000777 U	0.000307 U	0.000311 U	0.000262 U	0.000294 U	0.000902 J	
	MW-153-80	3/28/18	80	-25.7	–	0.000298 U	0.000479 U	0.000328 U	0.000770 U	0.000305 U	0.000308 U	0.000353 J	0.000291 U	0.00148	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co-Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-153 (continued)	MW-153-90	3/28/18	90	-35.7	–	0.000325 U	0.000523 U	0.000358 U	0.000841 U	0.000799 J	0.000336 U	0.000596 J	0.000318 U	0.00176	
	MW-153-110	3/28/18	110	-55.7	–	0.000318 U	0.000511 U	0.000350 U	0.000821 U	0.00254	0.000328 U	0.000773 J	0.000311 U	0.00311	
	MW-153-130	3/29/18	130	-75.7	–	0.000310 U	0.000499 U	0.000341 U	0.000802 U	0.000648 J	0.000321 U	0.000270 U	0.000303 U	0.000334 U	
MW-158	MW-158-20	4/5/18	20	21.1	0.0384 U	0.000584 J	0.000492 U	0.000336 U	0.000791 U	0.000313 U	0.000316 U	0.000266 U	0.000299 U	0.000330 U	
	MW-158-30	4/5/18	30	11.1	1.5 J+	0.0318 U	0.0512	0.0350 U	0.0823 U	15.1	3.57	3.00	0.0311 U	0.382	
MW-158A (-47.2 to -58.5)	MW-158A-40	4/5/18	40	1.1	0.839	0.000424 J	0.000626 J	0.000366 U	0.000860 U	1.76	0.684	0.168	0.000547 J	0.00972	
	MW-158A-50	4/5/18	50	-8.9	0.194	0.000312 U	0.000502 U	0.000343 U	0.000807 U	0.922	0.0628	0.0631	0.000423 J	0.000709 J	
	MW-158A-60	4/5/18	60	-18.9	0.319	0.000311 U	0.000499 U	0.000342 U	0.000803 U	4.08	0.0528	0.111	0.000810 J	0.000703 J	
	MW-158A-70	4/5/18	70	-28.9	0.129	0.000303 U	0.000487 U	0.000333 U	0.000783 U	0.00466	0.0431	0.946	0.000460 J	0.0164	
	MW-158A-80	4/6/18	80	-38.9	0.0376 U	0.000299 U	0.000481 U	0.000329 U	0.000774 U	0.00242	0.000599 J	0.00335	0.000293 U	0.000339 J	
	MW-158A-90	4/6/18	90	-48.9	0.0389 U	0.000310 U	0.000498 U	0.000341 U	0.000801 U	0.00622	0.00209	0.00789	0.000303 U	0.00160	
MW-159 (22.9 to 12.9)	MW-159-20	4/16/18	20	22.8	–	0.000326 U	0.000525 U	0.000359 U	0.000844 U	0.000334 U	0.000337 U	0.000284 U	0.000319 U	0.000352 U	
	MW-159-30	4/16/18	30	12.8	–	0.000329 U	0.000529 U	0.000362 U	0.000851 U	0.0196	0.0234	0.0506	0.000365 J	0.000355 U	
MW-160 (-76.5 to -86.5)	MW-160-11	5/8/18	11	31.5	–	0.000649 U	0.00635 J	0.000860 U	0.00776 U	0.00114 U	0.000649 U	0.00112 U	0.00232 U	0.00110 U	
	MW-160-21	5/8/18	21	21.5	–	0.000662 J	0.00421 J	0.000621 U	0.00560 U	0.000966 J	0.000469 U	0.00357	0.00168 U	0.000801 U	
	MW-160-31	5/8/18	31	11.5	–	0.000503 J	0.00285 J	0.000643 U	0.00580 U	0.000849 U	0.000485 U	0.000837 U	0.00173 U	0.000828 U	
	MW-160-40	5/8/18	40	2.5	–	0.000454 U	0.00196 J	0.000602 U	0.00543 U	0.281	0.100	0.151	0.00373 J	0.000775 U	
	MW-160-50	5/8/18	50	-7.5	–	0.000457 U	0.00144 J	0.000606 U	0.00546 U	0.00276 J	0.000714 J	0.00694	0.00163 U	0.000780 U	
	MW-160-55	5/8/18	55	-12.5	–	0.000474 U	0.00185 J	0.000629 U	0.00567 U	6.27	1.11	1.50	0.0221	0.0107	
	MW-160-60	5/8/18	60	-17.5	–	0.00134	0.00595	0.000699 J	0.00521 U	0.111	0.0907	0.352	0.00162 J	0.000744 U	
	MW-160-70	5/8/18	70	-27.5	–	0.000467 U	0.00221 J	0.000619 U	0.00558 U	0.00208 J	0.00150	0.00460	0.00167 U	0.000798 U	
	MW-160-90	5/8/18	90	-47.5	–	0.000471 U	0.00240 J	0.000624 U	0.00563 U	0.000824 U	0.00151	0.00432	0.00168 U	0.000804 U	
	MW-160-100	5/8/18	100	-57.5	–	0.000481 U	0.00150 U	0.000638 U	0.00575 U	0.000842 U	0.00153	0.00506	0.00172 U	0.000822 U	
	MW-160-110	5/8/18	110	-67.5	–	0.000454 U	0.00144 J	0.000601 U	0.00542 U	0.0113	0.00478	0.0128	0.00162 U	0.000774 U	
	MW-160-125	5/10/18	125	-82.5	–	0.000458 U	0.00265 J	0.000607 U	0.00547 U	0.00262 J	0.000576 J	0.000832 J	0.00164 U	0.000782 U	
	MW-160-127.5	5/10/18	128	-85.0	–	0.000462 U	0.00144 U	0.000612 U	0.00552 U	0.000808 U	0.000462 U	0.000797 U	0.00165 U	0.000789 U	
MW-161 (-78.9 to -88.9)	MW-161-11	5/14/18	11	32.8	–	0.00123 U	0.00615 U	0.00307 U	0.00799 U	0.00523	0.00123 U	0.00563	0.00615 U	0.00307 U	
	MW-161-21	5/14/18	21	22.8	–	0.00104 U	0.00520 U	0.00260 U	0.00676 U	0.00260 U	0.00104 U	0.00364	0.00520 U	0.00260 U	
	MW-161-31	5/14/18	31	12.8	–	0.00114 U	0.00572 U	0.00286 U	0.00744 U	0.0159	0.00196	0.00387	0.00572 U	0.00286 U	
	MW-161-40	5/14/18	40	3.8	–	0.00110 U	0.00552 U	0.00276 U	0.00717 U	0.00438	0.00132	0.376	0.00552 U	0.00276 U	
	MW-161-50	5/14/18	50	-6.2	–	0.00112 U	0.00558 U	0.00279 U	0.00725 U	0.0173	0.00956	0.0356	0.00558 U	0.00279 U	
	MW-161-60	5/14/18	60	-16.2	–	0.00114 U	0.00571 U	0.00286 U	0.00742 U	0.0356	0.00328	0.0316	0.00571 U	0.00286 U	
	MW-161-70	5/14/18	70	-26.2	–	0.00112 U	0.00558 U	0.00279 U	0.00726 U	0.00279 U	0.00112 U	0.00279 U	0.00558 U	0.00279 U	
	MW-161-80	5/14/18	80	-36.2	–	0.00123 U	0.00616 U	0.00308 U	0.00801 U	0.00308 U	0.00123 U	0.00308 U	0.00616 U	0.00308 U	
	MW-161-90	5/14/18	90	-46.2	–	0.00114 U	0.00569 U	0.00285 U	0.00740 U	0.00285 U	0.00114 U	0.00285 U	0.00569 U	0.00285 U	
	B-927-30	5/14/18	90 (dup)	-46.2	–	0.00124 U	0.00621 U	0.00310 U	0.00807 U	0.00310 U	0.00124 U	0.00310 U	0.00621 U	0.00310 U	
	MW-161-100	5/14/18	100	-56.2	–	0.00116 U	0.00582 U	0.00291 U	0.00757 U	0.00291 U	0.00116 U	0.00291 U	0.00582 U	0.00291 U	
	MW-161-110	5/14/18	110	-66.2	–	0.00122 U	0.00610 U	0.00305 U	0.00793 U	0.00305 U	0.00122 U	0.00305 U	0.00610 U	0.00305 U	
	MW-161-120	5/14/18	120	-76.2	–	0.00122 U	0.00610 U	0.00305 U	0.00793 U	0.00305 U	0.00122 U	0.00305 U	0.00610 U	0.00305 U	
	MW-161-130	5/14/18	130	-86.2	–	0.00110 U	0.00550 U	0.00275 U	0.00715 U	0.0307	0.0114	0.00275 U	0.00550 U	0.00275 U	
MW-161-140	5/15/18	140	-96.2	–	0.000580 J	0.00175 J	0.000650 U	0.00586 U	0.000858 U	0.000490 U	0.000846 U	0.00175 U	0.000837 U		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)												
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC			
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050			
MW-190 (-30.2 to -40.2)	MW-190-5	09/19/19	5	43.7	1.03 J	0.000741 J	0.00891	0.000611 U	0.00551 U	0.0166	0.000461 U	0.000796 U	0.00165 U	0.000788 U			
	MW-190-10	09/19/19	10	38.7	3.07 J	0.00553	0.0371	0.00350 J	0.0280	0.0965	0.000827 U	0.00143 U	0.00296 U	0.00141 U			
	MW-190-15	09/19/19	15	33.7	1.12 U	0.000530 U	0.0200	0.000702 U	0.00633 U	0.000927 U	0.000530 U	0.000913 U	0.00189 U	0.000904 U			
	MW-190-20	09/19/19	20	28.7	1.06 U	0.00144	0.0172	0.00108 J	0.00595 U	0.000871 U	0.000498 U	0.00477	0.00178 U	0.00116 J			
	MW-190-25	09/19/19	25	23.7	0.995 U	0.000484 J	0.0138	0.000622 U	0.00561 U	0.000822 U	0.000470 U	0.00187 J	0.00168 U	0.000802 U			
	MW-190-30	09/19/19	30	18.7	1.12 J	0.000419 U	0.0122	0.000555 U	0.00501 U	0.0585	0.0109	0.00418	0.00150 U	0.000716 U			
	MW-190-35	09/19/19	35	13.7	1.17 J	0.000425 U	0.00948	0.000563 U	0.00508 U	0.0786	0.0108	0.00442	0.00152 U	0.000726 U			
	MW-190-40	09/19/19	40	8.7	0.952 U	0.000449 U	0.0117	0.000595 U	0.00537 U	0.0108	0.00134	0.000775 U	0.00161 U	0.000767 U			
	MW-190-45	09/19/19	45	3.7	0.970 U	0.000457 U	0.00557 J	0.000606 U	0.00547 U	0.000800 U	0.000457 U	0.000789 U	0.00163 U	0.000781 U			
	MW-190-50	09/19/19	50	-1.4	1.79 J	0.000610 J	0.0175	0.000555 U	0.00501 U	0.00158 J	0.000419 U	0.000723 U	0.0015 U	0.000715 U			
	MW-190-55	09/19/19	55	-6.4	1.44 J	0.000459 J	0.00877	0.000575 U	0.00518 U	0.000759 U	0.000434 U	0.0790	0.00155 U	0.000676			
	MW-190-60	09/19/19	60	-11.4	1.39 J	0.000462 J	0.00549	0.000578 U	0.00521 U	0.00369 J	0.000436 U	0.00884 J	0.00156 U	0.00173			
	MW-2008-60	09/19/19	60 (dup)	-11.4	1.18 J	0.000432 U	0.0129	0.000573 U	0.00517 U	0.00950 J	0.000432 U	0.0214 J	0.00155 U	0.00138			
	MW-190-65	09/19/19	65	-16.4	1.65 J	0.000683 J	0.0191	0.000853 J	0.00528 U	0.000773 U	0.000442 U	0.000762 U	0.00158 U	0.000754 U			
	MW-190-70	09/19/19	70	-21.4	0.943 J	0.000443 U	0.00717	0.000587 U	0.00529 U	0.000775 U	0.000443 U	0.000764 U	0.00158 U	0.000757 U			
MW-190-75	09/19/19	75	-26.4	0.927 U	0.000437 U	0.00803	0.000579 U	0.00523 U	0.000765 U	0.000437 U	0.000754 U	0.00156 U	0.000747 U				
MW-190-80	09/19/19	80	-31.4	1.49 J	0.000437 U	0.0117	0.000579 U	0.00522 U	0.00132 J	0.000437 U	0.000753 U	0.00156 U	0.000746 U				
MW-190-85	09/19/19	85	-36.4	1.23 J	0.000460 U	0.00843	0.000609 U	0.00550 U	0.000805 U	0.000460 U	0.000793 U	0.00164 U	0.000785 U				
MW-190-87	09/19/19	87	-38.4	1.02 J	0.000521 J	0.00903	0.000633 U	0.00571 U	0.000837 U	0.000478 U	0.000825 U	0.00171 U	0.000816 U				
MW-301 (35.6 to 25.6)	MW-301-6	09/20/19	6	47.8	-	0.000469 U	0.0191	0.000628 J	0.00560 U	0.00260 J	0.000469 U	0.000809 U	0.00168 U	0.000800 U			
	MW-301-10	09/20/19	10	43.8	-	0.000440 U	0.00321 J	0.000583 U	0.00526 U	0.00463 J	0.000440 U	0.000759 U	0.00157 U	0.000751 U			
	MW-301-15	09/20/19	15	38.8	-	0.000454 U	0.0258	0.000602 U	0.00543 U	0.00396 J	0.000454 U	0.000783 U	0.00162 U	0.000775 U			
	MW-301-20	09/20/19	20	33.8	-	0.00135 U	0.0402	0.00178 U	0.0162 U	0.00927 J	0.00135 U	0.00232 U	0.00483 U	0.00231 U			
	MW-301-25	09/20/19	25	28.8	-	0.000455 U	0.0329	0.00121 J	0.00543 U	0.0326 J	0.00173	0.000784 U	0.00163 U	0.000776 U			
	MW-301-30	09/20/19	30	23.8	-	0.000495 U	0.0376	0.00111 J	0.00592 U	0.0141 J	0.000495 U	0.000854 U	0.00177 U	0.000845 U			
MW-302 (3.0 to -7.0)	MW-302-5	10/01/19	5	52.3	-	0.000468 U	0.00938	0.00110 J	0.00584 J	0.0461	0.000468 U	0.000808 U	0.00167 U	0.000800 U			
	MW-302-10	10/01/19	10	47.3	-	0.000498 U	0.00156 U	0.000659 U	0.00595 U	0.000871 U	0.000498 U	0.000859 U	0.00178 U	0.000850 U			
	MW-302-15	10/01/19	15	42.3	-	0.000545 U	0.0142	0.000723 U	0.00651 U	0.00215 J	0.000545 U	0.000940 U	0.00195 U	0.000931 U			
	MW-302-20	10/01/19	20	37.3	-	0.000477 U	0.00524 J	0.000632 U	0.00570 U	0.00541	0.000477 U	0.000823 U	0.00171 U	0.000815 U			
	MW-302-25	10/01/19	25	32.3	-	0.000448 U	0.00443 J	0.000594 U	0.00536 U	0.000784 U	0.000448 U	0.000773 U	0.00160 U	0.000765 U			
	MW-302-30	10/01/19	30	27.3	-	0.000438 U	0.00287 J	0.000580 U	0.00523 U	0.000766 U	0.000438 U	0.000755 U	0.00156 U	0.000747 U			
	MW-302-35	10/01/19	35	22.3	-	0.000430 U	0.00440 J	0.000570 U	0.00514 U	0.000752 U	0.000430 U	0.000742 U	0.00154 U	0.000734 U			
	MW-302-40	10/01/19	40	17.3	-	0.000425 U	0.00484 J	0.000564 U	0.00508 U	0.000745 U	0.000425 U	0.000734 U	0.00152 U	0.000727 U			
	MW-302-45	10/01/19	45	12.3	-	0.000477 U	0.0222	0.000631 U	0.00570 U	0.000834 U	0.000477 U	0.000822 U	0.00170 U	0.000814 U			
	MW-302-50	10/01/19	50	7.3	-	0.000478 U	0.0158	0.000633 U	0.00571 U	0.000836 U	0.000478 U	0.000824 U	0.00171 U	0.000816 U			
	MW-302-55	10/01/19	55	2.3	-	0.000455 U	0.00449 J	0.000602 U	0.00543 U	0.000795 U	0.000455 U	0.000784 U	0.00162 U	0.000776 U			
	MW-302-60	10/01/19	60	-2.7	-	0.000569 U	0.0216	0.00117 J	0.00680 U	0.000995 U	0.000569 U	0.000981 U	0.00204 U	0.000971 U			
	MW-302-65	10/01/19	65	-7.7	-	0.000468 U	0.00508 J	0.000621 U	0.00560 U	0.000820 U	0.000468 U	0.000808 U	0.00167 U	0.000800 U			
MW-2014-65	10/01/19	65 (dup)	-7.7	-	0.000485 U	0.0138	0.000643 U	0.00579 U	0.000849 U	0.000485 U	0.000836 U	0.00173 U	0.000828 U				

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-304 (-47.6 to -57.6)	MW-304-5	10/01/19	5	52.6	–	0.000451 U	0.00212 J	0.000597 U	0.00538 U	0.0250	0.000451 U	0.000777 U	0.00161 U	0.000769 U	
	MW-304-10	10/01/19	10	47.6	–	0.000456 U	0.00202 J	0.000604 U	0.00545 U	0.0198	0.000456 U	0.000786 U	0.00163 U	0.000778 U	
	MW-304-15	10/01/19	15	42.6	–	0.000476 U	0.00149 U	0.000630 U	0.00568 U	0.00806	0.000476 U	0.000820 U	0.00170 U	0.000812 U	
	MW-304-20	10/01/19	20	37.6	–	0.00166	0.00496 J	0.000624 U	0.00563 U	0.000824 U	0.000471 U	0.000813 U	0.00168 U	0.000804 U	
	MW-304-25	10/01/19	25	32.6	–	0.000438 U	0.00137 U	0.000580 U	0.00523 U	0.000766 U	0.000438 U	0.000755 U	0.00156 U	0.000747 U	
	MW-304-30	10/01/19	30	27.6	–	0.000470 U	0.00147 U	0.000623 U	0.00562 U	0.000823 U	0.000470 U	0.000812 U	0.00168 U	0.000803 U	
	MW-304-40	10/01/19	40	17.6	–	0.000434 U	0.00211 J	0.000575 U	0.00519 U	0.000760 U	0.000434 U	0.000749 U	0.00155 U	0.000741 U	
	MW-304-45	10/01/19	45	12.6	–	0.000406 U	0.0013 J	0.000538 U	0.00486 U	0.000711 U	0.000406 U	0.000701 U	0.00145 U	0.000694 U	
	MW-304-50	10/01/19	50	7.6	–	0.000431 U	0.00241 J	0.000571 U	0.00515 U	0.000754 U	0.000431 U	0.000743 U	0.00154 U	0.000735 U	
	MW-304-55	10/01/19	55	2.6	–	0.000403 U	0.00212 J	0.000534 U	0.00482 U	0.000706 U	0.000403 U	0.000695 U	0.00144 U	0.000688 U	
	MW-304-60	10/01/19	60	-2.4	–	0.000423 J	0.00355 J	0.000559 U	0.00504 U	0.000738 U	0.000422 U	0.000728 U	0.00151 U	0.000720 U	
	MW-304-65	10/01/19	65	-7.4	–	0.000463 U	0.00168 J	0.000614 U	0.00554 U	0.000811 U	0.000463 U	0.000799 U	0.00166 U	0.000791 U	
	MW-304-70	10/01/19	70	-12.4	–	0.000486 U	0.00270 J	0.000644 U	0.00581 U	0.000850 U	0.000486 U	0.000838 U	0.00174 U	0.000830 U	
	MW-304-75	10/01/19	75	-17.4	–	0.000458 U	0.0284	0.000619 J	0.00547 U	0.000801 U	0.000458 U	0.000790 U	0.00185 J	0.000782 U	
	MW-304-80	10/01/19	80	-22.4	–	0.000438 U	0.00188 J	0.000580 U	0.00523 U	0.000766 U	0.000438 U	0.000755 U	0.00157 U	0.000748 U	
	MW-304-85	10/01/19	85	-27.4	–	0.000438 U	0.00264 J	0.000580 U	0.00524 U	0.000767 U	0.000438 U	0.000756 U	0.00157 U	0.000748 U	
	MW-304-90	10/01/19	90	-32.4	–	0.000480 U	0.00223 J	0.000635 U	0.00573 U	0.000839 U	0.000480 U	0.000827 U	0.00171 U	0.000819 U	
	MW-304-95	10/01/19	95	-37.4	–	0.000474 U	0.00263 J	0.000628 U	0.00566 U	0.000829 U	0.000474 U	0.000818 U	0.00169 U	0.000809 U	
	MW-2009-95	10/01/19	95 (dup)	-37.4	–	0.000481 U	0.00217 J	0.000637 U	0.00574 U	0.000841 U	0.000481 U	0.000829 U	0.00172 U	0.000820 U	
	MW-304-100	10/02/19	100	-42.4	–	0.000471 U	0.00206 J	0.000625 U	0.00563 U	0.000825 U	0.000471 U	0.000813 U	0.00169 U	0.000805 U	
MW-304-105	10/02/19	105	-47.4	–	0.000468 U	0.00166 J	0.000620 U	0.00559 U	0.000819 U	0.000468 U	0.000807 U	0.00167 U	0.000799 U		
MW-304-110	10/02/19	110	-52.4	–	0.000506 U	0.00321 J	0.000699 J	0.00604 U	0.000885 U	0.000506 U	0.000872 U	0.00181 U	0.000864 U		
MW-304-115	10/02/19	115	-57.4	–	0.000466 U	0.00223 J	0.000617 U	0.00557 U	0.000816 U	0.000466 U	0.000804 U	0.00167 U	0.000796 U		
MW-307 (-12.4 to -22.4)	MW-307-6	10/03/19	6	54.5	–	0.000447 U	0.0131	0.000603 J	0.00534 U	0.000783 U	0.000447 U	0.000771 U	0.00160 U	0.000764 U	
	MW-307-10	10/03/19	10	50.5	–	0.000462 J	0.0260	0.000971 J	0.00551 U	0.000806 U	0.000460 U	0.000794 U	0.00165 U	0.000786 U	
	MW-307-15	10/03/19	15	45.5	–	0.000431 U	0.00403 J	0.000571 U	0.00515 U	0.000754 U	0.000431 U	0.000743 U	0.00154 U	0.000736 U	
	MW-307-20	10/03/19	20	40.5	–	0.000428 U	0.00602	0.000567 U	0.00511 U	0.000749 U	0.000428 U	0.000738 U	0.00153 U	0.00073 U	
	MW-307-25	10/03/19	25	35.5	–	0.000439 U	0.00675	0.000581 U	0.00524 U	0.000768 U	0.000439 U	0.000757 U	0.00157 U	0.000749 U	
	MW-307-30	10/03/19	30	30.5	–	0.000589 U	0.0148	0.000781 U	0.00705 U	0.00103 U	0.000589 U	0.00102 U	0.00211 U	0.00101 U	
	MW-307-35	10/03/19	35	25.5	–	0.000428 U	0.0111	0.000567 U	0.00511 U	0.000749 U	0.000428 U	0.000738 U	0.00153 U	0.000731 U	
	MW-307-40	10/03/19	40	20.5	–	0.000457 U	0.00815	0.000605 U	0.00546 U	0.000799 U	0.000457 U	0.000788 U	0.00163 U	0.00078 U	
	MW-307-45	10/03/19	45	15.5	–	0.000441 U	0.00846	0.000585 U	0.00527 U	0.000772 U	0.000441 U	0.000761 U	0.00158 U	0.000753 U	
	MW-307-50	10/03/19	50	10.5	–	0.000445 U	0.0157	0.000589 U	0.00532 U	0.000778 U	0.000445 U	0.000767 U	0.00159 U	0.000759 U	
	MW-307-55	10/03/19	55	5.5	–	0.000434 U	0.0104	0.000575 U	0.00519 U	0.000760 U	0.000434 U	0.000749 U	0.00155 U	0.000742 U	
	MW-307-60	10/03/19	60	0.5	–	0.000452 U	0.00583	0.000599 U	0.00540 U	0.000790 U	0.000452 U	0.000779 U	0.00161 U	0.000771 U	
	MW-307-65	10/03/19	65	-4.5	–	0.000921 U	0.0687	0.00148 J	0.0110 U	0.00161 U	0.000921 U	0.00159 U	0.00329 U	0.00157 U	
	MW-307-70	10/03/19	70	-9.5	–	0.004580 U	0.0561 J	0.00607 U	0.0547 U	0.00802 U	0.00458 U	0.00791 U	0.0164 U	0.00782 U	
	MW-307-75	10/03/19	75	-14.5	–	0.000441 U	0.0160	0.000584 U	0.00527 U	0.000772 U	0.000441 U	0.000761 U	0.00158 U	0.000753 U	
	MW-307-80	10/03/19	80	-19.5	–	0.000467 U	0.0261	0.000619 U	0.00558 U	0.000818 U	0.000467 U	0.000807 U	0.00167 U	0.000798 U	
	MW-307-85	10/03/19	85	-24.5	–	0.000836 J	0.0293	0.000962 J	0.00548 U	0.000802 U	0.000458 U	0.000790 U	0.00164 U	0.000782 U	
MW-2016-85	10/03/19	85 (dup)	-24.5	–	0.000722 J	0.0113	0.000584 J	0.00516 U	0.000756 U	0.000432 U	0.000745 U	0.00154 U	0.000738 U		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-309 (-32.0 to -42.0)	MW-309-5	09/19/19	5	25.4	–	0.00514	0.0102	0.00118 J	0.00734 J	0.00188 J	0.000477 U	0.000823 U	0.00171 U	0.000815 U	
	MW-309-10	09/19/19	10	20.4	389	0.117	0.0787 U	0.121 J	0.400 J	0.0440 U	0.0252 U	0.0434 U	0.0900 U	0.0429 U	
	MW-309-13.5	09/19/19	13.5	16.9	15.6	0.00485	0.00153 U	0.137	0.00584 U	0.000855 U	0.000489 U	0.000843 U	0.00175 U	0.000834 U	
	MW-309-15	09/19/19	15	15.4	29.9	0.0766	0.0503	1.45	0.174	0.00659 U	0.00377 U	0.00650 U	0.0134 U	0.00643 U	
	MW-309-20	09/19/19	20	10.4	–	0.150	0.0593	0.505	0.252	0.000824 U	0.000471 U	0.000812 U	0.00168 U	0.000804 U	
	MW-309-25	09/19/19	25	5.4	–	0.0796	0.0132	0.258	0.0896	0.000827 U	0.000473 U	0.000815 U	0.00169 U	0.000807 U	
	MW-309-30	09/19/19	30	0.4	–	0.00545	0.0250	0.00553	0.0159	0.000836 U	0.000478 U	0.000824 U	0.00171 U	0.000816 U	
	MW-309-35	09/19/19	35	-4.6	–	0.0286	0.0200	0.000977 J	0.00579 U	0.000849 U	0.000485 U	0.000721	0.00173 U	0.000828 U	
	MW-309-40	09/19/19	40	-9.6	–	0.0387	0.0381	0.00116 J	0.00580 U	0.000849 U	0.000485 U	0.170	0.00173 U	0.000828 U	
	MW-309-45	09/19/19	45	-14.6	–	0.00557	0.0229	0.000668 U	0.00603 U	0.000883 U	0.000505 U	0.0154	0.00180 U	0.000861 U	
	MW-309-50	09/19/19	50	-19.6	–	0.000477 U	0.00149 U	0.000632 U	0.00570 U	0.000834 U	0.000477 U	0.000822 U	0.00170 U	0.000814 U	
	MW-309-55	09/19/19	55	-24.6	–	0.000444 U	0.0257	0.00151 J	0.00583 J	0.000777 U	0.000444 U	0.00184 J	0.00159 U	0.000758 U	
	MW-309-60	09/19/19	60	-29.6	–	0.000447 U	0.0170	0.000592 U	0.00534 U	0.000782 U	0.000447 U	0.000771 U	0.00160 U	0.000763 U	
	MW-309-65	09/19/19	65	-34.6	–	0.000449 U	0.0164	0.000785 J	0.00537 U	0.000786 U	0.000449 U	0.000775 U	0.00161 U	0.000767 U	
MW-309-70	09/19/19	70	-39.6	–	0.000455 U	0.0129	0.000668 J	0.00544 U	0.000796 U	0.000455 U	0.000785 U	0.00163 U	0.000777 U		
MW-309-75	09/19/19	75	-44.6	–	0.000432 U	0.0100	0.000573 U	0.00517 U	0.000757 U	0.000432 U	0.000746 U	0.00155 U	0.000738 U		
MW-311 (-29.0 to -39.0)	MW-311-5	09/18/19	5	28.1	–	0.000644 J	0.00756	0.000634 U	0.00572 U	0.00286 J	0.000479 U	0.000826 U	0.00171 U	0.000818 U	
	MW-311-10	09/18/19	10	23.1	–	0.000460 U	0.00875	0.000610 U	0.00550 U	0.000806 U	0.000460 U	0.000794 U	0.00165 U	0.000786 U	
	MW-311-15	09/18/19	15	18.1	–	0.00107 U	0.0223	0.00142 U	0.0128 U	0.00188 U	0.00107 U	0.00185 U	0.00384 U	0.00184 U	
	MW-311-20	09/18/19	20	13.1	–	0.00112 U	0.0469	0.00148 U	0.0134 U	0.00196 U	0.00112 U	0.00193 U	0.00399 U	0.00192 U	
	MW-311-25	09/18/19	25	8.1	–	0.00199 U	0.196	0.00199 U	0.0237 U	0.00348 U	0.00199 U	0.00343 U	0.00710 U	0.00339 U	
	MW-311-30	09/18/19	30	3.1	–	0.00105 U	0.0804	0.00105 U	0.0180	0.00184 U	0.00105 U	0.00182 U	0.00376 U	0.00179 U	
	MW-311-35	09/18/19	35	-1.9	–	0.000933 U	0.0325	0.000933 U	0.0112 U	0.00163 U	0.000933 U	0.00161 U	0.00334 U	0.00160 U	
	MW-311-40	09/18/19	40	-6.9	–	0.000752 J	0.0152	0.000683 J	0.00560 U	0.00251 J	0.00304	0.00613	0.00168 U	0.00080 U	
	MW-311-45	09/18/19	45	-11.9	–	0.000502 U	0.00613 J	0.000665 U	0.00600 U	1.25	0.169	0.265	0.00184 J	0.000857 U	
	MW-311-50	09/18/19	50	-16.9	–	0.000485 J	0.0181	0.000619 U	0.00558 U	1.31	0.151	0.232	0.00195 J	0.000797 U	
	MW-311-55	09/18/19	55	-21.9	–	0.000690 J	0.0106	0.000586 U	0.00528 U	2.31	0.895	0.545	0.00191 J	0.0235	
	MW-311-60	09/18/19	60	-26.9	–	0.000877 U	0.0290	0.00131 J	0.0105 U	0.00274 J	0.0106	0.141	0.00313 U	0.0232	
	MW-311-65	09/18/19	65	-31.9	–	0.000424 U	0.0112	0.000562 U	0.00507 U	0.000742 U	0.000817 J	0.00153 J	0.00152 U	0.00565	
	MW-2005-65	09/18/19	65 (dup)	-31.9	–	0.000507 J	0.0123	0.000641 J	0.00524 U	0.00113 J	0.000439 U	0.000757 U	0.00157 U	0.00442	
MW-311-70	09/18/19	70	-36.9	–	0.000441 U	0.00420 J	0.000584 U	0.00527 U	0.00142 J	0.000483 J	0.000760 U	0.00158 U	0.000753 U		
MW-2006-70	09/18/19	70 (dup)	-36.9	–	0.000501 U	0.0128	0.000664 U	0.00599 U	0.000894 J	0.000501 U	0.0434	0.00179 U	0.000856 U		
MW-312 (19.9 to 9.9)	MW-312-6	09/16/19	6	29.6	–	0.000742 J	0.00946	0.000645 U	0.00582 U	0.000852 U	0.000487 U	0.000839 U	0.00174 U	0.000831 U	
	MW-312-10	09/16/19	10	25.6	–	0.00135 J	0.0225	0.00123 J	0.009700 U	0.00142 U	0.000812 U	0.00140 U	0.00290 U	0.00139 U	
	MW-312-15	09/16/19	15	20.6	–	0.00168	0.0408	0.00573	0.0241	0.000968 U	0.000553 U	0.00114 J	0.00198 U	0.000944 U	
	MW-312-20	09/16/19	20	15.6	–	0.000433 U	0.00520 J	0.000573 U	0.00517 U	0.000757 U	0.000433 U	0.000747 U	0.00155 U	0.000739 U	
	MW-2004-20	09/16/19	20	15.6	–	0.000462 U	0.00987	0.000612 U	0.00552 U	0.000808 U	0.000462 U	0.000797 U	0.00165 U	0.000789 U	
MW-312-25	09/16/19	25	10.6	–	0.00102 J	0.00658	0.000593 U	0.00660 J	0.000783 U	0.000447 U	0.000772 U	0.00160 U	0.000764 U		
MW-314 (-28.0 to -38.0)	MW-314-6	09/13/19	6	33.8	–	0.000909 J	0.00468 J	0.000803 J	0.00561 J	0.00325	0.000454 U	0.000784 U	0.00162 U	0.000776 U	
	MW-314-10	09/13/19	10	29.8	–	0.000459 U	0.00970	0.000608 U	0.00549 U	0.000803 U	0.000459 U	0.000791 U	0.00165 U	0.000784 U	
	MW-314-15	09/13/19	15	24.8	–	0.000450 U	0.0101	0.000596 U	0.00538 U	0.000788 U	0.000450 U	0.000776 U	0.00161 U	0.000768 U	
	MW-314-20	09/13/19	20	19.8	–	0.000940 J	0.00875	0.000608 U	0.00549 U	0.000803 U	0.00105 J	0.00292	0.00164 U	0.000784 U	

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-314 (continued)	MW-314-25	09/13/19	25	14.8	–	0.000508 U	0.00372 J	0.000673 U	0.00607 U	0.000889 U	0.000508 U	0.00456	0.00182 U	0.00563	
	MW-2002-25	09/13/19	25	14.8	–	0.000505 U	0.00170 J	0.000669 U	0.00603 U	0.000884 U	0.000505 U	0.00211 J	0.00181 U	0.000862 U	
	MW-314-30	09/13/19	30	9.8	–	0.000498 U	0.00696	0.000659 U	0.00595 U	0.0637	0.116	0.0481	0.00178 U	0.00230 J	
	MW-314-35	09/13/19	35	4.8	–	0.000429 U	0.0118	0.000569 U	0.00513 U	1.14	0.449	0.776	0.00420 J	0.0238	
	MW-314-40	09/13/19	40	-0.2	–	0.000446 U	0.00627	0.000591 U	0.00533 U	0.0258	0.199	2.55	0.00469 J	0.0515	
	MW-314-45	09/13/19	45	-5.2	–	0.000799 J	0.00815	0.000587 U	0.00529 U	0.00151 J	0.00106 J	0.00457	0.00158 U	0.00391	
	MW-314-50	09/13/19	50	-10.2	–	0.000445 U	0.00713	0.000590 U	0.00532 U	0.000779 U	0.000445 U	0.313	0.00159 U	0.000760 U	
	MW-314-55	09/13/19	55	-15.2	–	0.000483 U	0.00644	0.000640 U	0.00577 U	0.000845 U	0.000483 U	0.406	0.00173 U	0.0756	
	MW-314-60	09/13/19	60	-20.2	–	0.000442 U	0.00757	0.000586 U	0.00529 U	0.000774 U	0.000442 U	0.102	0.00158 U	0.0239	
	MW-314-65	09/13/19	65	-25.2	–	0.000454 U	0.00364 J	0.000602 U	0.00543 U	0.000795 U	0.000454 U	0.0843	0.00162 U	0.000775 U	
	MW-314-70	09/13/19	70	-30.2	–	0.00486 U	0.0338 J	0.00644 U	0.0581 U	0.298	0.138	0.0502	0.0174 U	0.00830 U	
	MW-314-75	09/13/19	75	-35.2	–	0.000913 U	0.00677 J	0.00121 U	0.0109 U	0.0441	0.124	0.153	0.00327 U	0.00156 U	
MW-314-80	09/13/19	80	-40.2	–	0.000597 U	0.00446 J	0.000792 U	0.00713 U	0.0160	0.100	0.139	0.00213 U	0.00102 U		
MW-316 (-10.0 to -20.0)	MW-316-5	09/09/19	5	44.8	–	0.000433 U	0.00780	0.000574 U	0.00517 U	0.000758 U	0.000433 U	0.000747 U	0.00155 U	0.000739 U	
	MW-316-10	09/09/19	10	39.8	–	0.000453 U	0.0197	0.000600 U	0.00541 U	0.000792 U	0.000453 U	0.000781 U	0.00162 U	0.000773 U	
	MW-316-15	09/09/19	15	34.8	–	0.000450 U	0.00457 J	0.000596 U	0.00537 U	0.000787 U	0.000450 U	0.000776 U	0.00161 U	0.000768 U	
	MW-316-20	09/09/19	20	29.8	–	0.000431 U	0.00535 J	0.000572 U	0.00516 U	0.00305	0.000431 U	0.000744 U	0.00154 U	0.000737 U	
	MW-316-25	09/09/19	25	24.8	–	0.000454 U	0.00791	0.000601 U	0.00542 U	0.000794 U	0.000454 U	0.00142 J	0.00162 U	0.000775 U	
	MW-316-30	09/09/19	30	19.8	–	0.000444 U	0.00612	0.000588 U	0.00530 U	0.000777 U	0.000444 U	0.000766 U	0.00159 U	0.000758 U	
	MW-316-35	09/09/19	35	14.8	–	0.000452 U	0.00707	0.000598 U	0.00540 U	0.000790 U	0.000452 U	0.000779 U	0.00161 U	0.000771 U	
	MW-316-40	09/09/19	40	9.8	–	0.000455 U	0.00483 J	0.000603 U	0.00544 U	0.000797 U	0.000455 U	0.000785 U	0.00163 U	0.000777 U	
	MW-316-45	09/09/19	45	4.8	–	0.000445 U	0.00703	0.000589 U	0.00532 U	0.000778 U	0.000445 U	0.000767 U	0.00159 U	0.000759 U	
	MW-316-50	09/09/19	50	-0.2	–	0.000479 U	0.0112	0.000634 U	0.00572 U	0.000838 U	0.000479 U	0.000826 U	0.00171 U	0.000817 U	
	MW-316-55	09/09/19	55	-5.2	–	0.000453 U	0.00464 J	0.000600 U	0.00541 U	0.000793 U	0.000453 U	0.000781 U	0.00162 U	0.000774 U	
	MW-316-60	09/09/19	60	-10.2	–	0.000450 U	0.00596	0.000596 U	0.00537 U	0.000787 U	0.000450 U	0.000776 U	0.00161 U	0.000768 U	
	MW-316-65	09/10/19	65	-15.2	–	0.000599 U	0.0131	0.000794 U	0.00715 U	0.00105 U	0.000599 U	0.00103 U	0.00214 U	0.00102 U	
	MW-2001-65	09/10/19	65	-15.2	–	0.000474 U	0.00811	0.000628 U	0.00566 U	0.000829 U	0.000474 U	0.000817 U	0.00169 U	0.000809 U	
MW-316-70	09/10/19	70	-20.2	–	0.000453 U	0.00694	0.000600 U	0.00541 U	0.000792 U	0.000453 U	0.000781 U	0.00162 U	0.000773 U		
MW-319 (-42.8 to -52.8)	MW-319-6	09/18/19	6	25.7	–	0.000468 J	0.0154	0.00182 J	0.0102	0.000812 U	0.000464 U	0.000801 U	0.00166 U	0.000792 U	
	MW-319-10	09/18/19	10	21.7	–	0.000461 U	0.00939	0.000611 U	0.00551 U	0.00247 J	0.000461 U	0.000796 U	0.00165 U	0.000787 U	
	MW-319-15	09/18/19	15	16.7	–	0.000458 U	0.0147	0.000607 U	0.00548 U	0.000802 U	0.000458 U	0.000790 U	0.00164 U	0.000782 U	
	MW-319-20	09/18/19	20	11.7	–	0.000495 U	0.00844	0.000656 U	0.00592 U	0.000867 U	0.000495 U	0.000855 U	0.00177 U	0.000846 U	
	MW-319-30	09/18/19	30	1.7	–	0.000457 U	0.0140	0.000606 U	0.00546 U	0.000800 U	0.000457 U	0.000789 U	0.00163 U	0.000781 U	
	MW-319-35	09/18/19	35	-3.3	–	0.00112 J	0.0151	0.000668 U	0.00603 U	0.000883 U	0.000504 U	0.00087 U	0.00180 U	0.000861 U	
	MW-319-40	09/18/19	40	-8.3	–	0.000472 U	0.00939	0.000626 U	0.00564 U	0.000826 U	0.000472 U	0.000815 U	0.00169 U	0.000806 U	
	MW-319-45	09/18/19	45	-13.3	–	0.000475 U	0.00874	0.000629 U	0.00568 U	0.000831 U	0.000475 U	0.000819 U	0.00170 U	0.000811 U	
	MW-319-50	09/18/19	50	-18.3	–	0.0772	0.00662	0.000647 U	0.00584 U	0.000855 U	0.000488 U	0.000843 U	0.00175 U	0.000834 U	
	MW-319-55	09/18/19	55	-23.3	–	0.0431	0.0279	0.00373	0.0102	0.000884 U	0.000505 U	0.00211 J	0.00181 U	0.000863 U	
	MW-319-60	09/18/19	60	-28.3	–	0.0132	0.0130	0.00761	0.0217	0.000831 U	0.000475 U	0.00497	0.00170 U	0.000811 U	
	MW-319-65	09/18/19	65	-33.3	–	0.00411	0.0141	0.00104 J	0.00713 J	0.0230	0.00875	0.0139	0.00182 U	0.000871 U	
	MW-319-70	09/18/19	70	-38.3	–	0.000487 U	0.0148	0.000646 U	0.00582 U	0.000853 U	0.000487 U	0.0396	0.00174 U	0.000832 U	
	MW-2007-70	09/18/19	70 (dup)	-38.3	–	0.00100 J	0.0366	0.00168 J	0.0102 U	0.00375 J	0.000852 U	0.00147 U	0.00305 U	0.00146 U	
MW-319-75	09/18/19	75	-43.3	–	0.000448 J	0.00954	0.000587 U	0.00529 U	0.0181	0.00318	0.194	0.00158 U	0.000757 U		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-319 (continued)	MW-319-80	09/18/19	80	-48.3	–	0.000486 U	0.00815	0.000644 U	0.00581 U	0.0693	0.0662	0.00625	0.00174 U	0.000830 U	
	MW-319-85	09/18/19	85	-53.3	–	0.000481 U	0.0106	0.000638 U	0.00575 U	0.0387	0.0562	0.0308	0.00172 U	0.000822 U	
MW-320 (18.6 to 8.6)	MW-320-19	09/29/19	19	15.1	707	0.00894 U	0.0279 U	0.0118 U	0.107 U	0.0156 U	0.00894 U	0.0154 U	0.0319 U	0.0153 U	
	MW-320-27	09/29/19	27	7.1	0.982 U	0.000463 U	0.0110	0.000614 U	0.00554 U	0.000811 U	0.000463 U	0.000799 U	0.00166 U	0.000791 U	
MW-323 (-65.4 to -75.4)	MW-323-10	09/28/19	10	24.7	–	0.0151	0.0310	0.00129 U	0.0117 U	0.0312	0.000975 U	0.0168	0.00349 U	0.00167 U	
	MW-2012-10	09/28/19	10 (dup)	24.7	–	0.000500 U	0.0132	0.000662 U	0.00598 U	0.000875 U	0.000500 U	0.000862 U	0.00178 U	0.000853 U	
	MW-323-15	09/28/19	15	19.7	–	0.00140 J	0.0548	0.00121 U	0.0110 U	0.0106	0.000917 U	0.00158 U	0.00328 U	0.00156 U	
	MW-323-20	09/28/19	20	14.7	–	0.00348	0.0313	0.0194	0.0535	0.00079 U	0.000452 U	0.000998 J	0.00161 U	0.000771 U	
	MW-323-25	09/28/19	25	9.7	–	0.000456 U	0.0107	0.000604 U	0.00545 U	0.000798 U	0.000456 U	0.00136 J	0.00163 U	0.000779 U	
	MW-323-30	09/28/19	30	4.7	–	0.000850 U	0.0475	0.00113 U	0.0102 U	0.00149 U	0.000850 U	0.00335 J	0.00304 U	0.00145 U	
	MW-323-35	09/28/19	35	-0.4	–	0.000514 U	0.0141	0.000681 U	0.00614 U	0.000900 U	0.000514 U	0.00305 J	0.00184 U	0.000878 U	
	MW-323-40	09/28/19	40	-5.4	–	0.000514 U	0.0104	0.000681 U	0.00614 U	0.000899 U	0.000514 U	0.00321 J	0.00184 U	0.000877 U	
	MW-323-45	09/28/19	45	-10.4	–	0.000512 U	0.0145	0.000678 U	0.00612 U	0.000896 U	0.000512 U	0.000883 U	0.00183 U	0.000874 U	
	MW-323-50	09/28/19	50	-15.4	–	0.000730 J	0.0193	0.000610 U	0.00550 U	0.000806 U	0.00121	0.00257 J	0.00165 U	0.000786 U	
	MW-323-55	09/28/19	55	-20.4	–	0.00179	0.0178	0.000618 U	0.00557 U	0.120	0.0144	0.682	0.0053 J	0.00604	
	MW-323-60	09/28/19	60	-25.4	–	0.000767 J	0.0510	0.00146 J	0.00613 U	0.0806	0.0165	2.13	0.0110	0.0218	
	MW-2010-60	09/28/19	60 (dup)	-25.4	–	0.000488 U	0.0171	0.000646 U	0.00583 U	0.0928	0.0177	1.93	0.00987	0.0239	
	MW-323-65	09/28/19	65	-30.4	–	0.000481 U	0.00820	0.000637 U	0.00574 U	0.0696	0.0520	3.03	0.0114	0.0403	
	MW-323-70	09/28/19	70	-35.4	–	0.0673 U	0.211 U	0.0892 U	0.804 U	0.118 U	0.0673 U	0.116 U	0.241 U	0.115 U	
	MW-323-75	09/28/19	75	-40.4	–	0.000470 U	0.0181	0.000623 U	0.00562 U	0.0408	0.0322	2.13	0.00790	0.0186	
	MW-323-80	09/28/19	80	-45.4	–	0.000452 U	0.0101	0.000599 U	0.00540 U	0.0303	0.321	0.453	0.00162 U	0.00582	
	MW-323-85	09/28/19	85	-50.4	–	0.000479 U	0.0140	0.000635 U	0.00572 U	0.0231	0.416	0.794	0.00811	0.0151	
	MW-323-91	09/28/19	91	-56.4	–	0.00113 U	0.0482	0.00150 U	0.0136 U	0.0125	0.0990	1.61	0.00405 U	0.0225	
MW-323-95	09/28/19	95	-60.4	–	0.000480 U	0.00831	0.000635 U	0.00573 U	0.00833	0.0303	0.433	0.00171 U	0.0195		
MW-323-99	09/28/19	99	-64.4	–	0.000462 U	0.00869	0.000613 U	0.00553 U	0.000809 U	0.0115	0.325	0.00165 U	0.0146		
MW-323-105	09/28/19	105	-70.4	–	0.000472 U	0.00492 J	0.000626 U	0.00564 U	0.000827 U	0.000472 U	0.000815 U	0.00169 U	0.000806 U		
MW-323-110	09/28/19	110	-75.4	–	0.000980 U	0.0546	0.00129 U	0.0117 U	0.00171 U	0.000980 U	0.0150	0.00351 U	0.00168 U		
MW-324 (-32.1 to -42.1)	MW-324-6	09/12/19	6	28.3	–	0.000450 U	0.00454 J	0.000596 U	0.00538 U	0.000787 U	0.000450 U	0.000776 U	0.00161 U	0.000768 U	
	MW-324-10	09/12/19	10	24.3	–	0.000463 U	0.00790	0.000614 U	0.00553 U	0.00158 J	0.000463 U	0.00566	0.00166 U	0.000791 U	
	MW-324-15	09/12/19	15	19.3	–	0.000437 U	0.00601	0.000579 U	0.00522 U	0.000764 U	0.000437 U	0.000754 U	0.00156 U	0.000746 U	
	MW-324-20	09/12/19	20	14.3	–	0.00362	0.00659	0.000618 U	0.00558 U	0.000817 U	0.000467 U	0.000805 U	0.00167 U	0.000797 U	
	MW-324-25	09/12/19	25	9.3	–	0.00177	0.0111	0.00114 J	0.00688 J	0.000826 U	0.000472 U	0.0120	0.00169 U	0.000806 U	
	MW-324-30	09/12/19	30	4.3	–	0.000492 U	0.0128	0.000652 U	0.00588 U	0.000860 U	0.000492 U	0.0354	0.00176 U	0.00084 U	
	MW-324-35	09/12/19	35	-0.7	–	0.000478 U	0.00528 J	0.000633 U	0.00571 U	0.000836 U	0.000478 U	0.000860 J	0.00171 U	0.000815 U	
	MW-324-40	09/12/19	40	-5.7	–	0.000483 U	0.00569 J	0.000641 U	0.00578 U	0.000846 U	0.000483 U	0.000834 U	0.00173 U	0.000826 U	
	MW-324-45	09/12/19	45	-10.7	–	0.000503 U	0.00913	0.000667 U	0.00602 U	0.000881 U	0.000503 U	0.00905	0.00180 U	0.000860 U	
	MW-324-50	09/12/19	50	-15.7	–	0.000400 U	0.00369 J	0.000530 U	0.00478 U	0.000700 U	0.000400 U	0.000690 U	0.00143 U	0.000683 U	
	MW-324-55	09/12/19	55	-20.7	–	0.0148	0.00501 J	0.000601 U	0.00542 U	0.000793 U	0.000453 U	0.0143	0.00162 U	0.00110 J	
	MW-324-60	09/12/19	60	-25.7	–	0.00992	0.00977	0.000601 U	0.00542 U	0.000793 U	0.000453 U	0.213	0.00171 J	0.0200	
	MW-324-65	09/12/19	65	-30.7	–	0.00303	0.0132	0.000623 U	0.00563 U	0.0115	0.0441	2.47	0.0113	0.0467	
	MW-324-70	09/12/19	70	-35.7	–	0.00121 J	0.00820	0.000658 U	0.00593 U	0.00674	0.0806	2.15	0.00850	0.0218	
MW-324-75	09/12/19	75	-40.7	–	0.000555 J	0.00848	0.000665 U	0.00599 U	0.0516	0.0194	1.47	0.00586 J	0.00486		
MW-324-80	09/12/19	80	-45.7	–	0.000689 J	0.0129	0.000663 U	0.00598 U	0.000876 U	0.000501 U	2.01	0.00696	0.0106		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)										
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC	
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050	
MW-326 (-48.7 to -58.7)	MW-326-5	09/09/19	5	36.3	–	0.00274	0.00961	0.00213 J	0.00846	0.000771 U	0.000441 U	0.000760 U	0.00158 U	0.000753 U	
	MW-326-10	09/09/19	10	31.3	–	0.000532 U	0.00821	0.000705 U	0.00636 U	0.000932 U	0.000532 U	0.000918 U	0.00191 U	0.000909 U	
	MW-326-15	09/09/19	15	26.3	–	0.000468 U	0.00821	0.000620 U	0.00559 U	0.000819 U	0.000468 U	0.000807 U	0.00167 U	0.000799 U	
	MW-326-20	09/09/19	20	21.3	–	0.000468 U	0.00613	0.000620 U	0.00560 U	0.000819 U	0.000468 U	0.000808 U	0.00167 U	0.000800 U	
	MW-326-25	09/09/19	25	16.3	–	0.000496 U	0.00595 J	0.000658 U	0.00593 U	0.000869 U	0.000496 U	0.000856 U	0.00177 U	0.000848 U	
	MW-326-30	09/09/19	30	11.3	–	0.001610 U	0.0174 J	0.00214 U	0.0193 U	0.00283 U	0.00161 U	0.00279 U	0.00578 U	0.00277 U	
	MW-326-35	09/09/19	35	6.3	–	0.000495 U	0.00819	0.000655 U	0.00591 U	0.000866 U	0.000495 U	0.000853 U	0.00177 U	0.000845 U	
	MW-326-40	09/09/19	40	1.3	–	0.000477 U	0.00812	0.000632 U	0.00570 U	0.000835 U	0.000477 U	0.000823 U	0.00171 U	0.000815 U	
	MW-326-45	09/09/19	45	-3.7	–	0.000482 U	0.00790	0.000638 U	0.00576 U	0.000843 U	0.00169	0.0617	0.00172 U	0.000823 U	
	MW-326-50	09/09/19	50	-8.7	–	0.000457 U	0.00480 J	0.000606 U	0.00546 U	0.101 J	0.0145	0.00570	0.00163 U	0.000781 U	
	MW-326-55	09/09/19	55	-13.7	–	0.000487 U	0.0143	0.000645 U	0.00581 U	0.00106 U	0.000487 U	0.0150	0.00174 U	0.000831 U	
	MW-326-60	09/09/19	60	-18.7	–	0.000435 U	0.00380 J	0.000576 U	0.00520 U	0.000761 U	0.000435 U	0.00433	0.00155 U	0.000742 U	
	MW-326-65	09/09/19	65	-23.7	–	0.000517 J	0.00667	0.000614 U	0.00554 U	0.00753	0.00243	0.00508	0.00166 U	0.000792 U	
	MW-326-70	09/09/19	70	-28.7	–	0.000487 U	0.00699	0.000646 U	0.00582 U	0.000853 U	0.000487 U	0.00136 J	0.00174 U	0.000832 U	
	MW-326-75	09/09/19	75	-33.7	–	0.000485 U	0.00783	0.000643 U	0.00579 U	0.000849 U	0.000485 U	0.000836 U	0.00173 U	0.000828 U	
	MW-326-80	09/09/19	80	-38.7	–	0.000475 U	0.00436 J	0.000630 U	0.00568 U	0.000832 U	0.000475 U	0.000820 U	0.00170 U	0.000812 U	
	MW-326-85	09/10/19	85	-43.7	–	0.000467 U	0.00342 J	0.000619 U	0.00559 U	0.000818 U	0.000467 U	0.000806 U	0.00167 U	0.000798 U	
MW-326-90	09/10/19	90	-48.7	–	0.000471 U	0.00651	0.000624 U	0.00563 U	0.000824 U	0.000471 U	0.000812 U	0.00168 U	0.000804 U		
MW-326-95	09/10/19	95	-53.7	–	0.000449 U	0.0102	0.000595 U	0.00537 U	0.000786 U	0.000449 U	0.000775 U	0.00161 U	0.000767 U		
MW-200I-95	09/10/19	95 (dup)	-53.7	–	0.000456 U	0.00797	0.000891 J	0.00545 U	0.000798 U	0.000456 U	0.000787 U	0.00163 U	0.000779 U		
MW-326-100	09/10/19	100	-58.7	–	0.000483 U	0.0108	0.000640 U	0.00578 U	0.000846 U	0.000483 U	0.000834 U	0.00173 U	0.000825 U		
MW-328 (-36.1 to -46.1)	MW-328-5	09/16/19	5	23.4	–	0.000476 U	0.0262	0.000952 J	0.00568 U	0.000832 U	0.000476 U	0.000820 U	0.00170 U	0.000812 U	
	MW-328-10	09/16/19	10	18.4	–	0.000550 U	0.00851	0.000728 U	0.00657 U	0.000962 U	0.000550 U	0.000948 U	0.00197 U	0.000939 U	
	MW-328-15	09/16/19	15	13.4	–	0.000491 U	0.00559 J	0.000651 U	0.00587 U	0.000859 U	0.000491 U	0.000847 U	0.00176 U	0.000838 U	
	MW-328-20	09/16/19	20	8.4	–	0.000985 J	0.0178	0.000633 U	0.00571 U	0.000836 U	0.000478 U	0.0304	0.00171 U	0.000816 U	
	MW-328-30	09/16/19	30	-1.6	–	0.00943 U	0.207	0.0125 U	0.113 U	0.0165 U	0.00943 U	0.0163 U	0.0337 U	0.0160 U	
	MW-328-35	09/16/19	35	-6.6	–	0.00117 J	0.00781	0.000681 U	0.00615 U	0.000900 U	0.000514 U	0.000886 U	0.00184 U	0.000878 U	
	MW-328-40	09/16/19	40	-11.6	–	0.00116 U	0.00849 J	0.00154 U	0.0139 U	0.00204 U	0.00116 U	0.00201 U	0.00416 U	0.00199 U	
	MW-328-45	09/16/19	45	-16.6	–	0.000493 U	0.00519 J	0.000654 U	0.00589 U	0.000863 U	0.000493 U	0.000851 U	0.00176 U	0.000842 U	
	MW-328-50	09/16/19	50	-21.6	–	0.0147 U	0.299	0.0195 U	0.175 U	0.0257 U	0.0147 U	0.0253 U	0.0524 U	0.0251 U	
	MW-328-55	09/16/19	55	-26.6	–	0.000476 U	0.00690	0.000631 U	0.00569 U	0.000833 U	0.000476 U	0.000821 U	0.00170 U	0.000813 U	
	MW-328-60	09/16/19	60	-31.6	–	0.000481 U	0.00798	0.000637 U	0.00575 U	0.000842 U	0.000481 U	0.000830 U	0.00172 U	0.000821 U	
	MW-328-65	09/16/19	65	-36.6	–	0.000466 U	0.00736	0.000618 U	0.00557 U	0.000816 U	0.000466 U	0.00706	0.00167 U	0.000796 U	
	MW-328-70	09/16/19	70	-41.6	–	0.0250	0.00601 J	0.000638 U	0.00576 U	0.000843 U	0.000482 U	0.0265	0.00172 U	0.000822 U	
MW-328-75	09/16/19	75	-46.6	–	0.0475	0.00701	0.000618 U	0.00558 U	0.000816 U	0.000467 U	0.0192	0.00167 U	0.000797 U		
MW-328-80	09/16/19	80	-51.6	–	0.0407	0.00605 J	0.000699 U	0.00631 U	0.000923 U	0.000528 U	0.0204	0.00189 U	0.000901 U		
MW-329 (-69.0 to -79.0)	MW-329-5	09/12/19	5	24.3	–	0.000428 U	0.00386 J	0.000566 U	0.00511 U	0.000748 U	0.000428 U	0.00156 J	0.00153 U	0.000730 U	
	MW-329-10	09/12/19	10	19.3	–	0.000421 U	0.0318	0.000558 U	0.00503 U	0.000736 U	0.000421 U	0.000902 J	0.00150 U	0.000718 U	
	MW-329-15	09/12/19	15	14.3	–	0.000439 U	0.00428 J	0.000582 U	0.00525 U	0.000769 U	0.000439 U	0.000758 U	0.00157 U	0.000750 U	
	MW-329-20	09/12/19	20	9.3	–	0.00199	0.00671 J	0.00123 J	0.00687 J	0.000968 U	0.000553 U	0.000954 U	0.00198 U	0.000944 U	
	MW-329-25	09/12/19	25	4.3	–	0.000573 U	0.00417 J	0.000760 U	0.00685 U	0.00100 U	0.000573 U	0.000989 U	0.00205 U	0.000979 U	
MW-329-30	09/12/19	30	-0.7	–	0.00404	0.00491 J	0.000655 U	0.00590 U	0.000865 U	0.000494 U	0.000852 U	0.00177 U	0.000844 U		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)											
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC		
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050		
MW-329 (continued)	MW-329-35	09/12/19	35	-5.7	–	0.000490 U	0.00574 J	0.000649 U	0.00586 U	0.000858 U	0.000490 U	0.000846 U	0.00175 U	0.000837 U		
	MW-329-40	09/12/19	40	-10.7	–	0.000493 U	0.00891	0.000653 U	0.00589 U	0.000863 U	0.000493 U	0.000850 U	0.00176 U	0.000842 U		
	MW-329-45	09/12/19	45	-15.7	–	0.000477 U	0.00430 J	0.000632 U	0.00570 U	0.000835 U	0.000477 U	0.000823 U	0.00171 U	0.000815 U		
	MW-329-50	09/12/19	50	-20.7	–	0.000493 U	0.00912	0.000653 U	0.00589 U	0.000863 U	0.000493 U	0.000851 U	0.00176 U	0.000842 U		
	MW-2003-50	09/12/19	50 (dup)	-20.7	–	0.000437 U	0.00455 J	0.000579 U	0.00522 U	0.000765 U	0.000437 U	0.000754 U	0.00156 U	0.000746 U		
	MW-329-55	09/12/19	55	-25.7	–	0.000462 U	0.00740	0.000612 U	0.00552 U	0.000808 U	0.000462 U	0.000797 U	0.00165 U	0.000788 U		
	MW-329-60	09/12/19	60	-30.7	–	0.00207	0.00462 J	0.000620 U	0.00559 U	0.000819 U	0.000468 U	0.00179 J	0.00167 U	0.000799 U		
	MW-329-65	09/12/19	65	-35.7	–	0.0241	0.00466 J	0.000619 U	0.00559 U	0.000818 U	0.000467 U	0.0140	0.00167 U	0.000798 U		
	MW-329-70	09/12/19	70	-40.7	–	0.0340	0.00431 J	0.000618 U	0.00557 U	0.000816 U	0.000466 U	0.0403	0.00167 U	0.0167		
	MW-329-75	09/12/19	75	-45.7	–	0.0265	0.0104	0.000607 U	0.00548 U	0.000802 U	0.000458 U	0.0637	0.00164 U	0.000783 U		
	MW-329-80	09/12/19	80	-50.7	–	0.0240	0.00376 J	0.000644 U	0.00581 U	0.000850 U	0.000486 U	0.103	0.00174 U	0.000830 U		
	MW-329-85	09/12/19	85	-55.7	–	0.0597	0.00654	0.000620 U	0.00559 U	0.000818 U	0.000468 U	0.261	0.00167 U	0.0751		
	MW-329-90	09/12/19	90	-60.7	–	0.0182	0.00704	0.000623 U	0.00562 U	0.000823 U	0.000470 U	0.136	0.00168 U	0.000803 U		
	MW-329-95	09/12/19	95	-65.7	–	0.000753 J	0.00569 J	0.000629 U	0.00568 U	0.000831 U	0.000475 U	0.0246	0.00170 U	0.000811 U		
	MW-329-100	09/12/19	100	-70.7	–	0.000476 U	0.00926	0.000631 U	0.00569 U	0.000833 U	0.000476 U	0.0119	0.00170 U	0.000813 U		
MW-329-105	09/12/19	105	-75.7	–	0.000440 U	0.00362 J	0.000583 U	0.00526 U	0.000771 U	0.000440 U	0.00860	0.00157 U	0.000752 U			
MW-329-110	09/12/19	110	-80.7	–	0.000437 U	0.00137 U	0.000579 U	0.00522 U	0.000765 U	0.000437 U	0.000754 U	0.00156 U	0.000746 U			
PW-1	Composite	1/1/98	–	–	31 U	–	–	–	–	–	–	–	–	–		
PW-4	Composite	5/13/98	–	–	27 U	ND	ND	ND	ND	ND	ND	ND	ND	ND		
R-MW4	Unknown	10/22/92	5	35.9	–	–	–	–	–	0.005 U	0.005 U	–	0.005 U	0.010 U		
	Unknown	10/22/92	15	25.9	–	–	–	–	–	0.005 U	0.005 U	–	0.005 U	0.010 U		
	Unknown	10/22/92	30	10.9	–	–	–	–	–	0.005 U	0.005 U	–	0.005 U	0.010 U		
R-MW6 (33.3 to 23.3)	Unknown	10/27/92	6	39.3	–	–	–	–	–	0.005 U	0.005 U	–	0.005 U	0.010 U		
	Unknown	10/27/92	11	34.3	–	–	–	–	–	0.005 U	0.005 U	–	0.005 U	0.010 U		
	Unknown	10/27/92	16	29.3	–	–	–	–	–	0.005 U	0.005 U	–	0.005 U	0.010 U		
RB1	RB1-17.5	10/18/93	17.5	18.4	5 U	0.063 U	0.063 U	0.063 U	0.13 U	–	–	–	–	–		
RB2	RB2-12.5	10/18/93	12.5	23.6	5 U	0.062 U	0.062 U	0.062 U	0.012 U	–	–	–	–	–		
	RB2-17.5	10/18/93	17.5	18.6	5 U	0.045 J	0.062 U	0.058 J	0.18	–	–	–	–	–		
RB3	RB3-17.5	10/18/93	17.5	20.5	5 U	0.061 U	0.061 U	0.061 U	0.12 U	–	–	–	–	–		
SCL-B100	B-100, S1	6/10/02	–	–	1 U	0.02 U	0.02 U	0.02 U	0.02 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		
	B-100, S2	6/10/02	–	–	1 U	0.02 U	0.02 U	0.02 U	0.02 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		
SCL-B101	B-101- S1&2	6/17/02	–	–	2	0.02 U	0.02 U	0.02 U	0.02 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		
	B101-S3	6/17/02	–	–	1 U	0.02 U	0.02 U	0.02 U	0.02 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		
SCL-B102	B102-S1	6/17/02	–	–	6	0.03	0.09	0.04	0.13	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		
	B102-S2	6/17/02	–	–	1 U	0.02 U	0.02 U	0.02 U	0.02 U	0.05 U	0.05 U	0.05 U	0.05 U	0.05 U		
SCL-MW101 (25.0 to 15.0)	MW101-S3	6/14/02	–	–	1 U	0.07	0.02 U	0.04	0.05	–	–	–	–	–		
SCL-MW102	MW-102, S1	6/10/02	–	–	99	0.67	0.47	1.0	2.5	–	–	–	–	–		
	MW-102, S2	6/10/02	–	–	2	0.05	0.02 U	0.12	0.07	–	–	–	–	–		
SCL-MW103	MW103-S1&S2	6/14/02	–	–	1 U	0.02 U	0.02 U	0.02 U	0.02 U	–	–	–	–	–		
SCL-MW105 (10.8 to 0.8)	MW-105, S2	6/10/02	–	–	650	2.1	1.5	11	24	–	–	–	–	–		
	MW-105, S4	6/10/02	–	–	1 U	0.05	0.02 U	0.02 U	0.03	–	–	–	–	–		

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Reslts (milligrams per kilogram)											
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC		
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050		
SCLB-1	RS1-2.5/RS-1 7.5 (Comp)	3/12/93	2.5-7.5	-	20 U	-	-	-	-	-	-	-	-	-		
	RS1-12.5/RS1-17.5 (Comp)	3/12/93	12.5-17.5	-	310	2.0	0.66	5.0	25.2 ve	-	-	-	-	-		
	RS-1 17.5	3/12/93	17.5	21.0	-	-	-	-	-	-	-	-	-	-		
	RS1-22.5/RS-27.5 (Comp)	3/12/93	22.5-27.5	-	30 J	0.089 J	0.14	0.31	1.53	-	-	-	-	-		
	RS1-32.5	3/12/93	32.5	6.0	77	0.18	0.35	0.96	4.8	-	-	-	-	-		
	RS1-37.5	3/12/93	37.5	1.0	5 U	0.050 U	0.05 U	0.05 U	1 U	-	-	-	-	-		
SCLB-2	RS2-2.5/RS-2 7.5 (Comp)	3/12/93	2.5-7.5	-	110	-	-	-	-	-	-	-	-	-		
	RS2-12.5/RS2-17.5 (Comp)	3/12/93	12.5-17.5	-	1,800	4.0	24	23	115 ve	-	-	-	-	-		
	RS2-17.5	3/12/93	17.5	21.0	-	-	-	-	-	-	-	-	-	-		
	RS2-22.5/RS2-27.5 (Comp)	3/12/93	22.5-27.5	-	59	0.8	1.1	0.85	3.9	-	-	-	-	-		
	RS2-32.5	3/12/93	32.5	6.0	94	1.5	2.7	1.4	6.8	-	-	-	-	-		
	RS2-37.5	3/12/93	37.5	1.0	9.8	0.74	0.05 U	0.11	1.34	-	-	-	-	-		
SSD-MW-1	MW-1 S-2	5/24/89	5-6.5	34.0	4 A	0.01 U	0.01 U	0.01 U	0.01 U	-	-	-	-	-		
	MW-1 S-6	5/24/89	15-16.5	24.0	332 A	0.01 U	1.03	2.84	6.25	-	-	-	-	-		
SSD-MW-2	MW-2 S-3	5/24/89	7.5-9	31.0	338 A	0.01 U	0.01 U	0.01 U	0.01 U	-	-	-	-	-		
	MW-2 S-6	5/24/89	15-16.5	31.0	71 A	0.01 U	0.53	0.01 U	0.01 U	-	-	-	-	-		
SSD-MW-3	MW-3 S-2	5/24/89	5-6.5	34.0	1 A	0.01 U	0.01 U	0.01 U	0.01 U	-	-	-	-	-		
	MW-3 S-5	5/24/89	12.5-14	34.0	5 A	0.01 U	0.01 U	0.01 U	0.01 U	-	-	-	-	-		
SSD-MW-4	MW-4 S-6	5/25/89	14.5-16	36.8	6 A	0.01 U	0.01 U	0.069	0.096	-	-	-	-	-		
	MW-4 S-9	5/25/89	22-23	29.5	9 A	0.01 U	0.01 U	0.01 U	0.01 U	-	-	-	-	-		
TB-12	16	8/1/97	62-63	-24.5	24 U	-	-	-	-	-	-	-	-	-		
TB-18	S-2	3/17/98	5-6.5	38.3	27 U	ND	ND	ND	ND	ND	ND	ND	ND	ND		
	S-8	3/17/98	20-21.5	23.3	28 U	ND	ND	ND	ND	ND	ND	ND	ND	ND		
	S-21	3/17/98	57.5-59	1.2	28 U	ND	ND	ND	ND	ND	ND	ND	ND	ND		
W-MW-01 (P-03) (-25.1 to -35.1)	SB-W-03-0160	1/27/12	16-16.5	28.4	-	0.0010 U	0.0006 J	0.0010 U	0.0020 U	0.0010 U	0.0010 U	0.0006 J	0.0010 U	0.0010 U		
	SB-W-03-0225	1/27/12	22.5-23	21.9	-	0.0009 U	0.0007 J	0.0009 U	0.0018 U	0.03 B	0.0018	0.0021	0.0009 U	0.0009 U		
	SB-W-03-0315	1/27/12	31.5-32	12.9	-	0.21 U	0.21 U	0.21 U	0.42 U	16 B	0.59	0.48	0.21 U	0.21 U		
	SB-W-03-0450	1/27/12	45-45.5	-0.6	-	0.0007 U	0.0006 J	0.0007 U	0.0014 U	0.38 B	0.022	0.041	0.0005 J	0.0007 U		
	SB-W-03-0550	1/27/12	55.5-56	-11.1	-	0.045 U	0.045 U	0.045 U	0.09 U	1.9 J	0.17	0.13	0.045 U	0.045 U		
	SB-W-03-0645	1/27/12	64.5-65	-20.1	-	0.0008 U	0.0008 U	0.0008 U	0.0016 U	0.0008 U	0.0008 U	0.0008 U	0.0008 U	0.0008 U		
	SB-W-03-0730	1/27/12	73-73.5	-28.6	-	0.0007 U	0.0006 J	0.0007 U	0.0014 U	0.1 B	0.0081	0.025	0.0007 U	0.0007 U		
W-MW-02 (P-06) (-26.5 to -36.5)	SB-W-06-0900	1/29/12	9-9.5	34.0	-	0.0009 J	0.0013 U	0.0013 U	0.0026 U	0.058 T	0.0081	0.0013 U	0.0013 U	0.0013 U		
	SB-W-06-0185	1/29/12	18.5-19	24.5	-	0.0008 J	0.0006 J	0.0009 U	0.0018 U	0.0009 UT	0.0009 U	0.0009 U	0.0009 U	0.0009 U		
	SB-W-06-0305	1/30/12	30.5-31	12.6	-	0.27 U	0.27 U	0.27 U	0.34 U	18	0.41	0.4	0.27 U	0.27 U		
	SB-W-06-0380	1/30/12	38-38.5	5.0	-	0.046 U	0.046 U	0.046 U	0.092 U	0.14	0.057	0.52	0.046 U	0.046 U		
	SB-W-06-0405	1/30/12	40.5-41	2.5	-	0.036 U	0.036 U	0.036 U	0.072 U	5.2	0.2	0.15	0.036 U	0.036 U		
	SB-W-06-0485	1/30/12	48.5-49	-5.5	-	0.0008 U	0.0008 U	0.0008 U	0.0016 U	0.033	0.0007 J	0.0009	0.0008 U	0.0008 U		
	SB-W-06-9485	1/30/12	8.5-49 (dup)	-5.5	-	0.0009 U	0.0009 U	0.0009 U	0.0018 U	0.052	0.0011	0.0010	0.0009 U	0.0009 U		
	SB-W-06-0590	1/30/12	59-59.5	-16.0	-	0.043 U	0.043 U	0.043 U	0.086 U	0.53	0.037 J	0.043 U	0.043 U	0.043 U		
	SB-W-06-0715	1/30/12	71.5-72	-28.5	-	0.0008 U	0.0008 U	0.0008 U	0.0016 U	0.0009	0.0008 U	0.0008 U	0.0008 U	0.0008 U		
SB-W-06-0790	1/31/12	79-79.5	-36.0	-	0.0009 U	0.0009 U	0.0009 U	0.0018 U	0.0022	0.0009 U	0.0009 U	0.0009 U	0.0009 U			

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																			
					GRO		Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC	
Screening Levels					30		0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050		0.050	
Mercer Megablock																								
DGW-1	DGW-1-10	03/06/19	10	37	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-1-12.5	03/06/19	12.5	34.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-1-15	03/06/19	15	32	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-1-25	03/06/19	25	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-1-30	03/06/19	30	17	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DGW-2	DGW-2-5	03/04/19	5	54	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-2-10	03/04/19	10	49	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-2-25	03/04/19	25	34	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-2-30	03/04/19	30	29	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DGW-3	DGW-3-2.5	03/06/19	2.5	44.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-3-12.5	03/06/19	12.5	34.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-3-15	03/06/19	15	32	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-3-20	03/06/19	20	27	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-3-25	03/06/19	25	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DGW-4	DGW-4-5	03/04/19	5	60	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-4-10	03/04/19	10	55	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-4-15	03/04/19	15	50	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-4-20	03/04/19	20	45	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-4-35	03/04/19	35	30	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DGW-4-50	03/04/19	50	15	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DMW-1S (36.0 to 26.0)	DMW-1S-5	03/23/19	5	42	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DMW-1S-10	03/23/19	10	37	5.0	U	0.020	U	0.050	U	0.053		0.071		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DMW-1S-12.5	03/23/19	12.5	34.5	1,200		0.020	U	0.050	U	2.1		4.4		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DMW-1S-15	03/23/19	15	32	67		0.020	U	0.050	U	0.12		0.20		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DMW-1S-20	03/23/19	20	27	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DPP-1	DPP-1-5	03/04/19	5	54.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-1-7.5	03/04/19	7.5	52	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-1-10	03/04/19	10	49.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DPP-2	DPP-2-20	03/04/19	20	39.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-2-5	03/04/19	5	54	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-2-10	03/04/19	10	49	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DPP-3	DPP-3-5	03/05/19	5	42	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-3-15	03/05/19	15	32	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-3-30	03/05/19	30	17	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DPP-4	DPP-4-10	03/04/19	10	49	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-4-12.5	03/04/19	12.5	46.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-4-17.5	03/04/19	17.5	41.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-4-20	03/04/19	20	39	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
DPP-5	DPP-5-10	03/04/19	10	49	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-5-17.5	03/04/19	17.5	41.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	DPP-5-20	03/04/19	20	39	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																				
					GRO		Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC		
Screening Levels					30		0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050		0.050		
DPP-6	DPP-6-5	03/05/19	5	42	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	DPP-6-7.5	03/05/19	7.5	39.5	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	DPP-6-12.5	03/05/19	12.5	34.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	DPP-6-17.5	03/05/19	17.5	29.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
HMW-1IB (-15.9 to -25.9)	HMW-1IB-7.5	03/12/19	7.5	30.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-1IB-15	03/12/19	15	23	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-1IB-20.5	03/12/19	20.5	18	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-1IB-27.5	03/12/19	27.5	10.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-1IB-50	03/12/19	50	-12	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.12	0.24	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-1IB-65	03/12/19	65	-27	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
HMW-2IB (-5.6 to -15.6)	HMW-2IB-7.5	03/12/19	7.5	39.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-2IB-15	03/12/19	15	32	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-2IB-22.5	03/12/19	22.5	24.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-2IB-30	03/12/19	30	17	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-2IB-45	03/12/19	45	2	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.12	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	HMW-2IB-65	03/12/19	65	-18	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
HMW-3IA (20.0 to 10.0)	HMW-3IA-15	03/15/19	15	40.5	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-3IA-20	03/15/19	20	35.5	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-3IA-22.5	03/15/19	22.5	33	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-3IA-25	03/15/19	25	30.5	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
HMW-4IA (8.8 to -1.2)	HMW-4IA-5	03/07/19	5	51	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-4IA-7.5	03/07/19	7.5	48.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-4IA-10	03/07/19	10	46	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	HMW-4IA-25	03/07/19	25	31	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
MBGW-1	MBGW-1-5	03/06/19	5	40	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-1-12.5	03/06/19	12.5	32.5	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-1-17.5	03/06/19	17.5	27.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-1-25	03/06/19	25	20	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-1-30	03/06/19	30	15	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
MBGW-2	MBGW-2-5	03/04/19	5	38.5	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	
	MBGW-2-10	03/04/19	10	33.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-2-12.5	03/04/19	12.5	31	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-2-25	03/04/19	25	18.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-2-30	03/04/19	30	13.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
MBGW-3	MBGW-3-5	03/07/19	5	42	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	–	
	MBGW-3-7.5	03/07/19	7.5	39.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-3-10	03/07/19	10	37	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-3-12.5	03/07/19	12.5	34.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-3-25	03/07/19	25	22	–	–	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	
	MBGW-3-26	03/07/19	26	21	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.074	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
American Linen Supply Co-Dexter Avenue Site
700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																			
					GRO		Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC	
Screening Levels					30		0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050		0.050	
MBGW-4	MBGW-4-5	03/06/19	5	41.5	-		-		-		-		-		-		-		-		-		-	
	MBGW-4-7.5	03/06/19	7.5	39	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-4-10	03/06/19	10	36.5	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-4-12.5	03/06/19	12.5	34	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-4-25	03/06/19	25	21.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-5	MBGW-5-10	03/11/19	10	43	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-5-15	03/11/19	15	38	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-5-20	03/11/19	20	33	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-5-27.5	03/11/19	27.5	25.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-5-45	03/11/19	45	8	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	3.4		0.47		0.260		0.050	U	0.050	U
MBGW-6	MBGW-6-10	03/14/19	10	42	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-6-15	03/14/19	15	37	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-6-20	03/14/19	20	32	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-7	MBGW-7-30	03/14/19	30	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-7-30	03/06/19	30	22.5	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-8	MBGW-8-10	03/15/19	10	37	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-8-15	03/15/19	15	32	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-8-25	03/15/19	25	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-8-35	03/15/19	35	12	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-9	MBGW-9-10	03/13/19	10	42.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-9-15	03/13/19	15	37.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-9-20	03/13/19	20	32.5	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-9-25	03/13/19	25	27.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-9-30	03/13/19	30	22.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-10	MBGW-10-10	03/13/19	10	-	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-10-15	03/13/19	15	-	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-10-20	03/13/19	20	-	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-10-25	03/13/19	25	-	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-11	MBGW-11-30	03/13/19	30	50.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-11-5	03/12/19	5	48	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-11-10	03/12/19	10	43	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-12	MBGW-12-5	03/15/19	5	48.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-12-20	03/15/19	20	33.5	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-12-25	03/15/19	25	28.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-12-30	03/15/19	30	23.5	-		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-13	MBGW-13-5	03/14/19	5	49	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-13-7.5	03/14/19	7.5	46.5	-		0.020	U	0.050	U	0.17		0.19		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-13-10	03/14/19	10	44	730		0.020	U	0.14		3.9		7.0		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-13-12.5	03/14/19	12.5	41.5	-		0.020	U	0.050	U	0.5		0.63		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-13-15	03/14/19	15	39	16		0.020	U	0.050	U	0.011		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-13-20	03/14/19	20	34	5.0	U	0.020	U	0.050	U	0.060		0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)																			
					GRO		Benzene		Toluene		Ethylbenzene		Total Xylenes		PCE		TCE		cDCE		tDCE		VC	
Screening Levels					30		0.030		0.27		0.34		0.83		0.025		0.030		0.050		0.050		0.050	
MBGW-14	MBGW-14-10	03/06/19	10	33.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-14-15	03/06/19	15	28.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-14-20	03/06/19	20	23.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-14-30	03/06/19	30	13.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBGW-16	MBGW-16-10	03/08/19	10	42	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-16-15	03/08/19	15	37	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBGW-16-20	03/08/19	20	32	–		–		–		–		–		–		–		–		–		–	
MBPP-1	MBPP-1-30	03/08/19	30	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-1-20	03/05/19	20	23.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-1-25	03/05/19	25	18.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-2	MBPP-2-10	03/05/19	10	33.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-2-20	03/05/19	20	23.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-2-27.5	03/05/19	27.5	16	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-3	MBPP-3-10	03/06/19	10	33.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-3-20	03/06/19	20	23.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-3-25	03/06/19	25	18.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-4	MBPP-4-2.5	03/07/19	2.5	44.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-4-10	03/07/19	10	37	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-4-15	03/07/19	15	32	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-4-17	03/07/19	17	30	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-4-18	03/07/19	18	29	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-5	MBPP-5-10	03/07/19	10	37	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-5-15	03/07/19	15	32	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-5-17.5	03/07/19	17.5	29.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-5-20	03/07/19	20	27	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-5-25	03/07/19	25	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-6	MBPP-6-7.5	03/08/19	7.5	44.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-10	03/08/19	10	42	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-12.5	03/08/19	12.5	39.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-15	03/08/19	15	37	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-17.5	03/08/19	17.5	34.5	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-20	03/08/19	20	32	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-25	03/08/19	25	27	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-6-30	03/08/19	30	22	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-7	MBPP-7-5	03/08/19	5	47	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-7-15	03/08/19	15	37	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-7-23	03/08/19	23	29	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
MBPP-8	MBPP-8-10	03/08/19	10	44	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-8-15	03/08/19	15	39	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-8-22.5	03/08/19	22.5	31.5	–		0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U
	MBPP-8-30	03/08/19	30	24	5.0	U	0.020	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U	0.050	U

Appendix B

Off Property Soil Petroleum Hydrocarbons and CVOCs
 American Linen Supply Co–Dexter Avenue Site
 700 Dexter Avenue North, Seattle, Washington

Sample Location	Sample ID	Sample Date	Sample Depth (feet bgs)	Sample Elevation (feet NAVD 88)	Analytical Results (milligrams per kilogram)									
					GRO	Benzene	Toluene	Ethylbenzene	Total Xylenes	PCE	TCE	cDCE	tDCE	VC
Screening Levels					30	0.030	0.27	0.34	0.83	0.025	0.030	0.050	0.050	0.050

Notes:


1. PHCs Analyzed by Method WTPH-HCID, Method 418.1, EPA Method 8020, EPA Method 8015M, or NWTPH-Gx.
2. VOCs Analyzed by EPA Methods 8010, 8020, 8021B, 8260B, 624/8240, or 8260C.
3. Well screen elevations provided below Sample Location in parentheses, where applicable.
4. Detected results shown in bold, detections above the screening level highlighted in gray
5. – = results not available or results not analyzed/measured.
6. A = result reported as total petroleum hydrocarbons.
7. B = analyte detected in an associated method blank.
8. J = the reported concentration is an estimate based on detectable results between the method detection limit and reporting limit, laboratory QA/QC, or data validation review.
9. J+ = the result is an estimated quantity, but the result may be biased high.
10. J- = the result is an estimated quantity, but the result may be biased low.
11. ND = not detected above laboratory reporting limit; reporting limit not available.
12. q = sample may contain gasoline or petroleum components. Chromatographic pattern indicates the presence of gasoline constituents.
13. R = the data is unusable. The sample result is rejected due to serious deficiencies in meeting QC criteria. The analyte may or may not be present in the sample.
14. T = analyte also detected in trip blank.
15. U = not detected at a concentration exceeding laboratory reporting limit.
16. ve = estimated value. The reported range exceeds the calibration range of the analysis.
17. w = petroleum product eluting in the C8-C9 range.
18. x = the sample chromatographic pattern does not resemble the fuel standard used for quantitation.
19. z = gasoline/petroleum detection result is likely elevated due to high detections of CVOCs.

Abbreviations:

20. AA = Advanced Analytical Laboratory, Redmond, Washington
21. PCE = perchloroethylene (tetrachloroethene)
22. bgs = below ground surface
23. cDCE = cis-1,2-dichloroethene
24. CVOCs = chlorinated volatile organic compounds
25. dup = duplicate
26. GRO = gasoline-range petroleum hydrocarbons
27. HC = Hart Crowser, Inc.
28. NWTPH = Northwest Total Petroleum Hydrocarbon
29. Pace = Pace Analytical
30. PCE = perchloroethylene (tetrachloroethene)
31. PES = PES Environmental, Inc.
32. PHCs = petroleum hydrocarbons
33. TCE = trichloroethylene
34. tDCE = trans-1,2-dichloroethene
35. VC = Vinyl Chloride

APPENDIX C
CVOC TIME-TREND PLOTS


Concentration vs Time
FMW-143 (10 to 5 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site

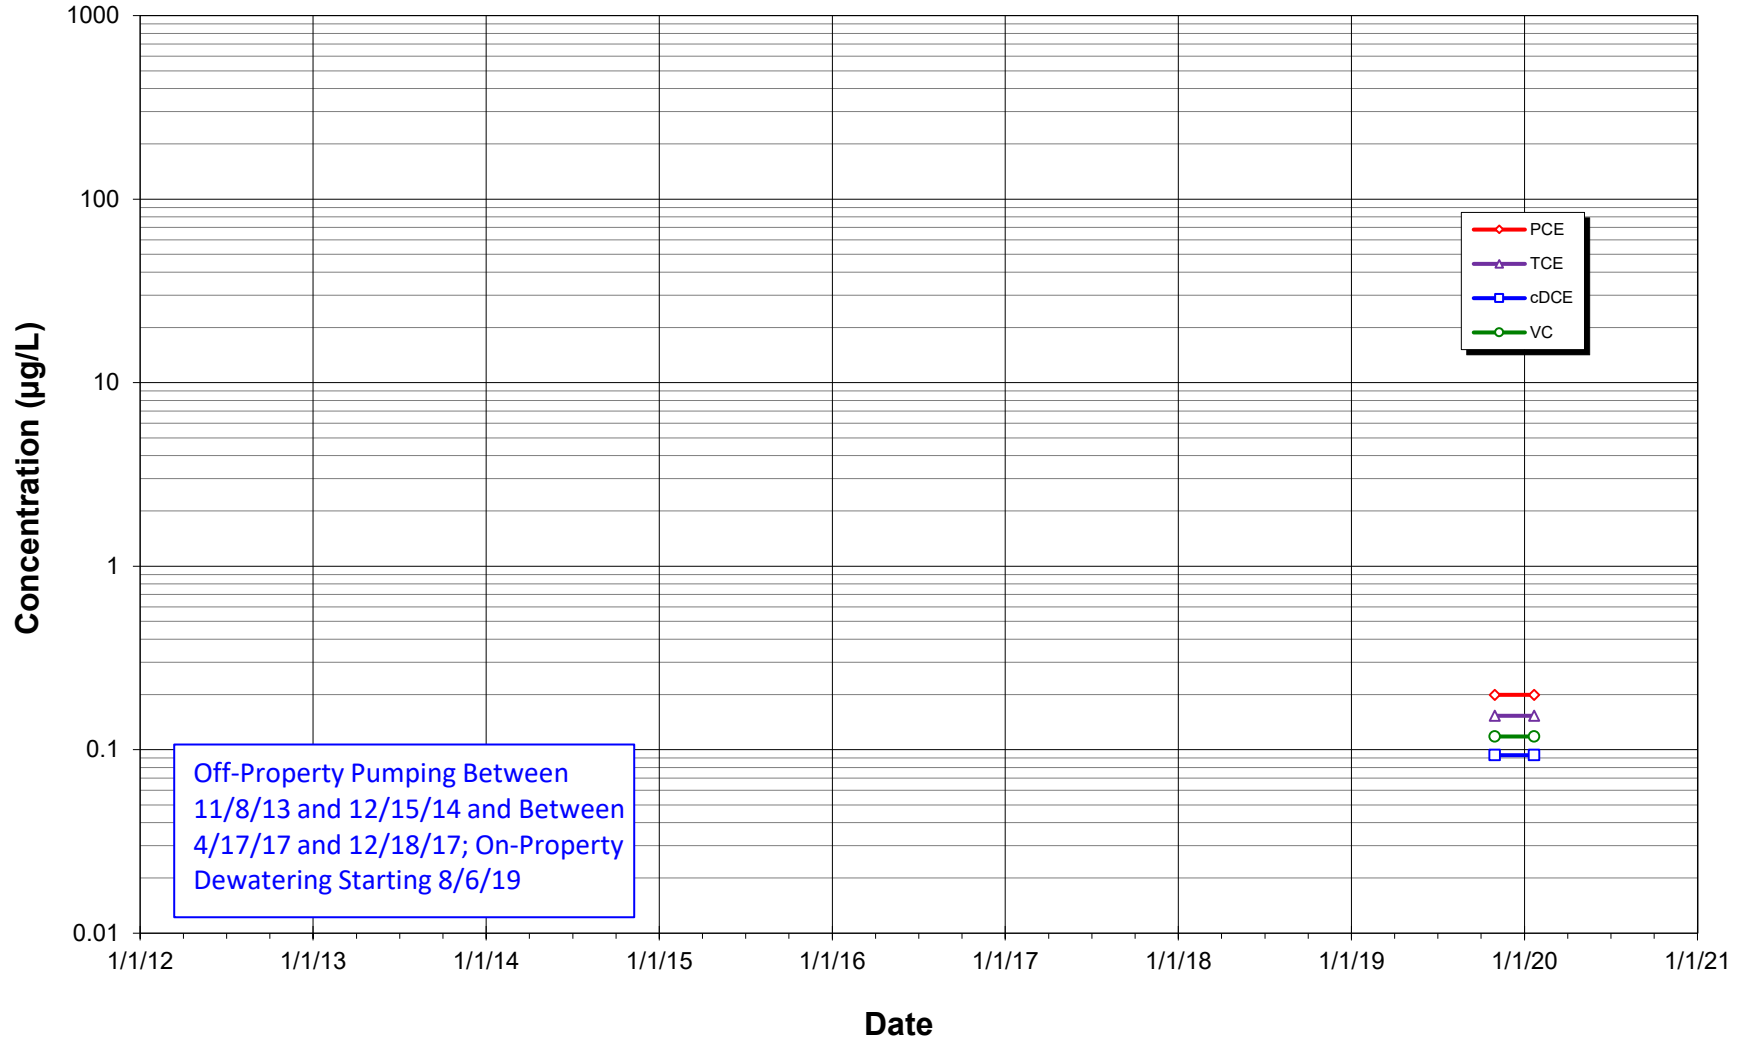

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW-8 (28.7 to 14.2 feet NAVD), Property
American Linen Supply Co–Dexter Ave Site**

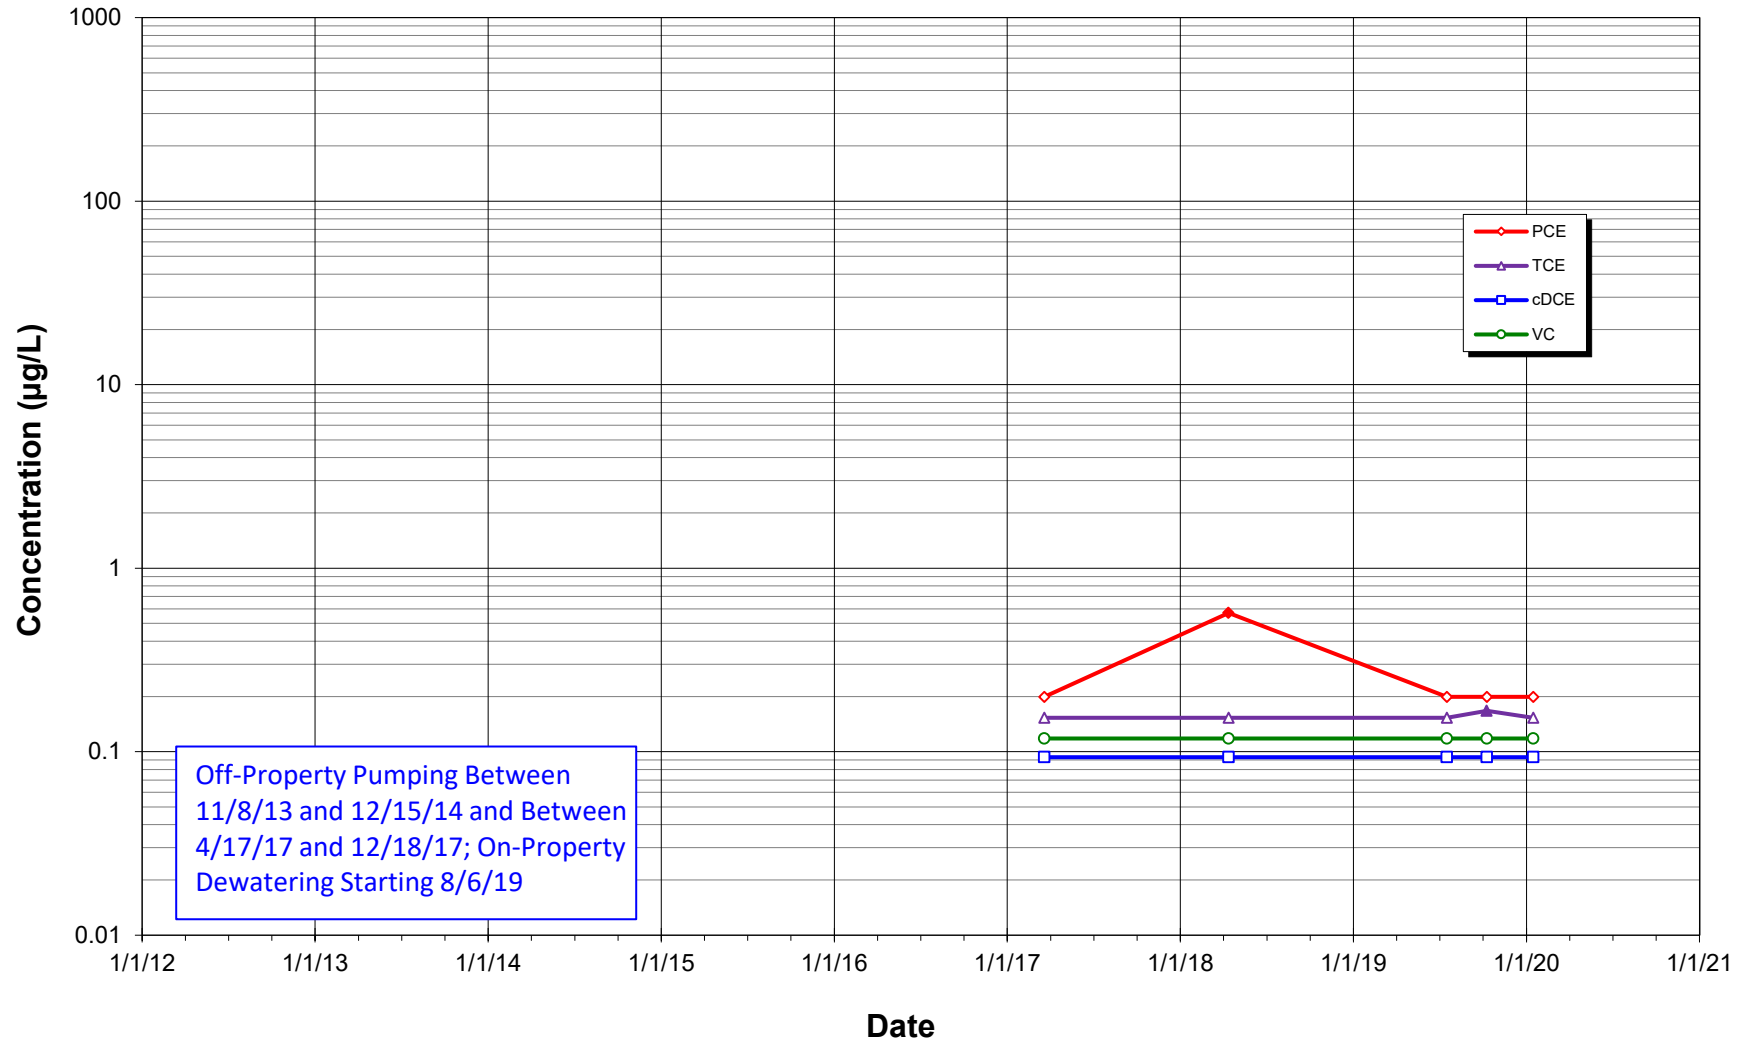

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-9 (33.8 to 18.8 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

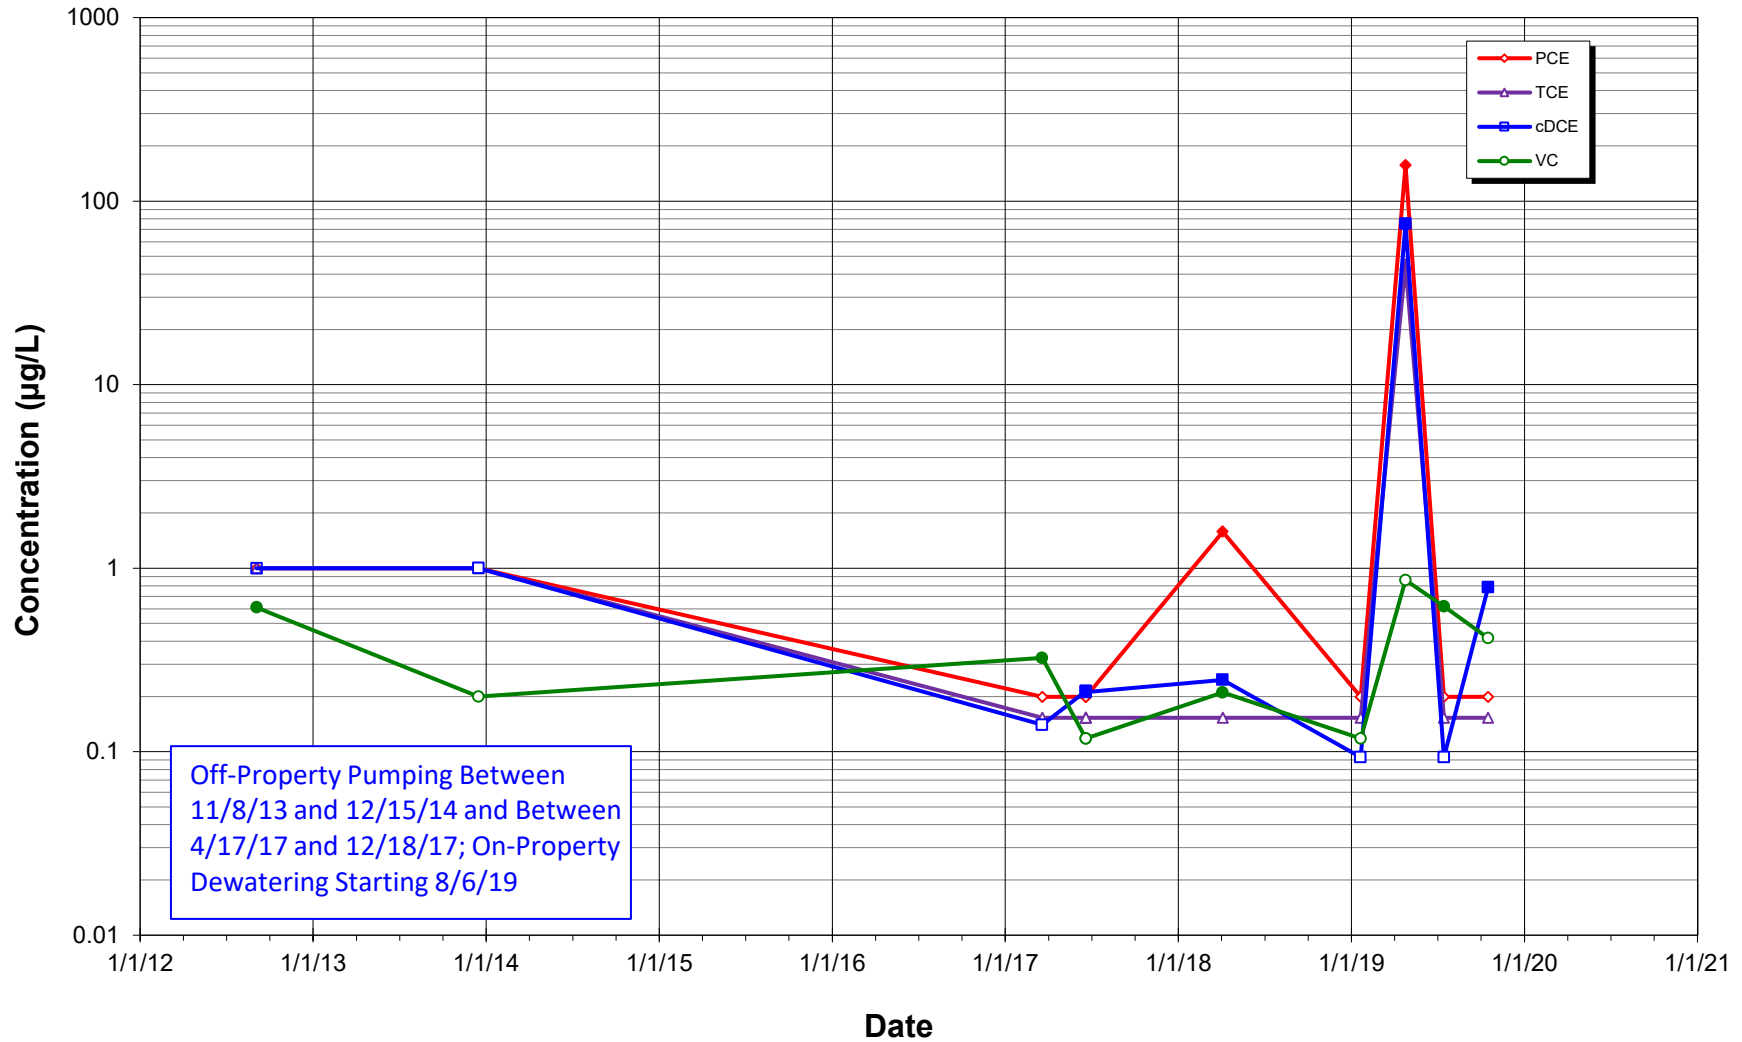

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW121 (26.7 to 16.7 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

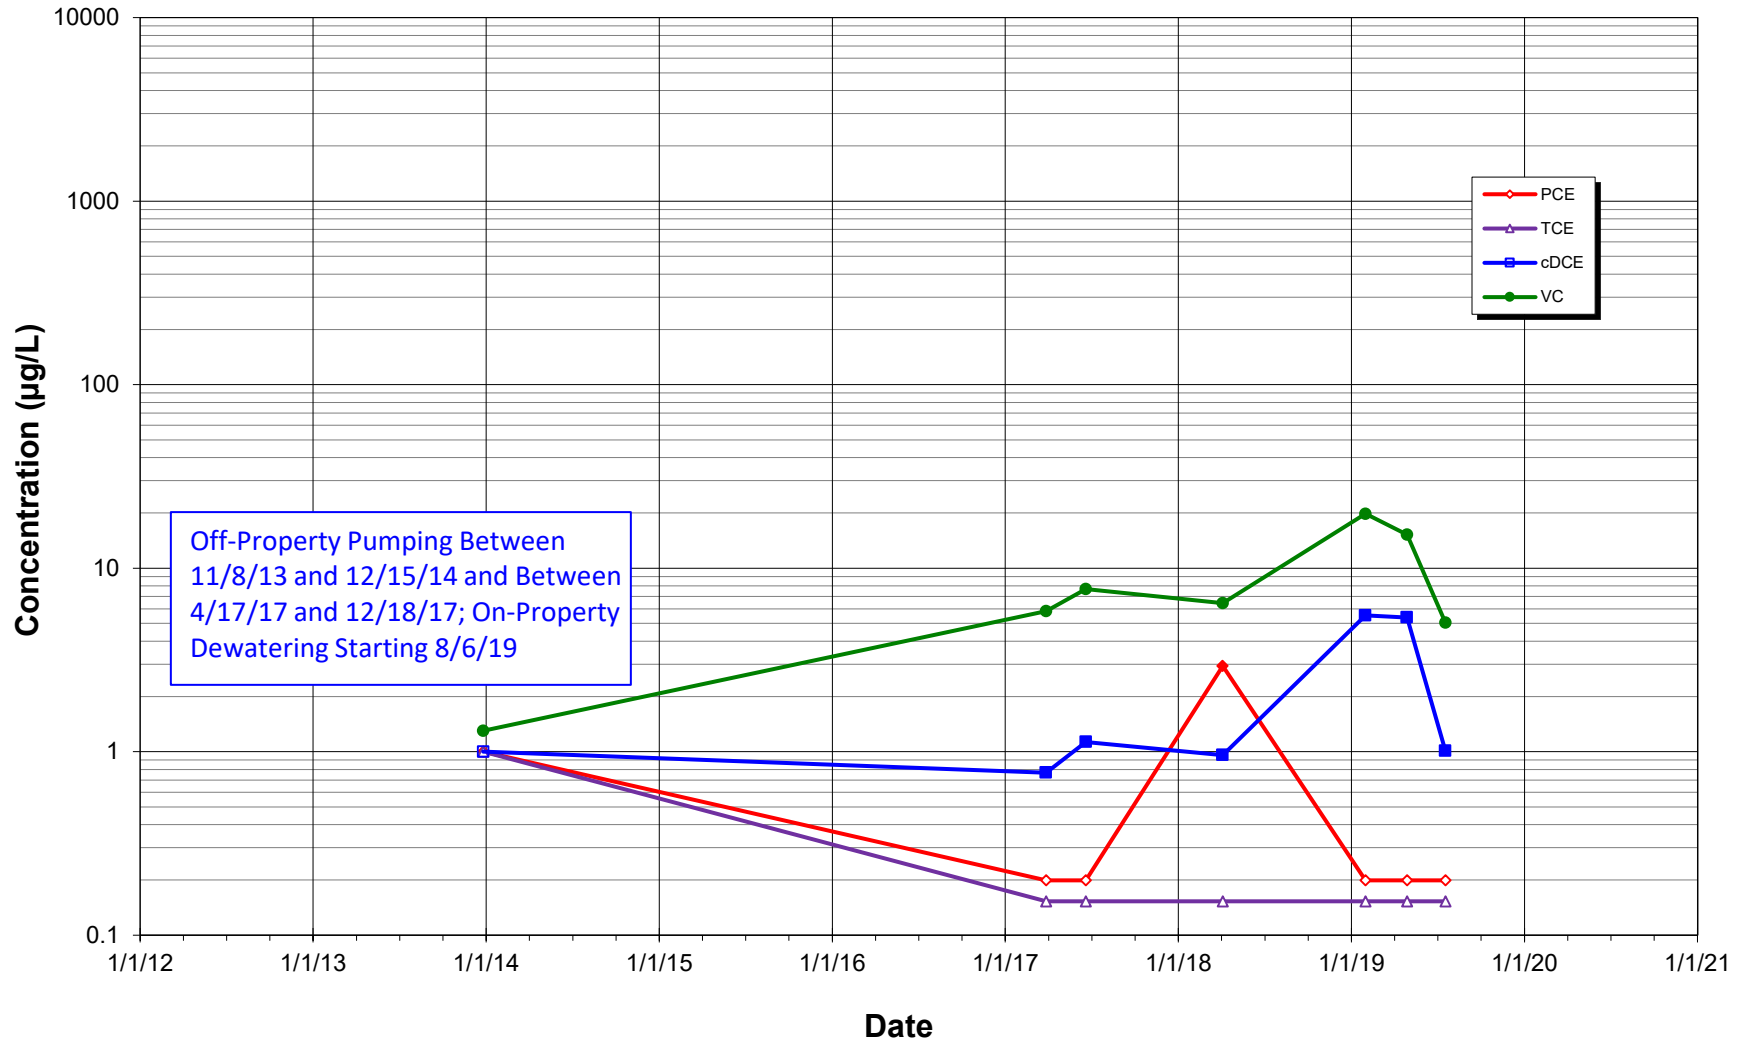

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW125 (28.6 to 13.6 feet NAVD), Valley Street
American Linen Supply Co-Dexter Ave Site**

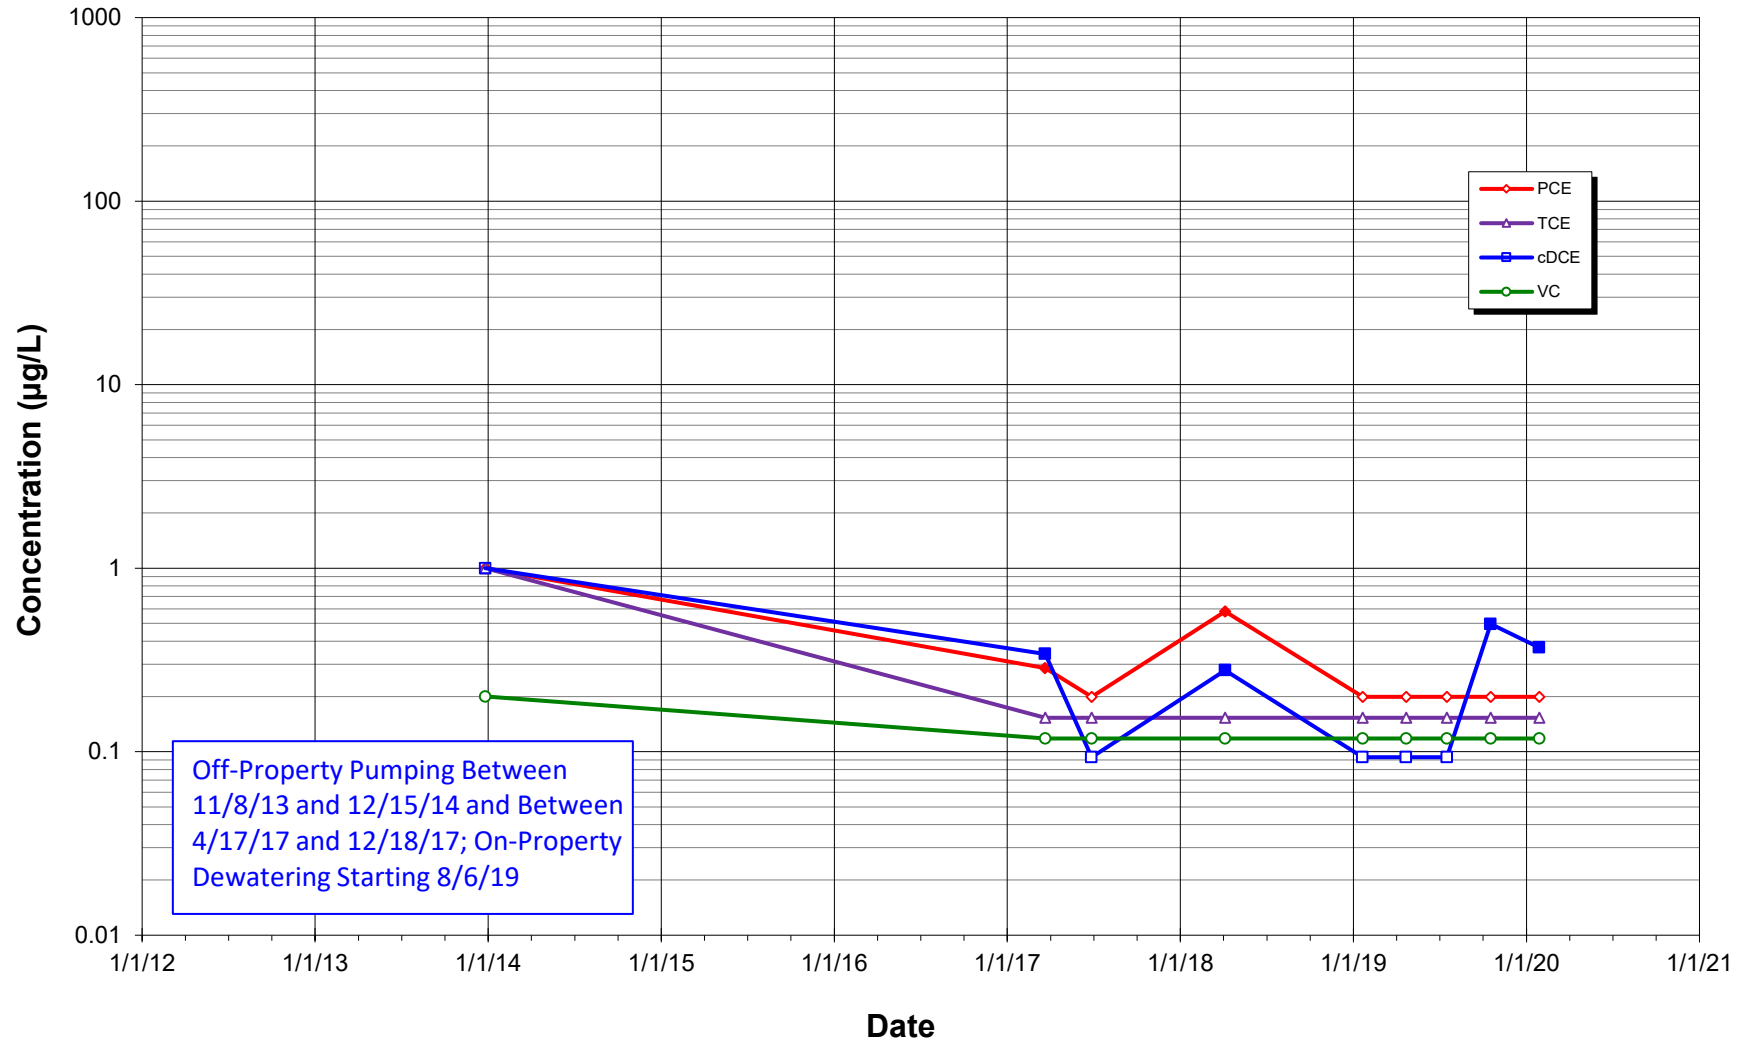

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-154 (28.1 to 18.1 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

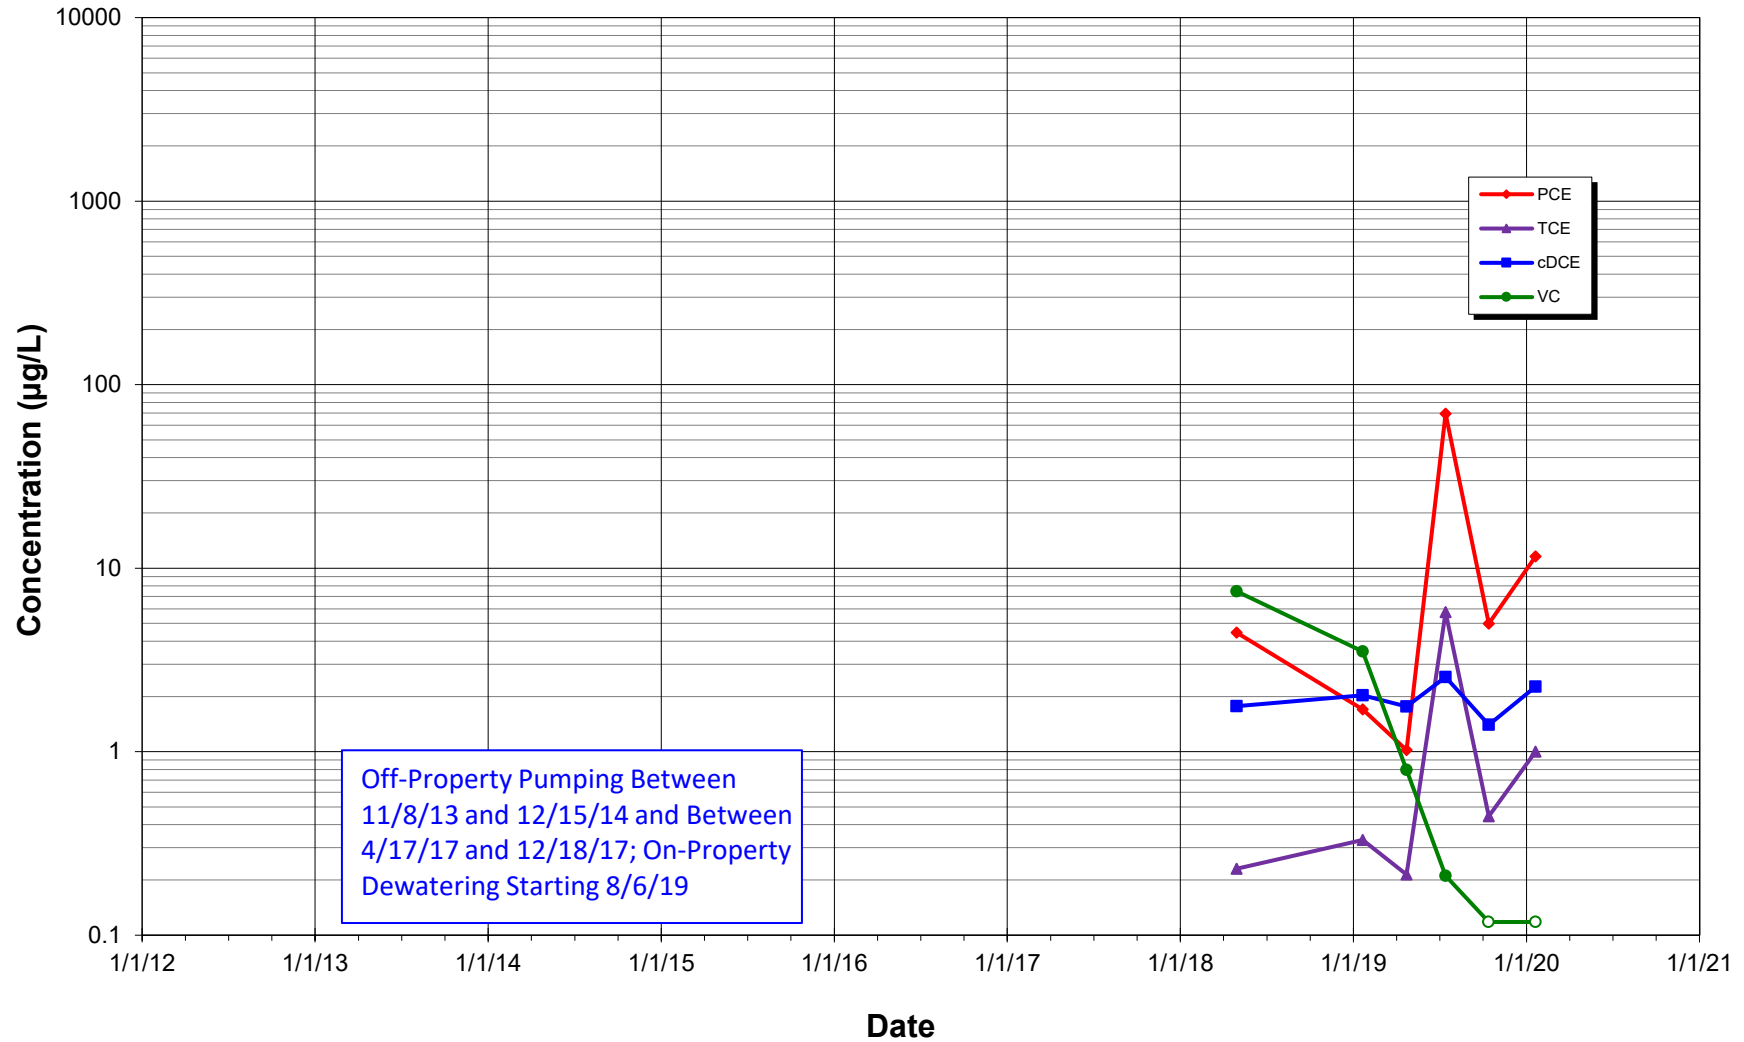

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-155 (24.4 to 14.4 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

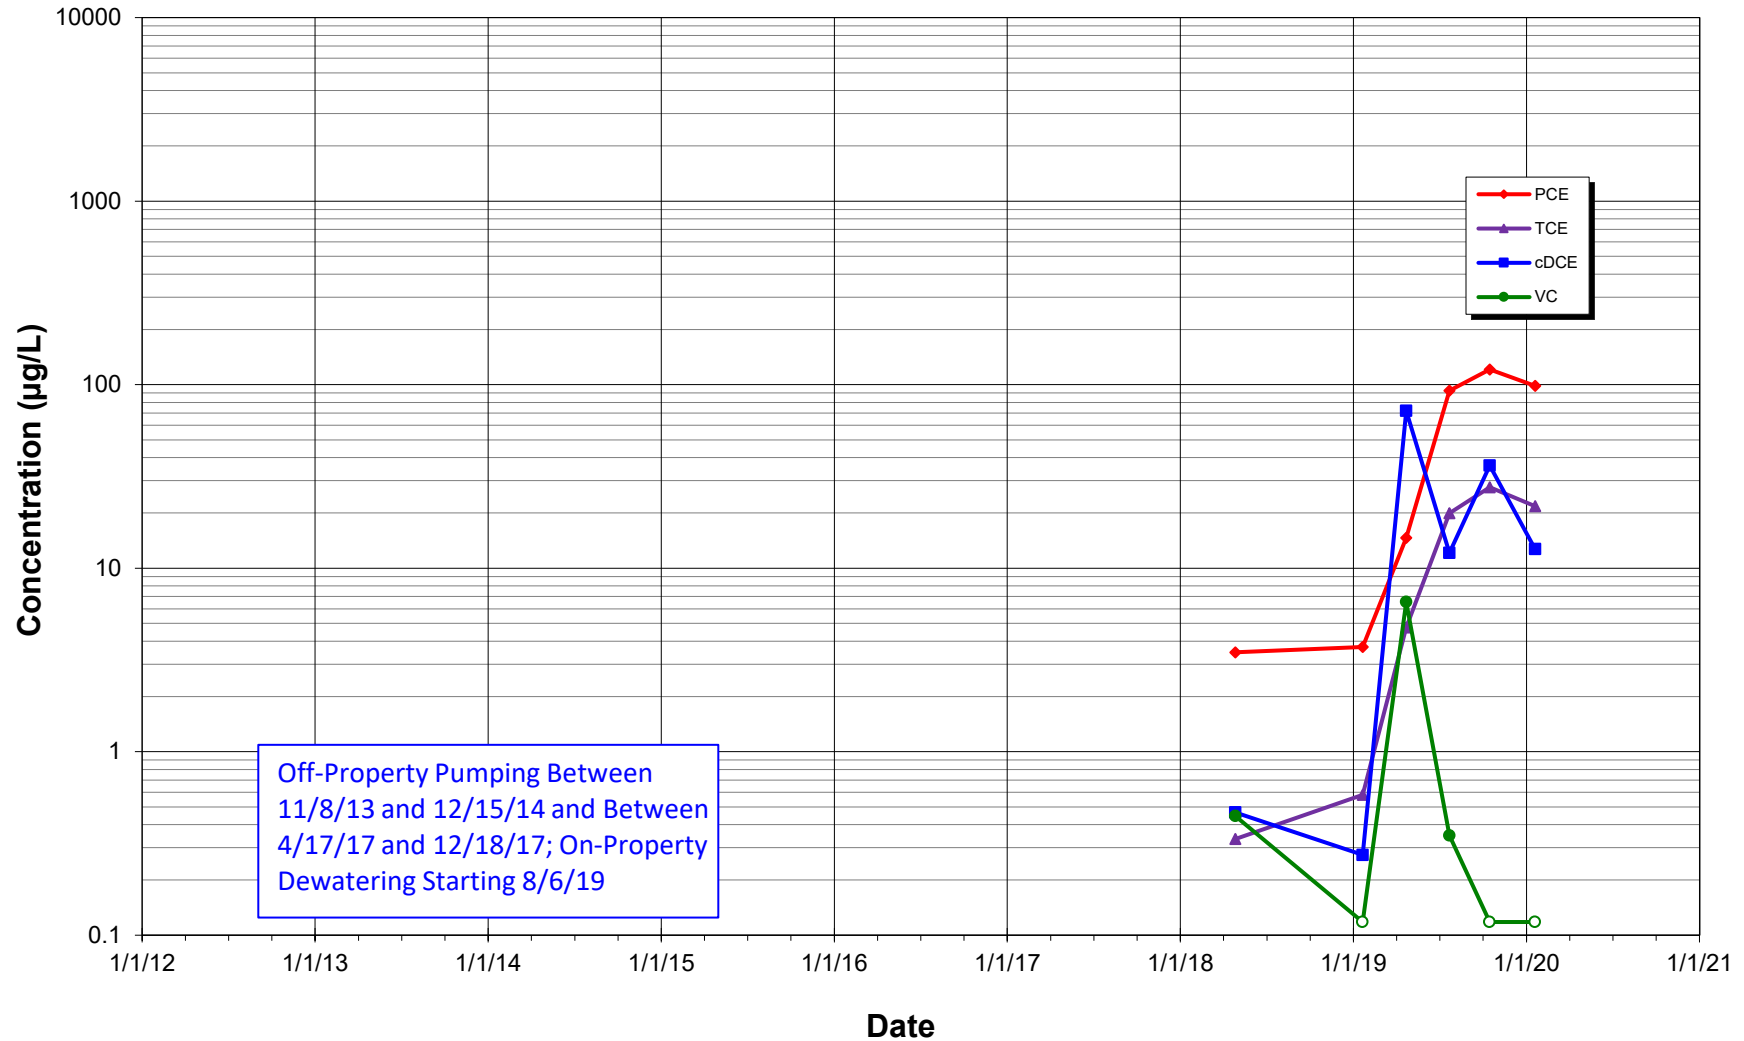

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-159 (22.9 to 12.9 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

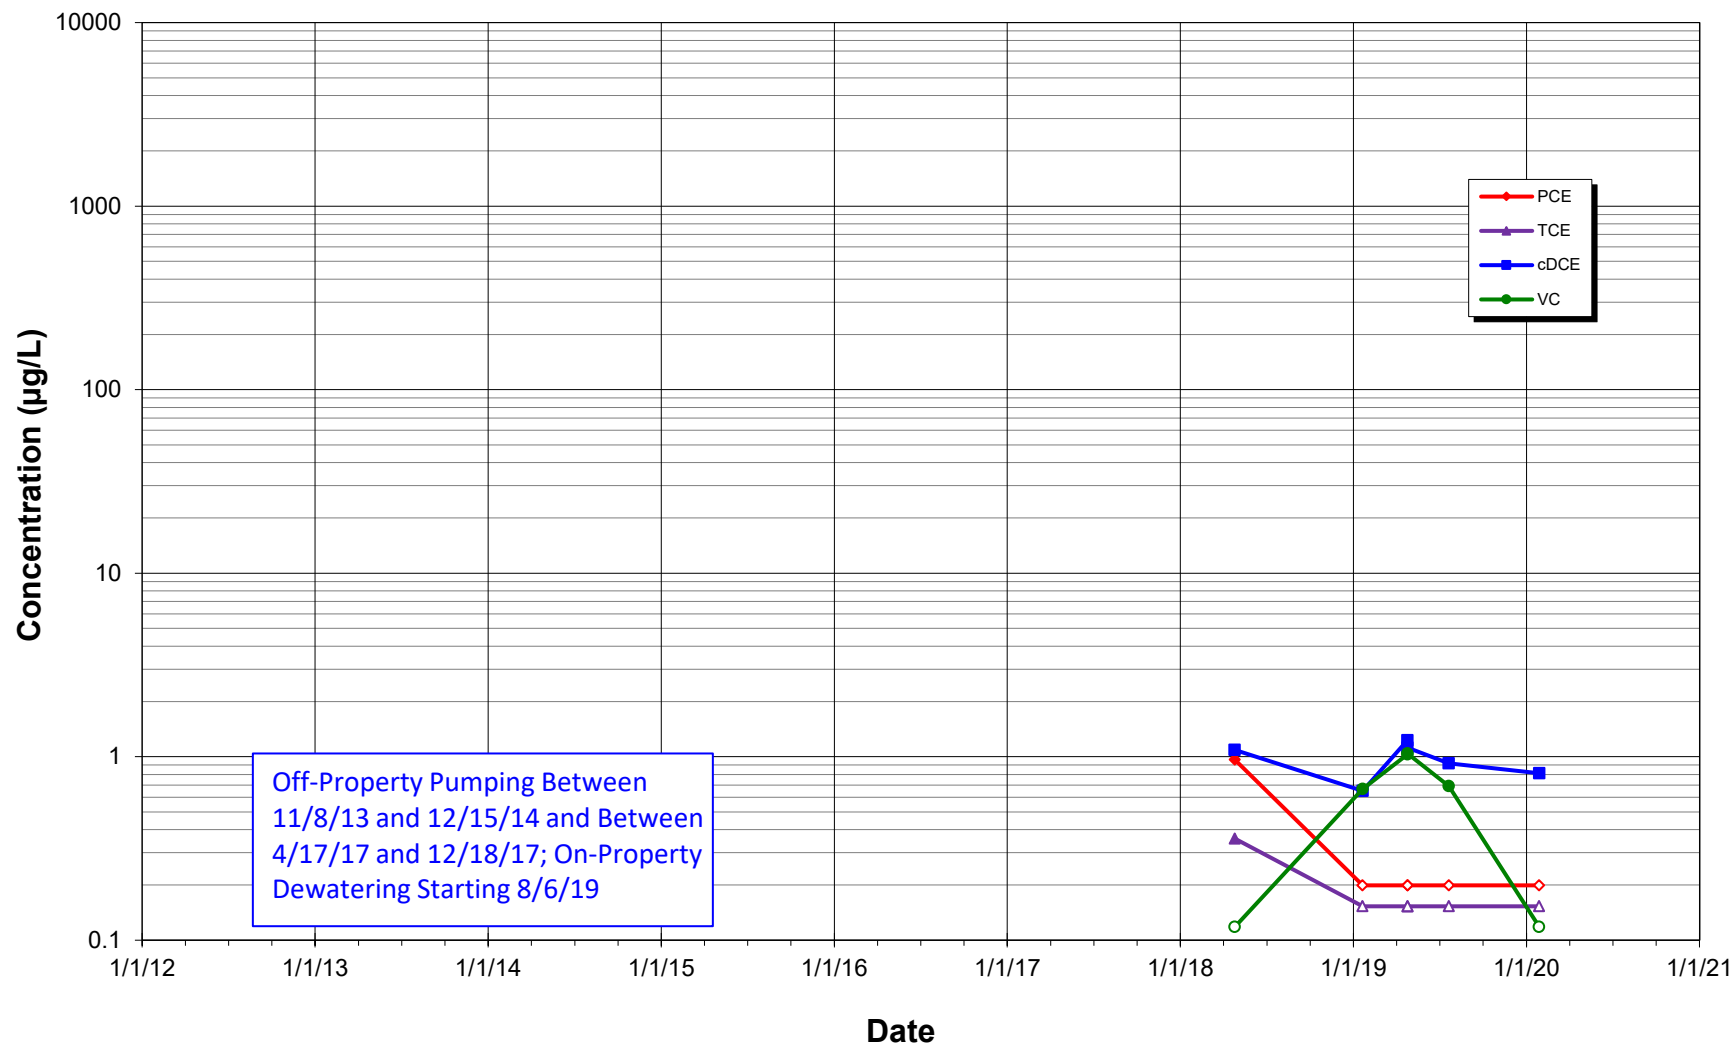

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW214 (20.8 to 10.8 feet NAVD), Valley Street
American Linen Supply Co–Dexter Ave Site

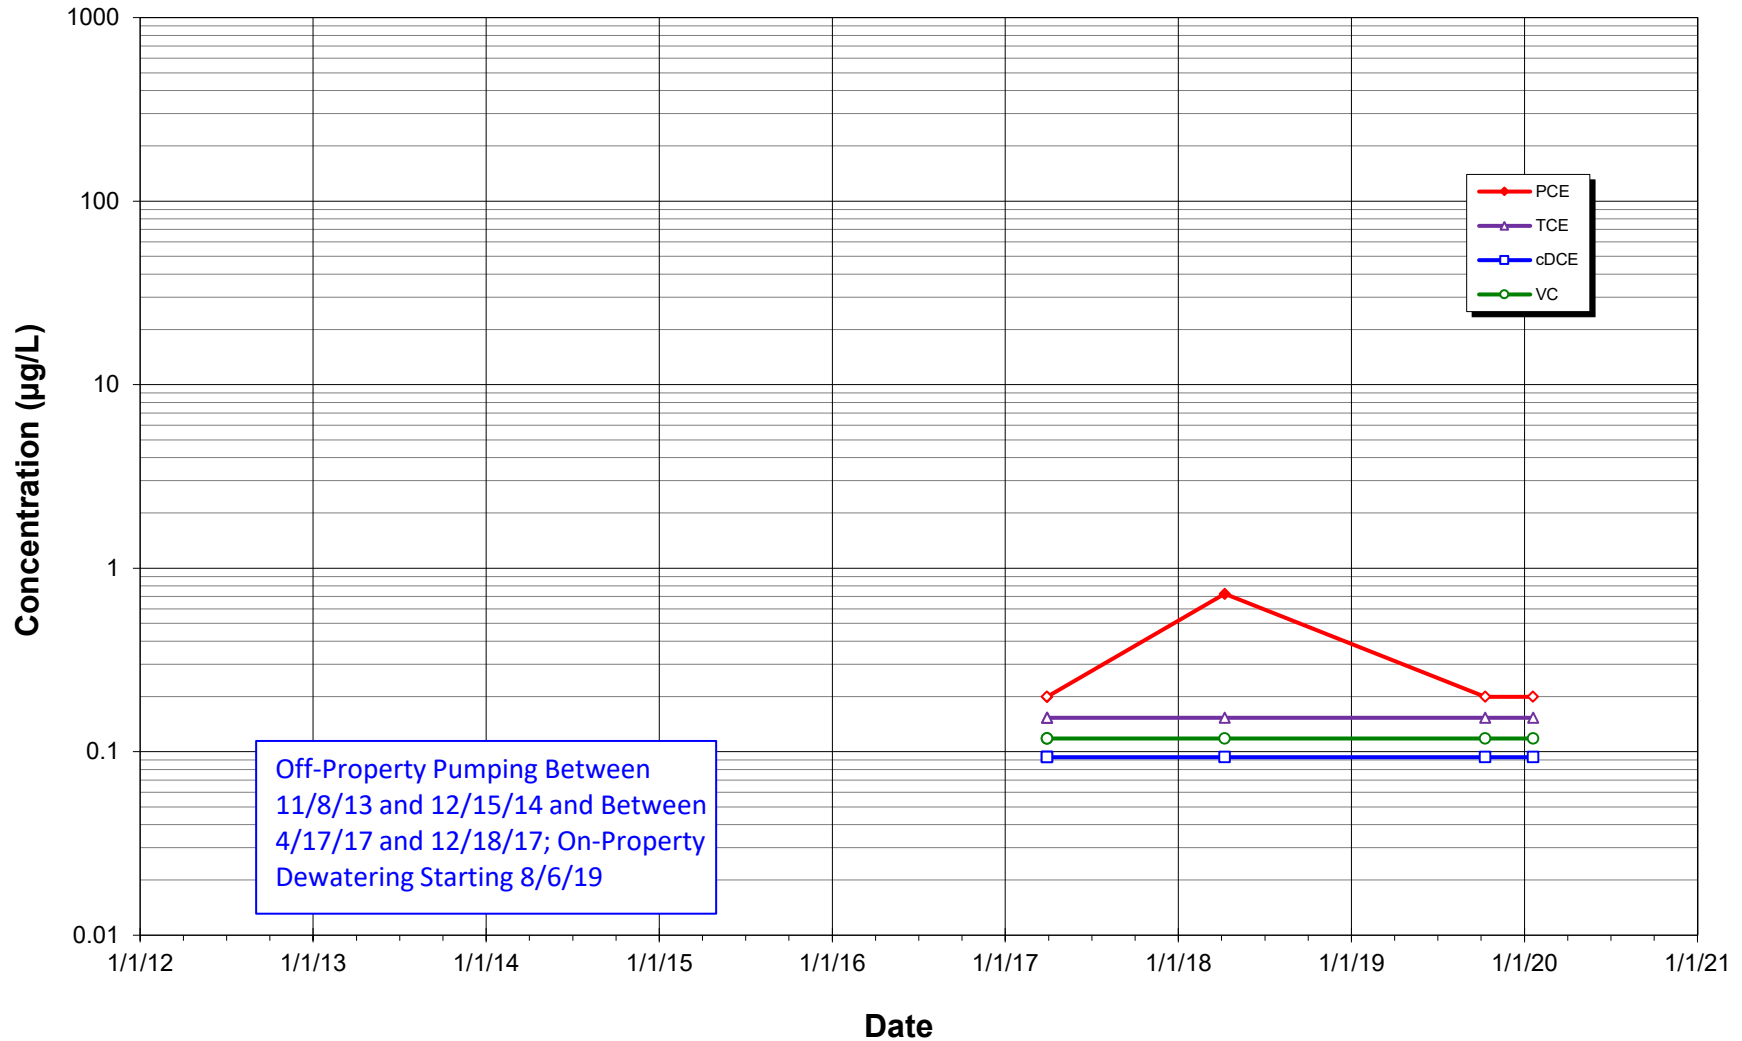

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-305 (37.4 to 27.4 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

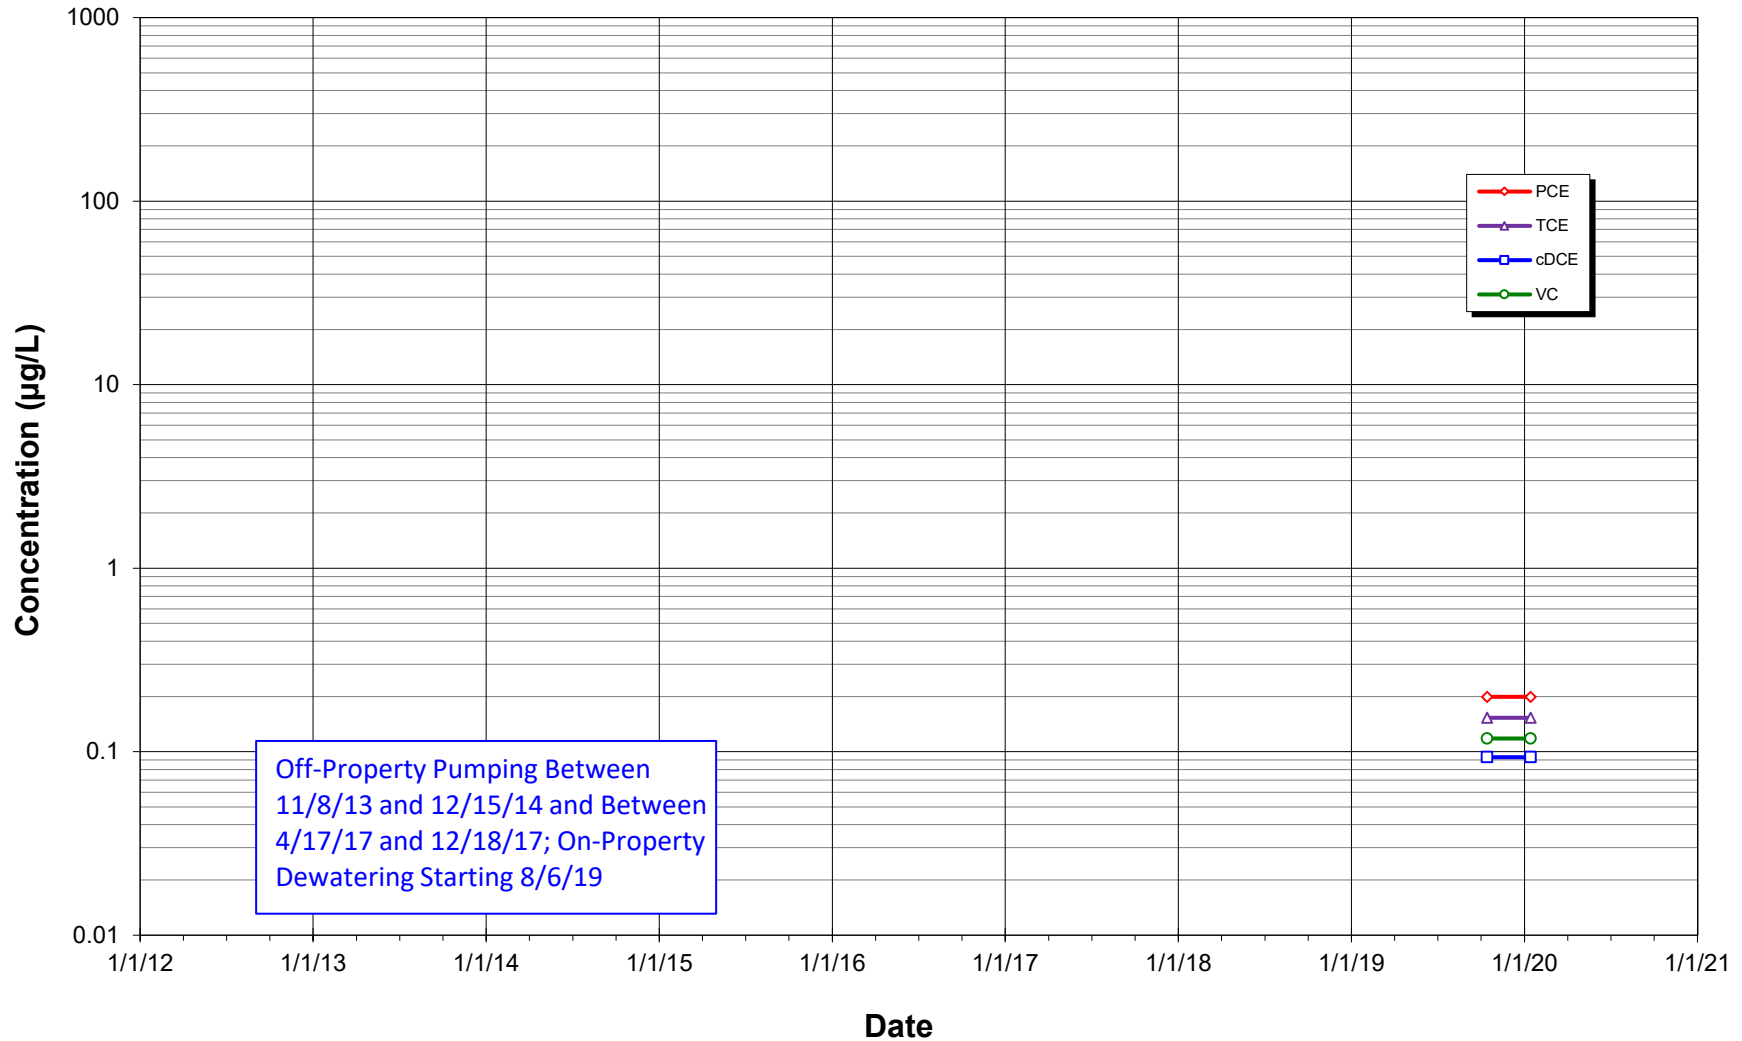

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time MW-310 (19.2 to 9.2 feet NAVD), Alley Between 8th and 9th American Linen Supply Co–Dexter Ave Site

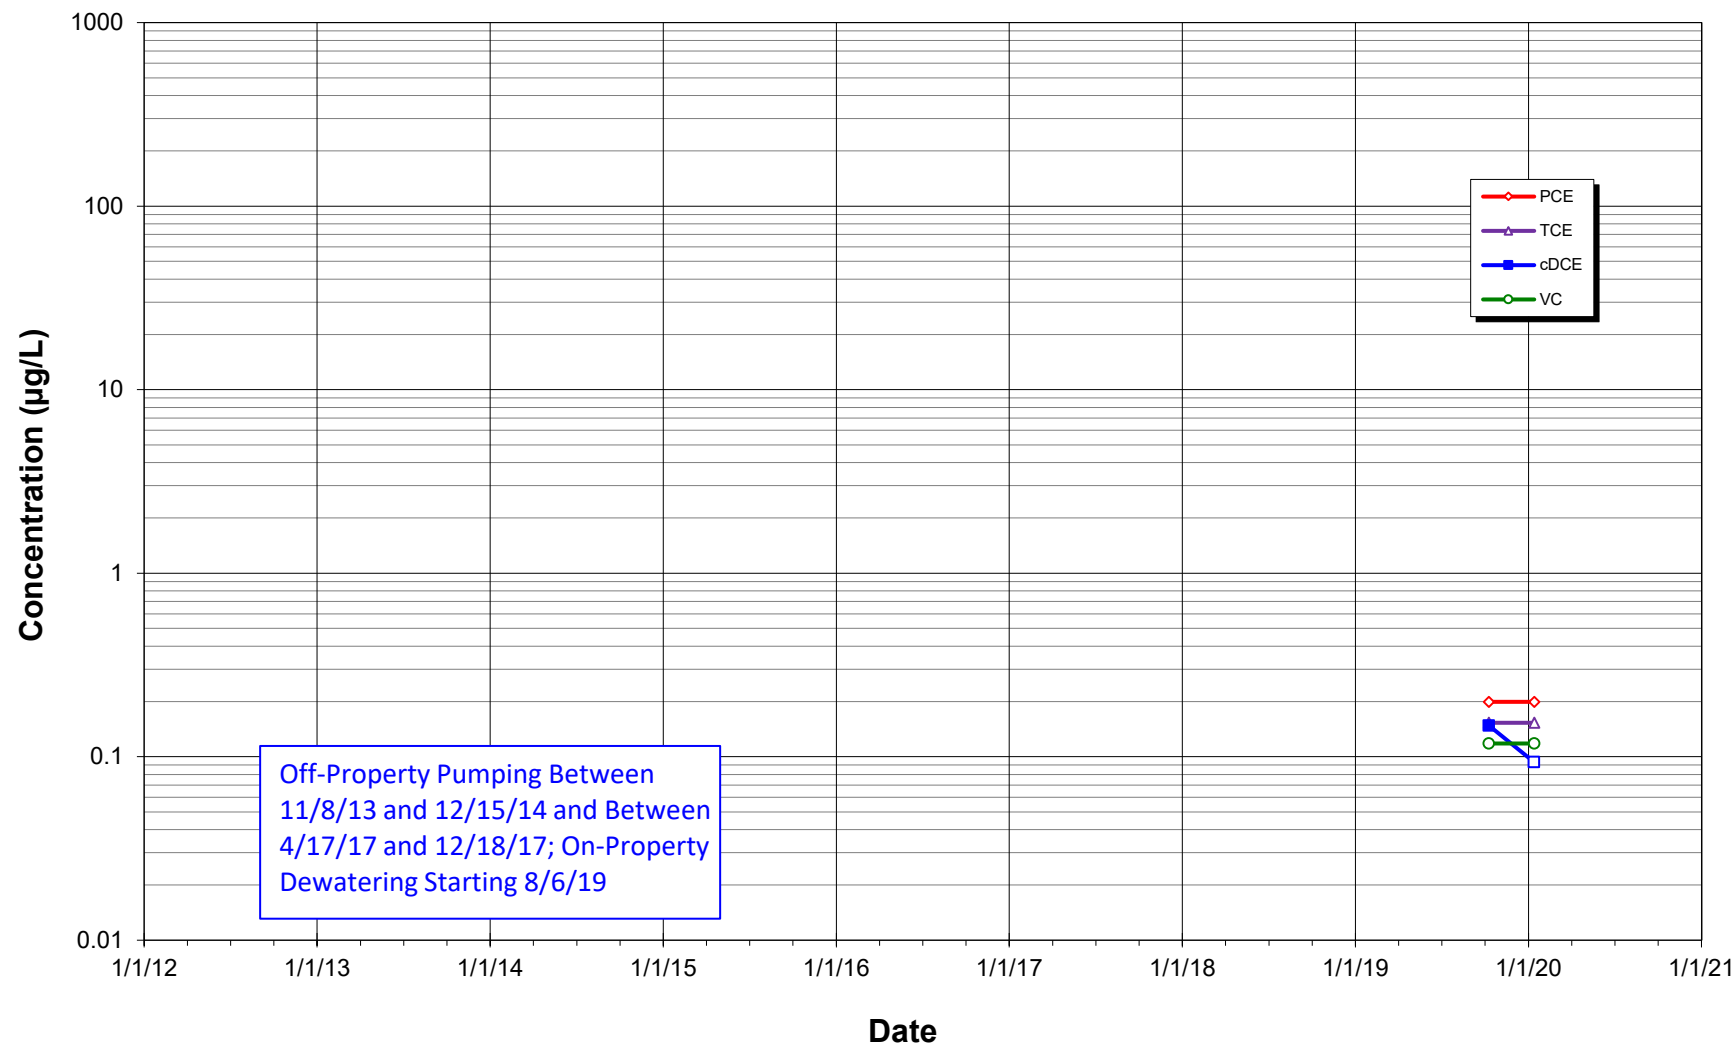

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time MW-312 (19.9 to 9.9 feet NAVD), Alley Between 8th and 9th American Linen Supply Co–Dexter Ave Site

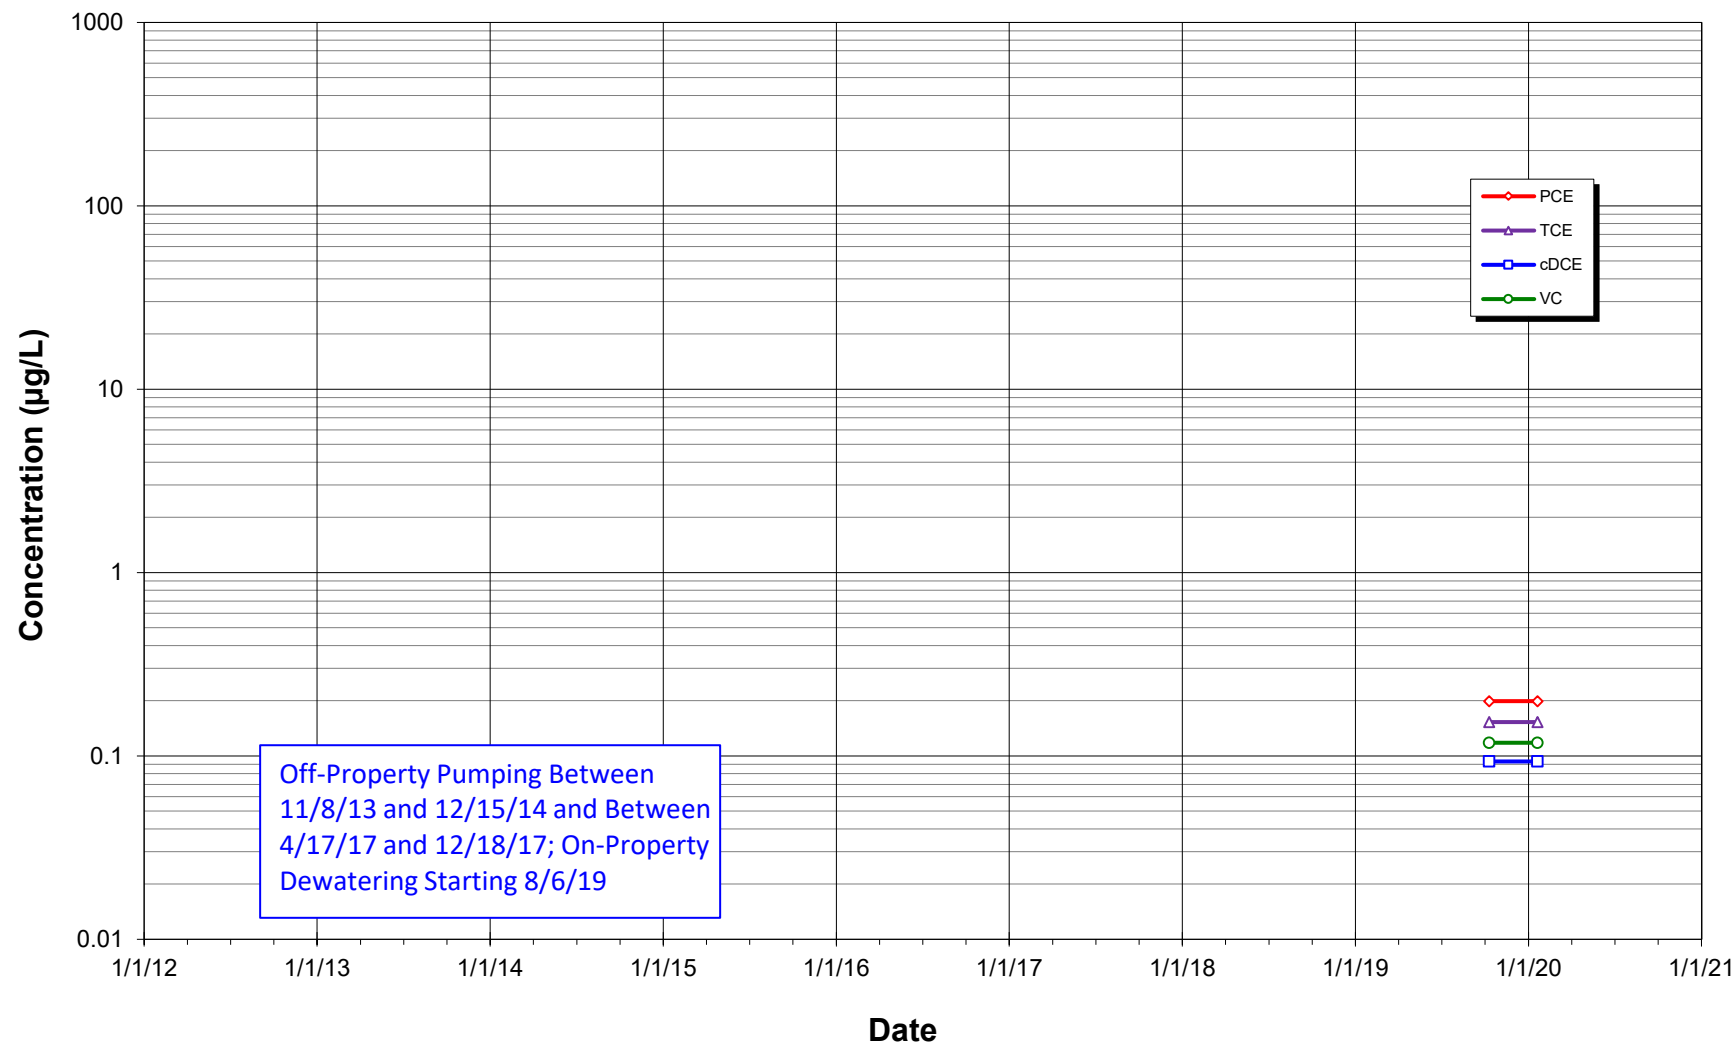

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-313 (20.4 to 10.4 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

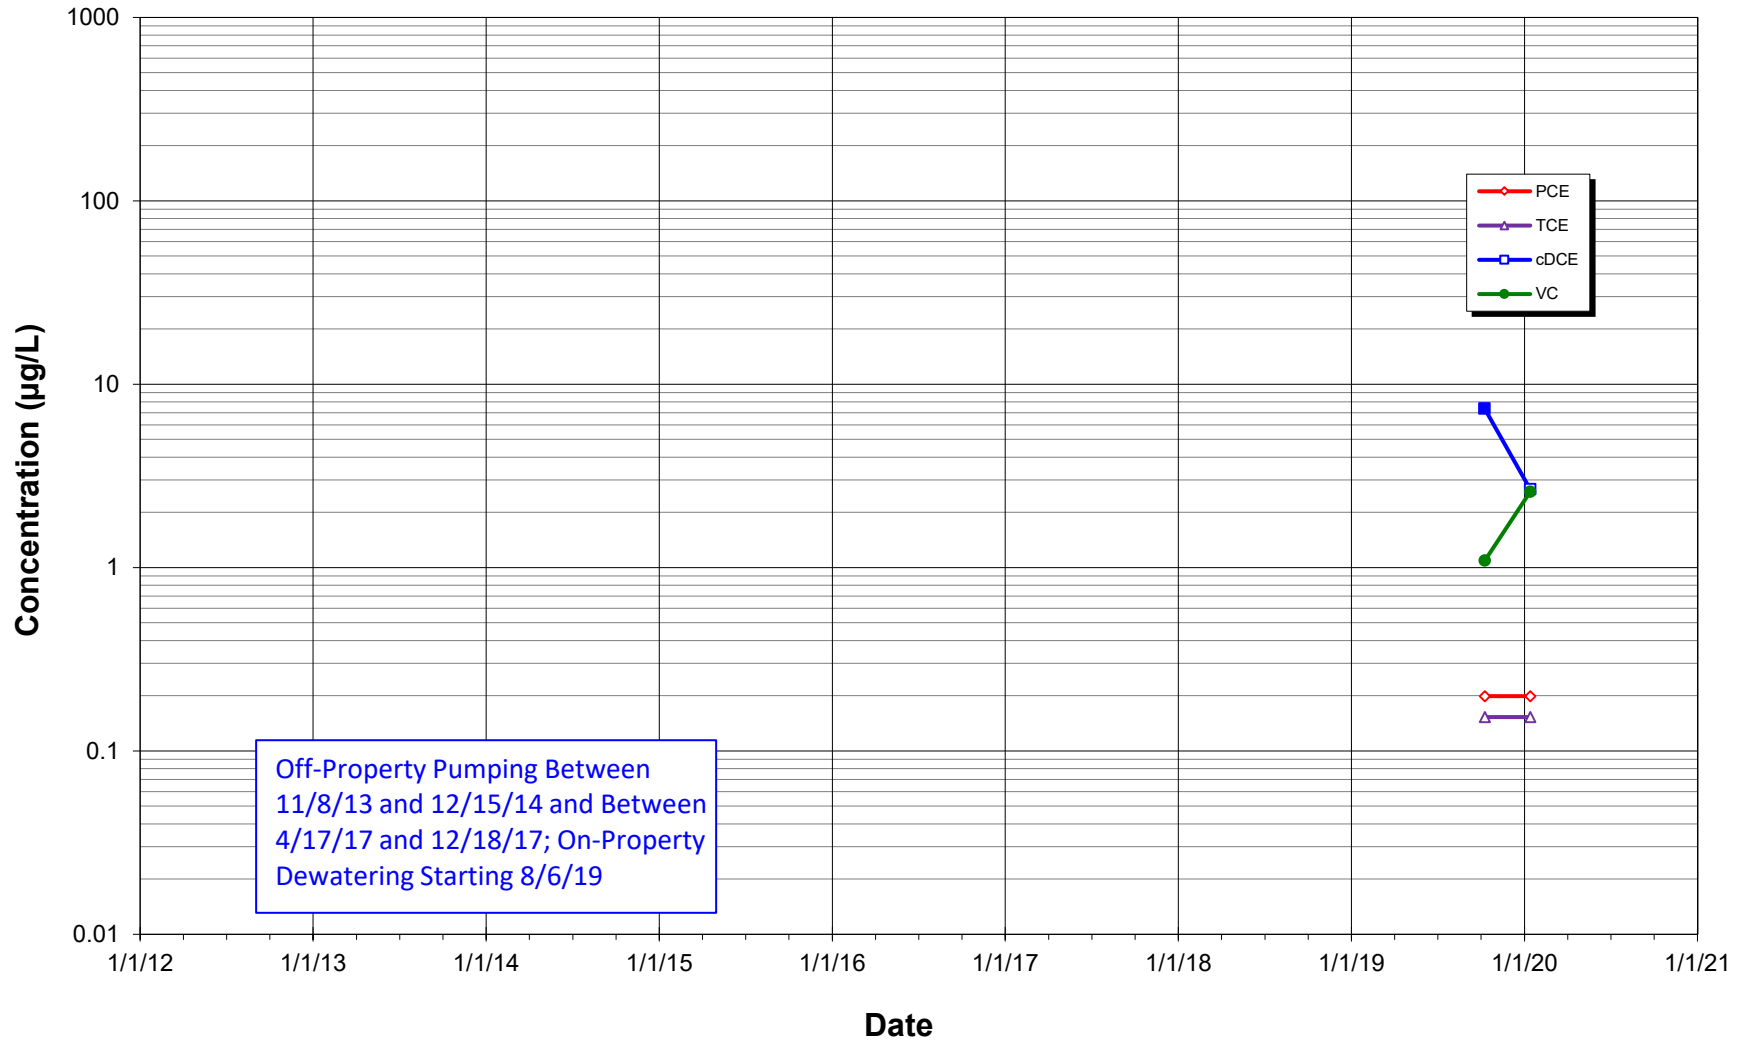

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-320 (18.6 to 8.6 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site

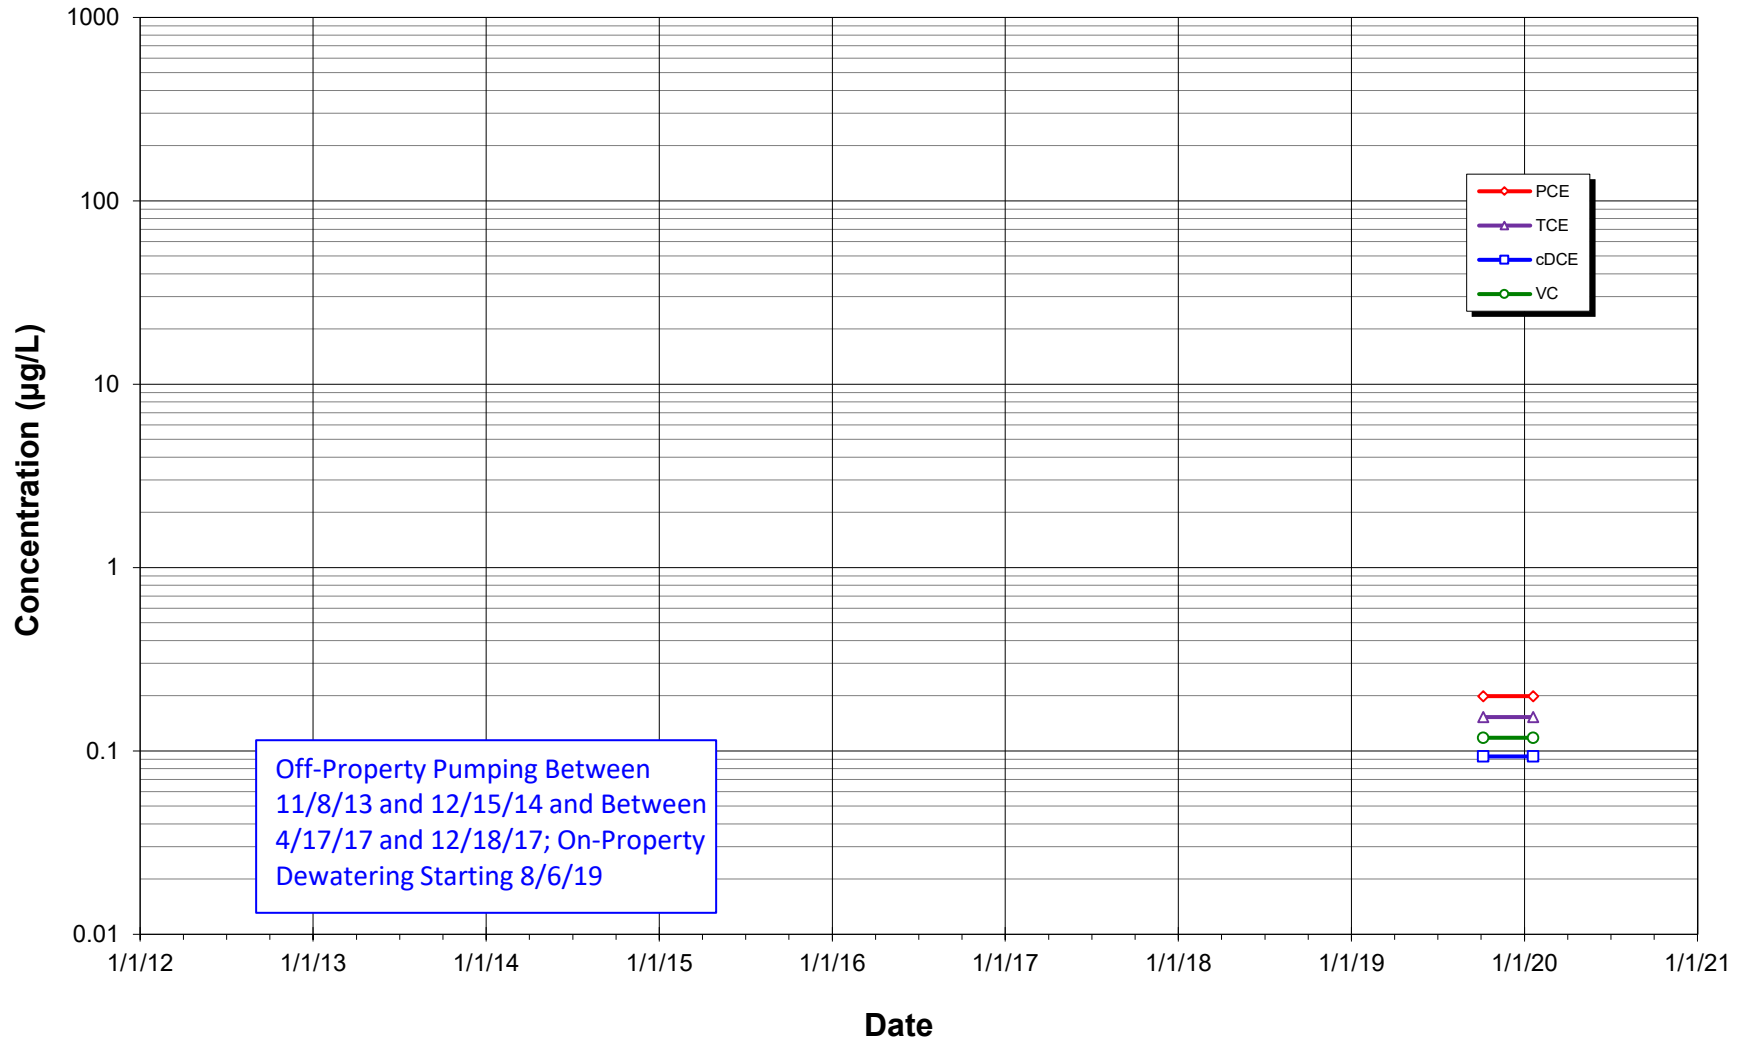

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
R-MW5 (42.0 to 27.0 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

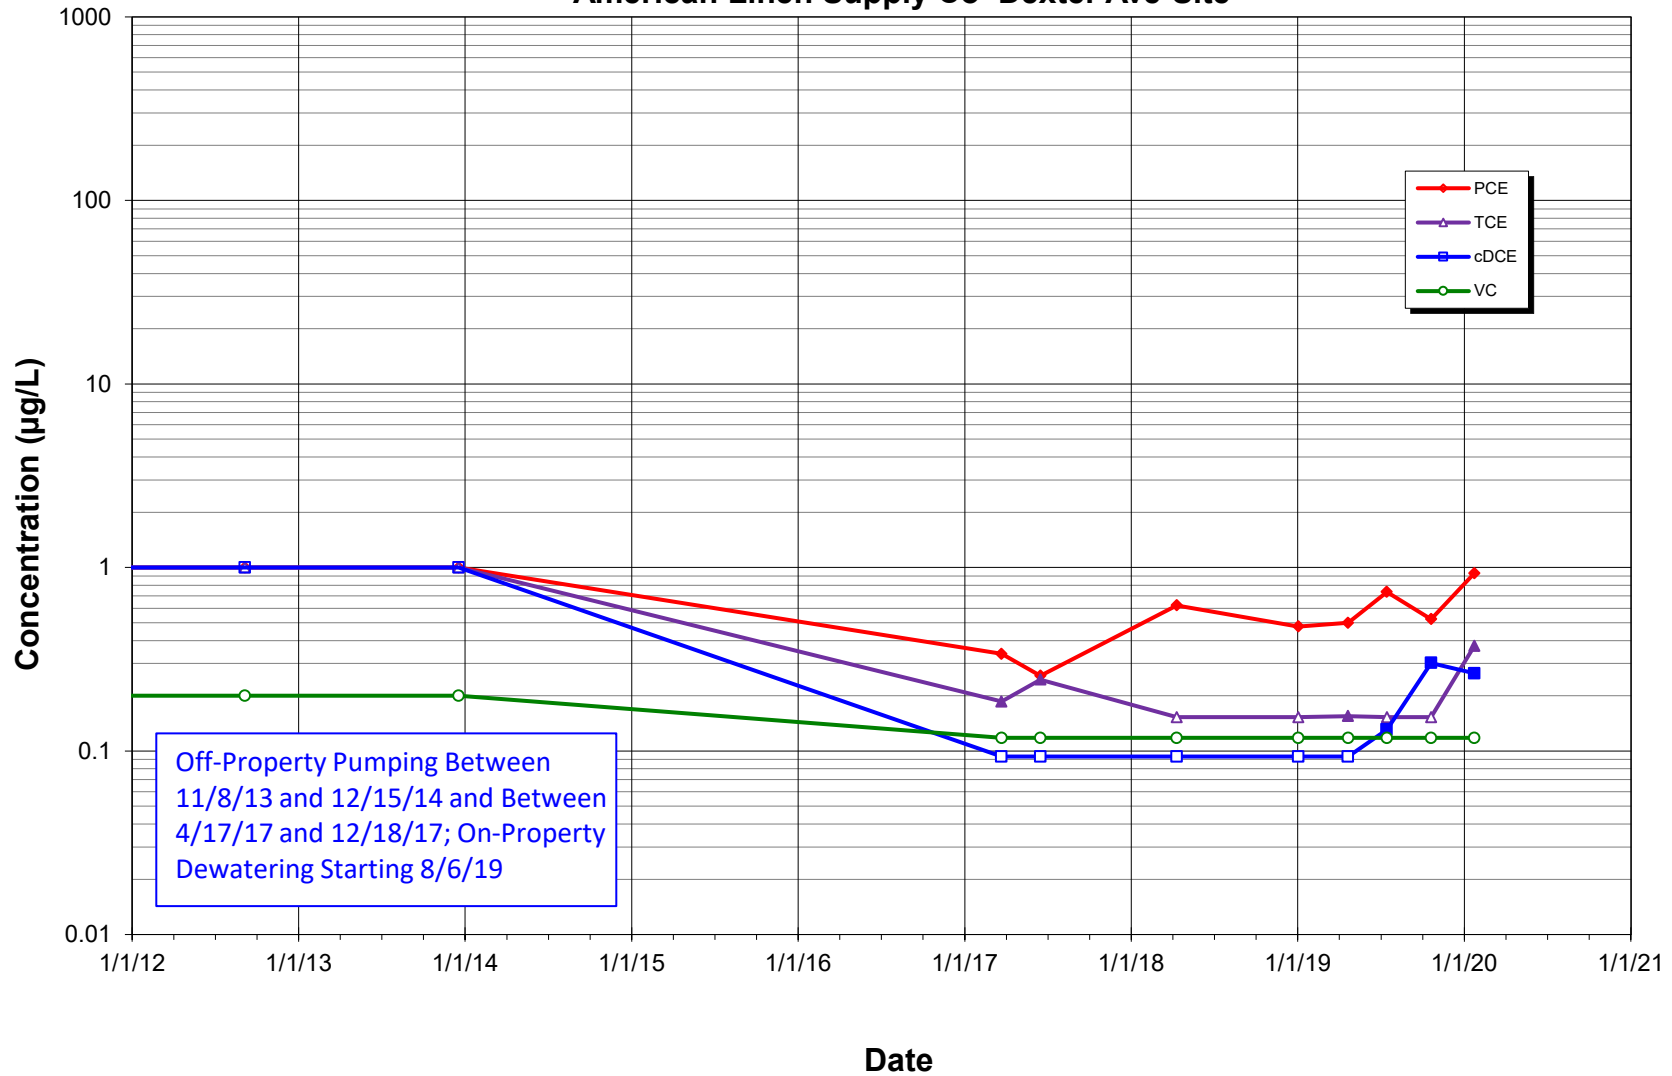

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time R-MW6 (33.3 to 23.3 feet NAVD), 8th Avenue North American Linen Supply Co–Dexter Ave Site

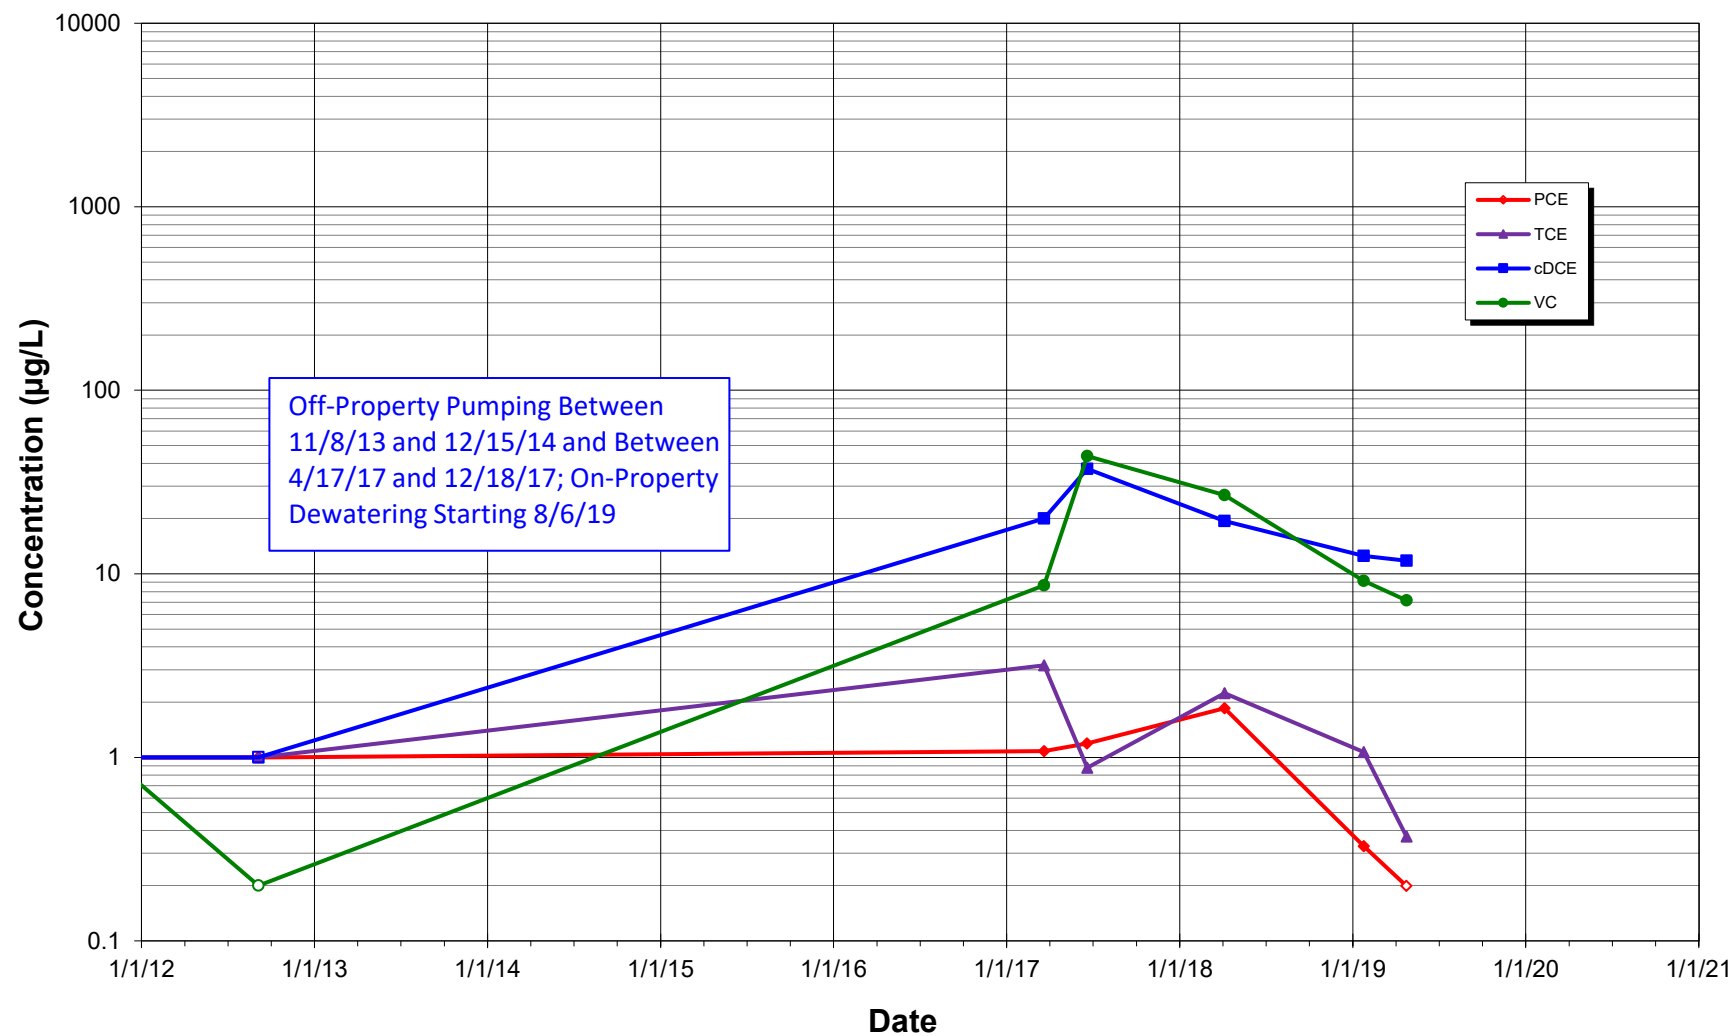

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
SCL-MW101 (25.5 to 15.5 feet NAVD), Alley
American Linen Supply Co–Dexter Ave Site**

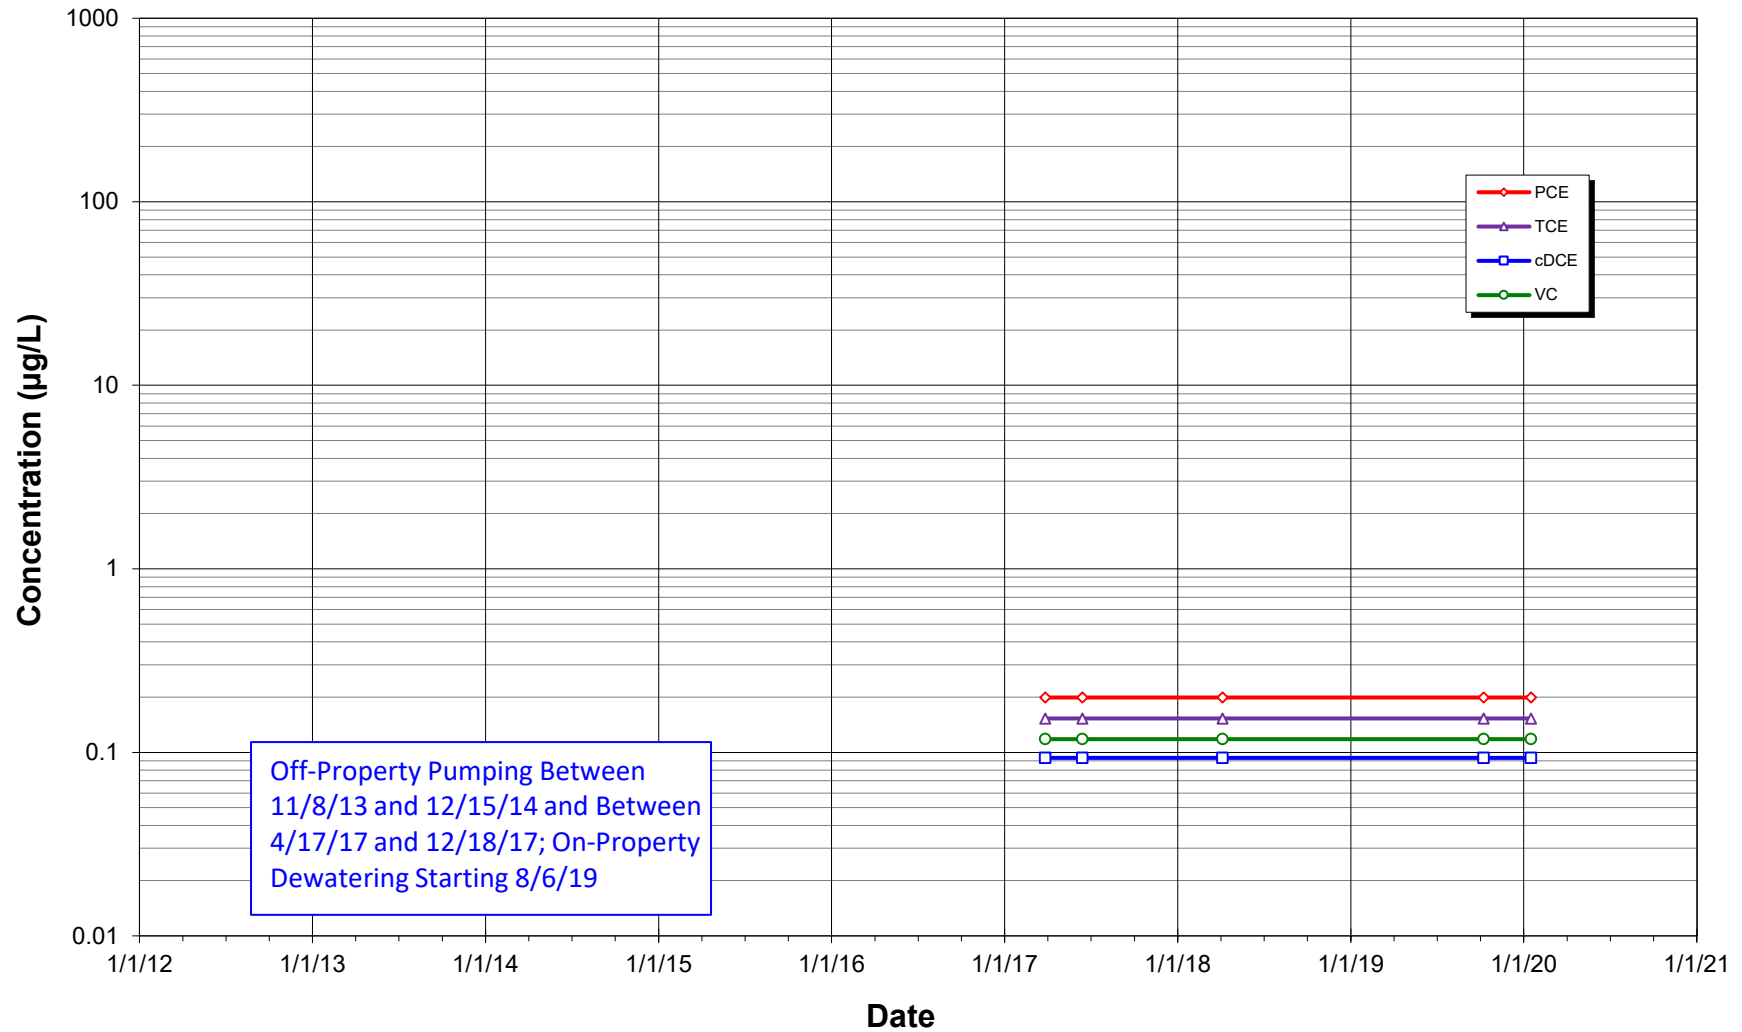

Notes:


- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
SCL-MW105 (11.3 to 1.3 feet NAVD), Alley
American Linen Supply Co–Dexter Ave Site

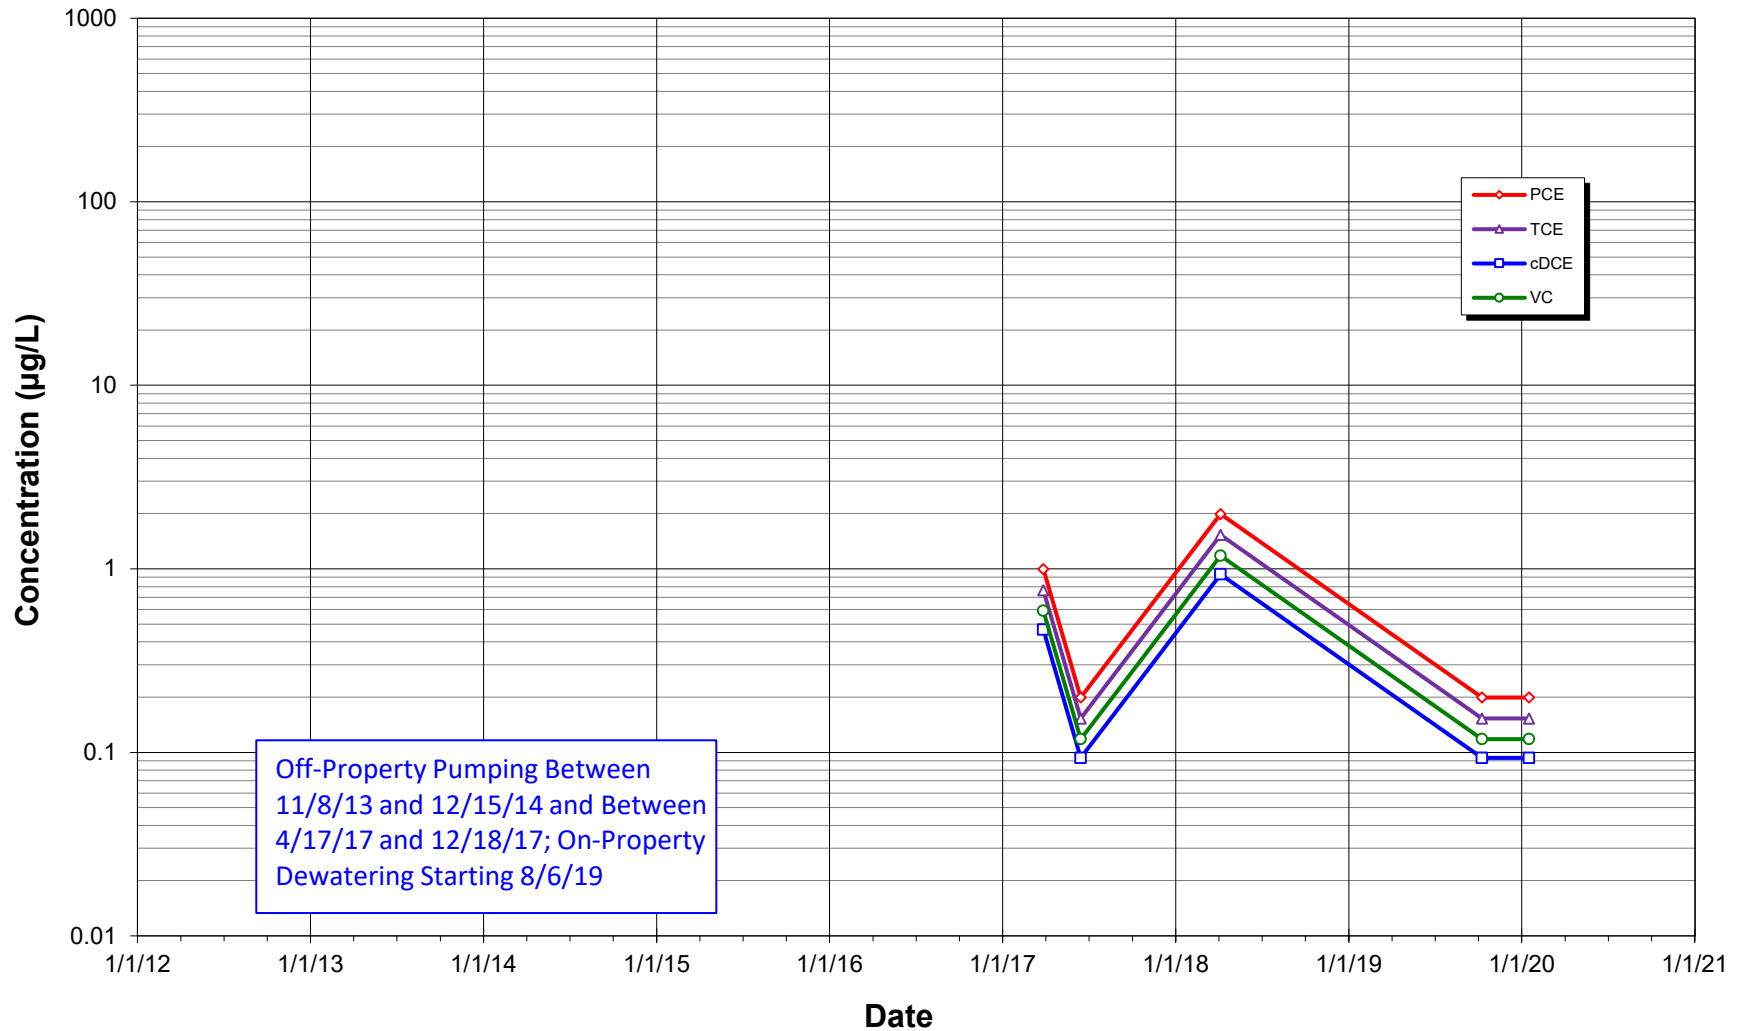

- Notes:**
- 1) All results detected below the laboratory MDLs are shown as hollow data points .
 - 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
SCS-2 (28.2 to 18.2 feet NAVD), SCL Property
American Linen Supply Co–Dexter Ave Site

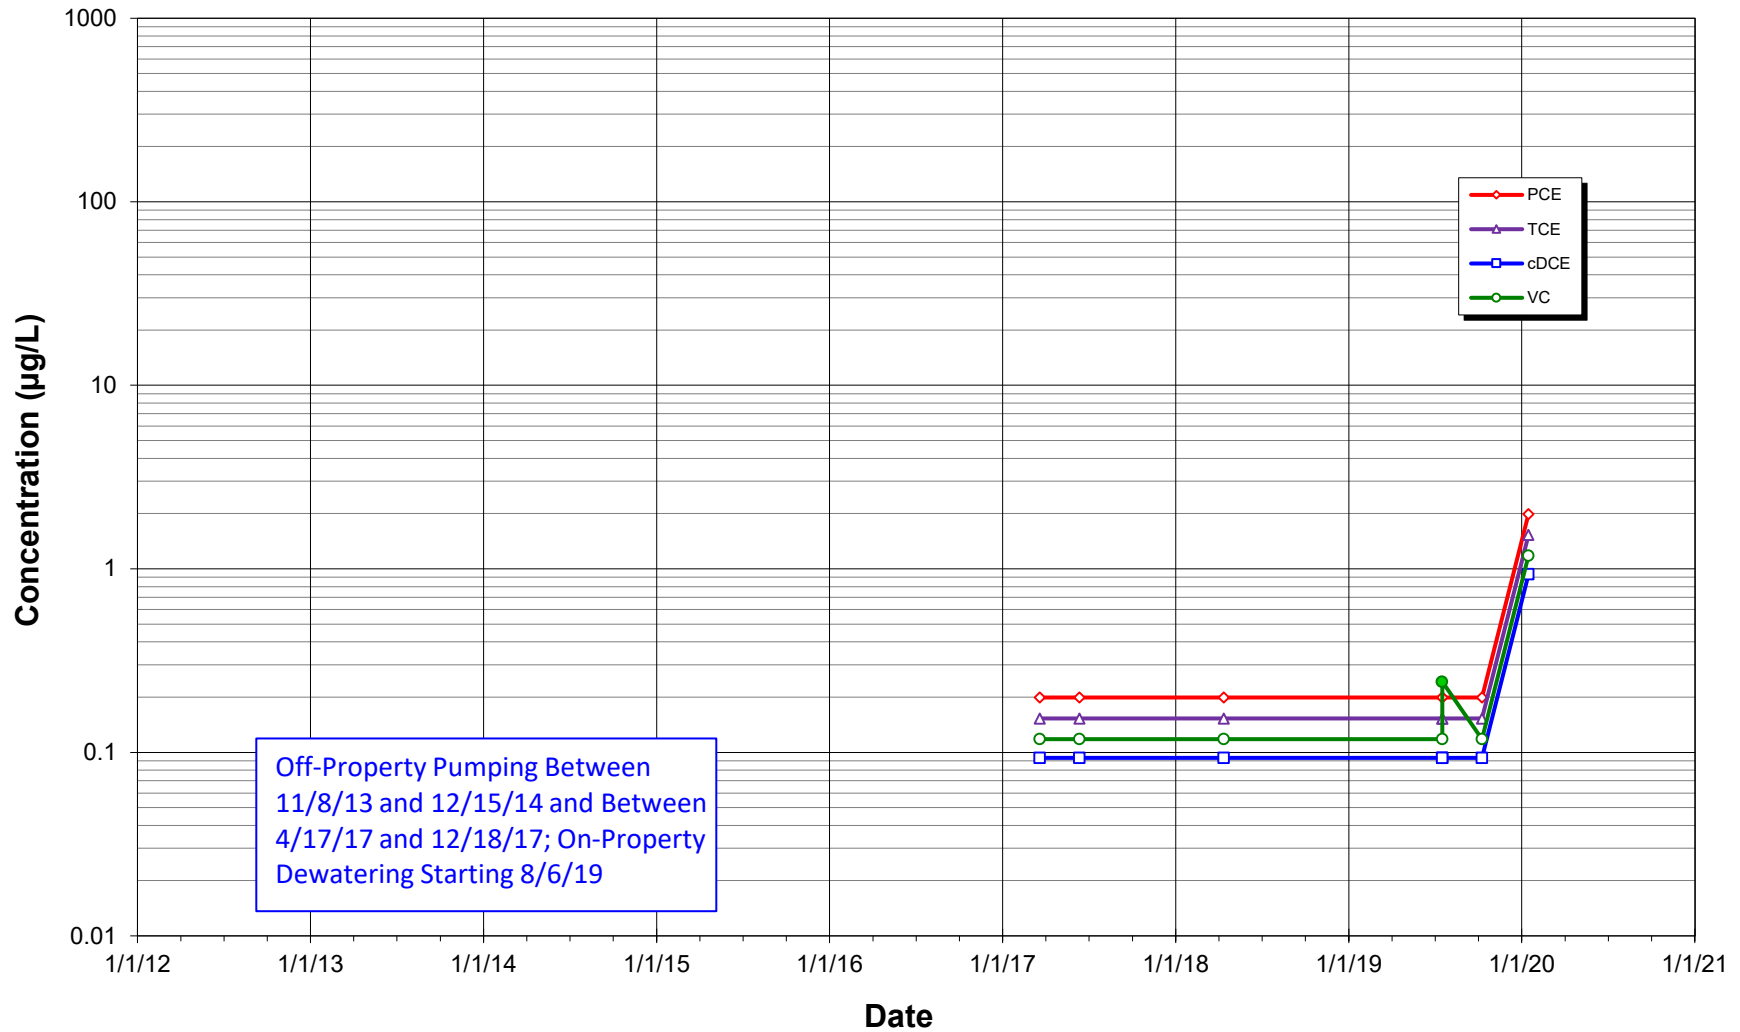

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
SMW-3 (17.1 to 7.1 feet NAVD), Valley Street
American Linen Supply Co–Dexter Ave Site

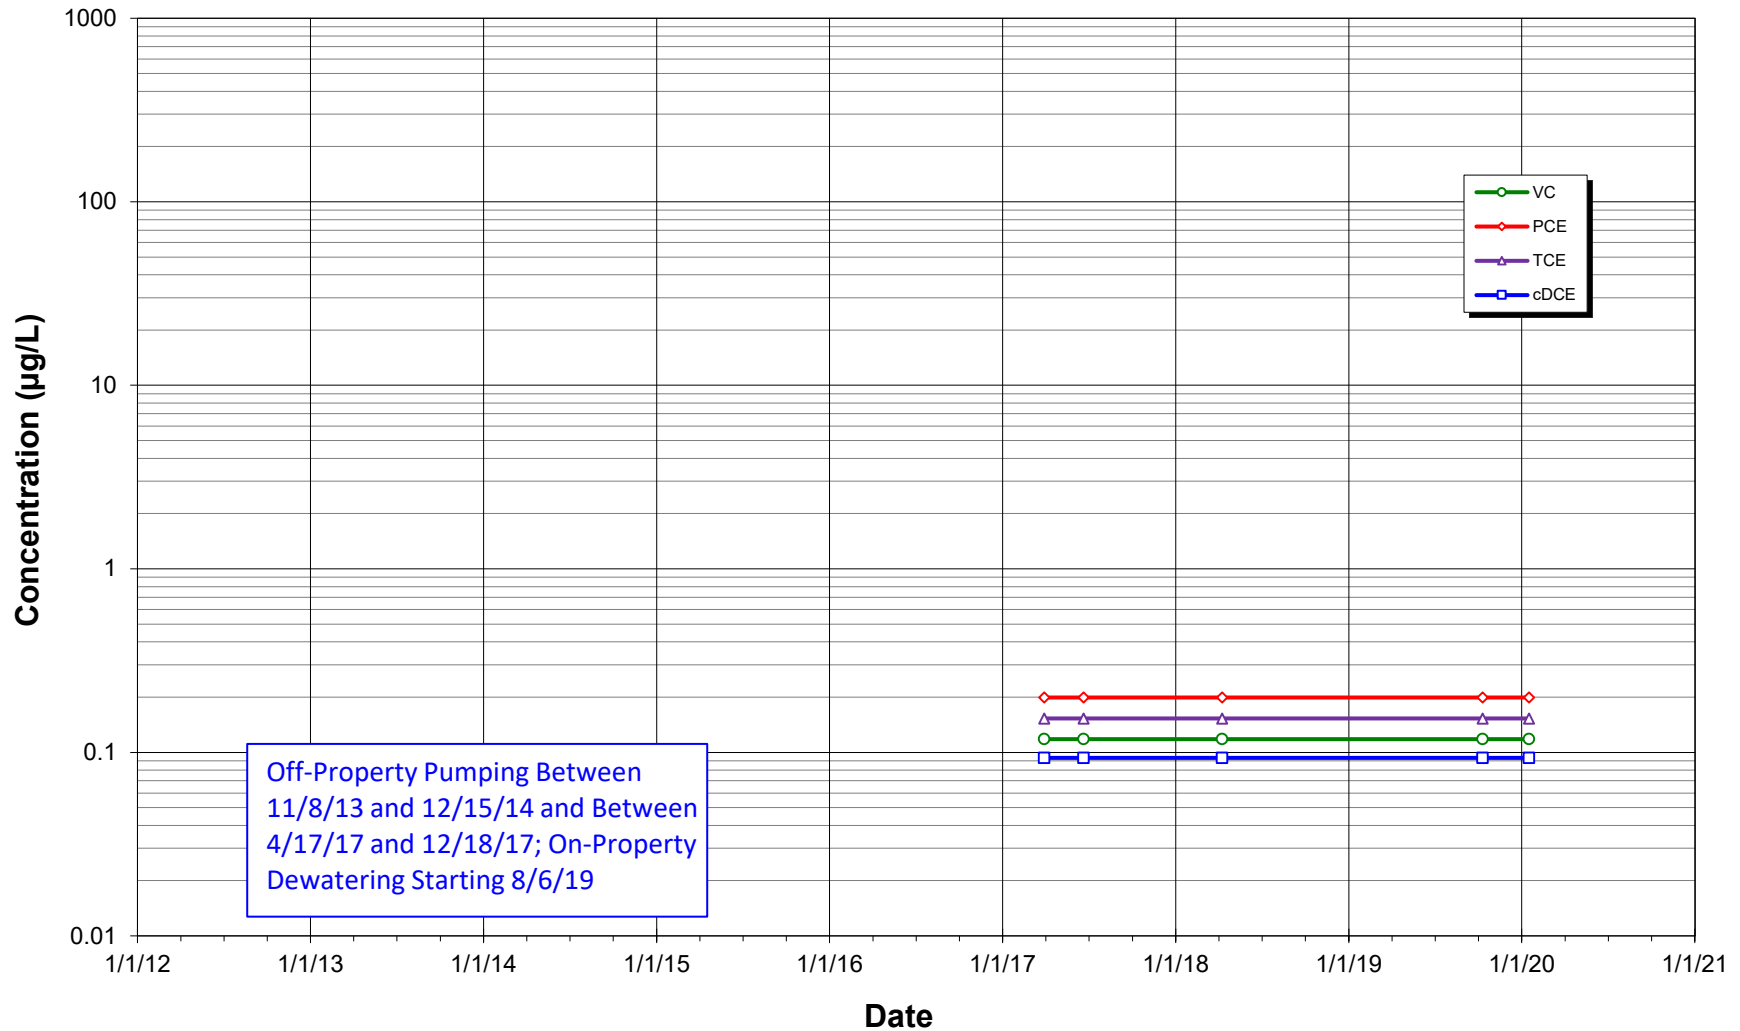


Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
BB-8 (13.7 to 3.7 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site**

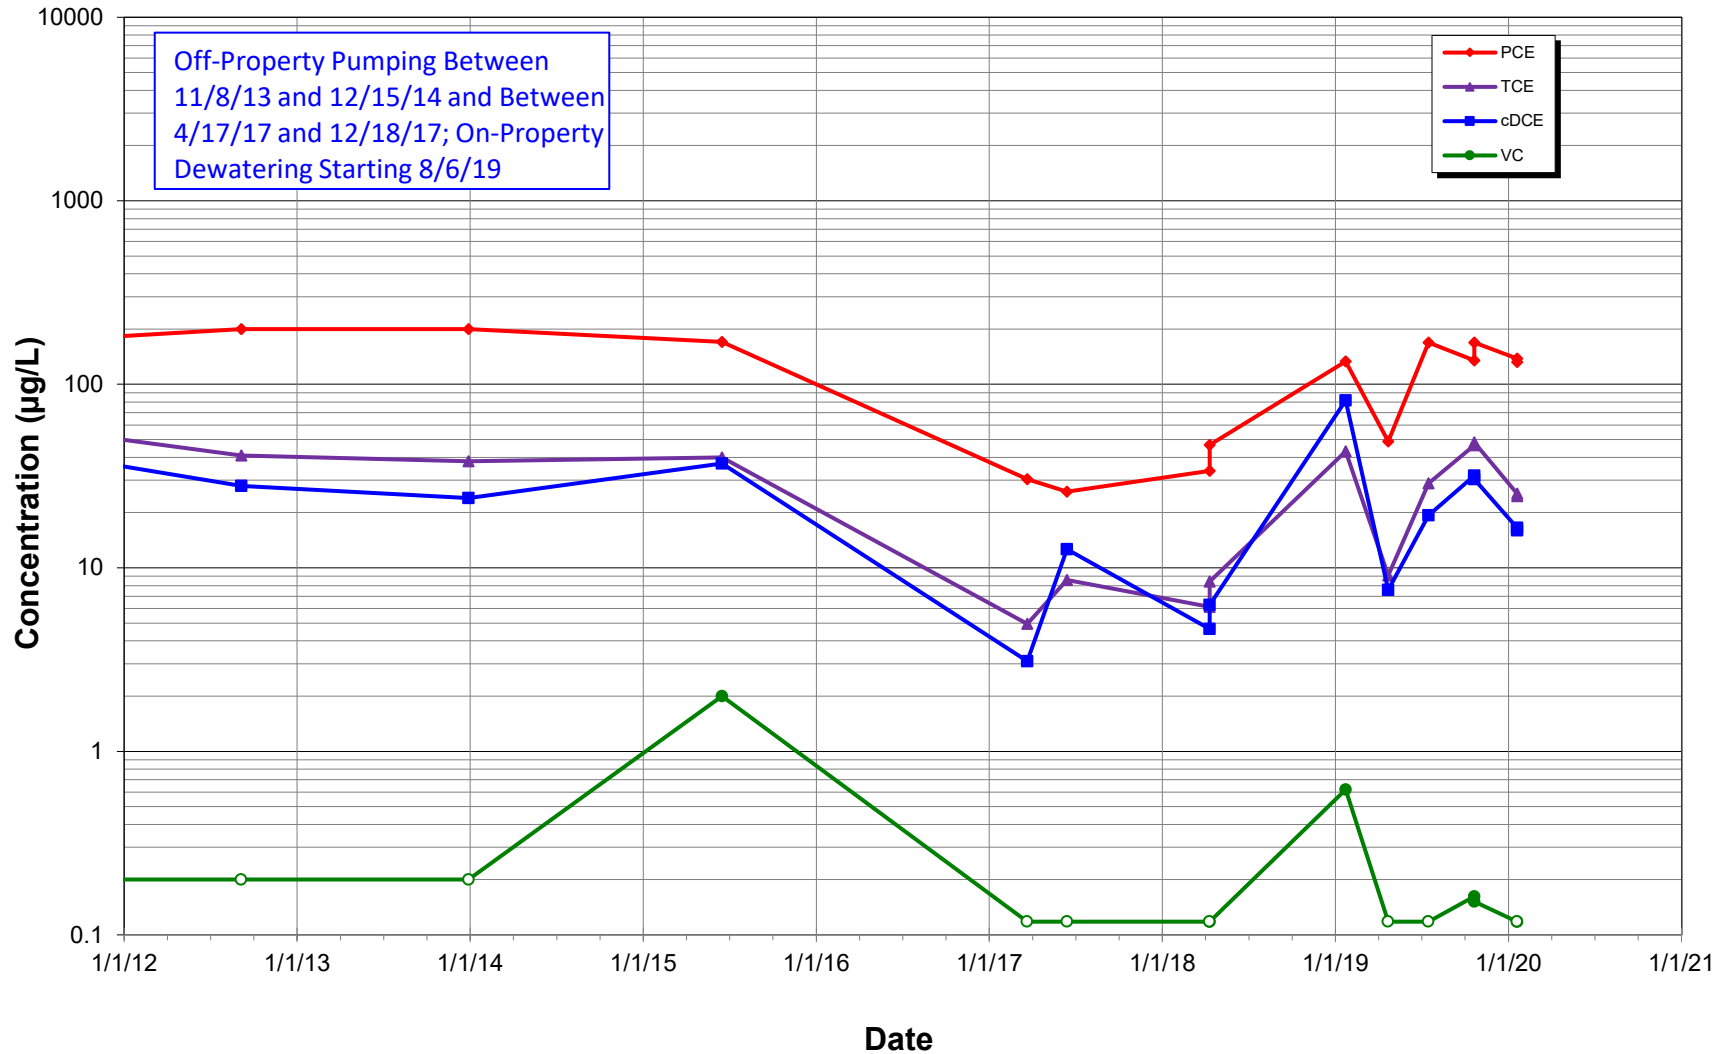

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
FMW-141 (-12 to -22 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

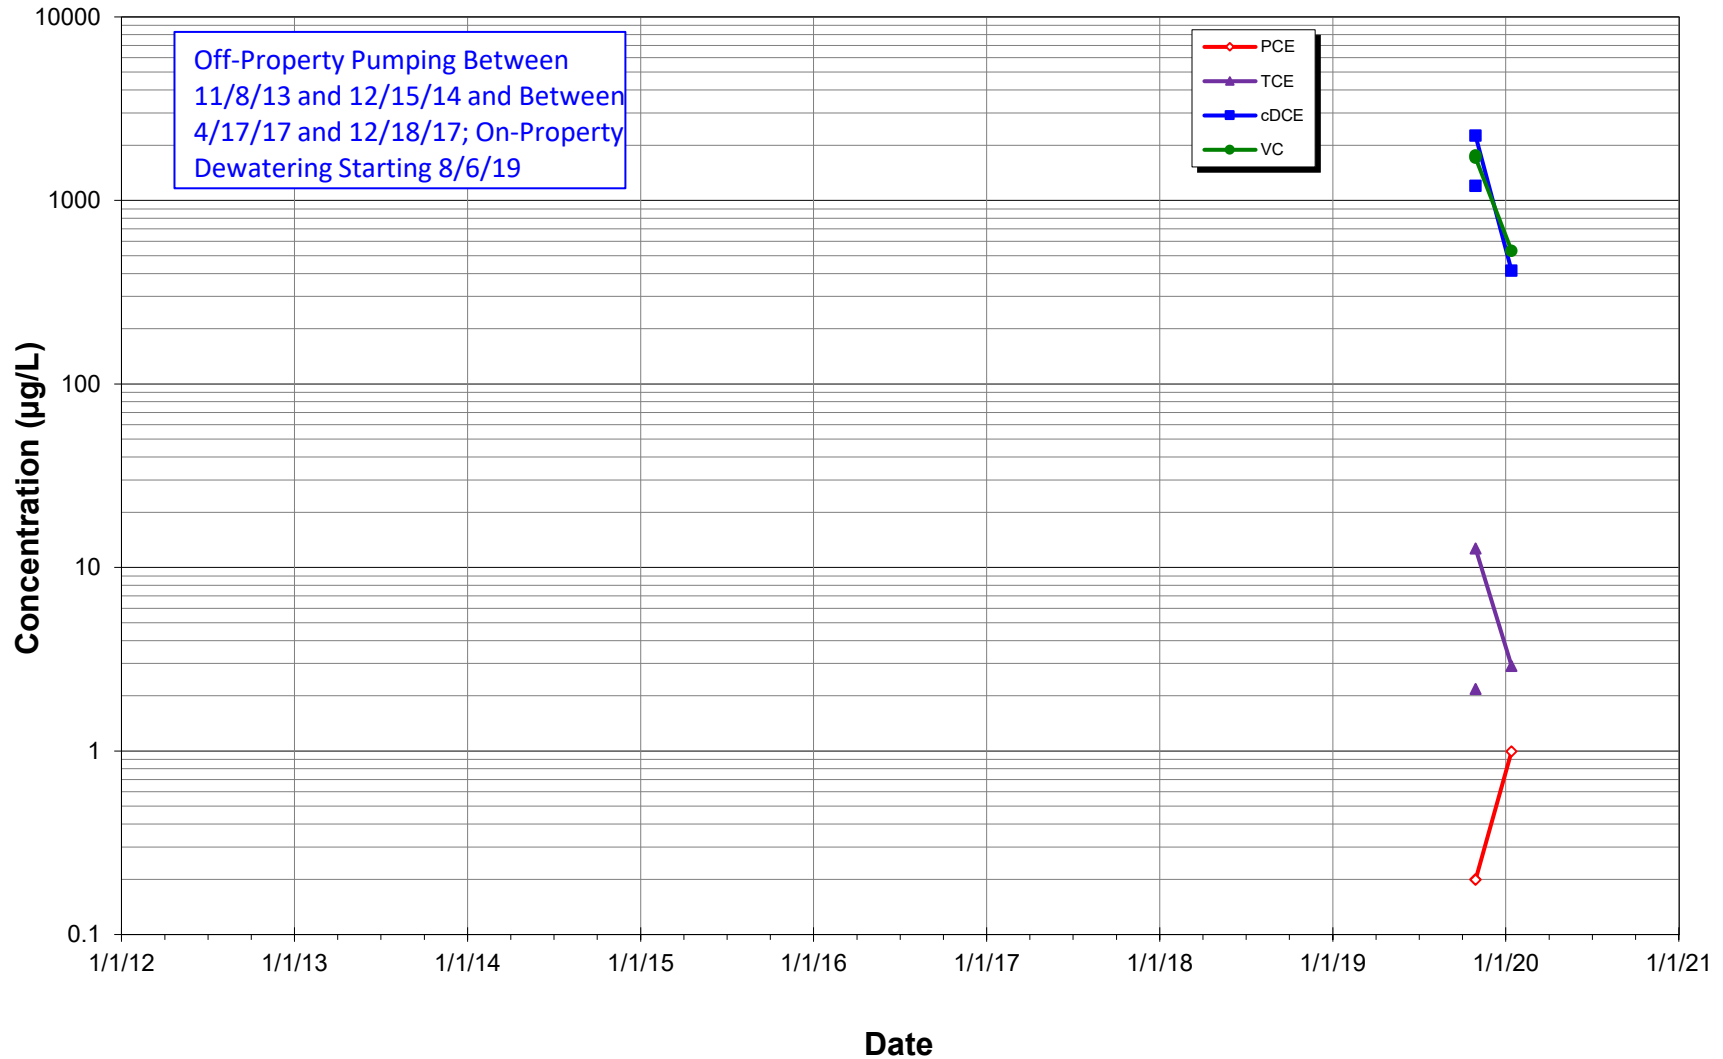

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
FMW-142 (-5 to -10 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site

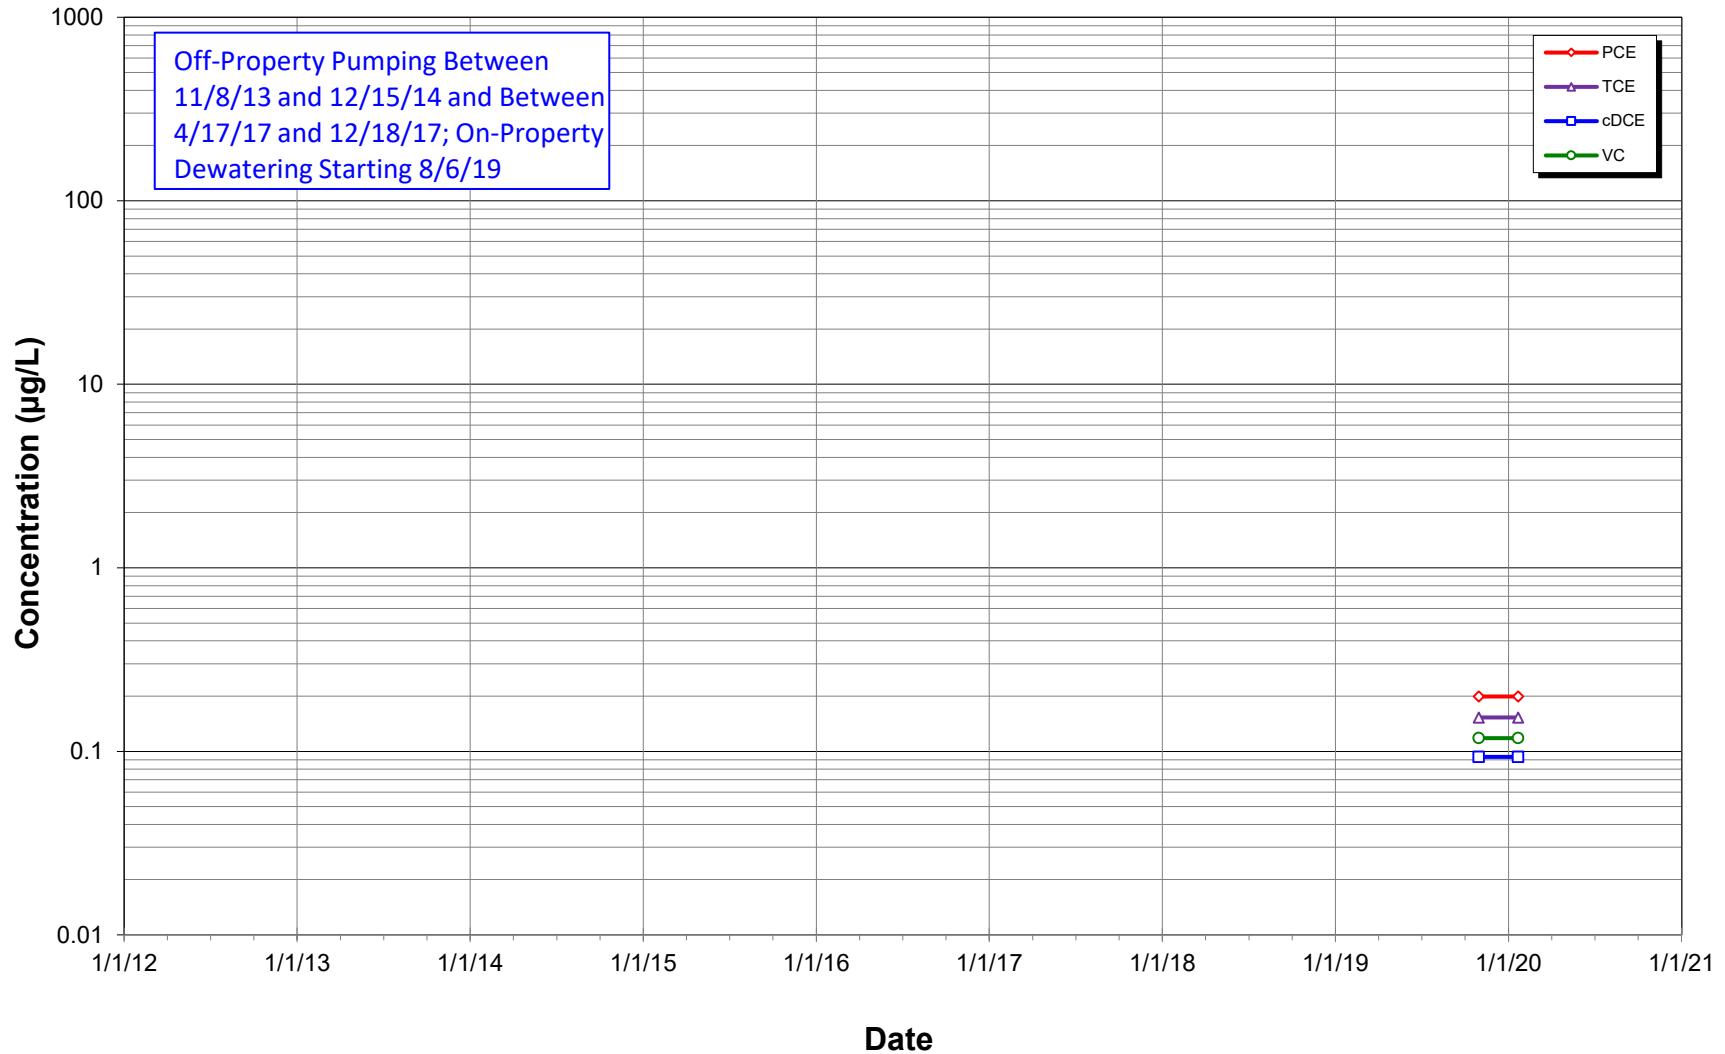

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
 GEI-1 (1.2 to -8.8 feet NAVD), Block 37
 American Linen Supply Co–Dexter Ave Site**

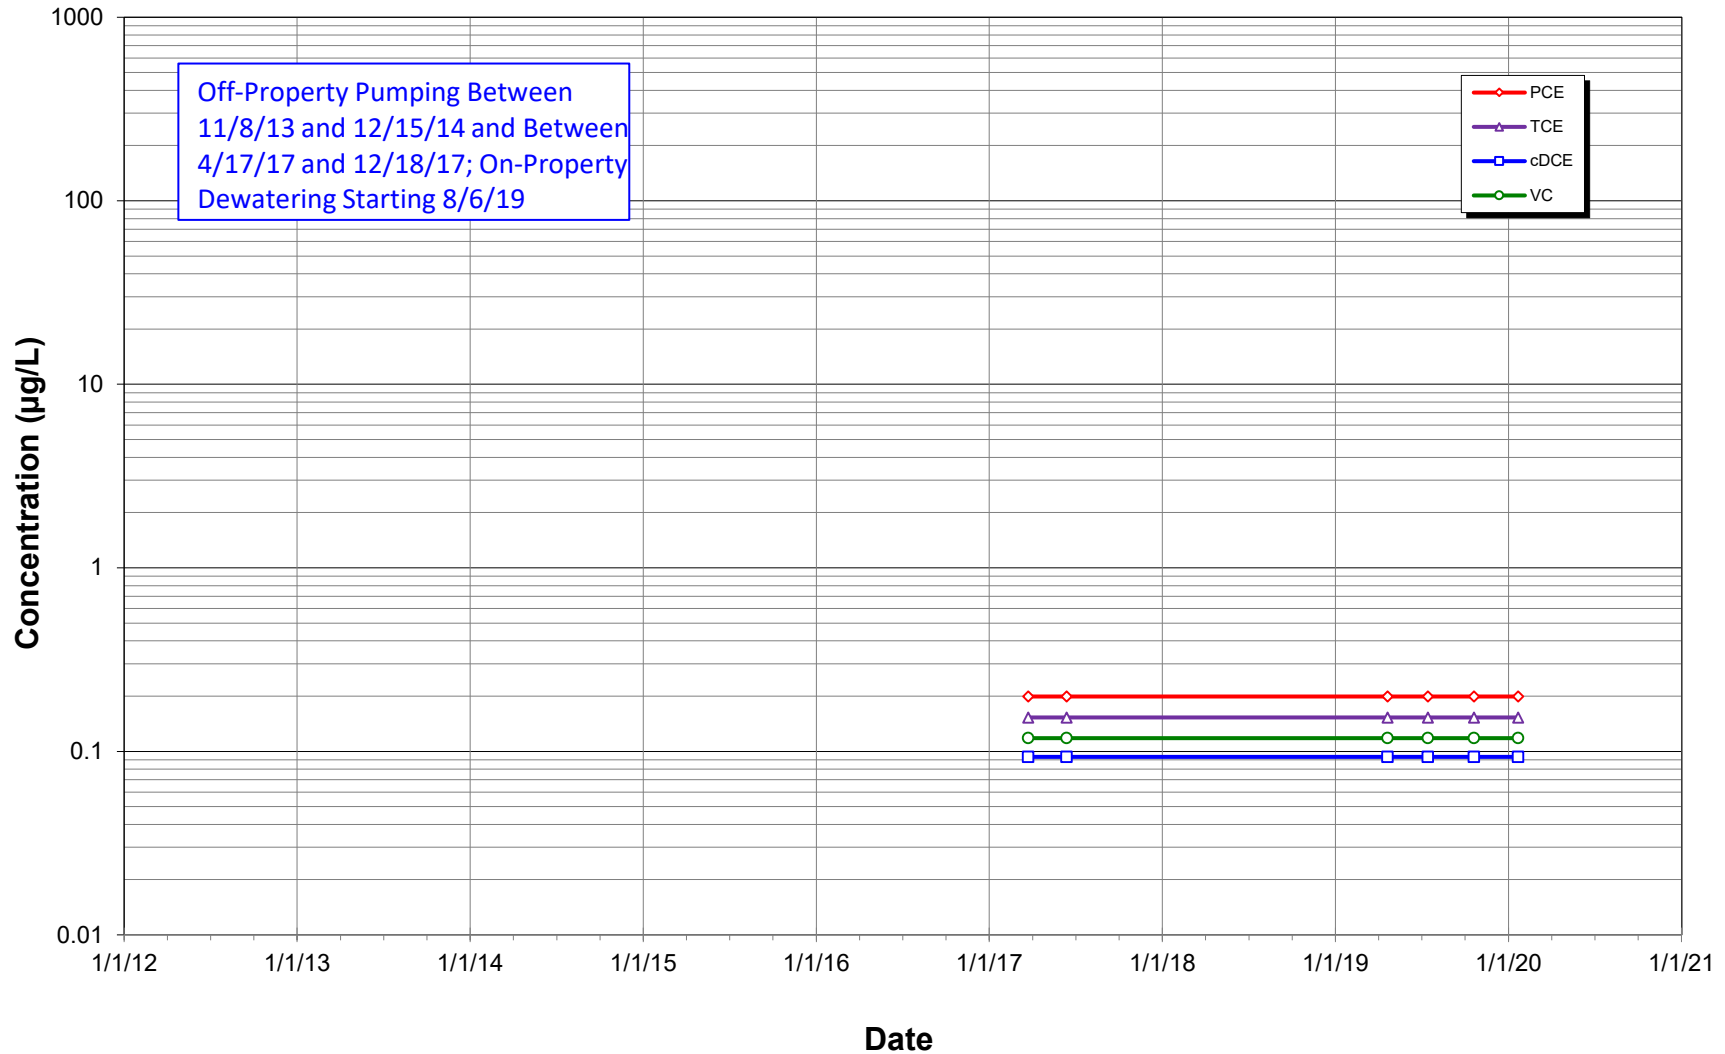

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW107 (8.8 to 1.2 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

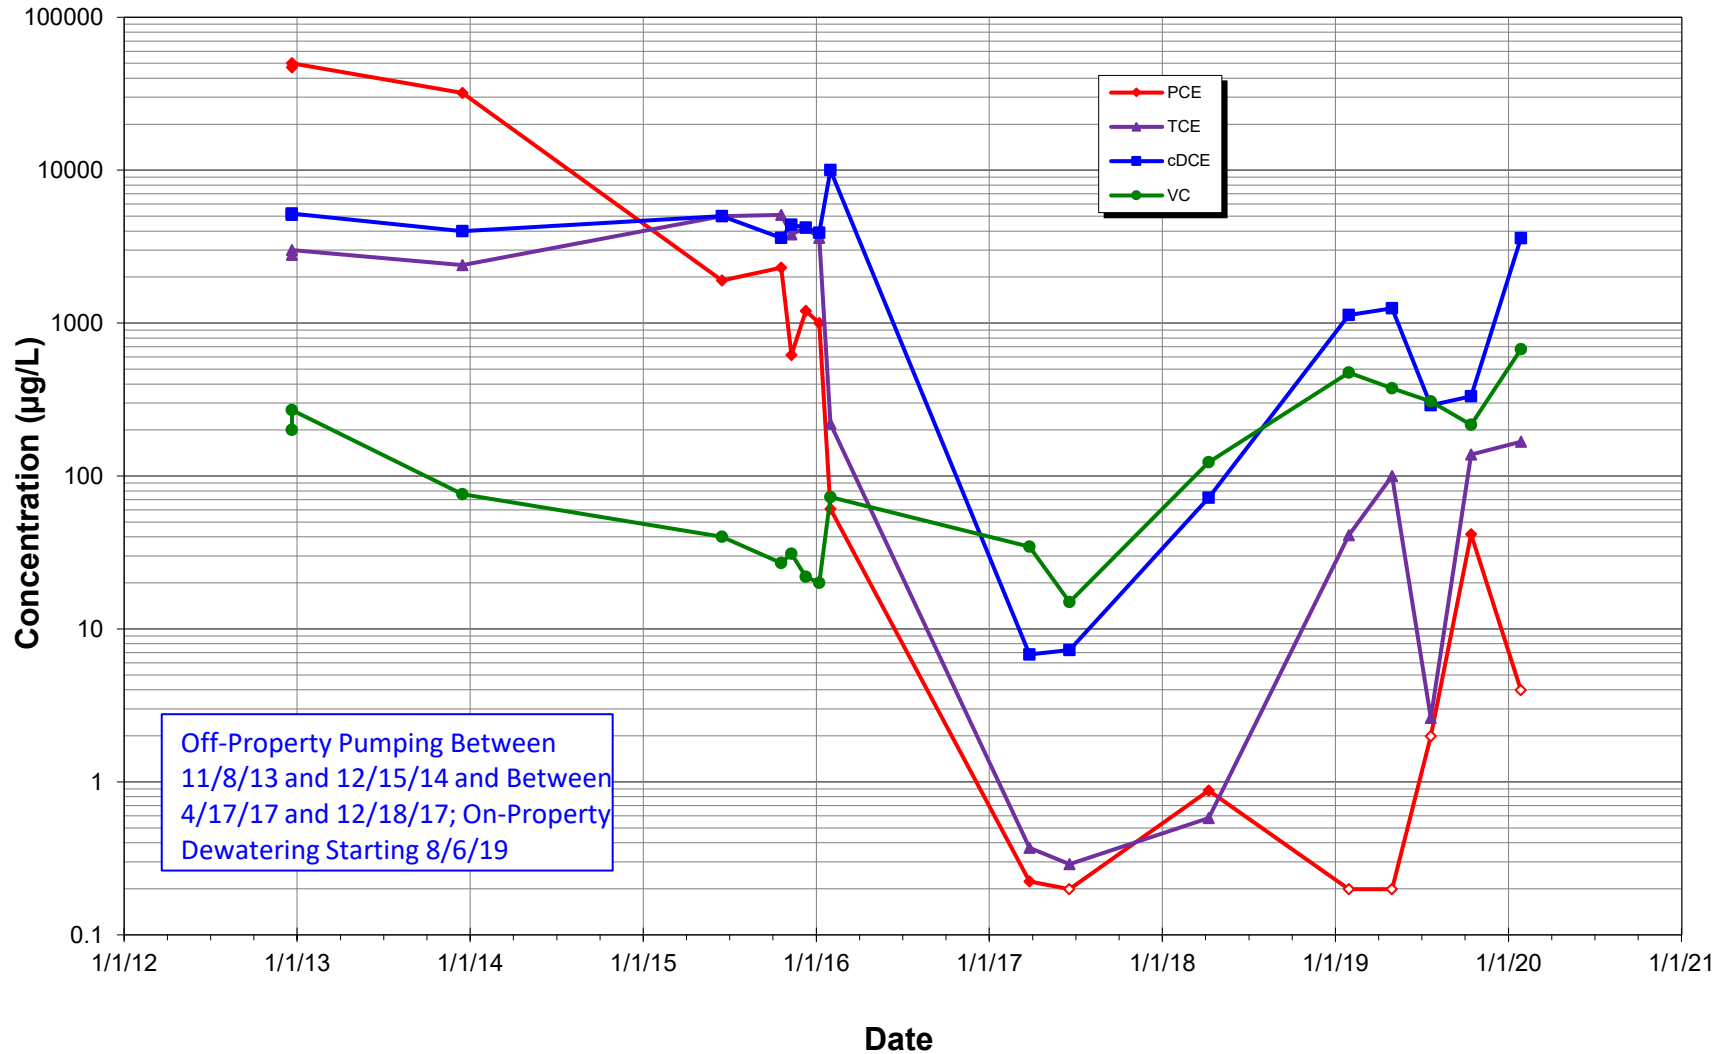

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW108 (-7.2 to -17.2 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

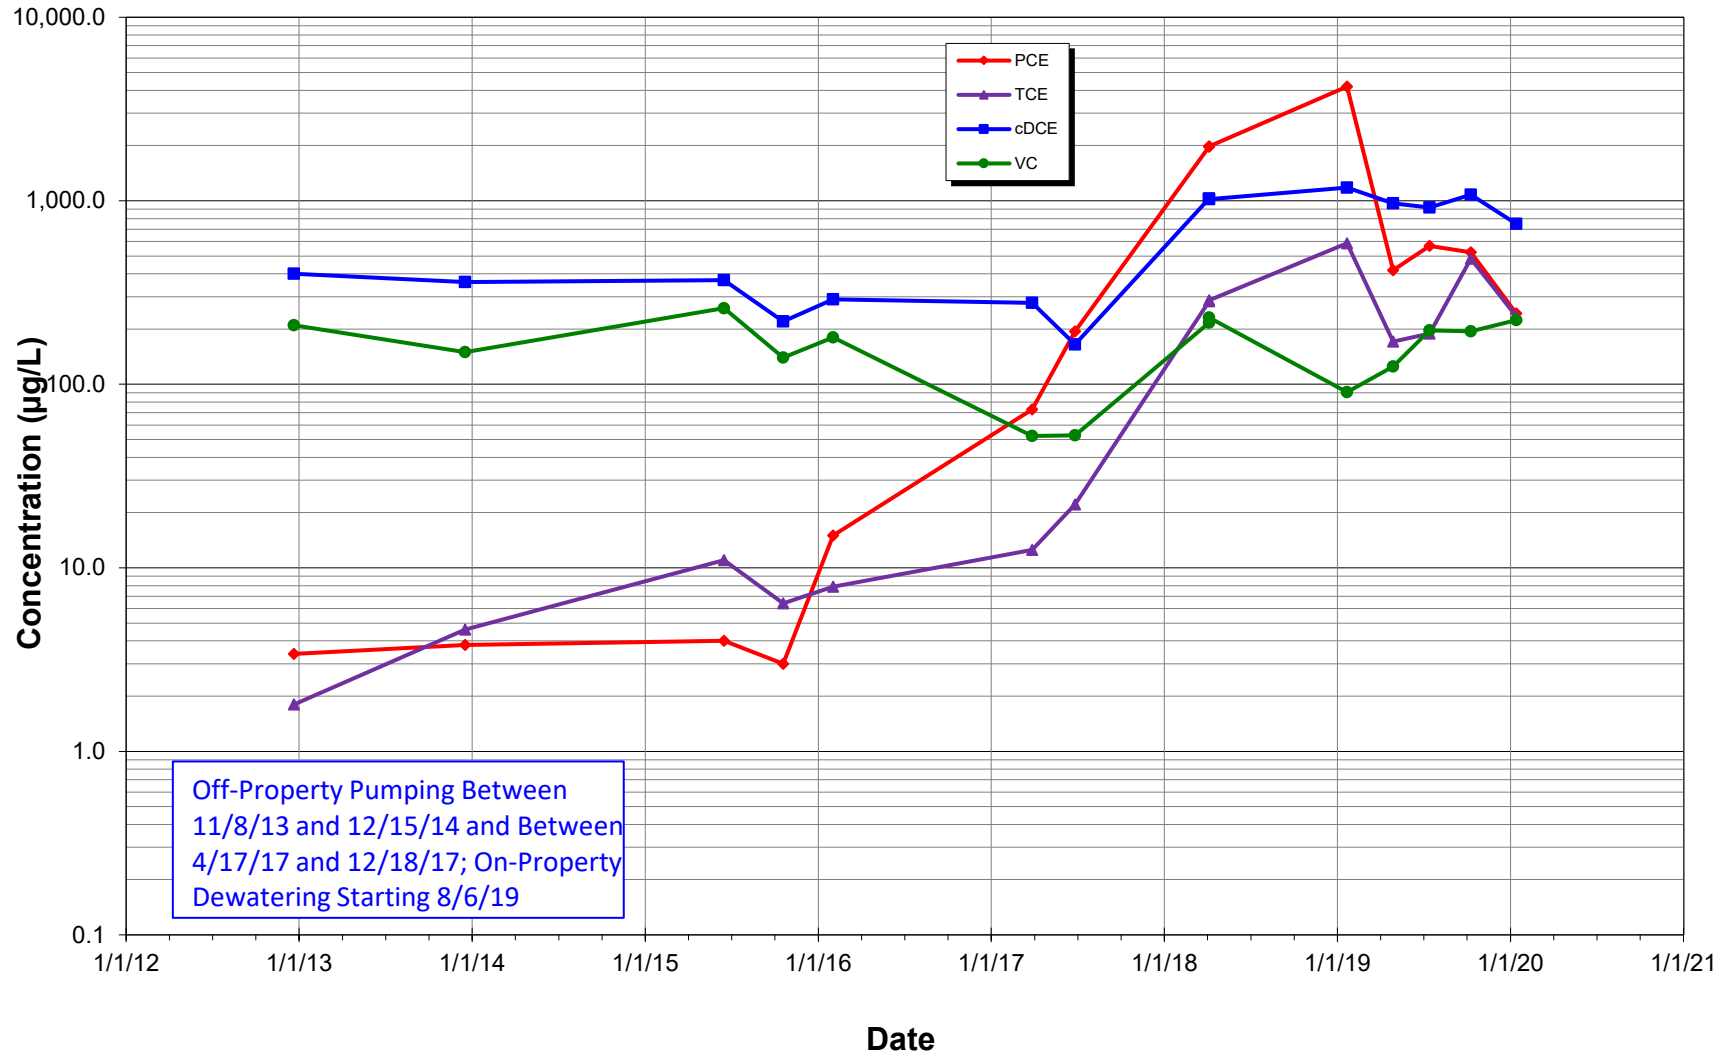

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW109 (0.0 to -10.0), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

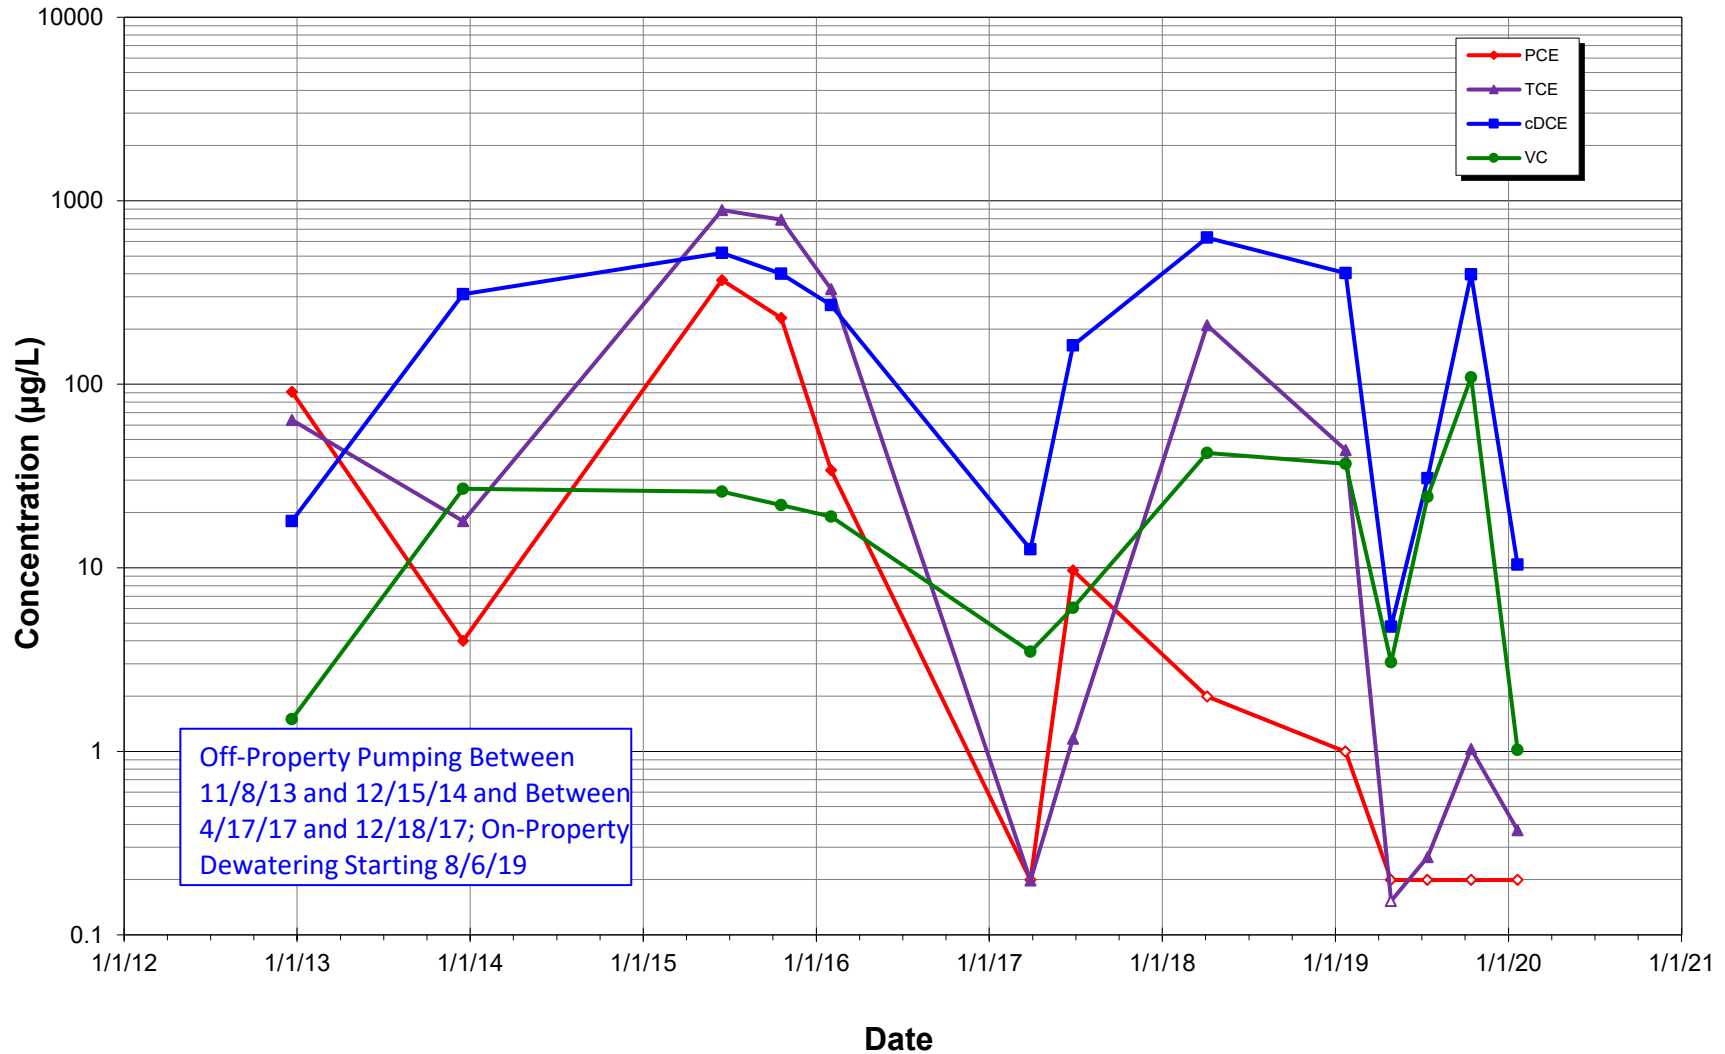


Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW110 (4.7 to -5.3 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co-Dexter Ave Site

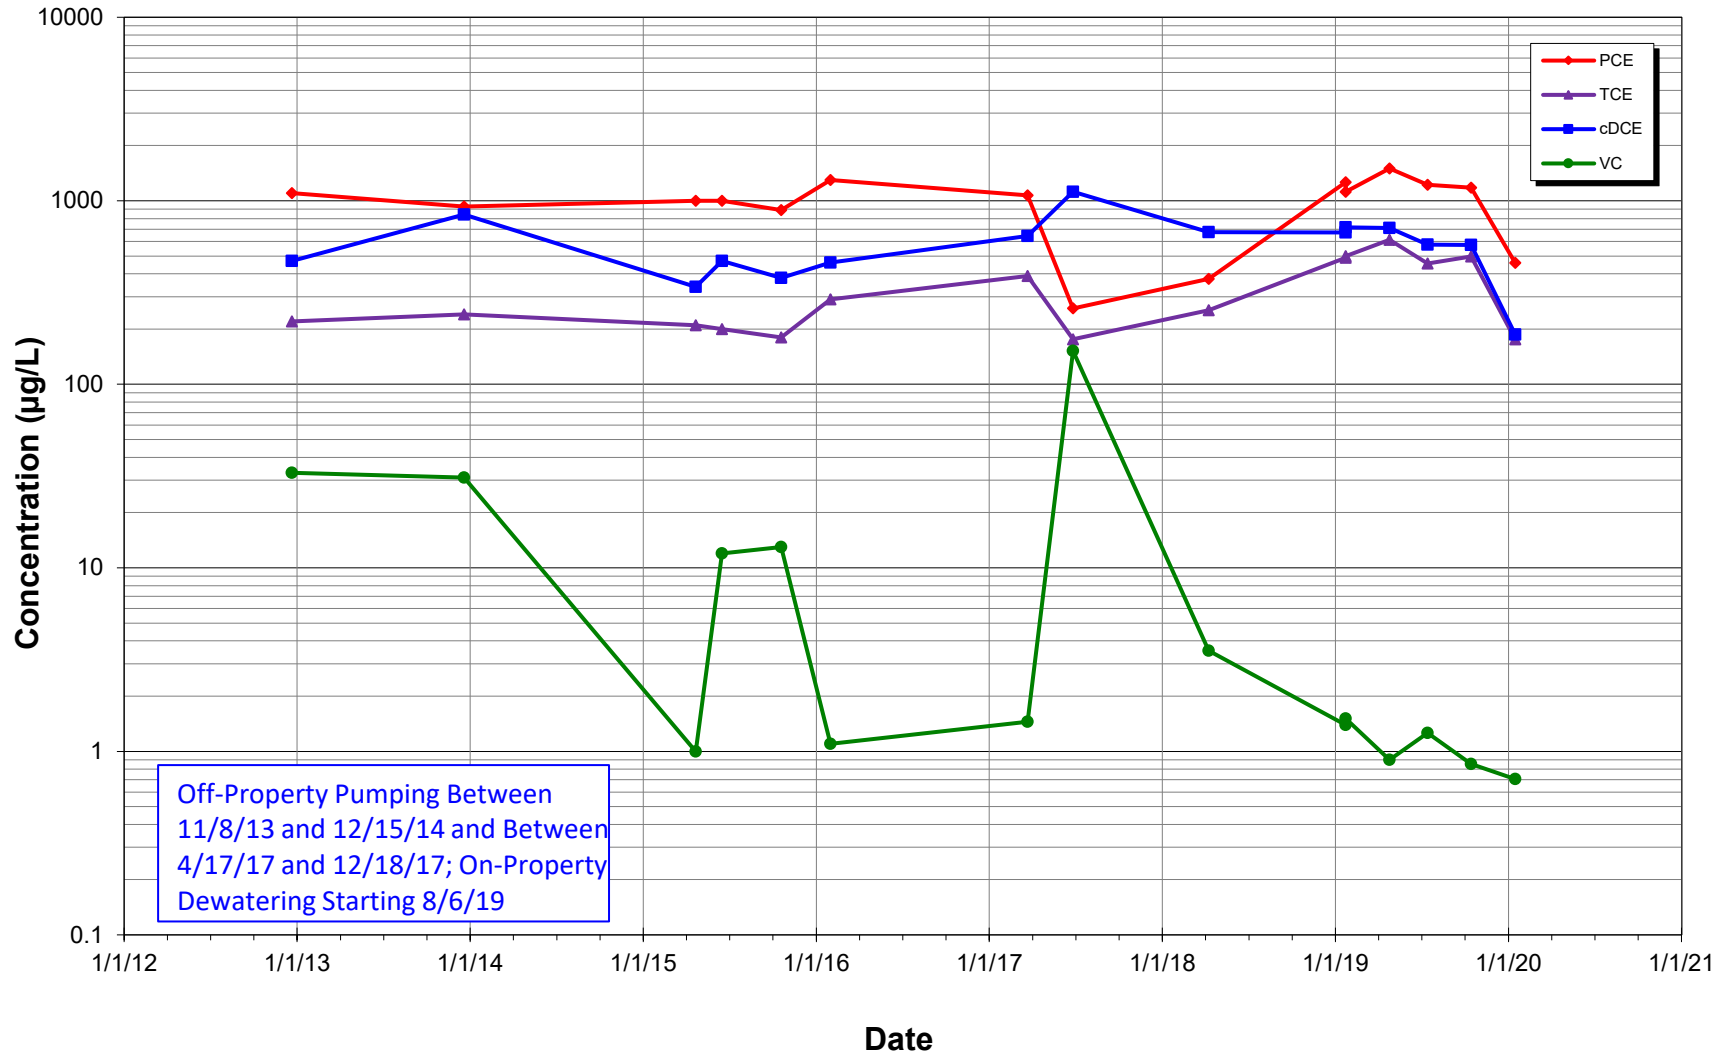


Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW111 (-33.5 to -43.5 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co-Dexter Ave Site

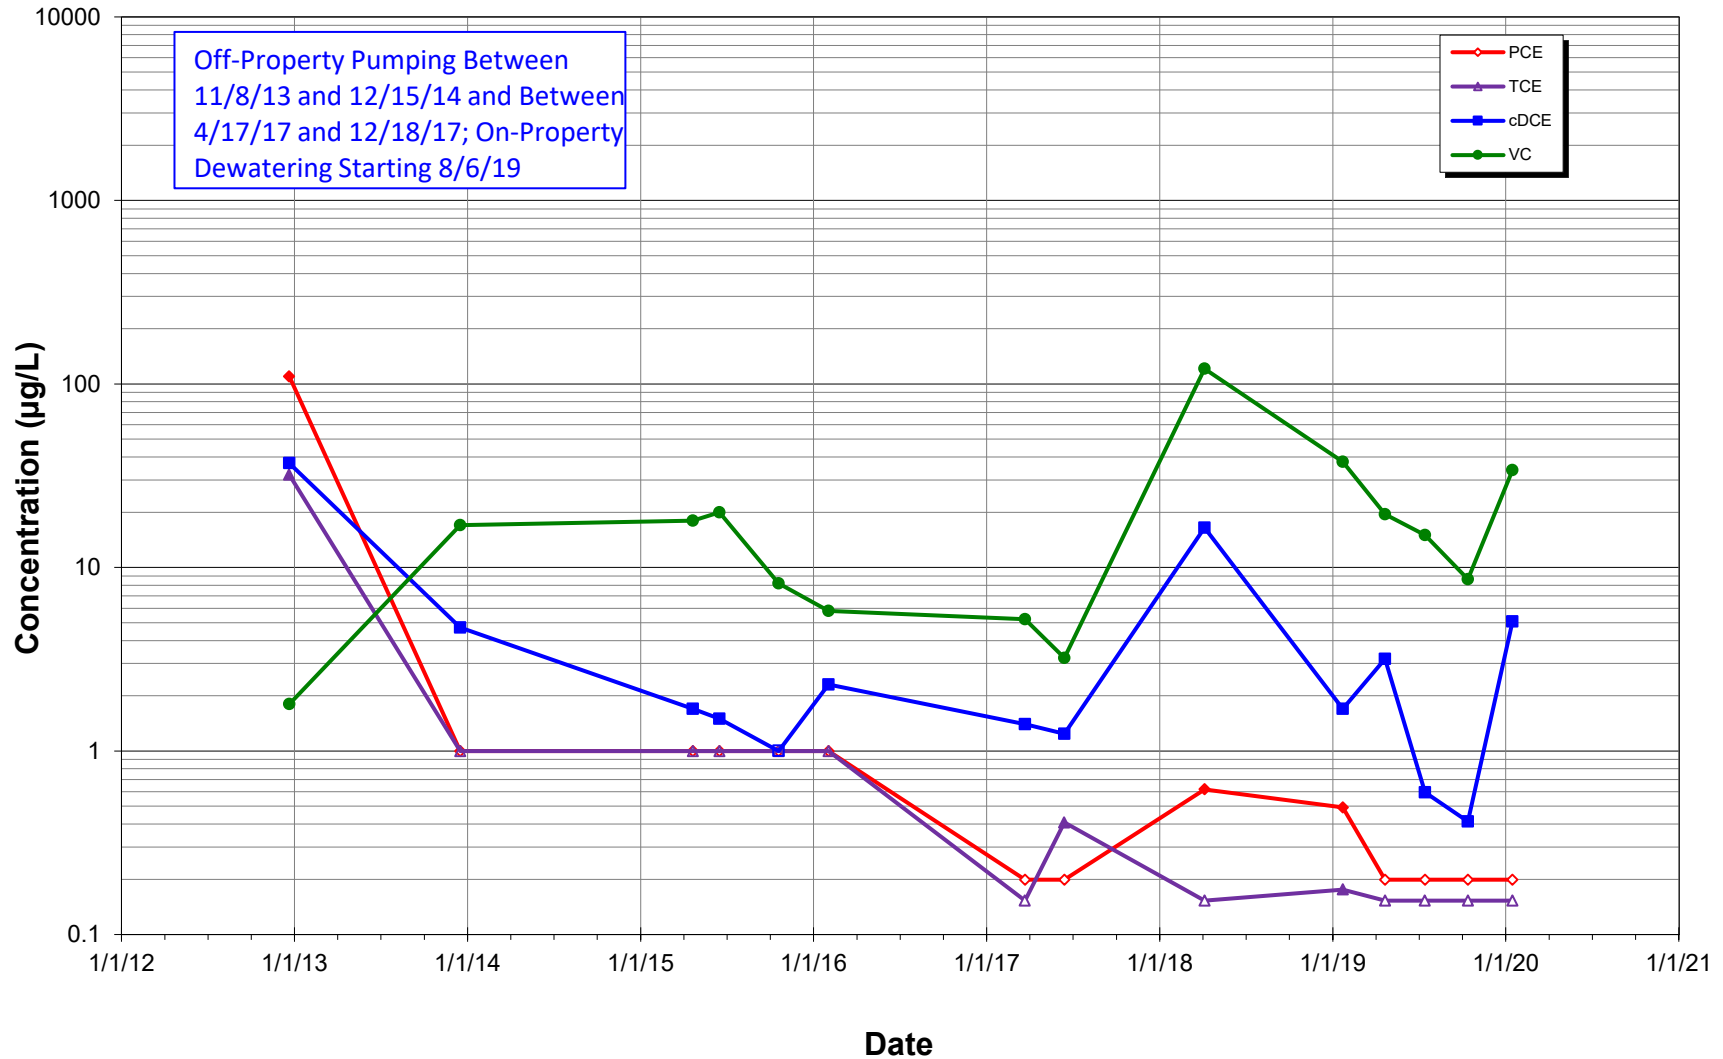

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW112 (-17.3 to -27.3 feet NAVD), Dexter Avenue
American Linen Supply Co–Dexter Ave Site

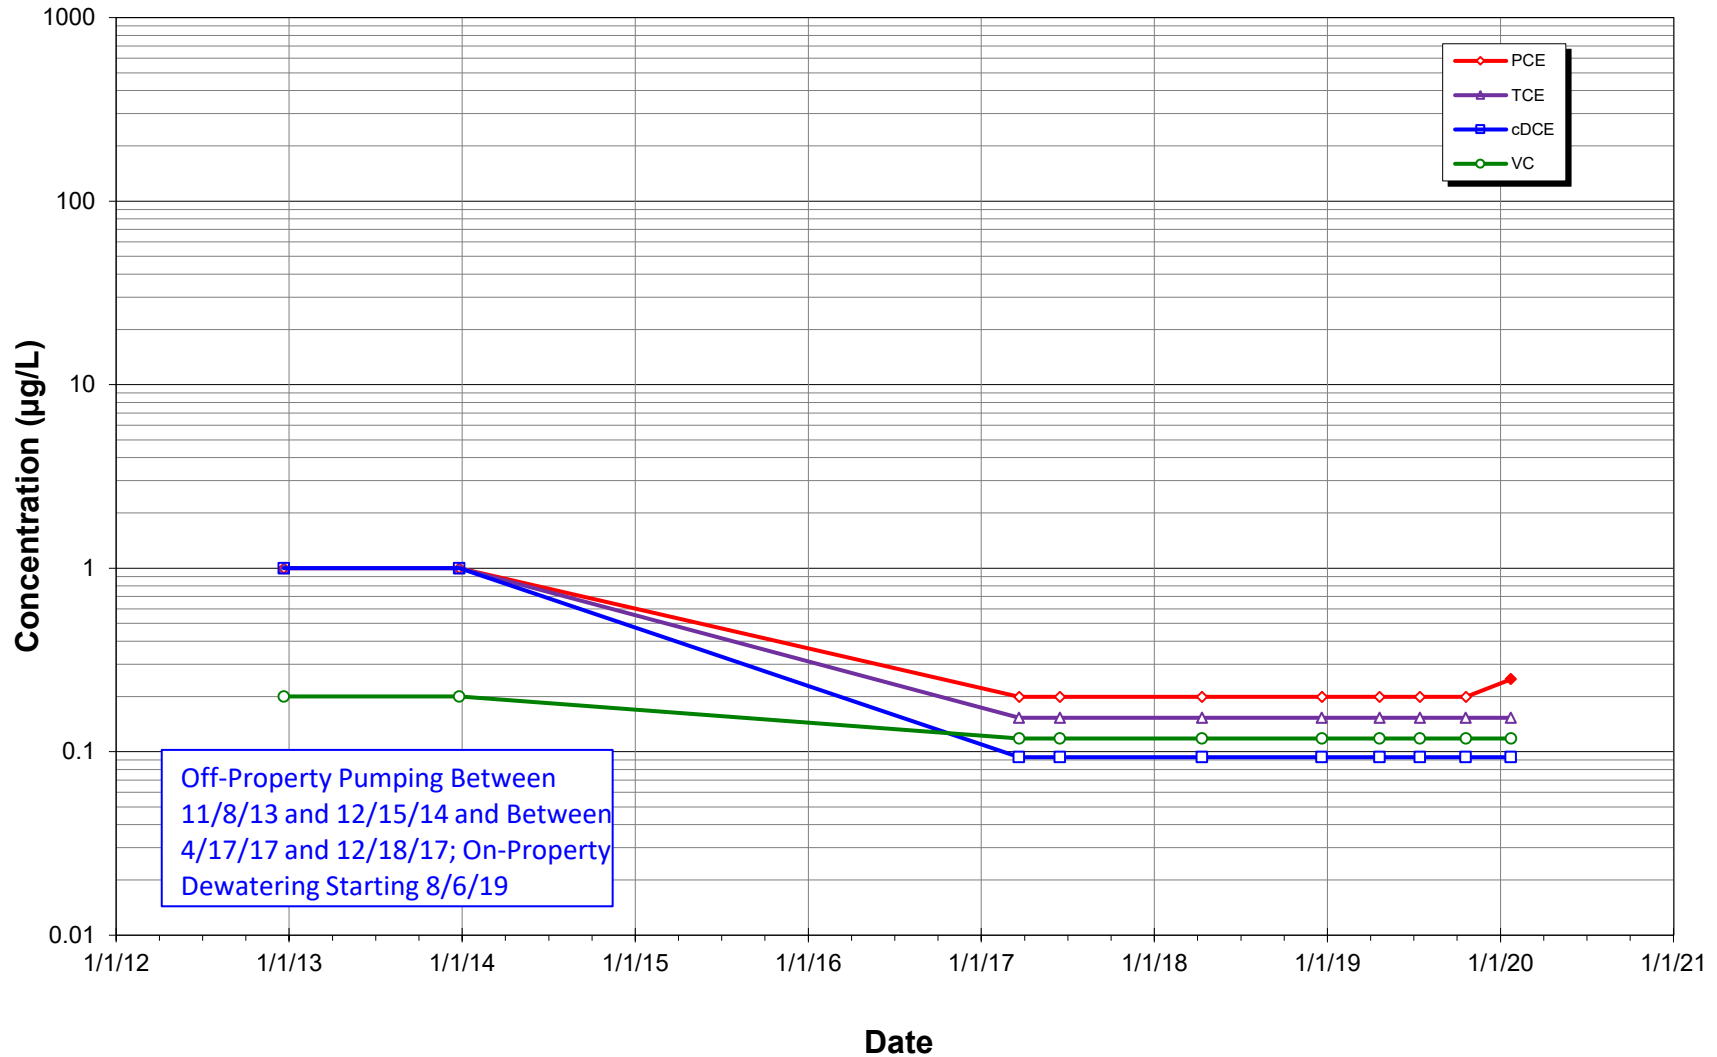

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW115 (-0.6 to -10.6 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site

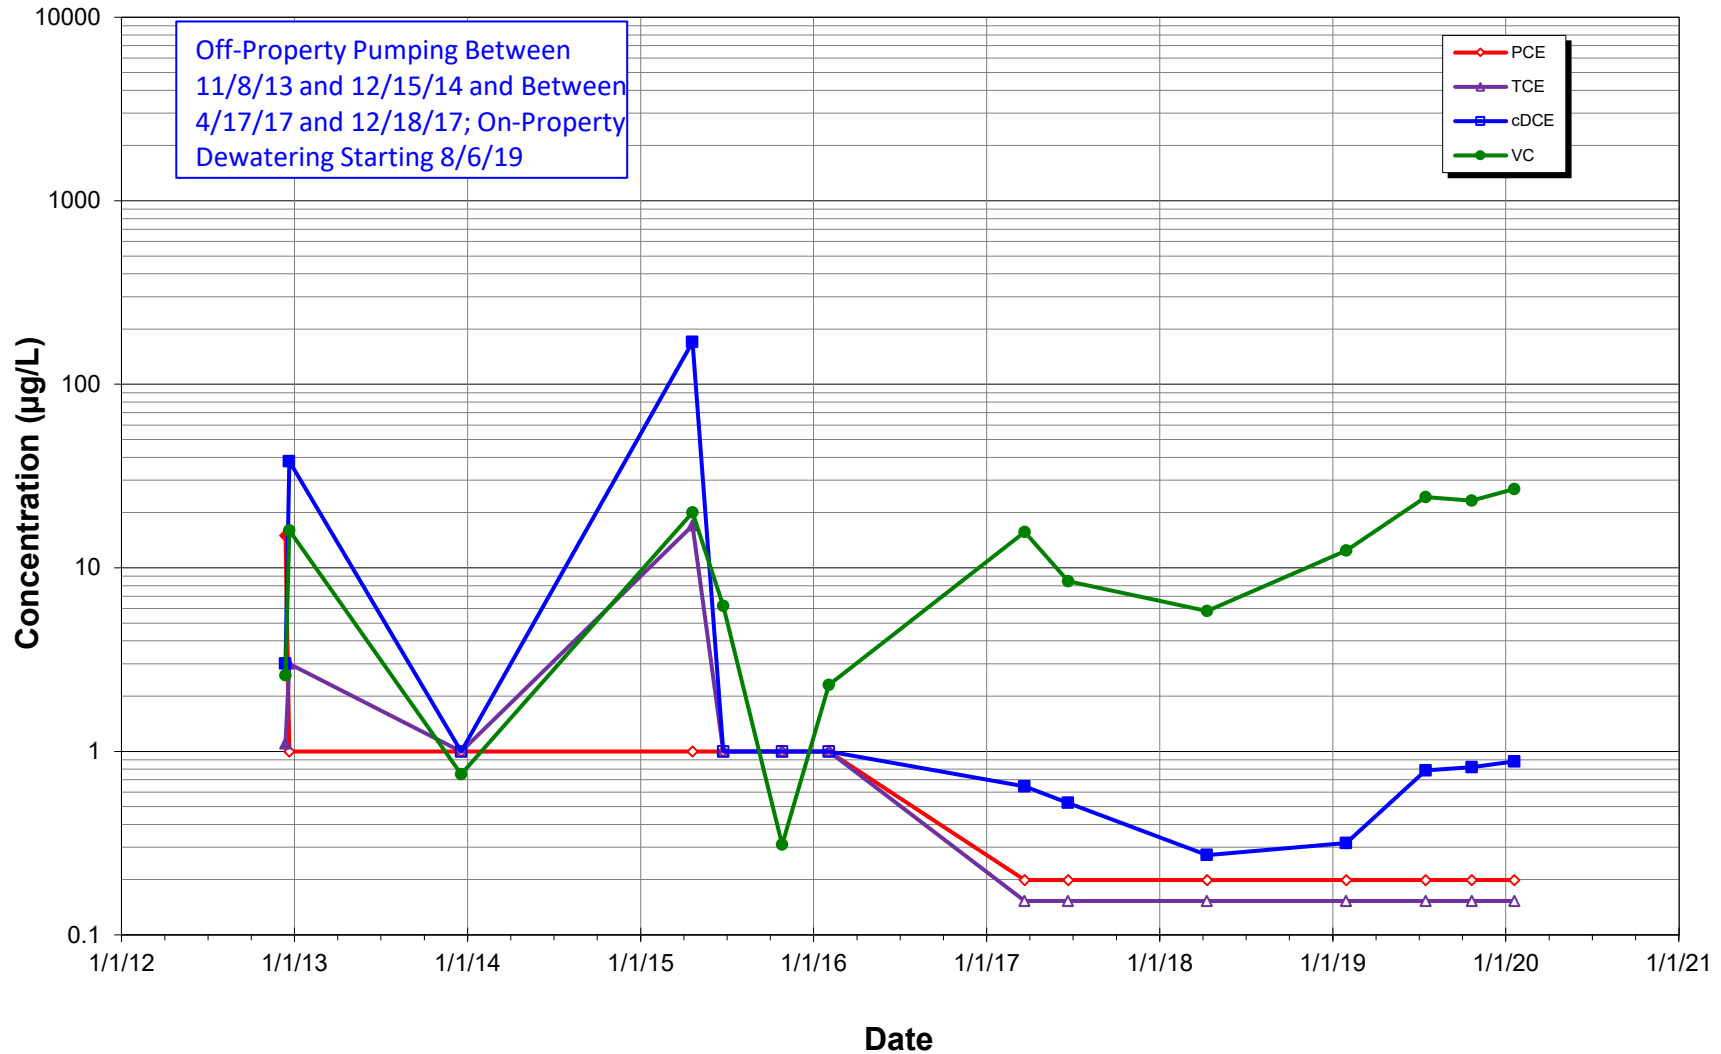

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW116 (-3.1 to -13.1 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site

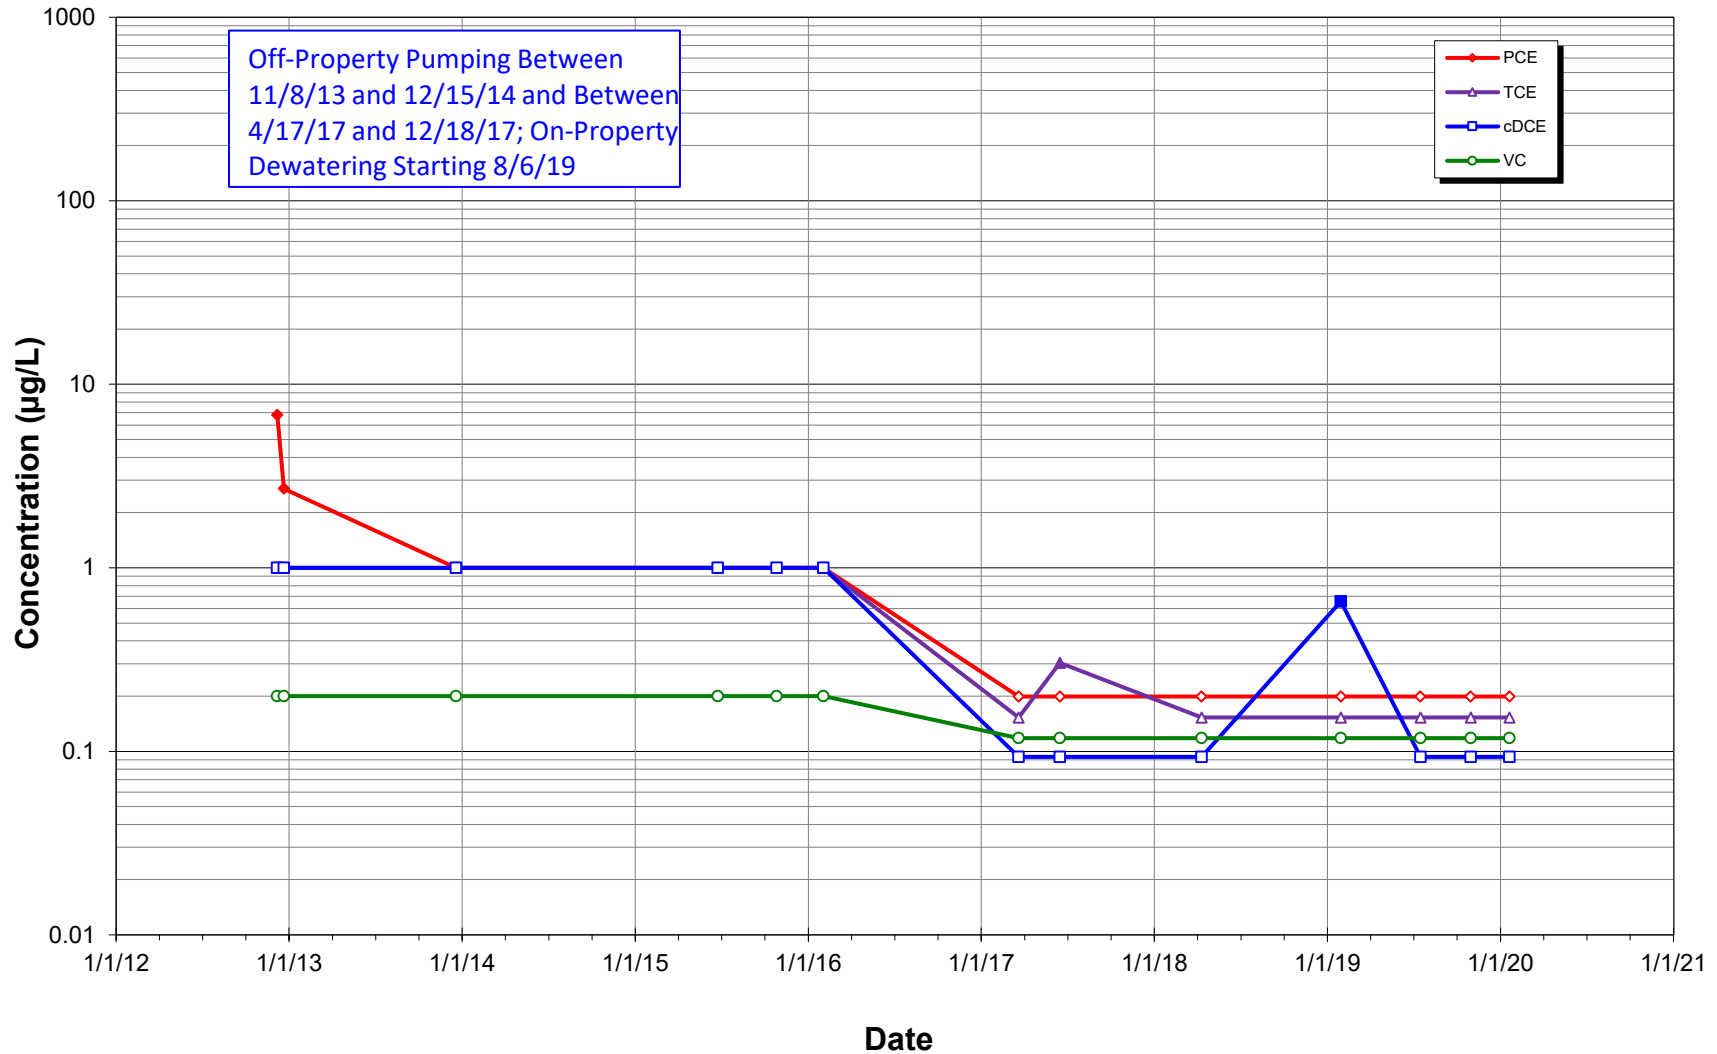

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW119 (2.7 to -7.3 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site**

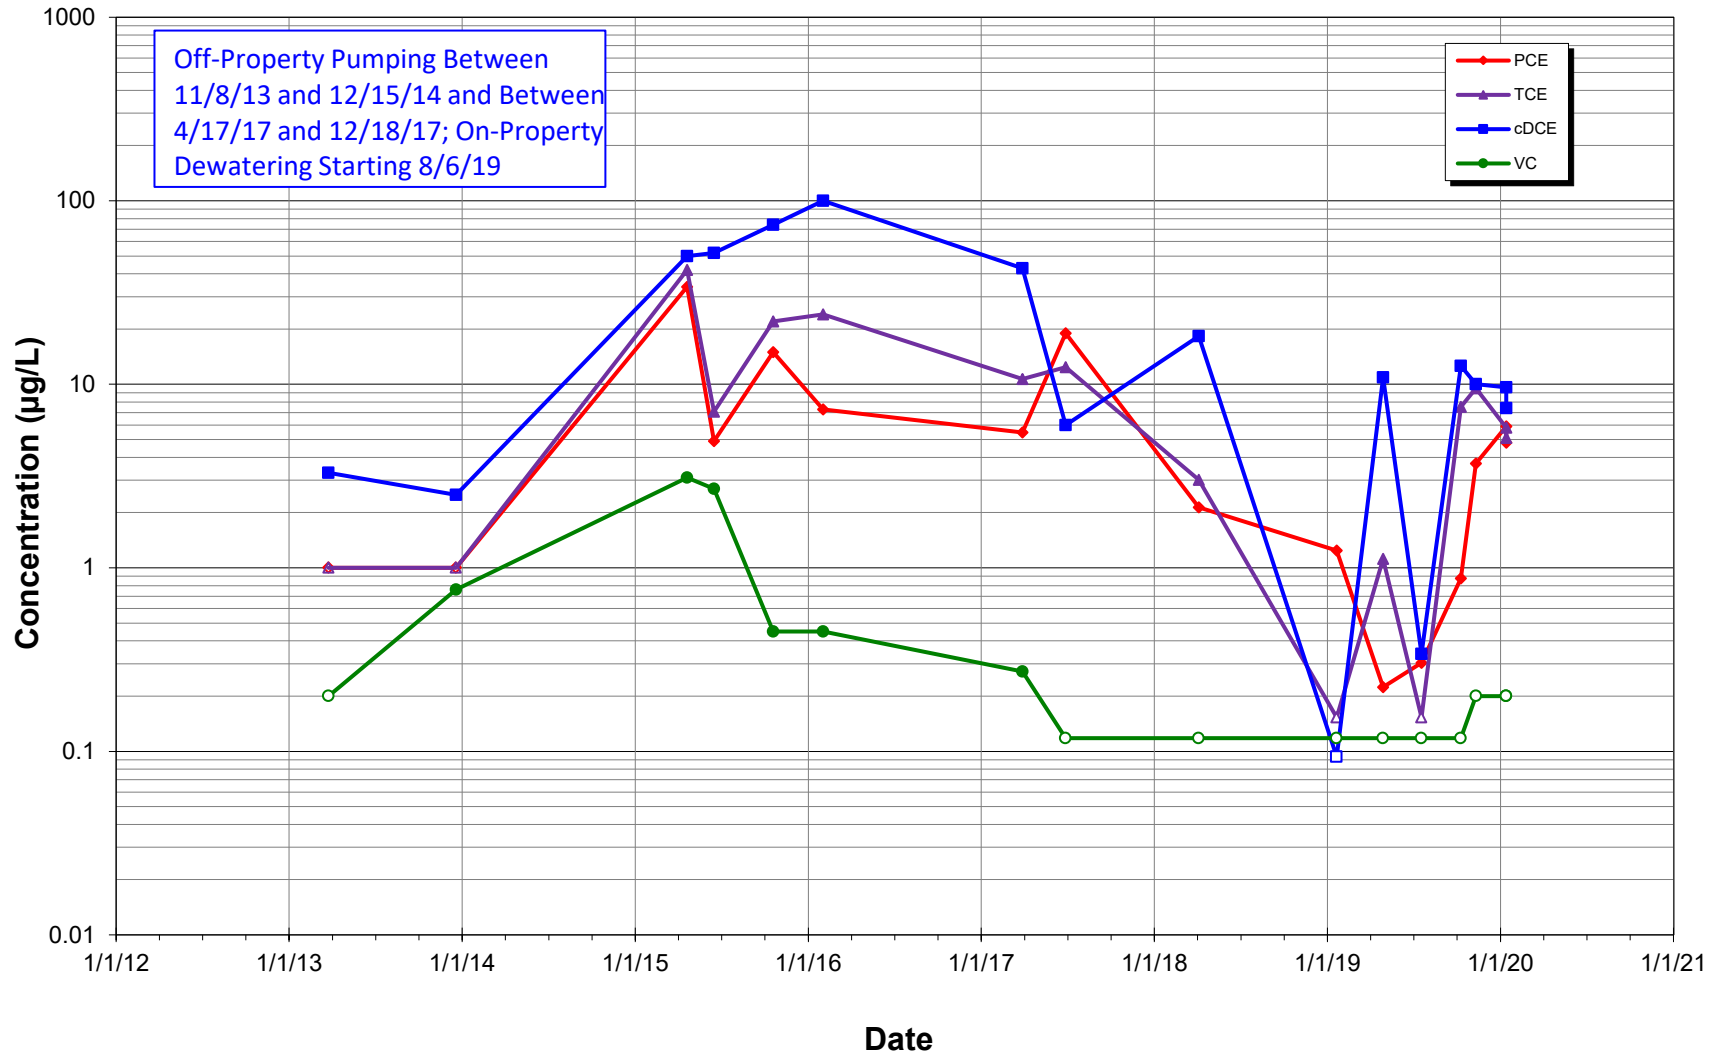

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW120 (0.0 to -10.0 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

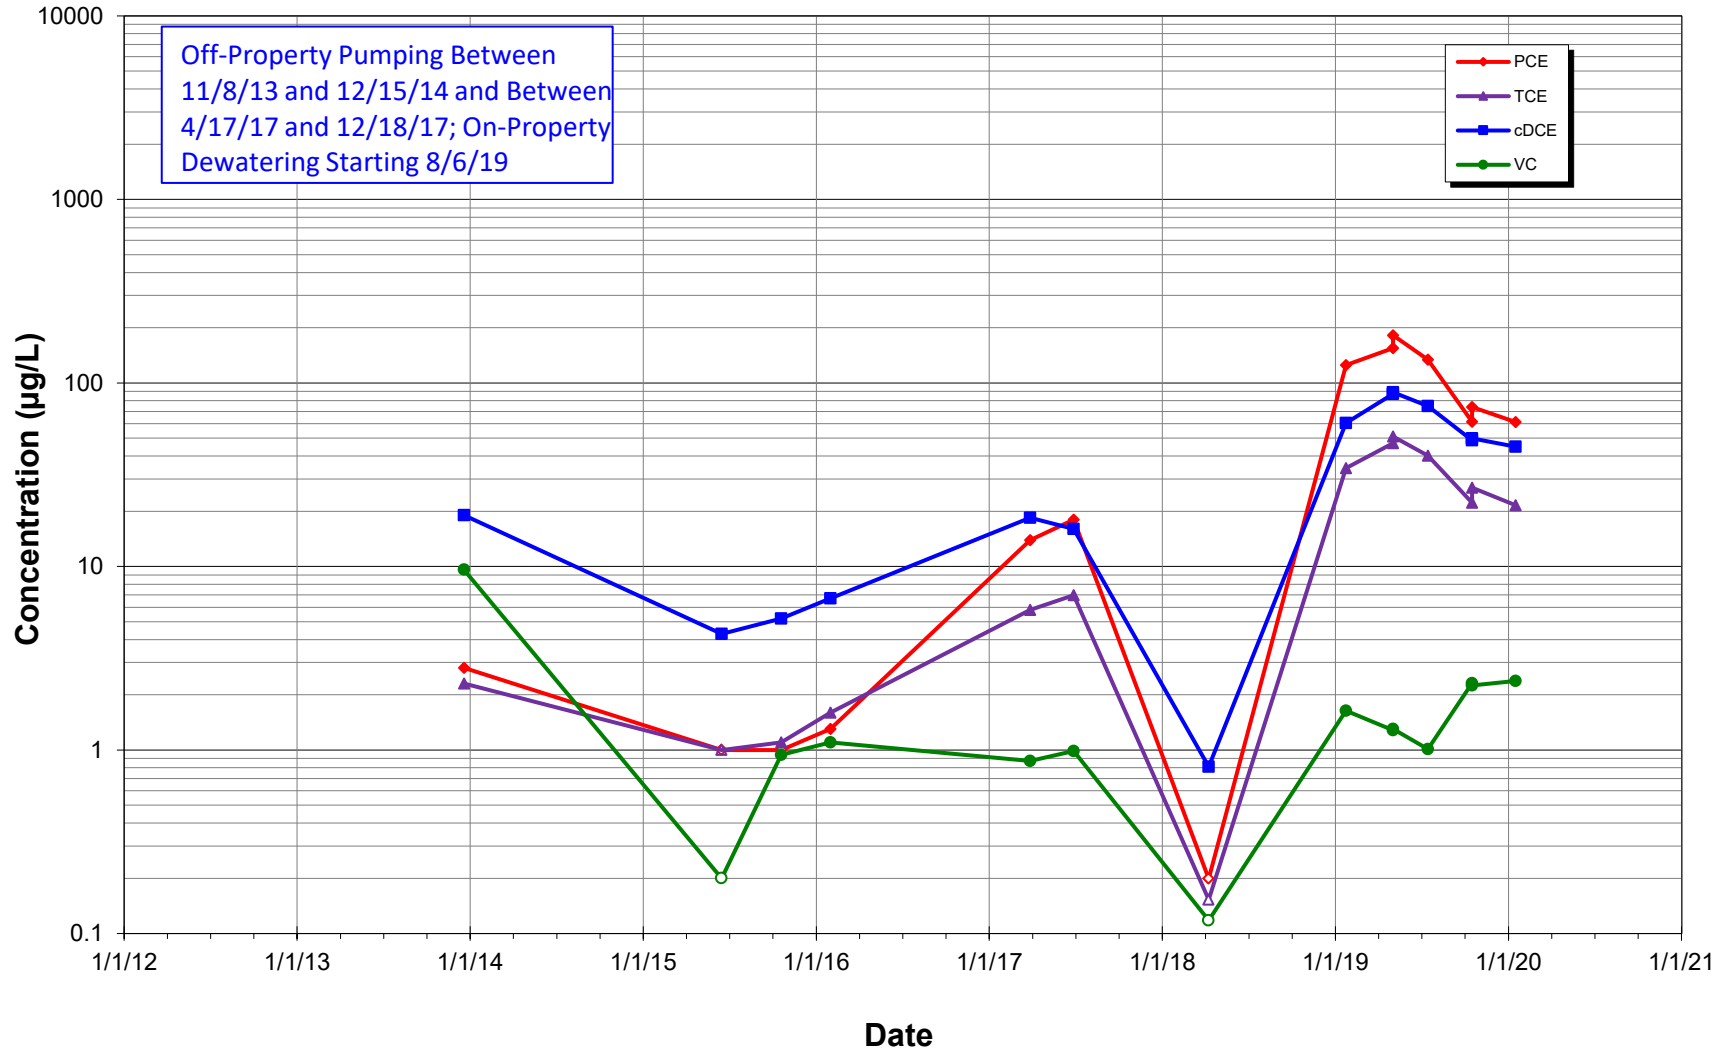

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW126 (-54.1 to -64.1 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

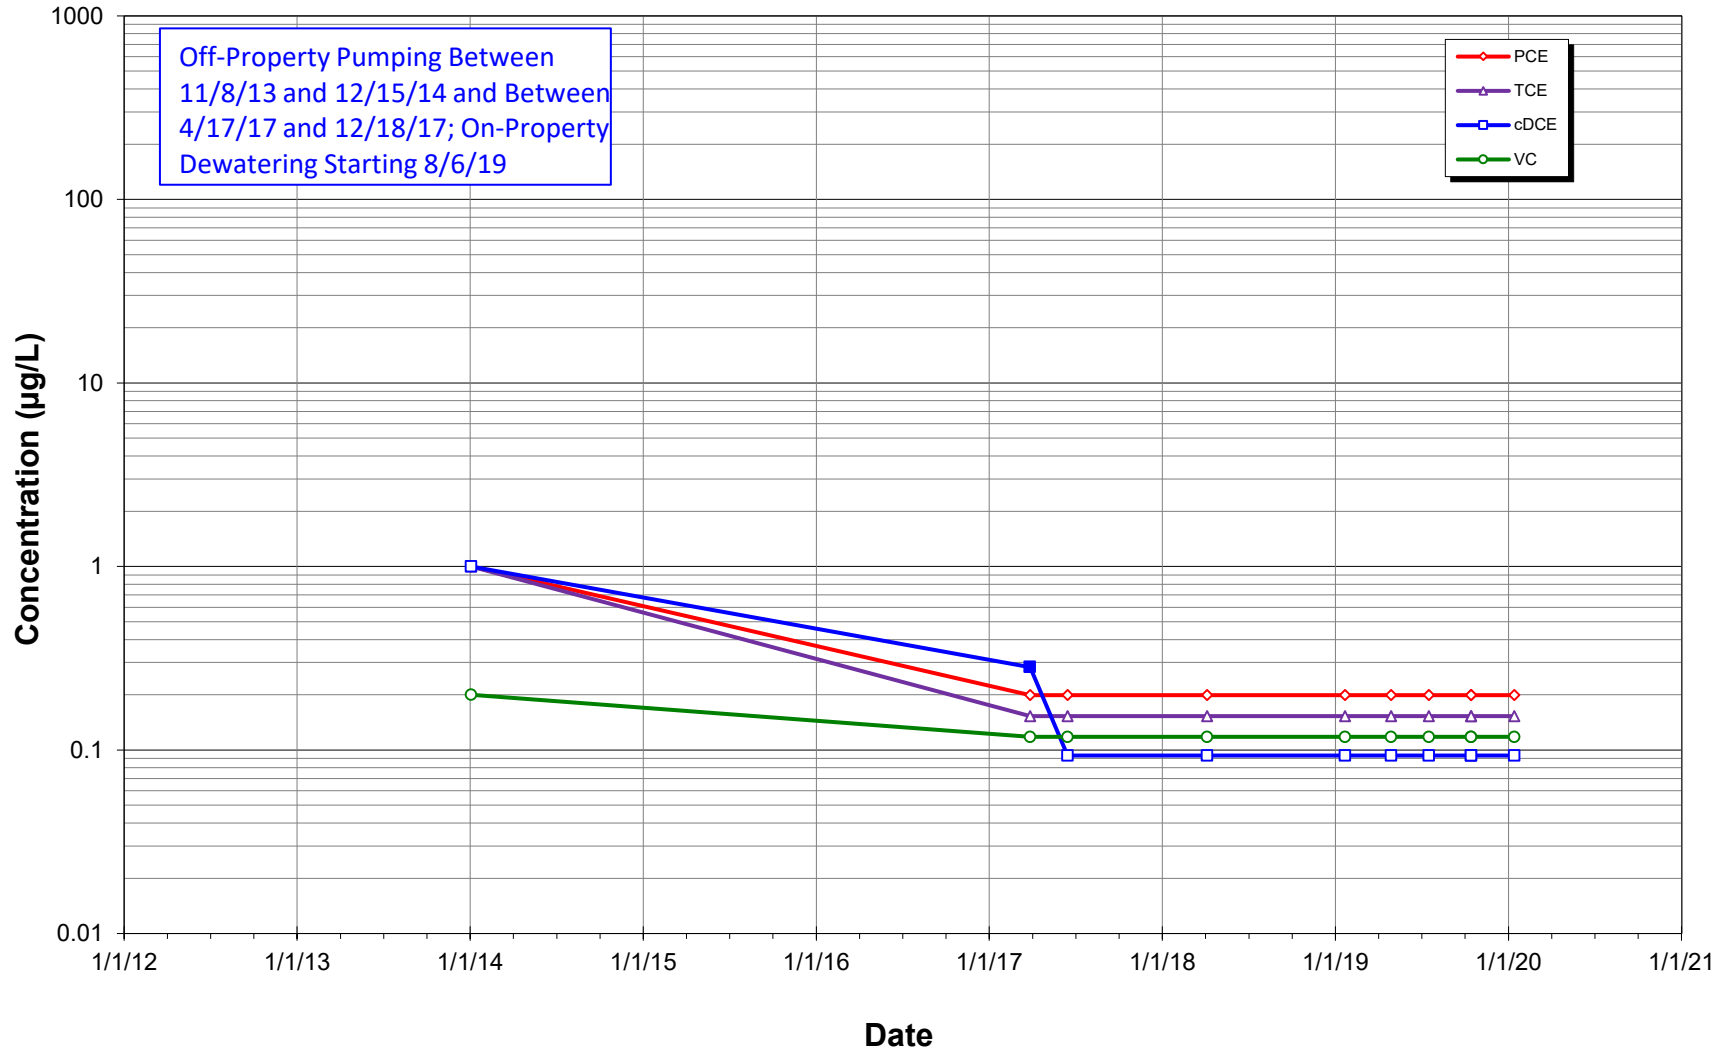

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW127 (-1.0 to -11.0 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

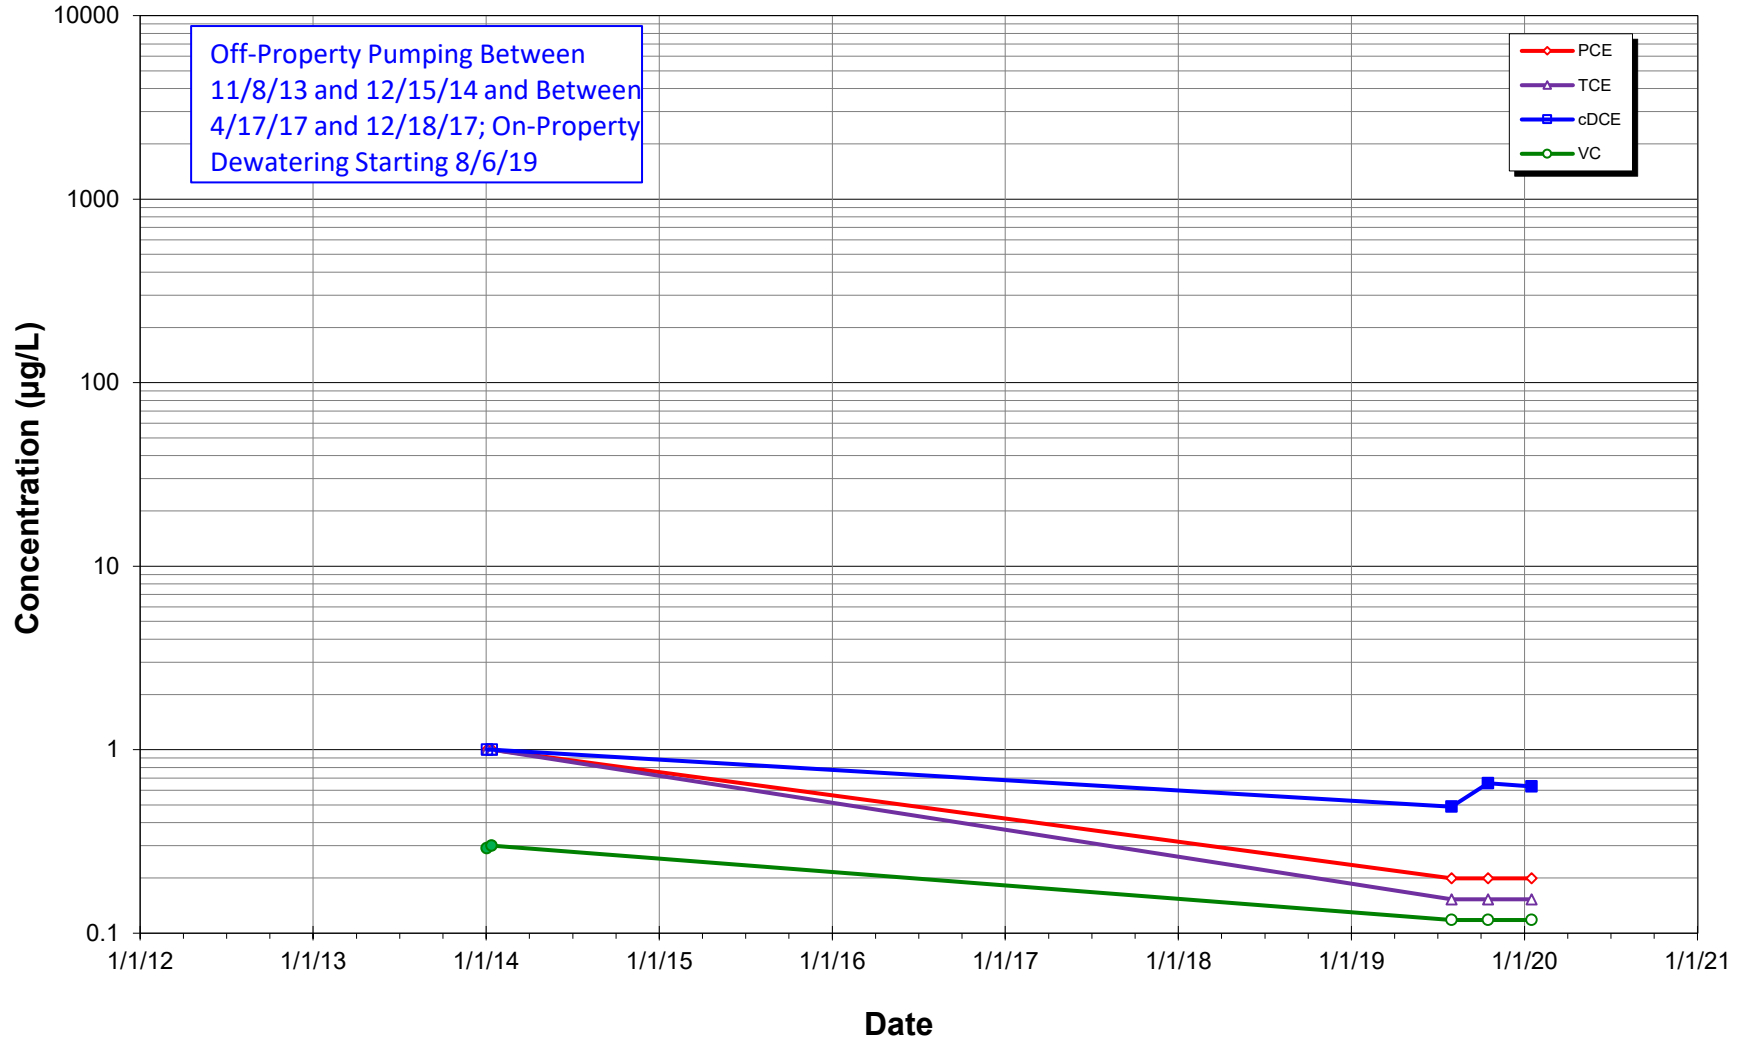

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-142 (2.4 to -7.6 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

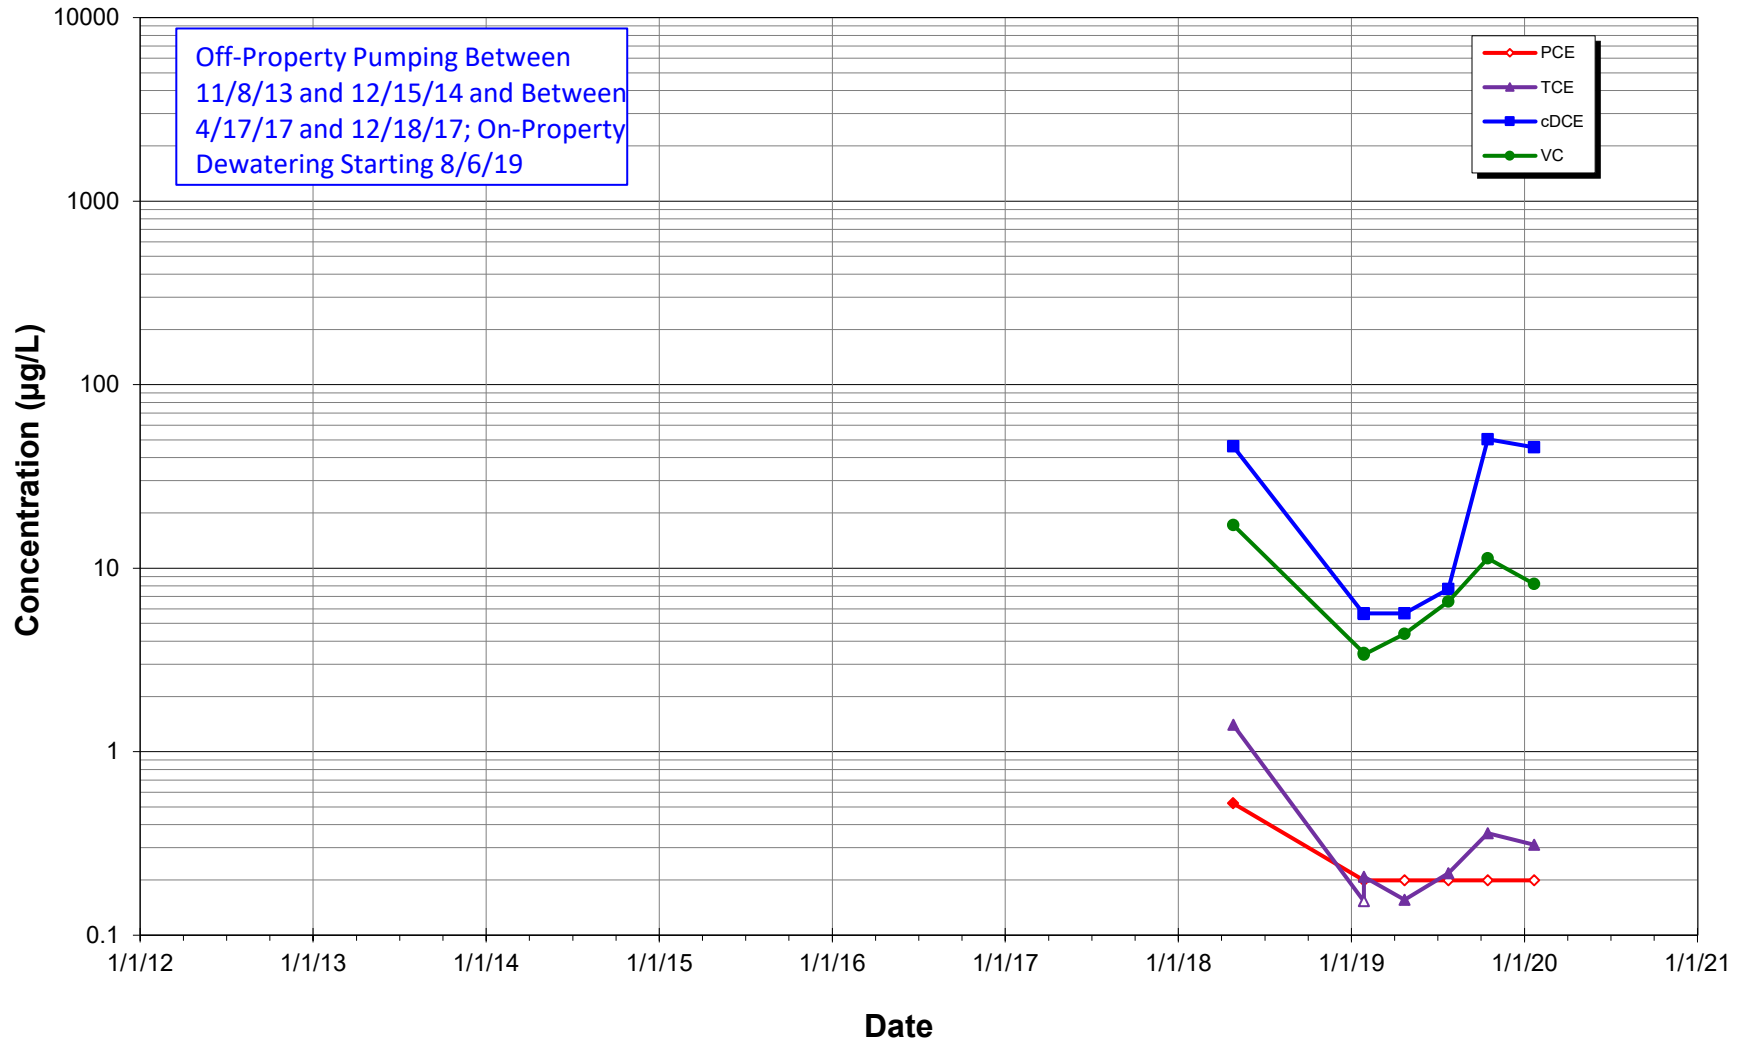

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-143 (-27.7 to -37.6 feet NAVD), 8th Avenue North
American Linen Supply Co-Dexter Ave Site

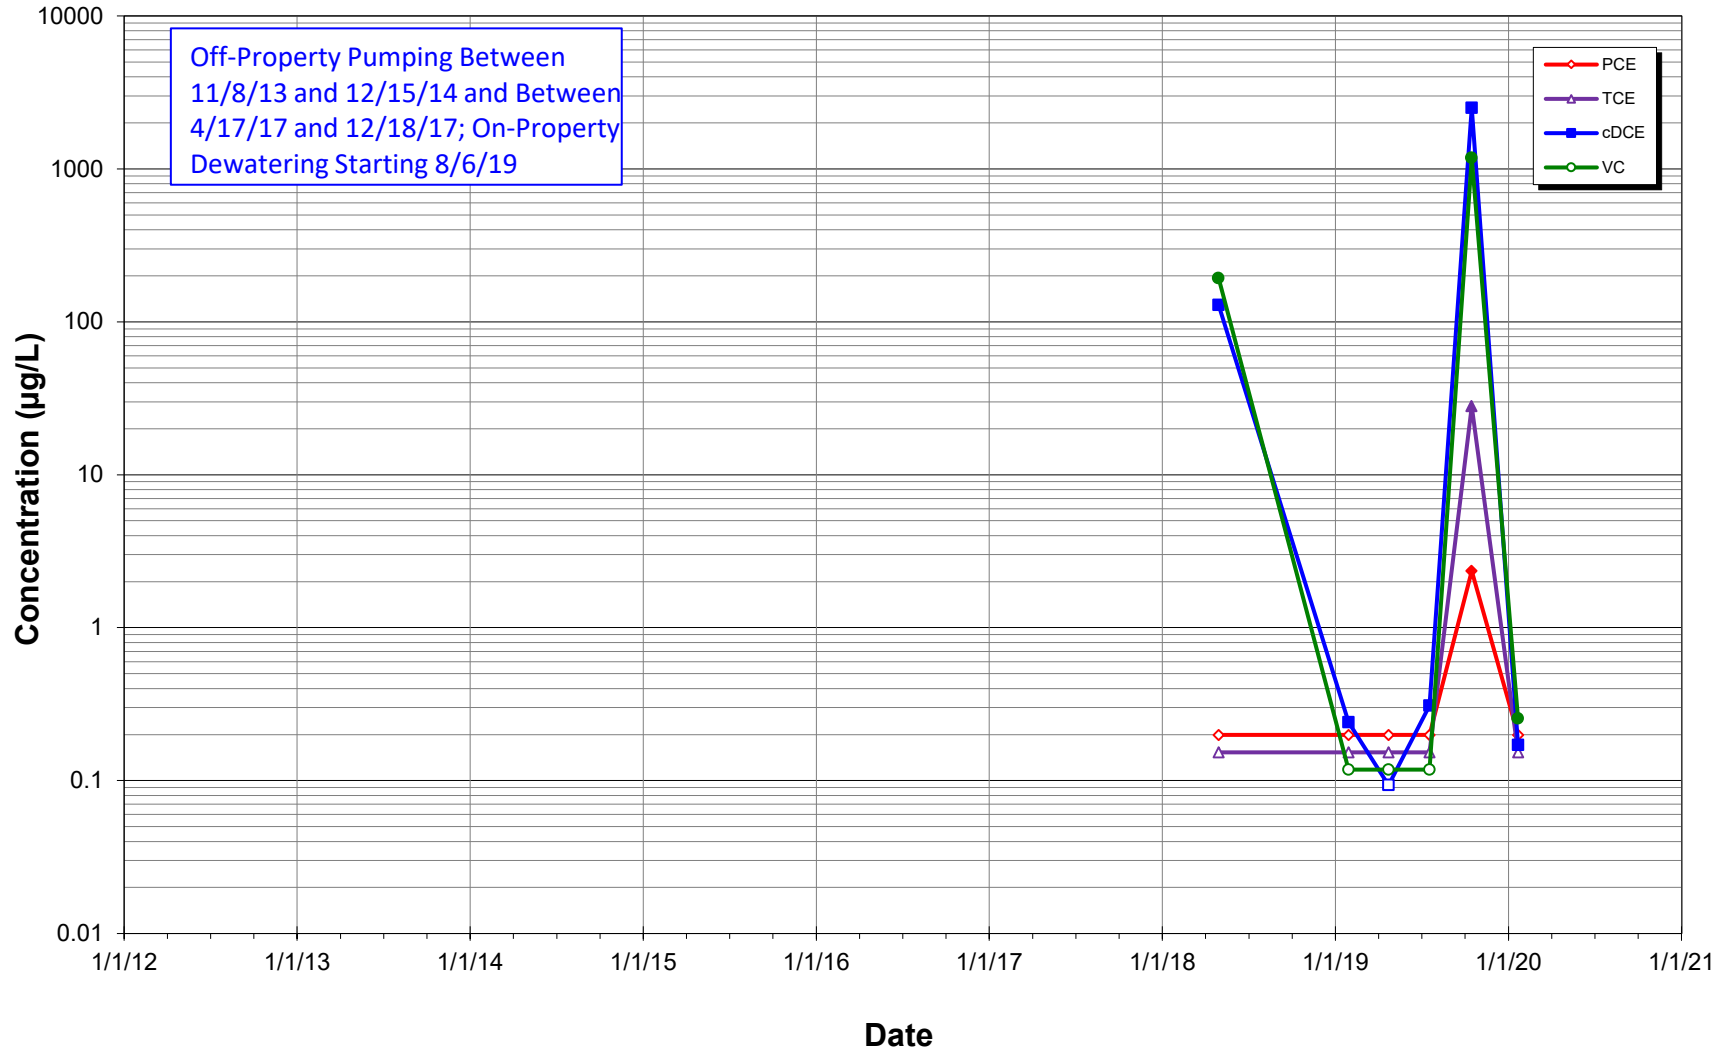

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-144R (2.8 to -7.3) feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

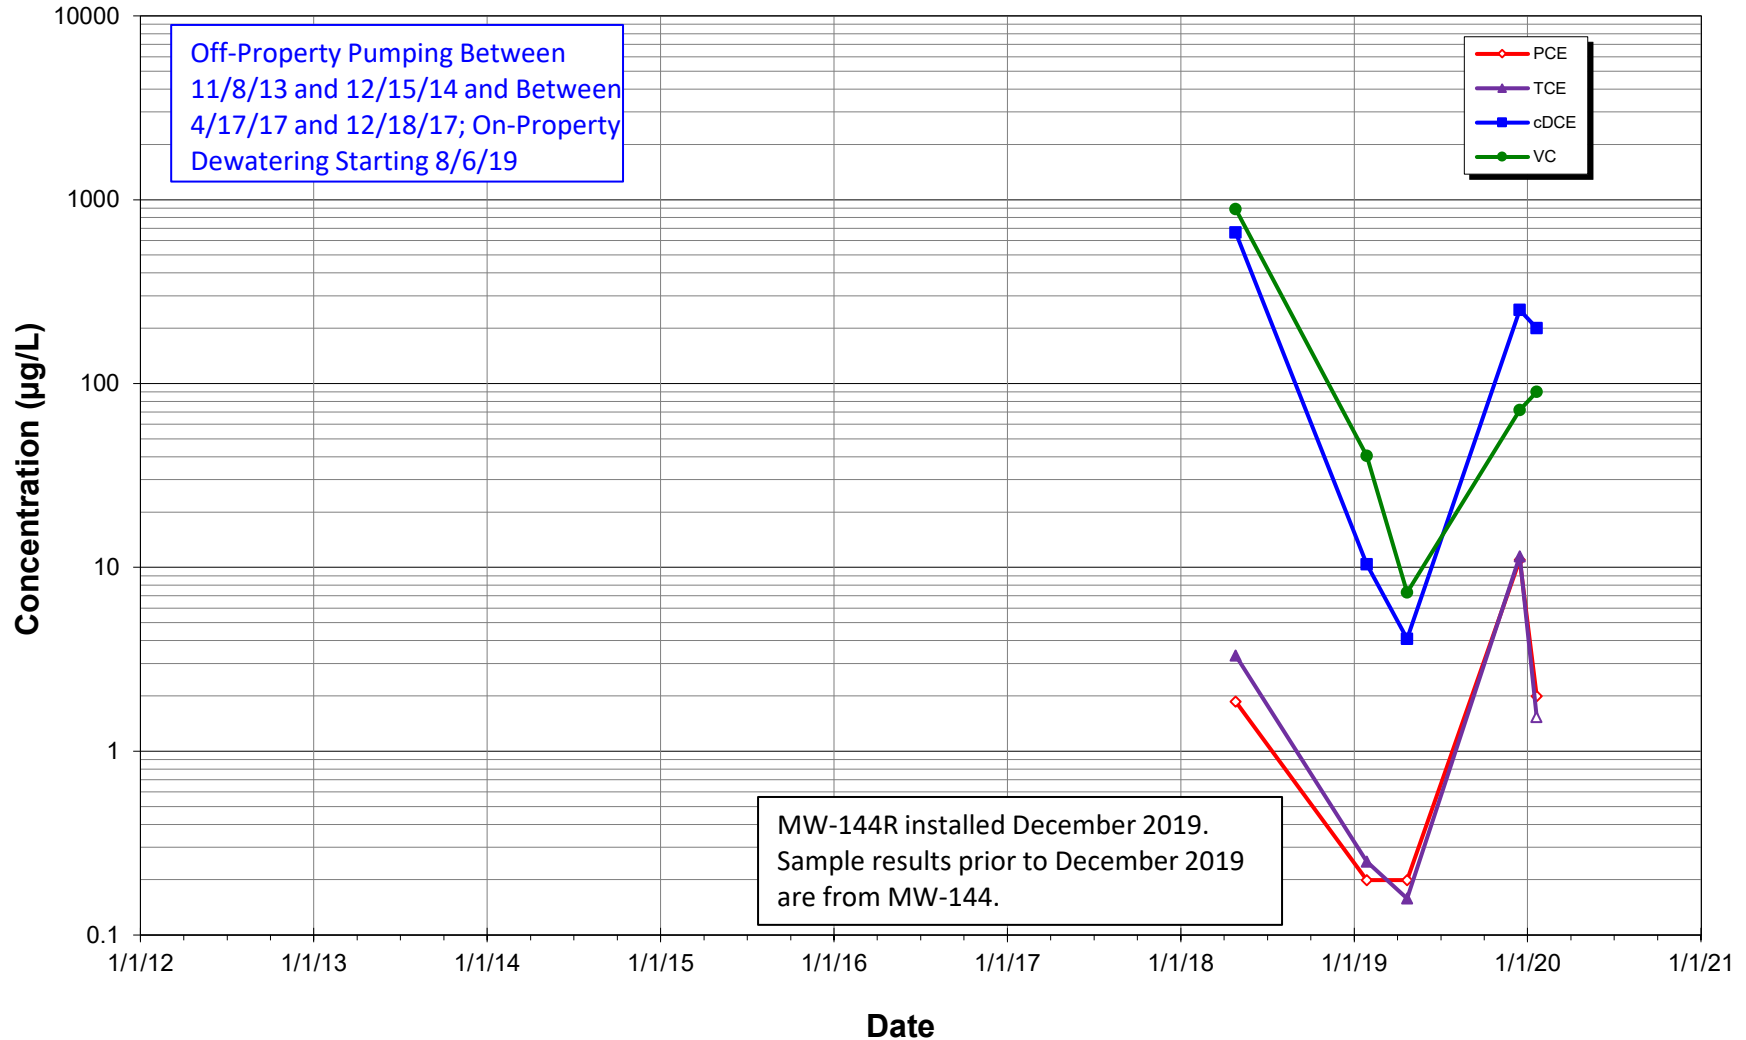

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-145R (-27.5 to -37.5 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

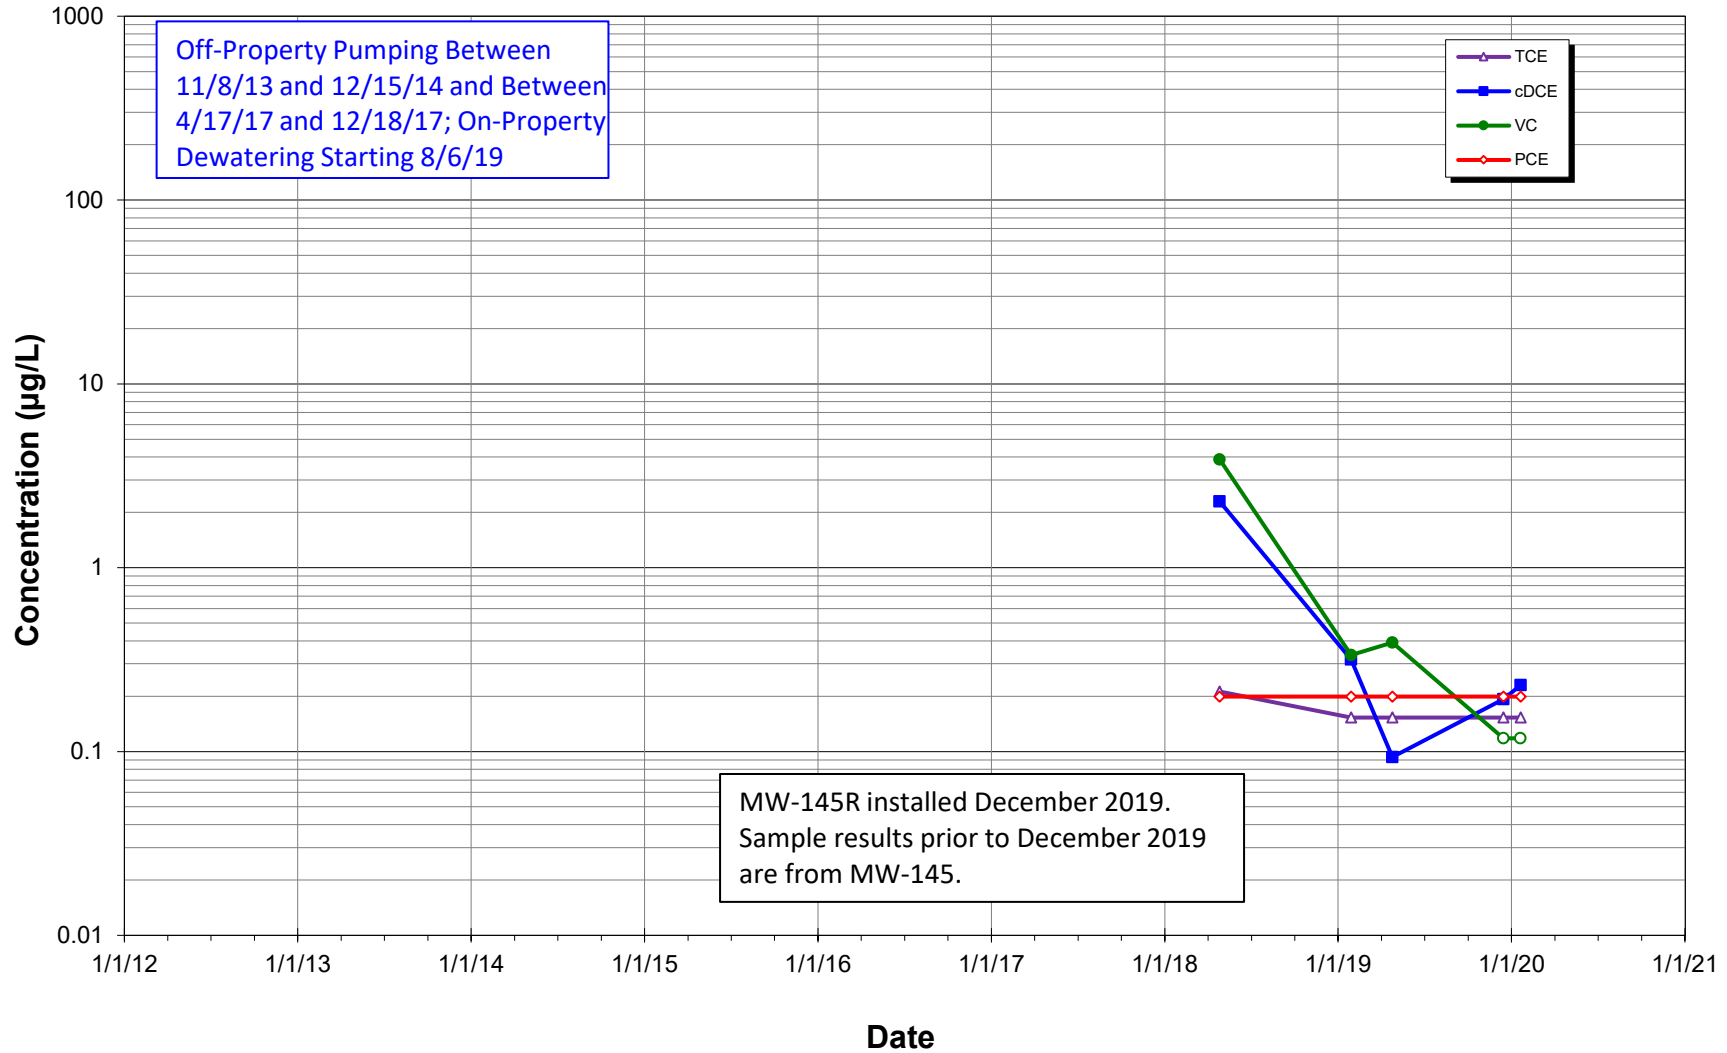

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-146 (12.9 to 2.9 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

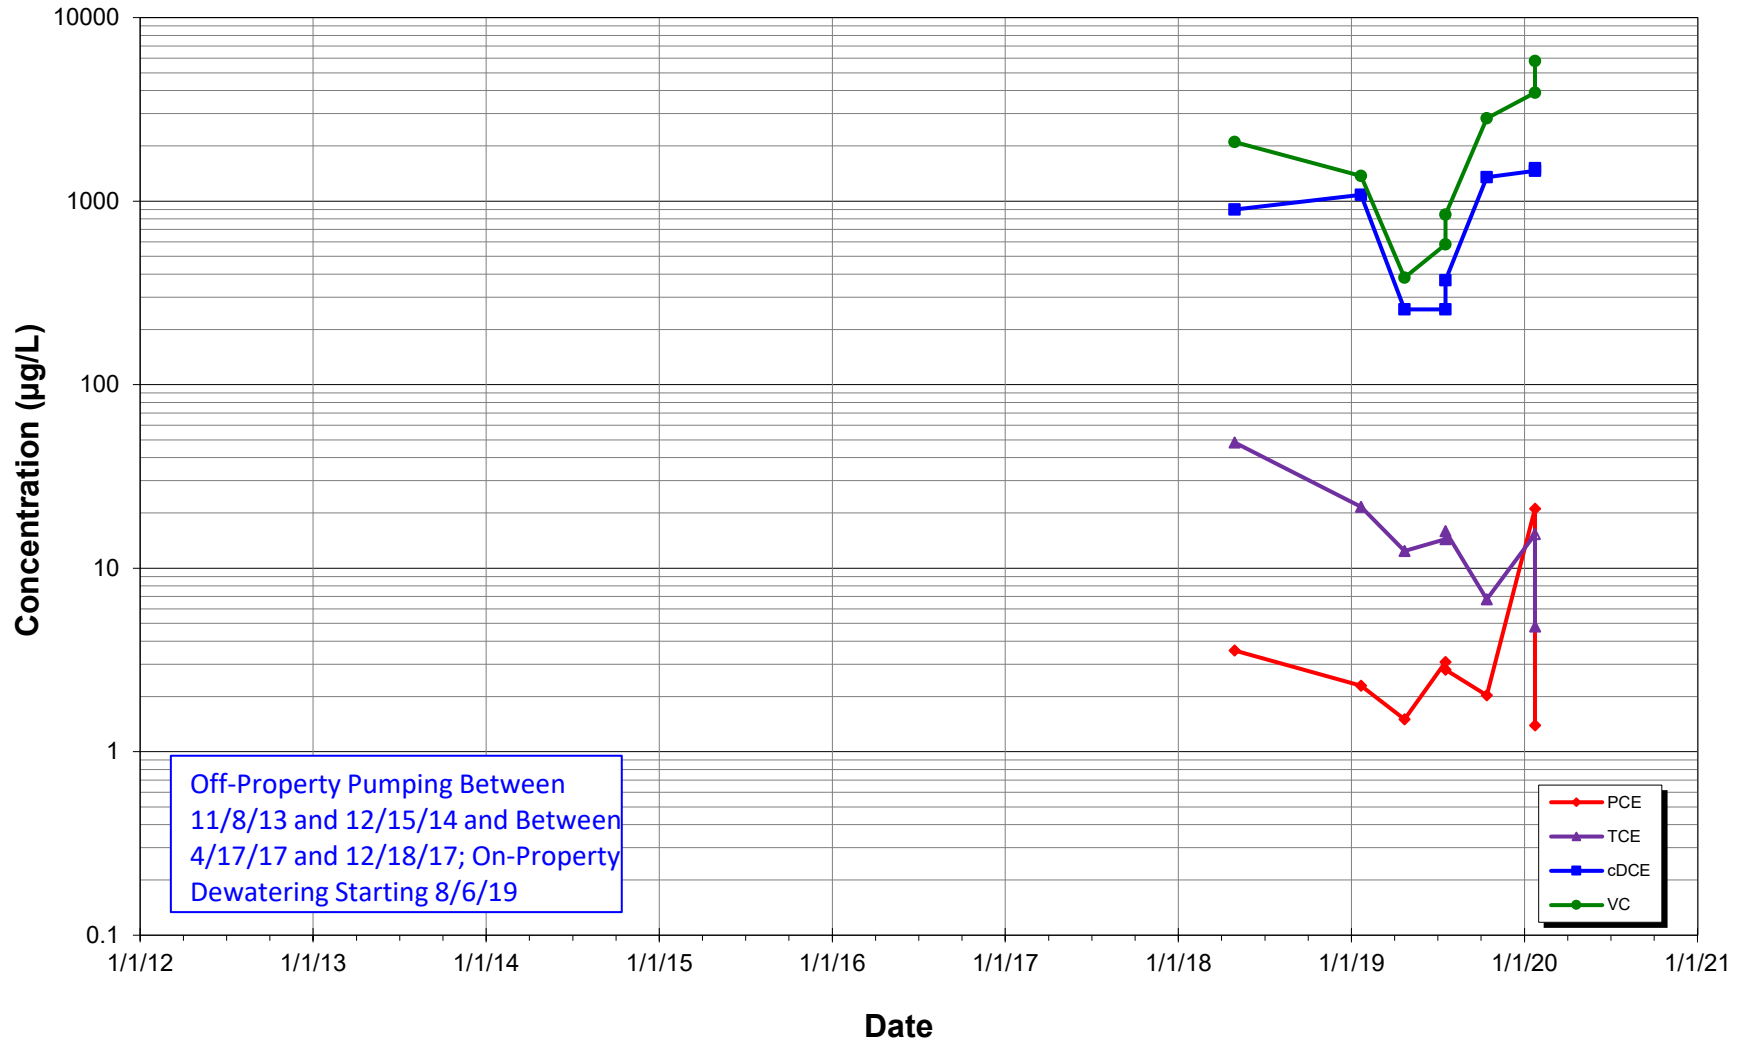

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-147 (-17.6 to -27.6 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

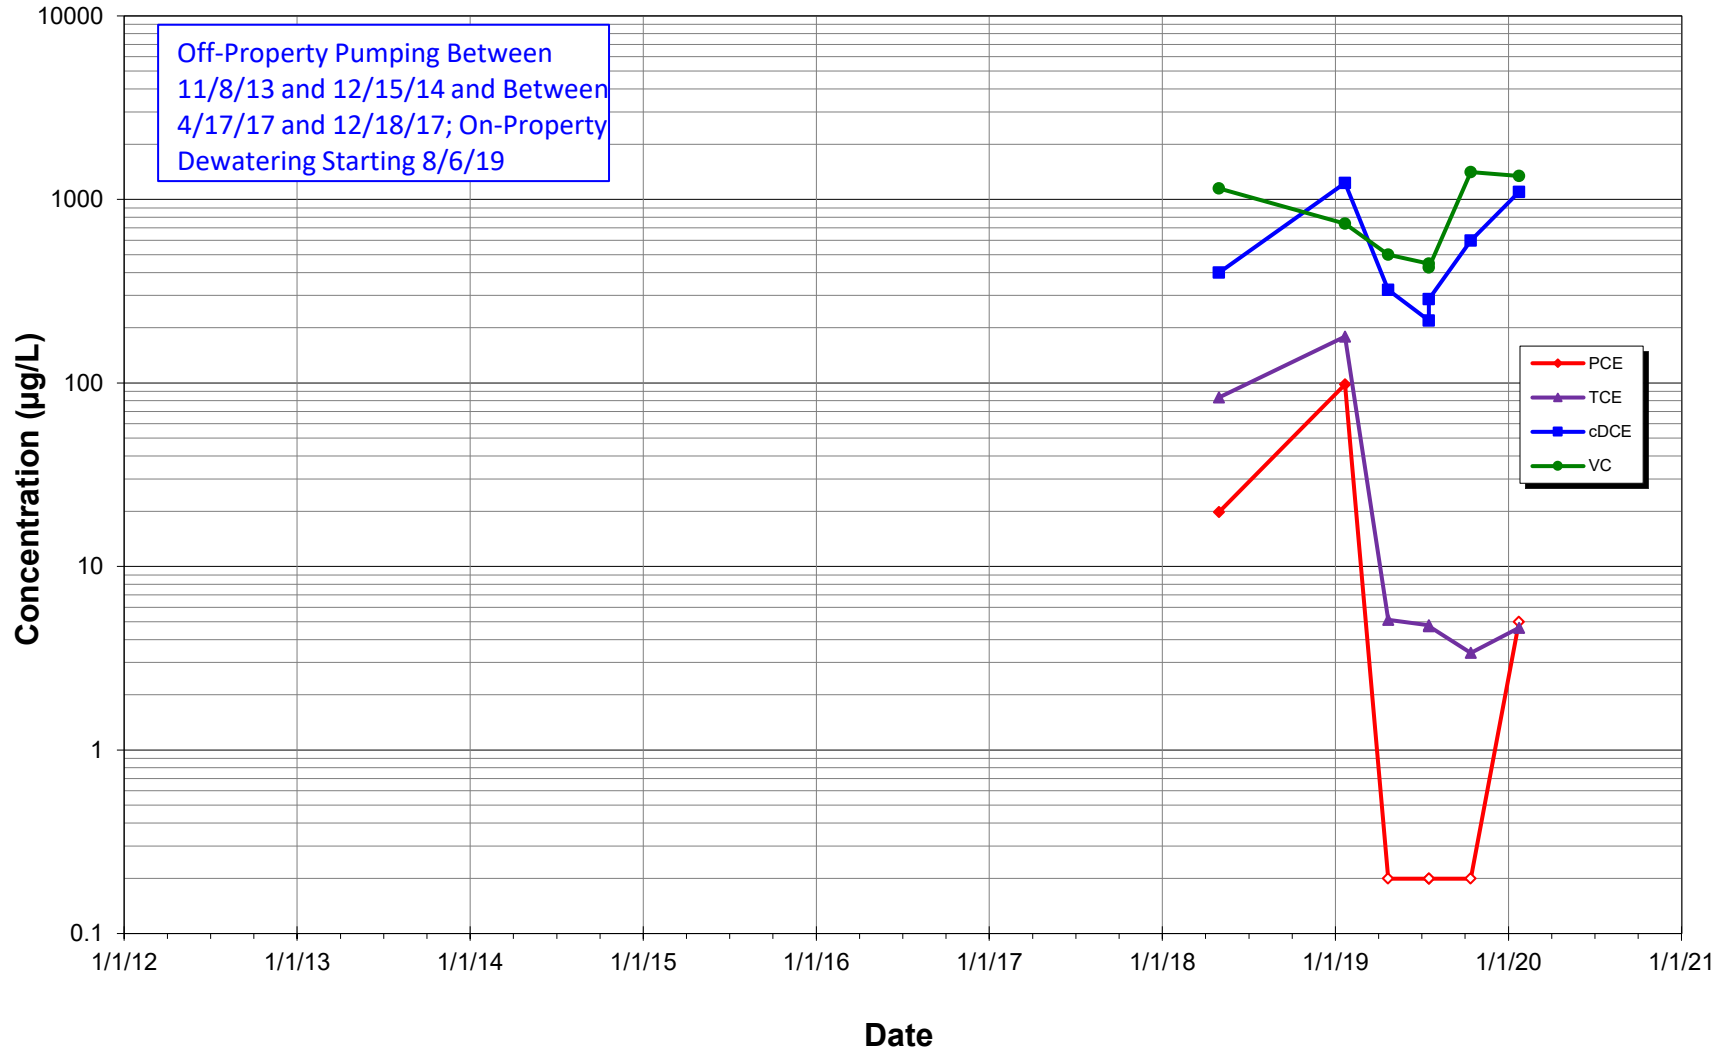

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-148 (-25.7 to -35.7 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

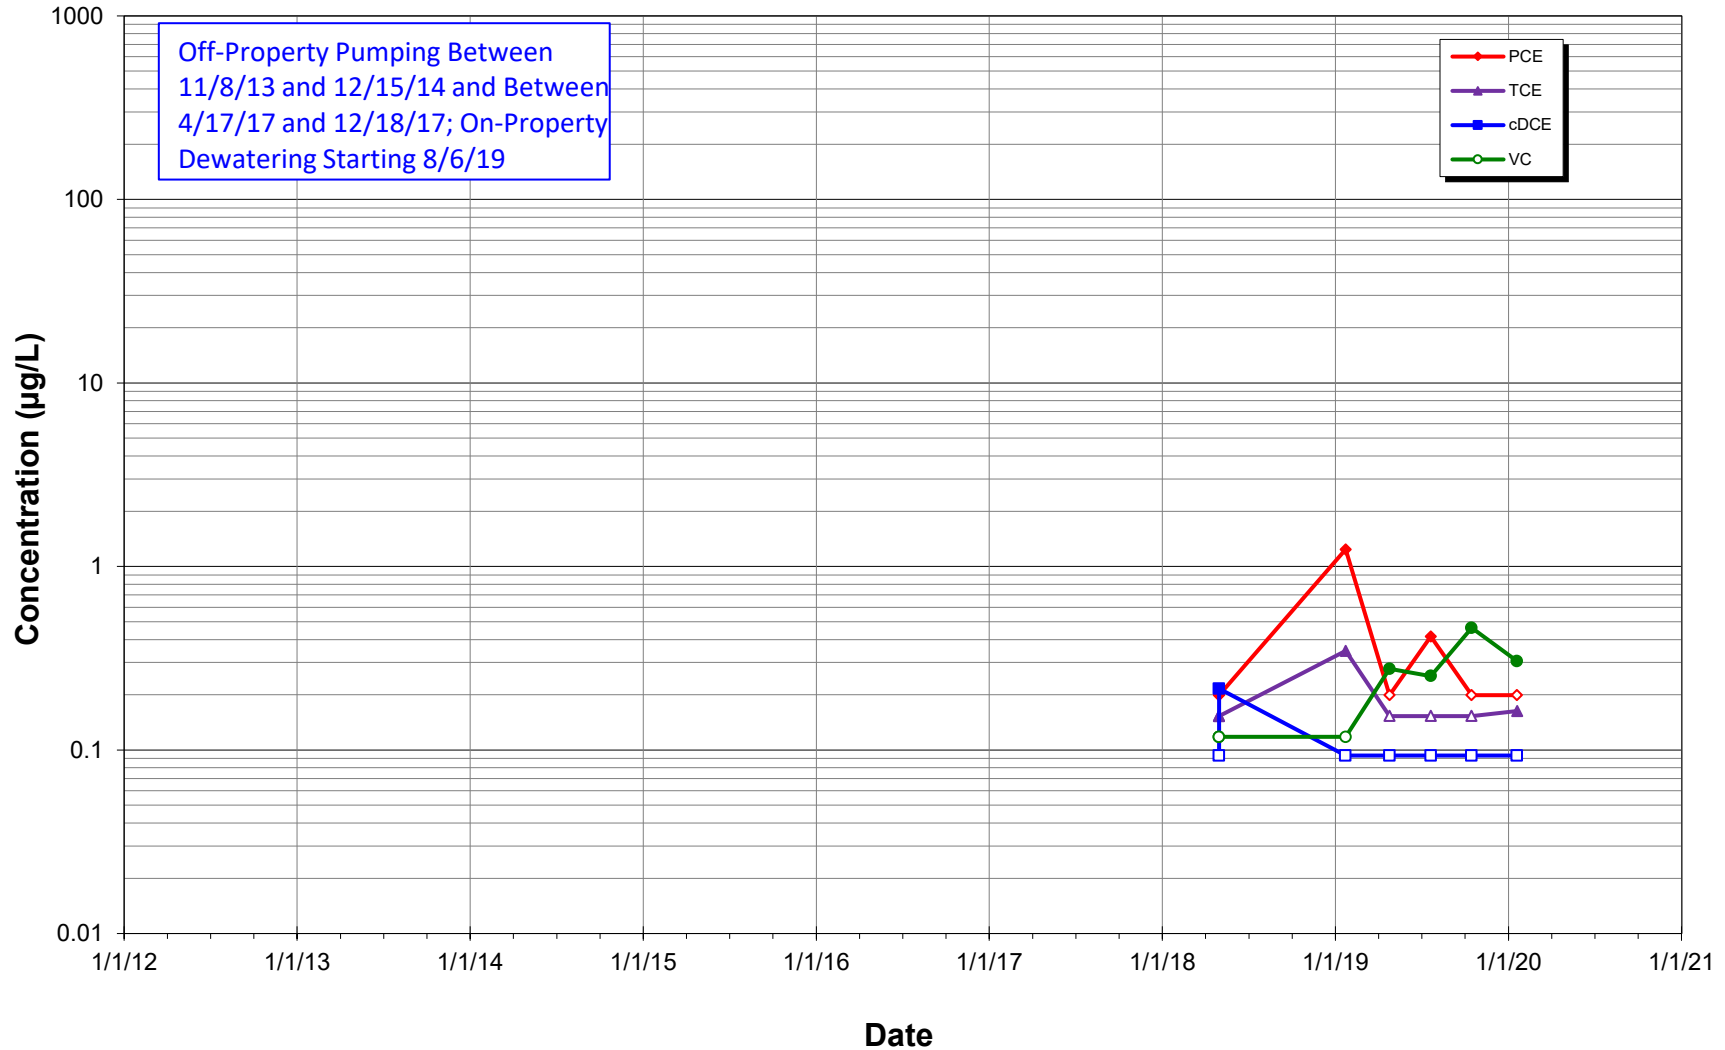

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-156 (2.0 to -8.0 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

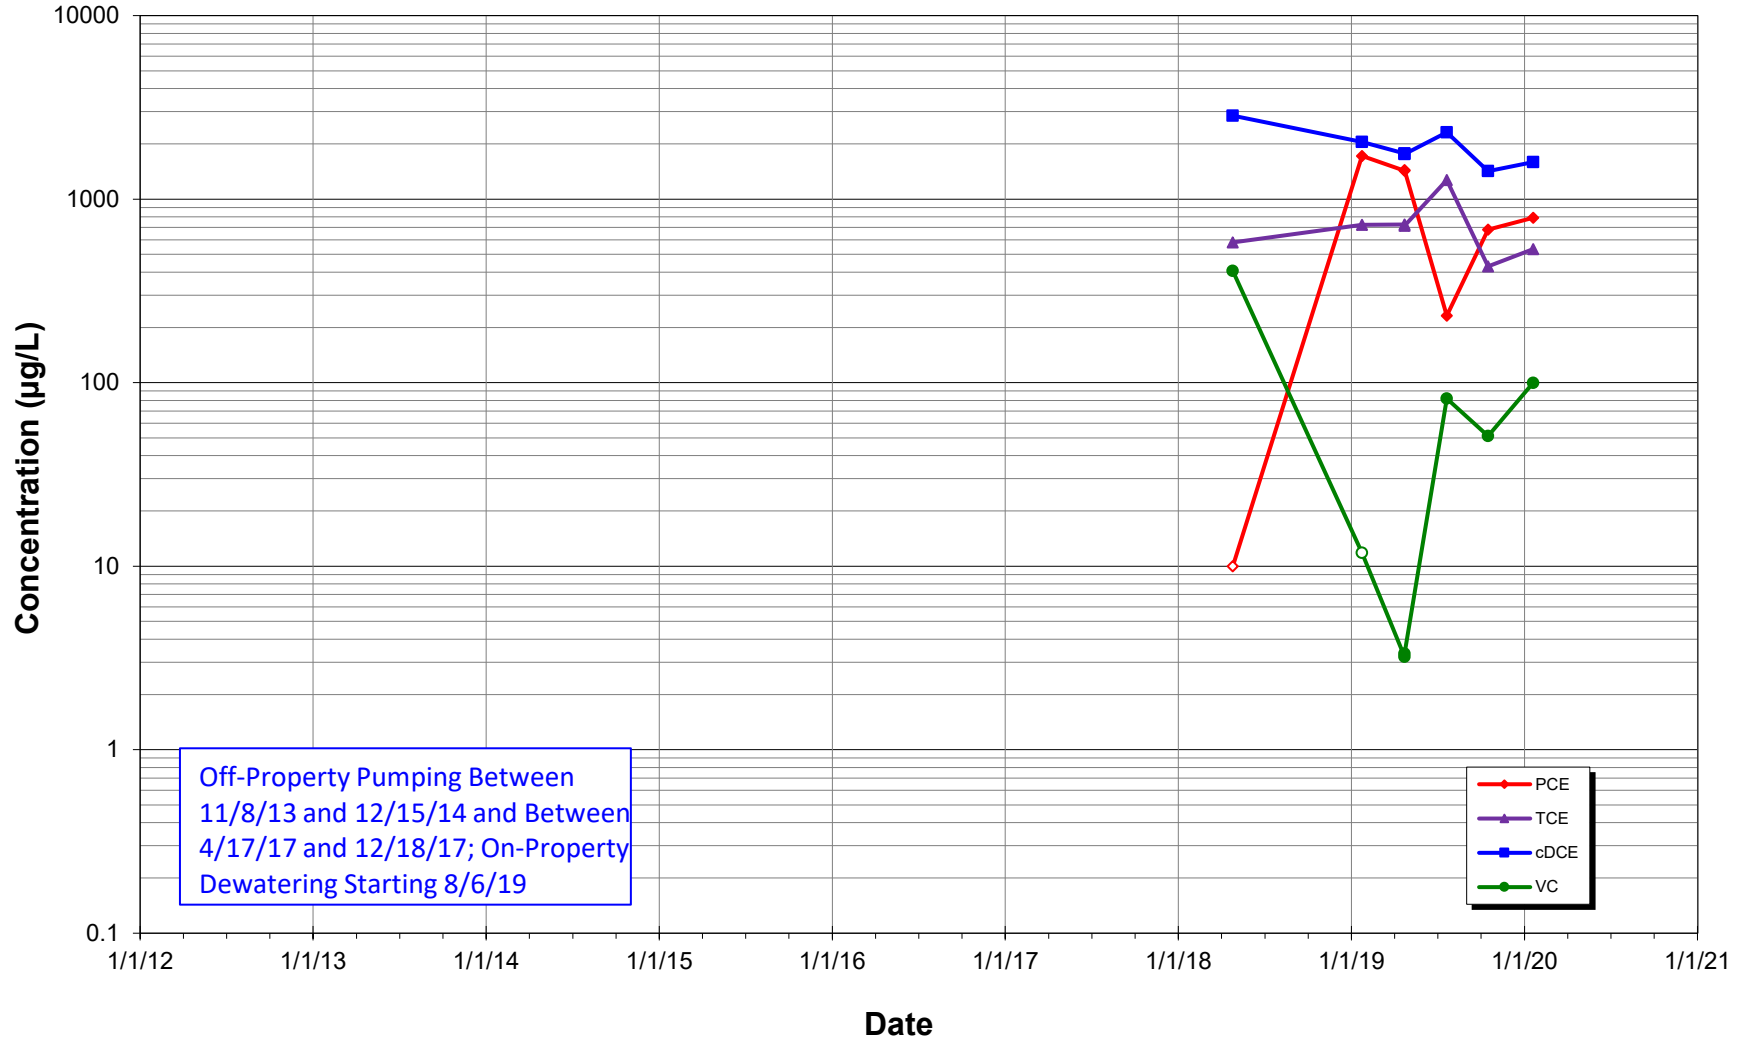

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-157 (-28.3 to -38.2 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

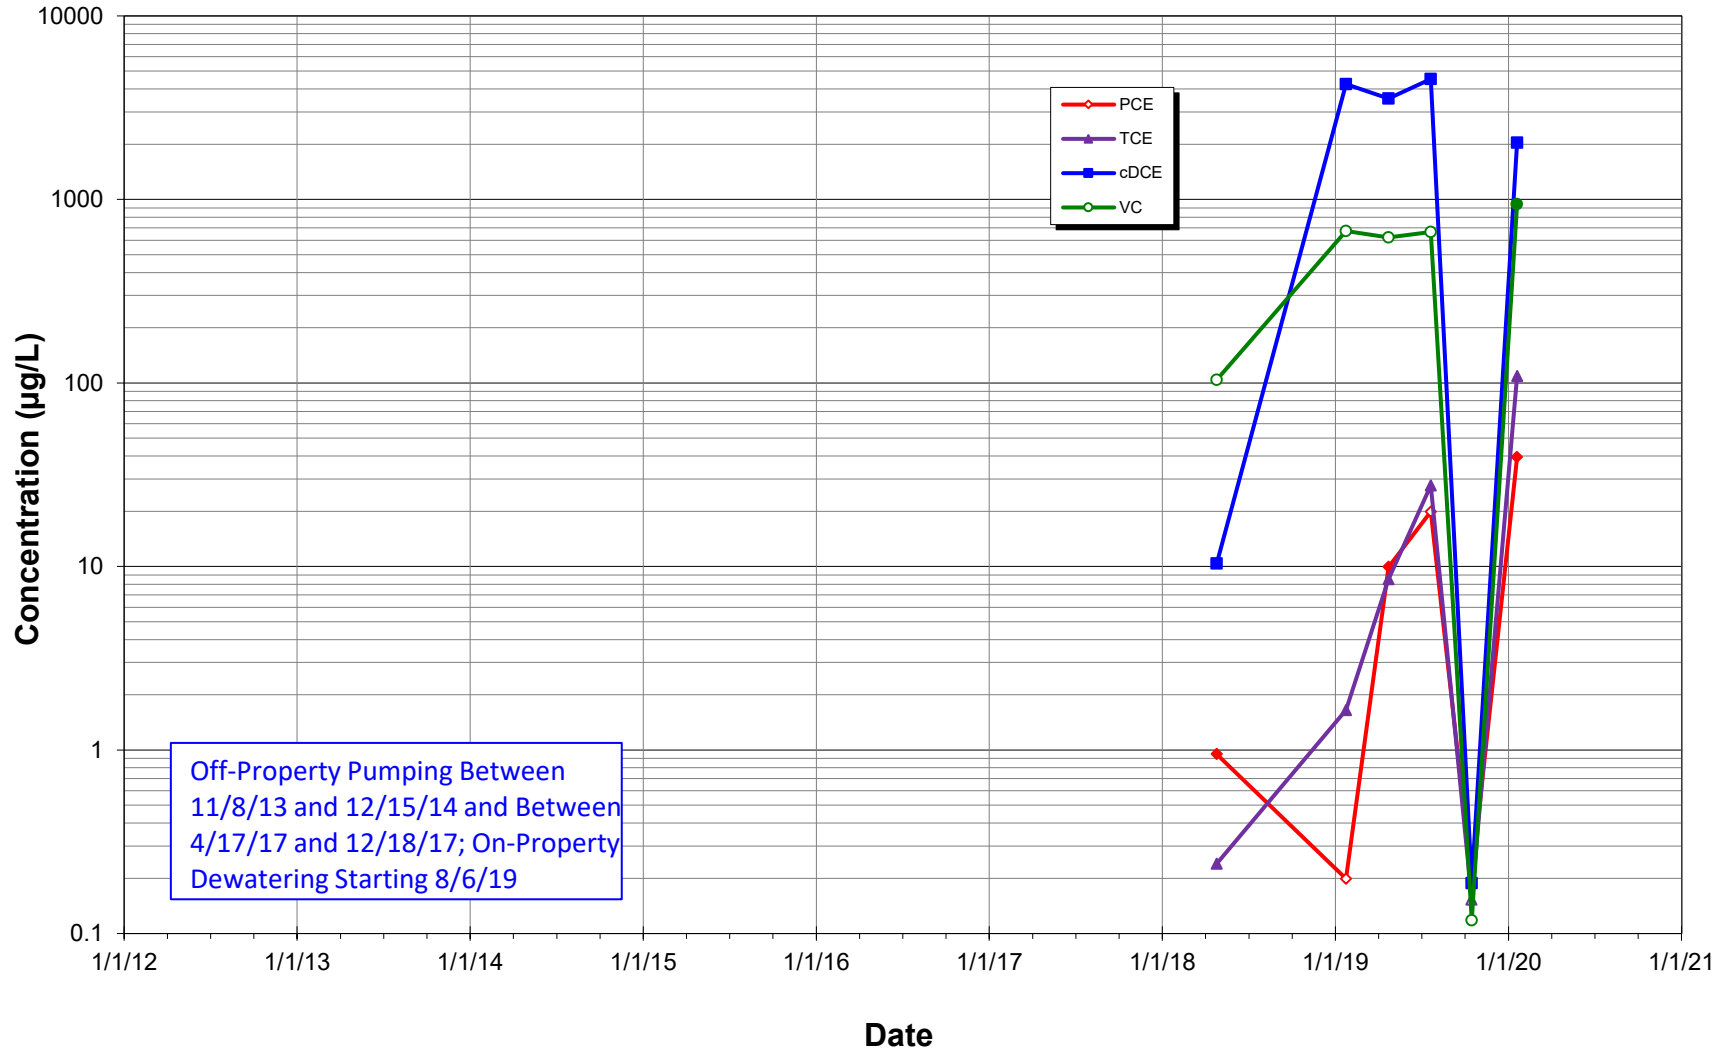

Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

- Notes:**
- 1) All results detected below the laboratory MDLs are shown as hollow data points .
 - 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW-189 (-1.2 to -11.2 feet NAVD), Valley Street
American Linen Supply Co-Dexter Ave Site

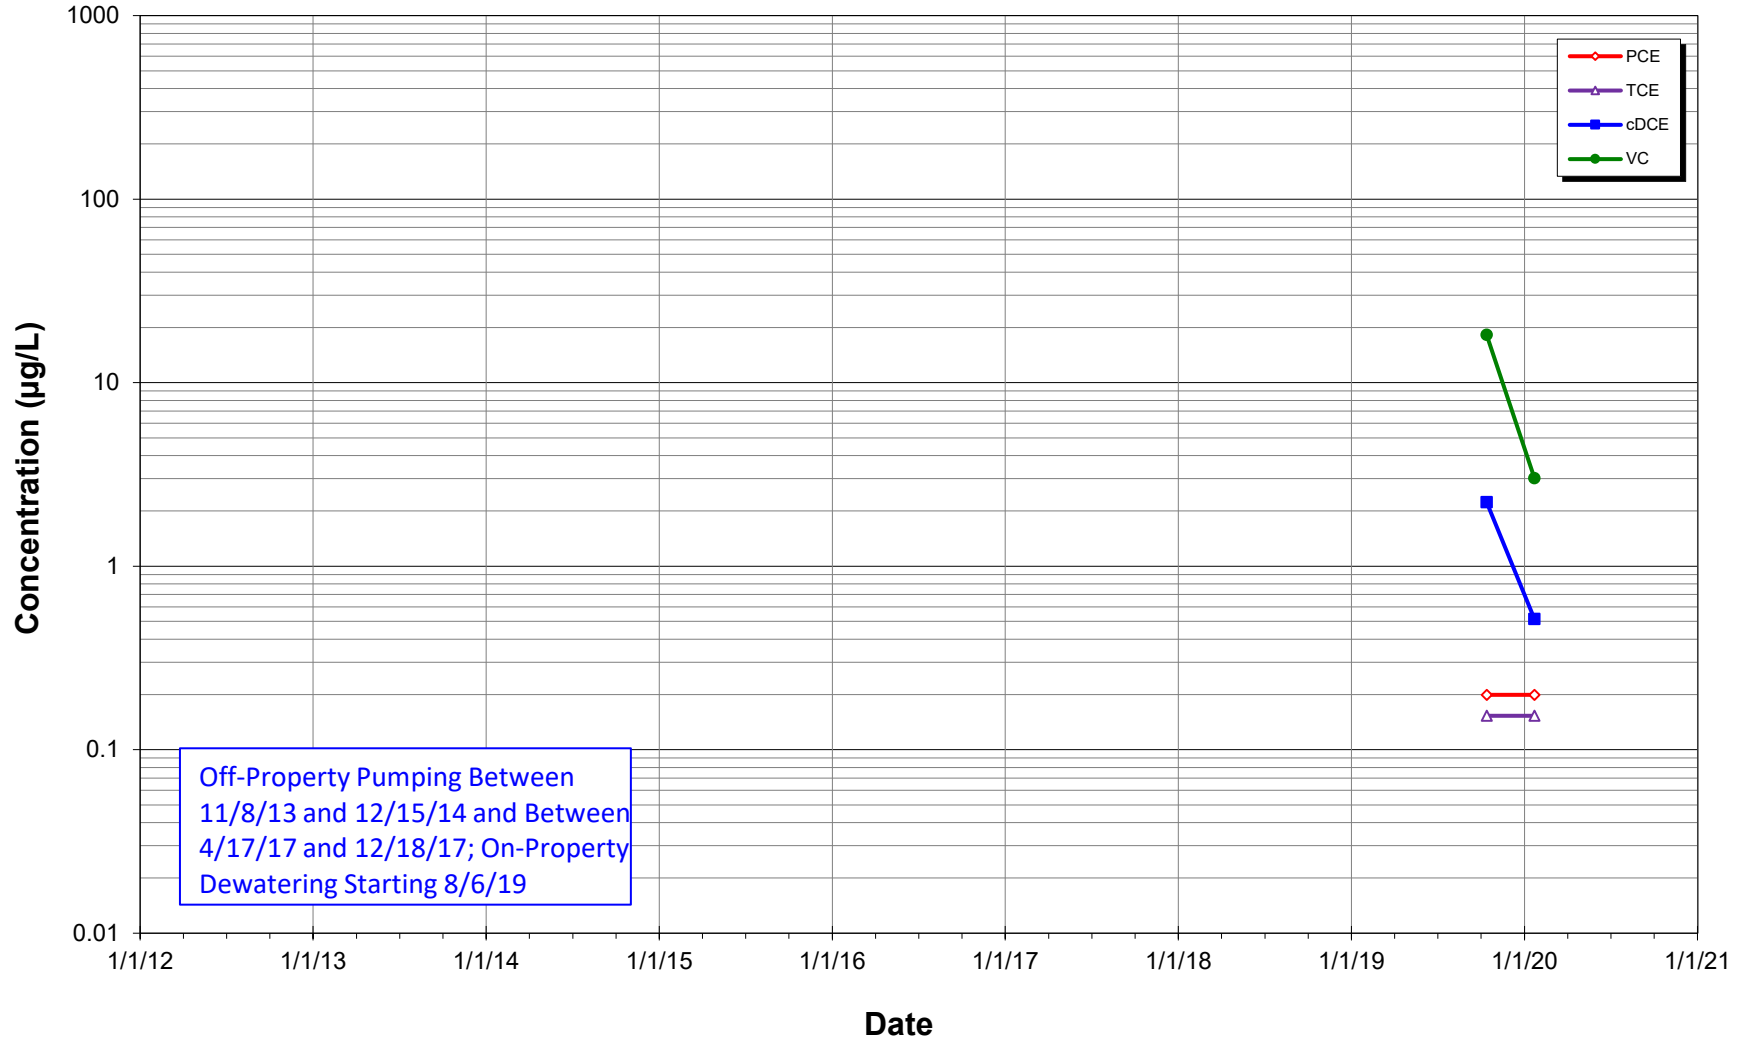


Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-190 (-30.2 to -40.2 feet NAVD), Valley Street
American Linen Supply Co–Dexter Ave Site

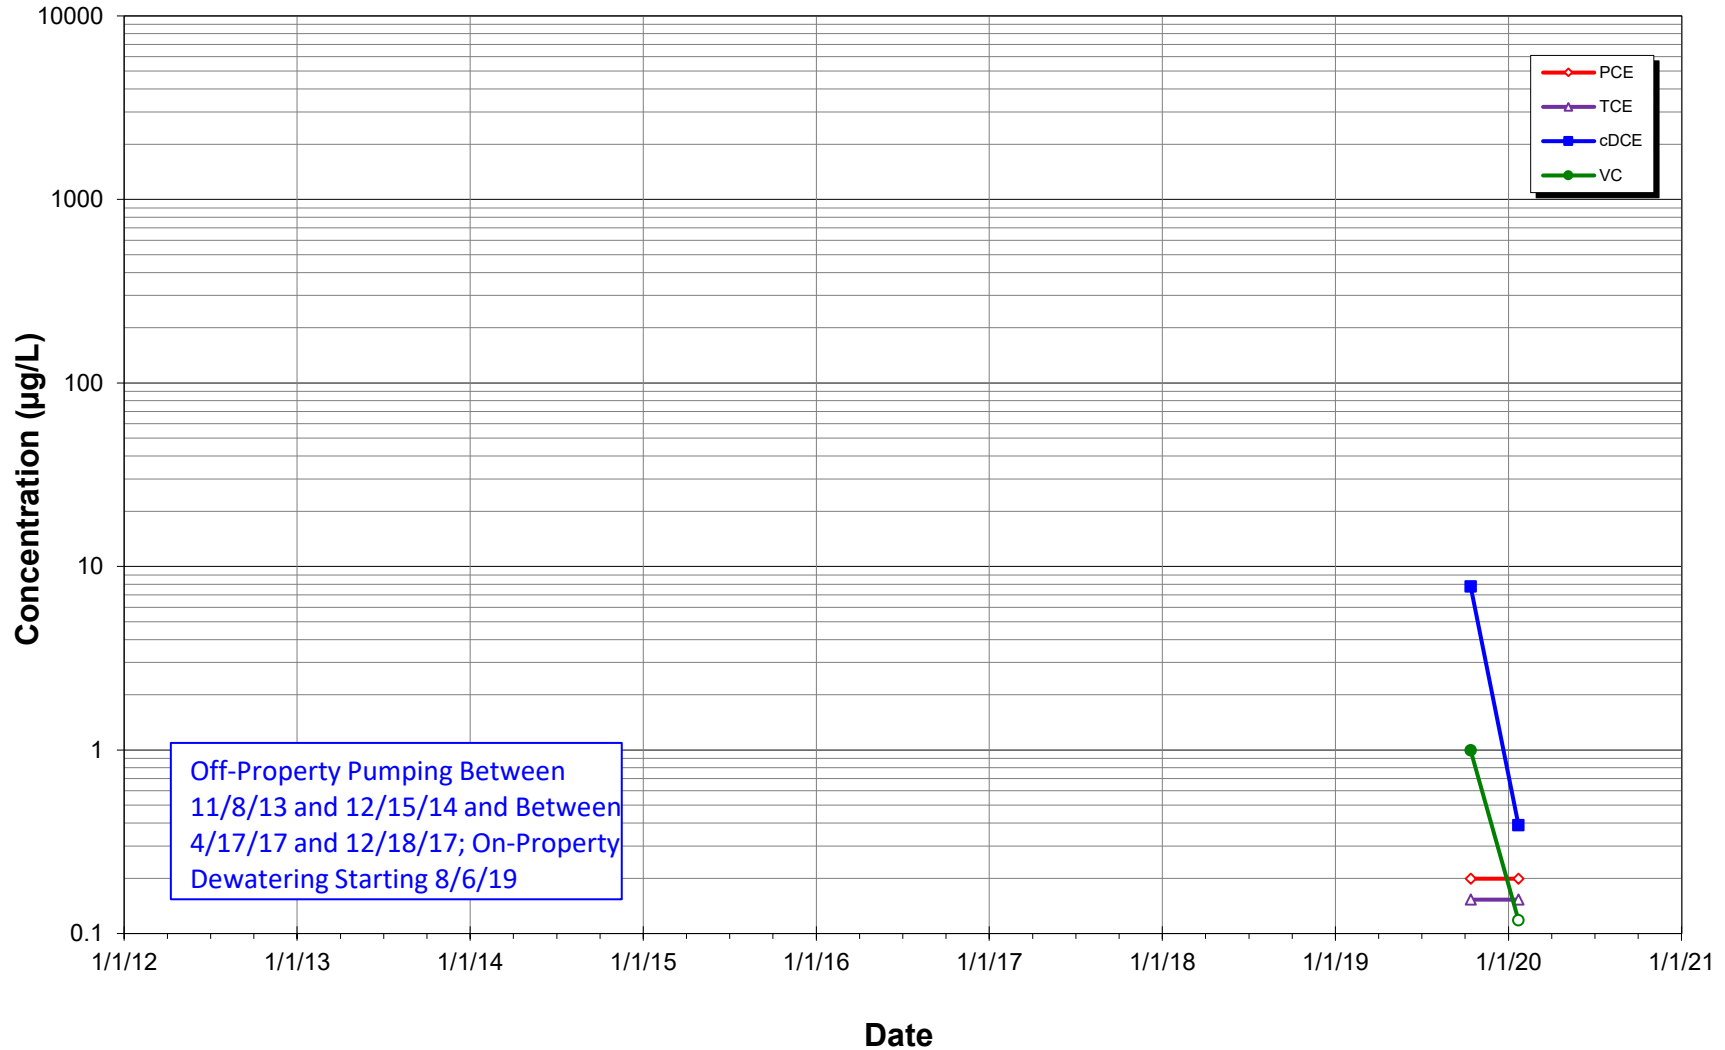

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-302 (2.0 to -8.0 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

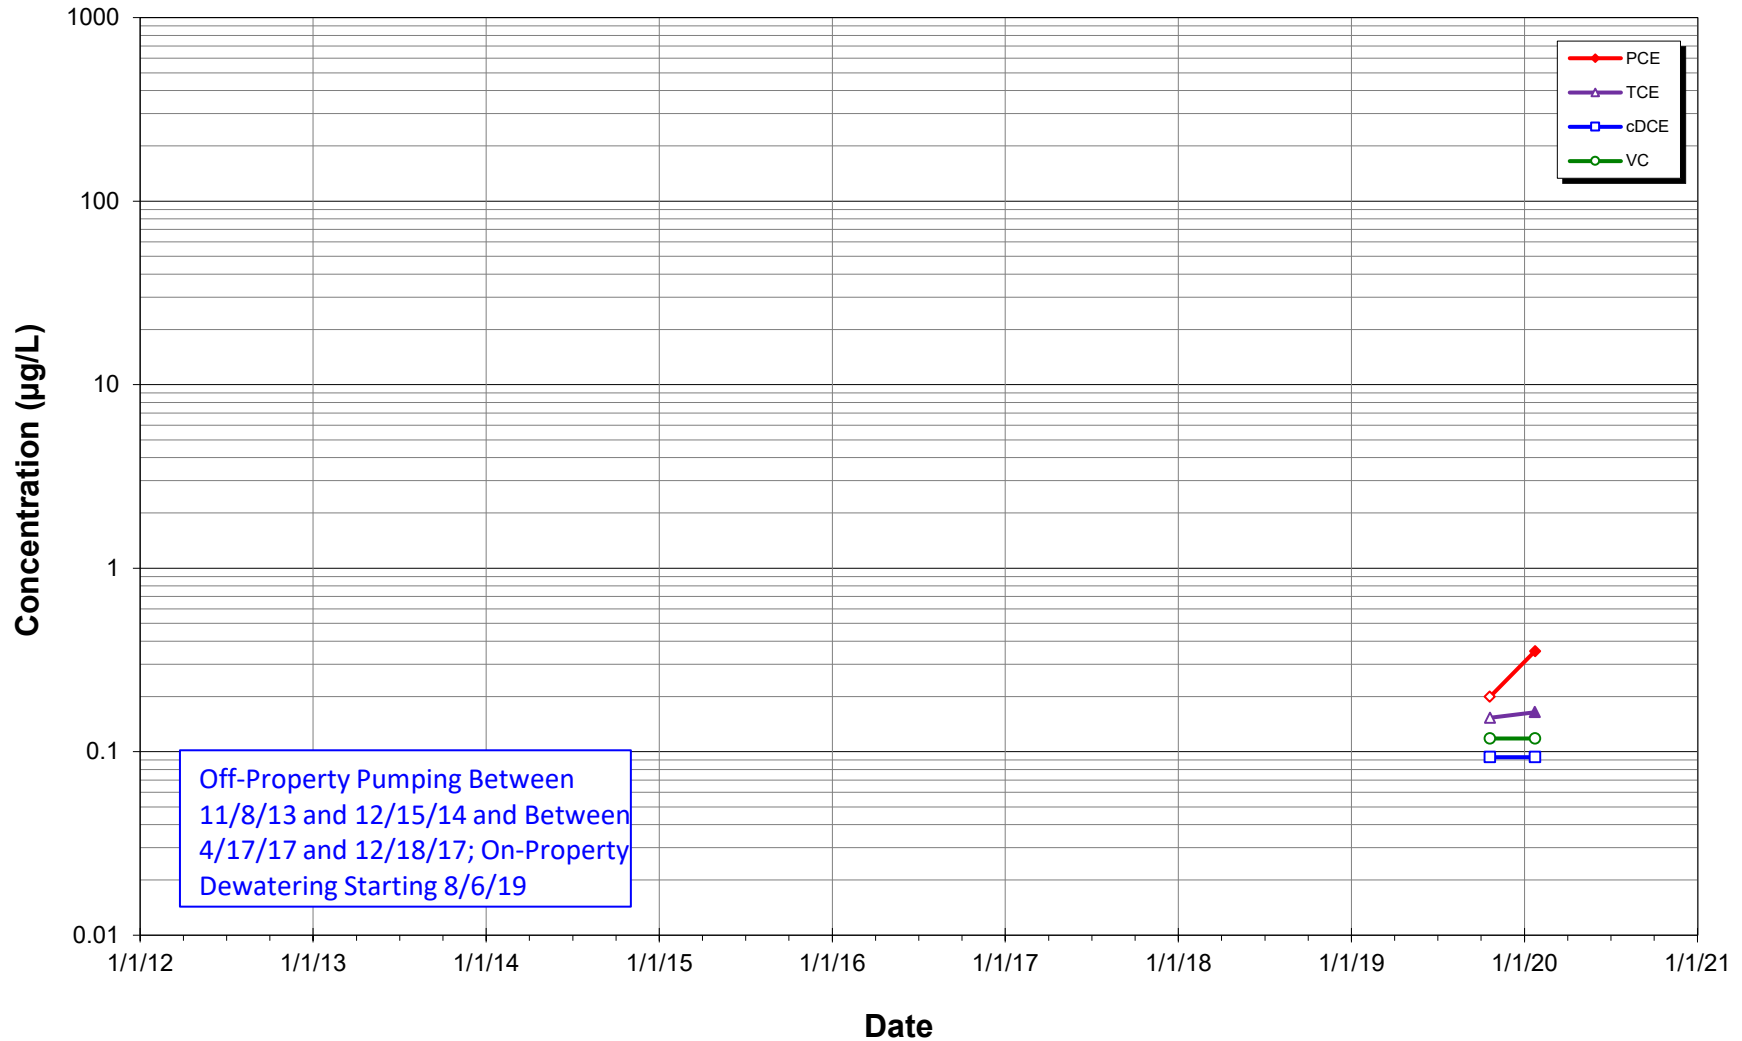

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-303 (-13.8 to -23.8 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

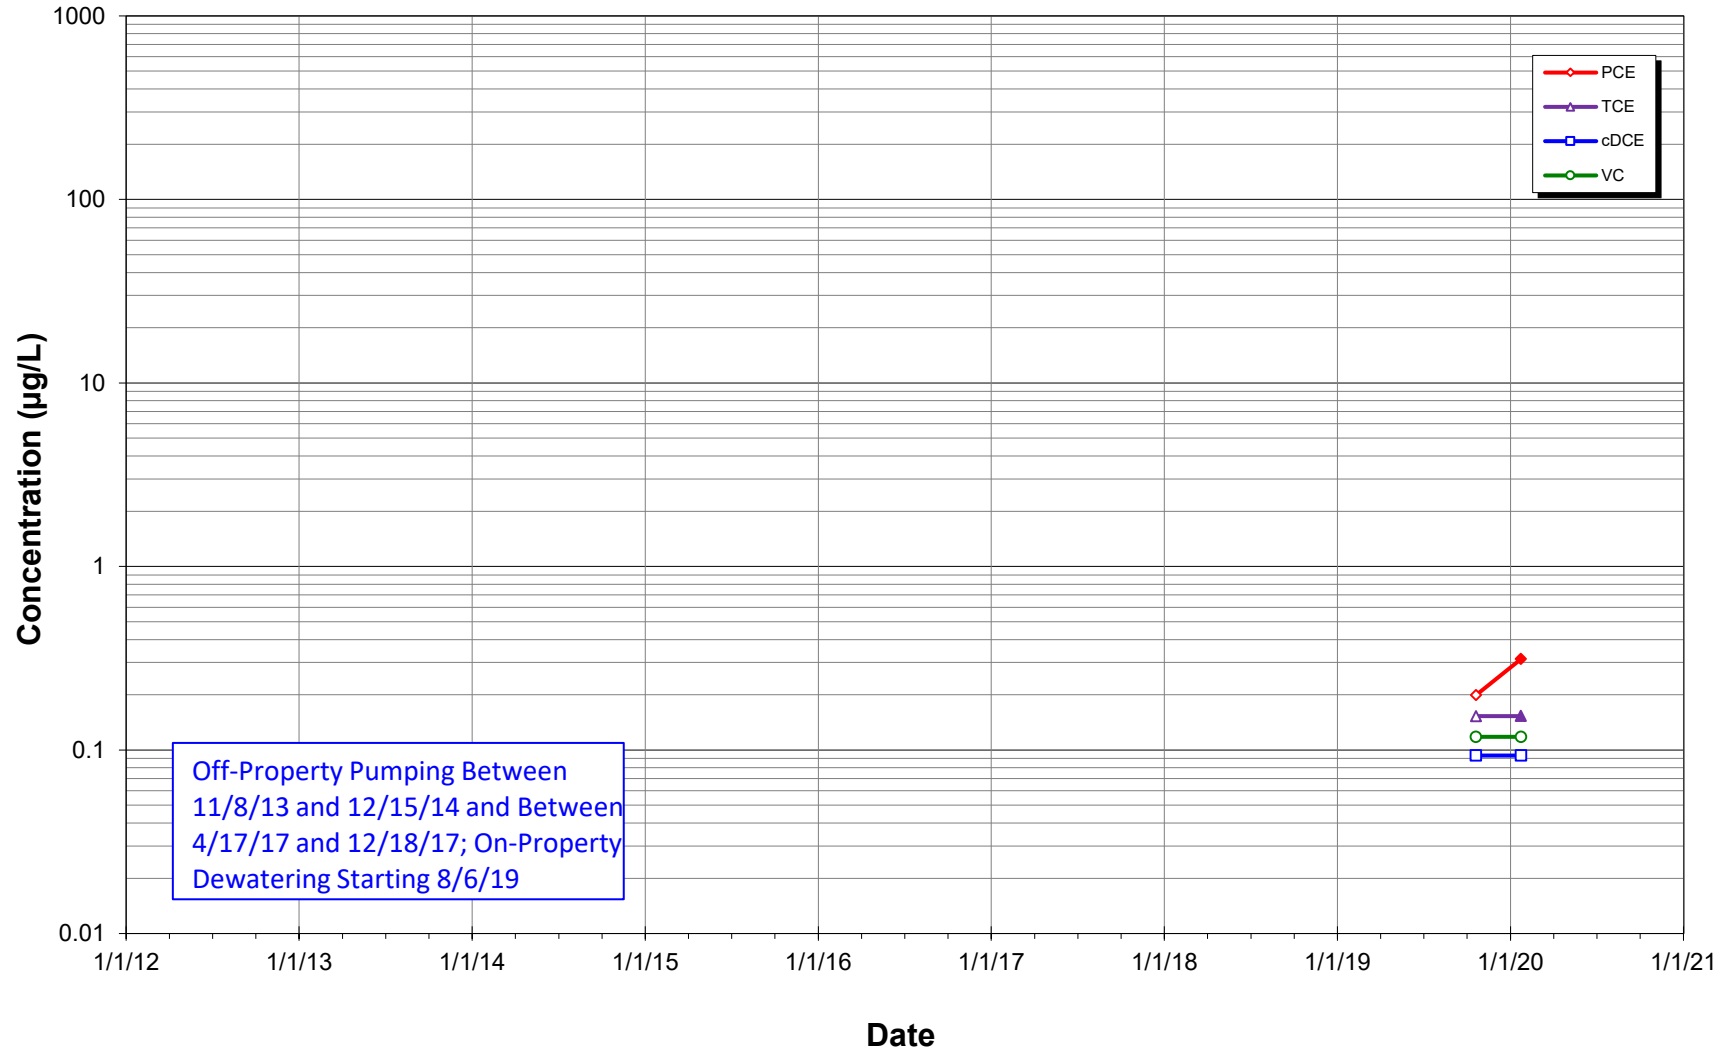

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW-306 (17.2 to 7.2 feet NAVD), Dexter Ave
American Linen Supply Co–Dexter Ave Site**

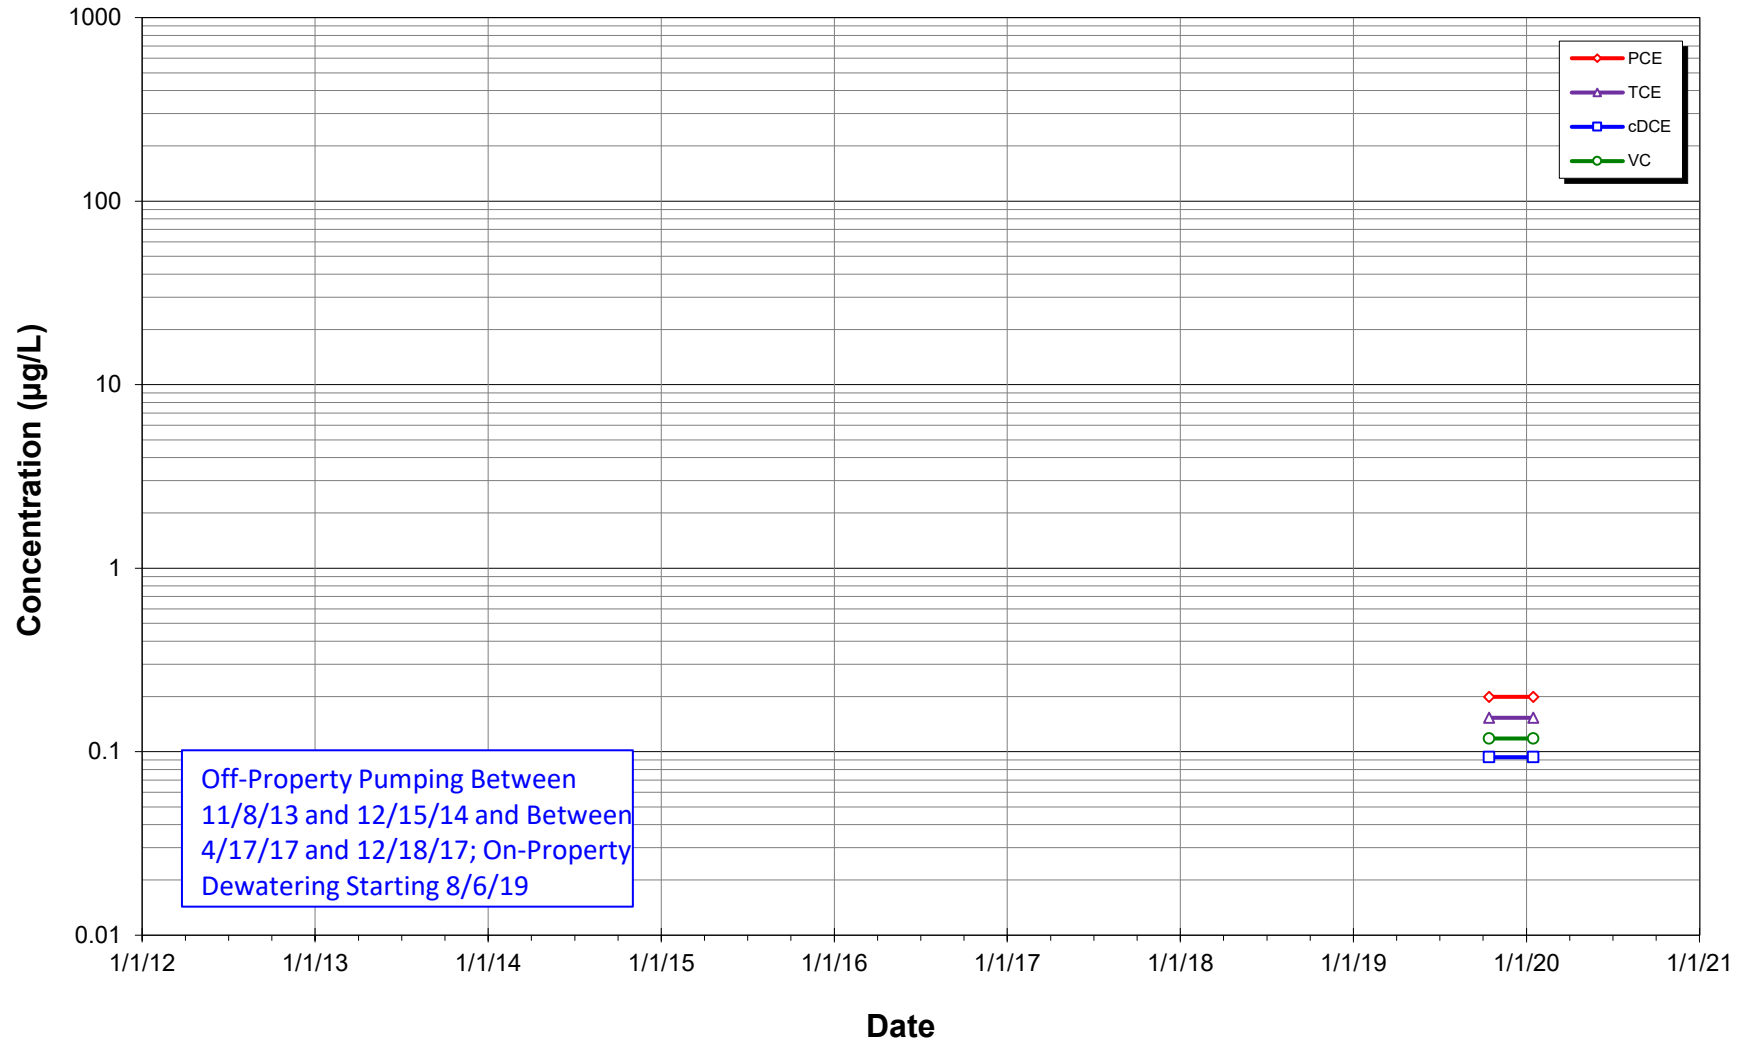

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-307 (-12.4 to -22.4 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

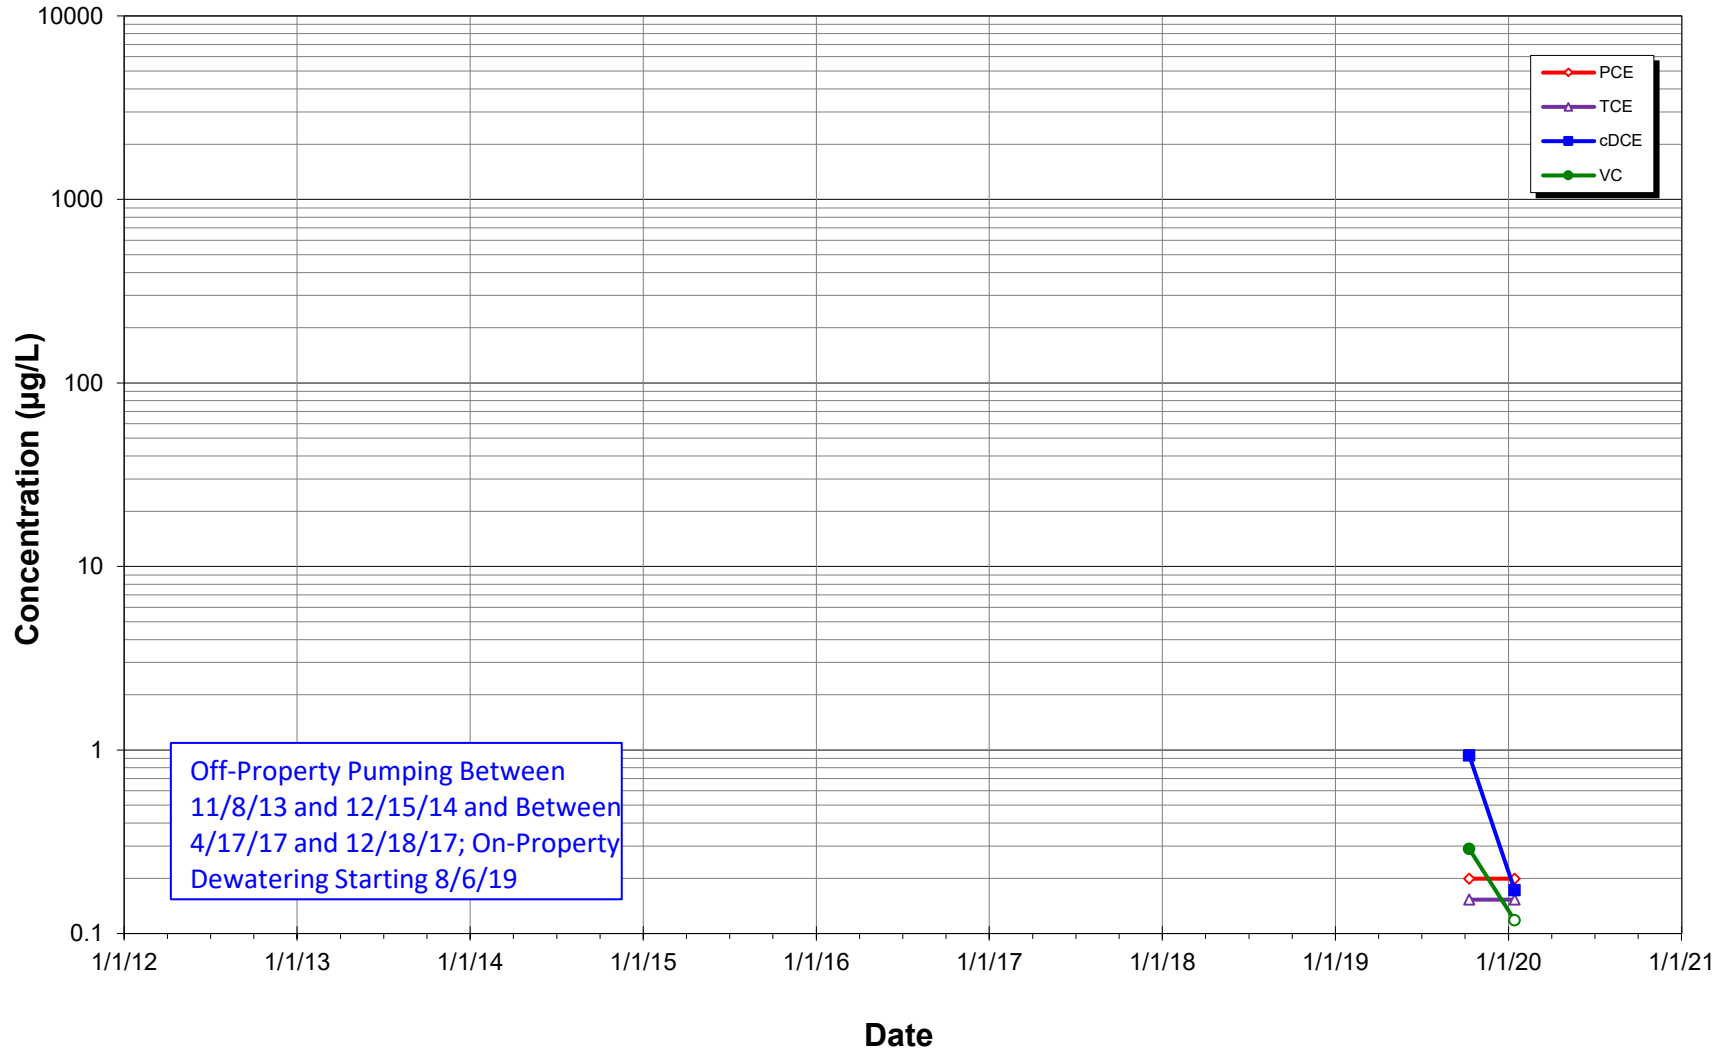

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-308 (-4.7 to -14.7 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

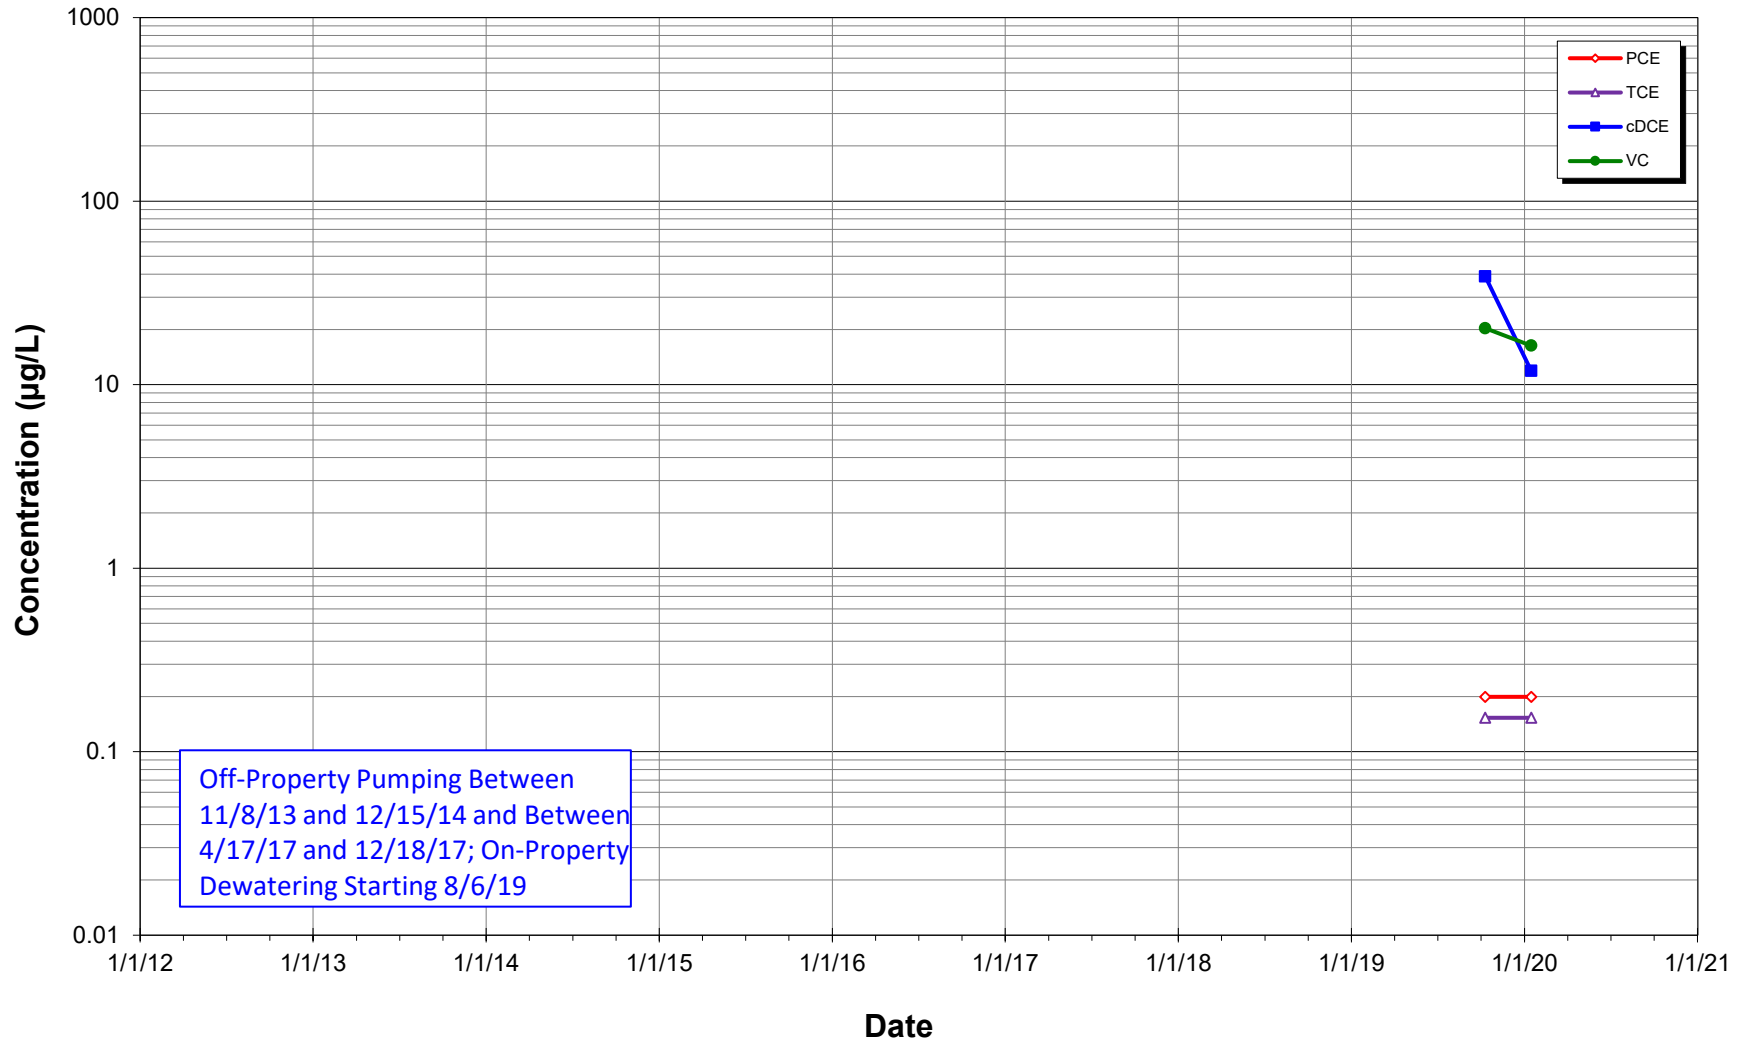

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW-309 (-32.0 to -42.0 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

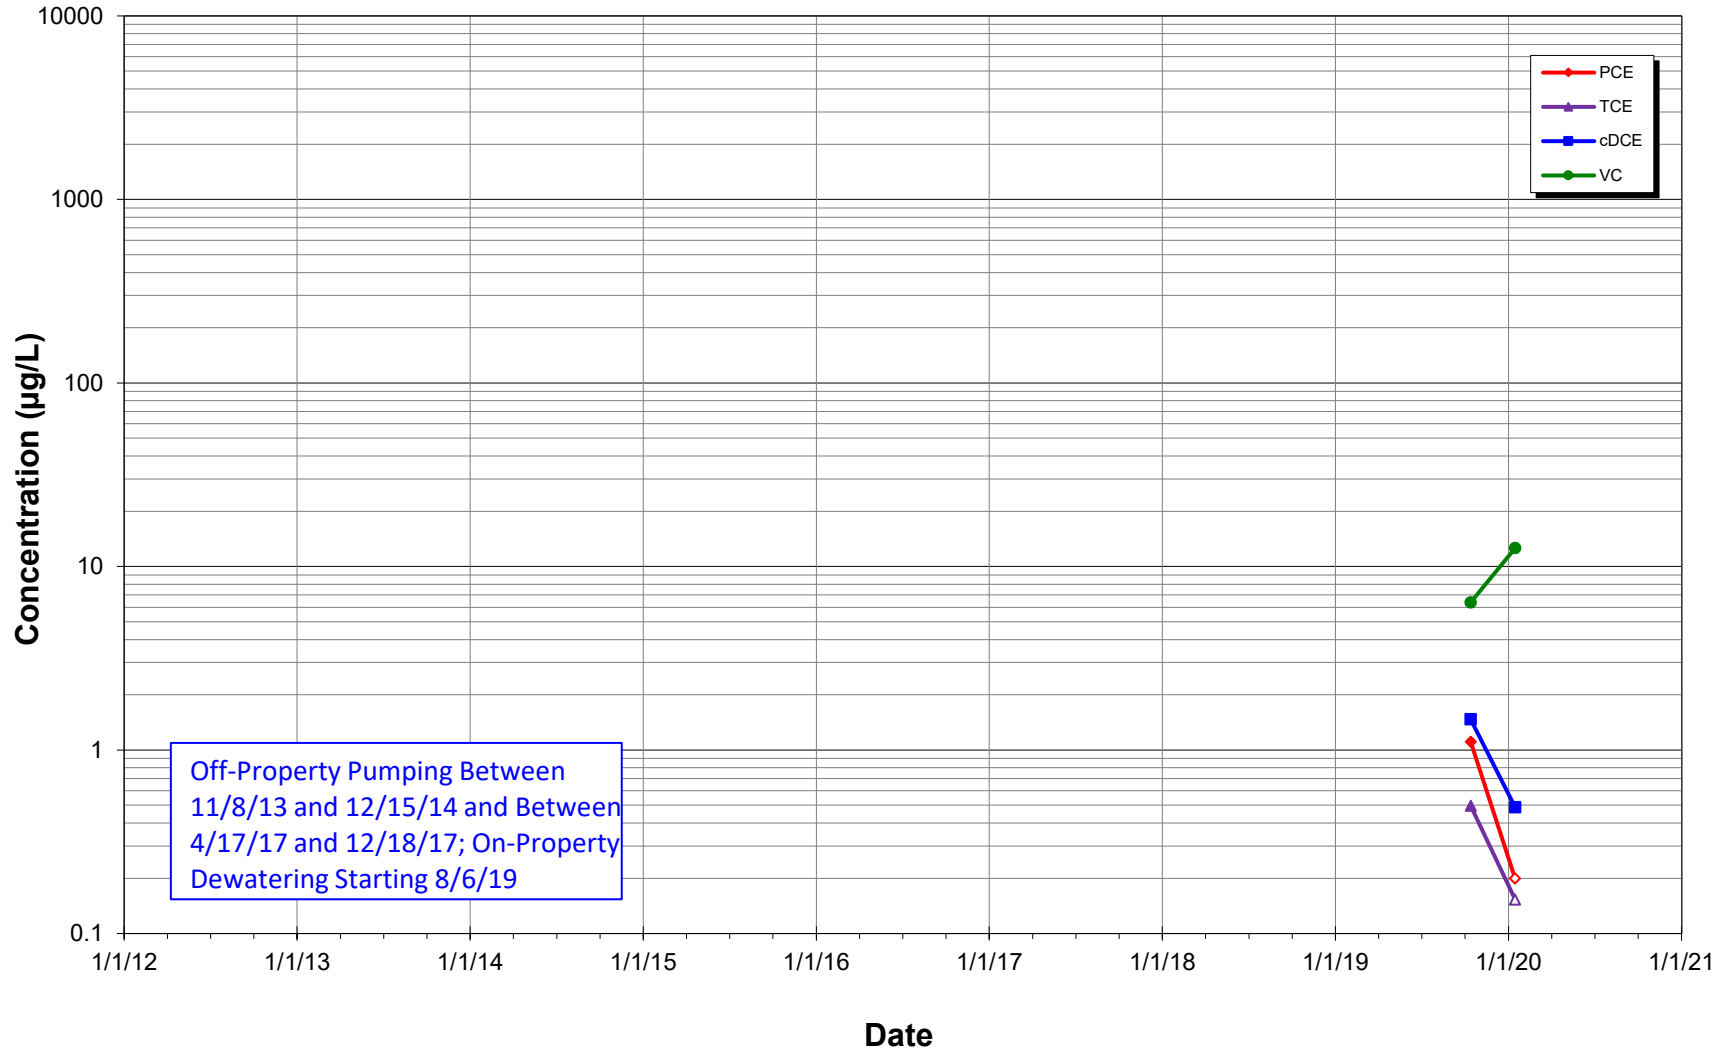


Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-311 (-29.0 to -39.0 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co–Dexter Ave Site

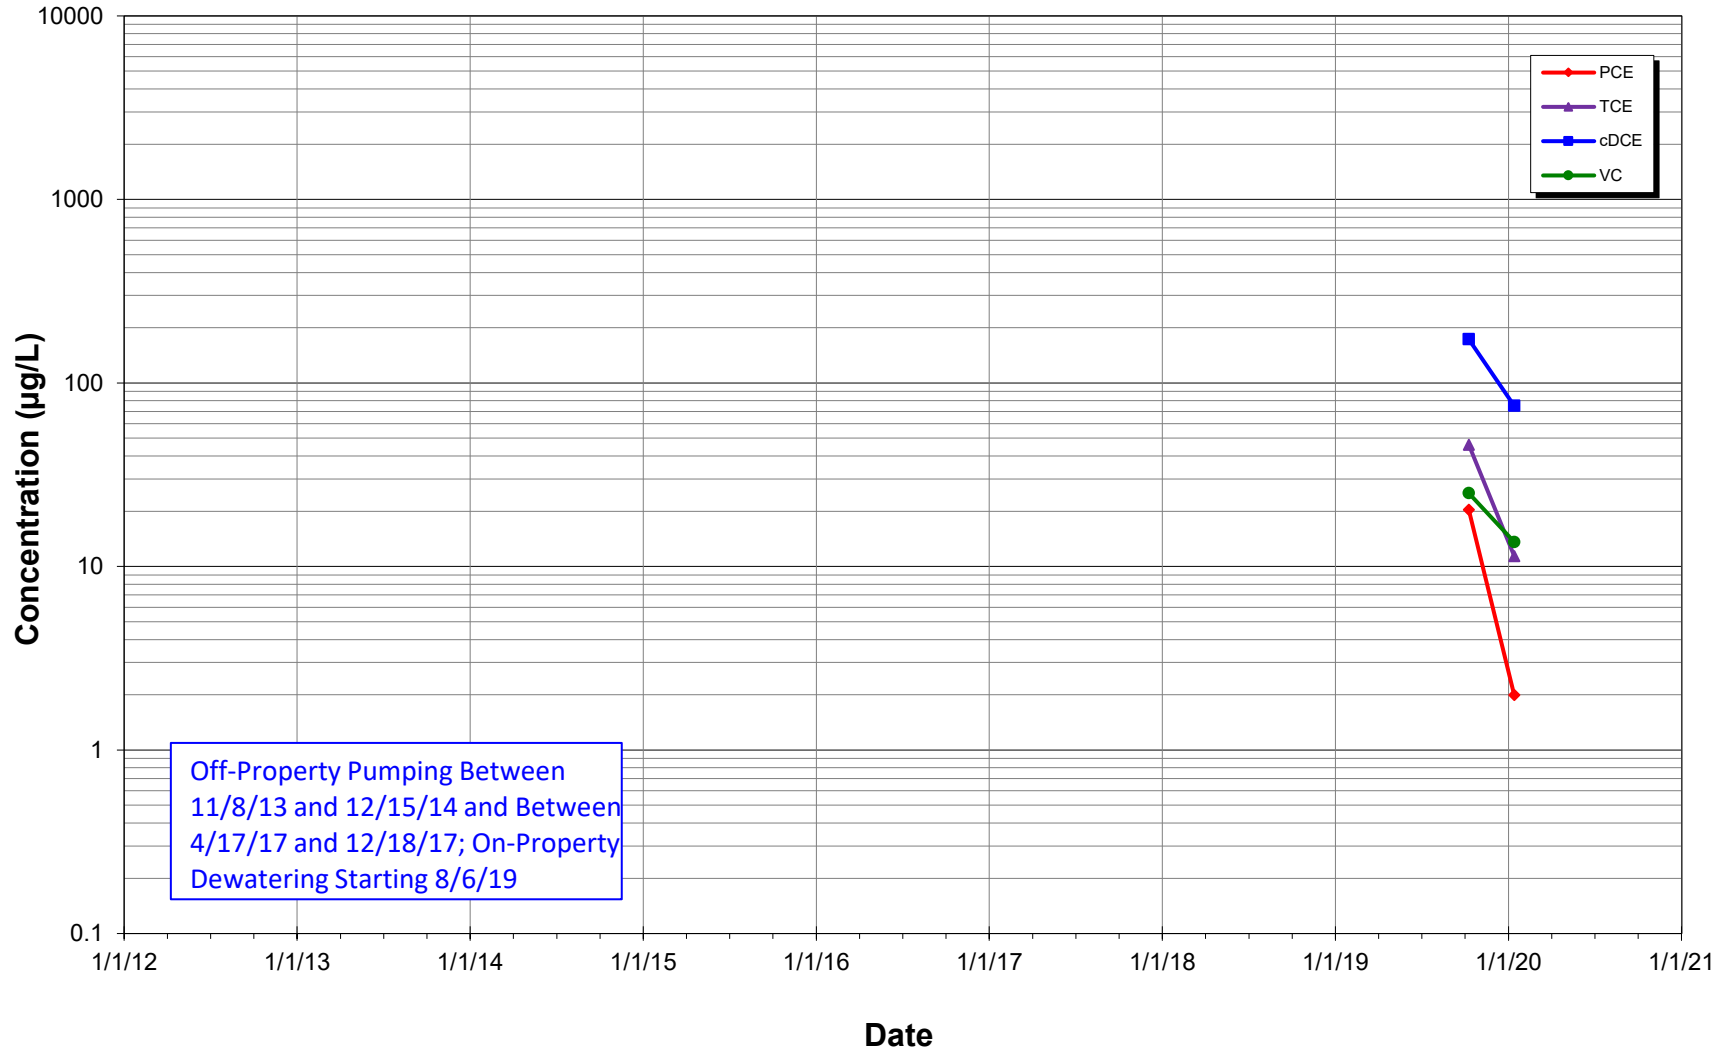

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-314 (-28.0 to -38.0 feet NAVD), Alley Between 8th and 9th
American Linen Supply Co-Dexter Ave Site

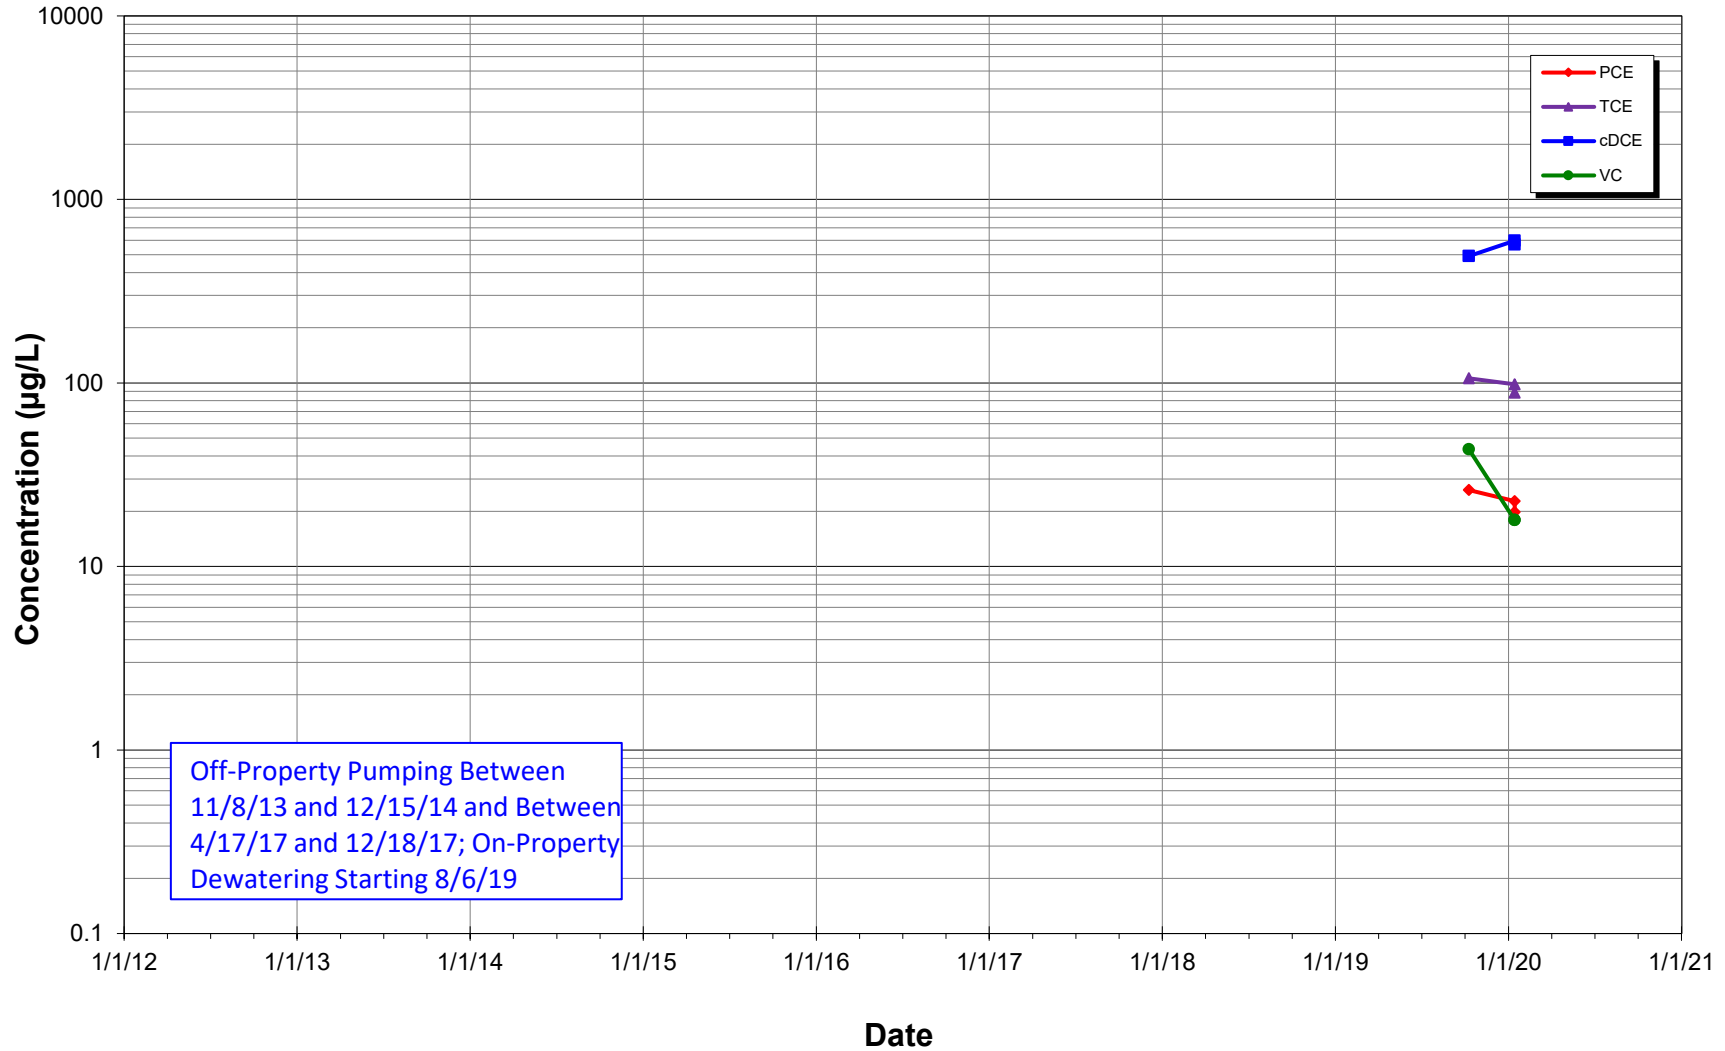

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-315 (12.2 to 2.2 feet NAVD), Mercer Street
American Linen Supply Co–Dexter Ave Site

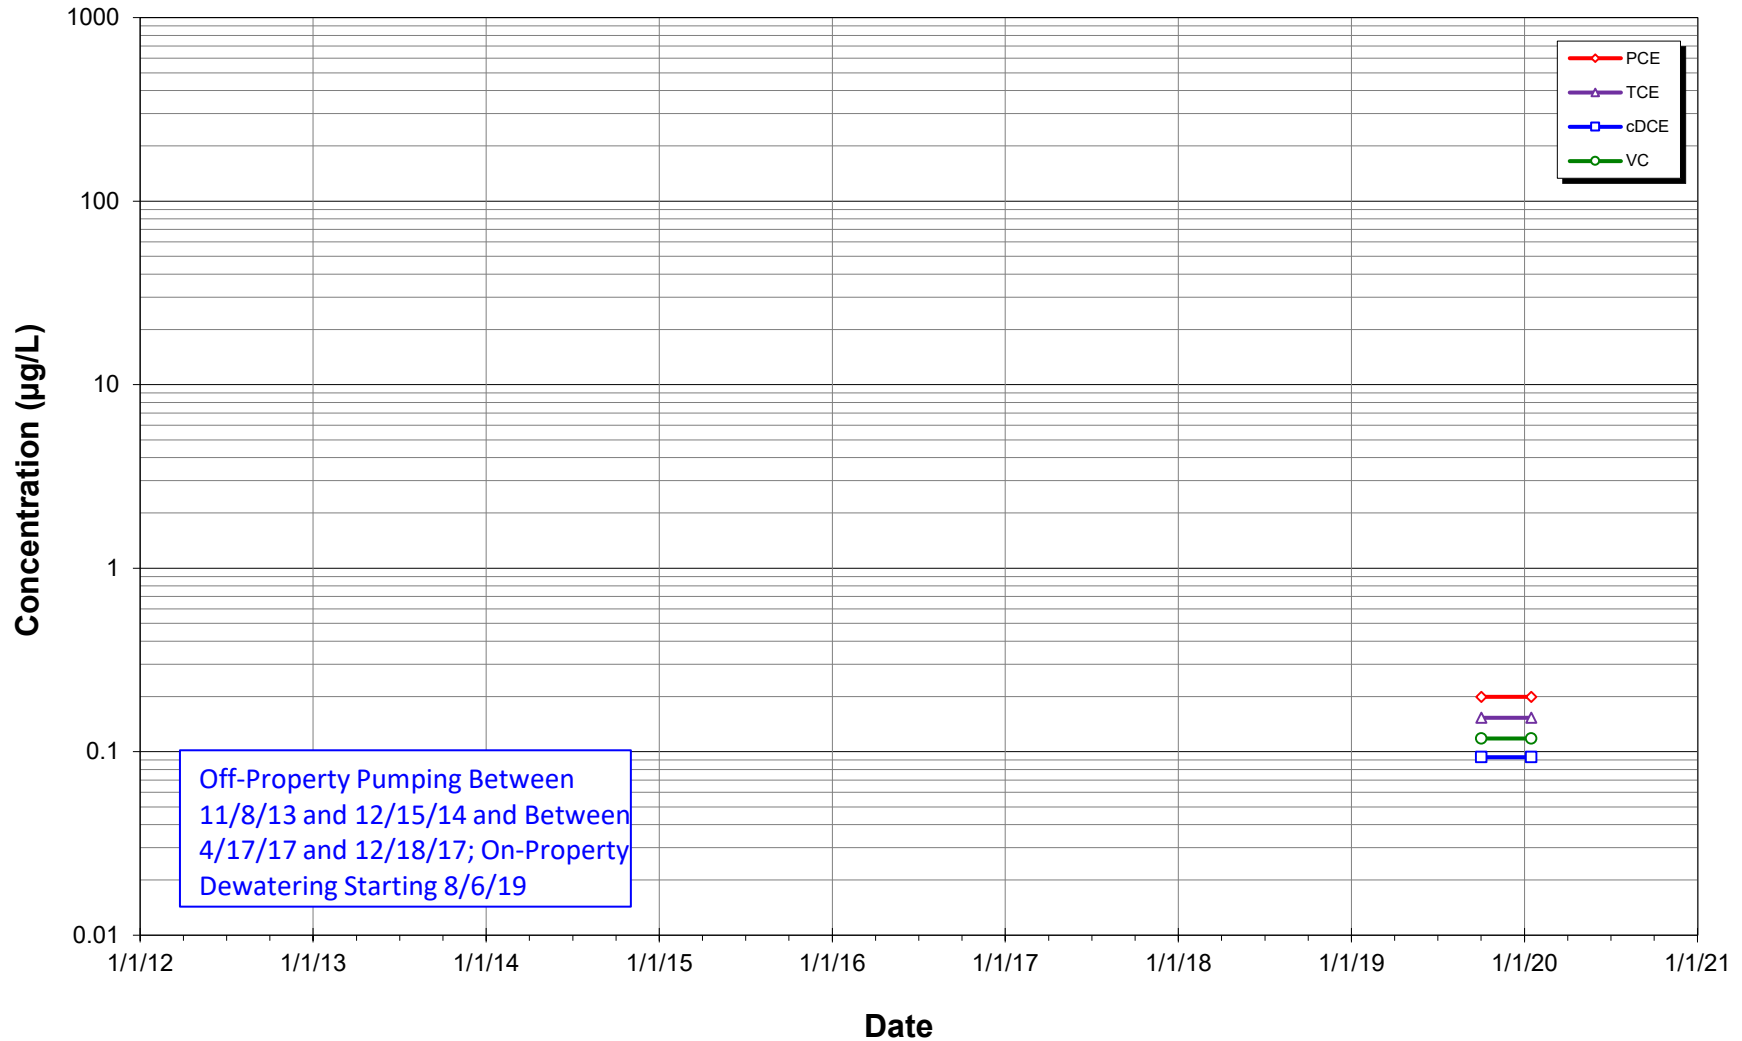

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-316 (-10.0 to -20.0 feet NAVD), Mercer Street
American Linen Supply Co–Dexter Ave Site

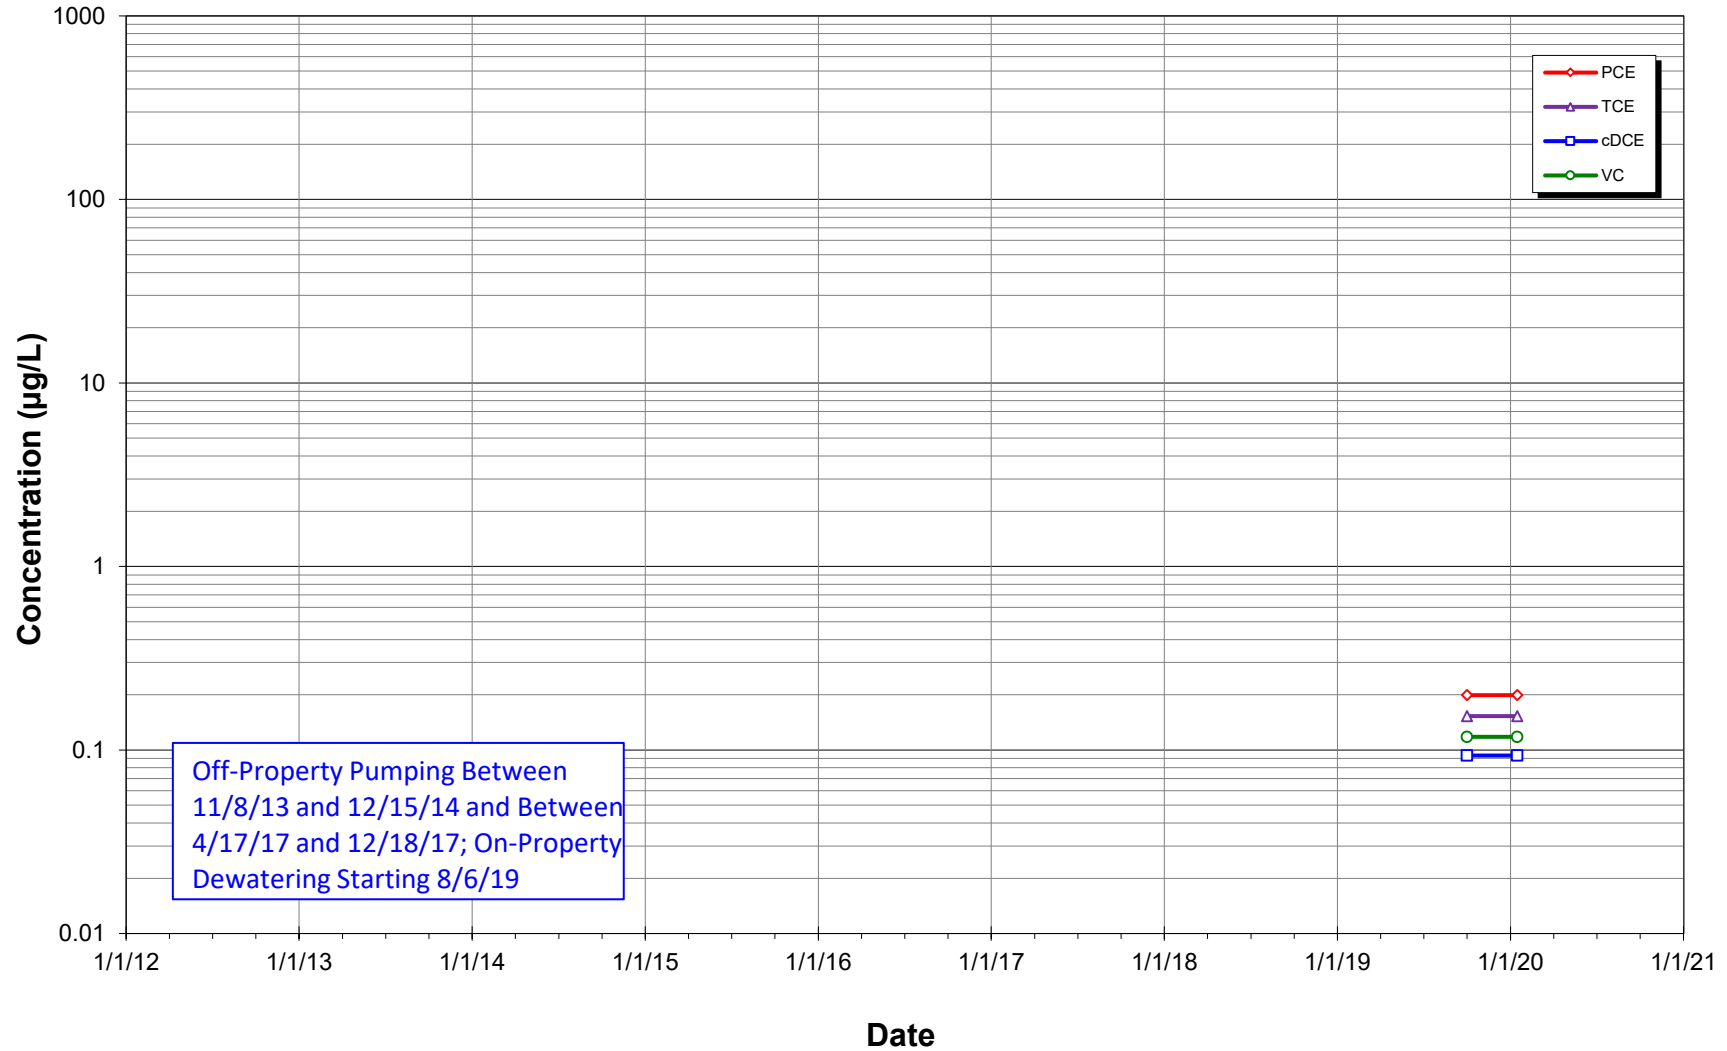

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-317 (3.4 to -6.6 feet NAVD), 9th Avenue North
American Linen Supply Co–Dexter Ave Site

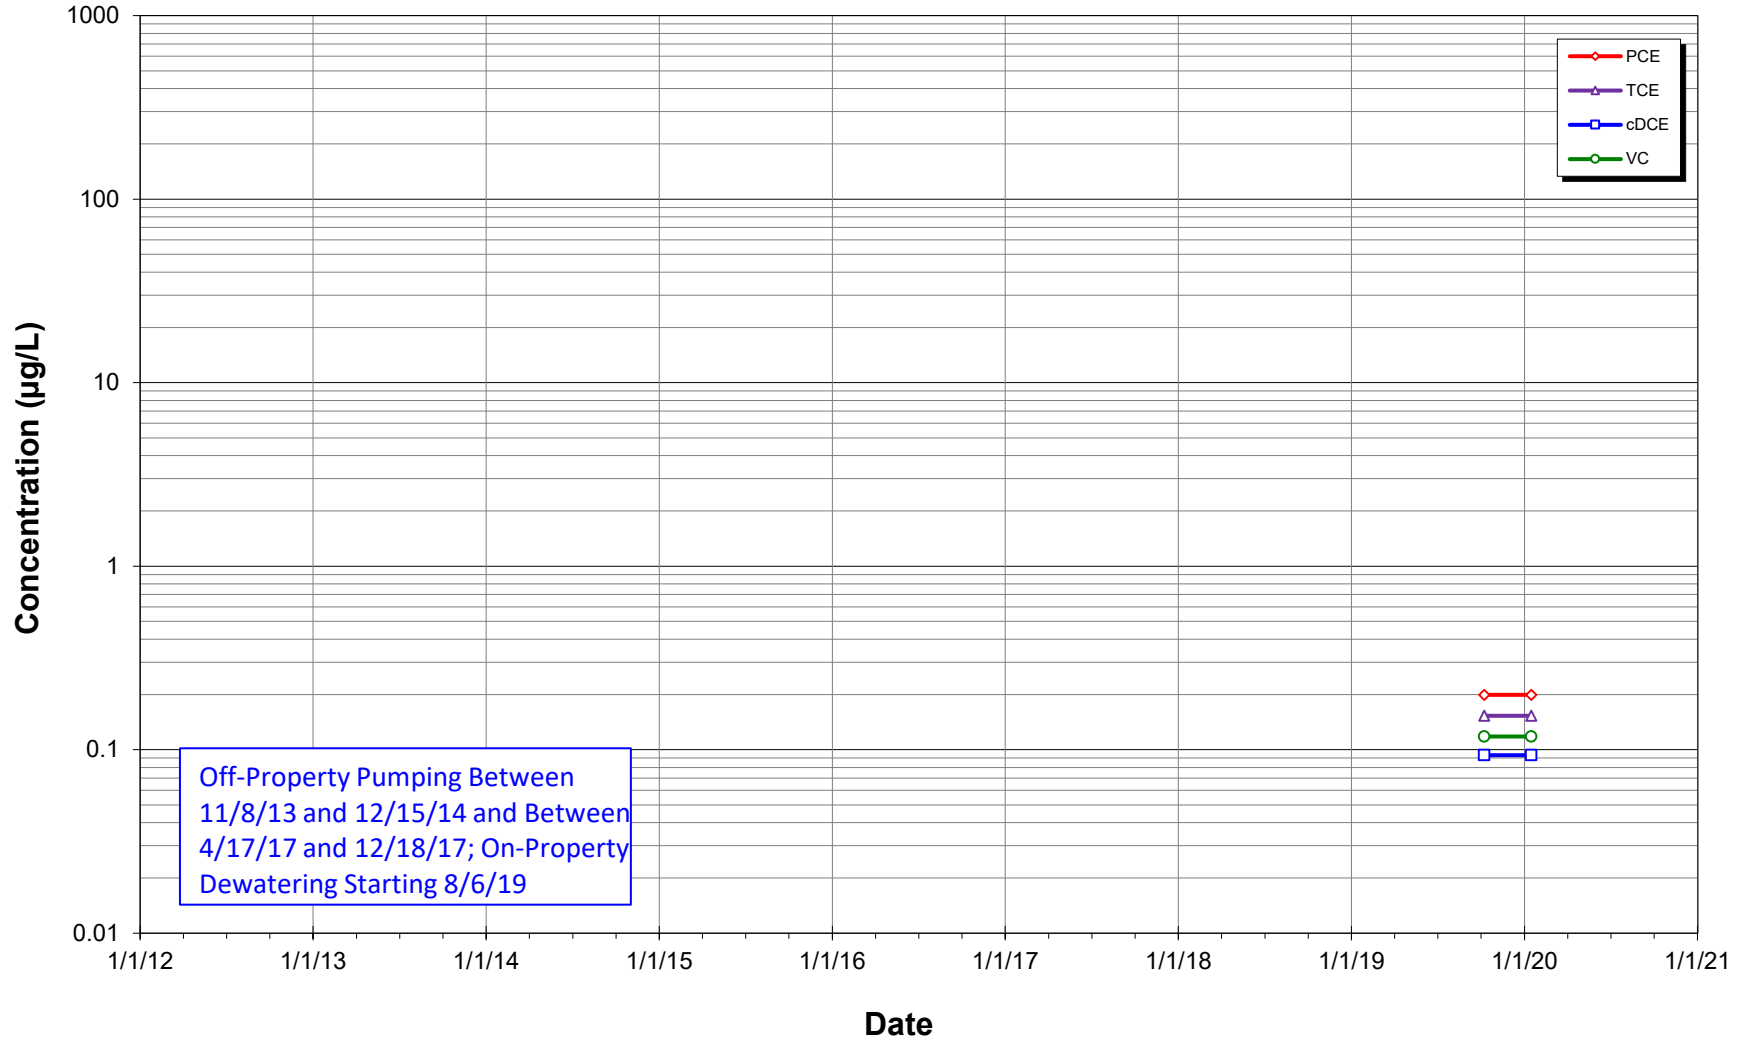

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-318 (-23.1 to -33.1 feet NAVD), 9th Avenue N
American Linen Supply Co–Dexter Ave Site

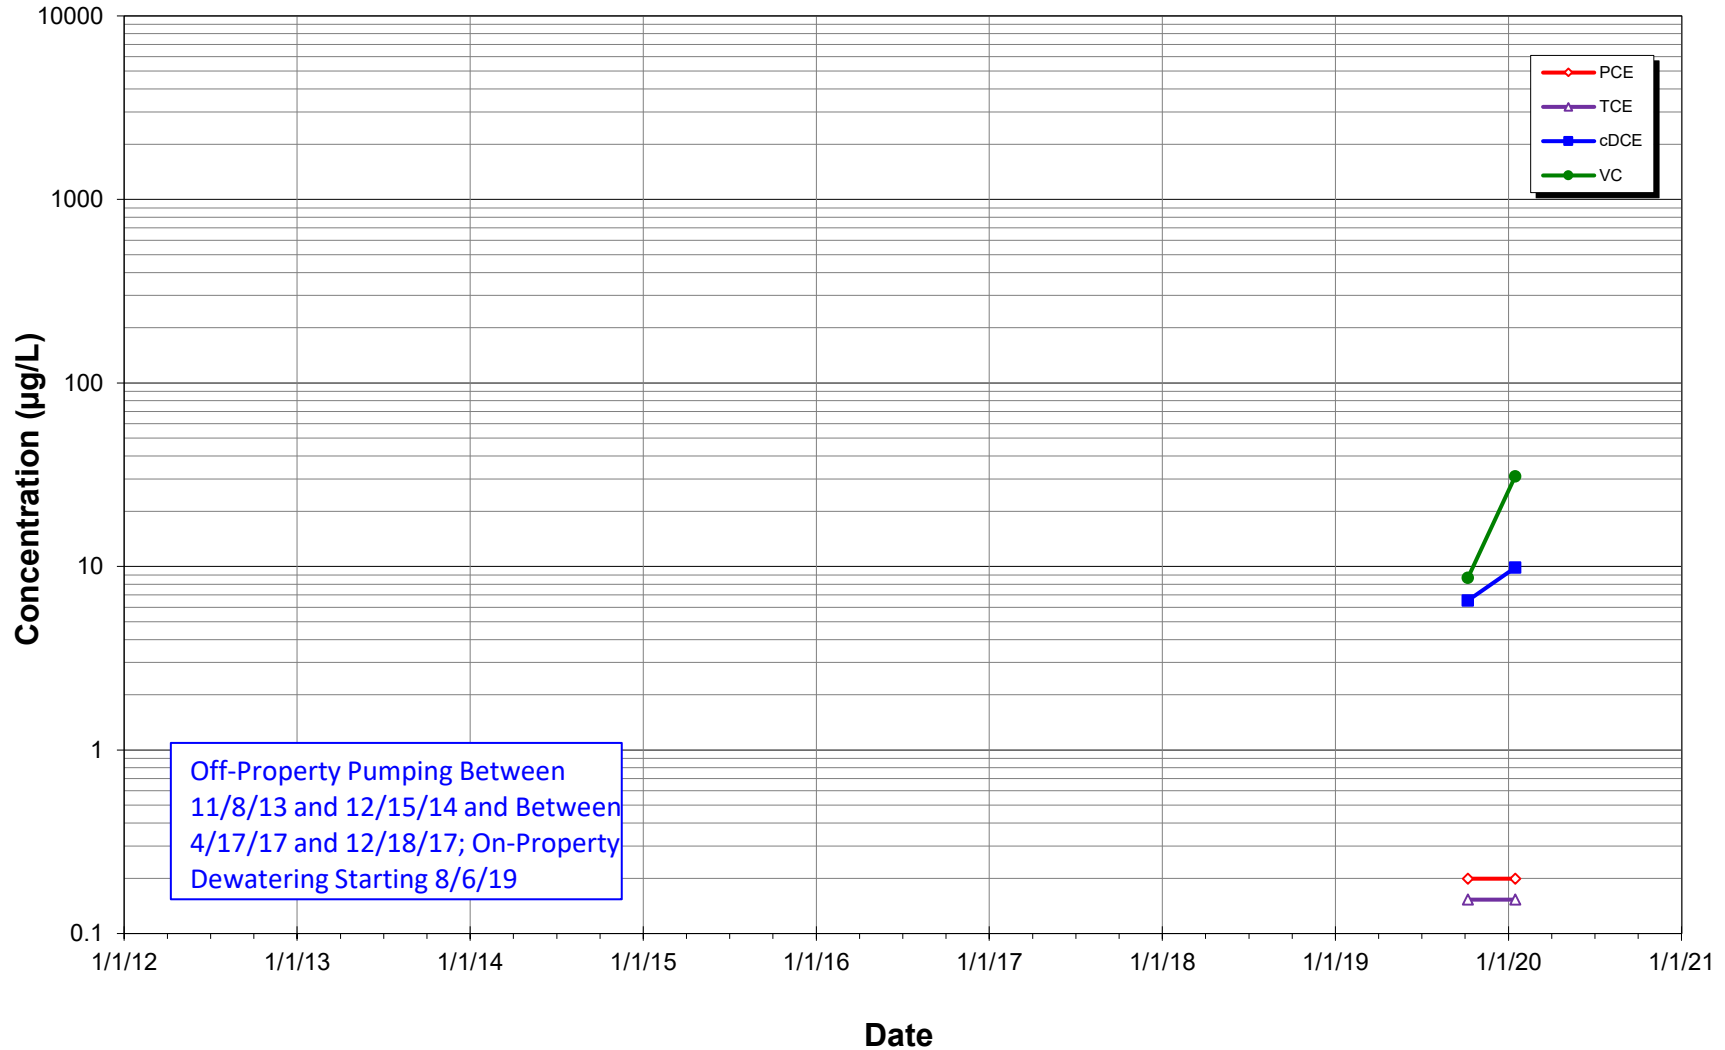

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-322 (-21.2 to -31.2 feet NAVD), 9th Avenue N
American Linen Supply Co–Dexter Ave Site

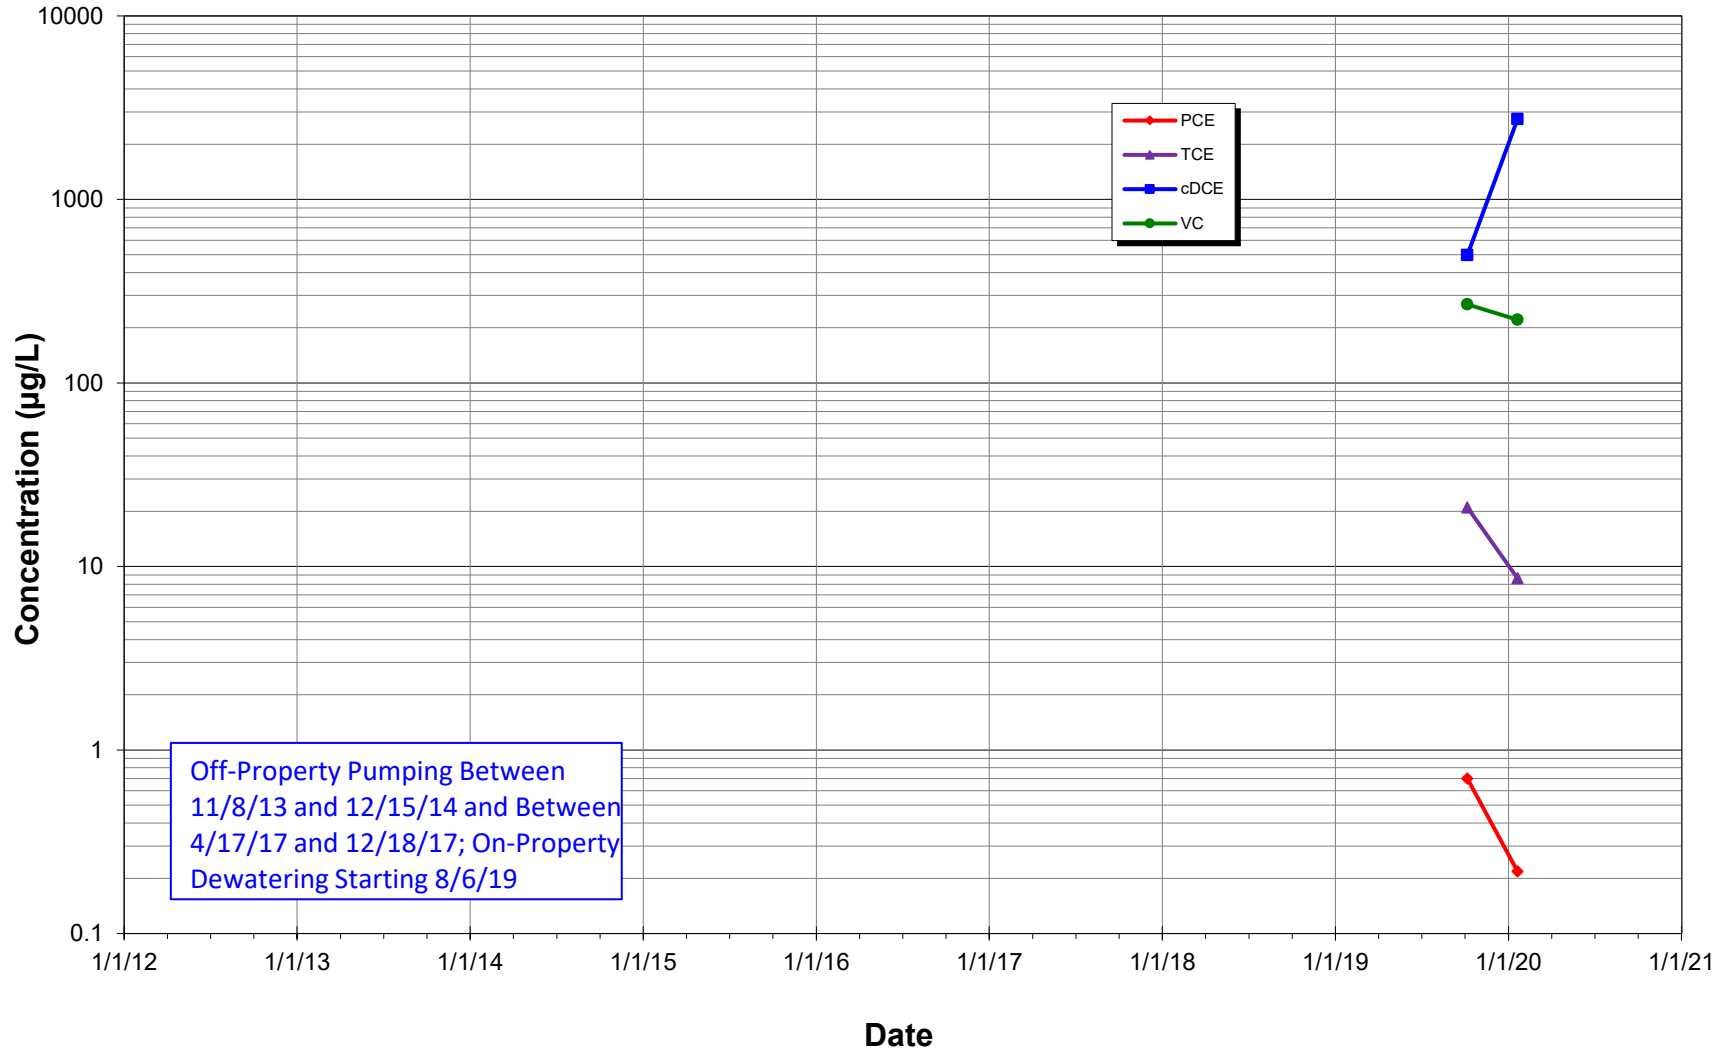

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-325 (7.0 to -3.0 feet NAVD), Mercer Street
American Linen Supply Co-Dexter Ave Site

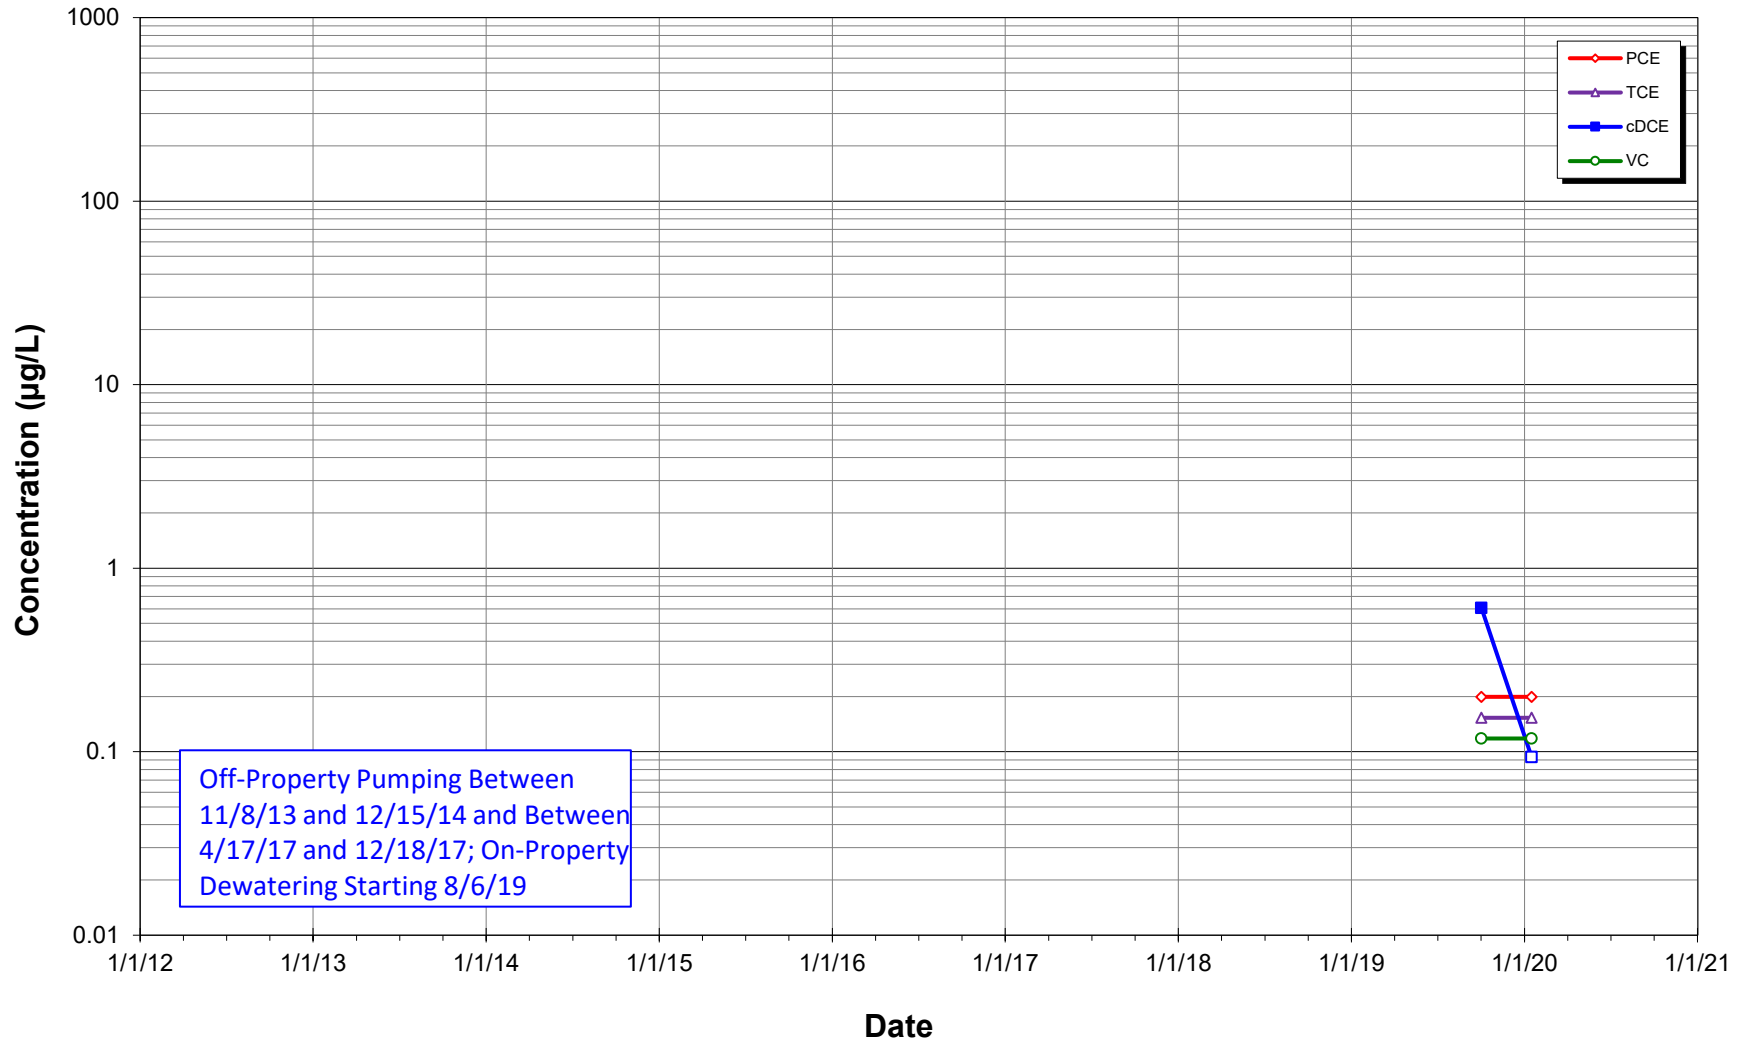

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-327 (3.6 to -6.3 feet NAVD), South Lake Union Park
American Linen Supply Co–Dexter Ave Site

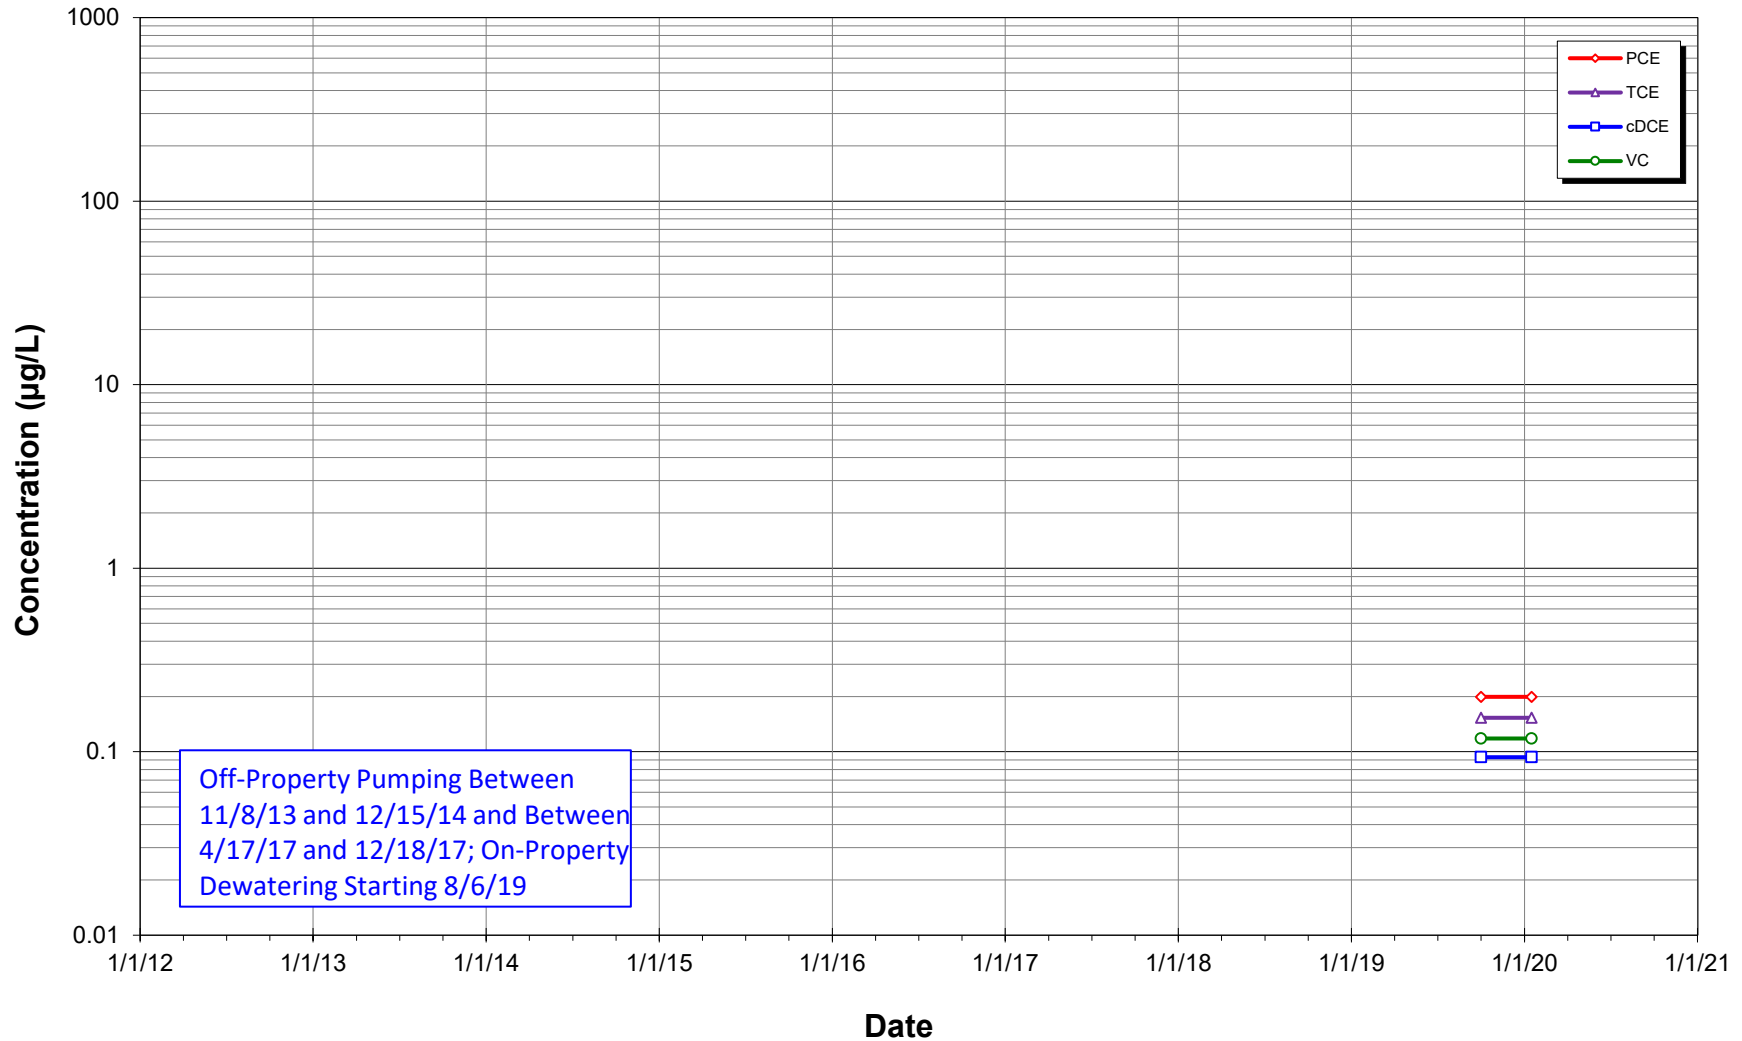

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
W-MW-01 (-25.1 to -35.1 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

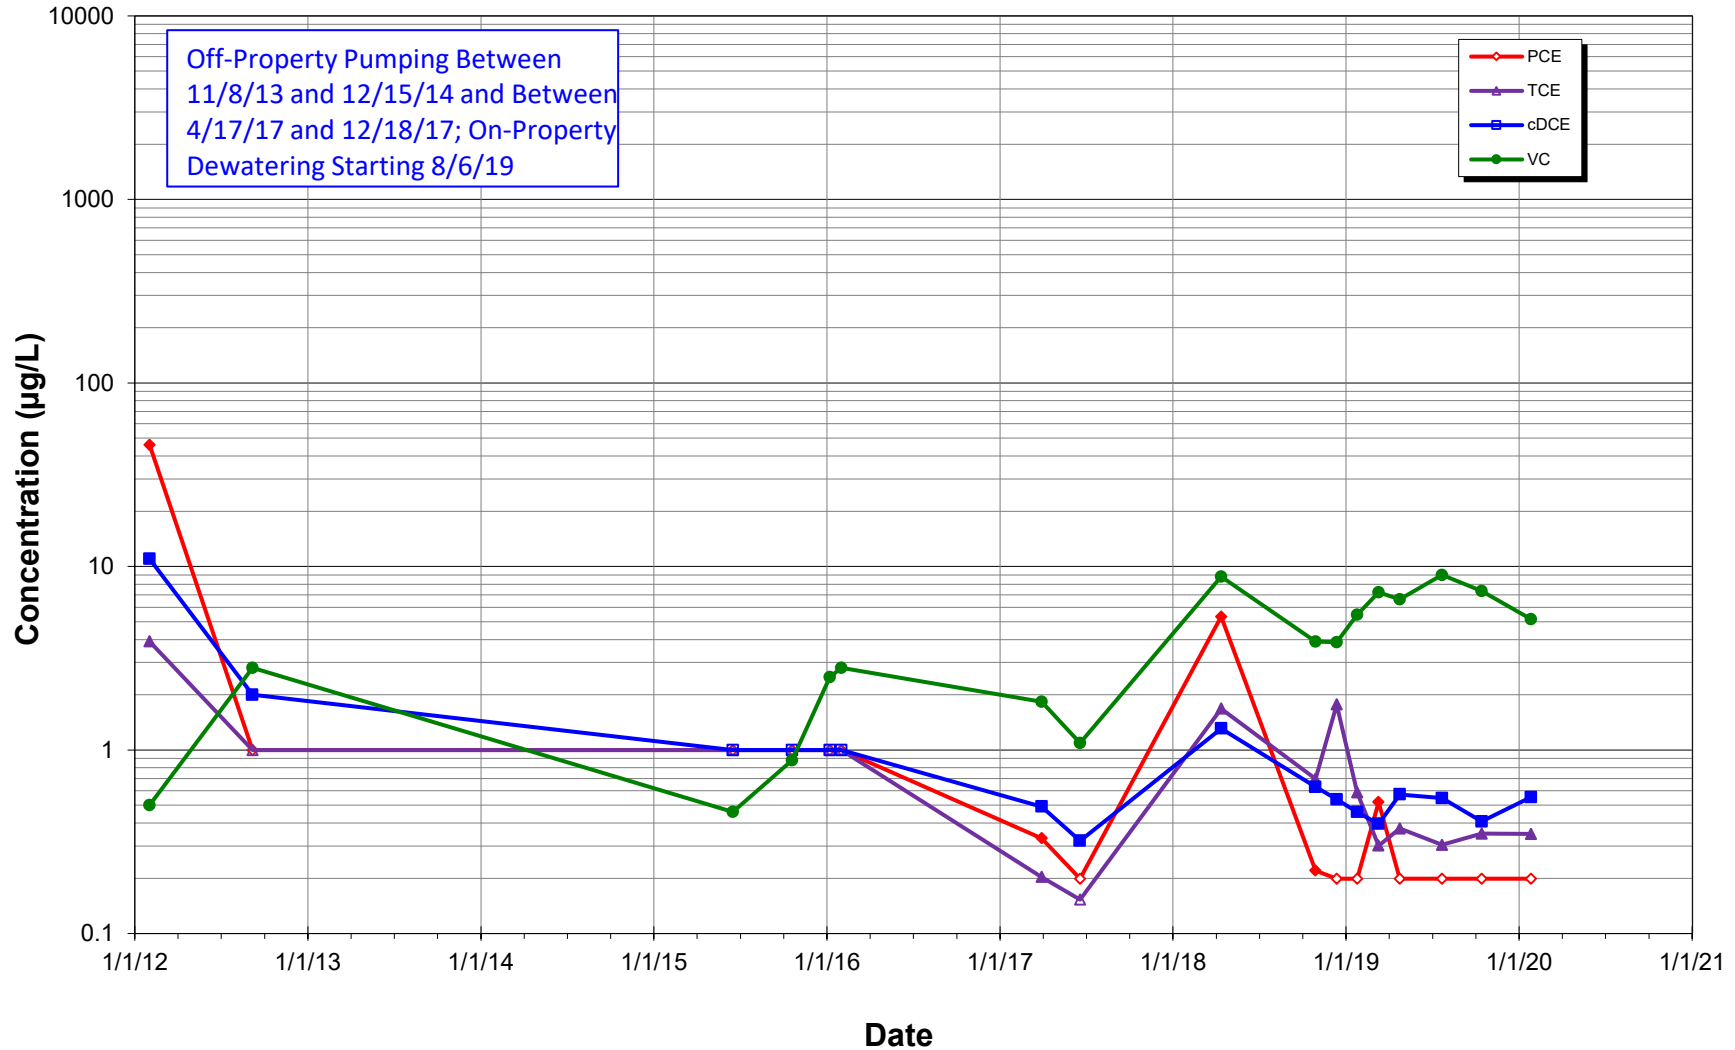

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
W-MW-02 (-26.5 to -36.5 feet NAVD), 8th Avenue North
American Linen Supply Co-Dexter Ave Site

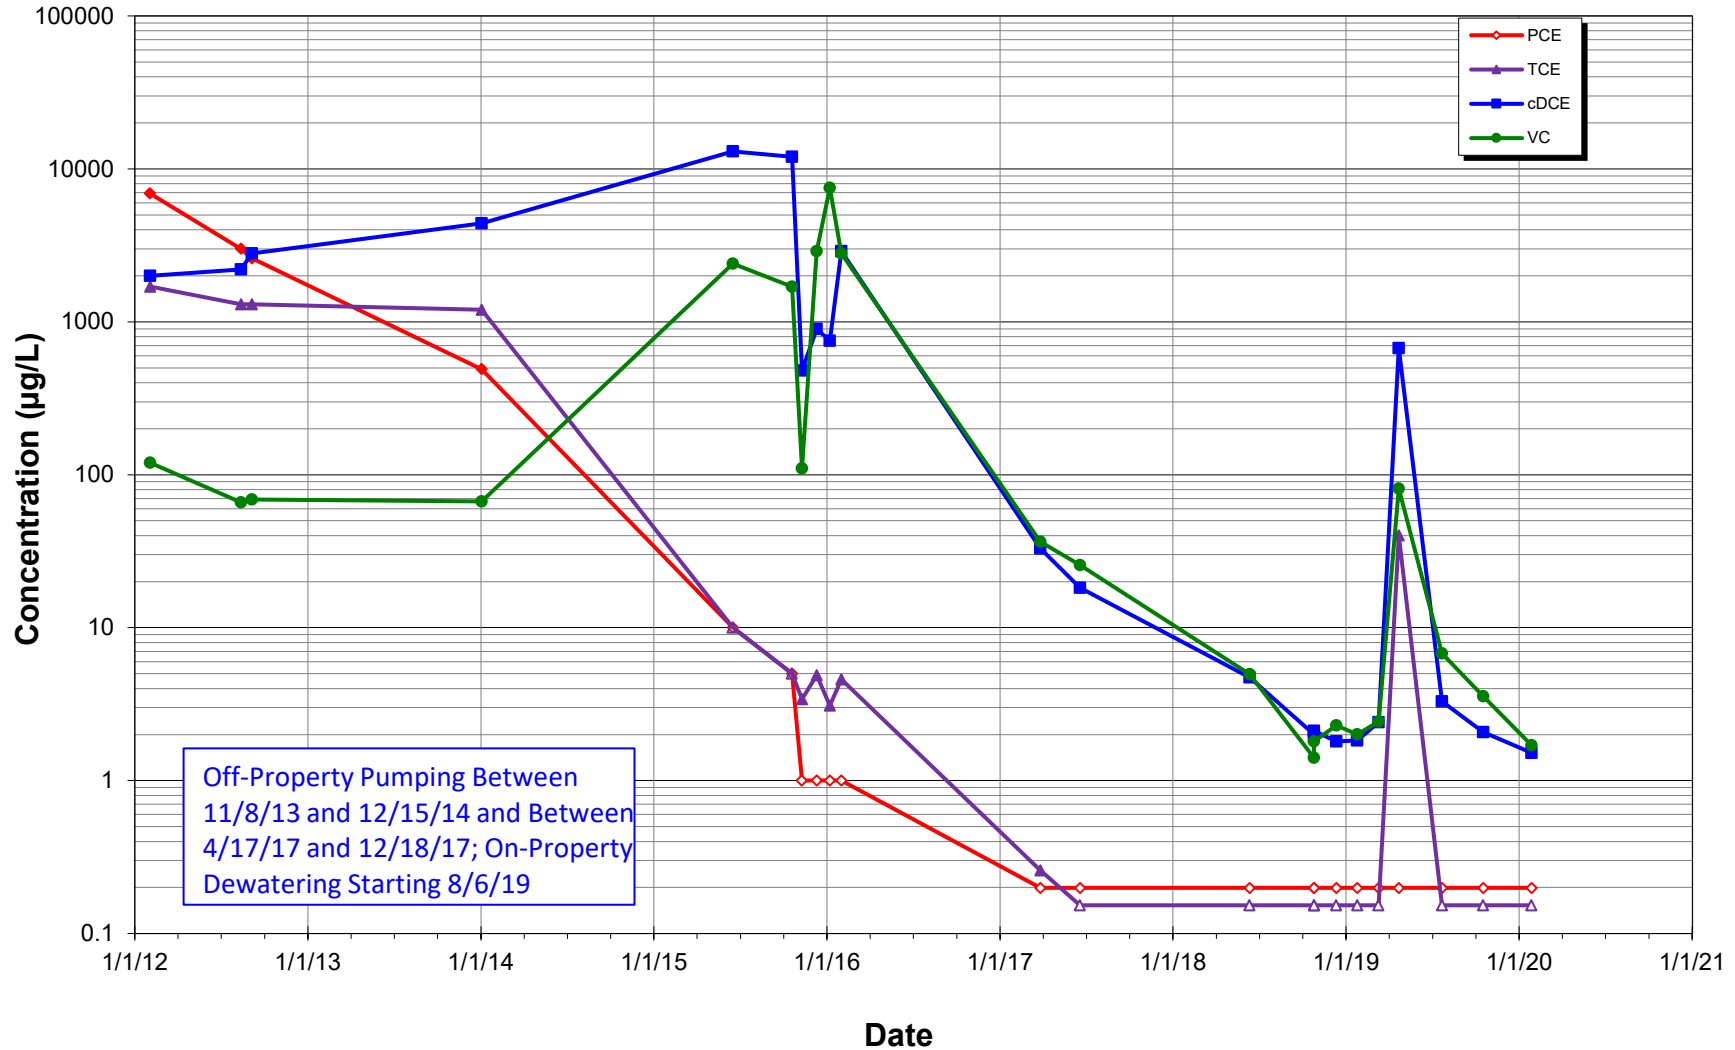

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
FMW-129 (-45.6 to -50.6 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

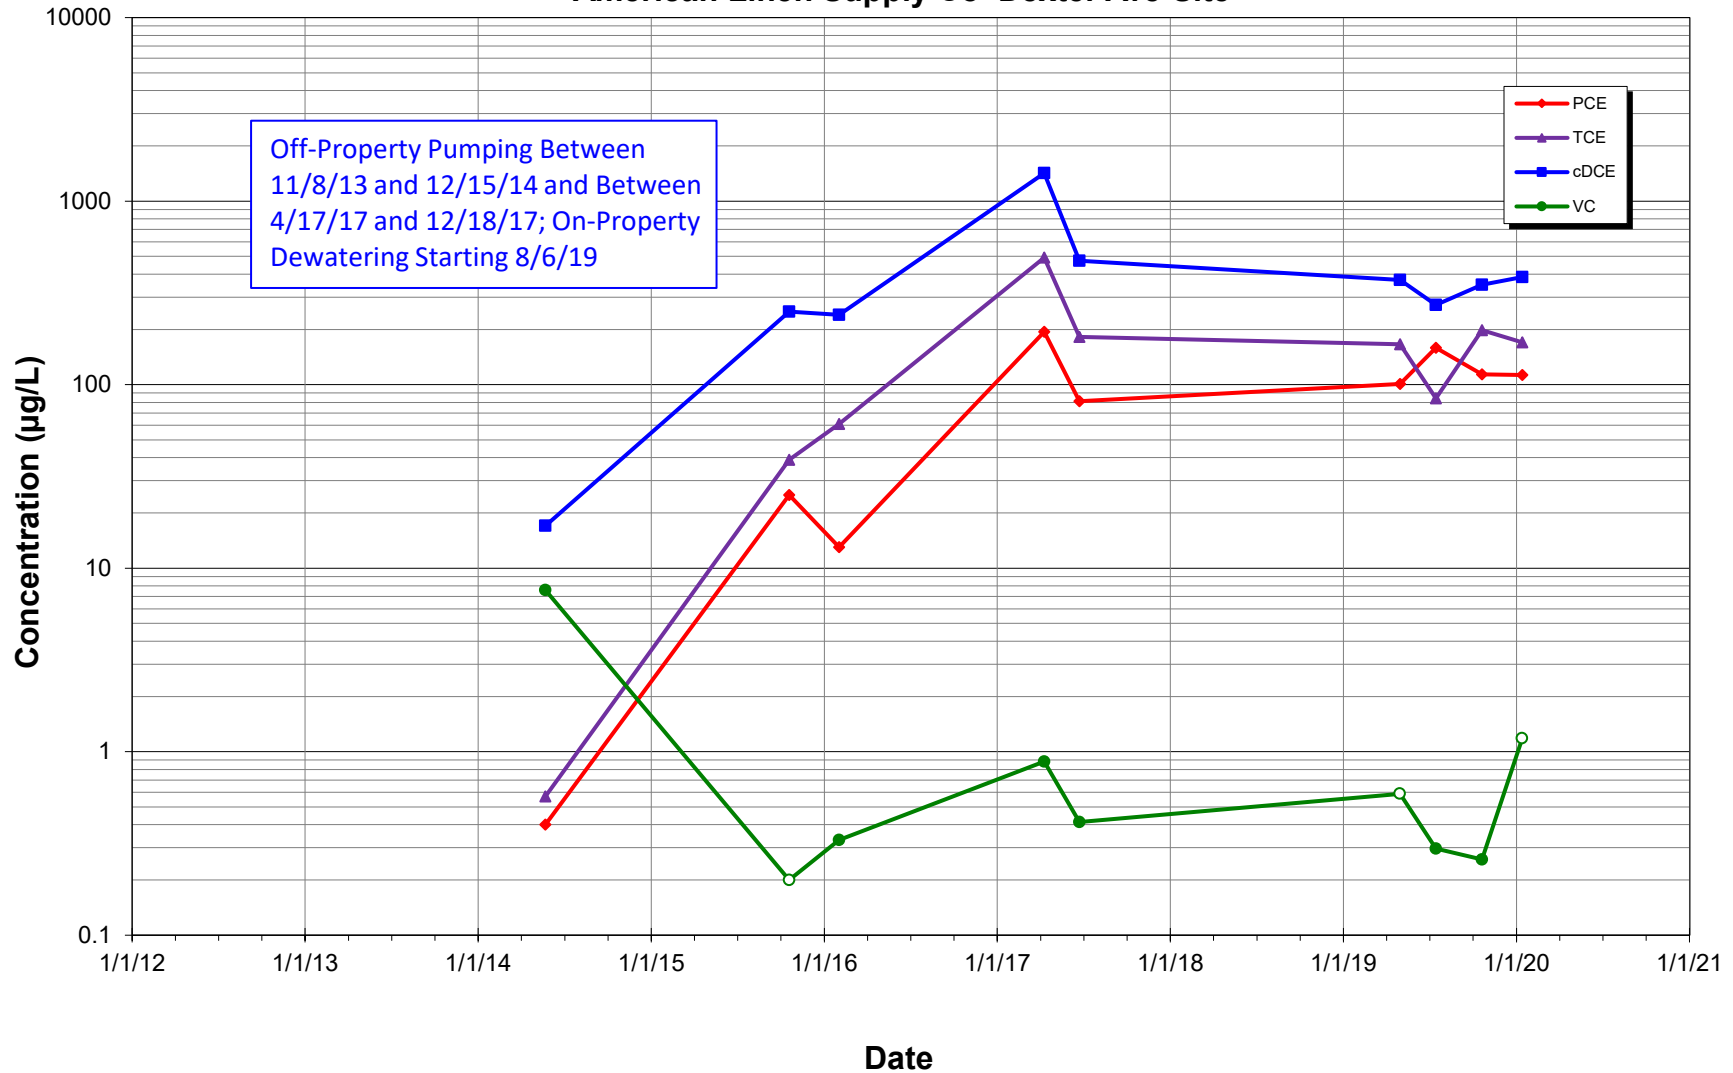

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
FMW-131 (-34.7 to -44.7 feet NAVD), Block 37
American Linen Supply Co-Dexter Ave Site

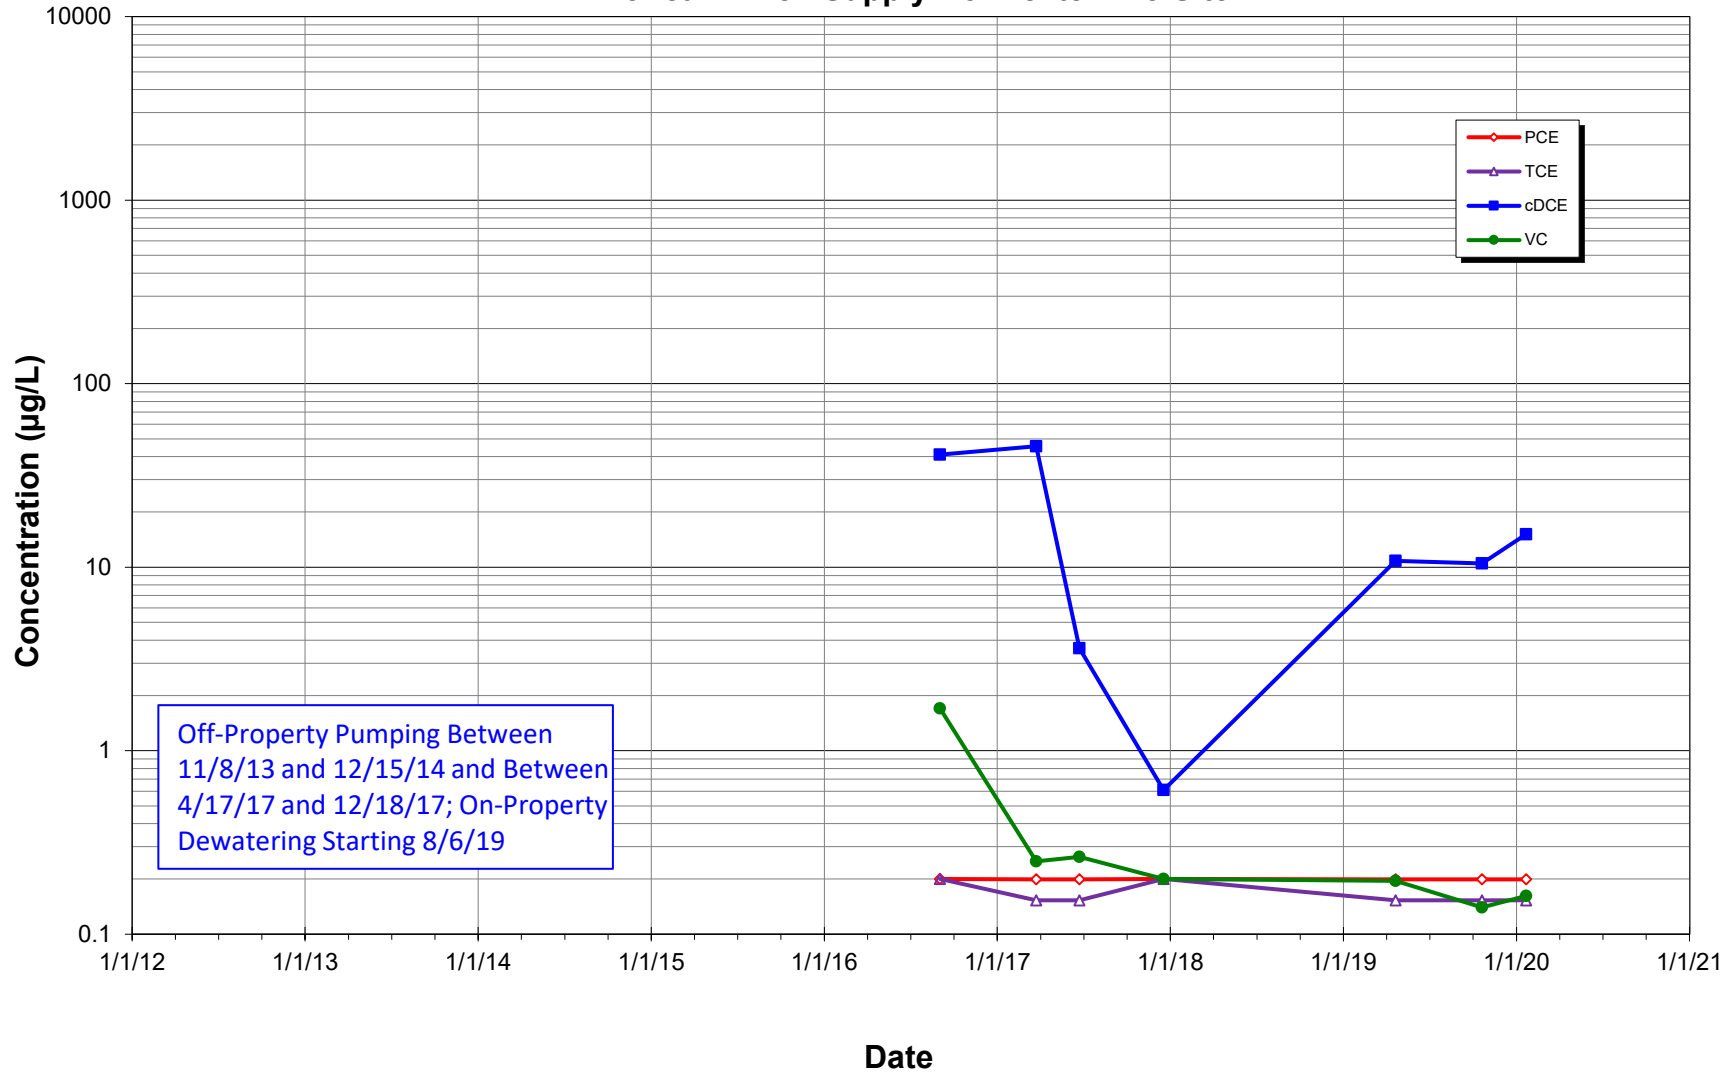

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
GEI-2 (-21.1 to -31.1 feet NAVD), Block 37
American Linen Supply Co-Dexter Ave Site

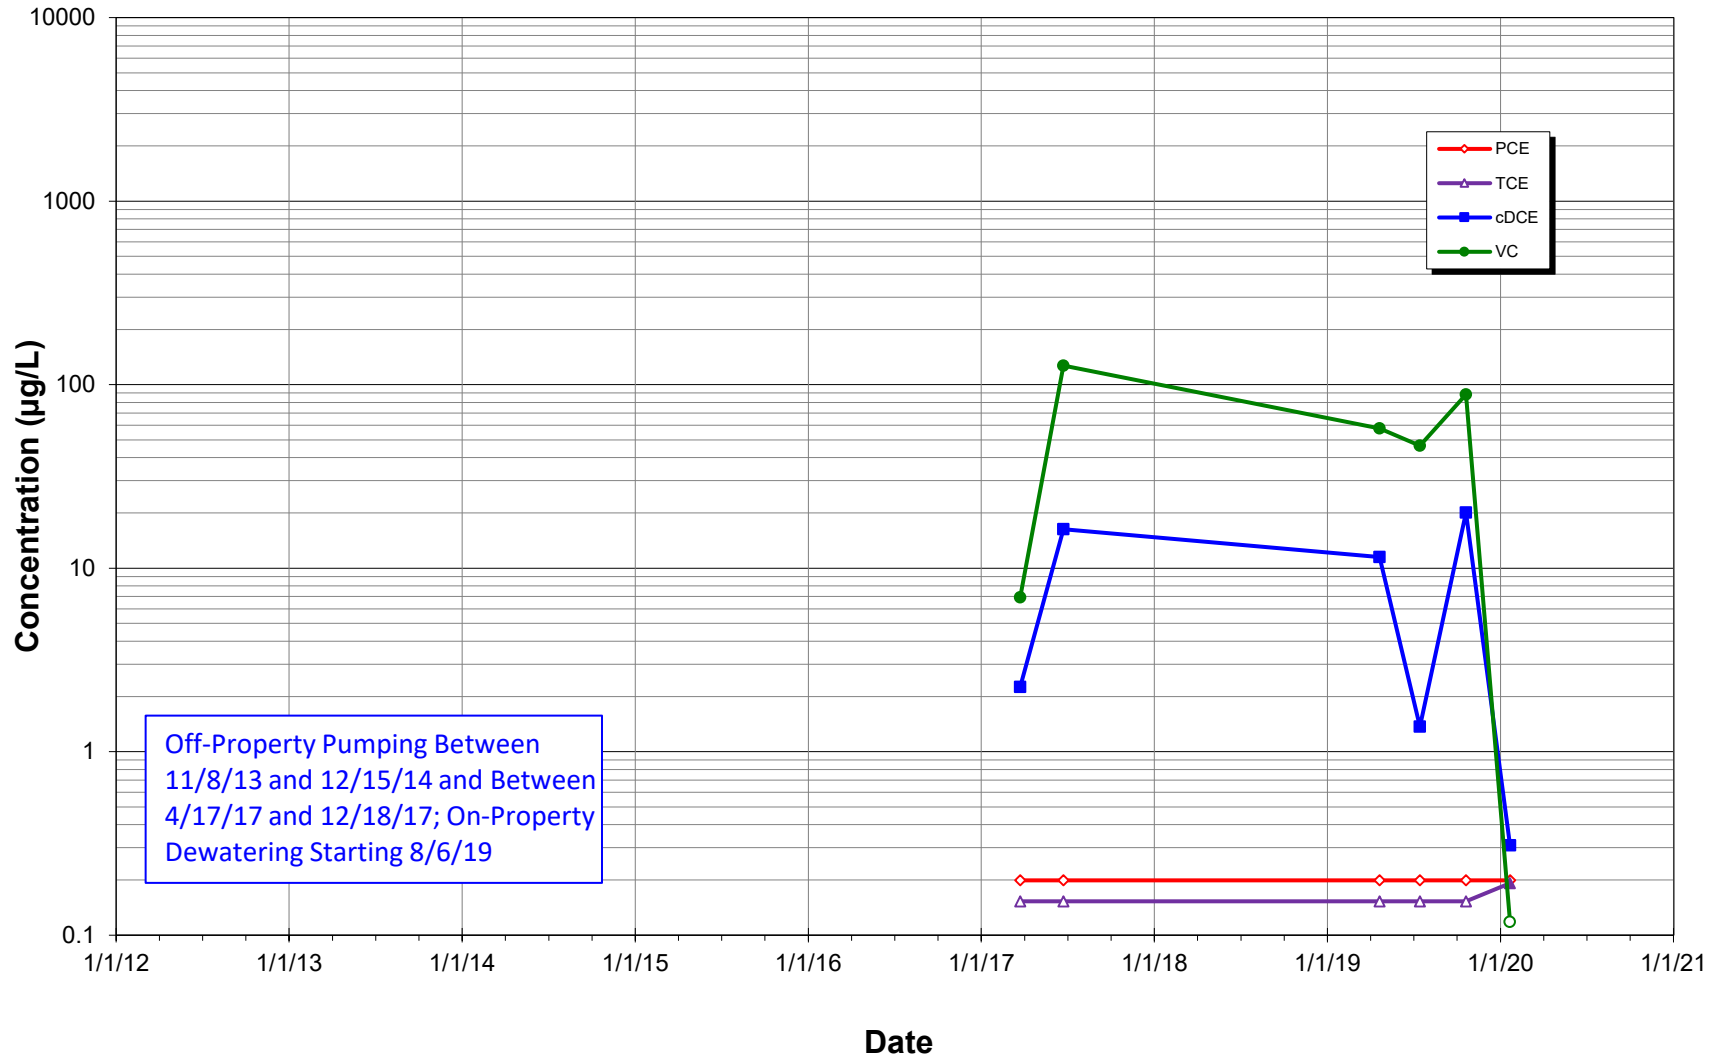

Off-Property Pumping Between 11/8/13 and 12/15/14 and Between 4/17/17 and 12/18/17; On-Property Dewatering Starting 8/6/19

- Notes:**
 1) All results detected below the laboratory MDLs are shown as hollow data points .
 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW102 (-65.8 to -75.8 feet NAVD), Valley Street
American Linen Supply Co–Dexter Ave Site**

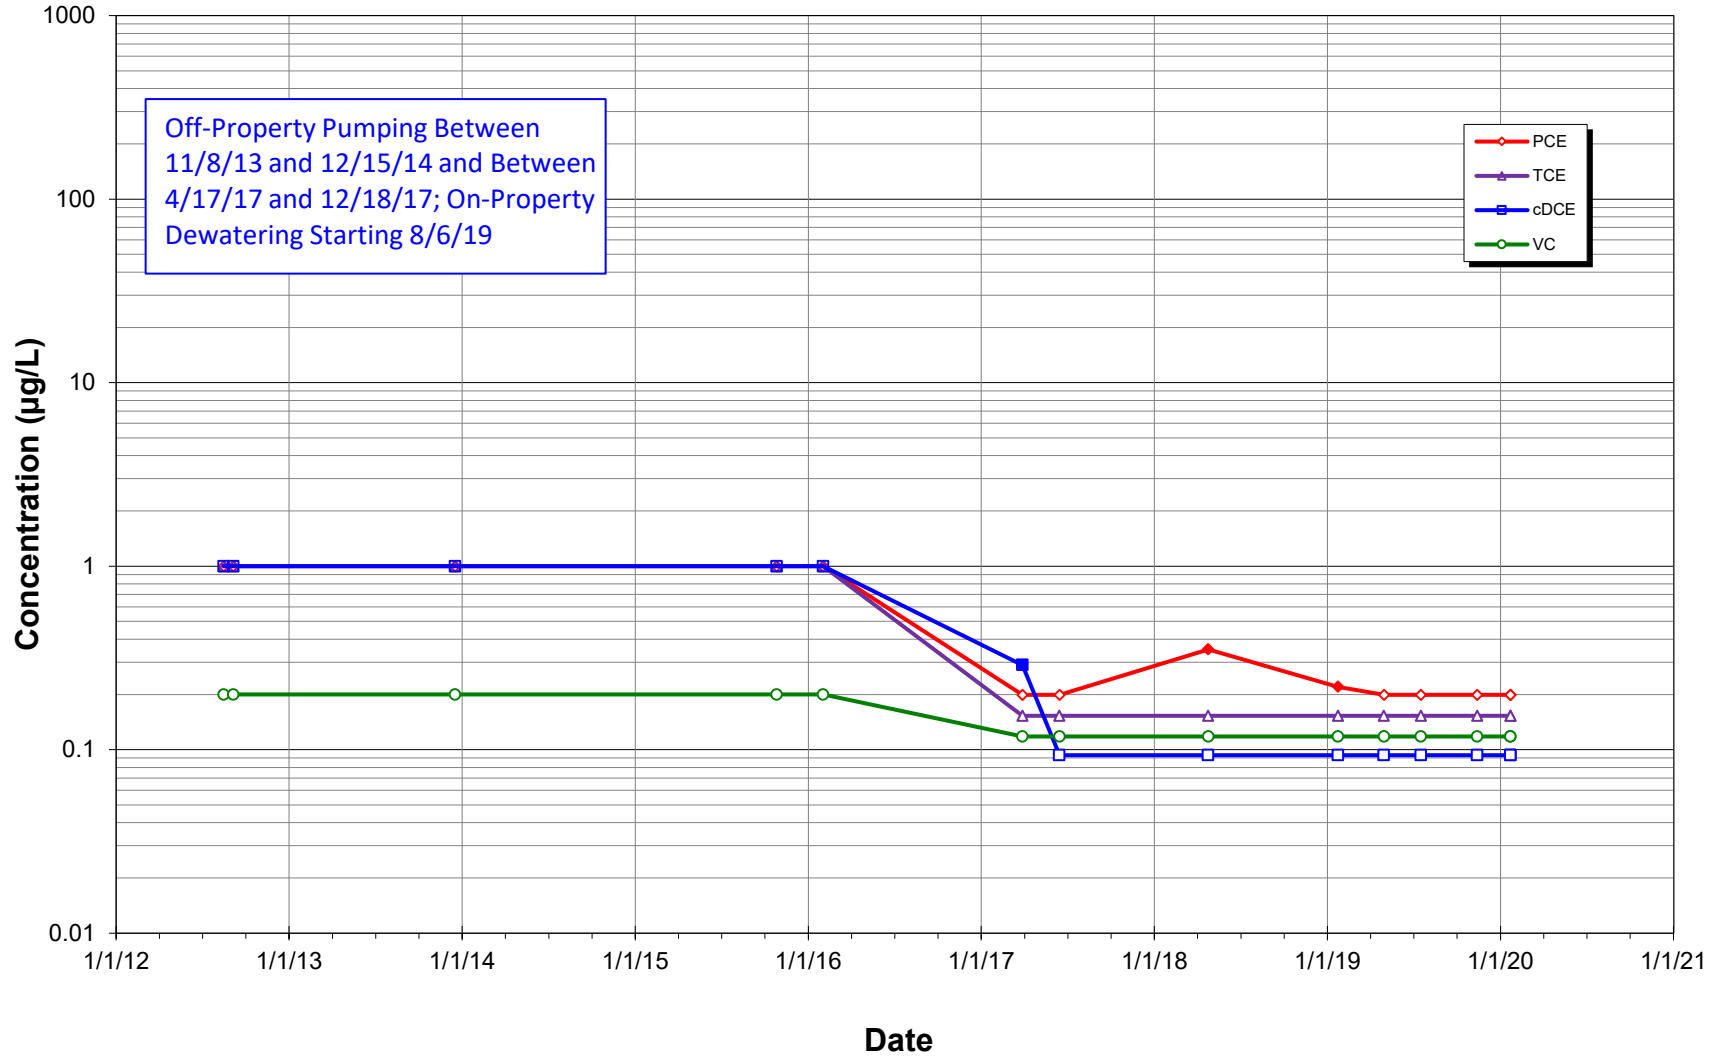

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW103 (-67.6 to -77.6 feet NAVD), Alley
American Linen Supply Co–Dexter Ave Site**

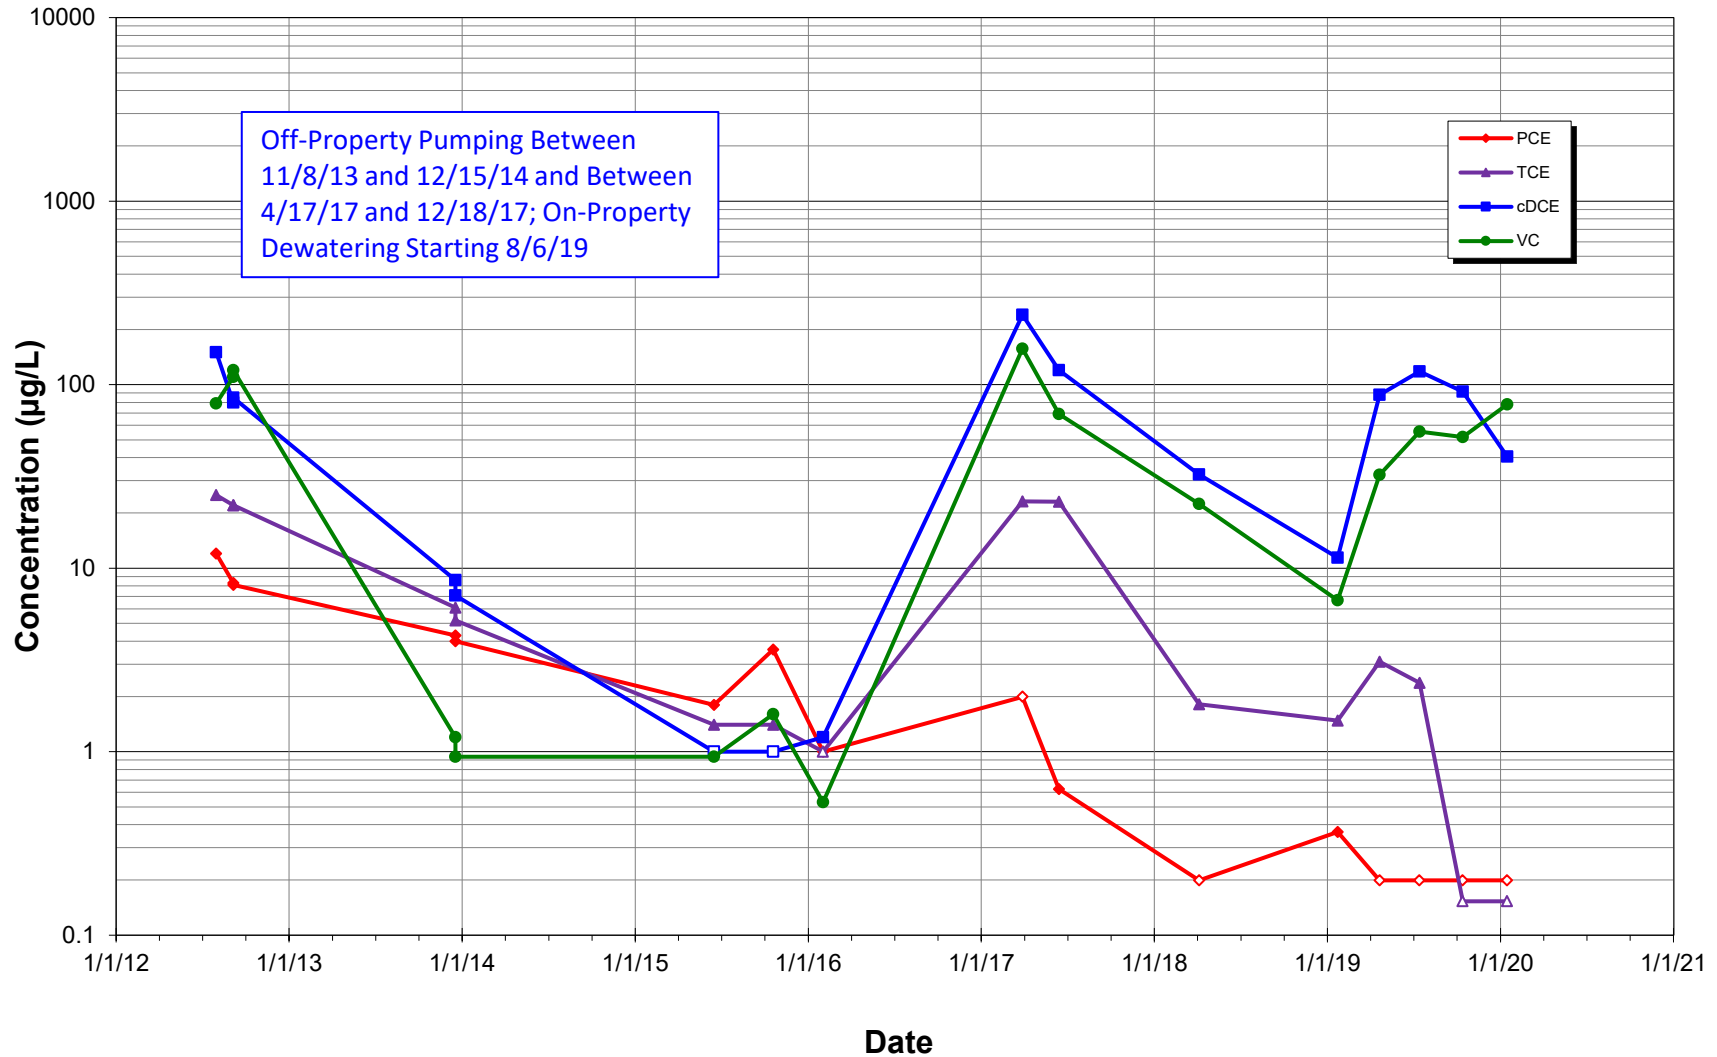

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW104 (-76.3 to -86.3 feet NAVD), 8th Avenue North
American Linen Supply Co-Dexter Ave Site

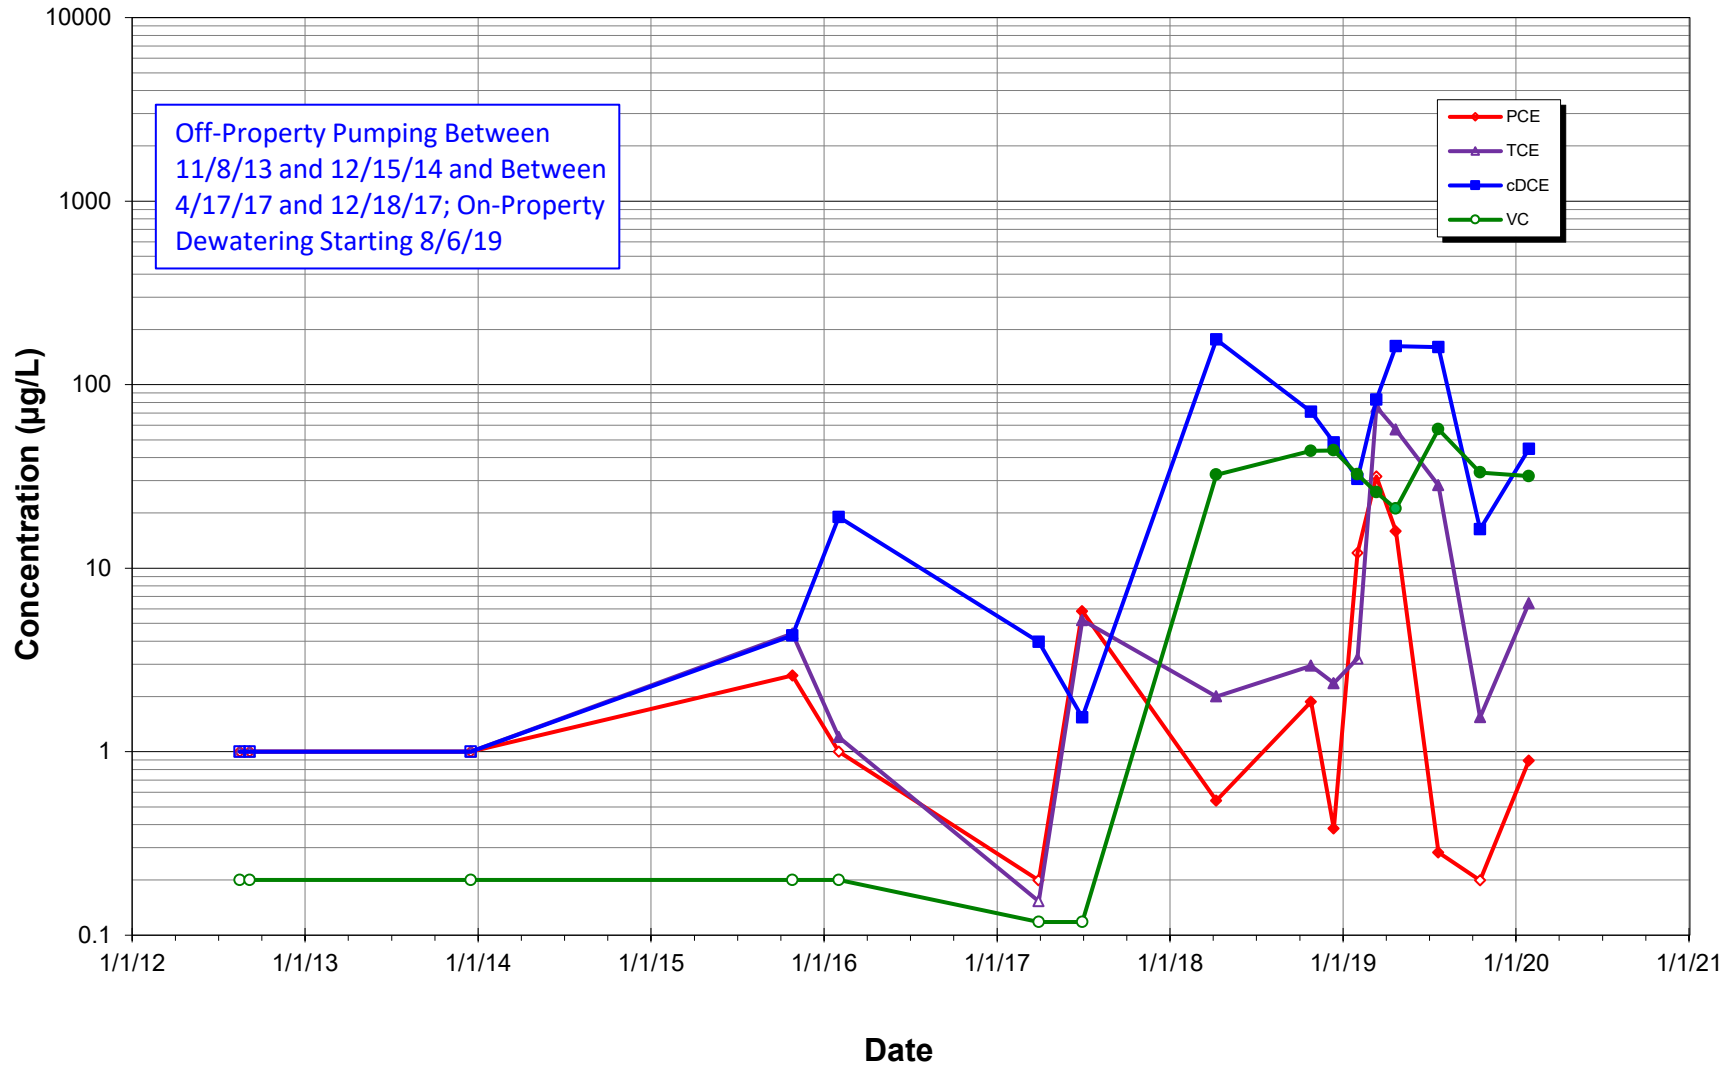

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW105 (-85.3 to -95.3 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

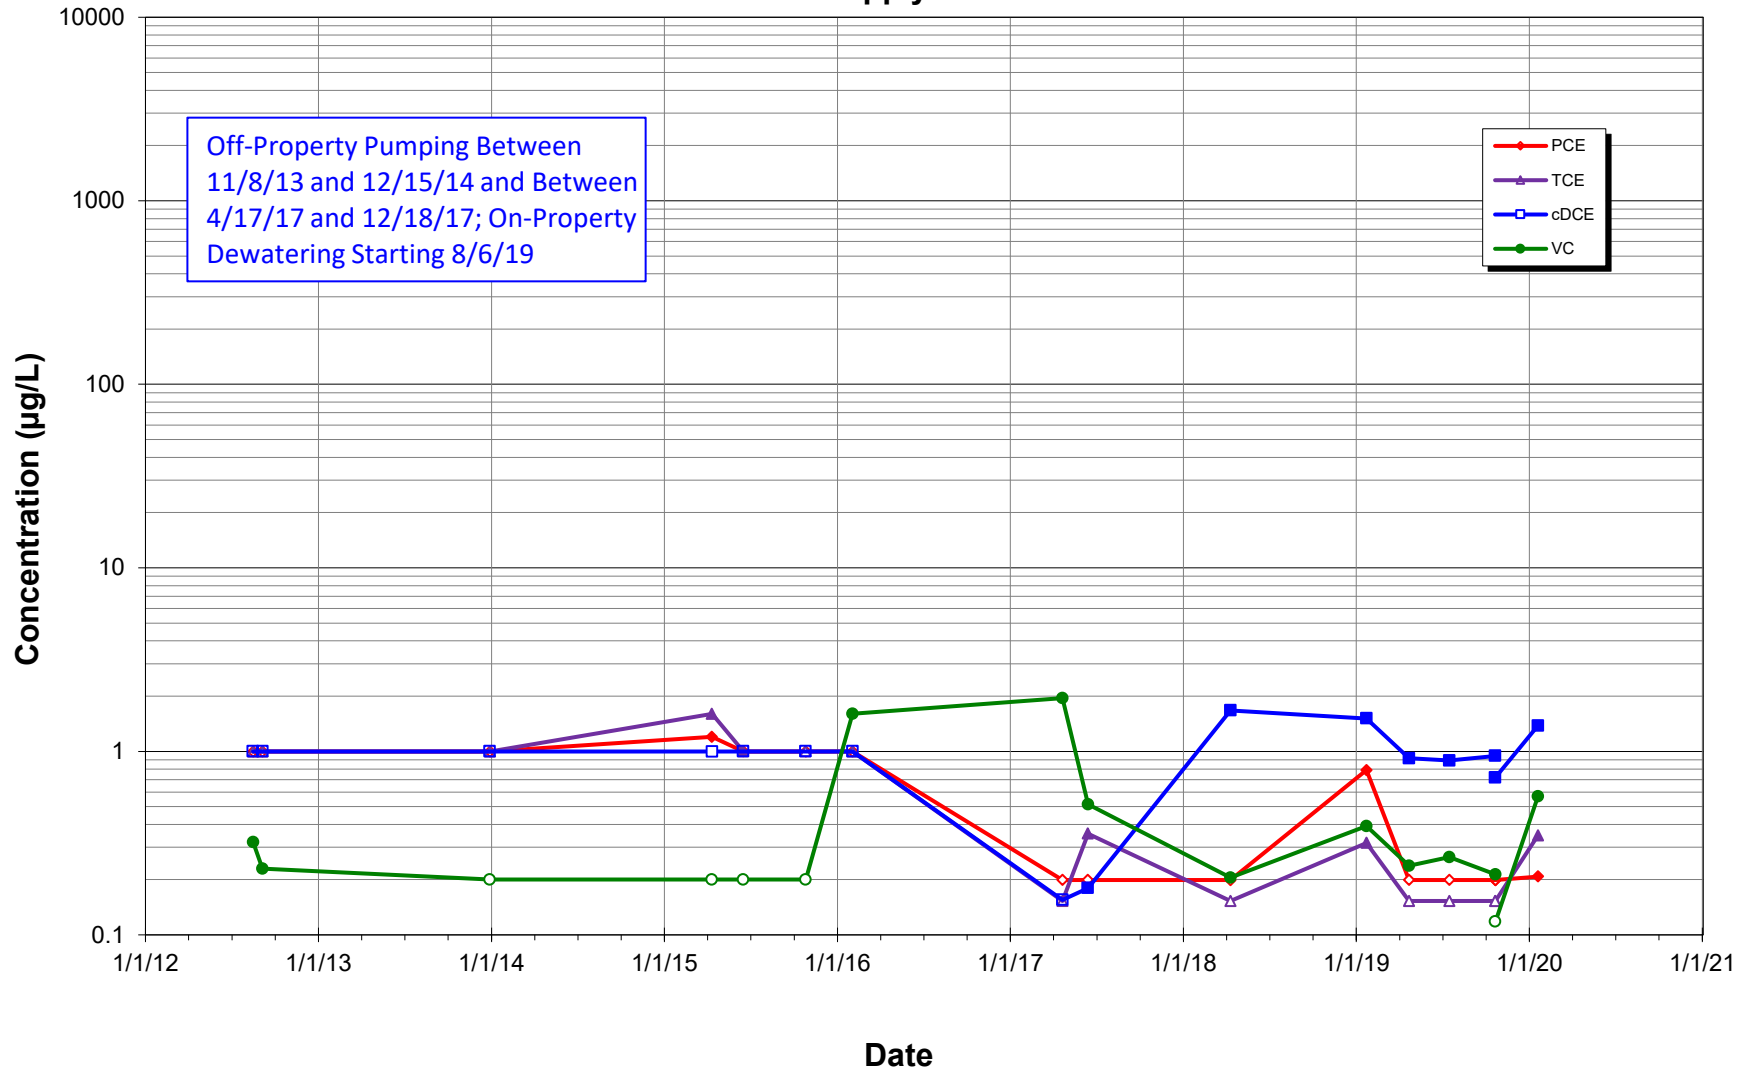

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW106 (-78.0 to -88.0 feet NAVD), South of Roy Street
American Linen Supply Co–Dexter Ave Site**

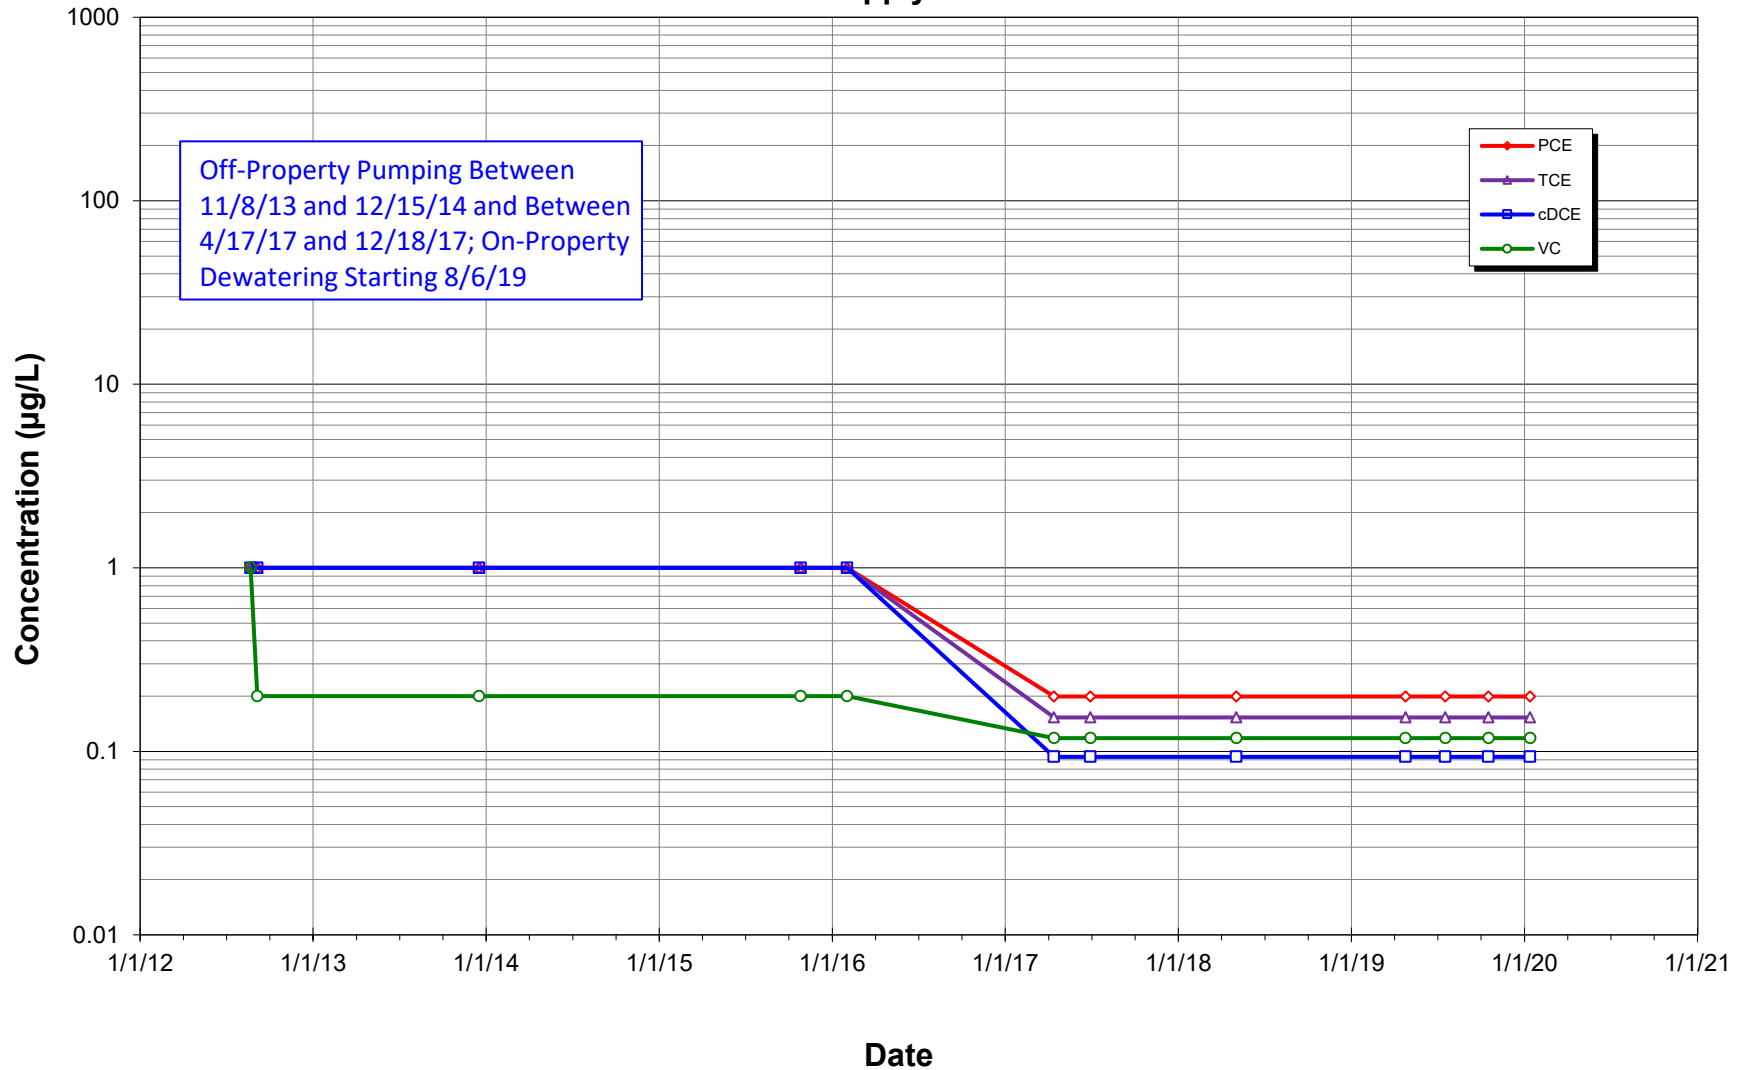

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW113 (-36.8 to -46.8 feet NAVD), 9th Avenue North
American Linen Supply Co-Dexter Ave Site

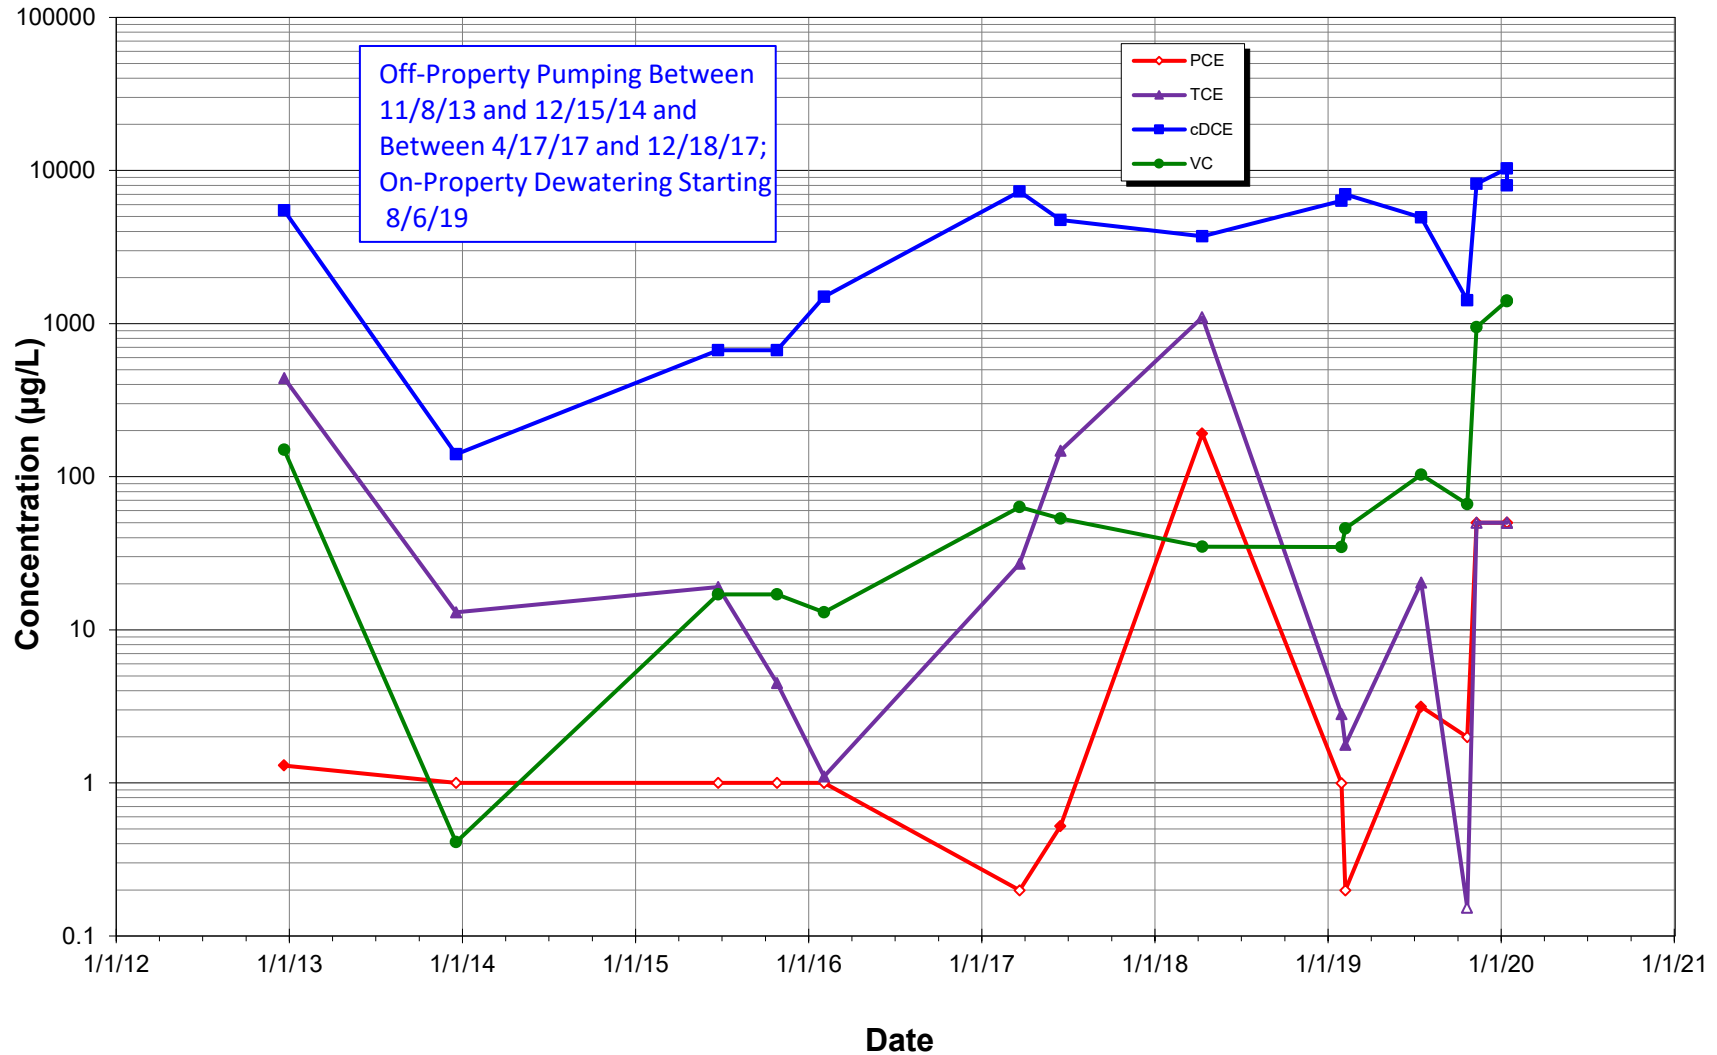

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


**Concentration vs Time
MW122 (-75.0 to -85.0 feet NAVD), SCL Parcel
American Linen Supply Co-Dexter Ave Site**

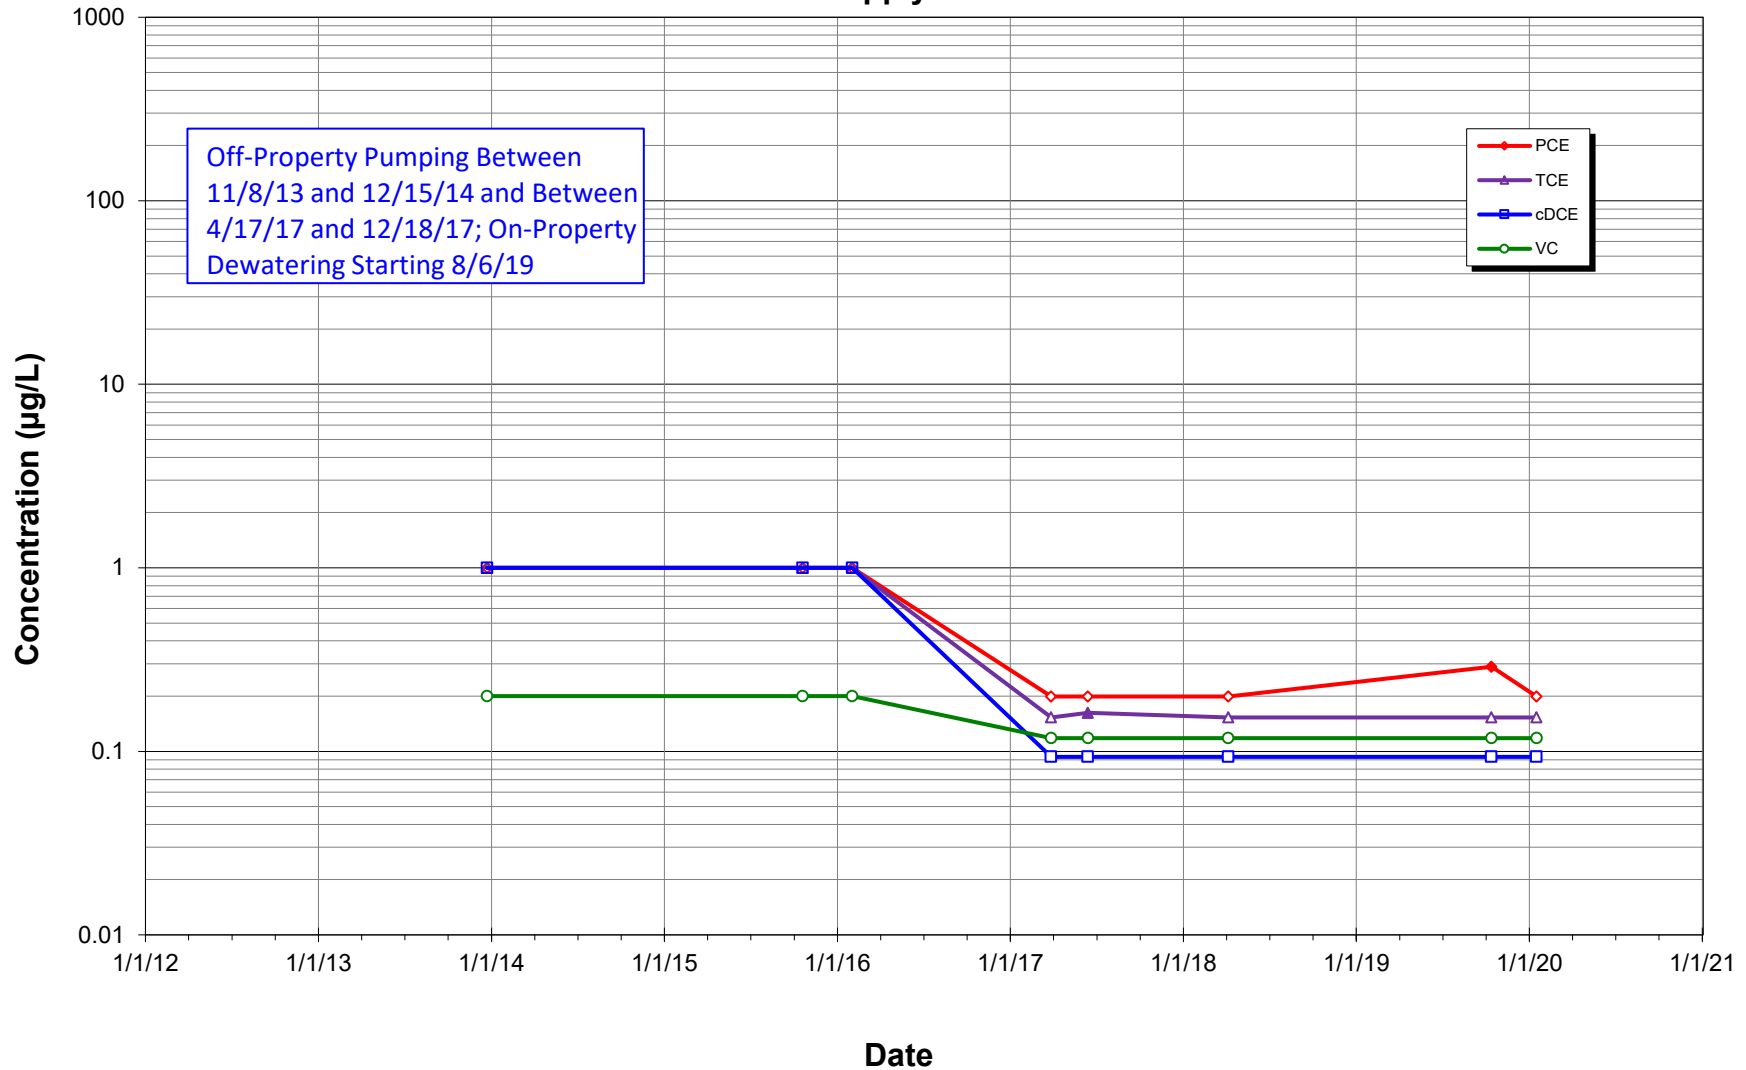

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW123 (-42.5 to -52.5 feet NAVD), Westlake Avenue North
American Linen Supply Co-Dexter Ave Site

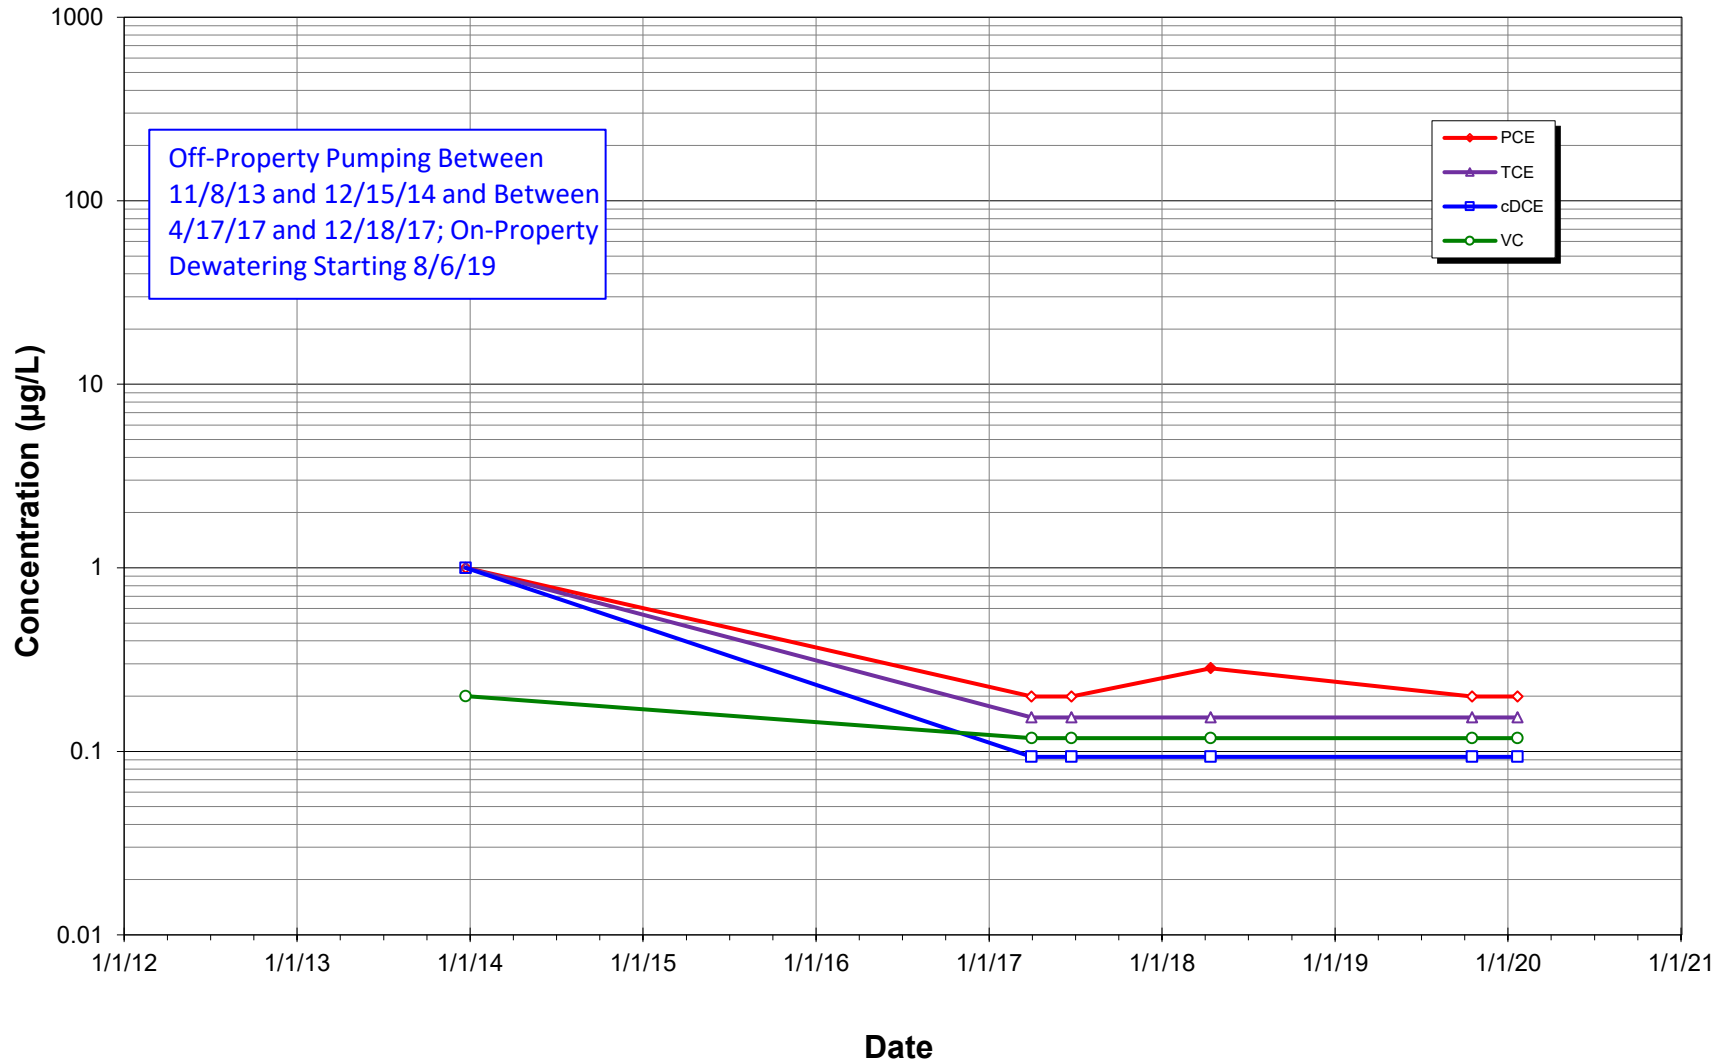

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW124 (-53.8 to -63.8 feet NAVD), Valley Street
American Linen Supply Co–Dexter Ave Site

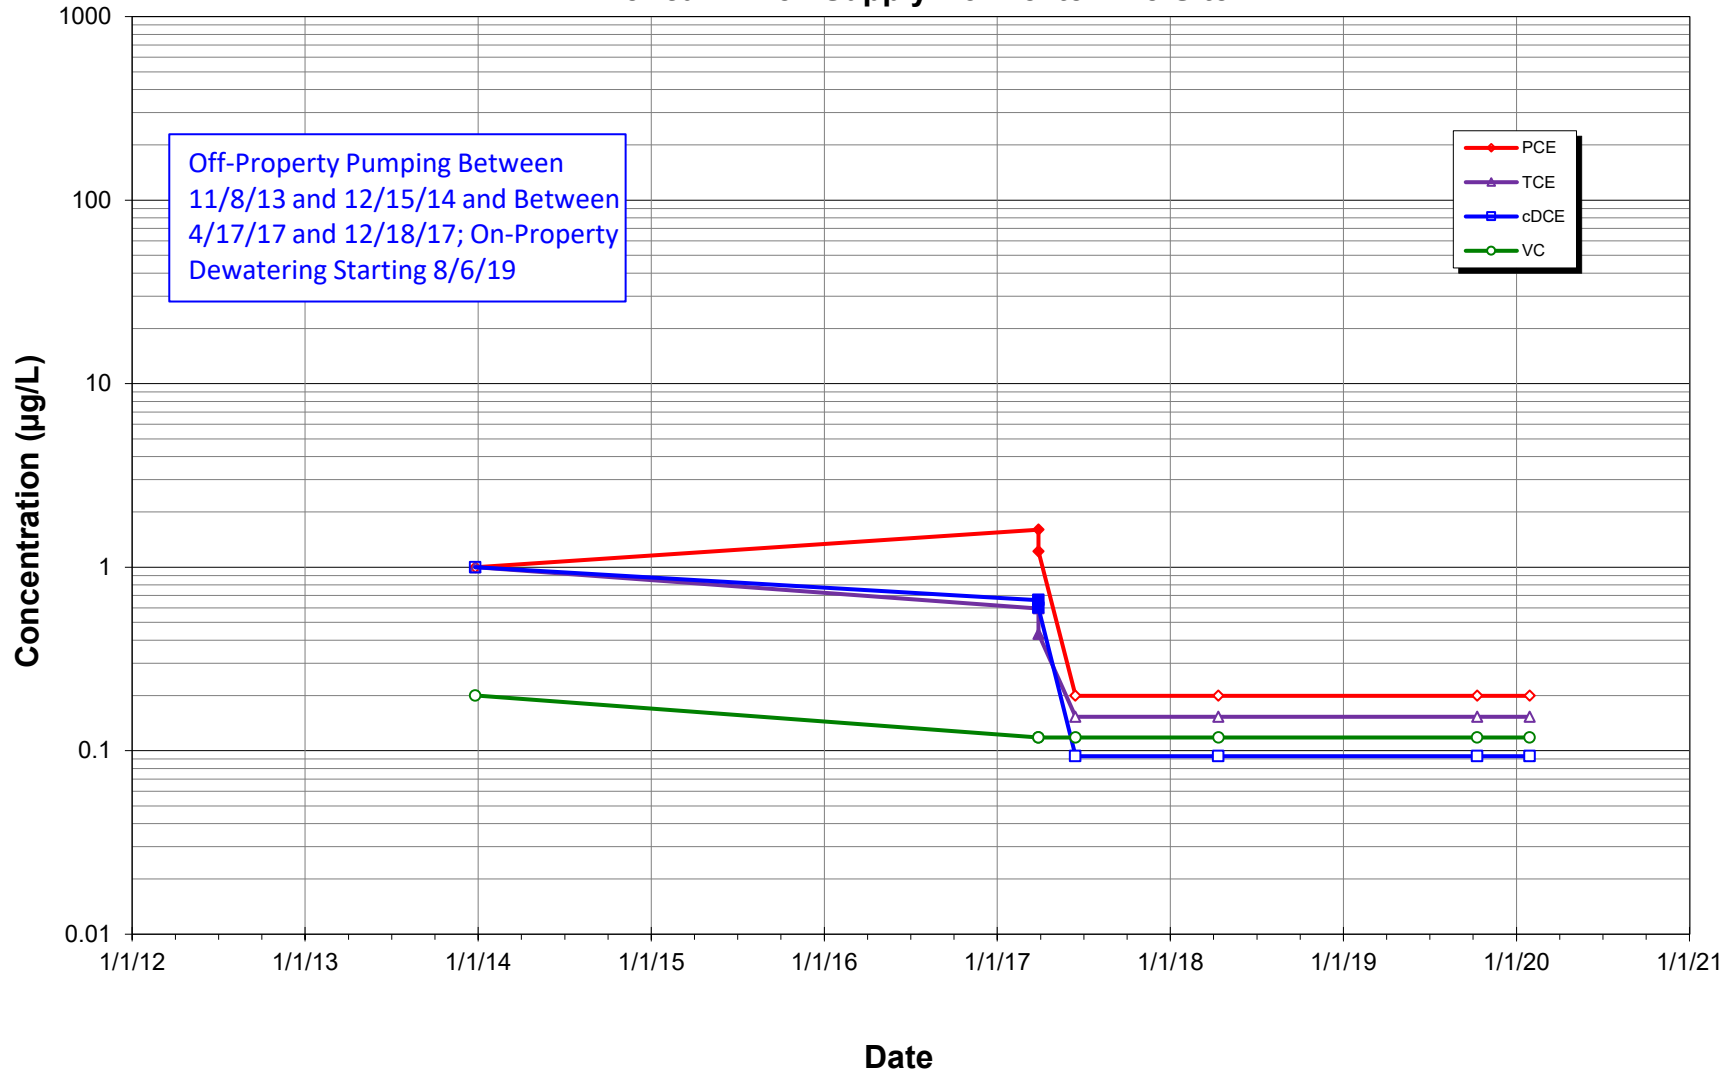

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW128 (-30.8 to -40.8 feet NAVD), Westlake Avenue North
American Linen Supply Co-Dexter Ave Site

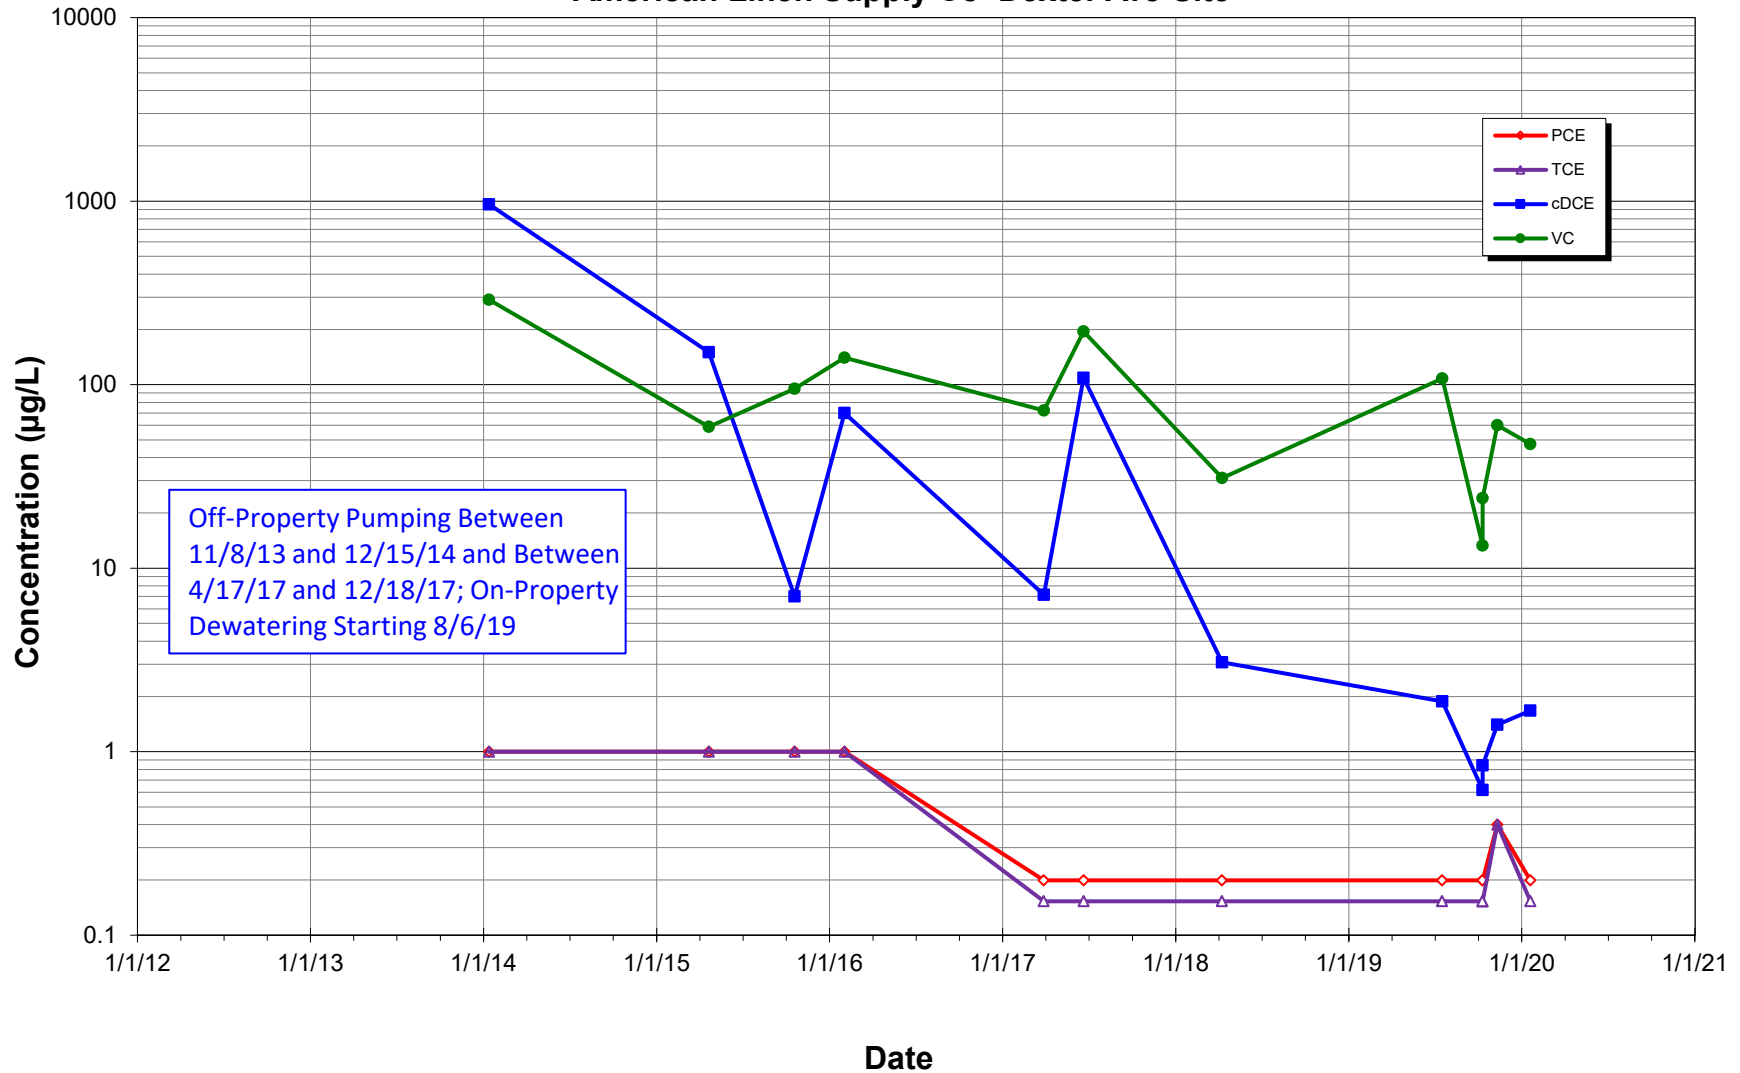

Notes:


- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW-138 (-47.5 to -57.5 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

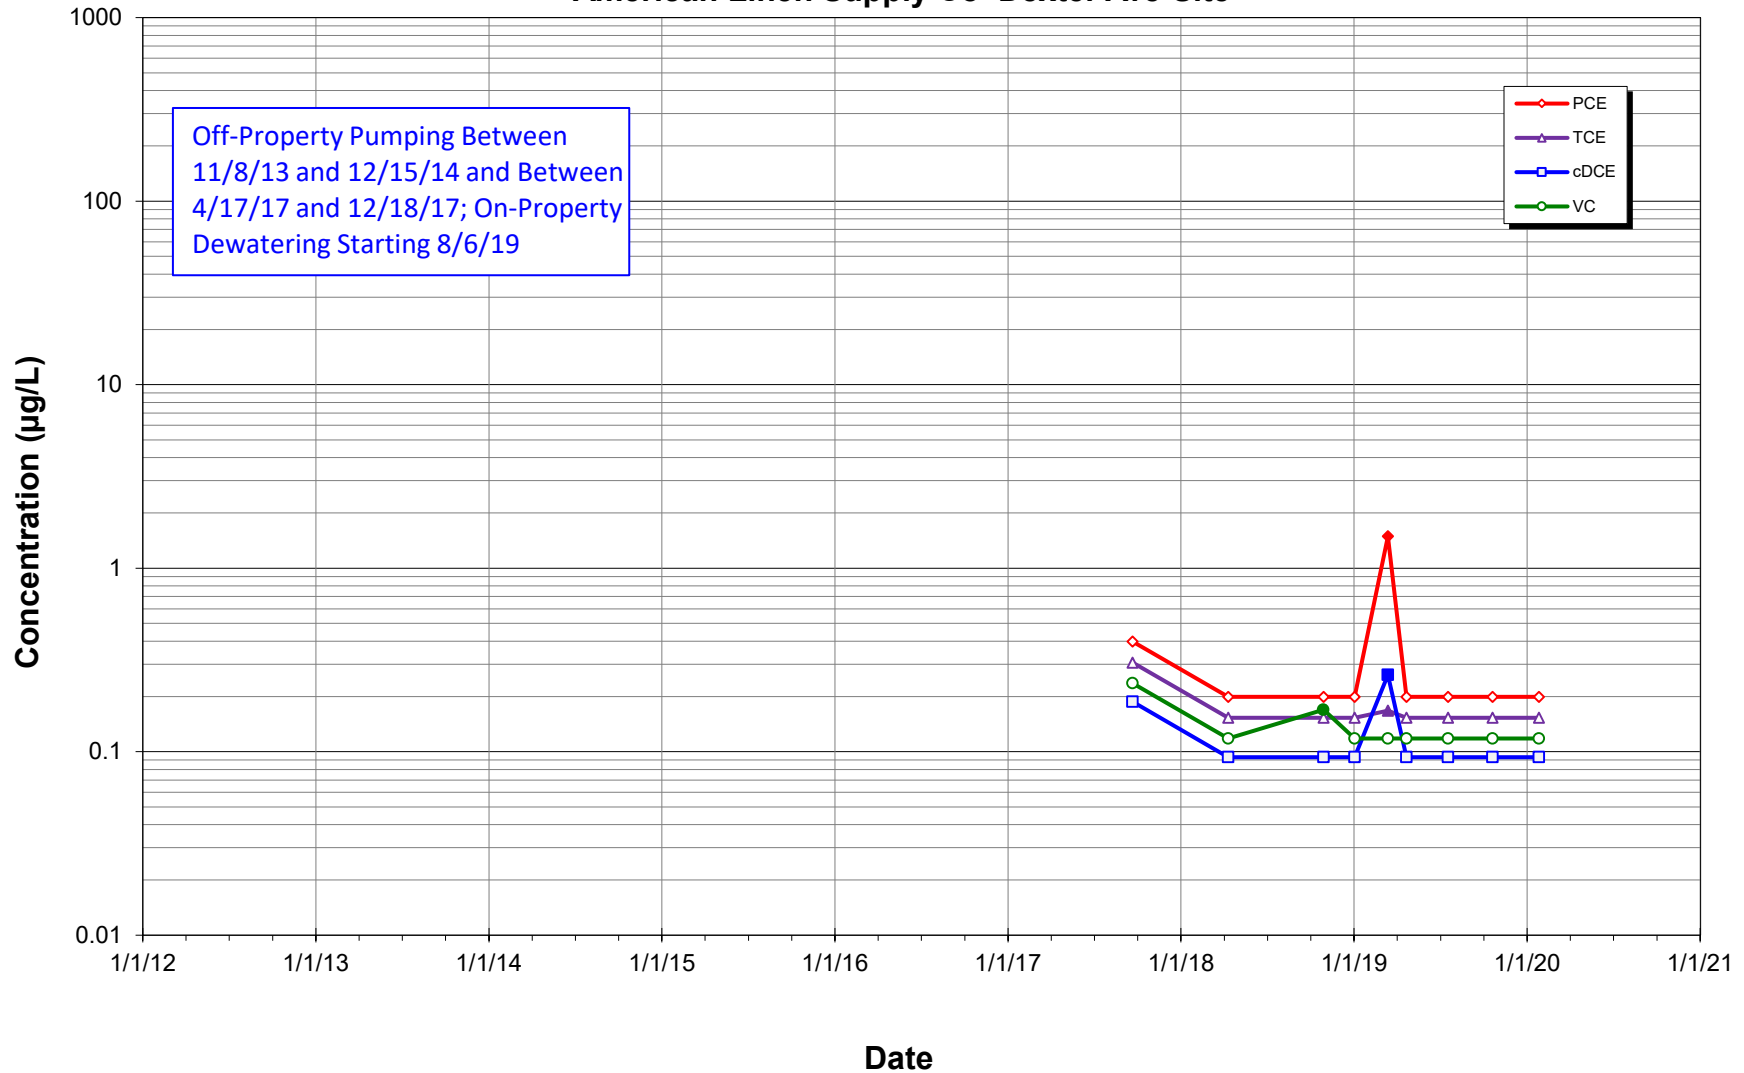

Notes:
 1) All results detected below the laboratory MDLs are shown as hollow data points .
 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-153 (-65.3 to -75.3 feet NAVD), Roy Street
American Linen Supply Co–Dexter Ave Site

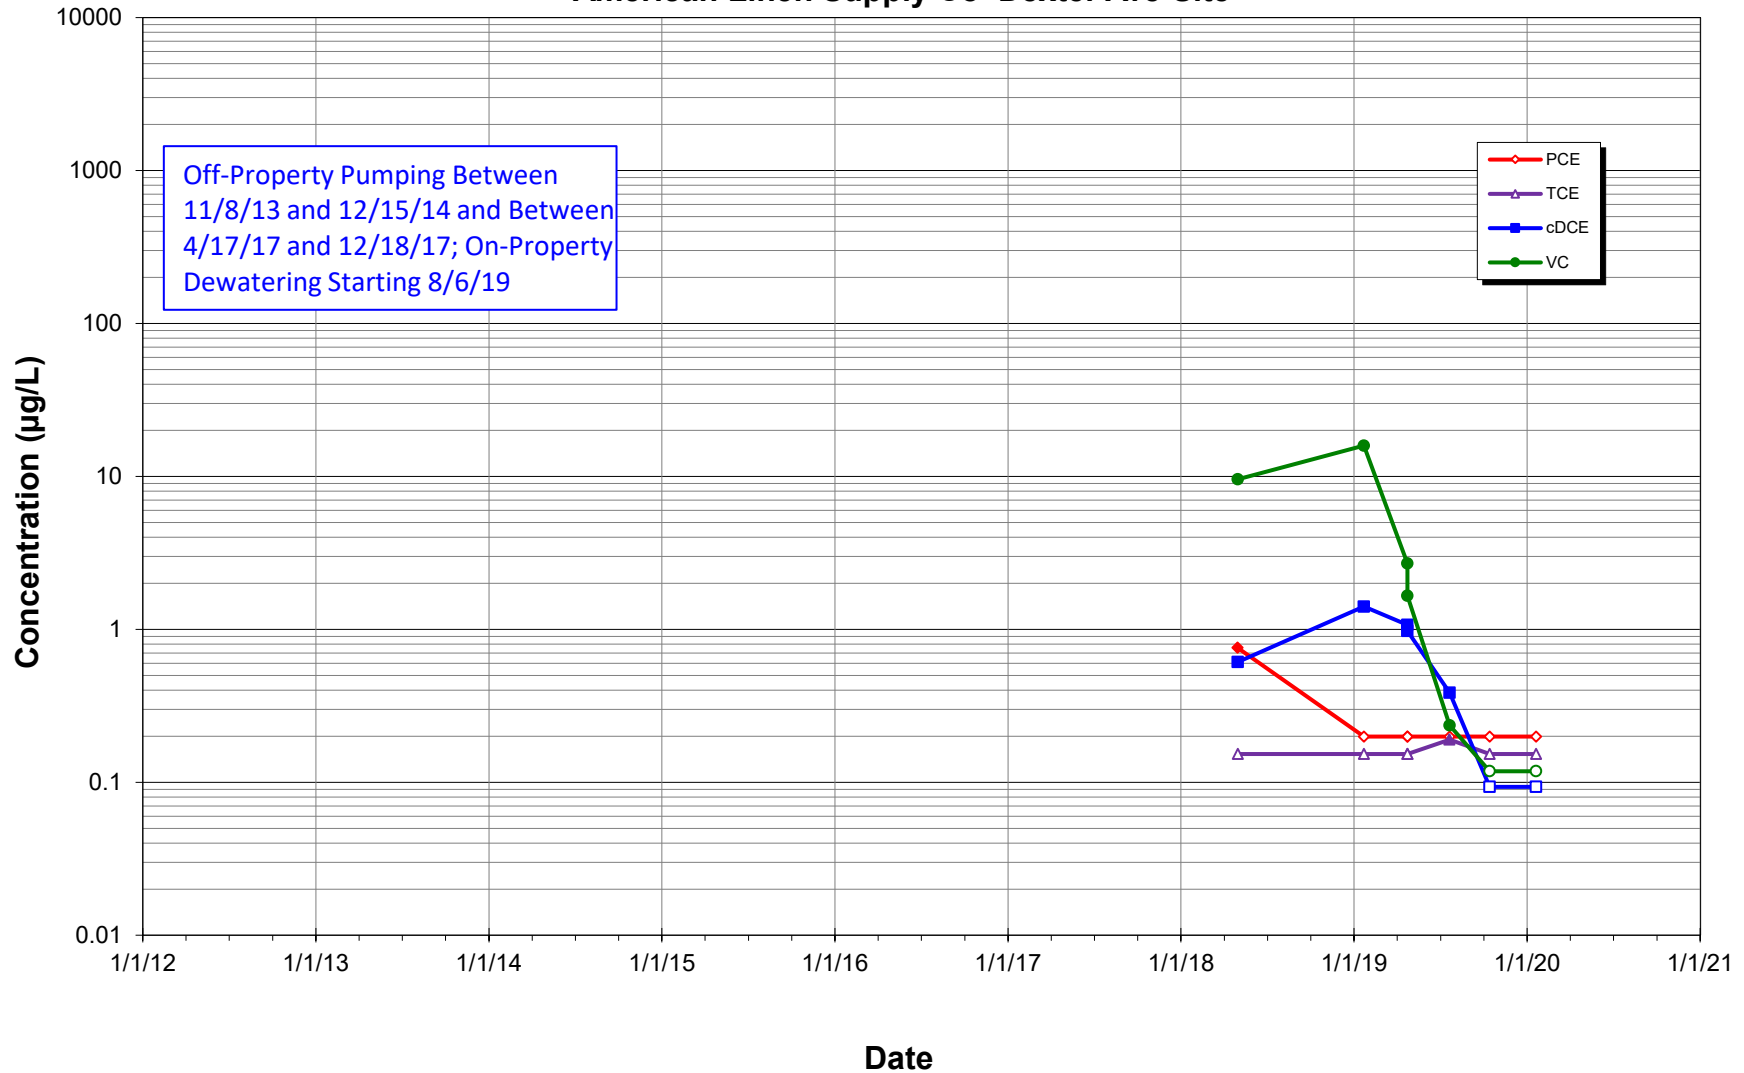

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-158A (-48.2 to -58.2 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

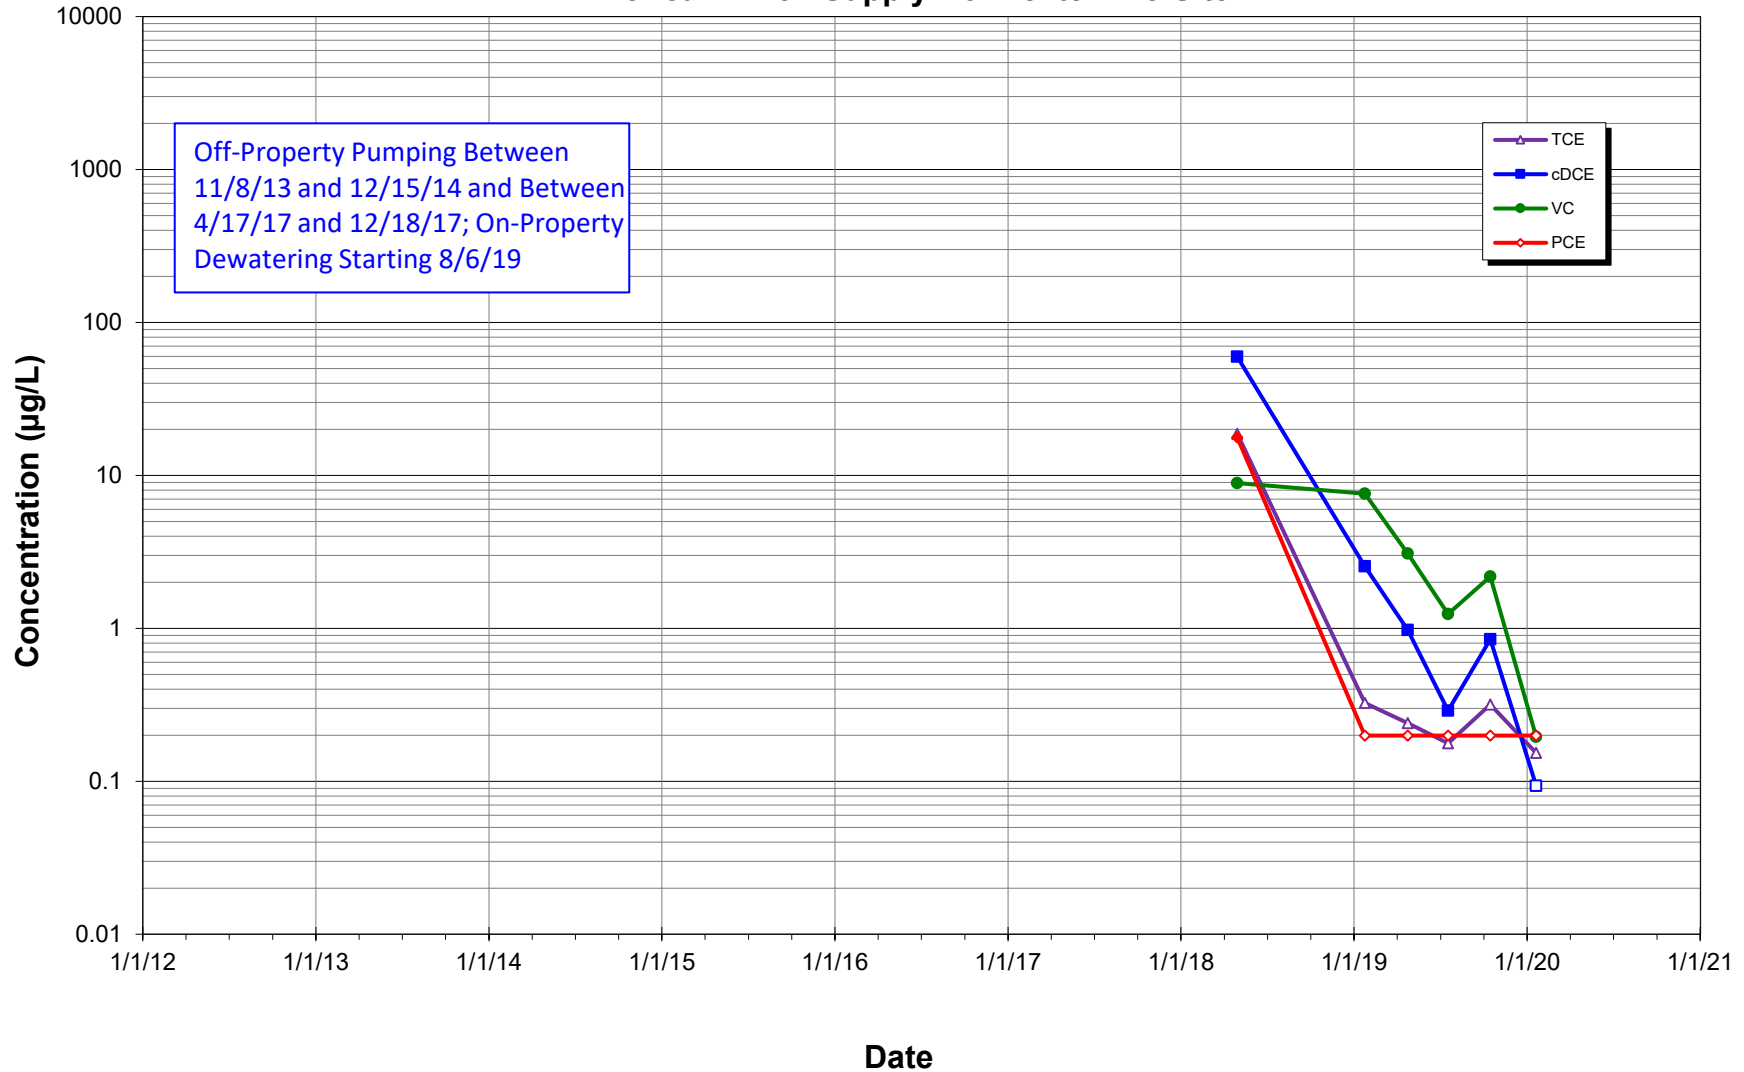

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-160 (-75.4 to -85.4 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

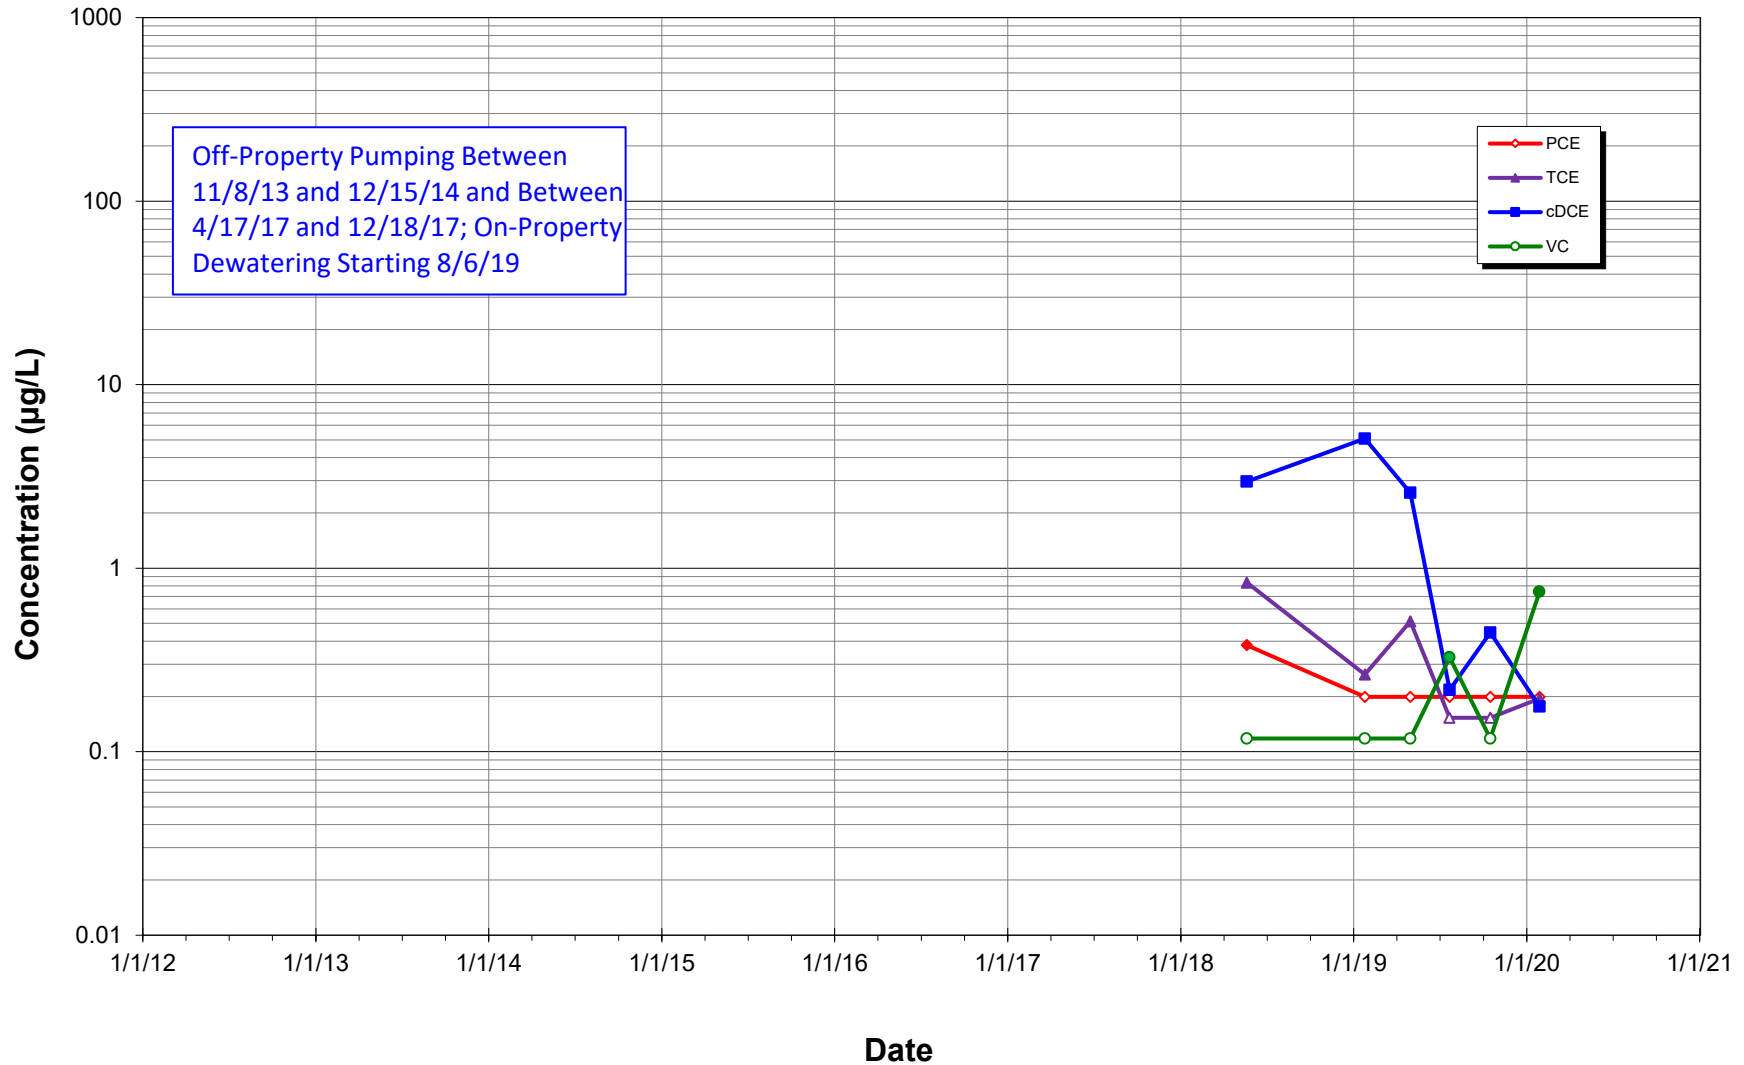

Notes:


- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW-161 (-88.5 to -98.5 feet NAVD), 8th Avenue North
American Linen Supply Co–Dexter Ave Site

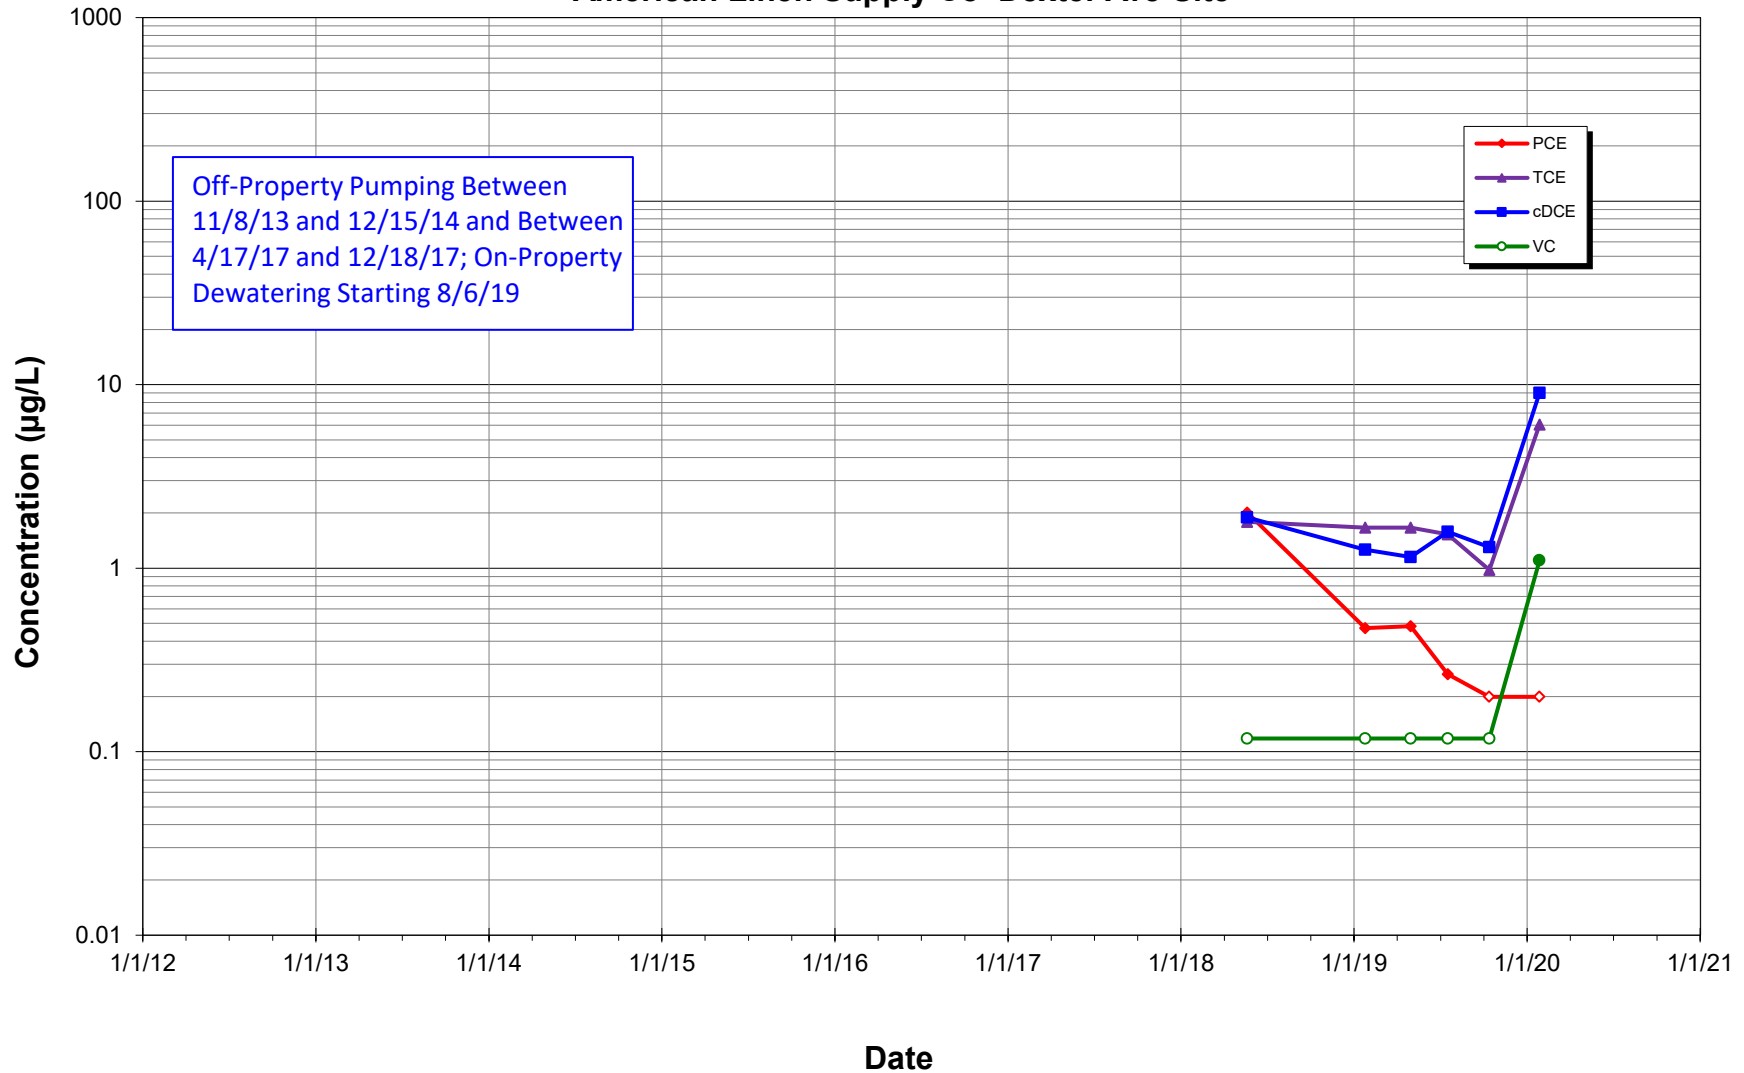

Notes:
 1) All results detected below the laboratory MDLs are shown as hollow data points .
 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-304 (-47.6 to -57.6 feet NAVD), Dexter Avenue North
American Linen Supply Co–Dexter Ave Site

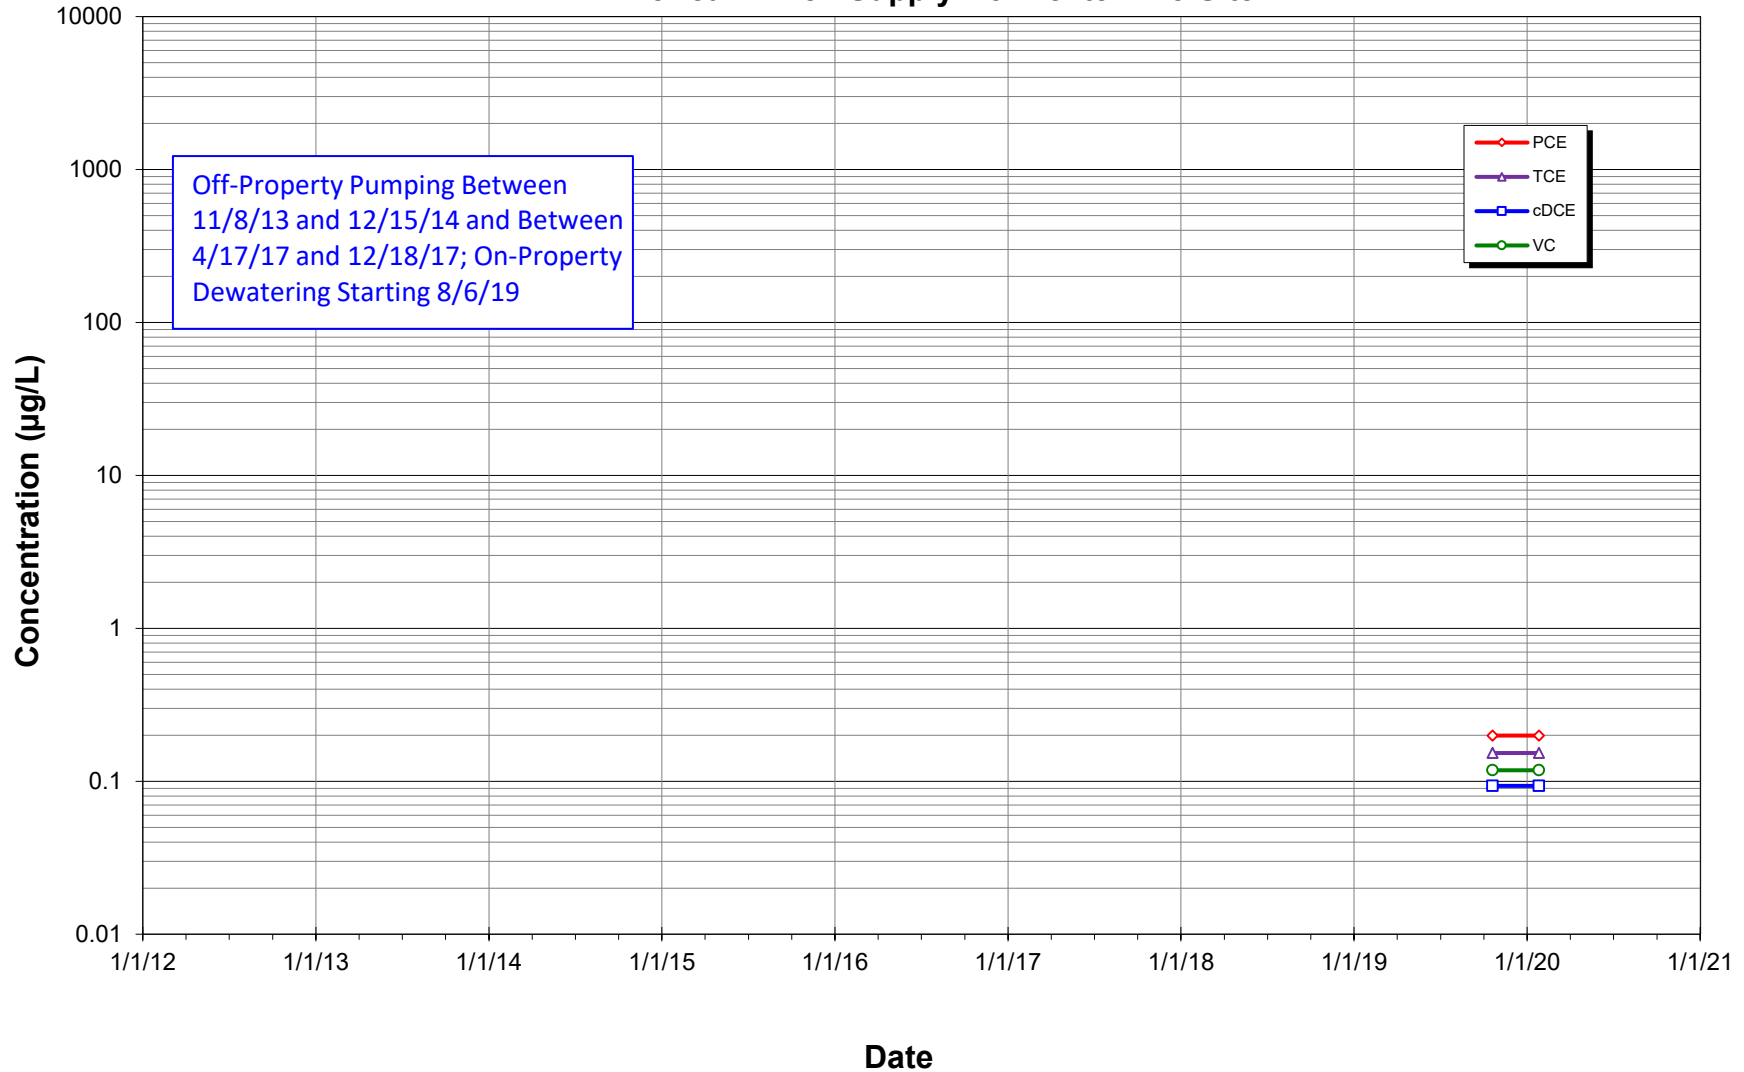

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-319 (-42.8 to -52.8 feet NAVD), 9th Avenue N
American Linen Supply Co–Dexter Ave Site

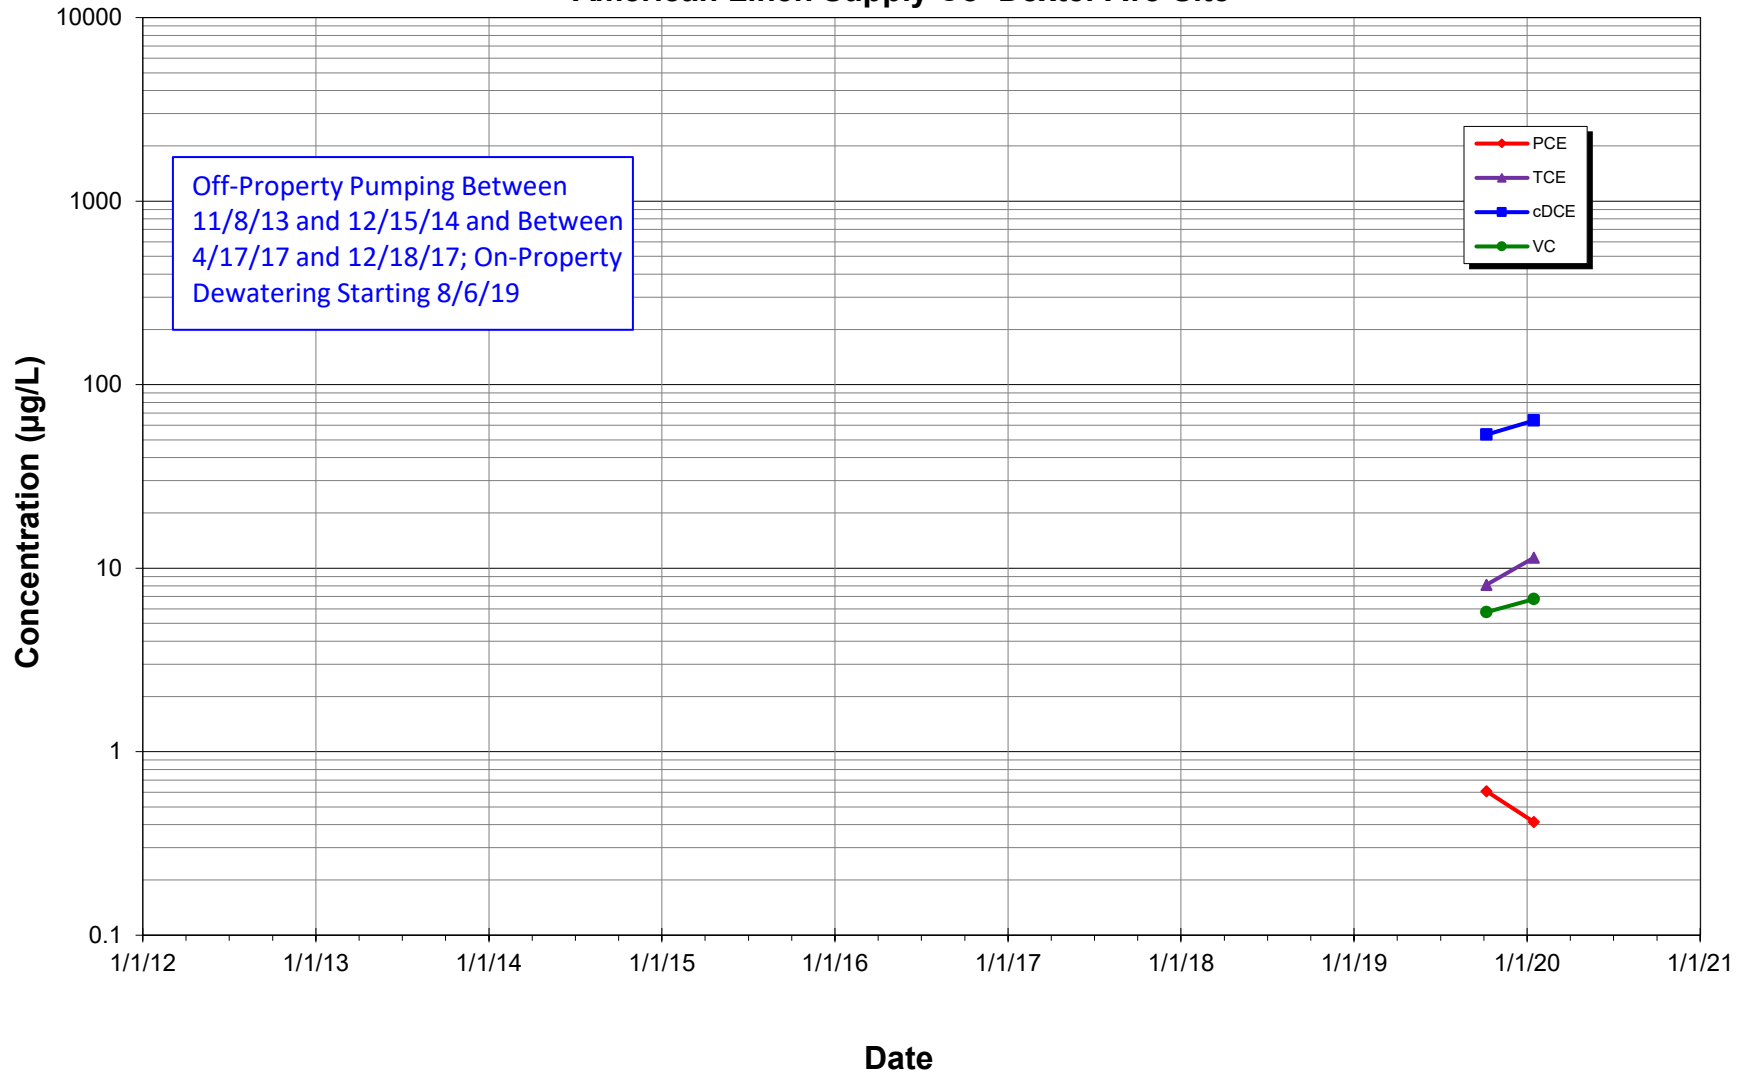

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-323 (-65.4 to -75.4 feet NAVD), 9th Avenue N
American Linen Supply Co–Dexter Ave Site

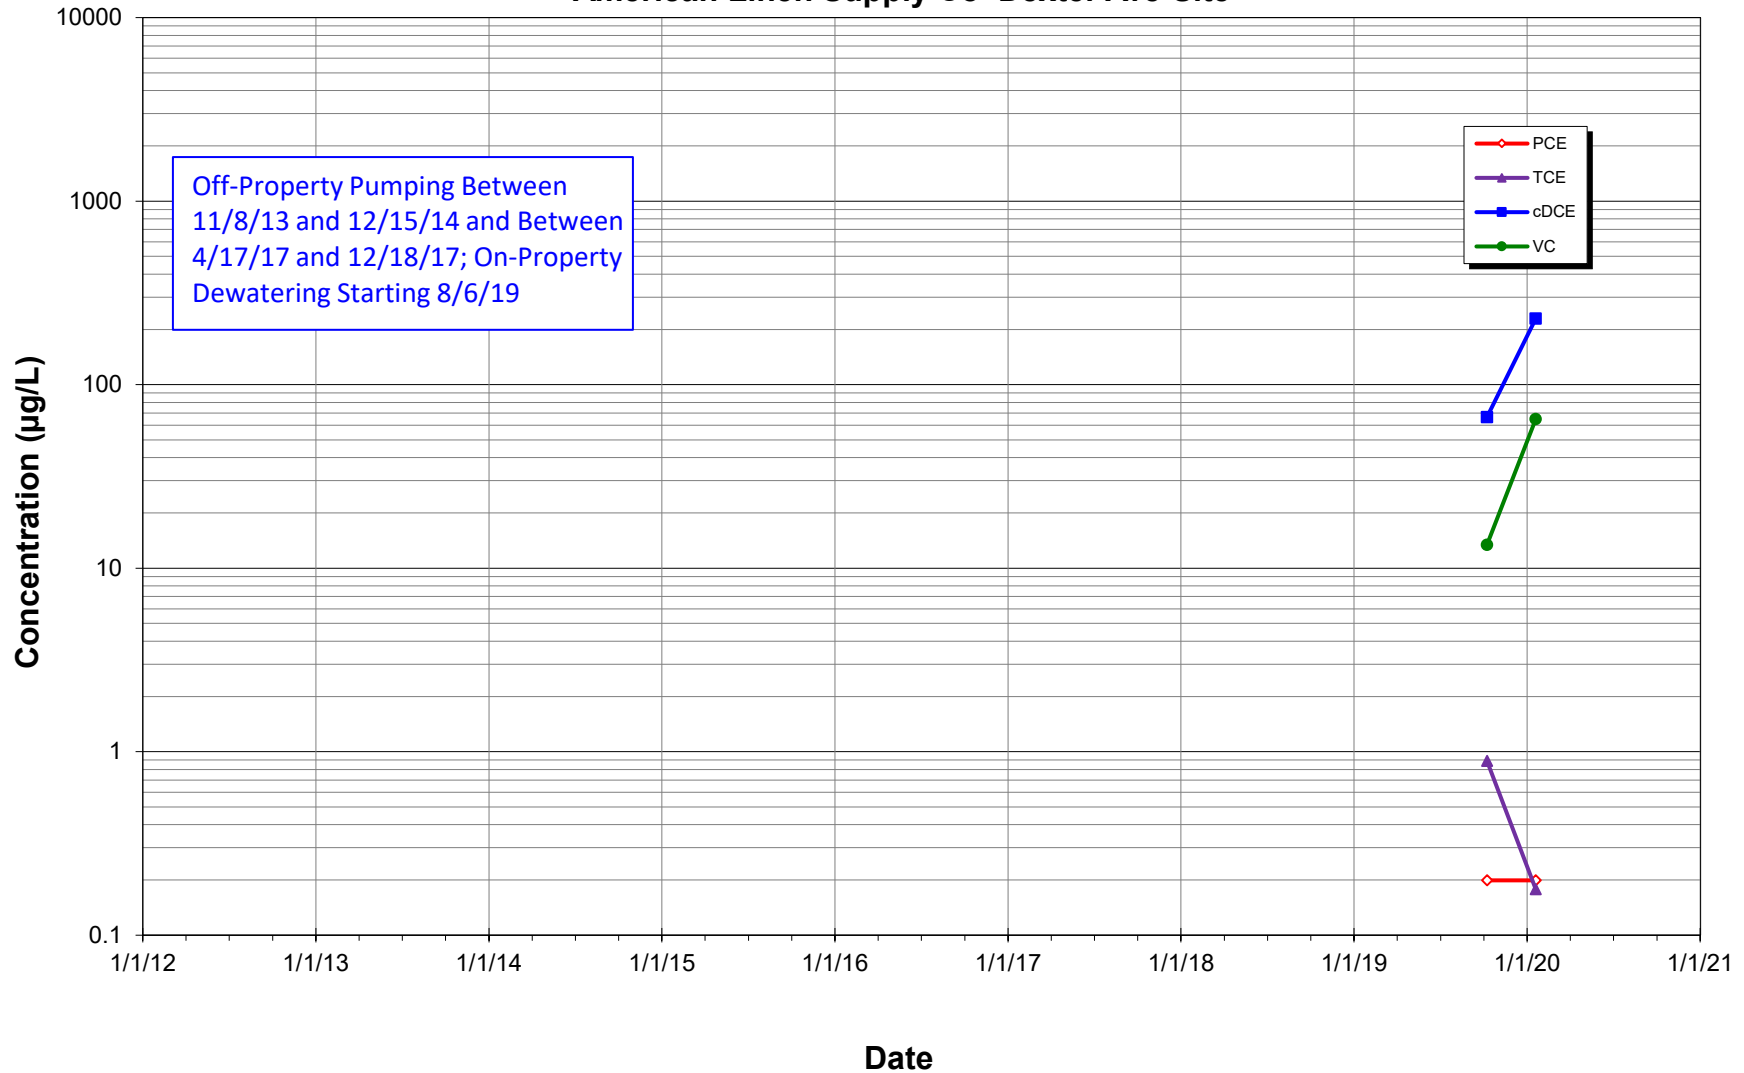

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-324 (-32.1 to -42.1 feet NAVD), 9th Avenue N
American Linen Supply Co–Dexter Ave Site

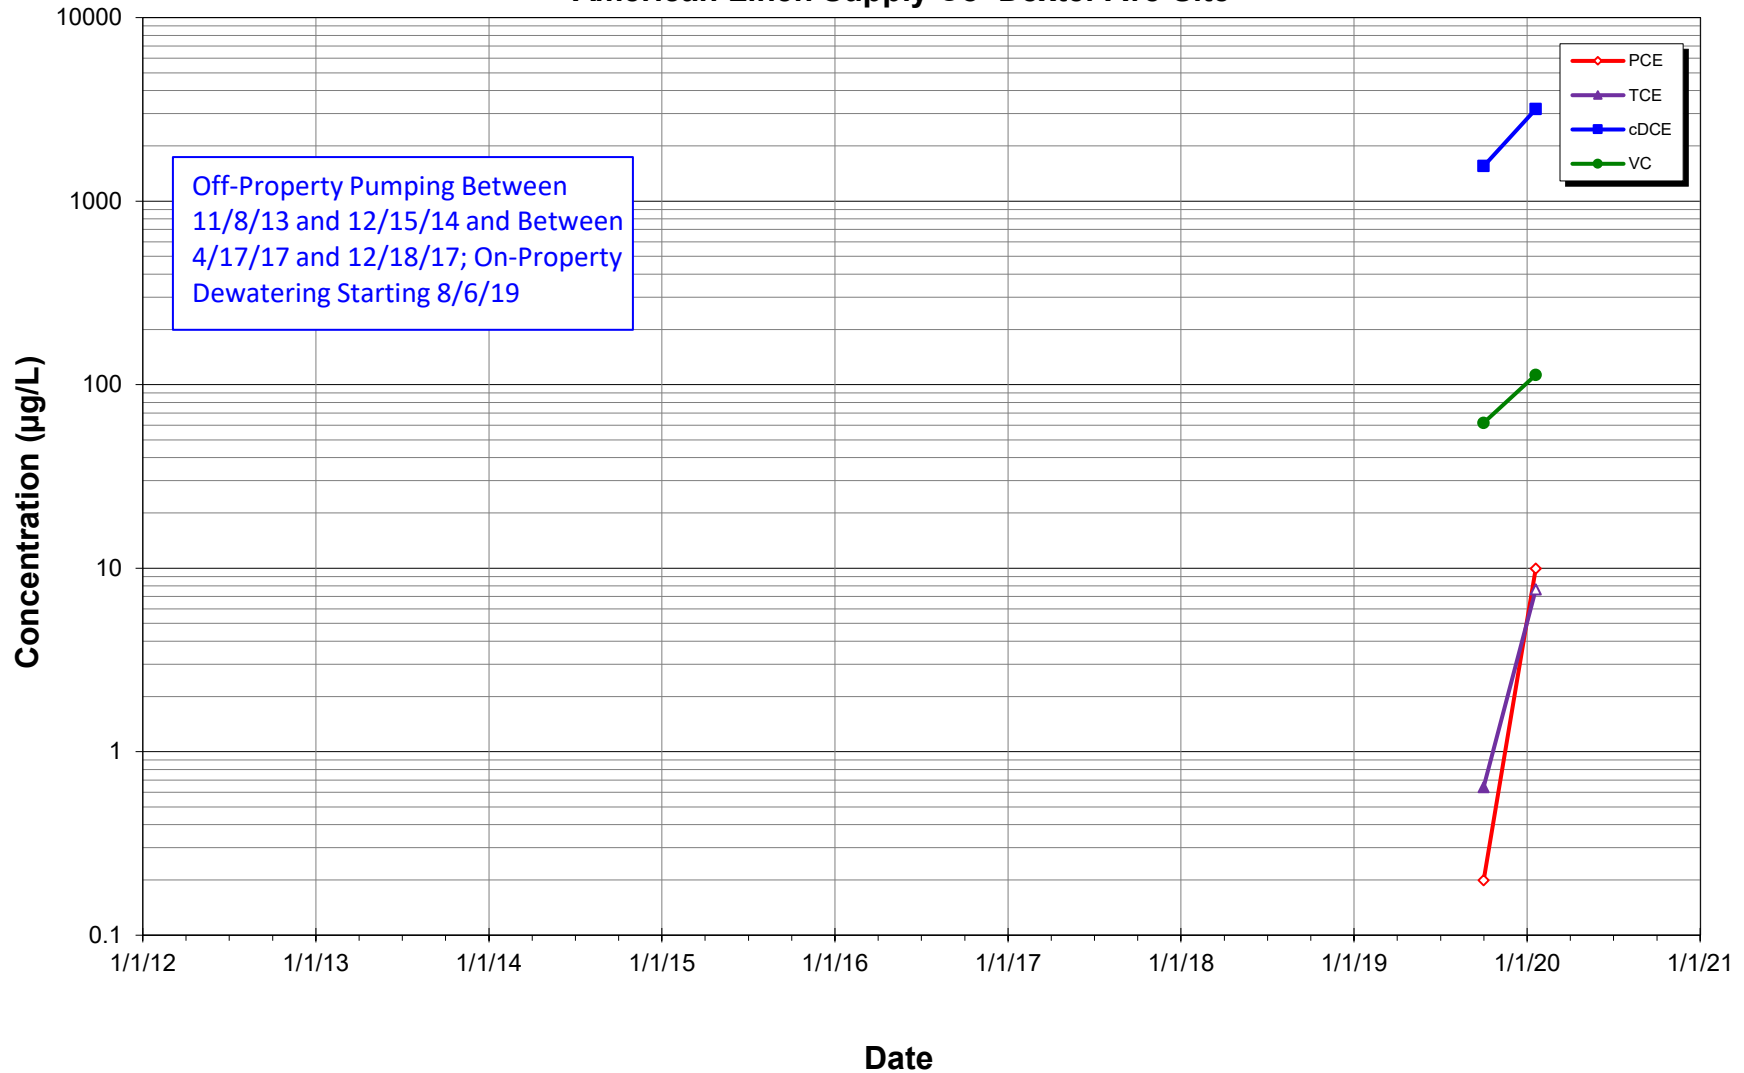

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-326 (-48.7 to -58.7 feet NAVD), Mercer Street
American Linen Supply Co–Dexter Ave Site

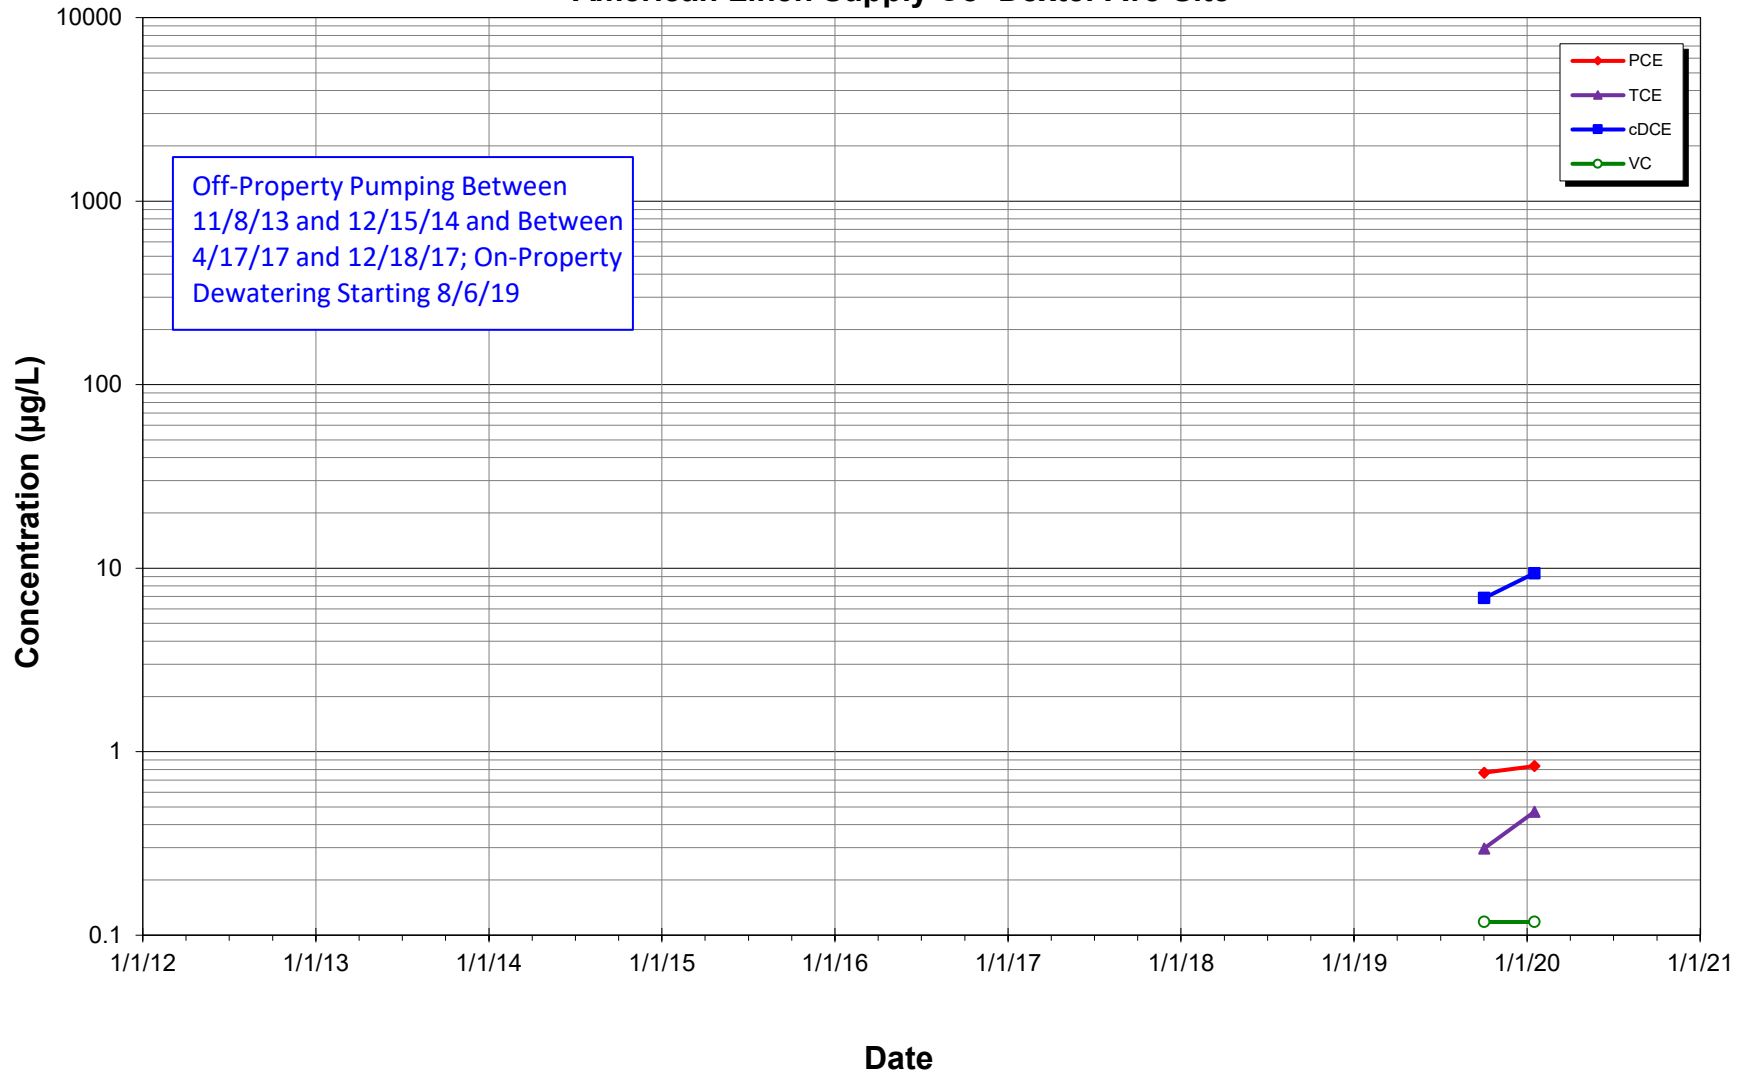

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.


Concentration vs Time
MW-328 (-36.1 to -46.1 feet NAVD), East of Westlake Ave N
American Linen Supply Co–Dexter Ave Site

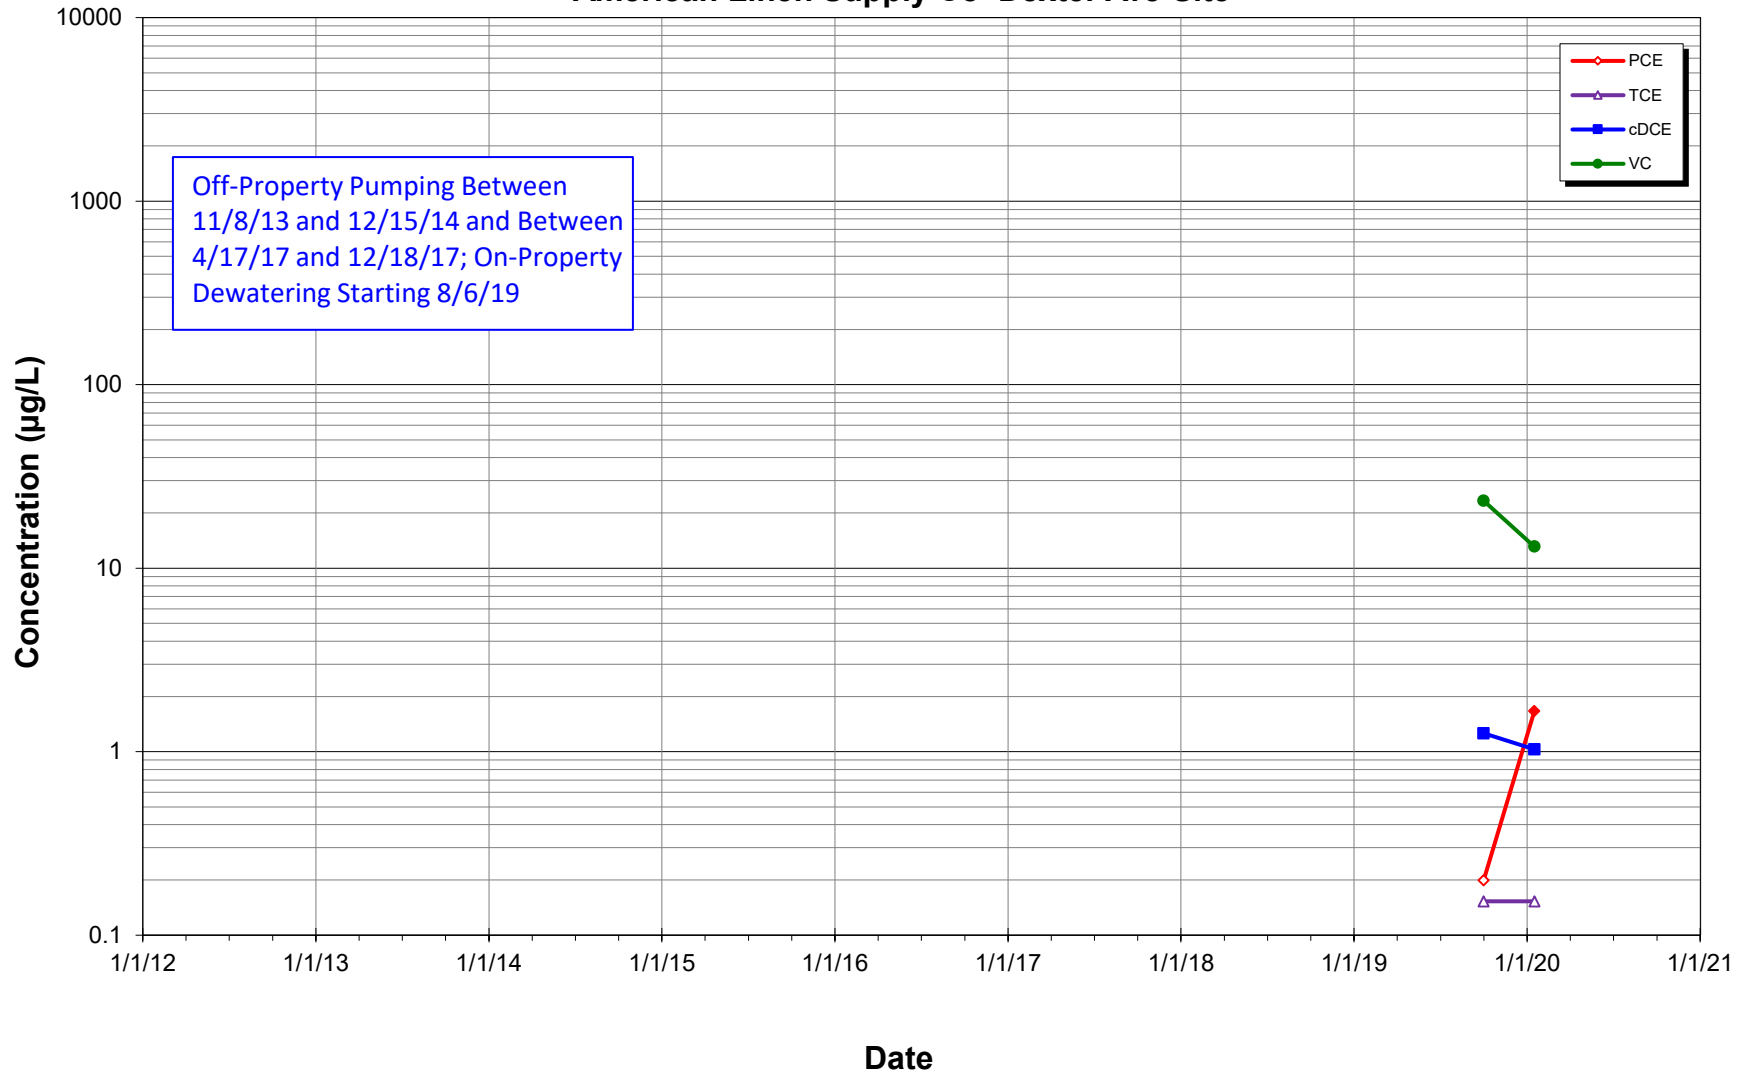

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.

Concentration vs Time
MW-329 (-69.0 to -79.0 feet NAVD), East of Westlake Ave N
American Linen Supply Co–Dexter Ave Site

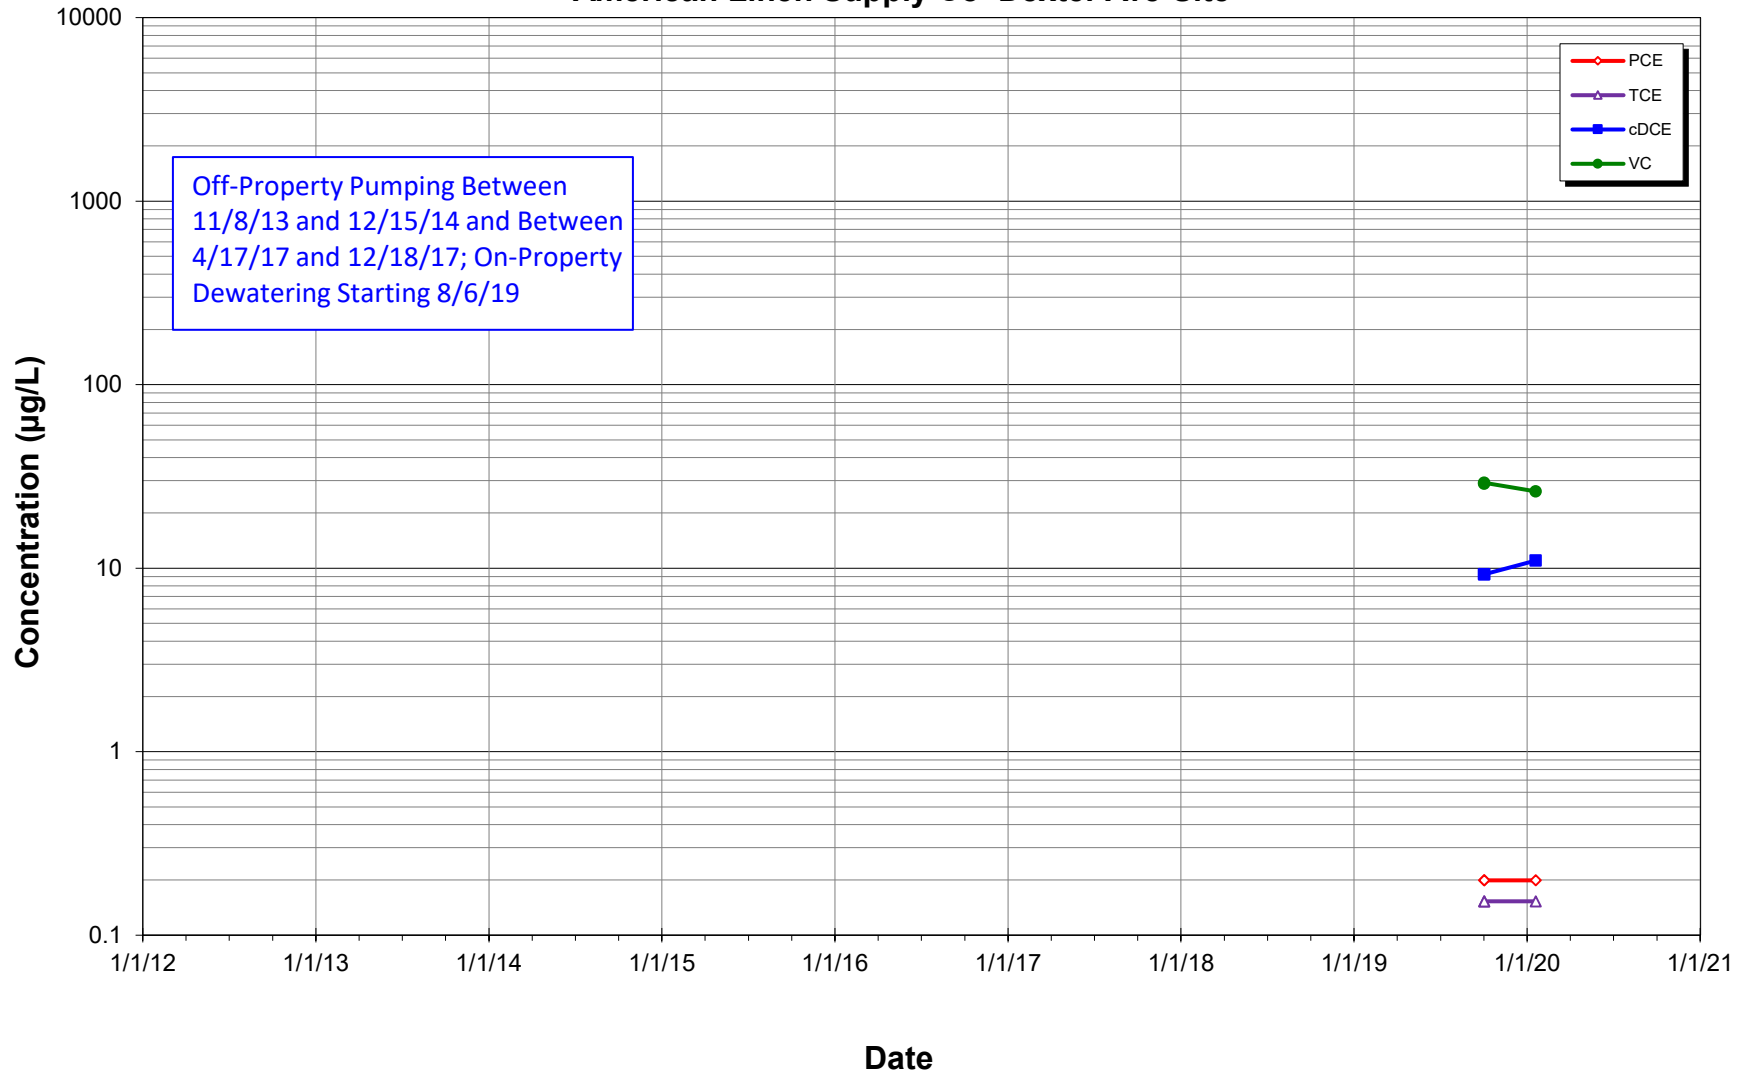

Notes:

- 1) All results detected below the laboratory MDLs are shown as hollow data points .
- 2) Preliminary Screening Levels: PCE = 1 µg/L, TCE = 1 µg/L, cDCE = 16 µg/L, and VC = 0.2 µg/L.