


Form 2C NPDES

Figure 1 – Outfall-Discharge Locations

RECEIVED
SEP 19 2019
Dept of Ecology
Central Regional Office

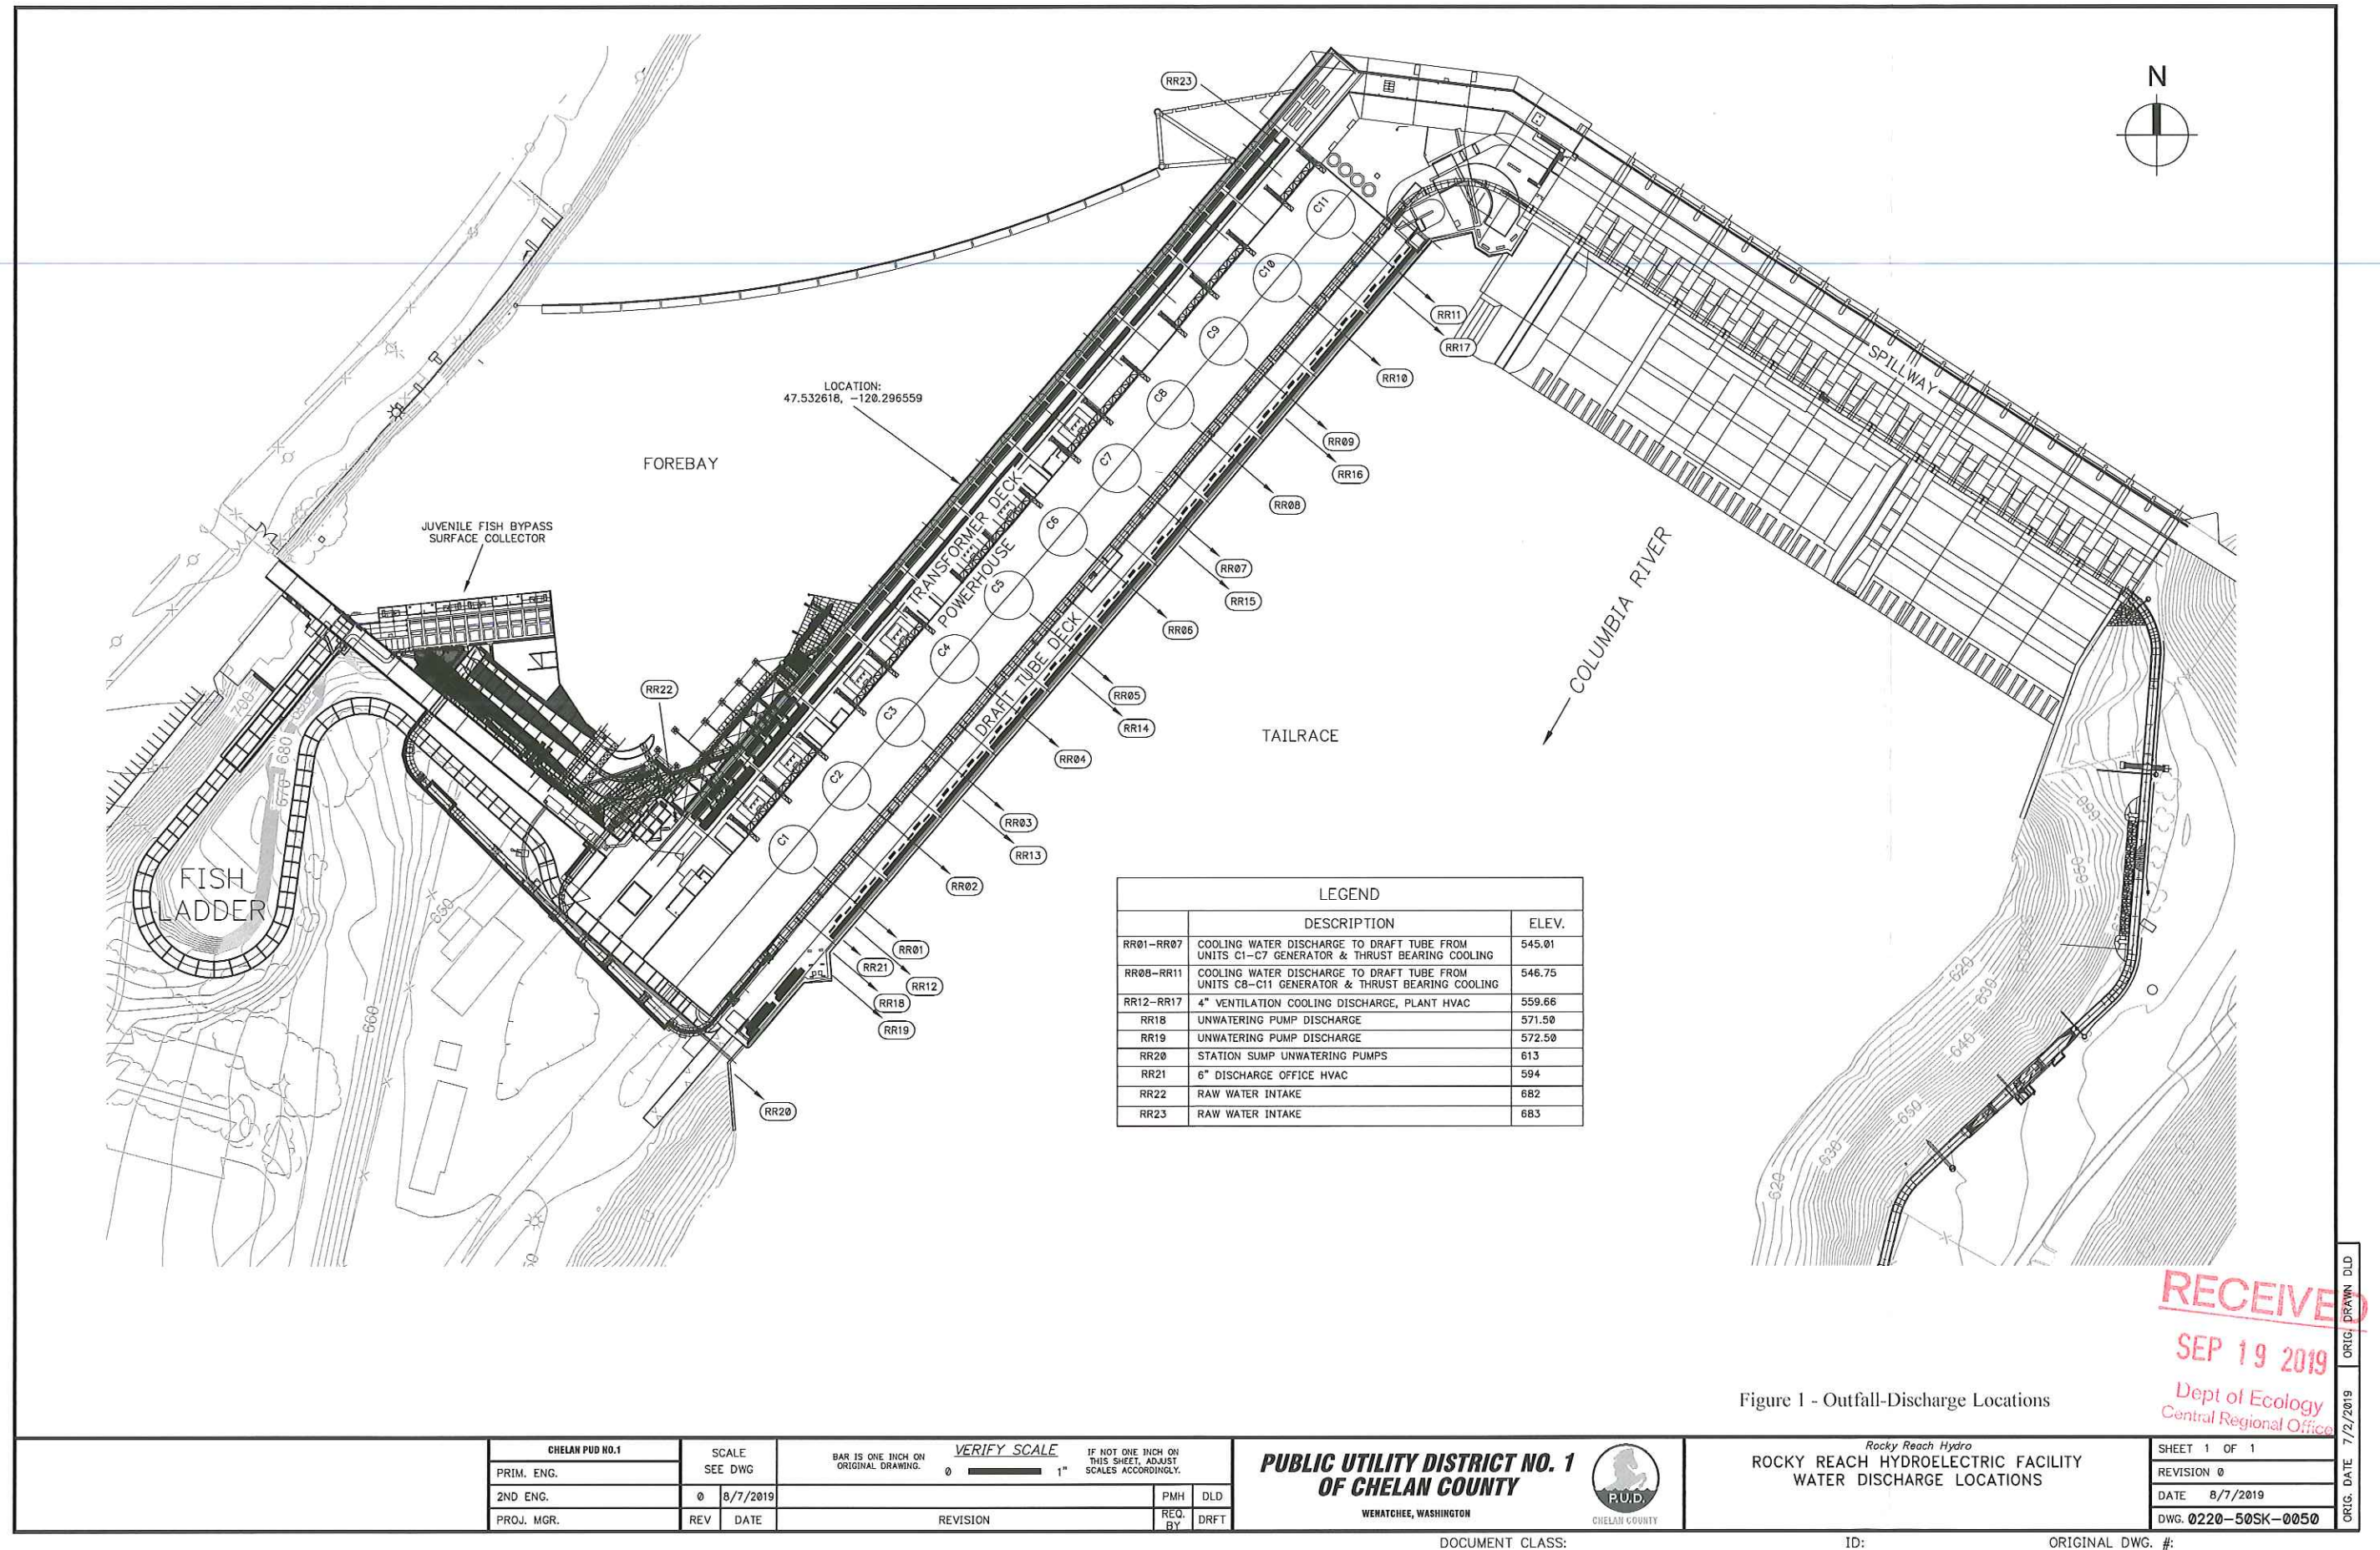

LEGEND		
	DESCRIPTION	ELEV.
RR01-RR07	COOLING WATER DISCHARGE TO DRAFT TUBE FROM UNITS C1-C7 GENERATOR & THRUST BEARING COOLING	545.01
RR08-RR11	COOLING WATER DISCHARGE TO DRAFT TUBE FROM UNITS C8-C11 GENERATOR & THRUST BEARING COOLING	546.75
RR12-RR17	4" VENTILATION COOLING DISCHARGE, PLANT HVAC	559.66
RR18	UNWATERING PUMP DISCHARGE	571.50
RR19	UNWATERING PUMP DISCHARGE	572.50
RR20	STATION SUMP UNWATERING PUMPS	613
RR21	6" DISCHARGE OFFICE HVAC	594
RR22	RAW WATER INTAKE	682
RR23	RAW WATER INTAKE	683

RECEIVED
SEP 19 2019
Dept of Ecology
Central Regional Office

Figure 1 - Outfall-Discharge Locations

CHELAN PUD NO.1		SCALE SEE DWG	BAR IS ONE INCH ON ORIGINAL DRAWING.	VERIFY SCALE 0 1"	IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.	PMH DLD	REQ. BY	DRAFT
PRIM. ENG.								
2ND ENG.	0	8/7/2019						
PROJ. MGR.	REV	DATE						

**PUBLIC UTILITY DISTRICT NO. 1
OF CHELAN COUNTY**
WENATCHEE, WASHINGTON



Rocky Reach Hydro
**ROCKY REACH HYDROELECTRIC FACILITY
WATER DISCHARGE LOCATIONS**

SHEET 1 OF 1
REVISION 0
DATE 8/7/2019
DWG. 0220-50SK-0050

DOCUMENT CLASS:

ID:

ORIGINAL DWG. #:

ORIG. DATE 7/2/2019
ORIG. DRAWN DLD