

P.O. Box 9
Woodland, WA 98674
www.ci.woodland.wa.us

200 East Scott Avenue
fax: (360) 225-1201

Police
(360) 225-6965

230 Davidson Avenue
fax: (360) 225-7336

Building
(360) 225-7299

**Mayor's Office
Clerk-Treasurer**
(360) 225-8281

Planning
(360) 225-1048

300 East Scott Avenue
fax: (360) 225-7467

Public Works
(360) 225-7999

December 20, 2016

Carey Cholski
Department of Ecology
Southwest Regional Office
PO Box 47775
Olympia, WA 98504-7775

SUBJECT: NPDES PERMIT RENEWAL
CITY OF WOODLAND, COWLITZ COUNTY WASHINGTON
NPDES PERMIT NO. WA0020401

Dear Mrs. Cholski,

The enclosed submittal is in accordance with section S8 of the City of Woodland NPDES permit.

Please contact me at (360) 225-7007 if you have any questions.

Sincerely,

Derrek Amburgey

Derrek Amburgey
City of Woodland
WWTP Superintendent

RECEIVED

DEC 27 2016

WA State Department
of Ecology (SWRO)

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086**FORM
2A
NPDES****NPDES FORM 2A APPLICATION OVERVIEW****APPLICATION OVERVIEW**

Form 2A has been developed in a modular format and consists of a "Basic Application Information" packet and a "Supplemental Application Information" packet. The Basic Application Information packet is divided into two parts. All applicants must complete Parts A and C. Applicants with a design flow greater than or equal to 0.1 mgd must also complete Part B. Some applicants must also complete the Supplemental Application Information packet. The following items explain which parts of Form 2A you must complete.

BASIC APPLICATION INFORMATION:

- A. Basic Application Information for all Applicants.** All applicants must complete questions A.1 through A.8. A treatment works that discharges effluent to surface waters of the United States must also answer questions A.9 through A.12.
- B. Additional Application Information for Applicants with a Design Flow ≥ 0.1 mgd.** All treatment works that have design flows greater than or equal to 0.1 million gallons per day must complete questions B.1 through B.6.
- C. Certification.** All applicants must complete Part C (Certification).

SUPPLEMENTAL APPLICATION INFORMATION:

- D. Expanded Effluent Testing Data.** A treatment works that discharges effluent to surface waters of the United States and meets one or more of the following criteria must complete Part D (Expanded Effluent Testing Data):
 - 1. Has a design flow rate greater than or equal to 1 mgd,
 - 2. Is required to have a pretreatment program (or has one in place), or
 - 3. Is otherwise required by the permitting authority to provide the information.
- E. Toxicity Testing Data.** A treatment works that meets one or more of the following criteria must complete Part E (Toxicity Testing Data):
 - 1. Has a design flow rate greater than or equal to 1 mgd,
 - 2. Is required to have a pretreatment program (or has one in place), or
 - 3. Is otherwise required by the permitting authority to submit results of toxicity testing.
- F. Industrial User Discharges and RCRA/CERCLA Wastes.** A treatment works that accepts process wastewater from any significant industrial users (SIUs) or receives RCRA or CERCLA wastes must complete Part F (Industrial User Discharges and RCRA/CERCLA Wastes). SIUs are defined as:
 - 1. All industrial users subject to Categorical Pretreatment Standards under 40 Code of Federal Regulations (CFR) 403.6 and 40 CFR Chapter I, Subchapter N (see instructions); and
 - 2. Any other industrial user that:
 - a. Discharges an average of 25,000 gallons per day or more of process wastewater to the treatment works (with certain exclusions); or
 - b. Contributes a process wastestream that makes up 5 percent or more of the average dry weather hydraulic or organic capacity of the treatment plant; or
 - c. Is designated as an SIU by the control authority.
- G. Combined Sewer Systems.** A treatment works that has a combined sewer system must complete Part G (Combined Sewer Systems).

ALL APPLICANTS MUST COMPLETE PART C (CERTIFICATION)

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086**BASIC APPLICATION INFORMATION****PART A. BASIC APPLICATION INFORMATION FOR ALL APPLICANTS:**

All treatment works must complete questions A.1 through A.8 of this Basic Application Information packet.

A.1. Facility Information.

Facility name City of Woodland

Mailing Address PO Box 9
Woodland, WA 98674

Contact person Derrek Amburgey

Title Plant Superintendent

Telephone number (360) 225-7007

Facility Address 755 Sandlewood Road
(not P.O. Box) Woodland, WA 98674

A.2. Applicant Information. If the applicant is different from the above, provide the following:

Applicant name _____

Mailing Address _____

Contact person _____

Title _____

Telephone number _____

Is the applicant the owner or operator (or both) of the treatment works?☒ owner ☒ operator

Indicate whether correspondence regarding this permit should be directed to the facility or the applicant.

☒ facility ☐ applicant**A.3. Existing Environmental Permits.** Provide the permit number of any existing environmental permits that have been issued to the treatment works (include state-issued permits).

NPDES WA 0020401 PSD _____

UIC _____ Other _____

RCRA _____ Other _____

A.4. Collection System Information. Provide information on municipalities and areas served by the facility. Provide the name and population of each entity and, if known, provide information on the type of collection system (combined vs. separate) and its ownership (municipal, private, etc.).

Name	Population Served	Type of Collection System	Ownership
<u>City of Woodland</u>	<u>5,695</u>	<u>Gravity/Pump Station</u>	<u>Public</u>
_____	_____	_____	_____
_____	_____	_____	_____
Total population served <u>5,695</u>			

FACILITY NAME AND PERMIT NUMBER:

Form Approved 1/14/99
OMB Number 2040-0086

City of Woodland Waste Water Treatment Plant WA 0020401

A.5. Indian Country.

- a. Is the treatment works located in Indian Country?

☐ Yes ☒ No

- b. Does the treatment works discharge to a receiving water that is either in Indian Country or that is upstream from (and eventually flows through) Indian Country?

☐ Yes ☒ No

A.6. Flow. Indicate the design flow rate of the treatment plant (i.e., the wastewater flow rate that the plant was built to handle). Also provide the average daily flow rate and maximum daily flow rate for each of the last three years. Each year's data must be based on a 12-month time period with the 12th month of "this year" occurring no more than three months prior to this application submittal.

- a. Design flow rate
- 2.00
- mgd

	<u>Two Years Ago</u>	<u>Last Year</u>	<u>This Year</u>
b. Annual average daily flow rate	<u>0.55</u>	<u>0.56</u>	<u>0.58</u> mgd
c. Maximum daily flow rate	<u>0.60</u>	<u>0.66</u>	<u>0.82</u> mgd

A.7. Collection System. Indicate the type(s) of collection system(s) used by the treatment plant. Check all that apply. Also estimate the percent contribution (by miles) of each.

☒ Separate sanitary sewer 100.00 %
☐ Combined storm and sanitary sewer _____ %

A.8. Discharges and Other Disposal Methods.

- a. Does the treatment works discharge effluent to waters of the U.S.?

☒ Yes ☐ No

If yes, list how many of each of the following types of discharge points the treatment works uses:

i. Discharges of treated effluent 1
ii. Discharges of untreated or partially treated effluent 0
iii. Combined sewer overflow points 0
iv. Constructed emergency overflows (prior to the headworks) 0
v. Other _____ 0

- b. Does the treatment works discharge effluent to basins, ponds, or other surface impoundments that do not have outlets for discharge to waters of the U.S.?

☐ Yes ☒ No

If yes, provide the following for each surface impoundment:

Location: _____

Annual average daily volume discharged to surface impoundment(s) _____ mgd

Is discharge _____ continuous or _____ intermittent?

- c. Does the treatment works land-apply treated wastewater?

☐ Yes ☒ No

If yes, provide the following for each land application site:

Location: _____

Number of acres: _____

Annual average daily volume applied to site: _____ Mgd

Is land application _____ continuous or _____ intermittent?

- d. Does the treatment works discharge or transport treated or untreated wastewater to another treatment works?

☐ Yes ☒ No

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

If yes, describe the mean(s) by which the wastewater from the treatment works is discharged or transported to the other treatment works (e.g., tank truck, pipe).

If transport is by a party other than the applicant, provide:

Transporter name: _____

Mailing Address: _____

Contact person: _____

Title: _____

Telephone number: _____

For each treatment works that receives this discharge, provide the following:

Name: _____

Mailing Address: _____

Contact person: _____

Title: _____

Telephone number: _____

If known, provide the NPDES permit number of the treatment works that receives this discharge. _____

Provide the average daily flow rate from the treatment works into the receiving facility. _____

_____ mgd

- e. Does the treatment works discharge or dispose of its wastewater in a manner not included in A.8.a through A.8.d above (e.g., underground percolation, well injection)?

_____ Yes

_____ ☒ No

If yes, provide the following for each disposal method:

Description of method (including location and size of site(s) if applicable):

Annual daily volume disposed of by this method: _____

Is disposal through this method _____ continuous or _____ intermittent?

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

WASTEWATER DISCHARGES:

If you answered "yes" to question A.8.a, complete questions A.9 through A.12 once for each outfall (including bypass points) through which effluent is discharged. Do not include information on combined sewer overflows in this section. If you answered "no" to question A.8.a, go to Part B, "Additional Application Information for Applicants with a Design Flow Greater than or Equal to 0.1 mgd."

A.9. Description of Outfall.

- a. Outfall number 1
- b. Location City of Woodland 98674
(City or town, if applicable) (Zip Code)
Clark WA
(County) (State)
45 54' 04"N 122 44' 10"W
(Latitude) (Longitude)
- c. Distance from shore (if applicable) 50.00 ft.
- d. Depth below surface (if applicable) 4.50 ft. Water level varies.
- e. Average daily flow rate 0.58 mgd
- f. Does this outfall have either an intermittent or a periodic discharge? ☒ Yes ☐ No (go to A.9.g.)
- If yes, provide the following information:
- Number of times per year discharge occurs: 2920
- Average duration of each discharge: 30 Minutes
- Average flow per discharge: 0.07 mgd
- Months in which discharge occurs: 12
- g. Is outfall equipped with a diffuser? ☐ Yes ☒ No

A.10. Description of Receiving Waters.

- a. Name of receiving water Lewis River
- b. Name of watershed (if known) Lewis River Watershed
- United States Soil Conservation Service 14-digit watershed code (if known): _____
- c. Name of State Management/River Basin (if known): WRIA 27
- United States Geological Survey 8-digit hydrologic cataloging unit code (if known): _____
- d. Critical low flow of receiving stream (if applicable):
acute 19.70 cfs* chronic 197.25 cfs*
- e. Total hardness of receiving stream at critical low flow (if applicable): _____ mg/l of CaCO₃

FACILITY NAME AND PERMIT NUMBER:

Form Approved 1/14/99
OMB Number 2040-0086

City of Woodland Waste Water Treatment Plant WA 0020401

A.11. Description of Treatment.

- a. What levels of treatment are provided? Check all that apply.

☒ Primary ☒ Secondary
☐ Advanced ☐ Other. Describe: _____

- b. Indicate the following removal rates (as applicable):

Design BOD₅ removal or Design CBOD₅ removal 85.00 %
 Design SS removal 85.00 %
 Design P removal _____ %
 Design N removal _____ %
 Other _____ %

- c. What type of disinfection is used for the effluent from this outfall? If disinfection varies by season, please describe.

UV

If disinfection is by chlorination, is dechlorination used for this outfall?

_____ Yes _____ No

- d. Does the treatment plant have post aeration?

_____ Yes ☒ No

A.12. Effluent Testing Information. All Applicants that discharge to waters of the US must provide effluent testing data for the following parameters. Provide the indicated effluent testing required by the permitting authority for each outfall through which effluent is discharged. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. At a minimum, effluent testing data must be based on at least three samples and must be no more than four and one-half years apart.

Outfall number: 1

PARAMETER	MAXIMUM DAILY VALUE		AVERAGE DAILY VALUE		
	Value	Units	Value	Units	Number of Samples
pH (Minimum)	6.80	s.u.			
pH (Maximum)	7.50	s.u.			
Flow Rate	0.82	MGD	0.58	MGD	365.00
Temperature (Winter)	20.70	degrees C	16.80	degrees C	120.00
Temperature (Summer)	23.60	degrees C	21.70	degrees C	123.00

* For pH please report a minimum and a maximum daily value

POLLUTANT	MAXIMUM DAILY DISCHARGE		AVERAGE DAILY DISCHARGE			ANALYTICAL METHOD	ML / MDL
	Conc.	Units	Conc.	Units	Number of Samples		

CONVENTIONAL AND NONCONVENTIONAL COMPOUNDS.

BIOCHEMICAL OXYGEN DEMAND (Report one)	BOD-5	23.00	mg/l	3.86	mg/l	221.00	SM5210 B-01	
	CBOD-5							
FECAL COLIFORM		160.00	#/100	34.12	#/100	78.00	SM9222 D-97	
TOTAL SUSPENDED SOLIDS (TSS)		14.00	mg/l	4.92	mg/l	196.00	SM2540 D-97	

END OF PART A.

REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE

FACILITY NAME AND PERMIT NUMBER:
City of Woodland Waste Water Treatment Plant WA 0020401

BASIC APPLICATION INFORMATION

PART B. ADDITIONAL APPLICATION INFORMATION FOR APPLICANTS WITH A DESIGN FLOW GREATER THAN OR EQUAL TO 0.1 MGD (100,000 gallons per day).

All applicants with a design flow rate ≥ 0.1 mgd must answer questions B.1 through B.6. All others go to Part C (Certification).

B.1. Inflow and Infiltration. Estimate the average number of gallons per day that flow into the treatment works from inflow and/or infiltration.
155,000.00 gpd

Briefly explain any steps underway or planned to minimize inflow and infiltration.

B.2. Topographic Map. Attach to this application a topographic map of the area extending at least one mile beyond facility property boundaries. This map must show the outline of the facility and the following information. (You may submit more than one map if one map does not show the entire area.)

- The area surrounding the treatment plant, including all unit processes.
- The major pipes or other structures through which wastewater enters the treatment works and the pipes or other structures through which treated wastewater is discharged from the treatment plant. Include outfalls from bypass piping, if applicable.
- Each well where wastewater from the treatment plant is injected underground.
- Wells, springs, other surface water bodies, and drinking water wells that are: 1) within 1/4 mile of the property boundaries of the treatment works, and 2) listed in public record or otherwise known to the applicant.
- Any areas where the sewage sludge produced by the treatment works is stored, treated, or disposed.
- If the treatment works receives waste that is classified as hazardous under the Resource Conservation and Recovery Act (RCRA) by truck, rail, or special pipe, show on the map where that hazardous waste enters the treatment works and where it is treated, stored, and/or disposed.

B.3. Process Flow Diagram or Schematic. Provide a diagram showing the processes of the treatment plant, including all bypass piping and all backup power sources or redundancy in the system. Also provide a water balance showing all treatment units, including disinfection (e.g., chlorination and dechlorination). The water balance must show daily average flow rates at influent and discharge points and approximate daily flow rates between treatment units. Include a brief narrative description of the diagram.

B.4. Operation/Maintenance Performed by Contractor(s).

Are any operational or maintenance aspects (related to wastewater treatment and effluent quality) of the treatment works the responsibility of a contractor? ☐ Yes ☒ No

If yes, list the name, address, telephone number, and status of each contractor and describe the contractor's responsibilities (attach additional pages if necessary).

Name: _____

Mailing Address: _____

Telephone Number: _____

Responsibilities of Contractor: _____

B.5. Scheduled Improvements and Schedules of Implementation. Provide information on any uncompleted implementation schedule or uncompleted plans for improvements that will affect the wastewater treatment, effluent quality, or design capacity of the treatment works. If the treatment works has several different implementation schedules or is planning several improvements, submit separate responses to question B.5 for each. (If none, go to question B.6.) NONE

a. List the outfall number (assigned in question A.9) for each outfall that is covered by this implementation schedule.

b. Indicate whether the planned improvements or implementation schedule are required by local, State, or Federal agencies.

☐ Yes ☐ No

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

- c. If the answer to B.5.b is "Yes," briefly describe, including new maximum daily inflow rate (if applicable).

- d. Provide dates imposed by any compliance schedule or any actual dates of completion for the implementation steps listed below, as applicable. For improvements planned independently of local, State, or Federal agencies, indicate planned or actual completion dates, as applicable. Indicate dates as accurately as possible.

Implementation Stage	Schedule	Actual Completion
	MM / DD / YYYY	MM / DD / YYYY
- Begin construction	___/___/___	___/___/___
- End construction	___/___/___	___/___/___
- Begin discharge	___/___/___	___/___/___
- Attain operational level	___/___/___	___/___/___

- e. Have appropriate permits/clearances concerning other Federal/State requirements been obtained? ☐ Yes ☐ No

Describe briefly: _____

B.6. EFFLUENT TESTING DATA (GREATER THAN 0.1 MGD ONLY).

Applicants that discharge to waters of the US must provide effluent testing data for the following parameters. Provide the indicated effluent testing required by the permitting authority for each outfall through which effluent is discharged. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. At a minimum, effluent testing data must be based on at least three pollutant scans and must be no more than four and one-half years old.

Outfall Number: 1

POLLUTANT	MAXIMUM DAILY DISCHARGE		AVERAGE DAILY DISCHARGE			ANALYTICAL METHOD	ML / MDL
	Conc.	Units	Conc.	Units	Number of Samples		
CONVENTIONAL AND NONCONVENTIONAL COMPOUNDS.							
AMMONIA (as N)	1.27	mg/l	0.19	mg/l	35.00	SM4500-NH3 D	
CHLORINE (TOTAL RESIDUAL, TRC)	0.07	mg/l	0.04	mg/l	3.00	SM4500-CL G	
DISSOLVED OXYGEN	6.09	mg/l	5.83	mg/l	3.00	SM5210-O G-01	
TOTAL KJELDAHL NITROGEN (TKN)	8.40	mg/l	3.80	mg/l	3.00	D1426-93B	
NITRATE PLUS NITRITE NITROGEN	8.27	mg/l	5.26	mg/l	3.00	353.2	
OIL and GREASE	0.29	mg/l	0.96	mg/l	3.00	1664A	
PHOSPHORUS (Total)	7.32	mg/l	6.44	mg/l	3.00	365.3	
TOTAL DISSOLVED SOLIDS (TDS)	514.00	mg/l	494.60	mg/l	3.00	SM2540 C	
OTHER							

END OF PART B.

REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086**BASIC APPLICATION INFORMATION****PART C. CERTIFICATION**

All applicants must complete the Certification Section. Refer to instructions to determine who is an officer for the purposes of this certification. All applicants must complete all applicable sections of Form 2A, as explained in the Application Overview. Indicate below which parts of Form 2A you have completed and are submitting. By signing this certification statement, applicants confirm that they have reviewed Form 2A and have completed all sections that apply to the facility for which this application is submitted.

Indicate which parts of Form 2A you have completed and are submitting:

Basic Application Information packet

Supplemental Application Information packet:



Part D (Expanded Effluent Testing Data)



Part E (Toxicity Testing: Biomonitoring Data)



Part F (Industrial User Discharges and RCRA/CERCLA Wastes)



Part G (Combined Sewer Systems)

ALL APPLICANTS MUST COMPLETE THE FOLLOWING CERTIFICATION.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Name and official title Will Finn, MayorSignature *William A. Finn*Telephone number (360) 608-1615Date signed 12-19-16

Upon request of the permitting authority, you must submit any other information necessary to assess wastewater treatment practices at the treatment works or identify appropriate permitting requirements.

SEND COMPLETED FORMS TO:

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

SUPPLEMENTAL APPLICATION INFORMATION

PART D. EXPANDED EFFLUENT TESTING DATA

Refer to the directions on the cover page to determine whether this section applies to the treatment works.

Effluent Testing: 1.0 mgd and Pretreatment Treatment Works. If the treatment works has a design flow greater than or equal to 1.0 mgd or it has (or is required to have) a pretreatment program, or is otherwise required by the permitting authority to provide the data, then provide effluent testing data for the following pollutants. Provide the indicated effluent testing information and any other information required by the permitting authority for each outfall through which effluent is discharged. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analyses conducted using 40 CFR Part 136 methods. In addition, these data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136. Indicate in the blank rows provided below any data you may have on pollutants not specifically listed in this form. At a minimum, effluent testing data must be based on at least three pollutant scans and must be no more than four and one-half years old.

Outfall number: 1 (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
METALS (TOTAL RECOVERABLE), CYANIDE, PHENOLS, AND HARDNESS.											
ANTIMONY	.39	ug/l			0.32	ug/l			3	200.8	.02
ARSENIC	.50	ug/l			0.44	ug/l			3	200.8	.08
BERYLLIUM	.006	ug/l			.002	ug/l			3	200.8	.005
CADMIUM	.075	ug/l			.054	ug/l			3	200.8	.005
CHROMIUM	.26	ug/l			0.25	ug/l			3	200.8	.05
COPPER	15.2	ug/l			13.3	ug/l			3	200.8	.03
LEAD	0.31	ug/l			.217	ug/l			3	200.8	.004
MERCURY	1.6	ung/l			.903	ng/l			3	1631E	.06
NICKEL	1.76	ug/l			1.30	ug/l			3	200.8	.04
SELENIUM	.4	ug/l			..20	ug/l			3	200.8	.1
SILVER	.013	ug/l			.007	ug/l			3	200.8	.002
THALLIUM	.002	ug/l			.0006	ug/l			3	200.8	.002
ZINC	68.8	ug/l			63.2	ug/l			3	200.8	.07
CYANIDE	1.0	mg/l			.333	mg/l			3	335.4	.9
TOTAL PHENOLIC COMPOUNDS	10	mg/l			5	mg/l			3	420.1	4
HARDNESS (AS CaCO ₃)	110	mg/l			105	mg/l			3	SM2340B	n/a

Use this space (or a separate sheet) to provide information on other metals requested by the permit writer.

FACILITY NAME AND PERMIT NUMBER:

Form Approved 1/14/99
OMB Number 2040-0086

City of Woodland Waste Water Treatment Plant WA 0020401

Outfall number: 1 (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
VOLATILE ORGANIC COMPOUNDS.											
ACROLEIN	ND				ND				3	624	
ACRYLONITRILE	ND				ND				3	624	
BENZENE	ND				ND				3	624	
BROMOFORM	ND				ND				3	624	
CARBON TETRACHLORIDE	ND				ND				3	624	
CLOROBENZENE	ND				ND				3	624	
CHLORODIBROMO-METHANE	ND				ND				3	624	
CHLOROETHANE	.18	ug/l			.06	ug/l			3	624	.03
2-CHLORO-ETHYL VINYL ETHER	ND				ND				3	624	
CHLOROFORM	.24	ug/l			.23	ug/l			3	624	.036
DICHLOROBROMO-METHANE	ND				ND				3	624	
1,1-DICHLOROETHANE	ND				ND				3	624	
1,2-DICHLOROETHANE	ND				ND				3	624	
TRANS-1,2-DICHLORO-ETHYLENE	ND				ND				3	624	
1,1-DICHLOROETHYLENE	ND				ND				3	624	
1,2-DICHLOROPROPANE	ND				ND				3	624	
1,3-DICHLORO-PROPYLENE	ND				ND				3	624	
ETHYLBENZENE	ND				ND				3	624	
METHYL BROMIDE	ND				ND				3	624	
METHYL CHLORIDE	ND				ND				3	624	
METHYLENE CHLORIDE	ND				ND				3	624	
1,1,2,2-TETRACHLORO-ETHANE	ND				ND				3	624	
TETRACHLORO-ETHYLENE	ND				ND				3	624	
TOLUENE	.25	ug/l			.127	ug/l			3	624	.032

FACILITY NAME AND PERMIT NUMBER:

Form Approved 1/14/99
OMB Number 2040-0086

City of Woodland Waste Water Treatment Plant WA 0020401

Outfall number: 1 (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
1,1,1-TRICHLOROETHANE	ND	ug/l			ND	ug/l			3	624	5
1,1,2-TRICHLOROETHANE	ND	ug/l			ND	ug/l			3	624	5
TRICHLORETHYLENE	ND				ND				3	624	
VINYL CHLORIDE	ND	ug/l			ND	ug/l			3	624	5

Use this space (or a separate sheet) to provide information on other volatile organic compounds requested by the permit writer.

--	--	--	--	--	--	--	--	--	--	--	--

ACID-EXTRACTABLE COMPOUNDS

P-CHLORO-M-CRESOL	ND				ND				3	625	
2-CHLOROPHENOL	ND				ND				3	625	
2,4-DICHLOROPHENOL	.052	ug/l			.017	ug/l			3	625	.047
2,4-DIMETHYLPHENOL	ND				ND				3	625	
4,6-DINITRO-O-CRESOL	ND				ND				3	625	
2,4-DINITROPHENOL	ND				ND				3	625	
2-NITROPHENOL	ND				ND				3	625	
4-NITROPHENOL	ND				ND				3	625	
PENTACHLOROPHENOL	ND				ND				3	625	
PHENOL	.10	ug/l			.437	ug/l			3	625	.063
2,4,6-TRICHLOROPHENOL	.069	ug/l			.023	ug/l			3	625	.058

Use this space (or a separate sheet) to provide information on other acid-extractable compounds requested by the permit writer.

--	--	--	--	--	--	--	--	--	--	--	--

BASE-NEUTRAL COMPOUNDS.

ACENAPHTHENE	ND				ND				3	625	
ACENAPHTHYLENE	ND				ND				3	625	
ANTHRACENE	.024	ug/l			.008	ug/l			3	625	.024
BENZIDINE	ND				ND				3	625	
BENZO(A)ANTHRACENE	ND				ND				3	625	
BENZO(A)PYRENE	ND				ND				3	625	

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

Outfall number: 1 (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
3,4 BENZO-FLUORANTHENE	ND				ND				3	625	
BENZO(GH)PERYLENE	ND				ND				3	625	
BENZO(K)FLUORANTHENE	ND				ND				3	625	
BIS (2-CHLOROETHOXY) METHANE	ND				ND				3	625	
BIS (2-CHLOROETHYL)-ETHER	ND				ND				3	625	
BIS (2-CHLOROISO-PROPYL) ETHER	ND				ND				3	625	
BIS (2-ETHYLHEXYL) PHTHALATE	7.0				2.48	ug/l			3	625	.13
4-BROMOPHENYL PHENYL ETHER	ND				ND				3	625	
BUTYL BENZYL PHTHALATE	.038				.012	ug/l			3	625	.018
2-CHLORONAPHTHALENE	ND				ND				3	625	
4-CHLORPHENYL PHENYL ETHER	ND				ND				3	625	
CHRYSENE	ND				ND				3	625	
DI-N-BUTYL PHTHALATE	.097	ug/l			.065	ug/l			3	625	.023
DI-N-OCTYL PHTHALATE	.043	ug/l			.014	ug/l			3	625	.018
DIBENZO(A,H) ANTHRACENE	ND				ND				3	625	
1,2-DICHLOROBENZENE	ND				ND				3	625	
1,3-DICHLOROBENZENE	ND	u			ND				3	625	
1,4-DICHLOROBENZENE	.13	ug/l			.12	ug/l			3	625	.073
3,3-DICHLOROBENZIDINE	ND				ND				3	625	
DIETHYL PHTHALATE	.059	ug/l			.047	ug/l			3	625	.012
DIMETHYL PHTHALATE	ND				ND				3	625	
2,4-DINITROTOLUENE	ND				ND				3	625	
2,6-DINITROTOLUENE	ND				ND				3	625	
1,2-DIPHENYLHYDRAZINE	ND				ND				3	625	

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

Outfall number: 1 (Complete once for each outfall discharging effluent to waters of the United States.)

POLLUTANT	MAXIMUM DAILY DISCHARGE				AVERAGE DAILY DISCHARGE					ANALYTICAL METHOD	ML/ MDL
	Conc.	Units	Mass	Units	Conc.	Units	Mass	Units	Number of Samples		
FLUORANTHENE	.026	ug/l			.008	ug/l			3	625	.020
FLUORENE	ND	ug/l							3	625	
HEXACHLOROBENZENE	ND	ug/l							3	625	
HEXACHLOROBUTADIENE	ND	ug/l							3	625	
HEXACHLOROCYCLO-PENTADIENE	ND	ug/l							3	625	
HEXACHLOROETHANE	ND	ug/l							3	625	
INDENO(1,2,3-CD)PYRENE	ND	ug/l							3	625	
ISOPHORONE	.039	ug/l			.035	ug/l			3	625	.016
NAPHTHALENE	.064	ug/l			.021	ug/l			3	625	.022
NITROBENZENE	ND	ug/l							3	625.00	
N-NITROSODI-N-PROPYLAMINE	ND	ug/l							3	625	
N-NITROSODI- METHYLAMINE	ND	ug/l							3	625	
N-NITROSODI-PHENYLAMINE	ND	ug/l							3	625	
PHENANTHRENE	.026	ug/l			.008	ug/l			3	625	.022
PYRENE	.022	ug/l			.007	ug/l			3	625	.019
1,2,4-TRICHLOROBENZENE	ND	ug/l							3	625	

Use this space (or a separate sheet) to provide information on other base-neutral compounds requested by the permit writer.

Use this space (or a separate sheet) to provide information on other pollutants (e.g., pesticides) requested by the permit writer.

END OF PART D.
REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

SUPPLEMENTAL APPLICATION INFORMATION

PART E. TOXICITY TESTING DATA

POTWs meeting one or more of the following criteria must provide the results of whole effluent toxicity tests for acute or chronic toxicity for each of the facility's discharge points: 1) POTWs with a design flow rate greater than or equal to 1.0 mgd; 2) POTWs with a pretreatment program (or those that are required to have one under 40 CFR Part 403); or 3) POTWs required by the permitting authority to submit data for these parameters.

- At a minimum, these results must include quarterly testing for a 12-month period within the past 1 year using multiple species (minimum of two species), or the results from four tests performed at least annually in the four and one-half years prior to the application, provided the results show no appreciable toxicity, and testing for acute and/or chronic toxicity, depending on the range of receiving water dilution. Do not include information on combined sewer overflows in this section. All information reported must be based on data collected through analysis conducted using 40 CFR Part 136 methods. In addition, this data must comply with QA/QC requirements of 40 CFR Part 136 and other appropriate QA/QC requirements for standard methods for analytes not addressed by 40 CFR Part 136.
- In addition, submit the results of any other whole effluent toxicity tests from the past four and one-half years. If a whole effluent toxicity test conducted during the past four and one-half years revealed toxicity, provide any information on the cause of the toxicity or any results of a toxicity reduction evaluation, if one was conducted.
- If you have already submitted any of the information requested in Part E, you need not submit it again. Rather, provide the information requested in question E.4 for previously submitted information. If EPA methods were not used, report the reasons for using alternate methods. If test summaries are available that contain all of the information requested below, they may be submitted in place of Part E.

If no biomonitoring data is required, do not complete Part E. Refer to the Application Overview for directions on which other sections of the form to complete.

E.1. Required Tests.

Indicate the number of whole effluent toxicity tests conducted in the past four and one-half years.

____ chronic ____ acute

E.2. Individual Test Data. Complete the following chart for each whole effluent toxicity test conducted in the last four and one-half years. Allow one column per test (where each species constitutes a test). Copy this page if more than three tests are being reported.

Test number: _____ Test number: _____ Test number: _____

a. Test information.

Test species & test method number			
Age at initiation of test			
Outfall number			
Dates sample collected			
Date test started			
Duration			

b. Give toxicity test methods followed.

Manual title			
Edition number and year of publication			
Page number(s)			

c. Give the sample collection method(s) used. For multiple grab samples, indicate the number of grab samples used.

24-Hour composite			
Grab			

d. Indicate where the sample was taken in relation to disinfection. (Check all that apply for each)

Before disinfection			
After disinfection			
After dechlorination			

FACILITY NAME AND PERMIT NUMBER:

Form Approved 1/14/99
OMB Number 2040-0086

City of Woodland Waste Water Treatment Plant WA 0020401

Test number: _____

Test number: _____

Test number: _____

e. Describe the point in the treatment process at which the sample was collected.

Sample was collected:

f. For each test, include whether the test was intended to assess chronic toxicity, acute toxicity, or both.

Chronic toxicity

Acute toxicity

g. Provide the type of test performed.

Static

Static-renewal

Flow-through

h. Source of dilution water. If laboratory water, specify type; if receiving water, specify source.

Laboratory water

Receiving water

i. Type of dilution water. If salt water, specify "natural" or type of artificial sea salts or brine used.

Fresh water

Salt water

j. Give the percentage effluent used for all concentrations in the test series.

k. Parameters measured during the test. (State whether parameter meets test method specifications)

pH

Salinity

Temperature

Ammonia

Dissolved oxygen

l. Test Results.

Acute:

Percent survival in 100%
effluent

%

%

%

LC₅₀

95% C.I.

%

%

%

Control percent survival

%

%

%

Other (describe)

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086**Chronic:**

NOEC	%	%	%
IC ₂₅	%	%	%
Control percent survival	%	%	%
Other (describe)			

m. Quality Control/Quality Assurance.

Is reference toxicant data available?			
Was reference toxicant test within acceptable bounds?			
What date was reference toxicant test run (MM/DD/YYYY)?			
Other (describe)			

E.3. Toxicity Reduction Evaluation. Is the treatment works involved in a Toxicity Reduction Evaluation?☐ Yes ☒ No

If yes, describe: _____

E.4. Summary of Submitted Biomonitoring Test Information. If you have submitted biomonitoring test information, or information regarding the cause of toxicity, within the past four and one-half years, provide the dates the information was submitted to the permitting authority and a summary of the results.Date submitted: 06/17/2016 (MM/DD/YYYY)

Summary of results: (see instructions)

Whole Eff. Toxicity Report submitted to DOE on 10/1/2016. Acute Toxicity USEPA(2002a)Chronic Toxicity USEPA(2002b) 1 outfall, sample dates: 6-15-15 & 1-8-16**END OF PART E.****REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE.**

Form Approved 1/14/99
OMB Number 2040-0086

SUPPLEMENTAL APPLICATION INFORMATION

All treatment works receiving discharges from significant industrial users or which receive RCRA, CERCLA, or other remedial wastes must complete Part F.

Yes ☒ No

b. Number of CIUs.	16.00
--------------------	-------

Mailing Address: 350 South Pekin Rd Woodland WA 98674

Slaughterhouse and meat packing plant

Raw material(s): Cattle

50,270.00 gpd (☒ continuous or ☐ intermittent)

_____ gpd (_____ continuous or _____ intermittent)

b. Categorical pretreatment standards Yes ☒ No

Page 18 of 21

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086**F.8. Problems at the Treatment Works Attributed to Waste Discharged by the SIU.** Has the SIU caused or contributed to any problems (e.g., upsets, interference) at the treatment works in the past three years?☐ Yes ☒ No

If yes, describe each episode.

RCRA HAZARDOUS WASTE RECEIVED BY TRUCK, RAIL, OR DEDICATED PIPELINE:**F.9. RCRA Waste.** Does the treatment works receive or has it in the past three years received RCRA hazardous waste by truck, rail, or dedicated pipe? ☐ Yes ☒ No (go to F.12.)**F.10. Waste Transport.** Method by which RCRA waste is received (check all that apply):☐ Truck ☐ Rail ☐ Dedicated Pipe**F.11. Waste Description.** Give EPA hazardous waste number and amount (volume or mass, specify units).EPA Hazardous Waste NumberAmountUnits**CERCLA (SUPERFUND) WASTEWATER, RCRA REMEDIATION/CORRECTIVE ACTION WASTEWATER, AND OTHER REMEDIAL ACTIVITY WASTEWATER:****F.12. Remediation Waste.** Does the treatment works currently (or has it been notified that it will) receive waste from remedial activities?☐ Yes (complete F.13 through F.15.)☒ No

Provide a list of sites and the requested information (F.13 - F.15.) for each current and future site.

F.13. Waste Origin. Describe the site and type of facility at which the CERCLA/RCRA/or other remedial waste originates (or is expected to originate in the next five years).**F.14. Pollutants.** List the hazardous constituents that are received (or are expected to be received). Include data on volume and concentration, if known. (Attach additional sheets if necessary).**F.15. Waste Treatment.****a.** Is this waste treated (or will it be treated) prior to entering the treatment works?☐ Yes ☐ No

If yes, describe the treatment (provide information about the removal efficiency):

b. Is the discharge (or will the discharge be) continuous or intermittent?☐ Continuous☐ Intermittent

If intermittent, describe discharge schedule.

END OF PART F.**REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE**

FACILITY NAME AND PERMIT NUMBER:

City of Woodland Waste Water Treatment Plant WA 0020401

Form Approved 1/14/99
OMB Number 2040-0086

SUPPLEMENTAL APPLICATION INFORMATION

PART G. COMBINED SEWER SYSTEMS

If the treatment works has a combined sewer system, complete Part G.

G.1. System Map. Provide a map indicating the following: (may be included with Basic Application Information)

- Part G Not Applicable
- All CSO discharge points.
 - Sensitive use areas potentially affected by CSOs (e.g., beaches, drinking water supplies, shellfish beds, sensitive aquatic ecosystems, and outstanding natural resource waters).
 - Waters that support threatened and endangered species potentially affected by CSOs.

G.2. System Diagram. Provide a diagram, either in the map provided in G.1. or on a separate drawing, of the combined sewer collection system that includes the following information:

- Locations of major sewer trunk lines, both combined and separate sanitary.
- Locations of points where separate sanitary sewers feed into the combined sewer system.
- Locations of in-line and off-line storage structures.
- Locations of flow-regulating devices.
- Locations of pump stations.

CSO OUTFALLS:

Complete questions G.3 through G.6 once for each CSO discharge point.

G.3. Description of Outfall.

- Outfall number _____
- Location _____
(City or town, if applicable) (Zip Code)

(County) (State)

(Latitude) (Longitude)
- Distance from shore (if applicable) _____ ft.
- Depth below surface (if applicable) _____ ft.
- Which of the following were monitored during the last year for this CSO?
 ____ Rainfall ____ CSO pollutant concentrations ____ CSO frequency
 ____ CSO flow volume ____ Receiving water quality
- How many storm events were monitored during the last year? _____

G.4. CSO Events.

- Give the number of CSO events in the last year.
_____ events (____ actual or ____ approx.)
- Give the average duration per CSO event.
_____ hours (____ actual or ____ approx.)

FACILITY NAME AND PERMIT NUMBER:Form Approved 1/14/99
OMB Number 2040-0086

City of Woodland Waste Water Treatment Plant WA 0020401

- c. Give the average volume per CSO event.
_____ million gallons (_____ actual or _____ approx.)
- d. Give the minimum rainfall that caused a CSO event in the last year.
_____ inches of rainfall


G.5. Description of Receiving Waters.

- a. Name of receiving water: _____
- b. Name of watershed/river/stream system: _____
- United States Soil Conservation Service 14-digit watershed code (if known): _____
- c. Name of State Management/River Basin: _____
- United States Geological Survey 8-digit hydrologic cataloging unit code (if known): _____

G.6. CSO Operations.


Describe any known water quality impacts on the receiving water caused by this CSO (e.g., permanent or intermittent beach closings, permanent or intermittent shell fish bed closings, fish kills, fish advisories, other recreational loss, or violation of any applicable State water quality standard).

END OF PART G.
REFER TO THE APPLICATION OVERVIEW TO DETERMINE WHICH OTHER PARTS OF FORM 2A YOU MUST COMPLETE.

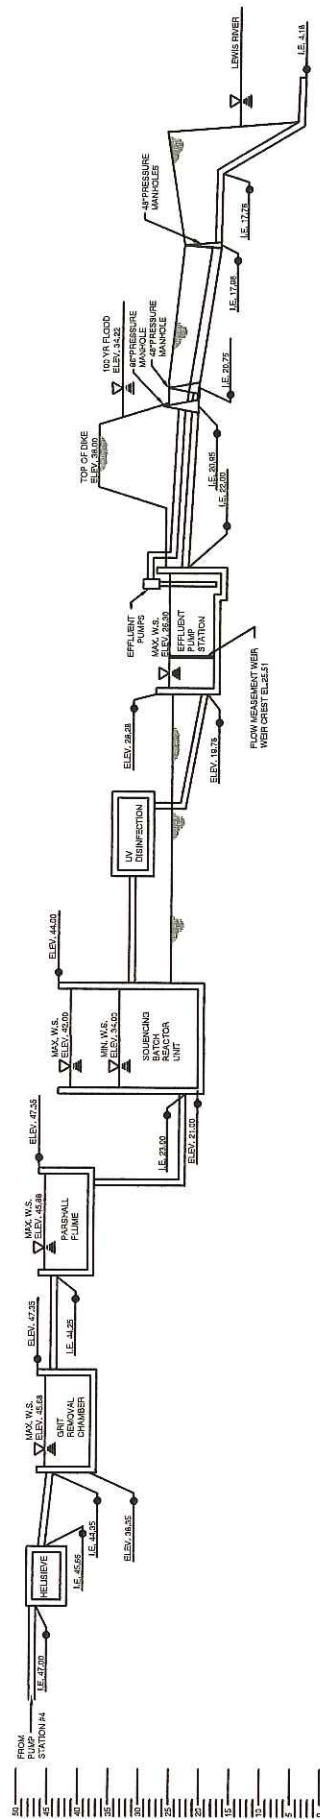

WWTP Hydraulic Profile

N.T.S.

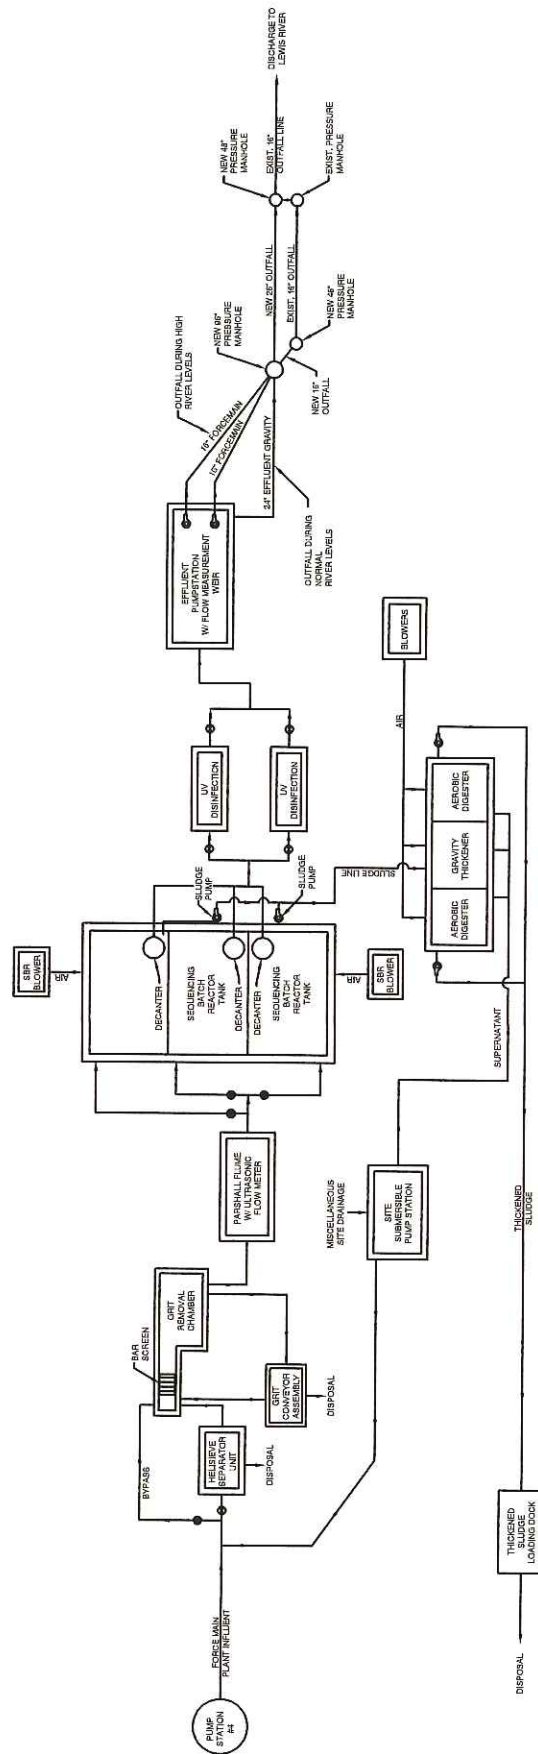


WWTP Flow Schematic

N.T.S.




Scale: 1"=60'

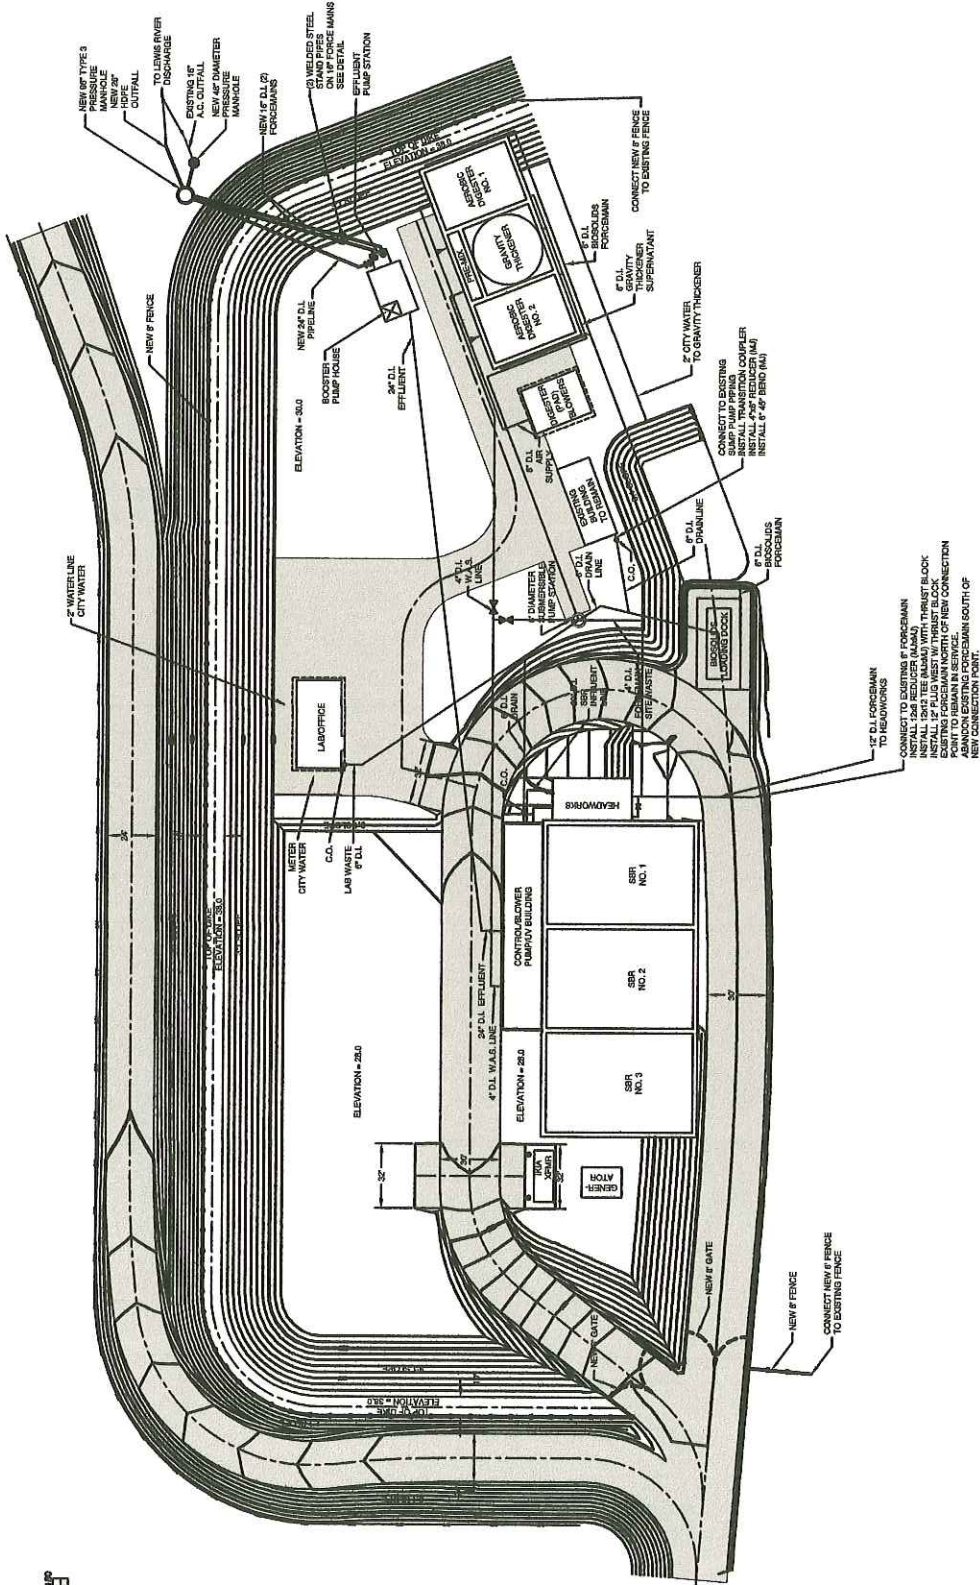

GIBBS & OLSON INC.
Engineers • Planners • Surveyors
LONGVIEW • OLYMPIA
WASHINGTON

City of Woodland
Wastewater Treatment Plant
Site Plan
NPDES Permit Application

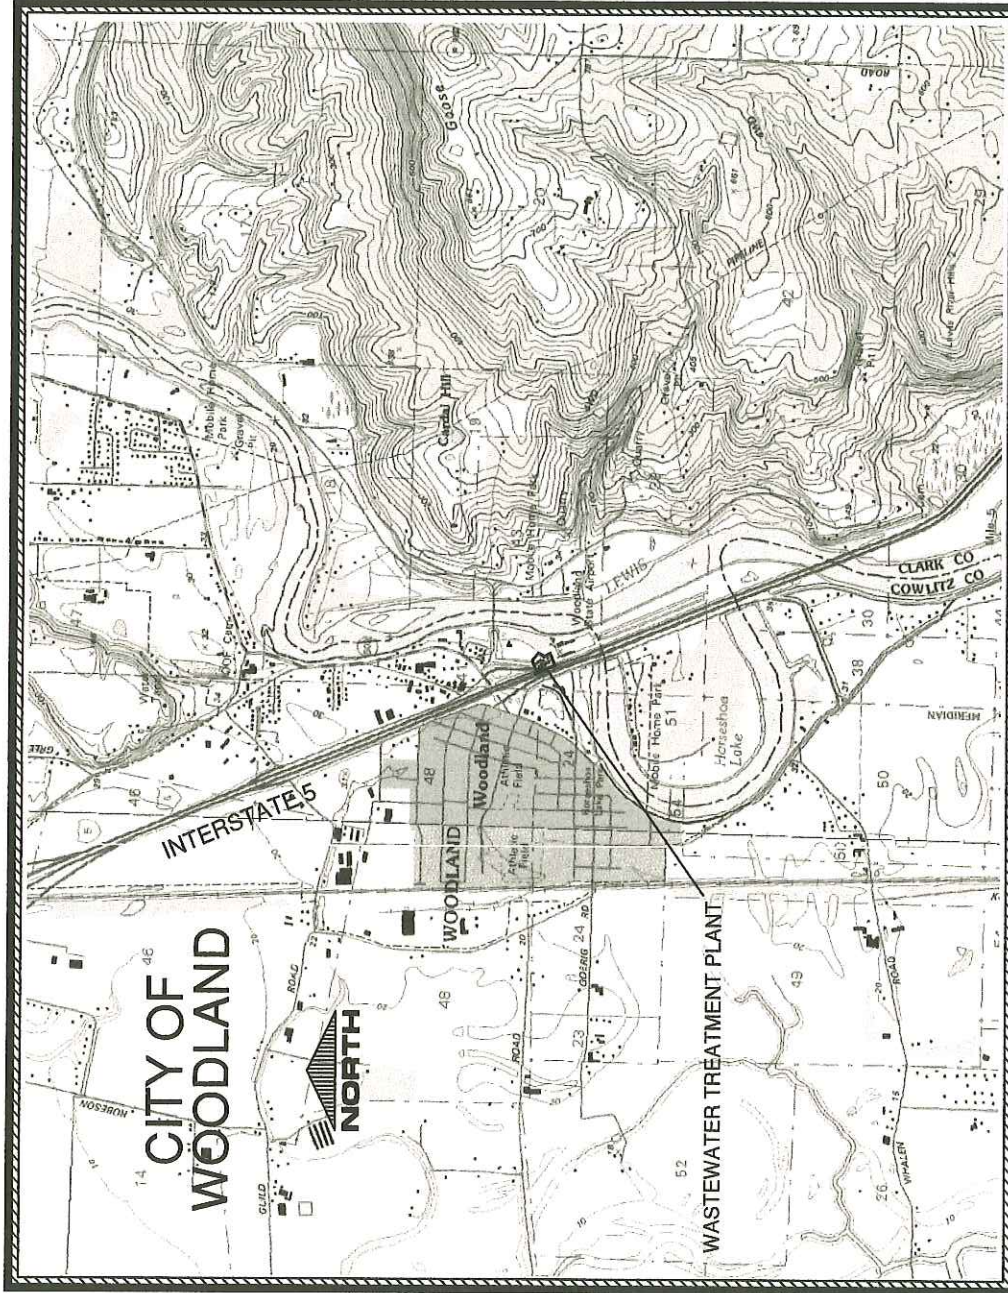

Contour Map

Scale: 1" = 2000'